
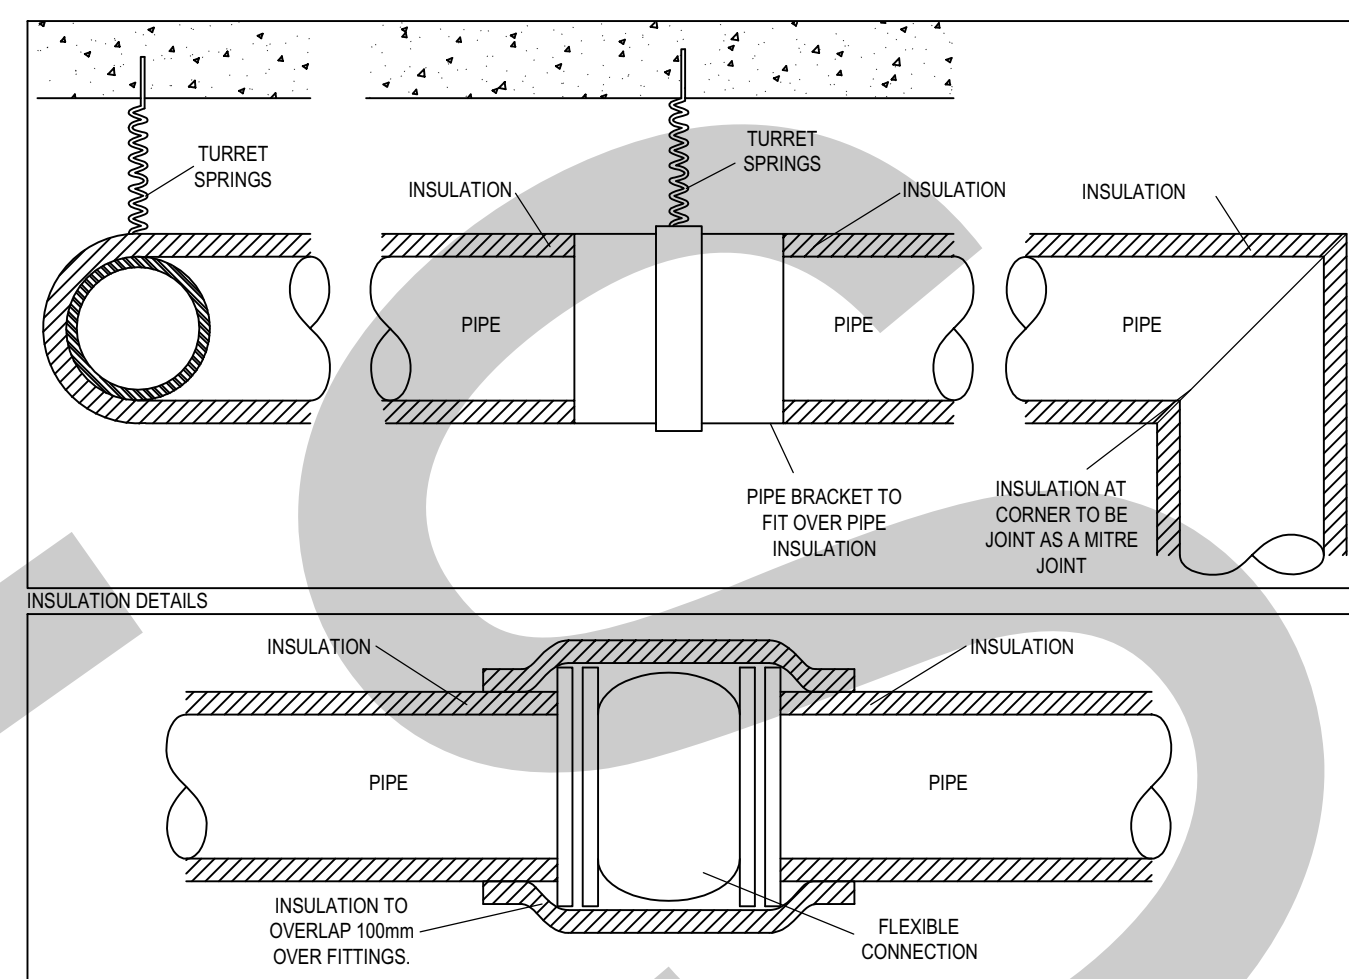


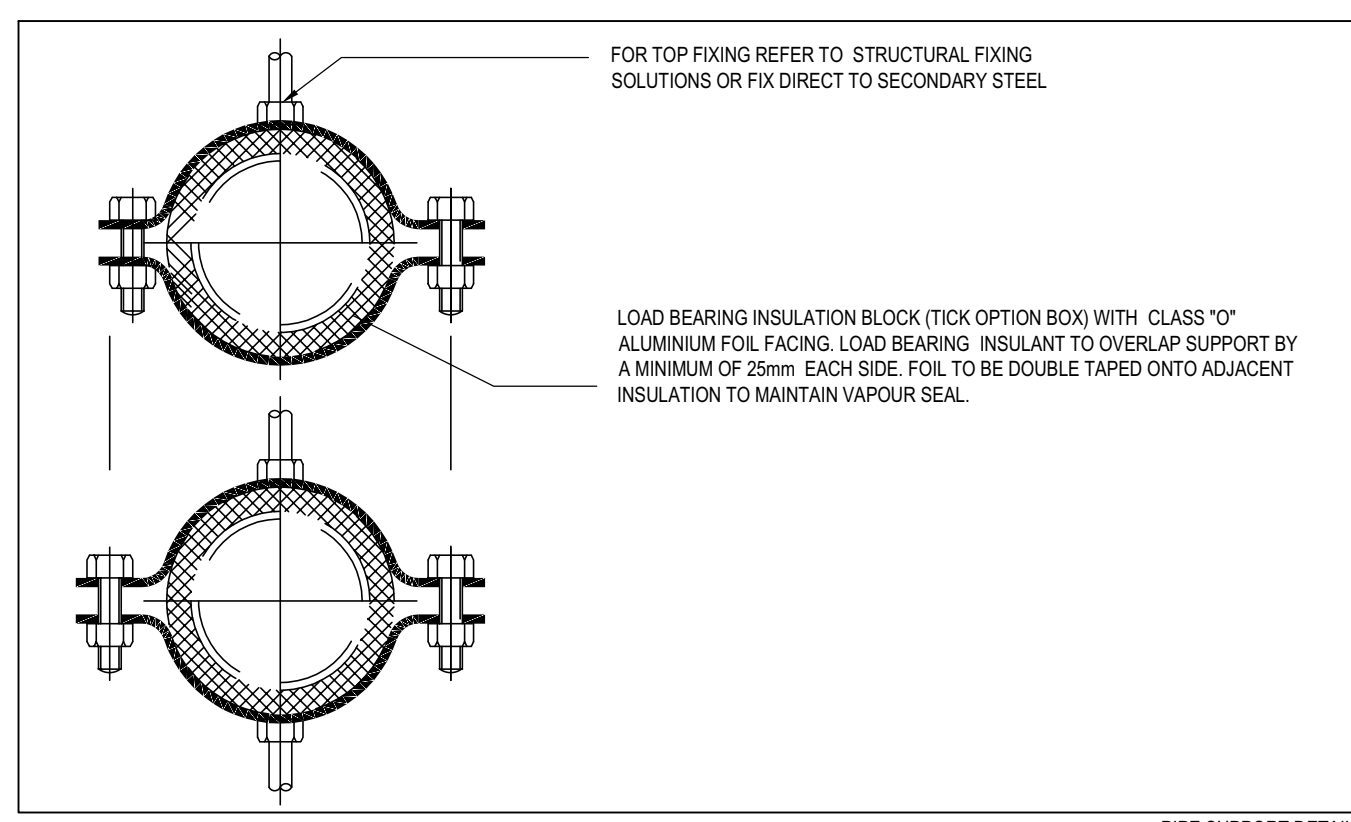

- HEATING RISER CUPBOARDS ARE TO BE VENTILATED TO EXTERNAL AT THE TOP.
- ALL PIPEWORK HIGH POINTS ARE TO BE VENTILATED AND LOW POINTS ARE TO BE FITTED WITH DRAIN OFF COCKS.

NOTE: ALL PIPE WORK AND FITTINGS TO BE INSULATED AS PER THE SPECIFICATION, GENERALLY WITH THE FOLLOWING MINIMUM THICKNESS:

PIPE SIZE (mm)	MIN. INSULATION THICKNESS	
	MINERAL WOOL (mm)	PHENOLIC FOAM (mm)
15	30	15
20	30	15
25	35	20
32	35	20
40	35	20
50	40	25
65	40	25
80	40	25
100	45	25
125	45	30
150	45	30
200	50	30
250	50	30

NOTE: ALL PIPE WORK AND FITTINGS TO BE INSULATED AS

