




Typical Installation Details



Safety Discharge Detail

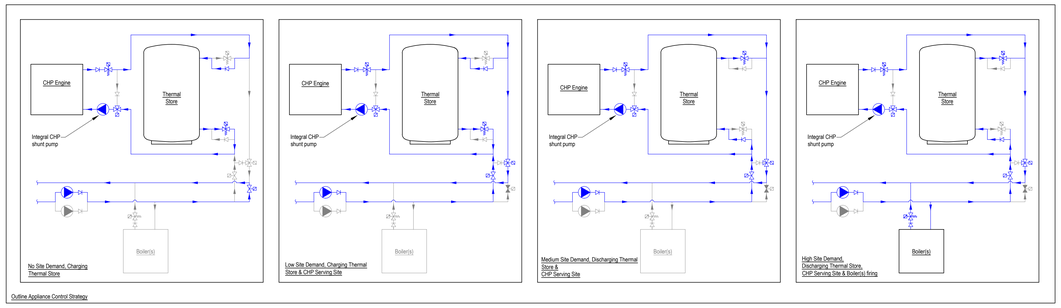



Outline Appliance Control Strategy

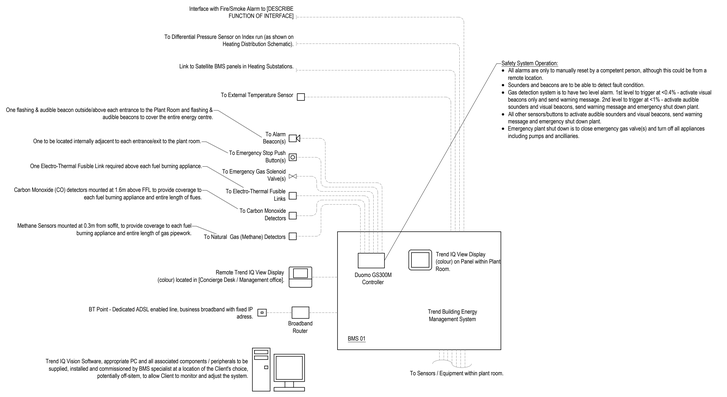



Safety System Operation:


- All alarms are only to manually reset by a competent person, although this could be from a remote location.
- Sounders and beacons are to be able to detect fault condition.
- Gas detection system is to have two level alarm. 1st level to trigger at <0.4% - activate visual beacons only and send warning message. 2nd level to trigger at <1% - activate audible sounders and visual beacons, send warning message and emergency shut down plant.
- All other sensors/buttons to activate audible sounders and visual beacons, send warning message and emergency shut down plant.
- Emergency plant shut down is to close emergency gas valve(s) and turn off all appliances including pumps and ancillaries.

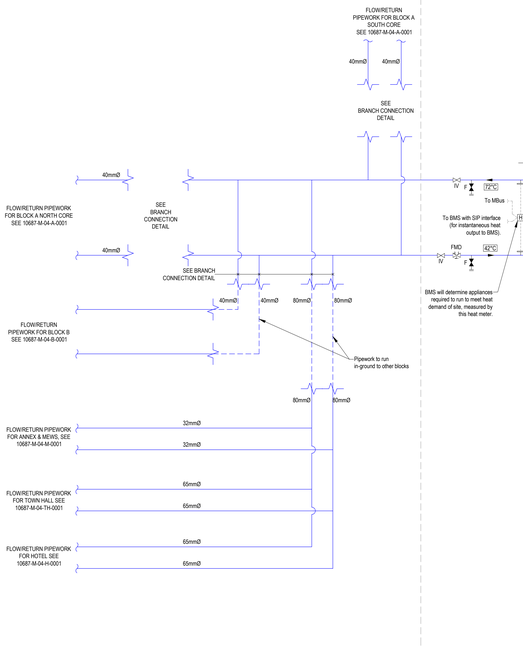

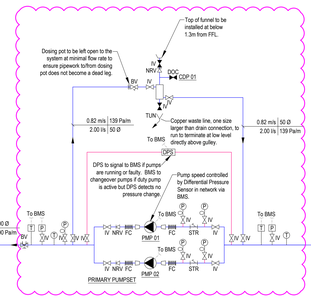


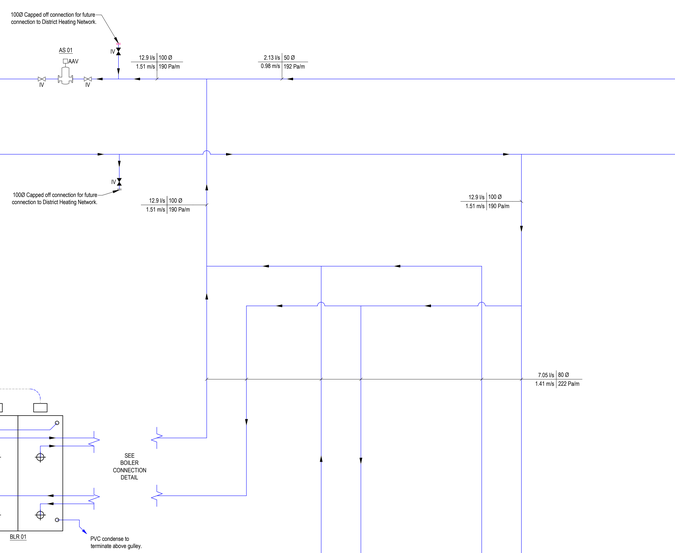

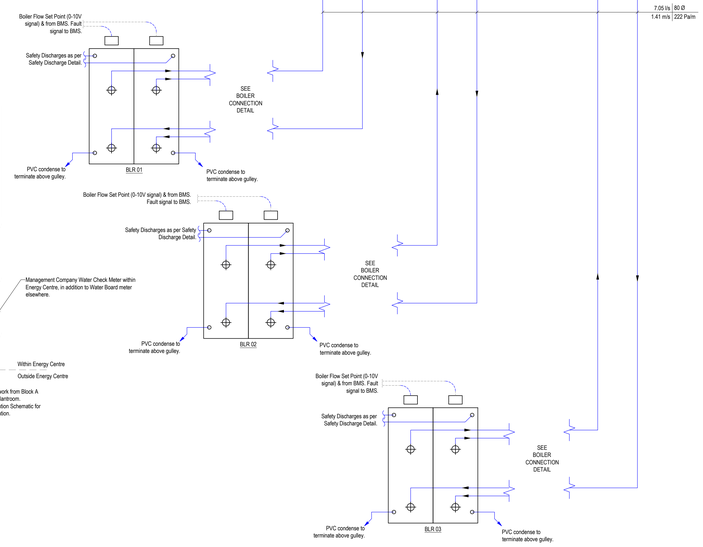

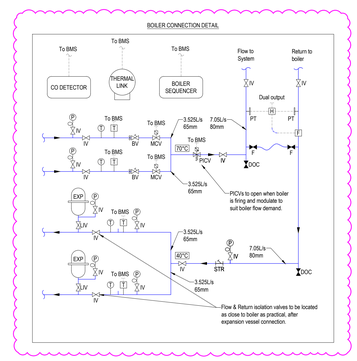

BRANCH CONNECTIONS DETAIL

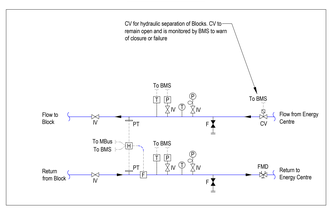

Plant Schedule					
Plant Ref.	Duty	Description	Manufacturer / Supplier	Product Range	Product Ref
AS 01	Full In-Line Flow	Smart Microbubble Air Separator with Compressed Particle Extractor and automatic air vent.	Flamco	Flamcovent	Flamcovent Smart 100 F
BLR 01-03	873.4 kW max output per boiler	Operating as Duty / Assist / Standby arrangement.	Hoval	Ultragas	900D
BMS 01	-	Management system with both local and remote maintenance access to ensure all plant can operate as intended and raise a fault alarm, including an automatic email message, should an item of plant become faulty. Incorporated safety system as noted.	Safe and Sound Controls	Trend	-
CDP 01	25 Litre	Wall Mounted chemical dosing pot with funnel, non-return valve on fill line and air release valve.	ESG Waterwise	DP	DP25
CHP 01	50 kWe, 93 kWth	Natural gas fired Combined Heat and Power unit with acoustic enclosure, anti-vibration mounts.	Remeha	Dachs R.Gen	50/100 NG
DS 01	Full In-Line Flow	Smart Dirt Separator with Compressed Particle Extractor, supermagnets, dirt collector, double scraper and drain off.	Flamco	Clean Smart	Flamco Clean Smart 100 F
EPF 01	3.14 bar minimum pressure, 3.84 bar final pressure	Pressure maintenance, pump driven expansion provision, vacuum degassing and water make up.	IMI Hydronic	TV 8.2 EH Tectrox Degassing SD 50.10 Buffer Vessel TU500 Primary Vessel P ABS Pleno Make-Up Tectrox	-
PMP 01	12.9 l/s @ 271 kPA / Pump	Single head variable speed pumpset, including built-in frequency converter. Operating as Duty/Standby. Installed on Inertia bases.	Grundfos	TPE 65-340/2	99113943
PMP 02					
SSF 01	6.97 m³/hr filtration	Skid mounted solidstream filtration package with closed recovery system, bag filtration, and insulation kit. Bag filter to be reduced to 5 micron bags before system is handed over.	Socotec	CSF Filter with CRS dirt recovery system	CSF10/CRS/1/01W
TLS 01	3000 litres usable volume	Mild steel fully insulated Buffer Vessel/Thermal Store provided with baffle plates/spargre pipe installed on both connections, manhole for access and extended temperature pockets as shown. Baffle plate / Spargre pipes to ensure a maximum velocity of <0.3m/s. Minimum height to diameter ratio of 2, preferably 3 or higher.	Ormandy	Storage Calorifier	3000 litres

Copyright, Designs and Patents Act 1988
The copyright & design right of the design documents & of the design remains that of Whitecode Ltd. All copies are only for the purpose of the application, they may not be used for any other purpose or copied without the express written permission of Whitecode Ltd.

Conflicts of Information
It will remains the responsibility of the Installer/contractor to ensure that there are no conflicts with information provided by ourselves & that of any manufacturers information or relevant requirements of statuary Bodies or Client specification/EIr. If any conflicts do exist it is the responsibility of the Installer/Contractor to inform The Consultant/Client immediately Verbally & in writing.

NOTICE TO HOUSE PURCHASERS - Property Misdescriptions Act 1991
The Contractor is warned that this is a working drawing and is not intended to be treated as descriptive material describing, in relation to any descriptive material describing, in relation to any descriptive particular property or development, any of the Specific Matters prescribed by an Order made under the above Act. The contents of this drawing may be subject to change at any time & alterations and variations can occur during the progress of the works without revision of the drawing. Consequently, all dimensions, levels & dimensions of the finished construction may differ materially from those shown. No rely on the contents of this drawing constitute a contract, part of any contract or a warranty.

General Notes

- Before commencing work on site, please read Design Risk Management Information.
- All manufacturer's instructions to be reviewed prior to installation.
- This drawing is to be read in conjunction with all schematics, details and specification documents.
- Dimensioned setting out details to be confirmed by architect.
- All dimensions are to be queried with WDA at Tender stage and before works commence.
- Any information believed to be missing is to be queried with WDA at Tender stage and before works commence.
- All items are to be installed in a way that they can be used and maintained correctly in line with manufacturer's instructions, including local mechanical and electrical isolation for removal of individual items without draining down other portions of the system.
- All items are to be installed in locations that can be safely accessed and maintained without the need for temporary scaffolding, steps or ladders.
- All controls (both as part of BMS and individual appliances) are to incorporate the appropriate time delays and/or proven signals to ensure safe and intended operation of the system and to avoid sporadic operation, "cycling" or "hunting".

Pipework / Valves Notes

- All dead legs (where flow does not occur under normal circumstances) must be no longer than 3x pipe diameter.
- Heating pipe work high points are to be vented with automatic air vents (AAVs), or shall be manually vented where not possible.
- Where pipes and ducts need to drop/rise, each individual high point must be fitted with an AAV.
- All moving items of equipment are to be installed on Anti-vibration mounts and have flexible connections.
- All sensors & gauges to be installed in steady flow conditions.
- Padlocks for lockable isolation valves to be provided by installing Contractor with suited keys and the padlock/valve labelled as "Do not isolate".

Insulation Notes

- All heating and water pipework as well as associated valves within then energy centre are to be fully insulated throughout.
- Pipe clips are to be installed around a section of load bearing insulation such as Rockwool Duraflex / ProRox, to prevent heat transmission through the pipe fixing.
- All heating and water valves within the energy centre are to be fully insulated throughout in a valve box, overlapping the pipe insulation either side of the valve. Extended valve handles are to be fitted to allow use of the valve without removal of the insulation box.
- All equipment that can be insulated in line with Manufacturer requirements is to be insulated.
- All drains and vent points (including those on pieces of equipment) are to be extended to be clear of insulation, to ensure correct operation without removal of insulation.
- All insulation within the energy centre is to be mineral wool and clad in dimpled aluminium.

Firestopping & Fire Safety Notes

- Where any items larger than 40mm penetrate a fire compartment element the item is to be fitted with a fire collar with a rating to match the compartment being penetrated. The fire collar must be installed in line with manufacturer's requirements.

Electrical Notes

- All wiring connections are to be completed in a manner that does not restrict the operation or maintenance of all components of all equipment.
- All individual items of equipment are to have individual electrical isolation.
- Any item that is required to be removed for maintenance or servicing shall be wired with a removable electrical connection in a readily accessible location.
- All electrical items within the plant room or gas meter room are to be suitable for Hazardous Zone 2.
- All electrical items within the plant room or gas meter room are to be at least IP54 rated.

Certification / Qualification Notes

- The BMS must be supplied, installed and commissioned by a Trend TTC Registered company such as Safe and Sound Control Systems Ltd.

LEGEND

VALVES

IV	Valve normally open / Valve normally closed respectively.
AAV	Air Admittance Valve, minimum 25mm within energy centre.
ABV	Automatic Bypass Valve, to open when pressure increases.
BV	Balancing Valve - with measuring points & hand wheel for positive shut off from IMI Hydronics STAF range.
BV	Balancing Valve, with self-sealing measuring points and positive shut-off, from IMI Hydronics STAF range.
CV	2-port butterfly-type control valve.
DOC	Drain Off Cock - Bronze Gland Pattern valve by Hattersley.
DV	3-Port Diverter Valve.
FMD	Flow Measuring Device, as per BVIIV but solely for the purpose of Flow measurement and isolation only. Valve to be left fully open.
F	Isolation Valve for Flushing Equipment Connection - as per IV, capped off. Line size or 54mm, whichever is smaller.
IV	Isolation Valve - Full bore ball valve with quarter turn lever (below 50mm) or Butterfly valve with lever operator (50mm and above) by Hattersley.
LIV	Lockable Isolation Valve - as per IV, with provision for padlock.
MCV	2-port seat-type modulating control valve.
MV	3-Port seat-type mixing valve.
NRV	Non-Return Valve.
PICV	Pressure Independent Control Valve - with measuring points and modulating control from IMI Hydronics FUSION range.
RPZ	Reduced Pressure Zone valve.
SV	Safety Valve, high lift type, fixed relief setting (not adjustable).
VAC	Automatic Anti-Vacuum Valve.

FITTINGS

	Change in Pipe Size.
EXP	Expansion Vessel.
FC	Flexible Connection, Unbid rubber bellow from Page Pipeline Supplies UTB range.
FH	Flexible Hose, metal braided.
FMD	Flow Measuring Orifice from IMI Hydronics MDFO range.
	Single Head Pump.
STR	Strainer - Y-type strainer, stainless steel screen, ≤DN25 with ≤0.75mm mesh. ≥DN32 with ≤1.5mm mesh, from Hattersley.
TUN	Tundish.

SENSORS/GAUGES

DPS	Differential Pressure Sensor.
F	Flow Sensor, as supplied with heat meter.
H	Heat Meter, ultrasonic with communication options as labelled, from Danfoss Sonometer 1100 range.
P IV	Analogue Pressure Gauge, Bourdon tube type, 150mm gauge diameter, 3/8" connection, with syphon loop and isolation valve.
P	Digital Pressure Sensor.
PT	Temperature Probe Pocket.
T	Analogue Temperature Gauge, Bi-metal type, 100mm gauge diameter, either in pocket or with isolation valve from Brannon Thermometers.
T	Digital Temperature Sensor, in 1/2" pocket or with isolation valve, accurate to at least 0.25K.

FLOW RATE	PIPE SIZE	Pipe Flow Characteristics
VELOCITY	PRESSURE DROP	

Rev	Date	Description	Drwn	Chkd
C4	26.07.2021	Boiler valves amended. Pump relocated. C4 and C5 revisions collated to issue to AP	EJ	AH
C3	24.03.2021	Updated to include Mews & Annex addition	EJ	AH
C2	17.02.2020	Construction Issue	JC	NC
C1	13.12.2019	Construction Issue	MDJ	JC
P1	15.11.2019	Preliminary Issue	MDJ	JC

Current purpose: CONSTRUCTION | Scale: NTS | Size: A0
Original Issue Date: 15.11.2019 | Drwn: MDJ | Chkd: JC

WHITECODE CONSULTING
BUILDING SERVICES DESIGN CONSULTANTS
26-27 The Hill, Northfleet, Gravesend Kent, DA11 9EU
www.whitecode.co.uk
T: 01322 289977 E: design@whitecode.co.uk

Title:
ENERGY CENTRE SCHEMATIC

Project:
HORNSEY TOWN HALL

Client:
ARDMORE

Dwg Number:
10687-M-04-BM-0007

Rev:
C4