

Air source heat pump acoustic sound pressure calculation as per MCS020 Planning Standards, Version 1,

Air source heat pump acoustic sound pressure calculation as per MCS020 Planning Standards – 34 The Avenue, N10 2QL



NEXT STEP HEATING

Air source heat pump acoustic sound pressure calculation as per MCS020 Planning Standards, Version 1,

Calculation Procedure	Result
Description of assessment position tested (This must be detailed enough to allow for identification, including property address and exact location of window / door opening and floor level. It is recommended that a map, sketch, photo or other record be attached to these workings.)	The assessment position is the rear first floor bedroom window of no 32 The Avenue and is 7m away from the proposed location of the Air Source Heat Pump
From manufacturer`s data, obtain the A-weighted sound power level of the heat pump. See „Note 1: Sound power level“. The highest sound power level specified should be used (the power in “low noise mode” should not be used).	60dB
Use „Note 2: Sound pressure level“ and „Note 3: Determination of directivity“ below to establish the directivity „Q“ of the heat pump noise.	Q8 – “Three Reflective Surfaces”
Measure the distance from the heat pump to the assessment position in metres. (rounded down to nearest m)	7m
Use table in „Note 4: dB distance reduction“ below to obtain a dB reduction.	-20 dB
Establish whether there is a solid barrier between the heat pump and the assessment position using „Note 5: Barriers between the heat pump and the assessment position“, and note any dB reduction.	There is a louvred enclosure around the heat pump. This completely partially obscures vision of the assessment position.
Calculate the sound pressure level (see „Note 2: Sound pressure level“) from the heat pump at the assessment position using the following calculation: (STEP 1) + (STEP 4) + (STEP 5)	35 dB(A)
Background noise level. For the purposes of the MCS Planning Standard for air source heat pumps the background noise level is assumed to be 40 dB(A) Lp. For information see „Note 6: MCS Planning Standard for air source heat pumps background noise level“.	40 dB(A)
Determine the difference between STEP 7 background noise level and the heat pump noise level using the following calculation: (STEP 7) – (STEP 6)	5dB(A)
Using the table in „Note 7: Decibel correction“ obtain an adjustment figure and then add this to	41.2 dB(A)

Air source heat pump acoustic sound pressure calculation as per MCS020 Planning Standards, Version 1, Issued 27.09.2022

whichever is the higher dB figure from STEP 6 and STEP 7. Round this number up to the nearest whole number.	
Final Result	42 dB(A)
Is the FINAL RESULT in STEP 9 lower than the permitted development noise limit of 42 dB(A)? If YES - the air source heat pump will comply with the permitted development noise limit for this assessment position and may be permitted development (subject to compliance with other permitted development limitations/conditions and parts of this standard). NOTE - Other assessment positions may also need to be tested. If NO – the air source heat pump will not be permitted development. This installation may still go ahead if planning permission is granted by the local planning authority	YES – The air source heat pump complies with the permitted development noise limit for this assessment position and may be permitted.

Calculation Summary as per MCS_Heat_Pump_Calculator_v1_8

ASHP - Sound Power Level	
1. Sound power level (dB)	60
2. Sound pressure level (dB)	Q8 - "Three Reflective Surfaces"
3.Distance from heat pump to assessment position (meters)	7
4. dB Distance Reduction	-20
5. Barriers Between heat pump and assessment position	Barrier (partial view)
6.Sound pressure level @ assessment position	35
7. Background noise level (dB)	40
8. Differential between 6. & 7.	5
9. Decibel Correction (dB)	41.2
10. Final Result (dB)	42.0
	Pass

PUZ-WM112VAA(-BS)

Ecodan R32

Monobloc Air Source Heat Pump

R32

Key Features:

- A+++ high efficiency system
- Ultra quiet noise levels
- Maintains full heating capacity at low temperatures
- Zero carbon solution
- MELCloud enabled

Key Benefits:

- Ultra low running cost
- Flexible product placement
- Confident and quick product selection
- Help to tackle the climate crisis
- Remote control, monitoring, maintenance and technical support




MELCloud



Manufactured in the UK



037-0034-20-01



ecodan[®]
Renewable Heating Technology

OUTDOOR UNIT		PUZ-WM112VAA(-BS)
HEAT PUMP SPACE HEATER - 55°C	ErP Rating	A++
	η_s	134%
	SCOP (MCS)	3.34
HEAT PUMP SPACE HEATER - 35°C	ErP Rating	A+++
	η_s	191%
	SCOP (MCS)	4.74
HEAT PUMP COMBINATION HEATER - Large Profile ^{*1}	ErP Rating	A+
	η_{wh}	148%
HEATING ^{*2} (A-7/W35)	Capacity (kW)	11.2
	Power Input (kW)	3.73
	COP	3.00
OPERATING AMBIENT TEMPERATURE (°C DB)		-25 ~ +35
SOUND DATA ^{*3}	Pressure Level at 1m (dBA)	45
	Power Level (dBA) ^{*4}	60
WATER DATA	Pipework Size (mm)	28
	Flow Rate (l/min)	32
	Water Pressure Drop (kPa)	24.0
DIMENSIONS (mm)	Width	1050
	Depth	480
	Height	1020
WEIGHT (kg)		119
ELECTRICAL DATA	Electrical Supply	220-240v, 50Hz
	Phase	Single
	Nominal Running Current [MAX] (A) ^{*5}	10.9 [28]
	Fuse Rating - MCB Sizes (A) ^{*6}	32
REFRIGERANT CHARGE (kg) / CO ₂ EQUIVALENT (t)	R32 (GWP 675)	3.0 / 2.03

Notes:

*1 Combination with E*PT20X Cylinder

*2 Under normal heating conditions at outdoor temp: -7°CDB / -8°CWB, outlet water temp 35°C, inlet water temp 30°C.

*3 Under normal heating conditions at outdoor temp: 7°CDB / 6°CWB, outlet water temp 55°C, inlet water temp 47°C as tested to BS EN14511.


*4 Sound power level tested to BS EN12102.

*5 Under nominal heating conditions at outdoor temp: 7°C, outlet water temp: 35°C.

*6 MCB Sizes BS EN60898-2 & BS EN60947-2.


 η_s is the seasonal space heating energy efficiency (SSHEE) η_{wh} is the water heating energy efficiency

NOMINAL HEATING CAPACITY

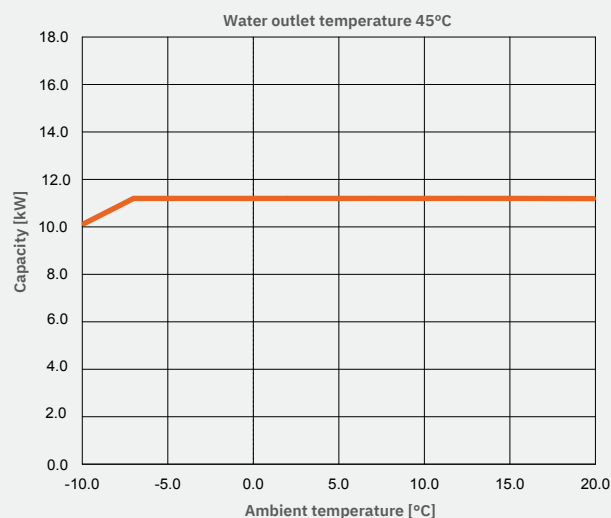


PUZ-WM112VAA(-BS) DIMENSIONS


FRONT VIEW

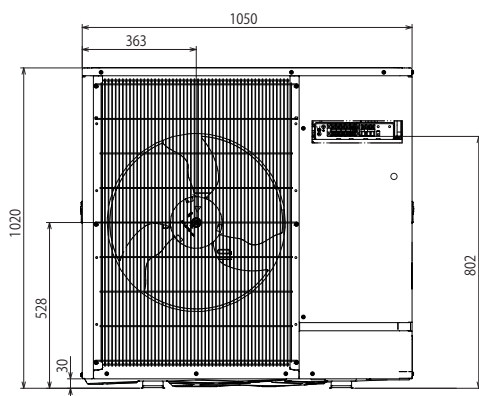

UPPER VIEW

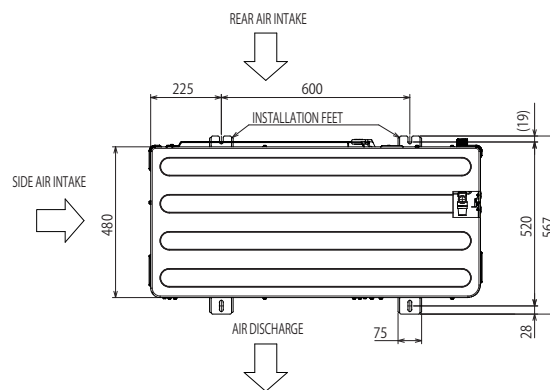



SIDE VIEW

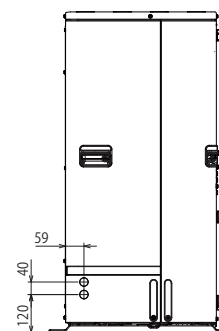

All dimensions (mm)



Telephone: 01707 282880
email: heating@meuk.mee.com
heating.mitsubishielectric.co.uk



UNITED KINGDOM Mitsubishi Electric Europe Living Environment Systems Division, Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England. Telephone: 01707 282880 Fax: 01707 278881
IRELAND Mitsubishi Electric Europe, Westgate Business Park, Ballymount, Dublin 24, Ireland. Telephone: (01) 419 8800 Fax: (01) 419 8890 International code: (003531)

Country of origin: United Kingdom - Japan - Thailand - Malaysia. ©Mitsubishi Electric Europe 2020. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe B.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public announcement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication present only general particulars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a copy of which is available on request. Third-party product and brand names may be trademarks or registered trademarks of their respective owners.

Note: Refer to 'Installation Manual' and 'Instruction Book' for further 'Technical Information'. The fuse rating is for guidance only and please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electrician/electrical engineer to select the correct cable size and fuse rating based on current regulation and site specific conditions. Mitsubishi Electric's air conditioning equipment and heat pump systems contain a fluorinated greenhouse gas, R410A (GWP:2088), R32 (GWP:675), R407C (GWP:1774), R134a (GWP:1430), R513A (GWP:631), R454B (GWP:466), R1234ze (GWP:7) or R1234yf (GWP:4). *These GWP values are based on Regulation (EU) No 517/2014 from IPCC 4th edition. In case of Regulation (EU) No.624/2011 from IPCC 3rd edition, these are as follows. R410A (GWP:1975), R32 (GWP:550), R407C (GWP:1650) or R134a (GWP:1300).

Effective as of August 2020

