

Unconfined Compressive Strength of soil - load frame method

Job Ref	A190707
Borehole/Pit No.	Val-009
Mix Design	5% CEMI
Depth	0.00
Sample Type	BLK
KeyLAB ID	CEGL202009160
Date of test	17/09/2020

Site Name	Hornsey Gas Works		
Soil Description			
Specimen Test Age	7 day	Specimen Depth	m
Specimen Description			
Test Method	BS EN 13286:Part 41:2003		

Test Number
 Length
 Diameter
 Bulk Density
 Moisture Content
 Dry Density


1	
99.6	mm
103.7	mm
1.96	Mg/m ³
	%
	Mg/m ³

Rate of Strain
 At failure

Axial Strain
 Unconfined Compressive Strength
 Mode of Failure


	%/min
1.9	%
746	kPa
Brittle	

Axial Compressive Stress v Axial Strain

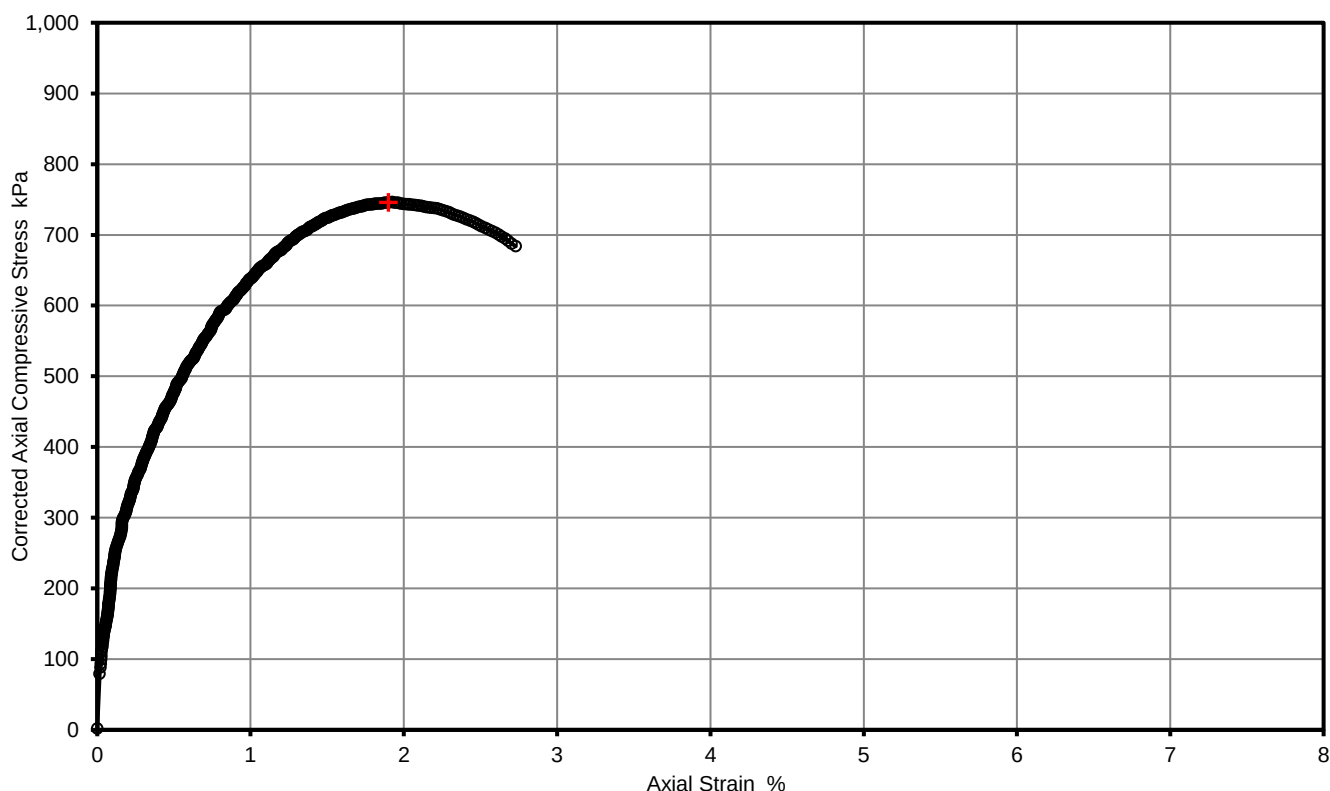

Remarks

Axial compressive stress corrected for area change, and membrane effects (if used)



CE Geotech Ltd
 CEG Laboratories
 Matlock Road, Kelstedge
 Derbyshire. S45 0DX

General remarks

Approved

Chris Salt
 25/09/2020