



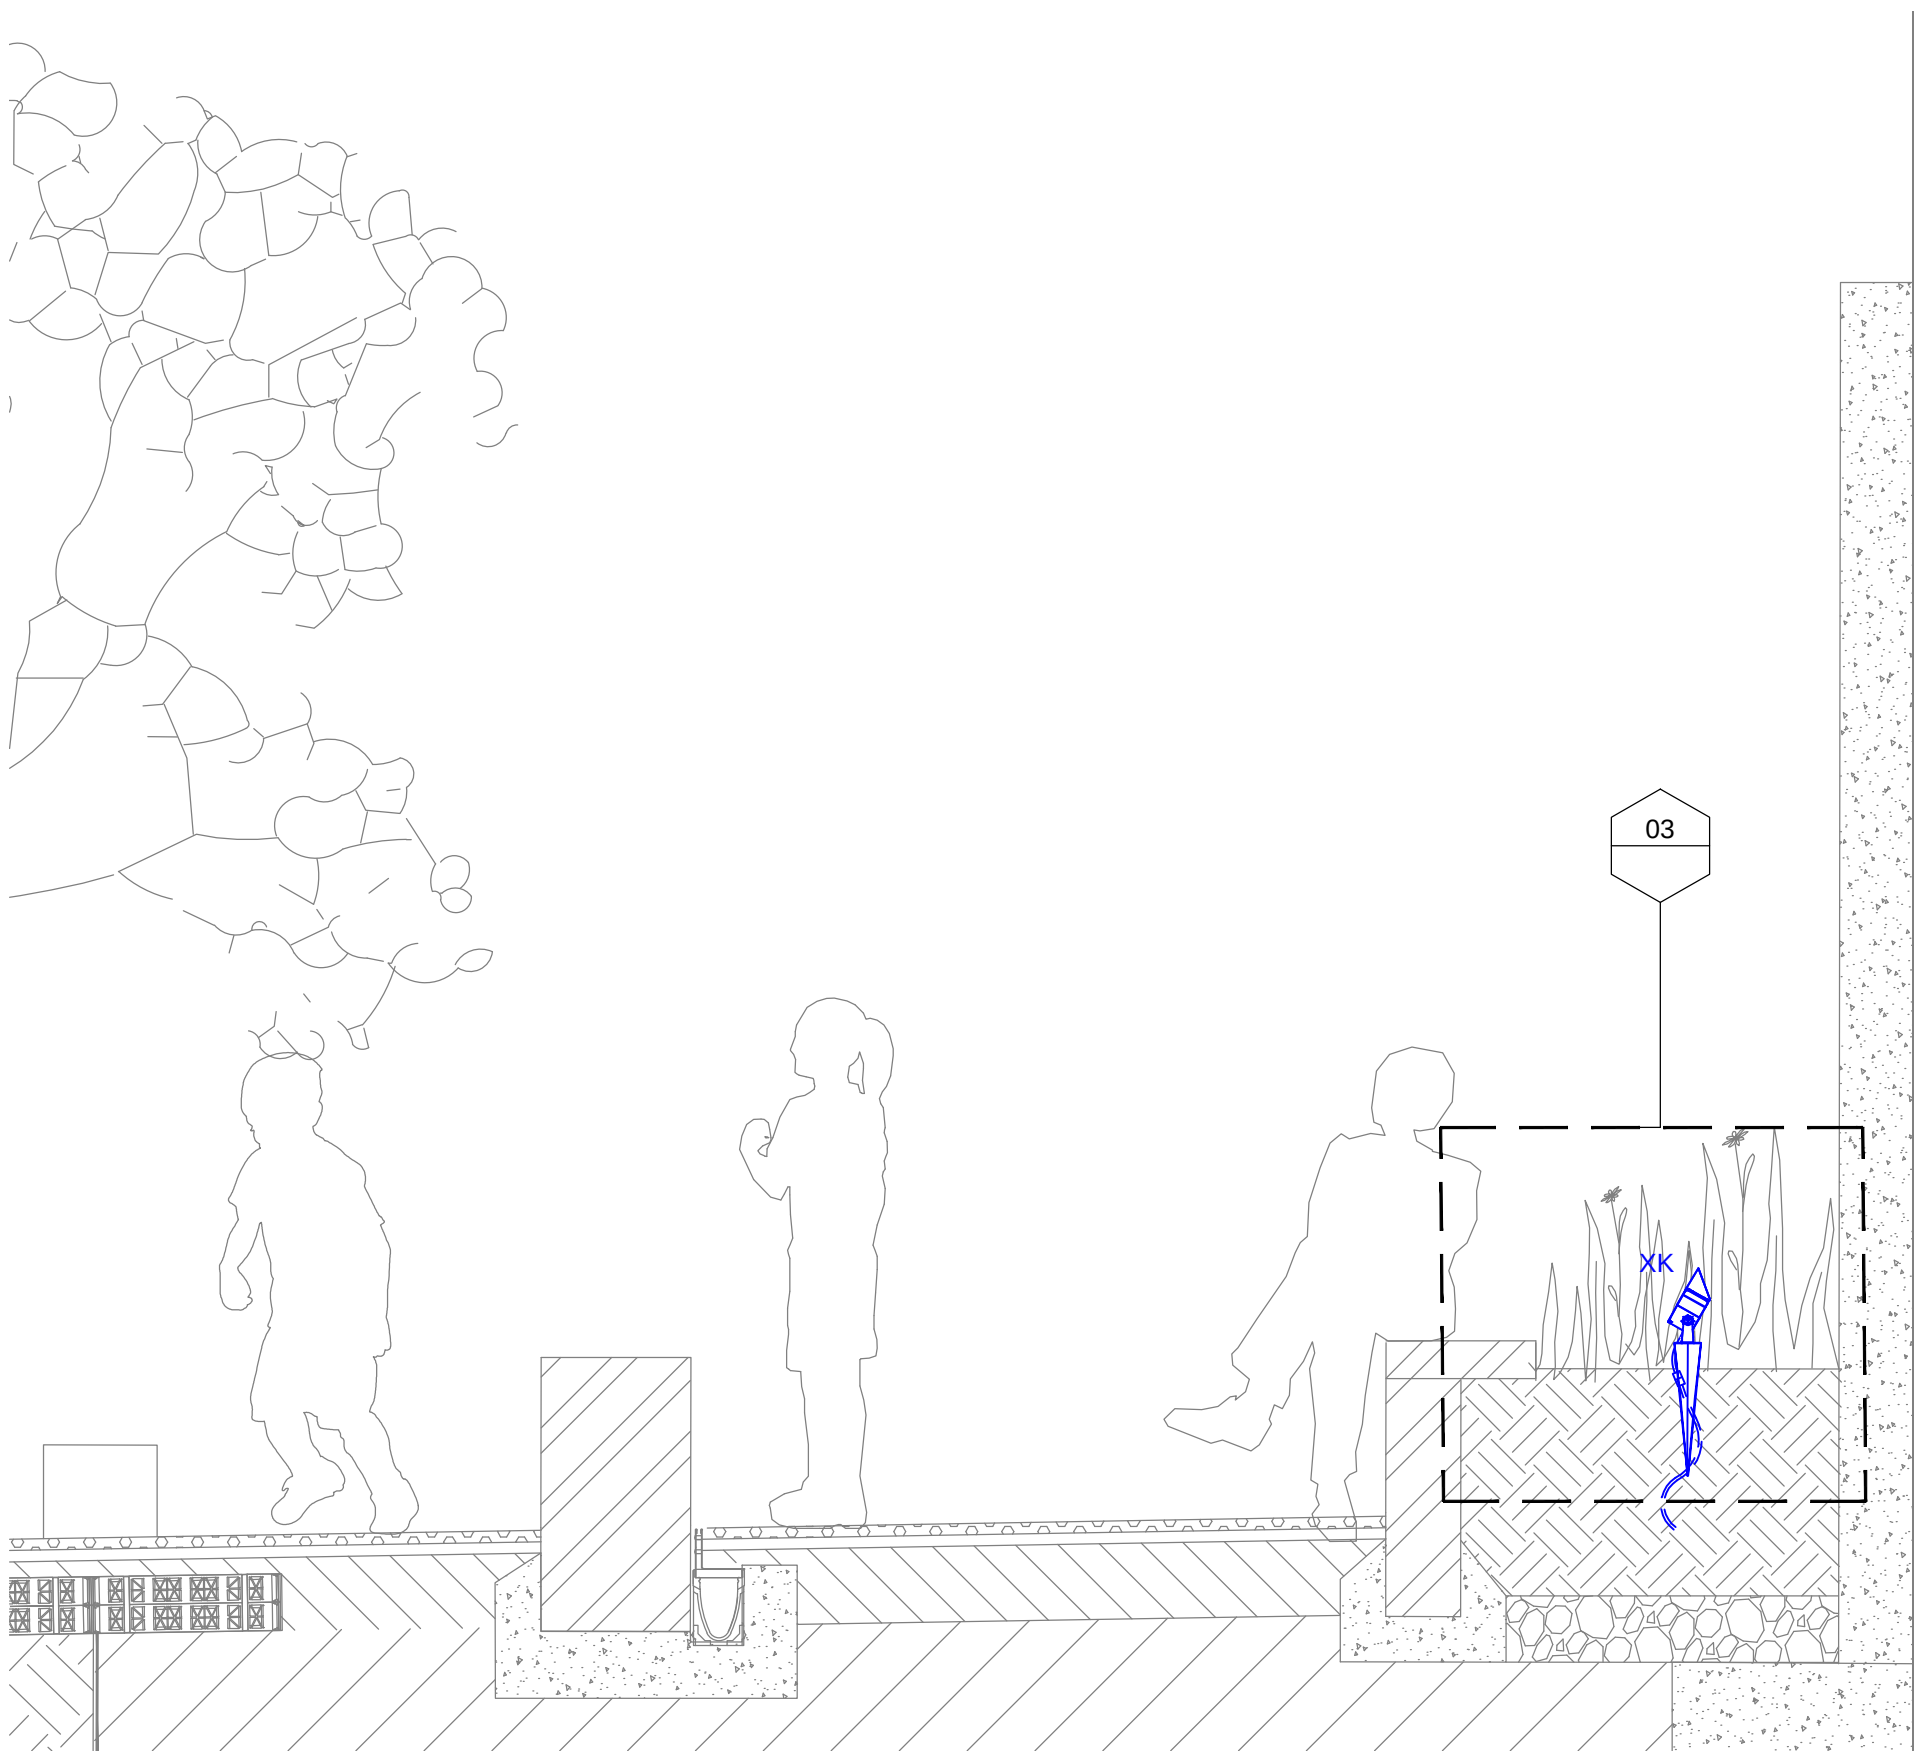


2

Section
1:20

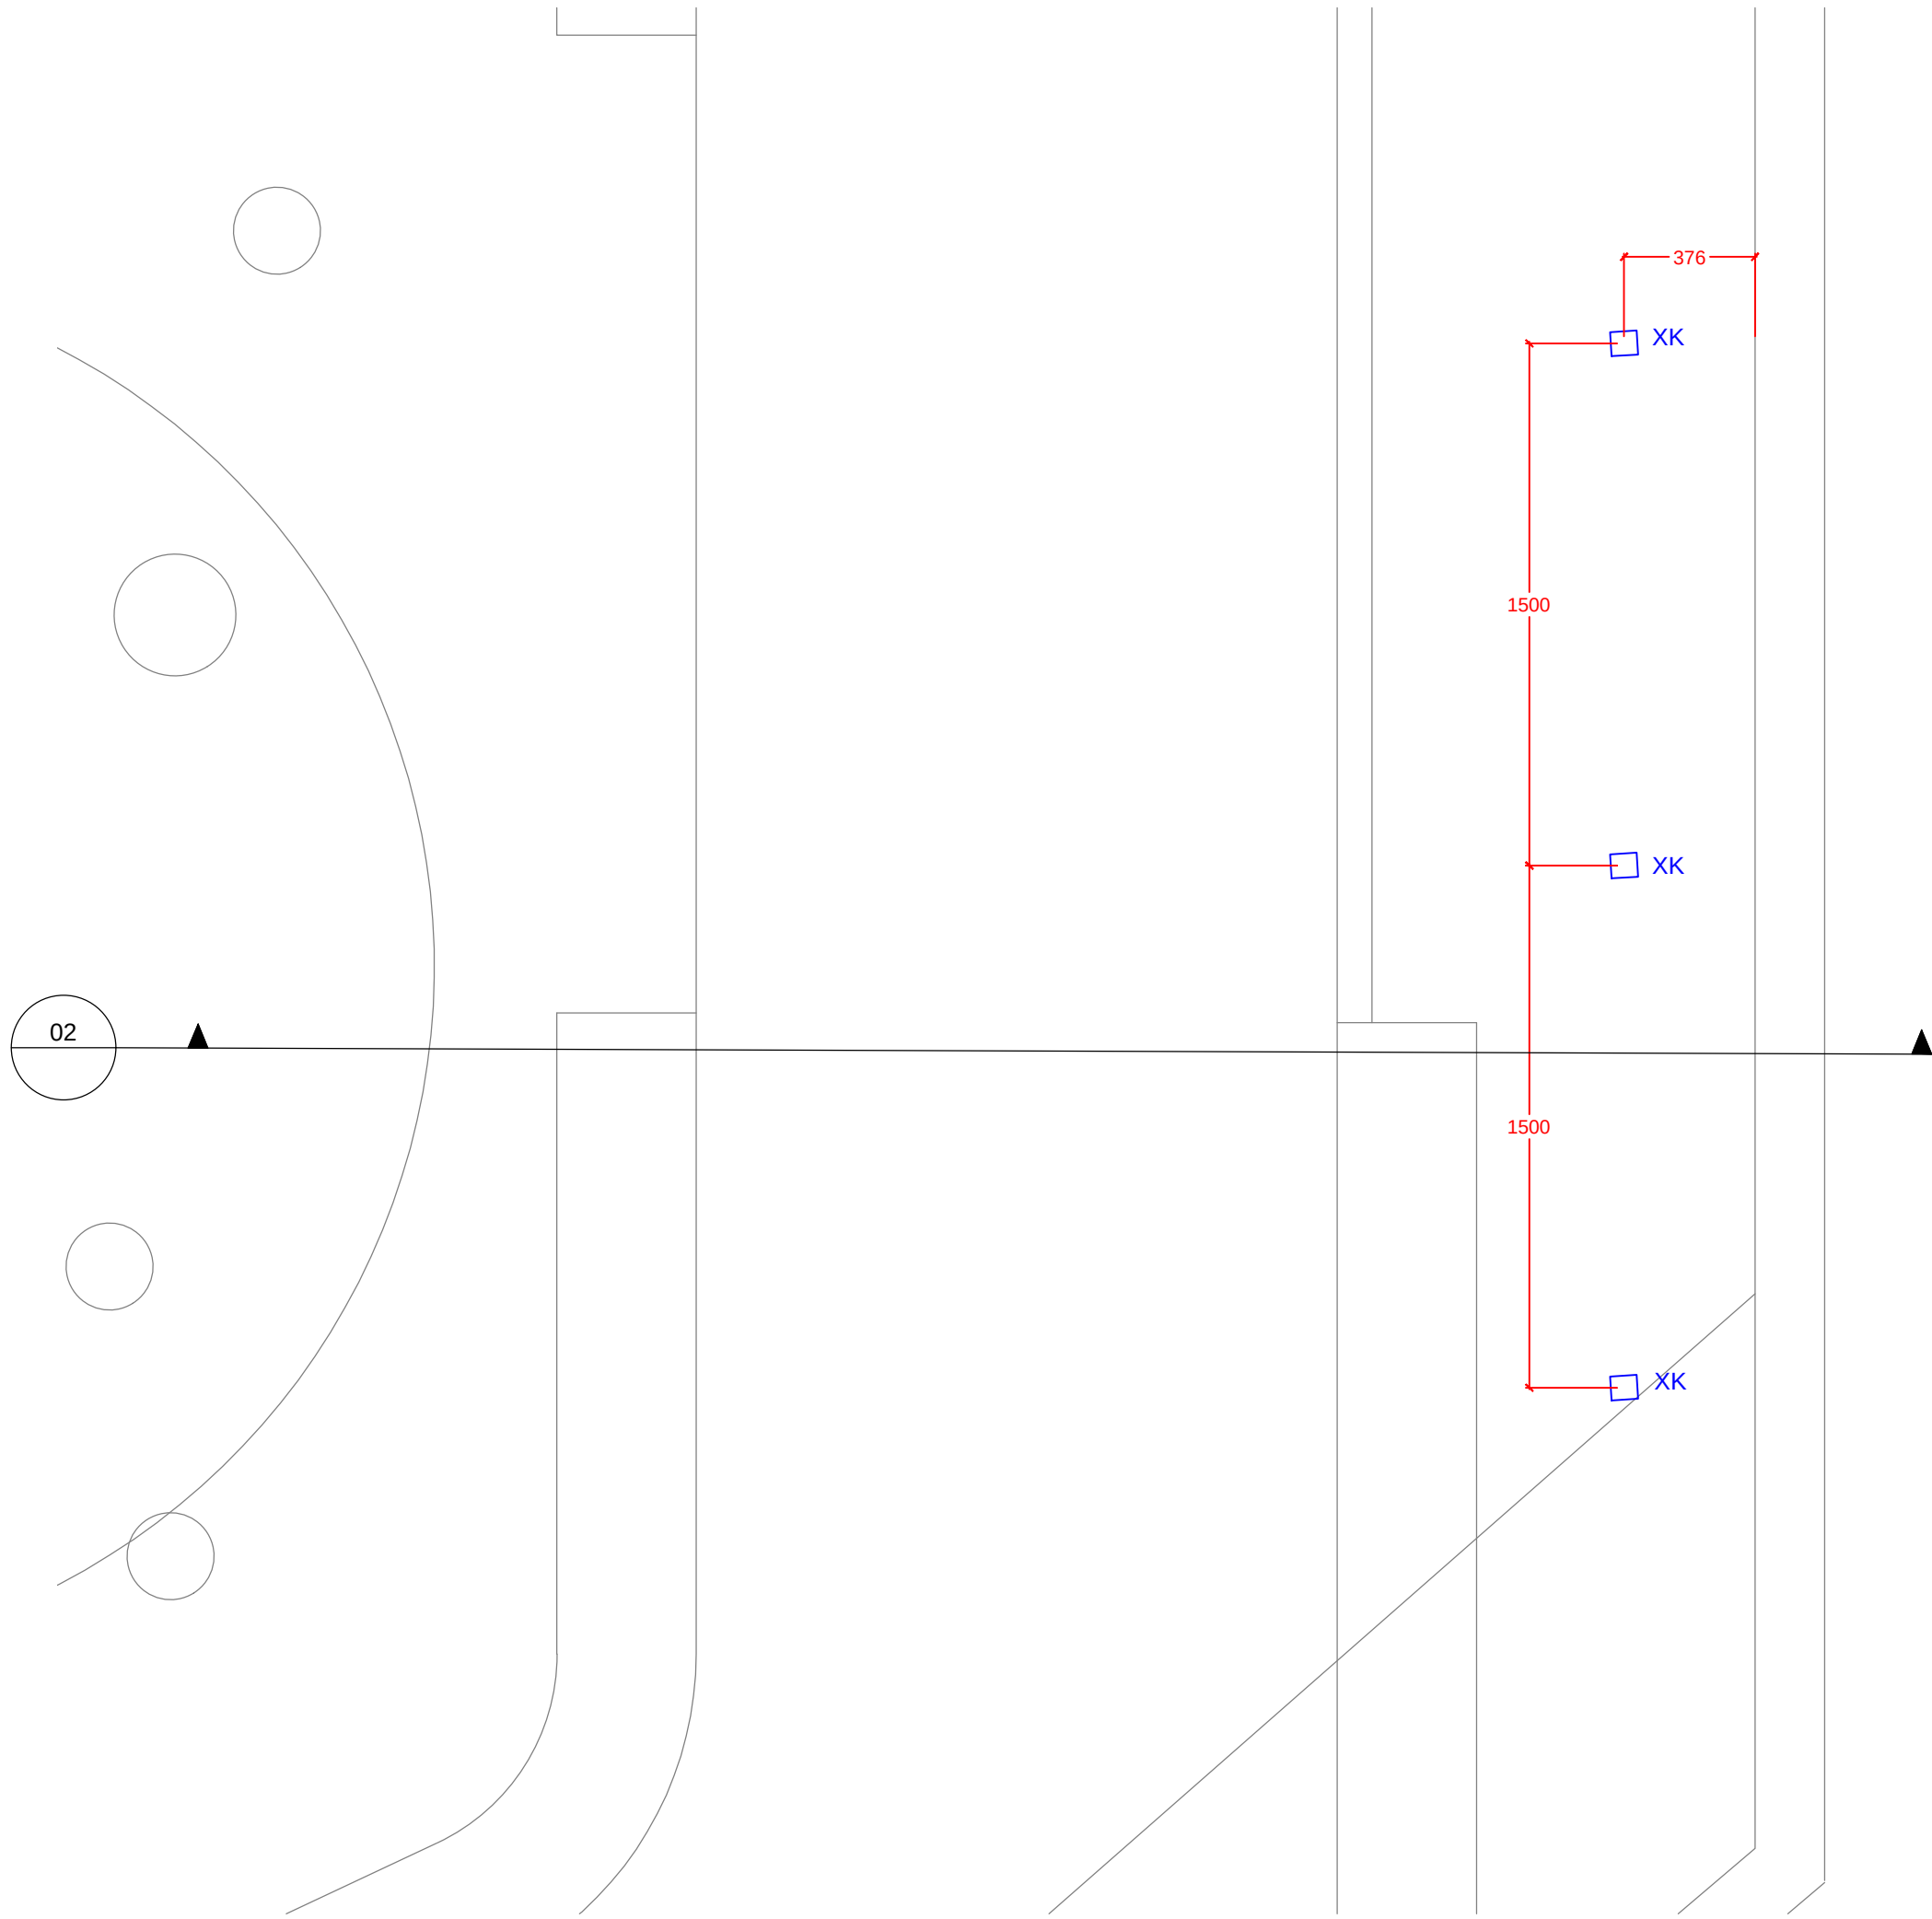

1

Plan
1:20

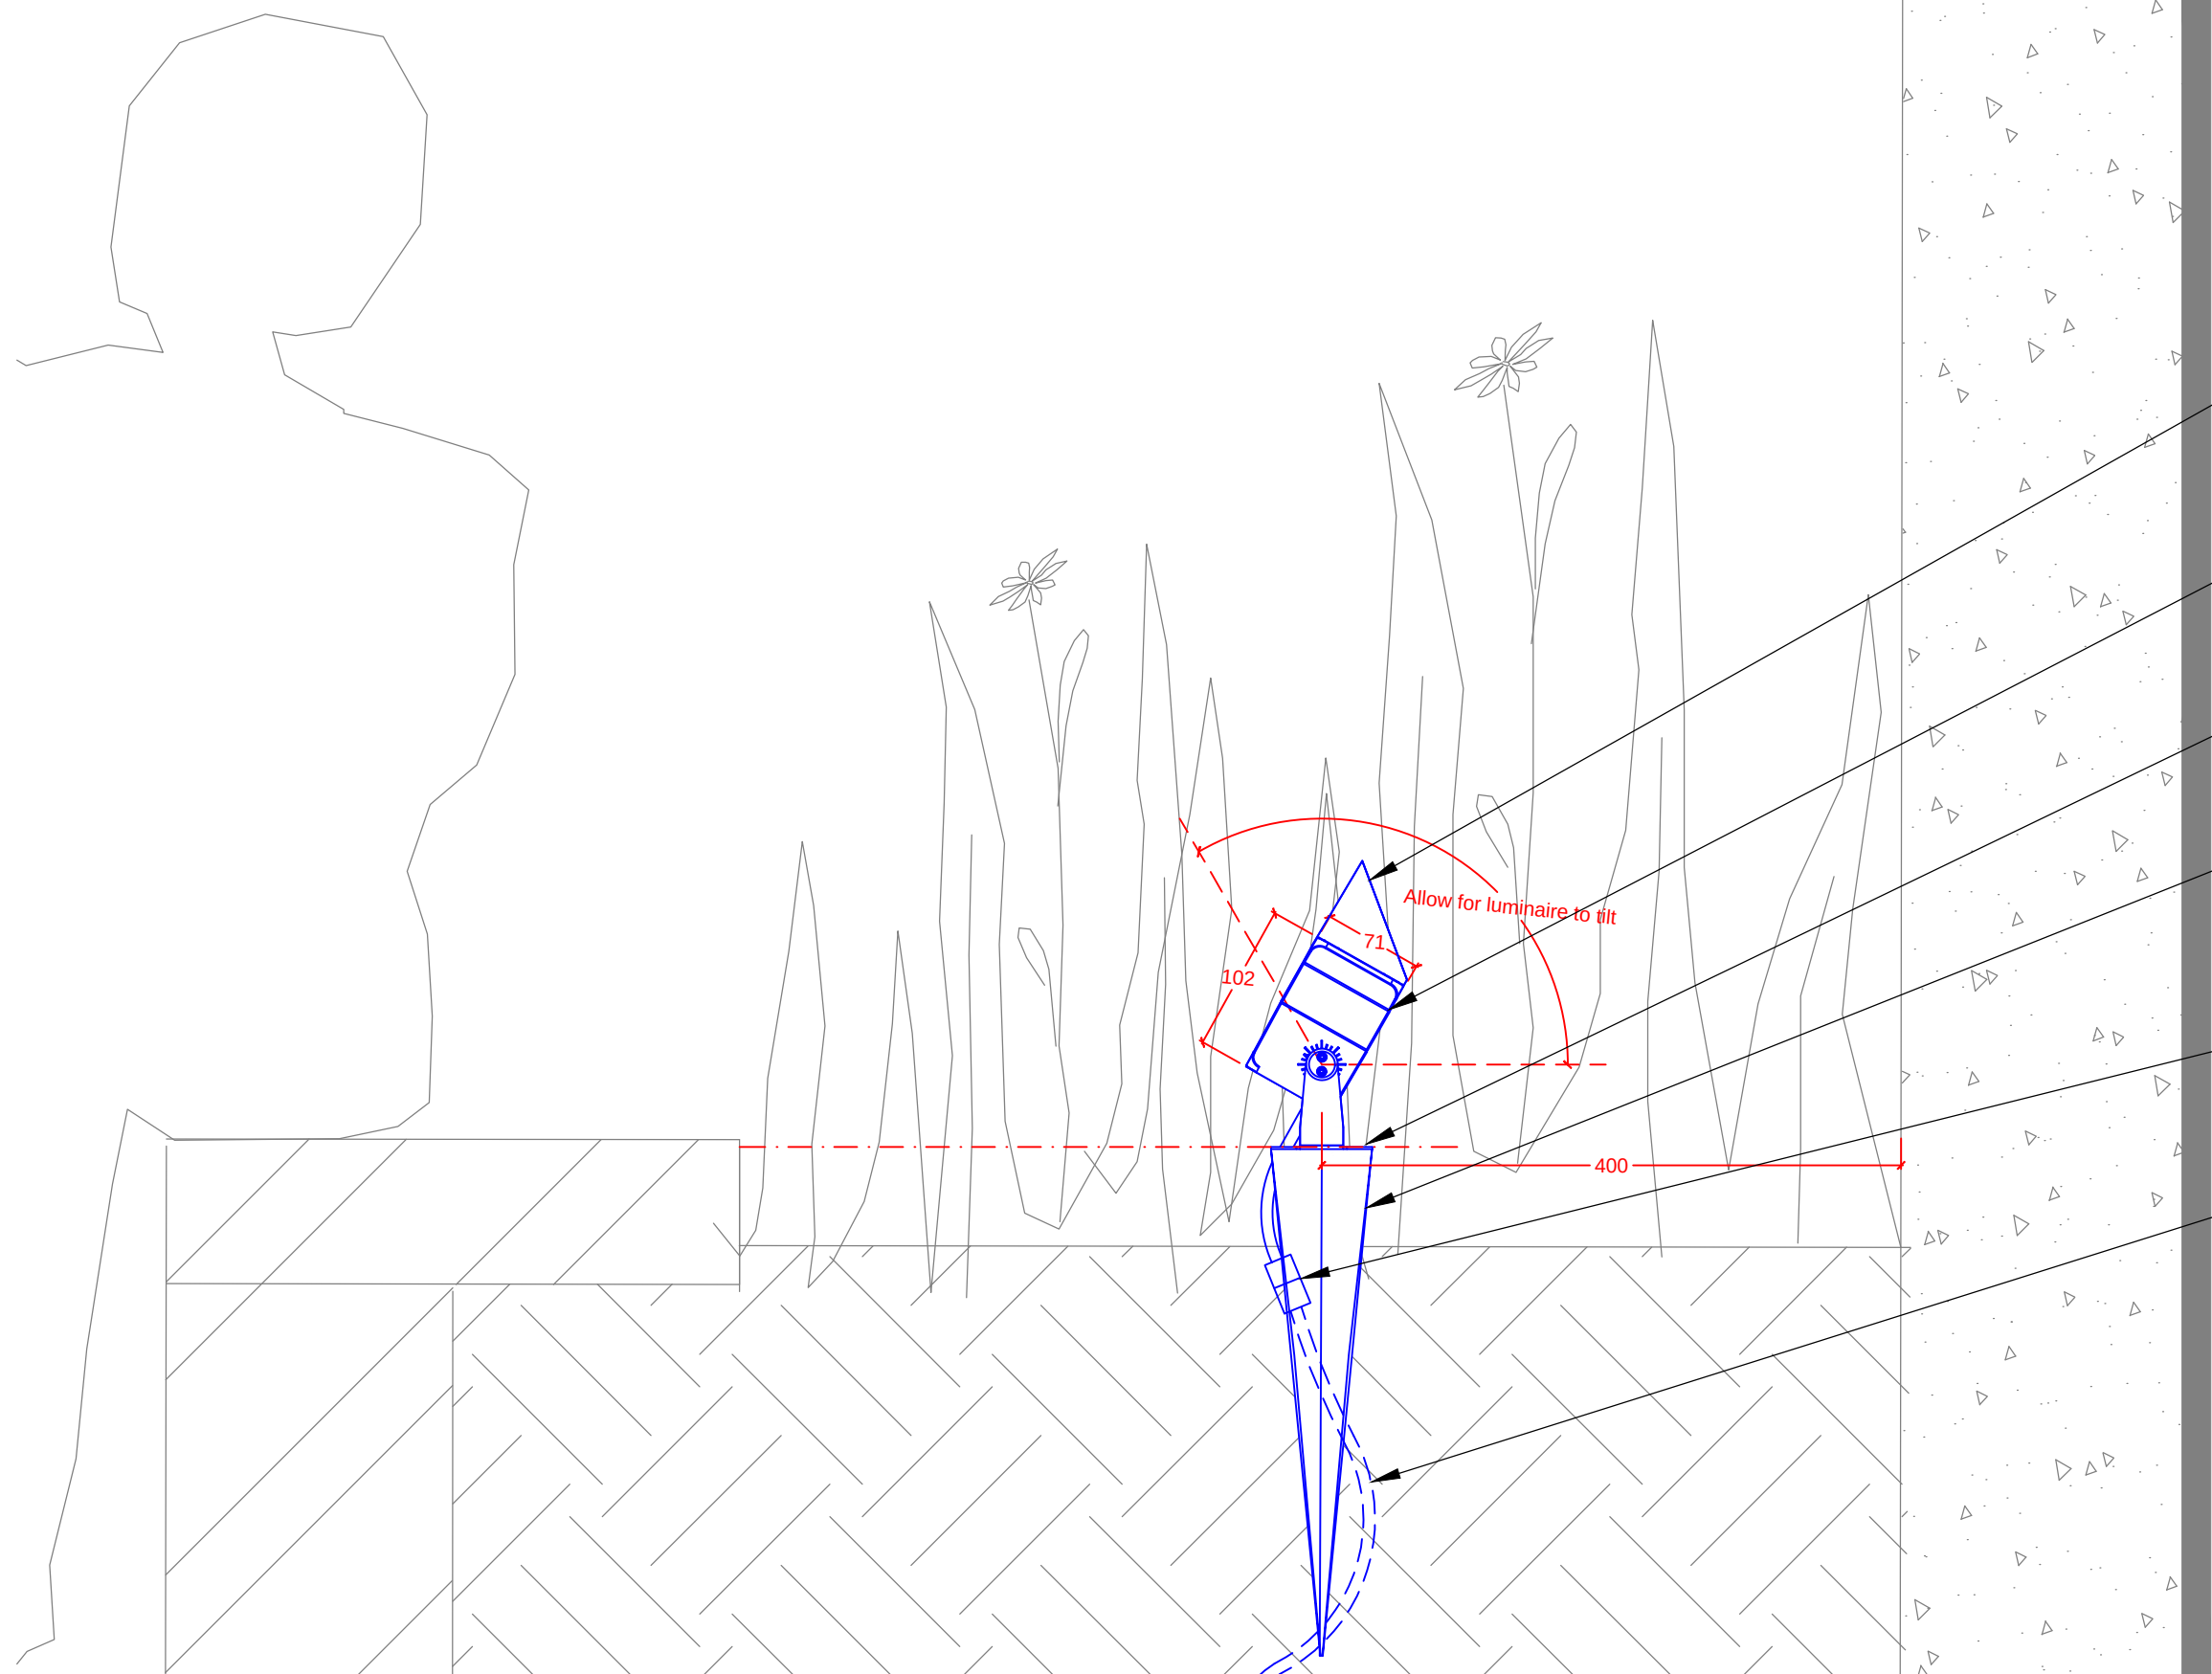

3

Detail
1:5

General Drawing Notes:

Do not scale off this drawing.

Lighting detail drawings to be read in conjunction with all other relevant documents, including lighting layout drawings, lighting equipment specifications and logical control channel schedules.

See architects' drawings for co-ordinated design information.

For details of electrical supply wiring, control data wiring, containment, etc, see relevant engineers' drawings.

All works to be carried out in accordance with such Standards, Building and IEE regulations, mandatory and statutory regulations and codes of practice as are deemed to apply in the relevant location.

Refer to Speirs + Major Lighting Designer's Risk Assessment for associated risks under the construction (Design and Management) Regulations (where applicable).

Copyright:

© Speirs + Major LLP, date as below. Under UK law, all rights described in Chapter 4 of the Copyrights, Designs Patents Act 1988 have been generally asserted.

IMPORTANT:

IF THIS DRAWING IS ISSUED TO CONTRACTORS, IT IS FOR INFORMATION ONLY - ARCHITECTS' AND ENGINEERS' DRAWINGS MUST BE USED AS THE BASIS FOR TENDER AND CONSTRUCTION.

General Lighting Detail Notes:

This detail drawing is based on available drawings by Architect/other consultants. Lighting equipment specified by Speirs + Major is shown in **BLUE**. Any additional elements required to support lighting equipment and to achieve the required lighting effect are shown in **GREEN** and are to be detailed by other consultants/Contractor.

Cabling and containment:
All cabling and containment to Electrical Engineers/Contractor's detail and specification.

Fixings:
All fixings and bracketry to Architect's/Contractor's detail and specification.

Installation:
Luminaire manufacturer/supplier's installation instructions should be followed.

Remote LED Drivers:
Where required, remote LED drivers must be located:

in accessible, dry, well ventilated locations (typically for luminaires located in interior spaces)

or

in accessible, suitably IP-rated enclosures with adequate internal air-space and suitably IP-rated cable glands (typically for luminaires located in exterior spaces).

Drivers must be located within the manufacturer's stated maximum distances from luminaires using the manufacturer's recommended gauge of secondary cabling. See Lighting Equipment Specification and manufacturer's installation instructions.

Anti-glare cowl supplied by luminaire manufacter

Luminaire XK
Spike-mounted, adjustable LED spotlight

Top of spike to remain below top of bench.

Spike supplied by luminaire manufacturer. Final position of luminaire to be determined on site after planting is in place.

IP68-rated connector shown indicatively. Allow sufficient lose cabling for positioning.

Cabling to remote driver shown indicatively. Allow extra cabling to remove/adjust fixture within softscape.

00	16/03/20	VL	AG	Stage 3 Design Development Issue
00	29/03/19	VL	AG	Stage 3 Design Development Issue

Rev.	Date	By	Chkd	Revision Notes
------	------	----	------	----------------

Project:
Island Sites, Tottenham Hale
London, UK

Drawing:
Lighting Detail
Building 3 Play Area
Lighting to planting

Drawing Number:
TH-IS-ZZ-001-J-11163C-63-612

Rev.
00

Scale: 1:50, 1:10, 1:5

ISO: A1

SPEIRS+MAJOR
London: +44(0)20 7067 4700 Email: info@speirsandmajor.com
www.speirsandmajor.com