




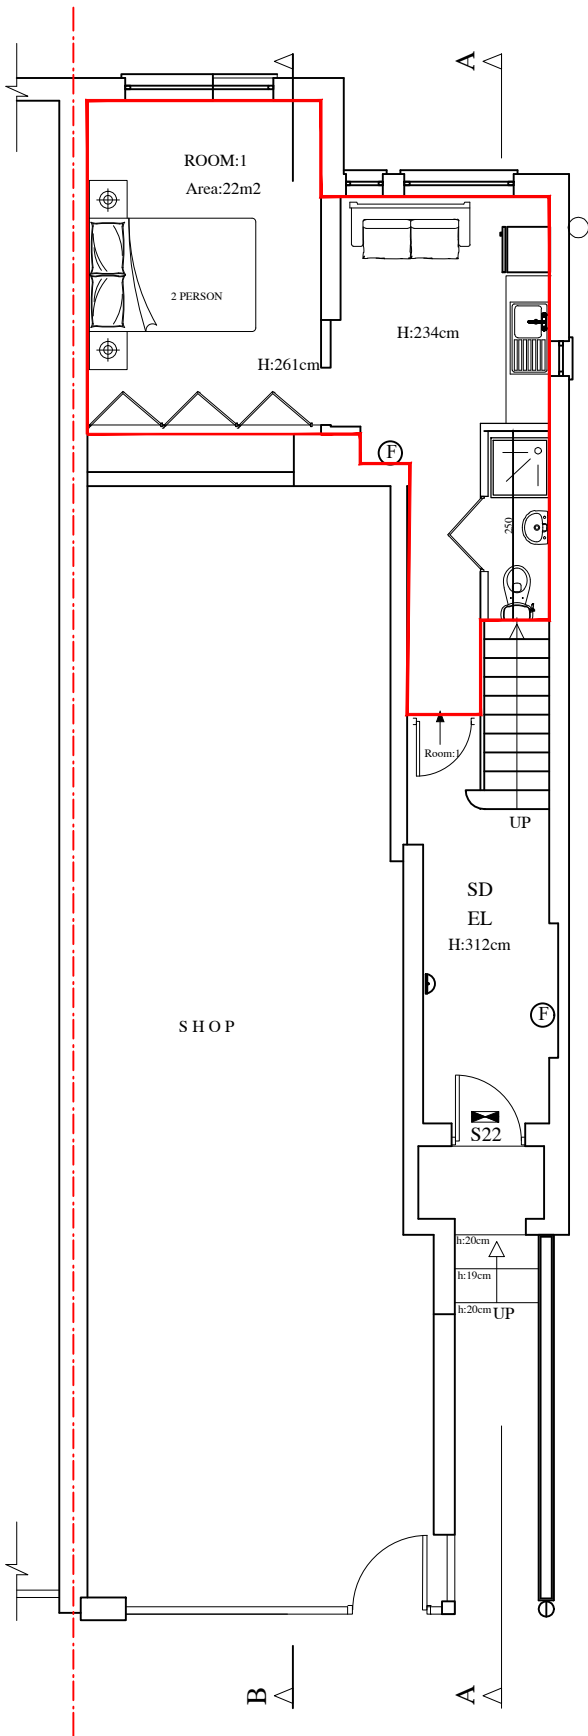

PROPOSED GROUND FLOOR PLAN

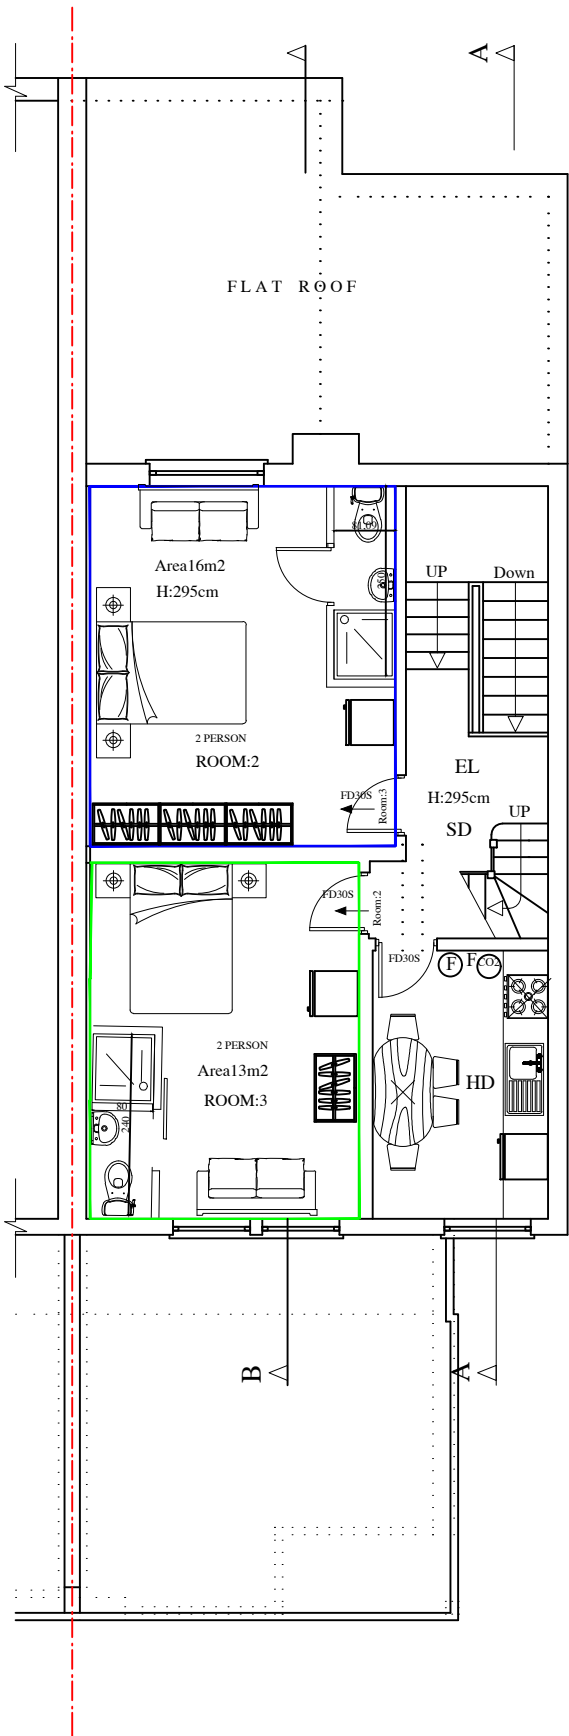


PROPOSED FIRST FLOOR PLAN

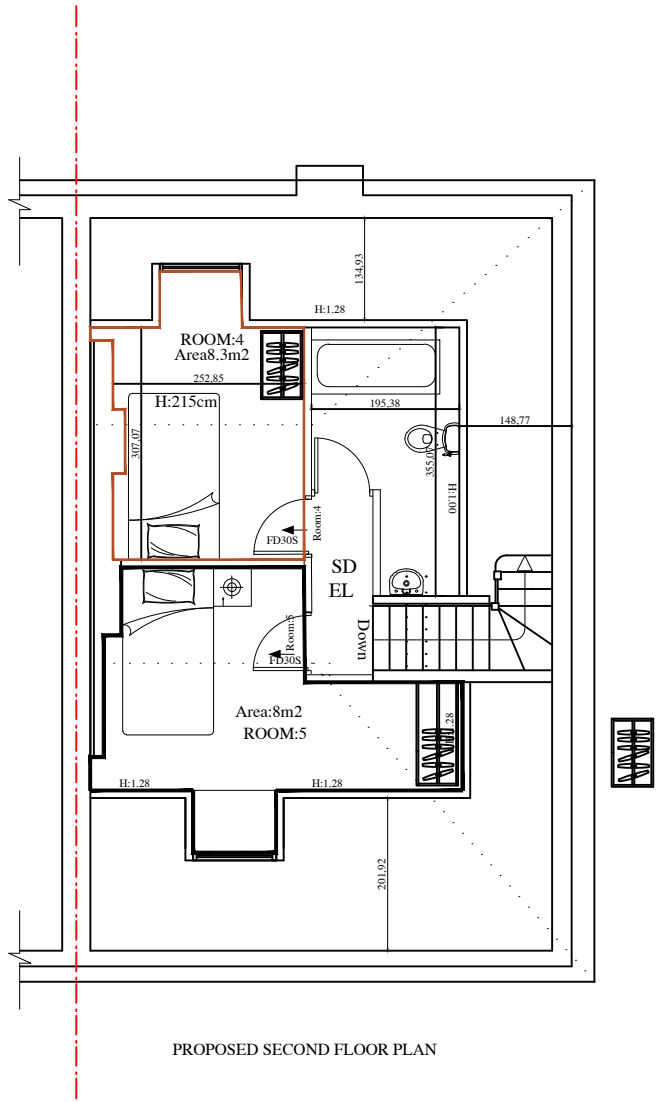

PROPOSED SECOND FLOOR PLAN

- LINE SHOWS ROOM: 1 FOR 2 PEOPLE
- LINE SHOWS ROOM: 2 FOR 2 PEOPLE
- LINE SHOWS ROOM: 3 FOR 2 PEOPLE
- LINE SHOWS ROOM:4 FOR 1PEOPLE
- LINE SHOWS ROOM:5 FOR 1PEOPLE

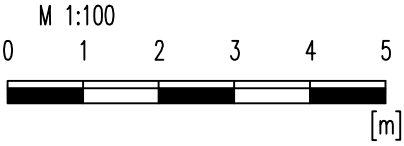

KEY SYMBOLS	
EL	AREA COVERED BY EMERGENCY LIGHTING, to BS5266-1 2005
SD	Smoke detector Mains operated, battery Backup, interlinked smoke alarm system, manufactured to BS5446:Part:1, is to be installed
HD	AREA COVERED BY HEAT DETECTOR
S22	ALL EXIT SIGN MIN HT.1000mm
	ILLUMINTAED EXIT SIGN
	BREAK GLASS CALL POINT (Should meet the requirement of EN54 and certified by BS 5839
PB	PUSH BAR
FD20	30MIN. FIRE RESISTANCE DOOR
	CARBON DIOXIDE FIRE EXTINGUISHER
	9 LT. WATER FIRE EXTINGUISHER
	FIRE BLANKETS
FD30S	30min. Fire Resistance Door with intumesced strip and approved door closer All internal doors should have minimum undercut of 10mm above fitted floor finish

no	revision	date	control
project 124A MUSWELL HILL BROADWAY, HORNSEY, LONDON N10 3RU			
drawing title PROPOSED FLOOR PLANS			
scale 1/100@A3			
date AUG' 2022			
drw.no LRY-08-PL05B			