


Mains Operated Smoke Alarm System. Ensure that the mains operated, battery back-up, interlinked smoke alarm system is installed in accordance with BS5839: Part 6.


Note: All doors on to the stairway must be FD30 rated fire doors to BS 476-22:1987 except bathroom and toilet doors.

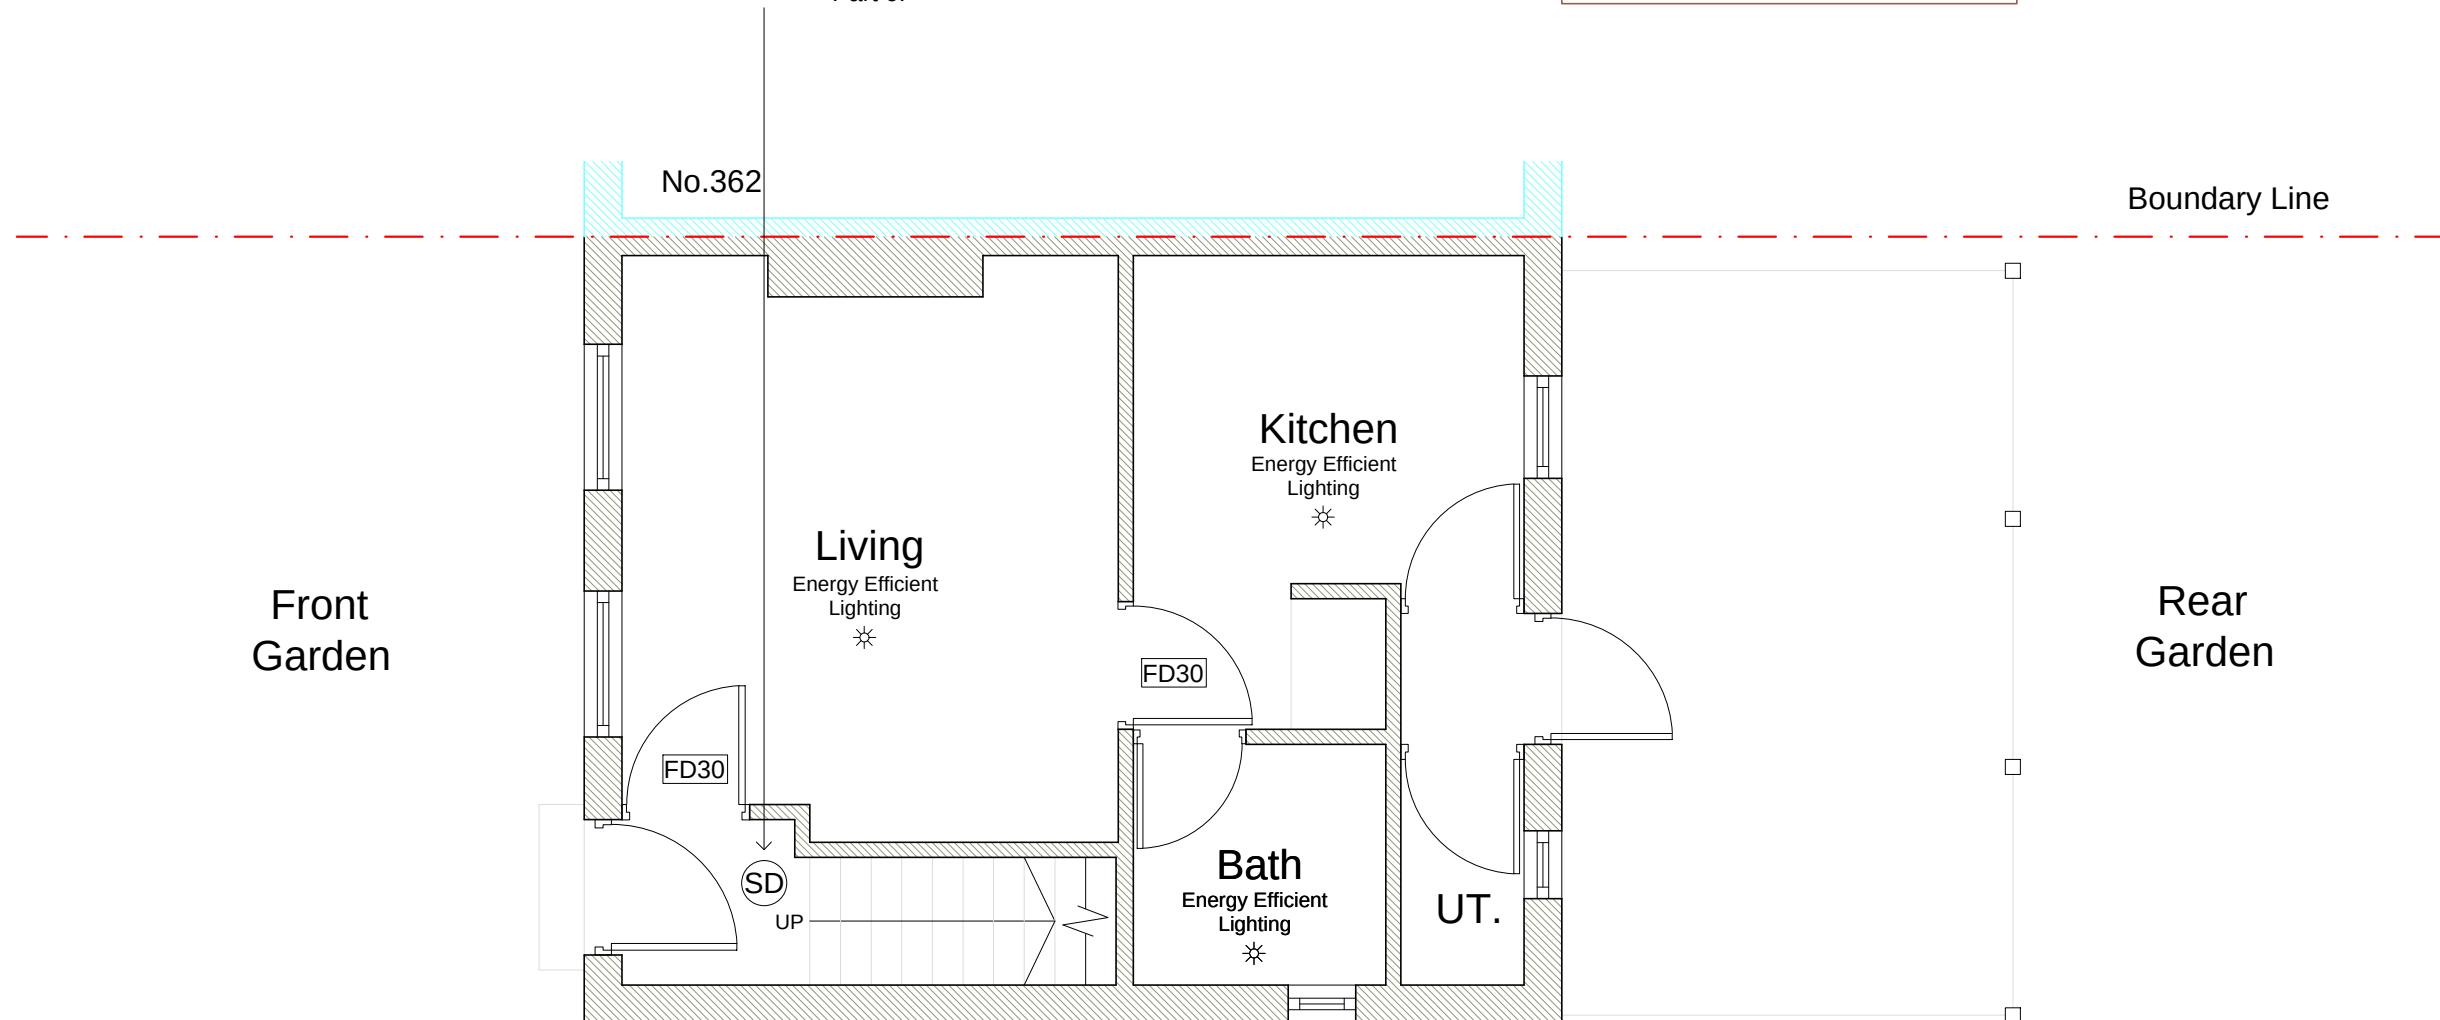

Proposed Ground Floor Plan 1:50

Proposed Plan
Proposed Loft Conversion

SCALE 1:50@A3

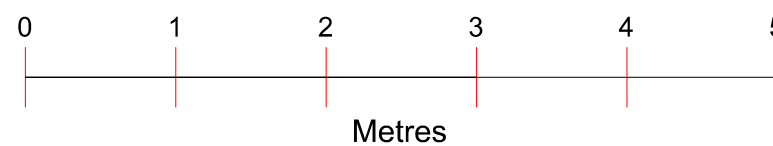


Project : Proposed Loft Conversion
Address : 364 WHITE HART LANE
LONDON
N17 8LN

Drawing no : 364_WHL_PD_02
Issue :
Date : 21/03/23




A	21.03.23	DA ISSUE	BL
ISSUE DATE	AMENDMENT	BY	

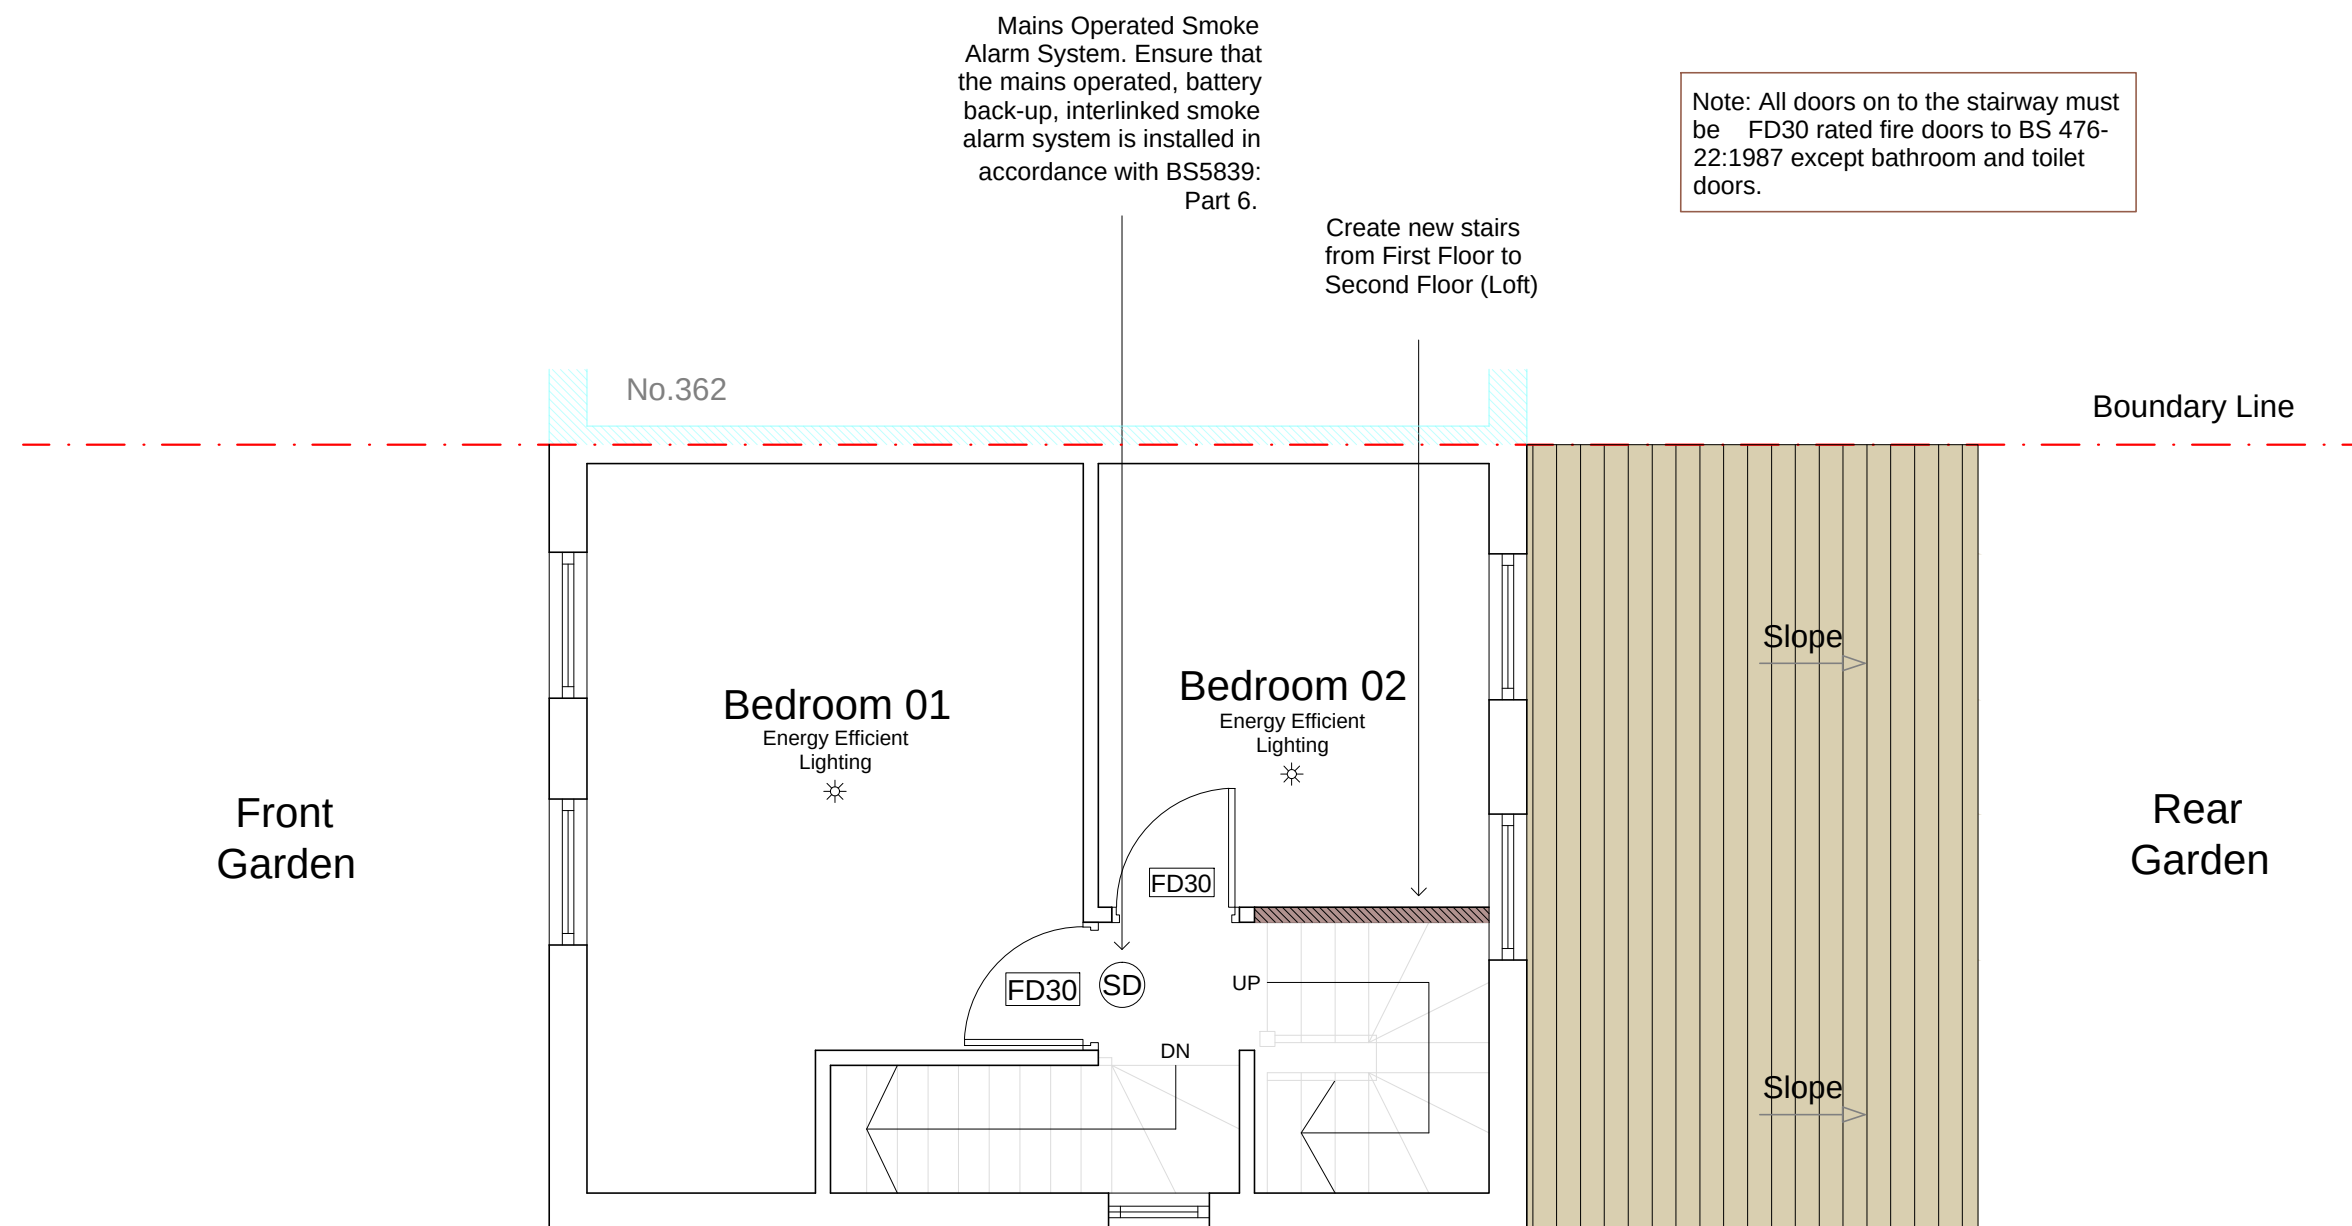

Proposed First Floor Plan 1:100

Proposed Plan
Proposed Loft Conversion

SCALE 1:50@A3

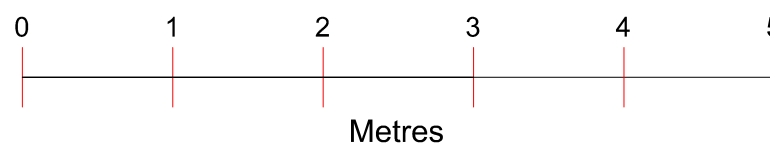

Project : Proposed Loft Conversion
Address : 364 WHITE HART LANE
LONDON
N17 8LN

Drawing no : 364_WHL_PD_03
Issue :
Date : 21/03/23




A	21.03.23	DA ISSUE	BL
ISSUE DATE		AMENDMENT	BY

Note: All doors on to the stairway must be FD30 rated fire doors to BS 476-22:1987 except bathroom and toilet doors.

Mains Operated Smoke Alarm System. Ensure that the mains operated, battery back-up, interlinked smoke alarm system is installed in accordance with BS5839: Part 6.

All glazing in 'critical' locations (i.e below 1500mm for doors and 800mm for windows, to internal and external walls) is to be safety glazing. If laminate or toughened glass is to be used it should be in accordance with BS6206, if to provide containment. This includes roof lights at low level.

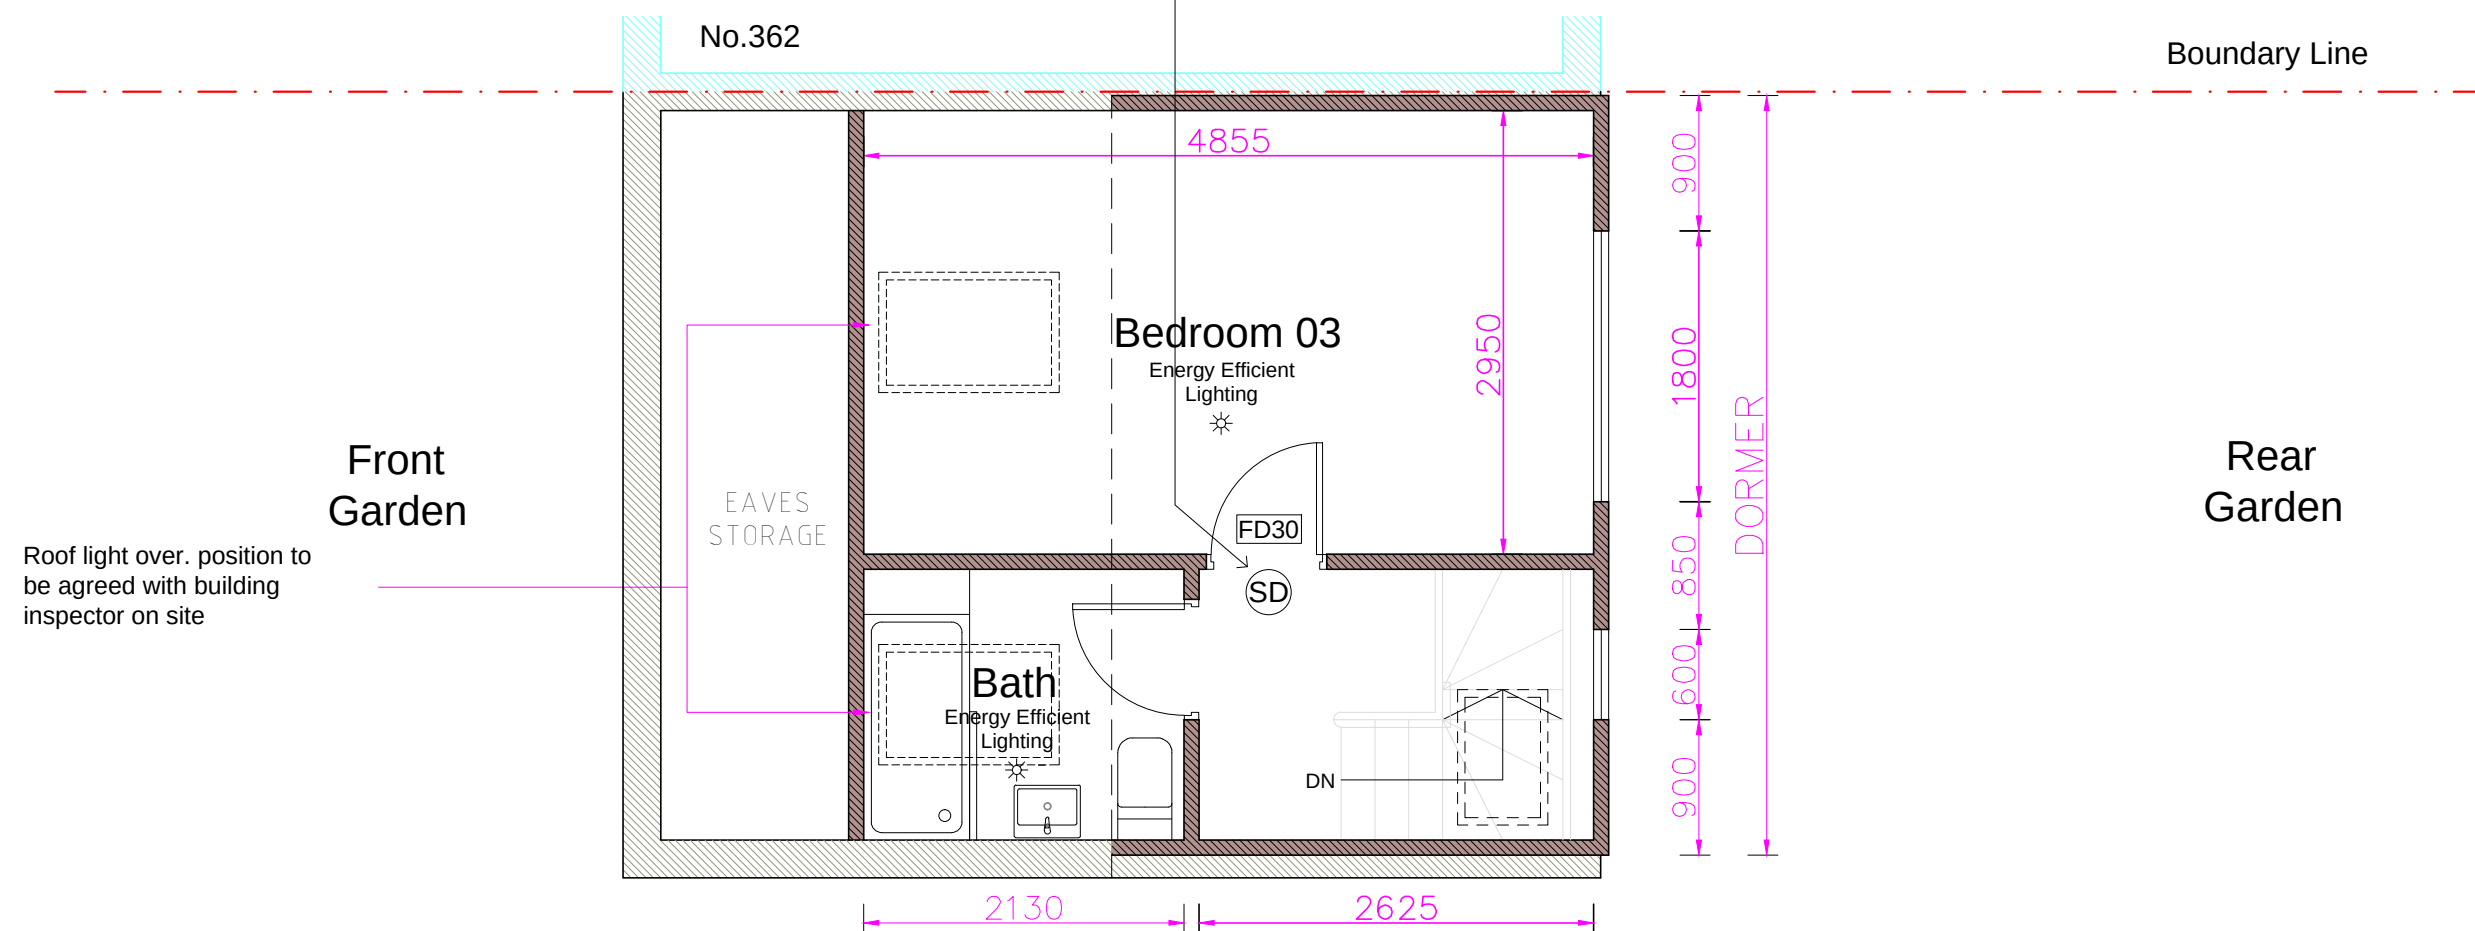


Proposed Second Floor Plan 1:50

Dormer face to be set back by at least 400mm from face of rear wall.

Proposed Plan
Proposed Loft Conversion

SCALE 1:50@A3

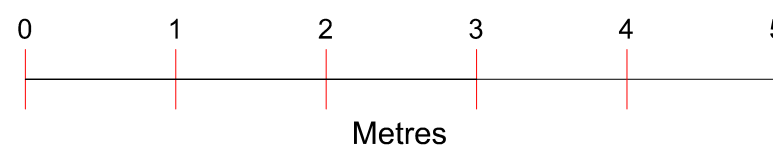

Project : Proposed Loft Conversion
Address : 364 WHITE HART LANE
LONDON
N17 8LN

Drawing no : 364_WHL_PD_04
Issue :
Date : 21/03/23