

Hornsey Town Hall

Town Hall & Hotel Schedule of Luminaires

Prepared for Ardmore

10687-LUMSCHD-0002

Revision C3

06 October 2022



WHITECODE
CONSULTING






Summary of comments from 4P

Whitecode comments in red below:



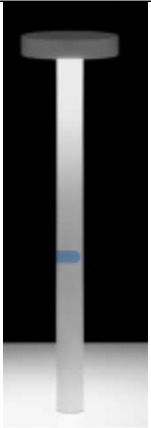
1. It is assumed that all services are coordinated with architectural and structural layouts.
- Noted
2. It is assumed that this drawing complies with the ERs and any deviations are highlighted. Noted.
3. L1 – This light is not been used in any of the town hall dressing rooms. Not in the ERs Lighting schedule for the Town Hall/ Hotel. Please clarify where does this go.
Schedule has been amended.
4. L4 – These new lighting proposed are note accepted by the CMT team. ERs shows Flos running magnet lights (ER's code) LT100. L4 to be changed as per the ERs FLos running magnet. Schedule and design have been changed.
5. P7 – Lighting are missing from this schedule. These lights would go to highly lited room 'mayor's parlour.' Please show as per the ERs. Schedule has been amended.
6. Hotel room's bathroom feature lights 'L2' are missing from the schedule. Schedule has been amended.
7. X2E light is missing from this schedule – is this the existing light that refurbished to include the emergency? Is there enough existing light to allow for that? Schedule has been amended. Quantities TBC from site.
8. X11 – This proposed new lights for the Town Hall LGF corridor LG.31B would not work as there is height issues in those corridor and this light is 68m deep surface mounted. Schedule and design have been changed.
9. Illuminated exit sign – We require to see the tech sub for this item to be able to make decision on the proposal. The escape sign to be as per the ERs or visually equivalent from another manufacturer. Tech sub to be provided by others.

10687 Hornsey Town Hall**Town Hall & Hotel Schedule of Luminaires****10687-LUMSCHD-000(2)****WHITECODE**
CONSULTING

Ref	Description	Locations	Manufacturer and Catalogue Number	Lamp	Image
B2E	Eyelid LED IP65 Bulkhead luminaire	External Staircase	Trilux Lighting SDEL LED 2140 ETDD 03	25W LED 4000K IP65	
B3E	Round LED wall and ceiling luminaire with linear cylindrical design E' Denotes integral 3hr emergency battery pack	Staircases	Solegra WD1 OTA 2600-830 ET	19W 3000K	
D6	Downlights Circular downlight – 65mm White Finish 'E' Denotes integral 3hr emergency battery pack	Apartments Entrance Door Pin Light Communal Areas	Trilux AMATRIS G2 C04 WR LED 1400-830 ET 01	16W 3000K	
D7	Ceiling recessed trim less LED downlight with remote controlled adjustability. 22-degree beam angle. Fitting installation to be allowed for into specialist acoustic ceiling. Pan movement: 185 degrees. Tilt movement: 35 degrees.	Assembly Hall	RCL DRX5 / DRX5.0068	20W 3000K	
D8	Recessed trimless plaster-in adjustable downlight with 55° beam optic. Pending confirmation from architects.	Assembly Hall	Lucent 91413-A-XIC-BK- XTD2430	18W 3000K	
D10	Recessed trimless plaster-in adjustable downlight with 55° beam optic.	Council Chamber Lobby	Lucent Pinhole Edge 90 Accent / 91413-A-XIC-VAR-XTD2430lm	13.6W 3000K	

10687 Hornsey Town Hall**Town Hall & Hotel Schedule of Luminaires****10687-LUMSCHD-000(2)**

WHITECODE
CONSULTING

D15	Recessed trimless plaster-in adjustable downlight with 55° beam optic. VAR RAL colour finish TBC by architects to match ceiling finish.	Function Room	Lucent Pinhole Edge 90 Accent / 91413-A-XIC-VAR-XTD2430lm	13.6W 3000K	
D17	Recessed trimless plaster-in adjustable downlight with 55° beam optic.	Assembly hall	Lucent Pinhole Edge 90 Accent / 91413-A-XIC-VAR-XTD2430lm	13.6W 3000K	
E1	Recessed non-maintained EMG fitting. With open anti-panic optic	Communal Areas	Etap K9 Mini Recessed anti panic optic K9R023/3NS211	0.9W LED	
F1	Surface mounted LED table luminaire with magnetic base and integrated rechargeable battery. Local concealed switch. Ten-hour battery life. Fitting mounted into bespoke desktop detail to be developed by architects in conjunction with PTL. Fitting charged via charging station to be within concealed location by others.	Council Chamber	Davide Groppi		
F2	Floor standing IP rated external use decorative luminaire comprised of aluminium framework	Town Hall Balcony / External terrace	Deltalight Montur L P 45 LED / 232 659 83 229 02 03 mounting plate	15W	
L1	Surface mounted anti-corrosive luminaire c/w integral 3hr emergency, non-dimmable. IP65.	High level plant room above dressing Room	WHITECROFT ACL Industry (ACH34K)	27W 3865lm	

10687 Hornsey Town Hall

Town Hall & Hotel Schedule of Luminaires

10687-LUMSCHD-000(2)



WHITECODE
CONSULTING

L2	Wall-mounted strip lights	Hotel bathrooms and public lavatories	Frandsen Project		
L3	Single surface mounted luminaire made of glass fibre reinforced polyester. Diffuser made of polycarbonate with stainless steel c/ w integral 3hr emergency, non-dimmable. IP67. 'E' Denotes integral 3hr emergency battery pack	Plantrooms Hotel Facilities	FAGERHULT Kaptur Lite (34335)	45W LED 5719 lm Fixed output 4000K	
L4	Rectangular surface-mounted LED ceiling luminaire with full-surface, borderless PMMA cover	Maintenance access above assembly hall.	Trilux Opendo D2-L PW19	32W 4000K	
L9	Linear LED Strip – Top Emitting IP68	Kitchen and Bar Supper Room	Orlight LUMENFLEX - TOP	12W 4000K	
L14	Linear LED tape luminaire mounted within rigid aluminium profile with diffuse cover using fixing clips to mechanically mount fitting within coffer detail behind upstand detail by others. All lengths and dimensions to be confirmed from site measures prior to orders being placed.	Function Room	Grupo MCI 7260222/1K9-6K 15310 * 20.5 * 22	8W 2700-6000K	


10687 Hornsey Town Hall**Town Hall & Hotel Schedule of Luminaires****10687-LUMSCHD-000(2)****WHITECODE**
CONSULTING

L15	Linear LED tape luminaire	Committee Room	LPA Lighting	14.4W 3000K	
R1	Ceiling surface mounted LED luminaire	Housekeeping	Trilux Lunexo D1 CDP-1 4400 830 ETDD 01	46W 3000K 4200lm	
P1	Pendant globe light short drop	Entrance hall, co-workers	LPA Lighting	29W 3000K	
P2	Pendant globe light long drop 'E' Denotes integral 3hr emergency battery pack	Committee Room	LPA Lighting	3000K	
P3	New replica Pendant Triple pendant lights Type 2	Members Room	LPA Lighting	3000K	
P4	Pendant saucer light	Foyer	LPA Lighting	28W 3000K	

10687 Hornsey Town Hall**Town Hall & Hotel Schedule of Luminaires****10687-LUMSCHD-000(2)****WHITECODE**
CONSULTING

P7	Triple Pendant light	Mayor's parlour	LPA Lighting	3000K	
PT4-X	Decorative external lighting table lamps FF&E item by others	Town Hall Balcony / External terrace	Decorative external lighting table lamps FF&E item by others	TBC	
P7	LPA-HTH-P7-30W-DALI: TRIPLE PENDANT LIGHT,	Mayor's parlour	LPA Lighting	3x10W 3000K	
S2	Surface Mounted ceiling luminaire	Finance Office Hotel Security	Iguzzini Light Square MT15	30W LED 3000K	
T1	Magnetic Track Linear & spot lights (refer to LPA drawings for quantities)	Co-workers space	LPA lighting LT100 Linear & LT100 Spot	30W 3000K (Linear) 8W 3000K (spot)	
W1	Refurbished Existing Wall mounted Dressing Room Lights	Male and Female Dressing Room	Octant		

10687 Hornsey Town Hall**Town Hall & Hotel Schedule of Luminaires****10687-LUMSCHD-000(2)****WHITECODE**
CONSULTING

W4	Wall Mounted Light	Hotel Corridor	Details to be confirmed		
W5	Wall recessed LED horizontal pathway luminaire with flamed bronze trim TBC by Architects.	Assembly Hall	Lucent InWall IW1043-BRZ	4W 2700-4000K	
W7	Wall mounted luminaire with opal glass diffuser and weathered brass housing.	Town Hall Balcony / External terrace	Davey Lighting DP8124/BR/WE/E27	8W LED	
W8	Floor standing IP rated external luminaire	Town Hall Balcony / External terrace	Lucent InWall50 IW5056	1.5W IP66 3000K	
X1	Surface mounted dish light	Ground floor exit	LPA lighting	56W 3000K	
X2	Refurbished Existing Ceiling mounted - Small dish light 360mm in diameter 20mm height (TBC) 'E' Denotes integral 3hr emergency battery pack	Communal Areas Staircases, Toilets	LPA lighting	21W 3000K	

10687 Hornsey Town Hall**Town Hall & Hotel Schedule of Luminaires****10687-LUMSCHD-000(2)****WHITECODE**
CONSULTING

X3	Refurbished Existing Ceiling mounted Globe lights 200mm diameter 'E' Denotes integral 3hr emergency battery pack	Communal Areas Staircases' Green room	LPA lighting	9W 3000K	
X4	Refurbished Existing Ceiling mounted half-barrel strip lights 345mm wide 345mm height (TBC) 1607mm length	Communal Areas, Entrance Hall	LPA Lighting	80W 3000K	
X5	Refurbished Existing Ceiling Light Panels 475x320mm and 475x630mm	Foyer	LPA Lighting	14W -320	
X6	Refurbished Existing Ceiling Laylights to be transformed into LED light panels	Communal Areas	Octant		
X7	Ceiling light panel 375x1580mm	Vestibule	LPA Lighting	80W 3000K	
X8	Ceiling light panel 375x1580mm	Entrance Hall Stairs	LPA lighting	46W RGBW	
X9	Ceiling lighting panel 320x720mm 'E' Denotes integral 3hr emergency battery pack	Entrance Hall	LPA lighting	20W 3000K	

10687 Hornsey Town Hall**Town Hall & Hotel Schedule of Luminaires****10687-LUMSCHD-000(2)****WHITECODE**
CONSULTING

X10	Ceiling lighting panel 320x1000mm	Entrance Hall, first floor landing	LPA Lighting	28W 3000K	
X11	Exclusive LED wall and ceiling luminaire with ring-shaped light element E' Denotes integral 3hr emergency battery pack	Public Areas	Polaroniq WD2 LED2000-830	22W 3000K	
X12	Round LED wall and ceiling luminaire with linear cylindrical design E' Denotes integral 3hr emergency battery pack	Ancillary non public areas	Solegra WD1 OTA 2600-830 ET	19W 3000K	
X13	Refurbished Existing ceiling mounted luminaire with circular feature glass shade to be refurbished and relamped to an LED source approved by PTL. Fitting to be controlled via DMX. 'E' Denotes integral 3hr emergency battery pack	Assembly Hall	Octant		
X17	Refurbished Existing ceiling suspended pendant luminaire with spherical feature glass cover to be refurbished and relamped to an LED source approved by PTL. All refurbishment works to meet with current building regs and any relevant statutory requirements.	Function room	Octant		
X18	Refurbished Existing ceiling suspended pendant luminaire with spherical feature glass cover to be refurbished and relamped to an LED source approved by PTL.	Committee Room			

10687 Hornsey Town Hall**Town Hall & Hotel Schedule of Luminaires****10687-LUMSCHD-000(2)****WHITECODE**
CONSULTING

X19	Ceiling Light Panel	Assembly Hall	LPA Lighting		
X20	Ceiling Light Panel	Assembly Hall	LPA Lighting		
X21	Ceiling Light Panel	Council Chamber	LPA Lighting	28W	
X22	Ceiling Light Panel	Cinema	LPA Lighting	25W	
X23	Ceiling Light Panel	Cinema	LPA Lighting	104W	
Z1	External Round surface-mounted LED luminaire for wall and ceiling mounting, Degree of protection IP 65. 'E' Denotes integral 3hr emergency battery pack	Exterior Entrances Cycle Bay Loading Bay	Trilux SABR LED	20W 4000K	
	Illuminated Exit Sign Surface plate with floating glass (Illuminated).	Corridor and escape routes	Phillip Payne (2-NI)	4W (LED) DALI	

Contact details:

Whitecode Consulting Ltd
26-27 The Hill
Northfleet
Gravesend
Kent
DA11 9EU

t: 01322 289977

e: design@whitecode.co.uk



WHITECODE
CONSULTING