



RIGHT OF LIGHT
CONSULTING
Chartered Surveyors

Right of Light Consulting

Burley House
15-17 High Street
Rayleigh
Essex
SS6 7EW

TEL 0800 197 4836

E-MAIL enquiries@right-of-light.co.uk

WEBSITE www.right-of-light.co.uk

Daylight and Sunlight Report (Within Development) 84 Cornwall Road, London N15 5AR

22 December 2020

Right of Light Consulting

Burley House
15-17 High Street
Rayleigh
Essex SS6 7EW

Tel: 0800 197 4836

www.right-of-light.co.uk

CONTENTS

1 EXECUTIVE SUMMARY	2
1.1 Overview	2
2 INFORMATION SOURCES	3
2.1 Documents Considered	3
3 METHODOLOGY OF THE STUDY	4
3.1 Local Planning Policy.....	4
3.2 National Planning Policy Framework.....	4
3.3 Interior Daylighting.....	5
3.4 Sunlight to Windows	7
3.5 Overshadowing to Gardens and Open Spaces	7
4 RESULTS OF THE STUDY	8
4.1 Window Reference Points and No Sky Line Contours	8
4.2 Numerical Results.....	8
4.3 Interior Daylighting.....	8
4.4 Sunlight to Windows	8
4.5 Overshadowing to Gardens and Open Spaces	9
4.6 Conclusion.....	9
5 CLARIFICATIONS	10
5.1 General.....	10

APPENDICES

APPENDIX 1	WINDOW KEY & NO SKY LINE CONTOURS
APPENDIX 2	DAYLIGHT AND SUNLIGHT CALCULATIONS
APPENDIX 3	OVERSHADOWING TO GARDENS AND OPEN SPACES

1 EXECUTIVE SUMMARY

1.1 Overview

- 1.1.1 Right of Light Consulting has been commissioned by Philip Pank Partnership to undertake a daylight and sunlight study in connection with the development at 84 Cornwall Road, London N15 5AR. The aim of the study is to check whether or not the proposed development receives satisfactory levels of daylight and sunlight.
- 1.1.2 The study is based on the numerical tests laid down in the Building Research Establishment (BRE) guide 'Site Layout Planning for Daylight and Sunlight: a good practice guide, 2nd Edition' by P J Littlefair 2011.
- 1.1.3 Appendix 1 identifies the windows analysed in this study. The numerical test results (including all calculation workings) are provided in Appendix 2. No sky line contours are presented in Appendix 1.
- 1.1.4 Right of Light Consulting confirms that the proposed development design achieves a high level of compliance with the BRE recommendations. We are therefore of the opinion that the proposed development is acceptable in terms of daylight and sunlight.

2 INFORMATION SOURCES

2.1 Documents Considered

2.1.1 This report is based on the following drawings:

Unit One Architects Ltd

0224 - 101	Proposed Location Plan	Rev A04
	Proposed Block Plan	
0224 - 102	Proposed Site Plan	Rev A11
0224 - 103	Proposed Floor Plans Block 1	Rev A05
0224 - 104	Proposed Ground Floor Plan Block 2	Rev A09
0224 - 105	Proposed First and Second Floor Plan Block 2	Rev A09
0224 - 106	Proposed North Elevation Block 2	Rev A09
0224 - 107	Proposed East Elevation Block 1	Rev A06
0224 - 108	Proposed East Elevation Block 2	Rev A08
0224 - 109	Proposed South Elevation Block 1 & 2	Rev A08
0224 - 110	Proposed West Elevation Block 1	Rev A07
0224 - 111	Proposed West Elevation Block 2	Rev A10
0224 - 112	Proposed Roof Plan	Rev A01

3 METHODOLOGY OF THE STUDY

3.1 Local Planning Policy

- 3.1.1 We understand that the Local Authority take the conventional approach of considering daylight and sunlight amenity with reference to the various numerical tests laid down in the Building Research Establishment (BRE) guide 'Site Layout Planning for Daylight and Sunlight: a guide to good practice, 2nd Edition' by P J Littlefair 2011. A new European standard BS EN 17037 'Daylight in Buildings' was published in May 2019. An update to the BRE guide to take into account the European standard is expected sometime in 2021. It is not yet clear, how and to what extent, the European recommendations will be adopted by the BRE and Local Authorities.
- 3.1.2 The standards set out in the BRE guide are intended to be used flexibly. The BRE guide states:
- 3.1.3 "The guide is intended for building designers and their clients, consultants and planning officials. The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly, since natural lighting is only one of many factors in site layout design."

3.2 National Planning Policy Framework

- 3.2.1 The BRE numerical guidelines should be considered in the context of the National Planning Policy Framework (NPPF), which stipulates that local planning authorities should take a flexible approach to daylight and sunlight to ensure the efficient use of land. The NPPF states:
- 3.2.2 "Local planning authorities should refuse applications which they consider fail to make efficient use of land, taking into account the policies in this Framework. In this context, when considering applications for housing, authorities should take a flexible approach in applying policies or guidance relating to daylight and sunlight, where they would otherwise inhibit making efficient use of a site (as long as the resulting scheme would provide acceptable living standards)."

3.3 Interior Daylighting

- 3.3.1 The interior daylighting recommendations set out in BRE guide are based on British Standard BS 8206 Part 2 and the Chartered Institute of Building Services Engineers Applications Manual on window design. Collectively, the guides set out three main criteria for interior daylighting. These are summarised as follows:

Test 1 Average Daylight Factor (df)

- 3.3.2 The Average Daylight Factor can be calculated using the following formula:

$$df = \frac{T A_w \theta}{A (1-R^2)} \%$$

Where

T is the diffuse visible transmittance of the glazing
Aw is the net glazed area of the window (m²)
A is the total area of the room surfaces (m²)
R is their average reflectance
θ is the angle of visible sky in degrees

- 3.3.3 The Average Daylight factor test is applied to habitable rooms within domestic properties. A kitchen is generally deemed to be a habitable room if it is large enough to accommodate a dining area. If the kitchen is small or if the property has a separate dining area then the accepted practice is to treat the kitchen as a non habitable room.
- 3.3.4 For the purpose of this study we have assumed BRE internal reflectance values pertaining to medium wooden floors (Coefficient value of 0.4), light painted walls (0.8) and matte white painted ceilings (0.85).
- 3.3.5 For the purpose of this study we have assumed the windows consist of modern double-glazed units with a frame to glazing ratio of 0.8. A maintenance factor has been applied to consider the effect of dirt and grime on the visibility of the window. On this basis, the transmittance value used within this study is 0.68.
- 3.3.6 To achieve a predominately daylit space, the guide recommends an Average Daylight Factor of 5% or more if there is no supplementary electric lighting, or 2% or more if supplementary lighting is provided. There are additional minimum recommendations for dwellings of 2% for kitchens, 1.5% for living rooms and 1% for bedrooms.

-
- 3.3.7 The BRE guide does not give guidance on how to apply the ADF test to spaces which contain a mix of room uses e.g. open plan living, dining and kitchen areas. For this assessment we have set a target of 2% with the aim of reaching the predominately daylight benchmark.
- 3.3.8 A special procedure is required for floor to ceiling windows such as patio doors. If part of a window is below the height of the working plane (a horizontal plane 0.85m above the floor in housing), this portion should be treated as a separate window. The ADF for this window has an extra factor applied to it, to take account of the reduced effectiveness of low level glazing in lighting the room. A value equal to the floor reflectance may be taken for this factor. The ADF for the portion of the window above the working plane is calculated in the normal way without this additional factor, and the ADFs for the two portions are added together.
- 3.3.9 Where a window has a large obstruction in front of it, the angle of visible sky can be increased by around 6° assuming the obstruction is painted a light colour.

Test 2 Room Depth

- 3.3.10 If a daylight room is lit by windows in one wall only, the depth of the room L should not exceed the limiting value given by:

$$\frac{L}{W} + \frac{L}{H} \leq \frac{2}{1-R_b}$$

Where

W is the room width
H is the window-head height above floor level
R_b is the average reflectance of the surfaces in the rear half of the room

Test 3 Position of the no sky line

- 3.3.11 If a significant area of the working plane lies beyond the no sky line (i.e. it receives no direct skylight), then the distribution of daylight in the room will look poor and supplementary electric lighting will be required.

3.3.12 The no sky line assessment is not applicable where a room derives its daylight solely from a light well or atrium. In these situations the room relies on borrowed light instead of direct skylight.

3.4 Sunlight to Windows

3.4.1 The BRE guide recommends that where possible each dwelling should have at least one main living room window that faces within 90 degrees of due south. However, the guide acknowledges that this is not always possible when it comes to flats.

3.4.2 The BRE sunlight tests should be applied to all main living rooms and conservatories which have a window which faces within 90 degrees of due south. The guide states that sunlight is viewed as less important in kitchens and bedrooms. In non-domestic buildings, any spaces which are deemed to have a specific requirement for sunlight should be checked.

3.4.3 The BRE guide recommends that main living room windows should receive 25% of the total annual probable sunlight hours, including 5% of the annual probable sunlight hours during the winter months between 21st September and 21st March.

3.5 Overshadowing to Gardens and Open Spaces

3.5.1 The availability of sunlight should be checked for all open spaces where sunlight is required. This would normally include:

- Gardens, usually the main back garden of a house
- Parks and playing fields
- Children's playgrounds
- Outdoor swimming pools and paddling pools
- Sitting out areas, such as those between non-domestic buildings and in public squares
- Focal points for views such as a group of monuments or fountains.

3.5.2 The BRE guide recommends that for an open space to appear adequately lit throughout the year, at least 50% of its area should receive two hours of sunlight on 21st March.

4 RESULTS OF THE STUDY

4.1 Window Reference Points and No Sky Line Contours

4.1.1 Refer to Appendix 1 for a drawing which identifies the positions of the windows analysed in this study. The no skyline contours for the habitable rooms are also presented in Appendix 1.

4.2 Numerical Results

4.2.1 The numerical test results including all calculation workings are provided in Appendix 2.

4.3 Interior Daylighting

4.3.1 All rooms with a requirement for daylight achieve or surpass the BRE Average Daylight Factor targets.

4.3.2 All rooms pass the room depth test.

4.3.3 The BRE guide does not give fixed numerical pass/fail criteria for the No Sky Line test when applied to new dwellings (guidance is given for when this test is applied to existing neighbouring buildings). However, for completeness, we have illustrated the no sky line contours in Appendix 1.

4.4 Sunlight to Windows

4.4.1 All living rooms have been tested for direct sunlight. The results are presented in Appendix 2. Not all windows receive ideal levels of direct sunlight. However, the BRE guide explains that for apartments it may not be possible to have every living room facing within 90 degrees of due south. The guide goes on to explain that the number of north facing living rooms should be minimised. Figure 26 on page 15 of the guide illustrates an example of good layout design where only 1 out of 5 apartments (20%) have only north facing windows. In the case of the proposed development at 84 Cornwall Road, none of the units have only north facing living room windows. The proposed development therefore satisfies the BRE direct sunlight to windows requirements.

4.5 Overshadowing to Gardens and Open Spaces

- 4.5.1 The gardens and amenity spaces have been tested for the proposed development. The results confirm that the majority of the gardens meet the BRE recommendations, with the exception of garden 2. However, there is at least one amenity area at each proposed block which meets the recommendations. In addition, the BRE guide is intended to be used flexibly, particularly in urban locations, and in this instance, we are of the opinion that it is unreasonable to expect that all the amenity areas will meet the BRE recommendations given the unavoidable constraints of the site and the obstructions created by the existing neighbouring properties.

4.6 Conclusion

- 4.6.1 Right of Light Consulting confirms that the proposed development design achieves a high level of compliance with the BRE recommendations. We are therefore of the opinion that the proposed development is acceptable in terms of daylight and sunlight.

5 CLARIFICATIONS


5.1 General

- 5.1.1 The report provided is solely for the use of the client and no liability to anyone else is accepted.
- 5.1.2 The study is limited to assessing daylight, sunlight and overshadowing of the proposed development as set out in section 2.1, (and) 3.1 and 3.3 of the BRE Guide.
- 5.1.3 The study has been undertaken without access to the proposed development site or neighbouring properties. The study is based on the information listed in section 2 of this report.
- 5.1.4 This study does not calculate the effects of trees and hedges on daylight, sunlight and overshadowing to gardens. The BRE guide states that trees should sometimes be taken into account, e.g. where there is concern that future occupants of the dwelling may want the trees to be cutdown if they block too much skylight or sunlight. We are not aware of any such circumstances, in this instance.
- 5.1.5 We have undertaken the survey following the guidelines of the RICS publication "Surveying Safely". Where limited access is available, assumptions will have been made.
- 5.1.6 This report is based upon and subject to the scope of work set out in Right of Light Consulting's quotation and standard terms and conditions.

APPENDICES

APPENDIX 1

WINDOW KEY & NO SKY LINE CONTOURS

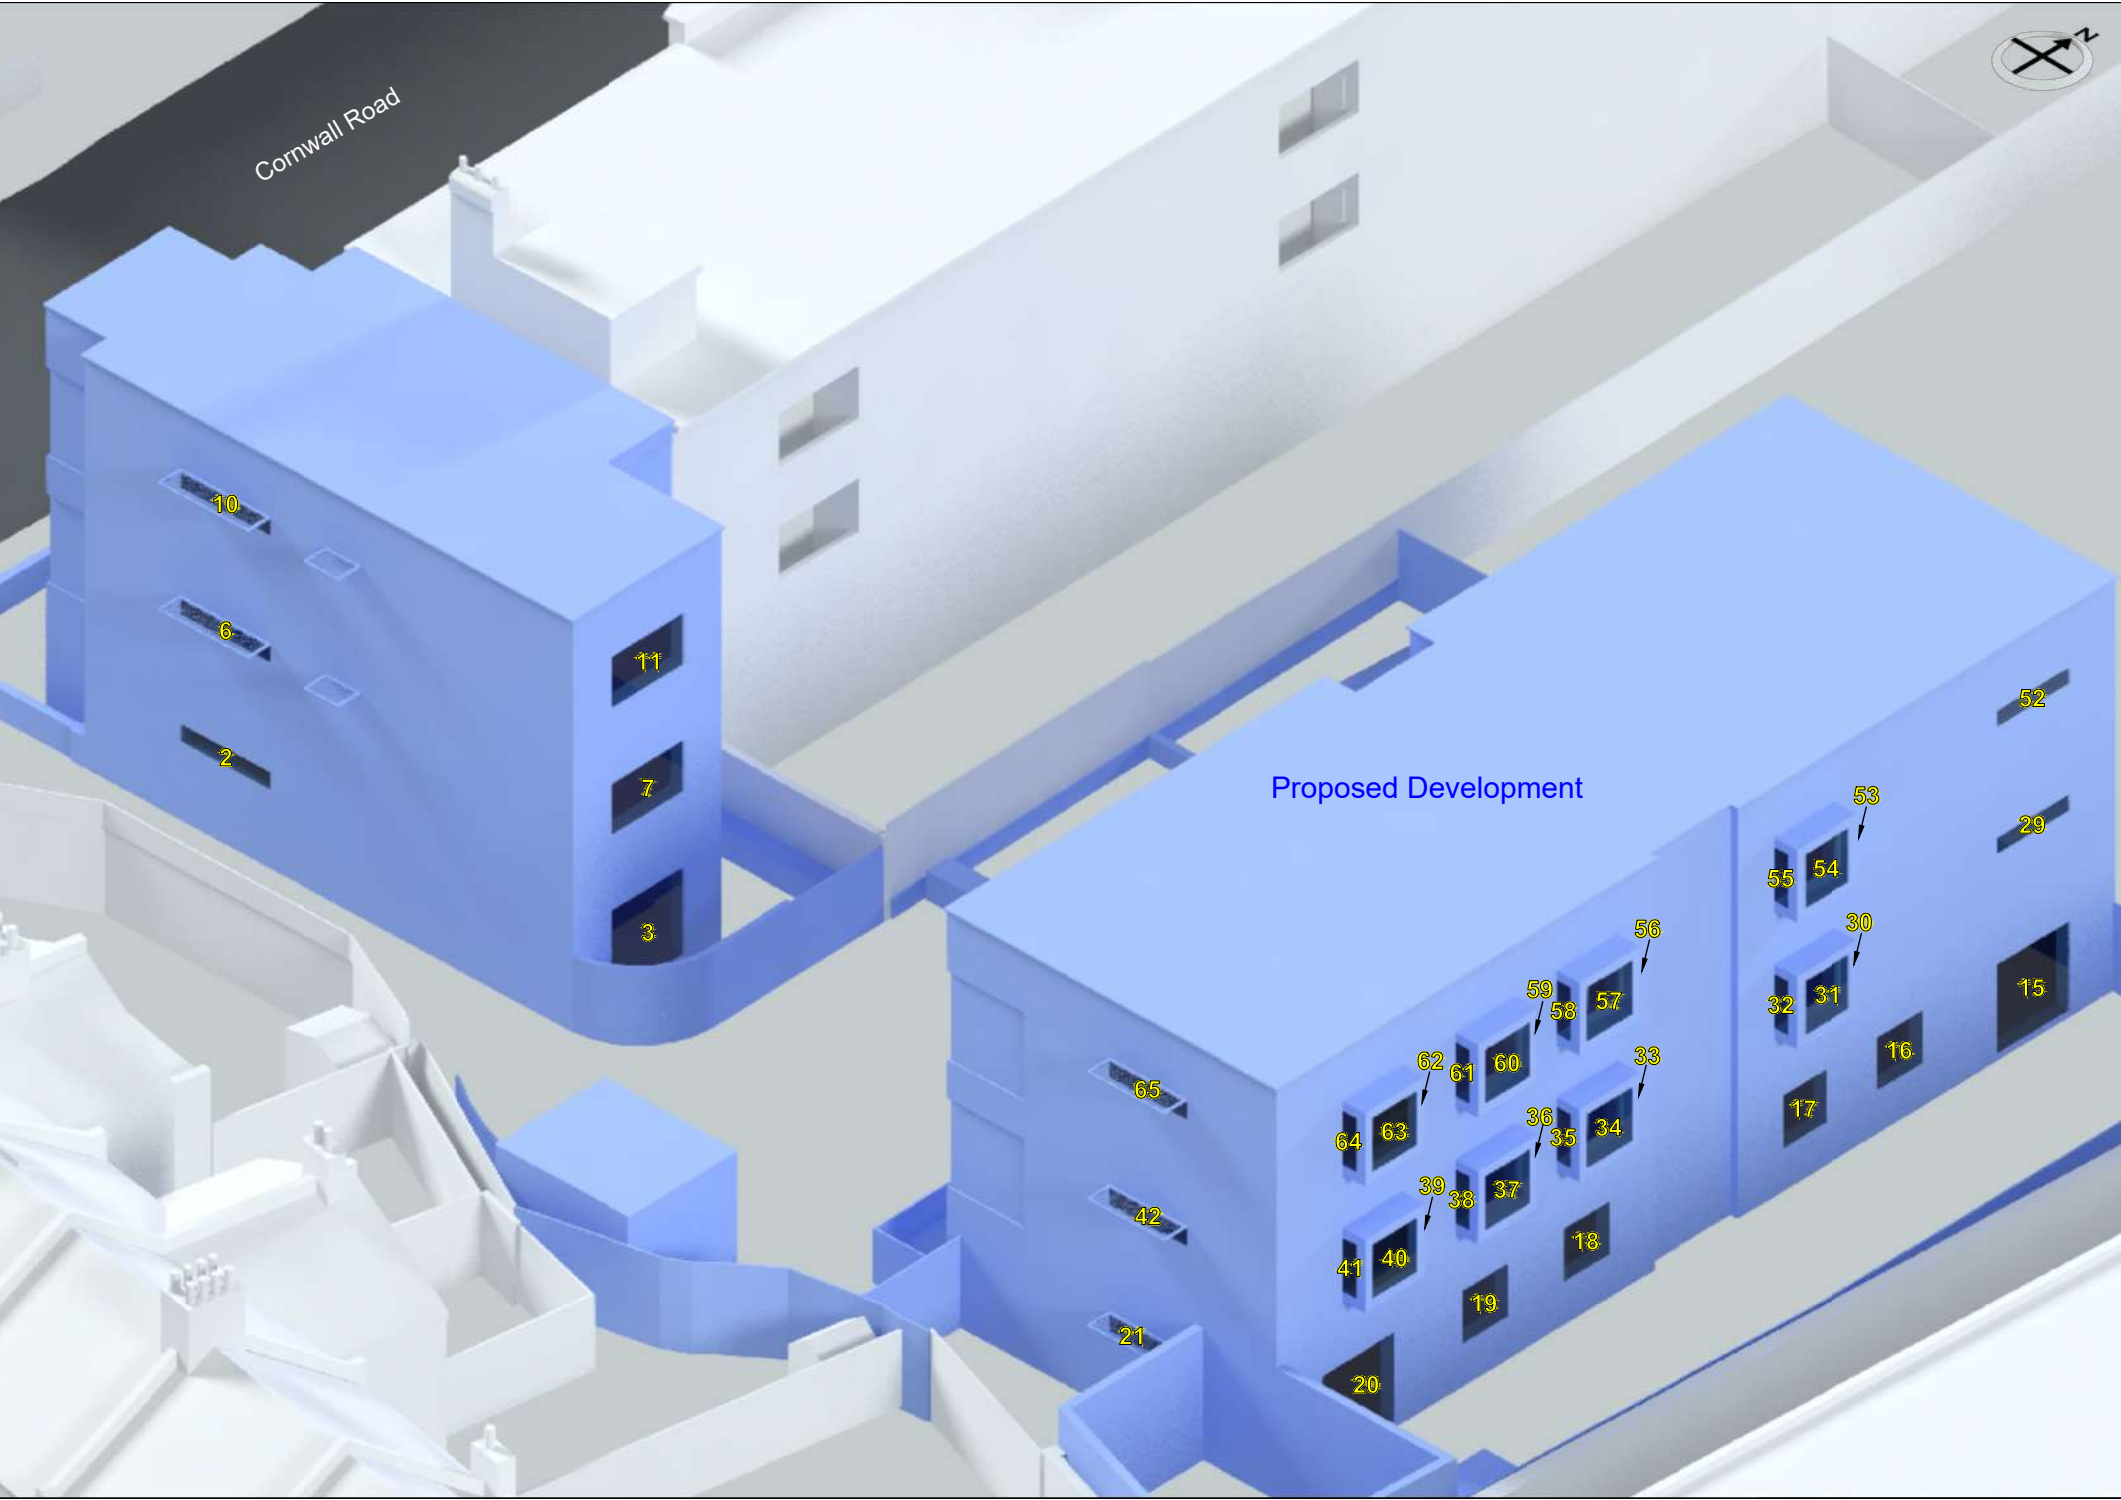

Cornwall Road

Proposed Development



10

6

2

11

7

3

52

29

53

55

54

30

32

31

16

15

17

56

59

58

57

33

62

61

60

64

63

36

35

34

39

38

37

18

41

40

19

21

20

65

42



Proposed Development

49
48
47
46
26
25
24
23

68
67
45
44

66
43
22

65
42
21

10
6
2

9
5
1

Cornwall Road



Proposed Development

Cornwall Road





Proposed Development

51

28

14

13

27

12

26

49

25

24

47

46

48

23

68

45

22

44

67

43

66

8

4

9


5

1

Cornwall Road

Proposed Ground Floor Block 1

Window Key and No Sky Line Contours

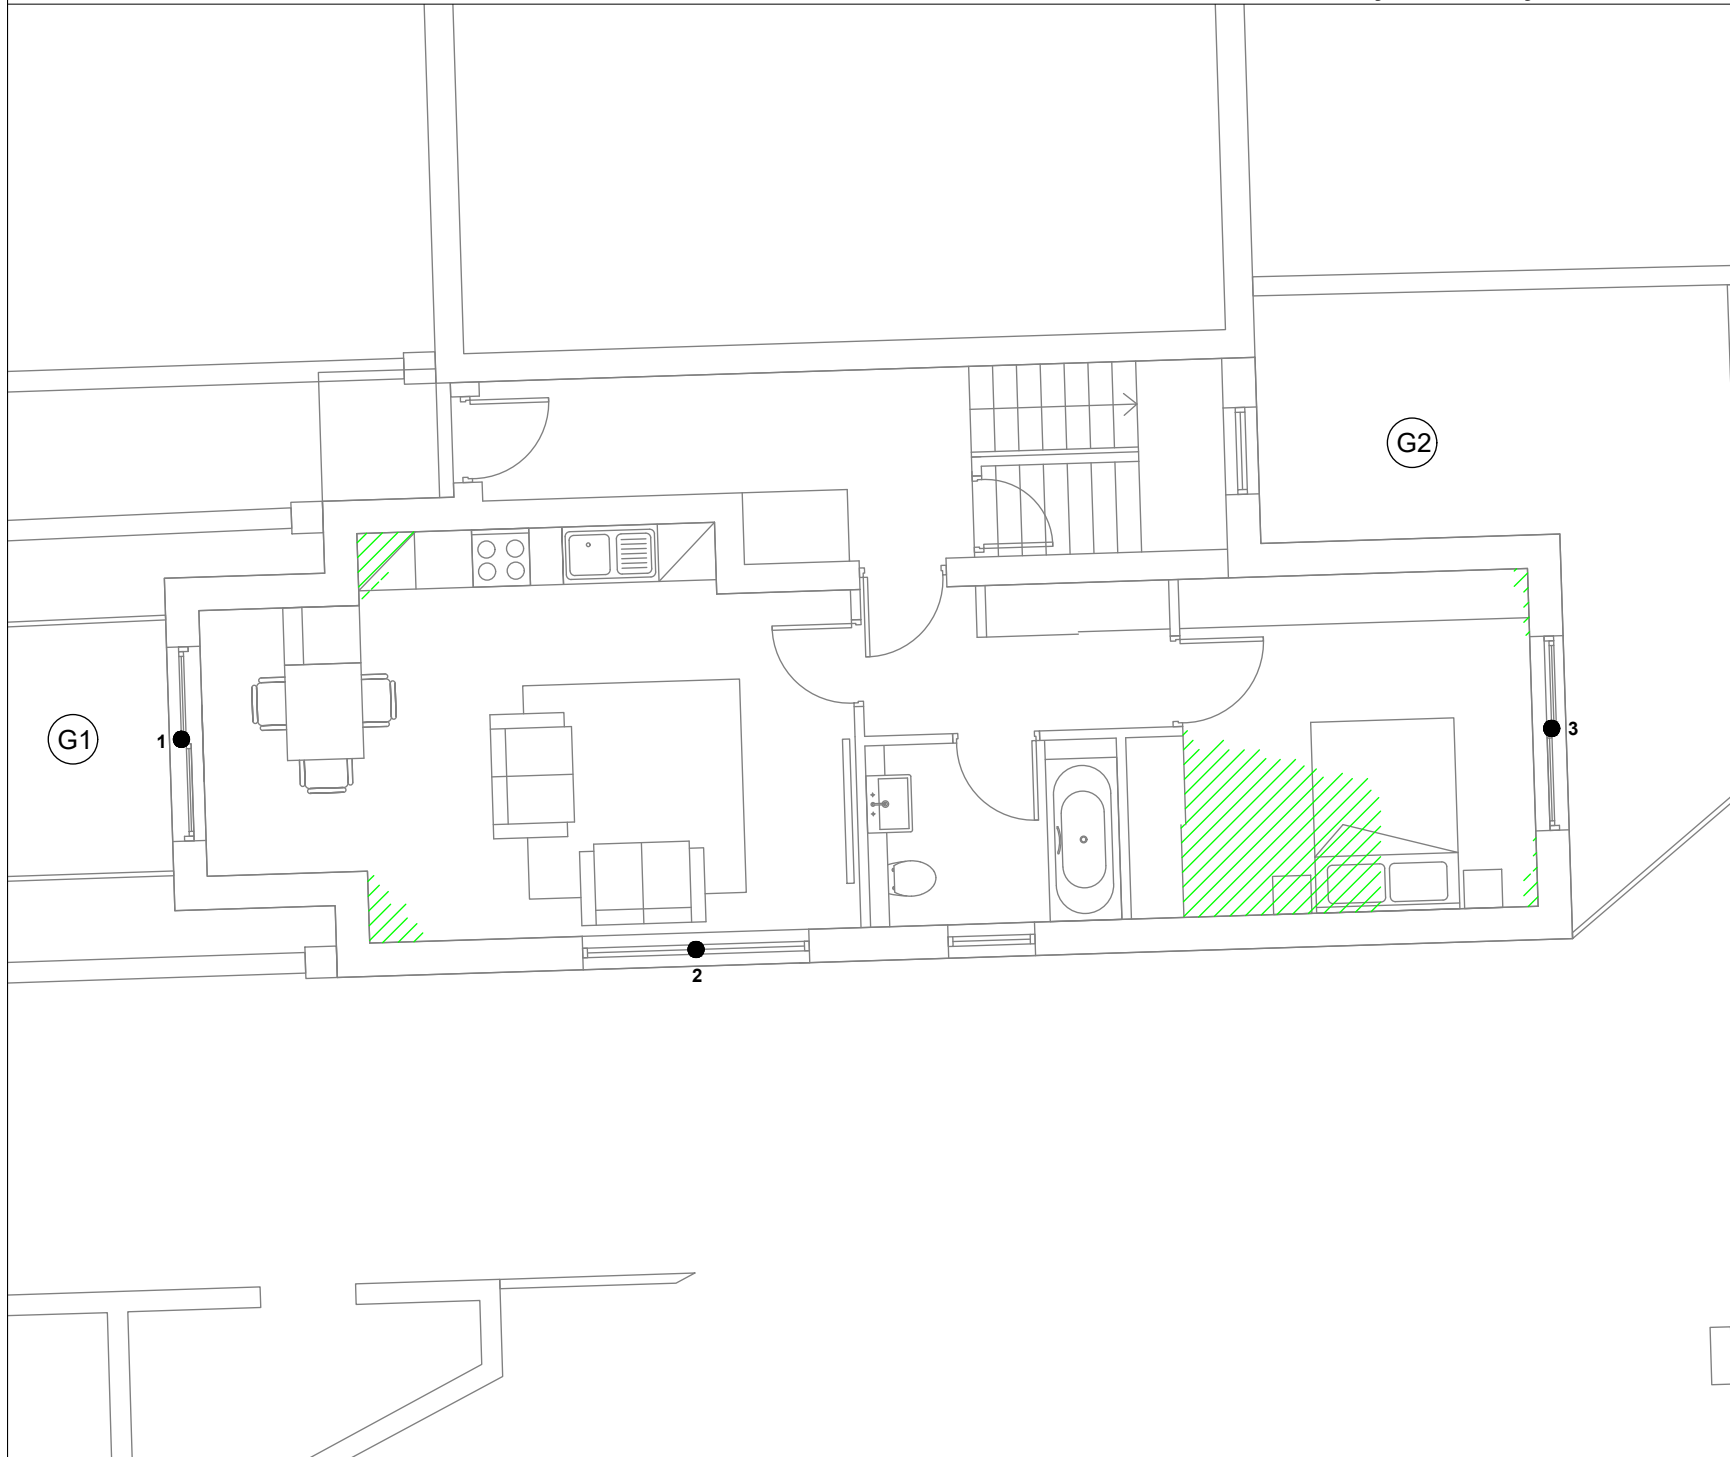

Key:

- Window reference
- G1 Gardens and Amenity Areas
- Area receives no direct sky light (applied to habitable rooms)
- Area does receive direct sky light.
- Light aperture.

Project Name: 84 Cornwall Road, London N15 5AR

Drawing Title: Window Key and No Sky Line Contours

Scale: Do not scale

Drawing No: 1 of 6

Rev. .

Rev	Date	Details of revision

Key:


● Window reference

G1 Gardens and Amenity Areas

Area receives no direct sky light
(applied to habitable rooms)

Area does receive direct sky light.

Light aperture.

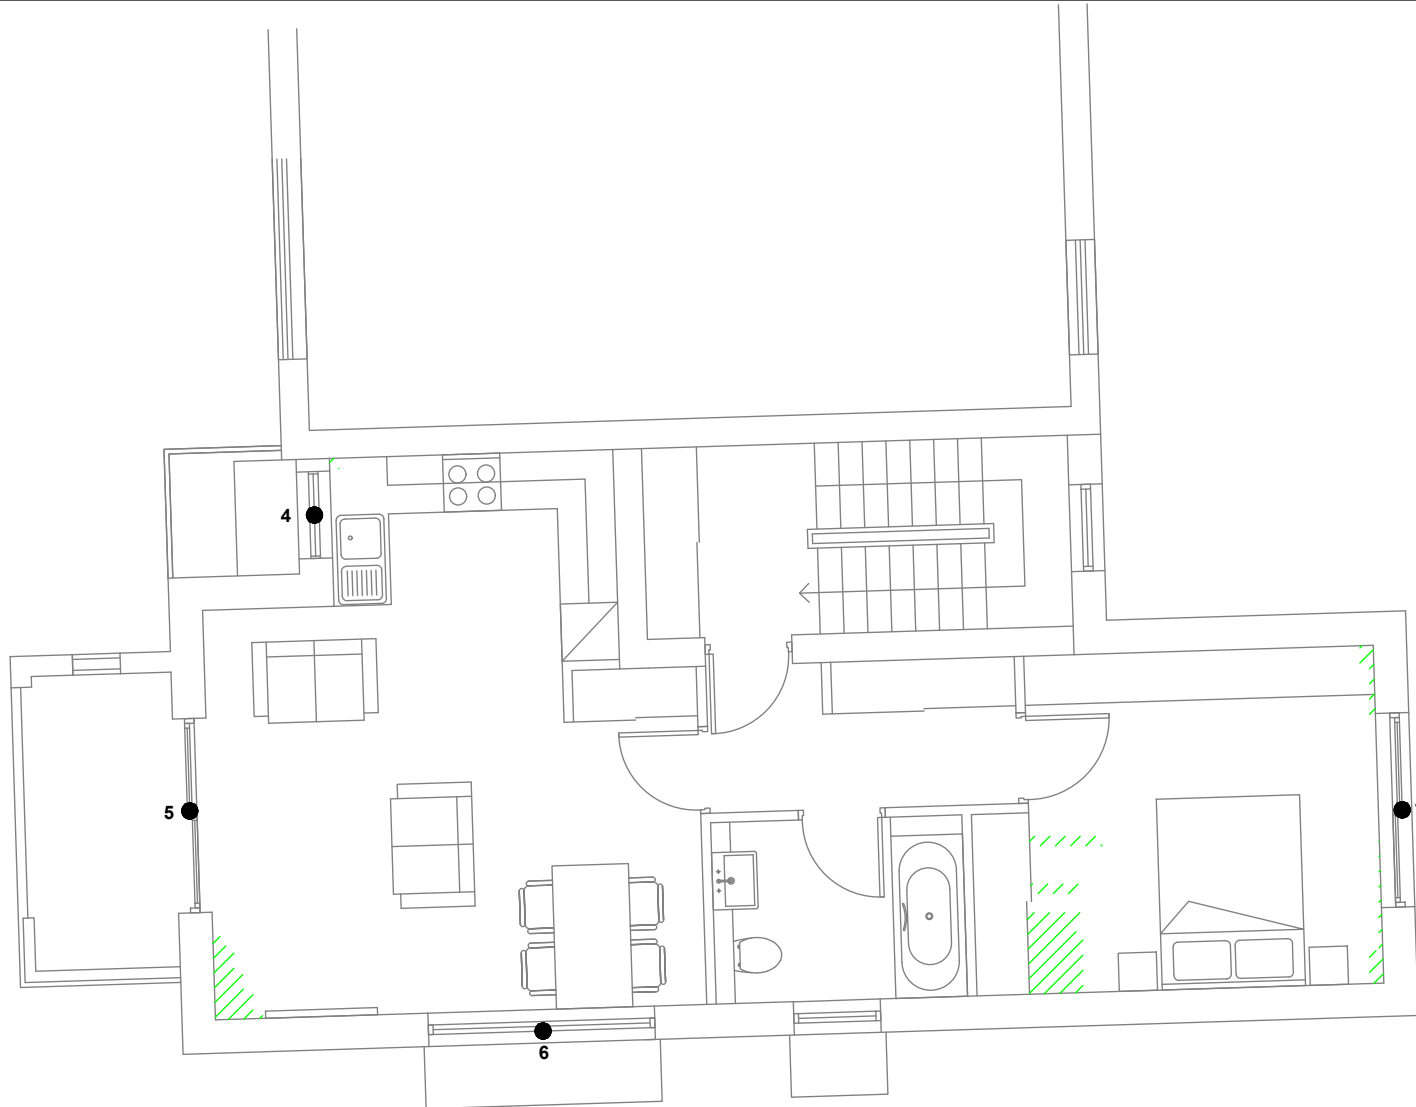

Project Name: 84 Cornwall Road, London N15 5AR

Drawing Title: Window Key and No Sky Line Contours

Scale: Do not scale

Drawing No: 2 of 6

Rev. .

Rev	Date	Details of revision

RIGHT OF LIGHT CONSULTING
Chartered Surveyors

Right of Light Consulting
Burley House
15 - 17 High Street
Rayleigh
Essex
SS6 7EW
TEL 0800 197 4836
E-MAIL enquiries@right-of-light.co.uk
WEBSITE www.right-of-light.co.uk



Key:

● Window reference

G1 Gardens and Amenity Areas

Area receives no direct sky light
(applied to habitable rooms)

Area does receive direct sky light.

Light aperture.

Project Name: 84 Cornwall Road, London N15 5AR

Drawing Title: Window Key and No Sky Line Contours

Scale: Do not scale

Drawing No: 3 of 6

Rev. .

Rev	Date	Details of revision



Right of Light Consulting

Burley House
15 - 17 High Street
Rayleigh
Essex
SS6 7EW
TEL 0800 197 4836
E-MAIL enquiries@right-of-light.co.uk
WEBSITE www.right-of-light.co.uk



Key:

- Window reference
- G1 Gardens and Amenity Areas
- Area receives no direct sky light (applied to habitable rooms)
- Area does receive direct sky light.
- Light aperture.

Project Name: 84 Cornwall Road, London N15 5AR

Drawing Title: Window Key and No Sky Line Contours

Scale: Do not scale


Drawing No: 4 of 6

Rev. .

Rev	Date	Details of revision



Right of Light Consulting
 Burley House
 15 - 17 High Street
 Rayleigh
 Essex
 SS6 7EW
 TEL 0800 197 4836
 E-MAIL enquiries@right-of-light.co.uk
 WEBSITE www.right-of-light.co.uk

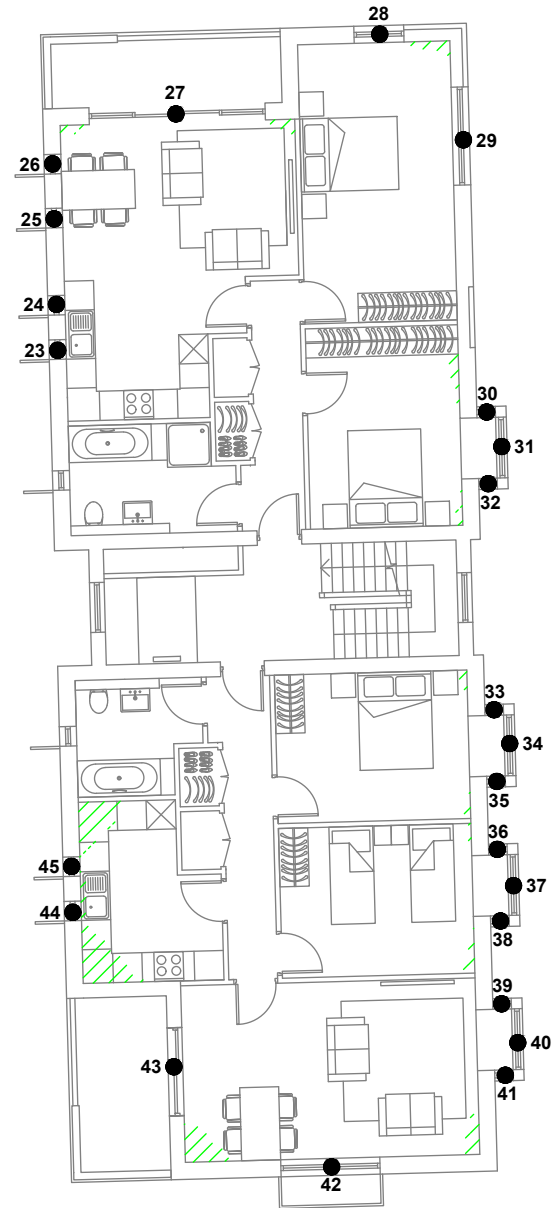

Key:

- Window reference
- G1 Gardens and Amenity Areas
- Area receives no direct sky light (applied to habitable rooms)
- Area does receive direct sky light.
- Light aperture.

Project Name: 84 Cornwall Road, London N15 5AR

Drawing Title: Window Key and No Sky Line Contours


Scale: Do not scale

Drawing No: 5 of 6

Rev. .

Rev	Date	Details of revision


RIGHT OF LIGHT CONSULTING
 Chartered Surveyors
Right of Light Consulting
 Burley House
 15 - 17 High Street
 Rayleigh
 Essex
 SS6 7EW
 TEL 0800 197 4836
 E-MAIL enquiries@right-of-light.co.uk
 WEBSITE www.right-of-light.co.uk

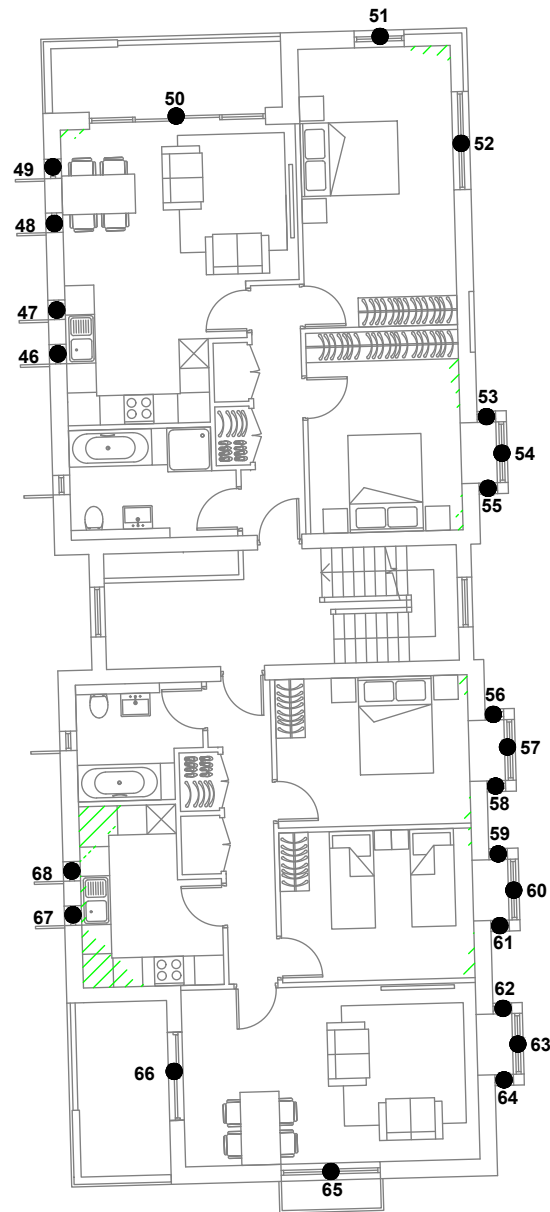

Key:

- Window reference
- G1 Gardens and Amenity Areas
- Area receives no direct sky light (applied to habitable rooms)
- Area does receive direct sky light.
- Light aperture.

Project Name: 84 Cornwall Road, London N15 5AR

Drawing Title: Window Key and No Sky Line Contours

Scale: Do not scale

Drawing No: 6 of 6

Rev. .

Rev	Date	Details of revision


RIGHT OF LIGHT CONSULTING
 Chartered Surveyors
Right of Light Consulting
 Burley House
 15 - 17 High Street
 Rayleigh
 Essex
 SS6 7EW
 TEL 0800 197 4836
 E-MAIL enquiries@right-of-light.co.uk
 WEBSITE www.right-of-light.co.uk

APPENDIX 2

DAYLIGHT AND SUNLIGHT CALCULATIONS

Appendix 2 - Average Daylight Factor (ADF)

84 Cornwall Road, London N15 5AR

Reference	Target ADF based on room use		T	Average Daylight Factor Coefficients			Theta	Actual
	Primary room use	ADF		Aw	A	R		ADF
<u>Proposed Block 1</u>								
<u>Ground Floor Block 1</u>								
Window 1 (lower)	Living/Dining/Kitchen	2.0%	0.68	1.56	110.32	0.69	76.4	0.6%
Window 1 (upper)			0.68	2.2	110.32	0.69	78.5	2.0%
Window 2			0.68	0.85	110.32	0.69	68.1	0.7%
Total ADF for room								
Window 3 (lower)	Bedroom	1.0%	0.68	1.56	64.43	0.69	51.1	0.6%
Window 3 (upper)			0.68	2.2	64.43	0.69	61.7	2.7%
Total ADF for room								
<u>First Floor Block 1</u>								
Window 4	Living/Dining/Kitchen	2.0%	0.68	1.23	113.26	0.69	53.5	0.7%
Window 5 (lower)			0.68	1.56	113.26	0.69	38.7	0.3%
Window 5 (upper)			0.68	2.29	113.26	0.69	25.3	0.7%
Window 6			0.68	0.85	113.26	0.69	43.7	0.4%
Total ADF for room								2.1%
Window 7	Bedroom	1.0%	0.68	2.2	65.16	0.71	71.2	3.3%
<u>Second Floor Block 1</u>								
Window 8	Living/Dining/Kitchen	2.0%	0.68	1.23	126.03	0.7	56.2	0.7%
Window 9 (lower)			0.68	1.56	126.03	0.7	39.9	0.3%
Window 9 (upper)			0.68	2.29	126.03	0.7	28.0	0.7%
Window 10			0.68	0.85	126.03	0.7	49.6	0.4%
Total ADF for room								2.1%
Window 11	Bedroom	1.0%	0.68	2.2	73.13	0.72	81.8	3.4%

Appendix 2 - Average Daylight Factor (ADF)

84 Cornwall Road, London N15 5AR

Reference	Target ADF based on room use		Average Daylight Factor Coefficients					Actual	
	Primary room use	ADF	T	Aw	A	R	Theta	ADF	
<u>Proposed Block 2</u>									
<u>Ground Floor Block 2</u>									
Window 12	Living/Dining/Kitchen	2.0%	0.68	1.42	137.72		0.69	58.9	0.8%
Window 13			0.68	0.68	137.72		0.69	67.3	0.4%
Window 14			0.68	0.68	137.72		0.69	66.0	0.4%
Window 15 (lower)			0.68	1.54	137.72		0.69	59.0	0.3%
Window 15 (upper)			0.68	2.27	137.72		0.69	65.4	1.4%
Total ADF for room									
Window 16	Bedroom	1.0%	0.68	1.4	53.32		0.72	64.7	2.4%
Window 17	Bedroom	1.0%	0.68	1.4	69.67		0.72	63.0	1.8%
Window 18	Bedroom	1.0%	0.68	1.4	77.74		0.72	61.9	1.6%
Window 19	Bedroom	1.0%	0.68	1.4	51.94		0.72	61.1	2.3%
Window 20 (lower)	Living/Dining/Kitchen	2.0%	0.68	1.54	137.7		0.69	52.9	0.3%
Window 20 (upper)			0.68	2.27	137.7		0.69	58.1	1.2%
Window 21			0.68	0.78	137.7		0.69	36.5	0.3%
Window 22			0.68	1.42	137.7		0.69	63.2	0.9%
Total ADF for room									2.7%
<u>First Floor Block 2</u>									
Window 23	Living/Dining/Kitchen	2.0%	0.68	0.4	108.24		0.67	54.6	0.2%
Window 24			0.68	0.4	108.24		0.67	57.9	0.3%
Window 25			0.68	0.4	108.24		0.67	56.3	0.3%
Window 26			0.68	0.4	108.24		0.67	58.6	0.3%
Window 27 (lower)			0.68	2.76	108.24		0.67	39.1	0.5%
Window 27 (upper)			0.68	4.07	108.24		0.67	24.2	1.1%
Total ADF for room								2.7%	
Window 28	Bedroom	1.0%	0.68	0.97	81.23		0.71	74.9	1.2%
Window 29			0.68	0.68	81.23		0.71	73.5	0.9%
Total ADF for room									2.1%

Appendix 2 - Average Daylight Factor (ADF)

84 Cornwall Road, London N15 5AR

Reference	Target ADF based on room use		Average Daylight Factor Coefficients					Actual
	Primary room use	ADF	T	Aw	A	R	Theta	ADF
Window 30 (lower)	Bedroom	1.0%	0.68	0.01	57.83	0.71	47.1	0.0%
Window 30 (upper)			0.68	0.43	57.83	0.71	47.7	0.5%
Window 31 (lower)			0.68	0.03	57.83	0.71	72.5	0.0%
Window 31 (upper)			0.68	1.4	57.83	0.71	74.6	2.5%
Window 32 (lower)			0.68	0.01	57.83	0.71	46.0	0.0%
Window 32 (upper)			0.68	0.43	57.83	0.71	47.1	0.5%
Total ADF for room								3.5%
Window 33 (lower)	Bedroom	1.0%	0.68	0.01	60.42	0.71	46.4	0.0%
Window 33 (upper)			0.68	0.43	60.42	0.71	47.3	0.5%
Window 34 (lower)			0.68	0.03	60.42	0.71	72.1	0.0%
Window 34 (upper)			0.68	1.4	60.42	0.71	74.3	2.4%
Window 35 (lower)			0.68	0.01	60.42	0.71	38.3	0.0%
Window 35 (upper)			0.68	0.43	60.42	0.71	39.6	0.4%
Total ADF for room								3.3%
Window 36 (lower)	Bedroom	1.0%	0.68	0.01	60.78	0.71	38.6	0.0%
Window 36 (upper)			0.68	0.43	60.78	0.71	40.0	0.4%
Window 37 (lower)			0.68	0.03	60.78	0.71	72.1	0.0%
Window 37 (upper)			0.68	1.4	60.78	0.71	74.4	2.3%
Window 38 (lower)			0.68	0.01	60.78	0.71	41.0	0.0%
Window 38 (upper)			0.68	0.43	60.78	0.71	42.3	0.4%
Total ADF for room								3.1%
Window 39 (lower)	Living/Dining	1.5%	0.68	0.01	96.02	0.67	40.4	0.0%
Window 39 (upper)			0.68	0.43	96.02	0.67	41.8	0.2%
Window 40 (lower)			0.68	0.03	96.02	0.67	72.4	0.0%
Window 40 (upper)			0.68	1.4	96.02	0.67	74.7	1.4%
Window 41 (lower)			0.68	0.01	96.02	0.67	50.3	0.0%
Window 41 (upper)			0.68	0.43	96.02	0.67	51.0	0.3%
Window 42			0.68	0.78	96.02	0.67	45.1	0.5%
Window 43 (lower)			0.68	1.38	96.02	0.67	26.8	0.2%
Window 43 (upper)			0.68	2.04	96.02	0.67	11.8	0.3%
Total ADF for room								2.9%

Appendix 2 - Average Daylight Factor (ADF)

84 Cornwall Road, London N15 5AR

Reference	Target ADF based on room use			Average Daylight Factor Coefficients				Actual
	Primary room use	ADF	T	Aw	A	R	Theta	ADF
Window 44	Kitchen	N/A	0.68	0.4	54.43	0.73	54.2	0.6%
Window 45			0.68	0.4	54.43	0.73	58.3	0.6%
Total ADF for room								
Second Floor Block 2								
Window 46	Living/Dining/Kitchen	2.0%	0.68	0.4	121.3	0.68	61.0	0.3%
Window 47			0.68	0.4	121.3	0.68	65.0	0.3%
Window 48			0.68	0.4	121.3	0.68	62.9	0.3%
Window 49			0.68	0.4	121.3	0.68	65.5	0.3%
Window 50 (lower)			0.68	2.77	121.3	0.68	41.2	0.5%
Window 50 (upper)			0.68	4.06	121.3	0.68	28.7	1.2%
Total ADF for room								
Window 51	Bedroom	1.0%	0.68	0.95	91.86	0.72	82.5	1.2%
Window 52			0.68	0.68	91.86	0.72	83.2	0.9%
Total ADF for room								
Window 53 (lower)	Bedroom	1.0%	0.68	0.01	65.79	0.72	50.6	0.0%
Window 53 (upper)			0.68	0.43	65.79	0.72	51.5	0.5%
Window 54 (lower)			0.68	0.03	65.79	0.72	83.7	0.0%
Window 54 (upper)			0.68	1.4	65.79	0.72	85.9	2.6%
Window 55 (lower)			0.68	0.01	65.79	0.72	51.4	0.0%
Window 55 (upper)			0.68	0.43	65.79	0.72	52.9	0.5%
Total ADF for room								
Window 56 (lower)	Bedroom	1.0%	0.68	0.01	68.82	0.72	51.3	0.0%
Window 56 (upper)			0.68	0.43	68.82	0.72	52.7	0.5%
Window 57 (lower)			0.68	0.03	68.82	0.72	83.7	0.0%
Window 57 (upper)			0.68	1.4	68.82	0.72	86.0	2.5%
Window 58 (lower)			0.68	0.01	68.82	0.72	42.9	0.0%
Window 58 (upper)			0.68	0.43	68.82	0.72	46.2	0.4%
Total ADF for room								

Appendix 2 - Average Daylight Factor (ADF)

84 Cornwall Road, London N15 5AR

Reference	Target ADF based on room use		T	Average Daylight Factor Coefficients				Actual ADF
	Primary room use	ADF		Aw	A	R	Theta	
Window 59 (lower)	Bedroom	1.0%	0.68	0.01	69.21	0.72	43.2	0.0%
Window 59 (upper)			0.68	0.43	69.21	0.72	46.4	0.4%
Window 60 (lower)			0.68	0.03	69.21	0.72	83.8	0.0%
Window 60 (upper)			0.68	1.4	69.21	0.72	86.0	2.5%
Window 61 (lower)			0.68	0.01	69.21	0.72	45.9	0.0%
Window 61 (upper)			0.68	0.43	69.21	0.72	48.6	0.4%
Total ADF for room								3.3%
Window 62 (lower)	Living/Dining	1.5%	0.68	0.01	107.62	0.69	45.2	0.0%
Window 62 (upper)			0.68	0.43	107.62	0.69	48.3	0.2%
Window 63 (lower)			0.68	0.03	107.62	0.69	83.9	0.0%
Window 63 (upper)			0.68	1.4	107.62	0.69	86.1	1.4%
Window 64 (lower)			0.68	0.01	107.62	0.69	53.4	0.0%
Window 64 (upper)			0.68	0.43	107.62	0.69	53.9	0.3%
Window 65			0.68	0.78	107.62	0.69	50.9	0.5%
Window 66 (lower)			0.68	1.38	107.62	0.69	29.7	0.2%
Window 66 (upper)			0.68	2.04	107.62	0.69	17.9	0.4%
Total ADF for room								3.0%
Window 67	Kitchen	N/A	0.68	0.4	62.37	0.74	60.8	0.6%
Window 68			0.68	0.4	62.37	0.74	65.3	0.6%
Total ADF for room								1.2%

Appendix 2 - Room Depth Calculation
84 Cornwall Road, London N15 5AR

Room	Room Depth Coefficients				Room Depth Calculation			Result
	L	W	H	Rb	L/W + L/H	<=	2/1-Rb	
<u>Proposed Block 1</u>								
<u>Ground Floor Block 1</u>								
Window 3	3.7	3.5	2.0	0.69	2.91	<=	6.43	Pass
<u>First Floor Block 1</u>								
Window 7	3.7	3.5	2.1	0.71	2.82	<=	6.82	Pass
<u>Second Floor Block 1</u>								
Window 11	3.7	3.5	2.1	0.72	2.82	<=	7.06	Pass
<u>Proposed Block 2</u>								
<u>Ground Floor Block 2</u>								
Window 16	3.5	2.8	2.1	0.72	2.92	<=	7.12	Pass
Window 17	4.7	3.0	2.1	0.72	3.8	<=	7.03	Pass
Window 18	5.8	3.0	2.1	0.72	4.7	<=	7.14	Pass
Window 19	3.5	2.8	2.1	0.72	2.92	<=	7.18	Pass
<u>First Floor Block 2</u>								
Window 44	2.9	3.7	2.1	0.73	2.16	<=	7.4	Pass
Window 45	2.9	3.7	2.1	0.73	2.16	<=	7.4	Pass
<u>Second Floor Block 2</u>								
Window 67	2.9	3.7	2.1	0.74	2.16	<=	7.65	Pass
Window 68	2.9	3.7	2.1	0.74	2.16	<=	7.65	Pass

Appendix 2 - Sunlight to Windows
84 Cornwall Road, London N15 5AR

Reference	Use Class	Annual Probable Total	Sunlight Hours Winter
<u>Proposed Block 1</u>			
<u>Ground Floor Block 1</u>			
Window 1	Living/Dinir	27%	8%
Window 2	Living/Dinir	10%	10%
<u>First Floor Block 1</u>			
Window 4	Living/Dinir	14%	2%
Window 5	Living/Dinir	4%	2%
Window 6	Living/Dinir	2%	2%
<u>Second Floor Block 1</u>			
Window 8	Living/Dinir	15%	2%
Window 9	Living/Dinir	4%	2%
Window 10	Living/Dinir	3%	3%
<u>Proposed Block 2</u>			
<u>Ground Floor Block 2</u>			
Window 12	Living/Dinir	16%	2%
Window 13	Living/Dinir	0%	0%
Window 14	Living/Dinir	0%	0%
Window 15	Living/Dinir	22%	5%
Window 20	Living/Dinir	18%	2%
Window 21	Living/Dinir	0%	0%
Window 22	Living/Dinir	20%	5%
<u>First Floor Block 2</u>			
Window 23	Living/Dinir	8%	0%
Window 24	Living/Dinir	8%	0%
Window 25	Living/Dinir	8%	0%
Window 26	Living/Dinir	8%	0%
Window 27	Living/Dinir	0%	0%
Window 39	Living/Dinir	0%	0%
Window 40	Living/Dinir	33%	6%
Window 41	Living/Dinir	19%	10%
Window 42	Living/Dinir	2%	2%
Window 43	Living/Dinir	0%	0%

Appendix 2 - Sunlight to Windows
84 Cornwall Road, London N15 5AR


Reference	Use Class	Annual Probable Sunlight Hours	
		Total	Winter
<u>Second Floor Block 2</u>			
Window 46	Living/Dinir	12%	0%
Window 47	Living/Dinir	11%	0%
Window 48	Living/Dinir	11%	0%
Window 49	Living/Dinir	11%	0%
Window 50	Living/Dinir	0%	0%
Window 62	Living/Dinir	0%	0%
Window 63	Living/Dinir	38%	9%
Window 64	Living/Dinir	19%	10%
Window 65	Living/Dinir	3%	3%
Window 66	Living/Dinir	2%	0%

Appendix 2 - Overshadowing to Gardens and Open Spaces
84 Cornwall Road, London N15 5AR

Reference	Total Area	Area receiving at least 2 hours of sunlight on 21st March		Result
<u>Proposed Block 1</u>				
<u>Ground Floor Block 1</u>				
Garden 1	9.17 m2	7.37 m2	80%	Pass
Garden 2	8.04 m2	1.32 m2	16%	Fail
<u>Proposed Block 2</u>				
<u>Ground Floor Block 2</u>				
Garden 3	44.08 m2	41.84 m2	95%	Pass
Garden 4	48.25 m2	39.03 m2	81%	Pass

APPENDIX 3

OVERSHADOWING TO GARDENS AND OPEN SPACES

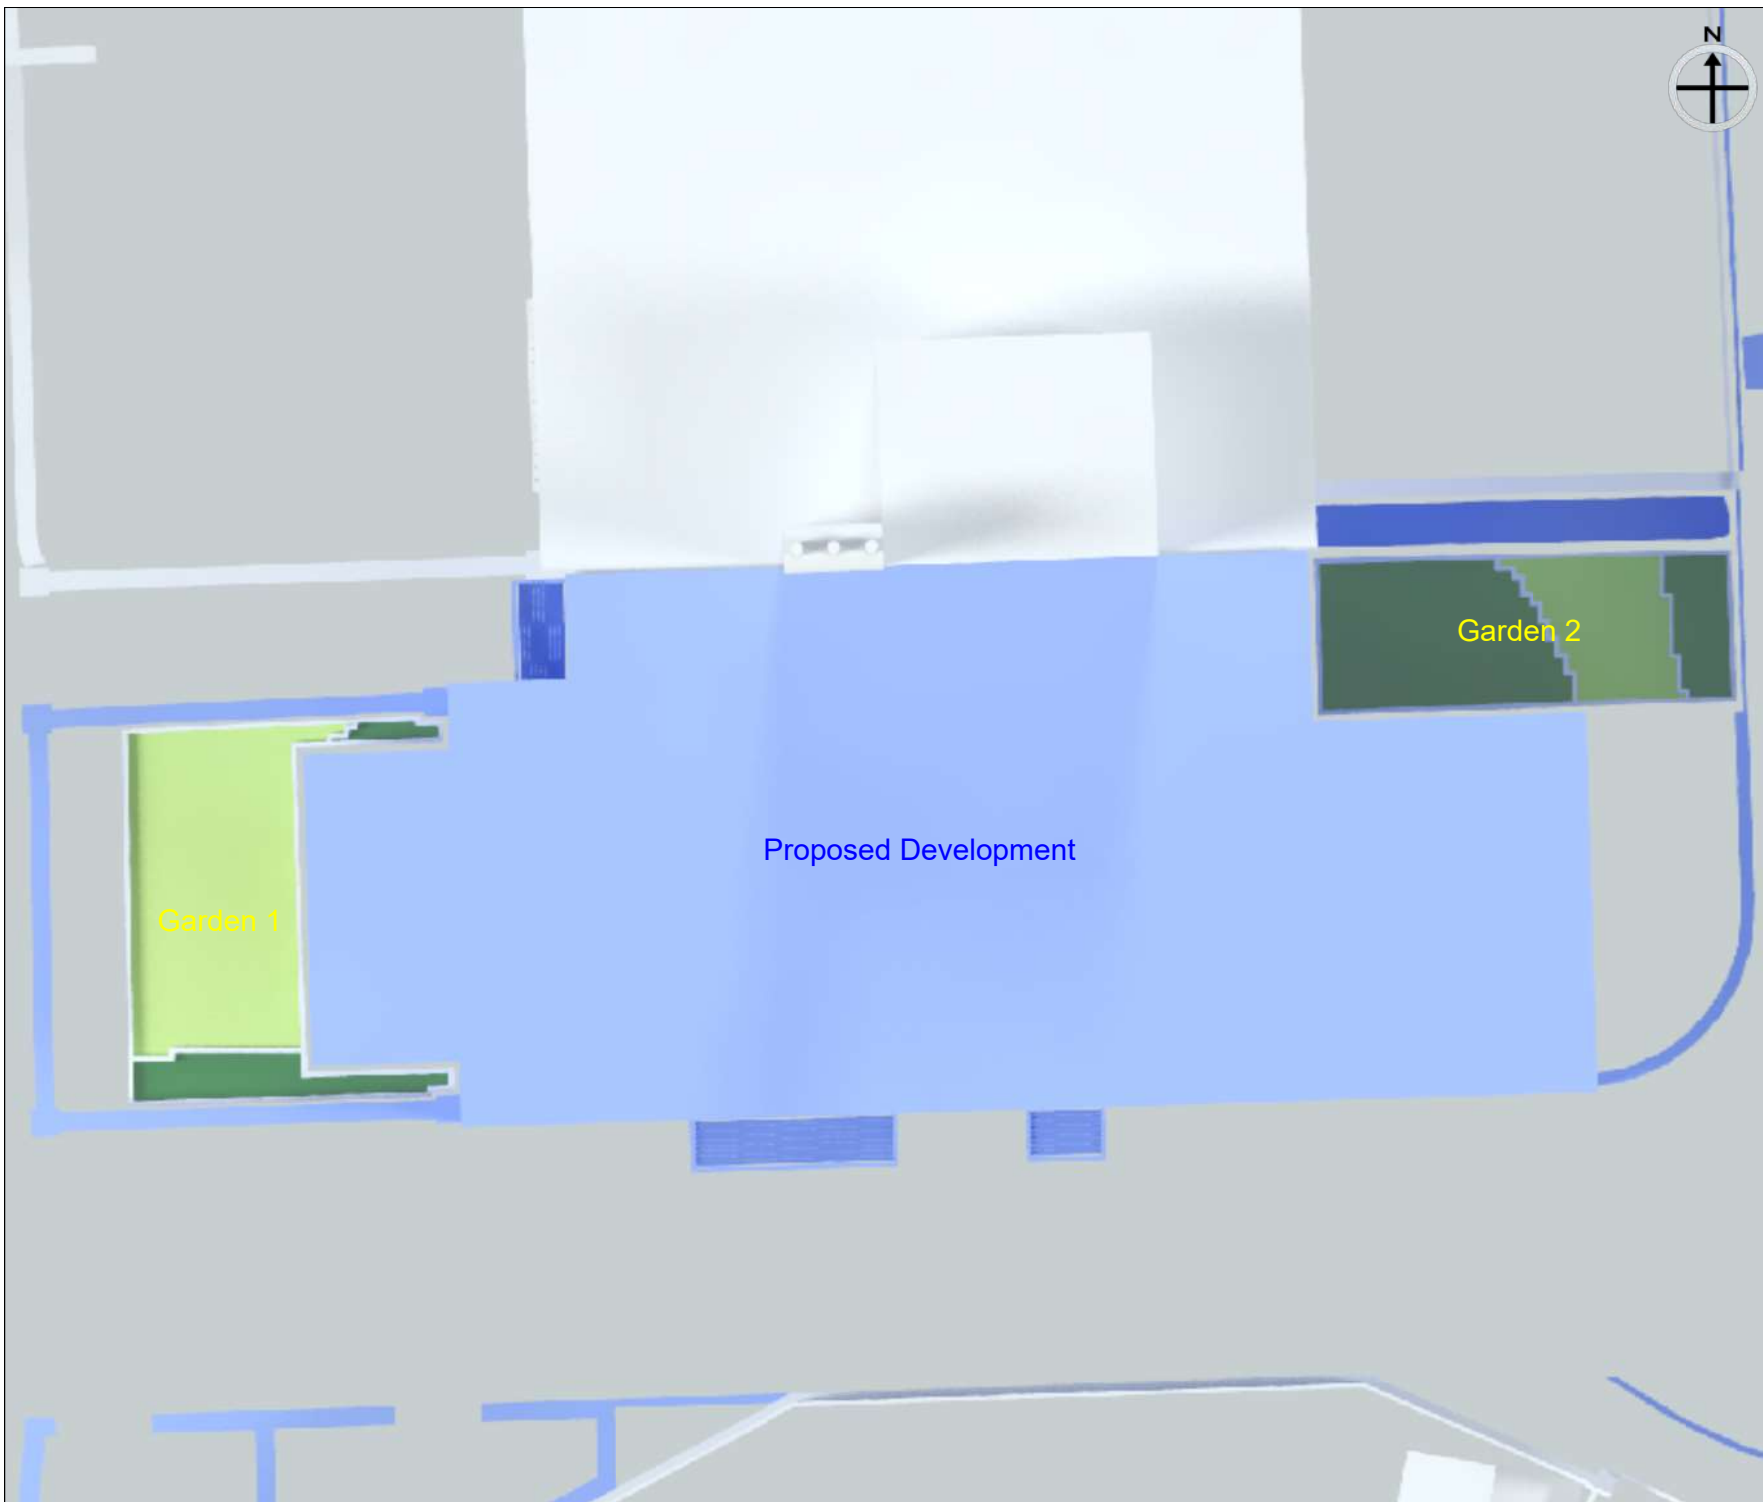

Key

-  Receives under two hours sunlight on 21st March before and after the development.
-  Receives at least two hours sunlight on 21st March before and after the development.


Project Name: 84 Cornwall Road, London N15 5AR

Drawing Title: Appendix 3 - Overshadowing to Gardens and Open Spaces



**RIGHT OF LIGHT
CONSULTING**
Chartered Surveyors

Right of Light Consulting
Burley House
15 - 17 High Street
Rayleigh
Essex
SS6 7EW
TEL 0800 197 4836
E-MAIL enquiries@right-of-light.co.uk
WEBSITE www.right-of-light.co.uk

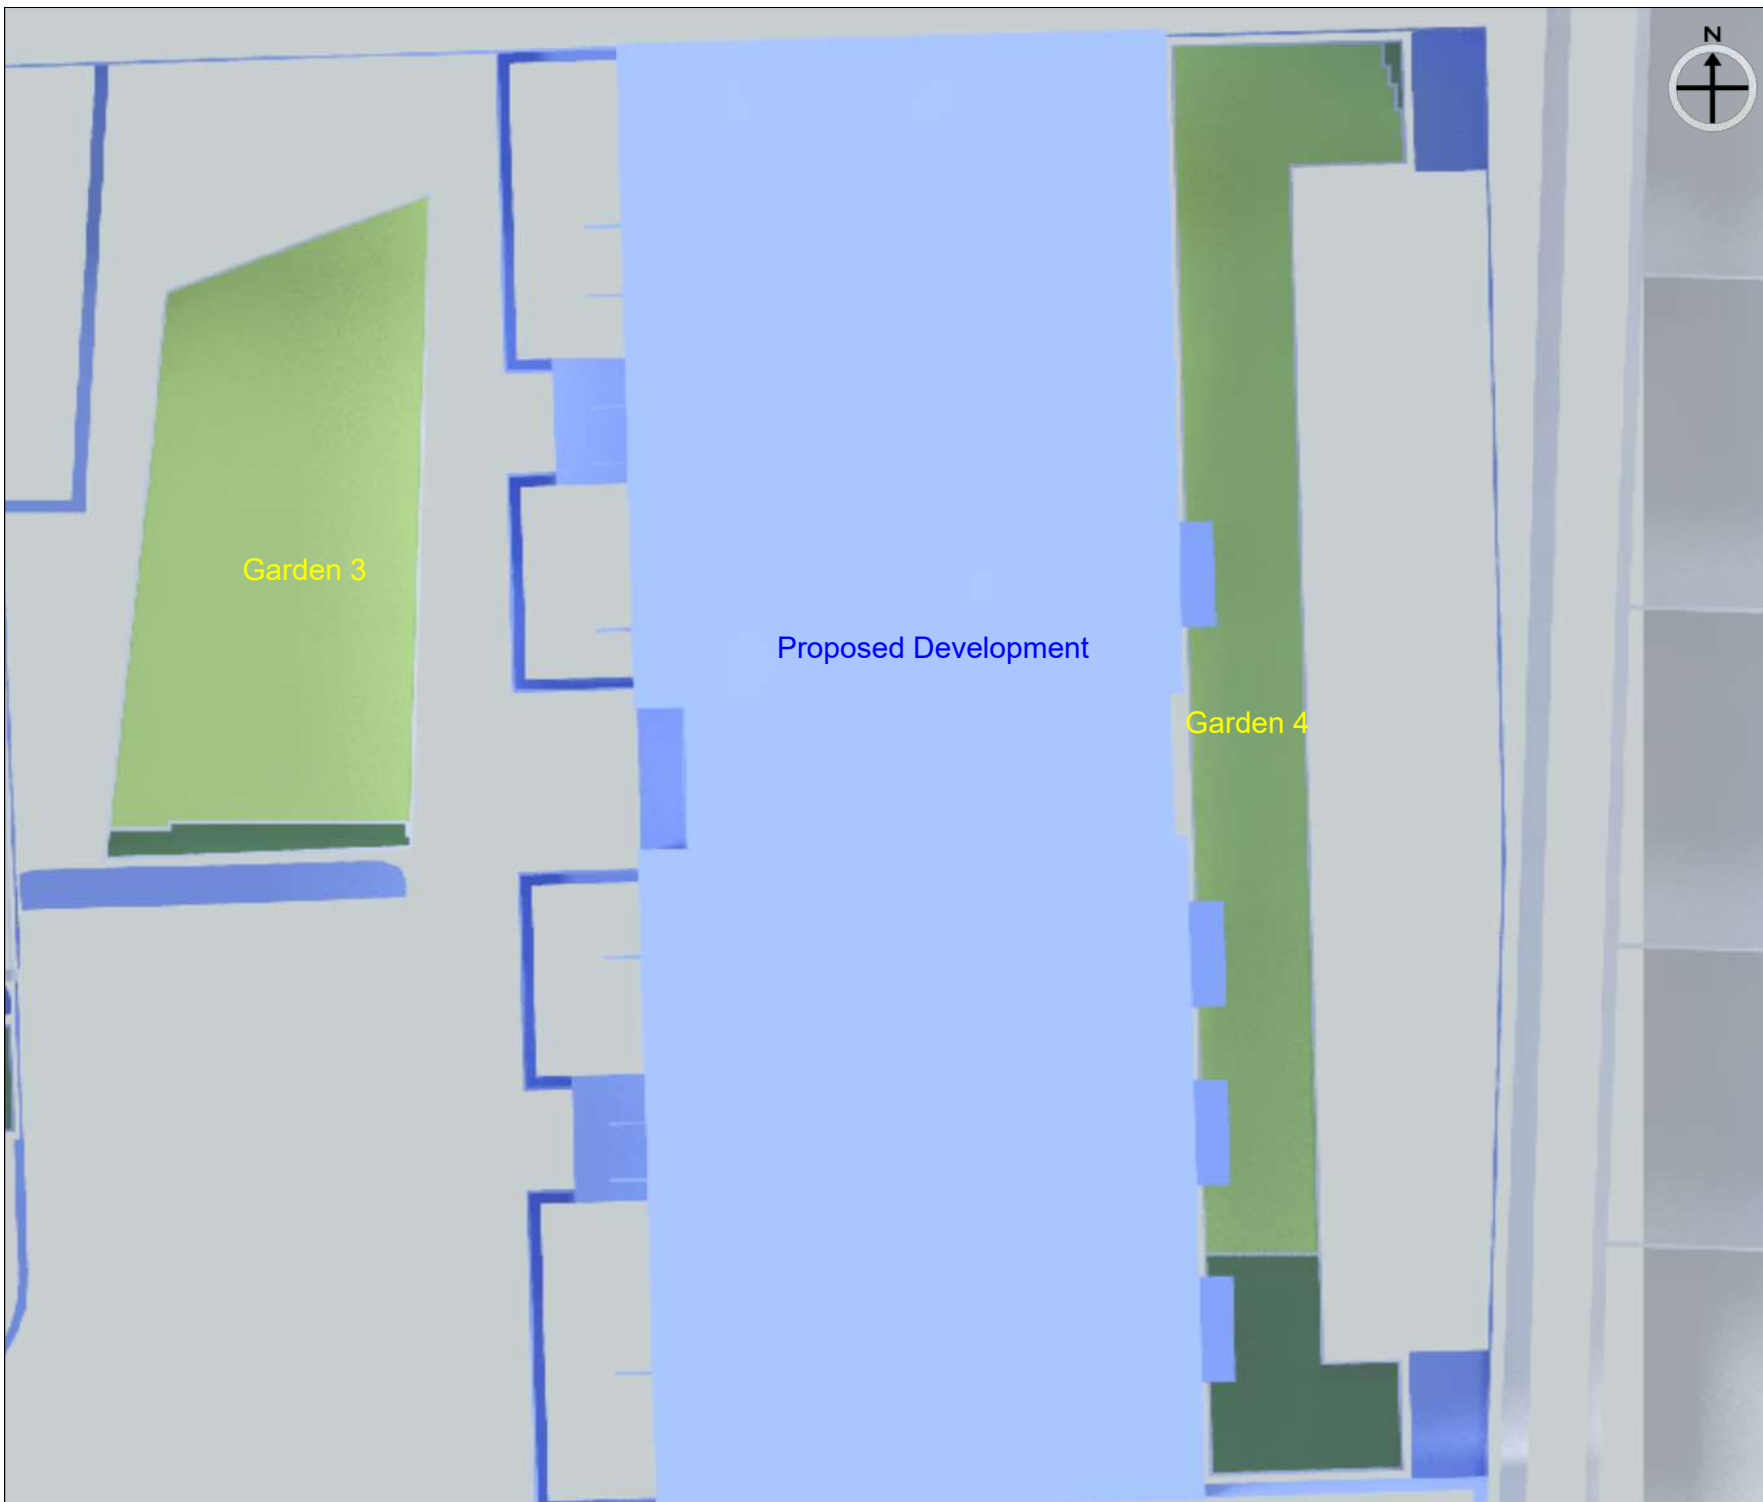

Key

-  Receives under two hours sunlight on 21st March before and after the development.
-  Receives at least two hours sunlight on 21st March before and after the development.

Project Name: 84 Cornwall Road, London N15 5AR

Drawing Title: Appendix 3 - Overshadowing to Gardens and Open Spaces



**RIGHT OF LIGHT
CONSULTING**
Chartered Surveyors

Right of Light Consulting
Burley House
15 - 17 High Street
Rayleigh
Essex
SS6 7EW
TEL 0800 197 4836
E-MAIL enquiries@right-of-light.co.uk
WEBSITE www.right-of-light.co.uk