

8.2 FIRE SAFETY & GATEWAY 1 (CONTINUED)

The evacuation strategy for the hotel areas, in combination with any of the basement plant and ancillary areas, is for these to both be evacuated simultaneously for a detected fire in either of these spaces.

The travel distance limits for the varying areas within the hotel demise are summarised in the table below:-

Area	Risk Profile	One Direction Travel Distance Limit [m]	Two-Direction Travel Distance Limit [m]
Hotel – Bedroom areas	Ciii1 (Short term occupancy)	9 (Direct) 12 (Actual)	18 (Direct) 27 (Actual)
Hotel Ancillary / Amenity Areas	B1	16 (Direct) 24 (Actual)	40 (Direct) 60 (Actual)
Standard-Risk Rooms / Storage Areas	A2	15 (Direct) 22 (Actual)	37 (Direct) 55 (Actual)
Plant and High-Risk Rooms / Storage Areas	A3	12 (Direct) 18 (Actual)	30 (Direct) 45 (Actual)

KEY

- Residential evacuation
- Hotel evacuation
- BoH & Parking evacuation

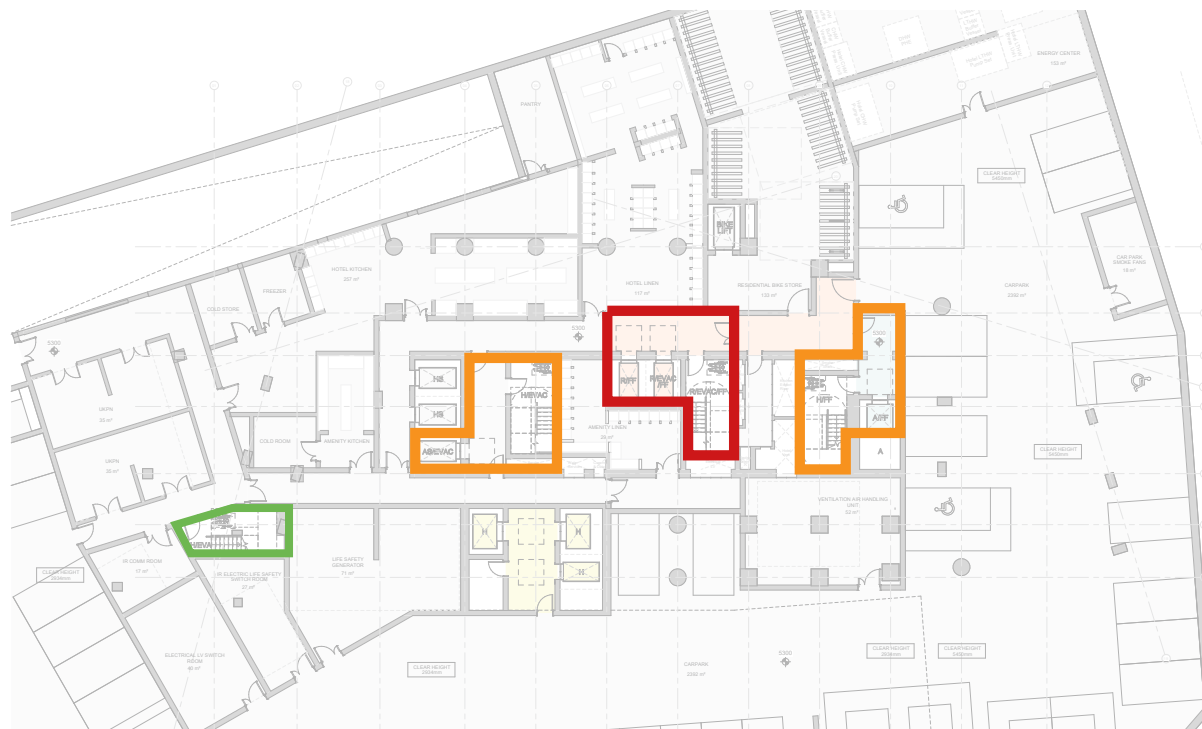


FIGURE 325. Basement General Arrangement Plan

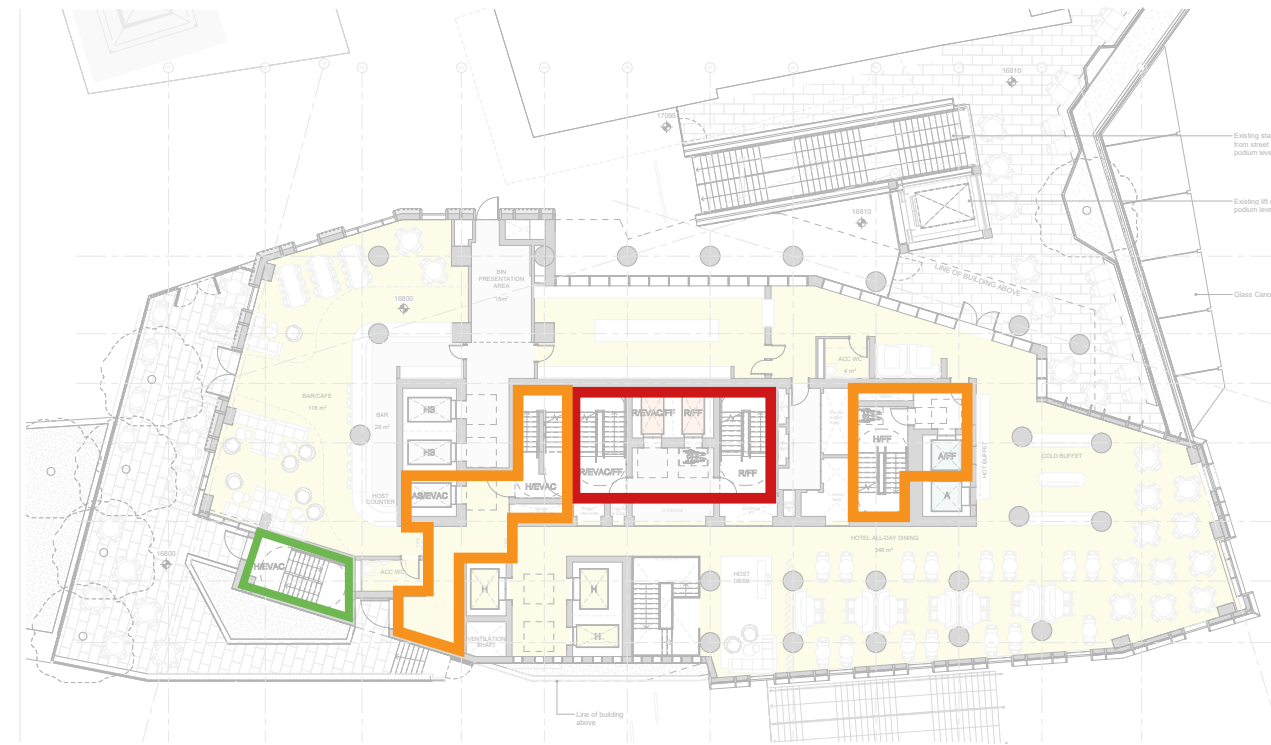


FIGURE 326. Level 01 General Arrangement Plan

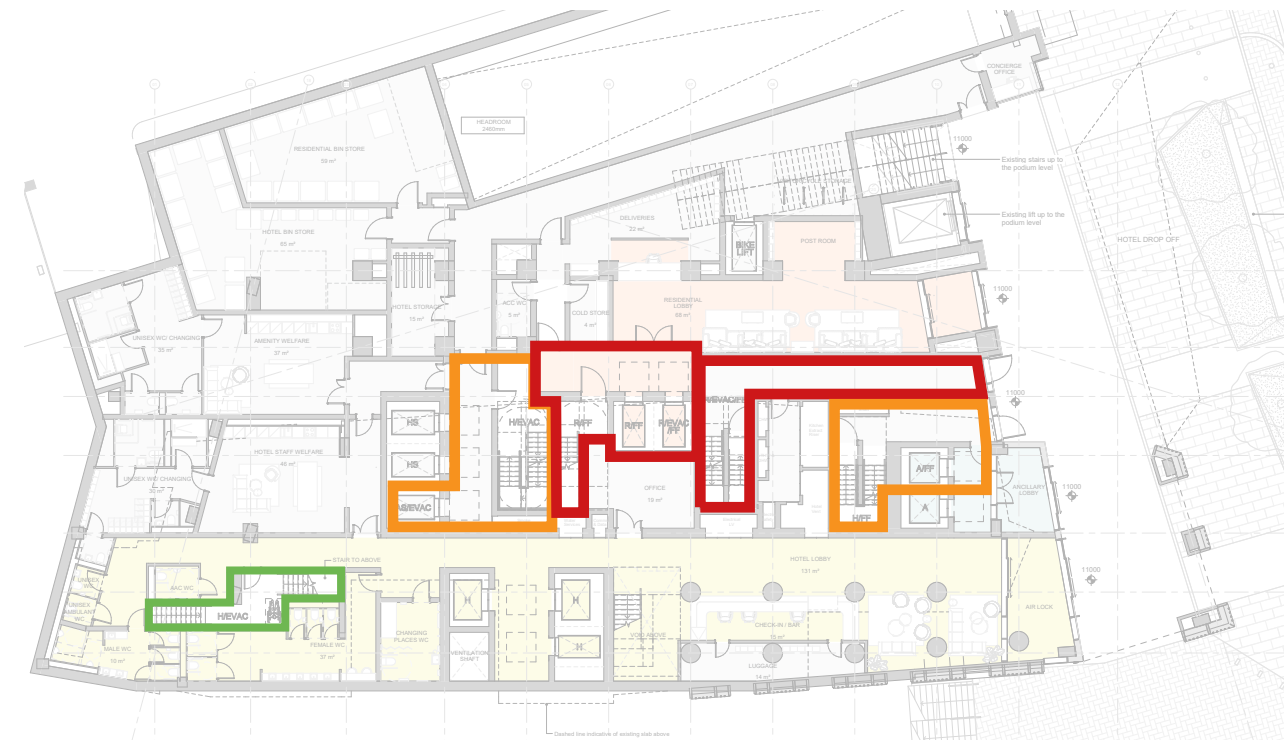


FIGURE 324. Level 00 General Arrangement Plan