


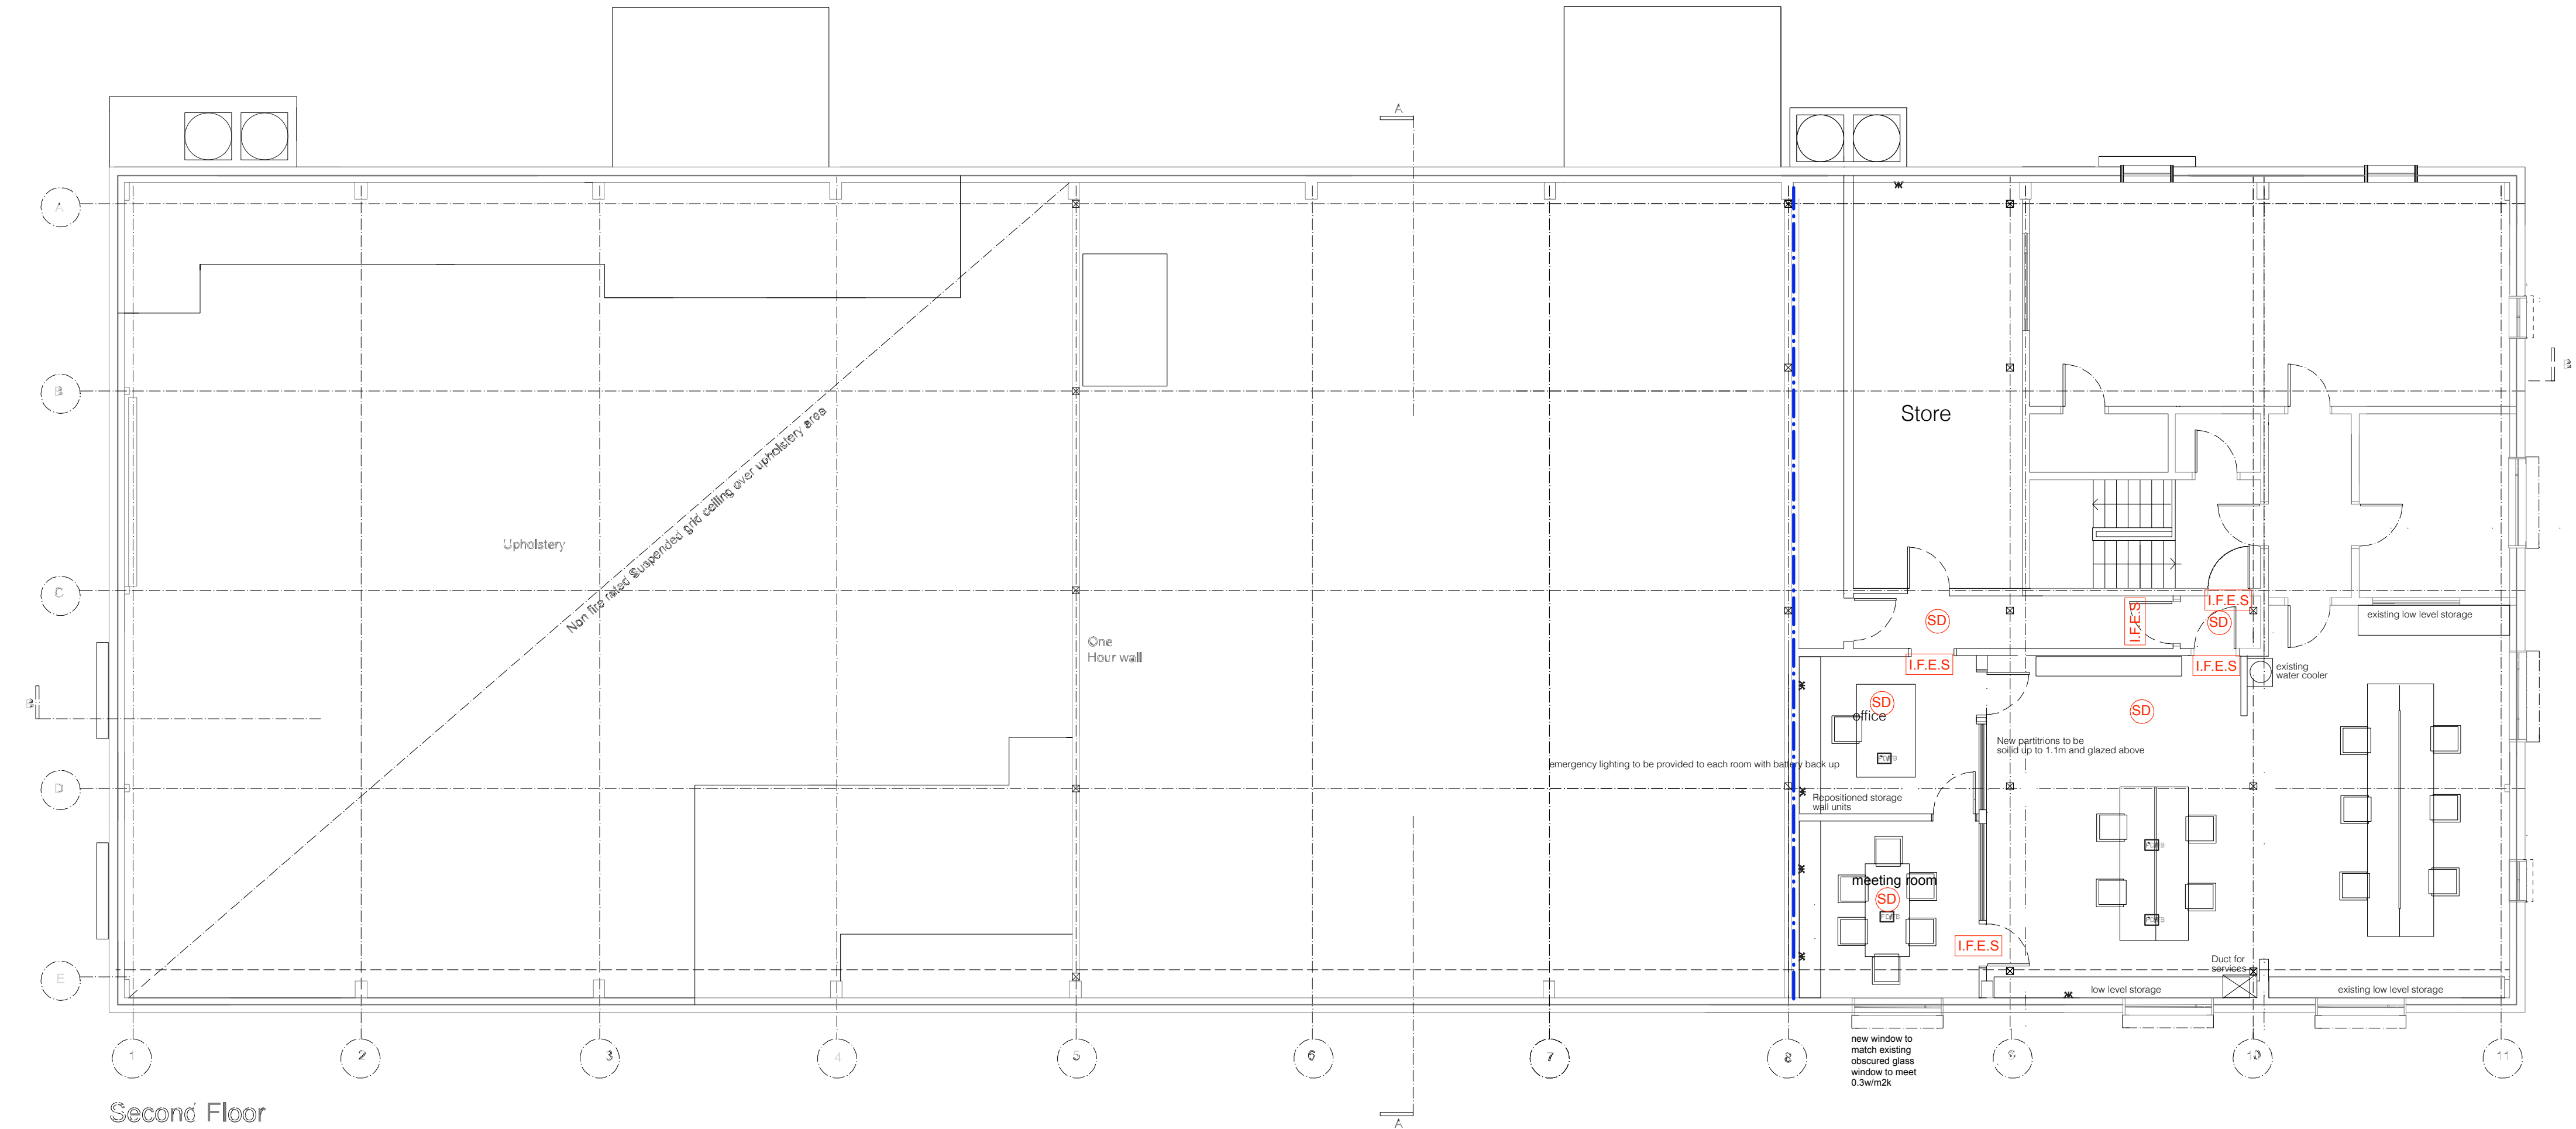

Second Floor

- Thermal wall lining
- * Double Switched Socket outlet to wall
- Power and data floor box
- Double Switched Socket outlet to floor box
- Steel columns for mezzanine
- Smoke Detector
- I.F.E.S. Illuminated fire escape sign over doorway linked to alarm system
- New wall to be constructed to achieve 1 HR FR

NOTE
The proposed fire alarm & smoke detection system and emergency lighting to be installed to the relevant British Standards (fire alarm & smoke detection system BS5839-1:2017, emergency lighting BS5266-1:2005 and fire safety escape signage to BS5499).

Rev C : 20:08:23 Office and meeting room added
Rev B : 29:04:17 Store room added
Rev A : 12:04:17 Store and Changing /shower room added