
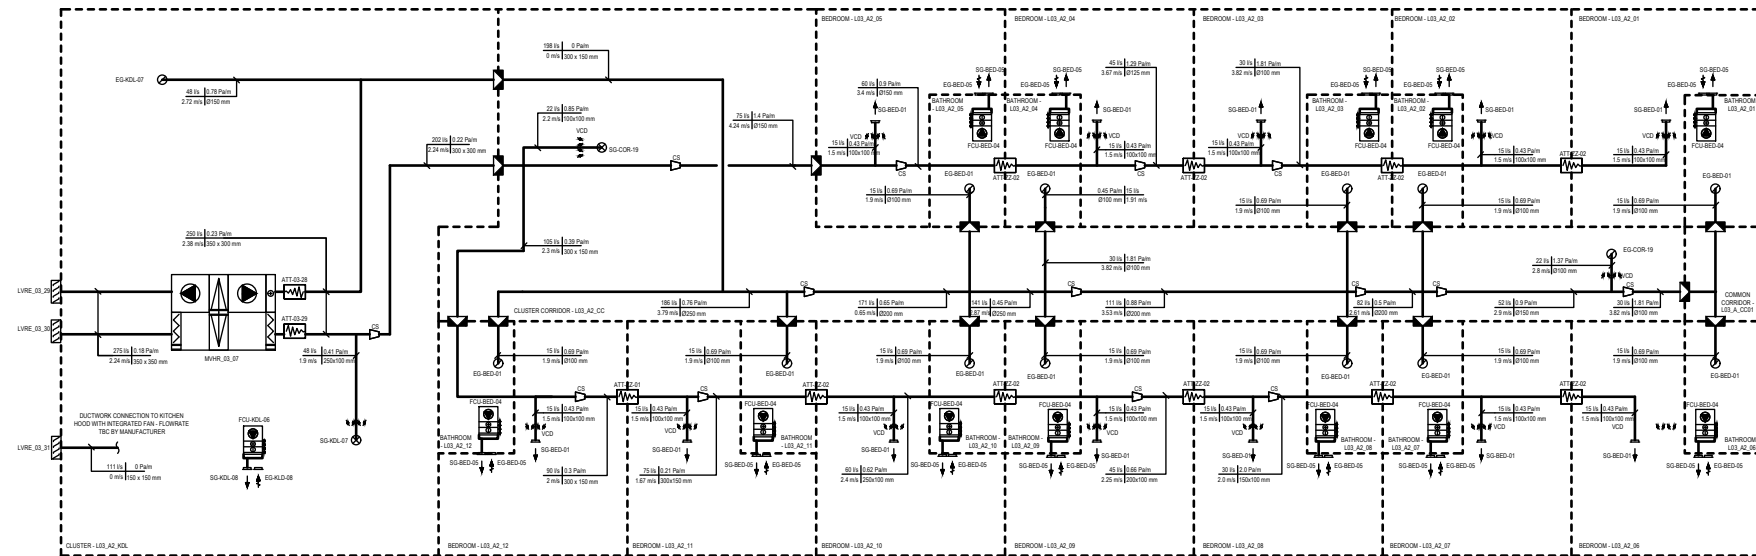


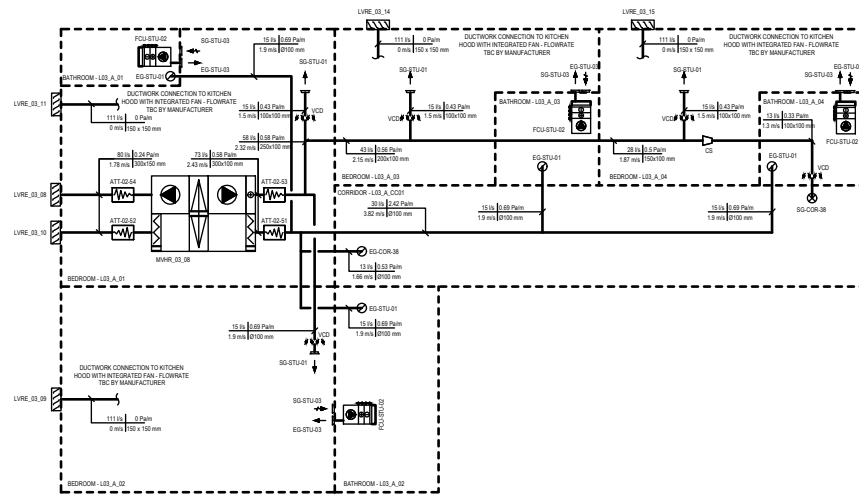

NOTES:

1. DO NOT SCALE.
2. ALL DIMENSIONS IN MILLIMETERS.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECT, STRUCTURAL, ENGINEERS & BUILDING SERVICES ENGINEERS DRAWINGS, SPECIFICATIONS & SCHEDULES.
4. ALL DUCTWORK TO BE INSTALLED TO DW144.
5. REFER TO EDC SCHEDULES FOR MAHR, EXTRACT FAN, FIRE DAMPER AND ATTENUATION DETAILS.
6. ALL INTAKE AND EXHAUST TERMINATION TO BE A MINIMUM OF 1000mm.
7. REFER TO EDC LAYOUTS FOR DETAILS REGARDING FIRE RATED EXTRACT SUPPLY SYSTEMS.
8. EXTRACT SUPPLY SYSTEMS.
9. PENETRATION SEALS IN LINE WITH BS 12011-2 TO BE INSTALLED WHERE DUCTWORK PENETRATES FIRE COMPARTMENTS.
10. ALL FCU TO HAVE 1000mm X 600mm ACCESS PANEL POSITIONED AT THE REAR QUARTER OF THE UNIT FOR FILTER REPLACEMENT.

Rev	Disc	Description	Disc	App
McAleer & Rushe				
Printworks				
Title				
Mechanical Services - Third Floor - Ventilation Schematic - Sheet 3 of 3				
Drawing No.				
179-EDC-B1-ZZ-DR-M-30126				
ISSA With Page	STAGE 4B	Drawn Code	S4	Revision
Drawn By	NTS	Model Manager	JC	Project Manager
				BP