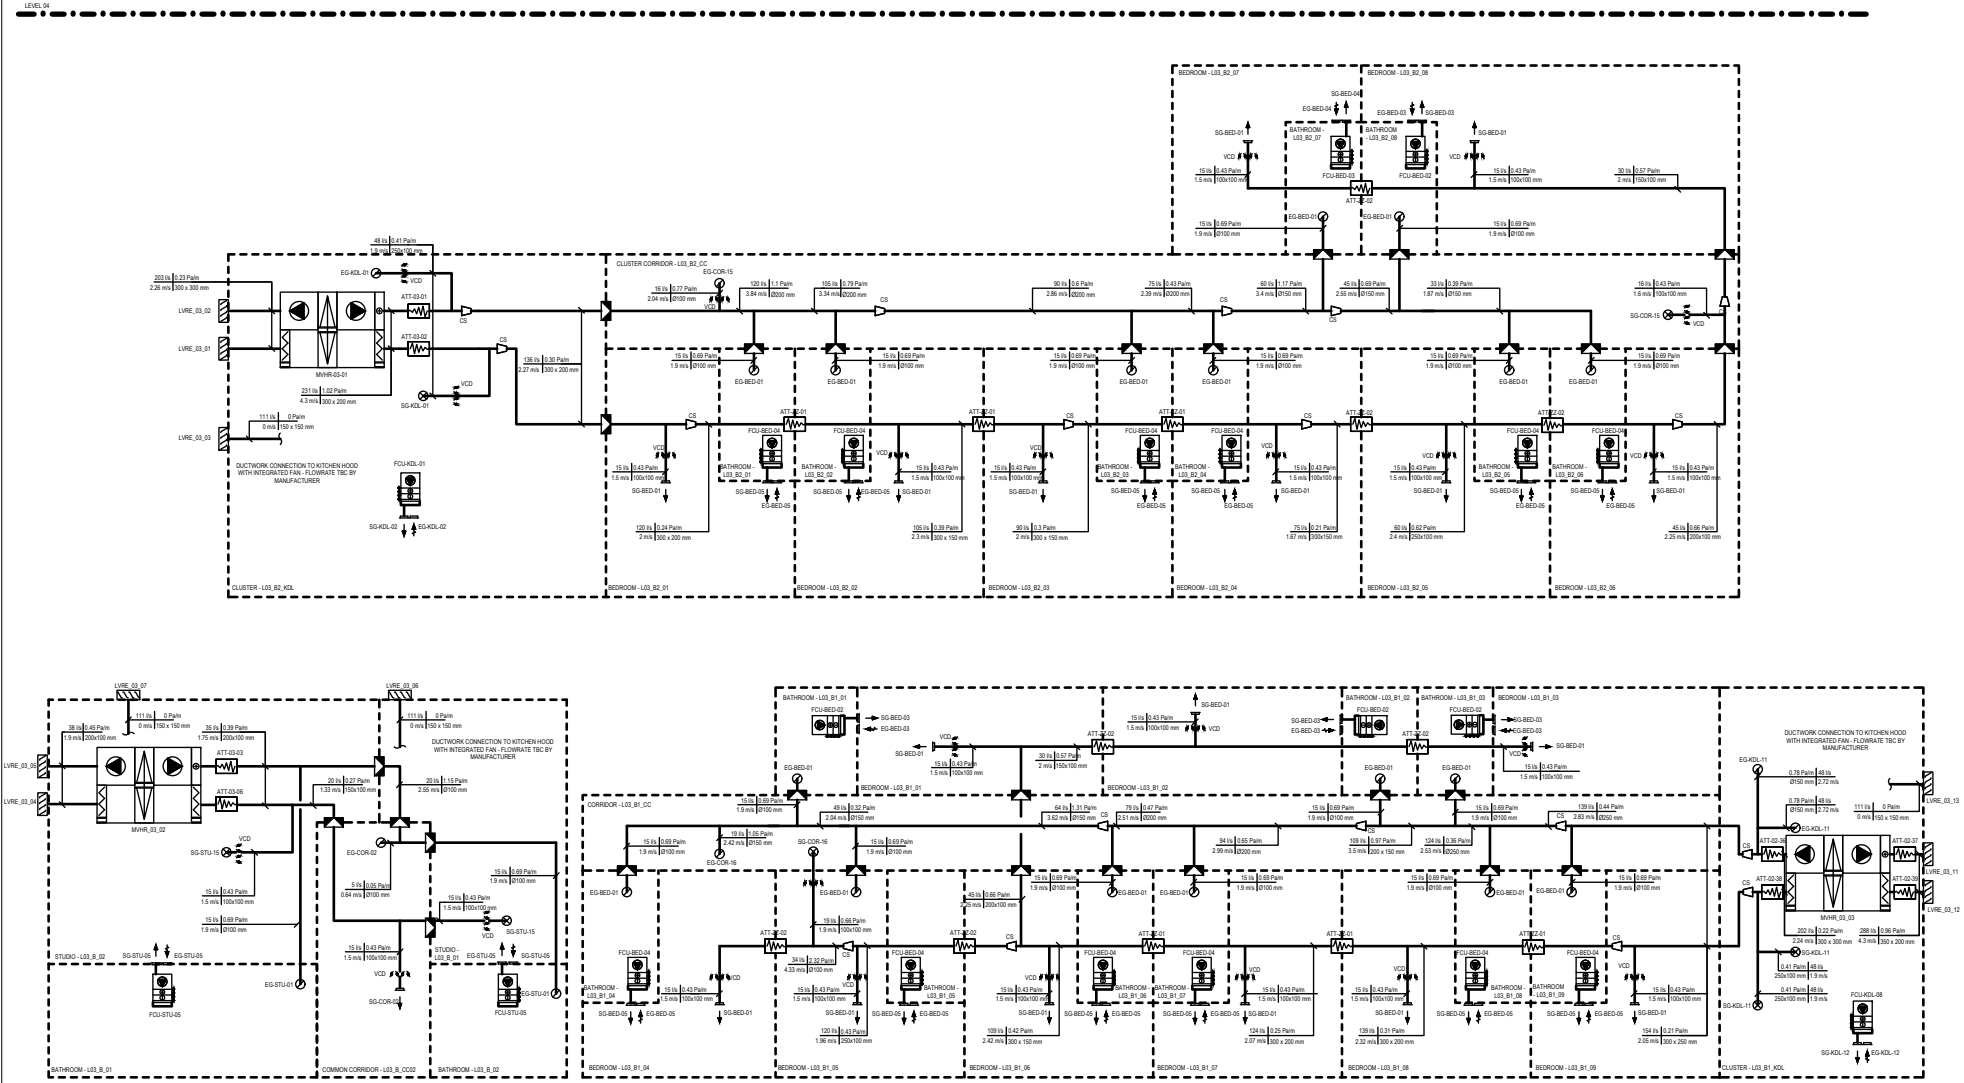

NOTES:

1. DO NOT SCALE.
2. ALL DIMENSIONS IN MILLIMETERS.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECT, STRUCTURAL ENGINEERS & BUILDING SERVICES ENGINEERS DRAWINGS, SPECIFICATIONS & SCHEDULES.
4. ALL DUCTWORK TO BE INSTALLED TO DW144
5. REFER TO EDC SCHEDULES FOR MVHR, EXTRACT FAN, FIRE DAMPER AND ATTENUATION DETAILS/
6. ALL INTAKE AND EXHAUST TERMINATION TO BE A MINIMUM OF 1M APART.
7. REFER TO EDC LAYOUTS FOR DETAILS REGARDING FIRE RATED SMOKE EXTRACT/SUPPLY SYSTEMS.
8. PENETRATION SEALS IN LINE WITH BS 12101-2 TO BE INSTALLED WHERE DUCTWORK PENETRATES FIRE COMPARTMENTS.
10. ALL FCUs TO HAVE 1NO 600MM X 600MM ACCESS PANEL POSITIONED AT THE REAR QUARTER OF THE UNIT FOR FILTER REPLACEMENT.

C03	23/01/2026	FOR REVIEW	XP	AB
Rev	Date	Description	Chkg	Appr

Client: McAleer & Rushe

Project: Printworks

Title: Mechanical Services - Third Floor - Ventilation Schematic - Sheet 1 of 3

Drawing No: 179-EDC-B1-ZZ-DR-M-30124

RIBA Work Stage	Status Code	Revision
STAGE 4B	S4	C01
Scale @ A0	Model Manager	Project Manager
NTS	JC	BF

Mechanical & Electrical Consulting Engineers
Cork Office
Tel: +353 (0)21 4280376,
Dublin Office
Tel: +353 (0)1 5113000,
London Office
Tel: +44 (0)203 5930800
email: info@edcconsult.com
Galway Office
Tel: +353 (0)91 538376,
Istanbul Office
Tel: +902169896026,

THIS DRAWING IS THE PROPERTY OF E.D.C. AND SHALL NOT BE USED, REPRODUCED OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF E.D.C. ALL RIGHTS RESERVED.