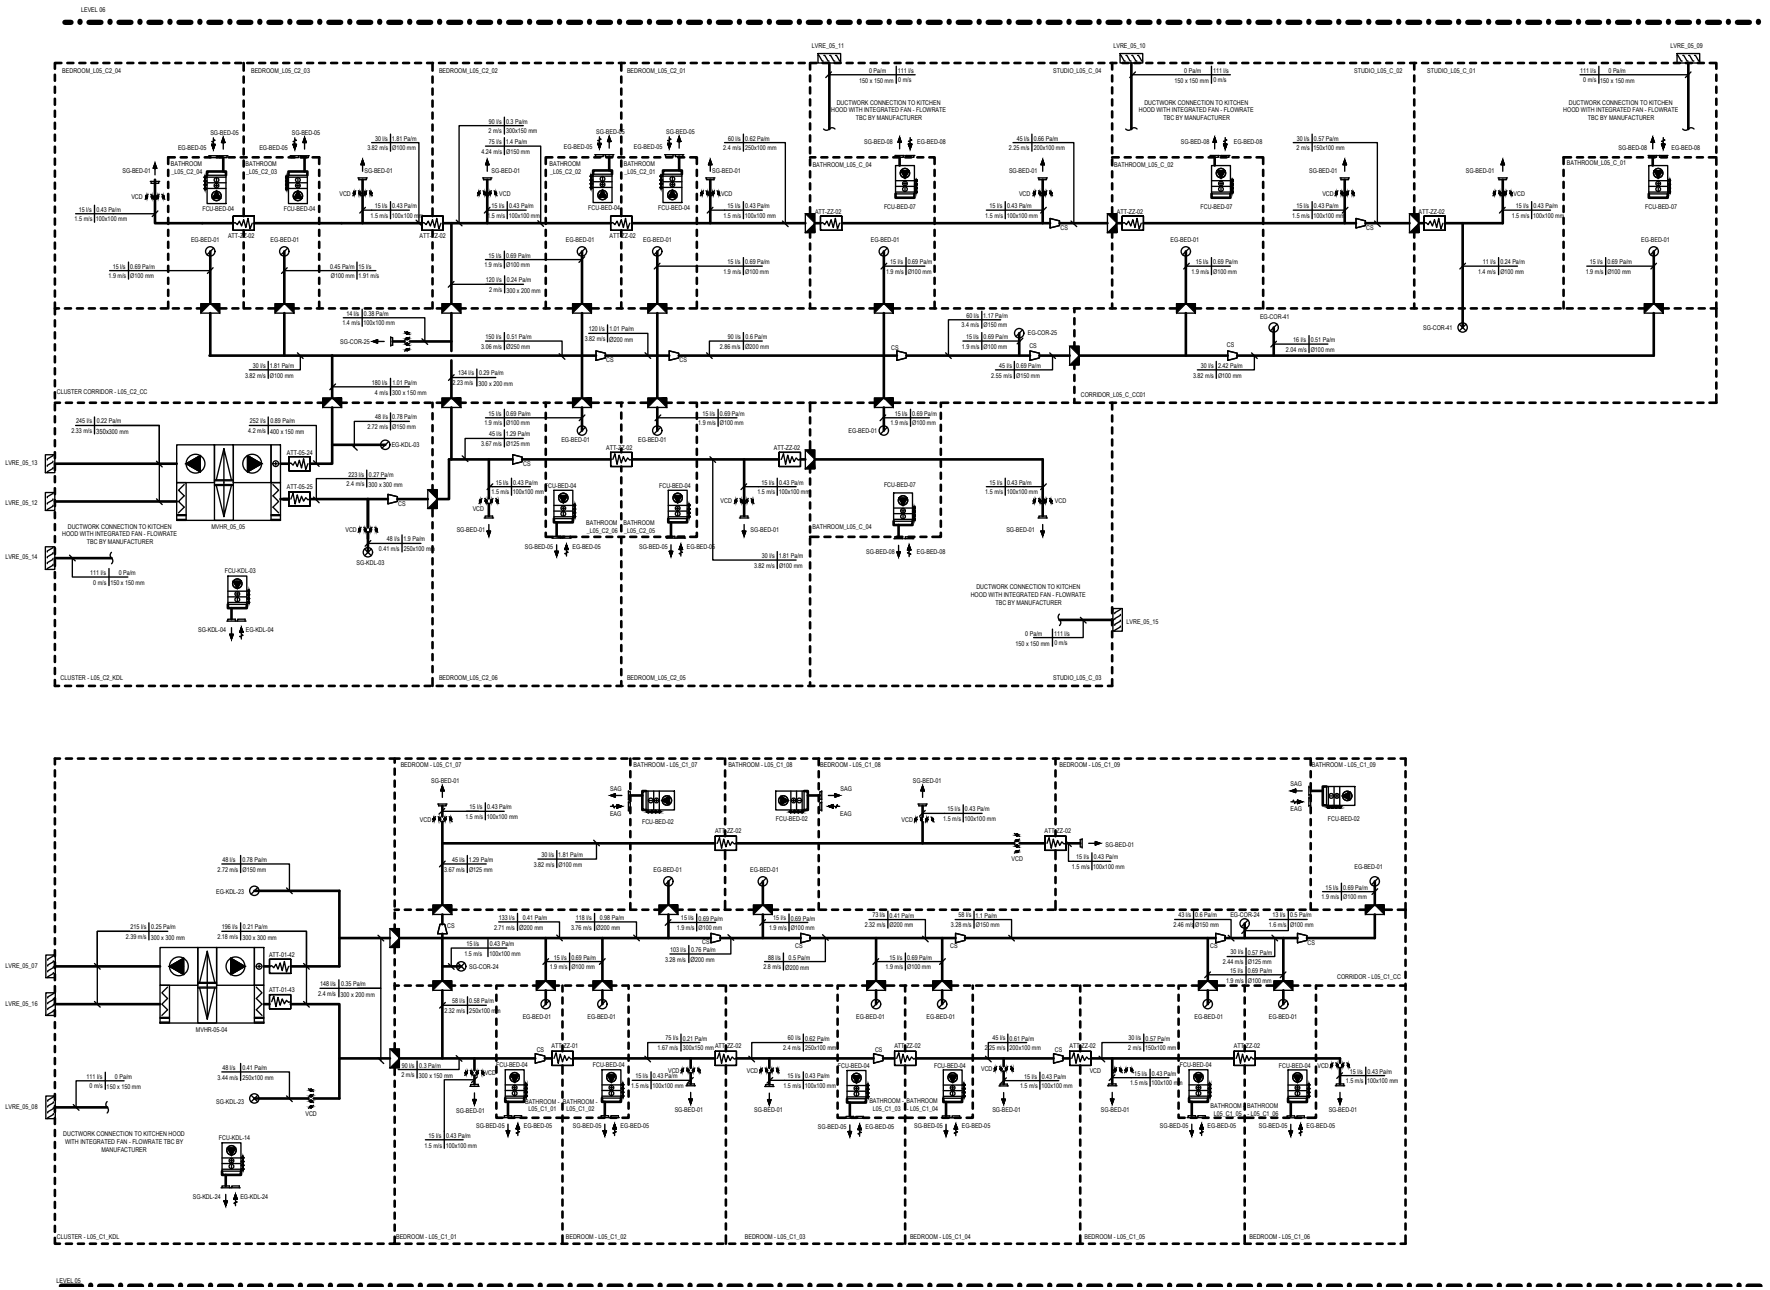

NOTES:

1. DO NOT SCALE.
2. ALL DIMENSIONS IN MILLIMETERS.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECT, STRUCTURAL ENGINEERS & BUILDING SERVICES ENGINEERS DRAWINGS, SPECIFICATIONS & SCHEDULES.
4. ALL DUCTWORK TO BE INSTALLED TO DW144
5. REFER TO EDC SCHEDULES FOR MVHR, EXTRACT FAN, FIRE DAMPER AND ATTENUATION DETAILS/
6. ALL INTAKE AND EXHAUST TERMINATION TO BE A MINIMUM OF 1M APART.
7. REFER TO EDC LAYOUTS FOR DETAILS REGARDING FIRE RATED SMOKE EXTRACT/SUPPLY SYSTEMS.
8. PENETRATION SEALS IN LINE WITH BS 12101-2 TO BE INSTALLED WHERE DUCTWORK PENETRATES FIRE COMPARTMENTS.
10. ALL FCUs TO HAVE 1NO 600MM X 600MM ACCESS PANEL POSITIONED AT THE REAR QUARTER OF THE UNIT FOR FILTER REPLACEMENT.

Rev	Date	Description	Orig	App
C01	23/02/2026	FOR REVIEW	JKP	AB

Client: McAleer & Rushe

Project: Printworks

Title: Mechanical Services - Fifth Floor - Ventilation Schematic - Sheet 2 of 2

Drawing No: 179-EDC-B1-ZZ-DR-M-30130

RIBA Work Stage	Status Code	Revision
STAGE 4B	S4	C01

Scale @ A0	Model Manager	Project Manager
NTS	JC	BF

Mechanical & Electrical Consulting Engineers

Cork Office
Tel: +353 (0)21 4240376,

Dublin Office
Tel: +353 (0)1 524 0830,

London Office
Tel: +44 (0)203 0040000

Limerick Office
Tel: +353 (0)87 6135316,

Galway Office
Tel: +353 (0)91 408376,

Navan Office
Tel: +353(0)86 8066226,

www.edcengineers.com
info@edcengineers.com

THIS DRAWING IS THE COPYRIGHT OF EDC ENGINEERS LTD. AND SHALL NOT BE USED, REPRODUCED OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF EDC ENGINEERS LTD. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY. DO NOT SCALE DRAWING. ALL DIMENSIONS TO BE CHECKED ON SITE BEFORE WORK COMMENCES. ALL WORK TO BE CARRIED OUT IN ACCORDANCE WITH ALL RELEVANT STATUTORY REGULATIONS AND BUILDING BYE-LAWS.