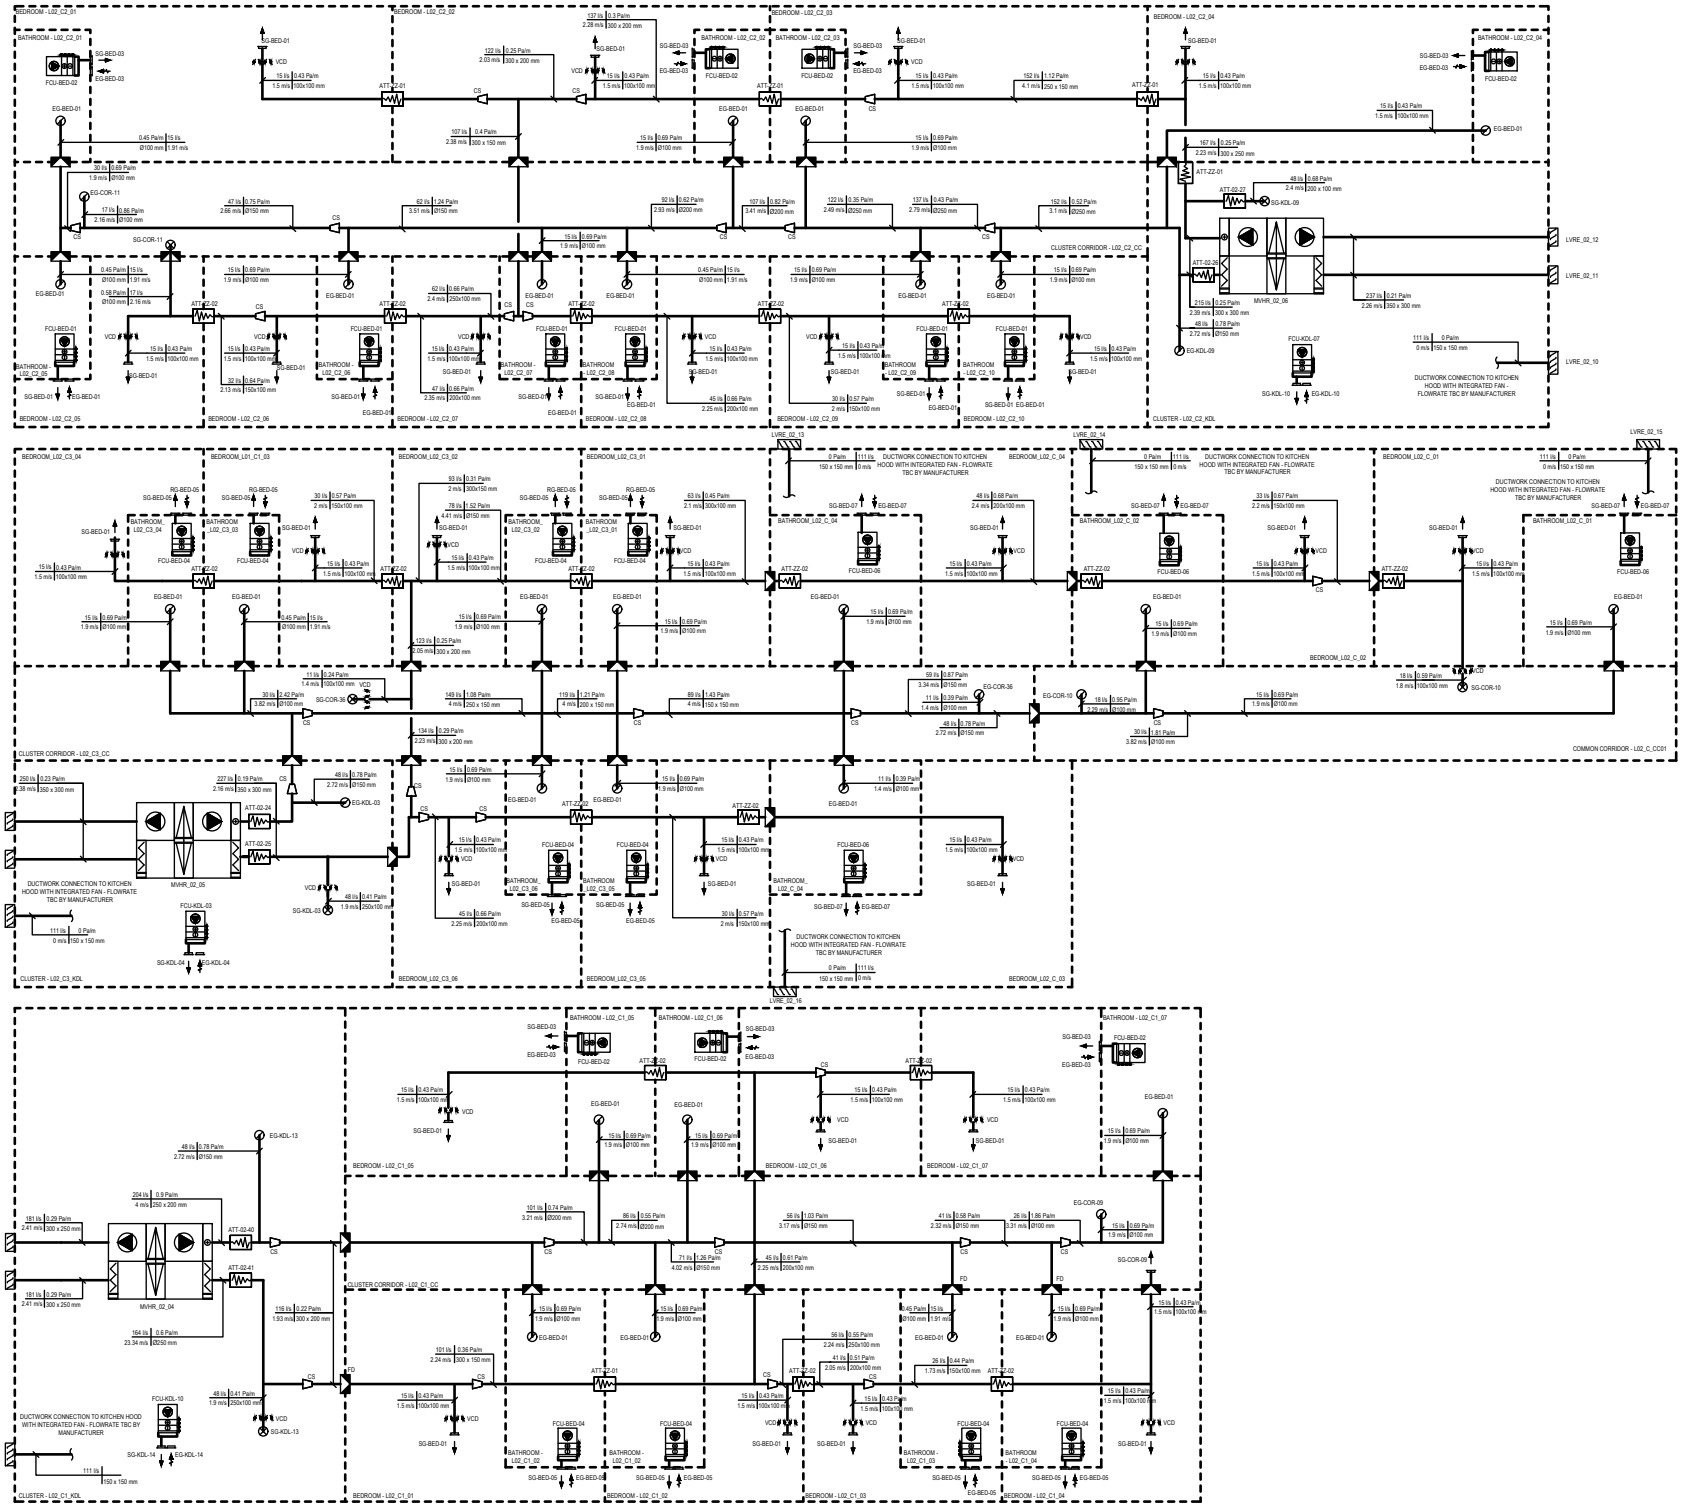


NOTES:

1. DO NOT SCALE.
2. ALL DIMENSIONS IN MILLIMETERS.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECT, STRUCTURAL ENGINEERS & BUILDING SERVICES ENGINEERS DRAWINGS, SPECIFICATIONS & SCHEDULES.
4. ALL DUCTWORK TO BE INSTALLED TO DW144
5. REFER TO EDC SCHEDULES FOR MVHR, EXTRACT FAN, FIRE DAMPER AND ATTENUATION DETAILS/
6. ALL INTAKE AND EXHAUST TERMINATION TO BE A MINIMUM OF 1M APART.
7. REFER TO EDC LAYOUTS FOR DETAILS REGARDING FIRE RATED SMOKE EXTRACT/SUPPLY SYSTEMS.
8. PENETRATION SEALS IN LINE WITH BS 12101-2 TO BE INSTALLED WHERE DUCTWORK PENETRATES FIRE COMPARTMENTS.
10. ALL FCUs TO HAVE 1NO 600MM X 600MM ACCESS PANEL POSITIONED AT THE REAR QUARTER OF THE UNIT FOR FILTER REPLACEMENT.

| Rev | Date | Description | Drg | App |
|---|---|---|---|---|
| C03 | 23/01/2026 | FOR REVIEW | XP | AB |

Client: McAleer & Rushe

Project: Printworks

Title: Mechanical Services - Second Floor - Ventilation Schematic - Sheet 2 of 3

Drawing No: 179-EDC-B1-ZZ-DR-M-30122

| RIBA Work Stage | Status Code | Revision |
|---|---|---|
| STAGE 4B | S4 | C01 |
| Scale @ A0 | Model Manager | Project Manager |
| NTS | JC | BF |

Mechanical & Electrical Consulting Engineers
Cork Office
Tel: +353 (0)21 4280376
Dublin Office
Tel: +353 (0)1 5313955
London Office
Tel: +44 (0)203 5934500
Limerick Office
Tel: +353 (0)61 436376
Sligo Office
Tel: +353 (0)71 9153131
Galway Office
Tel: +353 (0)91 436376
Wexford Office
Tel: +353 (0)53 9144120
Tel: +353 (0)86 3588626
www.edc.ie

THIS DRAWING IS THE PROPERTY OF E.D.C. AND SHALL NOT BE USED, REPRODUCED OR DISCLOSED WITHOUT THE WRITTEN CONSENT OF E.D.C. IT SHALL BE RETURNED UPON REQUEST.

ISO 9001 | BIM