
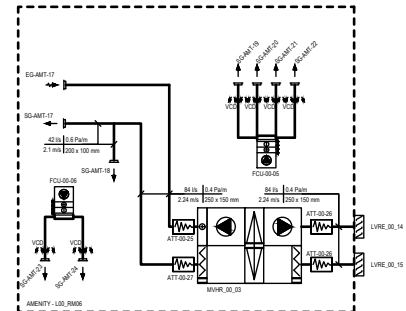
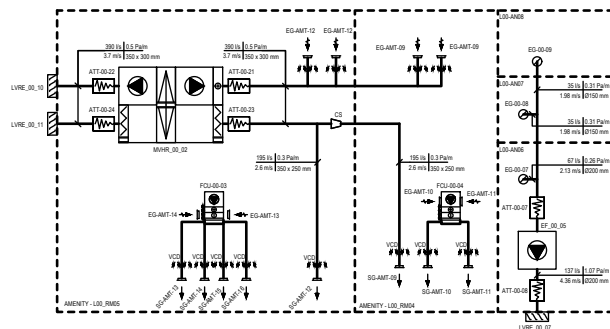
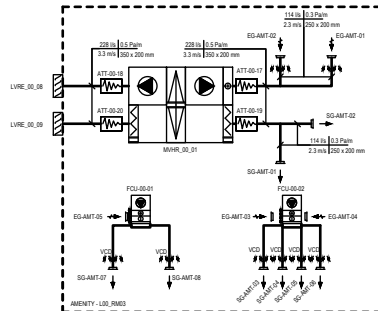


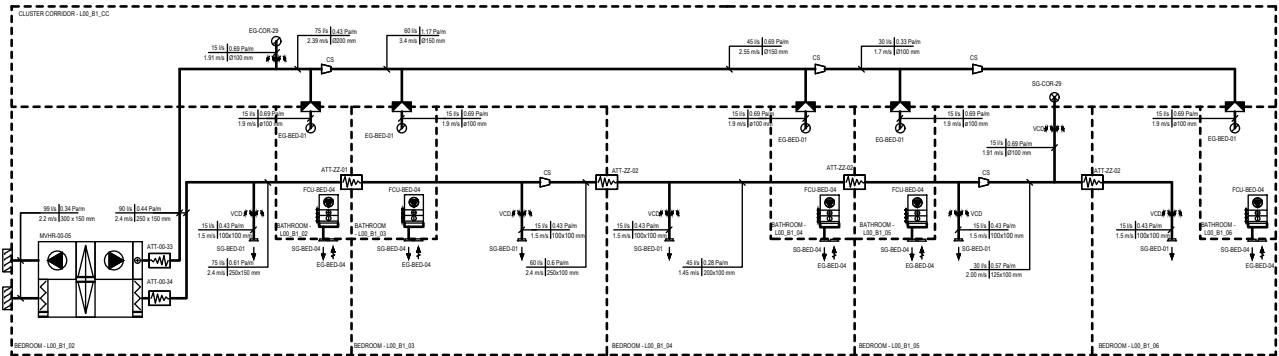

1. DO NOT SCALE
2. ALL DIMENSIONS IN MILLIMETERS.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHERS.
4. STRUCTURAL ENGINEERS & BUILDING SERVICES ENGINEERS DRAWINGS.
5. SPECIFICATIONS & SCHEDULES
6. ALL DUCTWORK TO BE INSTALLED TO DW144
7. REFER TO EDC SCHEDULES FOR MVHR, EXTRACT FAN, FIRE DAMPER AND ATTENUATION DETAILS/
8. ALL INTAKE AND EXHAUST TERMINATION TO BE A MINIMUM OF 1M APART.
9. REFER TO EDC LAYOUTS FOR DETAILS REGARDING FIRE RATED SMOKE
EXTRACT/SUPPLY SYSTEMS.
10. PENETRATION SEALS IN LINE WITH BS 1201-2 TO BE INSTALLED WHERE
DUCTWORK PENETRATES FIRE COMPARTMENTS.
11. 100MM EXHAUST, 100 600MM X 600MM ACCESS PANEL POSITIONED AT THE
REAR QUARTER OF THE UNIT FOR FILTER REPLACEMENT.

McAleer & Rushe