


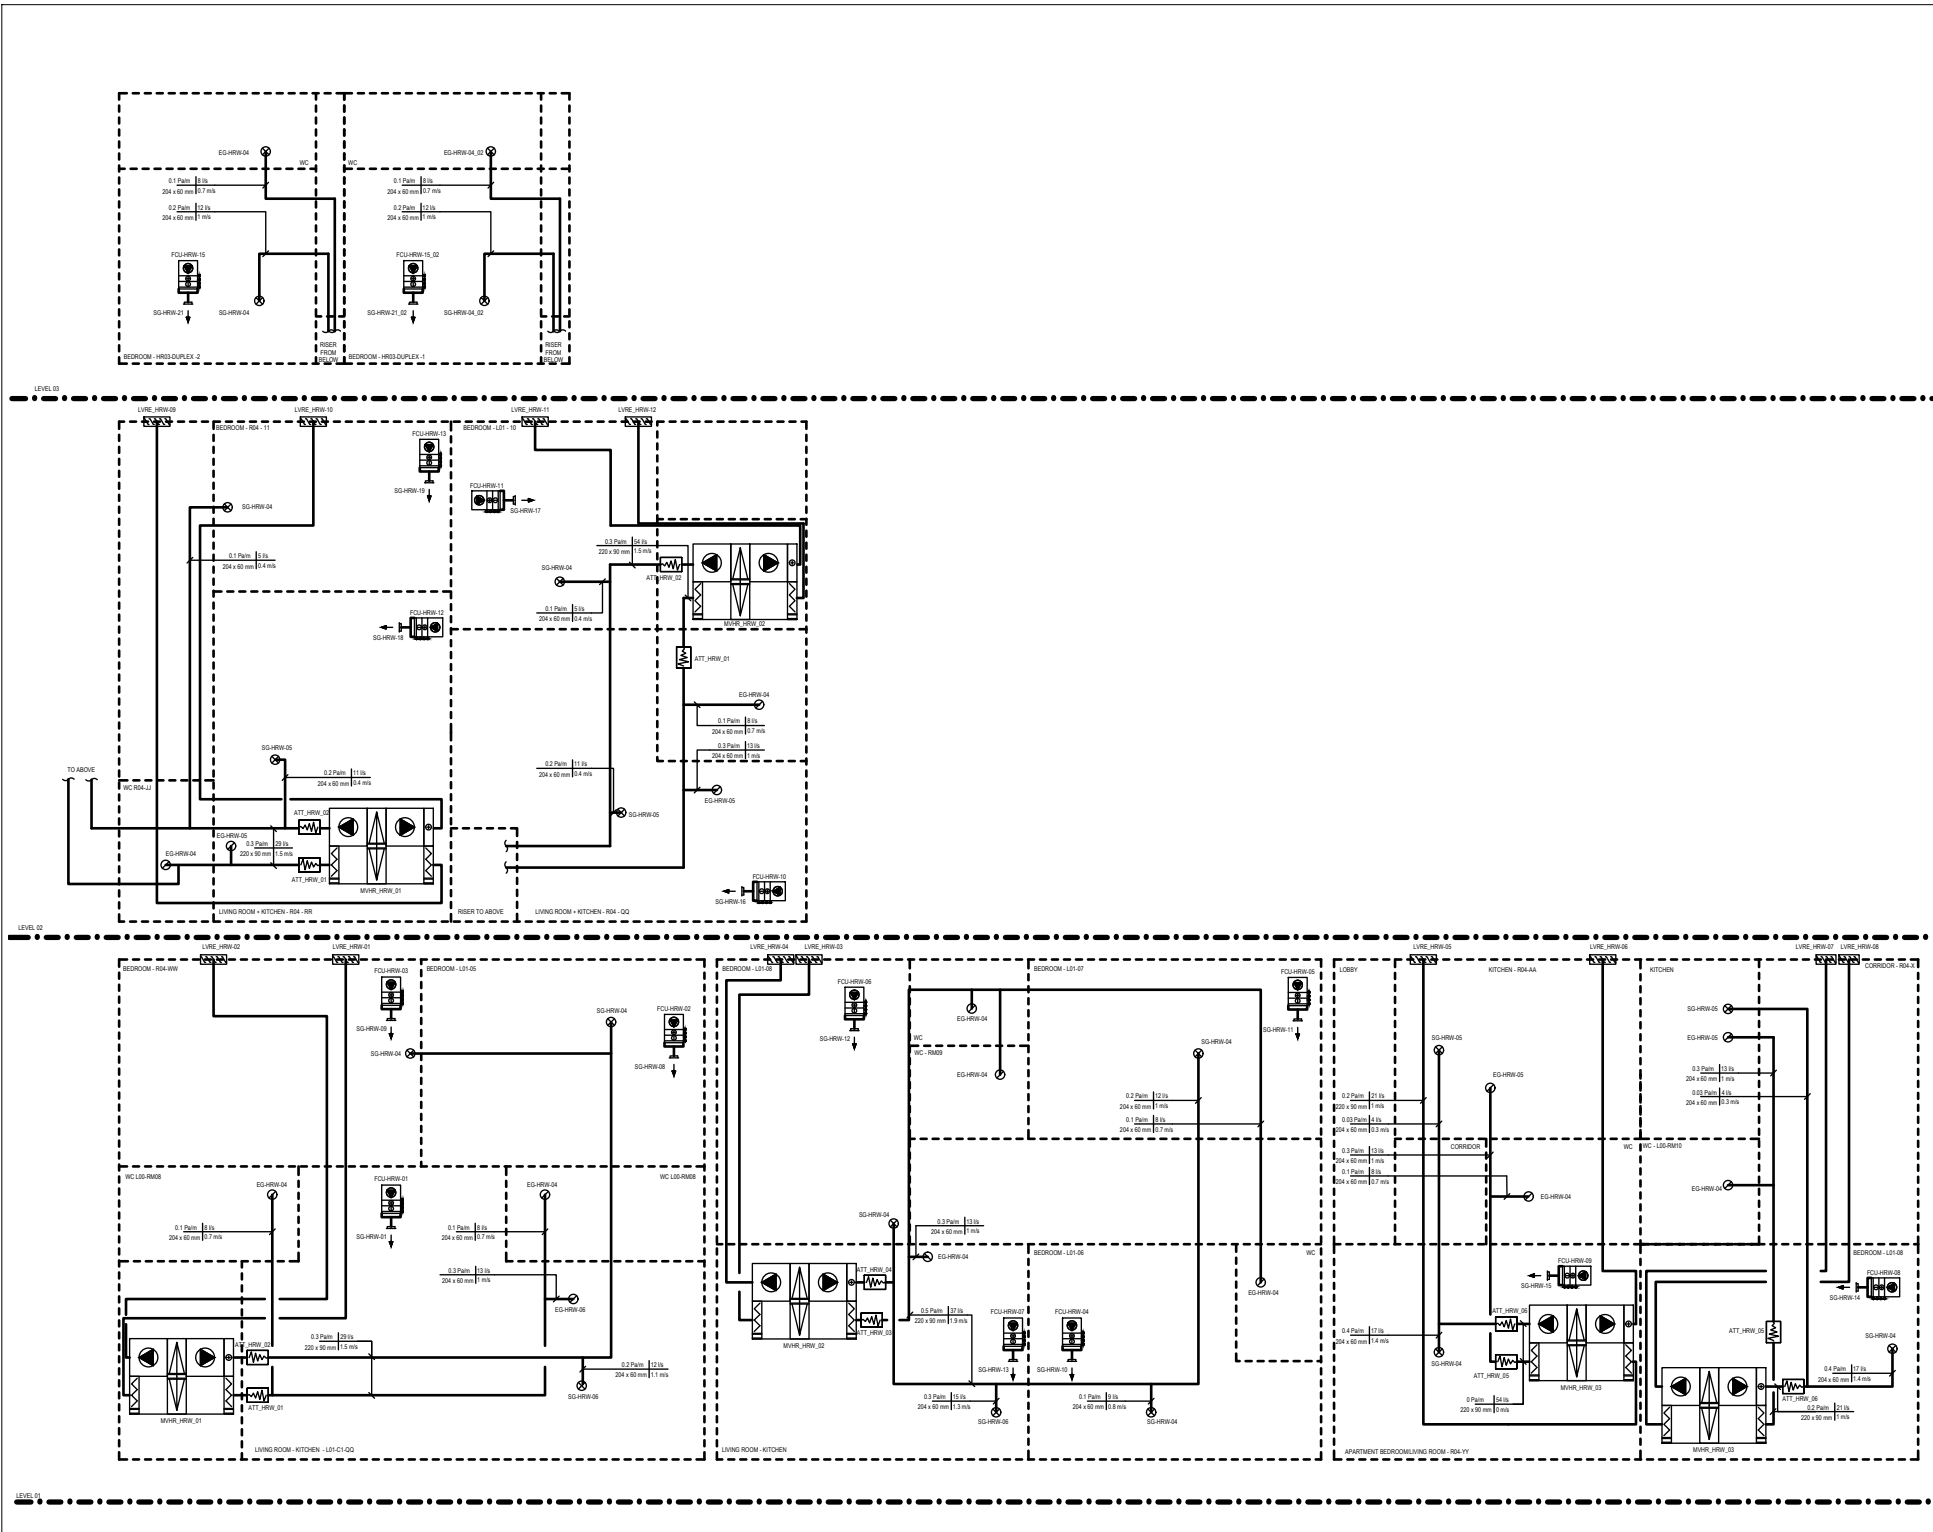

- NOTES:
1. DO NOT SCALE.
 2. ALL DIMENSIONS IN MILLIMETERS.
 3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECT, STRUCTURAL ENGINEERS & BUILDING SERVICES ENGINEERS DRAWINGS.
 4. SPECIFICATIONS & SCHEDULES.
 5. ALL DUCTWORK TO BE INSTALLED TO DW144.
 6. REFER TO EDC SCHEDULES FOR MVHR EXTRACT FAN, FIRE DAMPER AND ATTENUATION DETAILS/
 7. REFER TO EDC LAYOUTS FOR DETAILS REGARDING FIRE RATED ZONES.
 8. EXTRACT SUPPLY SYSTEMS.
 9. PENETRATION SEALS IN LINE WITH BS 12011-2 TO BE INSTALLED WHERE DUCTWORK PENETRATES FIRE COMPARTMENTS.
 10. ALL FCU TO HAVE 1NO 600MM X 600MM ACCESS PANEL POSITIONED AT THE REAR QUARTER OF THE UNIT FOR FILTER REPLACEMENT.

CSI	2/25/2025	FOR REVIEW	NOT	AP	
Rev	Date	Description	Disc	App	
Name McAlee & Rushe					
Project Printworks					
Title Mechanical Services - First Floor - Ventilation Schematic - Sheet 5 of 5					
Drawing No. 179-EDC-B1-ZZ-DR-M-30120					
BSA With Stage	STAGE 4B	Status Code	S4	Revision	C01
Drawn By	NTS	Model Manager	JC	Project Manager	BF