
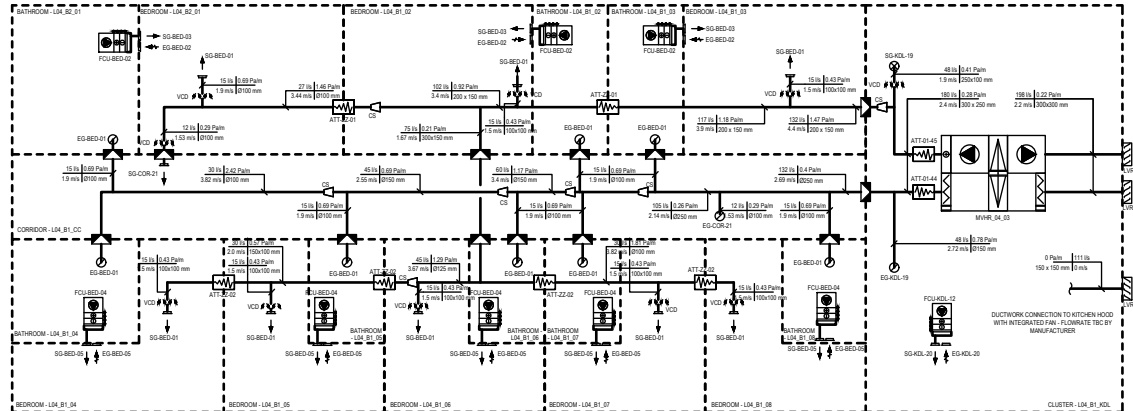
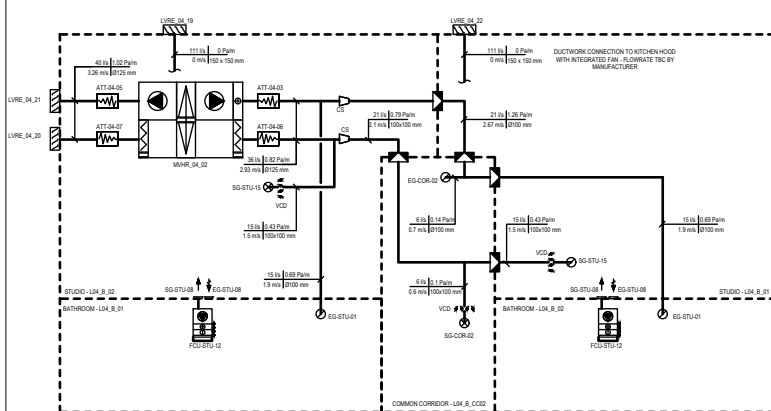


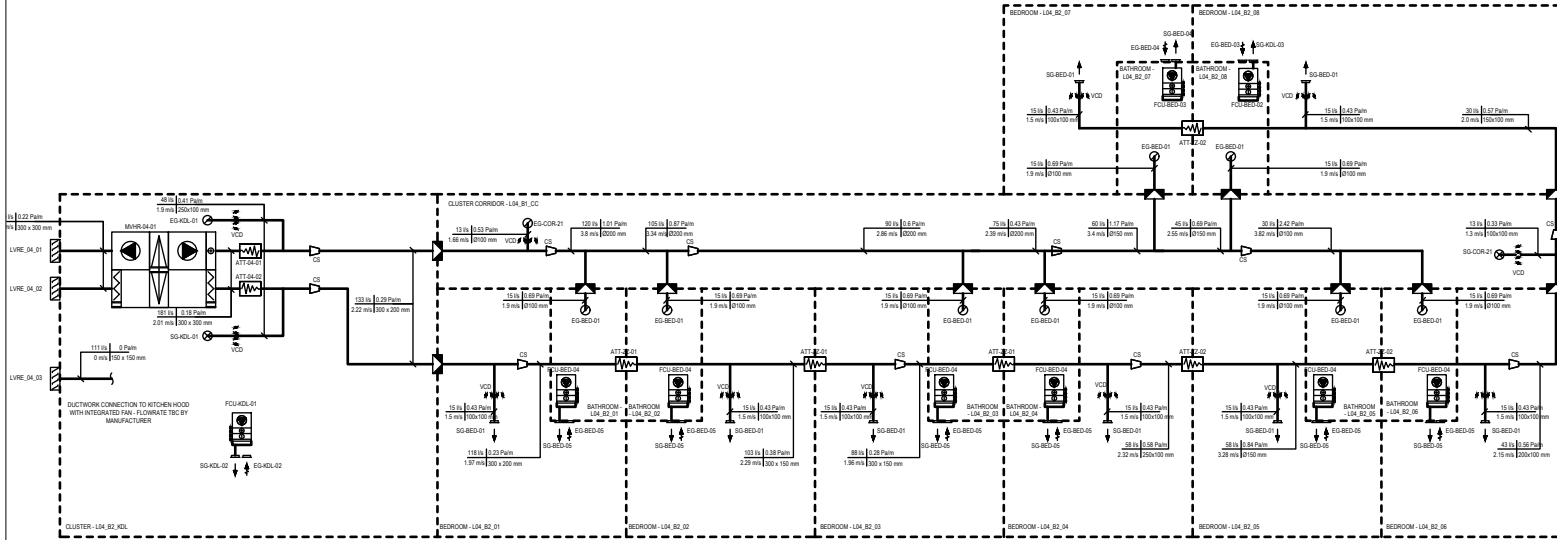

NOTES:

- DO NOT SCALE.
- ALL DIMENSIONS IN MILLIMETERS.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECT, STRUCTURAL ENGINEERS & BUILDING SERVICES ENGINEERS DRAWINGS, SPECIFICATIONS & SCHEDULES.
- ALL DUCTWORK TO BE INSTALLED TO DW144.
- REFER TO EDC SCHEDULES FOR MHR, EXTRACT FAN, FIRE DAMPER AND ATTENUATION DETAILS.
- ALL INTAKE AND EXHAUST TERMINATION TO BE A MINIMUM OF 1M APART.
- REFER TO EDC LAYOUTS FOR DETAILS REGARDING FIRE RATED SMOKE EXTRACT SUPPLY SYSTEMS.
- PENETRATION SEALS IN LINE WITH BS 12101-2 TO BE INSTALLED WHERE DUCTWORK PENETRATES FIRE COMPARTMENTS.
- ALL FCU TO HAVE TWO 600MM X 600MM ACCESS PANEL POSITIONED AT THE REAR QUARTER OF THE UNIT FOR FILTER REPLACEMENT.

CS1	20/08/2024	FOR REVIEW	RF	AS
Rev	Rev	Description	CS1	AS

McAfee & Rushe

Printworks

Mechanical Services - Fourth Floor - Ventilation Schematic - Sheet 1 of 2

179-EDC-B1-ZZ-DR-M-30127

ISSA With Change	Issue Code	Issue	COL
B7 PAGE 4B	S4	Service	

Drawn By	Model Manager	Project Manager
NTS	JC	BP