
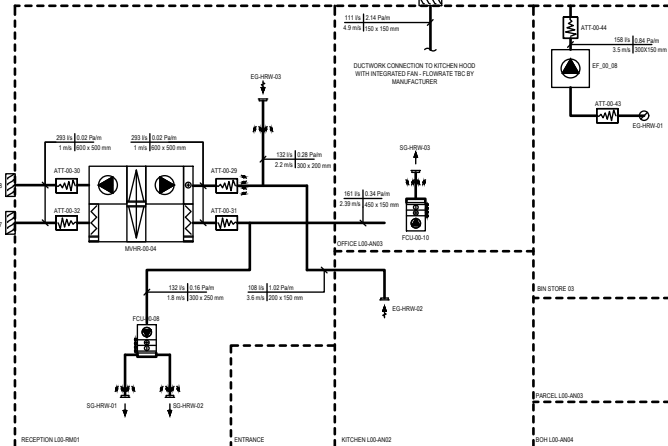
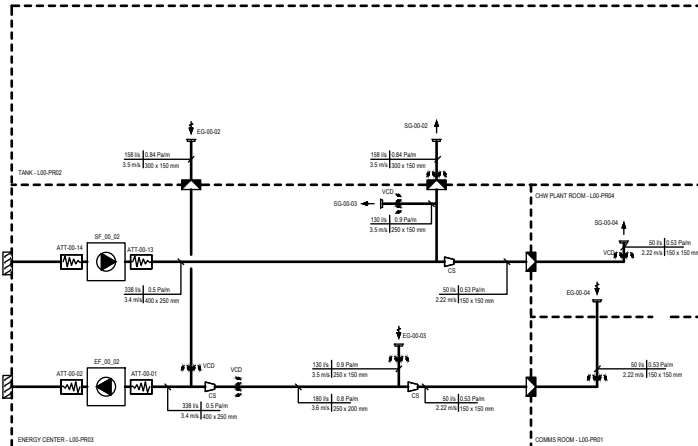
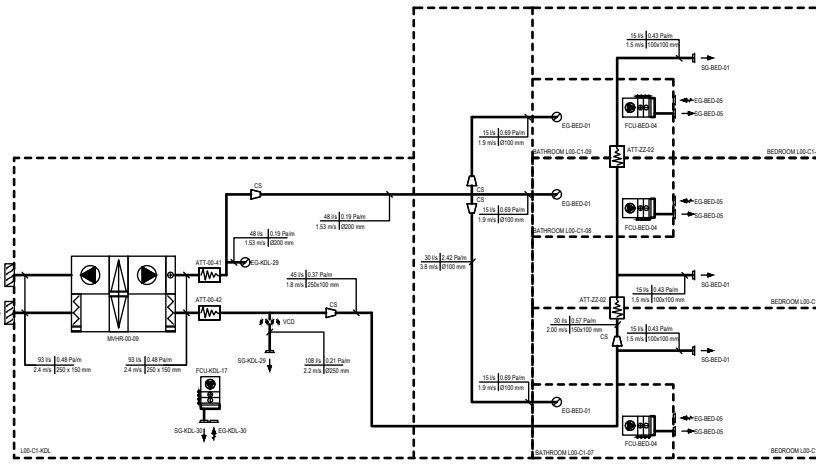
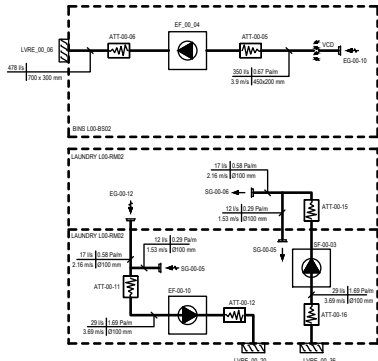
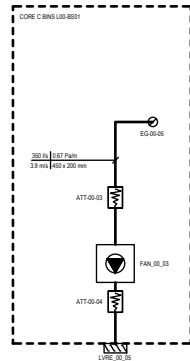


LEVEL 01

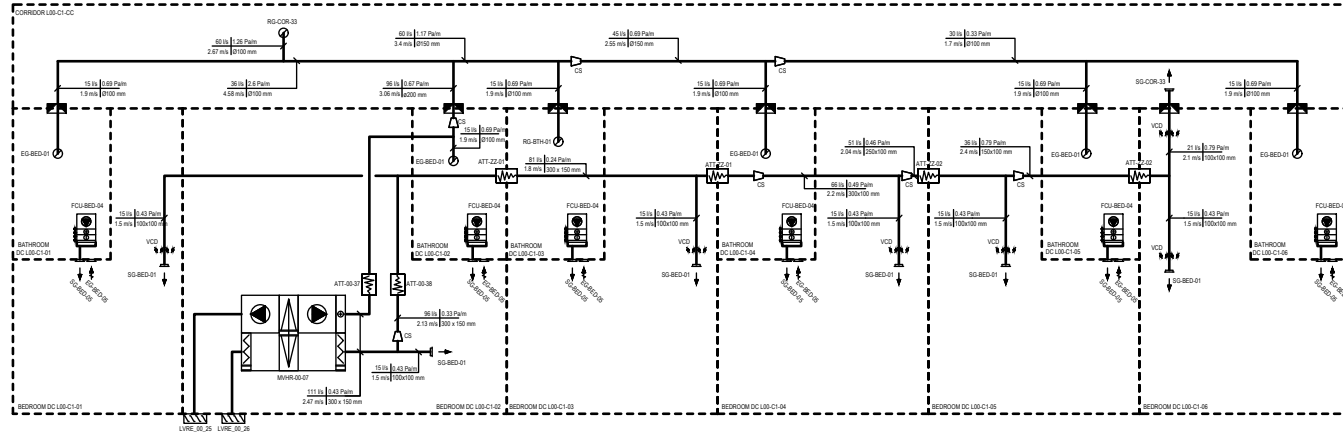

NOTES:

1. DO NOT SCALE.
2. ALL DIMENSIONS IN MILLIMETERS.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER ARCHITECT, STRUCTURAL, ENGINEERS & BUILDING SERVICES ENGINEERS DRAWINGS, SPECIFICATIONS & SCHEDULES.
4. ALL DUCTWORK TO BE INSTALLED TO DW144.
5. REFER TO EDC SCHEDULES FOR MHR, EXTRACT FAN, FIRE DAMPER AND ATTENUATION DETAILS.
6. ALL INTAKE AND EXHAUST TERMINATION TO BE A MINIMUM OF 1M APART.
7. REFER TO EDC LAYOUTS FOR DETAILS REGARDING FIRE RATED SMOKE.
8. EXTRACT/SUPPLY SYSTEMS.
9. PENETRATION BEARS IN LINE WITH BS 12101-2 TO BE INSTALLED.
10. DUCTWORK PENETRATES FIRE COMPARTMENTS.
11. ALL FOU TO HAVE 1000MM x 600MM ACCESS PANEL POSITIONED AT THE REAR QUARTER OF THE UNIT FOR FILTER REPLACEMENT.

CSI	20/03/2024	FOR REVIEW	RF	AB
REV	Rev	Description	CSG	AB

McAneer & Rushe

Printworks

Mechanical Services - Ground Floor -
Ventilation Schematic - Sheet 2 of 2

Drawing No: 179-EDC-B1-ZZ-DR-M-30115

ISSUE	Drawn	Checked	Drawn	Checked
01	NTS	JAC	JAC	BP