

WARRANTY VOID
IF SEAL IS BROKEN

QC
pass


Clearline

INVERTER


Product: Grid-Tied PV Inverter
Model : CSI2000S

PV Input	UDCmax: 600Vd.c.
	UMPP: 40...450Vd.c.
	IDC,max: 16Ad.c.
	ISC PV: 25Ad.c.
Output	UAC,r: 220/230/240Va.c.
	fAC, r: 50/60Hz
	PAC,r: 2000W
	IAC,max: 9.1Aa.c.
	Sr: 2000VA
	Smax: 2000VA

P.F.: ~1,0.8cap...0.8ind, Toperating: -25...+60°C
Non-isolated, IP66, Protective Class I, OVC DCII/ACIII

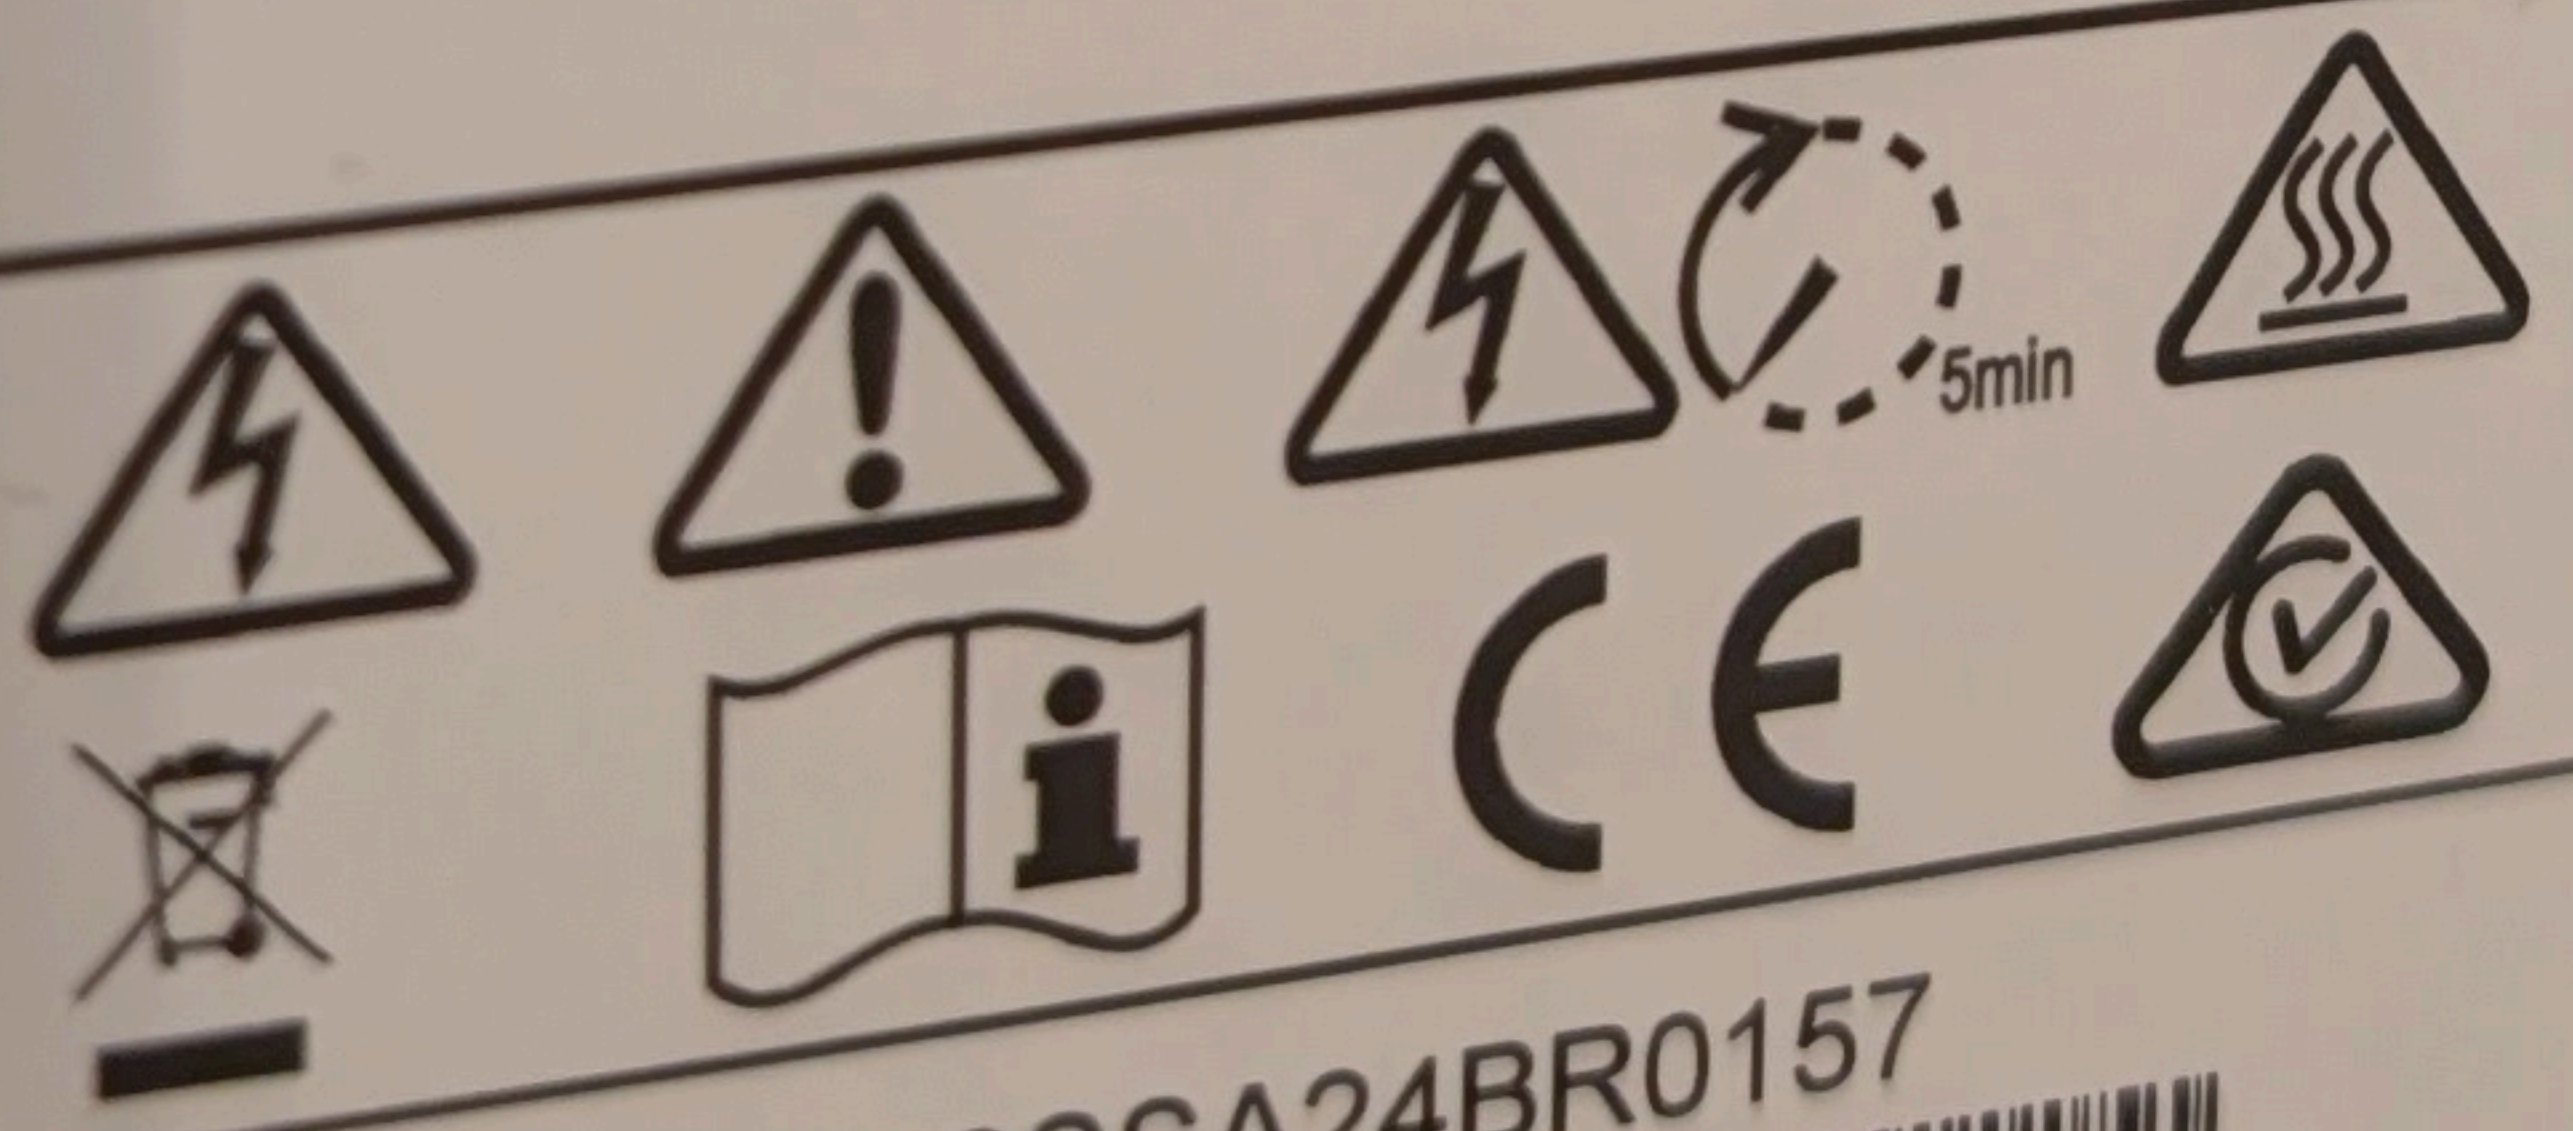


S/N: 22000SSA24BR0157

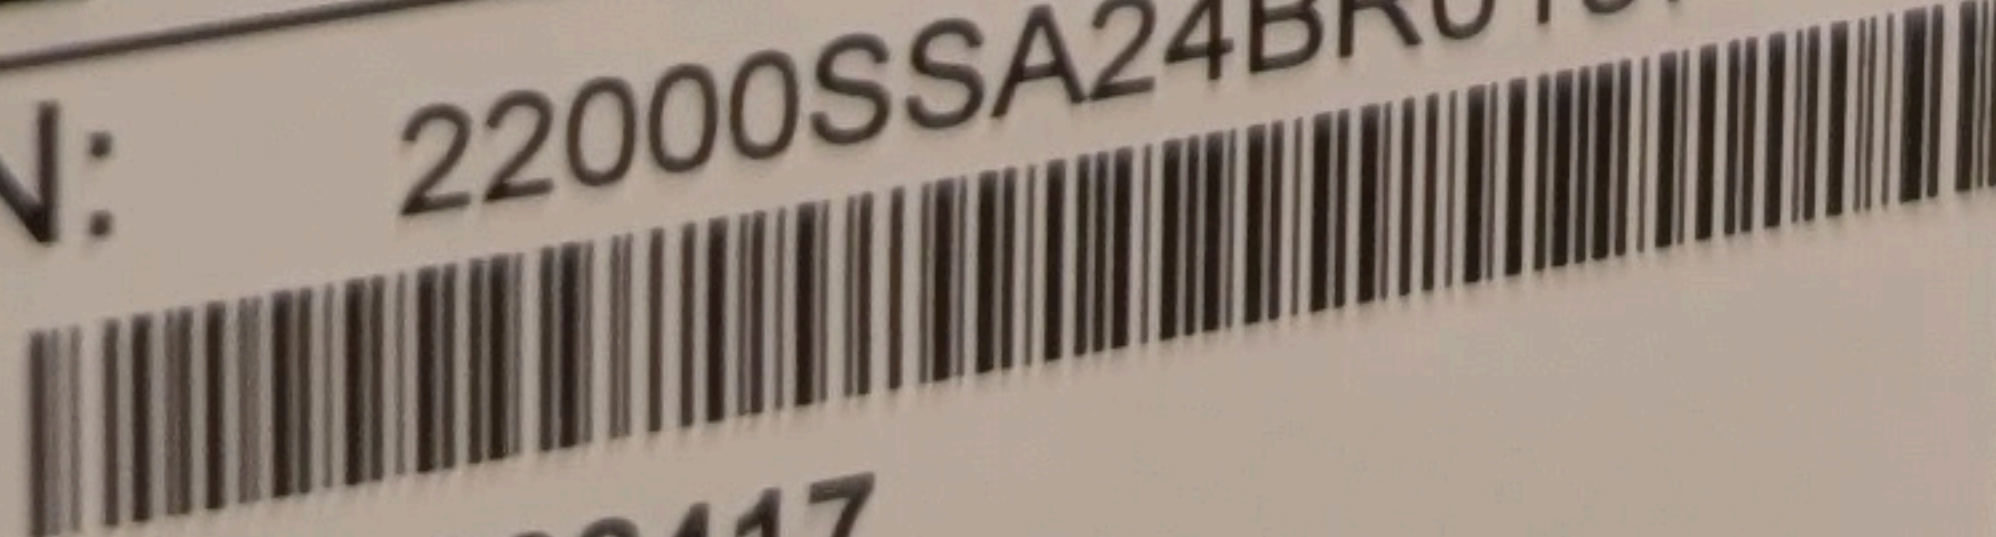

Check Code: 008417

Viridian Solar Ltd
E-mail: info@viridiansolar.co.uk
www.viridiansolar.co.uk

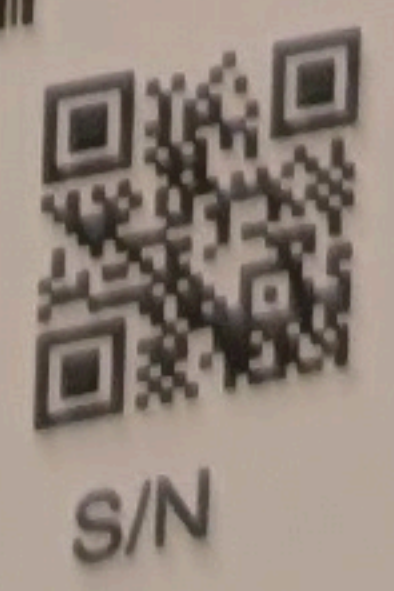



EML
M25

emlite
1 Stevern Way, Peterborough, PE1 5EL

EML
M25

Model Number:
ECA2.nz
V1

EXP
IMP


000000.0

NET
kWh

1000 Imp/ kWh Cl.B

230V 50Hz 1,0-20(100)A
-40°C...+70°C
2025


EML2548714369

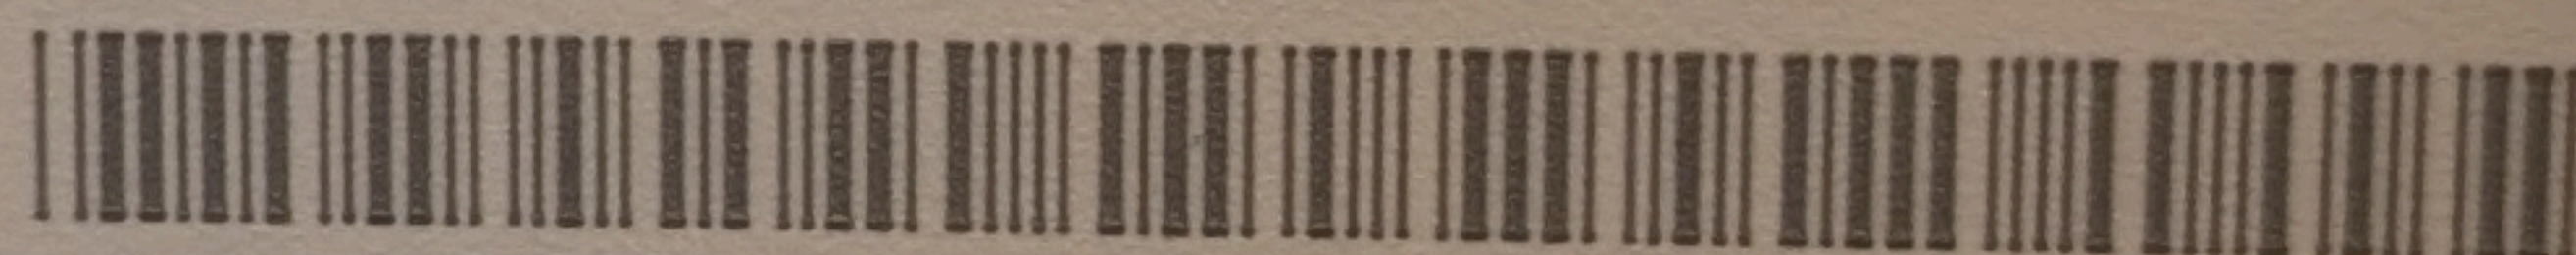

UK CA M25 0120 CE M25 0598 0120\ SGS0103

PHOTOVOLTAIC
SYSTEM

WARNING
ISOLATE ELSEWHERE
BEFORE REMOVING
THIS COVER

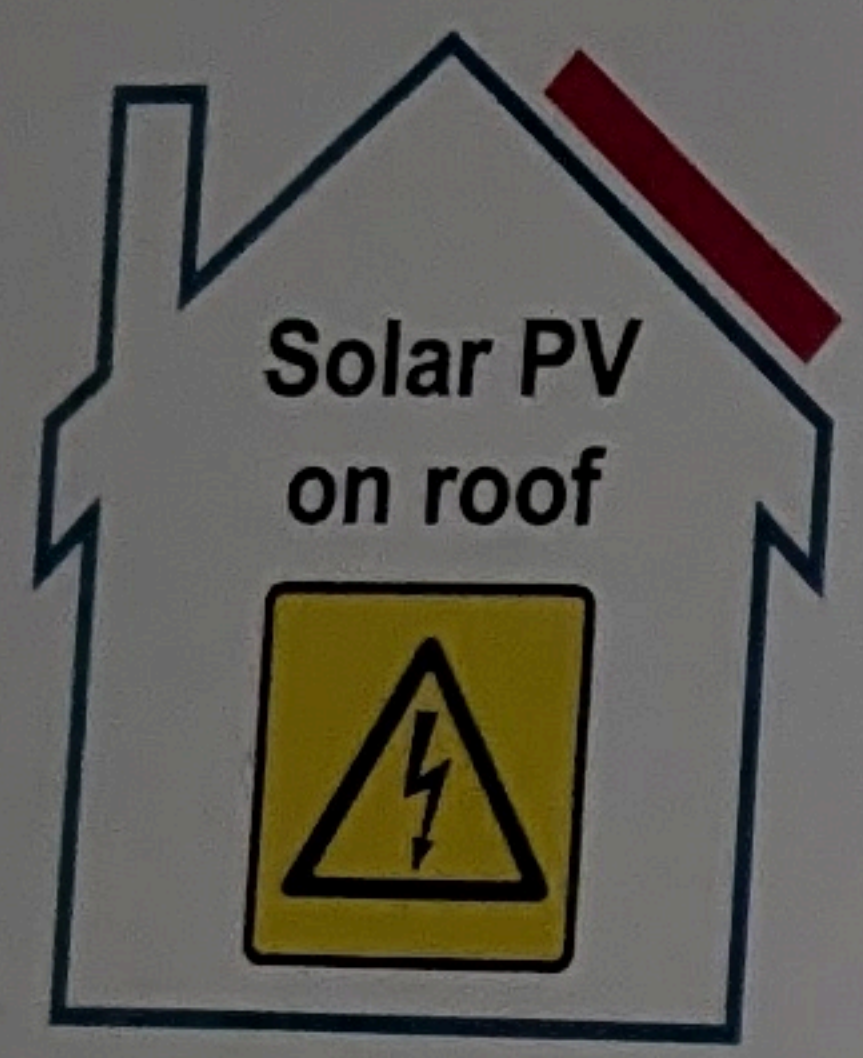

WARNING
Dual Supply

Do not work on this equipment until it is isolated from both the mains and the on-site generation supplies

Isolate on-site generator at: _____

Isolate the mains supply at: _____

Place at point of incoming mains (normally at electricity meter)

MAINS SMOKE / HEAT ALARMS

HOW TO REMOVE ALARM

SWITCH OFF THE MAINS SUPPLY, RELEASE CATCH ON ALARM BY PUSHING SCREWDRIVER INTO SLOT & PUSH COVER AWAY

DATE INSTALLED: 12/5/2026

No. OF ALARMS ON CIRCUIT: 1

WARNING: DO NOT MEGGER ALARMS P/N A13832

image

