

Clearline
INVERTER

INVERTER
WARNING - Dual Supply
Isolate AC and DC
before carrying out work
Place on inverter front cover

PV Array DC Isolator
WARNING
Contains live parts during daylight

DO NOT
disconnect DC plugs
and sockets under load
- turn off AC supply first

viridian solar

WARRANTY VOID
IF SEAL IS BROKEN

Clearline
INVERTER
Model: Grid-Tied PV Inverter
del: CS2000S

DCmax (W)	
DCmax (V)	
DCmax (A)	
ACmax (W)	
ACmax (V)	
ACmax (A)	
Grid (V)	
Grid (A)	
Grid (W)	

~110V, 50Hz, Temp. 0-40°C
max. PV Protection: DC 250VDC

CE

PHOTOVOLTAIC SYSTEM

Solar PV System
Point of Emergency
switching

IP65 4P32A

UK CB CE

 **WARRANTY VOID**
IF SEAL IS BROKEN

QC
pass

Clearline

INVERTER

Product: Grid-Tied PV Inverter
Model : CSI2000S

PV Input

U_{DCmax} : 600Vd.c.

U_{MPP} : 40...450Vd.c.

$I_{DC,max}$: 16Ad.c.

I_{SC} PV: 25Ad.c.

Output

$U_{AC,r}$: 220/230/240Va.c.

$f_{AC,r}$: 50/60Hz

$P_{AC,r}$: 2000W

$I_{AC,max}$: 9.1Aa.c.

S_r : 2000VA


S_{max} : 2000VA

P.F.: ~1, 0.8cap...0.8ind, $T_{operating}$: -25...+60°C
Non-isolated, IP66, Protective Class I, OVC DCII/ACIII



S/N:

22000SSA24BR0058

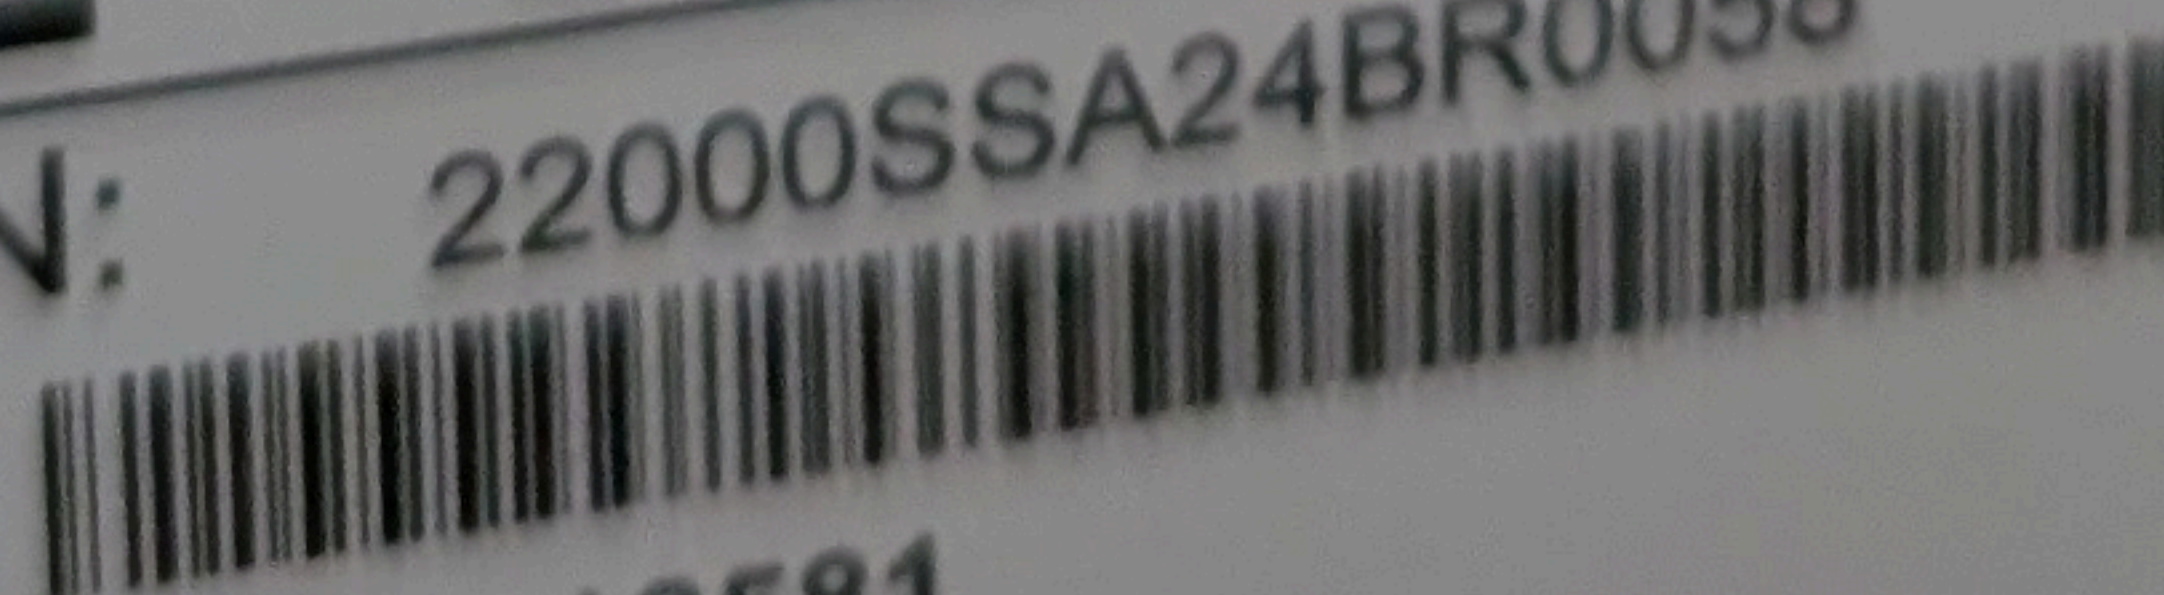

Check Code: 012581

Viridian Solar Ltd
E-mail: info@viridiansolar.co.uk
www.viridiansolar.co.uk



S/N

emlite
1 Stevern Way, Peterborough, PE1 5EL

EML
M25



Model Number:
ECA2.nz
V1
1000 Imp/ kWh Cl.B
230V 50Hz 1,0-20(100)A
-40°C...+70°C
2025

EXP
IMP

-0000000

NET
kWh


EML2548714370

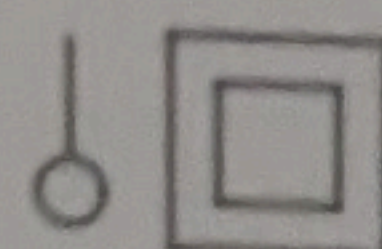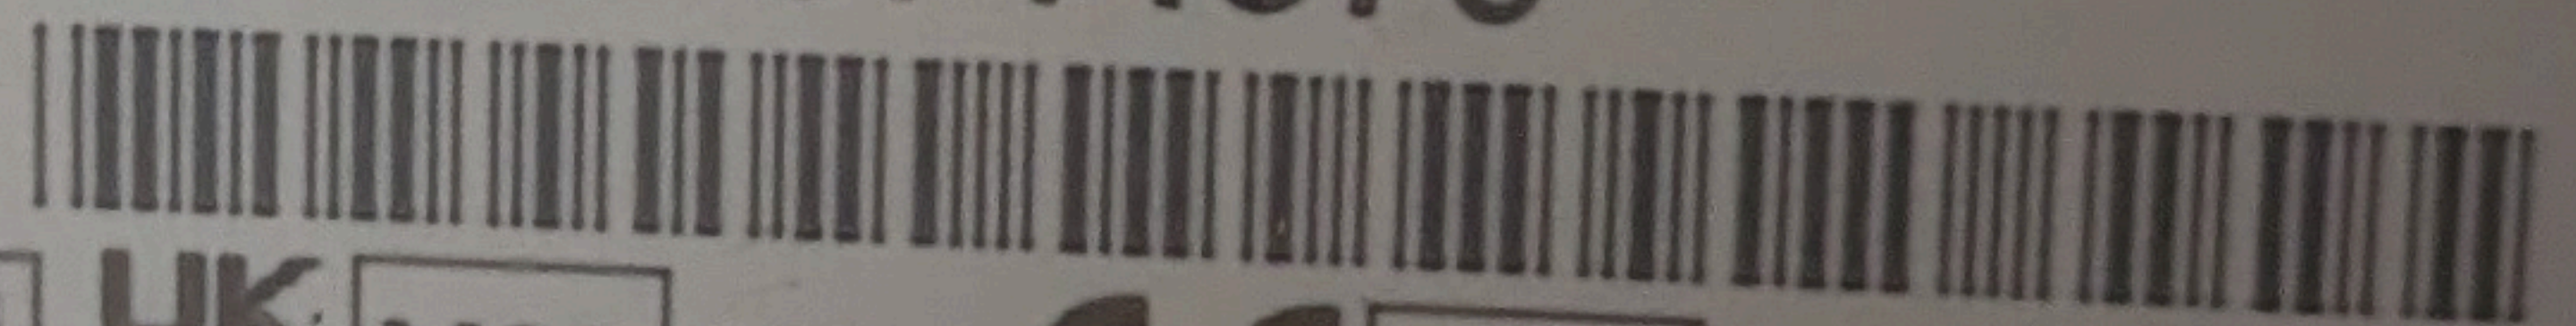

UK
CA

M25

0120

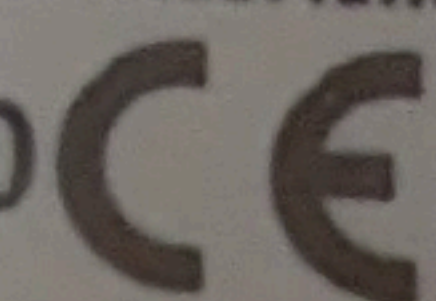

M25

0598

0120

SGS0103

PHOTOVOLTAIC
SYSTEM



WARNING
Dual Supply

Isolate on-site generator at:

Isolate the mains supply at:

Place at point of incoming mains (normally at electricity meter)

Do not work on this equipment until it is isolated from both the mains and the on-site generation supplies

:hager

MAINS SMOKE / HEAT ALARMS

HOW TO REMOVE ALARM

SWITCH OFF THE MAINS SUPPLY, RELEASE CATCH ON ALARM BY PUSHING SCREWDRIVER INTO SLOT & PUSH COVER AWAY

DATE INSTALLED: / /

No. OF ALARMS ON CIRCUIT: ☐

WARNING: DO NOT MEGGER ALARMS · P/N A13632 Rev. 1