Appendix: Daylight, Sunlight, Overshadowing and Solar Glare


Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 1

Drawings of the existing, proposed and surrounding buildings

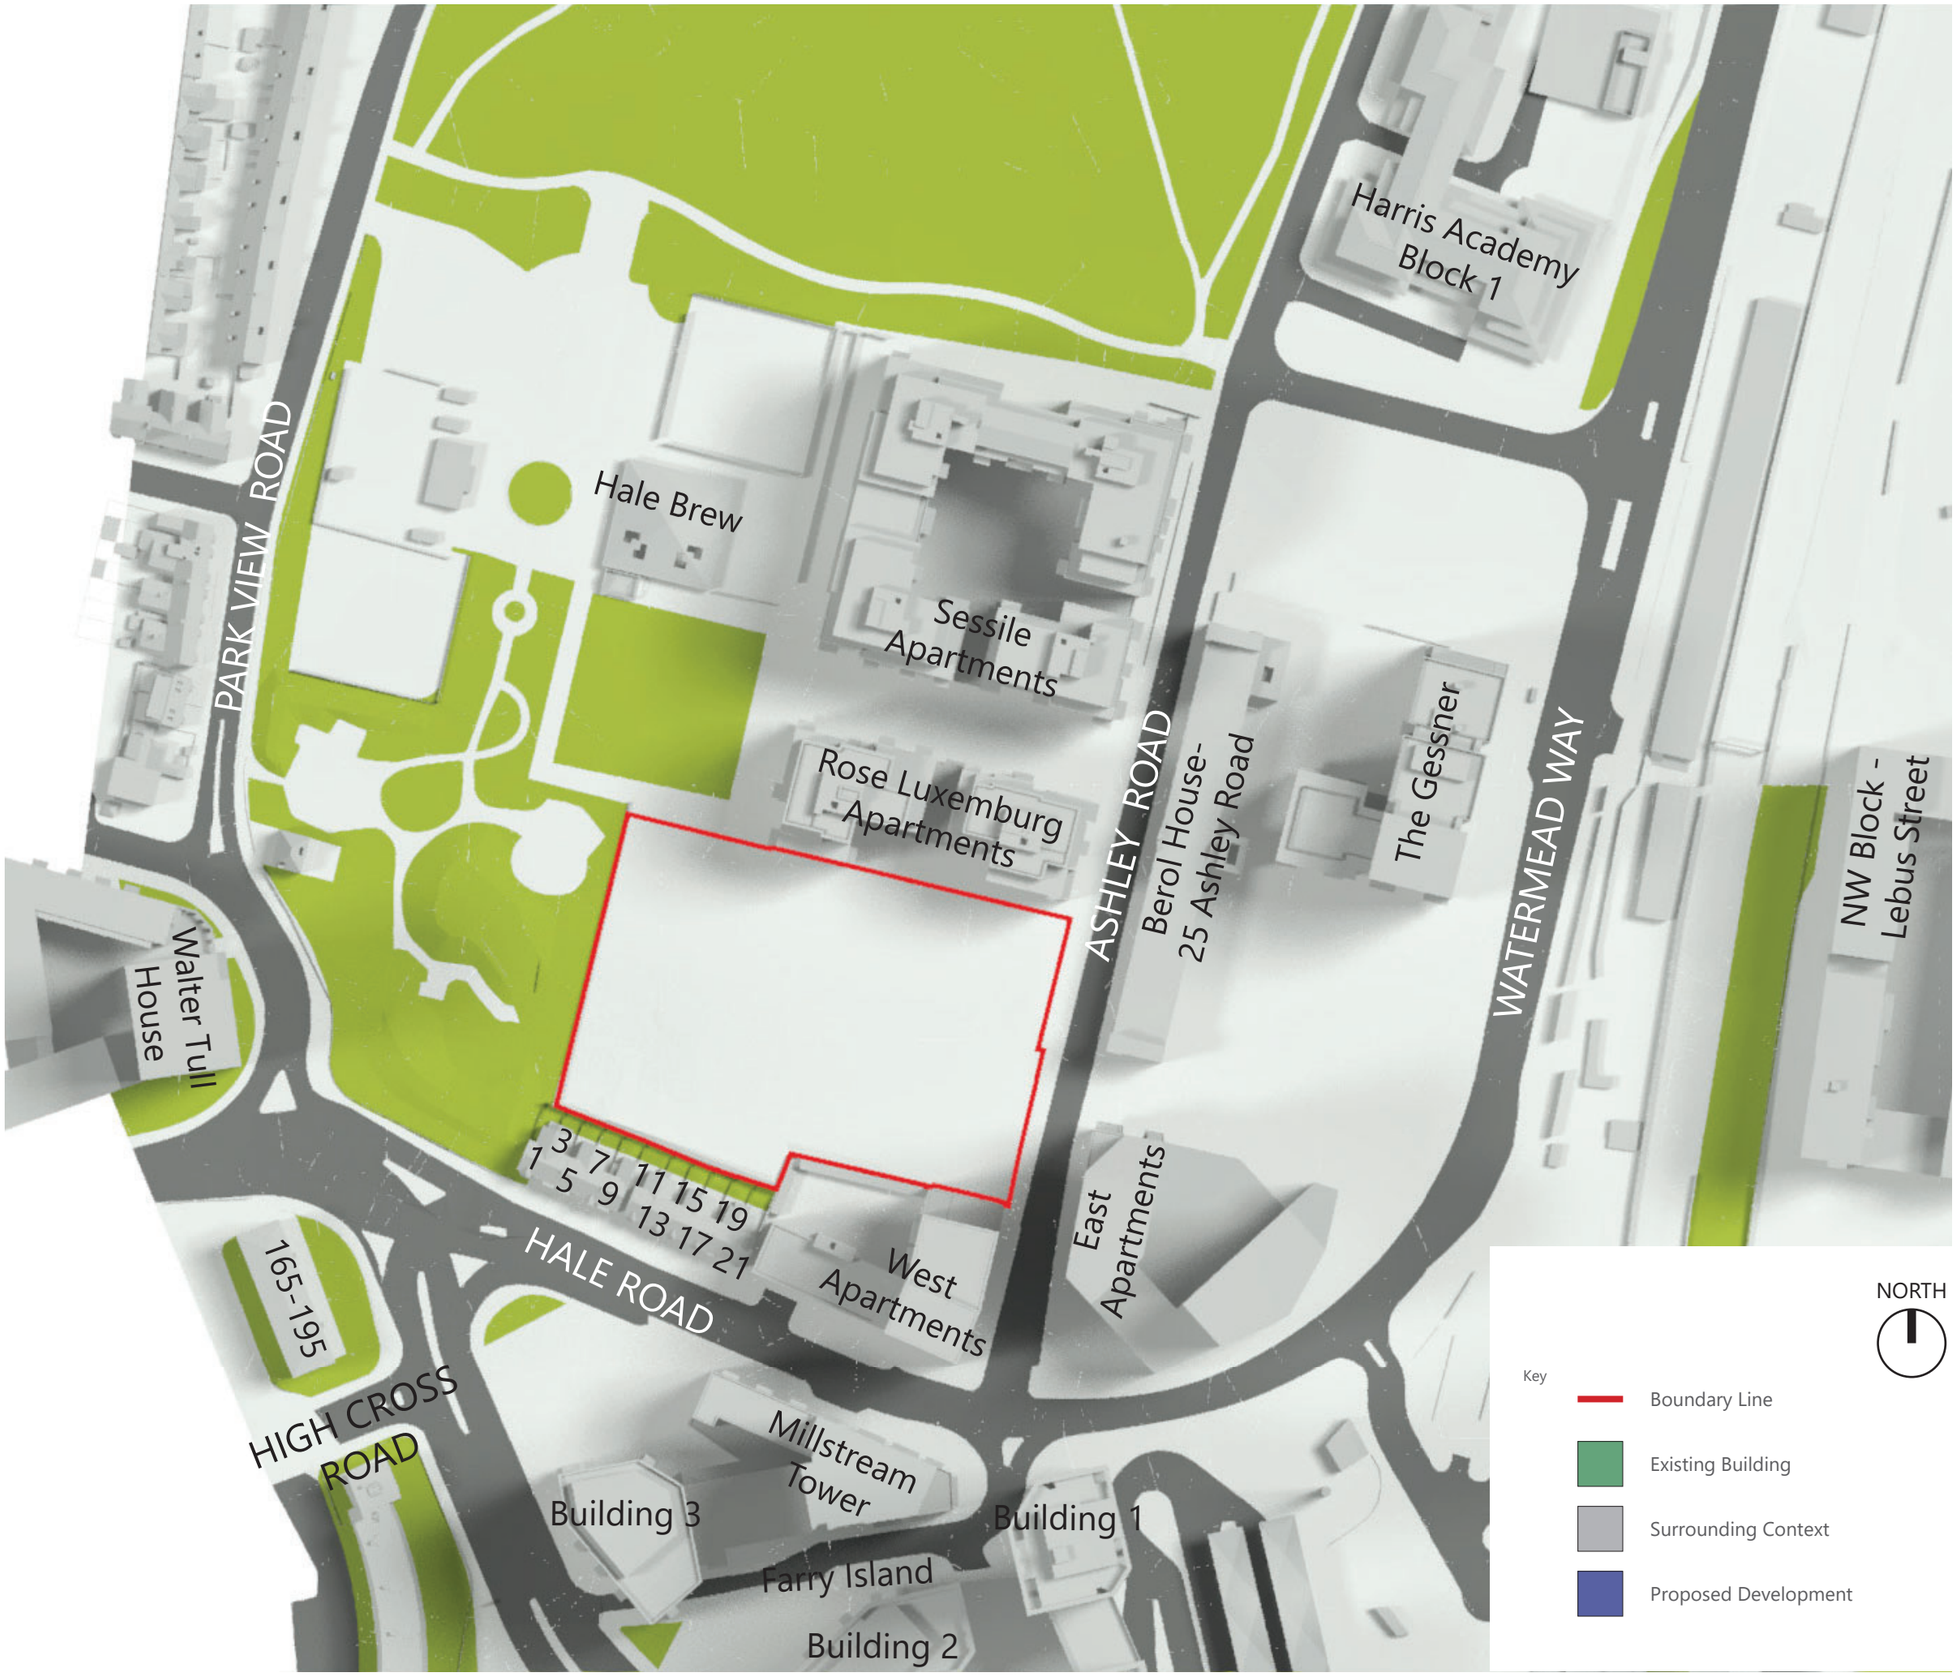

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH


Key
- Existing Building
- Surrounding Context
- Proposed Development

Project: Ashley Road Tottenham Hale

Title: Existing Condition Plan View

Drawn	TR	Checked	--
Date	08/08/2026	Project	10106

Rel no.	Prefix	Page no.
08	DS01	01

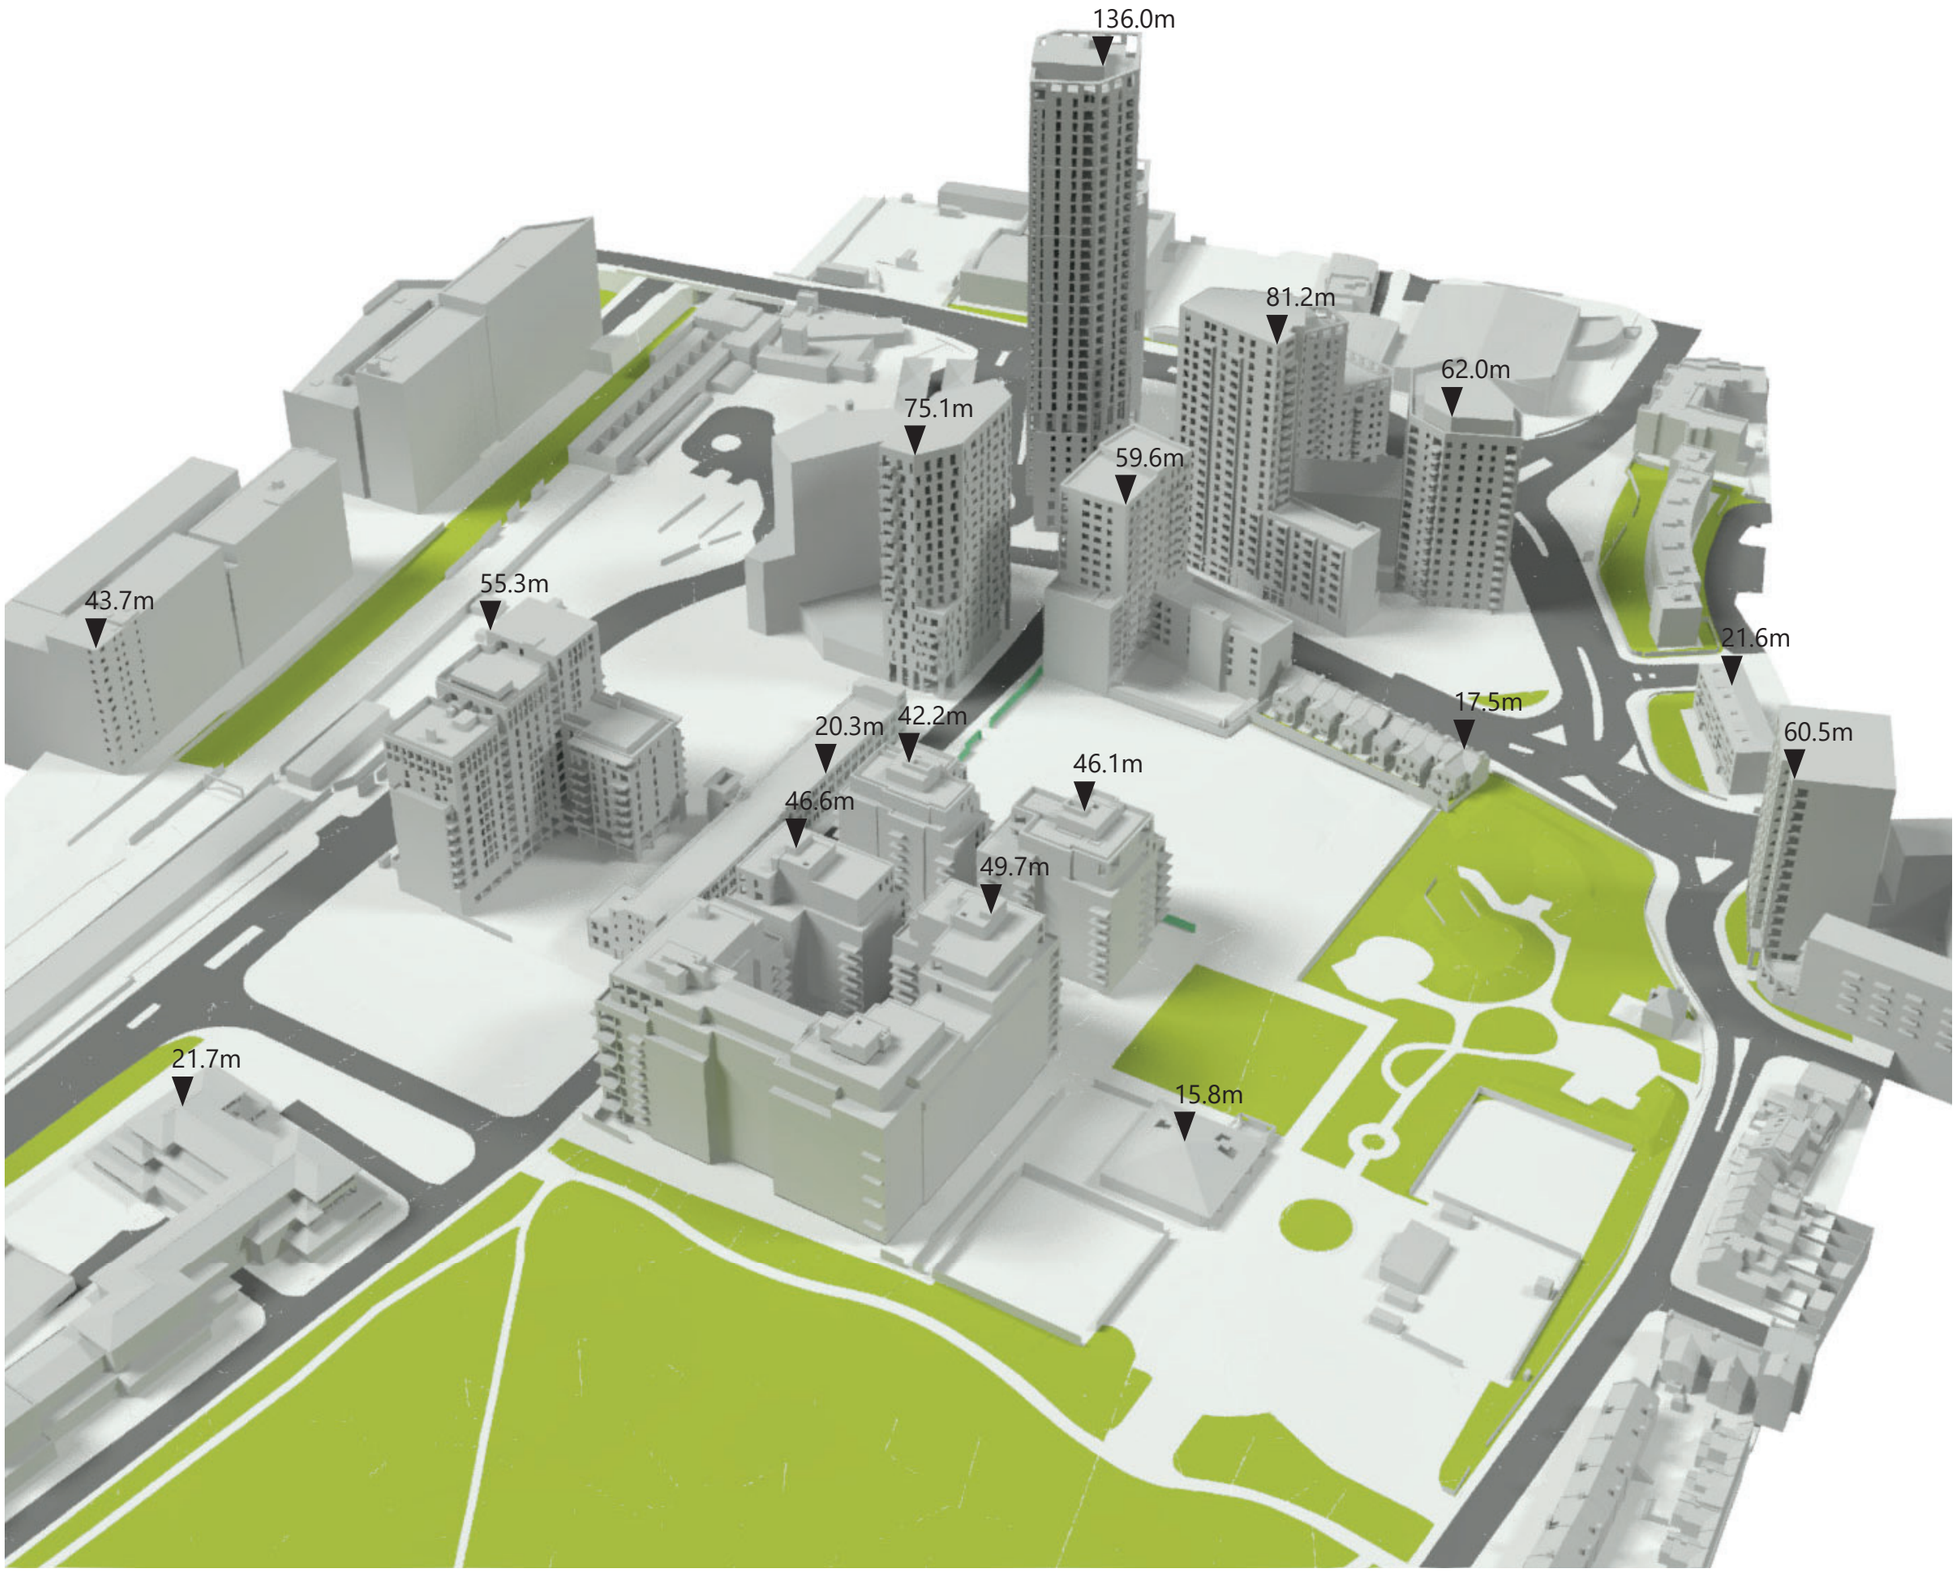

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey


Key

- Existing Building
- Surrounding Context
- Proposed Development

Project: Ashley Road
Tottenham Hale

Title: Existing Condition
3D View

Drawn	Checked
TR	--
Date	Project
08/08/2026	10106
Rel no.	Prefix / Page no.
08	DS01 / 02

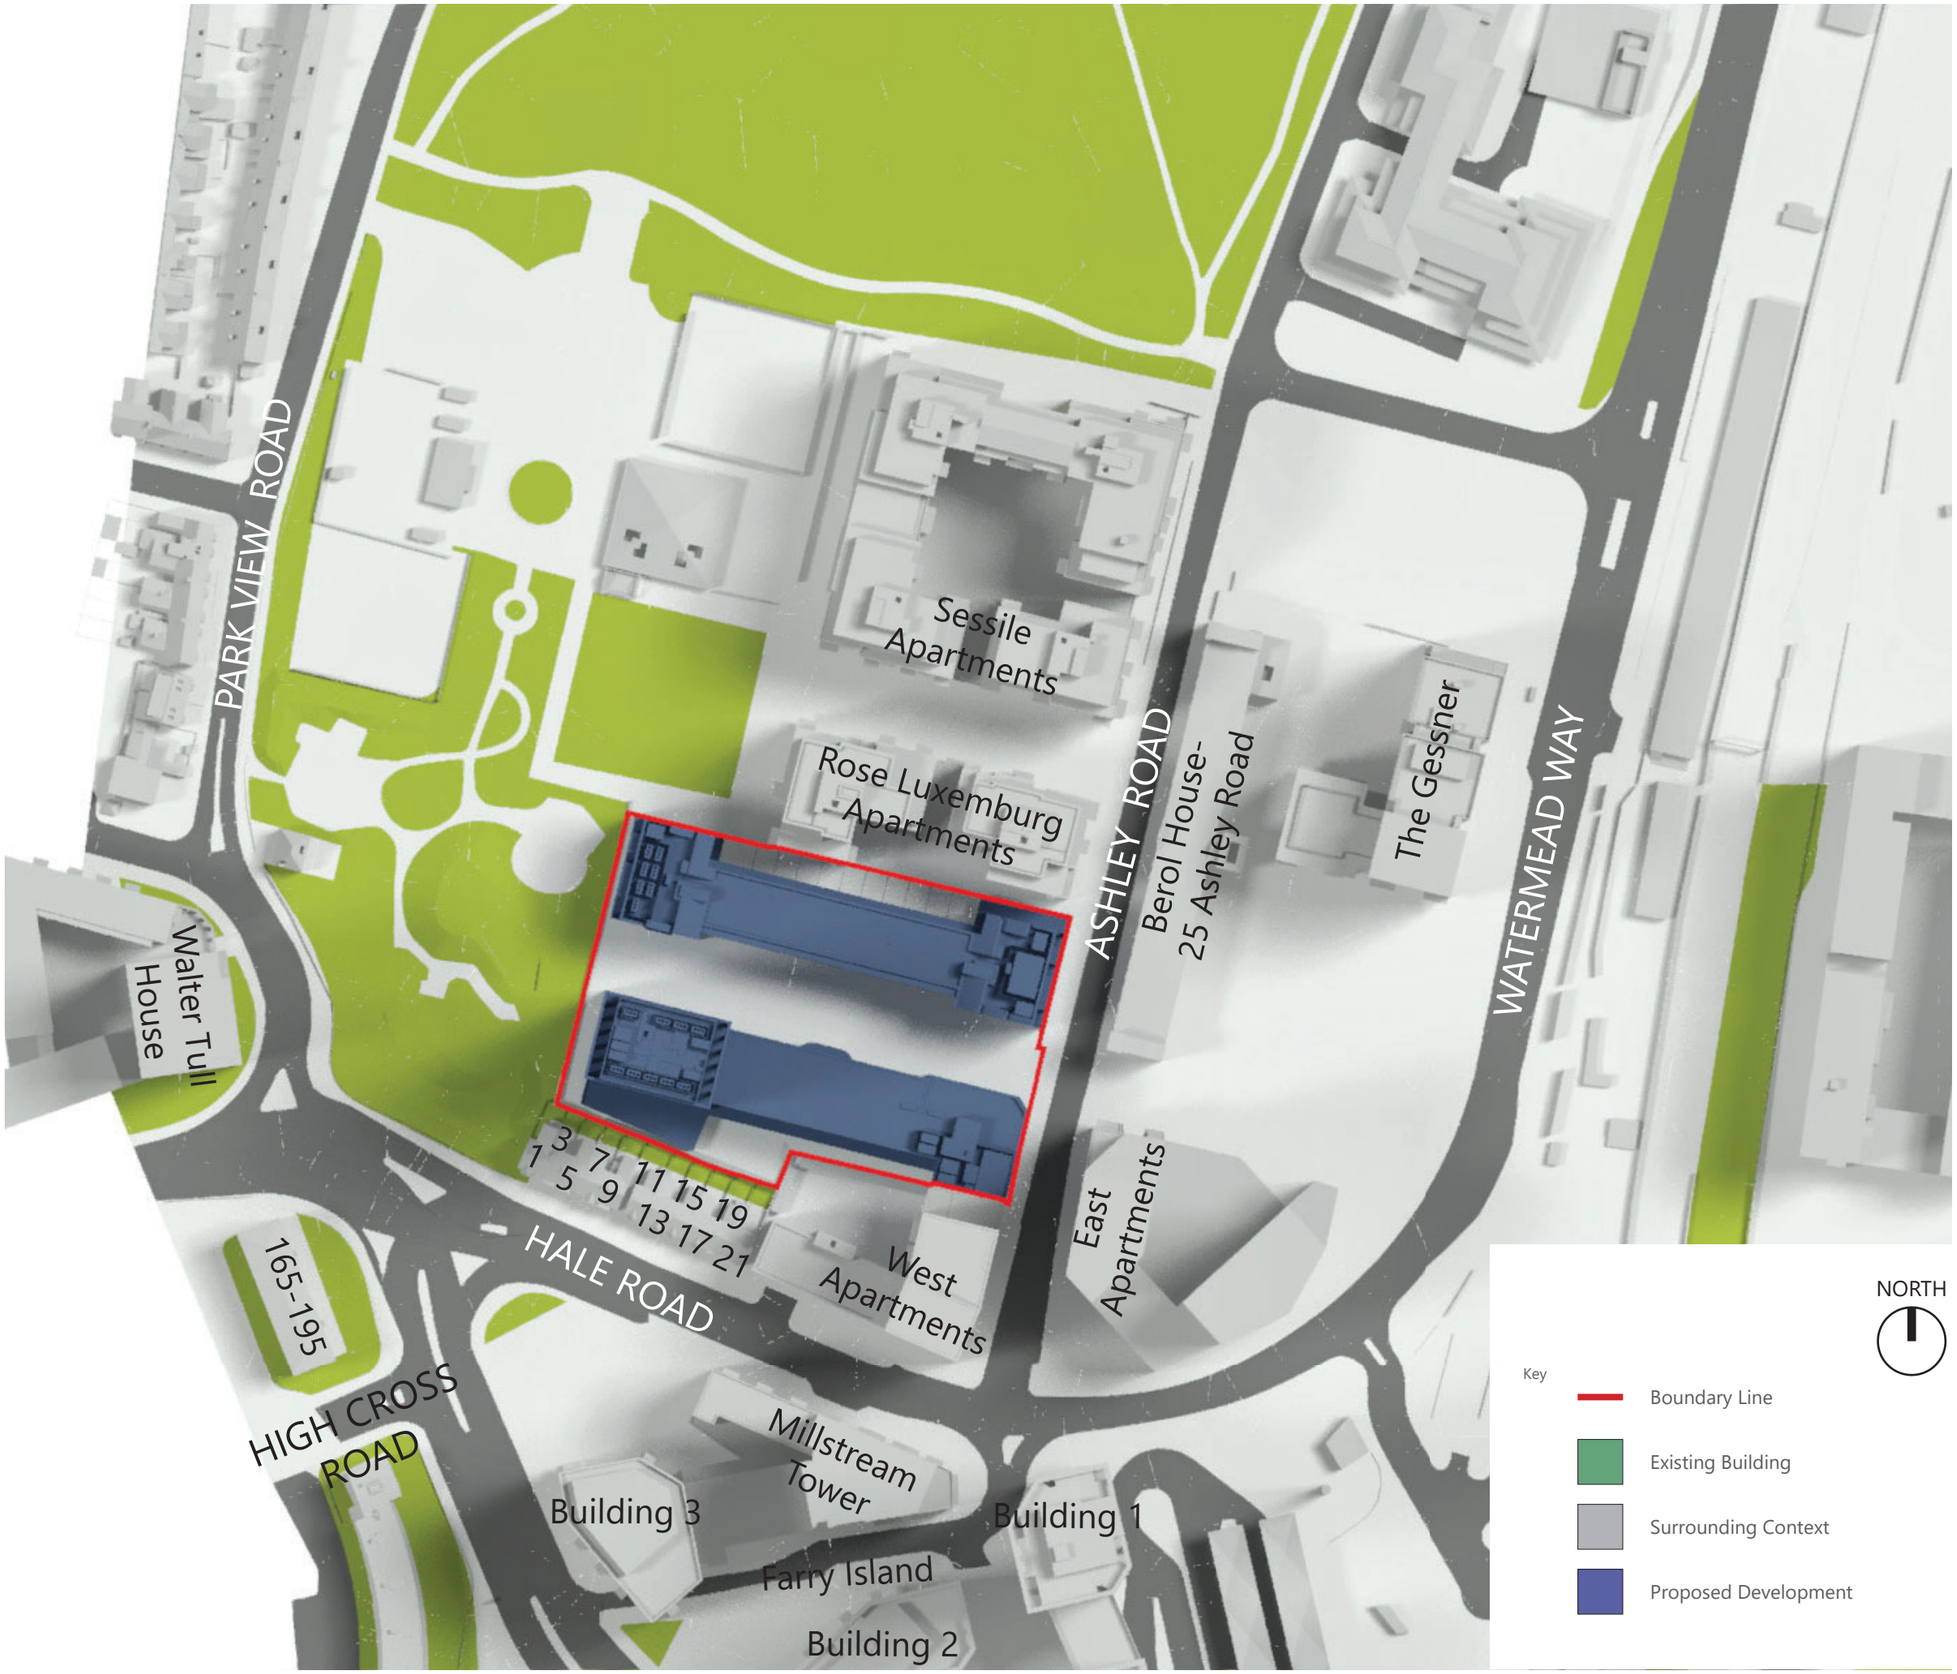

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey


NORTH

Key
- Existing Building
- Surrounding Context
- Proposed Development

Project: Ashley Road
Tottenham Hale

Title: Proposed Development
Plan View

Drawn	Checked
TR	--
Date	Project
08/08/2026	10106
Rel no.	Prefix / Page no.
08	DS01 / 03

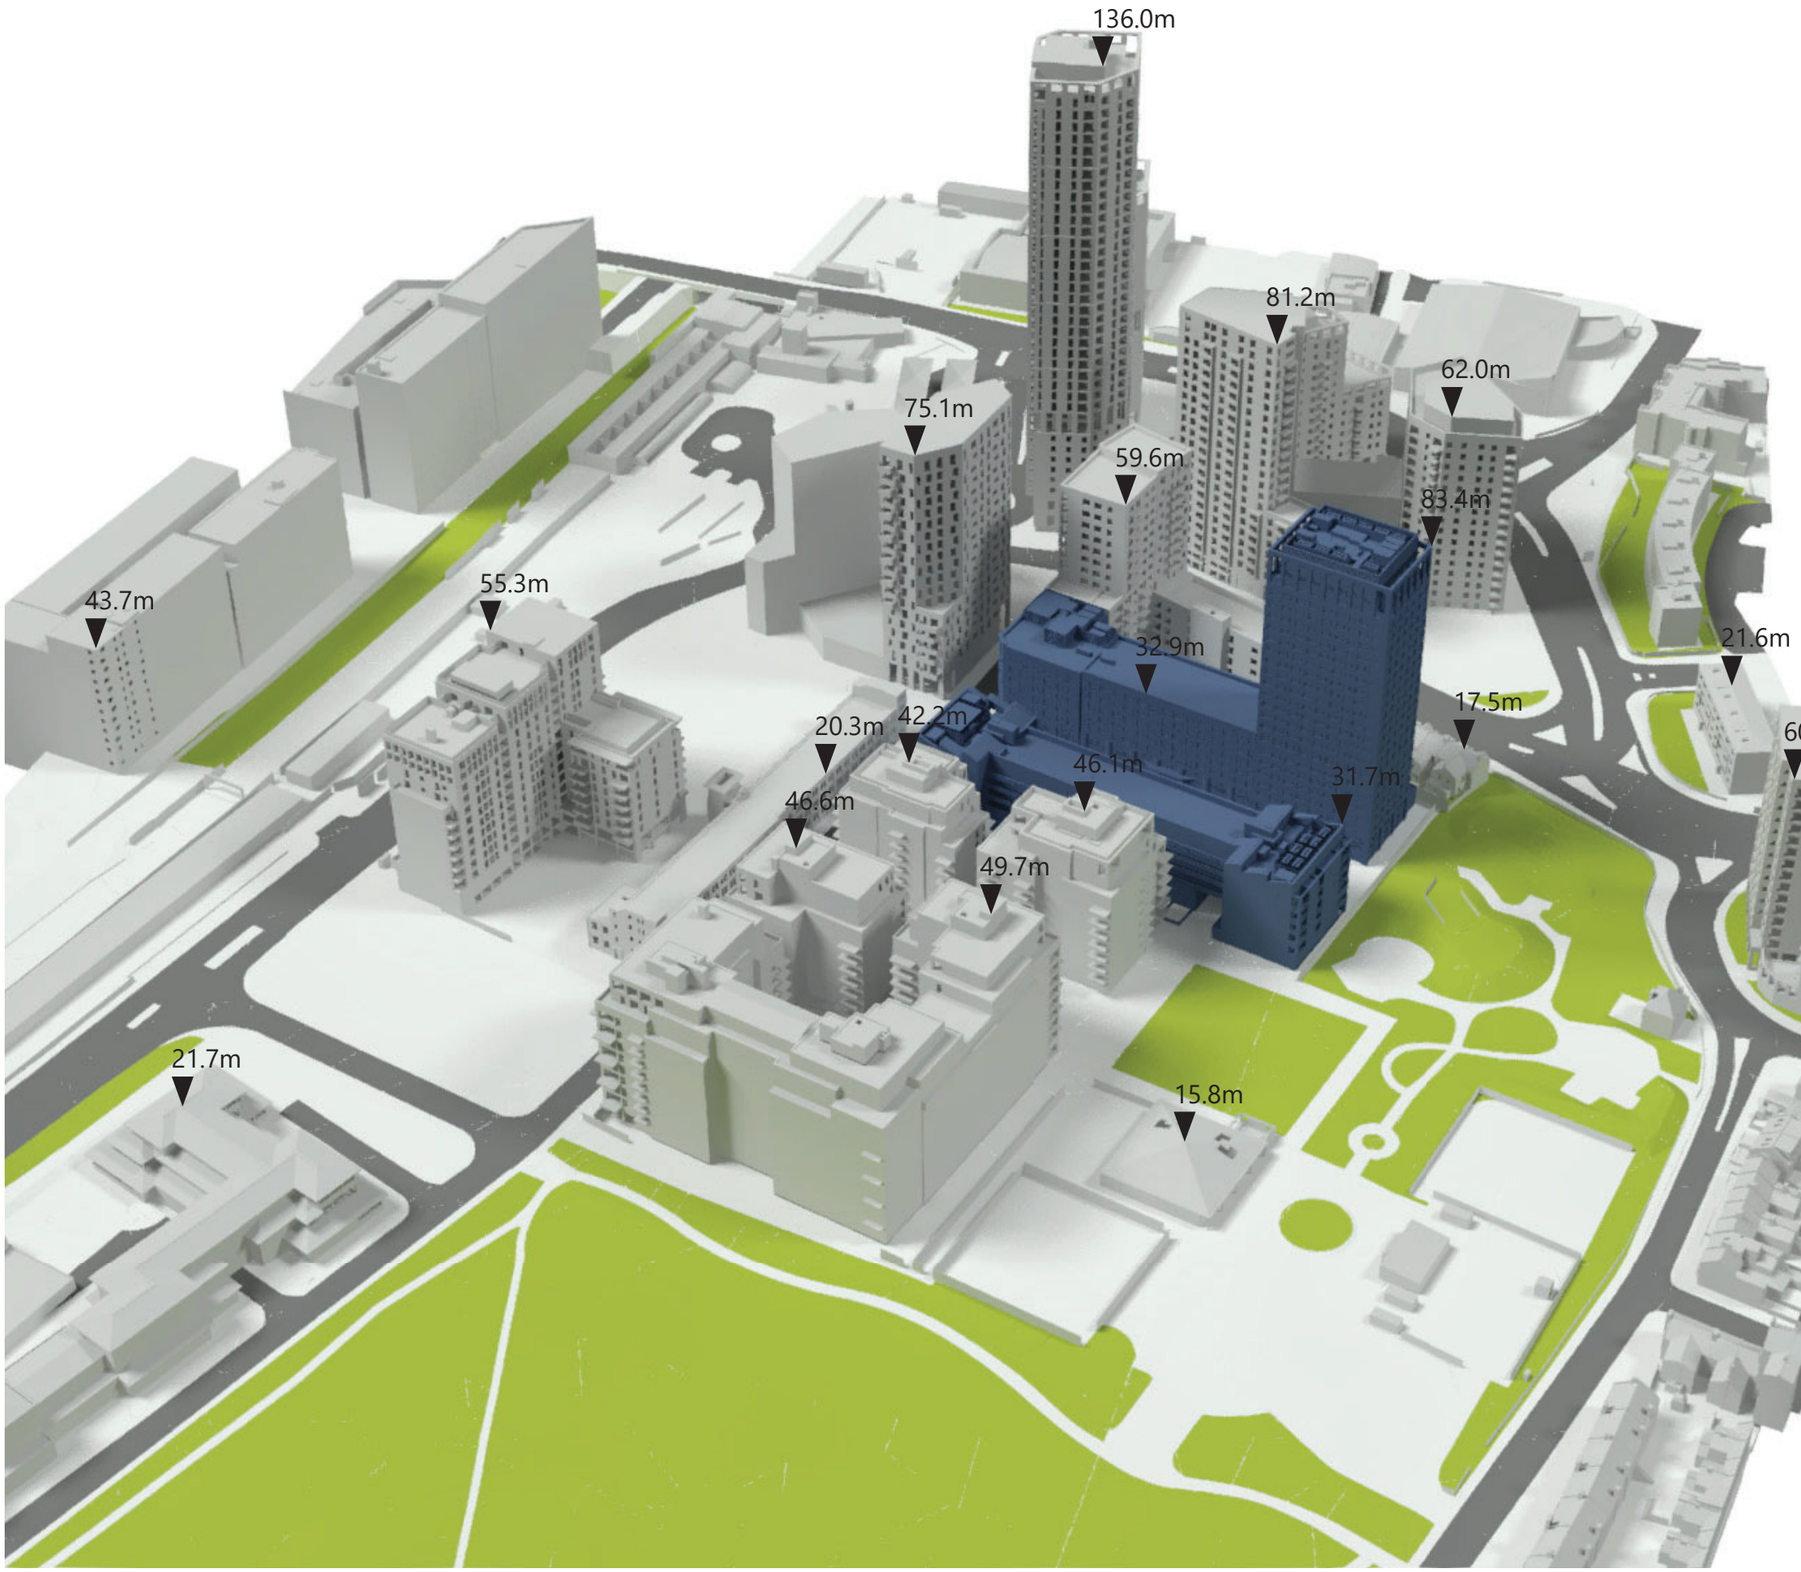

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026


EB7 Ltd
Site Photographs
Ordnance Survey

Key
- Existing Building
- Surrounding Context
- Proposed Development

Project: Ashley Road
Tottenham Hale

Title: Proposed Development
3D View

Drawn	Checked
TR	--
Date	Project
08/08/2026	10106
Rel no.	Prefix / Page no.
08	DS01 / 04

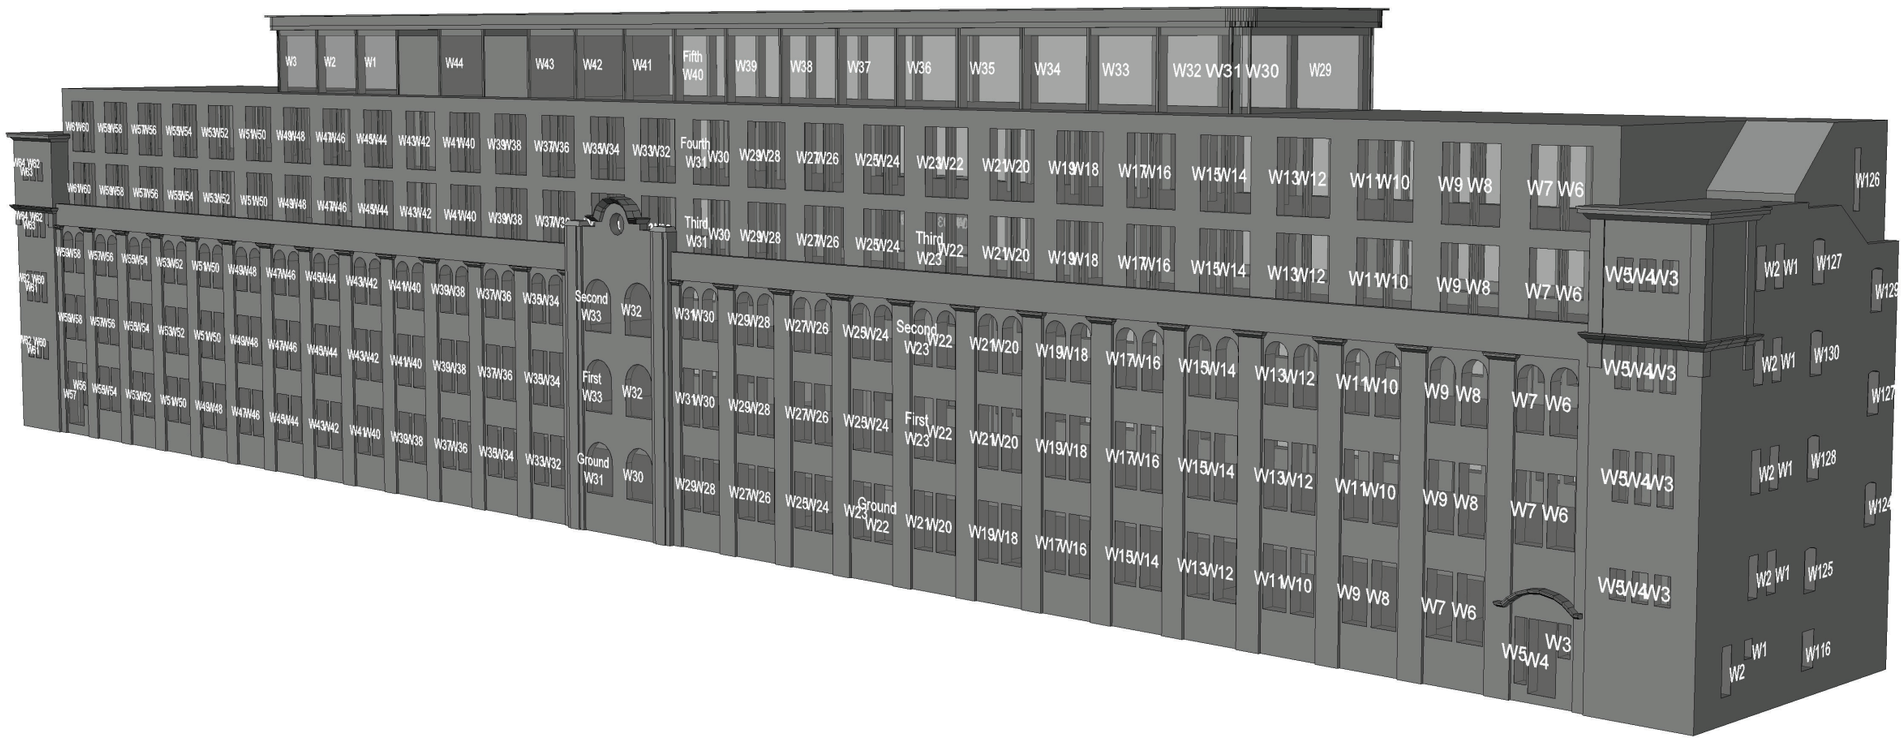


eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey

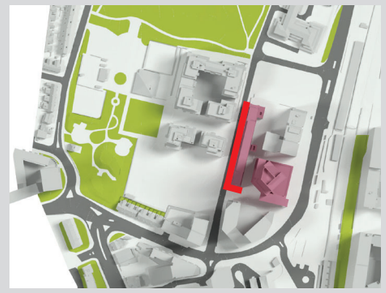

Project	Ashley Road Tottenham Hale		
Title	Berol House-25 Ashley Road Window Map		
Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	06

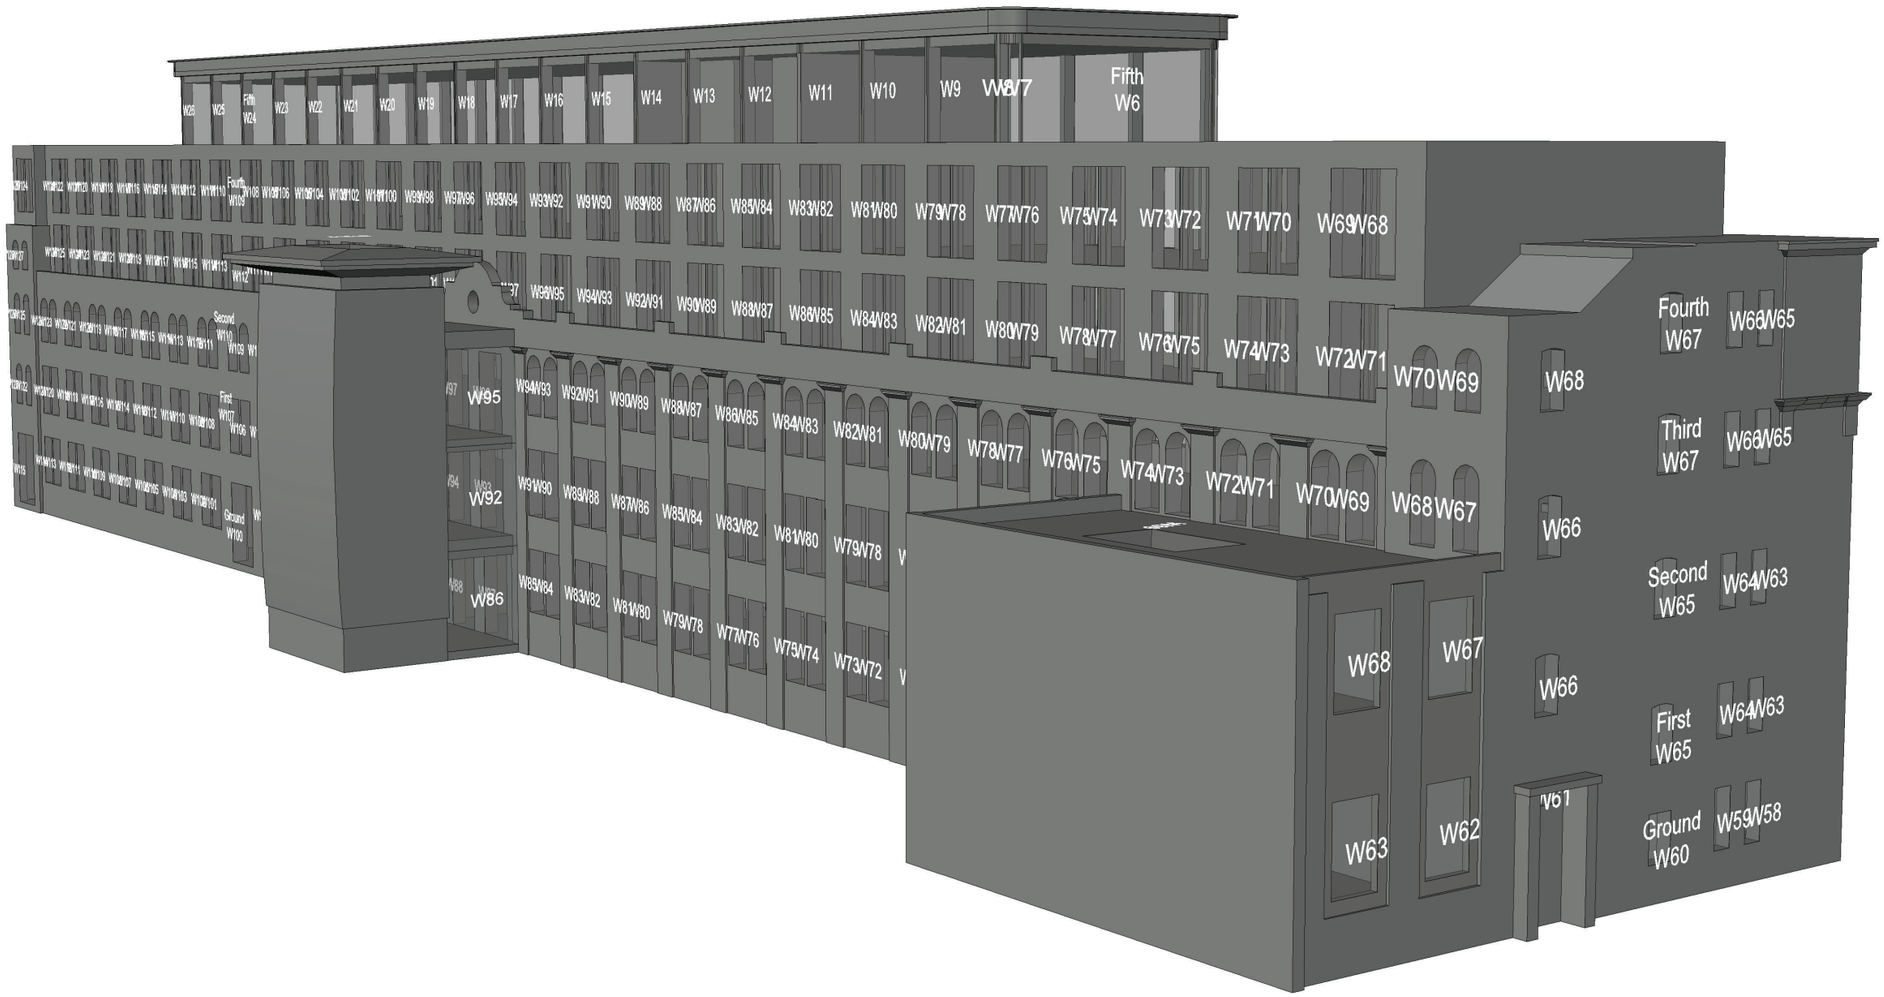

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: Berol House-25 Ashley Road Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	07

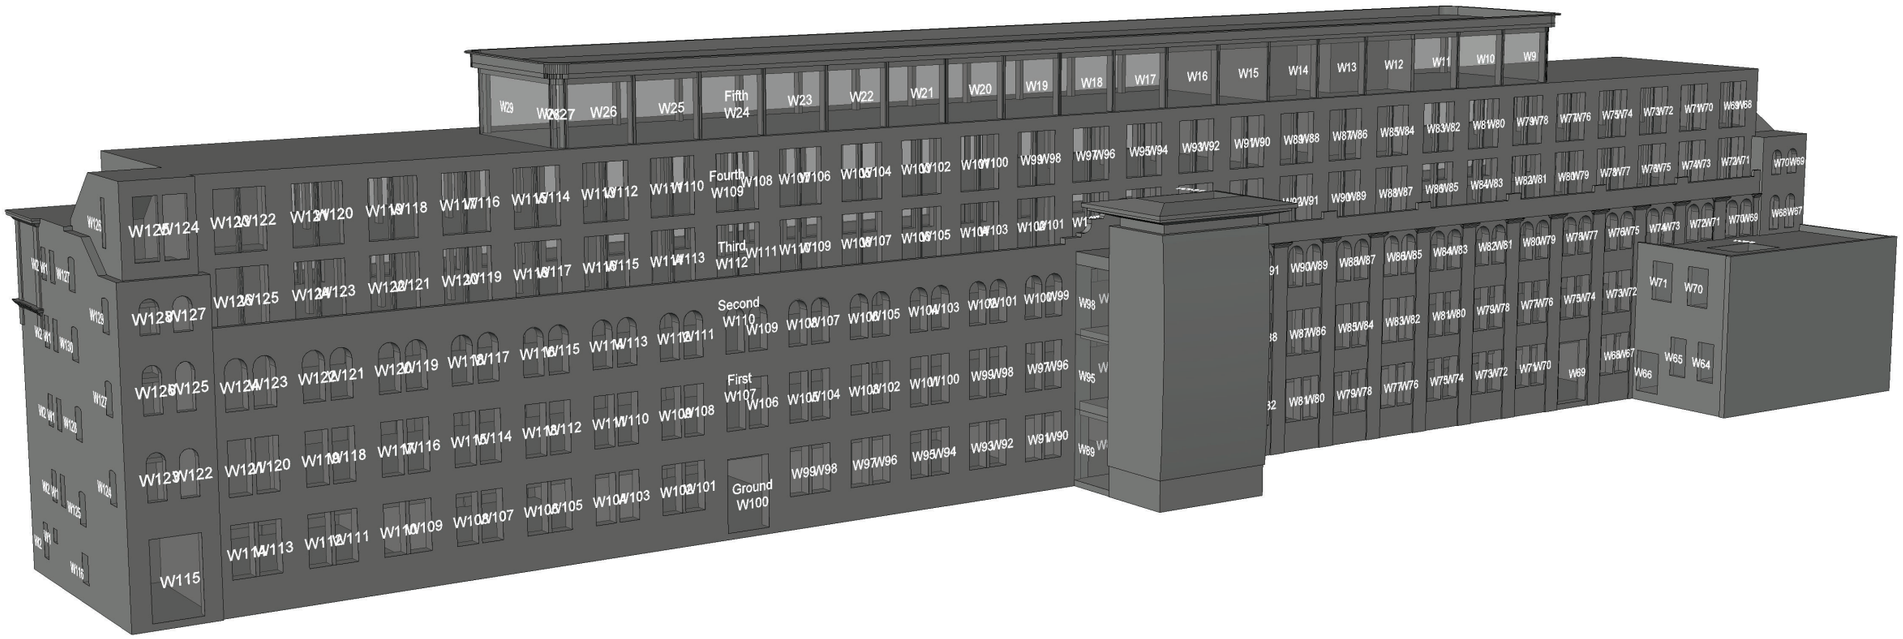


eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey

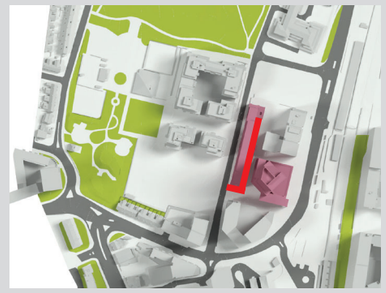

Project	Ashley Road Tottenham Hale
Title	Berol House-25 Ashley Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	08

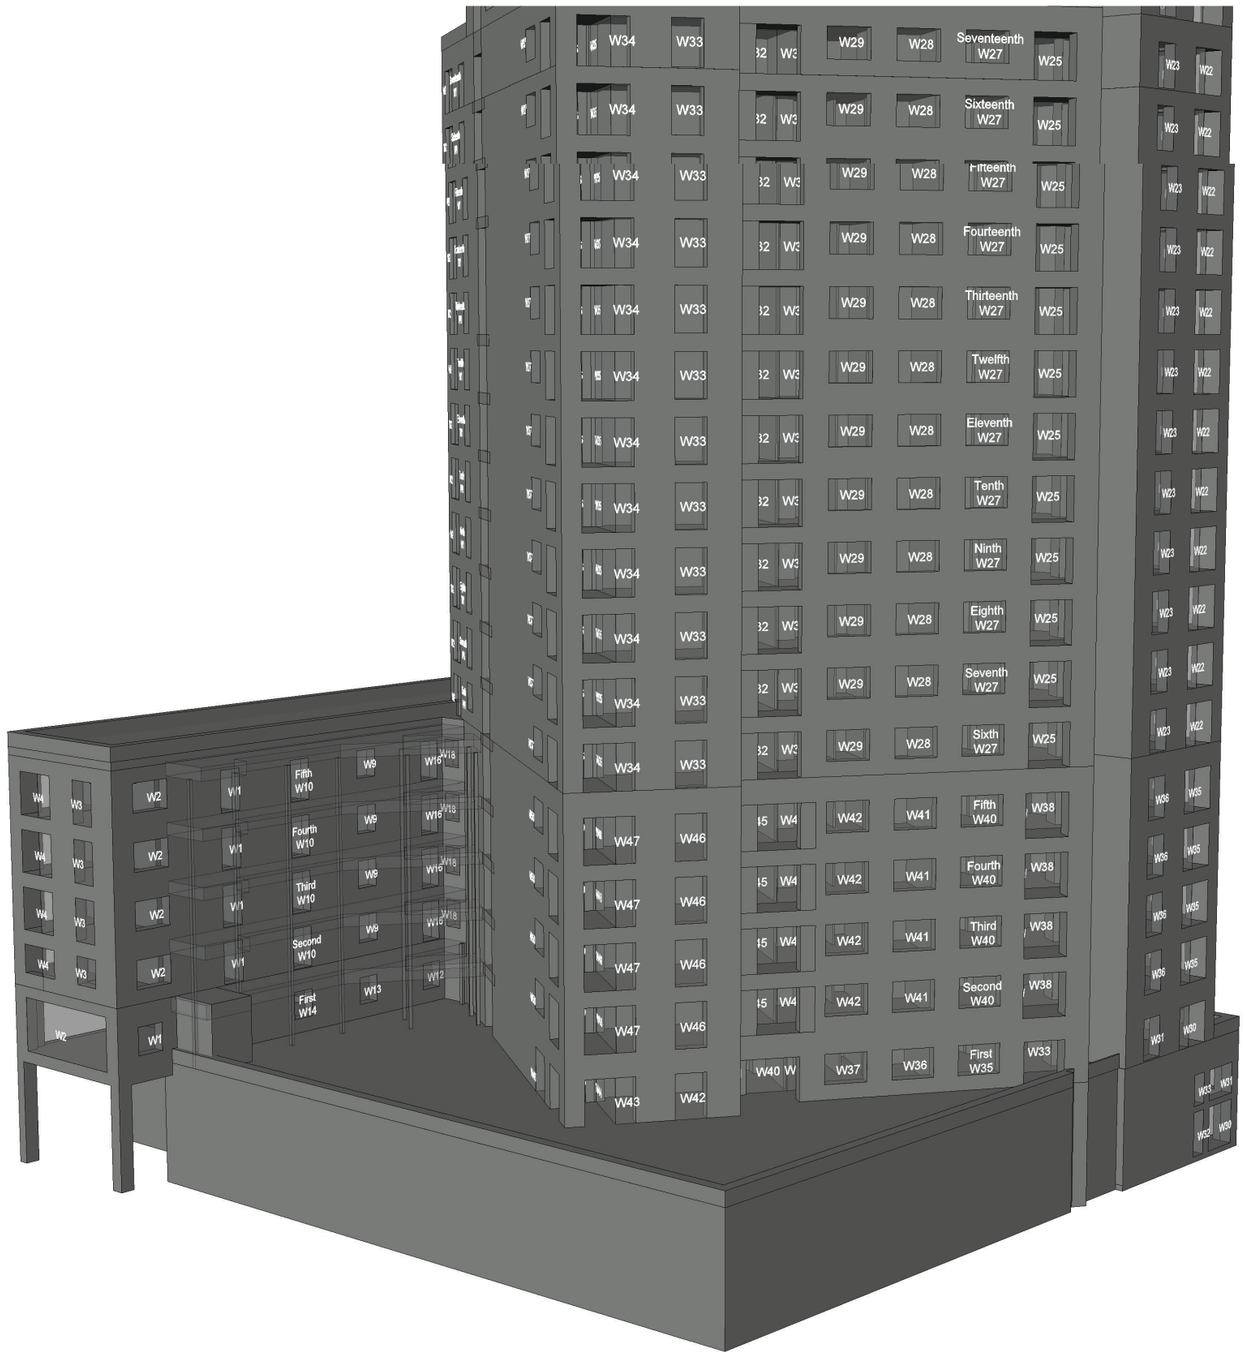

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	Berol Quarter Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	09



2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information


Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale		
Title	Berol Quarter Window Map		
Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	10

eb7 © copyright 2026

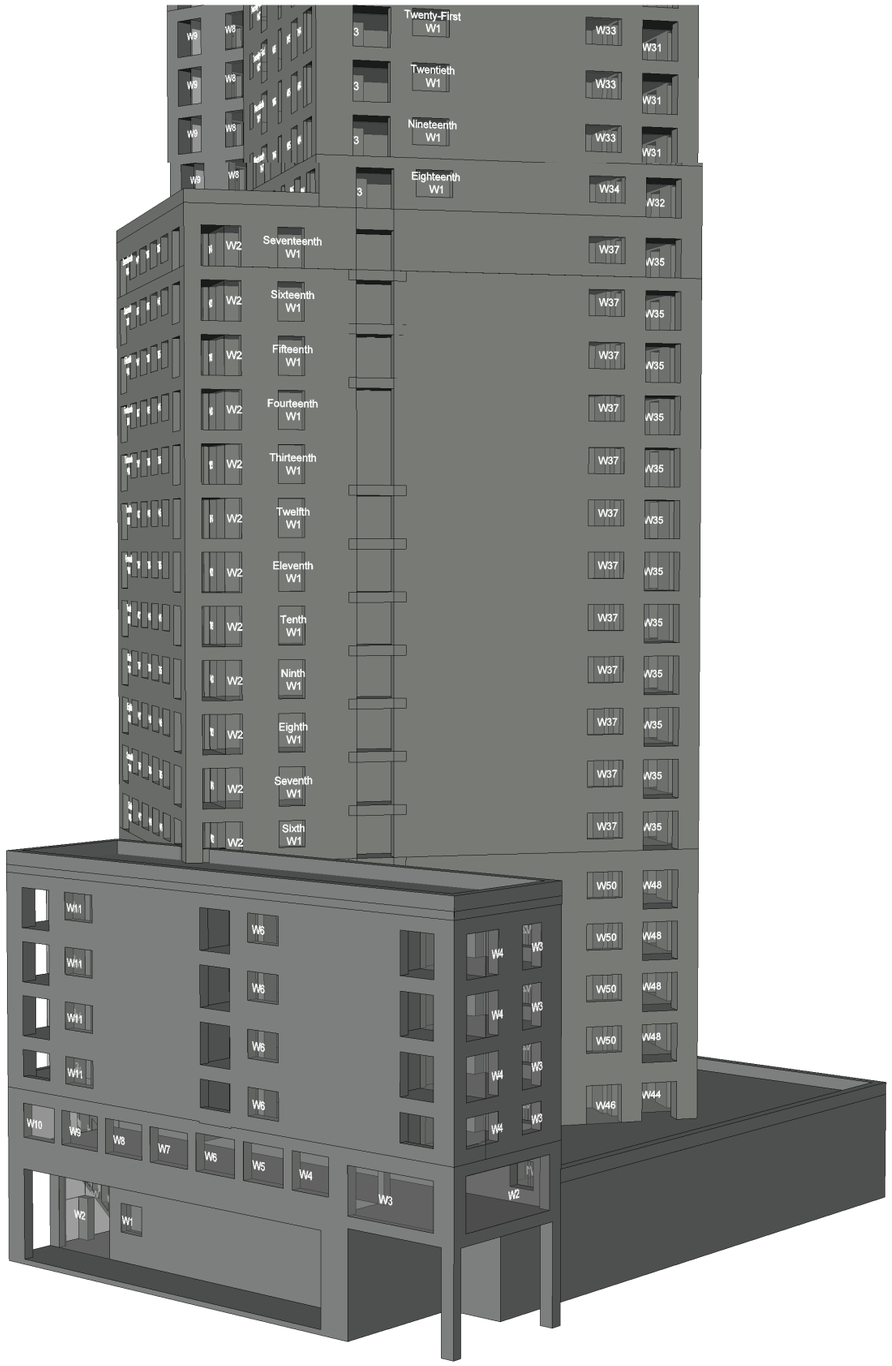

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	Berol Quarter Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	11



eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: Berol Quarter Window Map

Drawn	Checked
TR	--

Date	Project
20/07/2026	10106

Rel no.	Prefix	Page no.
	WM01	12



eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	Berol Quarter Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	13

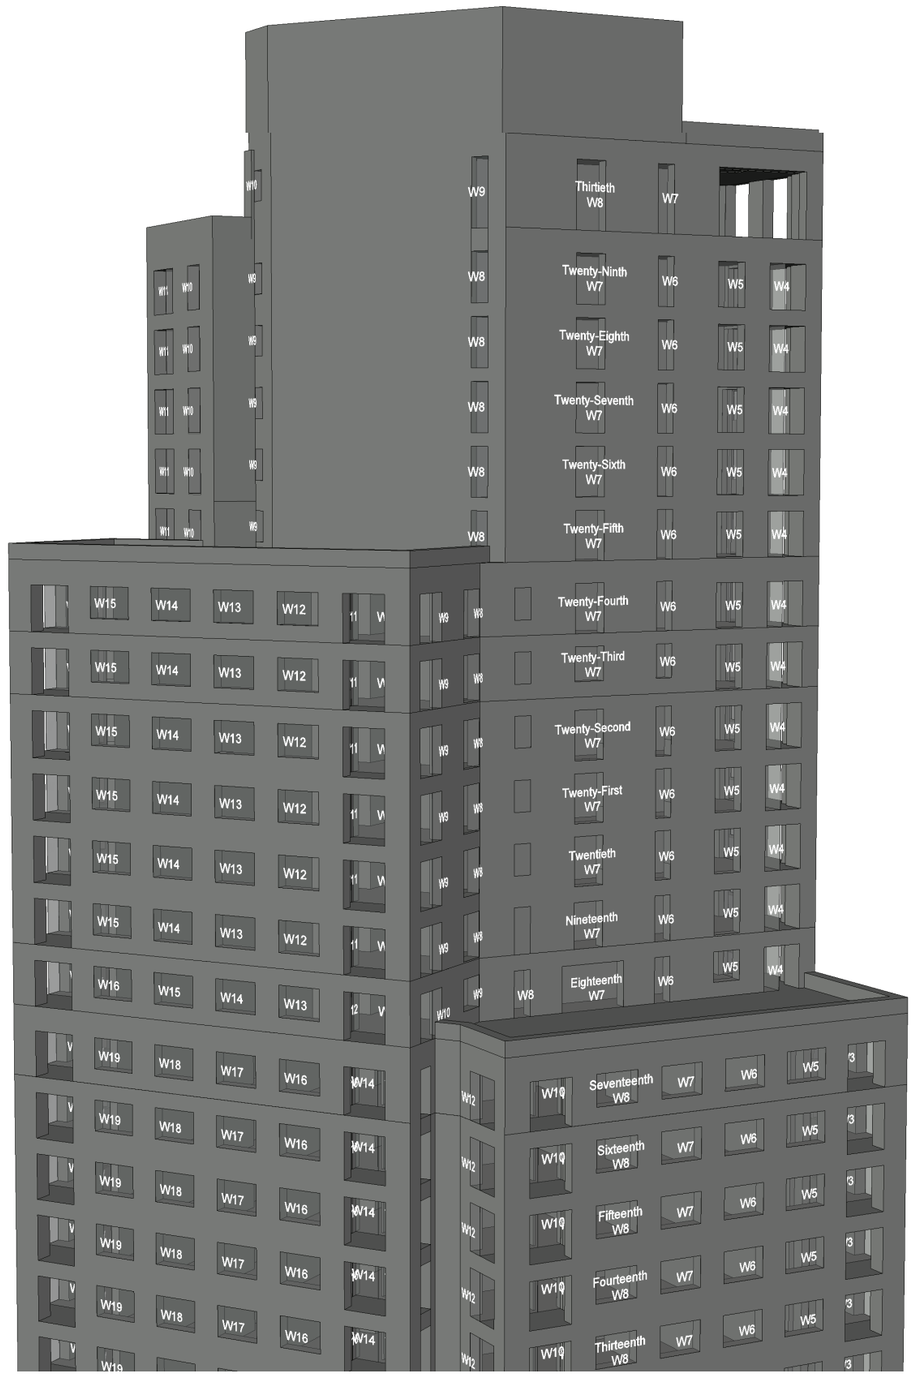

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: Berol Quarter Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	14



eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: Berol Quarter Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	15

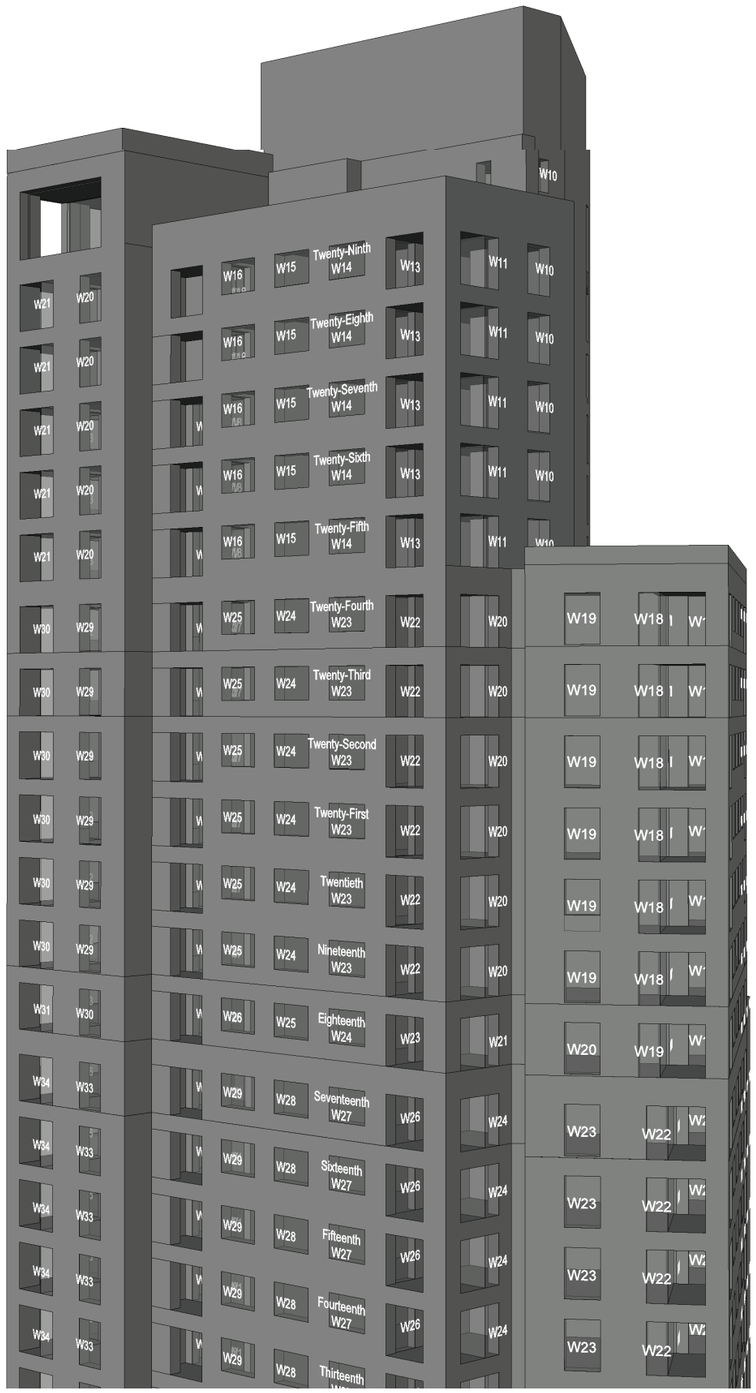

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: Berol Quarter Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	16

eb7 © copyright 2026

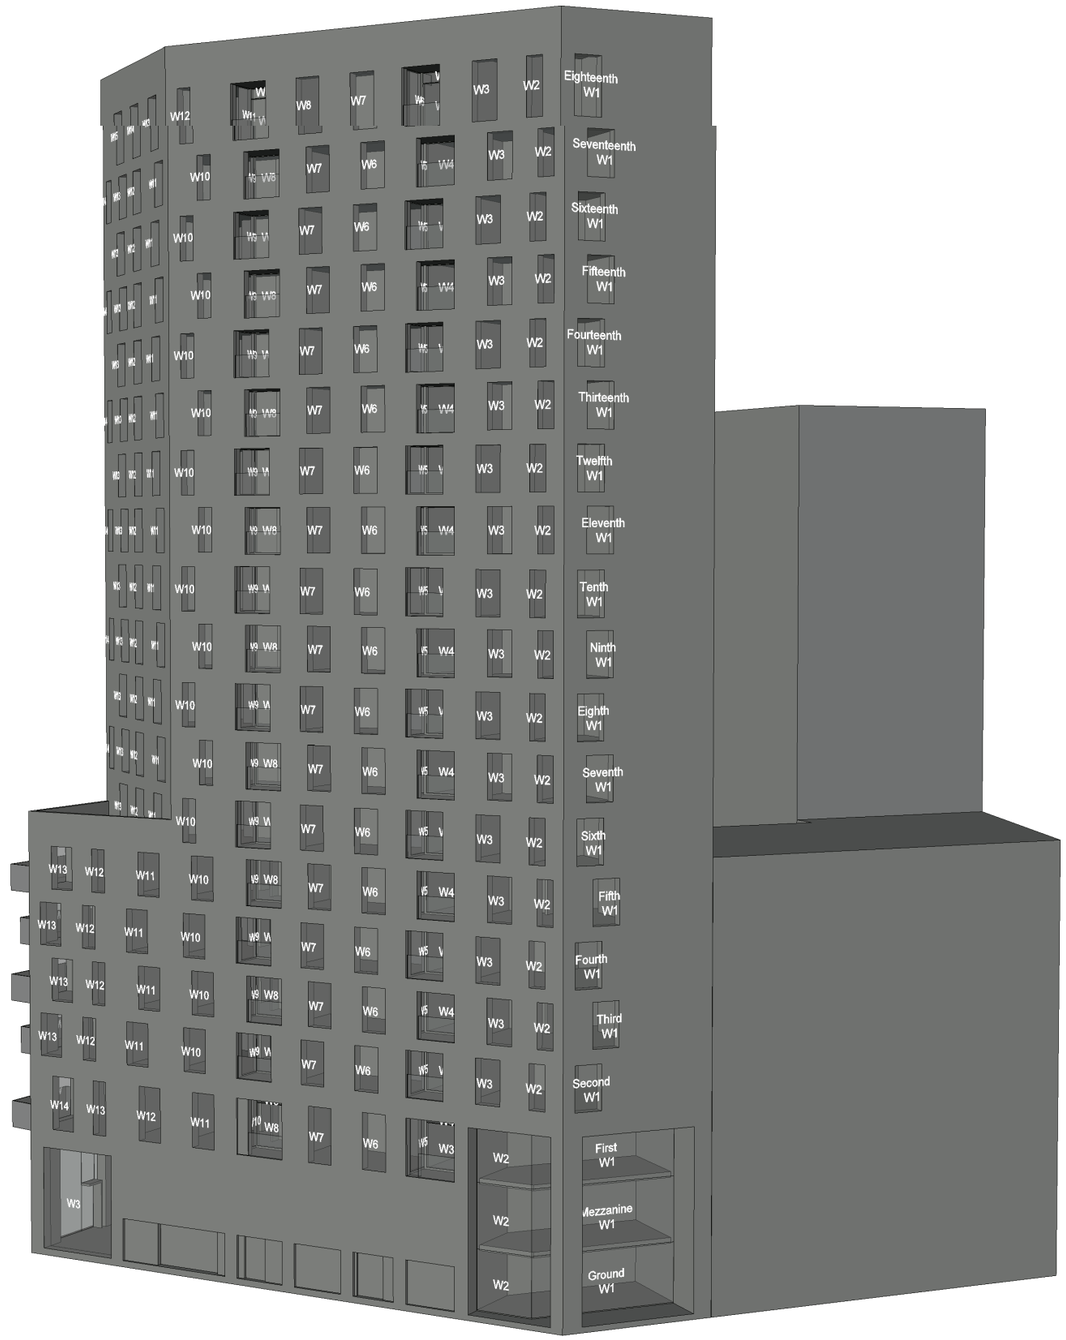

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	East Apartments Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	17

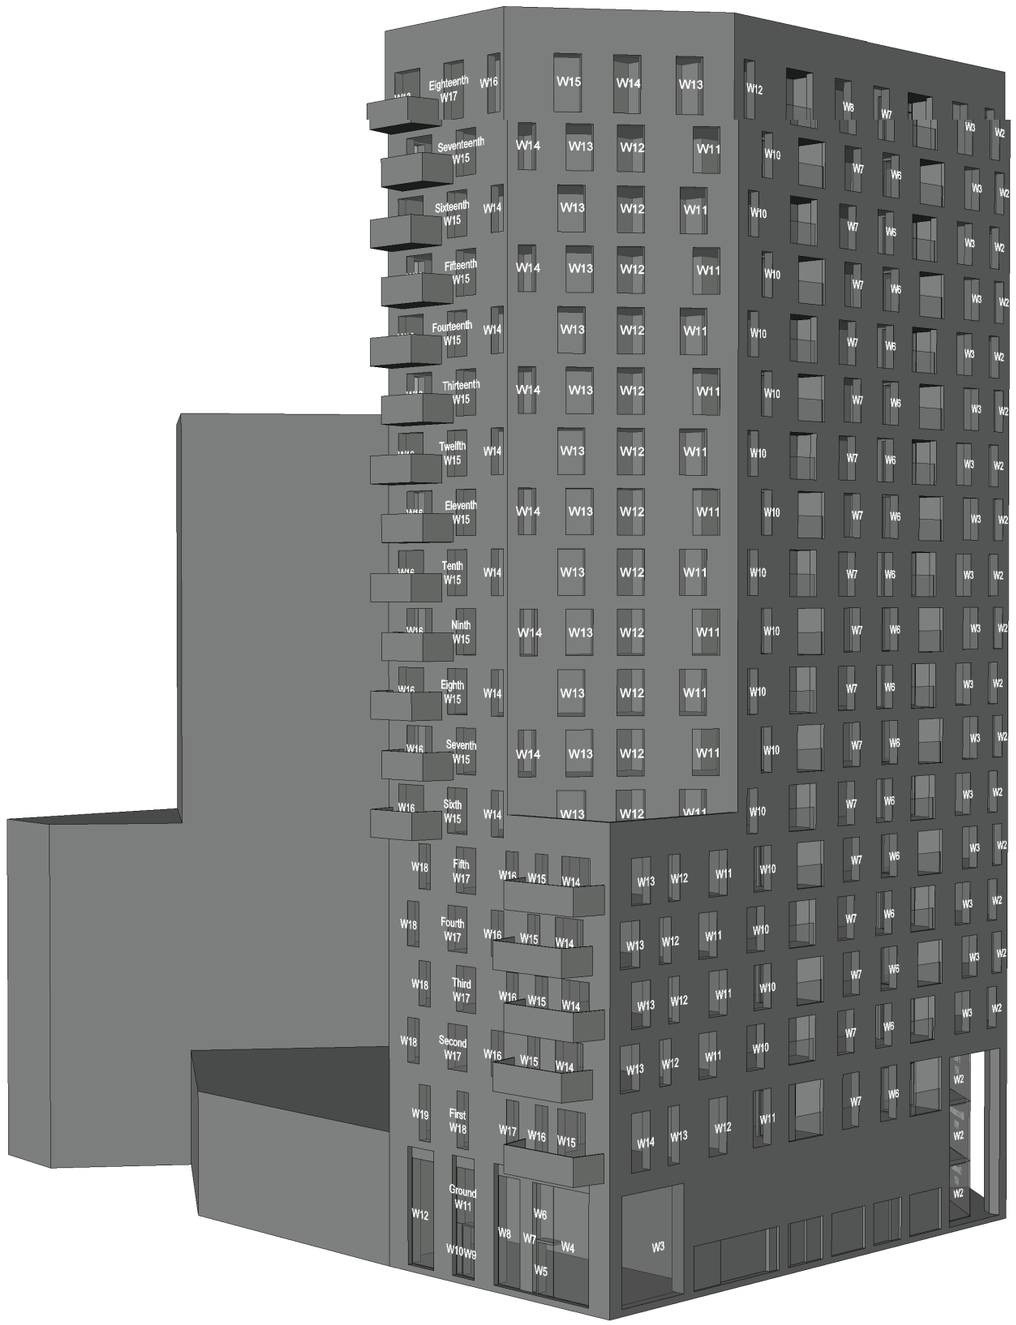

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: East Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	18

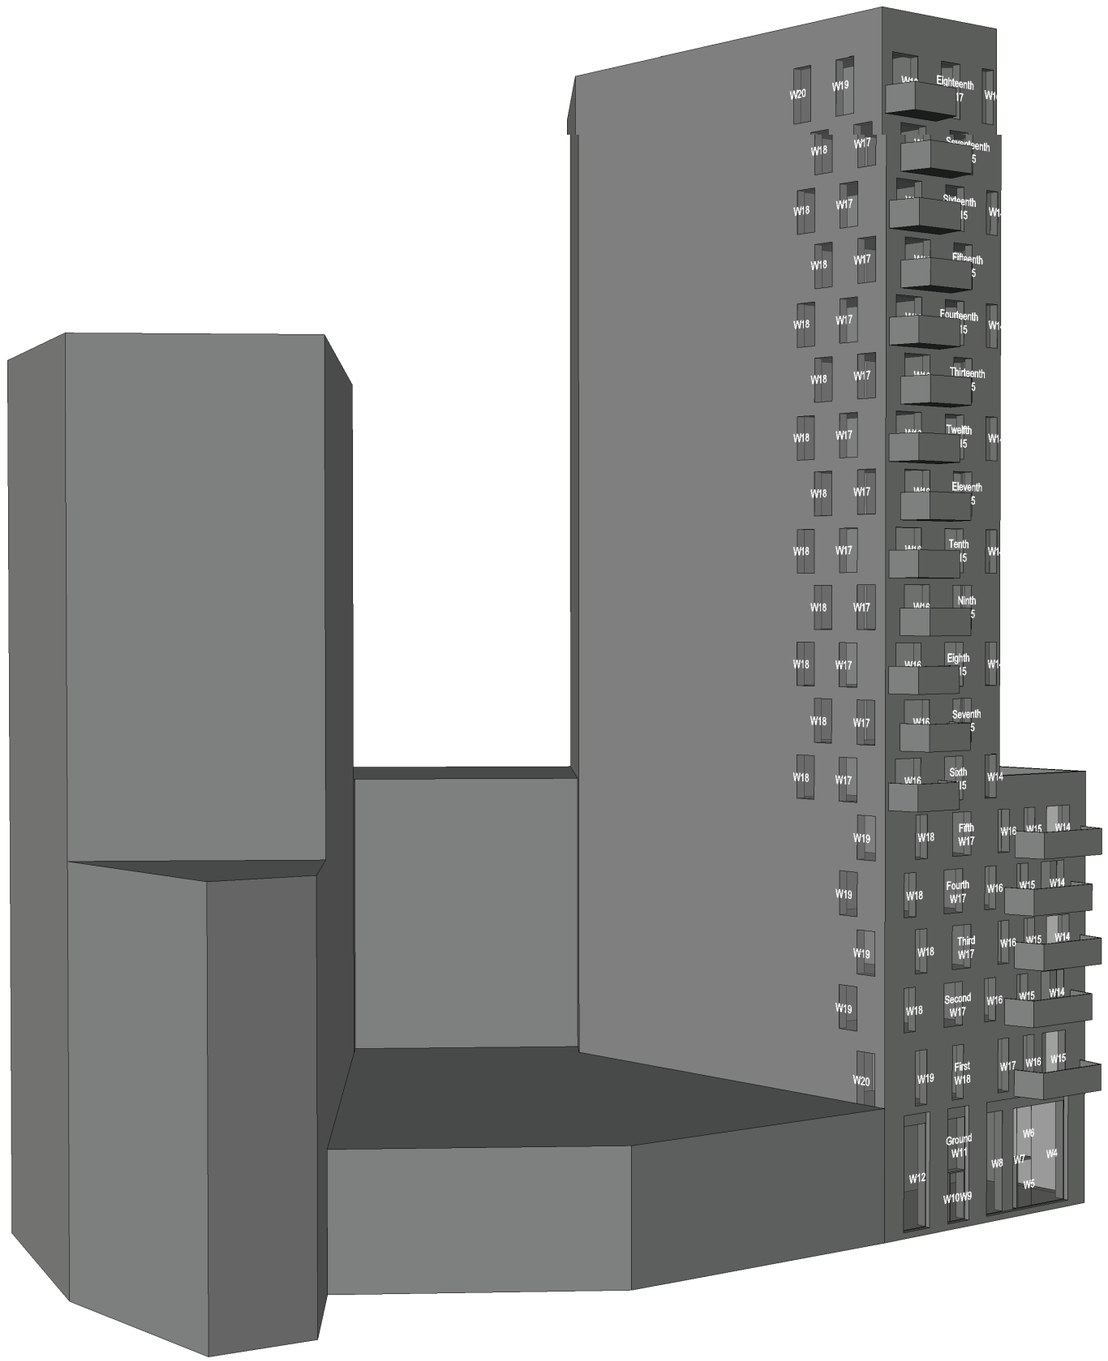

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: East Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	19

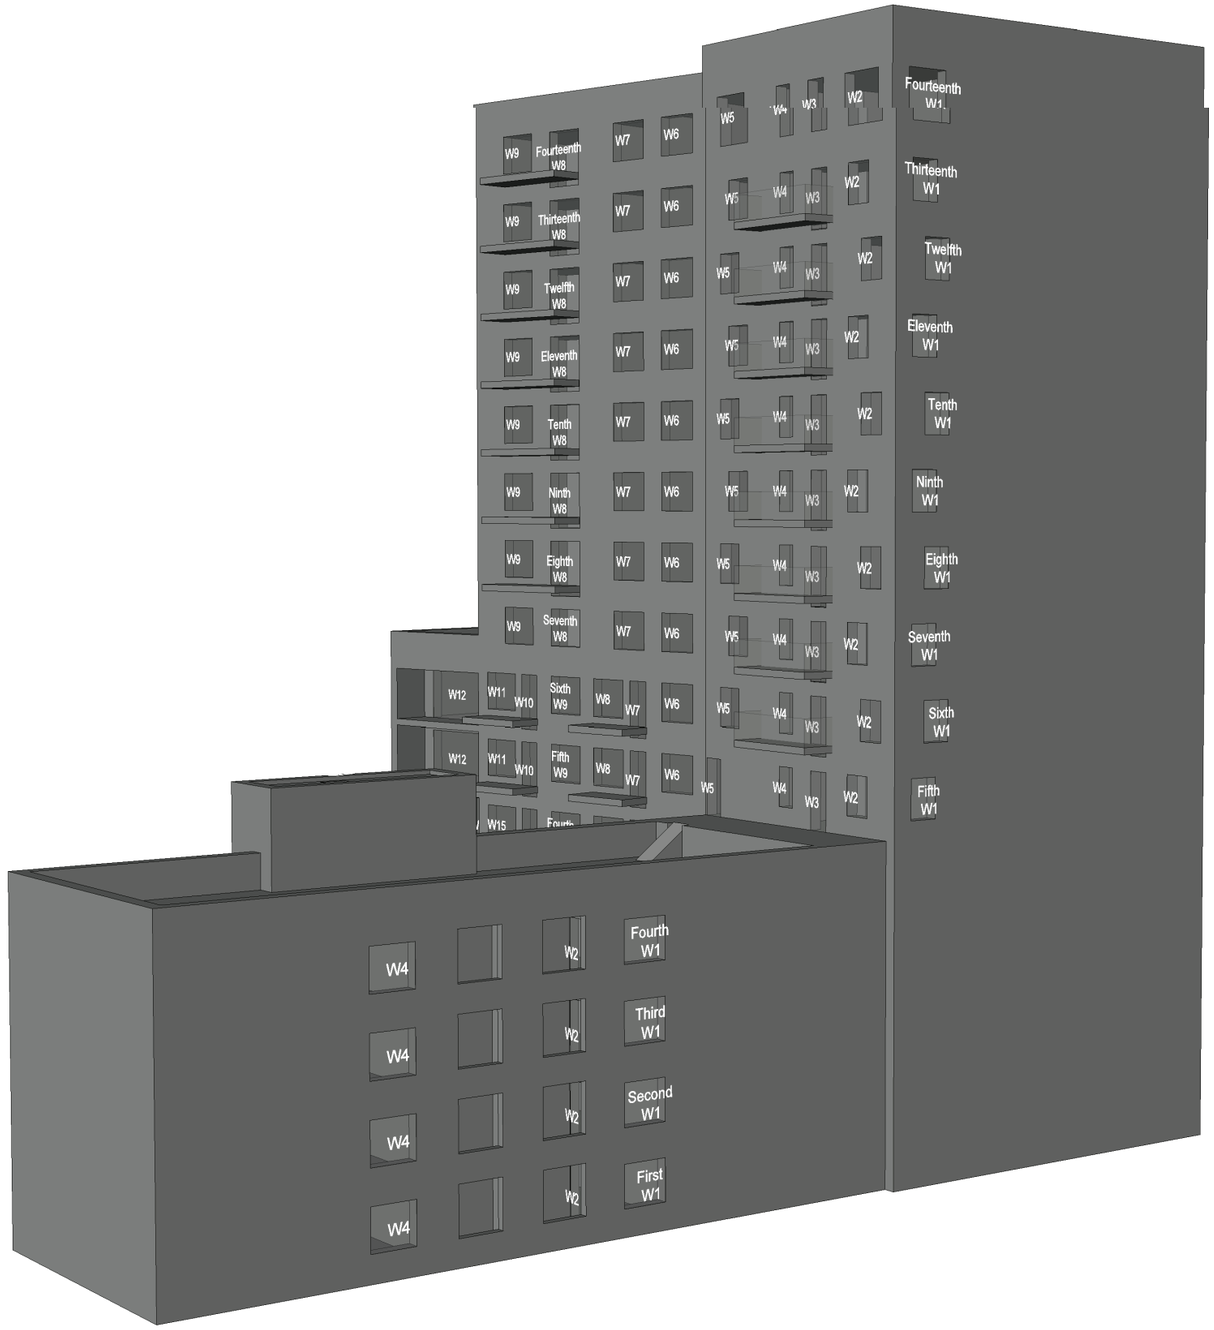

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: West Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	20

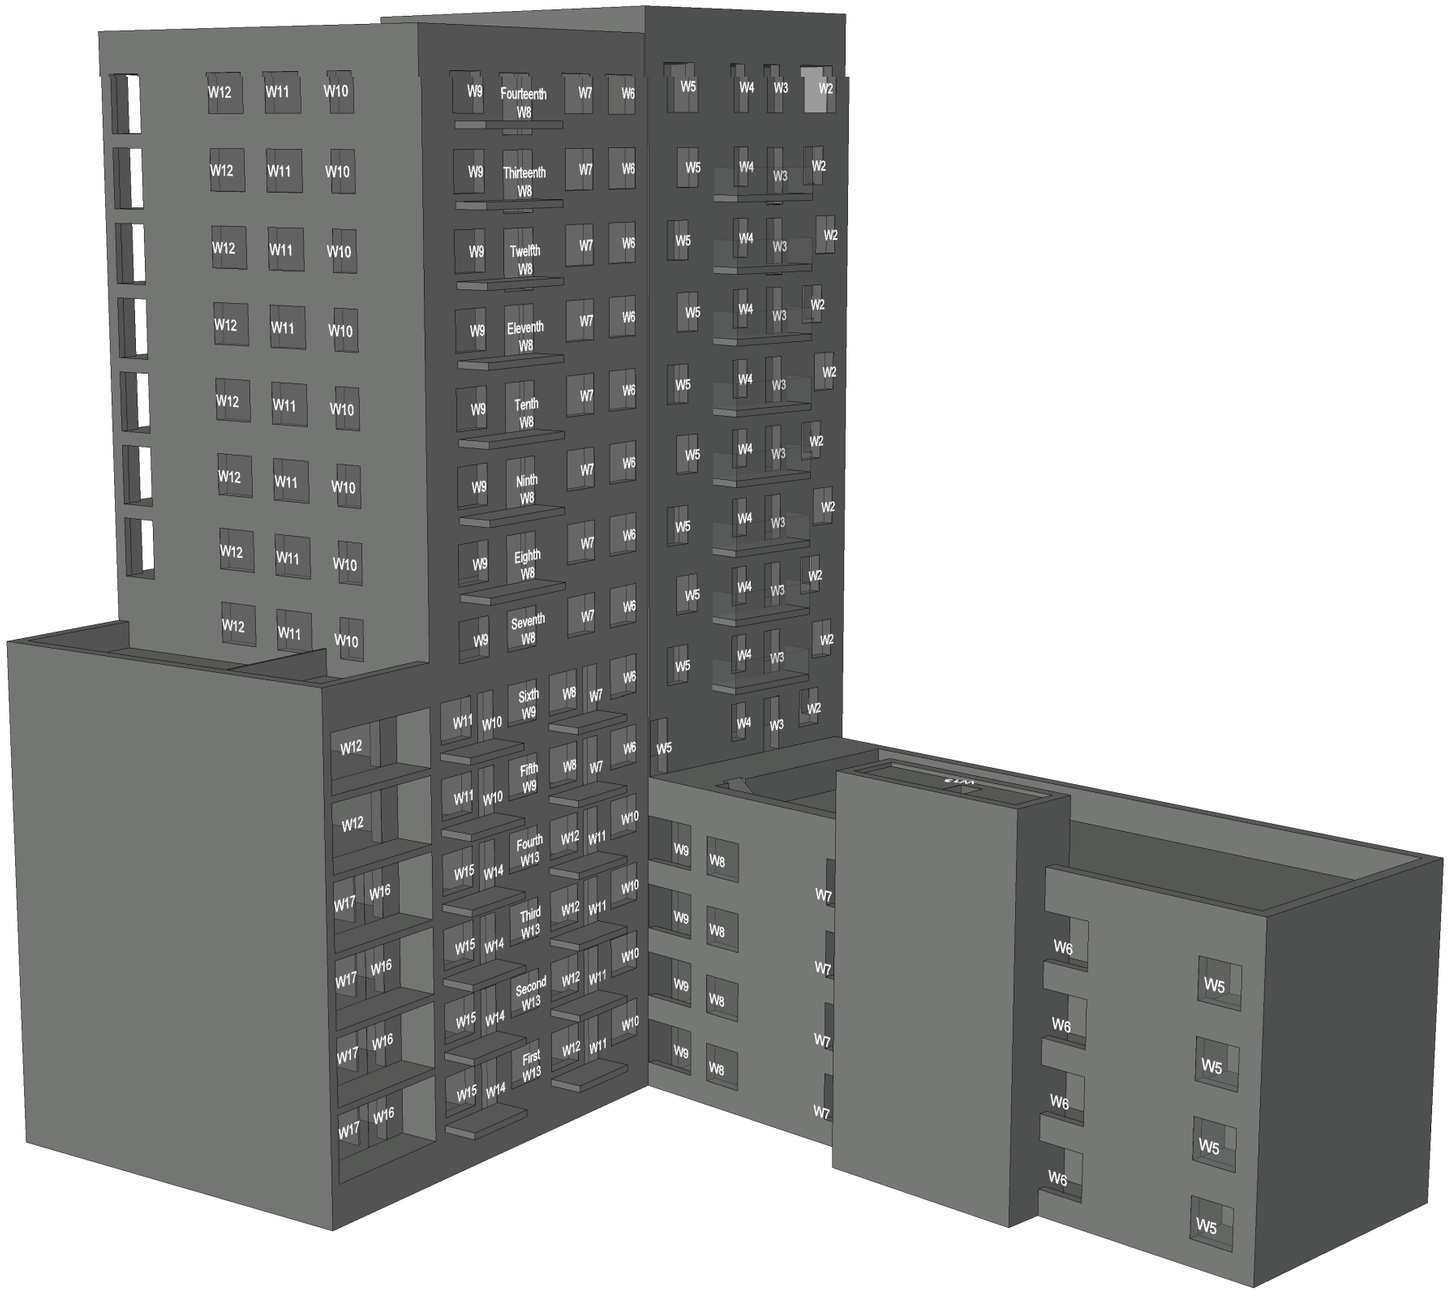

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: West Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix: WM01	Page no.	21

eb7 © copyright 2026

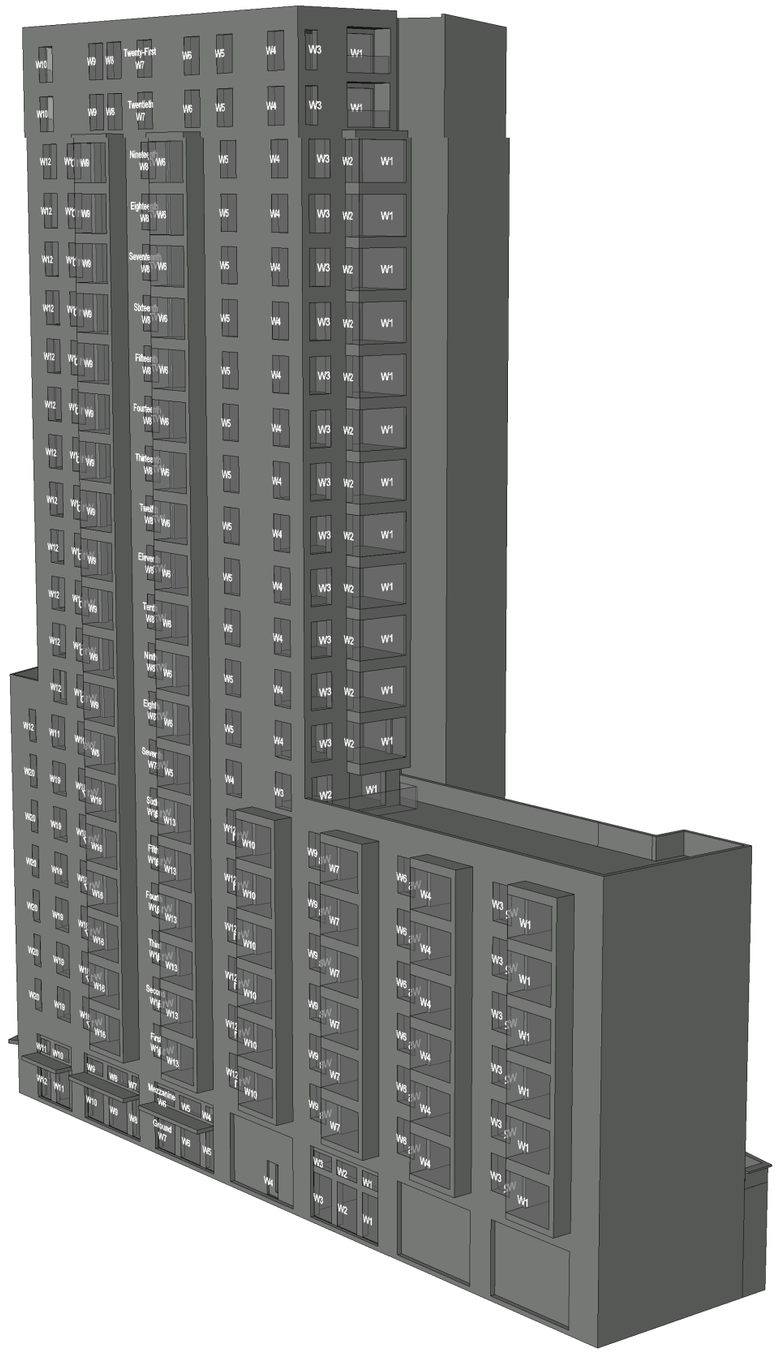


2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey

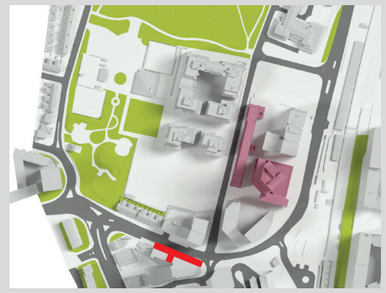


Project: Ashley Road Tottenham Hale

Title: Millstream Tower
Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	22

eb7 © copyright 2026

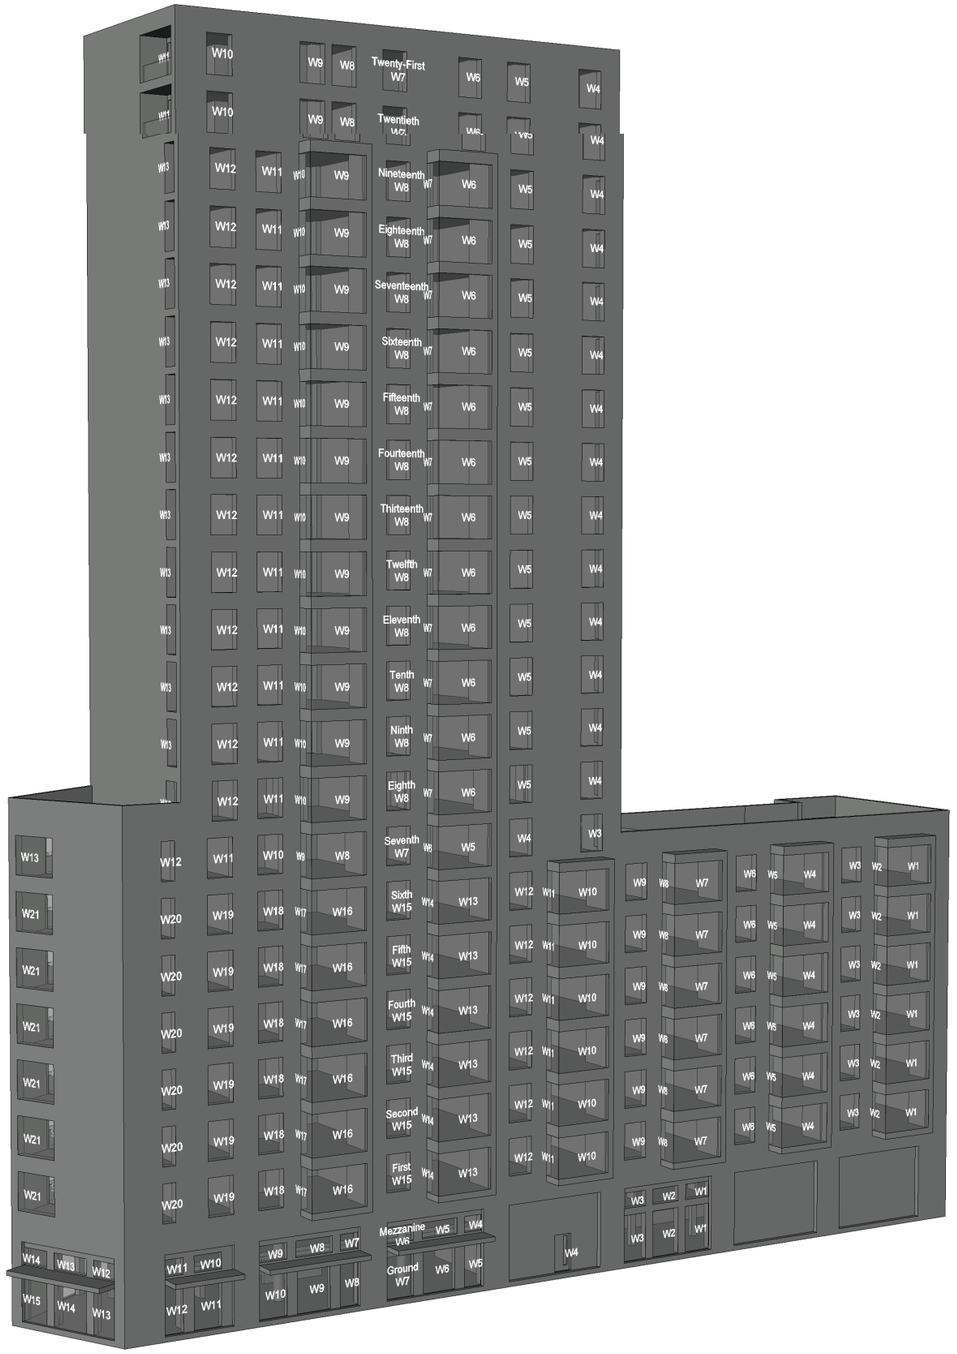

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: Millstream Tower Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106


Rel no.	Prefix	Page no.
	WM01	23

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey

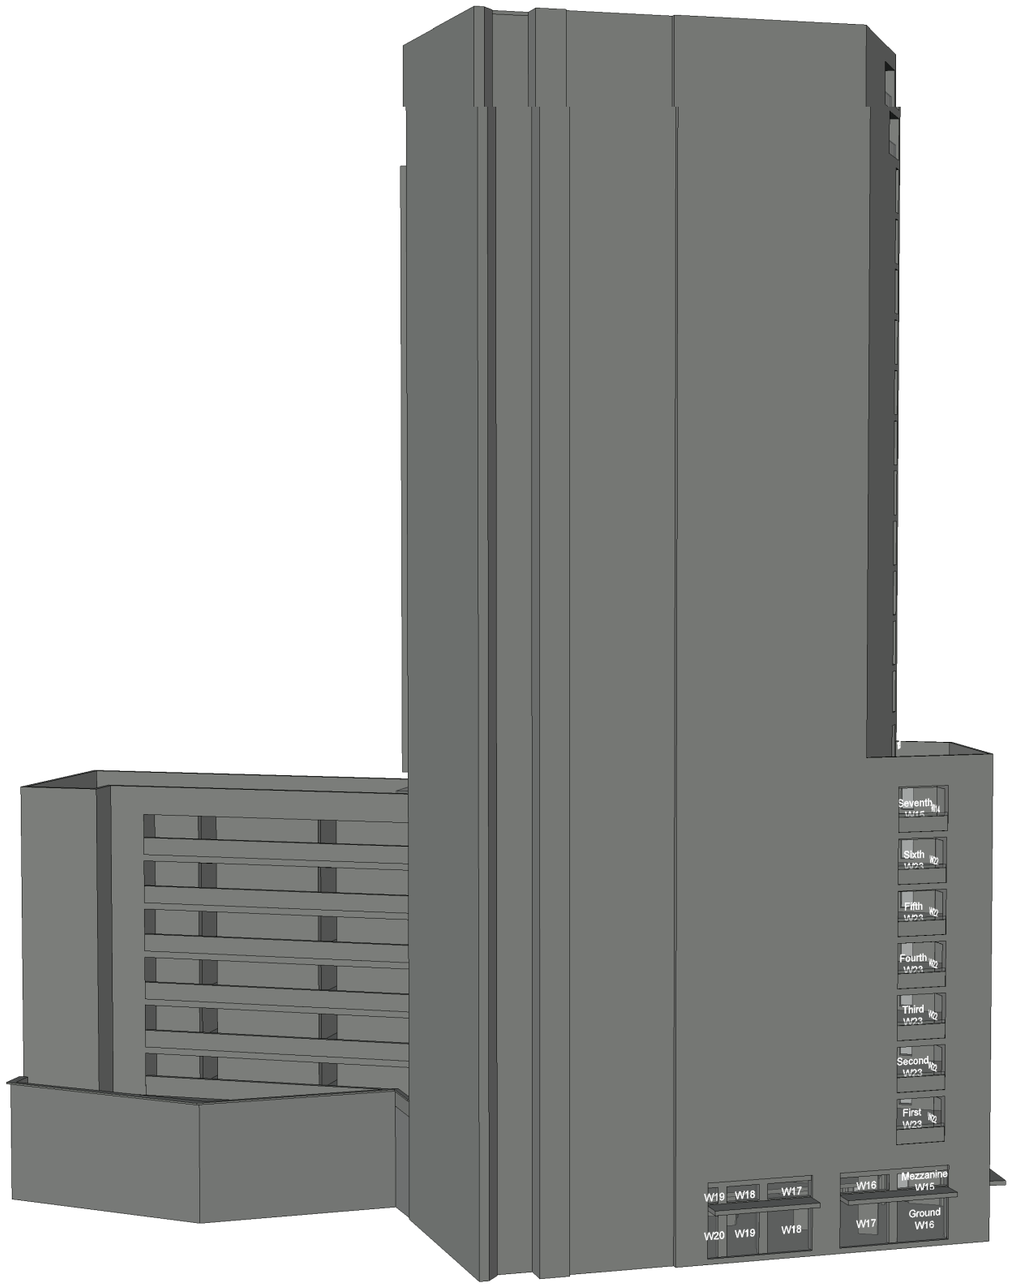



Project: Ashley Road Tottenham Hale


Title: Millstream Tower
Window Map

Drawn	Checked
TR	--

Date	Project
20/07/2026	10106

Rel no.	Prefix	Page no.
	WM01	24

eb7 © copyright 2026

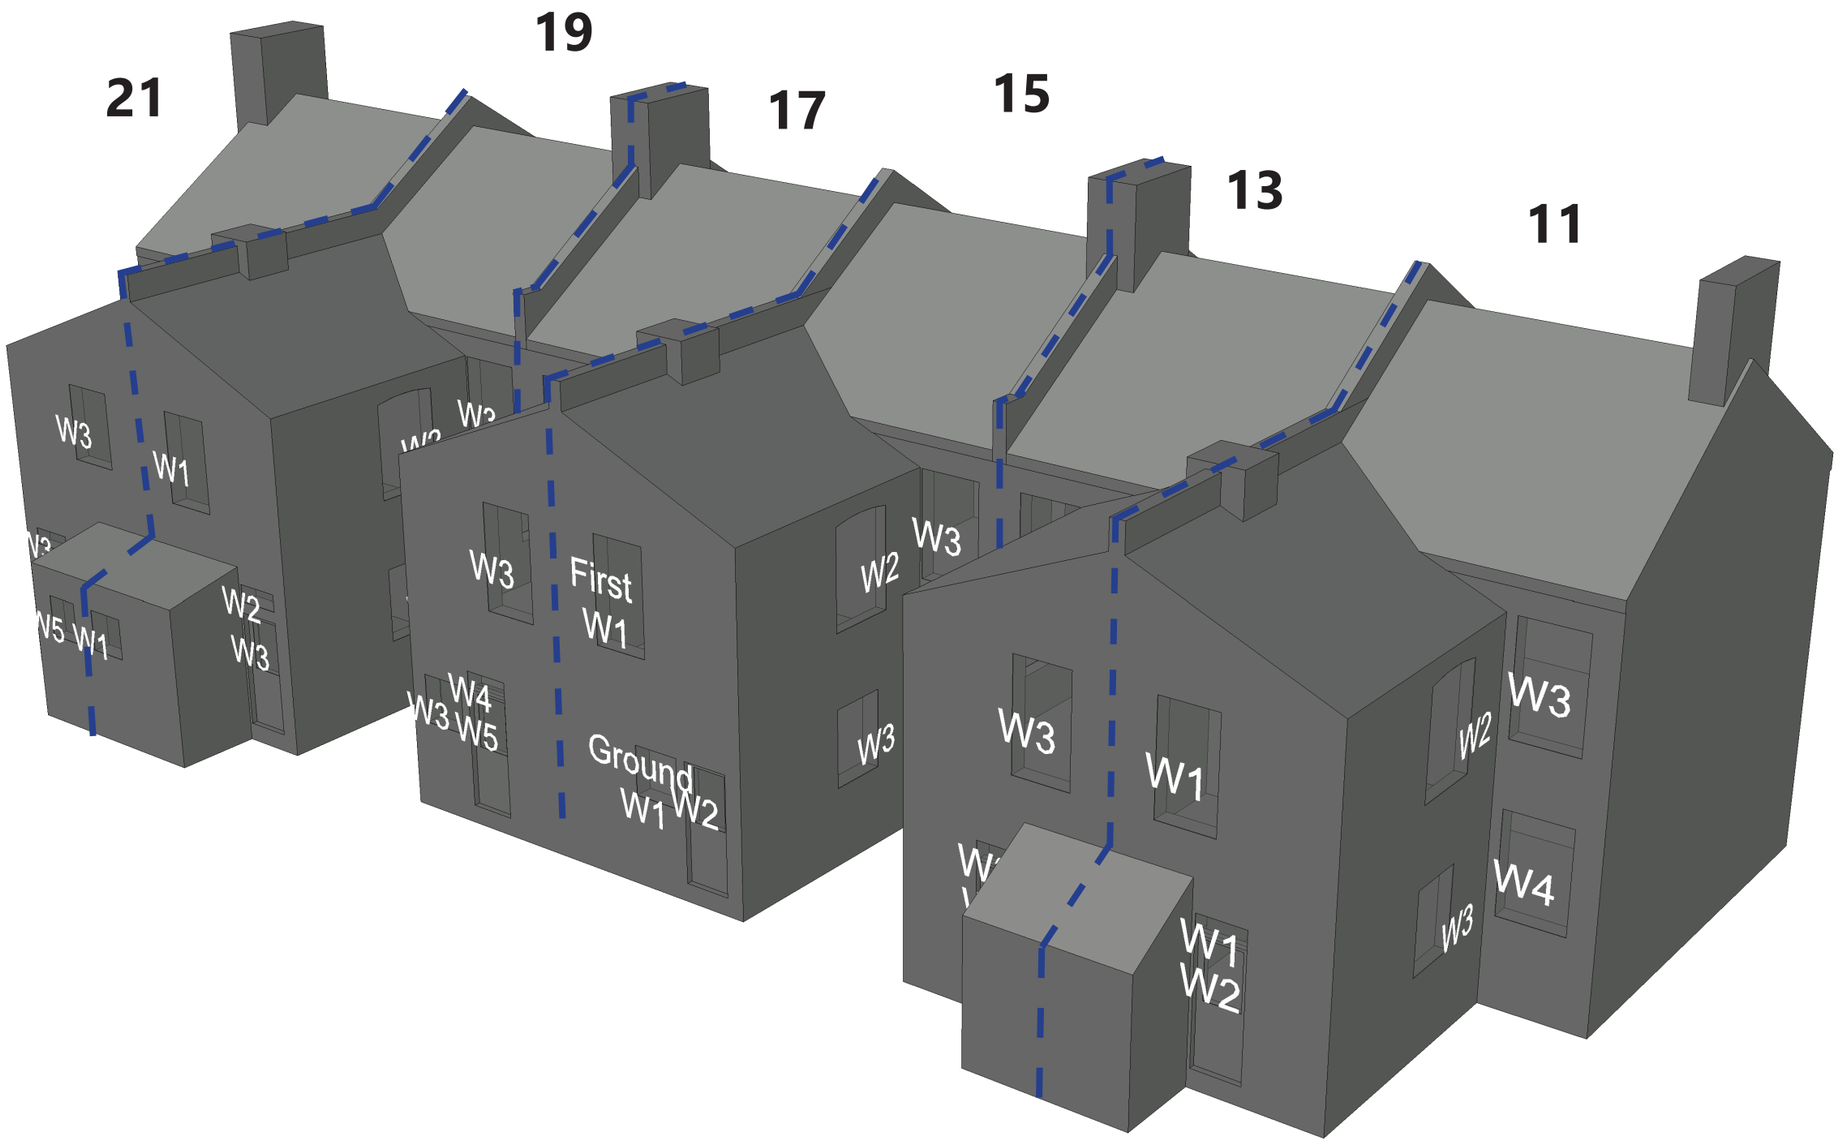

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information


Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	11-21 Hale Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	25

eb7 © copyright 2026

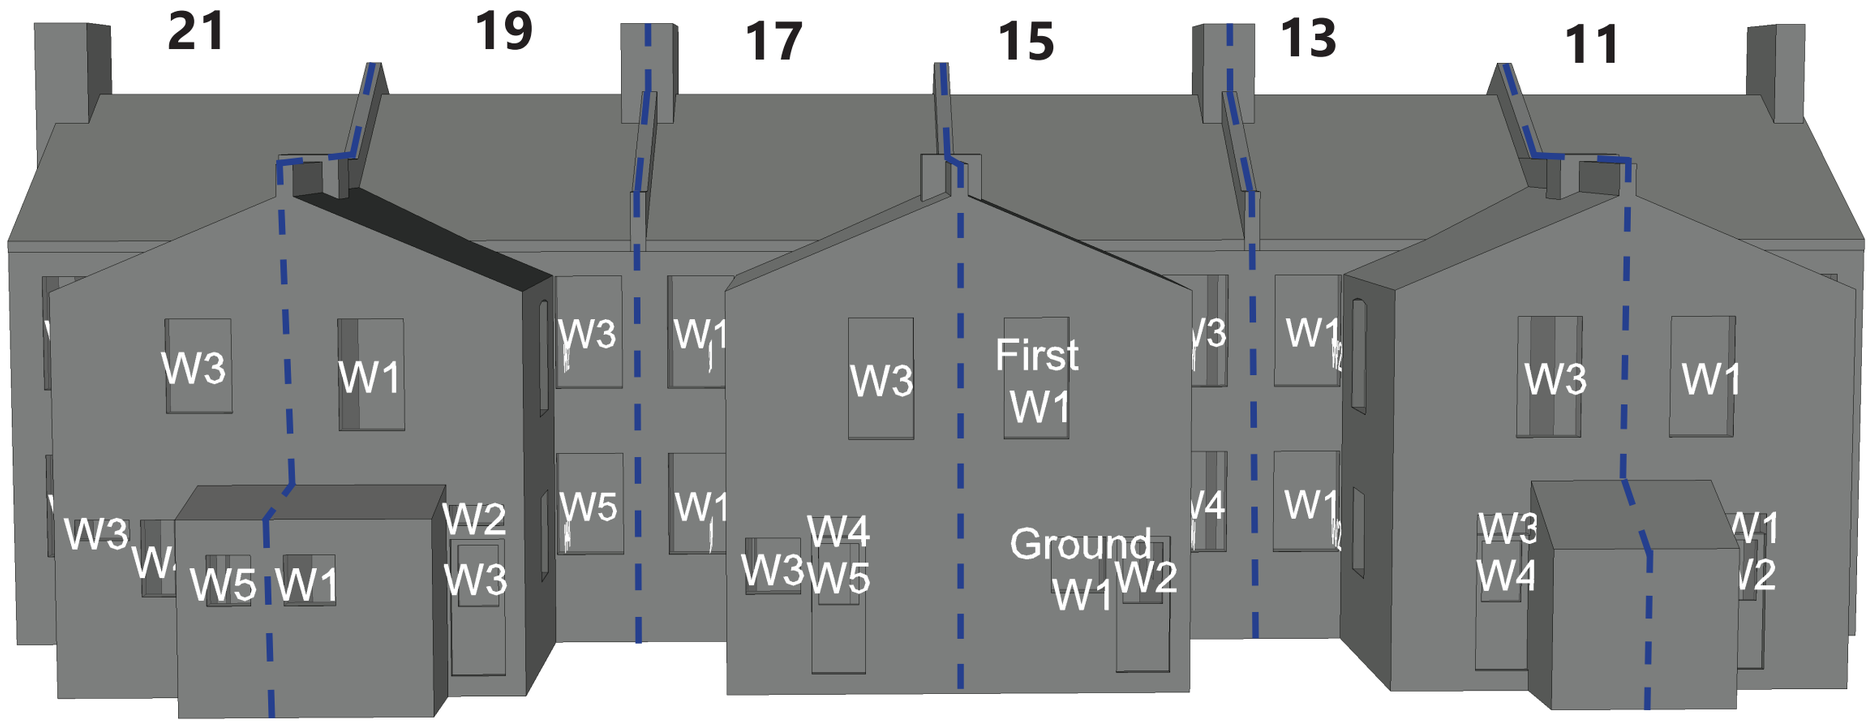

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	11-21 Hale Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	26

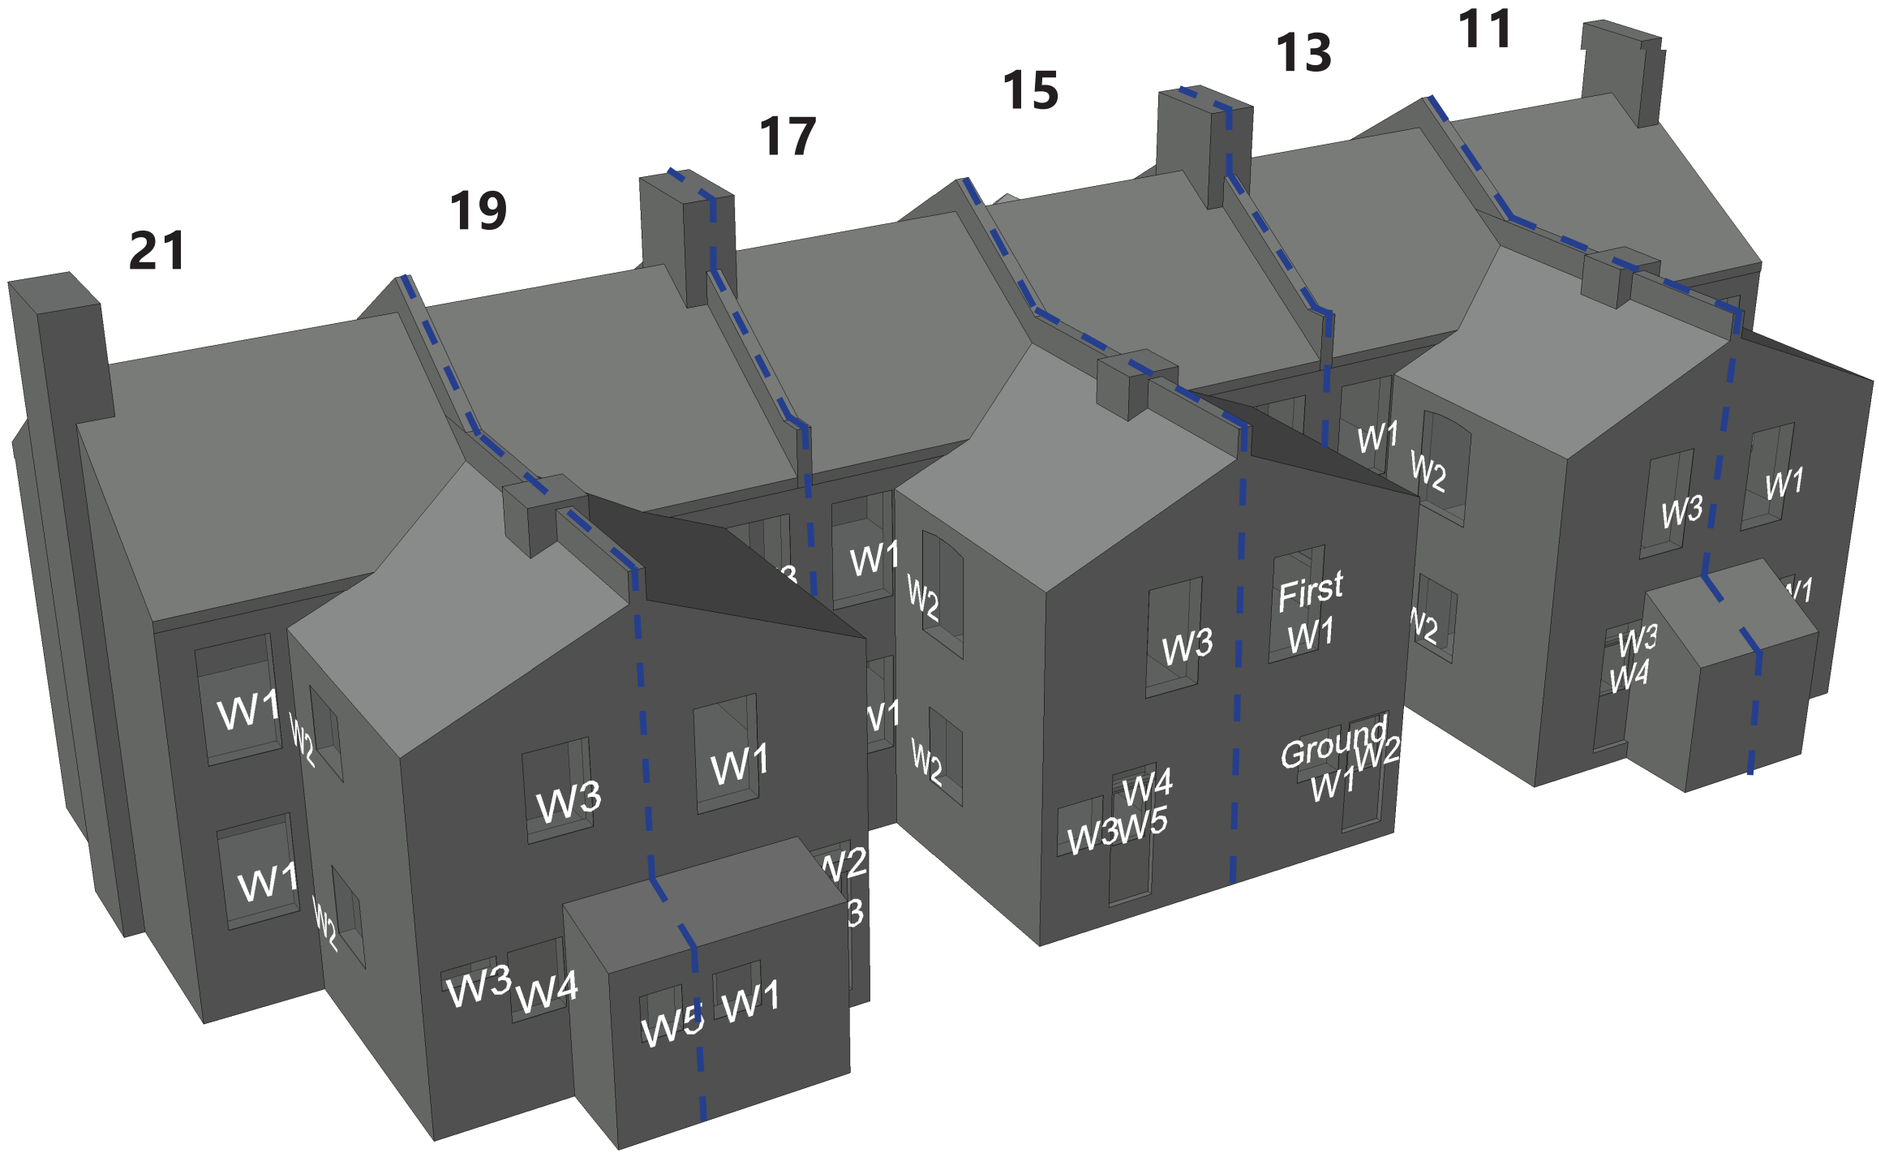

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	11-21 Hale Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	27

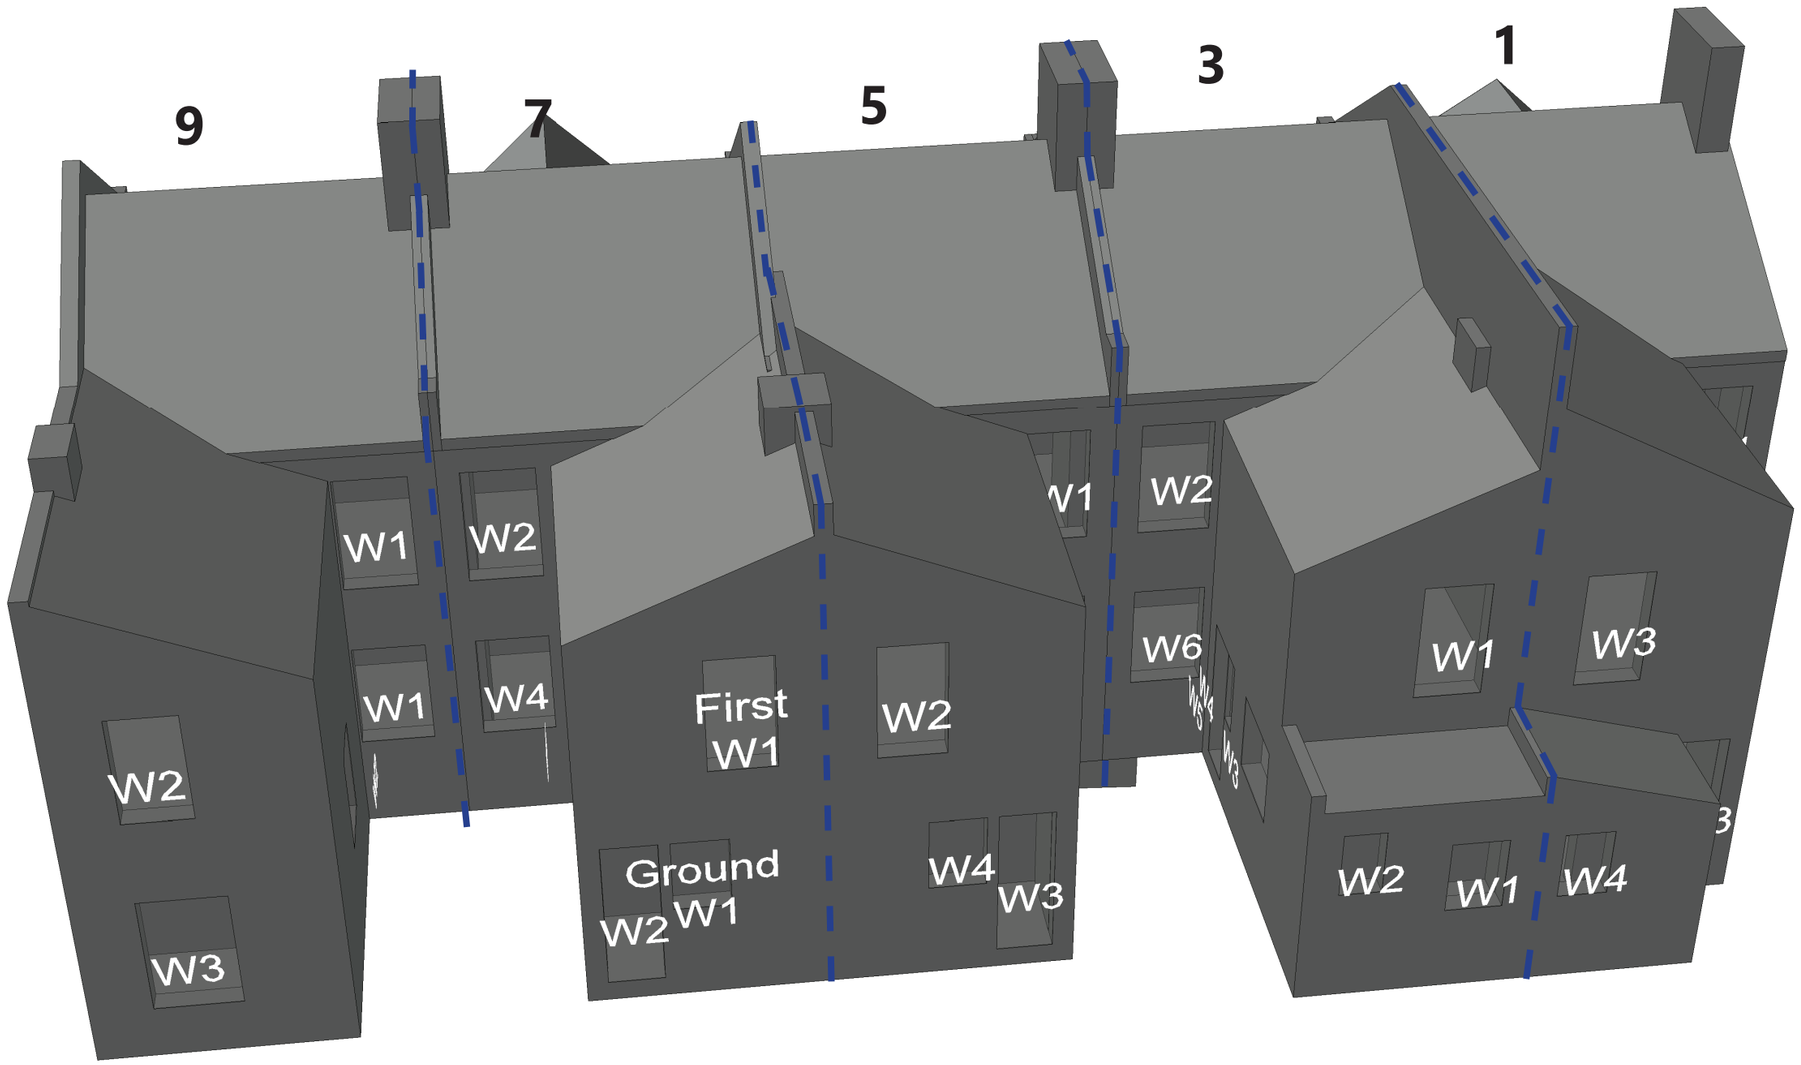

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: 1-9 Hale Road Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix: WM01	Page no.	28

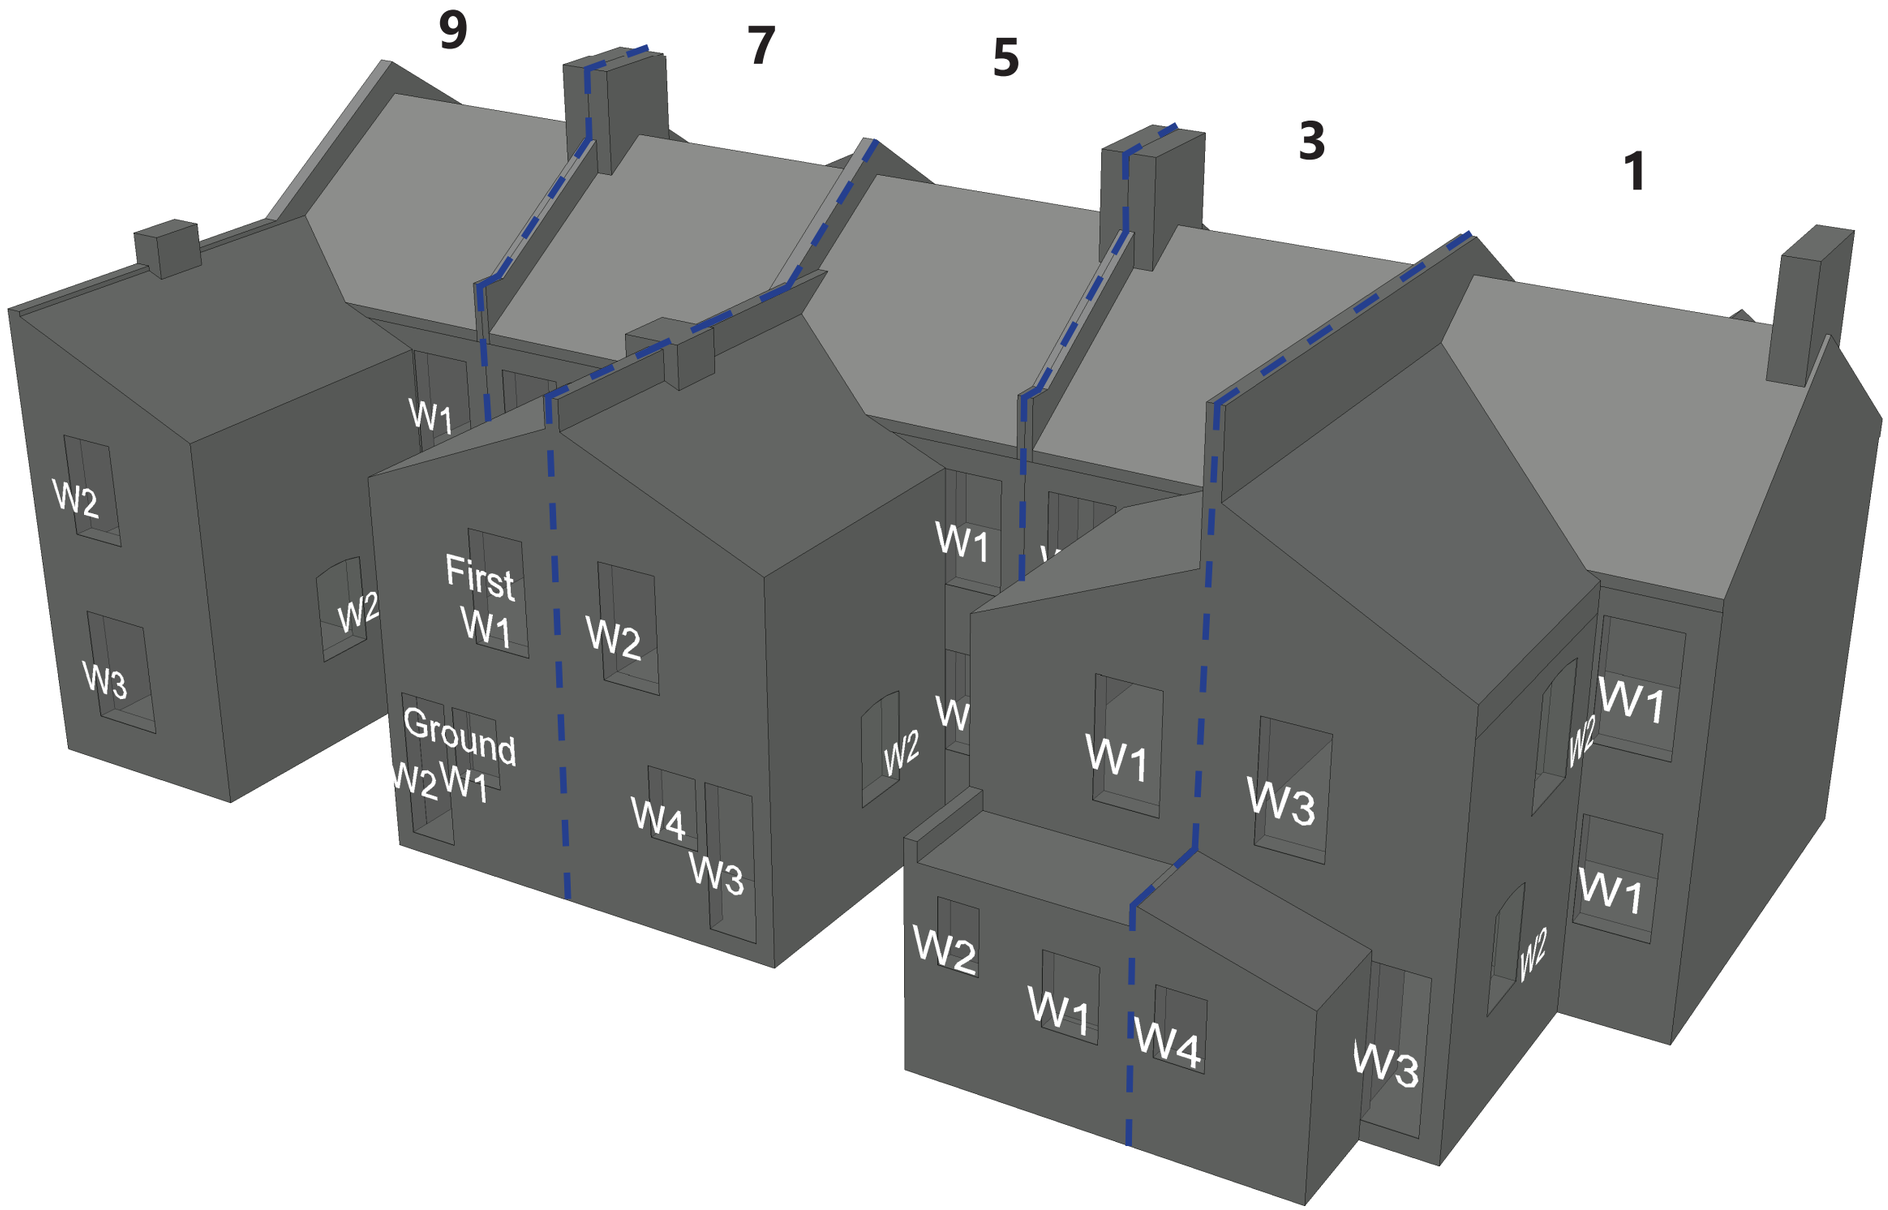

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	1-9 Hale Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	29

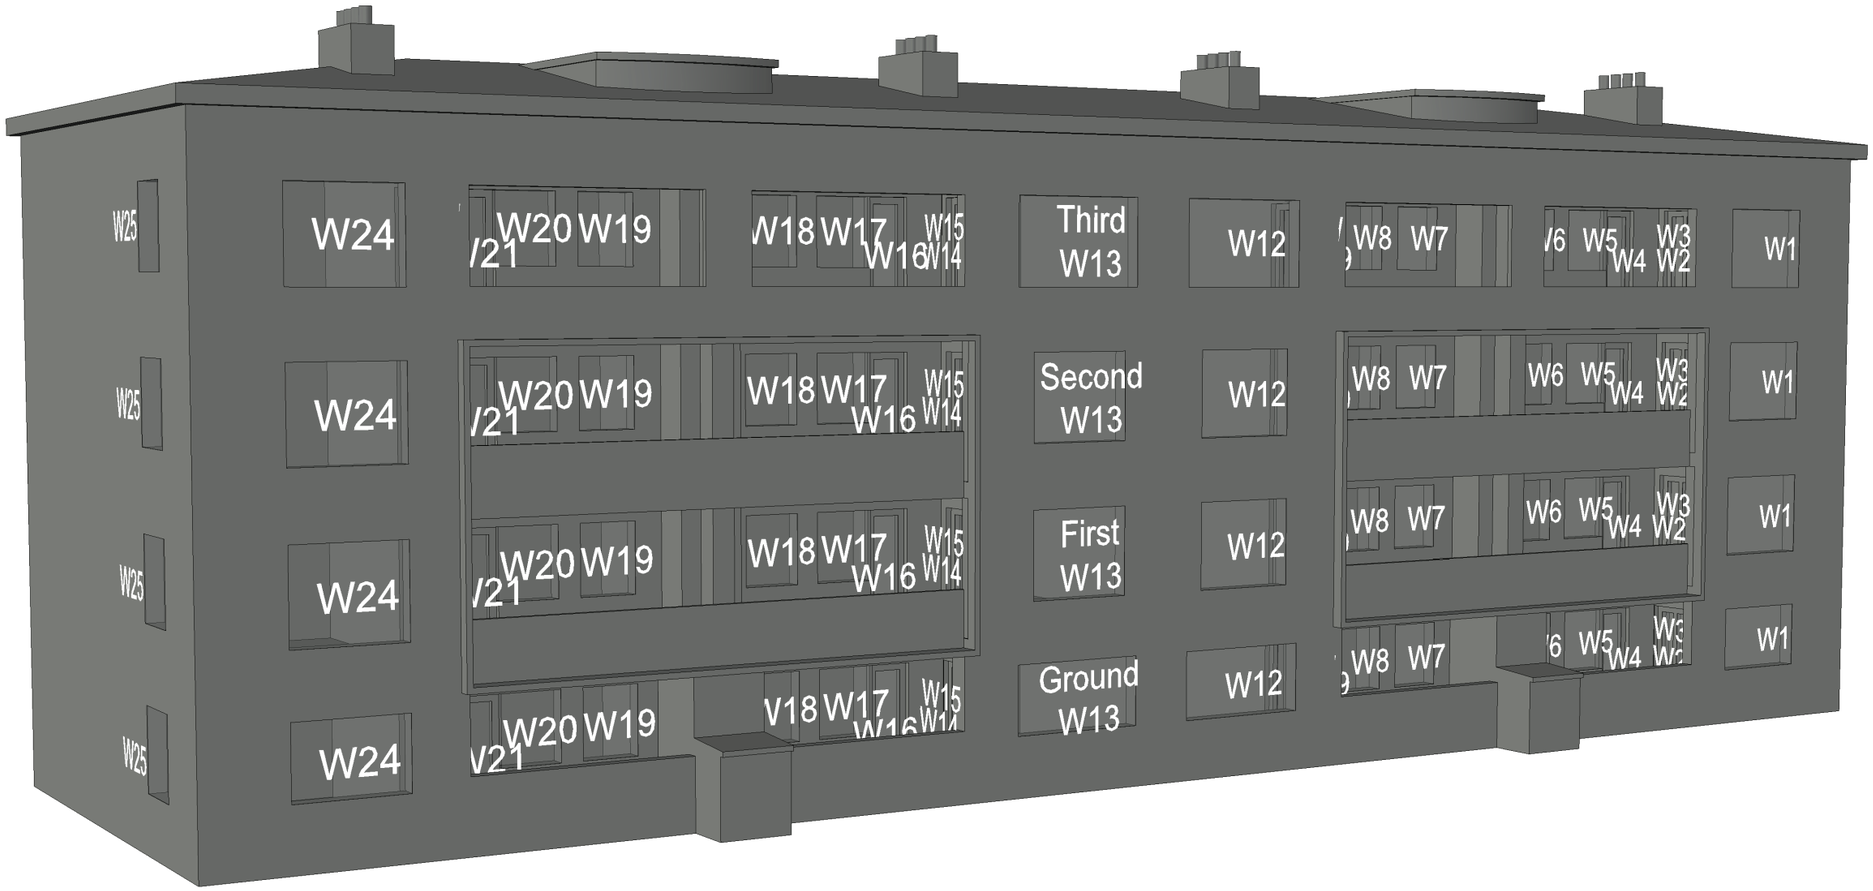

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	165-195 High cross road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	30

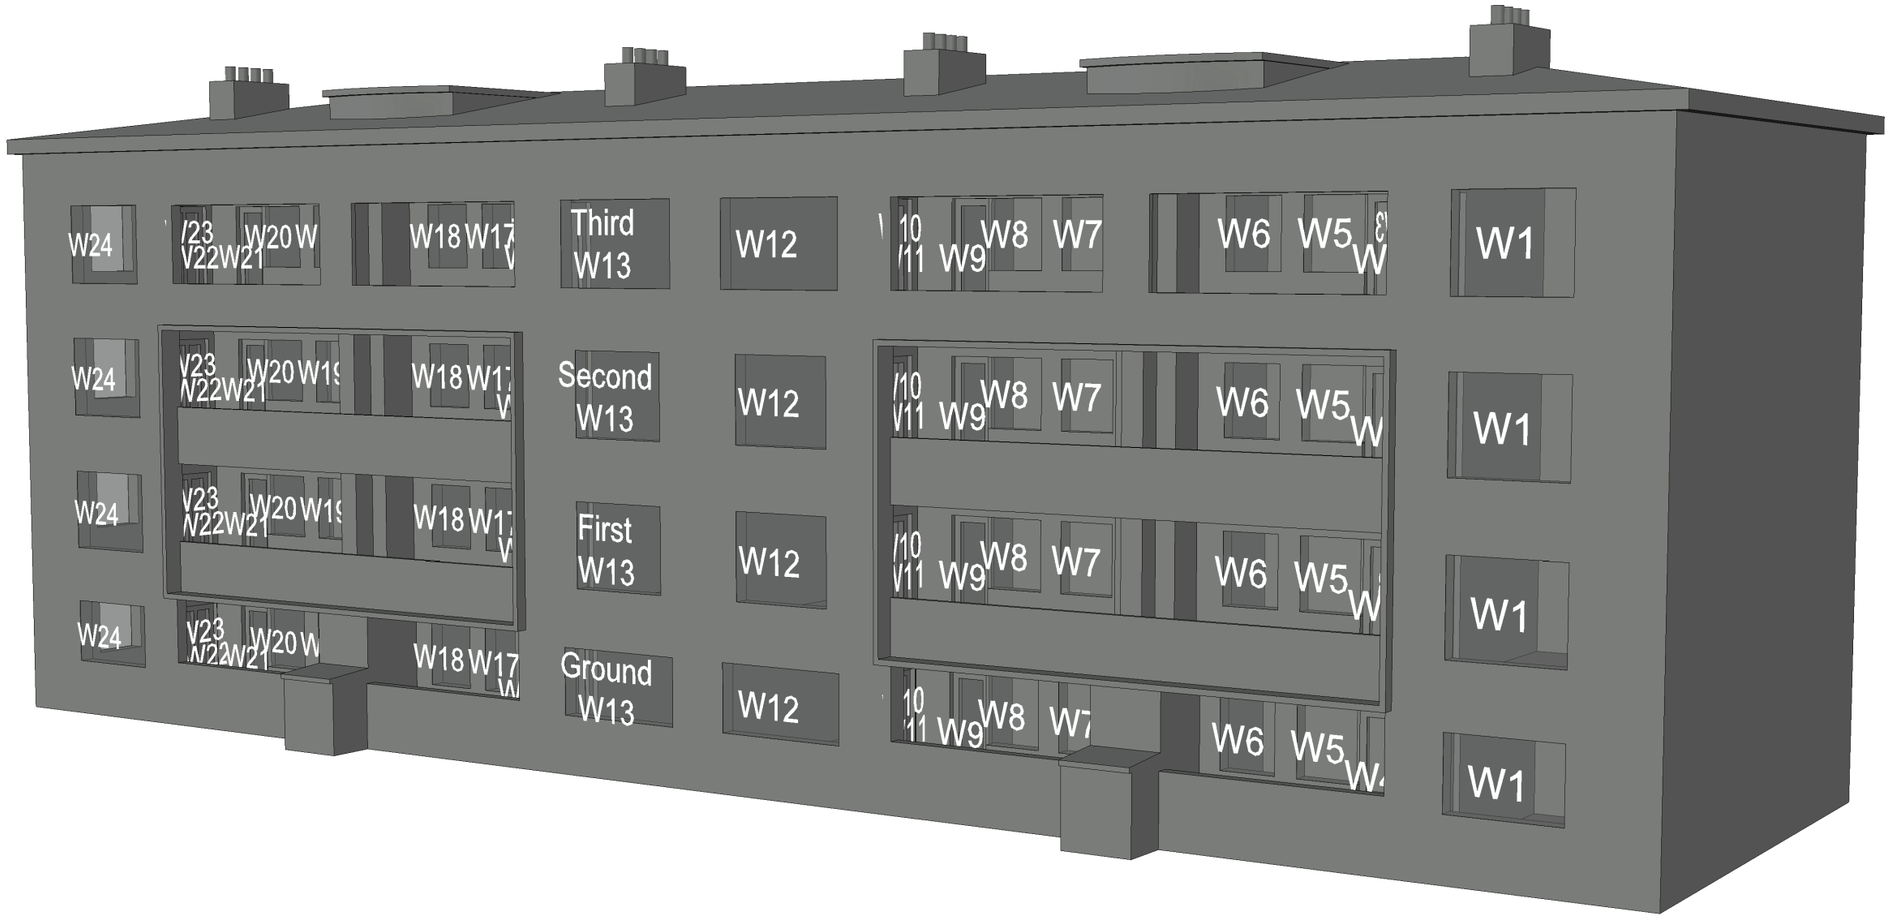

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information


Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale		
Title	165-195 High cross road Window Map		
Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	31

eb7 © copyright 2026

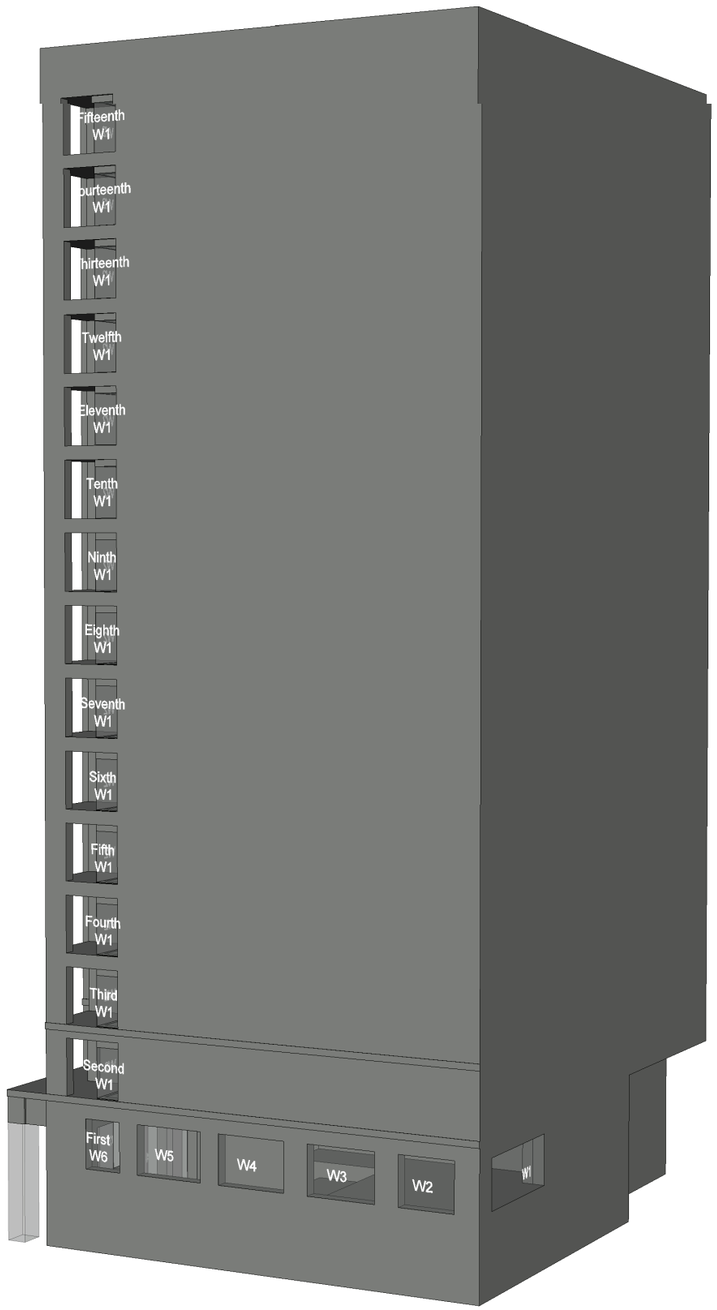

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: WalterTull House Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	32

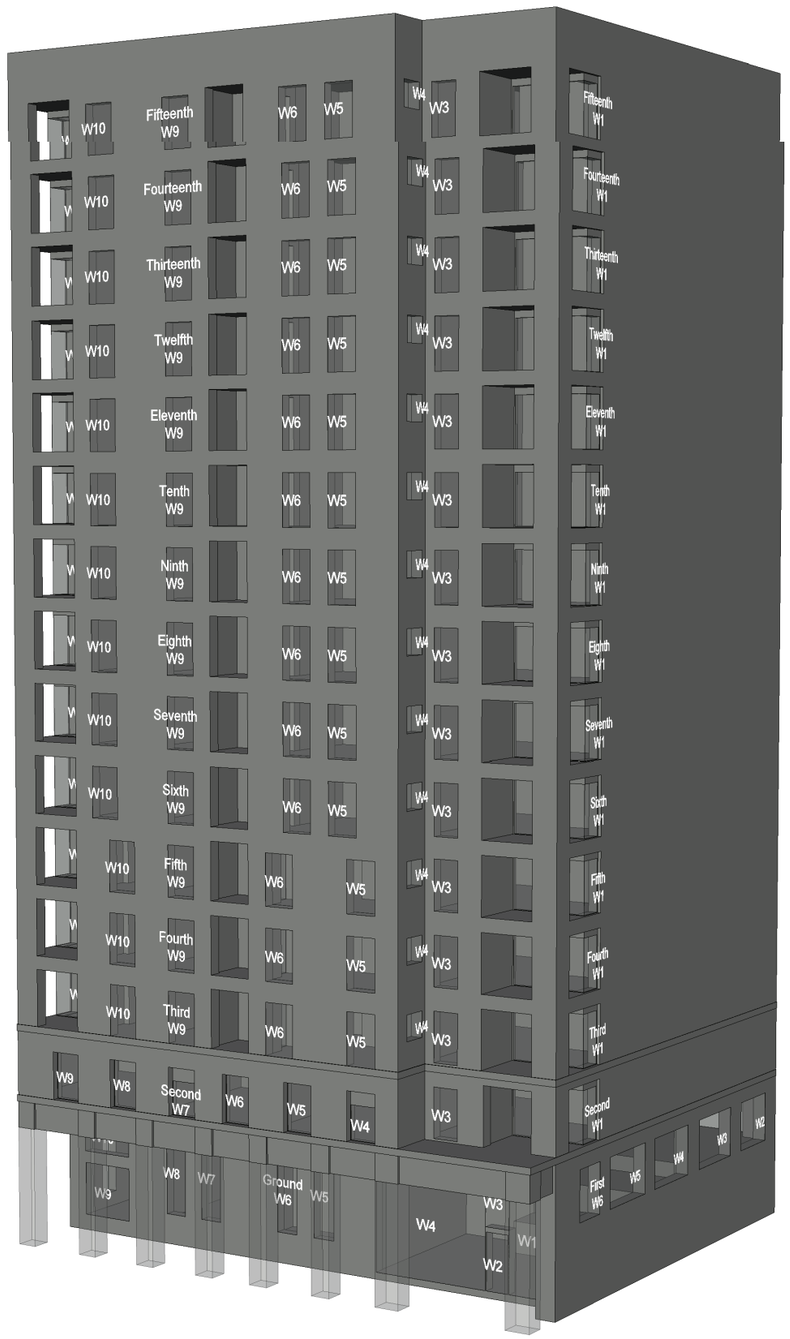

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: WalterTull House Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix: WM01	Page no.	33

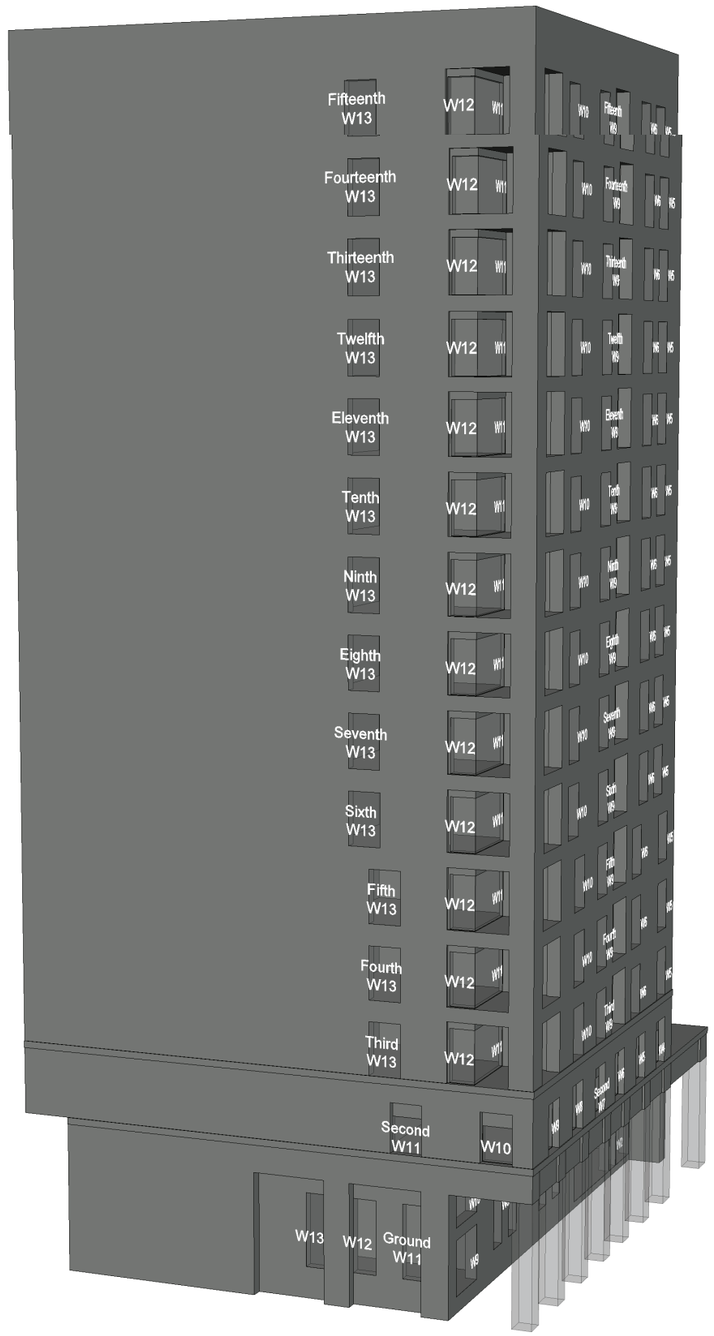

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: WalterTull House Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	34

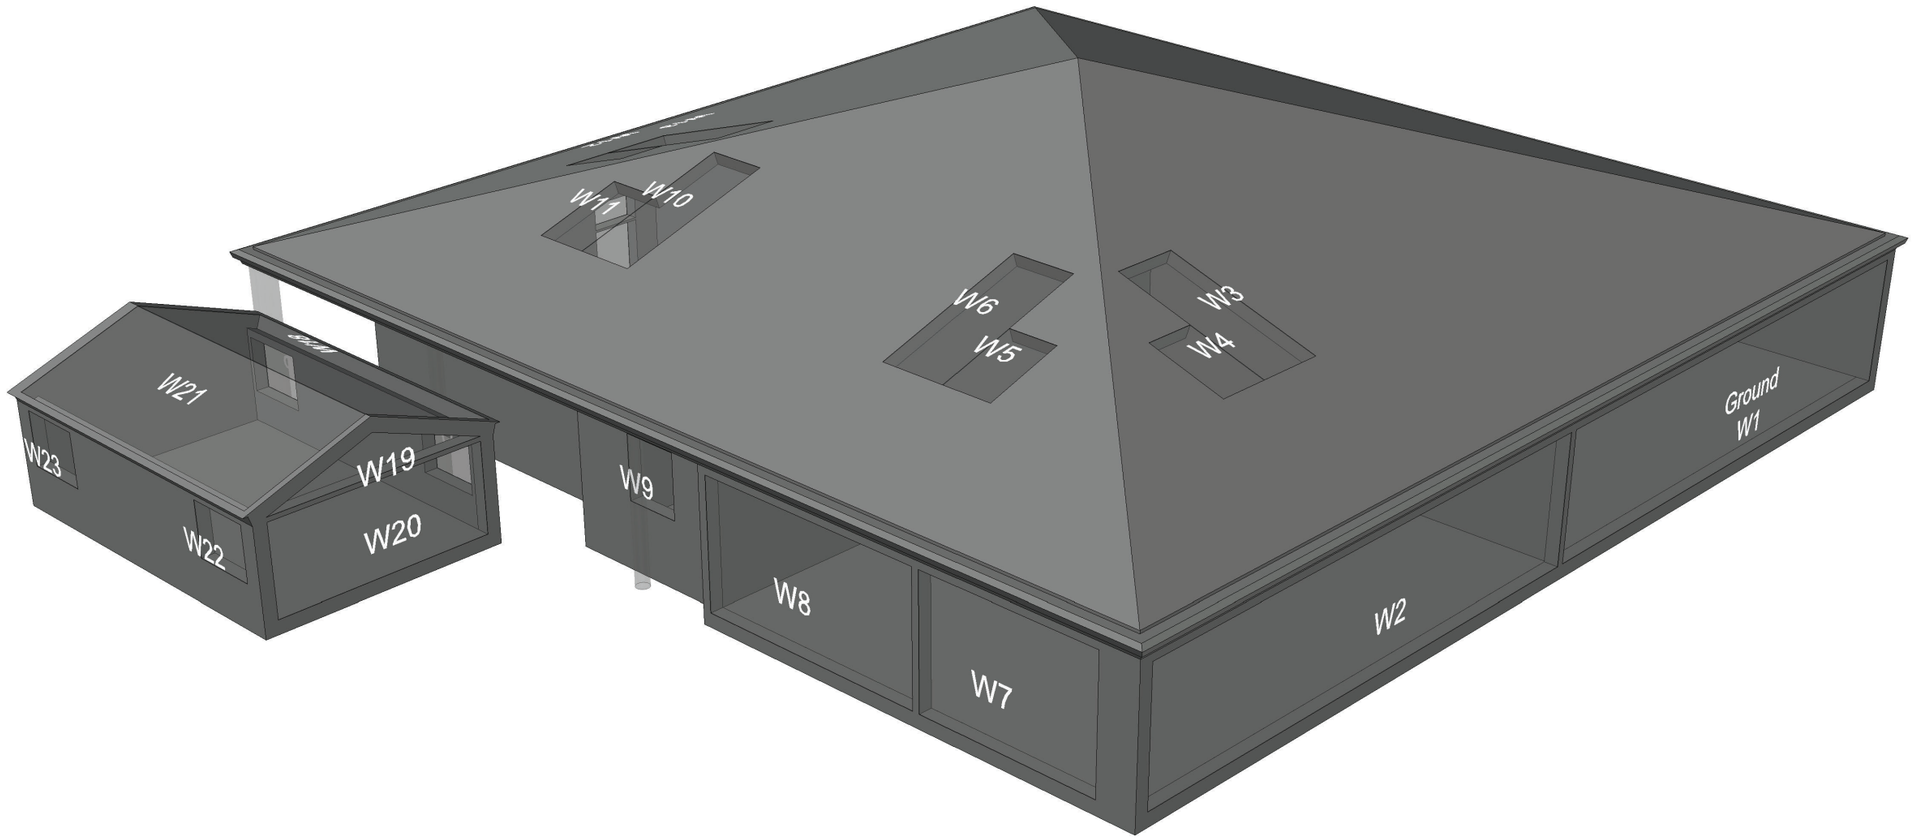

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information


Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	Hale Brew Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	35

eb7 © copyright 2026

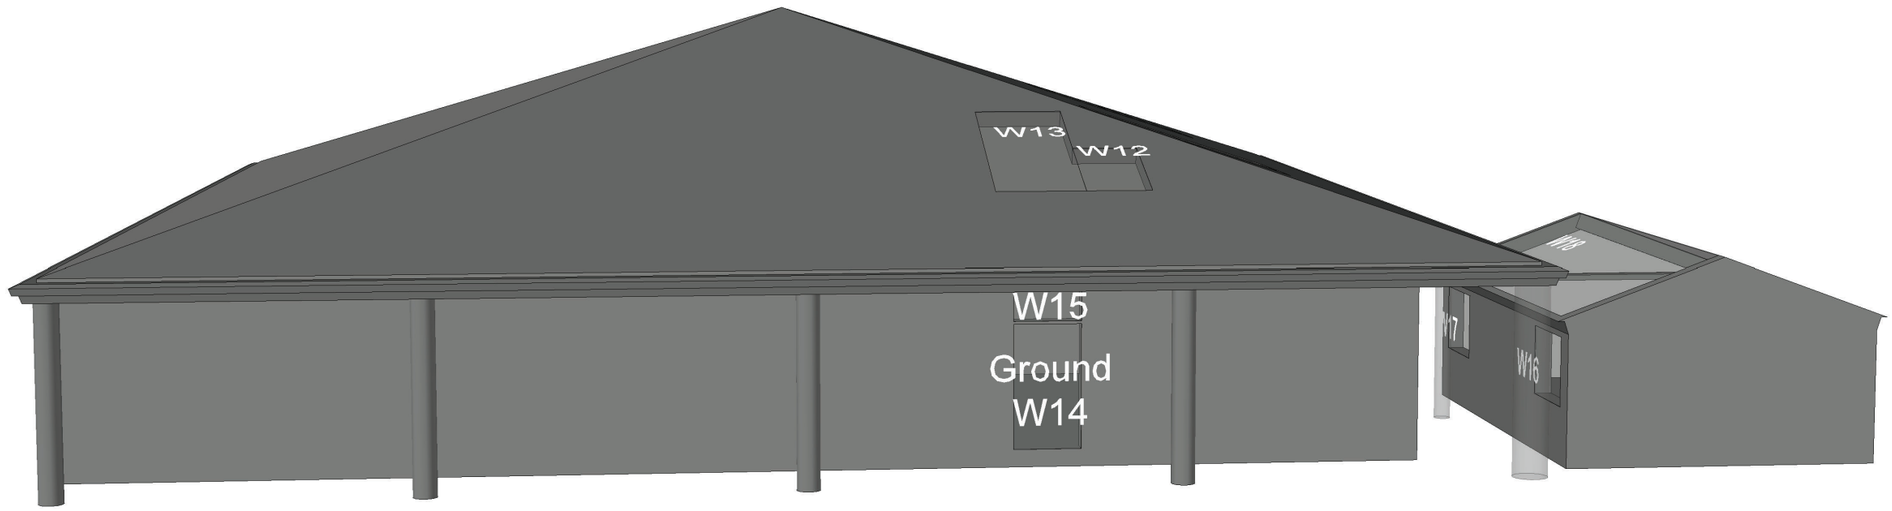

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: Hale Brew Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	36

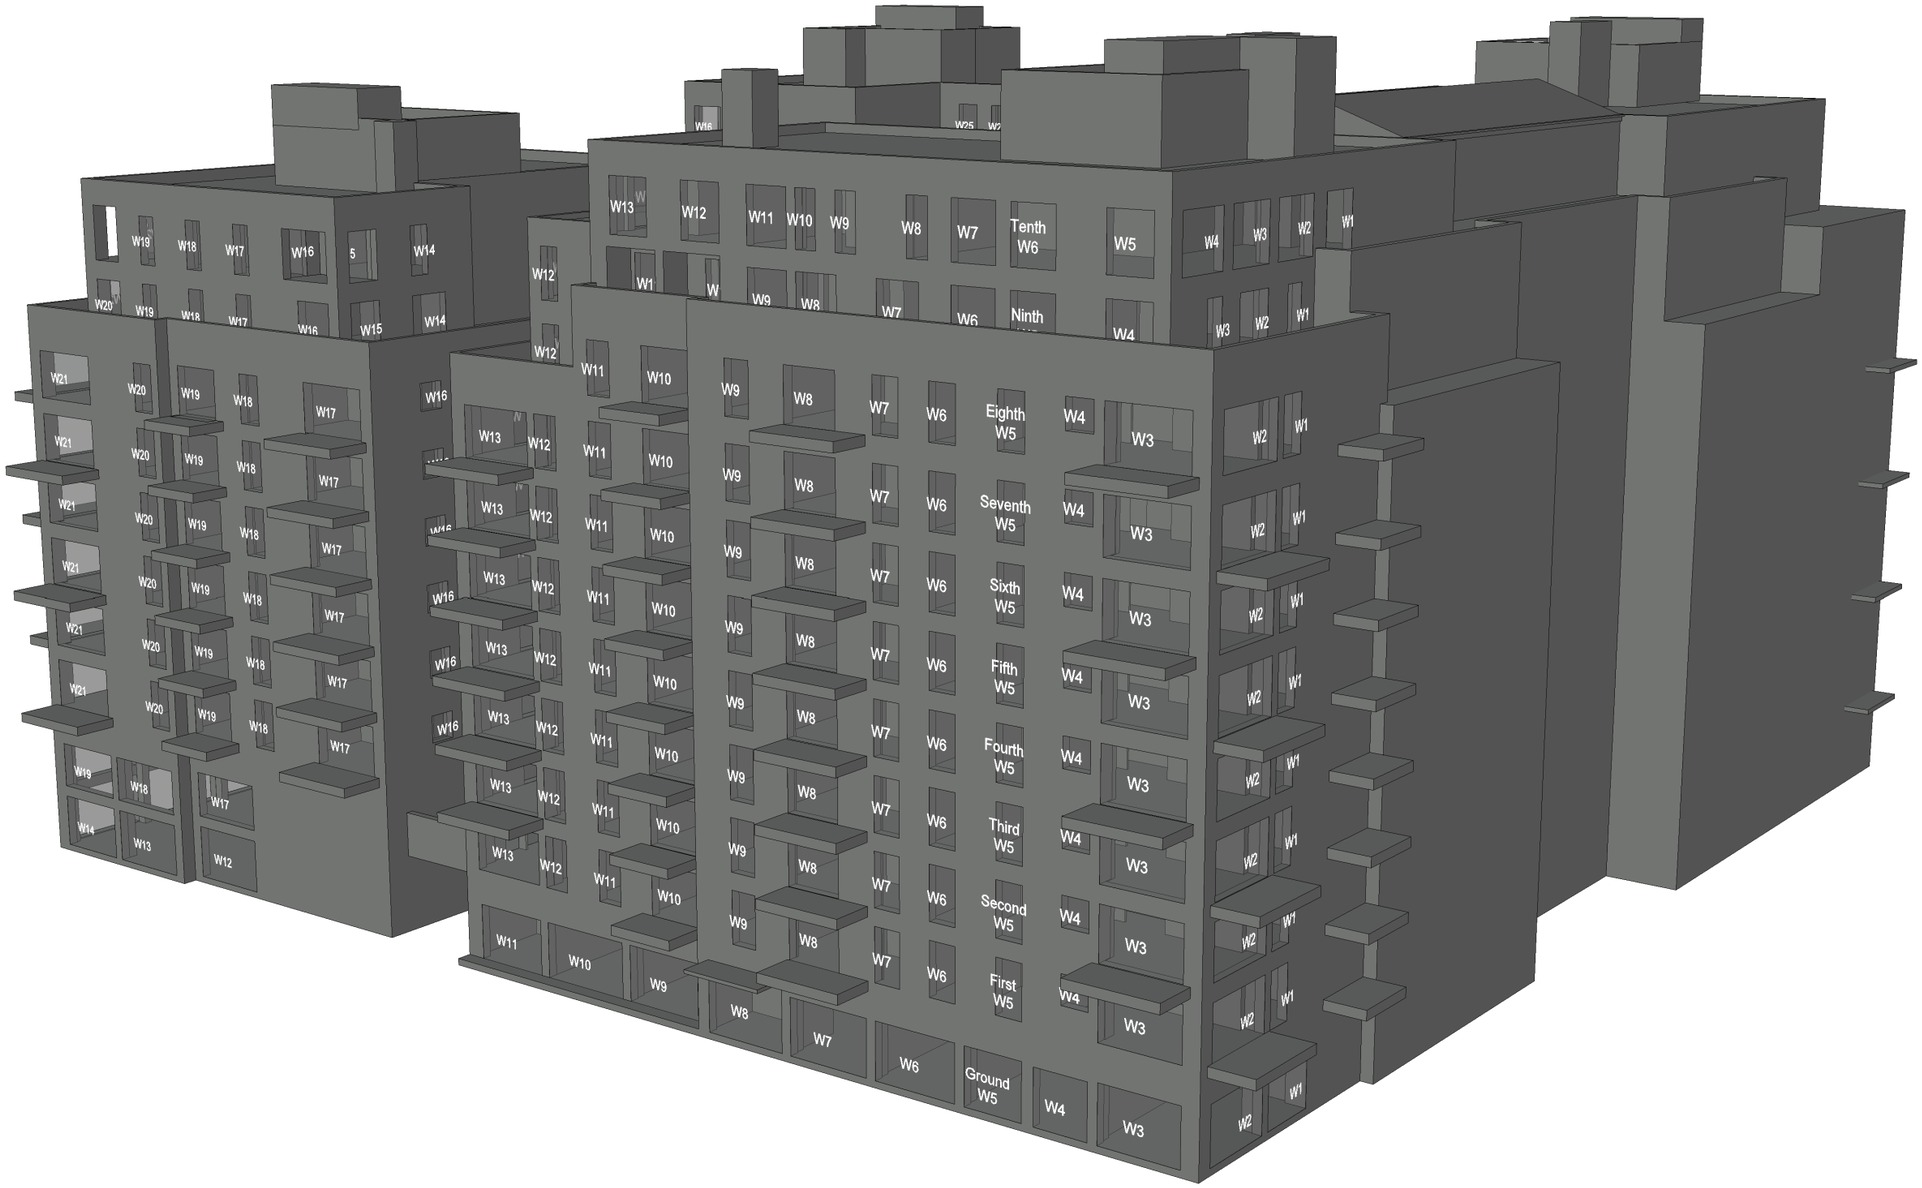


eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


EB7 Ltd
Site Photographs
Ordnance Survey

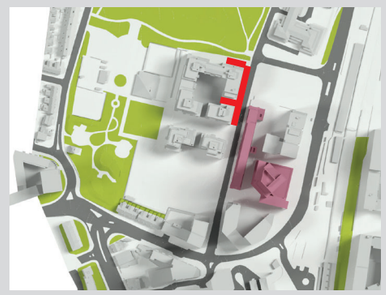

Project: Ashley Road Tottenham Hale

Title: Sessile Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	37

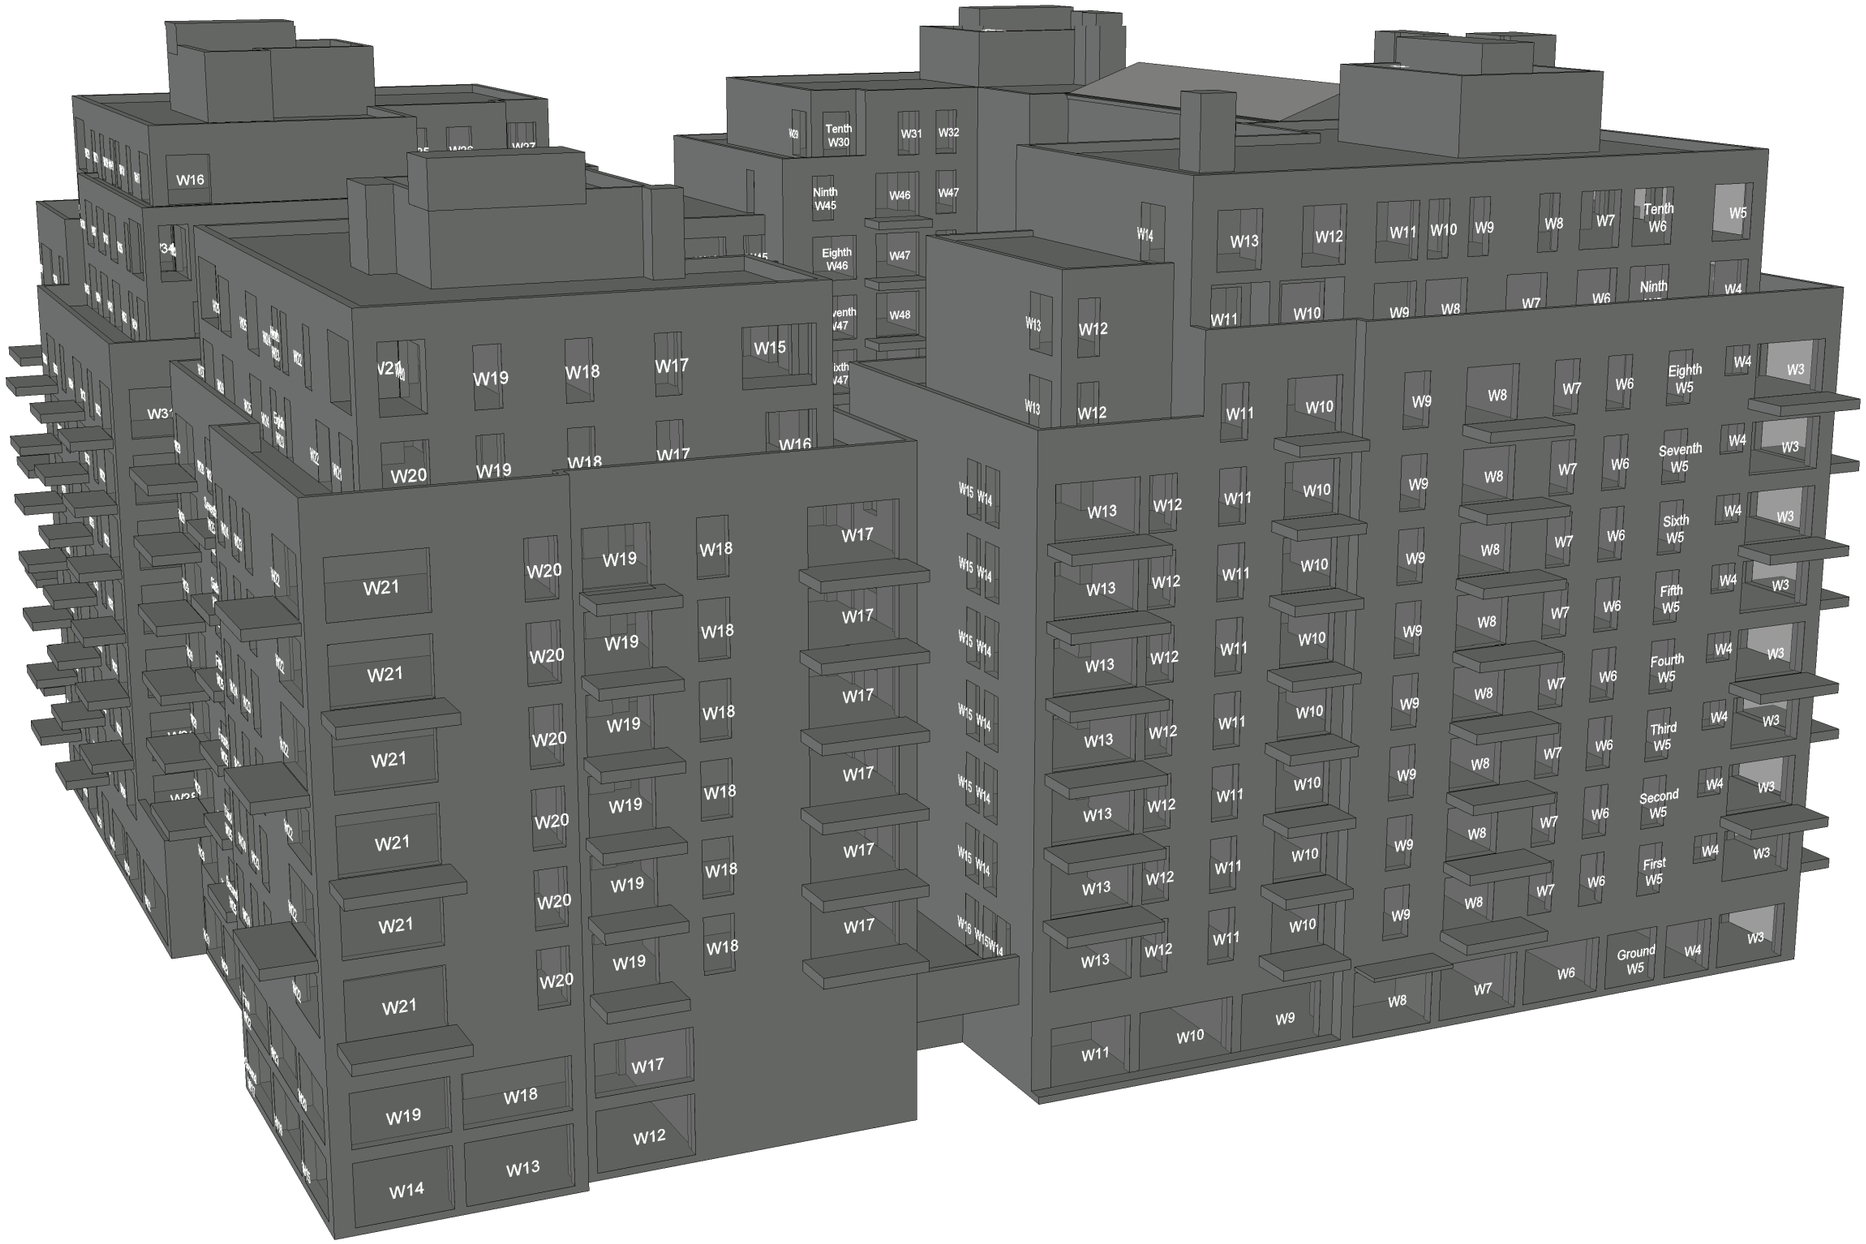


eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey

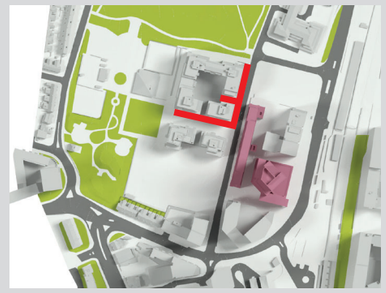


Project: Ashley Road Tottenham Hale

Title: Sessile Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	38

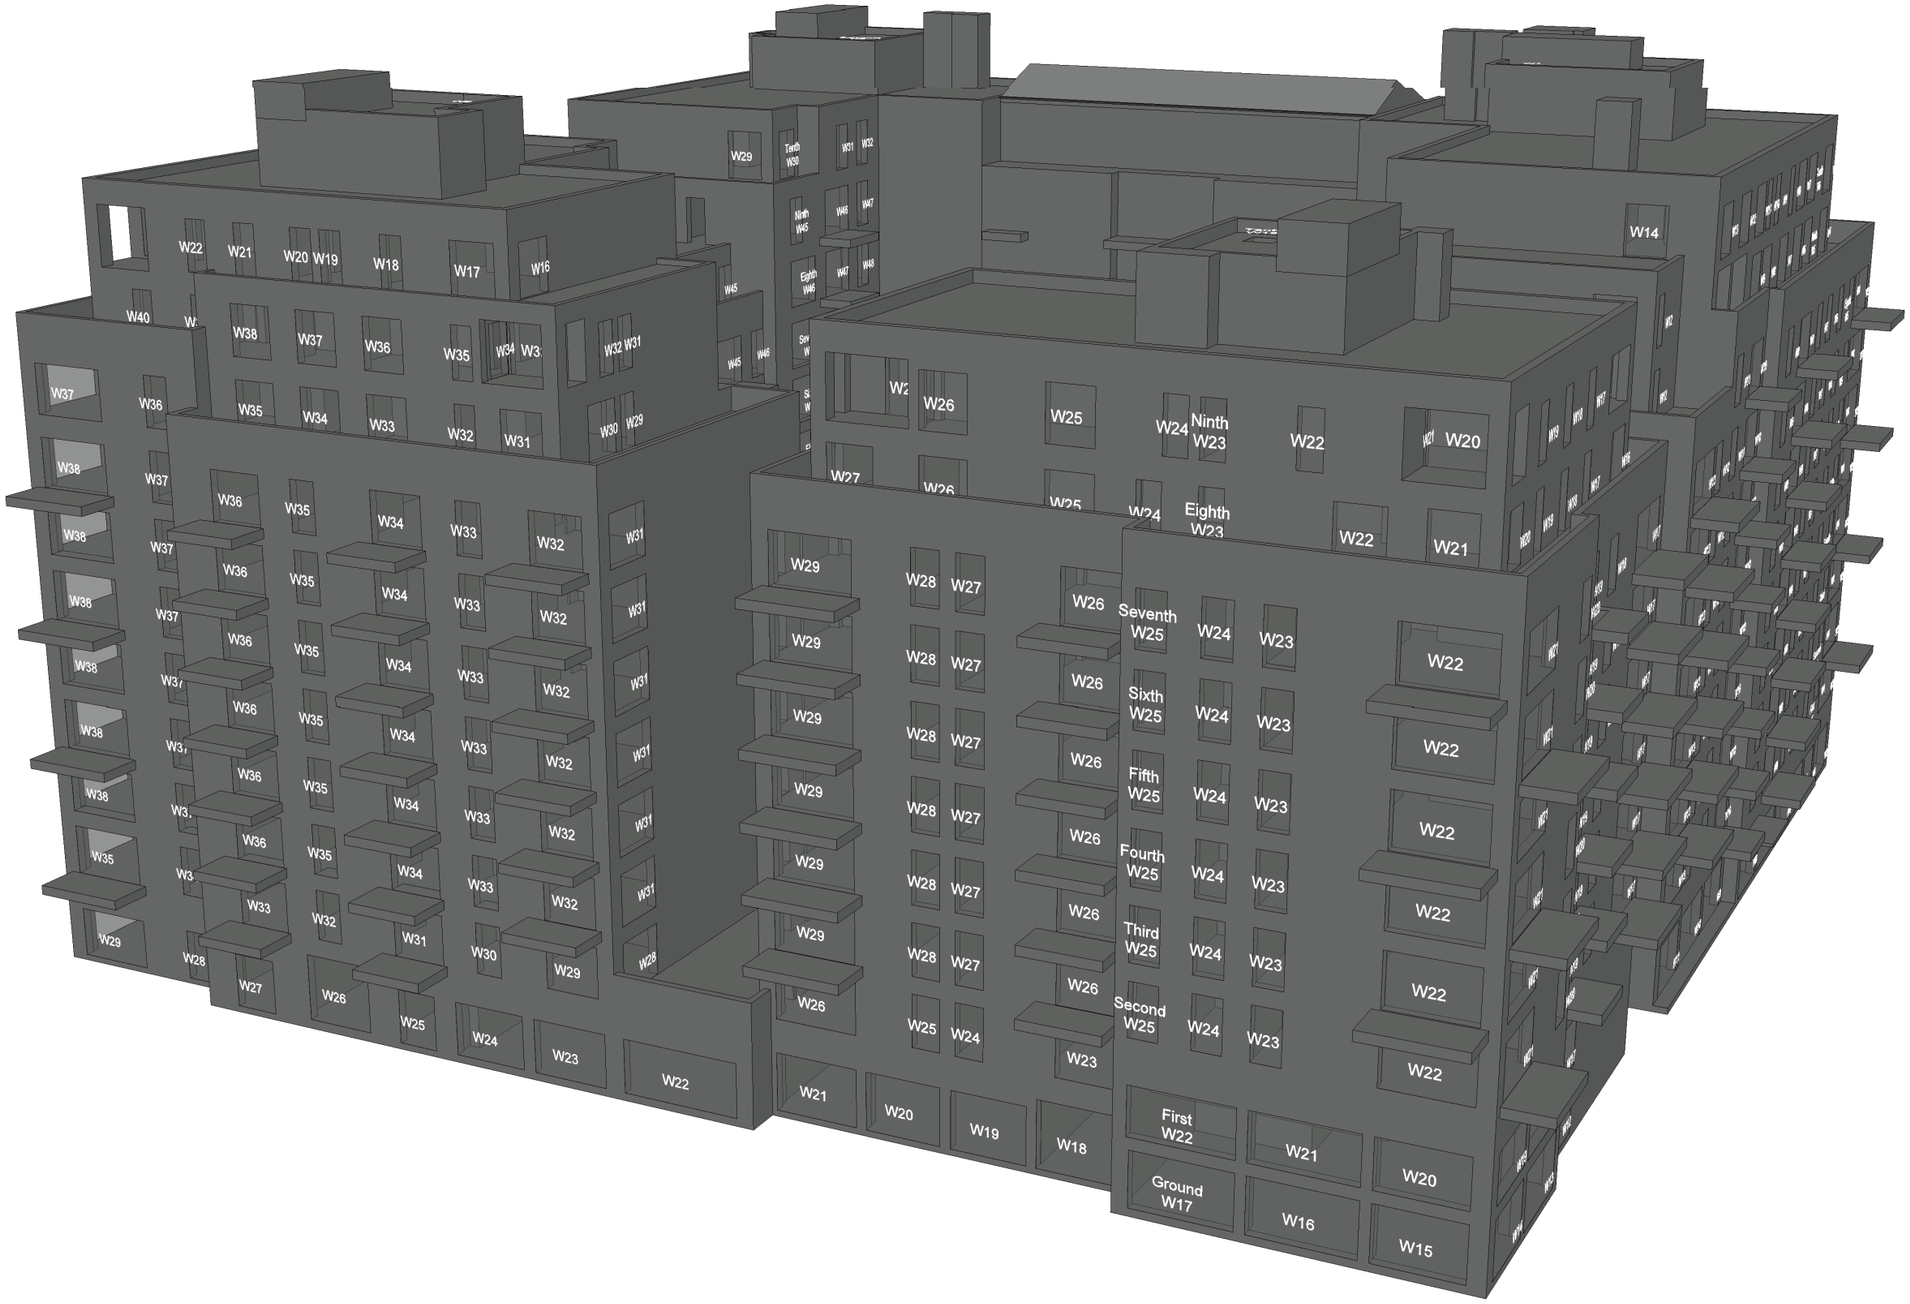

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: Sessile Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	39

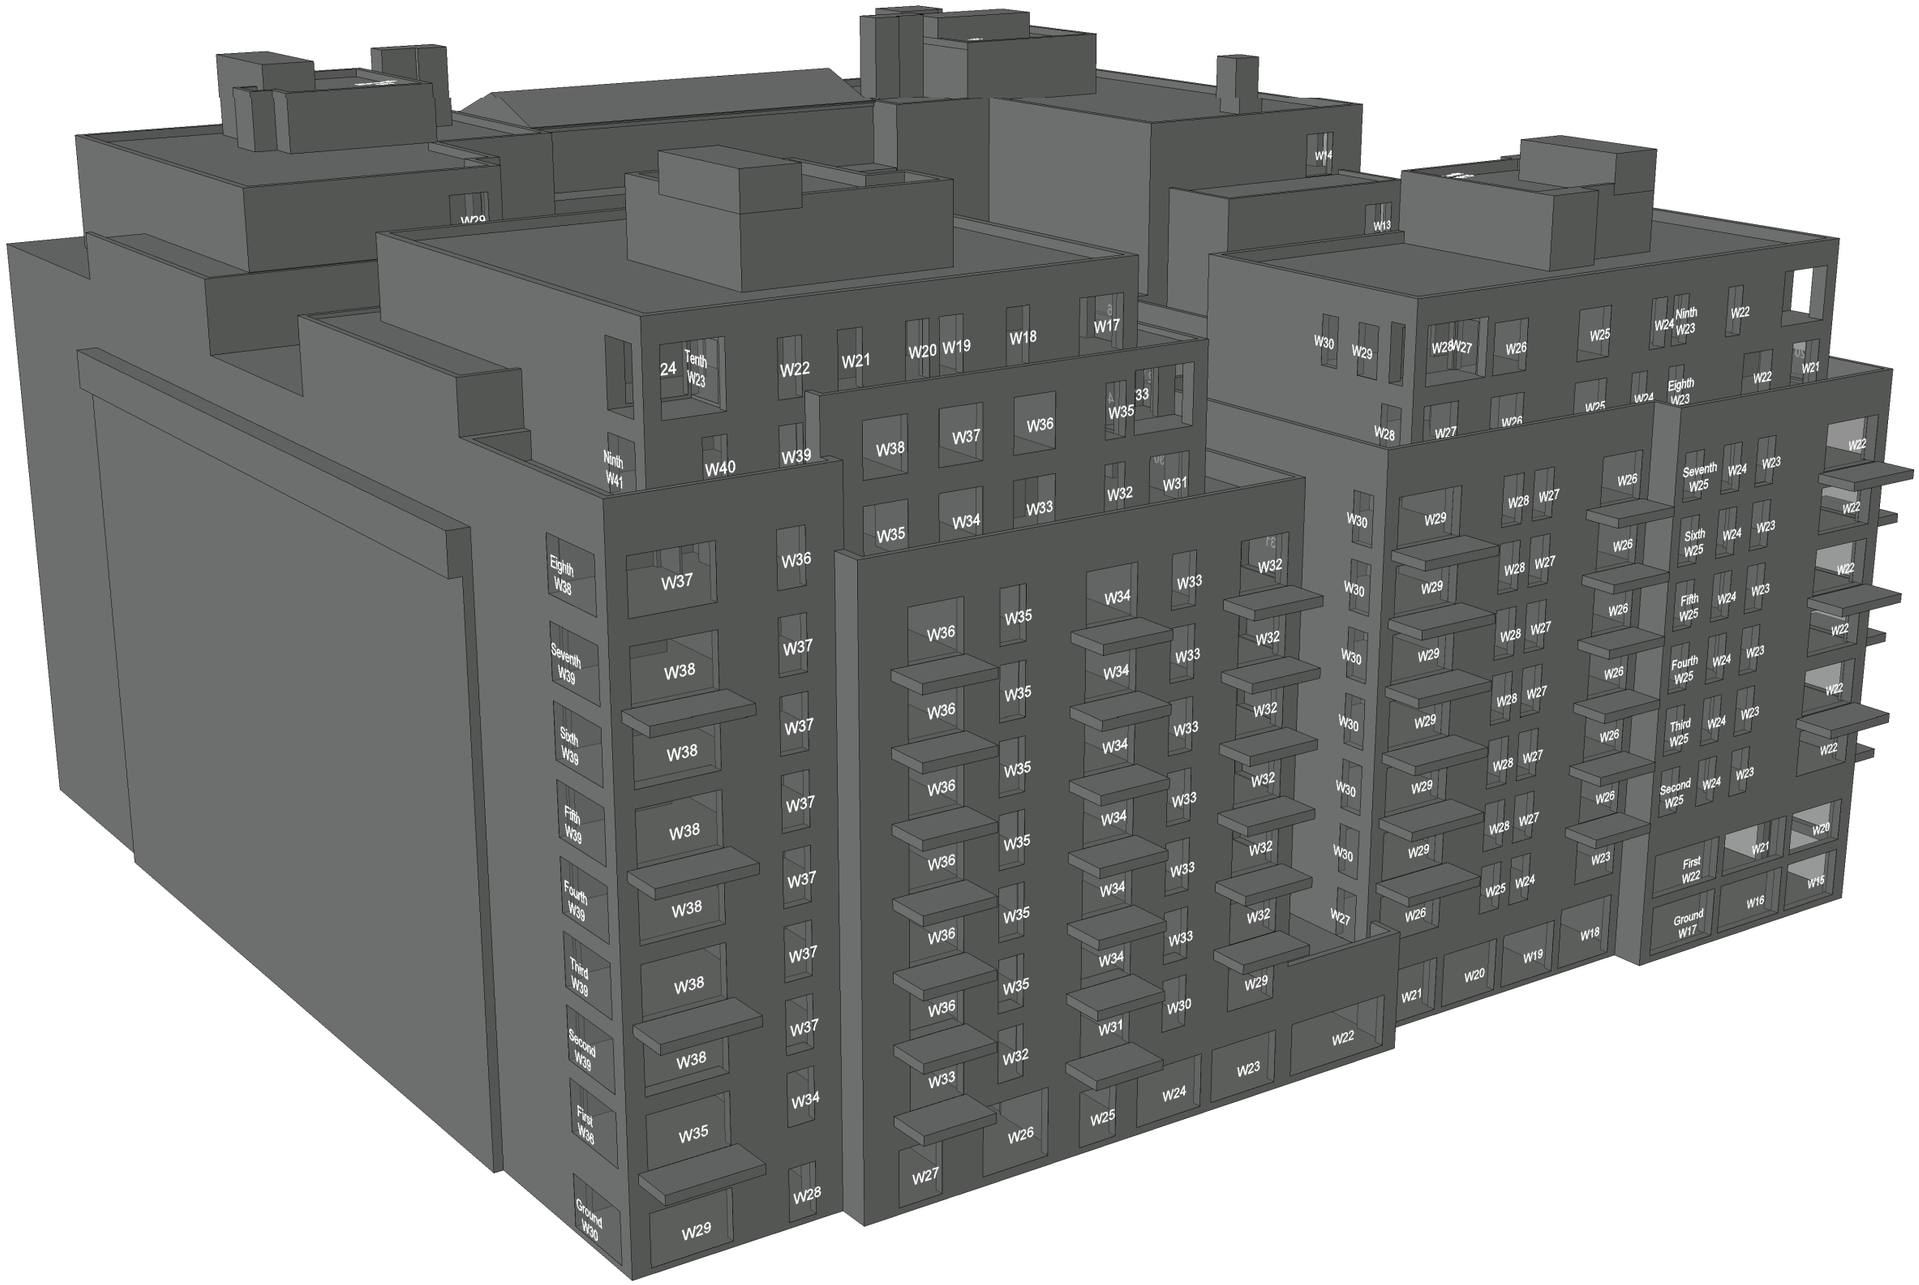


eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


EB7 Ltd
Site Photographs
Ordnance Survey

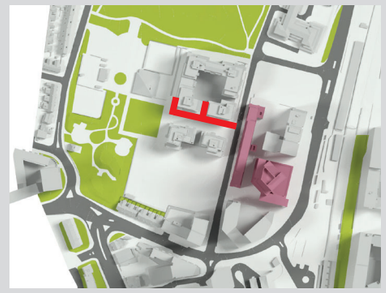

Project: Ashley Road Tottenham Hale

Title: Sessile Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix: WM01	Page no.	40

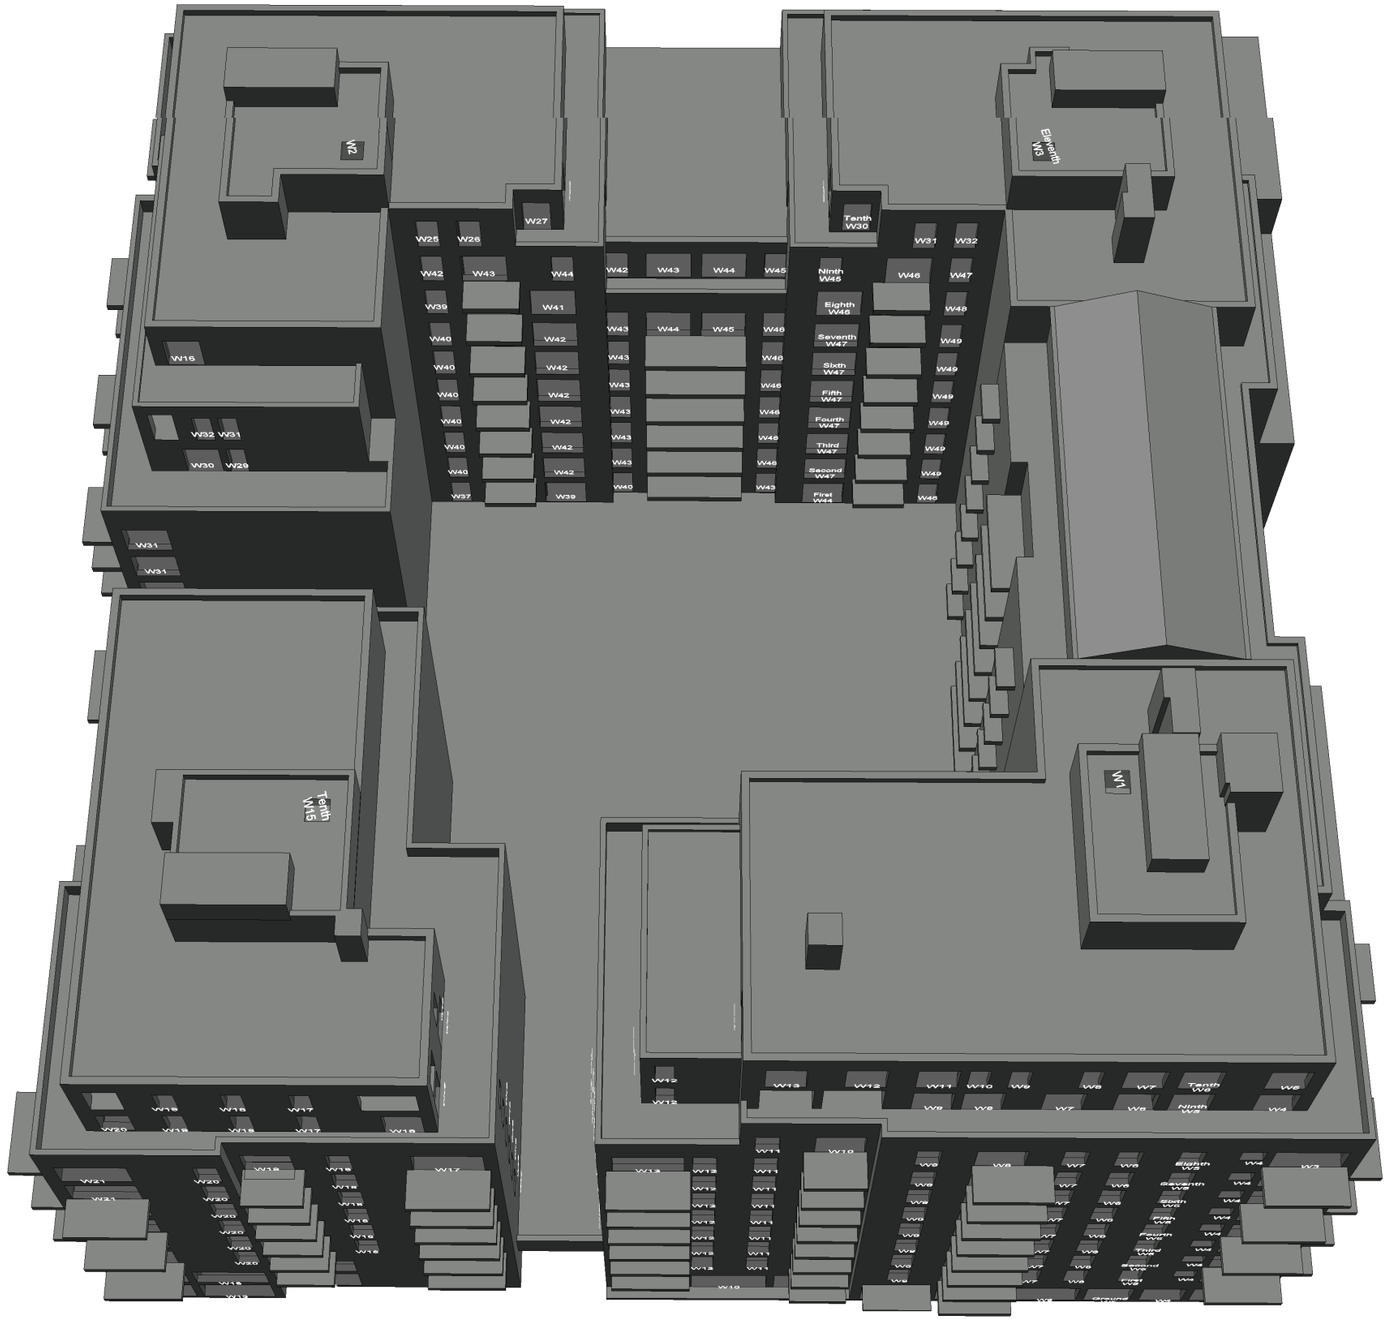


eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information


Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey

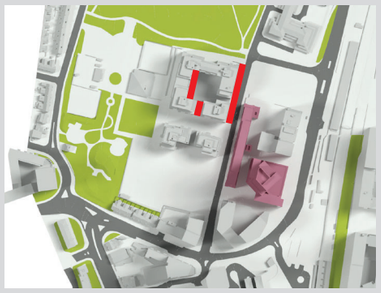

Project	Ashley Road Tottenham Hale		
Title	Sessile Apartments Window Map		
Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	41


2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

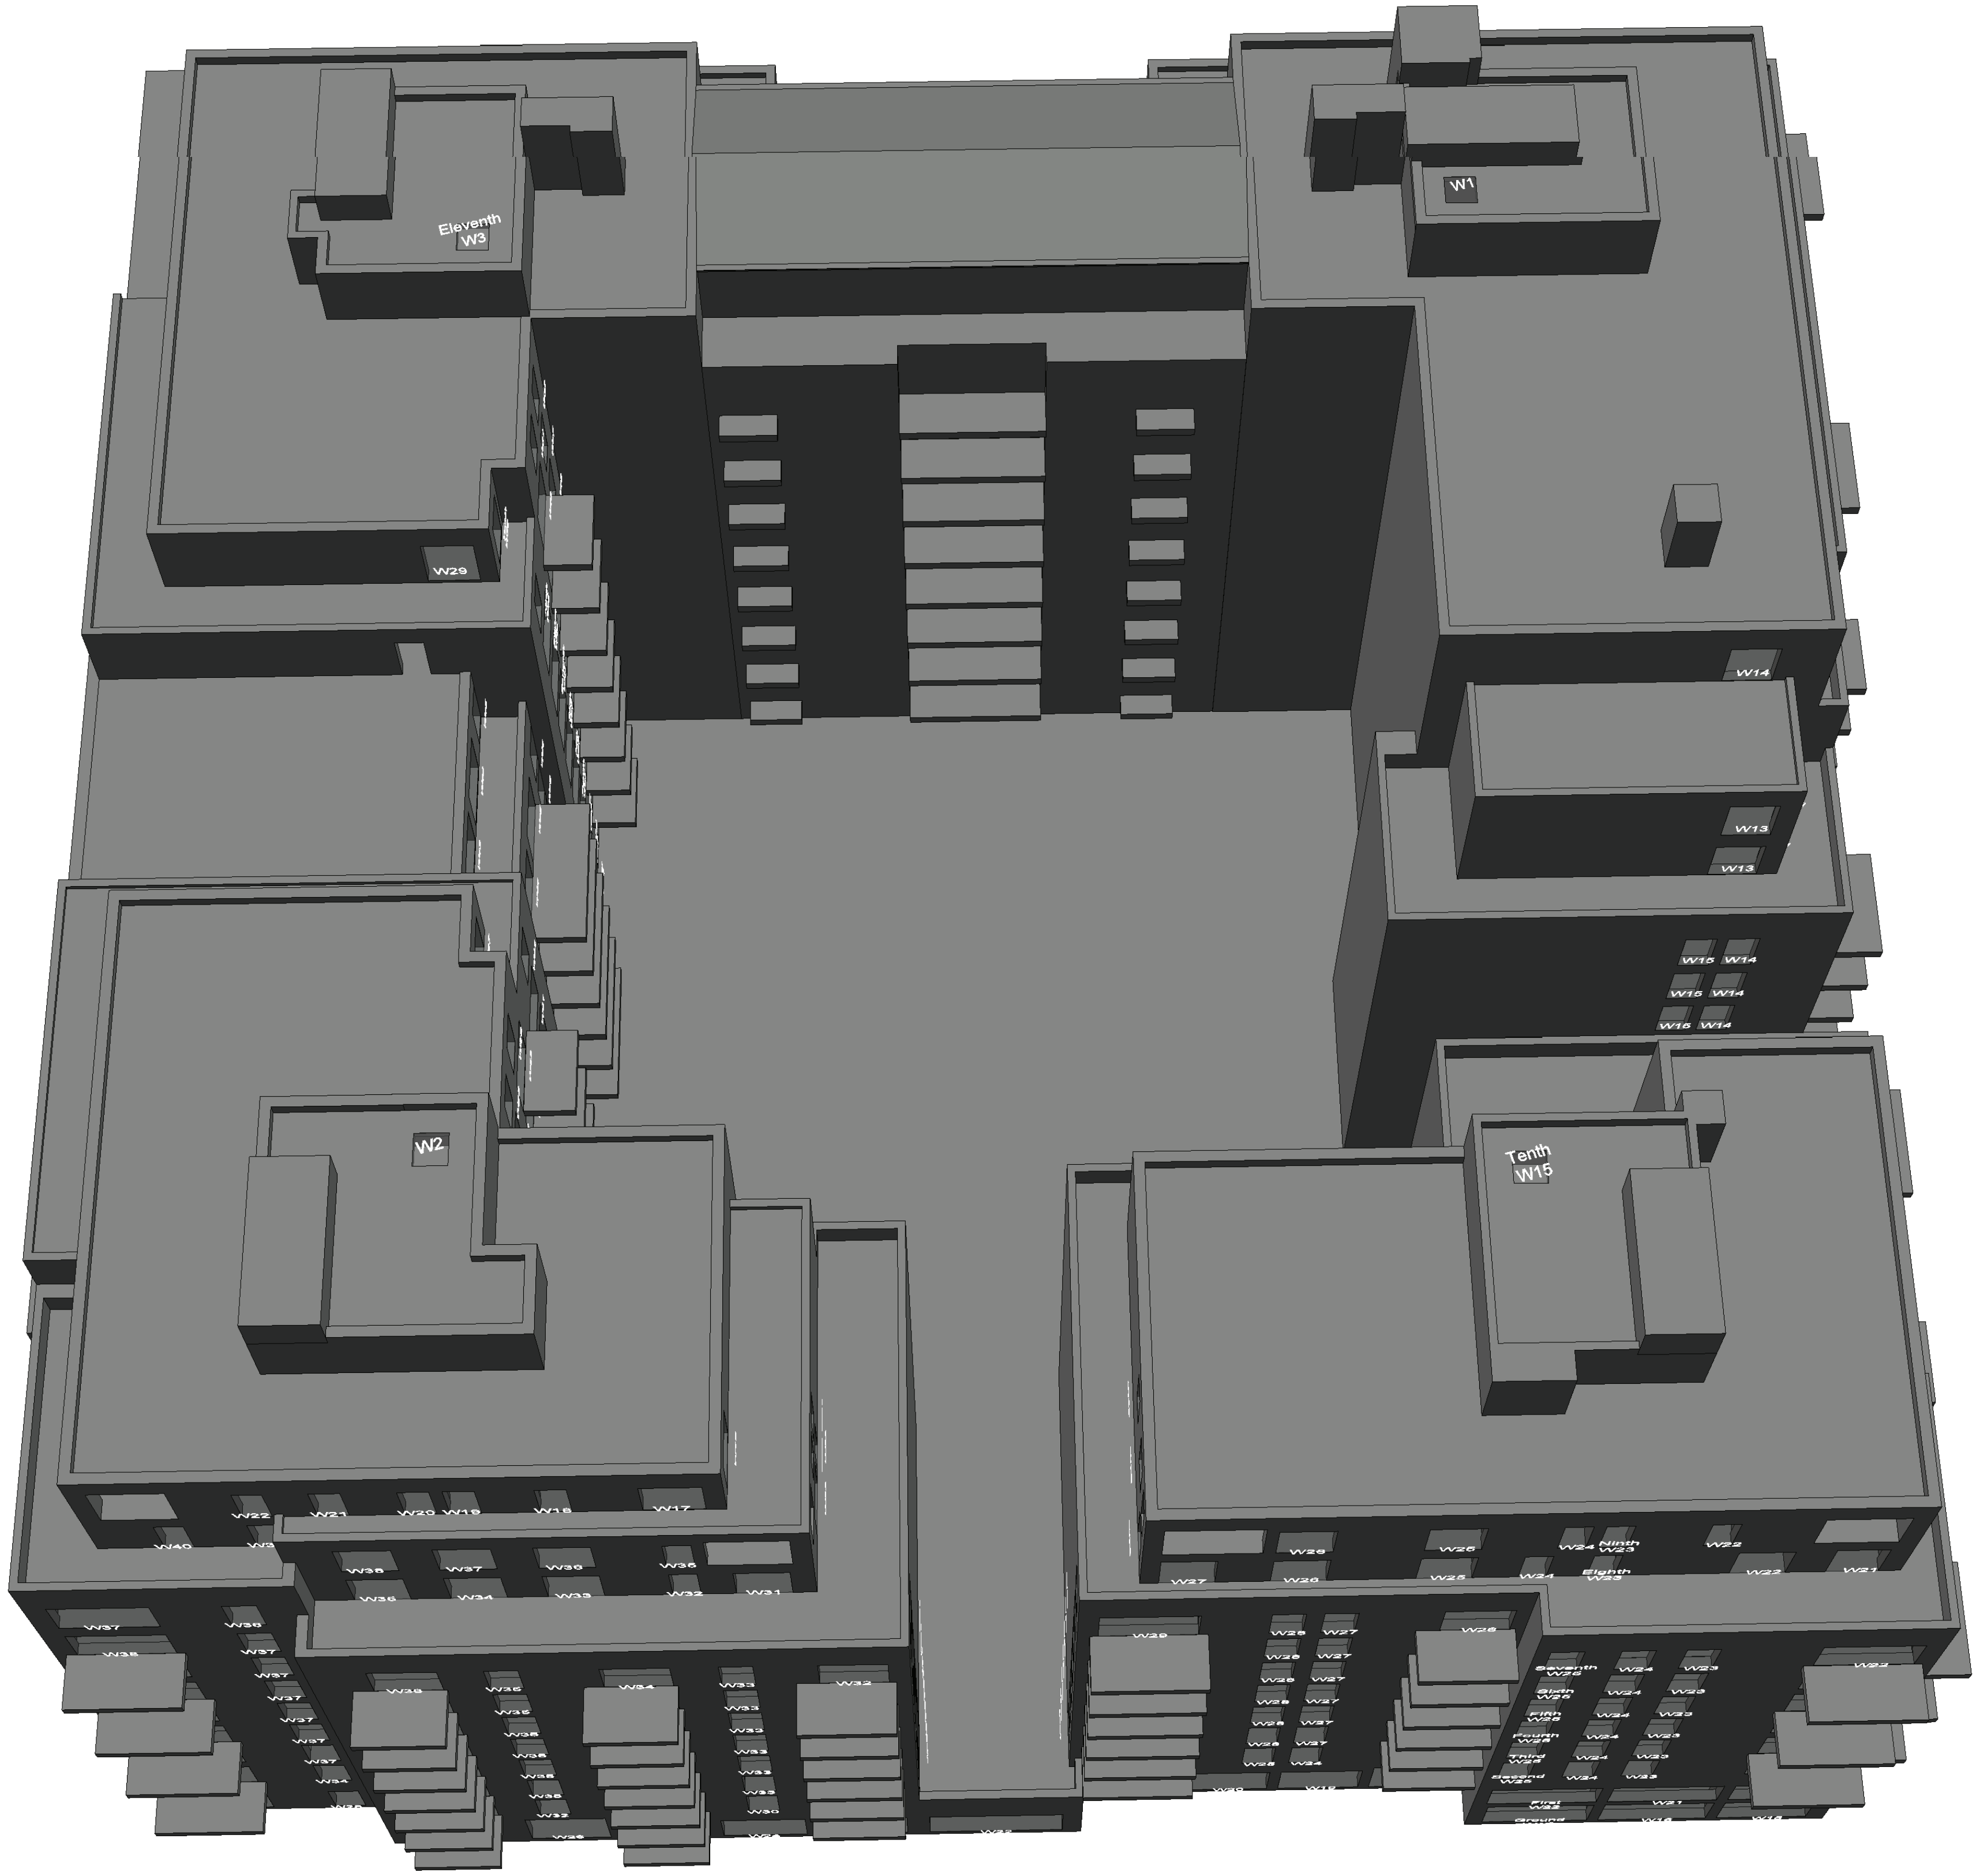

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey

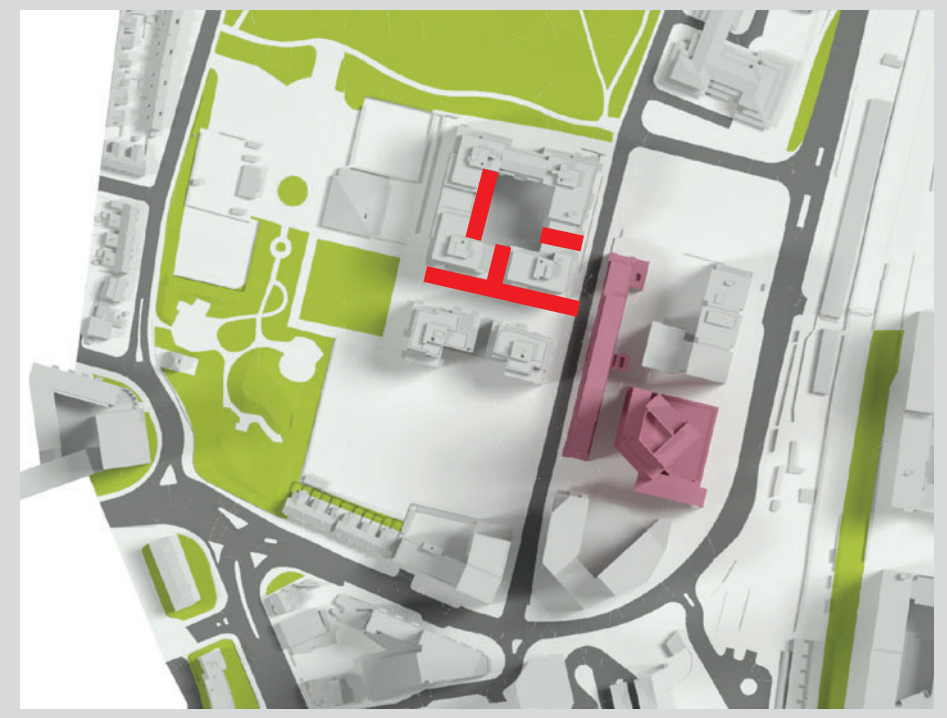

Project	Ashley Road Tottenham Hale		
Title	Sessile Apartments Window Map		
Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	42

eb7 © copyright 2026



eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	Rosa Luxemburg Apartments Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	43

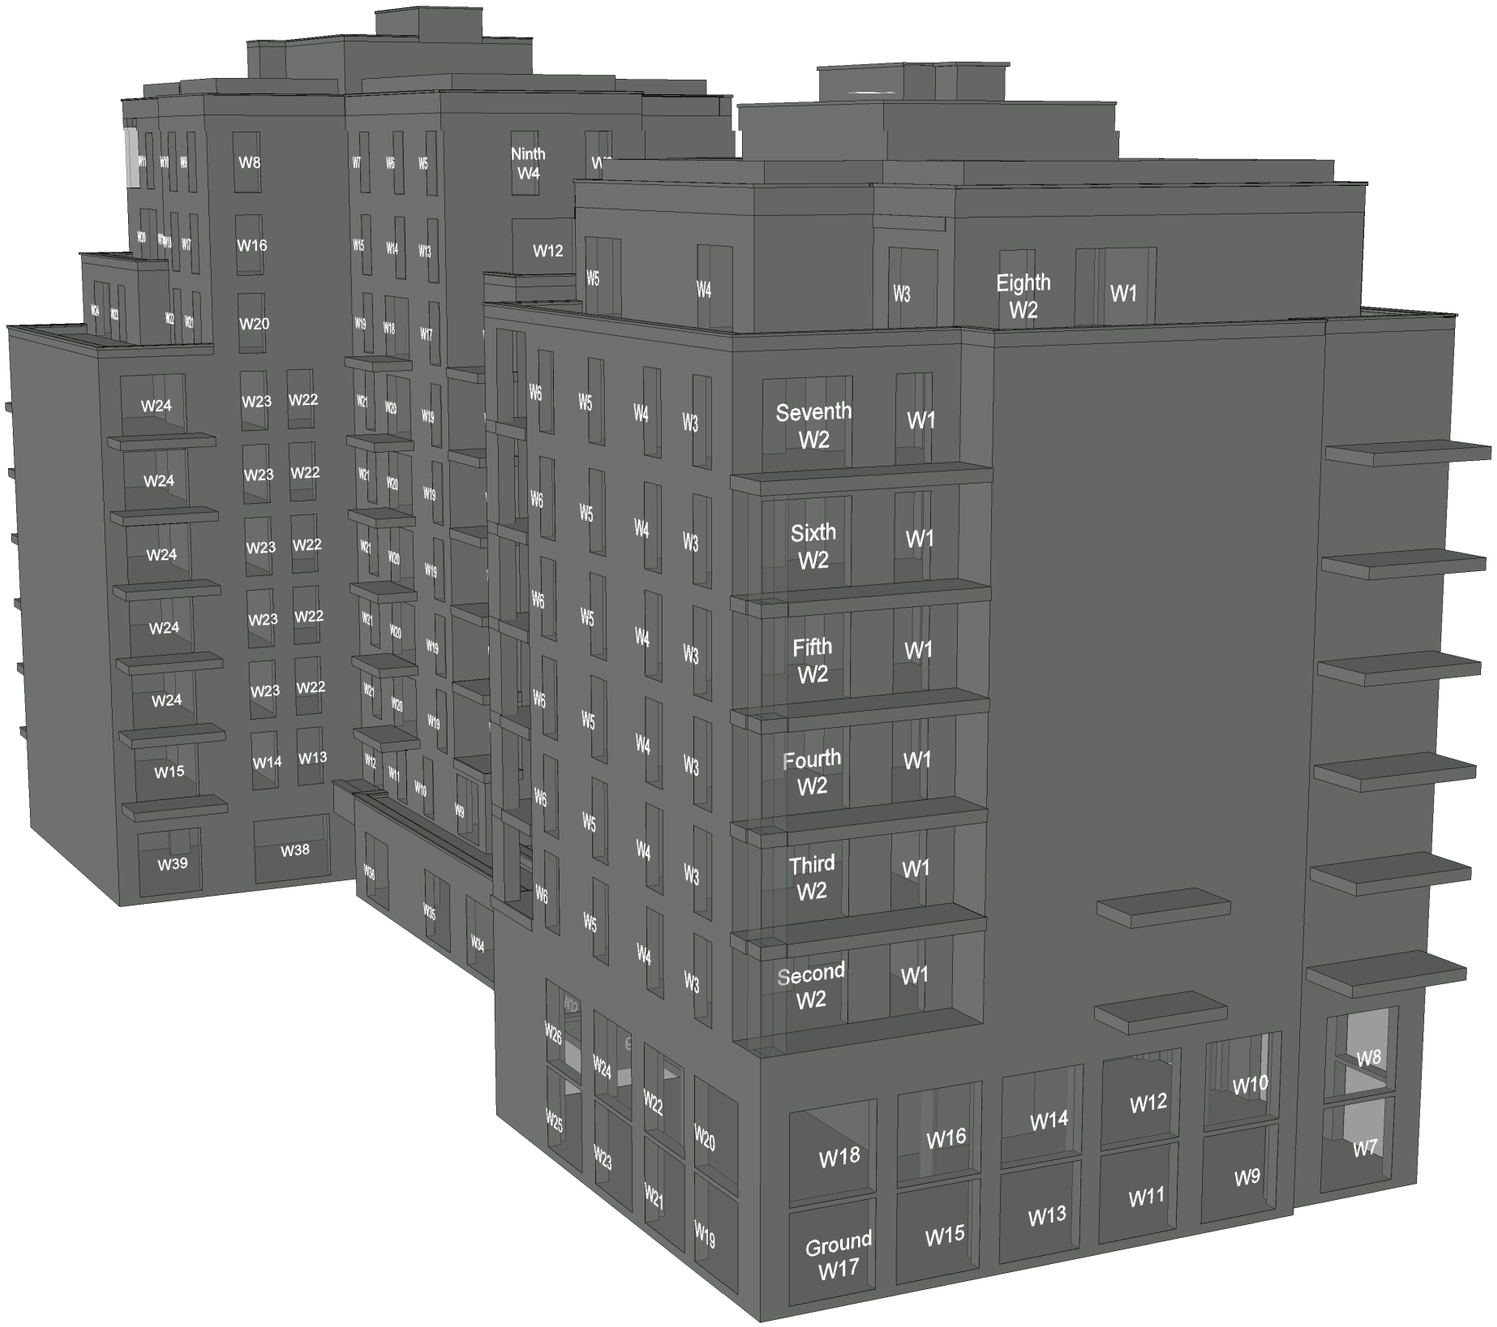

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	Rosa Luxemburg Apartments Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	44



eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: Rosa Luxemburg Apartments Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix: WM01	Page no.	45

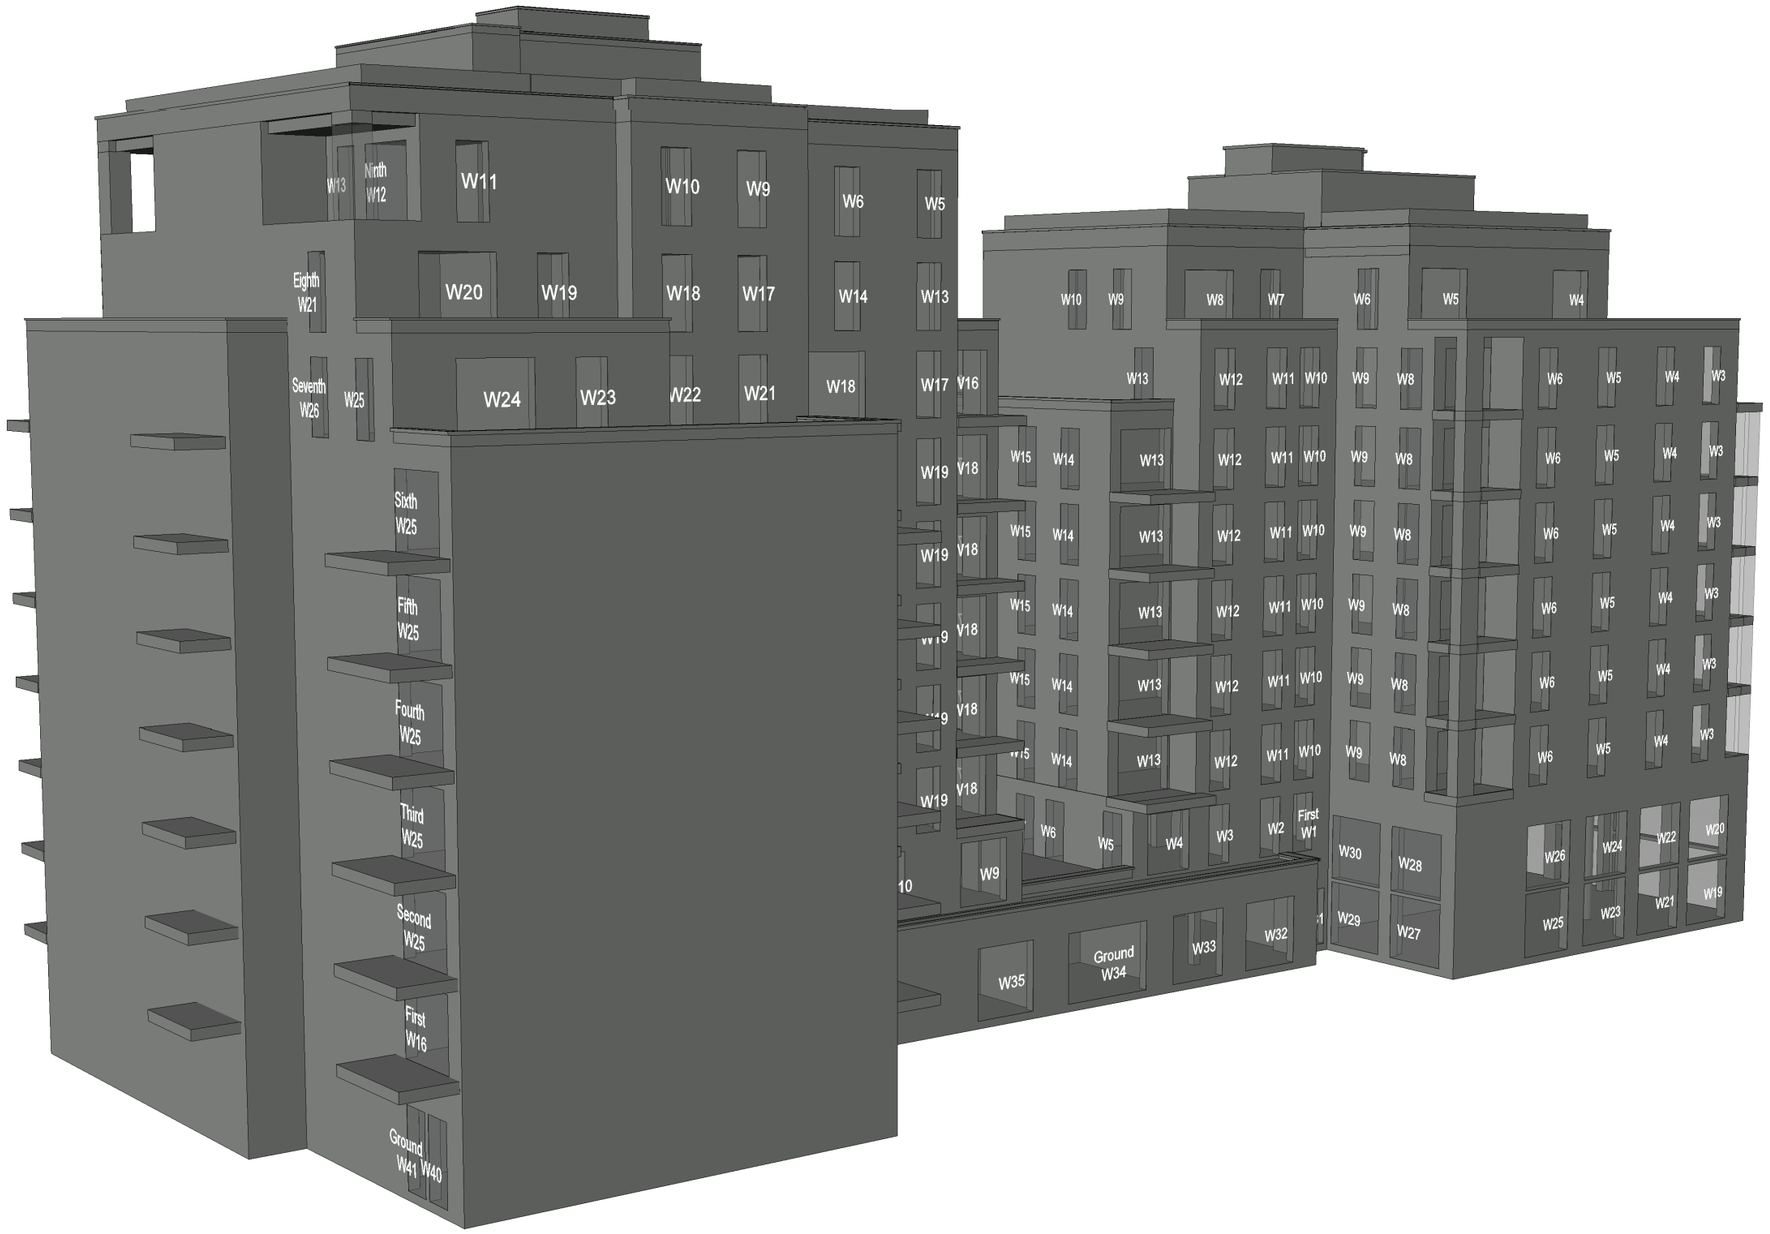

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale		
Title	Rosa Luxemburg Apartments Window Map		
Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	46

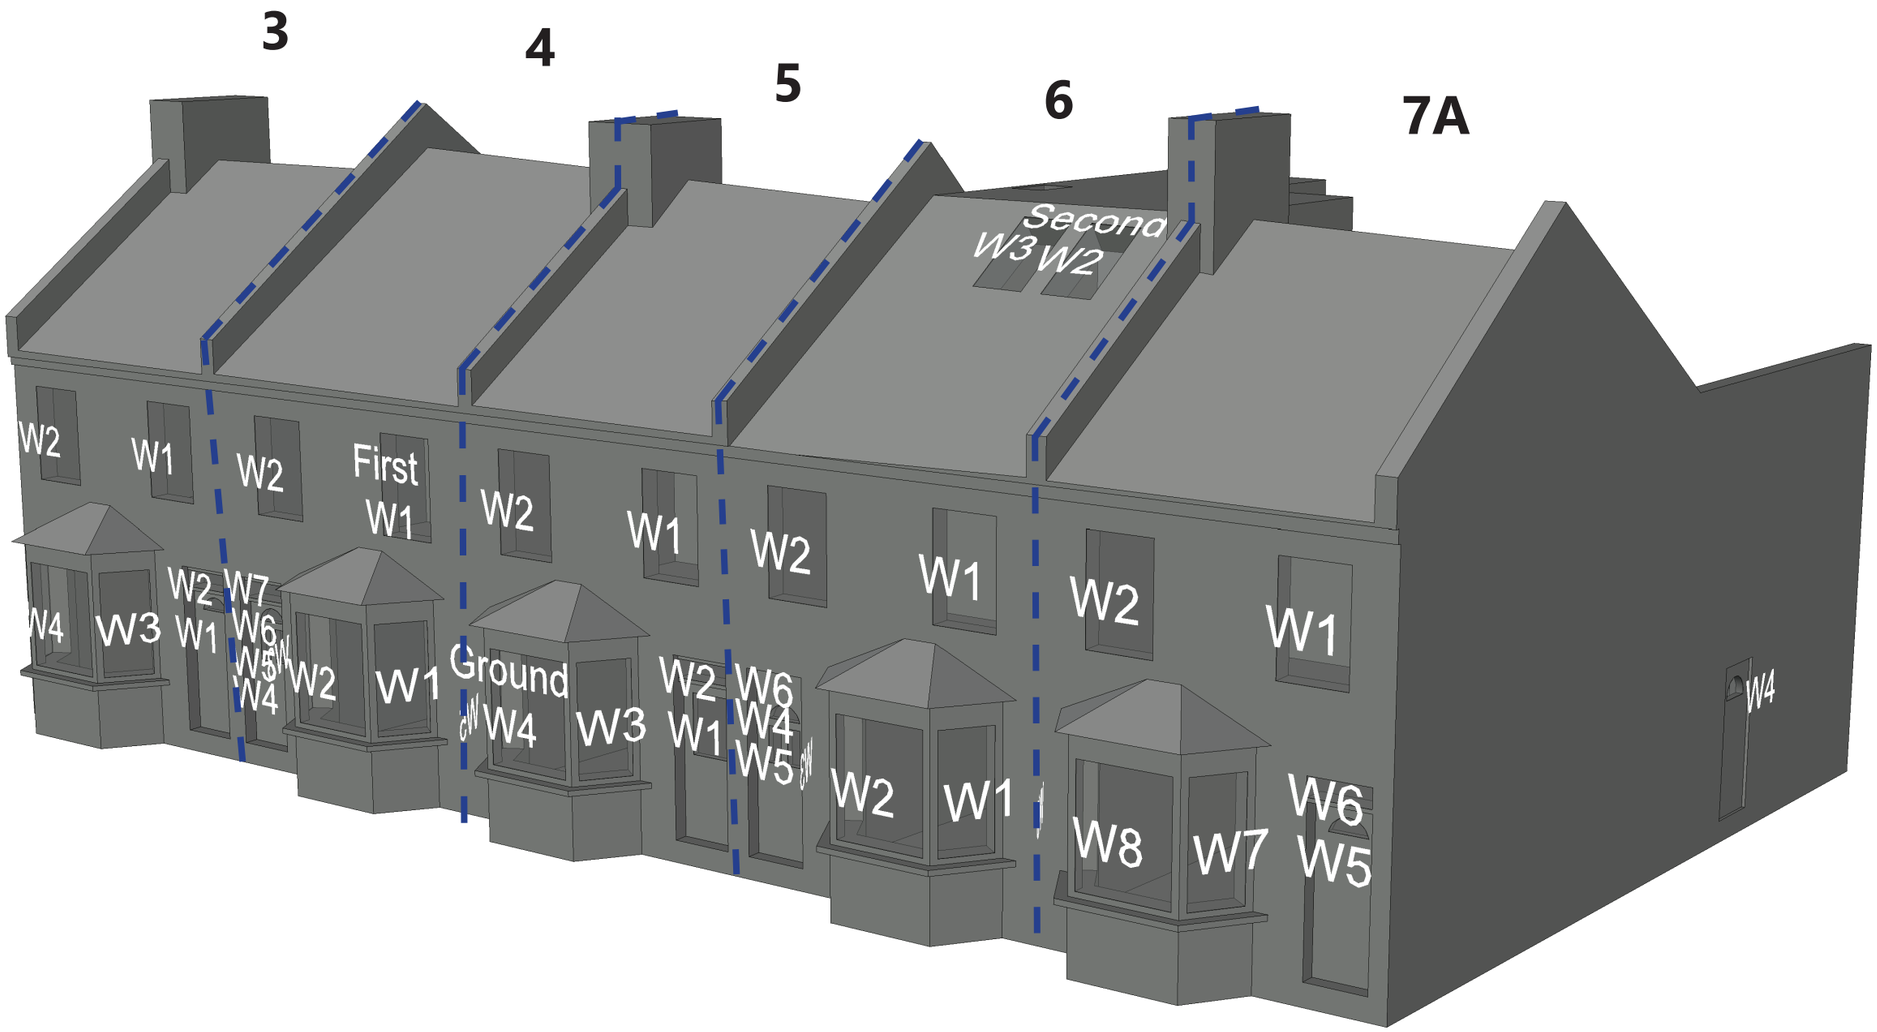

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


EB7 Ltd
Site Photographs
Ordnance Survey



Project: Ashley Road Tottenham Hale

Title: 3-7A Park View Road Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix: WM01	Page no.	47

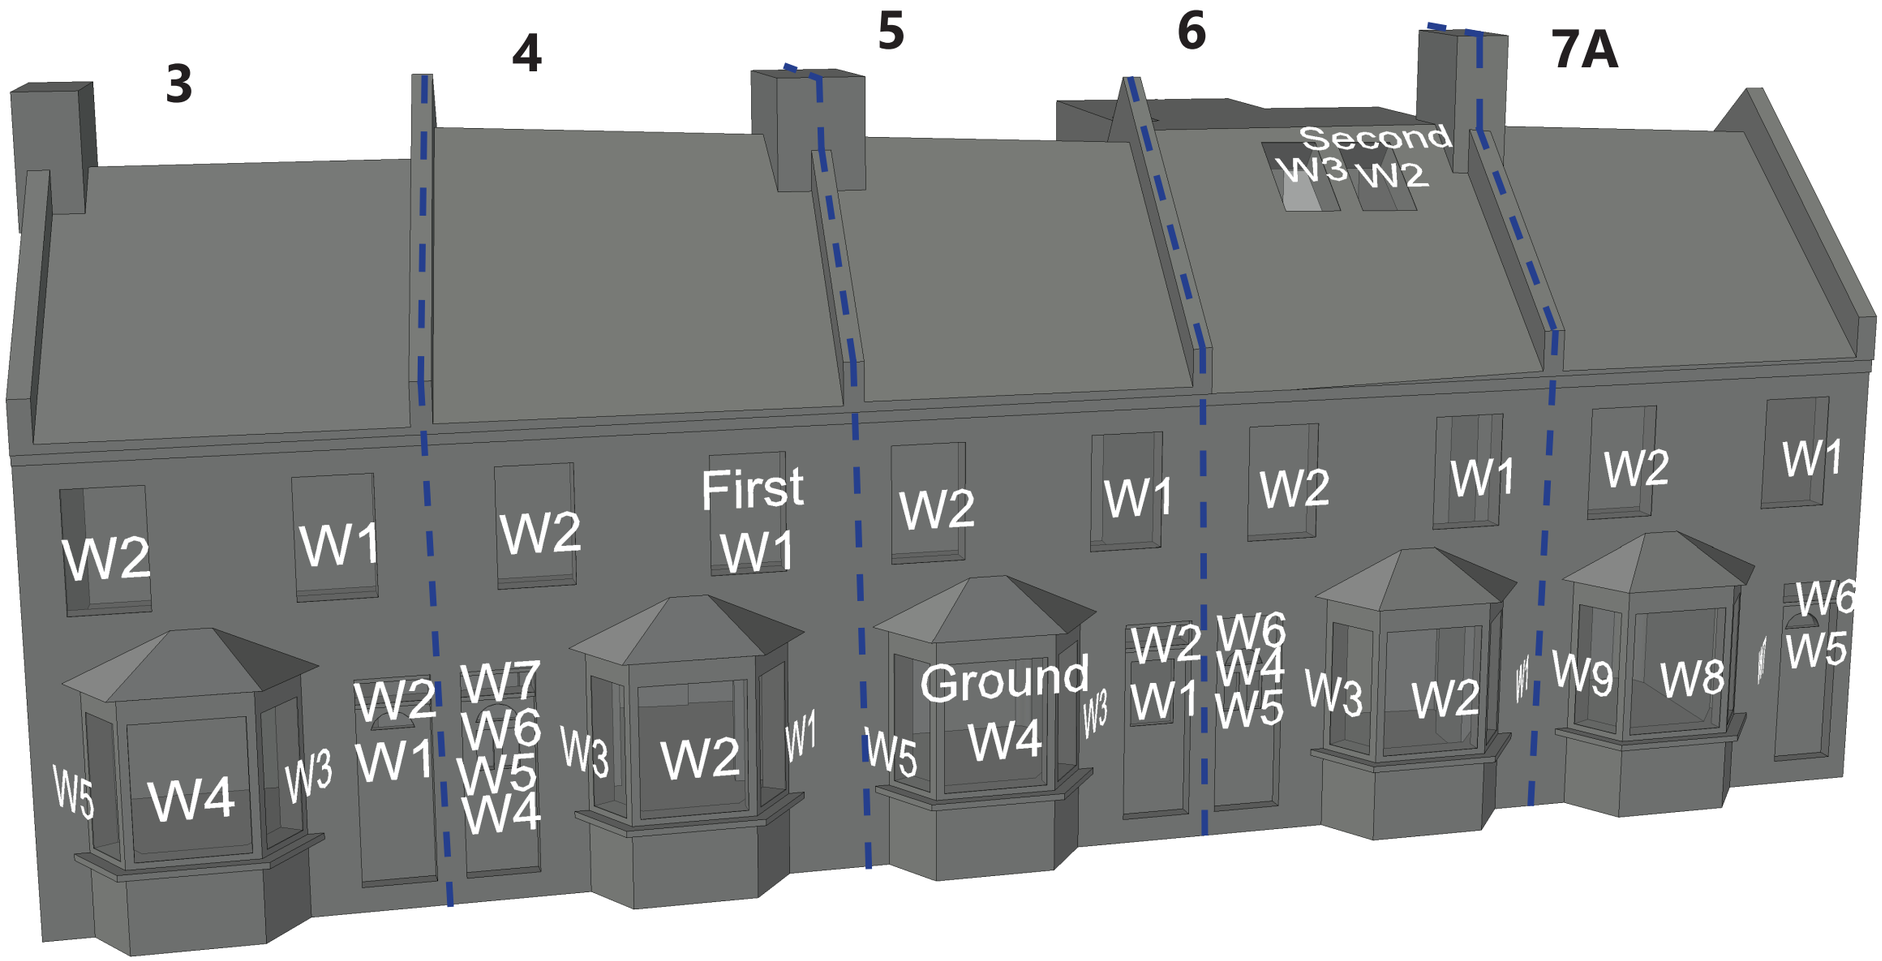

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	3-7A Park View Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	48

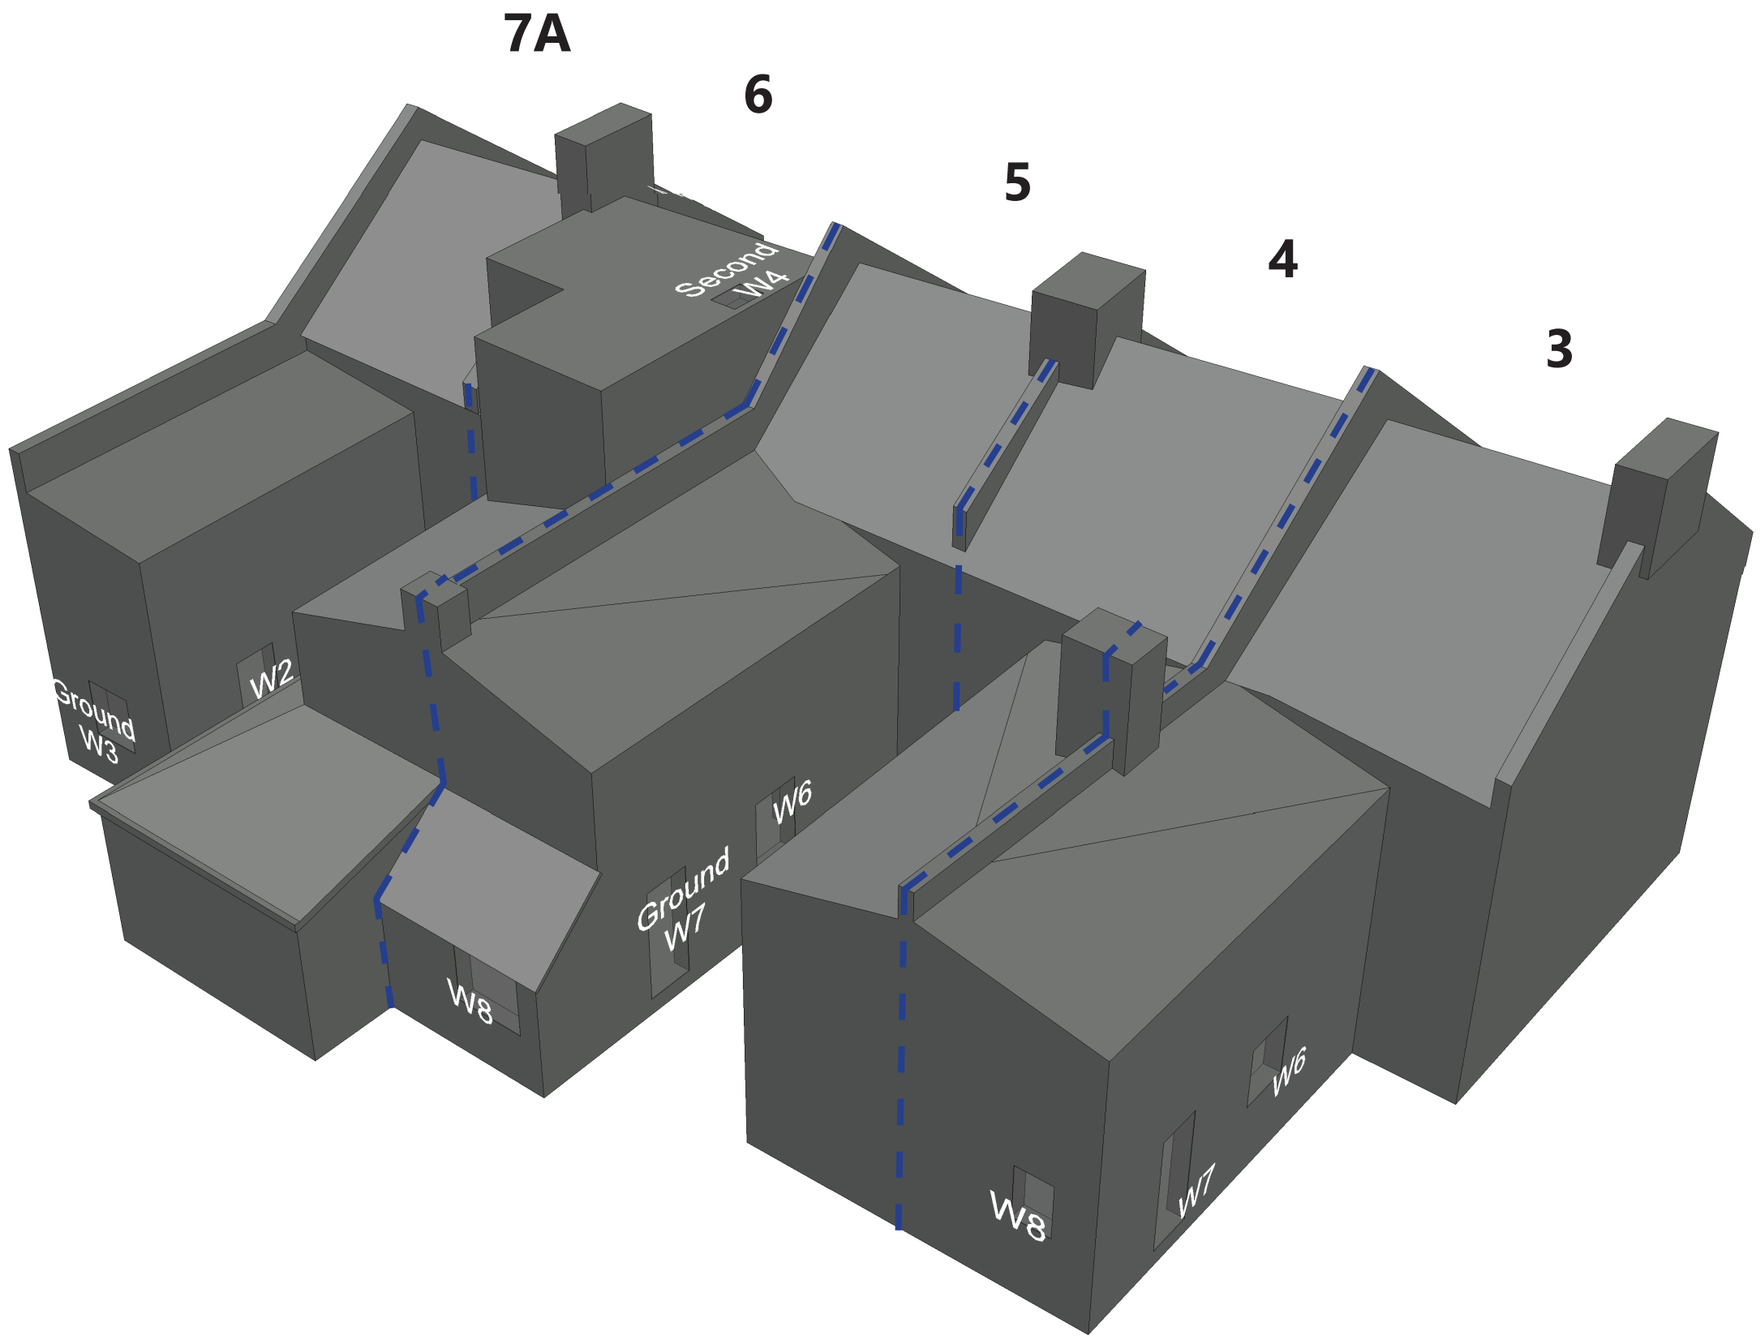

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information


Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	3-7A Park View Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	49

eb7 © copyright 2026

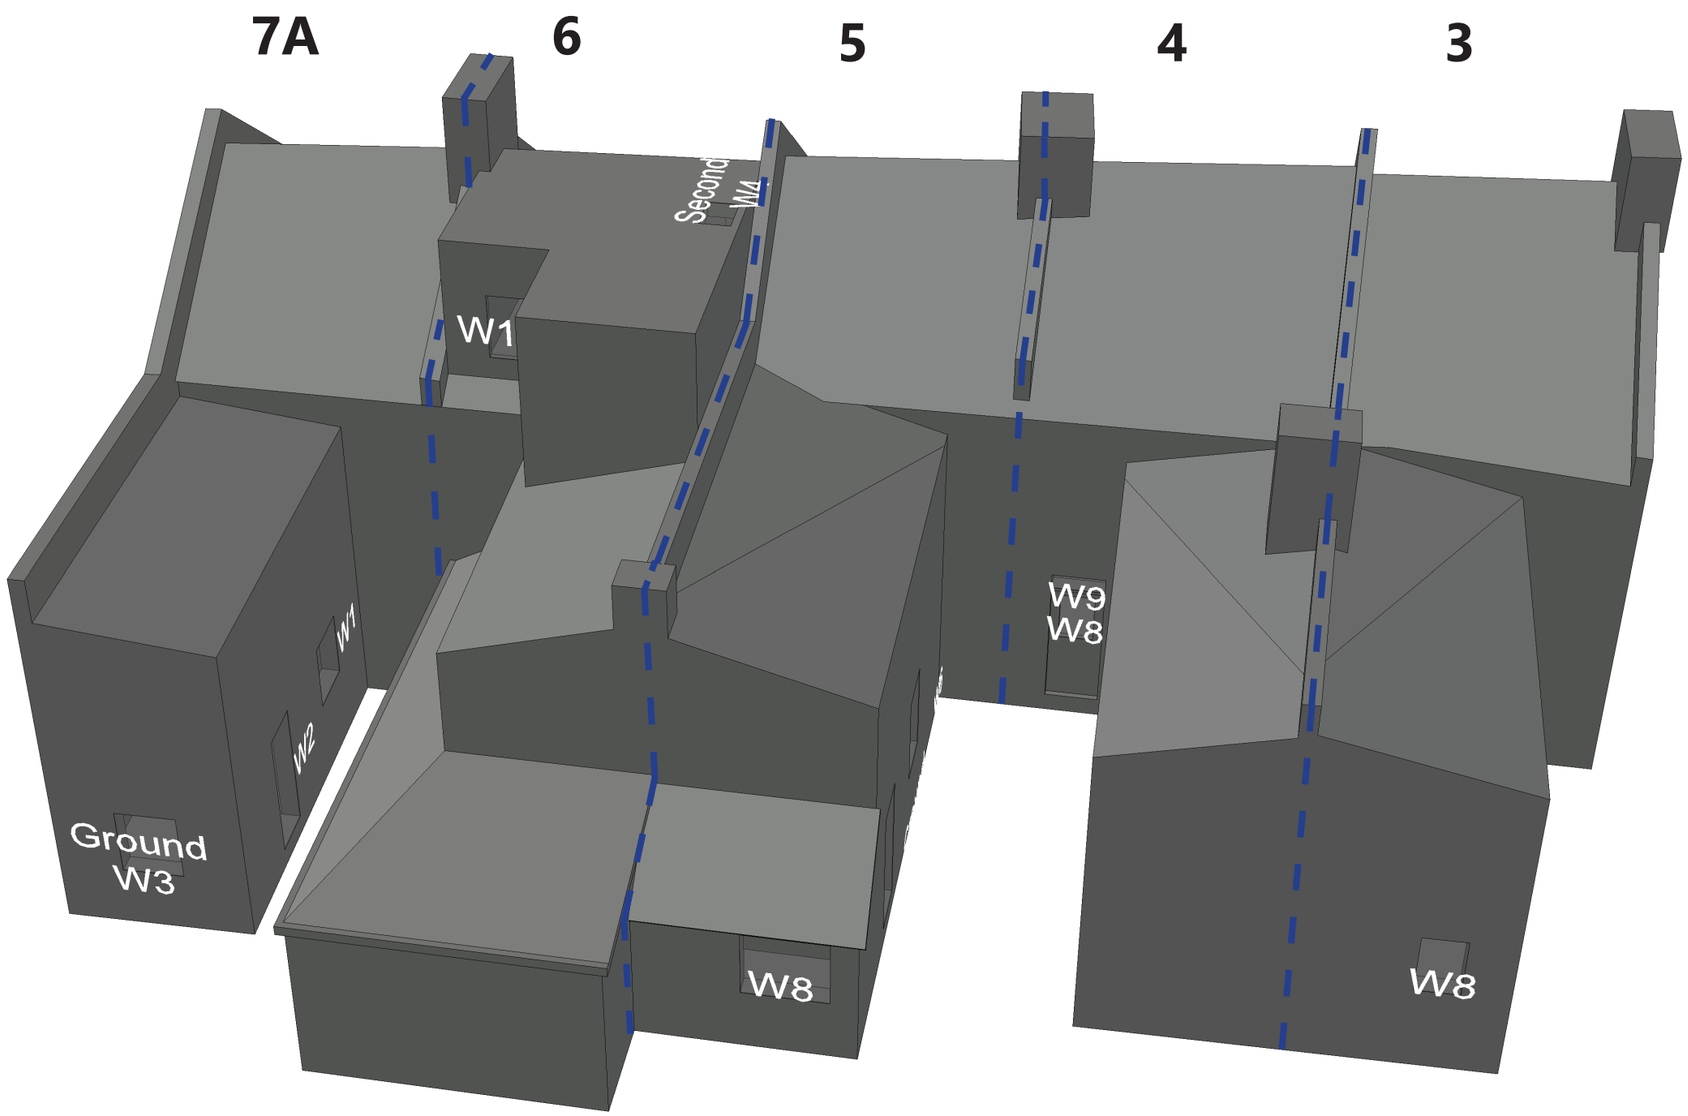

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	3-7A Park View Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	50

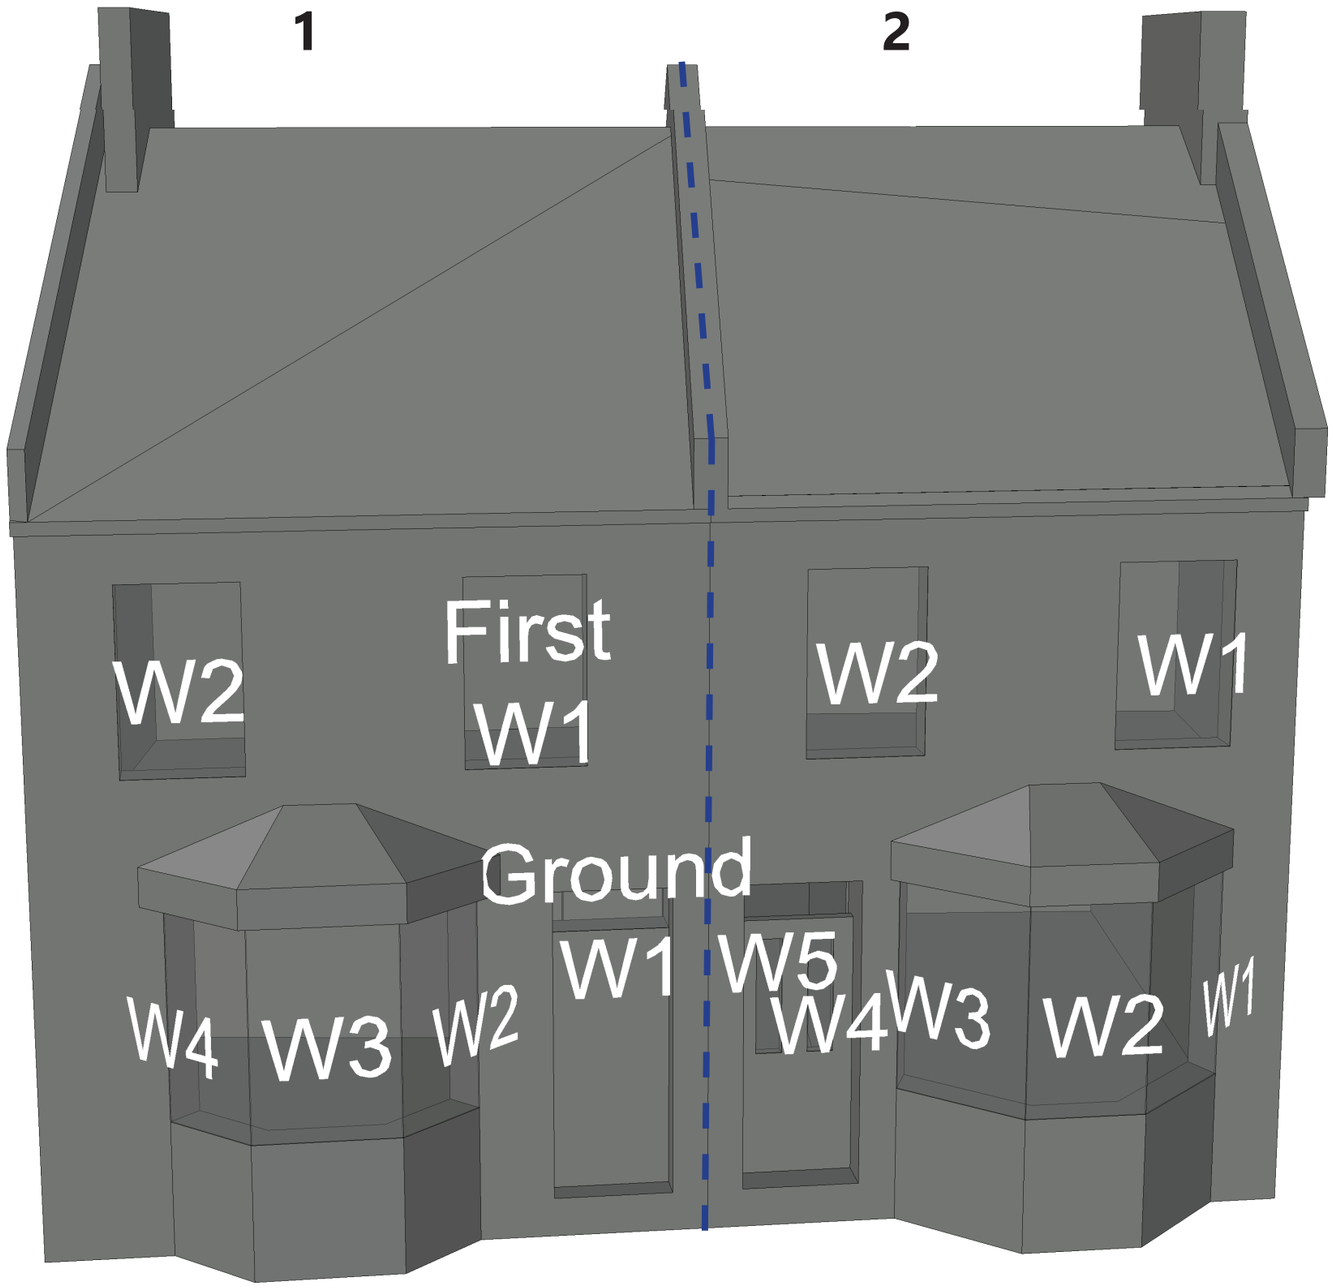

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information


Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	1-2 Park View Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	51

eb7 © copyright 2026

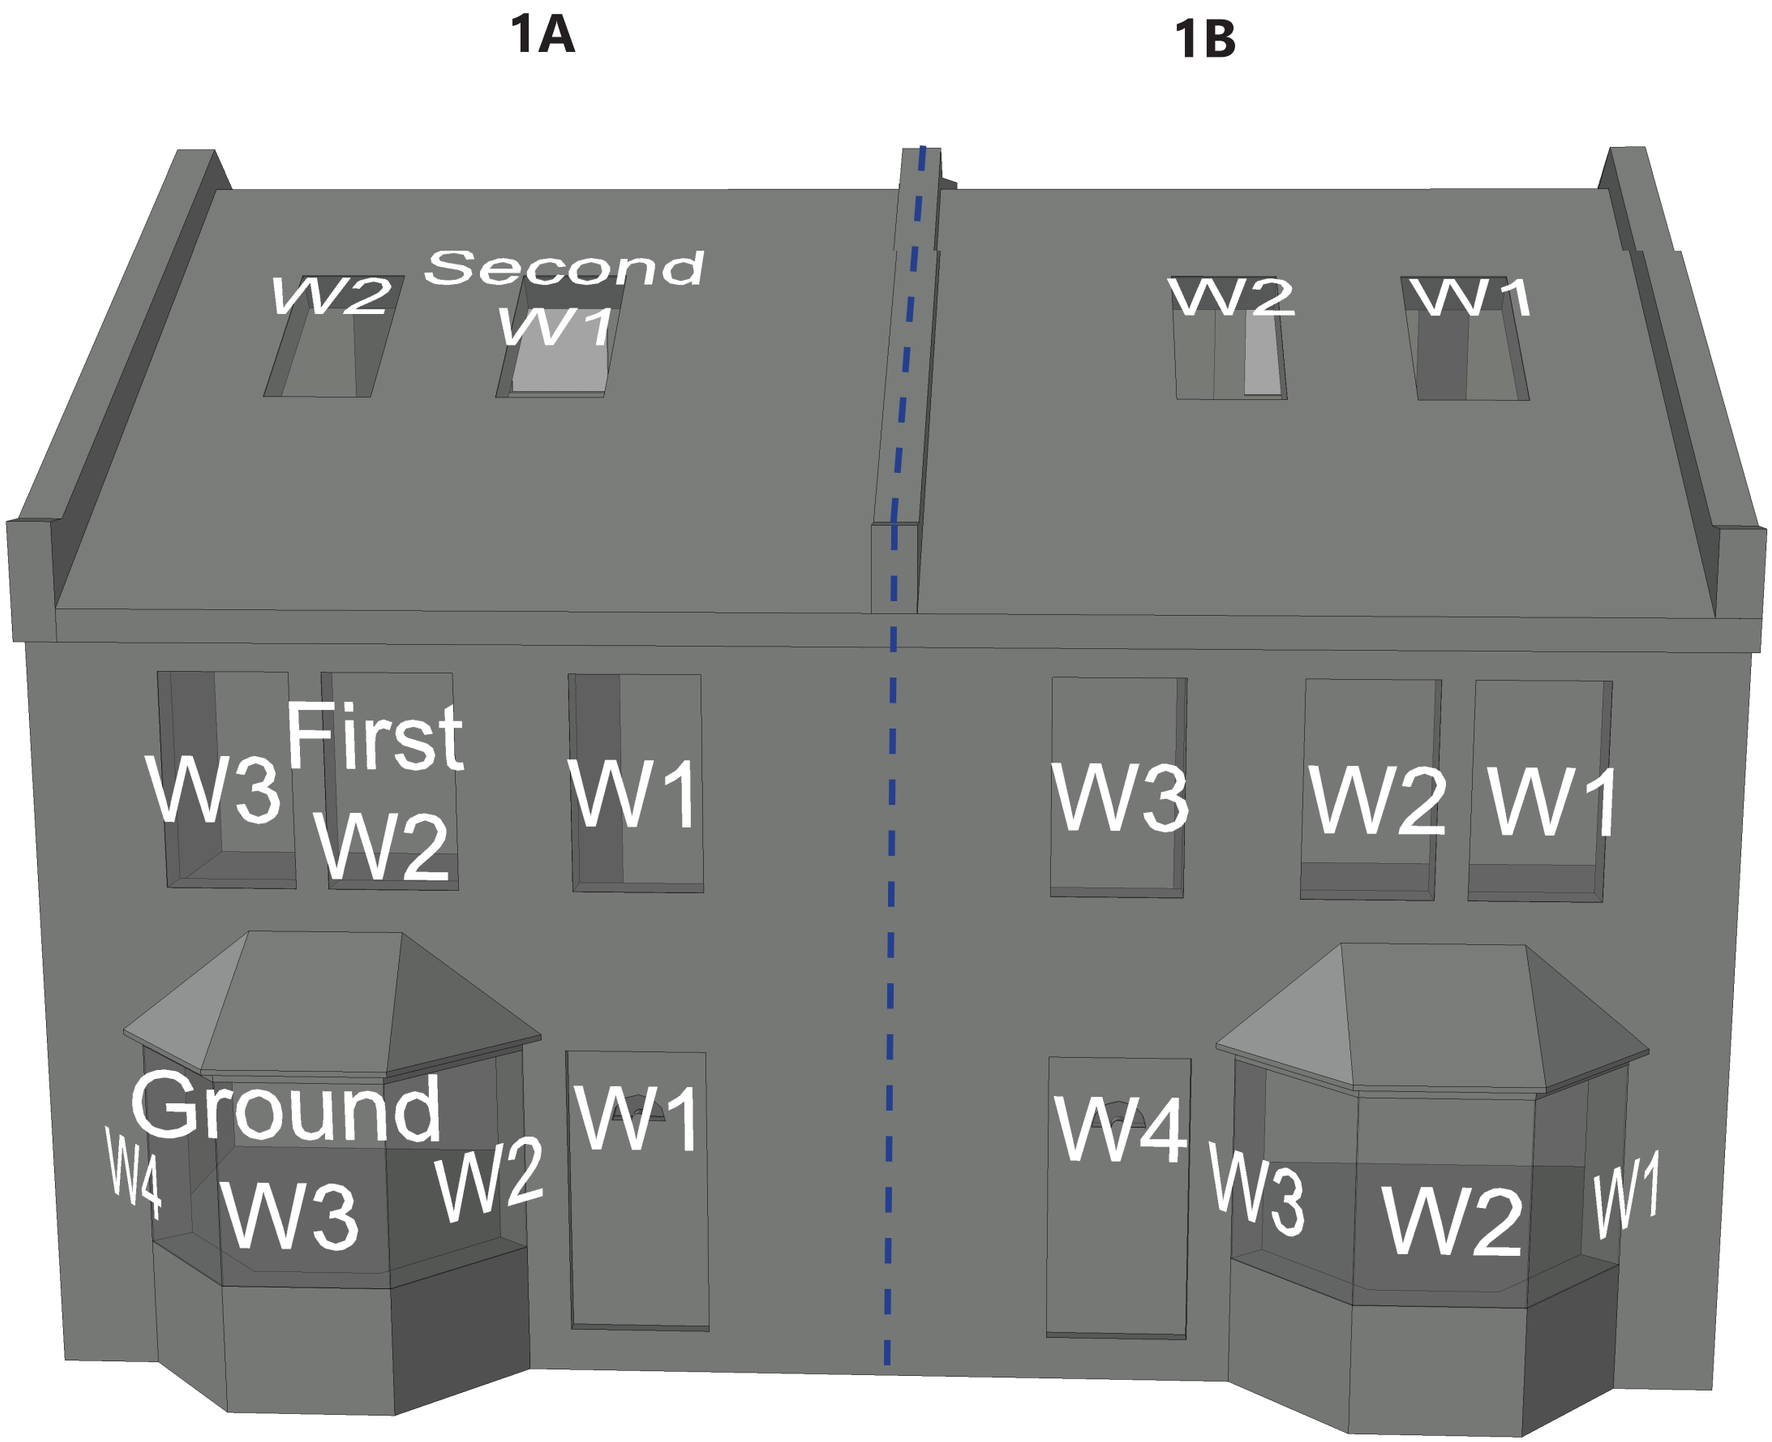

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale		
Title	1A-1B Park View Road Window Map		
Drawn	TR	Checked	--
Date	20/07/2026	Project	10106
Rel no.	Prefix WM01	Page no.	52

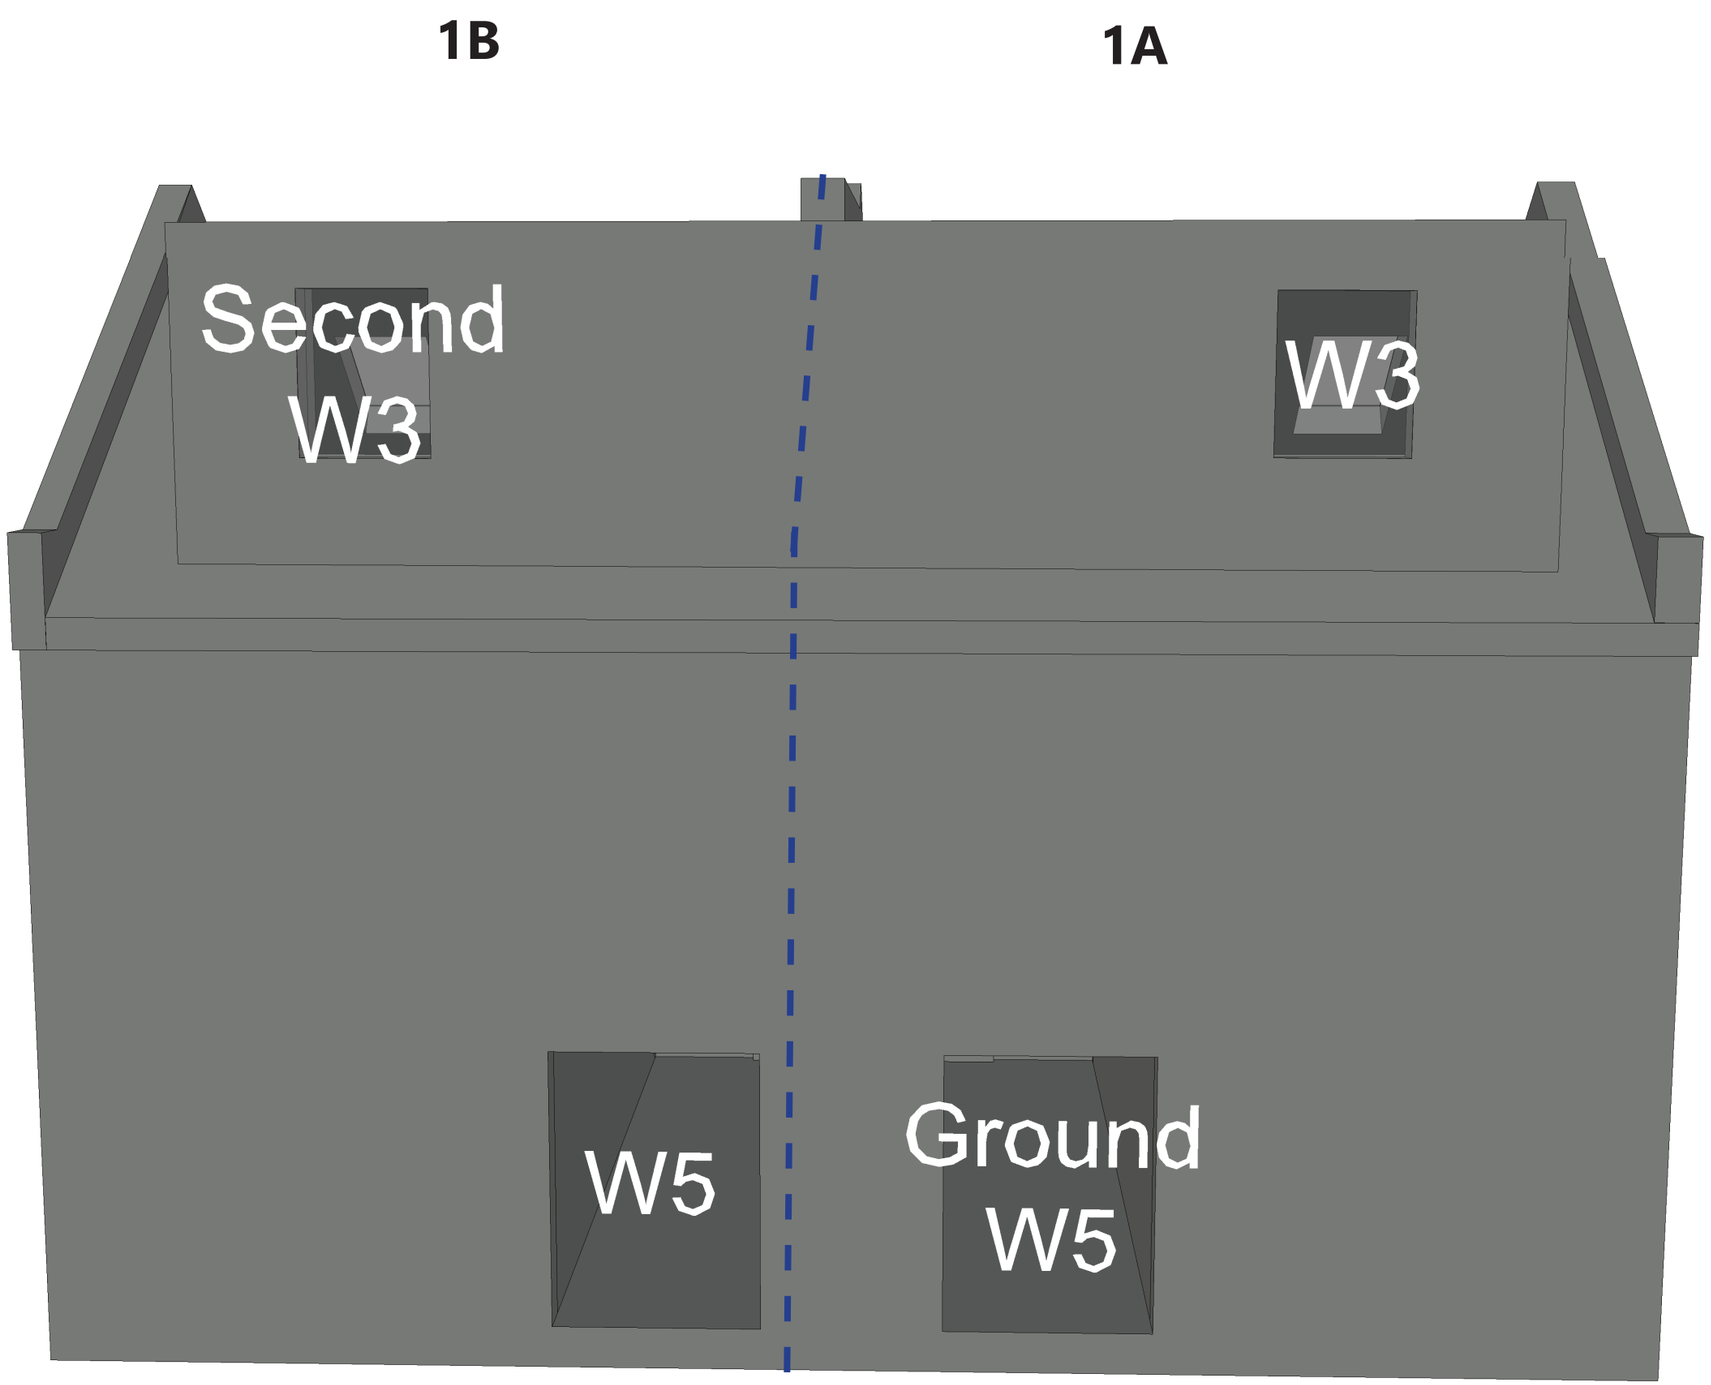

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	1A-1B Park View Road Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	53

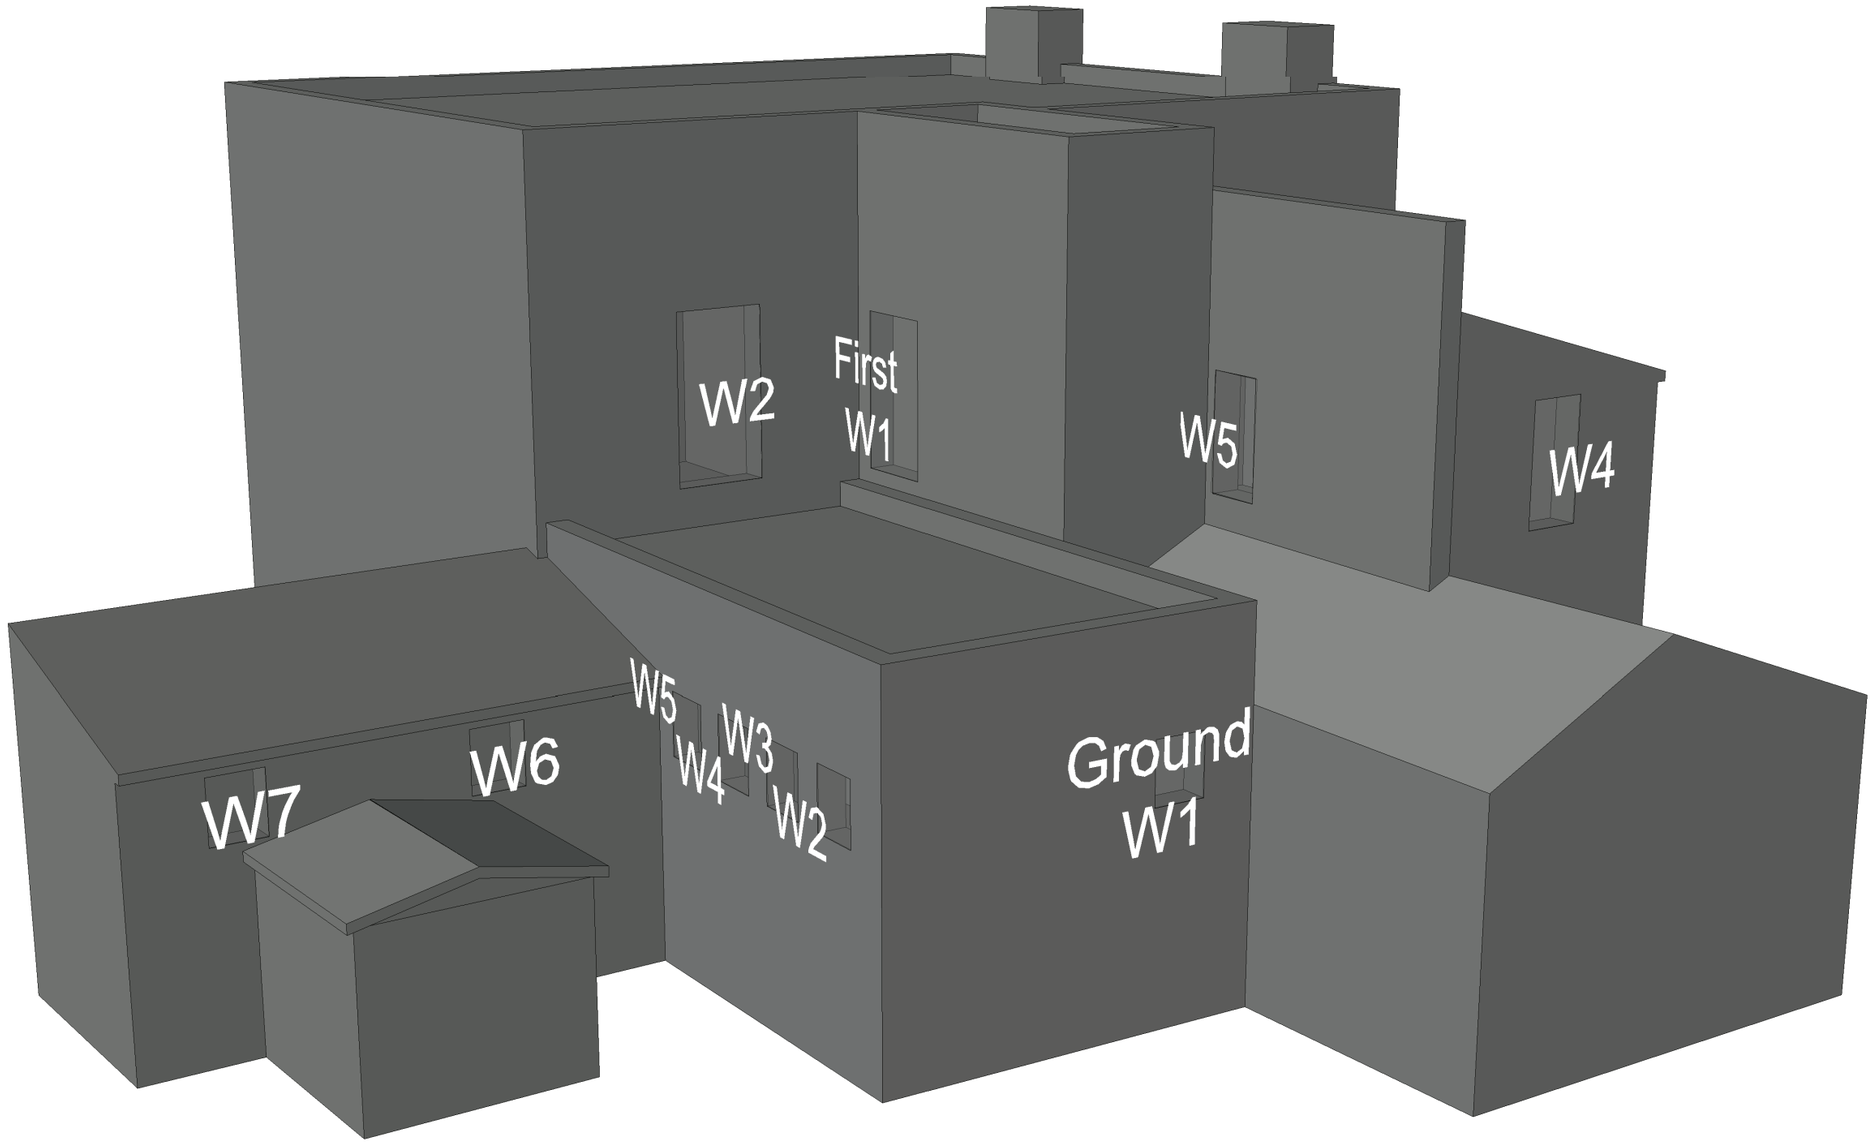

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey




Project: Ashley Road Tottenham Hale

Title: The Volunteer Window Map

Drawn	TR	Checked	--
Date	20/07/2026	Project	10106

Rel no.	Prefix	Page no.
	WM01	54

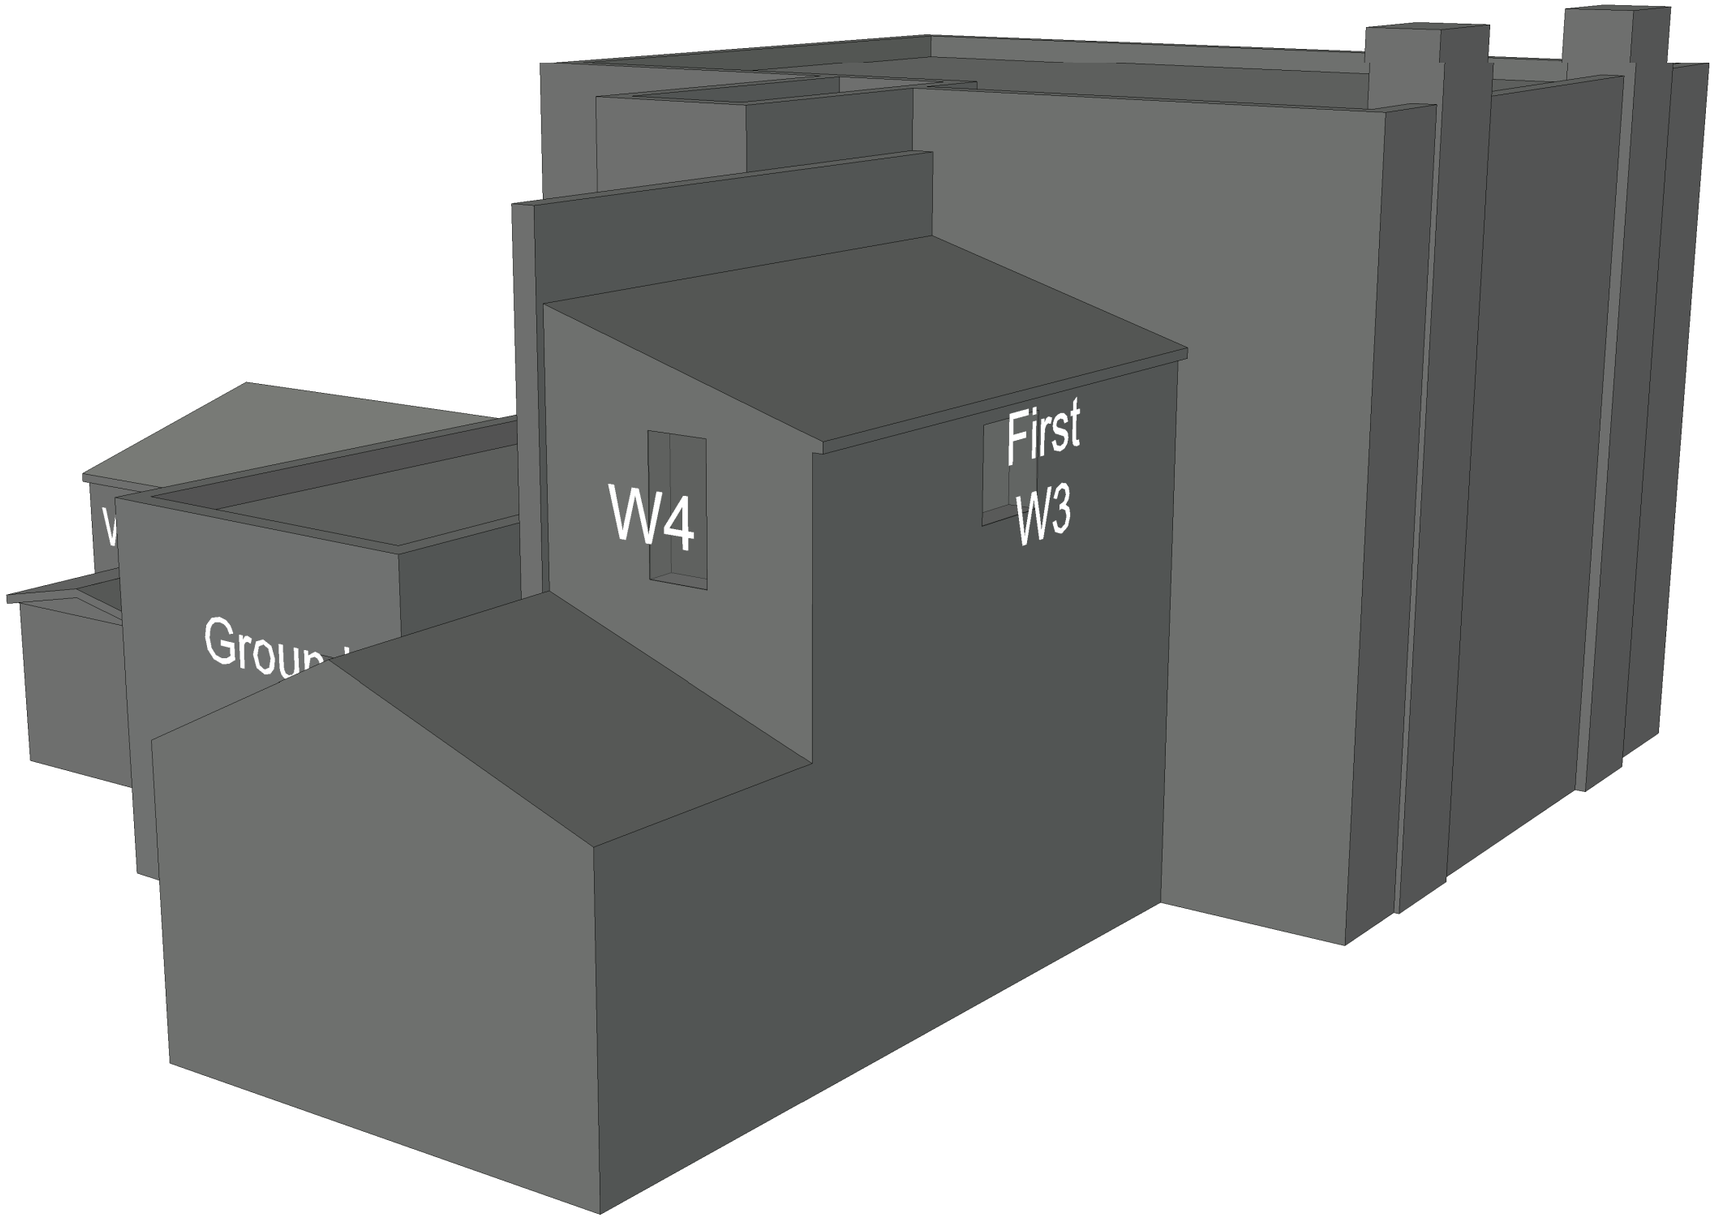

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information


Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project	Ashley Road Tottenham Hale
Title	The Volunteer Window Map
Drawn	TR
Checked	--
Date	20/07/2026
Project	10106
Rel no.	
Prefix	WM01
Page no.	55

Future Baseline Scenario

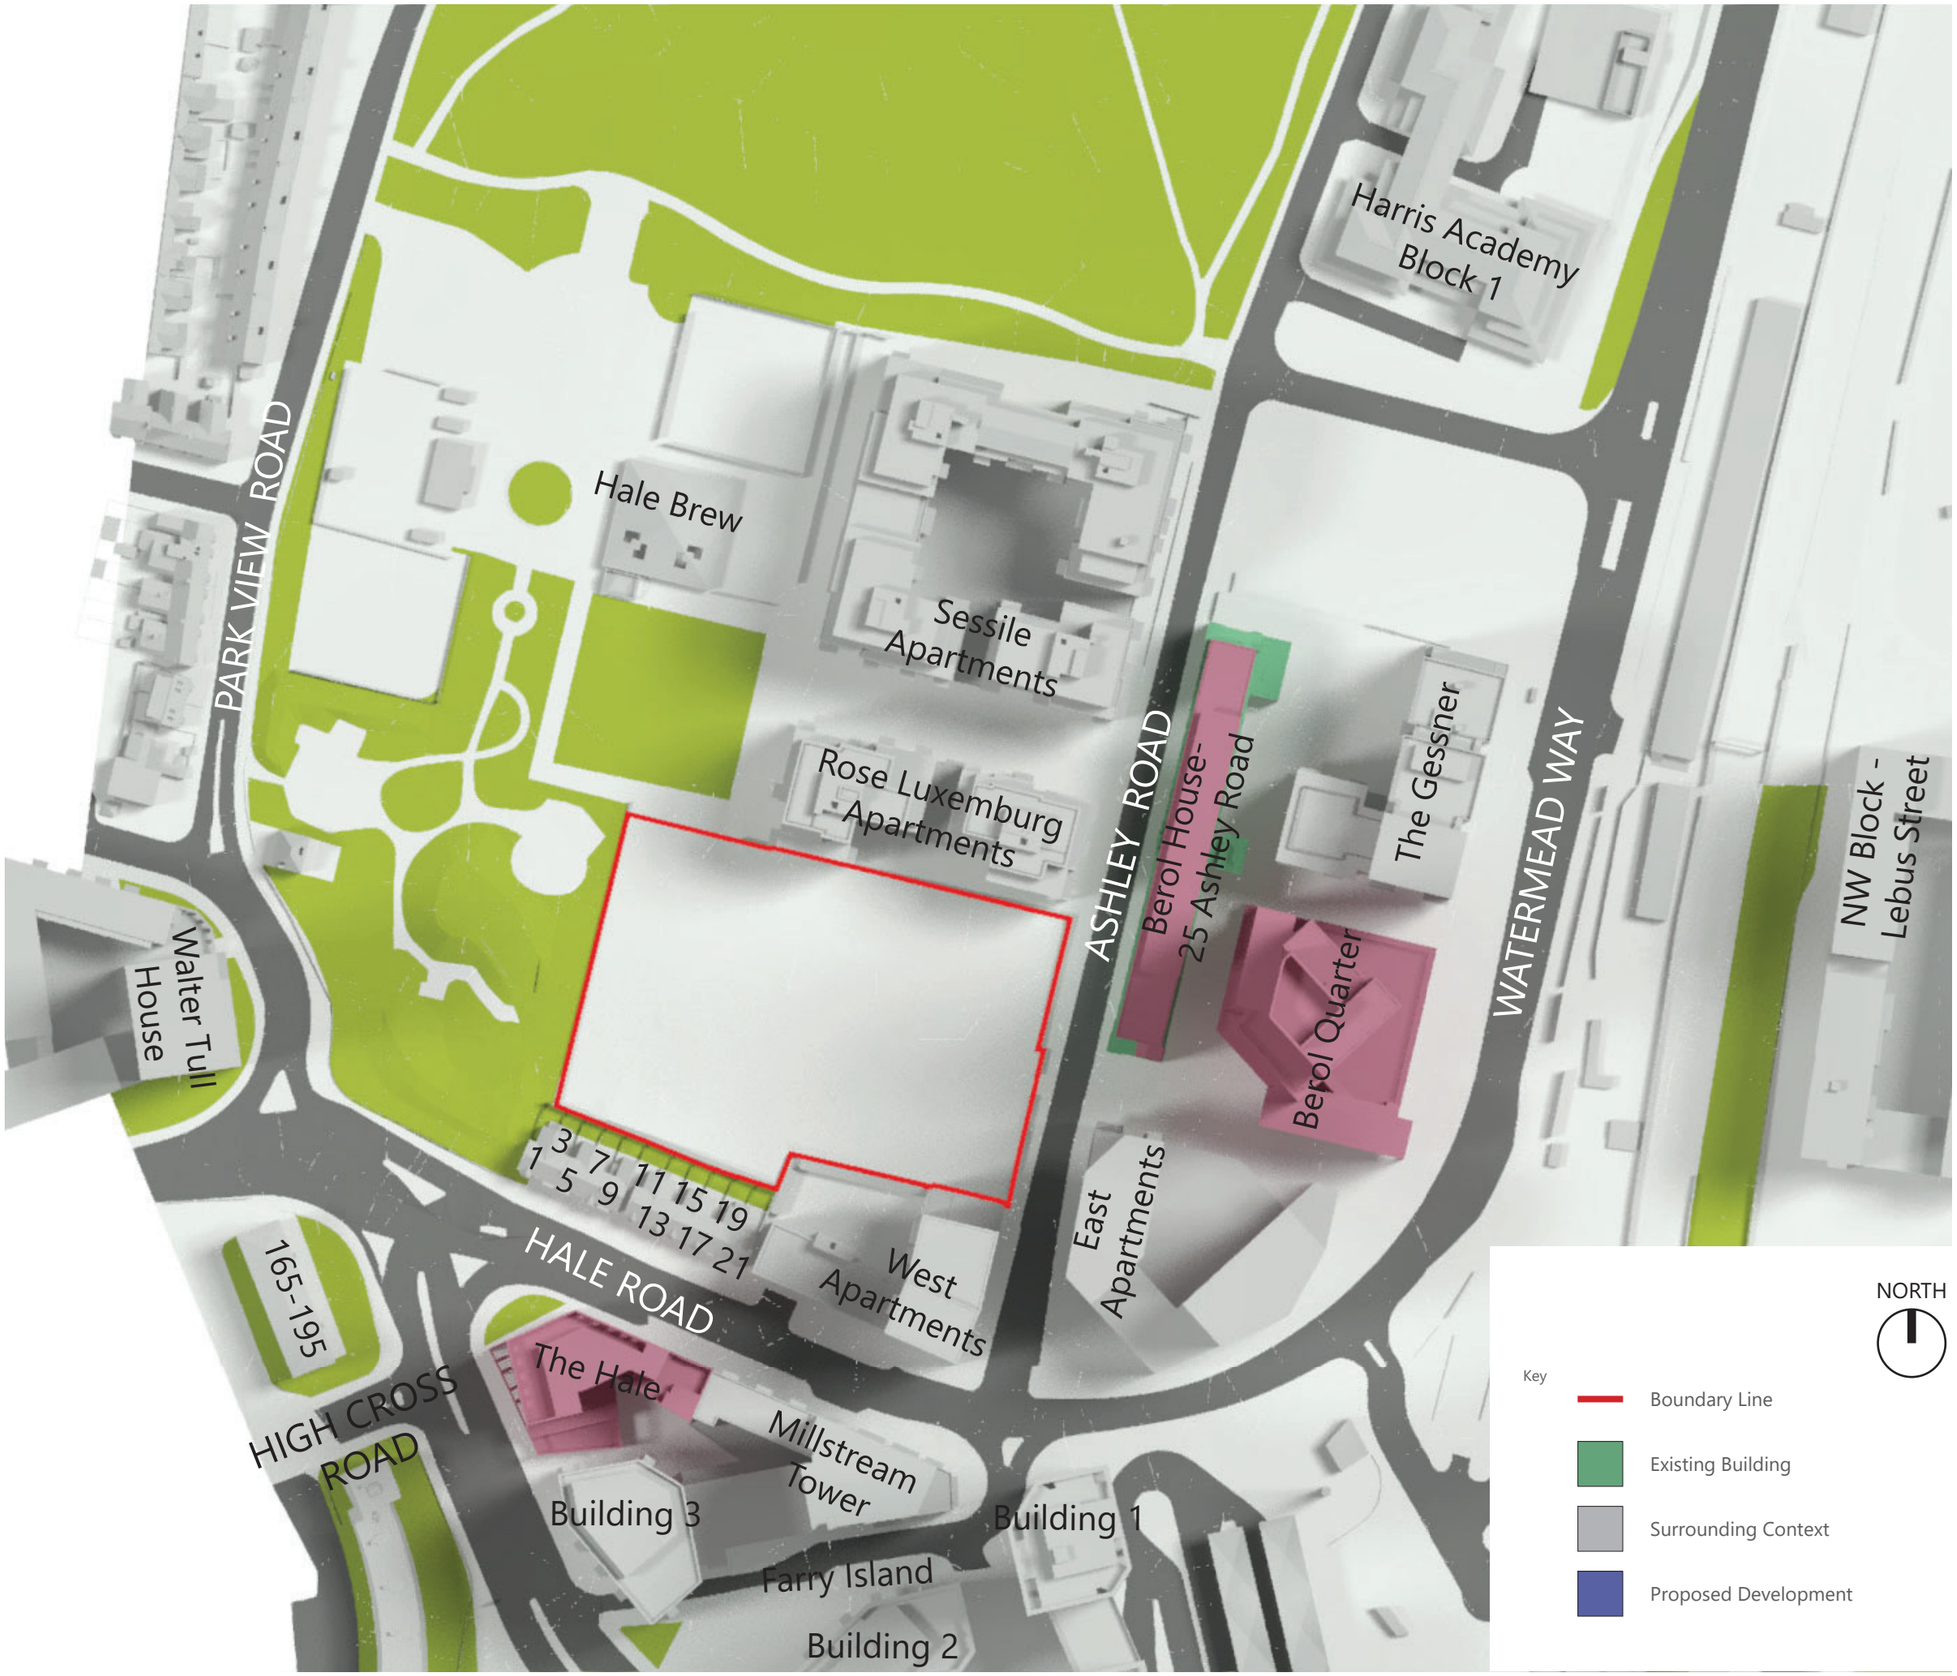

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey


NORTH

Key
- Cumulative Development
- Existing Building
- Surrounding Context
- Proposed Development

Project: Ashley Road Tottenham Hale

Title: Existing Condition Plan View

Drawn	TR	Checked	--
Date	08/08/2026	Project	10106
Rel no.	Prefix	Page no.	
08	DS03		01

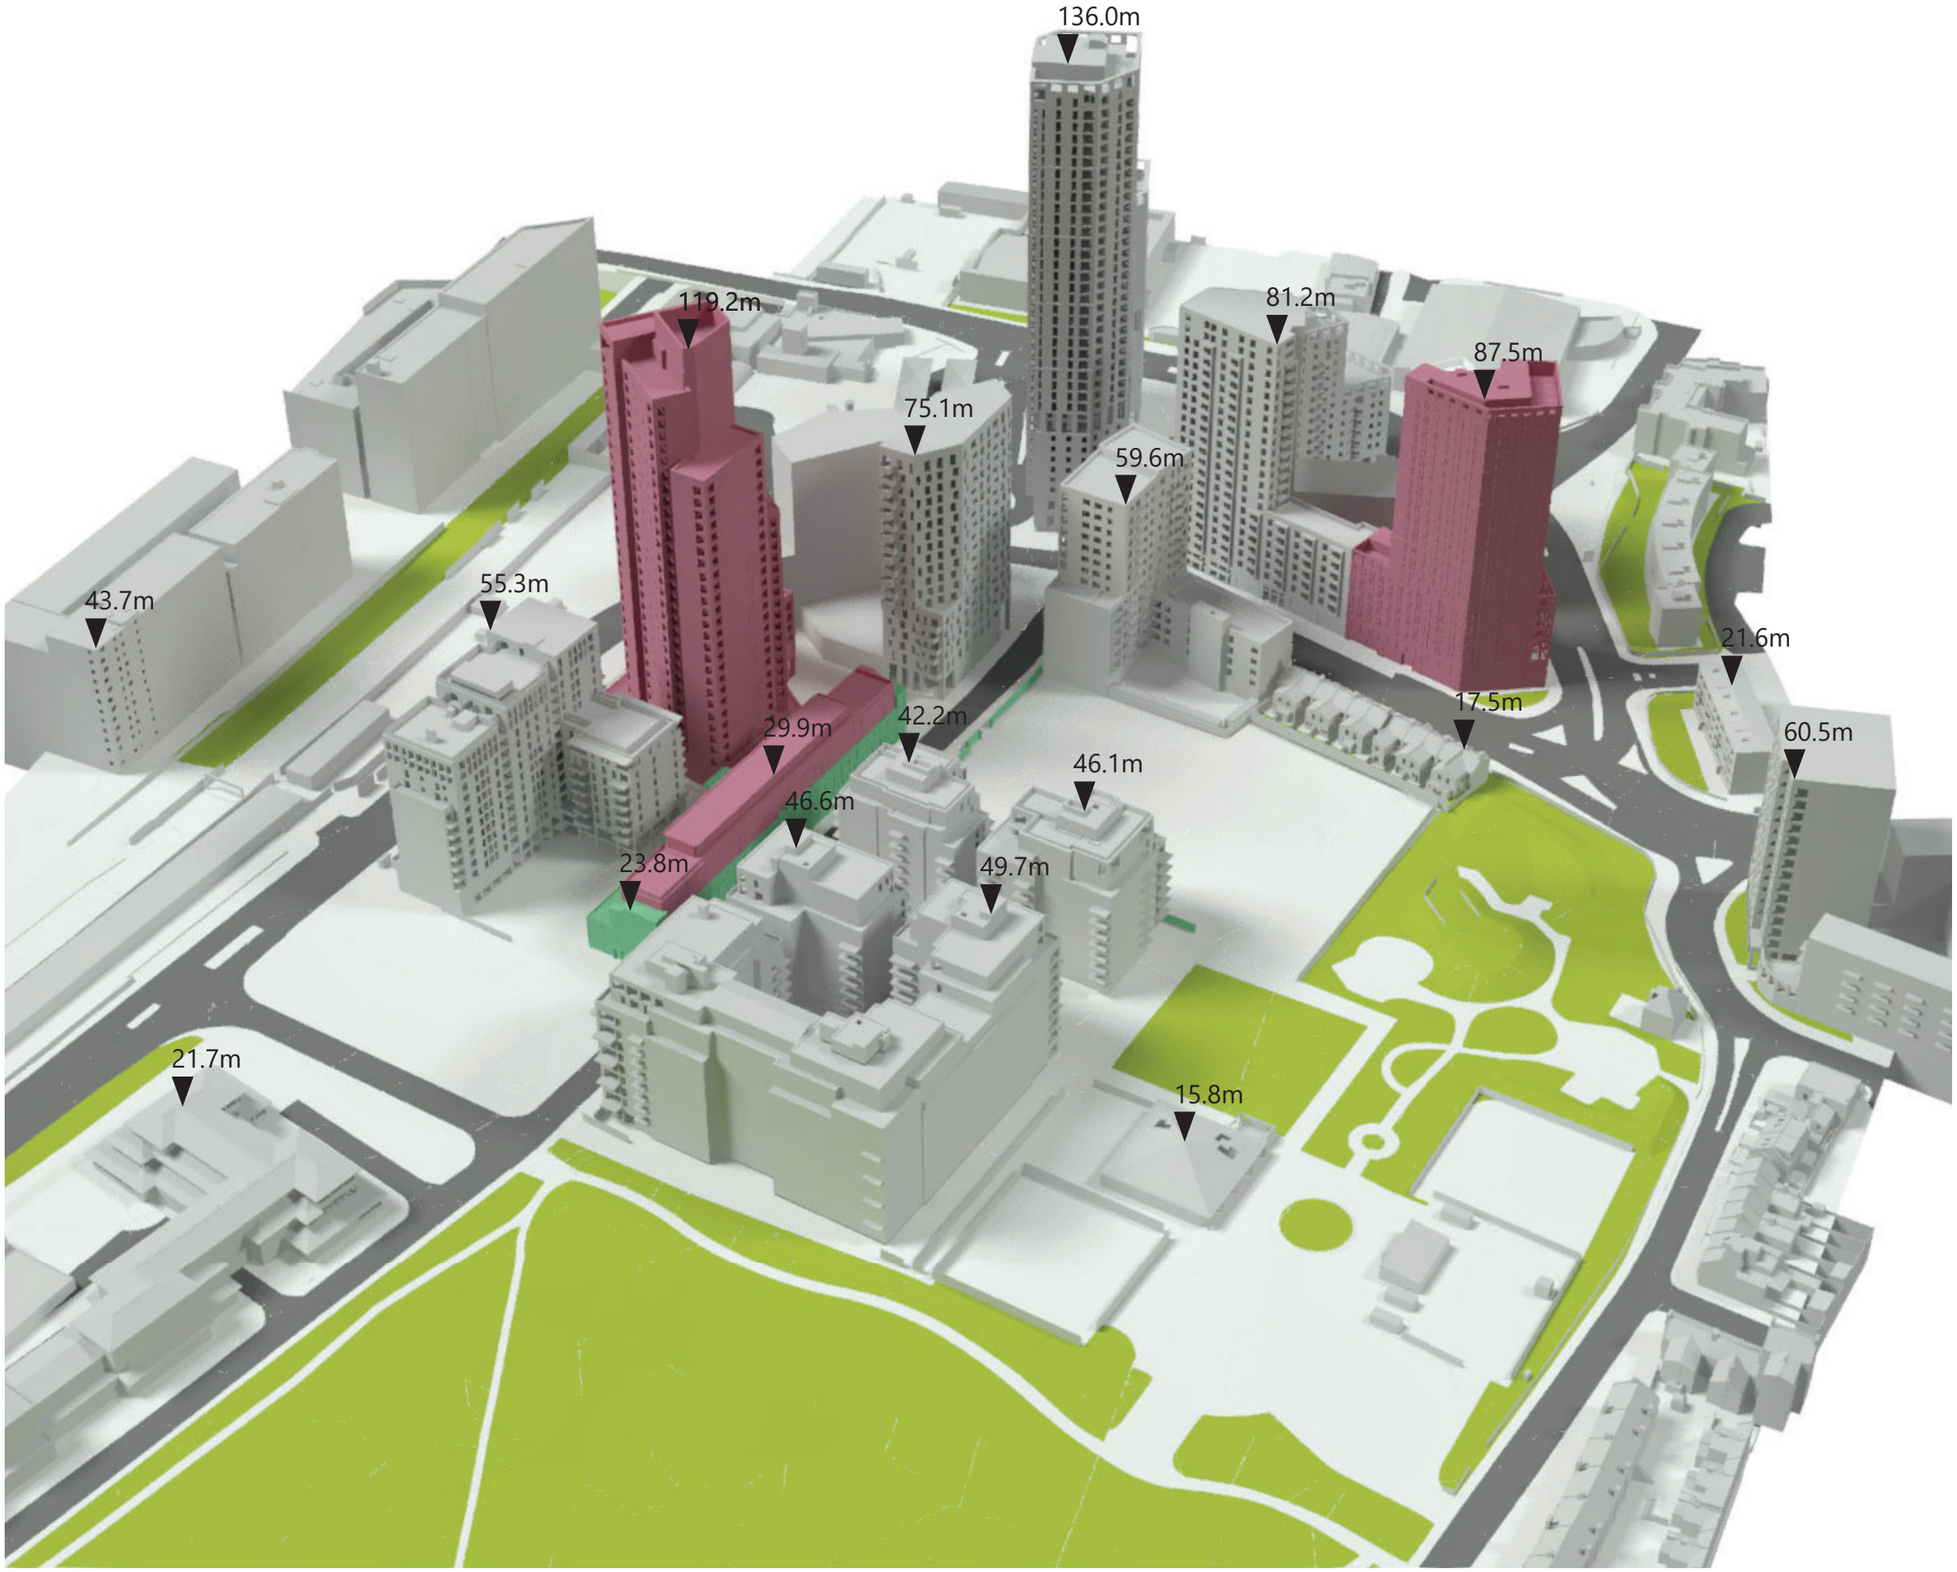

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Key

- Cumulative Development
- Existing Building
- Surrounding Context
- Proposed Development


Project: Ashley Road
Tottenham Hale

Title: Existing Condition
3D View

Drawn	TR	Checked	--
Date	08/08/2026	Project	10106

Rel no.	Prefix	Page no.
08	DS03	02

Cumulative Scenario

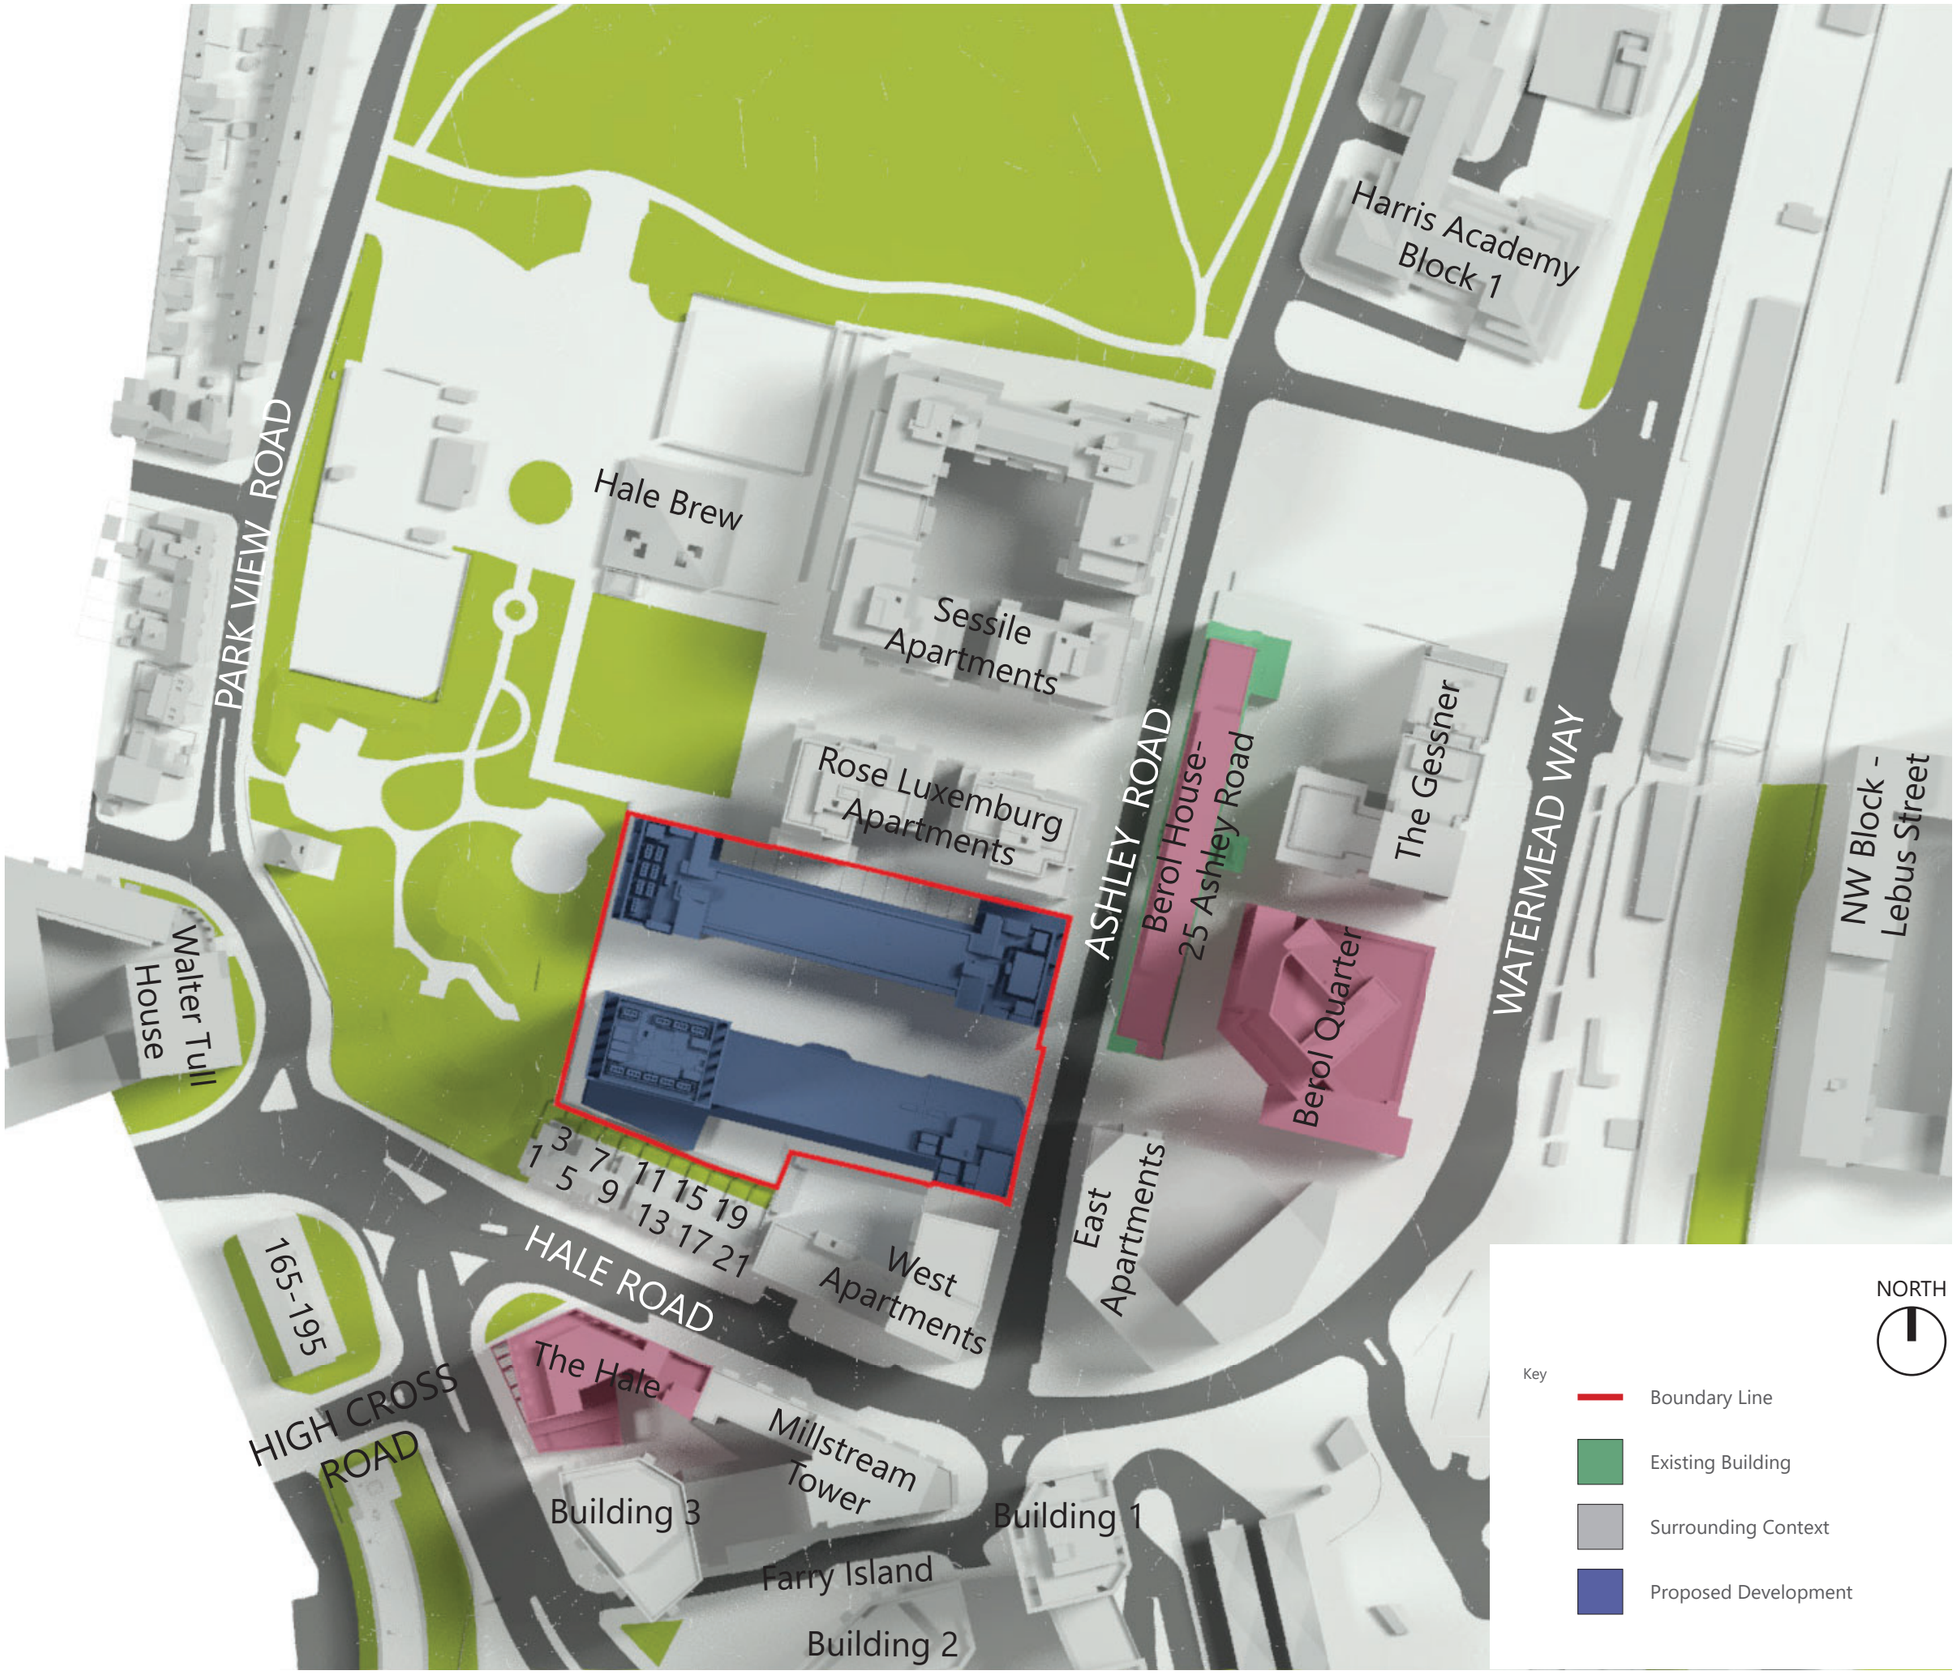

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey


NORTH

Key
- Cumulative Development
- Existing Building
- Surrounding Context
- Proposed Development

Project: Ashley Road Tottenham Hale

Title: Proposed Development Plan View

Drawn	Checked
TR	--
Date	Project
08/08/2026	10106
Rel no.	Prefix / Page no.
08	DS03 / 03

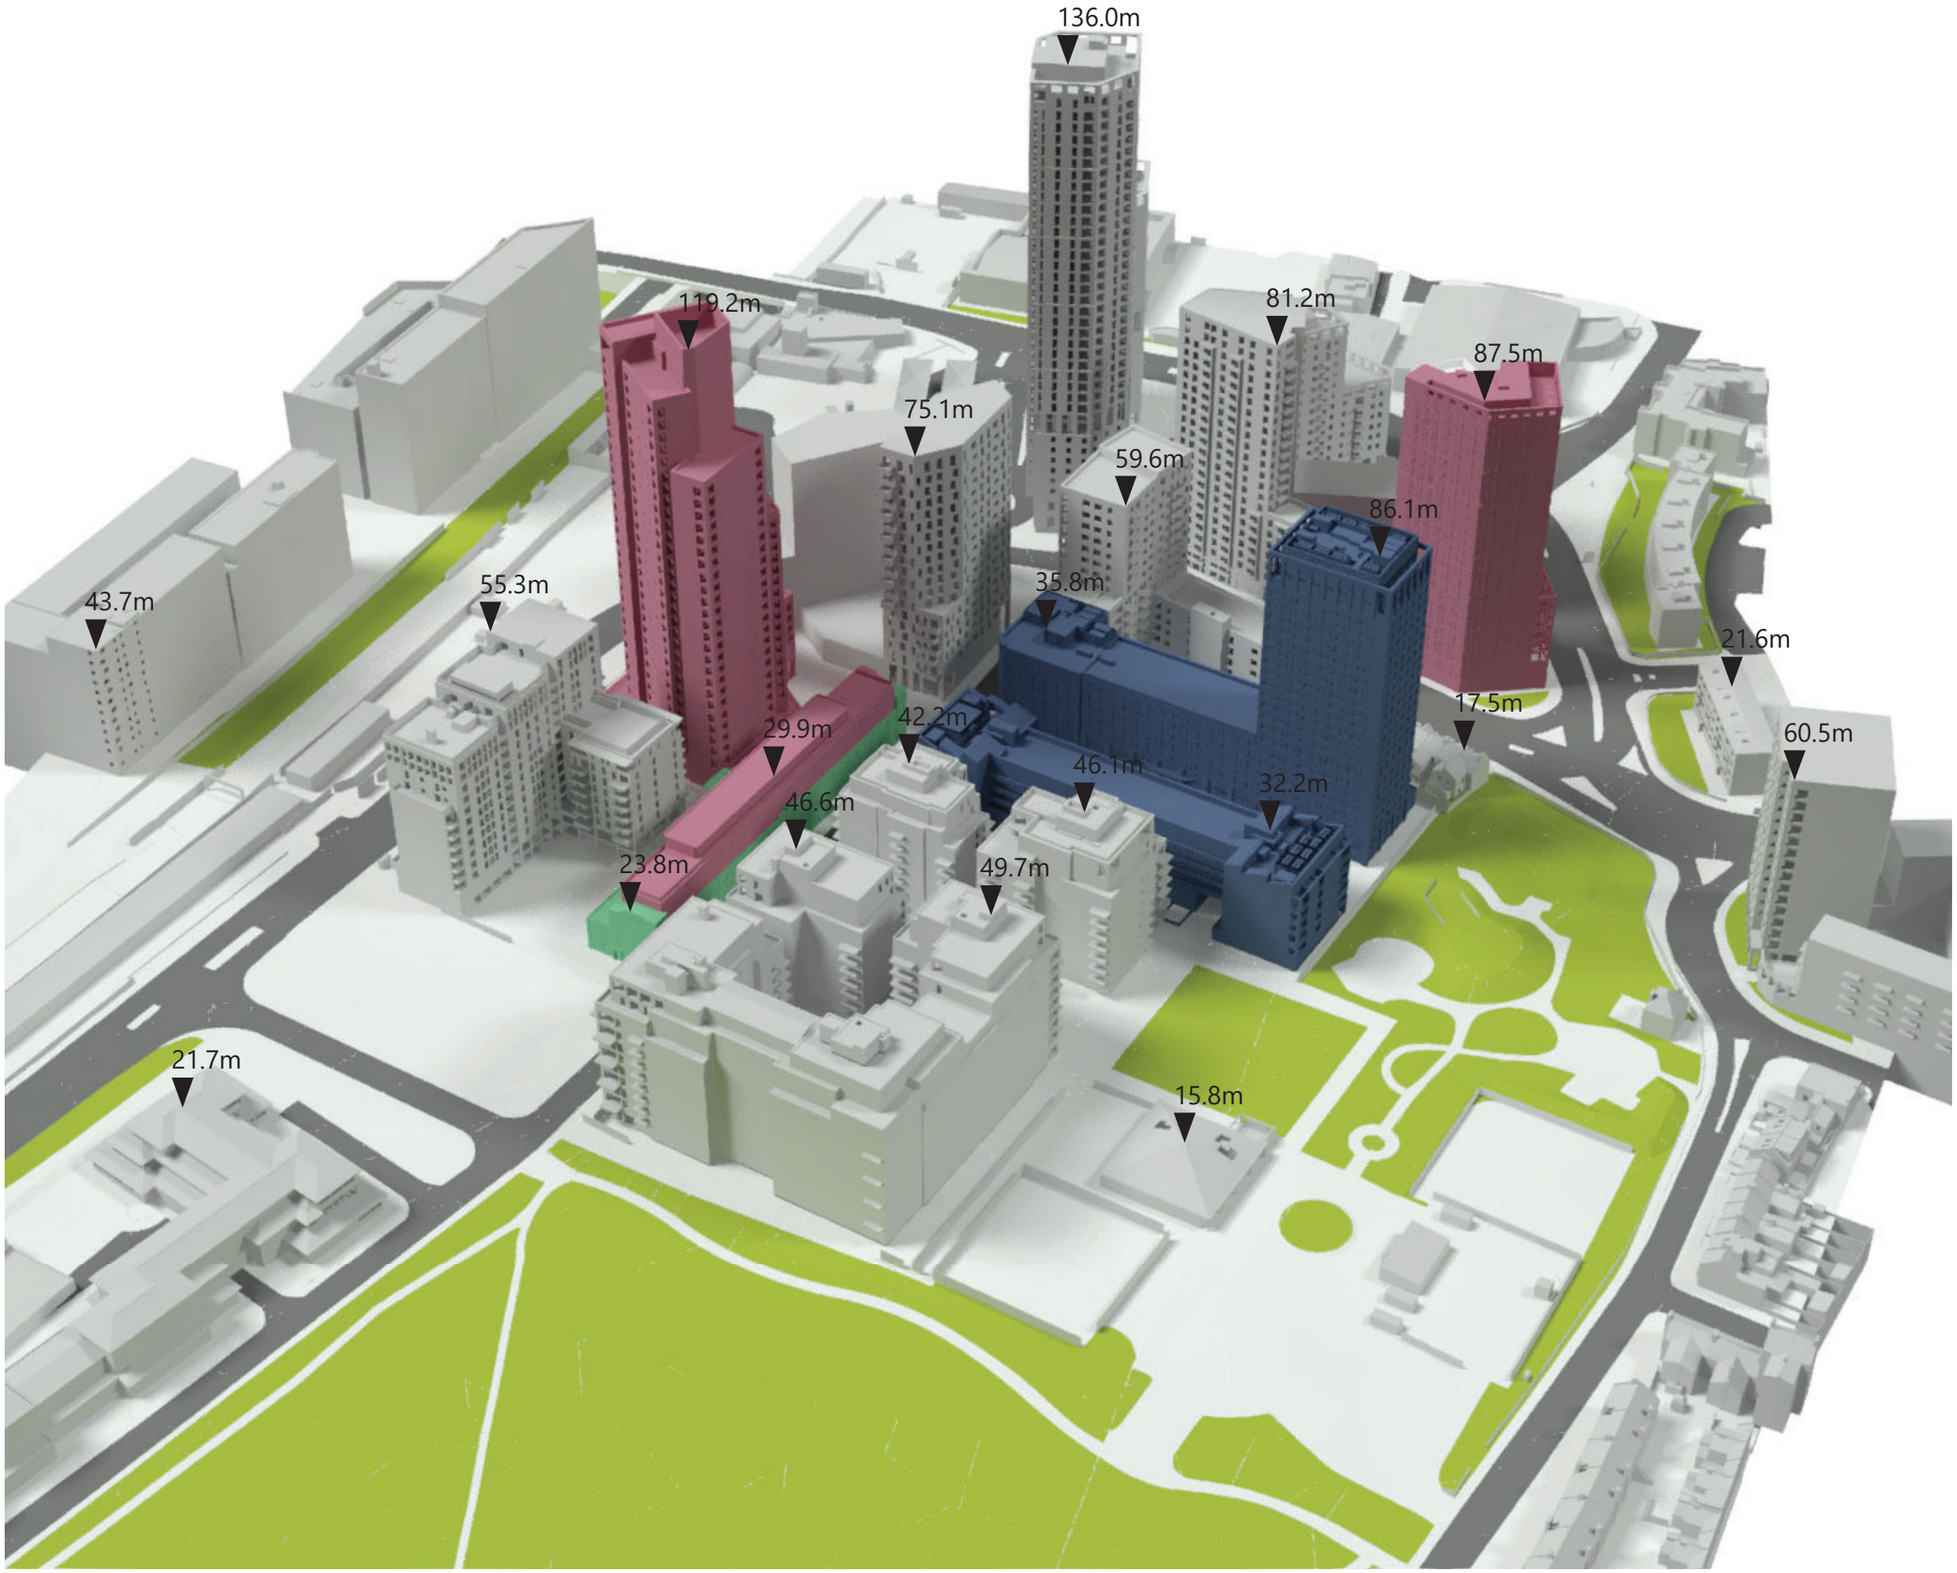

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Key

- Cumulative Development
- Existing Building
- Surrounding Context
- Proposed Development

Project: Ashley Road
Tottenham Hale

Title: Proposed Development
3D View

Drawn	TR	Checked	--
Date	08/08/2026	Project	10106

Rel no.	Prefix	Page no.
08	DS03	04

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings

Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties

Annex 3: Results of the Cumulative Daylight and Sunlight Assessments

Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments

Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments

Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments

Annex 7: Results of the Sunlight Amenity Assessments

Annex 8: Transient Shadow Images

Annex 9: Solar Glare Images

Annex 10: Policy and Legislation Review

Annex 11: Hale Road Properties

Annex 2

Results of the daylight and sunlight assessments within neighbouring properties

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ferry Island Building 1																			
First	R1	W1-L	LKD	11.6	11.4	0.2	1.5%												
		W1-U						34.9	18.9	54%	18.9	54%	0.0	0.0%	21	10	21	10	0.0%	0.0%
First	R2	W2	Bedroom	12.1	11.7	0.4	3.0%	13.5	6.6	49%	6.6	49%	0.0	0.0%	19	7	19	7	0.0%	0.0%
First	R3	W3	Residential	12.9	12.3	0.6	4.5%	19.7	11.7	60%	11.7	59%	0.0	0.3%	22	9	22	9	0.0%	0.0%
First	R4	W4	Residential	16.9	15.7	1.1	6.8%													
		W5		18.5	17.6	0.8	4.5%	18.4	13.1	71%	12.9	70%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W6	Residential	18.5	18.0	0.5	2.5%													
		W7		20.3	20.1	0.2	1.1%	14.1	13.6	96%	13.5	96%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W8	Residential	20.0	19.9	0.1	0.3%	17.0	13.4	79%	13.4	79%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W9	Bedroom	19.7	19.6	0.1	0.4%	15.1	12.3	81%	12.3	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W10	LKD	19.0	18.9	0.1	0.4%													
		W11		31.0	31.0	0.0	0.0%	24.2	22.4	93%	22.4	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	12.2	12.0	0.2	1.5%													
		W1-U						34.9	18.9	54%	18.9	54%	0.0	0.0%	22	10	22	10	0.0%	0.0%
Second	R2	W2	Bedroom	12.8	12.4	0.4	3.0%	13.5	6.8	51%	6.8	51%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Second	R3	W3	Bedroom	13.6	13.0	0.6	4.4%	14.9	10.4	69%	10.4	69%	0.0	0.2%	23	9	23	9	0.0%	0.0%
Second	R4	W4	Bedroom	17.7	16.5	1.2	6.7%	10.9	4.7	43%	4.7	43%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W5	LKD	19.3	18.4	0.9	4.6%													
		W6		19.3	18.9	0.5	2.5%													
		W7		21.5	21.3	0.2	0.9%	41.8	37.4	90%	36.9	88%	0.5	1.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W8	Bedroom	21.3	21.3	0.0	0.2%	13.6	11.9	88%	11.9	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W9	Bedroom	21.1	21.0	0.0	0.1%	15.1	12.7	84%	12.7	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W10	LKD	20.4	20.4	0.0	0.1%													
		W11		31.8	31.8	0.0	0.0%	24.2	23.3	96%	23.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	12.9	12.7	0.2	1.5%													
		W1-U						34.9	18.8	54%	18.8	54%	0.0	0.0%	22	10	22	10	0.0%	0.0%
Third	R2	W2	Bedroom	13.5	13.2	0.4	2.8%	13.5	7.1	53%	7.1	53%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Third	R3	W3	Bedroom	14.4	13.8	0.6	4.2%	14.9	10.7	72%	10.7	72%	0.0	0.1%	24	9	24	9	0.0%	0.0%
Third	R4	W4	Bedroom	18.5	17.3	1.2	6.4%	10.9	5.0	46%	5.0	46%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W5	LKD	20.1	19.2	0.9	4.4%													
		W6		20.2	19.7	0.5	2.4%													
		W7		22.7	22.5	0.2	0.8%	41.8	37.8	90%	37.3	89%	0.5	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W8	Bedroom	22.5	22.5	0.0	0.0%	13.6	12.0	88%	12.0	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R7	W9	Bedroom	22.4	22.4	0.0	0.0%	15.1	12.8	84%	12.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W10	LKD	21.9	21.9	0.0	0.0%													
		W11		32.7	32.7	0.0	0.0%	24.2	23.6	97%	23.6	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	13.7	13.4	0.2	1.7%													
		W1-U						34.9	18.8	54%	18.8	54%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Fourth	R2	W2	Bedroom	14.4	14.0	0.4	2.7%	13.5	7.6	56%	7.6	56%	0.0	0.1%	21	7	21	7	0.0%	0.0%
Fourth	R3	W3	Bedroom	15.3	14.7	0.6	3.8%	14.9	11.1	74%	11.1	74%	0.0	0.1%	25	9	25	9	0.0%	0.0%
Fourth	R4	W4	Bedroom	19.4	18.2	1.1	5.8%	10.9	5.5	50%	5.5	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W5	LKD	20.9	20.0	0.8	4.0%													
		W6		21.1	20.7	0.5	2.2%													
		W7		23.7	23.6	0.2	0.7%	41.8	38.0	91%	37.5	90%	0.5	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W8	Bedroom	23.7	23.7	0.0	0.0%	13.6	12.1	89%	12.1	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W9	Bedroom	23.7	23.7	0.0	0.0%	15.1	12.9	85%	12.9	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W10	LKD	23.4	23.4	0.0	0.0%													
		W11		33.6	33.6	0.0	0.0%	24.2	23.8	98%	23.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	14.6	14.4	0.3	1.8%													
		W1-U						34.9	18.7	54%	18.7	54%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Fifth	R2	W2	Bedroom	15.4	15.0	0.4	2.9%	13.5	7.9	59%	7.9	59%	0.0	0.2%	22	7	22	7	0.0%	0.0%
Fifth	R3	W3	Bedroom	16.4	15.8	0.5	3.3%	14.9	11.4	76%	11.4	76%	0.0	0.0%	27	9	27	9	0.0%	0.0%
Fifth	R4	W4	Bedroom	20.3	19.2	1.1	5.3%	10.9	5.9	54%	5.9	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W5	LKD	21.7	20.9	0.8	3.6%													
		W6		22.0	21.6	0.4	2.0%													
		W7		24.9	24.7	0.2	0.6%	41.8	38.1	91%	37.7	90%	0.5	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W8	Bedroom	24.8	24.8	0.0	0.0%	13.6	12.2	90%	12.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W9	Bedroom	24.8	24.8	0.0	0.0%	15.1	13.0	86%	13.0	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W10	LKD	24.7	24.7	0.0	0.0%													
		W11		34.3	34.3	0.0	0.0%	24.2	23.8	99%	23.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	15.6	15.3	0.3	1.9%													
		W1-U						34.9	18.7	54%	18.7	54%	0.0	0.0%	24	10	24	10	0.0%	0.0%
Sixth	R2	W2	Bedroom	16.3	15.9	0.5	2.9%	13.5	8.2	60%	8.1	60%	0.0	0.2%	22	7	22	7	0.0%	0.0%
Sixth	R3	W3	Bedroom	17.2	16.7	0.5	3.0%	14.9	11.6	77%	11.6	77%	0.0	0.0%	28	9	28	9	0.0%	0.0%
Sixth	R4	W4	Bedroom	20.8	19.8	1.0	4.8%	10.9	6.3	58%	6.3	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W5	LKD	22.3	21.5	0.7	3.3%													
		W6		22.6	22.2	0.4	1.8%													
		W7		25.7	25.5	0.2	0.6%	41.8	38.3	92%	37.8	91%	0.5	1.2%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R6	W8	Bedroom	25.7	25.7	0.0	0.0%	13.6	12.4	91%	12.4	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W9	Bedroom	25.7	25.7	0.0	0.0%	15.1	13.1	87%	13.1	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W10	LKD	25.6	25.6	0.0	0.0%													
		W11		34.6	34.6	0.0	0.0%	24.2	23.8	98%	23.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W1-L	LKD	9.3	9.3	0.0	0.0%													
		W1-U						36.5	18.2	50%	18.2	50%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Seventh	R8	W2-L	Bedroom	10.7	10.7	0.0	0.0%													
		W2-U						11.7	6.6	57%	6.6	57%	0.0	0.0%	11	0	11	0	0.0%	0.0%
Seventh	R9	W3-L	Bedroom	10.6	9.6	0.9	8.8%													
		W3-U						15.1	4.8	32%	4.8	32%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R10	W4-L	LKD	12.1	11.4	0.7	5.4%													
		W4-U																		
		W5-L		14.0	13.5	0.5	3.3%													
		W5-U																		
		W6-L		15.1	14.9	0.1	0.9%													
		W6-U						35.8	31.2	87%	30.5	85%	0.7	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R11	W7-L	Bedroom	14.8	14.8	0.0	0.0%													
		W7-U						10.3	7.5	73%	7.5	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R12	W8-L	Bedroom	14.2	14.2	0.0	0.0%													
		W8-U						10.9	9.7	89%	9.7	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W1-L	LKD	3.4	3.4	0.0	0.0%													
		W1-U						36.5	16.6	45%	16.6	45%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Eighth	R8	W2-L	Bedroom	4.4	4.4	0.0	0.0%													
		W2-U						11.7	5.8	50%	5.8	50%	0.0	0.1%	4	0	4	0	0.0%	0.0%
Eighth	R9	W3-L	Bedroom	5.0	4.1	0.9	17.3%													
		W3-U						15.1	4.3	29%	4.3	29%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W4-L	LKD	6.3	5.7	0.6	9.6%													
		W4-U																		
		W5-L		6.8	6.4	0.4	6.2%													
		W5-U																		
		W6-L		6.7	6.6	0.1	1.8%													
		W6-U						35.8	30.3	85%	29.4	82%	0.9	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W7-L	Bedroom	6.9	6.9	0.0	0.0%													
		W7-U						10.3	6.8	65%	6.8	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R12	W8-L	Bedroom	6.2	6.2	0.0	0.0%													
		W8-U						10.9	8.9	81%	8.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1-L	LKD	22.2	22.0	0.3	1.1%													
		W1-U						38.5	22.6	59%	22.6	59%	0.0	0.0%	37	10	37	10	0.0%	0.0%
Ninth	R2	W2-L	Bedroom	22.5	22.1	0.4	1.8%													
		W2-U						11.4	9.9	87%	9.9	87%	0.0	0.0%	38	9	38	9	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Ninth	R3	W3-L	LKD	22.8	22.4	0.4	1.8%													
		W3-U																		
		W4-L		24.4	23.6	0.9	3.5%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	42	12	42	12	0.0%	0.0%
Ninth	R4	W5-L	Bedroom	25.7	25.0	0.7	2.7%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W6-L	LKD	26.6	26.2	0.4	1.5%													
		W6-U																		
		W7-L		4.6	4.6	0.0	0.0%													
		W7-U																		
		W8-L		4.6	4.5	0.1	1.3%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9-L	Bedroom	3.5	3.4	0.1	2.0%													
		W9-U																		
		W10-L		30.3	30.3	0.0	0.0%													
		W10-U						15.1	13.9	92%	13.9	92%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Ninth	R7	W11-L	LKD	30.4	30.4	0.0	0.0%													
		W11-U																		
		W12-L		30.4	30.4	0.0	0.0%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.1	97%	38.1	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		37.6	37.6	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1-L	LKD	25.3	25.1	0.2	0.9%													
		W1-U						38.5	27.0	70%	27.0	70%	0.0	0.0%	43	12	43	12	0.0%	0.0%
Tenth	R2	W2-L	Bedroom	25.1	24.7	0.4	1.4%													
		W2-U						11.4	10.4	91%	10.4	91%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Tenth	R3	W3-L	LKD	25.0	24.7	0.4	1.5%													
		W3-U																		
		W4-L		25.6	24.8	0.8	3.2%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	44	14	44	14	0.0%	0.0%
Tenth	R4	W5-L	Bedroom	26.9	26.2	0.7	2.5%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W6-L	LKD	27.8	27.4	0.4	1.5%													
		W6-U																		
		W7-L		5.1	5.1	0.0	0.0%													
		W7-U																		
		W8-L		5.4	5.3	0.1	2.0%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9-L	Bedroom	3.8	3.7	0.1	2.7%													
		W9-U																		
		W10-L		31.8	31.7	0.0	0.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	13.9	92%	13.9	92%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Tenth	R7	W11-L	LKD	31.9	31.9	0.0	0.0%													
		W11-U																		
		W12-L		31.9	31.8	0.0	0.0%													
		W12-U																		
		W13-L		11.7	11.7	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		38.1	38.1	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1-L	LKD	28.3	28.1	0.2	0.8%													
		W1-U						38.5	31.0	81%	31.0	81%	0.0	0.0%	48	15	48	15	0.0%	0.0%
Eleventh	R2	W2-L	Bedroom	27.7	27.4	0.3	1.2%													
		W2-U						11.4	10.4	91%	10.4	91%	0.0	0.0%	45	14	45	14	0.0%	0.0%
Eleventh	R3	W3-L	LKD	27.3	26.9	0.4	1.3%													
		W3-U																		
		W4-L		26.9	26.1	0.8	3.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	45	15	45	15	0.0%	0.0%
Eleventh	R4	W5-L	Bedroom	28.1	27.4	0.7	2.5%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W6-L	LKD	29.1	28.6	0.5	1.8%													
		W6-U																		
		W7-L		5.6	5.6	0.0	0.0%													
		W7-U																		
		W8-L		6.2	6.0	0.2	3.9%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9-L	Bedroom	4.0	3.9	0.2	4.2%													
		W9-U																		
		W10-L		33.2	33.0	0.2	0.5%													
		W10-U						15.1	14.0	93%	14.0	93%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Eleventh	R7	W11-L	LKD	33.3	33.1	0.1	0.5%													
		W11-U																		
		W12-L		33.3	33.1	0.2	0.5%													
		W12-U																		
		W13-L		11.8	11.8	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		38.5	38.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1-L	LKD	31.0	30.8	0.2	0.7%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	49	17	49	17	0.0%	0.0%
Twelfth	R2	W2-L	Bedroom	30.0	29.7	0.3	1.0%													
		W2-U						11.4	10.4	92%	10.4	92%	0.0	0.0%	47	17	47	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twelfth	R3	W3-L	LKD	29.2	28.8	0.3	1.1%												
		W3-U																	
		W4-L		27.9	27.1	0.8	2.8%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	46	17	46	17	0.0%	0.0%
Twelfth	R4	W5-L	Bedroom	29.1	28.4	0.7	2.5%												
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W6-L	LKD	30.2	29.6	0.6	2.0%												
		W6-U																	
		W7-L		5.6	5.6	0.0	0.0%												
		W7-U																	
		W8-L		6.5	6.1	0.4	6.0%												
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9-L	Bedroom	4.0	3.7	0.2	6.0%												
		W9-U																	
		W10-L		34.3	33.9	0.4	1.1%												
		W10-U						15.1	14.1	93%	14.1	93%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Twelfth	R7	W11-L	LKD	34.4	34.0	0.4	1.0%												
		W11-U																	
		W12-L		34.4	34.1	0.4	1.0%												
		W12-U																	
		W13-L		11.2	11.2	0.0	0.0%												
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W14-L	Bedroom	2.5	2.5	0.0	0.0%												
		W14-U																	
		W15-L		38.5	38.5	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1-L	LKD	33.2	33.0	0.2	0.6%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Thirteenth	R2	W2-L	Bedroom	32.0	31.8	0.3	0.9%												
		W2-U						11.4	10.7	94%	10.7	94%	0.0	0.0%	50	18	50	18	0.0%	0.0%
Thirteenth	R3	W3-L	LKD	31.0	30.7	0.3	1.0%												
		W3-U																	
		W4-L		29.6	28.8	0.8	2.6%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	50	19	50	19	0.0%	0.0%
Thirteenth	R4	W5-L	Bedroom	30.8	30.1	0.7	2.4%												
		W5-U						11.6	8.9	77%	8.9	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W6-L	LKD	32.0	31.3	0.7	2.2%												
		W6-U																	
		W7-L		6.5	6.5	0.0	0.0%												
		W7-U																	
		W8-L		7.9	7.3	0.5	6.9%												
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W9-L	Bedroom	4.5	4.2	0.3	7.0%												
		W9-U																	
		W10-L		35.9	35.4	0.6	1.6%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.2	94%	14.2	94%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Thirteenth	R7	W11-L	LKD	36.0	35.5	0.5	1.5%													
		W11-U																		
		W12-L		36.0	35.5	0.5	1.4%													
		W12-U																		
		W13-L		12.0	12.0	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.1	39.1	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1-L	LKD	34.0	33.9	0.2	0.5%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	53	19	53	19	0.0%	0.0%
Fourteenth	R2	W2-L	Bedroom	32.9	32.6	0.3	0.8%													
		W2-U						11.4	10.9	96%	10.9	96%	0.0	0.0%	51	19	51	19	0.0%	0.0%
Fourteenth	R3	W3-L	LKD	31.8	31.5	0.3	0.8%													
		W3-U																		
		W4-L		30.7	30.0	0.7	2.3%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	49	19	49	19	0.0%	0.0%
Fourteenth	R4	W5-L	Bedroom	31.9	31.2	0.7	2.2%													
		W5-U						11.6	9.0	77%	9.0	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W6-L	LKD	33.1	32.4	0.7	2.2%													
		W6-U																		
		W7-L		6.8	6.8	0.0	0.0%													
		W7-U																		
		W8-L		8.4	7.8	0.6	7.2%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W9-L	Bedroom	4.7	4.3	0.4	7.5%													
		W9-U																		
		W10-L		36.8	36.2	0.7	1.8%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Fourteenth	R7	W11-L	LKD	36.9	36.3	0.6	1.7%													
		W11-U																		
		W12-L		36.9	36.3	0.6	1.5%													
		W12-U																		
		W13-L		12.0	12.0	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.2	39.2	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R1	W1-L	LKD	34.8	34.6	0.1	0.4%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	53	18	53	18	0.0%	0.0%
Fifteenth	R2	W2-L	Bedroom	33.7	33.5	0.2	0.7%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	19	50	19	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifteenth	R3	W3-L	LKD	32.7	32.4	0.2	0.7%												
		W3-U																	
		W4-L		31.7	31.1	0.6	1.9%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	18	48	18	0.0%	0.0%
Fifteenth	R4	W5-L	Bedroom	32.8	32.2	0.6	1.9%												
		W5-U						11.6	9.1	78%	9.1	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W6-L	LKD	33.9	33.3	0.6	1.9%												
		W6-U																	
		W7-L		7.2	7.2	0.0	0.0%												
		W7-U																	
		W8-L		8.5	8.0	0.5	6.0%												
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R6	W9-L	Bedroom	4.7	4.4	0.3	6.4%												
		W9-U																	
		W10-L		37.4	36.8	0.5	1.5%												
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fifteenth	R7	W11-L	LKD	37.4	36.9	0.5	1.4%												
		W11-U																	
		W12-L		37.4	36.9	0.5	1.3%												
		W12-U																	
		W13-L		12.1	12.1	0.0	0.0%												
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.2	39.2	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R1	W1-L	LKD	35.6	35.5	0.1	0.3%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	54	20	54	20	0.0%	0.0%
Sixteenth	R2	W2-L	Bedroom	34.7	34.5	0.2	0.5%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	19	50	19	0.0%	0.0%
Sixteenth	R3	W3-L	LKD	33.7	33.5	0.2	0.6%												
		W3-U																	
		W4-L		32.9	32.4	0.5	1.6%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	18	48	18	0.0%	0.0%
Sixteenth	R4	W5-L	Bedroom	33.9	33.4	0.5	1.5%												
		W5-U						11.6	9.4	81%	9.4	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W6-L	LKD	34.9	34.3	0.5	1.5%												
		W6-U																	
		W7-L		7.5	7.5	0.0	0.0%												
		W7-U																	
		W8-L		8.7	8.2	0.4	5.1%												
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R6	W9-L	Bedroom	4.7	4.4	0.3	5.3%												
		W9-U																	
		W10-L		37.9	37.4	0.5	1.2%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Sixteenth	R7	W11-L	LKD	38.0	37.5	0.4	1.2%													
		W11-U																		
		W12-L		38.0	37.6	0.4	1.1%													
		W12-U																		
		W13-L		12.1	12.1	0.0	0.0%													
		W13-U						39.2	38.5	98%	38.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.3	39.3	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R1	W1-L	LKD	36.4	36.3	0.1	0.3%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Seventeenth	R2	W2-L	Bedroom	35.7	35.5	0.1	0.4%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Seventeenth	R3	W3-L	LKD	34.9	34.8	0.2	0.5%													
		W3-U																		
		W4-L		34.2	33.8	0.4	1.2%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Seventeenth	R4	W5-L	Bedroom	35.1	34.7	0.4	1.2%													
		W5-U						11.6	10.0	86%	10.0	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W6-L	LKD	35.9	35.5	0.4	1.2%													
		W6-U																		
		W7-L		7.8	7.8	0.0	0.0%													
		W7-U																		
		W8-L		8.8	8.5	0.4	4.0%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R6	W9-L	Bedroom	4.7	4.5	0.2	4.3%													
		W9-U																		
		W10-L		38.4	38.0	0.4	1.0%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Seventeenth	R7	W11-L	LKD	38.4	38.1	0.4	0.9%													
		W11-U																		
		W12-L		38.5	38.2	0.3	0.9%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.3	39.3	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R1	W1-L	LKD	37.0	37.0	0.1	0.2%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	51	17	51	17	0.0%	0.0%
Eighteenth	R2	W2-L	Bedroom	36.5	36.4	0.1	0.3%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	17	50	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighteenth	R3	W3-L	LKD	36.0	35.9	0.1	0.3%													
		W3-U																		
		W4-L		35.5	35.2	0.3	0.9%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	17	48	17	0.0%	0.0%
Eighteenth	R4	W5-L	Bedroom	36.1	35.8	0.3	0.9%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R5	W6-L	LKD	36.7	36.4	0.3	0.9%													
		W6-U																		
		W7-L		7.5	7.5	0.0	0.0%													
		W7-U																		
		W8-L		8.4	8.1	0.3	3.3%													
		W8-U						28.7	28.1	98%	28.1	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R6	W9-L	Bedroom	4.4	4.2	0.2	3.7%													
		W9-U																		
		W10-L		38.5	38.3	0.3	0.8%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Eighteenth	R7	W11-L	LKD	38.6	38.4	0.3	0.7%													
		W11-U																		
		W12-L		38.7	38.4	0.3	0.7%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R8	W14-L	Bedroom	2.5	2.5	0.0	0.0%													
		W14-U																		
		W15-L		39.0	39.0	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R1	W1-L	LKD	38.4	38.3	0.1	0.2%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Nineteenth	R2	W2-L	Bedroom	38.1	38.0	0.1	0.2%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Nineteenth	R3	W3-L	LKD	37.8	37.7	0.1	0.2%													
		W3-U																		
		W4-L		37.5	37.3	0.2	0.6%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Nineteenth	R4	W5-L	Bedroom	37.9	37.7	0.2	0.6%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R5	W6-L	LKD	38.2	38.0	0.2	0.6%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	8.8	0.2	2.2%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R6	W9-L	Bedroom	4.7	4.6	0.1	2.3%													
		W9-U																		
		W10-L		39.3	39.1	0.2	0.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Nineteenth	R7	W11-L	LKD	39.3	39.1	0.2	0.5%													
		W11-U																		
		W12-L		39.4	39.2	0.2	0.5%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R1	W1-L	LKD	39.2	39.1	0.0	0.1%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twentieth	R2	W2-L	Bedroom	39.1	39.1	0.1	0.1%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twentieth	R3	W3-L	LKD	39.0	39.0	0.1	0.1%													
		W3-U																		
		W4-L		39.0	38.9	0.1	0.4%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twentieth	R4	W5-L	Bedroom	39.1	38.9	0.1	0.4%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R5	W6-L	LKD	39.2	39.0	0.1	0.4%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	8.8	0.1	1.4%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W9-L	Bedroom	4.7	4.6	0.1	1.5%													
		W9-U																		
		W10-L		39.4	39.3	0.1	0.3%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twentieth	R7	W11-L	LKD	39.4	39.3	0.1	0.3%													
		W11-U																		
		W12-L		39.4	39.3	0.1	0.3%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R1	W1-L	LKD	39.4	39.4	0.0	0.1%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-First	R2	W2-L	Bedroom	39.5	39.4	0.0	0.1%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-First	R3	W3-L	LKD	39.4	39.4	0.0	0.1%												
		W3-U																	
		W4-L		39.5	39.4	0.1	0.2%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-First	R4	W5-L	Bedroom	39.5	39.4	0.1	0.2%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R5	W6-L	LKD	39.5	39.4	0.1	0.2%												
		W6-U																	
		W7-L		8.2	8.2	0.0	0.0%												
		W7-U																	
		W8-L		9.0	8.9	0.1	0.6%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W9-L	Bedroom	4.7	4.7	0.0	0.6%												
		W9-U																	
		W10-L		39.5	39.4	0.1	0.2%												
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-First	R7	W11-L	LKD	39.5	39.4	0.1	0.1%												
		W11-U																	
		W12-L		39.5	39.4	0.1	0.1%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.4	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R1	W1-L	LKD	39.4	39.4	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Secc	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Secc	R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.5	39.5	0.0	0.0%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Secc	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R5	W6-L	LKD	39.5	39.5	0.0	0.0%												
		W6-U																	
		W7-L		8.2	8.2	0.0	0.0%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.4	39.4	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Secc	R7	W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Thir	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Thir	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.4	39.4	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Thir	R4	W5-L	Bedroom	39.4	39.4	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R5	W6-L	LKD	39.4	39.4	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	39.4	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Thir	R7	W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R1	W1-L	LKD	39.0	39.0	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Four	R2	W2-L	Bedroom	39.1	39.1	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Four	R3	W3-L	LKD	39.1	39.1	0.0	0.0%													
		W3-U																		
		W4-L		39.1	39.1	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Four	R4	W5-L	Bedroom	39.1	39.1	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R5	W6-L	LKD	39.1	39.1	0.0	0.0%													
		W6-U																		
		W7-L		7.6	7.6	0.0	0.0%													
		W7-U																		
		W8-L		8.4	8.4	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R6	W9-L	Bedroom	4.4	4.4	0.0	0.0%													
		W9-U																		
		W10-L		39.1	39.1	0.0	0.0%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Four	R7	W11-L	LKD	39.0	39.0	0.0	0.0%													
		W11-U																		
		W12-L		39.1	39.1	0.0	0.0%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.0	39.0	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Fifth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Fifth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Fifth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Fifth	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Sixth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Sixth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Sixth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Sixth	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Seve	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-Seve	R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.5	39.5	0.0	0.0%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Seve	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R5	W6-L	LKD	39.5	39.5	0.0	0.0%												
		W6-U																	
		W7-L		8.2	8.2	0.0	0.0%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.5	39.5	0.0	0.0%												
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Seve	R7	W11-L	LKD	39.5	39.5	0.0	0.0%												
		W11-U																	
		W12-L		39.5	39.5	0.0	0.0%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.4	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R1	W1-L	LKD	39.4	39.4	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Eigh	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Eigh	R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.5	39.5	0.0	0.0%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Eigh	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R5	W6-L	LKD	39.5	39.5	0.0	0.0%												
		W6-U																	
		W7-L		8.2	8.2	0.0	0.0%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.4	39.4	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Eigh	R7	W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Nint	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Nint	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Nint	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.4	39.4	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Nint	R4	W5-L	Bedroom	39.4	39.4	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Nint	R5	W6-L	LKD	39.4	39.4	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Nint	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	39.4	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twenty-Nint	R7	W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Nint	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R1	W1-L	LKD	39.0	39.0	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Thirtieth	R2	W2-L	Bedroom	39.1	39.1	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	52	17	52	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirtieth	R3	W3-L	LKD	39.1	39.1	0.0	0.0%													
		W3-U																		
		W4-L		39.1	39.1	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Thirtieth	R4	W5-L	Bedroom	39.1	39.1	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R5	W6-L	LKD	39.1	39.1	0.0	0.0%													
		W6-U																		
		W7-L		7.6	7.6	0.0	0.0%													
		W7-U																		
		W8-L		8.4	8.4	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R6	W9-L	Bedroom	4.4	4.4	0.0	0.0%													
		W9-U																		
		W10-L		39.1	39.1	0.0	0.0%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Thirtieth	R7	W11-L	LKD	39.0	39.0	0.0	0.0%													
		W11-U																		
		W12-L		39.1	39.1	0.0	0.0%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.0	39.0	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-First	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-First	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-First	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-First	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Secon	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Secon	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Secon	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Secon	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Third	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirty-Third	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Third	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Third	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Fourth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Fourth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Fourth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Fourth	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Fifth	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Fifth	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Fifth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	39.4	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Fifth	R7	W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R1	W1-L	Bedroom	19.3	19.3	0.0	0.0%													
		W1-U																		
		W2-L		39.4	39.4	0.0	0.0%													
		W2-U						18.4	18.4	100%	18.4	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Thirty-Sixth	R2	W3-L	Bedroom	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		16.8	16.8	0.0	0.0%												
		W4-U						15.3	15.3	100%	15.3	100%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Sixth	R3	W5-L	LKD	18.5	18.5	0.0	0.0%												
		W5-U																	
		W6-L		23.0	23.0	0.0	0.0%												
		W6-U						35.4	33.0	93%	33.0	93%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Sixth	R4	W7-L	LKD	39.4	39.4	0.0	0.0%												
		W7-U																	
		W8-L		39.4	39.4	0.0	0.0%												
		W8-U																	
		W9-L		22.0	22.0	0.0	0.0%												
		W9-U																	
		W10-L		15.6	15.6	0.0	0.0%												
		W10-U						40.4	40.2	100%	40.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R5	W11-L	Bedroom	10.8	10.8	0.0	0.0%												
		W11-U																	
		W12-L		39.4	39.4	0.0	0.0%												
		W12-U						14.8	14.6	99%	14.6	99%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirty-Sixth	R6	W13-L	Bedroom	39.4	39.4	0.0	0.0%												
		W13-U																	
		W14-L		19.0	19.0	0.0	0.0%												
		W14-U						15.9	15.8	100%	15.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R7	W15-L	LKD	17.1	17.1	0.0	0.0%												
		W15-U																	
		W16-L		39.4	39.4	0.0	0.0%												
		W16-U						20.9	20.5	98%	20.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Mezzanine	R1	W1-L	Residential	10.9	10.7	0.2	1.5%												
		W1-U																	
		W2-L		11.1	10.8	0.3	2.7%												
		W2-U						56.8	48.3	85%	48.2	85%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Mezzanine	R2	W3-L	Residential	11.9	11.3	0.5	4.5%												
		W3-U																	
		W4-L		14.9	13.8	1.1	7.6%												
		W4-U																	
		W5-L		17.0	16.2	0.8	4.8%												
		W5-U																	
		W6-L		17.3	16.9	0.5	2.7%												
		W6-U																	
		W7-L		18.6	18.3	0.3	1.4%												
		W7-U																	
		W8-L		18.1	18.0	0.2	0.8%												
		W8-U																	
		W9-L		17.8	17.6	0.2	0.9%												
		W9-U																	
		W10-L		20.5	20.5	0.0	0.0%												
		W10-U																	
		W11-L		20.6	20.6	0.0	0.0%												
		W11-U						152.1	151.9	100%	151.9	100%	0.0	0.0%	52	15	52	15	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ferry Island Building 2																			
First	R1	W1-L	LKD	13.2	13.2	0.0	0.0%												
		W1-U																	
		W2-L		16.7	16.7	0.0	0.0%												
		W2-U																	
		W3		23.3	23.3	0.0	0.1%	33.5	23.6	70%	23.6	70%	0.0	0.0%	40	18	40	18	0.0%	0.0%
First	R2	W4	Bedroom	22.0	22.0	0.0	0.0%	12.4	9.5	77%	9.5	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	LKD	8.2	8.2	0.0	0.0%												
		W5-U						32.4	20.6	64%	20.6	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W6	Bedroom	16.8	16.8	0.0	0.0%	12.4	6.2	50%	6.2	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7	LKD	16.4	16.4	0.0	0.0%												
		W8-L		7.3	7.3	0.0	0.0%												
		W8-U						35.2	14.1	40%	14.1	40%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W9	Bedroom	11.4	11.4	0.0	0.0%	12.2	4.7	38%	4.7	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10	Bedroom	13.3	13.3	0.0	0.0%	11.5	6.0	52%	6.0	52%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W11-L	Studio	3.3	3.3	0.0	0.0%												
		W11-U						29.1	5.5	19%	5.5	19%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W12	LKD	9.0	9.0	0.0	0.0%												
		W13-L		1.3	1.3	0.0	0.0%												
		W13-U						35.1	6.8	19%	6.8	19%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R10	W14	Bedroom	5.4	5.4	0.0	0.0%	11.3	2.1	18%	2.1	18%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W15	Bedroom	6.4	6.4	0.0	0.0%	14.5	1.9	13%	1.9	13%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R12	W16	Bedroom	6.6	6.6	0.0	0.0%	10.0	1.1	11%	1.1	11%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W17	Bedroom	7.0	7.0	0.0	0.0%												
		W18		7.8	7.8	0.0	0.0%	11.3	4.3	38%	4.3	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W19	LKD	8.7	8.7	0.0	0.0%												
		W20-L		0.1	0.1	0.0	14.3%												
		W20-U																	
		W21-L		0.9	0.9	0.0	0.0%												
		W21-U																	
		W22-L		5.1	5.1	0.0	0.0%												
		W22-U						43.1	14.4	33%	14.4	33%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	13.7	13.7	0.0	0.0%												
		W1-U																	
		W2-L		17.3	17.3	0.0	0.0%												
		W2-U																	
		W3		24.5	24.3	0.2	0.7%	33.5	23.6	70%	23.6	70%	0.0	0.1%	40	18	40	18	0.0%	0.0%
Second	R2	W4	Bedroom	23.3	23.1	0.2	0.7%	12.4	9.9	80%	9.9	80%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	LKD	9.2	9.1	0.1	1.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U						32.4	21.6	67%	21.3	66%	0.3	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W6	Bedroom	18.2	18.2	0.1	0.4%	12.4	7.2	58%	7.2	58%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7	LKD	17.8	17.8	0.0	0.1%													
		W8-L		8.3	8.3	0.0	0.0%													
		W8-U						35.2	16.1	46%	16.1	46%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W9	Bedroom	12.9	12.9	0.0	0.0%	12.2	5.3	44%	5.3	44%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10	Bedroom	14.9	14.9	0.0	0.0%	11.5	7.3	64%	7.3	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W11-L	Studio	4.0	4.0	0.0	0.0%													
		W11-U						29.1	6.0	21%	6.0	21%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W12	LKD	10.3	10.3	0.0	0.0%													
		W13-L		1.7	1.7	0.0	0.0%													
		W13-U						35.1	8.3	24%	8.3	24%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W14	Bedroom	6.2	6.2	0.0	0.0%	11.3	2.5	22%	2.5	22%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W15	Bedroom	7.2	7.2	0.0	0.0%	14.5	2.1	15%	2.1	15%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R12	W16	Bedroom	7.4	7.4	0.0	0.0%	10.0	1.3	13%	1.3	13%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W17	Bedroom	7.7	7.7	0.0	0.0%													
		W18		8.5	8.5	0.0	0.0%	11.3	4.6	40%	4.6	40%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W19	LKD	9.3	9.3	0.0	0.0%													
		W20-L		0.1	0.1	0.0	12.5%													
		W20-U																		
		W21-L		0.9	0.9	0.0	1.1%													
		W21-U																		
		W22-L		5.4	5.4	0.0	0.0%													
		W22-U						43.1	15.1	35%	15.1	35%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	13.8	13.8	0.0	0.0%													
		W1-U																		
		W2-L		17.4	17.4	0.0	0.0%													
		W2-U																		
		W3		25.6	25.2	0.4	1.5%	33.5	23.6	70%	23.6	70%	0.0	0.2%	40	18	40	18	0.0%	0.0%
Third	R2	W4	Bedroom	24.4	24.0	0.4	1.6%	12.4	10.0	81%	10.0	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	LKD	9.9	9.6	0.4	3.5%													
		W5-U						32.4	22.7	70%	22.0	68%	0.7	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W6	Bedroom	19.6	19.3	0.3	1.7%	12.4	8.5	69%	8.5	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7	LKD	19.2	18.9	0.3	1.4%													
		W8-L		9.3	9.2	0.2	1.9%													
		W8-U						35.2	18.2	52%	18.0	51%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W9	Bedroom	14.5	14.4	0.1	1.0%	12.2	6.5	53%	6.5	53%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10	Bedroom	16.5	16.4	0.0	0.3%	11.5	8.0	69%	8.0	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Third	R8	W11-L	Studio	5.0	5.0	0.0	0.0%													
		W11-U						29.1	8.3	28%	8.3	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W12	LKD	11.6	11.6	0.0	0.0%													
		W13-L		2.5	2.5	0.0	0.0%													
		W13-U						35.1	11.2	32%	11.2	32%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W14	Bedroom	7.0	7.0	0.0	0.0%	11.3	3.1	27%	3.1	27%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W15	Bedroom	8.1	8.1	0.0	0.0%	14.5	2.5	17%	2.5	17%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R12	W16	Bedroom	8.2	8.2	0.0	0.0%	10.0	1.6	16%	1.6	16%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W17	Bedroom	8.5	8.5	0.0	0.0%													
		W18		9.2	9.2	0.0	0.0%	11.3	4.9	43%	4.9	43%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W19	LKD	10.0	10.0	0.0	0.0%													
		W20-L		0.1	0.1	0.0	0.0%													
		W20-U																		
		W21-L		1.0	1.0	0.0	0.0%													
		W21-U																		
		W22-L		5.8	5.8	0.0	0.0%													
		W22-U						43.1	15.6	36%	15.6	36%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%													
		W1-U																		
		W2-L		17.3	17.3	0.0	0.0%													
		W2-U																		
		W3		26.7	26.1	0.6	2.3%	33.5	23.6	70%	23.6	70%	0.0	0.2%	39	18	39	18	0.0%	0.0%
Fourth	R2	W4	Bedroom	25.7	25.0	0.6	2.5%	12.4	10.1	81%	10.1	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	LKD	10.7	10.1	0.6	5.8%													
		W5-U						32.4	24.0	74%	24.0	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W6	Bedroom	21.2	20.6	0.6	2.9%	12.4	8.8	71%	8.8	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7	LKD	20.7	20.1	0.6	2.9%													
		W8-L		10.5	10.0	0.5	5.0%													
		W8-U						35.2	22.6	64%	22.1	63%	0.5	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W9	Bedroom	16.3	15.8	0.5	3.2%	12.2	7.4	61%	7.4	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10	Bedroom	18.3	17.9	0.4	2.3%	11.5	8.0	70%	8.0	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W11-L	Studio	6.9	6.8	0.1	0.9%													
		W11-U						29.1	15.6	54%	15.5	53%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W12	LKD	13.1	13.1	0.0	0.0%													
		W13-L		4.3	4.3	0.0	0.0%													
		W13-U						35.1	16.4	47%	16.4	47%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W14	Bedroom	7.7	7.7	0.0	0.0%	11.3	3.5	31%	3.5	31%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W15	Bedroom	9.1	9.1	0.0	0.0%	14.5	3.1	22%	3.1	22%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R12	W16	Bedroom	9.2	9.2	0.0	0.0%	10.0	2.1	21%	2.1	21%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R13	W17	Bedroom	9.4	9.4	0.0	0.0%												
		W18		10.1	10.1	0.0	0.0%	11.3	5.2	47%	5.2	47%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W19	LKD	10.8	10.8	0.0	0.0%												
		W20-L		0.1	0.1	0.0	0.0%												
		W20-U																	
		W21-L		1.0	1.0	0.0	0.0%												
		W21-U																	
		W22-L		6.3	6.3	0.0	0.0%												
		W22-U						43.1	16.5	38%	16.5	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%												
		W1-U																	
		W2-L		17.3	17.3	0.0	0.0%												
		W2-U																	
		W3		27.9	27.1	0.8	3.0%	33.5	23.6	70%	23.6	70%	0.0	0.1%	39	18	39	18	0.0%	0.0%
Fifth	R2	W4	Bedroom	27.0	26.1	0.9	3.2%	12.4	10.1	82%	10.1	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	LKD	11.4	10.6	0.9	7.6%												
		W5-U						32.4	24.8	76%	24.8	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W6	Bedroom	23.3	22.4	0.9	3.9%	12.4	8.8	71%	8.8	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7	LKD	22.4	21.5	0.9	4.1%												
		W8-L		11.7	10.8	0.9	7.6%												
		W8-U						35.2	29.2	83%	27.4	78%	1.8	6.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W9	Bedroom	18.2	17.3	0.9	5.1%	12.2	7.5	62%	7.5	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10	Bedroom	20.2	19.4	0.8	4.0%	11.5	8.1	70%	8.1	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W11-L	Studio	7.5	7.2	0.2	3.0%												
		W11-U						29.1	22.0	76%	21.9	75%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W12	LKD	14.5	14.5	0.0	0.0%												
		W13-L		4.7	4.7	0.0	0.0%												
		W13-U						35.1	26.7	76%	26.7	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W14	Bedroom	8.5	8.5	0.0	0.0%	11.3	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W15	Bedroom	10.0	10.0	0.0	0.0%	14.5	3.8	26%	3.8	26%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R12	W16	Bedroom	10.2	10.2	0.0	0.0%	10.0	3.0	30%	3.0	30%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W17	Bedroom	10.4	10.4	0.0	0.0%												
		W18		10.9	10.9	0.0	0.0%	11.3	5.7	50%	5.7	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W19	LKD	11.5	11.5	0.0	0.0%												
		W20-L		0.2	0.2	0.0	0.0%												
		W20-U																	
		W21-L		1.0	1.0	0.0	0.0%												
		W21-U																	
		W22-L		6.8	6.8	0.0	0.0%												
		W22-U						43.1	17.8	41%	17.8	41%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%													
		W1-U																		
		W2-L		17.3	17.3	0.0	0.0%													
		W2-U																		
		W3		29.1	28.0	1.0	3.5%	33.5	23.6	70%	23.6	70%	0.0	0.0%	39	18	39	18	0.0%	0.0%
Sixth	R2	W4	Bedroom	28.3	27.2	1.1	3.8%	12.4	10.1	82%	10.1	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W5-L	LKD	26.7	25.6	1.1	4.2%													
		W5-U						32.4	25.0	77%	25.0	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W6	Bedroom	25.6	24.4	1.1	4.5%	12.4	8.9	72%	8.9	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7	LKD	24.0	22.8	1.2	5.0%													
		W8-L		14.0	12.8	1.2	8.6%													
		W8-U						35.2	30.5	87%	29.0	82%	1.5	4.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W9	Bedroom	20.0	18.7	1.3	6.3%	12.2	7.6	63%	7.6	63%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10	Bedroom	22.0	20.8	1.1	5.2%	11.5	8.3	72%	8.3	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W11-L	Studio	9.7	9.3	0.4	3.6%													
		W11-U						29.1	23.9	82%	23.7	82%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W12	LKD	15.8	15.8	0.0	0.0%													
		W13-L		6.3	6.3	0.0	0.0%													
		W13-U						35.1	29.8	85%	29.8	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W14	Bedroom	8.9	8.9	0.0	0.0%	11.3	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W15	Bedroom	11.0	11.0	0.0	0.0%	14.5	3.9	27%	3.9	27%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R12	W16	Bedroom	11.2	11.2	0.0	0.0%	10.0	3.5	35%	3.5	35%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W17	Bedroom	11.4	11.4	0.0	0.0%													
		W18		11.8	11.8	0.0	0.0%	11.3	6.1	54%	6.1	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W19	LKD	12.1	12.1	0.0	0.0%													
		W20-L		0.4	0.4	0.0	0.0%													
		W20-U																		
		W21-L		1.1	1.1	0.0	0.0%													
		W21-U																		
		W22-L		7.4	7.4	0.0	0.0%													
		W22-U						43.1	19.6	46%	19.6	46%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	36.1	36.1	0.0	0.0%													
		W1-U																		
		W2-L		33.2	33.2	0.0	0.0%													
		W2-U																		
		W3		25.4	24.1	1.3	5.1%													
		W4-L		14.0	12.6	1.4	9.7%													
		W4-U						39.4	39.4	100%	39.3	100%	0.1	0.2%	72	26	72	26	0.0%	0.0%
Seventh	R2	W5	Bedroom	21.5	20.1	1.4	6.3%	12.3	7.8	64%	7.8	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W6	Bedroom	23.4	22.2	1.3	5.4%	11.2	8.3	74%	8.3	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R4	W7-L	Studio	9.6	9.2	0.4	4.4%													
		W7-U						29.2	23.7	81%	23.6	81%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8	LKD	17.0	17.0	0.0	0.0%													
		W9-L		6.3	6.3	0.0	0.0%													
		W9-U						34.2	29.9	87%	29.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10	Bedroom	9.6	9.6	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W11	Bedroom	12.0	12.0	0.0	0.0%	14.5	4.0	28%	4.0	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W12	Bedroom	12.3	12.3	0.0	0.0%	10.1	3.7	36%	3.7	36%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R9	W13	Bedroom	12.4	12.4	0.0	0.0%													
		W14		12.7	12.7	0.0	0.0%	11.2	6.5	58%	6.5	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R10	W15	LKD	12.9	12.9	0.0	0.0%													
		W16-L		0.6	0.6	0.0	0.0%													
		W16-U																		
		W17-L		1.2	1.2	0.0	0.0%													
		W17-U																		
		W18-L		8.1	8.1	0.0	0.0%													
		W18-U						42.4	21.1	50%	21.1	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1	LKD	37.0	37.0	0.0	0.0%													
		W2-L		38.7	38.7	0.0	0.0%													
		W2-U																		
		W3-L		38.5	38.5	0.0	0.0%													
		W3-U																		
		W4		26.4	25.2	1.2	4.6%	34.8	33.4	96%	33.4	96%	0.0	0.0%	87	30	87	30	0.0%	0.0%
Eighth	R2	W5-L	Bedroom	14.7	13.5	1.3	8.5%													
		W5-U						8.3	7.0	85%	7.0	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W6	Bedroom	22.6	21.3	1.3	5.6%	11.8	7.7	65%	7.7	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W7	Bedroom	24.5	23.3	1.2	4.8%	11.2	8.7	78%	8.7	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W8-L	Studio	10.3	10.0	0.4	3.8%													
		W8-U						29.2	23.8	81%	23.6	81%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W9	LKD	17.9	17.9	0.0	0.0%													
		W10-L		6.8	6.8	0.0	0.0%													
		W10-U						34.2	30.2	88%	30.2	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W11	Bedroom	10.1	10.1	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W12	Bedroom	12.8	12.8	0.0	0.0%	14.5	4.0	28%	4.0	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W13	Bedroom	13.1	13.1	0.0	0.0%	10.1	3.8	38%	3.8	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W14	Bedroom	13.2	13.2	0.0	0.0%													
		W15		13.4	13.4	0.0	0.0%	11.2	6.9	62%	6.9	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W16	LKD	13.6	13.6	0.0	0.0%													
		W17-L		0.7	0.7	0.0	0.0%													
		W17-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W18-L		1.3	1.3	0.0	0.0%													
		W18-U																		
		W19-L		8.8	8.8	0.0	0.0%													
		W19-U						42.4	21.6	51%	21.6	51%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1	LKD	37.2	37.2	0.0	0.0%													
		W2-L		38.8	38.8	0.0	0.0%													
		W2-U																		
		W3-L		38.7	38.7	0.0	0.0%													
		W3-U																		
		W4		27.7	26.5	1.1	4.0%	34.8	33.4	96%	33.4	96%	0.0	0.0%	89	30	89	30	0.0%	0.0%
Ninth	R2	W5-L	Bedroom	15.8	14.6	1.2	7.3%													
		W5-U						8.3	7.2	88%	7.2	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W6	Bedroom	23.9	22.8	1.2	4.9%	11.8	8.4	71%	8.4	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W7	Bedroom	25.9	24.8	1.1	4.2%	11.2	9.3	83%	9.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W8-L	Studio	11.3	10.9	0.4	3.3%													
		W8-U						29.2	23.8	81%	23.7	81%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9	LKD	19.1	19.1	0.0	0.0%													
		W10-L		7.3	7.3	0.0	0.0%													
		W10-U						34.2	30.6	89%	30.6	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W11	Bedroom	10.7	10.7	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W12	Bedroom	13.6	13.6	0.0	0.0%	14.5	4.1	28%	4.1	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W13	Bedroom	13.9	13.9	0.0	0.0%	10.1	4.0	39%	4.0	39%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W14	Bedroom	13.9	13.9	0.0	0.0%													
		W15		14.2	14.2	0.0	0.0%	11.2	7.5	67%	7.5	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W16	LKD	14.4	14.4	0.0	0.0%													
		W17-L		0.8	0.8	0.0	0.0%													
		W17-U																		
		W18-L		1.4	1.4	0.0	0.0%													
		W18-U																		
		W19-L		9.4	9.4	0.0	0.0%													
		W19-U						42.4	22.1	52%	22.1	52%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1	LKD	37.4	37.4	0.0	0.0%													
		W2-L		39.0	39.0	0.0	0.0%													
		W2-U																		
		W3-L		38.8	38.8	0.0	0.0%													
		W3-U																		
		W4		29.9	28.9	1.0	3.4%	34.8	33.4	96%	33.4	96%	0.0	0.0%	90	30	90	30	0.0%	0.0%
Tenth	R2	W5-L	Bedroom	16.8	15.8	1.1	6.4%													
		W5-U						8.3	7.6	92%	7.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W6	Bedroom	26.4	25.3	1.1	4.1%	11.8	9.7	82%	9.7	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W7	Bedroom	27.5	26.5	1.0	3.6%	11.2	9.6	86%	9.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Tenth	R5	W8-L	Studio	12.2	11.9	0.3	2.8%													
		W8-U						29.2	24.2	83%	24.1	82%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9	LKD	20.9	20.9	0.0	0.0%													
		W10-L		7.7	7.7	0.0	0.0%													
		W10-U						34.2	30.9	90%	30.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W11	Bedroom	12.3	12.3	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W12	Bedroom	14.6	14.6	0.0	0.0%	14.5	4.1	28%	4.1	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W13	Bedroom	14.7	14.7	0.0	0.0%	10.1	4.1	41%	4.1	41%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R10	W14	Bedroom	14.7	14.7	0.0	0.0%													
		W15		15.0	15.0	0.0	0.0%	11.2	7.8	70%	7.8	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R11	W16	LKD	15.2	15.2	0.0	0.0%													
		W17-L		0.9	0.9	0.0	0.0%													
		W17-U																		
		W18-L		1.6	1.6	0.0	0.0%													
		W18-U																		
		W19-L		9.8	9.8	0.0	0.0%													
		W19-U						42.4	22.9	54%	22.9	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1	LKD	37.6	37.6	0.0	0.0%													
		W2-L		39.1	39.1	0.0	0.0%													
		W2-U																		
		W3-L		39.0	39.0	0.0	0.0%													
		W3-U																		
		W4		31.5	30.6	0.9	3.0%	34.8	33.4	96%	33.4	96%	0.0	0.0%	90	30	90	30	0.0%	0.0%
Eleventh	R2	W5-L	Bedroom	30.9	29.9	1.0	3.2%													
		W5-U						8.3	7.6	93%	7.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W6	Bedroom	30.2	29.2	1.0	3.3%	11.8	11.2	95%	11.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W7	Bedroom	29.0	28.0	0.9	3.2%	11.2	9.6	86%	9.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W8-L	Studio	26.0	25.7	0.3	1.2%													
		W8-U						29.2	25.5	87%	25.5	87%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9	LKD	22.8	22.8	0.0	0.0%													
		W10-L		16.0	16.0	0.0	0.0%													
		W10-U						34.2	31.2	91%	31.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W11	Bedroom	15.5	15.5	0.0	0.0%	11.1	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W12	Bedroom	15.4	15.4	0.0	0.0%	14.5	4.1	28%	4.1	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W13	Bedroom	15.5	15.5	0.0	0.0%	10.1	4.3	42%	4.3	42%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R10	W14	Bedroom	15.6	15.6	0.0	0.0%													
		W15		15.9	15.9	0.0	0.0%	11.2	8.0	71%	8.0	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R11	W16	LKD	16.1	16.1	0.0	0.0%													
		W17-L		0.9	0.9	0.0	0.0%													
		W17-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W18-L		1.7	1.7	0.0	0.0%													
		W18-U																		
		W19-L		10.3	10.3	0.0	0.0%													
		W19-U						42.4	24.1	57%	24.1	57%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1	LKD	37.7	37.7	0.0	0.0%													
		W2-L		39.2	39.2	0.0	0.0%													
		W2-U																		
		W3-L		39.1	39.1	0.0	0.0%													
		W3-U																		
		W4		32.9	32.0	0.9	2.6%	34.8	33.4	96%	33.4	96%	0.0	0.0%	90	30	90	30	0.0%	0.0%
Twelfth	R2	W5-L	Bedroom	32.1	31.3	0.9	2.7%													
		W5-U						8.3	7.7	93%	7.7	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W6	Bedroom	31.4	30.5	0.9	2.8%	11.8	11.2	95%	11.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W7	Bedroom	30.1	29.3	0.8	2.8%	11.2	9.6	86%	9.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W8-L	Studio	27.2	26.9	0.3	1.0%													
		W8-U						29.2	25.9	89%	25.9	89%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9	LKD	23.9	23.9	0.0	0.0%													
		W10-L		16.9	16.9	0.0	0.0%													
		W10-U						34.2	31.3	92%	31.3	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W11	Bedroom	16.5	16.5	0.0	0.0%	11.1	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W12	Bedroom	16.3	16.3	0.0	0.0%	14.5	4.1	29%	4.1	29%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W13	Bedroom	16.4	16.4	0.0	0.0%	10.1	4.3	43%	4.3	43%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R10	W14	Bedroom	16.5	16.5	0.0	0.0%													
		W15		16.8	16.8	0.0	0.0%	11.2	8.1	73%	8.1	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R11	W16	LKD	17.1	17.1	0.0	0.0%													
		W17-L		1.0	1.0	0.0	0.0%													
		W17-U																		
		W18-L		1.8	1.8	0.0	0.0%													
		W18-U																		
		W19-L		10.8	10.8	0.0	0.0%													
		W19-U						42.4	24.5	58%	24.5	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
The Gessner																				
First	R1	W1-L	LKD	33.9	33.9	0.0	0.0%													
		W1-U																		
		W2-L		33.8	33.8	0.0	0.0%													
		W2-U																		
		W3-L		10.7	10.2	0.4	4.1%													
		W3-U						37.2	28.7	77%	28.7	77%	0.0	0.0%	59	19	58	18	1.7%	5.3%
First	R2	W4-L	Bedroom	13.7	13.0	0.6	4.6%													
		W4-U						12.2	11.3	93%	11.3	93%	0.0	0.0%	26	13	25	12	3.8%	7.7%
First	R3	W5-L	Bedroom	27.3	26.6	0.7	2.5%													
		W5-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-L		28.7	28.1	0.6	2.0%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	60	18	59	17	1.7%	5.6%
First	R4	W7-L	Bedroom	13.4	12.8	0.5	4.1%													
		W7-U						11.9	9.3	78%	9.2	78%	0.1	0.9%	33	18	32	17	3.0%	5.6%
First	R5	W8-L	LKD	9.5	8.7	0.8	8.2%													
		W8-U						31.7	24.5	77%	24.5	77%	0.0	0.2%	17	13	16	12	5.9%	7.7%
First	R6	W9-L	Bedroom	15.9	15.3	0.6	3.6%													
		W9-U																		
		W10-L		16.8	16.8	0.0	0.0%													
		W10-U						14.2	12.2	86%	12.2	86%	0.0	0.0%	47	14	46	13	2.1%	7.1%
First	R7	W11-L	Bedroom	25.0	24.4	0.6	2.6%													
		W11-U						12.0	11.0	91%	11.0	91%	0.0	0.0%	53	18	51	17	3.8%	5.6%
First	R8	W12-L	LKD	10.9	10.2	0.7	6.5%													
		W12-U																		
		W13-L		12.3	11.4	0.9	7.6%													
		W13-U						34.1	25.3	74%	25.2	74%	0.0	0.1%	38	20	36	19	5.3%	5.0%
First	R9	W14-L	Bedroom	24.2	23.3	0.9	3.9%													
		W14-U						15.5	11.2	72%	11.2	72%	0.0	0.0%	50	14	48	13	4.0%	7.1%
First	R10	W15-L	Bedroom	24.7	24.0	0.7	2.7%													
		W15-U						13.4	10.5	78%	10.5	78%	0.0	0.0%	52	15	50	14	3.8%	6.7%
First	R11	W16-L	LKD	12.0	11.4	0.7	5.4%													
		W16-U																		
		W17-L		9.1	8.5	0.7	7.2%													
		W17-U																		
		W18-L		24.1	24.0	0.1	0.3%													
		W18-U						42.0	31.2	74%	30.0	71%	1.2	3.9%	48	16	46	15	4.2%	6.3%
First	R12	W19-L	Bedroom	26.5	26.2	0.3	1.2%													
		W19-U						12.2	10.7	88%	10.7	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W20-L	LKD	27.5	27.0	0.5	1.7%													
		W20-U																		
		W21-L		12.7	12.7	0.0	0.0%													
		W21-U																		
		W22-L		11.1	11.1	0.0	0.0%													
		W22-U						42.8	35.7	83%	35.6	83%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W23-L	Bedroom	23.9	23.9	0.0	0.0%													
		W23-U						12.5	10.8	87%	10.8	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R15	W24-L	Bedroom	23.7	23.7	0.0	0.0%													
		W24-U						14.6	12.2	84%	12.2	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R16	W25-L	LKD	11.2	11.2	0.0	0.0%													
		W25-U																		
		W26-L		8.7	8.7	0.0	0.0%													
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R17	W27-L	Bedroom	12.2	12.2	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R18	W28-L	Studio	8.7	8.7	0.0	0.0%													
		W28-U						42.7	21.5	50%	21.5	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R19	W29-L	Bedroom	14.3	14.3	0.0	0.0%													
		W29-U						13.1	7.8	59%	7.8	59%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R20	W30-L	LKD	19.1	19.1	0.0	0.0%													
		W30-U																		
		W31-L		20.7	20.7	0.0	0.0%													
		W31-U						32.3	26.5	82%	26.5	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R21	W32-L	Bedroom	22.1	22.1	0.0	0.0%													
		W32-U						12.7	8.3	65%	8.3	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R22	W33-L	Bedroom	24.6	24.6	0.0	0.0%													
		W33-U						13.8	10.7	78%	10.7	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R23	W34-L	LKD	5.6	5.5	0.0	0.7%													
		W34-U						33.3	18.4	55%	18.4	55%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R24	W35-L	Studio	28.1	27.8	0.3	0.9%													
		W35-U																		
		W36-L		29.0	28.6	0.4	1.3%													
		W36-U																		
		W37-L		29.5	29.1	0.4	1.3%													
		W37-U						39.0	31.8	81%	31.7	81%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R25	W38-L	Bedroom	29.9	29.5	0.4	1.3%													
		W38-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R26	W39-L	LKD	30.6	30.2	0.4	1.2%													
		W39-U																		
		W40-L		10.0	10.0	0.0	0.0%													
		W40-U						35.5	26.2	74%	26.2	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R27	W41-L	Bedroom	9.9	9.9	0.0	0.0%													
		W41-U						15.1	11.3	75%	11.3	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R28	W42-L	Bedroom	26.1	26.1	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	20	0	20	0	0.0%	0.0%
First	R29	W43-L	LKD	30.2	30.2	0.0	0.0%													
		W43-U																		
		W44-L		35.4	35.4	0.0	0.0%													
		W44-U						41.1	26.0	63%	26.0	63%	0.0	0.0%	55	16	55	16	0.0%	0.0%
Second	R1	W1-L	LKD	34.6	34.6	0.0	0.0%													
		W1-U																		
		W2-L		34.5	34.5	0.0	0.0%													
		W2-U																		
		W3-L		11.2	10.7	0.5	4.5%													
		W3-U						37.2	29.0	78%	29.0	78%	0.0	0.0%	61	20	60	19	1.6%	5.0%
Second	R2	W4-L	Bedroom	14.2	13.6	0.7	4.7%													
		W4-U						12.2	11.3	93%	11.3	93%	0.0	0.0%	27	13	26	12	3.7%	7.7%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R3	W5-L	Bedroom	27.9	27.2	0.7	2.6%												
		W5-U																	
		W6-L		29.3	28.7	0.6	2.2%												
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	60	18	59	17	1.7%	5.6%
Second	R4	W7-L	Bedroom	13.9	13.3	0.7	4.7%												
		W7-U						11.9	9.3	79%	9.3	78%	0.1	0.7%	33	18	32	17	3.0%	5.6%
Second	R5	W8-L	LKD	10.1	9.3	0.9	8.6%												
		W8-U						31.7	24.8	78%	24.8	78%	0.0	0.0%	19	14	18	13	5.3%	7.1%
Second	R6	W9-L	Bedroom	16.5	15.8	0.7	4.1%												
		W9-U																	
		W10-L		17.1	17.1	0.0	0.0%												
		W10-U						14.2	12.5	88%	12.5	88%	0.0	0.0%	48	15	47	14	2.1%	6.7%
Second	R7	W11-L	Bedroom	25.8	25.0	0.8	3.1%												
		W11-U						12.0	11.1	93%	11.1	93%	0.0	0.0%	55	20	53	19	3.6%	5.0%
Second	R8	W12-L	LKD	11.5	10.6	0.9	7.8%												
		W12-U																	
		W13-L		13.0	11.9	1.1	8.4%												
		W13-U						34.1	25.5	75%	25.5	75%	0.0	0.0%	39	21	37	20	5.1%	4.8%
Second	R9	W14-L	Bedroom	25.2	24.0	1.2	4.6%												
		W14-U						15.5	11.5	74%	11.5	74%	0.0	0.0%	53	16	50	14	5.7%	12.5%
Second	R10	W15-L	Bedroom	25.7	24.7	1.0	3.8%												
		W15-U						13.4	10.9	81%	10.9	81%	0.0	0.0%	56	18	53	16	5.4%	11.1%
Second	R11	W16-L	LKD	12.9	11.9	1.0	7.8%												
		W16-U																	
		W17-L		10.9	9.8	1.1	10.4%												
		W17-U																	
		W18-L		29.5	28.8	0.7	2.4%												
		W18-U						41.9	34.1	81%	33.3	79%	0.8	2.3%	57	19	53	16	7.0%	15.8%
Second	R12	W19-L	Bedroom	29.7	29.0	0.7	2.3%												
		W19-U						12.2	11.1	91%	11.1	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W20-L	LKD	30.0	29.2	0.8	2.6%												
		W20-U																	
		W21-L		13.4	13.4	0.0	0.0%												
		W21-U																	
		W22-L		11.6	11.6	0.0	0.0%												
		W22-U						42.8	35.8	84%	35.8	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W23-L	Bedroom	24.5	24.5	0.0	0.0%												
		W23-U						12.5	10.9	87%	10.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R15	W24-L	Bedroom	24.2	24.2	0.0	0.0%												
		W24-U						14.6	12.3	84%	12.3	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R16	W25-L	LKD	11.6	11.6	0.0	0.0%												
		W25-U																	
		W26-L		9.1	9.1	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R17	W27-L	Bedroom	12.5	12.5	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R18	W28-L	Studio	9.1	9.1	0.0	0.0%													
		W28-U						42.7	23.1	54%	23.1	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R19	W29-L	Bedroom	15.0	15.0	0.0	0.0%													
		W29-U						13.1	7.9	60%	7.9	60%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R20	W30-L	LKD	20.2	20.2	0.0	0.0%													
		W30-U																		
		W31-L		22.0	22.0	0.0	0.0%													
		W31-U						32.3	27.3	85%	27.3	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R21	W32-L	Bedroom	23.5	23.5	0.0	0.0%													
		W32-U						12.7	8.5	67%	8.5	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R22	W33-L	Bedroom	26.0	26.0	0.0	0.0%													
		W33-U						13.8	10.8	79%	10.8	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R23	W34-L	LKD	6.3	6.3	0.0	0.6%													
		W34-U						33.3	20.5	62%	20.5	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R24	W35-L	Studio	29.4	29.1	0.3	1.0%													
		W35-U																		
		W36-L		30.4	29.9	0.4	1.4%													
		W36-U																		
		W37-L		30.8	30.3	0.4	1.4%													
		W37-U						39.0	33.7	86%	33.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R25	W38-L	Bedroom	31.2	30.7	0.4	1.4%													
		W38-U						14.2	13.0	92%	13.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R26	W39-L	LKD	31.8	31.4	0.4	1.3%													
		W39-U																		
		W40-L		10.5	10.5	0.0	0.0%													
		W40-U						35.5	27.6	78%	27.6	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R27	W41-L	Bedroom	10.6	10.6	0.0	0.0%													
		W41-U						15.1	12.6	84%	12.6	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R28	W42-L	Bedroom	26.4	26.4	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	21	0	21	0	0.0%	0.0%
Second	R29	W43-L	LKD	30.4	30.4	0.0	0.0%													
		W43-U																		
		W44-L		35.9	35.9	0.0	0.0%													
		W44-U						41.1	27.1	66%	27.1	66%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Third	R1	W1-L	LKD	35.3	35.3	0.0	0.0%													
		W1-U																		
		W2-L		35.3	35.3	0.0	0.0%													
		W2-U																		
		W3-L		11.6	11.1	0.5	4.2%													
		W3-U						37.2	29.4	79%	29.4	79%	0.0	0.0%	61	20	61	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Third	R2	W4-L	Bedroom	14.7	14.1	0.6	4.3%													
		W4-U						12.2	11.3	93%	11.3	93%	0.0	0.0%	27	13	27	13	0.0%	0.0%
Third	R3	W5-L	Bedroom	28.4	27.7	0.7	2.4%													
		W5-U																		
		W6-L		29.9	29.2	0.6	2.1%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	61	19	61	19	0.0%	0.0%
Third	R4	W7-L	Bedroom	14.3	13.7	0.6	4.3%													
		W7-U						11.9	9.4	79%	9.3	79%	0.1	0.6%	34	19	34	19	0.0%	0.0%
Third	R5	W8-L	LKD	10.6	9.8	0.8	7.6%													
		W8-U						31.7	25.3	80%	25.2	79%	0.0	0.1%	21	15	20	14	4.8%	6.7%
Third	R6	W9-L	Bedroom	16.9	16.3	0.6	3.6%													
		W9-U																		
		W10-L		17.5	17.5	0.0	0.0%													
		W10-U						14.2	12.8	90%	12.8	90%	0.0	0.0%	50	16	49	15	2.0%	6.3%
Third	R7	W11-L	Bedroom	26.3	25.5	0.8	2.9%													
		W11-U						12.0	11.3	94%	11.3	94%	0.0	0.0%	55	20	53	19	3.6%	5.0%
Third	R8	W12-L	LKD	12.1	11.2	0.9	7.0%													
		W12-U																		
		W13-L		13.7	12.7	1.0	7.3%													
		W13-U						34.1	25.7	75%	25.7	75%	0.0	0.0%	41	22	39	21	4.9%	4.5%
Third	R9	W14-L	Bedroom	25.8	24.7	1.1	4.1%													
		W14-U						15.5	11.8	76%	11.8	76%	0.0	0.0%	54	17	51	15	5.6%	11.8%
Third	R10	W15-L	Bedroom	26.3	25.4	0.9	3.4%													
		W15-U						13.4	11.4	85%	11.4	85%	0.0	0.0%	56	18	53	16	5.4%	11.1%
Third	R11	W16-L	LKD	13.5	12.5	1.0	7.2%													
		W16-U																		
		W17-L		11.8	10.5	1.2	10.4%													
		W17-U																		
		W18-L		32.1	30.5	1.6	4.9%													
		W18-U						41.9	34.8	83%	34.1	81%	0.7	2.0%	58	20	54	17	6.9%	15.0%
Third	R12	W19-L	Bedroom	31.8	30.6	1.2	3.8%													
		W19-U						12.2	11.5	94%	11.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W20-L	LKD	31.5	30.6	0.9	2.9%													
		W20-U																		
		W21-L		14.1	14.1	0.0	0.0%													
		W21-U																		
		W22-L		12.4	12.4	0.0	0.0%													
		W22-U						42.8	35.8	84%	35.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W23-L	Bedroom	25.0	25.0	0.0	0.0%													
		W23-U						12.5	10.9	87%	10.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R15	W24-L	Bedroom	24.8	24.8	0.0	0.0%													
		W24-U						14.6	12.3	84%	12.3	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R16	W25-L	LKD	12.1	12.1	0.0	0.0%													
		W25-U																		
		W26-L		9.4	9.4	0.0	0.0%													
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R17	W27-L	Bedroom	12.7	12.7	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R18	W28-L	Studio	9.6	9.6	0.0	0.0%													
		W28-U						42.7	26.1	61%	26.1	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R19	W29-L	Bedroom	15.9	15.9	0.0	0.0%													
		W29-U						13.1	7.9	61%	7.9	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R20	W30-L	LKD	21.5	21.5	0.0	0.0%													
		W30-U																		
		W31-L		23.4	23.4	0.0	0.0%													
		W31-U						32.3	28.2	87%	28.2	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R21	W32-L	Bedroom	24.9	24.9	0.0	0.0%													
		W32-U						12.7	8.9	70%	8.9	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R22	W33-L	Bedroom	27.7	27.7	0.0	0.0%													
		W33-U						13.8	11.1	81%	11.1	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R23	W34-L	LKD	7.3	7.2	0.1	0.8%													
		W34-U						33.3	22.0	66%	22.0	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R24	W35-L	Studio	30.9	30.6	0.3	1.1%													
		W35-U																		
		W36-L		31.8	31.3	0.4	1.4%													
		W36-U																		
		W37-L		32.1	31.7	0.5	1.5%													
		W37-U						39.0	36.5	94%	36.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R25	W38-L	Bedroom	32.4	32.0	0.5	1.4%													
		W38-U						14.2	13.4	95%	13.4	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R26	W39-L	LKD	33.0	32.5	0.4	1.3%													
		W39-U																		
		W40-L		10.7	10.7	0.0	0.0%													
		W40-U						35.5	28.9	82%	28.9	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R27	W41-L	Bedroom	11.3	11.3	0.0	0.0%													
		W41-U						15.1	14.4	96%	14.4	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R28	W42-L	Bedroom	26.7	26.7	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Third	R29	W43-L	LKD	30.5	30.5	0.0	0.0%													
		W43-U																		
		W44-L		36.4	36.4	0.0	0.0%													
		W44-U						41.1	28.6	70%	28.6	70%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Fourth	R1	W1-L	LKD	36.0	36.0	0.0	0.0%													
		W1-U																		
		W2-L		36.0	36.0	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		12.0	11.5	0.5	3.8%													
		W3-U						37.2	29.7	80%	29.7	80%	0.0	0.0%	64	21	64	21	0.0%	0.0%
Fourth	R2	W4-L	Bedroom	15.2	14.6	0.6	3.8%													
		W4-U						12.2	11.4	93%	11.4	93%	0.0	0.0%	28	14	28	14	0.0%	0.0%
Fourth	R3	W5-L	Bedroom	28.9	28.3	0.6	2.1%													
		W5-U																		
		W6-L		30.4	29.8	0.6	1.8%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	62	20	62	20	0.0%	0.0%
Fourth	R4	W7-L	Bedroom	14.7	14.2	0.6	3.8%													
		W7-U						11.9	9.5	81%	9.5	80%	0.1	0.6%	34	19	34	19	0.0%	0.0%
Fourth	R5	W8-L	LKD	11.0	10.3	0.7	6.5%													
		W8-U						31.7	25.6	81%	25.6	81%	0.0	0.0%	21	15	21	15	0.0%	0.0%
Fourth	R6	W9-L	Bedroom	17.3	16.8	0.5	3.0%													
		W9-U																		
		W10-L		17.8	17.8	0.0	0.0%													
		W10-U						14.2	13.1	92%	13.1	92%	0.0	0.0%	50	16	49	15	2.0%	6.3%
Fourth	R7	W11-L	Bedroom	26.9	26.3	0.7	2.5%													
		W11-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	56	20	54	19	3.6%	5.0%
Fourth	R8	W12-L	LKD	12.6	11.8	0.8	6.2%													
		W12-U																		
		W13-L		14.3	13.4	0.9	6.2%													
		W13-U						34.1	25.9	76%	25.9	76%	0.0	0.0%	42	22	41	21	2.4%	4.5%
Fourth	R9	W14-L	Bedroom	26.5	25.6	0.9	3.5%													
		W14-U						15.5	12.2	79%	12.2	79%	0.0	0.0%	55	18	52	16	5.5%	11.1%
Fourth	R10	W15-L	Bedroom	27.0	26.2	0.8	3.0%													
		W15-U						13.4	12.0	90%	12.0	90%	0.0	0.0%	57	19	54	17	5.3%	10.5%
Fourth	R11	W16-L	LKD	14.1	13.2	0.9	6.2%													
		W16-U																		
		W17-L		12.4	11.3	1.1	8.6%													
		W17-U																		
		W18-L		33.3	31.9	1.5	4.4%													
		W18-U						41.9	35.1	84%	34.8	83%	0.3	0.9%	62	21	59	19	4.8%	9.5%
Fourth	R12	W19-L	Bedroom	33.1	31.9	1.2	3.5%													
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R13	W20-L	LKD	32.8	32.0	0.9	2.7%													
		W20-U																		
		W21-L		14.4	14.4	0.0	0.0%													
		W21-U																		
		W22-L		13.0	13.0	0.0	0.0%													
		W22-U						42.8	36.0	84%	36.0	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W23-L	Bedroom	25.8	25.8	0.0	0.0%													
		W23-U						12.5	11.0	88%	11.0	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fourth	R15	W24-L	Bedroom	25.5	25.5	0.0	0.0%													
		W24-U						14.6	12.4	85%	12.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R16	W25-L	LKD	12.4	12.4	0.0	0.0%													
		W25-U																		
		W26-L		9.6	9.6	0.0	0.0%													
		W26-U						40.3	37.1	92%	37.1	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R17	W27-L	Bedroom	12.9	12.9	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R18	W28-L	Studio	10.5	10.5	0.0	0.0%													
		W28-U						42.7	28.1	66%	28.1	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R19	W29-L	Bedroom	17.3	17.3	0.0	0.0%													
		W29-U						13.1	8.1	62%	8.1	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R20	W30-L	LKD	23.1	23.1	0.0	0.0%													
		W30-U																		
		W31-L		25.2	25.2	0.0	0.0%													
		W31-U						32.3	28.9	90%	28.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R21	W32-L	Bedroom	26.8	26.8	0.0	0.0%													
		W32-U						12.7	9.5	75%	9.5	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R22	W33-L	Bedroom	29.5	29.5	0.0	0.0%													
		W33-U						13.8	11.5	84%	11.5	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R23	W34-L	LKD	8.0	7.9	0.1	1.0%													
		W34-U						33.3	23.1	69%	23.1	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R24	W35-L	Studio	32.5	32.1	0.4	1.2%													
		W35-U																		
		W36-L		33.1	32.7	0.5	1.4%													
		W36-U																		
		W37-L		33.4	32.9	0.5	1.5%													
		W37-U						39.0	38.1	98%	38.1	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R25	W38-L	Bedroom	33.7	33.2	0.5	1.5%													
		W38-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R26	W39-L	LKD	34.1	33.6	0.4	1.3%													
		W39-U																		
		W40-L		10.7	10.7	0.0	0.0%													
		W40-U						35.5	29.3	83%	29.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R27	W41-L	Bedroom	12.0	12.0	0.0	0.0%													
		W41-U						15.1	14.7	97%	14.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R28	W42-L	Bedroom	27.0	27.0	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Fourth	R29	W43-L	LKD	30.6	30.6	0.0	0.0%													
		W43-U																		
		W44-L		36.9	36.9	0.0	0.0%													
		W44-U						41.1	30.5	74%	30.5	74%	0.0	0.0%	57	17	57	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R1	W1-L	LKD	36.7	36.7	0.0	0.0%													
		W1-U																		
		W2-L		36.7	36.7	0.0	0.0%													
		W2-U																		
		W3-L		12.3	11.9	0.4	3.2%													
		W3-U						37.2	29.9	80%	29.9	80%	0.0	0.0%	65	22	65	22	0.0%	0.0%
Fifth	R2	W4-L	Bedroom	15.6	15.1	0.5	3.1%													
		W4-U						12.2	11.4	93%	11.4	93%	0.0	0.0%	29	15	29	15	0.0%	0.0%
Fifth	R3	W5-L	Bedroom	29.4	28.8	0.5	1.8%													
		W5-U																		
		W6-L		30.9	30.4	0.5	1.6%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	62	20	62	20	0.0%	0.0%
Fifth	R4	W7-L	Bedroom	15.1	14.6	0.5	3.2%													
		W7-U						11.9	9.8	82%	9.7	82%	0.0	0.5%	35	19	35	19	0.0%	0.0%
Fifth	R5	W8-L	LKD	11.5	10.9	0.6	5.3%													
		W8-U						31.7	25.6	81%	25.6	81%	0.0	0.0%	23	16	23	16	0.0%	0.0%
Fifth	R6	W9-L	Bedroom	17.7	17.3	0.4	2.3%													
		W9-U																		
		W10-L		18.2	18.2	0.0	0.0%													
		W10-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	50	16	49	15	2.0%	6.3%
Fifth	R7	W11-L	Bedroom	28.2	27.6	0.6	2.1%													
		W11-U						12.0	11.7	97%	11.7	97%	0.0	0.0%	56	20	54	19	3.6%	5.0%
Fifth	R8	W12-L	LKD	13.0	12.3	0.7	5.3%													
		W12-U																		
		W13-L		14.7	14.0	0.8	5.2%													
		W13-U						34.1	26.0	76%	26.0	76%	0.0	0.0%	45	23	43	22	4.4%	4.3%
Fifth	R9	W14-L	Bedroom	28.0	27.2	0.8	2.9%													
		W14-U						15.5	12.9	83%	12.9	83%	0.0	0.0%	58	18	55	16	5.2%	11.1%
Fifth	R10	W15-L	Bedroom	28.5	27.8	0.7	2.5%													
		W15-U						13.4	12.3	92%	12.3	92%	0.0	0.0%	62	19	59	17	4.8%	10.5%
Fifth	R11	W16-L	LKD	14.6	13.8	0.8	5.1%													
		W16-U																		
		W17-L		12.8	11.9	0.9	6.9%													
		W17-U																		
		W18-L		34.5	33.1	1.3	3.8%													
		W18-U						41.9	35.3	84%	35.2	84%	0.1	0.3%	67	22	64	20	4.5%	9.1%
Fifth	R12	W19-L	Bedroom	34.3	33.2	1.1	3.2%													
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W20-L	LKD	34.1	33.2	0.9	2.5%													
		W20-U																		
		W21-L		14.7	14.7	0.0	0.0%													
		W21-U																		
		W22-L		13.7	13.7	0.0	0.0%													
		W22-U						42.8	36.5	85%	36.5	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R14	W23-L	Bedroom	27.1	27.1	0.0	0.0%													
		W23-U						12.5	11.1	89%	11.1	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R15	W24-L	Bedroom	26.7	26.7	0.0	0.0%													
		W24-U						14.6	12.5	86%	12.5	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R16	W25-L	LKD	12.6	12.6	0.0	0.0%													
		W25-U																		
		W26-L		9.7	9.7	0.0	0.0%													
		W26-U						40.3	37.2	92%	37.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R17	W27-L	Bedroom	13.4	13.4	0.0	0.0%													
		W27-U						14.4	11.7	81%	11.7	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R18	W28-L	Studio	11.9	11.9	0.0	0.0%													
		W28-U						42.7	29.4	69%	29.4	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R19	W29-L	Bedroom	19.4	19.4	0.0	0.0%													
		W29-U						13.1	8.3	64%	8.3	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R20	W30-L	LKD	25.4	25.4	0.0	0.0%													
		W30-U																		
		W31-L		27.6	27.6	0.0	0.0%													
		W31-U						32.3	29.5	91%	29.5	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R21	W32-L	Bedroom	29.3	29.3	0.0	0.0%													
		W32-U						12.7	10.3	81%	10.3	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R22	W33-L	Bedroom	31.7	31.7	0.0	0.1%													
		W33-U						13.8	12.3	89%	12.3	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R23	W34-L	LKD	8.8	8.7	0.1	1.1%													
		W34-U						33.3	24.5	74%	24.5	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R24	W35-L	Studio	34.0	33.6	0.4	1.3%													
		W35-U																		
		W36-L		34.5	34.0	0.5	1.5%													
		W36-U																		
		W37-L		34.7	34.2	0.5	1.5%													
		W37-U						39.0	38.2	98%	38.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R25	W38-L	Bedroom	34.8	34.3	0.5	1.4%													
		W38-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R26	W39-L	LKD	35.1	34.7	0.4	1.3%													
		W39-U																		
		W40-L		10.9	10.9	0.0	0.0%													
		W40-U						35.5	29.4	83%	29.4	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R27	W41-L	Bedroom	12.6	12.6	0.0	0.0%													
		W41-U						15.1	14.8	98%	14.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R28	W42-L	Bedroom	27.3	27.3	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Fifth	R29	W43-L	LKD	30.6	30.6	0.0	0.0%													
		W43-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W44-L		37.4	37.4	0.0	0.0%													
		W44-U						41.1	33.7	82%	33.7	82%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Sixth	R1	W1-L	LKD	37.3	37.3	0.0	0.0%													
		W1-U																		
		W2-L		37.3	37.3	0.0	0.0%													
		W2-U																		
		W3-L		12.7	12.4	0.4	2.8%													
		W3-U						37.2	30.0	81%	30.0	81%	0.0	0.0%	67	24	67	24	0.0%	0.0%
Sixth	R2	W4-L	Bedroom	16.1	15.7	0.4	2.5%													
		W4-U						12.2	11.4	93%	11.4	93%	0.0	0.0%	31	17	31	17	0.0%	0.0%
Sixth	R3	W5-L	Bedroom	30.0	29.5	0.4	1.5%													
		W5-U																		
		W6-L		31.5	31.1	0.4	1.3%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	63	21	63	21	0.0%	0.0%
Sixth	R4	W7-L	Bedroom	15.6	15.2	0.4	2.8%													
		W7-U						11.9	9.9	84%	9.9	84%	0.0	0.5%	35	19	35	19	0.0%	0.0%
Sixth	R5	W8-L	LKD	11.9	11.4	0.5	4.4%													
		W8-U						31.7	25.8	81%	25.8	81%	0.0	0.0%	24	16	24	16	0.0%	0.0%
Sixth	R6	W9-L	Bedroom	18.1	17.7	0.4	2.2%													
		W9-U																		
		W10-L		18.5	18.5	0.0	0.0%													
		W10-U						14.2	13.7	96%	13.7	96%	0.0	0.0%	51	17	50	16	2.0%	5.9%
Sixth	R7	W11-L	Bedroom	31.2	30.6	0.6	1.9%													
		W11-U						12.0	11.7	97%	11.7	97%	0.0	0.0%	69	20	68	19	1.4%	5.0%
Sixth	R8	W12-L	LKD	31.1	30.4	0.6	2.0%													
		W12-U																		
		W13-L		31.0	30.4	0.6	2.1%													
		W13-U						34.1	27.1	80%	27.1	80%	0.0	0.0%	76	24	75	23	1.3%	4.2%
Sixth	R9	W14-L	Bedroom	31.0	30.3	0.7	2.2%													
		W14-U						15.5	13.5	87%	13.5	87%	0.0	0.0%	76	24	73	22	3.9%	8.3%
Sixth	R10	W15-L	Bedroom	31.0	30.3	0.7	2.3%													
		W15-U						13.4	12.3	92%	12.3	92%	0.0	0.0%	75	24	72	22	4.0%	8.3%
Sixth	R11	W16-L	LKD	31.0	30.3	0.7	2.4%													
		W16-U																		
		W17-L		31.4	30.7	0.8	2.4%													
		W17-U																		
		W18-L		35.5	34.3	1.2	3.4%													
		W18-U						41.9	35.5	85%	35.5	85%	0.0	0.1%	79	25	76	23	3.8%	8.0%
Sixth	R12	W19-L	Bedroom	35.4	34.4	1.0	2.9%													
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W20-L	LKD	35.2	34.4	0.9	2.4%													
		W20-U																		
		W21-L		31.2	31.2	0.0	0.0%													
		W21-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W22-L		30.0	30.0	0.0	0.0%													
		W22-U						42.8	37.4	87%	37.4	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W23-L	Bedroom	28.5	28.5	0.0	0.0%													
		W23-U						12.5	11.3	91%	11.3	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R15	W24-L	Bedroom	26.8	26.8	0.0	0.0%													
		W24-U						14.6	12.6	87%	12.6	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R16	W25-L	LKD	25.3	25.3	0.0	0.0%													
		W25-U																		
		W26-L		23.4	23.4	0.0	0.0%													
		W26-U						40.3	37.6	93%	37.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R17	W27-L	Bedroom	14.7	14.7	0.0	0.0%													
		W27-U						14.4	12.8	89%	12.8	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R18	W28-L	Studio	14.8	14.8	0.0	0.0%													
		W28-U						42.7	30.6	72%	30.6	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R19	W29-L	Bedroom	23.3	23.3	0.0	0.0%													
		W29-U						13.1	9.2	70%	9.2	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R20	W30-L	LKD	29.1	29.1	0.0	0.0%													
		W30-U																		
		W31-L		31.1	31.1	0.0	0.0%													
		W31-U						32.3	29.6	92%	29.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R21	W32-L	Bedroom	32.4	32.4	0.0	0.0%													
		W32-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R22	W33-L	Bedroom	34.1	34.1	0.1	0.2%													
		W33-U						13.8	12.8	93%	12.8	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R23	W34-L	LKD	9.4	9.3	0.1	1.3%													
		W34-U						33.3	26.4	79%	26.4	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R24	W35-L	Studio	35.5	35.0	0.5	1.4%													
		W35-U																		
		W36-L		35.7	35.2	0.5	1.5%													
		W36-U																		
		W37-L		35.9	35.3	0.5	1.5%													
		W37-U						39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R25	W38-L	Bedroom	35.9	35.4	0.5	1.4%													
		W38-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R26	W39-L	LKD	36.1	35.6	0.5	1.2%													
		W39-U																		
		W40-L		10.8	10.8	0.0	0.0%													
		W40-U						35.5	29.4	83%	29.4	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R27	W41-L	Bedroom	13.3	13.3	0.0	0.0%													
		W41-U						15.1	15.0	99%	15.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R28	W42-L	Bedroom	27.6	27.6	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	23	2	23	2	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R29	W43-L	LKD	30.9	30.9	0.0	0.0%													
		W43-U																		
		W44-L		37.9	37.9	0.0	0.0%													
		W44-U						41.1	36.0	88%	36.0	88%	0.0	0.0%	58	18	58	18	0.0%	0.0%
Seventh	R1	W1-L	LKD	38.0	38.0	0.0	0.0%													
		W1-U																		
		W2-L		38.0	38.0	0.0	0.0%													
		W2-U																		
		W3-L		14.6	14.2	0.3	2.3%													
		W3-U						37.2	30.1	81%	30.1	81%	0.0	0.0%	67	24	67	24	0.0%	0.0%
Seventh	R2	W4-L	Bedroom	17.5	17.1	0.4	2.1%													
		W4-U						12.2	11.4	93%	11.4	93%	0.0	0.0%	34	18	34	18	0.0%	0.0%
Seventh	R3	W5-L	Bedroom	30.7	30.4	0.4	1.3%													
		W5-U																		
		W6-L		32.3	31.9	0.4	1.2%													
		W6-U						11.7	11.5	98%	11.5	98%	0.0	0.0%	63	21	63	21	0.0%	0.0%
Seventh	R4	W7-L	Bedroom	17.0	16.6	0.4	2.4%													
		W7-U						13.0	11.4	88%	11.4	87%	0.0	0.3%	39	21	39	21	0.0%	0.0%
Seventh	R5	W8-L	LKD	13.8	13.4	0.5	3.3%													
		W8-U						31.7	25.9	82%	25.9	82%	0.0	0.0%	25	18	25	18	0.0%	0.0%
Seventh	R6	W9-L	Bedroom	19.2	18.7	0.5	2.5%													
		W9-U																		
		W10-L		22.5	22.0	0.5	2.2%													
		W10-U						14.9	14.7	98%	14.6	98%	0.0	0.2%	51	18	50	17	2.0%	5.6%
Seventh	R7	W11-L	LKD	9.1	8.7	0.4	4.6%													
		W11-U																		
		W12-L		9.0	8.6	0.4	3.9%													
		W12-U						27.3	24.8	91%	24.8	91%	0.0	0.0%	16	16	15	15	6.3%	6.3%
Seventh	R8	W13-L	Bedroom	6.1	6.1	0.0	0.0%													
		W13-U						12.0	9.1	76%	9.1	76%	0.0	0.0%	11	11	11	11	0.0%	0.0%
Seventh	R9	W14-L	Bedroom	20.4	19.8	0.6	2.9%													
		W14-U																		
		W15-L		20.5	19.9	0.6	3.0%													
		W15-U						13.3	13.1	99%	13.1	99%	0.0	0.0%	46	26	44	24	4.3%	7.7%
Seventh	R10	W16-L	Bedroom	21.3	20.6	0.6	3.0%													
		W16-U						11.6	9.8	85%	9.8	85%	0.0	0.0%	44	23	41	21	6.8%	8.7%
Seventh	R11	W17-L	LKD	7.3	6.6	0.6	8.7%													
		W17-U																		
		W18-L		11.1	10.4	0.7	6.2%													
		W18-U																		
		W19-L		36.5	35.4	1.1	3.0%													
		W19-U																		
		W20-L		36.5	35.4	1.1	2.9%													
		W20-U						42.6	35.5	83%	35.1	82%	0.4	1.2%	46	16	43	14	6.5%	12.5%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Seventh	R12	W21-L	LKD	36.4	35.5	1.0	2.7%												
		W21-U																	
		W22-L		36.4	35.5	0.9	2.5%												
		W22-U																	
		W23-L		9.6	9.6	0.0	0.0%												
		W23-U						36.0	32.5	90%	32.5	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R13	W24-L	Bedroom	20.9	20.9	0.0	0.0%												
		W24-U																	
		W25-L		20.4	20.4	0.0	0.0%												
		W25-U						16.2	14.4	89%	14.4	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R14	W26-L	Bedroom	19.3	19.3	0.0	0.0%												
		W26-U						15.7	13.7	87%	13.7	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R15	W27-L	LKD	7.7	7.7	0.0	0.0%												
		W27-U																	
		W28-L		8.5	8.5	0.0	0.0%												
		W28-U						31.0	27.9	90%	27.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R16	W29-L	Bedroom	17.8	17.8	0.0	0.0%												
		W29-U						14.3	13.4	94%	13.4	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R17	W30-L	Studio	22.5	22.5	0.0	0.0%												
		W30-U						42.7	37.0	87%	37.0	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R18	W31-L	Bedroom	30.8	30.8	0.0	0.0%												
		W31-U						13.1	12.8	97%	12.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R19	W32-L	LKD	34.2	34.2	0.0	0.0%												
		W32-U																	
		W33-L		35.1	35.0	0.1	0.4%												
		W33-U						32.3	29.6	92%	29.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R20	W34-L	Bedroom	35.6	35.3	0.3	0.7%												
		W34-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R21	W35-L	Bedroom	36.2	35.8	0.4	1.1%												
		W35-U						13.8	12.9	94%	12.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R22	W36-L	LKD	10.4	10.3	0.2	1.5%												
		W36-U						33.3	27.8	83%	27.8	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R23	W37-L	Studio	36.7	36.1	0.6	1.6%												
		W37-U																	
		W38-L		36.8	36.2	0.6	1.5%												
		W38-U																	
		W39-L		36.8	36.3	0.5	1.5%												
		W39-U						39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R24	W40-L	Bedroom	36.9	36.3	0.5	1.5%												
		W40-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R25	W41-L	LKD	36.9	36.4	0.5	1.3%												
		W41-U																	
		W42-L		24.4	24.4	0.0	0.0%												
		W42-U						35.5	29.8	84%	29.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R26	W43-L	Bedroom	28.7	28.7	0.0	0.0%													
		W43-U						15.1	15.0	99%	15.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R27	W44-L	Bedroom	27.9	27.9	0.0	0.0%													
		W44-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	24	3	24	3	0.0%	0.0%
Seventh	R28	W45-L	LKD	32.2	32.2	0.0	0.0%													
		W45-U																		
		W46-L		38.4	38.4	0.0	0.0%													
		W46-U						41.1	36.1	88%	36.1	88%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Eighth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		38.6	38.6	0.0	0.0%													
		W2-U																		
		W3-L		13.8	13.5	0.3	2.3%													
		W3-U						37.1	30.8	83%	30.8	83%	0.0	0.0%	69	26	69	26	0.0%	0.0%
Eighth	R2	W4-L	Bedroom	17.4	17.1	0.3	1.9%													
		W4-U						12.2	11.4	94%	11.4	94%	0.0	0.0%	35	18	35	18	0.0%	0.0%
Eighth	R3	W5-L	Bedroom	32.4	32.0	0.4	1.1%													
		W5-U																		
		W6-L		33.9	33.5	0.4	1.1%													
		W6-U						12.0	11.9	99%	11.9	99%	0.0	0.0%	76	23	76	23	0.0%	0.0%
Eighth	R4	W7-L	Bedroom	17.0	16.6	0.4	2.2%													
		W7-U						11.8	10.3	87%	10.2	86%	0.0	0.3%	40	20	40	20	0.0%	0.0%
Eighth	R5	W8-L	LKD	13.2	12.8	0.4	3.1%													
		W8-U																		
		W9-L		35.1	34.3	0.8	2.3%													
		W9-U						31.6	28.2	89%	28.1	89%	0.1	0.4%	48	18	48	18	0.0%	0.0%
Eighth	R7	W12-L	Bedroom	35.1	34.8	0.3	0.9%													
		W12-U						16.2	15.4	95%	15.4	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W13-L	LKD	11.8	11.2	0.5	4.5%													
		W13-U						40.8	29.8	73%	29.0	71%	0.8	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W14-L	Bedroom	37.3	36.7	0.6	1.6%													
		W14-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W15-L	Bedroom	37.4	36.8	0.6	1.6%													
		W15-U						14.2	13.7	96%	13.7	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W16-L	Bedroom	37.5	36.9	0.6	1.7%													
		W16-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R12	W17-L	Bedroom	37.6	36.9	0.6	1.7%													
		W17-U						12.8	12.3	96%	12.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R13	W18-L	LKD	10.6	10.4	0.2	1.6%													
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R14	W19-L	Studio	37.6	37.0	0.6	1.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W19-U																	
		W20-L		37.6	37.1	0.6	1.5%												
		W20-U																	
		W21-L		37.6	37.1	0.6	1.5%												
		W21-U						39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R15	W22-L	Bedroom	37.7	37.1	0.6	1.5%												
		W22-U						12.8	11.9	93%	11.9	93%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R16	W23-L	LKD	37.7	37.2	0.5	1.3%												
		W23-U																	
		W24		39.5	39.5	0.0	0.0%												
		W25-L		39.5	39.5	0.0	0.0%												
		W25-U						35.3	33.3	94%	33.3	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R17	W26	Bedroom	39.5	39.5	0.0	0.0%	11.4	10.5	93%	10.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R18	W27-L	LKD	39.5	39.5	0.0	0.0%												
		W27-U																	
		W28-L		38.8	38.8	0.0	0.0%												
		W28-U						32.6	28.8	88%	28.8	88%	0.0	0.0%	61	19	61	19	0.0%	0.0%
Ninth	R1	W1-L	LKD	39.1	39.1	0.0	0.0%												
		W1-U																	
		W2-L		39.1	39.1	0.0	0.0%												
		W2-U																	
		W3-L		35.7	35.4	0.3	0.8%												
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	94	26	94	26	0.0%	0.0%
Ninth	R2	W4-L	Bedroom	35.6	35.3	0.3	0.9%												
		W4-U						12.2	11.4	94%	11.4	94%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Ninth	R3	W5-L	Bedroom	35.6	35.2	0.3	0.9%												
		W5-U																	
		W6-L		35.6	35.2	0.3	1.0%												
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Ninth	R4	W7-L	Bedroom	35.3	34.9	0.4	1.0%												
		W7-U						11.8	10.5	89%	10.5	89%	0.0	0.0%	81	24	81	24	0.0%	0.0%
Ninth	R5	W8-L	LKD	35.2	34.8	0.4	1.1%												
		W8-U																	
		W9-L		37.8	37.0	0.8	2.0%												
		W9-U						31.6	28.2	89%	28.1	89%	0.1	0.4%	84	25	84	25	0.0%	0.0%
Ninth	R6	W10-L	Studio	37.9	37.2	0.7	1.9%												
		W10-U																	
		W11-L		37.9	37.2	0.8	2.0%												
		W11-U																	
		W12-L		38.0	37.3	0.7	1.8%												
		W12-U						31.9	31.4	98%	31.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W13-L	LKD	12.6	11.9	0.6	4.9%												
		W13-U						33.0	24.6	74%	24.3	74%	0.3	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	38.1	37.4	0.7	1.8%												
		W14-U						13.7	13.4	97%	13.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ninth	R9	W15-L	Bedroom	38.1	37.5	0.7	1.7%												
		W15-U						15.2	14.6	96%	14.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W16-L	Bedroom	38.2	37.5	0.6	1.7%												
		W16-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W17-L	Bedroom	38.2	37.6	0.6	1.6%												
		W17-U						12.8	12.3	96%	12.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R12	W18-L	LKD	11.1	10.9	0.2	1.5%												
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R13	W19-L	Studio	38.2	37.7	0.6	1.5%												
		W19-U																		
		W20-L		38.3	37.7	0.6	1.5%												
		W20-U																		
		W21-L		38.3	37.7	0.6	1.5%												
		W21-U						39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R14	W22-L	Bedroom	38.3	37.7	0.5	1.4%												
		W22-U						12.8	11.9	93%	11.9	93%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R15	W23-L	LKD	38.3	37.8	0.5	1.3%												
		W23-U																		
		W24		39.5	39.5	0.0	0.0%												
		W25-L		39.5	39.5	0.0	0.0%												
		W25-U						35.3	32.8	93%	32.8	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R16	W26	Bedroom	39.5	39.5	0.0	0.0%	11.4	10.5	93%	10.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R17	W27-L	LKD	39.6	39.6	0.0	0.0%												
		W27-U																		
		W28-L		39.2	39.2	0.0	0.0%												
		W28-U						32.6	28.8	88%	28.8	88%	0.0	0.0%	61	19	61	19	0.0%	0.0%
Tenth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%												
		W1-U																		
		W2-L		39.5	39.5	0.0	0.0%												
		W2-U																		
		W3-L		36.1	35.8	0.3	0.8%												
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	95	27	95	27	0.0%	0.0%
Tenth	R2	W4-L	Bedroom	36.0	35.7	0.3	0.8%												
		W4-U						12.2	11.4	94%	11.4	94%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Tenth	R3	W5-L	Bedroom	36.0	35.6	0.3	0.9%												
		W5-U																		
		W6-L		35.9	35.6	0.3	0.9%												
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Tenth	R4	W7-L	Bedroom	35.7	35.4	0.3	1.0%												
		W7-U						11.8	10.5	89%	10.5	89%	0.0	0.0%	81	24	81	24	0.0%	0.0%
Tenth	R5	W8-L	LKD	35.6	35.2	0.4	1.0%												
		W8-U																		
		W9-L		38.2	37.5	0.7	1.8%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W9-U						31.6	28.2	89%	28.1	89%	0.1	0.4%	84	25	84	25	0.0%	0.0%
Tenth	R6	W10-L	Studio	38.3	37.7	0.7	1.7%													
		W10-U																		
		W11-L		38.4	37.7	0.7	1.8%													
		W11-U																		
		W12-L		38.4	37.8	0.6	1.7%													
		W12-U						31.9	31.4	98%	31.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W13-L	LKD	12.8	12.2	0.6	4.5%													
		W13-U						33.0	24.6	74%	24.3	74%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	38.5	37.9	0.6	1.6%													
		W14-U						13.7	13.4	97%	13.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W15-L	Bedroom	38.6	38.0	0.6	1.6%													
		W15-U						15.2	14.6	96%	14.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R10	W16-L	Bedroom	38.6	38.0	0.6	1.6%													
		W16-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R11	W17-L	Bedroom	38.6	38.1	0.6	1.5%													
		W17-U						12.8	12.3	96%	12.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R12	W18-L	LKD	11.4	11.2	0.2	1.4%													
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R13	W19-L	Bedroom	31.6	31.1	0.5	1.7%													
		W19-U																		
		W20-L		31.6	31.1	0.5	1.7%													
		W20-U						13.1	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R14	W21-L	Bedroom	31.6	31.1	0.5	1.7%													
		W21-U																		
		W22-L		31.6	31.1	0.5	1.6%													
		W22-U						11.9	11.8	100%	11.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R15	W23-L	LKD	31.6	31.1	0.5	1.6%													
		W23-U																		
		W24-L		31.6	31.1	0.5	1.5%													
		W24-U																		
		W25-L		5.0	5.0	0.0	0.0%													
		W25-U						33.8	31.5	93%	31.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R16	W26-L	Studio	34.2	34.2	0.0	0.0%													
		W26-U																		
		W27-L		31.3	31.3	0.0	0.0%													
		W27-U																		
		W28-L		31.8	31.8	0.0	0.0%													
		W28-U																		
		W29-L		31.7	31.7	0.0	0.0%													
		W29-U																		
		W30-L		34.2	34.2	0.0	0.0%													
		W30-U						38.0	37.4	98%	37.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R17	W31-L	LKD	4.7	4.7	0.0	0.0%													
		W31-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W32-L		39.5	39.5	0.0	0.0%													
		W32-U																		
		W33-L		39.5	39.5	0.0	0.0%													
		W33-U																		
		W34-L		39.5	39.5	0.0	0.0%													
		W34-U																		
		W35-L		39.5	39.5	0.0	0.0%													
		W35-U						38.4	37.1	97%	37.1	97%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Eleventh	R1	W1-L	LKD	39.6	39.6	0.0	0.0%													
		W1-U																		
		W2-L		39.6	39.6	0.0	0.0%													
		W2-U																		
		W3-L		36.4	36.2	0.3	0.7%													
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	96	28	96	28	0.0%	0.0%
Eleventh	R2	W4-L	Bedroom	36.4	36.1	0.3	0.7%													
		W4-U						12.2	11.4	94%	11.4	94%	0.0	0.0%	84	27	84	27	0.0%	0.0%
Eleventh	R3	W5-L	Bedroom	36.3	36.0	0.3	0.8%													
		W5-U																		
		W6-L		36.3	36.0	0.3	0.8%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	85	28	85	28	0.0%	0.0%
Eleventh	R4	W7-L	Bedroom	36.1	35.8	0.3	0.9%													
		W7-U						11.8	10.5	89%	10.5	89%	0.0	0.0%	82	25	82	25	0.0%	0.0%
Eleventh	R5	W8-L	LKD	36.0	35.7	0.3	0.9%													
		W8-U																		
		W9-L		38.5	37.9	0.6	1.7%													
		W9-U						31.6	28.2	89%	28.1	89%	0.1	0.4%	85	26	85	26	0.0%	0.0%
Eleventh	R6	W10-L	Studio	38.6	38.0	0.6	1.6%													
		W10-U																		
		W11-L		38.7	38.0	0.6	1.7%													
		W11-U																		
		W12-L		38.7	38.1	0.6	1.5%													
		W12-U						31.9	31.4	98%	31.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W13-L	LKD	13.1	12.6	0.5	4.0%													
		W13-U						32.7	24.1	74%	23.9	73%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	30.7	30.1	0.6	1.9%													
		W14-U																		
		W15-L		31.7	31.2	0.6	1.8%													
		W15-U						13.5	13.4	99%	13.4	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W16-L	Bedroom	30.7	30.2	0.6	1.8%													
		W16-U																		
		W17-L		31.7	31.2	0.5	1.7%													
		W17-U						13.4	13.1	98%	13.1	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R10	W18-L	Bedroom	31.7	31.2	0.5	1.7%													
		W18-U																		
		W19-L		30.8	30.2	0.5	1.7%													
		W19-U						11.8	11.7	99%	11.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eleventh	R11	W20-L	Bedroom	31.7	31.2	0.5	1.6%													
		W20-U																		
		W21-L		31.8	31.2	0.5	1.6%													
		W21-U						12.5	12.4	99%	12.4	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R12	W22-L	LKD	23.9	23.7	0.2	0.6%													
		W22-U						33.0	27.6	84%	27.6	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R13	W23-L	Bedroom	30.5	29.9	0.5	1.7%													
		W23-U																		
		W24-L		30.5	30.0	0.5	1.6%													
		W24-U						13.1	13.1	99%	13.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R14	W25-L	Bedroom	30.4	30.0	0.5	1.6%													
		W25-U																		
		W26-L		30.4	30.0	0.5	1.5%													
		W26-U						11.9	11.8	100%	11.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R15	W27-L	LKD	30.5	30.0	0.5	1.5%													
		W27-U																		
		W28-L		30.4	30.0	0.4	1.4%													
		W28-U																		
		W29-L		5.0	5.0	0.0	0.0%													
		W29-U						33.8	31.5	93%	31.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R16	W30-L	Studio	32.5	32.5	0.0	0.0%													
		W30-U																		
		W31-L		32.3	32.3	0.0	0.0%													
		W31-U																		
		W32-L		32.9	32.9	0.0	0.0%													
		W32-U																		
		W33-L		32.8	32.8	0.0	0.0%													
		W33-U																		
		W34-L		32.4	32.4	0.0	0.0%													
		W34-U						38.0	37.4	98%	37.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R17	W35-L	LKD	4.7	4.7	0.0	0.0%													
		W35-U																		
		W36-L		39.6	39.6	0.0	0.0%													
		W36-U																		
		W37-L		39.6	39.6	0.0	0.0%													
		W37-U																		
		W38-L		39.6	39.6	0.0	0.0%													
		W38-U																		
		W39-L		39.6	39.6	0.0	0.0%													
		W39-U						38.4	37.1	97%	37.1	97%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Twelfth	R1	W1-L	LKD	8.6	8.6	0.0	0.0%													
		W1-U																		
		W2-L		36.7	36.5	0.2	0.6%													
		W2-U																		
		W3-L		36.7	36.4	0.2	0.7%													
		W3-U																		
		W4-L		36.6	36.4	0.3	0.7%													
		W4-U						30.7	29.3	96%	29.3	96%	0.0	0.0%	93	29	93	29	0.0%	0.0%
Twelfth	R2	W5-L	Bedroom	36.6	36.3	0.3	0.7%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U																		
		W6-L		36.6	36.3	0.3	0.8%													
		W6-U						12.8	12.7	99%	12.7	99%	0.0	0.0%	85	28	85	28	0.0%	0.0%
Twelfth	R3	W7-L	LKD	36.5	36.2	0.3	0.8%													
		W7-U																		
		W8-L		36.4	36.1	0.3	0.8%													
		W8-U																		
		W9-L		6.9	6.9	0.0	0.0%													
		W9-U																		
		W10-L		4.4	4.0	0.3	7.6%													
		W10-U																		
		W11-L		30.5	29.9	0.6	1.8%													
		W11-U																		
		W12-L		31.7	31.2	0.6	1.8%													
		W12-U						33.7	30.7	91%	30.7	91%	0.0	0.0%	85	26	85	26	0.0%	0.0%
Twelfth	R4	W13-L	Bedroom	31.7	31.2	0.5	1.7%													
		W13-U																		
		W14-L		31.7	31.2	0.6	1.8%													
		W14-U						11.9	11.8	99%	11.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W15-L	Bedroom	31.7	31.2	0.6	1.8%													
		W15-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W16-L	LKD	24.9	24.4	0.5	2.0%													
		W16-U						32.0	27.6	86%	27.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W17-L	Bedroom	29.5	28.9	0.5	1.8%													
		W17-U																		
		W18-L		30.4	29.9	0.5	1.7%													
		W18-U						11.4	11.2	99%	11.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W19-L	Bedroom	29.5	29.0	0.5	1.7%													
		W19-U																		
		W20-L		30.4	29.9	0.5	1.6%													
		W20-U						13.4	13.3	99%	13.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W21-L	Bedroom	30.4	29.9	0.5	1.6%													
		W21-U																		
		W22-L		29.5	29.0	0.5	1.6%													
		W22-U						13.3	13.2	99%	13.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R10	W23-L	LKD	30.4	30.0	0.5	1.6%													
		W23-U																		
		W24-L		30.4	30.0	0.5	1.5%													
		W24-U																		
		W25-L		34.0	34.0	0.0	0.0%													
		W25-U						30.5	28.9	95%	28.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R12	W27-L	LKD	34.1	34.1	0.0	0.0%													
		W27-U																		
		W28-L		9.4	9.4	0.0	0.0%													
		W28-U						28.7	28.6	100%	28.6	100%	0.0	0.0%	20	6	20	6	0.0%	0.0%
Thirteenth	R1	W1-L	LKD	8.7	8.7	0.0	0.0%													
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-L		37.0	36.8	0.2	0.6%													
		W2-U																		
		W3-L		36.9	36.7	0.2	0.6%													
		W3-U																		
		W4-L		36.9	36.7	0.2	0.7%													
		W4-U						30.6	29.3	96%	29.3	96%	0.0	0.0%	94	30	94	30	0.0%	0.0%
Thirteenth	R2	W5-L	Bedroom	36.9	36.6	0.2	0.7%													
		W5-U																		
		W6-L		36.9	36.6	0.3	0.7%													
		W6-U						12.7	12.7	99%	12.7	99%	0.0	0.0%	86	29	86	29	0.0%	0.0%
Thirteenth	R3	W7-L	LKD	36.8	36.5	0.3	0.7%													
		W7-U																		
		W8-L		36.8	36.5	0.3	0.7%													
		W8-U																		
		W9-L		6.9	6.9	0.0	0.0%													
		W9-U																		
		W10-L		4.4	4.1	0.3	6.8%													
		W10-U																		
		W11-L		29.3	28.8	0.5	1.7%													
		W11-U																		
		W12-L		30.4	29.9	0.5	1.7%													
		W12-U						33.7	31.1	92%	31.1	92%	0.0	0.0%	86	27	86	27	0.0%	0.0%
Thirteenth	R4	W13-L	Bedroom	30.4	29.9	0.5	1.7%													
		W13-U																		
		W14-L		30.4	29.9	0.5	1.7%													
		W14-U						11.9	11.8	99%	11.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W15-L	Bedroom	30.4	29.9	0.5	1.6%													
		W15-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W17-L	Living Room	35.4	35.4	0.0	0.0%													
		W17-U																		
		W18-L		39.6	39.6	0.0	0.0%													
		W18-U																		
		W19-L		39.6	39.6	0.0	0.0%													
		W19-U																		
		W20-L		39.6	39.6	0.0	0.0%													
		W20-U																		
		W21-L		39.6	39.6	0.0	0.0%													
		W21-U						41.1	41.1	100%	41.1	100%	0.0	0.0%	61	19	61	19	0.0%	0.0%
11 Hale Road																				
Ground	R1	W1	Residential	28.1	6.5	21.6	77.0%													
		W2		20.8	3.3	17.5	84.2%													
		W3		8.1	3.1	5.0	61.7%	13.0	12.3	94%	2.8	21%	9.5	77.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W4-L	Bedroom	12.0	1.0	11.0	91.3%													
		W4-U						9.9	7.2	73%	0.6	6%	6.6	92.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	33.9	8.4	25.5	75.1%													
		W1-U																		
		W2-L		17.1	10.7	6.5	37.8%													
		W2-U						11.8	11.3	96%	10.0	85%	1.3	11.3%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R2	W3-L	Bedroom	22.0	5.7	16.2	73.9%												
		W3-U						9.9	8.9	90%	2.0	21%	6.8	77.1%	N/F	N/F	N/F	N/F	N/F	N/F
13 Hale Road																			
Ground	R1	W1-L	Bedroom	12.2	5.7	6.5	53.2%												
		W1-U						9.9	8.0	81%	2.3	24%	5.7	70.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Residential	9.8	7.1	2.7	27.5%												
		W3		25.9	6.6	19.3	74.4%												
		W4		19.4	5.7	13.8	70.7%	13.0	12.1	93%	4.8	37%	7.4	60.8%	6	0	2	0	66.7%	0.0%
First	R1	W1-L	Bedroom	22.3	9.6	12.7	56.9%												
		W1-U						9.9	9.2	93%	3.8	39%	5.4	58.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	16.2	13.4	2.7	16.9%												
		W2-U																		
		W3-L		33.8	8.8	25.0	74.0%												
		W3-U						11.8	11.3	96%	8.4	71%	2.9	25.6%	16	0	12	0	25.0%	0.0%
15 Hale Road																			
Ground	R1	W1	Residential	29.6	8.7	20.9	70.6%	1.6	1.3	78%	0.6	36%	0.7	54.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	27.9	7.3	20.6	73.8%												
		W3		10.2	4.1	6.1	59.6%	10.8	6.1	56%	2.3	21%	3.8	62.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W4-L	Bedroom	12.8	2.8	10.0	78.1%												
		W4-U						9.9	7.8	79%	1.7	17%	6.2	78.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	33.3	10.1	23.1	69.6%												
		W1-U																		
		W2-L		23.3	14.2	9.1	38.9%												
		W2-U						11.8	11.3	95%	10.7	90%	0.6	5.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W3-L	Bedroom	24.0	8.2	15.8	65.8%												
		W3-U						9.9	9.4	95%	2.9	29%	6.5	69.5%	N/F	N/F	N/F	N/F	N/F	N/F
17 Hale Road																			
Ground	R1	W1-L	Bedroom	12.4	7.1	5.3	42.4%												
		W1-U						9.9	8.0	81%	2.7	28%	5.2	65.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Residential	9.7	7.2	2.5	25.6%												
		W3		29.4	9.2	20.3	68.8%												
		W4		30.8	9.3	21.5	69.8%												
		W5		28.1	8.1	20.0	71.0%	13.0	12.1	93%	5.4	41%	6.8	55.8%	2	0	0	0	100.0%	0.0%
First	R1	W1-L	Bedroom	22.2	11.6	10.5	47.5%												
		W1-U						9.9	9.1	92%	4.2	42%	4.9	54.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	14.5	12.0	2.5	17.3%												
		W2-U																		
		W3-L		33.1	10.3	22.8	68.9%												
		W3-U						11.8	11.3	95%	7.1	60%	4.2	37.1%	12	0	10	0	16.7%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
21 Hale Road																				
Ground	R1	W1-L	Bedroom	12.0	6.2	5.7	47.8%													
		W1-U						9.2	6.9	75%	2.5	27%	4.4	63.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	5.8	3.5	2.4	40.8%	11.4	2.7	24%	1.9	17%	0.8	29.7%	0	0	0	0	0.0%	0.0%
First	R1	W1-L	Bedroom	18.7	9.4	9.3	49.9%													
		W1-U						9.3	7.1	76%	3.1	33%	4.1	57.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W3	Kitchen	32.2	11.6	20.6	64.0%	6.3	6.0	95%	3.1	49%	2.9	48.2%	N/F	N/F	N/F	N/F	N/F	N/F
19 Hale Road																				
Ground	R2	W2	Kitchen	28.9	9.8	19.1	66.0%													
		W3		20.1	5.0	15.1	75.3%													
		W4		10.0	4.3	5.7	57.0%	10.8	6.7	62%	2.3	22%	4.4	65.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W5-L	Bedroom	12.5	4.4	8.1	64.9%													
		W5-U						9.9	7.7	78%	1.9	20%	5.8	74.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	32.4	11.3	21.1	65.3%													
		W1-U																		
		W2-L		23.1	13.8	9.3	40.4%													
		W2-U						11.8	11.3	96%	10.6	89%	0.7	6.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W3-L	Bedroom	23.6	9.8	13.8	58.4%													
		W3-U						9.9	9.4	95%	2.7	27%	6.7	71.2%	N/F	N/F	N/F	N/F	N/F	N/F
1 Hale Road																				
Ground	R1	W1	Bedroom	22.0	19.5	2.6	11.6%	9.8	9.1	93%	9.0	92%	0.1	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	31.0	30.9	0.0	0.1%													
		W3-L		19.0	15.0	3.9	20.7%													
		W3-U						10.8	10.7	99%	10.3	96%	0.4	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	25.9	20.1	5.9	22.6%													
		W1-U						9.8	9.3	94%	9.1	93%	0.1	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	29.0	29.0	0.1	0.2%													
		W2-U																		
		W3-L		35.1	19.9	15.2	43.3%													
		W3-U						12.4	12.1	97%	11.8	95%	0.3	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
3 Hale Road																				
Ground	R1	W1	Residential	24.5	12.8	11.8	48.0%													
		W2		27.6	13.8	13.8	50.1%	4.5	4.2	94%	3.4	76%	0.8	18.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W3	Kitchen	13.4	6.3	7.0	52.7%													
		W4		8.8	4.3	4.4	50.5%													
		W5-L		6.4	2.8	3.6	56.5%													
		W5-U						11.9	9.6	80%	5.7	48%	3.9	40.2%	11	0	7	0	36.4%	0.0%
Ground	R3	W6	Bedroom	12.3	1.7	10.6	86.4%	9.8	7.9	81%	1.8	18%	6.2	77.7%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R1	W1-L	Residential	35.0	19.0	16.0	45.7%												
		W1-U						11.3	11.0	97%	8.3	73%	2.7	24.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	24.2	9.3	14.9	61.6%												
		W2-U						9.8	9.4	95%	4.8	49%	4.5	48.5%	N/F	N/F	N/F	N/F	N/F	N/F
5 Hale Road																			
Ground	R1	W1	Bedroom	13.0	6.1	6.8	52.8%	9.8	7.7	79%	5.8	59%	2.0	25.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	11.1	10.0	1.1	9.9%	9.5	5.1	54%	5.1	54%	0.0	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W3-L	Residential	25.9	9.8	16.1	62.2%												
		W3-U																		
		W4		29.4	10.2	19.1	65.1%	3.3	3.0	90%	2.9	87%	0.1	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	23.1	11.4	11.7	50.5%												
		W1-U						9.8	9.1	92%	7.2	73%	1.9	20.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	34.7	11.8	22.9	66.1%												
		W2-U						10.9	10.5	96%	2.5	23%	8.0	76.0%	N/F	N/F	N/F	N/F	N/F	N/F
7 Hale Road																			
Ground	R1	W1	Residential	29.6	8.5	21.0	71.2%												
		W2-L		26.4	7.7	18.7	70.9%												
		W2-U						3.3	3.0	90%	2.7	81%	0.3	10.2%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W3	Kitchen	10.8	6.8	4.0	36.8%	9.6	4.9	51%	3.9	40%	1.0	21.1%	3	0	3	0	0.0%	0.0%
Ground	R3	W4	Bedroom	12.1	2.0	10.1	83.2%	9.8	7.9	80%	2.0	21%	5.8	74.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Residential	34.6	10.1	24.5	70.7%												
		W1-U						10.9	10.5	96%	3.4	31%	7.1	67.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	24.9	6.9	17.9	72.1%												
		W2-U						9.8	9.3	95%	3.7	38%	5.6	59.9%	N/F	N/F	N/F	N/F	N/F	N/F
9 Hale Road																			
Ground	R1	W1	Bedroom	1.5	0.0	1.5	100.0%	9.8	6.1	62%	0.0	0%	6.1	100.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	5.6	1.0	4.6	82.6%	9.9	5.2	52%	4.1	42%	1.0	19.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W3-L	Residential	27.6	6.8	20.8	75.2%												
		W3-U						4.5	4.3	95%	2.4	54%	1.8	43.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	24.6	6.7	17.9	72.8%												
		W1-U						9.8	9.3	95%	4.1	41%	5.3	56.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	34.2	7.8	26.5	77.3%												
		W2-U						12.4	11.8	95%	2.1	17%	9.7	82.3%	N/F	N/F	N/F	N/F	N/F	N/F
1B Park View Road																			
Ground	R2	W1-L	Living Room	31.4	30.8	0.5	1.7%												
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		32.4	31.1	1.3	4.0%													
		W2-U																		
		W3-L		23.9	22.7	1.2	5.1%													
		W3-U						13.5	13.4	100%	13.4	100%	0.0	0.1%	50	11	48	10	4.0%	9.1%
First	R1	W3-L	Study	31.7	30.4	1.3	4.0%													
		W3-U						5.1	5.0	97%	5.0	97%	0.0	0.0%	43	10	40	8	7.0%	20.0%
First	R2	W1-L	Bedroom	31.9	30.7	1.2	3.7%													
		W1-U																		
		W2-L		31.8	30.5	1.3	3.9%													
		W2-U						12.0	11.9	99%	11.9	99%	0.0	0.0%	45	11	43	9	4.4%	18.2%
Second	R1	W1	Bedroom	82.0	81.0	1.0	1.2%													
		W2		82.2	81.2	1.0	1.2%													
		W3		38.9	38.9	0.0	0.0%	18.8	18.7	100%	18.7	100%	0.0	0.0%	91	21	90	20	1.1%	4.8%
1A Park View Road																				
Ground	R1	W2-L	Living Room	29.8	29.1	0.7	2.2%													
		W2-U																		
		W3-L		32.0	30.4	1.5	4.8%													
		W3-U																		
		W4-L		24.7	23.4	1.3	5.3%													
		W4-U						13.5	13.5	100%	13.5	100%	0.0	0.0%	53	10	52	10	1.9%	0.0%
First	R1	W2-L	Bedroom	31.5	30.0	1.4	4.5%													
		W2-U																		
		W3-L		31.4	29.9	1.4	4.6%													
		W3-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	41	8	40	8	2.4%	0.0%
First	R2	W1-L	Study	31.6	30.2	1.4	4.3%													
		W1-U						5.1	4.9	96%	4.9	95%	0.0	0.8%	43	10	41	9	4.7%	10.0%
Second	R1	W1	Bedroom	81.7	80.6	1.1	1.3%													
		W2		81.4	80.2	1.1	1.4%													
		W3		38.7	38.7	0.0	0.0%	18.9	18.9	100%	18.9	100%	0.0	0.0%	87	17	86	17	1.1%	0.0%
1 Park View Road																				
Ground	R2	W2-L	Living Room	30.8	30.5	0.4	1.2%													
		W2-U																		
		W3-L		33.1	32.0	1.1	3.2%													
		W3-U																		
		W4-L		26.7	25.6	1.2	4.3%													
		W4-U						11.2	11.1	100%	11.1	100%	0.0	0.0%	52	11	50	9	3.8%	18.2%
First	R1	W1-L	Bedroom	33.6	32.7	1.0	2.9%													
		W1-U																		
		W2-L		33.6	32.6	1.0	3.1%													
		W2-U						11.9	11.7	98%	11.7	98%	0.0	0.0%	48	12	46	10	4.2%	16.7%
2 Park View Road																				
Ground	R1	W1-L	Living Room	29.7	29.4	0.3	0.9%													
		W1-U																		
		W2-L		33.5	32.6	0.9	2.7%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		26.9	25.9	1.0	3.9%													
		W3-U						20.2	20.1	100%	20.1	100%	0.0	0.0%	52	12	50	10	3.8%	16.7%
First	R1	W1-L	Bedroom	33.7	32.9	0.8	2.5%													
		W1-U																		
		W2-L		33.7	32.8	0.9	2.7%													
		W2-U						12.4	12.2	99%	12.2	99%	0.0	0.0%	47	12	45	10	4.3%	16.7%
The Volunteer																				
First	R2	W2-L	Bedroom	26.4	26.4	0.0	0.1%													
		W2-U						12.3	11.3	92%	11.3	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W3	Kitchen	35.9	35.9	0.0	0.0%													
		W5-L		19.7	19.2	0.5	2.6%													
		W5-U						8.5	8.1	96%	8.1	96%	0.0	0.0%	40	2	40	2	0.0%	0.0%
3 Park View Road																				
Ground	R2	W3-L	Living Room	29.2	29.1	0.1	0.4%													
		W3-U																		
		W4-L		33.1	32.3	0.8	2.5%													
		W4-U																		
		W5-L		22.4	21.5	0.9	3.8%													
		W5-U						12.3	12.3	100%	12.3	100%	0.0	0.0%	50	11	48	9	4.0%	18.2%
First	R1	W1-L	Bedroom	33.8	33.1	0.7	2.2%													
		W1-U																		
		W2-L		33.7	32.9	0.8	2.3%													
		W2-U						12.1	11.9	99%	11.9	99%	0.0	0.0%	47	12	45	10	4.3%	16.7%
5 Park View Road																				
Ground	R1	W1	Kitchen	29.3	28.7	0.6	2.2%													
		W2		27.6	27.0	0.6	2.2%													
		W6-L		12.7	12.7	0.0	0.0%													
		W6-U																		
		W7-L		16.6	16.6	0.0	0.0%													
		W7-U						22.7	18.1	80%	18.1	80%	0.0	0.0%	72	12	70	10	2.8%	16.7%
Ground	R2	W3-L	Living Room	29.3	29.3	0.1	0.2%													
		W3-U																		
		W4-L		33.3	32.6	0.6	1.9%													
		W4-U																		
		W5-L		22.8	22.1	0.7	3.2%													
		W5-U						13.9	13.9	100%	13.9	100%	0.0	0.0%	50	11	48	9	4.0%	18.2%
First	R1	W1-L	Bedroom	34.0	33.4	0.6	1.8%													
		W1-U																		
		W2-L		33.9	33.3	0.6	1.9%													
		W2-U						11.9	11.7	98%	11.7	98%	0.0	0.0%	47	12	45	10	4.3%	16.7%
4 Park View Road																				
Ground	R1	W1-L	Living Room	27.6	27.5	0.1	0.3%													
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		33.2	32.4	0.7	2.2%													
		W2-U																		
		W3-L		23.0	22.2	0.8	3.4%													
		W3-U																		
		W8		12.7	12.7	0.0	0.0%													
		W9		15.0	15.0	0.0	0.0%	19.1	18.8	98%	18.6	97%	0.2	0.9%	56	13	55	12	1.8%	7.7%
First	R1	W1-L	Bedroom	33.9	33.2	0.7	1.9%													
		W1-U																		
		W2-L		33.8	33.1	0.7	2.1%													
		W2-U						14.0	13.8	98%	13.8	98%	0.0	0.0%	47	12	46	11	2.1%	8.3%
6 Park View Road																				
Ground	R1	W1-L	Living Room	27.2	27.2	0.0	0.1%													
		W1-U																		
		W2-L		33.4	32.9	0.6	1.7%													
		W2-U																		
		W3-L		23.4	22.8	0.7	2.8%													
		W3-U						11.4	11.3	99%	11.3	99%	0.0	0.1%	51	12	51	12	0.0%	0.0%
First	R1	W1-L	Bedroom	34.1	33.6	0.5	1.5%													
		W1-U																		
		W2-L		34.0	33.5	0.5	1.6%													
		W2-U						11.6	11.4	98%	11.4	98%	0.0	0.0%	45	10	45	10	0.0%	0.0%
Second	R1	W1-L	Bedroom	26.7	26.7	0.0	0.0%													
		W1-U																		
		W2		78.3	77.9	0.5	0.6%	14.6	13.9	95%	13.9	95%	0.0	0.0%	83	17	82	16	1.2%	5.9%
7A Park View Road																				
Ground	R2	W7-L	Living Room	30.8	30.7	0.0	0.1%													
		W7-U																		
		W8-L		33.5	33.0	0.5	1.6%													
		W8-U																		
		W9-L		22.4	21.8	0.6	2.7%													
		W9-U						13.9	13.9	100%	13.9	100%	0.0	0.0%	48	10	48	10	0.0%	0.0%
First	R1	W1-L	Bedroom	34.3	33.8	0.5	1.4%													
		W1-U																		
		W2-L		34.1	33.6	0.5	1.5%													
		W2-U						12.1	11.9	98%	11.9	98%	0.0	0.0%	44	10	44	10	0.0%	0.0%
Rosa Luxemburg Apartments																				
Ground	R9	W40-L	LKD	23.6	14.6	9.0	38.2%													
		W40-U																		
		W41-L		25.6	16.6	9.0	35.2%													
		W41-U						34.3	31.5	92%	25.8	75%	5.6	17.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	19.4	9.7	9.7	50.1%													
		W1-U						15.6	14.0	90%	4.1	26%	9.9	70.7%	40	12	20	0	50.0%	100.0%
First	R2	W2-L	Bedroom	21.2	10.9	10.2	48.4%													
		W2-U						9.9	7.8	79%	3.7	38%	4.1	52.3%	42	12	21	0	50.0%	100.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R3	W3-L	LKD	22.0	11.3	10.7	48.6%												
		W3-U																	
		W4-L		19.0	7.9	11.1	58.3%												
		W4-U																	
		W5-L		11.9	6.6	5.3	44.6%												
		W5-U																	
		W6-L		8.8	4.7	4.2	46.9%												
		W6-U						28.8	28.4	99%	12.3	43%	16.2	56.9%	47	14	29	1	38.3%	92.9%
First	R4	W7-L	Bedroom	7.2	4.0	3.2	45.0%												
		W7-U						13.7	3.7	27%	1.4	10%	2.3	62.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W8-L	LKD	4.9	4.7	0.2	4.1%												
		W8-U																	
		W9-L		24.9	13.1	11.8	47.4%												
		W9-U						34.8	28.6	82%	7.4	21%	21.2	74.1%	53	16	31	1	41.5%	93.8%
First	R6	W10-L	Bedroom	21.5	12.0	9.5	44.3%												
		W10-U						13.1	11.7	89%	3.7	28%	8.0	68.5%	47	16	30	0	36.2%	100.0%
First	R7	W11-L	Bedroom	7.7	0.9	6.8	87.8%												
		W11-U						12.8	10.1	79%	0.5	4%	9.6	94.9%	12	9	3	0	75.0%	100.0%
First	R8	W12-L	Bedroom	10.8	6.9	3.9	36.2%												
		W12-U						17.2	13.7	79%	4.5	26%	9.2	67.4%	24	8	17	1	29.2%	87.5%
First	R9	W13-L	Bedroom	13.0	10.9	2.1	16.2%												
		W13-U						14.5	9.4	65%	8.1	56%	1.3	13.9%	29	7	25	3	13.8%	57.1%
First	R10	W14-L	Bedroom	14.1	11.9	2.2	15.8%												
		W14-U						13.5	5.9	43%	5.9	43%	0.0	0.0%	23	4	18	1	21.7%	75.0%
First	R11	W15-L	LKD	5.7	2.7	3.0	52.4%												
		W15-U						29.0	26.9	93%	25.8	89%	1.1	3.9%	16	10	6	0	62.5%	100.0%
First	R12	W16-L	LKD	19.3	11.1	8.3	42.8%												
		W16-U						27.2	26.8	99%	25.4	93%	1.5	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	10.7	10.7	0.0	0.0%												
		W1-U																	
		W2-L		11.1	11.0	0.0	0.4%												
		W2-U																	
		W3-L		27.4	11.5	15.9	58.2%												
		W3-U						26.9	26.7	99%	26.0	97%	0.7	2.7%	78	17	39	6	50.0%	64.7%
Second	R2	W4-L	Bedroom	27.5	10.2	17.2	62.7%												
		W4-U						8.4	7.8	93%	2.1	25%	5.7	72.6%	69	16	27	4	60.9%	75.0%
Second	R3	W5-L	Bedroom	27.7	9.5	18.2	65.8%												
		W5-U						12.0	11.0	92%	2.7	23%	8.3	75.1%	71	15	26	3	63.4%	80.0%
Second	R4	W6-L	LKD	27.6	10.0	17.6	63.7%												
		W6-U																	
		W7-L		7.0	0.7	6.3	89.8%												
		W7-U																	
		W8-L		19.1	12.7	6.5	33.9%												
		W8-U						23.3	22.7	97%	17.1	73%	5.7	24.9%	70	15	37	2	47.1%	86.7%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R5	W9-L	Bedroom	16.8	11.1	5.7	34.0%												
		W9-U						12.9	10.6	82%	7.3	56%	3.4	31.7%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10-L	Bedroom	19.8	11.6	8.3	41.6%												
		W10-U						14.5	13.2	91%	5.7	40%	7.5	56.7%	40	12	23	2	42.5%	83.3%
Second	R7	W11-L	Bedroom	21.7	13.2	8.5	39.1%												
		W11-U						9.1	7.7	85%	5.2	57%	2.6	32.9%	42	12	25	2	40.5%	83.3%
Second	R8	W12-L	LKD	22.9	14.0	8.9	38.8%												
		W12-U																		
		W13-L		6.7	0.4	6.3	94.3%												
		W13-U																		
		W14-L		10.3	6.1	4.2	40.6%												
		W14-U						27.3	26.9	99%	14.4	53%	12.5	46.6%	47	14	32	3	31.9%	78.6%
Second	R9	W15-L	Bedroom	8.0	4.8	3.2	40.4%												
		W15-U						14.0	3.8	27%	1.9	14%	1.9	50.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W16-L	Bedroom	6.0	5.9	0.1	1.5%												
		W16-U						13.0	2.3	18%	2.3	18%	0.0	0.0%	14	2	14	2	0.0%	0.0%
Second	R11	W17-L	LKD	8.3	7.8	0.5	6.0%												
		W17-U																		
		W18-L		11.6	3.8	7.8	67.4%												
		W18-U																		
		W19-L		24.4	15.1	9.2	37.9%												
		W19-U						23.4	23.0	98%	15.1	64%	7.9	34.4%	54	17	38	6	29.6%	64.7%
Second	R12	W20-L	LKD	9.2	3.3	5.9	63.7%												
		W20-U						22.9	22.5	98%	4.9	21%	17.6	78.3%	20	14	11	5	45.0%	64.3%
Second	R13	W21-L	Bedroom	11.6	8.5	3.1	26.6%												
		W21-U						15.3	12.4	81%	6.4	42%	5.9	48.1%	26	9	21	4	19.2%	55.6%
Second	R14	W22-L	Bedroom	13.6	12.1	1.5	11.3%												
		W22-U						14.5	9.8	68%	9.2	64%	0.6	6.3%	30	7	27	4	10.0%	42.9%
Second	R15	W23-L	Bedroom	15.1	13.6	1.5	9.8%												
		W23-U						13.5	6.1	45%	6.1	45%	0.0	0.0%	25	4	24	3	4.0%	25.0%
Second	R16	W24-L	LKD	6.3	3.7	2.6	41.0%												
		W24-U						29.0	27.0	93%	26.4	91%	0.6	2.2%	17	10	7	0	58.8%	100.0%
Second	R17	W25-L	LKD	20.0	11.5	8.5	42.6%												
		W25-U						27.2	26.8	99%	25.4	93%	1.5	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	11.7	11.7	0.0	0.1%												
		W1-U																		
		W2-L		12.1	12.1	0.0	0.3%												
		W2-U																		
		W3-L		28.1	13.9	14.2	50.4%												
		W3-U						26.9	26.8	100%	26.1	97%	0.7	2.7%	79	17	47	6	40.5%	64.7%
Third	R2	W4-L	Bedroom	28.2	12.9	15.3	54.3%												
		W4-U						8.4	7.8	93%	2.8	34%	5.0	63.8%	70	16	37	5	47.1%	68.8%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R3	W5-L	Bedroom	28.3	12.1	16.2	57.3%												
		W5-U						12.0	11.0	92%	3.5	29%	7.5	68.1%	71	15	38	3	46.5%	80.0%
Third	R4	W6-L	LKD	28.3	13.0	15.3	54.0%												
		W6-U																	
		W7-L		7.4	2.1	5.2	71.0%												
		W7-U																	
		W8-L		20.4	14.7	5.6	27.7%												
		W8-U						23.3	22.8	98%	20.1	86%	2.6	11.6%	70	15	44	3	37.1%	80.0%
Third	R5	W9-L	Bedroom	17.7	12.7	5.0	28.2%												
		W9-U						12.9	10.8	83%	8.2	64%	2.6	23.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10-L	Bedroom	20.3	13.8	6.5	32.1%												
		W10-U						14.5	13.3	92%	8.8	61%	4.4	33.4%	40	12	28	4	30.0%	66.7%
Third	R7	W11-L	Bedroom	22.3	15.7	6.6	29.6%												
		W11-U						9.1	8.0	88%	7.5	83%	0.5	6.1%	42	12	29	4	31.0%	66.7%
Third	R8	W12-L	LKD	23.6	16.8	6.9	29.1%												
		W12-U																	
		W13-L		7.2	2.2	5.0	70.0%												
		W13-U																	
		W14-L		11.3	7.4	3.9	34.3%												
		W14-U						27.3	26.9	99%	20.4	75%	6.6	24.4%	46	13	35	5	23.9%	61.5%
Third	R9	W15-L	Bedroom	8.9	5.9	3.1	34.3%												
		W15-U						14.0	3.9	28%	2.2	16%	1.8	44.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16-L	Bedroom	7.6	7.5	0.1	0.8%												
		W16-U						13.0	2.8	22%	2.8	22%	0.0	0.0%	15	3	15	3	0.0%	0.0%
Third	R11	W17-L	LKD	10.0	9.8	0.3	2.5%												
		W17-U																	
		W18-L		12.1	5.9	6.2	51.3%												
		W18-U																	
		W19-L		25.4	17.9	7.5	29.5%												
		W19-U						23.4	23.0	98%	19.9	85%	3.1	13.6%	57	19	42	10	26.3%	47.4%
Third	R12	W20-L	LKD	9.7	5.5	4.2	43.1%												
		W20-U						22.9	22.5	98%	8.3	36%	14.2	63.3%	22	14	18	10	18.2%	28.6%
Third	R13	W21-L	Bedroom	12.4	10.4	2.0	16.1%												
		W21-U						15.3	12.7	82%	9.5	62%	3.2	25.0%	27	9	24	6	11.1%	33.3%
Third	R14	W22-L	Bedroom	14.4	13.4	1.0	7.0%												
		W22-U						14.5	10.3	71%	10.2	70%	0.1	0.7%	30	7	30	7	0.0%	0.0%
Third	R15	W23-L	Bedroom	16.1	15.1	1.0	6.4%												
		W23-U						13.5	6.6	49%	6.6	49%	0.0	0.0%	26	4	25	3	3.8%	25.0%
Third	R16	W24-L	LKD	7.0	4.9	2.2	30.9%												
		W24-U						29.0	27.2	94%	26.7	92%	0.5	1.9%	18	10	8	0	55.6%	100.0%
Third	R17	W25-L	LKD	20.2	11.9	8.3	41.0%												
		W25-U						27.2	26.8	99%	25.5	94%	1.4	5.1%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R1	W1-L	LKD	12.3	12.3	0.0	0.0%												
		W1-U																	
		W2-L		14.1	14.1	0.0	0.4%												
		W2-U																	
		W3-L		28.8	17.4	11.4	39.6%												
		W3-U						29.5	28.4	96%	27.2	92%	1.2	4.2%	79	17	58	6	26.6%	64.7%
Fourth	R2	W4-L	Bedroom	28.8	17.2	11.6	40.4%												
		W4-U						12.2	9.0	74%	5.4	44%	3.6	40.3%	71	16	49	5	31.0%	68.8%
Fourth	R3	W5-L	Bedroom	29.0	16.4	12.6	43.4%												
		W5-U						12.6	11.7	93%	4.8	38%	7.0	59.3%	70	15	47	3	32.9%	80.0%
Fourth	R4	W6-L	LKD	29.0	17.7	11.3	38.9%												
		W6-U																	
		W7-L		7.8	4.2	3.6	45.6%												
		W7-U																	
		W8-L		21.8	17.0	4.8	22.0%												
		W8-U						23.3	22.8	98%	21.4	92%	1.3	5.8%	71	15	59	7	16.9%	53.3%
Fourth	R5	W9-L	Bedroom	18.7	14.4	4.3	23.2%												
		W9-U						12.9	11.0	85%	9.1	71%	1.9	16.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W10-L	Bedroom	20.8	15.7	5.1	24.3%												
		W10-U						14.5	13.4	92%	12.9	89%	0.5	3.6%	41	13	32	8	22.0%	38.5%
Fourth	R7	W11-L	Bedroom	23.0	17.9	5.2	22.4%												
		W11-U						9.1	8.3	91%	8.3	91%	0.0	0.0%	43	13	34	8	20.9%	38.5%
Fourth	R8	W12-L	LKD	24.5	19.0	5.5	22.3%												
		W12-U																	
		W13-L		8.5	4.3	4.2	48.9%												
		W13-U																	
		W14-L		12.9	9.4	3.5	27.3%												
		W14-U						27.3	27.0	99%	26.9	98%	0.1	0.3%	48	14	40	9	16.7%	35.7%
Fourth	R9	W15-L	Bedroom	10.3	7.5	2.8	27.6%												
		W15-U						14.0	4.1	29%	2.4	18%	1.7	40.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W16-L	Bedroom	9.9	9.9	0.0	0.5%												
		W16-U						13.0	4.1	32%	4.1	32%	0.0	0.0%	16	3	16	3	0.0%	0.0%
Fourth	R11	W17-L	LKD	12.4	12.2	0.1	1.1%												
		W17-U																	
		W18-L		12.7	7.7	5.0	39.2%												
		W18-U																	
		W19-L		26.6	20.4	6.2	23.2%												
		W19-U						23.4	23.1	98%	22.9	98%	0.1	0.5%	64	20	51	14	20.3%	30.0%
Fourth	R12	W20-L	LKD	10.4	7.4	3.1	29.3%												
		W20-U						22.9	22.5	98%	18.2	79%	4.3	19.2%	24	14	20	11	16.7%	21.4%
Fourth	R13	W21-L	Bedroom	13.8	12.8	1.0	7.1%												
		W21-U						15.3	13.0	85%	12.9	84%	0.1	0.7%	28	9	25	6	10.7%	33.3%
Fourth	R14	W22-L	Bedroom	15.5	15.0	0.5	3.3%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W22-U						14.5	11.0	76%	11.0	76%	0.0	0.1%	34	7	34	7	0.0%	0.0%
Fourth	R15	W23-L	Bedroom	17.4	16.7	0.6	3.7%													
		W23-U						13.5	7.4	55%	7.4	55%	0.0	0.0%	28	4	28	4	0.0%	0.0%
Fourth	R16	W24-L	LKD	8.0	6.7	1.4	16.9%													
		W24-U						29.0	27.7	95%	27.6	95%	0.1	0.5%	21	11	15	5	28.6%	54.5%
Fourth	R17	W25-L	LKD	20.4	14.0	6.4	31.3%													
		W25-U						27.2	26.8	99%	26.1	96%	0.8	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	13.0	13.0	0.0	0.0%													
		W1-U																		
		W2-L		14.7	14.7	0.0	0.1%													
		W2-U																		
		W3-L		29.4	22.3	7.1	24.1%													
		W3-U						29.5	28.6	97%	27.8	94%	0.9	3.0%	82	18	72	11	12.2%	38.9%
Fifth	R2	W4-L	Bedroom	29.5	22.4	7.0	23.9%													
		W4-U						12.2	9.0	74%	8.3	68%	0.8	8.5%	72	17	61	9	15.3%	47.1%
Fifth	R3	W5-L	Bedroom	29.6	22.1	7.5	25.3%													
		W5-U						12.6	11.8	94%	10.4	83%	1.4	12.3%	72	16	62	8	13.9%	50.0%
Fifth	R4	W6-L	LKD	29.6	22.9	6.7	22.5%													
		W6-U																		
		W7-L		8.2	7.3	1.0	11.5%													
		W7-U																		
		W8-L		23.6	19.6	4.0	16.9%													
		W8-U						23.3	22.8	98%	22.1	95%	0.7	3.1%	73	18	65	14	11.0%	22.2%
Fifth	R5	W9-L	Bedroom	19.9	16.2	3.7	18.5%													
		W9-U						12.9	11.3	87%	9.5	74%	1.8	15.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W10-L	Bedroom	21.3	17.4	3.9	18.4%													
		W10-U						14.5	13.5	93%	13.1	90%	0.4	2.7%	41	13	35	10	14.6%	23.1%
Fifth	R7	W11-L	Bedroom	23.9	19.9	4.0	16.8%													
		W11-U						9.1	8.6	95%	8.6	95%	0.0	0.0%	44	13	37	10	15.9%	23.1%
Fifth	R8	W12-L	LKD	25.7	21.4	4.3	16.7%													
		W12-U																		
		W13-L		9.0	5.7	3.3	36.8%													
		W13-U																		
		W14-L		15.3	12.1	3.2	20.9%													
		W14-U						27.3	27.0	99%	27.0	99%	0.0	0.1%	51	16	45	13	11.8%	18.8%
Fifth	R9	W15-L	Bedroom	12.6	9.9	2.6	20.9%													
		W15-U						14.0	4.6	33%	3.3	24%	1.3	27.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W16-L	Bedroom	13.3	13.2	0.0	0.2%													
		W16-U						13.0	6.4	49%	6.4	49%	0.0	0.0%	23	6	23	6	0.0%	0.0%
Fifth	R11	W17-L	LKD	15.6	15.6	0.1	0.5%													
		W17-U																		
		W18-L		13.3	9.2	4.0	30.5%													
		W18-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W19-L		28.0	22.7	5.3	18.8%												
		W19-U						23.4	23.1	99%	23.1	99%	0.0	0.0%	68	22	58	17	14.7%	22.7%
Fifth	R12	W20-L	LKD	11.7	8.9	2.8	24.3%												
		W20-U						22.9	22.6	99%	22.2	97%	0.4	1.9%	26	15	22	13	15.4%	13.3%
Fifth	R13	W21-L	Bedroom	15.6	15.2	0.4	2.3%												
		W21-U						15.3	13.6	89%	13.4	88%	0.2	1.4%	33	11	32	10	3.0%	9.1%
Fifth	R14	W22-L	Bedroom	17.1	16.9	0.2	1.2%												
		W22-U						14.5	11.9	82%	11.9	82%	0.0	0.0%	43	10	42	9	2.3%	10.0%
Fifth	R15	W23-L	Bedroom	19.4	19.1	0.3	1.3%												
		W23-U						13.5	8.5	63%	8.5	63%	0.0	0.0%	39	5	38	4	2.6%	20.0%
Fifth	R16	W24-L	LKD	9.3	8.8	0.5	5.3%												
		W24-U						29.0	28.5	98%	28.5	98%	0.0	0.0%	23	12	21	10	8.7%	16.7%
Fifth	R17	W25-L	LKD	20.5	16.3	4.2	20.5%												
		W25-U						27.2	26.8	99%	26.2	97%	0.6	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	14.9	14.9	0.0	0.0%												
		W1-U																		
		W2-L		16.4	16.4	0.0	0.0%												
		W2-U																		
		W3-L		30.0	27.0	3.0	10.0%												
		W3-U						29.5	28.8	98%	28.8	97%	0.1	0.2%	85	21	79	18	7.1%	14.3%
Sixth	R2	W4-L	Bedroom	30.0	26.8	3.2	10.6%												
		W4-U						12.2	9.1	75%	9.1	75%	0.0	0.1%	75	19	69	16	8.0%	15.8%
Sixth	R3	W5-L	Bedroom	30.1	26.8	3.4	11.2%												
		W5-U						12.6	11.9	95%	11.9	95%	0.0	0.0%	74	18	69	15	6.8%	16.7%
Sixth	R4	W6-L	LKD	30.2	26.9	3.3	10.8%												
		W6-U																		
		W7-L		9.6	9.5	0.2	2.0%												
		W7-U																		
		W8-L		26.0	22.5	3.5	13.4%												
		W8-U						23.3	22.8	98%	22.5	97%	0.2	1.1%	74	18	69	16	6.8%	11.1%
Sixth	R5	W9-L	Bedroom	21.7	18.4	3.3	15.1%												
		W9-U						12.9	11.4	88%	9.7	75%	1.7	14.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W10-L	Bedroom	22.1	18.7	3.4	15.4%												
		W10-U						14.5	13.6	94%	13.2	91%	0.3	2.4%	43	13	37	10	14.0%	23.1%
Sixth	R7	W11-L	Bedroom	25.1	21.6	3.5	13.9%												
		W11-U						9.1	8.8	97%	8.8	97%	0.0	0.0%	47	13	41	10	12.8%	23.1%
Sixth	R8	W12-L	LKD	28.0	24.3	3.7	13.4%												
		W12-U																		
		W13-L		26.1	22.2	3.9	15.0%												
		W13-U																		
		W14-L		18.7	15.7	3.0	15.9%												
		W14-U						27.3	27.1	99%	27.1	99%	0.0	0.0%	56	16	51	13	8.9%	18.8%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R9	W15-L	Bedroom	16.6	13.9	2.6	15.8%												
		W15-U						14.0	5.7	41%	4.7	33%	1.0	17.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W16-L	Bedroom	17.8	17.8	0.0	0.1%												
		W16-U						13.0	9.6	74%	9.6	74%	0.0	0.0%	26	6	26	6	0.0%	0.0%
Sixth	R11	W17-L	LKD	19.6	19.6	0.0	0.1%												
		W17-U																		
		W18-L		14.9	11.1	3.8	25.4%												
		W18-U																		
		W19-L		29.6	24.7	5.0	16.8%												
		W19-U						23.4	23.1	99%	23.1	99%	0.0	0.0%	72	24	63	20	12.5%	16.7%
Sixth	R12	W20-L	LKD	14.8	10.7	4.1	27.5%												
		W20-U						22.9	22.7	99%	22.4	98%	0.3	1.4%	36	20	29	16	19.4%	20.0%
Sixth	R13	W21-L	Bedroom	17.7	17.1	0.6	3.2%												
		W21-U						15.3	14.0	91%	13.9	90%	0.2	1.2%	36	15	36	15	0.0%	0.0%
Sixth	R14	W22-L	Bedroom	18.7	18.7	0.0	0.2%												
		W22-U						14.5	12.7	88%	12.7	88%	0.0	0.0%	46	13	46	13	0.0%	0.0%
Sixth	R15	W23-L	Bedroom	21.6	21.6	0.0	0.2%												
		W23-U						13.5	9.8	73%	9.8	73%	0.0	0.0%	47	13	47	13	0.0%	0.0%
Sixth	R16	W24-L	LKD	25.9	25.8	0.1	0.3%												
		W24-U						29.0	28.9	100%	28.9	100%	0.0	0.0%	48	14	48	14	0.0%	0.0%
Sixth	R17	W25-L	LKD	38.3	34.7	3.5	9.2%												
		W25-U						27.2	26.9	99%	26.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	28.3	28.3	0.0	0.0%												
		W1-U																		
		W2-L		33.2	33.2	0.0	0.0%												
		W2-U																		
		W3-L		30.6	28.6	2.0	6.5%												
		W3-U						29.5	29.0	98%	29.0	98%	0.0	0.0%	86	21	82	19	4.7%	9.5%
Seventh	R2	W4-L	Bedroom	30.6	28.4	2.2	7.3%												
		W4-U						12.2	9.2	76%	9.2	76%	0.0	0.0%	76	20	72	18	5.3%	10.0%
Seventh	R3	W5-L	Bedroom	30.8	28.3	2.4	7.9%												
		W5-U						12.6	12.1	96%	12.1	96%	0.0	0.0%	73	18	69	16	5.5%	11.1%
Seventh	R4	W6-L	LKD	30.8	28.1	2.7	8.8%												
		W6-U																		
		W7-L		11.0	11.0	0.0	0.0%												
		W7-U																		
		W8-L		29.5	26.4	3.2	10.8%												
		W8-U						23.3	22.8	98%	22.6	97%	0.2	0.8%	74	19	70	17	5.4%	10.5%
Seventh	R5	W9-L	Bedroom	25.9	22.9	3.0	11.6%												
		W9-U						12.9	11.4	88%	9.8	76%	1.6	14.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10-L	Bedroom	23.5	20.5	3.1	13.0%												
		W10-U						14.0	13.5	96%	13.2	94%	0.3	2.0%	45	13	39	10	13.3%	23.1%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R7	W11-L	LKD	27.1	23.9	3.2	11.7%													
		W11-U																		
		W12-L		29.8	26.4	3.4	11.4%													
		W12-U																		
		W13-L		27.5	24.7	2.8	10.3%													
		W13-U						26.6	26.3	99%	26.3	99%	0.0	0.0%	64	19	60	16	6.3%	15.8%
Seventh	R8	W14-L	Bedroom	23.3	23.3	0.0	0.0%													
		W14-U						13.0	11.4	88%	11.4	88%	0.0	0.0%	34	8	34	8	0.0%	0.0%
Seventh	R9	W15-L	LKD	24.6	24.6	0.0	0.0%													
		W15-U																		
		W16-L		26.2	22.7	3.6	13.6%													
		W16-U																		
		W17-L		31.1	26.3	4.8	15.4%													
		W17-U						23.5	23.2	99%	23.2	99%	0.0	0.0%	74	25	66	21	10.8%	16.0%
Seventh	R10	W18-L	LKD	27.9	23.0	4.9	17.6%													
		W18-U						23.1	22.9	99%	22.8	99%	0.1	0.4%	65	22	57	17	12.3%	22.7%
Seventh	R11	W19-L	Bedroom	20.8	19.9	0.9	4.2%													
		W19-U						15.3	14.4	94%	14.3	93%	0.2	1.1%	51	17	51	17	0.0%	0.0%
Seventh	R12	W20-L	Bedroom	23.5	23.5	0.0	0.0%													
		W20-U																		
		W21-L		33.1	26.3	6.8	20.6%													
		W21-U						11.5	11.4	98%	10.9	94%	0.5	4.0%	83	25	71	18	14.5%	28.0%
Seventh	R13	W22-L	Bedroom	27.9	20.8	7.1	25.4%													
		W22-U						12.0	11.5	96%	10.7	89%	0.8	6.9%	67	24	54	17	19.4%	29.2%
Seventh	R14	W23-L	Bedroom	33.8	26.1	7.7	22.9%													
		W23-U						13.5	12.7	94%	10.6	78%	2.1	16.3%	81	24	67	16	17.3%	33.3%
Seventh	R15	W24-L	LKD	34.0	26.0	8.0	23.5%													
		W24-U																		
		W25-L		38.2	35.9	2.3	6.0%													
		W25-U																		
		W26-L		34.8	32.8	2.0	5.7%													
		W26-U						33.5	33.2	99%	33.2	99%	0.0	0.1%	81	23	72	18	11.1%	21.7%
Eighth	R1	W1-L	LKD	34.9	34.9	0.0	0.0%													
		W1-U						21.6	21.3	98%	21.3	98%	0.0	0.0%	54	15	54	15	0.0%	0.0%
Eighth	R2	W2-L	Bedroom	34.8	34.8	0.0	0.0%													
		W2-U																		
		W3-L		25.2	25.2	0.0	0.0%													
		W3-U						13.8	13.8	100%	13.8	100%	0.0	0.0%	68	18	68	18	0.0%	0.0%
Eighth	R3	W4-L	Bedroom	31.8	29.6	2.2	6.9%													
		W4-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	79	22	75	20	5.1%	9.1%
Eighth	R4	W5-L	LKD	31.9	29.2	2.7	8.5%													
		W5-U																		
		W6-L		30.8	27.9	2.9	9.3%													
		W6-U						22.1	22.0	100%	22.0	100%	0.0	0.0%	75	20	69	17	8.0%	15.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighth	R5	W7-L	Bedroom	26.5	23.7	2.9	10.8%													
		W7-U						9.3	8.5	91%	8.0	86%	0.5	6.0%	50	13	45	10	10.0%	23.1%
Eighth	R6	W8-L	LKD	30.5	27.4	3.1	10.1%													
		W8-U																		
		W9-L		31.1	28.6	2.6	8.2%													
		W9-U																		
		W10-L		31.2	28.9	2.4	7.7%													
		W10-U						28.6	28.2	99%	28.2	99%	0.0	0.0%	66	17	62	14	6.1%	17.6%
Eighth	R7	W11-L	LKD	17.8	17.8	0.0	0.0%													
		W11-U																		
		W12-L		31.9	31.9	0.0	0.0%													
		W12-U																		
		W13-L		32.2	27.7	4.6	14.2%													
		W13-U						33.8	33.7	100%	33.7	100%	0.0	0.0%	84	25	76	20	9.5%	20.0%
Eighth	R8	W14-L	Bedroom	30.1	25.1	5.0	16.6%													
		W14-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	68	22	60	17	11.8%	22.7%
Eighth	R9	W15-L	Bedroom	21.9	21.1	0.8	3.8%													
		W15-U						14.0	12.4	89%	11.9	85%	0.5	4.2%	51	18	51	18	0.0%	0.0%
Eighth	R10	W16-L	Bedroom	26.2	26.2	0.0	0.0%													
		W16-U																		
		W17-L		34.1	27.6	6.5	19.1%													
		W17-U						13.0	12.9	100%	12.2	94%	0.7	5.7%	89	26	78	19	12.4%	26.9%
Eighth	R11	W18-L	Bedroom	34.3	27.4	6.9	20.0%													
		W18-U						11.4	10.9	95%	10.3	90%	0.6	5.8%	83	26	70	19	15.7%	26.9%
Eighth	R12	W19-L	Bedroom	33.3	26.2	7.1	21.3%													
		W19-U						8.3	7.9	96%	7.4	89%	0.5	6.8%	70	22	57	14	18.6%	36.4%
Eighth	R13	W20-L	LKD	34.5	27.2	7.2	21.0%													
		W20-U																		
		W21-L		38.9	37.0	1.9	5.0%													
		W21-U						28.5	28.2	99%	28.2	99%	0.0	0.0%	80	24	72	19	10.0%	20.8%
Ninth	R2	W2-L	LKD	31.4	31.4	0.0	0.0%													
		W2-U																		
		W3-L		35.0	35.0	0.0	0.0%													
		W3-U						33.0	30.5	92%	30.5	92%	0.0	0.0%	54	14	54	14	0.0%	0.0%
Ninth	R3	W4-L	Bedroom	35.1	35.1	0.0	0.0%													
		W4-U																		
		W5-L		33.5	29.2	4.3	12.9%													
		W5-U						14.6	13.6	93%	13.6	93%	0.0	0.0%	90	24	82	19	8.9%	20.8%
Ninth	R5	W7-L	Bedroom	25.4	24.2	1.3	4.9%													
		W7-U						13.8	8.4	60%	6.3	45%	2.1	25.2%	58	19	57	19	1.7%	0.0%
Ninth	R6	W8-L	Bedroom	30.9	30.9	0.0	0.0%													
		W8-U																		
		W9-L		34.5	28.3	6.2	18.0%													
		W9-U						13.3	12.0	90%	11.5	86%	0.5	4.2%	91	26	81	19	11.0%	26.9%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ninth	R7	W10-L	Bedroom	34.7	28.2	6.5	18.8%												
		W10-U						11.1	10.8	97%	9.7	87%	1.1	10.2%	83	27	72	20	13.3%	25.9%
Ninth	R8	W11-L	LKD	34.8	28.0	6.9	19.7%												
		W11-U																	
		W12-L		16.6	14.7	1.9	11.2%												
		W12-U																	
		W13-L		15.7	15.5	0.2	1.4%												
		W13-U						31.6	31.5	100%	31.5	100%	0.0	0.0%	81	24	71	18	12.3%	25.0%
West Apartments																			
First	R1	W1-L	LKD	13.4	13.4	0.0	0.0%												
		W1-U																	
		W2-L		4.9	4.9	0.0	0.0%												
		W2-U																	
		W7-L		1.5	0.0	1.5	100.0%												
		W7-U						30.8	20.1	65%	12.6	41%	7.5	37.2%	27	2	27	2	0.0%	0.0%
First	R2	W3-L	LKD	0.0	0.0	0.0	0.0%												
		W3-U																	
		W4-L		17.3	17.3	0.0	0.0%												
		W4-U																	
		W6-L		0.9	0.0	0.9	100.0%												
		W6-U						30.8	17.2	56%	8.1	26%	9.1	52.9%	32	2	32	2	0.0%	0.0%
First	R3	W5-L	Bedroom	31.6	12.9	18.7	59.2%												
		W5-U						12.8	12.6	98%	5.2	41%	7.4	58.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W8-L	Bedroom	17.6	8.6	9.0	51.1%												
		W8-U						12.8	9.3	72%	4.8	37%	4.5	48.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W9-L	Bedroom	6.1	2.0	4.1	67.3%												
		W9-U						12.3	7.9	64%	2.1	17%	5.8	73.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W10-L	Bedroom	15.1	7.7	7.4	49.0%												
		W10-U						13.7	10.0	73%	10.0	73%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W11-L	LKD	13.1	4.7	8.4	64.4%												
		W11-U																	
		W12-L		13.9	5.5	8.4	60.4%												
		W12-U						28.4	24.9	88%	22.5	79%	2.4	9.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W13-L	Bedroom	22.8	14.1	8.7	38.1%												
		W13-U						14.0	12.8	91%	12.7	91%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W14-L	LKD	20.2	10.0	10.2	50.3%												
		W14-U																	
		W15-L		18.5	7.4	11.0	59.8%												
		W15-U						28.4	26.1	92%	22.8	80%	3.3	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
First	R10	W16-L	Bedroom	14.1	5.8	8.3	58.9%												
		W16-U						9.7	9.3	96%	5.7	58%	3.6	39.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W17-L	Bedroom	14.4	6.2	8.2	56.9%												
		W17-U						35.6	33.1	93%	26.4	74%	6.7	20.3%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R1	W1-L	LKD	14.6	14.6	0.0	0.0%												
		W1-U																	
		W2-L		5.1	5.1	0.0	0.0%												
		W2-U																	
		W7-L		1.8	0.0	1.8	100.0%												
		W7-U						30.8	20.1	65%	12.5	40%	7.7	38.1%	28	2	28	2	0.0%	0.0%
Second	R2	W3-L	LKD	0.0	0.0	0.0	0.0%												
		W3-U																	
		W4-L		18.6	18.6	0.0	0.0%												
		W4-U																	
		W6-L		1.2	0.0	1.2	100.0%												
		W6-U						30.8	19.4	63%	8.8	29%	10.6	54.7%	34	2	34	2	0.0%	0.0%
Second	R3	W5-L	Bedroom	32.4	15.4	17.0	52.5%												
		W5-U						12.8	12.6	98%	7.0	54%	5.6	44.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W8-L	Bedroom	18.1	10.2	8.0	43.9%												
		W8-U						12.8	9.3	73%	6.1	48%	3.2	34.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W9-L	Bedroom	6.3	2.8	3.5	55.4%												
		W9-U						12.3	7.9	64%	3.2	26%	4.7	59.6%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10-L	Bedroom	16.3	9.3	7.0	43.2%												
		W10-U						13.7	10.4	76%	10.4	76%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W11-L	LKD	15.0	7.1	7.9	52.6%												
		W11-U																	
		W12-L		15.3	7.4	7.9	51.8%												
		W12-U						28.4	25.3	89%	22.9	81%	2.4	9.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W13-L	Bedroom	25.0	16.6	8.3	33.4%												
		W13-U						14.0	13.4	96%	13.4	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W14-L	LKD	22.5	12.7	9.8	43.5%												
		W14-U																	
		W15-L		20.2	9.8	10.4	51.4%												
		W15-U						28.4	26.2	92%	22.8	80%	3.3	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W16-L	Bedroom	15.0	6.5	8.4	56.4%												
		W16-U						9.7	9.4	96%	5.7	59%	3.7	39.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W17-L	Bedroom	15.5	7.2	8.3	53.3%												
		W17-U						35.6	33.2	93%	26.7	75%	6.4	19.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	15.7	15.7	0.0	0.0%												
		W1-U																	
		W2-L		5.2	5.2	0.0	0.0%												
		W2-U																	
		W7-L		2.0	0.0	2.0	100.0%												
		W7-U						30.8	20.2	65%	13.3	43%	6.9	34.0%	30	3	30	3	0.0%	0.0%
Third	R2	W3-L	LKD	0.0	0.0	0.0	0.0%												
		W3-U																	
		W4-L		19.9	19.9	0.0	0.0%												
		W4-U																	
		W6-L		1.4	0.0	1.4	100.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U						30.8	21.4	69%	10.6	34%	10.8	50.5%	37	3	37	3	0.0%	0.0%
Third	R3	W5-L	Bedroom	33.1	18.2	14.9	44.9%													
		W5-U						12.8	12.6	98%	9.5	74%	3.1	24.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W8-L	Bedroom	18.7	12.0	6.7	35.9%													
		W8-U						12.8	9.4	73%	8.1	63%	1.3	13.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W9-L	Bedroom	6.5	3.7	2.8	43.3%													
		W9-U						12.3	7.9	64%	4.7	38%	3.2	40.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10-L	Bedroom	18.9	12.4	6.6	34.7%													
		W10-U						13.7	11.9	87%	11.9	87%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W11-L	LKD	18.7	11.5	7.2	38.6%													
		W11-U																		
		W12-L		17.9	10.7	7.2	40.4%													
		W12-U						28.4	25.8	91%	23.5	83%	2.3	9.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W13-L	Bedroom	27.6	19.9	7.8	28.2%													
		W13-U						14.0	13.8	99%	13.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W14-L	LKD	25.0	15.9	9.1	36.4%													
		W14-U																		
		W15-L		22.2	12.8	9.5	42.6%													
		W15-U						28.4	26.2	92%	22.9	80%	3.4	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16-L	Bedroom	15.9	7.6	8.3	52.1%													
		W16-U						9.7	9.4	96%	6.0	61%	3.4	36.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W17-L	Bedroom	16.6	8.4	8.2	49.4%													
		W17-U						35.6	33.2	93%	27.1	76%	6.1	18.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	16.8	16.8	0.0	0.0%													
		W1-U																		
		W2-L		5.3	5.3	0.0	0.0%													
		W2-U																		
		W7-L		2.2	0.1	2.0	94.0%													
		W7-U						30.8	20.5	66%	16.5	54%	3.9	19.2%	33	4	33	4	0.0%	0.0%
Fourth	R2	W3-L	LKD	0.0	0.0	0.0	0.0%													
		W3-U																		
		W4-L		21.2	21.2	0.0	0.0%													
		W4-U																		
		W6-L		1.7	0.1	1.6	94.7%													
		W6-U						30.8	21.6	70%	15.1	49%	6.5	30.0%	39	4	39	4	0.0%	0.0%
Fourth	R3	W5-L	Bedroom	33.8	21.4	12.3	36.6%													
		W5-U						12.8	12.6	98%	11.9	93%	0.7	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W8-L	Bedroom	19.4	14.0	5.4	27.8%													
		W8-U						12.8	9.5	74%	9.5	74%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W9-L	Bedroom	6.8	4.7	2.1	30.2%													
		W9-U						12.3	8.0	65%	6.7	54%	1.3	15.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W10-L	Bedroom	27.3	21.4	6.0	21.8%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						13.7	13.6	99%	13.6	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W11-L	LKD	25.1	18.7	6.4	25.5%													
		W11-U																		
		W12-L		22.3	15.8	6.5	29.0%													
		W12-U						28.4	26.3	93%	24.1	85%	2.2	8.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W13-L	Bedroom	30.4	23.4	7.0	23.1%													
		W13-U						14.0	13.8	99%	13.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W14-L	LKD	27.3	19.2	8.0	29.5%													
		W14-U																		
		W15-L		24.1	15.8	8.3	34.5%													
		W15-U						28.4	26.3	93%	23.1	81%	3.2	12.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W16-L	Bedroom	16.9	9.1	7.8	46.1%													
		W16-U						9.7	9.4	96%	7.1	73%	2.3	24.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W17-L	Bedroom	17.6	9.8	7.8	44.1%													
		W17-U						35.6	33.3	93%	27.6	77%	5.7	17.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	12.5	12.5	0.0	0.0%													
		W1-U																		
		W2-L		32.9	28.3	4.6	14.0%													
		W2-U																		
		W3-L		28.3	23.6	4.7	16.5%													
		W3-U																		
		W4-L		24.3	19.3	5.0	20.4%													
		W4-U						35.2	30.1	86%	30.1	86%	0.0	0.0%	32	4	32	4	0.0%	0.0%
Fifth	R3	W6-L	Bedroom	34.0	28.7	5.3	15.5%													
		W6-U						11.5	11.5	99%	11.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W7-L	LKD	28.7	23.1	5.6	19.6%													
		W7-U																		
		W8-L		25.0	19.3	5.7	22.9%													
		W8-U						29.6	27.2	92%	25.4	86%	1.9	7.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W9-L	Bedroom	33.2	27.1	6.1	18.3%													
		W9-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W10-L	LKD	29.2	22.4	6.8	23.2%													
		W10-U																		
		W11-L		25.7	18.7	7.0	27.2%													
		W11-U						29.6	27.2	92%	25.0	84%	2.2	8.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W12-L	LKD	18.8	11.8	7.0	37.0%													
		W12-U						46.5	44.4	96%	41.8	90%	2.6	5.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	13.1	13.1	0.0	0.0%													
		W1-U																		
		W2-L		34.5	30.1	4.4	12.7%													
		W2-U																		
		W3-L		22.4	19.5	2.9	12.9%													
		W3-U																		
		W4-L		24.4	19.7	4.7	19.1%													
		W4-U						35.2	29.7	85%	29.7	85%	0.0	0.0%	34	6	34	6	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R3	W6-L	Bedroom	35.6	30.9	4.7	13.2%												
		W6-U						11.5	11.5	99%	11.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W7-L	LKD	35.9	30.9	5.0	13.8%												
		W7-U																	
		W8-L		35.7	30.7	5.0	14.0%												
		W8-U						29.6	27.3	92%	25.5	86%	1.8	6.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W9-L	Bedroom	35.2	30.0	5.2	14.6%												
		W9-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W10-L	LKD	35.5	30.0	5.6	15.6%												
		W10-U																	
		W11-L		36.1	30.5	5.6	15.4%												
		W11-U						29.6	27.2	92%	25.1	85%	2.0	7.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W12-L	LKD	15.8	11.0	4.8	30.4%												
		W12-U						46.5	43.9	95%	41.0	88%	2.9	6.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1	LKD	14.0	14.0	0.0	0.0%												
		W2		34.1	29.9	4.1	12.1%												
		W3-L		23.2	20.4	2.8	12.1%												
		W3-U																	
		W4		24.9	20.5	4.4	17.7%	35.2	30.1	86%	30.1	86%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Seventh	R3	W6	Bedroom	35.9	31.5	4.4	12.2%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W7	Bedroom	35.8	31.3	4.5	12.6%	10.5	10.0	95%	9.8	93%	0.2	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8	LKD	25.8	21.2	4.7	18.2%												
		W9		26.7	21.8	4.9	18.4%												
		W10		34.8	33.0	1.8	5.3%	44.0	39.3	89%	39.3	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W11	Bedroom	34.2	32.7	1.5	4.5%	13.3	13.1	98%	13.0	98%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W12-L	Bedroom	33.5	32.1	1.4	4.1%												
		W12-U						13.7	13.6	99%	13.5	99%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1	LKD	14.6	14.6	0.0	0.0%												
		W2		35.3	31.4	3.9	11.0%												
		W3-L		23.3	20.7	2.6	11.1%												
		W3-U																	
		W4		25.2	21.0	4.2	16.6%	35.2	29.7	85%	29.7	85%	0.0	0.0%	38	7	38	7	0.0%	0.0%
Eighth	R3	W6	Bedroom	36.2	32.1	4.1	11.4%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W7	Bedroom	36.1	31.8	4.3	11.9%	10.5	10.0	95%	9.8	93%	0.2	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W8-L	LKD	29.2	24.7	4.5	15.4%												
		W8-U																	
		W9		27.0	22.3	4.7	17.3%												
		W10		35.3	33.9	1.4	4.1%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W11	Bedroom	34.7	33.4	1.3	3.7%	12.4	12.2	99%	12.2	98%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W12-L	Bedroom	34.0	32.8	1.1	3.3%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W12-U						12.7	12.5	99%	12.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1	LKD	15.5	15.5	0.0	0.0%													
		W2		34.7	31.1	3.7	10.6%													
		W3-L		23.9	21.4	2.5	10.5%													
		W3-U																		
		W4		25.5	21.6	3.9	15.5%	35.2	30.1	86%	30.1	86%	0.0	0.0%	39	8	39	8	0.0%	0.0%
Ninth	R3	W6	Bedroom	36.5	32.6	3.9	10.7%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W7	Bedroom	36.4	32.4	4.0	11.1%	10.5	10.0	95%	9.8	93%	0.2	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W8-L	LKD	29.5	25.3	4.2	14.4%													
		W8-U																		
		W9		27.2	22.8	4.4	16.2%													
		W10		35.8	34.5	1.4	3.8%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W11	Bedroom	35.2	34.0	1.2	3.4%	12.4	12.2	99%	12.2	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W12-L	Bedroom	34.5	33.4	1.1	3.1%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1	LKD	16.1	16.1	0.0	0.0%													
		W2		36.0	32.6	3.4	9.5%													
		W3-L		23.9	21.7	2.3	9.4%													
		W3-U																		
		W4		25.8	22.1	3.7	14.3%	35.2	29.8	85%	29.8	85%	0.0	0.0%	41	8	41	8	0.0%	0.0%
Tenth	R3	W6	Bedroom	36.9	33.2	3.7	9.9%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W7	Bedroom	36.8	33.0	3.8	10.3%	10.5	10.0	95%	9.8	93%	0.2	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W8-L	LKD	29.8	25.8	4.0	13.4%													
		W8-U																		
		W9		27.5	23.3	4.1	15.1%													
		W10		36.3	35.0	1.3	3.5%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W11	Bedroom	35.7	34.6	1.1	3.1%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W12-L	Bedroom	34.9	34.0	1.0	2.8%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1	LKD	17.2	17.2	0.0	0.0%													
		W2		35.4	32.2	3.2	9.0%													
		W3-L		24.0	22.0	2.0	8.4%													
		W3-U																		
		W4		26.1	22.7	3.4	13.1%	35.2	30.1	86%	30.1	86%	0.0	0.0%	41	8	41	8	0.0%	0.0%
Eleventh	R3	W6	Bedroom	37.3	33.9	3.4	9.1%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W7	Bedroom	37.1	33.6	3.5	9.5%	10.5	10.0	95%	9.8	93%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W8-L	LKD	30.1	26.4	3.7	12.3%													
		W8-U																		
		W9		27.7	23.8	3.9	13.9%													
		W10		36.7	35.5	1.2	3.2%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eleventh	R6	W11	Bedroom	36.1	35.1	1.0	2.9%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W12-L	Bedroom	35.4	34.5	0.9	2.6%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1	LKD	18.0	18.0	0.0	0.0%													
		W2		37.0	34.1	2.9	7.8%													
		W3-L		23.4	21.8	1.6	6.7%													
		W3-U																		
		W4		26.4	23.2	3.1	11.8%	35.2	29.8	85%	29.8	85%	0.0	0.0%	43	8	43	8	0.0%	0.0%
Twelfth	R3	W6	Bedroom	37.9	34.7	3.1	8.2%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W7	Bedroom	37.5	34.3	3.2	8.6%	10.5	10.0	95%	9.9	94%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W8-L	LKD	30.6	27.1	3.4	11.2%													
		W8-U																		
		W9		27.9	24.3	3.6	12.8%													
		W10		37.1	36.0	1.1	2.9%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W11	Bedroom	36.5	35.5	1.0	2.6%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W12-L	Bedroom	35.8	35.0	0.8	2.3%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1	LKD	19.4	19.4	0.0	0.0%													
		W2		38.6	36.0	2.6	6.8%													
		W3-L		31.0	29.7	1.3	4.2%													
		W3-U																		
		W4		38.7	35.9	2.8	7.3%	35.2	30.1	86%	30.1	86%	0.0	0.0%	46	9	46	9	0.0%	0.0%
Thirteenth	R3	W6	Bedroom	38.3	35.5	2.8	7.4%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W7	Bedroom	38.2	35.2	3.0	7.7%	10.5	10.0	95%	10.0	95%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W8-L	LKD	30.8	27.7	3.1	10.2%													
		W8-U																		
		W9		28.1	24.8	3.3	11.6%													
		W10		37.4	36.4	1.0	2.6%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W11	Bedroom	36.9	36.0	0.9	2.4%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W12-L	Bedroom	36.2	35.4	0.8	2.1%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1	LKD	20.8	20.8	0.0	0.0%													
		W2		38.9	36.6	2.3	6.0%													
		W3		39.0	36.6	2.4	6.2%													
		W4		39.1	36.6	2.5	6.4%	35.2	30.2	86%	30.2	86%	0.0	0.0%	50	10	50	10	0.0%	0.0%
Fourteenth	R3	W6	Bedroom	38.7	36.2	2.6	6.6%	14.3	14.2	100%	14.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W7	Bedroom	38.9	36.3	2.6	6.8%	10.5	10.0	96%	10.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W8-L	LKD	39.0	36.2	2.8	7.2%													
		W8-U																		
		W9		39.1	36.2	2.9	7.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10		37.7	36.8	0.9	2.4%	43.6	39.3	90%	39.3	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W11	Bedroom	37.2	36.5	0.8	2.1%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W12-L	Bedroom	36.6	36.0	0.7	1.9%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
WalterTull House																				
Second	R1	W1-L	LKD	27.8	27.8	0.0	0.0%													
		W1-U																		
		W2-L		7.6	6.2	1.4	18.6%													
		W2-U																		
		W3-L		25.7	23.4	2.3	9.0%													
		W3-U						34.4	32.2	94%	32.0	93%	0.2	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	29.3	29.3	0.0	0.0%													
		W1-U																		
		W2-L		7.8	6.4	1.4	17.6%													
		W2-U																		
		W3-L		26.2	24.0	2.2	8.3%													
		W3-U						34.4	32.7	95%	32.7	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R2	W4	LKD	22.0	22.0	0.0	0.0%													
		W5-L		34.6	32.2	2.4	6.9%													
		W5-U																		
		W6-L		34.5	31.8	2.7	7.7%													
		W6-U																		
		W7-L		1.7	1.7	0.0	0.0%													
		W7-U						29.5	26.9	91%	26.3	89%	0.6	2.1%	43	11	37	11	14.0%	0.0%
Third	R3	W8-L	Bedroom	6.2	4.0	2.2	35.2%													
		W8-U						11.9	10.9	92%	10.1	85%	0.8	7.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W9-L	Bedroom	34.3	31.4	2.9	8.5%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W10-L	Bedroom	34.3	31.3	3.0	8.8%													
		W10-U						13.5	13.2	98%	12.7	94%	0.5	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W11-L	LKD	7.5	5.2	2.2	30.0%													
		W11-U																		
		W12-L		35.6	35.4	0.2	0.6%													
		W12-U																		
		W13-L		36.5	36.2	0.3	0.7%													
		W13-U						33.6	30.8	91%	30.8	91%	0.0	0.0%	87	28	84	28	3.4%	0.0%
Fourth	R1	W1-L	LKD	31.6	31.6	0.0	0.0%													
		W1-U																		
		W2-L		8.0	6.6	1.4	17.4%													
		W2-U																		
		W3-L		26.5	24.4	2.1	8.0%													
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R2	W4	LKD	22.1	22.1	0.0	0.0%													
		W5-L		35.0	32.7	2.3	6.5%													
		W5-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-L		34.9	32.3	2.6	7.3%													
		W6-U																		
		W7-L		1.8	1.8	0.0	0.0%													
		W7-U						29.5	26.9	91%	26.4	90%	0.4	1.7%	44	11	38	11	13.6%	0.0%
Fourth	R3	W8-L	Bedroom	6.4	4.2	2.2	34.4%													
		W8-U						11.9	10.9	92%	10.3	87%	0.7	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W9-L	Bedroom	34.8	31.9	2.8	8.2%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W10-L	Bedroom	34.7	31.8	2.9	8.4%													
		W10-U						13.5	13.2	98%	12.7	95%	0.4	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W11-L	LKD	7.7	5.5	2.3	29.5%													
		W11-U																		
		W12-L		36.0	35.8	0.2	0.6%													
		W12-U																		
		W13-L		36.9	36.7	0.2	0.7%													
		W13-U						33.6	30.8	91%	30.8	91%	0.0	0.0%	89	28	86	28	3.4%	0.0%
Fifth	R1	W1-L	LKD	34.9	34.9	0.0	0.0%													
		W1-U																		
		W2-L		8.2	6.8	1.4	17.4%													
		W2-U																		
		W3-L		26.7	24.7	2.0	7.6%													
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R2	W4	LKD	22.1	22.1	0.0	0.0%													
		W5-L		35.4	33.2	2.2	6.2%													
		W5-U																		
		W6-L		35.3	32.8	2.5	7.0%													
		W6-U																		
		W7-L		1.9	1.9	0.0	0.0%													
		W7-U						29.5	26.9	91%	26.5	90%	0.3	1.2%	44	11	39	11	11.4%	0.0%
Fifth	R3	W8-L	Bedroom	6.6	4.3	2.2	34.0%													
		W8-U						11.9	10.9	92%	10.5	88%	0.4	3.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W9-L	Bedroom	35.2	32.4	2.7	7.8%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W10-L	Bedroom	35.1	32.3	2.8	8.1%													
		W10-U						13.5	13.2	98%	12.8	95%	0.3	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W11-L	LKD	8.0	5.6	2.3	29.1%													
		W11-U																		
		W12-L		36.1	35.9	0.2	0.6%													
		W12-U																		
		W13-L		37.1	36.9	0.2	0.6%													
		W13-U						33.6	30.8	91%	30.8	91%	0.0	0.0%	89	28	86	28	3.4%	0.0%
Sixth	R1	W1-L	LKD	38.1	38.1	0.0	0.0%													
		W1-U																		
		W2-L		8.4	6.9	1.5	17.4%													
		W2-U																		
		W3-L		27.0	25.0	2.0	7.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R2	W4	LKD	22.2	22.2	0.0	0.0%													
		W5-L		35.8	33.6	2.2	6.1%													
		W5-U																		
		W6-L		35.7	33.3	2.3	6.6%													
		W6-U																		
		W7-L		2.0	2.0	0.0	0.0%													
		W7-U						29.5	26.8	91%	26.7	91%	0.1	0.3%	45	11	40	11	11.1%	0.0%
Sixth	R3	W8-L	Bedroom	6.7	4.5	2.3	33.5%													
		W8-U						11.9	10.9	92%	10.6	90%	0.3	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W9-L	Bedroom	35.6	32.9	2.7	7.4%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W10-L	Bedroom	35.5	32.7	2.8	7.8%													
		W10-U						13.5	13.1	97%	12.8	95%	0.4	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W11-L	LKD	8.2	5.8	2.4	29.0%													
		W11-U																		
		W12-L		36.3	36.1	0.2	0.5%													
		W12-U																		
		W13-L		37.3	37.1	0.2	0.6%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	87	28	3.3%	0.0%
Seventh	R1	W1-L	LKD	38.4	38.4	0.0	0.0%													
		W1-U																		
		W2-L		8.6	7.1	1.5	17.4%													
		W2-U																		
		W3-L		27.2	25.3	1.9	6.9%													
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W4	LKD	22.2	22.2	0.0	0.0%													
		W5-L		36.2	34.1	2.1	5.8%													
		W5-U																		
		W6-L		36.1	33.8	2.2	6.2%													
		W6-U																		
		W7-L		2.1	2.1	0.0	0.0%													
		W7-U						29.5	27.0	91%	26.8	91%	0.1	0.5%	45	11	40	11	11.1%	0.0%
Seventh	R3	W8-L	Bedroom	6.9	4.7	2.3	32.5%													
		W8-U						11.9	10.9	92%	10.7	90%	0.2	1.8%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W9-L	Bedroom	36.0	33.4	2.6	7.1%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W10-L	Bedroom	35.9	33.2	2.7	7.4%													
		W10-U						13.5	13.1	97%	12.9	96%	0.2	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W11-L	LKD	8.4	6.0	2.4	28.6%													
		W11-U																		
		W12-L		36.5	36.3	0.2	0.5%													
		W12-U																		
		W13-L		37.5	37.3	0.2	0.6%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	87	28	3.3%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		8.7	7.2	1.5	17.6%													
		W2-U																		
		W3-L		27.5	25.7	1.8	6.6%													
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W4	LKD	22.3	22.3	0.0	0.0%													
		W5-L		36.5	34.5	2.0	5.5%													
		W5-U																		
		W6-L		36.5	34.3	2.1	5.9%													
		W6-U																		
		W7-L		2.2	2.2	0.0	0.0%													
		W7-U						29.5	27.0	92%	26.9	91%	0.1	0.5%	46	12	43	12	6.5%	0.0%
Eighth	R3	W8-L	Bedroom	7.1	4.9	2.2	30.6%													
		W8-U						11.9	10.9	92%	10.8	91%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W9-L	Bedroom	36.4	33.9	2.4	6.7%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W10-L	Bedroom	36.3	33.7	2.6	7.1%													
		W10-U						13.5	13.1	97%	13.0	96%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W11-L	LKD	8.7	6.2	2.4	28.1%													
		W11-U																		
		W12-L		36.6	36.5	0.2	0.5%													
		W12-U																		
		W13-L		37.7	37.5	0.2	0.5%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Ninth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		8.9	7.4	1.5	17.1%													
		W2-U																		
		W3-L		27.7	26.0	1.7	6.1%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R2	W4	LKD	22.4	22.4	0.0	0.0%													
		W5-L		36.9	35.0	1.9	5.2%													
		W5-U																		
		W6-L		36.8	34.8	2.0	5.5%													
		W6-U																		
		W7-L		2.3	2.3	0.0	0.0%													
		W7-U						29.5	27.1	92%	27.0	91%	0.1	0.5%	46	12	43	12	6.5%	0.0%
Ninth	R3	W8-L	Bedroom	7.3	5.2	2.1	28.2%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W9-L	Bedroom	36.7	34.4	2.3	6.3%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W10-L	Bedroom	36.7	34.2	2.4	6.6%													
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W11-L	LKD	8.9	6.4	2.4	27.3%													
		W11-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W12-L		36.8	36.6	0.2	0.5%													
		W12-U																		
		W13-L		37.8	37.6	0.2	0.5%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Tenth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		9.1	7.6	1.5	16.0%													
		W2-U																		
		W3-L		27.9	26.3	1.6	5.8%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R2	W4	LKD	22.4	22.4	0.0	0.0%													
		W5-L		37.2	35.4	1.8	4.9%													
		W5-U																		
		W6-L		37.2	35.2	1.9	5.2%													
		W6-U																		
		W7-L		2.4	2.4	0.0	0.0%													
		W7-U						29.5	27.1	92%	27.0	92%	0.1	0.5%	46	12	44	12	4.3%	0.0%
Tenth	R3	W8-L	Bedroom	7.4	5.5	2.0	26.3%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W9-L	Bedroom	37.1	34.9	2.2	5.9%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W10-L	Bedroom	37.0	34.7	2.3	6.2%													
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W11-L	LKD	9.1	6.8	2.3	25.5%													
		W11-U																		
		W12-L		37.0	36.8	0.2	0.4%													
		W12-U																		
		W13-L		38.0	37.8	0.2	0.4%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Eleventh	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.2	7.8	1.4	14.8%													
		W2-U																		
		W3-L		28.1	26.6	1.5	5.4%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R2	W4	LKD	22.5	22.5	0.0	0.0%													
		W5-L		37.6	35.9	1.7	4.5%													
		W5-U																		
		W6-L		37.5	35.7	1.8	4.8%													
		W6-U																		
		W7-L		2.5	2.5	0.0	0.0%													
		W7-U						29.5	27.2	92%	27.0	92%	0.1	0.5%	46	12	44	12	4.3%	0.0%
Eleventh	R3	W8-L	Bedroom	7.6	5.7	1.8	24.1%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W9-L	Bedroom	37.4	35.4	2.1	5.5%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eleventh	R5	W10-L	Bedroom	37.4	35.2	2.2	5.8%													
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W11-L	LKD	9.2	7.1	2.2	23.6%													
		W11-U																		
		W12-L		37.1	37.0	0.1	0.4%													
		W12-U																		
		W13-L		38.1	38.0	0.2	0.4%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Twelfth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.3	8.1	1.3	13.5%													
		W2-U																		
		W3-L		28.2	26.8	1.4	5.0%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R2	W4	LKD	22.5	22.5	0.0	0.0%													
		W5-L		37.8	36.3	1.6	4.2%													
		W5-U																		
		W6-L		37.8	36.1	1.7	4.4%													
		W6-U																		
		W7-L		2.6	2.6	0.0	0.0%													
		W7-U						29.5	27.2	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
Twelfth	R3	W8-L	Bedroom	7.7	6.0	1.7	22.1%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W9-L	Bedroom	37.7	35.8	1.9	5.0%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W10-L	Bedroom	37.7	35.7	2.0	5.3%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W11-L	LKD	9.4	7.4	2.0	21.6%													
		W11-U																		
		W12-L		37.3	37.1	0.1	0.4%													
		W12-U																		
		W13-L		38.3	38.1	0.2	0.4%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Thirteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.4	8.2	1.2	12.3%													
		W2-U																		
		W3-L		28.3	27.0	1.3	4.6%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R2	W4	LKD	22.7	22.7	0.0	0.0%													
		W5-L		38.1	36.6	1.5	3.8%													
		W5-U																		
		W6-L		38.0	36.5	1.5	4.0%													
		W6-U																		
		W7-L		2.7	2.7	0.0	0.0%													
		W7-U						29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
Thirteenth	R3	W8-L	Bedroom	7.8	6.2	1.6	20.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W9-L	Bedroom	37.9	36.2	1.8	4.6%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W10-L	Bedroom	37.9	36.0	1.9	4.9%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W11-L	LKD	9.5	7.6	1.9	19.6%													
		W11-U																		
		W12-L		37.4	37.3	0.1	0.3%													
		W12-U																		
		W13-L		38.4	38.3	0.1	0.4%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Fourteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.5	8.4	1.1	11.2%													
		W2-U																		
		W3-L		28.4	27.2	1.2	4.1%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R2	W4	LKD	23.0	23.0	0.0	0.0%													
		W5-L		38.2	36.9	1.3	3.4%													
		W5-U																		
		W6-L		38.2	36.8	1.4	3.7%													
		W6-U																		
		W7-L		2.8	2.8	0.0	0.0%													
		W7-U						29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
Fourteenth	R3	W8-L	Bedroom	7.8	6.4	1.4	18.0%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W9-L	Bedroom	38.1	36.5	1.6	4.2%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W10-L	Bedroom	38.1	36.4	1.7	4.4%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W11-L	LKD	9.5	7.9	1.7	17.6%													
		W11-U																		
		W12-L		37.6	37.5	0.1	0.3%													
		W12-U																		
		W13-L		38.6	38.4	0.1	0.3%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Fifteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.5	8.6	0.9	10.0%													
		W2-U																		
		W3-L		28.8	27.8	1.1	3.6%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R2	W4	LKD	24.5	24.5	0.0	0.0%													
		W5-L		38.4	37.2	1.2	3.1%													
		W5-U																		
		W6-L		38.4	37.1	1.3	3.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U																		
		W7-L		2.9	2.9	0.0	0.0%													
		W7-U						29.5	27.3	93%	27.1	92%	0.2	0.6%	46	12	46	12	0.0%	0.0%
Fifteenth	R3	W8-L	Bedroom	7.9	6.6	1.3	16.1%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W9-L	Bedroom	38.3	36.9	1.4	3.7%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W10-L	Bedroom	38.3	36.8	1.5	3.9%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R6	W11-L	LKD	9.6	8.1	1.5	15.7%													
		W11-U																		
		W12-L		37.7	37.6	0.1	0.3%													
		W12-U																		
		W13-L		38.7	38.6	0.1	0.3%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
East Apartments																				
First	R2	W3-L	Bedroom	1.3	0.0	1.3	100.0%													
		W3-U																		
		W4		0.2	0.0	0.2	100.0%	12.2	4.5	37%	0.3	2%	4.2	93.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		18.8	10.3	8.5	45.4%													
		W6-U																		
		W7-L		21.2	10.9	10.3	48.6%													
		W7-U						32.0	24.3	76%	13.7	43%	10.7	43.8%	12	2	9	2	25.0%	0.0%
First	R4	W8-L	LKD	4.9	0.0	4.9	100.0%													
		W8-U																		
		W9		0.4	0.0	0.4	100.0%													
		W10-L		0.0	0.0	0.0	0.0%													
		W10-U																		
		W11-L		25.4	12.6	12.8	50.4%													
		W11-U						34.0	26.6	78%	8.3	24%	18.3	68.7%	14	1	6	1	57.1%	0.0%
First	R5	W12-L	Bedroom	27.0	13.7	13.3	49.2%													
		W12-U						12.2	11.4	94%	5.0	41%	6.5	56.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W13-L	LKD	28.3	15.1	13.2	46.7%													
		W13-U																		
		W14-L		29.0	16.3	12.7	43.8%													
		W14-U																		
		W15-L		20.3	18.8	1.5	7.5%													
		W15-U																		
		W16-L		19.5	18.3	1.3	6.5%													
		W16-U						44.4	38.3	86%	35.1	79%	3.2	8.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W17-L	Bedroom	24.7	23.6	1.1	4.5%													
		W17-U						9.3	8.4	91%	8.4	90%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W18-L	Bedroom	29.5	28.6	0.9	2.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W18-U						9.2	8.7	94%	8.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W19-L	Bedroom	30.6	29.9	0.7	2.3%													
		W19-U																		
		W20-L		23.3	23.3	0.0	0.0%													
		W20-U						17.9	17.9	100%	17.9	100%	0.0	0.0%	23	0	23	0	0.0%	0.0%
Second	R1	W1-L	LKD	9.7	9.7	0.0	0.0%													
		W1-U																		
		W2-L		12.2	10.1	2.1	17.5%													
		W2-U																		
		W3-L		14.2	11.1	3.2	22.2%													
		W3-U						38.7	23.9	62%	10.3	27%	13.6	57.0%	22	8	22	8	0.0%	0.0%
Second	R2	W4-L	Bedroom	2.7	0.0	2.7	100.0%													
		W4-U						12.2	7.8	64%	0.1	1%	7.7	98.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		20.3	12.9	7.4	36.5%													
		W6-U																		
		W7-L		22.5	13.7	8.7	38.8%													
		W7-U						31.9	24.9	78%	12.9	40%	12.0	48.4%	12	2	9	2	25.0%	0.0%
Second	R4	W8-L	LKD	6.0	0.0	6.0	100.0%													
		W8-U																		
		W9-L		0.3	0.1	0.2	66.7%													
		W9-U																		
		W10-L		26.7	15.8	10.8	40.6%													
		W10-U						34.0	29.7	87%	9.6	28%	20.1	67.6%	15	0	6	0	60.0%	0.0%
Second	R5	W11-L	Bedroom	28.4	17.3	11.1	39.1%													
		W11-U						12.2	11.8	97%	6.9	56%	4.9	41.7%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W12-L	LKD	29.5	18.7	10.8	36.6%													
		W12-U																		
		W13-L		30.3	20.1	10.2	33.6%													
		W13-U																		
		W14-L		16.0	15.0	0.9	5.8%													
		W14-U																		
		W15-L		20.7	20.0	0.7	3.5%													
		W15-U						44.5	39.4	89%	35.0	79%	4.4	11.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W16-L	Bedroom	29.8	29.2	0.6	2.0%													
		W16-U						9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W17-L	Bedroom	32.3	31.8	0.5	1.5%													
		W17-U						9.5	9.3	97%	9.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W18-L	Bedroom	32.9	32.5	0.4	1.2%													
		W18-U																		
		W19-L		24.0	24.0	0.0	0.0%													
		W19-U						18.0	16.7	93%	16.7	93%	0.0	0.0%	26	2	26	2	0.0%	0.0%
Third	R1	W1-L	LKD	10.6	10.6	0.0	0.1%													
		W1-U																		
		W2-L		13.1	11.5	1.6	12.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		15.1	12.6	2.5	16.5%													
		W3-U						38.7	20.3	52%	13.8	36%	6.6	32.3%	24	7	24	7	0.0%	0.0%
Third	R2	W4-L	Bedroom	1.1	0.2	0.9	85.8%													
		W4-U						12.2	4.6	38%	1.6	13%	3.0	64.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		21.0	15.3	5.8	27.5%													
		W6-U																		
		W7-L		23.2	16.3	6.9	29.8%													
		W7-U						32.0	24.2	76%	16.2	51%	8.1	33.2%	12	2	9	2	25.0%	0.0%
Third	R4	W8-L	LKD	3.8	0.2	3.6	93.9%													
		W8-U																		
		W9-L		0.0	0.0	0.0	0.0%													
		W9-U																		
		W10-L		27.4	18.6	8.7	31.9%													
		W10-U						34.0	27.0	79%	11.8	35%	15.2	56.3%	16	1	7	1	56.3%	0.0%
Third	R5	W11-L	Bedroom	28.9	19.8	9.1	31.5%													
		W11-U						12.2	11.3	93%	6.4	53%	4.9	43.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W12-L	LKD	30.2	21.4	8.8	29.2%													
		W12-U																		
		W13-L		31.0	22.7	8.3	26.8%													
		W13-U																		
		W14-L		20.1	19.6	0.5	2.4%													
		W14-U																		
		W15-L		18.1	17.7	0.4	2.0%													
		W15-U						44.6	39.7	89%	36.4	82%	3.3	8.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W16-L	Bedroom	26.9	26.6	0.3	1.1%													
		W16-U						9.4	8.6	92%	8.6	92%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W17-L	Bedroom	33.0	32.8	0.2	0.7%													
		W17-U						12.1	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W18-L	Bedroom	33.6	33.4	0.2	0.6%													
		W18-U																		
		W19-L		25.9	25.9	0.0	0.0%													
		W19-U						14.3	14.3	100%	14.3	100%	0.0	0.0%	29	2	29	2	0.0%	0.0%
Fourth	R1	W1-L	LKD	11.3	11.3	0.0	0.4%													
		W1-U																		
		W2-L		14.8	13.4	1.4	9.5%													
		W2-U																		
		W3-L		17.1	14.7	2.4	14.2%													
		W3-U						38.7	27.1	70%	19.3	50%	7.7	28.5%	26	8	26	8	0.0%	0.0%
Fourth	R2	W4-L	Bedroom	3.9	1.2	2.6	68.3%													
		W4-U						12.2	9.4	77%	6.1	50%	3.3	34.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		22.7	17.9	4.8	21.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W6-U																	
		W7-L		24.6	19.2	5.4	22.0%												
		W7-U						32.0	25.8	81%	24.2	76%	1.6	6.2%	14	2	11	2	21.4%	0.0%
Fourth	R4	W8-L	LKD	6.8	2.2	4.6	68.1%												
		W8-U																	
		W9-L		0.5	0.4	0.1	27.5%												
		W9-U																	
		W10-L		28.6	21.8	6.8	23.6%												
		W10-U						34.0	30.0	88%	21.0	62%	9.0	30.0%	17	1	11	1	35.3%	0.0%
Fourth	R5	W11-L	Bedroom	30.2	23.3	6.9	22.9%												
		W11-U						12.2	11.8	97%	11.6	95%	0.2	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W12-L	LKD	31.3	24.7	6.6	21.1%												
		W12-U																	
		W13-L		32.0	26.0	6.0	18.8%												
		W13-U																	
		W14-L		18.6	18.4	0.2	1.1%												
		W14-U																	
		W15-L		23.0	22.9	0.2	0.7%												
		W15-U						44.5	39.6	89%	35.6	80%	4.0	10.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W16-L	Bedroom	32.5	32.4	0.1	0.4%												
		W16-U						9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W17-L	Bedroom	33.7	33.6	0.1	0.4%												
		W17-U						9.5	9.3	98%	9.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W18-L	Bedroom	33.3	33.2	0.1	0.3%												
		W18-U																	
		W19-L		26.4	26.4	0.0	0.0%												
		W19-U						18.0	16.7	93%	16.7	93%	0.0	0.0%	30	2	29	2	3.3%	0.0%
Fifth	R1	W1-L	LKD	12.5	12.4	0.0	0.3%												
		W1-U																	
		W2-L		16.0	15.0	1.0	6.3%												
		W2-U																	
		W3-L		18.3	16.2	2.1	11.5%												
		W3-U						38.7	28.7	74%	23.0	59%	5.7	19.9%	27	8	27	8	0.0%	0.0%
Fifth	R2	W4-L	Bedroom	2.8	1.1	1.8	62.3%												
		W4-U						12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	LKD	0.0	0.0	0.0	0.0%												
		W5-U																	
		W6-L		23.9	20.5	3.4	14.4%												
		W6-U																	
		W7-L		25.7	22.0	3.7	14.4%												
		W7-U						32.0	25.2	79%	25.1	79%	0.1	0.5%	18	3	16	3	11.1%	0.0%
Fifth	R4	W8-L	LKD	4.7	2.1	2.6	55.8%												
		W8-U																	
		W9-L		0.0	0.0	0.0	0.0%												
		W9-U																	
		W10-L		29.4	25.0	4.5	15.1%												
		W10-U						34.0	28.8	85%	28.4	83%	0.4	1.5%	19	2	16	2	15.8%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R5	W11-L	Bedroom	30.9	26.3	4.6	14.9%													
		W11-U						12.2	11.5	94%	11.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W12-L	LKD	32.0	27.6	4.5	13.9%													
		W12-U																		
		W13-L		32.7	28.4	4.3	13.2%													
		W13-U																		
		W14-L		35.8	35.7	0.1	0.3%													
		W14-U																		
		W15-L		35.6	35.5	0.1	0.2%													
		W15-U						44.6	40.8	92%	37.9	85%	3.0	7.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W16-L	Bedroom	35.2	35.1	0.1	0.2%													
		W16-U						9.4	8.6	92%	8.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W17-L	Bedroom	32.8	32.7	0.1	0.2%													
		W17-U						12.1	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W18-L	Bedroom	21.3	21.3	0.1	0.3%													
		W18-U																		
		W19-L		28.1	28.1	0.0	0.0%													
		W19-U						14.3	14.3	100%	14.3	100%	0.0	0.0%	38	3	37	3	2.6%	0.0%
Sixth	R1	W1-L	Bedroom	13.4	13.3	0.1	0.7%													
		W1-U																		
		W2-L		18.0	16.9	1.1	6.1%													
		W2-U						11.7	8.9	76%	8.0	69%	0.9	9.7%	30	10	30	10	0.0%	0.0%
Sixth	R2	W3-L	Bedroom	20.7	18.3	2.4	11.4%													
		W3-U						12.1	8.7	71%	8.4	69%	0.3	3.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W4-L	Bedroom	5.4	3.1	2.3	42.6%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		25.5	22.8	2.6	10.3%													
		W6-U																		
		W7-L		27.2	24.7	2.5	9.1%													
		W7-U						32.1	28.5	89%	28.5	89%	0.0	0.0%	21	3	19	3	9.5%	0.0%
Sixth	R5	W8-L	LKD	7.6	5.3	2.4	31.0%													
		W8-U																		
		W9-L		0.7	0.7	0.0	4.2%													
		W9-U																		
		W10-L		30.8	28.2	2.6	8.5%													
		W10-U																		
		W11-L		36.6	34.6	2.0	5.5%													
		W11-U						31.3	30.7	98%	30.7	98%	0.0	0.0%	23	1	22	1	4.3%	0.0%
Sixth	R6	W12-L	Bedroom	36.8	35.0	1.9	5.1%													
		W12-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W13-L	Bedroom	37.0	35.3	1.7	4.6%													
		W13-U						11.8	11.4	97%	11.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R8	W14-L	Bedroom	35.4	35.3	0.0	0.1%													
		W14-U																		
		W15-L		30.4	30.4	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W16-L	LKD	25.6	25.6	0.0	0.1%													
		W16-U																		
		W17-L		28.7	28.7	0.0	0.0%													
		W17-U																		
		W18-L		27.2	27.2	0.0	0.0%													
		W18-U						36.0	29.0	80%	29.0	80%	0.0	0.0%	38	3	37	3	2.6%	0.0%
Seventh	R1	W1-L	Bedroom	14.8	14.8	0.1	0.5%													
		W1-U																		
		W2-L		19.0	18.2	0.8	4.1%													
		W2-U						11.7	9.0	77%	8.7	74%	0.3	3.0%	29	9	29	9	0.0%	0.0%
Seventh	R2	W3-L	Bedroom	21.3	19.4	1.9	9.0%													
		W3-U						12.1	6.2	51%	5.2	43%	1.1	17.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W4-L	Bedroom	3.6	1.6	2.0	55.6%													
		W4-U						12.4	10.3	83%	10.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		26.3	24.2	2.1	7.9%													
		W6-U																		
		W7-L		28.0	25.9	2.1	7.3%													
		W7-U						32.1	26.0	81%	26.0	81%	0.1	0.3%	21	3	19	3	9.5%	0.0%
Seventh	R5	W8-L	LKD	5.2	3.3	1.9	35.8%													
		W8-U																		
		W9-L		0.0	0.0	0.0	0.0%													
		W9-U																		
		W10-L		31.3	29.3	2.1	6.5%													
		W10-U																		
		W11-L		37.1	35.4	1.7	4.6%													
		W11-U						31.3	30.7	98%	30.6	98%	0.1	0.2%	27	3	26	3	3.7%	0.0%
Seventh	R6	W12-L	Bedroom	37.4	35.9	1.5	4.1%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W13-L	Bedroom	37.6	36.1	1.4	3.8%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W14-L	Bedroom	37.7	36.3	1.3	3.6%													
		W14-U																		
		W15-L		34.2	34.2	0.0	0.1%													
		W15-U						14.9	14.9	100%	14.8	99%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R9	W16-L	LKD	22.5	22.5	0.0	0.1%													
		W16-U																		
		W17-L		30.6	30.6	0.0	0.0%													
		W17-U																		
		W18-L		29.3	29.3	0.0	0.0%													
		W18-U						36.0	30.2	84%	30.2	84%	0.0	0.0%	43	5	42	5	2.3%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R1	W1-L	Bedroom	16.1	16.0	0.1	0.5%												
		W1-U																	
		W2-L		20.7	19.8	0.8	4.1%												
		W2-U						11.7	8.9	76%	8.2	70%	0.7	8.3%	31	10	31	10	0.0%	0.0%
Eighth	R2	W3-L	Bedroom	23.1	21.2	2.0	8.6%												
		W3-U						12.1	9.0	74%	8.7	72%	0.2	2.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W4-L	Bedroom	5.6	3.7	1.9	33.8%												
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W5-L	LKD	0.0	0.0	0.0	0.0%												
		W5-U																	
		W6-L		27.6	25.6	2.0	7.3%												
		W6-U																	
		W7-L		29.3	27.3	1.9	6.6%												
		W7-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	23	3	21	3	8.7%	0.0%
Eighth	R5	W8-L	LKD	7.8	6.0	1.8	23.5%												
		W8-U																	
		W9-L		0.9	0.9	0.0	0.0%												
		W9-U																	
		W10-L		32.6	30.7	1.9	5.9%												
		W10-U																	
		W11-L		37.7	36.2	1.6	4.1%												
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	29	3	28	3	3.4%	0.0%
Eighth	R6	W12-L	Bedroom	37.9	36.5	1.5	3.8%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W13-L	Bedroom	38.1	36.8	1.3	3.4%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W14-L	Bedroom	36.7	36.6	0.0	0.1%												
		W14-U																	
		W15-L		31.7	31.6	0.0	0.1%												
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W16-L	LKD	26.8	26.8	0.0	0.1%												
		W16-U																	
		W17-L		31.5	31.5	0.0	0.0%												
		W17-U																	
		W18-L		30.2	30.2	0.0	0.0%												
		W18-U						36.0	29.0	81%	29.0	81%	0.0	0.0%	44	4	43	4	2.3%	0.0%
Ninth	R1	W1-L	Bedroom	18.0	17.9	0.1	0.4%												
		W1-U																	
		W2-L		22.1	21.5	0.7	3.1%												
		W2-U						11.7	9.3	80%	9.3	80%	0.0	0.0%	33	9	33	9	0.0%	0.0%
Ninth	R2	W3-L	Bedroom	24.2	22.5	1.7	6.9%												
		W3-U						12.1	7.0	58%	6.3	52%	0.7	10.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W4-L	Bedroom	3.7	1.9	1.8	47.4%												
		W4-U						12.4	10.3	83%	10.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W5-L	LKD	0.1	0.1	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U																	
		W6-L		28.7	26.9	1.8	6.4%												
		W6-U																	
		W7-L		30.3	28.5	1.8	6.0%												
		W7-U						32.1	26.7	83%	26.6	83%	0.1	0.3%	26	3	24	3	7.7%	0.0%
Ninth	R5	W8-L	LKD	5.4	3.8	1.6	30.2%												
		W8-U																	
		W9-L		0.1	0.1	0.0	0.0%												
		W9-U																	
		W10-L		33.3	31.5	1.8	5.4%												
		W10-U																	
		W11-L		38.2	36.6	1.5	4.0%												
		W11-U						31.3	30.7	98%	30.7	98%	0.1	0.2%	30	3	29	3	3.3%	0.0%
Ninth	R6	W12-L	Bedroom	38.4	37.0	1.4	3.6%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W13-L	Bedroom	38.5	37.3	1.3	3.3%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	38.6	37.4	1.2	3.1%												
		W14-U																	
		W15-L		35.3	35.3	0.0	0.1%												
		W15-U						14.9	14.9	100%	14.8	99%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W16-L	LKD	23.6	23.6	0.0	0.1%												
		W16-U																	
		W17-L		33.6	33.6	0.0	0.0%												
		W17-U																	
		W18-L		32.5	32.5	0.0	0.0%												
		W18-U						36.0	30.2	84%	30.2	84%	0.0	0.0%	49	8	48	8	2.0%	0.0%
Tenth	R1	W1-L	Bedroom	19.7	19.7	0.1	0.3%												
		W1-U																	
		W2-L		24.5	23.8	0.7	3.0%												
		W2-U						11.7	9.0	77%	8.7	74%	0.3	3.3%	36	10	36	10	0.0%	0.0%
Tenth	R2	W3-L	Bedroom	26.6	24.9	1.7	6.4%												
		W3-U						12.1	9.6	79%	9.5	78%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W4-L	Bedroom	5.7	4.1	1.6	28.4%												
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W5-L	LKD	0.9	0.9	0.0	0.0%												
		W5-U																	
		W6-L		30.4	28.7	1.7	5.7%												
		W6-U																	
		W7-L		31.9	30.2	1.7	5.2%												
		W7-U						32.1	29.4	92%	29.4	92%	0.0	0.0%	29	3	27	3	6.9%	0.0%
Tenth	R5	W8-L	LKD	8.2	6.6	1.6	19.4%												
		W8-U																	
		W9-L		1.9	1.9	0.0	0.0%												
		W9-U																	
		W10-L		34.6	32.9	1.7	4.9%												
		W10-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W11-L		38.6	37.3	1.4	3.5%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	33	4	32	4	3.0%	0.0%
Tenth	R6	W12-L	Bedroom	38.8	37.5	1.3	3.3%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W13-L	Bedroom	38.9	37.8	1.2	3.0%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	37.6	37.6	0.0	0.1%													
		W14-U																		
		W15-L		32.6	32.5	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W16-L	LKD	27.7	27.7	0.0	0.1%													
		W16-U																		
		W17-L		34.7	34.7	0.0	0.0%													
		W17-U																		
		W18-L		33.7	33.7	0.0	0.0%													
		W18-U						36.0	29.3	81%	29.3	81%	0.0	0.0%	49	8	49	8	0.0%	0.0%
Eleventh	R1	W1-L	Bedroom	22.2	22.1	0.1	0.3%													
		W1-U																		
		W2-L		27.0	26.4	0.6	2.1%													
		W2-U						11.7	10.3	88%	10.3	88%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Eleventh	R2	W3-L	Bedroom	28.5	27.1	1.4	4.9%													
		W3-U						12.1	9.2	75%	8.9	74%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W4-L	Bedroom	4.4	2.9	1.5	34.2%													
		W4-U						12.4	10.8	87%	10.8	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W5-L	LKD	0.5	0.5	0.0	0.0%													
		W5-U																		
		W6-L		32.0	30.4	1.6	4.9%													
		W6-U																		
		W7-L		33.2	31.6	1.6	4.7%													
		W7-U						32.1	27.9	87%	27.9	87%	0.1	0.3%	31	4	29	4	6.5%	0.0%
Eleventh	R5	W8-L	LKD	6.2	4.8	1.4	22.7%													
		W8-U																		
		W9-L		0.8	0.8	0.0	0.0%													
		W9-U																		
		W10-L		35.4	33.8	1.6	4.4%													
		W10-U																		
		W11-L		38.9	37.6	1.3	3.4%													
		W11-U						31.3	30.7	98%	30.7	98%	0.1	0.2%	34	4	33	4	2.9%	0.0%
Eleventh	R6	W12-L	Bedroom	39.1	37.9	1.2	3.0%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W13-L	Bedroom	39.1	38.0	1.1	2.8%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	39.2	38.2	1.0	2.7%													
		W14-U																		
		W15-L		36.0	36.0	0.0	0.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W15-U						14.9	14.9	100%	14.8	99%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W16-L	LKD	24.3	24.3	0.0	0.1%													
		W16-U																		
		W17-L		36.5	36.5	0.0	0.0%													
		W17-U																		
		W18-L		35.9	35.9	0.0	0.0%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	56	14	56	14	0.0%	0.0%
Twelfth	R1	W1-L	Bedroom	24.6	24.6	0.1	0.2%													
		W1-U																		
		W2-L		30.2	29.6	0.6	2.0%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Twelfth	R2	W3-L	Bedroom	31.5	30.1	1.4	4.5%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W4-L	Bedroom	7.1	5.8	1.3	18.9%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W5-L	LKD	2.6	2.6	0.0	0.0%													
		W5-U																		
		W6-L		34.0	32.5	1.5	4.3%													
		W6-U																		
		W7-L		34.9	33.5	1.4	4.0%													
		W7-U						32.1	29.8	93%	29.8	93%	0.0	0.0%	33	4	31	4	6.1%	0.0%
Twelfth	R5	W8-L	LKD	9.0	7.7	1.4	15.0%													
		W8-U																		
		W9-L		3.4	3.4	0.0	0.0%													
		W9-U																		
		W10-L		36.6	35.2	1.4	3.9%													
		W10-U																		
		W11-L		39.2	38.0	1.2	3.0%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	35	5	34	5	2.9%	0.0%
Twelfth	R6	W12-L	Bedroom	39.2	38.1	1.1	2.8%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W13-L	Bedroom	39.3	38.3	1.0	2.5%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W14-L	Bedroom	38.0	38.0	0.0	0.1%													
		W14-U																		
		W15-L		33.0	32.9	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W16-L	LKD	28.1	28.0	0.0	0.1%													
		W16-U																		
		W17-L		37.8	37.8	0.0	0.0%													
		W17-U																		
		W18-L		37.4	37.4	0.0	0.0%													
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	56	14	56	14	0.0%	0.0%
Thirteenth	R1	W1-L	Bedroom	27.4	27.2	0.1	0.5%													
		W1-U																		
		W2-L		33.5	32.8	0.7	2.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	47	10	47	10	0.0%	0.0%
Thirteenth	R2	W3-L	Bedroom	34.2	33.0	1.2	3.4%													
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W4-L	Bedroom	7.6	6.4	1.2	15.9%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W5-L	LKD	1.1	1.1	0.0	0.0%													
		W5-U																		
		W6-L		35.9	34.6	1.3	3.6%													
		W6-U																		
		W7-L		36.5	35.2	1.3	3.5%													
		W7-U						32.1	30.8	96%	30.8	96%	0.0	0.0%	35	5	33	5	5.7%	0.0%
Thirteenth	R5	W8-L	LKD	7.9	6.7	1.2	14.8%													
		W8-U																		
		W9-L		1.6	1.6	0.0	0.0%													
		W9-U																		
		W10-L		37.5	36.2	1.3	3.5%													
		W10-U																		
		W11-L		39.3	38.2	1.1	2.8%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	36	6	35	6	2.8%	0.0%
Thirteenth	R6	W12-L	Bedroom	39.4	38.4	1.0	2.5%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W13-L	Bedroom	39.4	38.5	0.9	2.4%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R8	W14-L	Bedroom	39.5	38.6	0.9	2.2%													
		W14-U																		
		W15-L		36.3	36.3	0.0	0.1%													
		W15-U						14.9	14.9	100%	14.8	99%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R9	W16-L	LKD	24.4	24.4	0.0	0.1%													
		W16-U																		
		W17-L		39.1	39.1	0.0	0.0%													
		W17-U																		
		W18-L		39.0	39.0	0.0	0.0%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Fourteenth	R1	W1-L	Bedroom	29.9	29.6	0.3	1.0%													
		W1-U																		
		W2-L		36.6	35.6	1.0	2.7%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	52	13	51	13	1.9%	0.0%
Fourteenth	R2	W3-L	Bedroom	37.0	35.8	1.1	3.1%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W4-L	Bedroom	9.2	8.1	1.1	11.7%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W5-L	LKD	4.4	4.4	0.0	0.0%													
		W5-U																		
		W6-L		37.7	36.6	1.2	3.1%													
		W6-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W7-L		38.0	36.9	1.1	2.9%												
		W7-U						32.1	31.2	97%	31.2	97%	0.0	0.0%	37	7	35	7	5.4%	0.0%
Fourteenth	R5	W8-L	LKD	9.8	8.7	1.1	11.2%												
		W8-U																	
		W9-L		4.9	4.9	0.0	0.0%												
		W9-U																	
		W10-L		38.4	37.3	1.2	3.0%												
		W10-U																	
		W11-L		39.5	38.6	1.0	2.4%												
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Fourteenth	R6	W12-L	Bedroom	39.5	38.6	0.9	2.3%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W13-L	Bedroom	39.6	38.7	0.8	2.1%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R8	W14-L	Bedroom	38.2	38.2	0.0	0.1%												
		W14-U																	
		W15-L		33.1	33.1	0.0	0.1%												
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R9	W16-L	LKD	28.2	28.2	0.0	0.1%												
		W16-U																	
		W17-L		39.4	39.4	0.0	0.0%												
		W17-U																	
		W18-L		39.4	39.4	0.0	0.0%												
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Fifteenth	R1	W1-L	Bedroom	31.2	30.9	0.3	0.9%												
		W1-U																	
		W2-L		37.9	37.0	1.0	2.6%												
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	53	13	52	13	1.9%	0.0%
Fifteenth	R2	W3-L	Bedroom	38.1	37.1	1.0	2.6%												
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W4-L	Bedroom	9.7	8.7	0.9	9.7%												
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W5-L	LKD	1.8	1.8	0.0	0.0%												
		W5-U																	
		W6-L		38.5	37.5	1.0	2.6%												
		W6-U																	
		W7-L		38.6	37.6	1.0	2.6%												
		W7-U						32.1	30.9	96%	30.9	96%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Fifteenth	R5	W8-L	LKD	8.9	8.0	0.9	10.3%												
		W8-U																	
		W9-L		2.2	2.2	0.0	0.0%												
		W9-U																	
		W10-L		38.8	37.8	1.0	2.7%												
		W10-U																	
		W11-L		39.6	38.7	0.9	2.2%												
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	38	9	2.6%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifteenth	R6	W12-L	Bedroom	39.6	38.8	0.8	2.0%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W13-L	Bedroom	39.6	38.9	0.7	1.9%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R8	W14-L	Bedroom	39.6	38.9	0.7	1.8%													
		W14-U																		
		W15-L		36.4	36.3	0.0	0.1%													
		W15-U						14.9	14.9	100%	14.9	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R9	W16-L	LKD	24.5	24.5	0.0	0.0%													
		W16-U																		
		W17-L		39.4	39.4	0.0	0.0%													
		W17-U																		
		W18-L		39.4	39.4	0.0	0.0%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Sixteenth	R1	W1-L	Bedroom	31.8	31.6	0.3	0.8%													
		W1-U																		
		W2-L		38.3	37.4	0.9	2.2%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	55	14	54	14	1.8%	0.0%
Sixteenth	R2	W3-L	Bedroom	38.4	37.5	0.8	2.2%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W4-L	Bedroom	9.5	8.7	0.8	8.4%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R4	W5-L	LKD	5.0	5.0	0.0	0.0%													
		W5-U																		
		W6-L		38.7	37.8	0.9	2.2%													
		W6-U																		
		W7-L		38.8	37.9	0.9	2.2%													
		W7-U						32.1	31.2	97%	31.2	97%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Sixteenth	R5	W8-L	LKD	9.9	9.1	0.8	8.3%													
		W8-U																		
		W9-L		5.4	5.4	0.0	0.0%													
		W9-U																		
		W10-L		39.0	38.1	0.9	2.3%													
		W10-U																		
		W11-L		39.6	38.9	0.7	1.8%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Sixteenth	R6	W12-L	Bedroom	39.6	38.9	0.7	1.7%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W13-L	Bedroom	39.6	39.0	0.6	1.6%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R8	W14-L	Bedroom	38.4	38.4	0.0	0.1%													
		W14-U																		
		W15-L		33.2	33.2	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R9	W16-L	LKD	28.3	28.3	0.0	0.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W16-U																	
		W17-L		39.5	39.5	0.0	0.0%												
		W17-U																	
		W18-L		39.5	39.5	0.0	0.0%												
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Seventeenth	R1	W1-L	Bedroom	32.3	32.1	0.2	0.7%												
		W1-U																	
		W2-L		38.5	37.8	0.7	1.8%												
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	55	14	54	14	1.8%	0.0%
Seventeenth	R2	W3-L	Bedroom	38.6	37.9	0.7	1.8%												
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W4-L	Bedroom	9.7	9.0	0.7	6.9%												
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R4	W5-L	LKD	2.3	2.3	0.0	0.0%												
		W5-U																	
		W6-L		38.9	38.1	0.7	1.8%												
		W6-U																	
		W7-L		38.9	38.2	0.7	1.8%												
		W7-U						32.1	31.0	97%	31.0	97%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Seventeenth	R5	W8-L	LKD	8.9	8.3	0.7	7.3%												
		W8-U																	
		W9-L		2.6	2.6	0.0	0.0%												
		W9-U																	
		W10-L		39.1	38.4	0.7	1.8%												
		W10-U																	
		W11-L		39.6	39.0	0.6	1.6%												
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Seventeenth	R6	W12-L	Bedroom	39.6	39.0	0.6	1.4%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R7	W13-L	Bedroom	39.6	39.1	0.5	1.3%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R8	W14-L	Bedroom	39.6	39.1	0.5	1.3%												
		W14-U																	
		W15-L		37.2	37.2	0.0	0.0%												
		W15-U						14.9	14.9	100%	14.9	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R9	W16-L	LKD	24.5	24.5	0.0	0.1%												
		W16-U																	
		W17-L		39.5	39.5	0.0	0.0%												
		W17-U																	
		W18-L		39.5	39.5	0.0	0.0%												
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Eighteenth	R1	W1-L	Bedroom	33.0	32.9	0.2	0.5%												
		W1-U																	
		W2-L		38.8	38.3	0.6	1.4%												
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	56	15	56	15	0.0%	0.0%
Eighteenth	R2	W3-L	Bedroom	38.9	38.3	0.6	1.4%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R3	W4-L	Bedroom	13.0	12.4	0.5	4.2%													
		W4-U																		
		W5		2.0	1.6	0.5	23.2%	12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R4	W6-L	LKD	6.4	6.4	0.0	0.0%													
		W6-U																		
		W7-L		39.1	38.5	0.6	1.5%													
		W7-U																		
		W8-L		39.1	38.6	0.5	1.4%													
		W8-U						32.1	31.1	97%	31.1	97%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Eighteenth	R5	W9-L	LKD	13.5	13.0	0.5	4.0%													
		W9-U																		
		W10		2.1	1.6	0.5	22.6%													
		W11-L		6.7	6.7	0.0	0.0%													
		W11-U																		
		W12-L		39.2	38.7	0.6	1.5%													
		W12-U																		
		W13-L		39.6	39.1	0.5	1.2%													
		W13-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	40	10	40	10	0.0%	0.0%
Eighteenth	R6	W14-L	Bedroom	39.6	39.2	0.5	1.1%													
		W14-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W15-L	Bedroom	39.6	39.2	0.4	1.0%													
		W15-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R8	W16-L	Bedroom	39.6	39.6	0.0	0.0%													
		W16-U																		
		W17-L		39.6	39.6	0.0	0.0%													
		W17-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R9	W18-L	LKD	39.6	39.6	0.0	0.0%													
		W18-U																		
		W19-L		39.5	39.5	0.0	0.0%													
		W19-U																		
		W20-L		39.5	39.5	0.0	0.0%													
		W20-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	58	15	58	15	0.0%	0.0%
Mezzanine	R1	W1-L	Residential	4.5	4.4	0.1	2.9%													
		W1-U																		
		W2-L		9.3	5.2	4.1	44.5%													
		W2-U						37.9	37.2	98%	35.7	94%	1.5	4.0%	11	4	11	4	0.0%	0.0%
Millstream Tower																				
First	R1	W1-L	LKD	26.3	20.5	5.8	22.0%													
		W1-U																		
		W2-L		8.4	8.4	0.0	0.0%													
		W2-U						33.5	20.6	61%	19.3	57%	1.4	6.6%	7	0	7	0	0.0%	0.0%
First	R2	W3-L	Bedroom	20.9	15.7	5.2	24.9%													
		W3-U						14.8	11.0	74%	10.9	74%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W4-L	LKD	23.5	19.2	4.2	18.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W4-U																	
		W5-L		7.9	7.9	0.0	0.0%												
		W5-U						28.8	14.4	50%	13.1	45%	1.4	9.6%	7	0	7	0	0.0%	0.0%
First	R4	W6-L	Bedroom	18.2	14.5	3.7	20.3%												
		W6-U						14.5	9.7	67%	9.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7-L	LKD	21.1	18.1	2.9	13.9%												
		W7-U																	
		W8-L		7.9	7.9	0.0	0.0%												
		W8-U						28.8	13.1	46%	13.1	46%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R6	W9-L	Bedroom	16.5	13.9	2.6	15.5%												
		W9-U						14.5	9.3	64%	9.3	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10-L	LKD	19.4	17.2	2.2	11.3%												
		W10-U																	
		W11-L		8.5	8.5	0.0	0.0%												
		W11-U						28.8	13.3	46%	13.3	46%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R8	W12-L	Bedroom	14.8	13.2	1.5	10.4%												
		W12-U						14.5	9.0	62%	9.0	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W13-L	LKD	17.5	15.8	1.7	9.7%												
		W13-U																	
		W14-L		8.9	8.9	0.0	0.0%												
		W14-U						28.9	14.9	51%	14.9	51%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R10	W15-L	Bedroom	13.0	12.0	1.1	8.3%												
		W15-U						14.5	8.2	57%	8.2	57%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W16-L	LKD	16.2	14.9	1.3	8.2%												
		W16-U																	
		W17-L		9.3	9.3	0.0	0.0%												
		W17-U						28.9	18.2	63%	18.2	63%	0.0	0.0%	6	0	6	0	0.0%	0.0%
First	R12	W18-L	Bedroom	15.1	14.4	0.7	4.9%												
		W18-U						14.5	13.1	90%	13.1	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W19-L	Bedroom	18.2	17.0	1.2	6.5%												
		W19-U						12.9	11.4	88%	11.4	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W20-L	LKD	19.0	18.0	1.1	5.6%												
		W20-U																	
		W21-L		11.9	11.9	0.0	0.1%												
		W21-U																	
		W22-L		3.2	3.2	0.0	0.0%												
		W22-U																	
		W23-L		1.0	1.0	0.0	0.0%												
		W23-U						40.8	31.6	77%	31.0	76%	0.7	2.1%	19	7	19	7	0.0%	0.0%
Second	R1	W1-L	LKD	28.6	22.8	5.8	20.3%												
		W1-U																	
		W2-L		9.0	9.0	0.0	0.0%												
		W2-U						33.5	24.5	73%	24.5	73%	0.0	0.1%	7	0	7	0	0.0%	0.0%
Second	R2	W3-L	Bedroom	23.1	17.9	5.2	22.6%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						14.8	13.4	91%	13.4	90%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W4-L	LKD	26.0	21.7	4.3	16.7%													
		W4-U																		
		W5-L		8.4	8.4	0.0	0.0%													
		W5-U						28.8	20.2	70%	20.2	70%	0.0	0.2%	7	0	7	0	0.0%	0.0%
Second	R4	W6-L	Bedroom	20.5	16.7	3.8	18.7%													
		W6-U						14.5	12.3	85%	12.3	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7-L	LKD	23.5	20.3	3.2	13.4%													
		W7-U																		
		W8-L		8.2	8.2	0.0	0.0%													
		W8-U						28.8	19.5	68%	19.5	68%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Second	R6	W9-L	Bedroom	18.6	15.9	2.8	14.8%													
		W9-U						14.5	11.4	79%	11.4	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10-L	LKD	21.5	19.1	2.4	11.3%													
		W10-U																		
		W11-L		8.8	8.8	0.0	0.0%													
		W11-U						28.8	18.9	66%	18.9	66%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Second	R8	W12-L	Bedroom	16.6	14.9	1.8	10.5%													
		W12-U						14.5	10.6	73%	10.6	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W13-L	LKD	19.2	17.2	1.9	10.0%													
		W13-U																		
		W14-L		9.2	9.2	0.0	0.0%													
		W14-U						28.9	19.8	68%	19.8	68%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Second	R10	W15-L	Bedroom	14.4	13.1	1.3	8.7%													
		W15-U						14.5	8.7	60%	8.7	60%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W16-L	LKD	17.4	15.9	1.5	8.7%													
		W16-U																		
		W17-L		9.6	9.6	0.0	0.0%													
		W17-U						28.9	21.5	74%	21.5	74%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Second	R12	W18-L	Bedroom	16.2	15.3	0.9	5.3%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W19-L	Bedroom	19.3	18.0	1.4	7.0%													
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W20-L	LKD	20.0	18.8	1.2	6.1%													
		W20-U																		
		W21-L		12.4	12.4	0.0	0.0%													
		W21-U																		
		W22-L		3.3	3.3	0.0	0.0%													
		W22-U																		
		W23-L		1.0	1.0	0.0	0.0%													
		W23-U						40.8	31.7	78%	31.1	76%	0.7	2.1%	19	7	19	7	0.0%	0.0%
Third	R1	W1-L	LKD	30.5	25.0	5.5	18.1%													
		W1-U																		
		W2-L		9.7	9.7	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U						33.5	31.1	93%	30.9	92%	0.3	0.9%	7	0	7	0	0.0%	0.0%
Third	R2	W3-L	Bedroom	25.0	20.0	5.0	20.1%													
		W3-U						14.8	13.5	91%	13.5	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W4-L	LKD	28.3	24.0	4.3	15.1%													
		W4-U																		
		W5-L		8.9	8.9	0.0	0.1%													
		W5-U						28.8	27.3	95%	27.0	94%	0.3	1.1%	7	0	7	0	0.0%	0.0%
Third	R4	W6-L	Bedroom	22.7	18.8	3.9	17.2%													
		W6-U						14.5	12.4	85%	12.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7-L	LKD	25.8	22.5	3.3	12.8%													
		W7-U																		
		W8-L		8.6	8.6	0.0	0.0%													
		W8-U						28.8	25.0	87%	24.7	86%	0.3	1.2%	8	0	8	0	0.0%	0.0%
Third	R6	W9-L	Bedroom	20.7	17.8	2.9	14.2%													
		W9-U						14.5	11.5	79%	11.5	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10-L	LKD	23.6	21.0	2.7	11.3%													
		W10-U																		
		W11-L		9.1	9.1	0.0	0.0%													
		W11-U						28.8	22.8	79%	22.5	78%	0.3	1.5%	9	0	9	0	0.0%	0.0%
Third	R8	W12-L	Bedroom	18.4	16.5	2.0	10.7%													
		W12-U						14.5	10.6	73%	10.6	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W13-L	LKD	20.8	18.7	2.1	10.2%													
		W13-U																		
		W14-L		9.5	9.5	0.0	0.0%													
		W14-U						28.9	22.6	78%	22.5	78%	0.0	0.2%	8	0	8	0	0.0%	0.0%
Third	R10	W15-L	Bedroom	15.7	14.3	1.4	8.9%													
		W15-U						14.5	8.8	61%	8.8	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W16-L	LKD	18.7	17.0	1.7	9.1%													
		W16-U																		
		W17-L		10.0	10.0	0.0	0.0%													
		W17-U						28.9	24.2	84%	24.2	84%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Third	R12	W18-L	Bedroom	17.2	16.3	0.9	5.5%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W19-L	Bedroom	20.4	18.9	1.5	7.3%													
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W20-L	LKD	21.1	19.7	1.3	6.3%													
		W20-U																		
		W21-L		12.8	12.8	0.0	0.0%													
		W21-U																		
		W22-L		3.4	3.4	0.0	0.0%													
		W22-U																		
		W23-L		1.1	1.1	0.0	0.0%													
		W23-U						40.8	31.8	78%	31.2	76%	0.7	2.1%	19	7	19	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fourth	R1	W1-L	LKD	31.8	26.4	5.5	17.1%													
		W1-U																		
		W2-L		10.4	10.4	0.0	0.3%													
		W2-U						33.5	31.4	93%	31.4	93%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourth	R2	W3-L	Bedroom	26.3	21.3	5.0	19.0%													
		W3-U						14.8	13.6	92%	13.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W4-L	LKD	30.0	25.4	4.5	15.1%													
		W4-U																		
		W5-L		9.5	9.5	0.0	0.3%													
		W5-U						28.8	27.5	95%	27.5	95%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourth	R4	W6-L	Bedroom	24.3	20.1	4.2	17.2%													
		W6-U						14.5	12.4	86%	12.4	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7-L	LKD	27.6	23.9	3.7	13.5%													
		W7-U																		
		W8-L		9.1	9.1	0.0	0.0%													
		W8-U						28.8	25.5	88%	25.4	88%	0.0	0.1%	9	0	9	0	0.0%	0.0%
Fourth	R6	W9-L	Bedroom	22.3	19.0	3.3	14.7%													
		W9-U						14.5	11.6	80%	11.6	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10-L	LKD	25.3	22.2	3.1	12.1%													
		W10-U																		
		W11-L		9.4	9.4	0.0	0.0%													
		W11-U						28.8	23.2	81%	23.2	80%	0.1	0.2%	10	0	10	0	0.0%	0.0%
Fourth	R8	W12-L	Bedroom	19.8	17.5	2.3	11.6%													
		W12-U						14.5	10.6	73%	10.6	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W13-L	LKD	22.1	19.7	2.4	10.7%													
		W13-U																		
		W14-L		9.8	9.8	0.0	0.0%													
		W14-U						28.9	23.0	79%	22.9	79%	0.0	0.2%	8	0	8	0	0.0%	0.0%
Fourth	R10	W15-L	Bedroom	16.7	15.2	1.6	9.4%													
		W15-U						14.5	8.8	61%	8.8	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W16-L	LKD	19.8	17.9	1.9	9.5%													
		W16-U																		
		W17-L		10.3	10.3	0.0	0.0%													
		W17-U						28.9	25.0	87%	25.0	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Fourth	R12	W18-L	Bedroom	18.3	17.2	1.1	5.9%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R13	W19-L	Bedroom	21.4	19.8	1.6	7.4%													
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W20-L	LKD	22.1	20.7	1.4	6.5%													
		W20-U																		
		W21-L		13.3	13.3	0.0	0.0%													
		W21-U																		
		W22-L		3.5	3.5	0.0	0.0%													
		W22-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W23-L		1.1	1.1	0.0	0.0%												
		W23-U						40.8	31.9	78%	31.3	77%	0.6	1.9%	19	7	19	7	0.0%	0.0%
Fifth	R1	W1-L	LKD	32.7	27.5	5.2	15.9%												
		W1-U																	
		W2-L		11.2	11.1	0.0	0.4%												
		W2-U						33.5	31.4	94%	31.4	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fifth	R2	W3-L	Bedroom	27.4	22.6	4.7	17.3%												
		W3-U						14.8	13.8	93%	13.8	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W4-L	LKD	30.9	26.6	4.4	14.1%												
		W4-U																	
		W5-L		10.1	10.1	0.0	0.4%												
		W5-U						28.8	27.6	96%	27.6	96%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Fifth	R4	W6-L	Bedroom	25.4	21.4	4.0	15.7%												
		W6-U						14.5	12.5	86%	12.5	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7-L	LKD	28.6	25.0	3.6	12.6%												
		W7-U																	
		W8-L		9.5	9.5	0.0	0.0%												
		W8-U						28.8	25.8	90%	25.8	90%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifth	R6	W9-L	Bedroom	23.4	20.3	3.2	13.4%												
		W9-U						14.5	11.6	80%	11.6	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10-L	LKD	26.2	23.3	3.0	11.3%												
		W10-U																	
		W11-L		9.8	9.8	0.0	0.0%												
		W11-U						28.8	23.7	82%	23.7	82%	0.0	0.1%	10	0	10	0	0.0%	0.0%
Fifth	R8	W12-L	Bedroom	20.8	18.6	2.2	10.7%												
		W12-U						14.5	10.6	73%	10.6	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W13-L	LKD	23.0	20.6	2.4	10.3%												
		W13-U																	
		W14-L		10.2	10.2	0.0	0.0%												
		W14-U						28.9	23.0	80%	23.0	80%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifth	R10	W15-L	Bedroom	17.7	16.1	1.6	9.1%												
		W15-U						14.5	8.9	61%	8.9	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W16-L	LKD	20.8	18.9	1.9	9.3%												
		W16-U																	
		W17-L		10.6	10.6	0.0	0.0%												
		W17-U						28.9	25.2	87%	25.2	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Fifth	R12	W18-L	Bedroom	19.3	18.2	1.1	5.7%												
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W19-L	Bedroom	22.4	20.8	1.6	7.3%												
		W19-U						12.9	11.7	90%	11.7	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W20-L	LKD	23.1	21.7	1.4	6.2%												
		W20-U																	
		W21-L		13.8	13.8	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W21-U																		
		W22-L		3.6	3.6	0.0	0.0%													
		W22-U																		
		W23-L		1.1	1.1	0.0	0.0%													
		W23-U						40.8	32.0	78%	31.4	77%	0.6	1.8%	21	7	21	7	0.0%	0.0%
Sixth	R1	W1-L	LKD	33.4	28.5	4.9	14.6%													
		W1-U																		
		W2-L		12.0	12.0	0.0	0.2%													
		W2-U						33.5	31.5	94%	31.5	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Sixth	R2	W3-L	Bedroom	29.9	25.5	4.4	14.8%													
		W3-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W4-L	LKD	31.7	27.7	4.0	12.7%													
		W4-U																		
		W5-L		10.7	10.7	0.0	0.3%													
		W5-U						28.8	27.6	96%	27.6	96%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Sixth	R4	W6-L	Bedroom	28.0	24.3	3.7	13.2%													
		W6-U						14.5	12.9	89%	12.9	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7-L	LKD	29.4	26.1	3.3	11.3%													
		W7-U																		
		W8-L		10.0	10.0	0.0	0.0%													
		W8-U						28.8	26.1	91%	26.1	91%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Sixth	R6	W9-L	Bedroom	26.0	23.1	2.9	11.1%													
		W9-U						14.5	11.8	82%	11.8	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10-L	LKD	27.1	24.3	2.7	10.1%													
		W10-U																		
		W11-L		10.2	10.2	0.0	0.0%													
		W11-U						28.8	24.4	85%	24.4	85%	0.0	0.0%	11	0	11	0	0.0%	0.0%
Sixth	R8	W12-L	Bedroom	22.7	20.6	2.0	9.0%													
		W12-U						14.5	10.7	74%	10.7	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W13-L	LKD	23.8	21.6	2.2	9.3%													
		W13-U																		
		W14-L		10.5	10.5	0.0	0.0%													
		W14-U						28.9	23.0	80%	23.0	80%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Sixth	R10	W15-L	Bedroom	18.5	17.1	1.5	8.0%													
		W15-U						14.5	8.9	62%	8.9	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W16-L	LKD	21.8	20.0	1.8	8.2%													
		W16-U																		
		W17-L		10.9	10.9	0.0	0.0%													
		W17-U						28.9	25.2	87%	25.2	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Sixth	R12	W18-L	Bedroom	20.2	19.2	1.0	5.1%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W19-L	Bedroom	23.4	21.9	1.5	6.5%													
		W19-U						12.9	11.7	90%	11.7	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R14	W20-L	LKD	24.1	22.7	1.4	5.7%												
		W20-U																	
		W21-L		14.2	14.2	0.0	0.0%												
		W21-U																	
		W22-L		3.7	3.7	0.0	0.0%												
		W22-U																	
		W23-L		1.1	1.1	0.0	0.0%												
		W23-U						40.8	32.1	79%	31.5	77%	0.6	1.8%	21	7	21	7	0.0%	0.0%
Seventh	R1	W1-L	LKD	19.1	16.6	2.5	13.1%												
		W1-U																	
		W2-L		32.9	30.1	2.8	8.5%												
		W2-U																	
		W3-L		28.7	26.2	2.6	8.9%												
		W3-U						24.5	24.5	100%	24.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W4-L	Bedroom	25.8	23.5	2.3	8.9%												
		W4-U						14.6	10.8	74%	10.8	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W5-L	LKD	24.8	22.7	2.1	8.3%												
		W5-U																	
		W6-L		10.9	10.9	0.0	0.0%												
		W6-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Seventh	R4	W7-L	Bedroom	19.5	18.1	1.4	7.0%												
		W7-U						14.5	9.0	62%	9.0	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8-L	LKD	22.7	21.1	1.7	7.3%												
		W8-U																	
		W9-L		11.2	11.2	0.0	0.0%												
		W9-U						28.7	25.0	87%	25.0	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Seventh	R6	W10-L	Bedroom	21.1	20.2	0.9	4.4%												
		W10-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W11-L	Bedroom	24.3	22.9	1.4	5.8%												
		W11-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W12-L	LKD	25.0	23.8	1.3	5.1%												
		W12-U																	
		W13-L		14.6	14.6	0.0	0.0%												
		W13-U																	
		W14-L		4.1	4.1	0.0	0.0%												
		W14-U																	
		W15-L		1.1	1.1	0.0	0.0%												
		W15-U						40.8	32.3	79%	31.8	78%	0.5	1.7%	23	7	23	7	0.0%	0.0%
Eighth	R1	W1-L	LKD	34.2	31.7	2.5	7.2%												
		W1-U																	
		W2-L		22.3	19.8	2.5	11.3%												
		W2-U																	
		W3-L		33.2	30.5	2.6	8.0%												
		W3-U																	
		W4-L		29.7	27.3	2.4	8.0%												
		W4-U						27.6	27.2	99%	27.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W5-L	Bedroom	26.8	24.6	2.2	8.1%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U						14.3	10.6	74%	10.6	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W6-L	LKD	25.8	23.9	1.9	7.5%													
		W6-U																		
		W7-L		11.2	11.2	0.0	0.0%													
		W7-U						28.8	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighth	R4	W8-L	Bedroom	20.6	19.3	1.3	6.2%													
		W8-U						14.3	9.1	64%	9.1	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W9-L	LKD	23.9	22.3	1.6	6.5%													
		W9-U																		
		W10-L		11.5	11.5	0.0	0.0%													
		W10-U						31.0	26.7	86%	26.7	86%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Eighth	R6	W11-L	Bedroom	22.2	21.3	0.9	3.9%													
		W11-U						12.7	12.2	96%	12.2	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W12-L	Bedroom	25.3	23.9	1.3	5.3%													
		W12-U																		
		W13-L		14.6	14.6	0.0	0.0%													
		W13-U						17.4	16.1	92%	16.1	92%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Ninth	R1	W1-L	LKD	34.9	32.6	2.3	6.6%													
		W1-U																		
		W2-L		22.6	20.2	2.4	10.5%													
		W2-U																		
		W3-L		33.6	31.1	2.5	7.3%													
		W3-U																		
		W4-L		30.8	28.6	2.3	7.3%													
		W4-U						29.2	28.9	99%	28.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R2	W5-L	Bedroom	27.9	25.9	2.0	7.2%													
		W5-U						14.8	11.1	75%	11.1	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W6-L	LKD	27.1	25.3	1.8	6.7%													
		W6-U																		
		W7-L		11.6	11.6	0.0	0.0%													
		W7-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Ninth	R4	W8-L	Bedroom	21.9	20.7	1.2	5.5%													
		W8-U						14.5	9.2	64%	9.2	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W9-L	LKD	25.2	23.8	1.4	5.7%													
		W9-U																		
		W10-L		11.8	11.8	0.0	0.0%													
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.2%	6	0	6	0	0.0%	0.0%
Ninth	R6	W11-L	Bedroom	23.5	22.6	0.8	3.5%													
		W11-U						12.1	11.2	92%	11.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W12-L	Bedroom	26.5	25.2	1.2	4.7%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	10.6	74%	10.6	74%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Tenth	R1	W1-L	LKD	35.6	33.5	2.1	6.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W1-U																	
		W2-L		22.8	20.6	2.2	9.6%												
		W2-U																	
		W3-L		34.1	31.8	2.3	6.7%												
		W3-U																	
		W4-L		32.1	30.0	2.1	6.5%												
		W4-U						29.2	28.9	99%	28.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R2	W5-L	Bedroom	29.3	27.4	1.9	6.4%												
		W5-U						14.8	11.4	76%	11.4	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W6-L	LKD	28.6	26.9	1.7	5.8%												
		W6-U																	
		W7-L		12.0	12.0	0.0	0.0%												
		W7-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Tenth	R4	W8-L	Bedroom	23.4	22.3	1.1	4.8%												
		W8-U						14.5	9.5	65%	9.5	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W9-L	LKD	26.8	25.4	1.3	5.0%												
		W9-U																	
		W10-L		12.1	12.1	0.0	0.0%												
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.1%	6	0	6	0	0.0%	0.0%
Tenth	R6	W11-L	Bedroom	24.9	24.1	0.8	3.0%												
		W11-U						12.1	11.2	92%	11.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W12-L	Bedroom	27.8	26.7	1.2	4.2%												
		W12-U																	
		W13-L		0.0	0.0	0.0	0.0%												
		W13-U						14.2	10.6	75%	10.6	75%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Eleventh	R1	W1-L	LKD	36.4	34.4	2.0	5.4%												
		W1-U																	
		W2-L		23.0	21.0	2.0	8.8%												
		W2-U																	
		W3-L		34.5	32.4	2.1	6.1%												
		W3-U																	
		W4-L		33.4	31.5	1.9	5.8%												
		W4-U						29.2	29.1	100%	29.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R2	W5-L	Bedroom	30.8	29.0	1.7	5.6%												
		W5-U						14.8	11.9	80%	11.9	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W6-L	LKD	30.3	28.7	1.5	5.1%												
		W6-U																	
		W7-L		12.5	12.5	0.0	0.0%												
		W7-U						28.7	22.8	79%	22.8	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eleventh	R4	W8-L	Bedroom	25.1	24.0	1.0	4.1%												
		W8-U						14.5	10.0	69%	10.0	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W9-L	LKD	28.6	27.4	1.2	4.3%												
		W9-U																	
		W10-L		12.4	12.4	0.0	0.0%												
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.1%	7	0	7	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eleventh	R6	W11-L	Bedroom	26.5	25.8	0.7	2.6%													
		W11-U						12.1	11.4	94%	11.4	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W12-L	Bedroom	29.4	28.3	1.1	3.6%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	10.9	77%	10.9	77%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Twelfth	R1	W1-L	LKD	37.2	35.4	1.8	4.8%													
		W1-U																		
		W2-L		23.2	21.4	1.9	8.0%													
		W2-U																		
		W3-L		35.0	33.0	1.9	5.5%													
		W3-U																		
		W4-L		34.7	33.0	1.8	5.0%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R2	W5-L	Bedroom	32.3	30.7	1.6	4.9%													
		W5-U						14.8	13.2	89%	13.2	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W6-L	LKD	32.2	30.8	1.4	4.4%													
		W6-U																		
		W7-L		12.9	12.9	0.0	0.0%													
		W7-U						28.7	22.8	79%	22.8	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Twelfth	R4	W8-L	Bedroom	27.0	26.0	0.9	3.5%													
		W8-U						14.5	11.9	82%	11.9	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W9-L	LKD	30.6	29.5	1.1	3.7%													
		W9-U																		
		W10-L		12.6	12.6	0.0	0.0%													
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Twelfth	R6	W11-L	Bedroom	28.2	27.6	0.6	2.3%													
		W11-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W12-L	Bedroom	31.0	30.1	1.0	3.1%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	11.8	83%	11.8	83%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Thirteenth	R1	W1-L	LKD	38.0	36.4	1.6	4.3%													
		W1-U																		
		W2-L		23.4	21.7	1.7	7.2%													
		W2-U																		
		W3-L		35.4	33.7	1.8	4.9%													
		W3-U																		
		W4-L		35.9	34.3	1.6	4.4%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R2	W5-L	Bedroom	33.7	32.3	1.4	4.2%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W6-L	LKD	34.1	32.8	1.3	3.7%													
		W6-U																		
		W7-L		13.3	13.3	0.0	0.0%													
		W7-U						28.7	23.8	83%	23.8	83%	0.0	0.0%	9	0	9	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirteenth	R4	W8-L	Bedroom	28.9	28.1	0.8	2.9%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W9-L	LKD	32.8	31.8	1.0	3.1%													
		W9-U																		
		W10-L		12.9	12.9	0.0	0.0%													
		W10-U						32.3	29.0	90%	29.0	90%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Thirteenth	R6	W11-L	Bedroom	30.0	29.5	0.6	1.9%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W12-L	Bedroom	32.7	31.9	0.9	2.7%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	90%	12.8	90%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fourteenth	R1	W1-L	LKD	38.7	37.3	1.5	3.7%													
		W1-U																		
		W2-L		23.5	22.0	1.5	6.4%													
		W2-U																		
		W3-L		35.8	34.3	1.6	4.4%													
		W3-U																		
		W4-L		36.9	35.5	1.4	3.8%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R2	W5-L	Bedroom	35.0	33.7	1.3	3.6%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W6-L	LKD	35.8	34.7	1.1	3.2%													
		W6-U																		
		W7-L		13.7	13.7	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fourteenth	R4	W8-L	Bedroom	30.7	29.9	0.8	2.4%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W9-L	LKD	34.9	34.0	0.9	2.6%													
		W9-U																		
		W10-L		13.1	13.1	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.8	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourteenth	R6	W11-L	Bedroom	31.8	31.3	0.5	1.6%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W12-L	Bedroom	34.4	33.6	0.8	2.3%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	90%	12.8	90%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fifteenth	R1	W1-L	LKD	39.3	38.1	1.3	3.2%													
		W1-U																		
		W2-L		23.6	22.3	1.3	5.6%													
		W2-U																		
		W3-L		36.2	34.8	1.4	3.8%													
		W3-U																		
		W4-L		37.8	36.6	1.2	3.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R2	W5-L	Bedroom	36.1	35.0	1.1	3.1%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W6-L	LKD	37.3	36.3	1.0	2.7%													
		W6-U																		
		W7-L		14.0	14.0	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifteenth	R4	W8-L	Bedroom	32.3	31.6	0.7	2.0%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W9-L	LKD	36.9	36.1	0.8	2.2%													
		W9-U																		
		W10-L		13.3	13.3	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fifteenth	R6	W11-L	Bedroom	33.4	32.9	0.5	1.3%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W12-L	Bedroom	35.9	35.2	0.7	1.9%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Sixteenth	R1	W1-L	LKD	39.6	38.5	1.1	2.8%													
		W1-U																		
		W2-L		23.6	22.5	1.1	4.8%													
		W2-U																		
		W3-L		36.4	35.2	1.2	3.2%													
		W3-U																		
		W4-L		38.2	37.2	1.1	2.8%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R2	W5-L	Bedroom	36.5	35.5	1.0	2.6%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W6-L	LKD	37.9	37.1	0.9	2.3%													
		W6-U																		
		W7-L		14.2	14.2	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Sixteenth	R4	W8-L	Bedroom	32.9	32.3	0.6	1.7%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W9-L	LKD	37.6	36.9	0.7	1.8%													
		W9-U																		
		W10-L		13.4	13.4	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Sixteenth	R6	W11-L	Bedroom	34.0	33.6	0.4	1.1%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W12-L	Bedroom	36.4	35.8	0.6	1.6%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Seventeenth	R1	W1-L	LKD	39.6	38.7	0.9	2.3%													
		W1-U																		
		W2-L		23.7	22.7	1.0	4.1%													
		W2-U																		
		W3-L		36.4	35.4	1.0	2.7%													
		W3-U																		
		W4-L		38.5	37.6	0.9	2.3%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R2	W5-L	Bedroom	36.8	36.0	0.8	2.2%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W6-L	LKD	38.2	37.5	0.7	1.9%													
		W6-U																		
		W7-L		14.6	14.6	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Seventeenth	R4	W8-L	Bedroom	33.2	32.7	0.5	1.4%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W9-L	LKD	37.9	37.3	0.6	1.5%													
		W9-U																		
		W10-L		13.6	13.6	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Seventeenth	R6	W11-L	Bedroom	34.3	34.0	0.3	1.0%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R7	W12-L	Bedroom	36.8	36.3	0.5	1.3%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Eighteenth	R1	W1-L	LKD	39.6	38.9	0.8	1.9%													
		W1-U																		
		W2-L		23.7	22.9	0.8	3.3%													
		W2-U																		
		W3-L		36.5	35.7	0.8	2.2%													
		W3-U																		
		W4-L		38.7	38.0	0.7	1.9%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R2	W5-L	Bedroom	37.1	36.5	0.7	1.8%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R3	W6-L	LKD	38.5	37.9	0.6	1.5%													
		W6-U																		
		W7-L		14.9	14.9	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighteenth	R4	W8-L	Bedroom	33.7	33.3	0.4	1.2%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R5	W9-L	LKD	38.1	37.7	0.5	1.2%													
		W9-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-L		13.8	13.8	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Eighteenth	R6	W11-L	Bedroom	34.7	34.4	0.3	0.8%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W12-L	Bedroom	37.2	36.7	0.4	1.1%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Nineteenth	R1	W1-L	LKD	39.6	39.0	0.6	1.5%													
		W1-U																		
		W2-L		23.7	23.1	0.6	2.6%													
		W2-U																		
		W3-L		37.5	36.8	0.6	1.7%													
		W3-U																		
		W4-L		38.9	38.4	0.6	1.5%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R2	W5-L	Bedroom	38.0	37.5	0.5	1.4%													
		W5-U						14.8	14.5	98%	14.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R3	W6-L	LKD	38.8	38.3	0.5	1.2%													
		W6-U																		
		W7-L		15.2	15.2	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Nineteenth	R4	W8-L	Bedroom	35.5	35.2	0.3	0.9%													
		W8-U						14.5	14.2	98%	14.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R5	W9-L	LKD	38.4	38.1	0.4	1.0%													
		W9-U																		
		W10-L		14.0	14.0	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Nineteenth	R6	W11-L	Bedroom	35.9	35.7	0.2	0.6%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R7	W12-L	Bedroom	37.7	37.4	0.3	0.8%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Twentieth	R1	W1-L	LKD	20.2	19.9	0.3	1.3%													
		W1-U																		
		W2-L		9.7	9.7	0.0	0.0%													
		W2-U																		
		W3-L		39.6	39.2	0.5	1.2%													
		W3-U																		
		W4-L		39.1	38.7	0.4	1.1%													
		W4-U						34.9	34.9	100%	34.9	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%
Twentieth	R2	W5-L	Bedroom	39.0	38.6	0.4	1.0%													
		W5-U						12.9	12.6	98%	12.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R3	W6-L	Bedroom	38.9	38.5	0.3	0.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U						12.9	12.7	99%	12.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R4	W7-L	Bedroom	38.8	38.5	0.3	0.8%													
		W7-U						14.6	13.7	94%	13.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R5	W8-L	Bedroom	38.6	38.3	0.3	0.7%													
		W8-U						13.5	12.9	96%	12.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W9-L	Bedroom	38.5	38.2	0.3	0.7%													
		W9-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R7	W10-L	LKD	38.1	37.9	0.2	0.6%													
		W10-U																		
		W11-L		5.9	5.9	0.0	0.0%													
		W11-U						27.4	25.1	92%	25.1	92%	0.0	0.0%	10	4	10	4	0.0%	0.0%
Twenty-First	R1	W1-L	LKD	20.2	20.0	0.2	0.9%													
		W1-U																		
		W2-L		9.7	9.7	0.0	0.0%													
		W2-U																		
		W3-L		39.6	39.3	0.3	0.8%													
		W3-U																		
		W4-L		39.1	38.8	0.3	0.7%													
		W4-U						34.9	34.9	100%	34.9	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%
Twenty-First	R2	W5-L	Bedroom	39.0	38.7	0.3	0.7%													
		W5-U						12.9	12.6	98%	12.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R3	W6-L	Bedroom	38.9	38.7	0.2	0.6%													
		W6-U						12.9	12.7	99%	12.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R4	W7-L	Bedroom	38.8	38.6	0.2	0.5%													
		W7-U						14.6	13.7	94%	13.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R5	W8-L	Bedroom	38.6	38.4	0.2	0.5%													
		W8-U						13.5	12.9	96%	12.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W9-L	Bedroom	38.5	38.3	0.2	0.5%													
		W9-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R7	W10-L	LKD	38.2	38.0	0.1	0.4%													
		W10-U																		
		W11-L		6.1	6.1	0.0	0.0%													
		W11-U						27.4	25.1	92%	25.1	92%	0.0	0.0%	10	4	10	4	0.0%	0.0%
Sessile Apartments																				
Ground	R15	W28-L	Bedroom	13.7	12.2	1.5	10.7%													
		W28-U						9.8	5.2	53%	4.8	49%	0.4	7.7%	31	6	27	2	12.9%	66.7%
Ground	R16	W29-L	LKD	12.3	8.7	3.6	29.0%													
		W29-U																		
		W30-L		36.9	35.9	1.0	2.7%													
		W30-U						41.4	32.9	80%	31.3	76%	1.6	5.0%	43	9	37	4	14.0%	55.6%
First	R1	W1-L	Bedroom	35.7	35.7	0.0	0.0%													
		W1-U						11.3	10.4	92%	10.4	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
First	R2	W2-L	LKD	35.4	35.4	0.0	0.0%													
		W2-U																		
		W3-L		15.5	15.5	0.0	0.0%													
		W3-U																		
		W4		26.8	26.8	0.0	0.0%	27.5	27.5	100%	27.5	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%
First	R3	W5-L	Bedroom	32.5	32.5	0.0	0.0%													
		W5-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	43	8	43	8	0.0%	0.0%
First	R4	W6-L	Bedroom	32.1	32.1	0.0	0.0%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	40	6	40	6	0.0%	0.0%
First	R5	W7-L	Bedroom	27.8	27.8	0.0	0.0%													
		W7-U						11.3	10.5	94%	10.5	94%	0.0	0.0%	28	2	28	2	0.0%	0.0%
First	R6	W8-L	LKD	16.0	16.0	0.0	0.0%													
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	28	8	28	8	0.0%	0.0%
First	R7	W9-L	Bedroom	29.7	29.7	0.0	0.0%													
		W9-U						16.9	15.9	94%	15.9	94%	0.0	0.0%	40	5	40	5	0.0%	0.0%
First	R8	W10-L	LKD	15.2	15.2	0.0	0.0%													
		W10-U						23.1	20.3	88%	20.3	88%	0.0	0.0%	23	6	23	6	0.0%	0.0%
First	R9	W11-L	Bedroom	27.9	27.9	0.0	0.0%													
		W11-U						12.7	9.8	77%	9.8	77%	0.0	0.0%	40	6	40	6	0.0%	0.0%
First	R10	W12-L	Bedroom	24.3	24.3	0.0	0.0%													
		W12-U						7.8	6.2	80%	6.2	80%	0.0	0.0%	20	1	20	1	0.0%	0.0%
First	R11	W13-L	LKD	12.3	12.3	0.0	0.0%													
		W13-U																		
		W14-L		7.0	7.0	0.0	0.0%													
		W14-U																		
		W15-L		5.4	5.4	0.0	0.0%													
		W15-U																		
		W16-L		4.1	4.1	0.0	0.0%													
		W16-U						36.2	27.4	76%	27.4	76%	0.0	0.0%	36	7	36	7	0.0%	0.0%
First	R13	W23-L	Bedroom	1.8	1.8	0.0	0.0%													
		W23-U						19.1	4.1	22%	4.1	22%	0.0	0.0%	5	1	5	1	0.0%	0.0%
First	R14	W24-L	Bedroom	13.5	13.5	0.0	0.2%													
		W24-U						14.6	3.9	27%	3.5	24%	0.4	11.0%	28	2	28	2	0.0%	0.0%
First	R15	W25-L	LKD	13.8	13.7	0.1	0.7%													
		W25-U																		
		W26-L		3.0	2.9	0.1	2.7%													
		W26-U																		
		W27-L		5.0	5.0	0.0	0.4%													
		W27-U						48.9	34.0	70%	31.9	65%	2.1	6.3%	41	6	41	6	0.0%	0.0%
First	R16	W28-L	LKD	8.8	8.8	0.0	0.0%													
		W28-U																		
		W29-L		3.3	3.3	0.0	0.0%													
		W29-U						35.0	20.7	59%	20.7	59%	0.0	0.0%	30	3	30	3	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
First	R17	W30-L W30-U	Bedroom	9.5	9.5	0.0	0.0%	11.2	3.5	31%	3.5	31%	0.0	0.0%	23	2	23	2	0.0%	0.0%
First	R18	W31-L W31-U	LKD	2.9	2.9	0.0	0.0%	34.5	3.9	11%	3.9	11%	0.0	0.0%	11	1	11	1	0.0%	0.0%
First	R19	W32-L W32-U	Bedroom	10.0	9.9	0.1	1.1%	12.1	4.7	38%	4.6	38%	0.0	1.0%	25	2	25	2	0.0%	0.0%
First	R20	W33-L W33-U	LKD	4.5	4.1	0.4	9.1%	33.0	6.1	19%	5.9	18%	0.3	4.3%	18	3	17	2	5.6%	33.3%
First	R21	W34-L W34-U	Bedroom	15.4	14.3	1.2	7.7%	11.5	7.5	65%	7.1	62%	0.3	4.5%	36	7	33	4	8.3%	42.9%
First	R22	W35-L W35-U W36-L W36-U	LKD	19.1 38.1	15.8 37.3	3.3 0.9	17.3% 2.3%	36.4	28.2	78%	27.1	74%	1.1	3.9%	53	10	48	5	9.4%	50.0%
First	R23	W37-L W37-U	Bedroom	7.5	7.5	0.0	0.0%	73.9	14.0	19%	14.0	19%	0.0	0.0%	1	0	1	0	0.0%	0.0%
First	R24	W38-L W38-U	Bedroom	1.0	1.0	0.0	0.0%	17.0	11.7	69%	11.7	69%	0.0	0.0%	5	0	5	0	0.0%	0.0%
First	R25	W39-L W39-U	Bedroom	11.6	11.6	0.0	0.0%	12.9	12.6	97%	12.6	97%	0.0	0.0%	6	0	6	0	0.0%	0.0%
First	R26	W40-L W40-U	Bedroom	10.6	10.6	0.0	0.0%	12.0	6.6	55%	6.6	55%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R27	W41-L W41-U	LKD	0.5	0.5	0.0	0.0%	27.9	7.4	26%	7.4	26%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R28	W42-L W42-U	LKD	0.3	0.3	0.0	0.0%	27.9	5.8	21%	5.8	21%	0.0	0.0%	1	0	1	0	0.0%	0.0%
First	R29	W43-L W43-U	Bedroom	10.0	10.0	0.0	0.0%	11.9	5.3	45%	5.3	45%	0.0	0.0%	11	0	11	0	0.0%	0.0%
First	R30	W44-L W44-U	Bedroom	10.7	10.7	0.0	0.0%	12.9	6.7	52%	6.7	52%	0.0	0.0%	15	0	15	0	0.0%	0.0%
First	R31	W45-L W45-U	Bedroom	0.2	0.2	0.0	0.0%	17.0	1.7	10%	1.7	10%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R32	W46-L W46-U	Residential	6.5	6.5	0.0	0.0%	76.4	4.4	6%	4.4	6%	0.0	0.0%	13	0	13	0	0.0%	0.0%
Second	R1	W1-L W1-U	Bedroom	31.3	31.3	0.0	0.0%	11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R2	W2-L W2-U W3-L	LKD	19.8 31.9	19.8 31.9	0.0 0.0	0.0% 0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U																		
		W4		32.6	32.6	0.0	0.0%	34.2	30.4	89%	30.4	89%	0.0	0.0%	50	12	50	12	0.0%	0.0%
Second	R3	W5-L	Bedroom	33.5	33.5	0.0	0.0%													
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	46	11	46	11	0.0%	0.0%
Second	R4	W6-L	Bedroom	32.9	32.9	0.0	0.0%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	43	9	43	9	0.0%	0.0%
Second	R5	W7-L	Bedroom	28.6	28.6	0.0	0.0%													
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.0%	31	6	31	6	0.0%	0.0%
Second	R6	W8-L	LKD	16.5	16.5	0.0	0.0%													
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	30	11	0.0%	0.0%
Second	R7	W9-L	Bedroom	30.5	30.5	0.0	0.0%													
		W9-U						16.9	16.1	95%	16.1	95%	0.0	0.0%	42	7	42	7	0.0%	0.0%
Second	R8	W10-L	LKD	15.8	15.8	0.0	0.0%													
		W10-U						25.0	20.8	83%	20.8	83%	0.0	0.0%	24	8	24	8	0.0%	0.0%
Second	R9	W11-L	Bedroom	28.7	28.7	0.0	0.0%													
		W11-U						12.7	10.2	80%	10.2	80%	0.0	0.0%	42	8	42	8	0.0%	0.0%
Second	R10	W12-L	Bedroom	25.1	25.1	0.0	0.0%													
		W12-U						7.8	6.5	83%	6.5	83%	0.0	0.0%	24	4	24	4	0.0%	0.0%
Second	R11	W13-L	LKD	13.0	13.0	0.0	0.0%													
		W13-U																		
		W14-L		6.1	6.1	0.0	0.0%													
		W14-U																		
		W15-L		4.6	4.6	0.0	0.0%													
		W15-U						36.4	27.1	74%	27.1	74%	0.0	0.0%	33	5	33	5	0.0%	0.0%
Second	R12	W16	LKD	8.8	8.8	0.0	0.0%													
		W17-L		10.9	10.9	0.0	0.0%													
		W17-U						43.0	34.9	81%	34.9	81%	0.0	0.0%	17	4	17	4	0.0%	0.0%
Second	R13	W18-L	Bedroom	24.8	24.8	0.0	0.0%													
		W18-U						12.1	9.2	76%	9.2	76%	0.0	0.0%	29	3	29	3	0.0%	0.0%
Second	R14	W19-L	LKD	11.8	11.8	0.0	0.0%													
		W19-U						28.4	18.9	67%	18.9	67%	0.0	0.0%	22	8	22	8	0.0%	0.0%
Second	R15	W20-L	Bedroom	26.1	26.1	0.0	0.0%													
		W20-U						13.1	10.9	83%	10.9	83%	0.0	0.0%	38	10	38	10	0.0%	0.0%
Second	R16	W21-L	LKD	25.4	25.4	0.0	0.0%													
		W21-U																		
		W22-L		4.3	4.3	0.0	0.0%													
		W22-U						43.2	30.4	70%	30.4	70%	0.0	0.0%	51	12	51	12	0.0%	0.0%
Second	R17	W23-L	Bedroom	18.3	18.3	0.0	0.0%													
		W23-U						13.6	3.3	24%	3.3	24%	0.0	0.0%	52	7	52	7	0.0%	0.0%
Second	R18	W24-L	Bedroom	18.0	18.0	0.0	0.0%													
		W24-U						11.8	4.1	35%	4.1	34%	0.0	0.8%	48	7	48	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Second	R19	W25-L	Bedroom	17.5	17.5	0.0	0.0%													
		W25-U						7.7	2.4	32%	2.4	31%	0.0	1.5%	46	7	46	7	0.0%	0.0%
Second	R20	W26-L	LKD	2.0	1.9	0.0	1.5%													
		W26-U						30.6	6.7	22%	6.7	22%	0.0	0.0%	7	2	7	2	0.0%	0.0%
Second	R21	W27-L	Bedroom	15.6	15.5	0.1	0.5%													
		W27-U						8.0	3.4	43%	3.0	38%	0.4	11.7%	35	3	35	3	0.0%	0.0%
Second	R22	W28-L	Bedroom	15.9	15.8	0.1	0.6%													
		W28-U						11.7	5.5	47%	5.5	47%	0.0	0.4%	38	4	38	4	0.0%	0.0%
Second	R23	W29-L	LKD	3.3	3.3	0.0	0.3%													
		W29-U																		
		W30-L		6.0	6.0	0.0	0.2%													
		W30-U						39.0	24.6	63%	24.3	62%	0.3	1.2%	24	7	24	7	0.0%	0.0%
Second	R24	W31-L	LKD	10.0	10.0	0.0	0.0%													
		W31-U																		
		W32-L		3.7	3.7	0.0	0.0%													
		W32-U						35.2	21.3	61%	21.3	61%	0.0	0.0%	31	3	31	3	0.0%	0.0%
Second	R25	W33-L	Bedroom	11.1	11.1	0.0	0.0%													
		W33-U						11.2	4.2	37%	4.2	37%	0.0	0.0%	25	2	25	2	0.0%	0.0%
Second	R26	W34-L	LKD	3.3	3.3	0.0	0.0%													
		W34-U						34.5	4.7	14%	4.7	14%	0.0	0.0%	12	1	12	1	0.0%	0.0%
Second	R27	W35-L	Bedroom	11.7	11.6	0.1	0.7%													
		W35-U						12.1	5.3	44%	5.3	44%	0.0	0.3%	31	3	31	3	0.0%	0.0%
Second	R28	W36-L	LKD	4.8	4.5	0.3	6.6%													
		W36-U						33.1	6.6	20%	6.6	20%	0.1	1.2%	19	3	18	2	5.3%	33.3%
Second	R29	W37-L	Bedroom	16.3	15.3	1.0	6.0%													
		W37-U						11.5	7.7	66%	7.4	64%	0.2	3.1%	34	7	32	5	5.9%	28.6%
Second	R30	W38-L	LKD	8.4	5.4	3.0	35.3%													
		W38-U																		
		W39-L		38.5	37.7	0.8	2.1%													
		W39-U						37.4	29.2	78%	28.1	75%	1.1	3.8%	41	11	37	7	9.8%	36.4%
Second	R31	W40-L	Bedroom	8.5	8.5	0.0	0.0%													
		W40-U						14.8	8.4	57%	8.4	57%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Second	R32	W41-L	LKD	1.4	1.4	0.0	0.0%													
		W41-U						26.1	18.0	69%	18.0	69%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Second	R33	W42-L	Bedroom	13.3	13.3	0.0	0.0%													
		W42-U						12.5	11.8	95%	11.8	95%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Second	R34	W43-L	Bedroom	12.1	12.1	0.0	0.0%													
		W43-U						11.1	7.6	68%	7.6	68%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Second	R35	W44-L	LKD	0.7	0.7	0.0	0.0%													
		W44-U						34.5	8.8	25%	8.8	25%	0.0	0.0%	1	0	1	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Second	R36	W45-L W45-U	LKD	0.5	0.5	0.0	0.0%	34.4	6.4	19%	6.4	19%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Second	R37	W46-L W46-U	Bedroom	11.3	11.3	0.0	0.0%	11.1	7.7	69%	7.7	69%	0.0	0.0%	13	0	13	0	0.0%	0.0%
Second	R38	W47-L W47-U	Bedroom	12.3	12.3	0.0	0.0%	12.5	8.0	64%	8.0	64%	0.0	0.0%	18	0	18	0	0.0%	0.0%
Second	R39	W48-L W48-U	LKD	0.5	0.5	0.0	0.0%	26.1	2.9	11%	2.9	11%	0.0	0.0%	2	2	2	2	0.0%	0.0%
Second	R40	W49-L W49-U	Bedroom	7.3	7.3	0.0	0.0%	14.8	5.8	39%	5.8	39%	0.0	0.0%	13	0	13	0	0.0%	0.0%
Third	R1	W1-L W1-U	Bedroom	36.4	36.4	0.0	0.0%	11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R2	W2-L W2-U W3-L W3-U W4	LKD	36.1 16.7 28.2	36.1 16.7 28.2	0.0 0.0 0.0	0.0% 0.0% 0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	50	12	50	12	0.0%	0.0%
Third	R3	W5-L W5-U	Bedroom	34.0	34.0	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	46	11	46	11	0.0%	0.0%
Third	R4	W6-L W6-U	Bedroom	33.6	33.6	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	44	10	44	10	0.0%	0.0%
Third	R5	W7-L W7-U	Bedroom	29.3	29.3	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	32	7	32	7	0.0%	0.0%
Third	R6	W8-L W8-U	LKD	17.1	17.1	0.0	0.0%	31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	30	11	0.0%	0.0%
Third	R7	W9-L W9-U	Bedroom	31.3	31.3	0.0	0.0%	16.9	16.2	96%	16.2	96%	0.0	0.0%	43	8	43	8	0.0%	0.0%
Third	R8	W10-L W10-U	LKD	16.4	16.4	0.0	0.0%	25.0	21.2	85%	21.2	85%	0.0	0.0%	25	9	25	9	0.0%	0.0%
Third	R9	W11-L W11-U	Bedroom	29.5	29.5	0.0	0.0%	12.7	10.6	83%	10.6	83%	0.0	0.0%	43	9	43	9	0.0%	0.0%
Third	R10	W12-L W12-U	Bedroom	25.9	25.9	0.0	0.0%	7.8	6.9	88%	6.9	88%	0.0	0.0%	25	4	25	4	0.0%	0.0%
Third	R11	W13-L W13-U W14-L W14-U W15-L W15-U	LKD	13.7 7.0 5.4	13.7 7.0 5.4	0.0 0.0 0.0	0.0% 0.0% 0.0%	36.4	27.2	75%	27.2	75%	0.0	0.0%	36	8	36	8	0.0%	0.0%
Third	R12	W16	LKD	9.5	9.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W17-L		12.3	12.3	0.0	0.0%													
		W17-U						43.0	35.2	82%	35.2	82%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Third	R13	W18-L	Bedroom	26.6	26.6	0.0	0.0%													
		W18-U						12.1	9.9	82%	9.9	82%	0.0	0.0%	33	4	33	4	0.0%	0.0%
Third	R14	W19-L	LKD	13.6	13.6	0.0	0.0%													
		W19-U						28.4	19.8	70%	19.8	70%	0.0	0.0%	25	10	25	10	0.0%	0.0%
Third	R15	W20-L	Bedroom	28.1	28.1	0.0	0.0%													
		W20-U						13.1	11.3	86%	11.3	86%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Third	R16	W21-L	LKD	11.0	11.0	0.0	0.0%													
		W21-U																		
		W22-L		19.2	19.2	0.0	0.0%													
		W22-U						43.2	30.4	70%	30.4	70%	0.0	0.0%	68	12	68	12	0.0%	0.0%
Third	R17	W23-L	Bedroom	20.3	20.3	0.0	0.0%													
		W23-U						13.6	4.2	31%	4.2	31%	0.1	1.4%	49	7	49	7	0.0%	0.0%
Third	R18	W24-L	Bedroom	20.1	20.1	0.0	0.2%													
		W24-U						11.8	4.5	38%	4.4	38%	0.1	1.5%	51	7	51	7	0.0%	0.0%
Third	R19	W25-L	Bedroom	19.7	19.6	0.1	0.4%													
		W25-U						7.7	2.9	37%	2.7	36%	0.1	4.3%	55	7	55	7	0.0%	0.0%
Third	R20	W26-L	LKD	2.4	2.2	0.2	7.8%													
		W26-U						30.6	7.3	24%	7.3	24%	0.0	0.6%	8	2	8	2	0.0%	0.0%
Third	R21	W27-L	Bedroom	18.0	17.8	0.2	1.0%													
		W27-U						8.0	4.4	55%	3.9	49%	0.5	11.4%	41	4	41	4	0.0%	0.0%
Third	R22	W28-L	Bedroom	18.2	18.1	0.1	0.7%													
		W28-U						11.7	6.1	52%	6.1	52%	0.0	0.1%	45	6	45	6	0.0%	0.0%
Third	R23	W29-L	LKD	3.9	3.9	0.0	0.0%													
		W29-U																		
		W30-L		7.4	7.4	0.0	0.1%													
		W30-U						39.0	25.6	66%	25.6	65%	0.0	0.1%	27	7	27	7	0.0%	0.0%
Third	R24	W31-L	LKD	11.5	11.5	0.0	0.0%													
		W31-U																		
		W32-L		4.2	4.2	0.0	0.0%													
		W32-U						35.2	22.0	63%	22.0	63%	0.0	0.0%	34	5	34	5	0.0%	0.0%
Third	R25	W33-L	Bedroom	13.0	13.0	0.0	0.0%													
		W33-U						11.2	5.1	46%	5.1	46%	0.0	0.0%	30	2	30	2	0.0%	0.0%
Third	R26	W34-L	LKD	3.8	3.8	0.0	0.0%													
		W34-U						34.5	5.4	16%	5.4	16%	0.0	0.0%	14	3	14	3	0.0%	0.0%
Third	R27	W35-L	Bedroom	13.7	13.6	0.1	0.5%													
		W35-U						12.1	6.1	50%	6.1	50%	0.0	0.1%	34	3	34	3	0.0%	0.0%
Third	R28	W36-L	LKD	5.3	5.0	0.3	4.9%													
		W36-U						33.1	7.5	23%	7.4	22%	0.0	0.7%	20	4	19	3	5.0%	25.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R29	W37-L	Bedroom	18.3	17.5	0.8	4.3%												
		W37-U						11.5	7.9	69%	7.7	67%	0.2	2.9%	42	8	40	6	4.8%	25.0%
Third	R30	W38-L	LKD	21.8	19.0	2.8	12.8%												
		W38-U																	
		W39-L		38.7	38.0	0.7	1.8%												
		W39-U						37.4	29.2	78%	28.4	76%	0.8	2.8%	57	11	53	7	7.0%	36.4%
Third	R31	W40-L	Bedroom	9.5	9.5	0.0	0.0%												
		W40-U						14.8	9.5	64%	9.5	64%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Third	R32	W41-L	LKD	1.9	1.9	0.0	0.0%												
		W41-U						26.1	18.3	70%	18.3	70%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Third	R33	W42-L	Bedroom	15.2	15.2	0.0	0.0%												
		W42-U						12.5	12.1	97%	12.1	97%	0.0	0.0%	16	0	16	0	0.0%	0.0%
Third	R34	W43-L	Bedroom	13.6	13.6	0.0	0.0%												
		W43-U						11.1	8.3	75%	8.3	75%	0.0	0.0%	15	0	15	0	0.0%	0.0%
Third	R35	W44-L	LKD	1.1	1.1	0.0	0.0%												
		W44-U						34.5	10.1	29%	10.1	29%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Third	R36	W45-L	LKD	0.9	0.9	0.0	0.0%												
		W45-U						34.4	7.9	23%	7.9	23%	0.0	0.0%	2	0	2	0	0.0%	0.0%
Third	R37	W46-L	Bedroom	12.8	12.8	0.0	0.0%												
		W46-U						11.1	9.1	82%	9.1	82%	0.0	0.0%	17	0	17	0	0.0%	0.0%
Third	R38	W47-L	Bedroom	14.2	14.2	0.0	0.0%												
		W47-U						12.5	8.9	72%	8.9	72%	0.0	0.0%	22	2	22	2	0.0%	0.0%
Third	R39	W48-L	LKD	1.0	1.0	0.0	0.0%												
		W48-U						26.1	4.2	16%	4.2	16%	0.0	0.0%	3	3	3	3	0.0%	0.0%
Third	R40	W49-L	Bedroom	8.1	8.1	0.0	0.0%												
		W49-U						14.8	6.9	47%	6.9	47%	0.0	0.0%	15	1	15	1	0.0%	0.0%
Fourth	R1	W1-L	Bedroom	31.7	31.7	0.0	0.0%												
		W1-U						11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R2	W2-L	LKD	20.4	20.4	0.0	0.0%												
		W2-U																	
		W3-L		33.3	33.3	0.0	0.0%												
		W3-U																	
		W4		33.9	33.9	0.0	0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	52	13	52	13	0.0%	0.0%
Fourth	R3	W5-L	Bedroom	34.8	34.8	0.0	0.0%												
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	47	12	47	12	0.0%	0.0%
Fourth	R4	W6-L	Bedroom	34.3	34.3	0.0	0.0%												
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	44	10	44	10	0.0%	0.0%
Fourth	R5	W7-L	Bedroom	29.9	29.9	0.0	0.0%												
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.0%	32	7	32	7	0.0%	0.0%
Fourth	R6	W8-L	LKD	17.8	17.8	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	30	11	0.0%	0.0%
Fourth	R7	W9-L	Bedroom	32.0	32.0	0.0	0.0%													
		W9-U						16.9	16.3	97%	16.3	97%	0.0	0.0%	43	8	43	8	0.0%	0.0%
Fourth	R8	W10-L	LKD	17.2	17.2	0.0	0.0%													
		W10-U						25.0	21.5	86%	21.5	86%	0.0	0.0%	25	9	25	9	0.0%	0.0%
Fourth	R9	W11-L	Bedroom	30.3	30.3	0.0	0.0%													
		W11-U						12.7	11.0	87%	11.0	87%	0.0	0.0%	43	9	43	9	0.0%	0.0%
Fourth	R10	W12-L	Bedroom	26.7	26.7	0.0	0.0%													
		W12-U						7.8	7.4	94%	7.4	94%	0.0	0.0%	26	5	26	5	0.0%	0.0%
Fourth	R11	W13-L	LKD	14.6	14.6	0.0	0.0%													
		W13-U																		
		W14-L		8.2	8.2	0.0	0.0%													
		W14-U																		
		W15-L		6.6	6.6	0.0	0.0%													
		W15-U						36.4	27.5	76%	27.5	76%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Fourth	R12	W16	LKD	10.6	10.6	0.0	0.0%													
		W17-L		13.8	13.8	0.0	0.0%													
		W17-U						43.0	35.8	83%	35.8	83%	0.0	0.0%	22	8	22	8	0.0%	0.0%
Fourth	R13	W18-L	Bedroom	28.3	28.3	0.0	0.0%													
		W18-U						12.1	10.5	87%	10.5	87%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Fourth	R14	W19-L	LKD	15.4	15.4	0.0	0.0%													
		W19-U						28.4	20.9	74%	20.9	74%	0.0	0.0%	27	11	27	11	0.0%	0.0%
Fourth	R15	W20-L	Bedroom	29.7	29.7	0.0	0.0%													
		W20-U						13.1	11.8	90%	11.8	90%	0.0	0.0%	46	13	46	13	0.0%	0.0%
Fourth	R16	W21-L	LKD	28.7	28.7	0.0	0.0%													
		W21-U																		
		W22-L		5.6	5.6	0.0	0.0%													
		W22-U						43.2	30.5	71%	30.5	71%	0.0	0.0%	58	14	58	14	0.0%	0.0%
Fourth	R17	W23-L	Bedroom	22.8	22.8	0.0	0.2%													
		W23-U						13.6	5.7	42%	5.4	40%	0.3	5.9%	62	9	62	9	0.0%	0.0%
Fourth	R18	W24-L	Bedroom	22.7	22.6	0.1	0.4%													
		W24-U						11.8	5.2	44%	5.1	43%	0.1	2.4%	59	8	58	8	1.7%	0.0%
Fourth	R19	W25-L	Bedroom	22.2	22.0	0.2	0.9%													
		W25-U						7.7	3.4	44%	3.3	42%	0.1	4.0%	56	7	55	7	1.8%	0.0%
Fourth	R20	W26-L	LKD	3.7	3.3	0.4	11.5%													
		W26-U						30.6	9.8	32%	8.1	26%	1.7	17.1%	12	5	11	4	8.3%	20.0%
Fourth	R21	W27-L	Bedroom	20.8	20.4	0.3	1.7%													
		W27-U						8.0	5.7	72%	5.5	69%	0.2	3.0%	44	5	44	5	0.0%	0.0%
Fourth	R22	W28-L	Bedroom	20.9	20.7	0.3	1.2%													
		W28-U						11.7	7.1	61%	7.1	61%	0.0	0.0%	47	7	47	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R23	W29-L W29-U W30-L W30-U	LKD	4.8 9.3	4.8 9.3	0.0 0.0	0.6% 0.2%	39.0	26.3	67%	26.3	67%	0.0	0.0%	29	7	29	7	0.0%	0.0%
Fourth	R24	W31-L W31-U W32-L W32-U	LKD	13.4 5.3	13.4 5.3	0.0 0.0	0.0% 0.0%	35.2	23.1	66%	23.1	66%	0.0	0.0%	38	8	38	8	0.0%	0.0%
Fourth	R25	W33-L W33-U	Bedroom	15.4	15.4	0.0	0.0%	11.2	6.6	59%	6.6	59%	0.0	0.0%	37	4	37	4	0.0%	0.0%
Fourth	R26	W34-L W34-U	LKD	4.6	4.6	0.0	0.0%	34.5	6.6	19%	6.6	19%	0.0	0.0%	17	6	17	6	0.0%	0.0%
Fourth	R27	W35-L W35-U	Bedroom	16.0	16.0	0.1	0.3%	12.1	7.1	59%	7.1	59%	0.0	0.0%	41	6	41	6	0.0%	0.0%
Fourth	R28	W36-L W36-U	LKD	6.0	5.9	0.2	2.8%	33.1	8.8	27%	8.8	27%	0.0	0.2%	21	6	20	5	4.8%	16.7%
Fourth	R29	W37-L W37-U	Bedroom	19.6	18.9	0.7	3.7%	11.5	8.4	73%	8.0	70%	0.4	4.4%	40	9	38	7	5.0%	22.2%
Fourth	R30	W38-L W38-U W39-L W39-U	LKD	9.2 38.8	6.5 38.2	2.7 0.6	29.1% 1.6%	37.4	29.2	78%	28.5	76%	0.7	2.4%	42	12	39	9	7.1%	25.0%
Fourth	R31	W40-L W40-U	Bedroom	10.9	10.9	0.0	0.0%	14.8	10.7	73%	10.7	73%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fourth	R32	W41-L W41-U	LKD	2.8	2.8	0.0	0.0%	26.1	18.8	72%	18.8	72%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourth	R33	W42-L W42-U	Bedroom	17.3	17.3	0.0	0.0%	12.5	12.3	99%	12.3	99%	0.0	0.0%	20	0	20	0	0.0%	0.0%
Fourth	R34	W43-L W43-U	Bedroom	15.1	15.1	0.0	0.0%	11.1	9.1	82%	9.1	82%	0.0	0.0%	16	0	16	0	0.0%	0.0%
Fourth	R35	W44-L W44-U	LKD	2.0	2.0	0.0	0.0%	34.5	12.2	35%	12.2	35%	0.0	0.0%	4	2	4	2	0.0%	0.0%
Fourth	R36	W45-L W45-U	LKD	1.5	1.5	0.0	0.0%	34.4	10.1	29%	10.1	29%	0.0	0.0%	2	0	2	0	0.0%	0.0%
Fourth	R37	W46-L W46-U	Bedroom	14.3	14.3	0.0	0.0%	11.1	9.8	88%	9.8	88%	0.0	0.0%	18	1	18	1	0.0%	0.0%
Fourth	R38	W47-L W47-U	Bedroom	16.3	16.3	0.0	0.0%	12.5	10.0	80%	10.0	80%	0.0	0.0%	31	5	31	5	0.0%	0.0%
Fourth	R39	W48-L W48-U	LKD	2.2	2.2	0.0	0.0%	26.1	6.2	24%	6.2	24%	0.0	0.0%	7	4	7	4	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R40	W49-L	Bedroom	9.2	9.2	0.0	0.0%												
		W49-U						14.8	8.1	55%	8.1	55%	0.0	0.0%	18	2	18	2	0.0%	0.0%
Fifth	R1	W1-L	Bedroom	36.7	36.7	0.0	0.0%												
		W1-U						11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R2	W2-L	LKD	36.3	36.3	0.0	0.0%												
		W2-U																	
		W3-L		17.9	17.9	0.0	0.0%												
		W3-U																	
		W4		29.4	29.4	0.0	0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	55	15	55	15	0.0%	0.0%
Fifth	R3	W5-L	Bedroom	35.3	35.3	0.0	0.0%												
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	50	13	50	13	0.0%	0.0%
Fifth	R4	W6-L	Bedroom	34.9	34.9	0.0	0.0%												
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	45	11	45	11	0.0%	0.0%
Fifth	R5	W7-L	Bedroom	30.5	30.5	0.0	0.0%												
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.0%	32	7	32	7	0.0%	0.0%
Fifth	R6	W8-L	LKD	18.6	18.6	0.0	0.0%												
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	32	13	32	13	0.0%	0.0%
Fifth	R7	W9-L	Bedroom	32.6	32.6	0.0	0.0%												
		W9-U						16.9	16.4	97%	16.4	97%	0.0	0.0%	45	10	45	10	0.0%	0.0%
Fifth	R8	W10-L	LKD	18.0	18.0	0.0	0.0%												
		W10-U						25.0	21.7	87%	21.7	87%	0.0	0.0%	27	11	27	11	0.0%	0.0%
Fifth	R9	W11-L	Bedroom	31.2	31.2	0.0	0.0%												
		W11-U						12.7	11.5	91%	11.5	91%	0.0	0.0%	47	10	47	10	0.0%	0.0%
Fifth	R10	W12-L	Bedroom	27.5	27.5	0.0	0.0%												
		W12-U						7.8	7.5	96%	7.5	96%	0.0	0.0%	27	6	27	6	0.0%	0.0%
Fifth	R11	W13-L	LKD	15.4	15.4	0.0	0.0%												
		W13-U																	
		W14-L		10.3	10.3	0.0	0.0%												
		W14-U																	
		W15-L		8.6	8.6	0.0	0.0%												
		W15-U						36.4	27.9	77%	27.9	77%	0.0	0.0%	41	10	41	10	0.0%	0.0%
Fifth	R12	W16	LKD	12.3	12.3	0.0	0.0%												
		W17-L		14.7	14.7	0.0	0.0%												
		W17-U						43.0	36.1	84%	36.1	84%	0.0	0.0%	23	8	23	8	0.0%	0.0%
Fifth	R13	W18-L	Bedroom	29.6	29.6	0.0	0.0%												
		W18-U						12.1	11.2	92%	11.2	92%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Fifth	R14	W19-L	LKD	16.4	16.4	0.0	0.0%												
		W19-U						28.4	22.1	78%	22.1	78%	0.0	0.0%	27	11	27	11	0.0%	0.0%
Fifth	R15	W20-L	Bedroom	30.9	30.9	0.0	0.0%												
		W20-U						13.1	12.3	93%	12.3	93%	0.0	0.0%	50	12	50	12	0.0%	0.0%
Fifth	R16	W21-L	LKD	13.6	13.6	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W21-U																		
		W22-L		23.6	23.6	0.1	0.3%													
		W22-U						43.2	30.5	71%	30.5	71%	0.0	0.0%	79	16	79	16	0.0%	0.0%
Fifth	R17	W23-L	Bedroom	25.4	25.2	0.2	0.7%													
		W23-U						13.6	7.4	54%	6.8	50%	0.5	7.4%	60	12	60	12	0.0%	0.0%
Fifth	R18	W24-L	Bedroom	25.4	25.1	0.3	1.1%													
		W24-U						11.8	6.1	52%	6.0	51%	0.0	0.5%	62	12	62	12	0.0%	0.0%
Fifth	R19	W25-L	Bedroom	25.1	24.7	0.4	1.7%													
		W25-U						7.7	4.1	54%	4.1	53%	0.0	1.1%	65	11	64	10	1.5%	9.1%
Fifth	R20	W26-L	LKD	6.8	6.1	0.8	11.0%													
		W26-U						30.6	13.8	45%	10.2	33%	3.6	26.3%	18	10	15	7	16.7%	30.0%
Fifth	R21	W27-L	Bedroom	24.1	23.5	0.6	2.6%													
		W27-U						8.0	6.5	81%	6.3	79%	0.2	2.7%	48	8	48	8	0.0%	0.0%
Fifth	R22	W28-L	Bedroom	24.1	23.6	0.5	2.1%													
		W28-U						11.7	8.2	70%	8.2	70%	0.0	0.0%	52	10	52	10	0.0%	0.0%
Fifth	R23	W29-L	LKD	7.5	7.3	0.2	2.9%													
		W29-U																		
		W30-L		12.1	12.1	0.1	0.7%													
		W30-U						39.0	26.9	69%	26.9	69%	0.0	0.0%	35	10	35	10	0.0%	0.0%
Fifth	R24	W31-L	LKD	16.1	16.1	0.0	0.0%													
		W31-U																		
		W32-L		7.5	7.5	0.0	0.0%													
		W32-U						35.2	24.2	69%	24.2	69%	0.0	0.0%	44	10	44	10	0.0%	0.0%
Fifth	R25	W33-L	Bedroom	18.5	18.5	0.0	0.0%													
		W33-U						11.2	8.3	74%	8.3	74%	0.0	0.0%	42	8	42	8	0.0%	0.0%
Fifth	R26	W34-L	LKD	6.3	6.3	0.0	0.0%													
		W34-U						34.5	8.4	24%	8.4	24%	0.0	0.0%	21	9	21	9	0.0%	0.0%
Fifth	R27	W35-L	Bedroom	19.0	19.0	0.0	0.1%													
		W35-U						12.1	8.6	71%	8.6	71%	0.0	0.0%	47	8	47	8	0.0%	0.0%
Fifth	R28	W36-L	LKD	7.5	7.3	0.1	1.6%													
		W36-U						33.1	11.0	33%	11.0	33%	0.0	0.0%	25	8	25	8	0.0%	0.0%
Fifth	R29	W37-L	Bedroom	22.2	21.5	0.7	3.3%													
		W37-U						11.5	9.0	78%	8.3	72%	0.6	7.1%	50	10	48	8	4.0%	20.0%
Fifth	R30	W38-L	LKD	25.7	23.1	2.6	10.1%													
		W38-U																		
		W39-L		38.9	38.4	0.5	1.4%													
		W39-U						37.4	29.2	78%	28.6	76%	0.7	2.3%	67	15	63	11	6.0%	26.7%
Fifth	R31	W40-L	Bedroom	12.6	12.6	0.0	0.0%													
		W40-U						14.8	12.0	81%	12.0	81%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifth	R32	W41-L	LKD	4.2	4.2	0.0	0.0%													
		W41-U						26.1	19.6	75%	19.6	75%	0.0	0.0%	7	0	7	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R33	W42-L W42-U	Bedroom	19.9	19.9	0.0	0.0%	12.5	12.4	99%	12.4	99%	0.0	0.0%	22	0	22	0	0.0%	0.0%
Fifth	R34	W43-L W43-U	Bedroom	16.9	16.9	0.0	0.0%	11.1	9.8	89%	9.8	89%	0.0	0.0%	20	0	20	0	0.0%	0.0%
Fifth	R35	W44-L W44-U	LKD	3.9	3.9	0.0	0.0%	34.5	14.9	43%	14.9	43%	0.0	0.0%	11	3	11	3	0.0%	0.0%
Fifth	R36	W45-L W45-U	LKD	2.9	2.9	0.0	0.0%	34.4	12.6	36%	12.6	36%	0.0	0.0%	6	1	6	1	0.0%	0.0%
Fifth	R37	W46-L W46-U	Bedroom	16.1	16.1	0.0	0.0%	11.1	10.3	93%	10.3	93%	0.0	0.0%	21	1	21	1	0.0%	0.0%
Fifth	R38	W47-L W47-U	Bedroom	18.7	18.7	0.0	0.0%	12.5	10.7	86%	10.7	86%	0.0	0.0%	37	6	37	6	0.0%	0.0%
Fifth	R39	W48-L W48-U	LKD	3.6	3.6	0.0	0.0%	26.1	8.7	33%	8.7	33%	0.0	0.0%	11	5	11	5	0.0%	0.0%
Fifth	R40	W49-L W49-U	Bedroom	10.4	10.4	0.0	0.0%	14.8	9.1	62%	9.1	62%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Sixth	R1	W1-L W1-U	Bedroom	32.4	32.4	0.0	0.0%	11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R2	W2-L W2-U	LKD	20.7	20.7	0.0	0.0%													
		W3-L W3-U		34.6	34.6	0.0	0.0%													
		W4		35.2	35.2	0.0	0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	58	18	58	18	0.0%	0.0%
Sixth	R3	W5-L W5-U	Bedroom	36.1	36.1	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	54	14	54	14	0.0%	0.0%
Sixth	R4	W6-L W6-U	Bedroom	35.6	35.6	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	49	13	49	13	0.0%	0.0%
Sixth	R5	W7-L W7-U	Bedroom	31.2	31.2	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	34	9	34	9	0.0%	0.0%
Sixth	R6	W8-L W8-U	LKD	19.5	19.5	0.0	0.0%	31.4	24.7	79%	24.7	79%	0.0	0.0%	35	14	35	14	0.0%	0.0%
Sixth	R7	W9-L W9-U	Bedroom	33.5	33.5	0.0	0.0%	16.9	16.5	97%	16.5	97%	0.0	0.0%	46	11	46	11	0.0%	0.0%
Sixth	R8	W10-L W10-U	LKD	19.0	19.0	0.0	0.0%	25.0	22.0	88%	22.0	88%	0.0	0.0%	31	14	31	14	0.0%	0.0%
Sixth	R9	W11-L W11-U	Bedroom	32.5	32.5	0.0	0.0%	12.7	12.1	95%	12.1	95%	0.0	0.0%	53	13	53	13	0.0%	0.0%
Sixth	R10	W12-L W12-U	Bedroom	29.1	29.1	0.0	0.0%	7.8	7.5	96%	7.5	96%	0.0	0.0%	28	7	28	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R11	W13-L	LKD	16.5	16.5	0.0	0.0%												
		W13-U																	
		W14-L		13.5	13.5	0.0	0.0%												
		W14-U																	
		W15-L		11.9	11.9	0.0	0.0%												
		W15-U						36.4	27.9	77%	27.9	77%	0.0	0.0%	59	14	59	14	0.0%	0.0%
Sixth	R12	W16	LKD	15.3	15.3	0.0	0.0%												
		W17-L		15.7	15.7	0.0	0.0%												
		W17-U						43.0	36.4	85%	36.4	85%	0.0	0.0%	25	9	25	9	0.0%	0.0%
Sixth	R13	W18-L	Bedroom	31.8	31.8	0.0	0.0%												
		W18-U						12.1	11.5	94%	11.5	94%	0.0	0.0%	41	6	41	6	0.0%	0.0%
Sixth	R14	W19-L	LKD	17.5	17.5	0.0	0.0%												
		W19-U						28.4	22.7	80%	22.7	80%	0.0	0.0%	29	11	29	11	0.0%	0.0%
Sixth	R15	W20-L	Bedroom	32.5	32.5	0.0	0.0%												
		W20-U						13.1	12.5	95%	12.5	95%	0.0	0.0%	52	14	52	14	0.0%	0.0%
Sixth	R16	W21-L	LKD	33.7	33.7	0.0	0.0%												
		W21-U																	
		W22-L		10.2	9.8	0.4	3.4%												
		W22-U						43.2	30.8	71%	30.8	71%	0.0	0.0%	66	18	65	17	1.5%	5.6%
Sixth	R17	W23-L	Bedroom	28.1	27.6	0.5	1.6%												
		W23-U						13.6	9.9	72%	9.2	67%	0.7	6.7%	72	16	71	15	1.4%	6.3%
Sixth	R18	W24-L	Bedroom	28.3	27.7	0.6	2.0%												
		W24-U						11.8	8.1	69%	8.1	69%	0.0	0.1%	71	16	70	15	1.4%	6.3%
Sixth	R19	W25-L	Bedroom	28.1	27.4	0.7	2.6%												
		W25-U						7.7	5.7	74%	5.7	74%	0.0	0.0%	70	15	69	14	1.4%	6.7%
Sixth	R20	W26-L	LKD	9.4	8.4	1.0	11.0%												
		W26-U						30.6	16.5	54%	14.8	48%	1.7	10.3%	24	13	21	10	12.5%	23.1%
Sixth	R21	W27-L	Bedroom	27.9	27.0	0.9	3.2%												
		W27-U						8.0	7.3	92%	7.2	90%	0.1	2.0%	60	14	59	13	1.7%	7.1%
Sixth	R22	W28-L	Bedroom	27.9	27.1	0.8	2.8%												
		W28-U						11.7	9.4	80%	9.4	80%	0.0	0.0%	61	14	60	13	1.6%	7.1%
Sixth	R23	W29-L	LKD	10.2	9.6	0.5	5.2%												
		W29-U																	
		W30-L		16.0	15.8	0.2	1.4%												
		W30-U						39.0	27.9	71%	27.9	71%	0.0	0.0%	40	13	39	12	2.5%	7.7%
Sixth	R24	W31-L	LKD	19.7	19.7	0.0	0.0%												
		W31-U																	
		W32-L		10.4	10.4	0.0	0.0%												
		W32-U						35.2	24.6	70%	24.6	70%	0.0	0.0%	55	16	55	16	0.0%	0.0%
Sixth	R25	W33-L	Bedroom	23.1	23.1	0.0	0.0%												
		W33-U						11.2	9.5	85%	9.5	85%	0.0	0.1%	52	12	52	12	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R26	W34-L	LKD	8.6	8.6	0.0	0.0%													
		W34-U						34.5	12.5	36%	12.5	36%	0.0	0.0%	31	12	31	12	0.0%	0.0%
Sixth	R27	W35-L	Bedroom	23.3	23.3	0.0	0.2%													
		W35-U						12.1	9.8	81%	9.7	80%	0.1	0.8%	57	11	57	11	0.0%	0.0%
Sixth	R28	W36-L	LKD	9.4	9.3	0.1	1.2%													
		W36-U						33.1	13.6	41%	13.6	41%	0.0	0.0%	33	12	33	12	0.0%	0.0%
Sixth	R29	W37-L	Bedroom	24.3	23.4	0.9	3.7%													
		W37-U						11.5	9.7	84%	9.1	79%	0.5	5.5%	47	12	46	11	2.1%	8.3%
Sixth	R30	W38-L	LKD	12.3	9.7	2.6	21.0%													
		W38-U																		
		W39-L		39.0	38.6	0.5	1.2%													
		W39-U						37.4	29.2	78%	28.6	76%	0.6	2.2%	50	18	47	15	6.0%	16.7%
Sixth	R31	W40-L	Bedroom	14.5	14.5	0.0	0.0%													
		W40-U						14.8	13.2	89%	13.2	89%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Sixth	R32	W41-L	LKD	6.2	6.2	0.0	0.0%													
		W41-U						26.1	21.1	81%	21.1	81%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Sixth	R33	W42-L	Bedroom	22.7	22.7	0.0	0.0%													
		W42-U						12.5	12.4	99%	12.4	99%	0.0	0.0%	23	0	23	0	0.0%	0.0%
Sixth	R34	W43-L	Bedroom	19.7	19.7	0.0	0.0%													
		W43-U						11.1	10.5	95%	10.5	95%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Sixth	R35	W44-L	LKD	6.2	6.2	0.0	0.0%													
		W44-U						34.5	20.0	58%	20.0	58%	0.0	0.0%	13	4	13	4	0.0%	0.0%
Sixth	R36	W45-L	LKD	5.3	5.3	0.0	0.0%													
		W45-U						34.4	17.9	52%	17.9	52%	0.0	0.0%	9	3	9	3	0.0%	0.0%
Sixth	R37	W46-L	Bedroom	19.2	19.2	0.0	0.0%													
		W46-U						11.1	10.7	96%	10.7	96%	0.0	0.0%	30	2	30	2	0.0%	0.0%
Sixth	R38	W47-L	Bedroom	21.4	21.4	0.0	0.0%													
		W47-U						12.5	11.7	94%	11.7	94%	0.0	0.0%	41	8	41	8	0.0%	0.0%
Sixth	R39	W48-L	LKD	5.3	5.3	0.0	0.0%													
		W48-U						26.1	10.9	42%	10.9	42%	0.0	0.0%	15	7	15	7	0.0%	0.0%
Sixth	R40	W49-L	Bedroom	12.1	12.1	0.0	0.0%													
		W49-U						14.8	10.5	71%	10.5	71%	0.0	0.0%	23	4	23	4	0.0%	0.0%
Seventh	R1	W1-L	Bedroom	39.0	39.0	0.0	0.0%													
		W1-U						11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W2-L	LKD	39.5	39.5	0.0	0.0%													
		W2-U																		
		W3-L		22.3	22.3	0.0	0.0%													
		W3-U																		
		W4		31.2	31.2	0.0	0.0%	34.3	31.0	90%	31.0	90%	0.0	0.0%	59	18	59	18	0.0%	0.0%
Seventh	R3	W5-L	Bedroom	36.7	36.7	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Seventh	R4	W6-L	Bedroom	36.6	36.6	0.0	0.0%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	53	13	53	13	0.0%	0.0%
Seventh	R5	W7-L	Bedroom	32.8	32.8	0.0	0.0%													
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.0%	34	11	34	11	0.0%	0.0%
Seventh	R6	W8-L	LKD	23.2	23.2	0.0	0.0%													
		W8-U						31.4	24.8	79%	24.8	79%	0.0	0.0%	43	16	43	16	0.0%	0.0%
Seventh	R7	W9-L	Bedroom	34.9	34.9	0.0	0.0%													
		W9-U						16.9	16.5	97%	16.5	97%	0.0	0.0%	53	13	53	13	0.0%	0.0%
Seventh	R8	W10-L	LKD	22.7	22.7	0.0	0.0%													
		W10-U						25.0	22.8	92%	22.8	92%	0.0	0.0%	38	15	38	15	0.0%	0.0%
Seventh	R9	W11-L	Bedroom	34.3	34.3	0.0	0.0%													
		W11-U						12.7	12.3	97%	12.3	97%	0.0	0.0%	55	15	55	15	0.0%	0.0%
Seventh	R10	W12-L	Bedroom	36.0	36.0	0.0	0.0%													
		W12-U						7.8	7.5	96%	7.5	96%	0.0	0.0%	55	15	55	15	0.0%	0.0%
Seventh	R11	W13-L	LKD	36.0	36.0	0.0	0.0%													
		W13-U																		
		W14-L		18.3	18.3	0.0	0.0%													
		W14-U																		
		W15-L		16.9	16.9	0.0	0.0%													
		W15-U						36.4	28.0	77%	28.0	77%	0.0	0.0%	74	16	74	16	0.0%	0.0%
Seventh	R12	W16	LKD	20.8	20.8	0.0	0.0%													
		W17-L		35.4	35.4	0.0	0.0%													
		W17-U						43.0	36.8	86%	36.8	86%	0.0	0.0%	56	14	56	14	0.0%	0.0%
Seventh	R13	W18-L	Bedroom	35.1	35.1	0.0	0.0%													
		W18-U						12.1	11.5	95%	11.5	95%	0.0	0.0%	52	12	52	12	0.0%	0.0%
Seventh	R14	W19-L	LKD	34.3	34.3	0.0	0.0%													
		W19-U						28.4	24.0	85%	24.0	85%	0.0	0.0%	45	11	45	11	0.0%	0.0%
Seventh	R15	W20-L	Bedroom	34.8	34.8	0.0	0.0%													
		W20-U						13.1	12.5	95%	12.5	95%	0.0	0.0%	53	14	53	14	0.0%	0.0%
Seventh	R16	W21-L	LKD	34.6	34.6	0.0	0.0%													
		W21-U																		
		W22-L		31.5	30.8	0.7	2.2%													
		W22-U						43.2	31.6	73%	31.6	73%	0.0	0.0%	88	22	88	22	0.0%	0.0%
Seventh	R17	W23-L	Bedroom	30.9	30.1	0.8	2.6%													
		W23-U						13.6	11.1	81%	10.2	75%	0.9	7.8%	75	18	73	16	2.7%	11.1%
Seventh	R18	W24-L	Bedroom	30.8	29.9	0.9	3.0%													
		W24-U						11.8	10.8	91%	10.8	91%	0.0	0.0%	75	18	73	16	2.7%	11.1%
Seventh	R19	W25-L	Bedroom	30.8	29.8	1.1	3.4%													
		W25-U						7.7	7.1	92%	7.1	92%	0.0	0.0%	76	19	73	16	3.9%	15.8%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R20	W26-L	LKD	27.6	26.3	1.3	4.7%													
		W26-U						30.6	21.3	70%	21.3	70%	0.0	0.0%	58	16	55	13	5.2%	18.8%
Seventh	R21	W27-L	Bedroom	31.5	30.4	1.2	3.7%													
		W27-U						8.0	7.7	97%	7.6	95%	0.1	1.6%	77	21	74	18	3.9%	14.3%
Seventh	R22	W28-L	Bedroom	31.6	30.6	1.0	3.3%													
		W28-U						11.7	11.0	94%	11.0	94%	0.0	0.0%	76	20	73	17	3.9%	15.0%
Seventh	R23	W29-L	LKD	31.4	30.6	0.8	2.7%													
		W29-U																		
		W30-L		21.4	21.0	0.4	1.9%													
		W30-U						39.2	29.0	74%	29.0	74%	0.0	0.0%	73	18	71	16	2.7%	11.1%
Seventh	R24	W31-L	LKD	23.4	23.4	0.0	0.0%													
		W31-U																		
		W32-L		29.7	29.3	0.4	1.4%													
		W32-U						35.2	24.9	71%	24.9	71%	0.0	0.0%	78	21	78	21	0.0%	0.0%
Seventh	R25	W33-L	Bedroom	29.1	28.7	0.4	1.3%													
		W33-U						11.2	10.5	94%	10.5	94%	0.1	0.5%	75	18	75	18	0.0%	0.0%
Seventh	R26	W34-L	LKD	28.8	28.4	0.4	1.4%													
		W34-U						34.5	19.1	55%	19.1	55%	0.0	0.0%	75	18	74	17	1.3%	5.6%
Seventh	R27	W35-L	Bedroom	28.9	28.4	0.5	1.7%													
		W35-U						12.1	11.3	93%	11.1	92%	0.2	1.5%	74	17	73	16	1.4%	5.9%
Seventh	R28	W36-L	LKD	29.4	28.9	0.6	2.0%													
		W36-U						33.0	17.6	53%	17.2	52%	0.4	2.4%	76	19	75	18	1.3%	5.3%
Seventh	R29	W37-L	Bedroom	27.9	26.6	1.3	4.7%													
		W37-U						11.5	11.0	95%	10.9	95%	0.1	0.7%	57	15	55	13	3.5%	13.3%
Seventh	R30	W38-L	LKD	32.8	30.2	2.6	8.0%													
		W38-U																		
		W39-L		39.1	38.7	0.4	1.0%													
		W39-U						37.5	29.6	79%	28.7	77%	0.9	3.0%	78	20	76	18	2.6%	10.0%
Seventh	R31	W40-L	Bedroom	16.5	16.5	0.0	0.0%													
		W40-U						14.8	13.6	92%	13.6	92%	0.0	0.0%	14	0	14	0	0.0%	0.0%
Seventh	R32	W41-L	LKD	11.5	11.5	0.0	0.0%													
		W41-U						26.1	23.8	91%	23.8	91%	0.0	0.0%	16	1	16	1	0.0%	0.0%
Seventh	R33	W42-L	Bedroom	25.5	25.5	0.0	0.0%													
		W42-U						12.5	12.4	100%	12.4	100%	0.0	0.0%	28	3	28	3	0.0%	0.0%
Seventh	R34	W43-L	Bedroom	23.8	23.8	0.0	0.0%													
		W43-U						11.1	10.7	96%	10.7	96%	0.0	0.0%	25	3	25	3	0.0%	0.0%
Seventh	R35	W44-L	LKD	27.5	27.5	0.0	0.0%													
		W44-U						34.6	23.1	67%	23.1	67%	0.0	0.0%	37	6	37	6	0.0%	0.0%
Seventh	R36	W45-L	LKD	27.2	27.2	0.0	0.0%													
		W45-U						34.5	24.4	71%	24.4	71%	0.0	0.0%	41	9	41	9	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R37	W46-L W46-U	Bedroom	23.7	23.7	0.0	0.0%	11.1	10.7	96%	10.7	96%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Seventh	R38	W47-L W47-U	Bedroom	24.2	24.2	0.0	0.0%	12.5	12.4	100%	12.4	100%	0.0	0.0%	46	13	46	13	0.0%	0.0%
Seventh	R39	W48-L W48-U	LKD	9.9	9.9	0.0	0.0%	26.1	17.2	66%	17.2	66%	0.0	0.0%	28	14	28	14	0.0%	0.0%
Seventh	R40	W49-L W49-U	Bedroom	14.6	14.6	0.0	0.0%	14.8	11.8	80%	11.8	80%	0.0	0.0%	25	6	25	6	0.0%	0.0%
Eighth	R1	W1-L W1-U	Bedroom	39.6	39.6	0.0	0.0%	11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W2-L W2-U	LKD	39.6	39.6	0.0	0.0%													
		W3-L W3-U		37.9	37.9	0.0	0.0%													
		W4		37.9	37.9	0.0	0.0%	34.1	30.4	89%	30.4	89%	0.0	0.0%	60	18	60	18	0.0%	0.0%
Eighth	R3	W5-L W5-U	Bedroom	37.7	37.7	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R4	W6-L W6-U	Bedroom	37.6	37.6	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R5	W7-L W7-U	Bedroom	37.6	37.6	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R6	W8-L W8-U	LKD	37.4	37.4	0.0	0.0%	31.4	24.9	79%	24.9	79%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R7	W9-L W9-U	Bedroom	37.3	37.3	0.0	0.0%	16.9	16.5	97%	16.5	97%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R8	W10-L W10-U	LKD	36.0	36.0	0.0	0.0%	25.0	23.4	94%	23.4	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R9	W11-L W11-U	Bedroom	36.9	36.9	0.0	0.0%	14.5	13.3	92%	13.3	92%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R10	W12-L W12-U	Bedroom	34.3	34.3	0.0	0.0%													
		W13-L W13-U		27.9	27.9	0.0	0.0%	13.7	12.0	88%	12.0	88%	0.0	0.0%	82	15	82	15	0.0%	0.0%
Eighth	R11	W14-L W14-U	LKD	29.1	29.1	0.0	0.0%													
		W15-L W15-U		31.0	31.0	0.0	0.0%													
		W16-L W16-U		36.2	36.2	0.0	0.0%	33.3	29.1	87%	29.1	87%	0.0	0.0%	58	16	58	16	0.0%	0.0%
Eighth	R12	W17-L W17-U	Bedroom	36.0	36.0	0.0	0.0%	11.4	10.7	94%	10.7	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R13	W18-L	Bedroom	35.9	35.9	0.0	0.0%													
		W18-U						13.1	12.6	97%	12.6	97%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R14	W19-L	Bedroom	35.8	35.8	0.0	0.0%													
		W19-U						15.7	14.9	95%	14.9	95%	0.0	0.0%	54	14	54	14	0.0%	0.0%
Eighth	R15	W20-L	LKD	35.7	35.7	0.0	0.0%													
		W20-U																		
		W21-L		33.8	32.7	1.1	3.2%													
		W21-U																		
		W22-L		33.6	32.5	1.1	3.4%													
		W22-U						34.1	31.5	92%	31.5	92%	0.0	0.0%	93	25	92	24	1.1%	4.0%
Eighth	R16	W23-L	Bedroom	33.8	32.4	1.3	4.0%													
		W23-U																		
		W24-L		33.8	32.4	1.4	4.2%													
		W24-U						15.8	15.2	96%	15.2	96%	0.0	0.0%	81	24	79	22	2.5%	8.3%
Eighth	R17	W25-L	Bedroom	33.9	32.5	1.4	4.2%													
		W25-U						11.4	11.1	97%	11.1	97%	0.0	0.0%	81	24	79	22	2.5%	8.3%
Eighth	R18	W26-L	Bedroom	33.8	32.5	1.3	3.9%													
		W26-U						8.5	8.3	98%	8.3	98%	0.0	0.0%	81	24	79	22	2.5%	8.3%
Eighth	R19	W27-L	LKD	33.7	32.5	1.2	3.5%													
		W27-U																		
		W28-L		29.6	29.0	0.6	2.0%													
		W28-U						39.1	30.9	79%	30.7	79%	0.2	0.7%	79	22	77	20	2.5%	9.1%
Eighth	R20	W29-L	LKD	28.3	28.3	0.0	0.0%													
		W29-U																		
		W30-L		29.1	29.1	0.0	0.0%													
		W30-U																		
		W31-L		32.5	31.4	1.1	3.3%													
		W31-U																		
		W32-L		32.5	31.4	1.1	3.4%													
		W32-U						42.1	34.8	83%	34.8	83%	0.0	0.0%	86	25	85	24	1.2%	4.0%
Eighth	R21	W33-L	Bedroom	32.6	31.4	1.2	3.6%													
		W33-U						9.7	8.7	90%	8.6	89%	0.1	0.8%	79	22	78	21	1.3%	4.5%
Eighth	R22	W34-L	Bedroom	32.7	31.5	1.2	3.8%													
		W34-U						10.7	10.3	96%	10.3	96%	0.0	0.0%	76	22	74	20	2.6%	9.1%
Eighth	R23	W35-L	Bedroom	32.2	30.9	1.3	4.1%													
		W35-U						15.2	14.8	97%	14.8	97%	0.0	0.0%	75	24	72	21	4.0%	12.5%
Eighth	R24	W36-L	Bedroom	33.7	31.9	1.8	5.4%													
		W36-U						11.7	11.4	98%	11.3	97%	0.1	0.9%	83	26	80	23	3.6%	11.5%
Eighth	R25	W37-L	LKD	34.7	32.1	2.6	7.6%													
		W37-U																		
		W38-L		39.3	38.9	0.4	1.0%													
		W38-U						43.6	33.4	77%	32.7	75%	0.7	2.1%	85	26	84	25	1.2%	3.8%
Eighth	R26	W39-L	Bedroom	19.3	19.3	0.0	0.0%													
		W39-U						14.8	14.0	95%	14.0	95%	0.0	0.0%	17	1	17	1	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighth	R27	W40-L W40-U	LKD	14.0	14.0	0.0	0.0%	26.1	24.5	94%	24.5	94%	0.0	0.0%	19	2	19	2	0.0%	0.0%
Eighth	R28	W41-L W41-U	Bedroom	29.3	29.3	0.0	0.0%	12.8	12.4	97%	12.4	97%	0.0	0.0%	37	4	37	4	0.0%	0.0%
Eighth	R29	W42-L W42-U	Bedroom	19.8	19.8	0.0	0.0%	6.7	6.4	96%	6.4	96%	0.0	0.0%	16	2	16	2	0.0%	0.0%
Eighth	R30	W43-L W43-U	LKD	29.0	29.0	0.0	0.0%	28.9	21.6	75%	21.6	75%	0.0	0.0%	39	8	39	8	0.0%	0.0%
Eighth	R31	W44-L W44-U	LKD	28.7	28.7	0.0	0.0%	29.1	22.4	77%	22.4	77%	0.0	0.0%	47	11	47	11	0.0%	0.0%
Eighth	R32	W45-L W45-U	Bedroom	20.4	20.4	0.0	0.0%	6.7	6.4	96%	6.4	96%	0.0	0.0%	47	12	47	12	0.0%	0.0%
Eighth	R33	W46-L W46-U	Bedroom	27.6	27.6	0.0	0.0%	12.8	12.5	97%	12.5	97%	0.0	0.0%	51	16	51	16	0.0%	0.0%
Eighth	R34	W47-L W47-U	LKD	12.4	12.4	0.0	0.0%	26.3	23.7	90%	23.7	90%	0.0	0.0%	31	15	31	15	0.0%	0.0%
Eighth	R35	W48-L W48-U	Bedroom	18.2	18.2	0.0	0.0%	14.8	13.8	94%	13.8	94%	0.0	0.0%	36	8	36	8	0.0%	0.0%
Ninth	R1	W1-L W1-U	LKD	34.2	34.2	0.0	0.0%													
		W2-L W2-U		38.8	38.8	0.0	0.0%													
		W3-L W3-U		39.1	39.1	0.0	0.0%													
		W4-L W4-U		38.1	38.1	0.0	0.0%	37.0	36.9	100%	36.9	100%	0.0	0.0%	58	17	58	17	0.0%	0.0%
Ninth	R2	W5-L W5-U	Bedroom	38.0	38.0	0.0	0.0%	10.4	10.2	98%	10.2	98%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Ninth	R3	W6-L W6-U	Bedroom	37.9	37.9	0.0	0.0%	12.9	12.9	99%	12.9	99%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Ninth	R4	W7-L W7-U	Bedroom	37.8	37.8	0.0	0.0%	11.1	11.0	99%	11.0	99%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Ninth	R5	W8-L W8-U	LKD	37.7	37.7	0.0	0.0%													
		W9-L W9-U		37.6	37.6	0.0	0.0%	32.8	29.5	90%	29.5	90%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Ninth	R6	W10-L W10-U	LKD	18.3	18.3	0.0	0.0%													
		W11-L W11-U		18.1	18.1	0.0	0.0%	38.2	27.8	73%	27.8	73%	0.0	0.0%	30	7	30	7	0.0%	0.0%
Ninth	R7	W12-L	Bedroom	36.4	36.4	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W12-U																		
		W13-L		32.6	32.6	0.0	0.0%													
		W13-U						10.9	10.9	100%	10.9	100%	0.0	0.0%	92	24	92	24	0.0%	0.0%
Ninth	R8	W14-L	LKD	33.2	33.2	0.0	0.0%													
		W14-U																		
		W15-L		8.6	8.6	0.0	0.0%													
		W15-U						31.3	28.7	92%	28.7	92%	0.0	0.0%	17	3	17	3	0.0%	0.0%
Ninth	R9	W16-L	Bedroom	6.8	6.8	0.0	0.0%													
		W16-U																		
		W17-L		36.8	36.8	0.0	0.0%													
		W17-U						14.2	12.6	89%	12.6	89%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Ninth	R10	W18-L	Bedroom	36.7	36.7	0.0	0.0%													
		W18-U						13.0	12.1	94%	12.1	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Ninth	R11	W19-L	LKD	36.6	36.6	0.0	0.0%													
		W19-U																		
		W20-L		8.1	8.0	0.1	1.4%													
		W20-U																		
		W21-L		0.0	0.0	0.0	0.0%													
		W21-U						31.0	22.3	72%	22.3	72%	0.0	0.0%	63	23	63	23	0.0%	0.0%
Ninth	R12	W22-L	Bedroom	35.4	33.9	1.4	4.0%													
		W22-U						7.9	7.6	95%	7.6	95%	0.0	0.0%	83	26	81	24	2.4%	7.7%
Ninth	R14	W24-L	Bedroom	35.2	33.8	1.5	4.2%													
		W24-U						11.8	11.0	93%	11.0	93%	0.0	0.0%	83	26	80	23	3.6%	11.5%
Ninth	R15	W25-L	Bedroom	35.2	33.7	1.5	4.3%													
		W25-U						10.8	10.6	98%	10.6	98%	0.0	0.0%	83	26	80	23	3.6%	11.5%
Ninth	R16	W26-L	Bedroom	35.1	33.5	1.5	4.4%													
		W26-U																		
		W27-L		7.5	6.7	0.8	10.9%													
		W27-U						7.9	7.8	98%	7.8	98%	0.0	0.0%	82	25	80	23	2.4%	8.0%
Ninth	R17	W28-L	LKD	10.9	9.4	1.4	13.1%													
		W28-U																		
		W29-L		32.7	32.0	0.7	2.2%													
		W29-U																		
		W30-L		32.0	31.3	0.7	2.2%													
		W30-U						32.4	26.7	82%	26.7	82%	0.0	0.0%	42	17	39	14	7.1%	17.6%
Ninth	R18	W31-L	LKD	33.8	33.8	0.0	0.0%													
		W31-U																		
		W32-L		34.0	34.0	0.0	0.0%													
		W32-U																		
		W33-L		10.3	8.9	1.4	14.0%													
		W33-U																		
		W34-L		6.7	6.7	0.0	0.0%													
		W34-U																		
		W35-L		34.6	33.0	1.5	4.4%													
		W35-U						31.9	30.5	96%	30.5	96%	0.0	0.0%	93	26	92	25	1.1%	3.8%
Ninth	R19	W36-L	Bedroom	34.7	33.1	1.6	4.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W36-U						11.7	11.5	99%	11.5	99%	0.0	0.0%	84	27	82	25	2.4%	7.4%
Ninth	R20	W37-L	Bedroom	34.8	33.1	1.7	4.9%													
		W37-U						7.3	7.1	97%	7.1	97%	0.0	0.0%	85	28	83	26	2.4%	7.1%
Ninth	R21	W38-L	Bedroom	35.1	33.2	1.9	5.3%													
		W38-U						11.9	11.5	97%	11.5	97%	0.0	0.0%	85	28	83	26	2.4%	7.1%
Ninth	R22	W39-L	LKD	27.6	25.5	2.1	7.5%													
		W39-U																		
		W40-L		35.6	33.3	2.3	6.4%													
		W40-U																		
		W41-L		39.0	38.6	0.4	0.9%													
		W41-U						40.3	38.1	95%	38.0	95%	0.0	0.0%	83	26	82	25	1.2%	3.8%
Ninth	R23	W42-L	Bedroom	24.1	24.1	0.0	0.0%													
		W42-U						14.3	14.0	97%	14.0	97%	0.0	0.0%	19	1	19	1	0.0%	0.0%
Ninth	R24	W43-L	Bedroom	30.1	30.1	0.0	0.0%													
		W43-U						12.1	12.1	100%	12.1	100%	0.0	0.0%	36	2	36	2	0.0%	0.0%
Ninth	R25	W44-L	LKD	33.6	33.6	0.0	0.0%													
		W44-U						42.2	28.0	66%	28.0	66%	0.0	0.0%	50	11	50	11	0.0%	0.0%
Ninth	R26	W45-L	LKD	32.2	32.2	0.0	0.0%													
		W45-U						42.1	27.7	66%	27.7	66%	0.0	0.0%	55	17	55	17	0.0%	0.0%
Ninth	R27	W46-L	Bedroom	28.9	28.9	0.0	0.0%													
		W46-U						11.8	11.8	100%	11.8	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%
Ninth	R28	W47-L	Bedroom	23.6	23.6	0.0	0.0%													
		W47-U						14.3	14.0	98%	14.0	98%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Tenth	R1	W1-L	Studio	39.6	39.6	0.0	0.0%													
		W1-U																		
		W2-L		39.6	39.6	0.0	0.0%													
		W2-U																		
		W3-L		39.6	39.6	0.0	0.0%													
		W3-U																		
		W4-L		39.6	39.6	0.0	0.0%													
		W4-U																		
		W5-L		38.6	38.6	0.0	0.0%													
		W5-U																		
		W6-L		38.6	38.6	0.0	0.0%													
		W6-U																		
		W7-L		38.5	38.5	0.0	0.0%													
		W7-U																		
		W8-L		38.4	38.4	0.0	0.0%													
		W8-U						94.4	94.2	100%	94.2	100%	0.0	0.0%	60	18	60	18	0.0%	0.0%
Tenth	R2	W9-L	Studio	38.4	38.4	0.0	0.0%													
		W9-U																		
		W10-L		38.3	38.3	0.0	0.0%													
		W10-U																		
		W11-L		38.3	38.3	0.0	0.0%													
		W11-U						39.0	36.3	93%	36.3	93%	0.0	0.0%	57	17	57	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Tenth	R3	W12-L	Studio	38.2	38.2	0.0	0.0%												
		W12-U																	
		W13-L		38.1	38.1	0.0	0.0%												
		W13-U																	
		W14-L		36.1	35.4	0.7	1.9%												
		W14-U						39.7	38.2	96%	38.2	96%	0.0	0.0%	96	28	94	26	2.1%	7.1%
Tenth	R5	W16-L	LKD	36.9	36.9	0.0	0.0%												
		W16-U																	
		W17-L		36.1	34.2	1.9	5.1%												
		W17-U																	
		W18-L		36.3	34.3	2.0	5.5%												
		W18-U						40.4	38.2	94%	38.2	94%	0.0	0.0%	96	29	94	27	2.1%	6.9%
Tenth	R6	W19-L	Bedroom	36.4	34.3	2.1	5.8%												
		W19-U																	
		W20-L		36.5	34.3	2.2	6.0%												
		W20-U						11.6	11.5	99%	11.5	99%	0.0	0.0%	85	28	83	26	2.4%	7.1%
Tenth	R7	W21-L	LKD	36.5	34.3	2.2	6.1%												
		W21-U																	
		W22-L		36.6	34.3	2.3	6.2%												
		W22-U																	
		W23-L		8.4	8.0	0.4	4.9%												
		W23-U																	
		W24-L		9.3	7.2	2.1	23.0%												
		W24-U						40.6	38.9	96%	38.9	96%	0.0	0.0%	87	28	86	27	1.1%	3.6%
Tenth	R8	W25-L	Bedroom	29.7	29.7	0.0	0.0%												
		W25-U						10.7	10.4	97%	10.4	97%	0.0	0.0%	34	2	34	2	0.0%	0.0%
Tenth	R9	W26-L	Bedroom	34.5	34.5	0.0	0.0%												
		W26-U						7.7	7.4	96%	7.4	96%	0.0	0.0%	50	11	50	11	0.0%	0.0%
Tenth	R10	W27-L	LKD	32.0	32.0	0.0	0.0%												
		W27-U																	
		W28-L		36.0	36.0	0.0	0.0%												
		W28-U						30.8	26.7	87%	26.7	87%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Tenth	R11	W29-L	LKD	35.4	34.9	0.5	1.4%												
		W29-U																	
		W30-L		31.0	31.0	0.0	0.0%												
		W30-U						30.5	26.2	86%	26.2	86%	0.0	0.0%	96	29	95	28	1.0%	3.4%
Tenth	R12	W31-L	Bedroom	33.5	33.5	0.0	0.0%												
		W31-U						7.7	7.4	96%	7.4	96%	0.0	0.0%	58	19	58	19	0.0%	0.0%
Tenth	R13	W32-L	Bedroom	29.0	29.0	0.0	0.0%												
		W32-U						10.7	10.4	97%	10.4	97%	0.0	0.0%	54	19	54	19	0.0%	0.0%
165-195 High cross road																			
Ground	R1	W1-L	Residential	31.9	27.8	4.1	12.8%												
		W1-U																	
		W2-L		2.1	2.1	0.0	0.0%												
		W2-U																	
		W3-L		1.6	1.6	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	27	2	27	2	0.0%	0.0%
Ground	R2	W4-L	Residential	8.2	4.7	3.5	42.6%													
		W4-U																		
		W5-L		7.4	4.9	2.5	33.6%													
		W5-U																		
		W6-L		7.8	5.3	2.5	31.9%													
		W6-U						16.2	15.5	96%	15.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W7-L	Residential	6.0	3.5	2.5	41.3%													
		W7-U																		
		W8-L		7.8	5.3	2.5	31.5%													
		W8-U																		
		W9-L		10.6	7.2	3.4	32.4%													
		W9-U						16.2	15.3	95%	15.3	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R4	W10-L	Residential	4.5	4.5	0.0	0.0%													
		W10-U																		
		W11-L		2.4	2.4	0.0	0.0%													
		W11-U																		
		W12-L		31.5	27.6	3.9	12.5%													
		W12-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R5	W13-L	Residential	31.2	27.4	3.9	12.3%													
		W13-U																		
		W14-L		1.7	1.7	0.0	0.0%													
		W14-U																		
		W15-L		0.9	0.9	0.0	0.0%													
		W15-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	24	3	24	3	0.0%	0.0%
Ground	R6	W16-L	Residential	7.4	4.5	3.0	39.9%													
		W16-U																		
		W17-L		6.7	4.5	2.3	33.9%													
		W17-U																		
		W18-L		7.5	5.3	2.3	30.3%													
		W18-U						16.2	15.2	94%	15.2	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R7	W19-L	Residential	5.4	3.2	2.2	41.1%													
		W19-U																		
		W20-L		7.1	5.0	2.2	30.5%													
		W20-U																		
		W21-L		10.4	7.4	3.1	29.5%													
		W21-U						16.2	15.2	94%	15.2	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R8	W22-L	Residential	5.3	5.1	0.2	4.3%													
		W22-U																		
		W23-L		5.2	5.2	0.0	0.0%													
		W23-U																		
		W24-L		30.4	26.9	3.5	11.6%													
		W24-U																		
		W25-L		31.4	31.4	0.0	0.0%													
		W25-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	66	22	66	22	0.0%	0.0%
First	R1	W1-L	Residential	32.2	28.2	4.0	12.4%													
		W1-U																		
		W2-L		4.9	4.9	0.0	0.0%													
		W2-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W3-L		3.7	3.7	0.0	0.0%													
		W3-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	27	2	27	2	0.0%	0.0%
First	R2	W4-L	Residential	9.9	6.0	3.9	39.4%													
		W4-U																		
		W5-L		9.5	6.3	3.2	33.2%													
		W5-U																		
		W6-L		10.6	7.5	3.1	29.6%													
		W6-U						15.9	15.3	96%	15.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W7-L	Residential	9.7	6.5	3.1	32.3%													
		W7-U																		
		W8-L		10.7	7.6	3.1	29.0%													
		W8-U																		
		W9-L		13.2	9.4	3.8	29.0%													
		W9-U						15.9	15.2	96%	15.2	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W10-L	Residential	7.9	7.9	0.0	0.0%													
		W10-U																		
		W11-L		7.3	7.3	0.0	0.0%													
		W11-U																		
		W12-L		31.9	28.1	3.9	12.1%													
		W12-U						14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W13-L	Residential	31.6	27.9	3.8	11.9%													
		W13-U																		
		W14-L		5.2	5.2	0.0	0.0%													
		W14-U																		
		W15-L		3.6	3.6	0.0	0.0%													
		W15-U						14.1	14.0	100%	14.0	100%	0.0	0.0%	25	3	25	3	0.0%	0.0%
First	R6	W16-L	Residential	9.3	6.2	3.1	33.5%													
		W16-U																		
		W17-L		8.8	6.0	2.9	32.7%													
		W17-U																		
		W18-L		10.0	7.1	2.9	28.8%													
		W18-U						15.9	15.0	94%	15.0	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W19-L	Residential	9.0	6.1	2.8	31.5%													
		W19-U																		
		W20-L		10.0	7.2	2.8	27.6%													
		W20-U																		
		W21-L		12.8	9.4	3.4	26.6%													
		W21-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W22-L	Residential	7.9	7.7	0.2	2.3%													
		W22-U																		
		W23-L		7.5	7.5	0.0	0.0%													
		W23-U																		
		W24-L		30.8	27.4	3.4	11.2%													
		W24-U																		
		W25-L		32.4	32.4	0.0	0.0%													
		W25-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	69	24	69	24	0.0%	0.0%
Second	R1	W1-L	Residential	32.7	28.8	3.9	12.0%													
		W1-U																		
		W2-L		2.6	2.6	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		2.0	2.0	0.0	0.0%													
		W3-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	30	3	30	3	0.0%	0.0%
Second	R2	W4-L	Residential	7.6	4.3	3.3	43.5%													
		W4-U																		
		W5-L		6.5	4.2	2.3	34.9%													
		W5-U																		
		W6-L		7.4	5.1	2.3	30.7%													
		W6-U						15.9	15.2	95%	15.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W7-L	Residential	6.7	4.4	2.2	33.7%													
		W7-U																		
		W8-L		7.4	5.2	2.2	29.9%													
		W8-U																		
		W9-L		10.4	7.1	3.3	31.4%													
		W9-U						15.9	15.0	94%	15.0	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W10-L	Residential	5.8	5.8	0.0	0.0%													
		W10-U																		
		W11-L		4.9	4.9	0.0	0.0%													
		W11-U																		
		W12-L		32.3	28.6	3.8	11.7%													
		W12-U						14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W13-L	Residential	32.1	28.4	3.7	11.5%													
		W13-U																		
		W14-L		2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		1.9	1.9	0.0	0.0%													
		W15-U						14.1	14.0	100%	14.0	100%	0.0	0.0%	27	4	27	4	0.0%	0.0%
Second	R6	W16-L	Residential	7.2	4.6	2.6	36.6%													
		W16-U																		
		W17-L		6.0	4.0	2.1	34.0%													
		W17-U																		
		W18-L		6.9	4.8	2.1	29.8%													
		W18-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W19-L	Residential	6.1	4.1	2.0	32.7%													
		W19-U																		
		W20-L		6.9	4.9	2.0	28.5%													
		W20-U																		
		W21-L		9.9	7.1	2.9	29.1%													
		W21-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W22-L	Residential	5.8	5.6	0.2	3.1%													
		W22-U																		
		W23-L		5.0	5.0	0.0	0.0%													
		W23-U																		
		W24-L		31.3	28.0	3.4	10.7%													
		W24-U																		
		W25-L		33.4	33.4	0.0	0.0%													
		W25-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	71	25	71	25	0.0%	0.0%
Third	R1	W1-L	Residential	32.9	29.0	3.8	11.7%													
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		2.6	2.6	0.0	0.0%													
		W2-U																		
		W3-L		1.6	1.6	0.0	0.0%													
		W3-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	30	4	30	4	0.0%	0.0%
Third	R2	W4-L	Residential	7.5	4.3	3.2	42.8%													
		W4-U																		
		W5-L		5.7	3.7	1.9	34.2%													
		W5-U																		
		W6-L		6.3	4.4	1.9	30.7%													
		W6-U						15.9	15.2	95%	15.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W7-L	Residential	4.9	3.0	1.9	38.8%													
		W7-U																		
		W8-L		6.1	4.2	1.9	30.9%													
		W8-U																		
		W9-L		9.9	6.8	3.1	31.7%													
		W9-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W10-L	Residential	5.3	5.3	0.0	0.0%													
		W10-U																		
		W11-L		4.2	4.2	0.0	0.0%													
		W11-U																		
		W12-L		32.4	28.7	3.7	11.4%													
		W12-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W13-L	Residential	32.2	28.6	3.6	11.1%													
		W13-U																		
		W14-L		2.9	2.9	0.0	0.0%													
		W14-U																		
		W15-L		1.4	1.4	0.0	0.0%													
		W15-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	28	5	28	5	0.0%	0.0%
Third	R6	W16-L	Residential	7.0	4.4	2.6	37.4%													
		W16-U																		
		W17-L		5.2	3.5	1.8	33.5%													
		W17-U																		
		W18-L		5.9	4.2	1.7	29.5%													
		W18-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W19-L	Residential	4.5	2.8	1.7	37.6%													
		W19-U																		
		W20-L		5.6	4.0	1.7	29.4%													
		W20-U																		
		W21-L		9.5	6.7	2.8	29.4%													
		W21-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W22-L	Residential	5.2	5.2	0.0	0.0%													
		W22-U																		
		W23-L		4.3	4.3	0.0	0.0%													
		W23-U																		
		W24-L		31.5	28.2	3.3	10.3%													
		W24-U																		
		W25-L		34.0	34.0	0.0	0.0%													
		W25-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	71	25	71	25	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R1	W1-L	LKD	30.4	30.4	0.0	0.0%												
		W1-U																	
		W2-L		30.5	30.5	0.0	0.0%												
		W2-U																	
		W3-L		16.8	13.9	2.9	17.1%												
		W3-U						38.0	26.7	70%	26.7	70%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
First	R2	W4-L	Bedroom	30.4	26.6	3.8	12.4%												
		W4-U						12.1	10.8	89%	10.8	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	Bedroom	31.0	27.2	3.9	12.4%												
		W5-U						12.5	11.6	93%	11.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W6-L	Bedroom	30.5	26.5	4.0	13.2%												
		W6-U						13.0	12.4	96%	12.1	93%	0.3	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7-L	LKD	29.7	25.6	4.1	13.9%												
		W7-U																	
		W8-L		8.9	6.2	2.8	30.8%												
		W8-U						39.5	28.9	73%	26.3	67%	2.6	8.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W9-L	Bedroom	14.6	10.9	3.7	25.2%												
		W9-U						13.6	12.6	93%	10.7	78%	1.9	15.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10-L	Studio	12.4	9.1	3.3	26.3%												
		W10-U						37.2	16.5	44%	12.5	33%	4.0	24.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	32.8	32.8	0.0	0.0%												
		W1-U																	
		W2-L		32.9	32.9	0.0	0.0%												
		W2-U																	
		W3-L		18.0	14.9	3.0	16.9%												
		W3-U						38.0	27.9	73%	27.9	73%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Second	R2	W4-L	Bedroom	31.7	27.9	3.8	12.1%												
		W4-U						12.1	10.9	90%	10.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	Bedroom	32.4	28.4	4.0	12.2%												
		W5-U						12.5	11.7	93%	11.7	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W6-L	Bedroom	31.9	27.8	4.1	13.0%												
		W6-U						13.0	12.4	96%	12.1	93%	0.3	2.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7-L	LKD	31.1	26.8	4.3	13.7%												
		W7-U																	
		W8-L		9.6	6.7	3.0	30.6%												
		W8-U						39.5	29.5	75%	26.8	68%	2.7	9.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W9-L	Bedroom	15.6	11.9	3.8	24.2%												
		W9-U						13.6	12.8	94%	11.9	87%	0.9	7.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10-L	Studio	13.3	9.9	3.4	25.6%												
		W10-U						37.2	17.7	48%	13.6	37%	4.1	23.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	34.7	34.7	0.0	0.0%												
		W1-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		34.8	34.8	0.0	0.0%												
		W2-U																	
		W3-L		19.0	15.8	3.2	16.7%												
		W3-U						38.0	30.4	80%	30.4	80%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Third	R2	W4-L	Bedroom	32.7	28.9	3.9	11.9%												
		W4-U						12.1	10.9	90%	10.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	Bedroom	33.4	29.4	4.0	11.9%												
		W5-U						12.5	11.7	94%	11.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W6-L	Bedroom	33.0	28.8	4.2	12.7%												
		W6-U						13.0	12.4	96%	12.1	93%	0.3	2.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7-L	LKD	32.2	27.9	4.3	13.5%												
		W7-U																	
		W8-L		10.3	7.2	3.1	30.3%												
		W8-U						39.5	30.1	76%	27.4	69%	2.7	9.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W9-L	Bedroom	16.8	12.9	3.9	23.1%												
		W9-U						13.6	12.9	95%	12.1	89%	0.8	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10-L	Studio	15.4	11.9	3.5	22.7%												
		W10-U						37.2	18.6	50%	15.4	41%	3.2	17.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	36.4	36.4	0.0	0.0%												
		W1-U																	
		W2-L		36.4	36.4	0.0	0.0%												
		W2-U																	
		W3-L		20.0	16.7	3.3	16.4%												
		W3-U						38.0	32.7	86%	32.7	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Fourth	R2	W4-L	Bedroom	33.7	29.9	3.9	11.5%												
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	Bedroom	34.5	30.4	4.0	11.7%												
		W5-U						12.5	11.8	95%	11.8	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W6-L	Bedroom	34.1	29.9	4.2	12.4%												
		W6-U						13.0	12.4	96%	12.1	93%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7-L	LKD	33.4	29.0	4.4	13.2%												
		W7-U																	
		W8-L		11.0	7.7	3.3	30.0%												
		W8-U						39.5	31.0	78%	28.2	71%	2.8	9.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W9-L	Bedroom	18.1	14.2	3.9	21.6%												
		W9-U						13.6	12.9	95%	12.1	89%	0.8	6.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10-L	Studio	17.2	13.6	3.6	21.0%												
		W10-U						37.2	19.4	52%	17.3	46%	2.1	11.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	37.9	37.9	0.0	0.0%												
		W1-U																	
		W2-L		37.9	37.9	0.0	0.0%												
		W2-U																	
		W3-L		20.8	17.4	3.4	16.1%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Fifth	R2	W4-L	Bedroom	34.5	30.7	3.8	11.0%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	Bedroom	35.3	31.3	4.0	11.2%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W6-L	Bedroom	35.0	30.8	4.2	11.9%													
		W6-U						13.0	12.4	96%	12.1	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7-L	LKD	34.3	30.0	4.3	12.6%													
		W7-U																		
		W8-L		11.5	8.1	3.4	29.2%													
		W8-U						39.5	31.8	81%	30.9	78%	0.9	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W9-L	Bedroom	19.4	15.6	3.8	19.6%													
		W9-U						13.6	12.9	95%	12.1	89%	0.8	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10-L	Studio	18.6	15.0	3.6	19.3%													
		W10-U						37.2	20.0	54%	18.8	50%	1.2	6.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	38.2	38.2	0.0	0.0%													
		W1-U																		
		W2-L		38.2	38.2	0.0	0.0%													
		W2-U																		
		W3-L		21.2	17.8	3.3	15.7%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Sixth	R2	W4-L	Bedroom	34.8	31.1	3.7	10.5%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W5-L	Bedroom	35.6	31.8	3.8	10.7%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W6-L	Bedroom	35.4	31.4	4.0	11.3%													
		W6-U						13.0	12.4	96%	12.1	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7-L	LKD	34.8	30.7	4.1	11.8%													
		W7-U																		
		W8-L		11.9	8.6	3.3	27.6%													
		W8-U						39.5	32.5	82%	32.4	82%	0.2	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W9-L	Bedroom	20.7	17.1	3.6	17.5%													
		W9-U						13.6	12.9	95%	12.1	89%	0.8	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10-L	Studio	20.1	16.7	3.4	17.1%													
		W10-U						37.2	20.5	55%	19.5	52%	1.0	5.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	38.9	38.9	0.0	0.0%													
		W1-U																		
		W2-L		38.9	38.9	0.0	0.0%													
		W2-U																		
		W3-L		21.6	18.3	3.3	15.2%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Seventh	R2	W4-L	Bedroom	35.5	31.9	3.5	9.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W5-L	Bedroom	36.3	32.7	3.6	10.0%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W6-L	Bedroom	36.3	32.5	3.8	10.6%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W7-L	LKD	35.8	31.8	3.9	11.0%													
		W7-U																		
		W8-L		12.7	9.5	3.2	25.2%													
		W8-U						39.5	32.9	83%	32.9	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W9-L	Bedroom	22.4	19.0	3.4	15.4%													
		W9-U						13.6	13.0	96%	12.3	90%	0.8	5.8%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W10-L	Studio	22.0	18.7	3.3	14.9%													
		W10-U						37.2	21.5	58%	20.5	55%	1.0	4.6%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1-L	LKD	39.0	39.0	0.0	0.0%													
		W1-U																		
		W2-L		39.0	39.0	0.0	0.0%													
		W2-U																		
		W3-L		21.9	18.7	3.2	14.6%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Eighth	R2	W4-L	Bedroom	35.8	32.4	3.4	9.4%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W5-L	Bedroom	36.7	33.2	3.5	9.5%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W6-L	Bedroom	36.8	33.1	3.7	10.0%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W7-L	LKD	36.5	32.7	3.8	10.3%													
		W7-U																		
		W8-L		14.2	11.0	3.2	22.5%													
		W8-U						39.5	33.1	84%	33.1	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W9-L	Bedroom	24.1	20.8	3.3	13.6%													
		W9-U						13.6	13.1	96%	12.3	91%	0.7	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W10-L	Studio	24.1	20.9	3.1	13.0%													
		W10-U						37.2	23.2	62%	22.2	60%	1.0	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1-L	LKD	39.1	39.1	0.0	0.0%													
		W1-U																		
		W2-L		39.1	39.1	0.0	0.0%													
		W2-U																		
		W3-L		22.2	19.2	3.1	13.7%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Ninth	R2	W4-L	Bedroom	36.1	32.9	3.2	8.9%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W5-L	Bedroom	37.1	33.8	3.3	8.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W6-L	Bedroom	37.2	33.7	3.5	9.4%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W7-L	LKD	36.9	33.4	3.6	9.7%													
		W7-U																		
		W8-L		15.5	12.3	3.1	20.3%													
		W8-U						39.5	33.4	85%	33.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9-L	Bedroom	25.8	22.7	3.1	12.1%													
		W9-U						13.6	13.1	96%	12.3	91%	0.7	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W10-L	LKD	7.4	5.5	1.9	26.0%													
		W10-U						30.3	23.0	76%	21.2	70%	1.8	7.7%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1-L	LKD	39.1	39.1	0.0	0.0%													
		W1-U																		
		W2-L		39.1	39.1	0.0	0.0%													
		W2-U																		
		W3-L		22.5	19.6	2.9	12.9%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Tenth	R2	W4-L	Bedroom	36.4	33.4	3.0	8.4%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W5-L	Bedroom	37.4	34.2	3.1	8.4%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W6-L	Bedroom	37.6	34.3	3.3	8.8%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W7-L	LKD	37.3	34.0	3.4	9.1%													
		W7-U																		
		W8-L		16.5	13.5	3.0	18.4%													
		W8-U						39.5	35.8	91%	35.8	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9-L	Bedroom	27.4	24.4	3.0	10.9%													
		W9-U						13.6	13.1	96%	12.4	91%	0.7	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W10-L	LKD	9.1	7.2	1.9	21.0%													
		W10-U						30.3	24.4	80%	22.6	74%	1.8	7.3%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1-L	LKD	39.1	39.1	0.0	0.0%													
		W1-U																		
		W2-L		39.1	39.1	0.0	0.0%													
		W2-U																		
		W3-L		22.8	20.0	2.8	12.1%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Eleventh	R2	W4-L	Bedroom	36.6	33.7	2.9	7.9%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W5-L	Bedroom	37.6	34.6	3.0	7.9%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W6-L	Bedroom	37.8	34.7	3.1	8.2%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W7-L	LKD	37.6	34.4	3.2	8.6%													
		W7-U																		
		W8-L		17.1	14.2	2.9	16.9%													
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9-L	Bedroom	28.0	25.2	2.8	10.0%													
		W9-U						13.6	13.1	96%	12.4	91%	0.7	5.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W10-L	LKD	9.6	7.8	1.8	19.0%													
		W10-U						30.3	24.5	81%	22.7	75%	1.8	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1-L	LKD	38.7	38.7	0.0	0.0%													
		W1-U																		
		W2-L		38.7	38.7	0.0	0.0%													
		W2-U																		
		W3-L		22.9	20.3	2.6	11.3%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Twelfth	R2	W4-L	Bedroom	36.6	33.9	2.7	7.4%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W5-L	Bedroom	37.5	34.7	2.8	7.4%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W6-L	Bedroom	37.7	34.8	2.9	7.8%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W7-L	LKD	37.5	34.5	3.0	8.0%													
		W7-U																		
		W8-L		17.4	14.7	2.7	15.6%													
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9-L	Bedroom	28.3	25.7	2.6	9.3%													
		W9-U						13.6	13.1	96%	12.4	91%	0.7	5.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W10-L	LKD	9.5	7.7	1.7	18.2%													
		W10-U						30.3	24.5	81%	22.7	75%	1.8	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%													
		W1-U																		
		W2-L		39.3	39.3	0.0	0.0%													
		W2-U																		
		W3-L		23.2	20.8	2.4	10.5%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Thirteenth	R2	W4-L	Bedroom	37.1	34.6	2.5	6.8%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W5-L	Bedroom	38.1	35.5	2.6	6.9%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W6-L	Bedroom	38.3	35.6	2.7	7.2%													
		W6-U						13.0	12.5	96%	12.2	94%	0.2	1.9%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W7-L	LKD	38.0	35.2	2.8	7.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W7-U																	
		W8-L		17.9	15.3	2.5	14.2%												
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W9-L	Bedroom	29.2	26.8	2.5	8.4%												
		W9-U						13.6	13.1	96%	12.5	92%	0.6	4.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W10-L	LKD	10.3	8.7	1.6	15.5%												
		W10-U						30.3	24.6	81%	22.8	75%	1.7	7.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%												
		W1-U																	
		W2-L		39.3	39.3	0.0	0.0%												
		W2-U																	
		W3-L		23.4	21.1	2.3	9.7%												
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Fourteenth	R2	W4-L	Bedroom	37.3	35.0	2.4	6.3%												
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W5-L	Bedroom	38.3	35.9	2.4	6.3%												
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W6-L	Bedroom	38.5	36.0	2.5	6.6%												
		W6-U						13.0	12.5	96%	12.3	94%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W7-L	LKD	38.3	35.6	2.6	6.8%												
		W7-U																	
		W8-L		18.2	15.8	2.4	12.9%												
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W9-L	Bedroom	29.8	27.5	2.3	7.7%												
		W9-U						13.6	13.1	96%	12.5	92%	0.5	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W10-L	LKD	10.6	9.1	1.5	14.1%												
		W10-U						30.3	24.6	81%	22.9	76%	1.7	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%												
		W1-U																	
		W2-L		39.3	39.3	0.0	0.0%												
		W2-U																	
		W3-L		23.5	21.4	2.1	8.9%												
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Fifteenth	R2	W4-L	Bedroom	37.6	35.5	2.2	5.7%												
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W5-L	Bedroom	38.6	36.4	2.2	5.8%												
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W6-L	Bedroom	38.7	36.4	2.3	6.0%												
		W6-U						13.0	12.5	96%	12.3	95%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W7-L	LKD	38.5	36.1	2.4	6.2%												
		W7-U																	
		W8-L		18.5	16.3	2.2	11.7%												
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifteenth	R6	W9-L	Bedroom	30.4	28.3	2.1	6.9%													
		W9-U						13.6	13.1	96%	12.7	93%	0.4	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W10-L	LKD	10.8	9.5	1.4	12.6%													
		W10-U						30.3	24.7	81%	23.0	76%	1.7	6.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U																		
		W2-L		39.4	39.4	0.0	0.0%													
		W2-U																		
		W3-L		23.6	21.7	1.9	8.1%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Sixteenth	R2	W4-L	Bedroom	38.3	36.3	2.0	5.1%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W5-L	Bedroom	38.8	36.8	2.0	5.2%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R4	W6-L	Bedroom	38.9	36.8	2.1	5.5%													
		W6-U						13.0	12.5	96%	12.4	95%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W7-L	LKD	38.7	36.5	2.2	5.7%													
		W7-U																		
		W8-L		18.8	16.8	2.0	10.5%													
		W8-U						39.5	36.0	91%	36.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R6	W9-L	Bedroom	31.8	29.9	1.9	6.0%													
		W9-U						13.6	13.1	96%	12.9	95%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W10-L	LKD	11.0	9.8	1.2	11.2%													
		W10-U						30.3	24.7	81%	23.1	76%	1.6	6.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%													
		W1-U																		
		W2-L		39.3	39.3	0.0	0.0%													
		W2-U																		
		W3-L		39.1	37.4	1.7	4.4%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	N/R	N/R	N/R	N/R	N/A	N/A
Seventeenth	R2	W4-L	Bedroom	39.0	37.3	1.8	4.6%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W5-L	Bedroom	39.0	37.2	1.8	4.7%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R4	W6-L	Bedroom	39.0	37.1	1.9	4.9%													
		W6-U						13.0	12.5	96%	12.4	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W7-L	LKD	39.0	37.0	2.0	5.1%													
		W7-U																		
		W8-L		34.9	33.1	1.8	5.1%													
		W8-U						39.5	36.0	91%	36.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R6	W9-L	Bedroom	34.2	32.5	1.7	5.0%													
		W9-U						13.6	13.1	96%	13.0	96%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventeenth	R7	W10-L W10-U	LKD	11.2	10.1	1.1	10.0%	30.3	24.7	81%	23.3	77%	1.4	5.7%	N/F	N/F	N/F	N/F	N/F	N/F

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 3

Results of the cumulative daylight and sunlight assessments

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ferry Island Building 1																			
First	R1	W1-L	LKD	11.6	11.4	0.2	1.5%												
		W1-U						34.9	18.9	54%	18.9	54%	0.0	0.0%	21	10	21	10	0.0%	0.0%
First	R2	W2	Bedroom	12.1	11.7	0.4	3.0%	13.5	6.6	49%	6.6	49%	0.0	0.0%	19	7	19	7	0.0%	0.0%
First	R3	W3	Residential	12.9	12.3	0.6	4.5%	19.7	11.7	60%	11.7	59%	0.0	0.3%	22	9	22	9	0.0%	0.0%
First	R4	W4	Residential	16.9	15.6	1.2	7.2%													
		W5		18.5	17.6	0.9	5.0%	18.4	13.1	71%	12.9	70%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W6	Residential	18.5	17.6	0.9	4.9%													
		W7		20.3	18.4	1.9	9.4%	14.1	13.6	96%	13.2	93%	0.4	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W8	Residential	20.0	18.1	1.9	9.4%	17.0	13.4	79%	11.7	69%	1.6	12.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W9	Bedroom	19.7	17.9	1.8	9.3%	15.1	12.3	81%	10.7	71%	1.6	12.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W10	LKD	19.0	17.6	1.4	7.4%													
		W11		31.0	30.5	0.5	1.6%	24.2	22.4	93%	21.9	90%	0.6	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	12.2	12.0	0.2	1.5%													
		W1-U						34.9	18.9	54%	18.9	54%	0.0	0.0%	22	10	22	10	0.0%	0.0%
Second	R2	W2	Bedroom	12.8	12.4	0.4	3.0%	13.5	6.8	51%	6.8	51%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Second	R3	W3	Bedroom	13.6	13.0	0.6	4.4%	14.9	10.4	69%	10.4	69%	0.0	0.2%	23	9	23	9	0.0%	0.0%
Second	R4	W4	Bedroom	17.7	16.4	1.3	7.2%	10.9	4.7	43%	4.7	43%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W5	LKD	19.3	18.3	1.0	5.1%													
		W6		19.3	18.4	1.0	5.0%													
		W7		21.5	19.4	2.1	9.8%	41.8	37.4	90%	35.7	85%	1.8	4.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W8	Bedroom	21.3	19.2	2.1	10.0%	13.6	11.9	88%	11.3	83%	0.7	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W9	Bedroom	21.1	19.0	2.1	10.0%	15.1	12.7	84%	11.3	75%	1.4	10.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W10	LKD	20.4	18.8	1.7	8.3%													
		W11		31.8	31.2	0.7	2.1%	24.2	23.3	96%	22.2	92%	1.1	4.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	12.9	12.7	0.2	1.5%													
		W1-U						34.9	18.8	54%	18.8	54%	0.0	0.0%	22	10	22	10	0.0%	0.0%
Third	R2	W2	Bedroom	13.5	13.2	0.4	2.8%	13.5	7.1	53%	7.1	53%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Third	R3	W3	Bedroom	14.4	13.8	0.6	4.2%	14.9	10.7	72%	10.7	72%	0.0	0.1%	24	9	24	9	0.0%	0.0%
Third	R4	W4	Bedroom	18.5	17.2	1.3	6.9%	10.9	5.0	46%	5.0	46%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W5	LKD	20.1	19.1	1.0	4.9%													
		W6		20.2	19.3	1.0	4.8%													
		W7		22.7	20.5	2.2	9.7%	41.8	37.8	90%	36.2	87%	1.6	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W8	Bedroom	22.5	20.3	2.3	10.0%	13.6	12.0	88%	11.5	84%	0.5	4.5%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R7	W9	Bedroom	22.4	20.1	2.4	10.5%	15.1	12.8	84%	11.6	76%	1.2	9.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W10	LKD	21.9	20.0	2.0	9.0%													
		W11		32.7	31.9	0.9	2.6%	24.2	23.6	97%	22.3	92%	1.3	5.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	13.7	13.4	0.2	1.7%													
		W1-U						34.9	18.8	54%	18.8	54%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Fourth	R2	W2	Bedroom	14.4	14.0	0.4	2.7%	13.5	7.6	56%	7.6	56%	0.0	0.1%	21	7	21	7	0.0%	0.0%
Fourth	R3	W3	Bedroom	15.3	14.7	0.6	3.8%	14.9	11.1	74%	11.1	74%	0.0	0.1%	25	9	25	9	0.0%	0.0%
Fourth	R4	W4	Bedroom	19.4	18.1	1.2	6.3%	10.9	5.5	50%	5.5	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W5	LKD	20.9	19.9	0.9	4.5%													
		W6		21.1	20.2	0.9	4.5%													
		W7		23.7	21.5	2.2	9.3%	41.8	38.0	91%	36.5	87%	1.4	3.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W8	Bedroom	23.7	21.3	2.3	9.8%	13.6	12.1	89%	11.7	86%	0.4	3.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W9	Bedroom	23.7	21.2	2.5	10.4%	15.1	12.9	85%	11.7	77%	1.2	9.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W10	LKD	23.4	21.2	2.2	9.4%													
		W11		33.6	32.6	1.0	3.1%	24.2	23.8	98%	22.5	93%	1.3	5.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	14.6	14.4	0.3	1.8%													
		W1-U						34.9	18.7	54%	18.7	54%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Fifth	R2	W2	Bedroom	15.4	15.0	0.4	2.9%	13.5	7.9	59%	7.9	59%	0.0	0.2%	22	7	22	7	0.0%	0.0%
Fifth	R3	W3	Bedroom	16.4	15.8	0.5	3.3%	14.9	11.4	76%	11.4	76%	0.0	0.0%	27	9	27	9	0.0%	0.0%
Fifth	R4	W4	Bedroom	20.3	19.1	1.1	5.6%	10.9	5.9	54%	5.9	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W5	LKD	21.7	20.8	0.9	4.1%													
		W6		22.0	21.1	0.9	4.2%													
		W7		24.9	22.7	2.2	8.9%	41.8	38.1	91%	36.9	88%	1.2	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W8	Bedroom	24.8	22.5	2.3	9.4%	13.6	12.2	90%	12.0	88%	0.3	2.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W9	Bedroom	24.8	22.3	2.5	10.0%	15.1	13.0	86%	11.8	78%	1.2	8.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W10	LKD	24.7	22.4	2.3	9.1%													
		W11		34.3	33.2	1.1	3.2%	24.2	23.8	99%	22.7	94%	1.1	4.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	15.6	15.3	0.3	1.9%													
		W1-U						34.9	18.7	54%	18.7	54%	0.0	0.0%	24	10	24	10	0.0%	0.0%
Sixth	R2	W2	Bedroom	16.3	15.9	0.5	2.9%	13.5	8.2	60%	8.1	60%	0.0	0.2%	22	7	22	7	0.0%	0.0%
Sixth	R3	W3	Bedroom	17.2	16.7	0.5	3.0%	14.9	11.6	77%	11.6	77%	0.0	0.0%	28	9	28	9	0.0%	0.0%
Sixth	R4	W4	Bedroom	20.8	19.8	1.0	4.9%	10.9	6.3	58%	6.3	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W5	LKD	22.3	21.5	0.8	3.5%													
		W6		22.6	21.7	0.9	3.8%													
		W7		25.7	23.5	2.2	8.4%	41.8	38.3	92%	37.2	89%	1.1	3.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R6	W8	Bedroom	25.7	23.4	2.3	9.0%	13.6	12.4	91%	12.2	90%	0.2	1.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W9	Bedroom	25.7	23.2	2.5	9.6%	15.1	13.1	87%	12.0	79%	1.1	8.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W10	LKD	25.6	23.3	2.3	9.0%													
		W11		34.6	33.4	1.2	3.4%	24.2	23.8	98%	22.9	95%	0.9	3.6%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W1-L	LKD	9.3	9.3	0.0	0.0%													
		W1-U						36.5	18.2	50%	18.2	50%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Seventh	R8	W2-L	Bedroom	10.7	10.7	0.0	0.0%													
		W2-U						11.7	6.6	57%	6.6	57%	0.0	0.0%	11	0	11	0	0.0%	0.0%
Seventh	R9	W3-L	Bedroom	10.6	9.6	1.0	9.0%													
		W3-U						15.1	4.8	32%	4.8	32%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R10	W4-L	LKD	12.1	11.4	0.7	5.7%													
		W4-U																		
		W5-L		14.0	13.3	0.7	4.9%													
		W5-U																		
		W6-L		15.1	14.5	0.5	3.6%													
		W6-U						35.8	31.2	87%	29.3	82%	1.9	5.9%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R11	W7-L	Bedroom	14.8	14.8	0.0	0.0%													
		W7-U						10.3	7.5	73%	7.5	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R12	W8-L	Bedroom	14.2	14.2	0.0	0.0%													
		W8-U						10.9	9.7	89%	9.7	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W1-L	LKD	3.4	3.4	0.0	0.0%													
		W1-U						36.5	16.6	45%	16.6	45%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Eighth	R8	W2-L	Bedroom	4.4	4.4	0.0	0.0%													
		W2-U						11.7	5.8	50%	5.8	50%	0.0	0.1%	4	0	4	0	0.0%	0.0%
Eighth	R9	W3-L	Bedroom	5.0	4.1	0.9	17.3%													
		W3-U						15.1	4.3	29%	4.3	29%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W4-L	LKD	6.3	5.7	0.6	9.6%													
		W4-U																		
		W5-L		6.8	6.2	0.6	8.6%													
		W5-U																		
		W6-L		6.7	6.2	0.5	7.5%													
		W6-U						35.8	30.3	85%	27.7	77%	2.7	8.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W7-L	Bedroom	6.9	6.9	0.0	0.0%													
		W7-U						10.3	6.8	65%	6.8	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R12	W8-L	Bedroom	6.2	6.2	0.0	0.0%													
		W8-U						10.9	8.9	81%	8.8	81%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1-L	LKD	22.2	22.0	0.3	1.1%													
		W1-U						38.5	22.6	59%	22.6	59%	0.0	0.0%	37	10	37	10	0.0%	0.0%
Ninth	R2	W2-L	Bedroom	22.5	22.1	0.4	1.8%													
		W2-U						11.4	9.9	87%	9.9	87%	0.0	0.0%	38	9	38	9	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ninth	R3	W3-L	LKD	22.8	22.4	0.4	1.8%												
		W3-U																	
		W4-L		24.4	23.5	0.9	3.9%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	42	12	42	12	0.0%	0.0%
Ninth	R4	W5-L	Bedroom	25.7	24.9	0.8	3.0%												
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W6-L	LKD	26.6	25.8	0.7	2.7%												
		W6-U																	
		W7-L		4.6	2.6	2.0	44.3%												
		W7-U																	
		W8-L		4.6	4.5	0.1	1.3%												
		W8-U						28.7	28.0	98%	27.9	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9-L	Bedroom	3.5	3.3	0.2	4.9%												
		W9-U																	
		W10-L		30.3	28.2	2.2	7.1%												
		W10-U						15.1	13.9	92%	13.9	92%	0.0	0.3%	4	0	3	0	25.0%	0.0%
Ninth	R7	W11-L	LKD	30.4	28.0	2.4	7.9%												
		W11-U																	
		W12-L		30.4	28.0	2.4	7.8%												
		W12-U																	
		W13-L		11.5	11.5	0.0	0.0%												
		W13-U						39.2	38.1	97%	37.9	97%	0.2	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%												
		W14-U																	
		W15-L		37.6	36.4	1.2	3.2%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1-L	LKD	25.3	25.1	0.2	0.9%												
		W1-U						38.5	27.0	70%	27.0	70%	0.0	0.0%	43	12	43	12	0.0%	0.0%
Tenth	R2	W2-L	Bedroom	25.1	24.7	0.4	1.4%												
		W2-U						11.4	10.4	91%	10.4	91%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Tenth	R3	W3-L	LKD	25.0	24.7	0.4	1.5%												
		W3-U																	
		W4-L		25.6	24.7	0.9	3.6%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	44	14	44	14	0.0%	0.0%
Tenth	R4	W5-L	Bedroom	26.9	26.1	0.8	2.9%												
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W6-L	LKD	27.8	27.1	0.7	2.6%												
		W6-U																	
		W7-L		5.1	3.1	2.1	40.3%												
		W7-U																	
		W8-L		5.4	5.3	0.1	2.0%												
		W8-U						28.7	28.0	98%	27.9	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9-L	Bedroom	3.8	3.6	0.2	5.1%												
		W9-U																	
		W10-L		31.8	29.6	2.1	6.7%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	13.9	92%	13.9	92%	0.0	0.2%	4	0	3	0	25.0%	0.0%
Tenth	R7	W11-L	LKD	31.9	29.5	2.4	7.4%													
		W11-U																		
		W12-L		31.9	29.5	2.4	7.4%													
		W12-U																		
		W13-L		11.7	11.7	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.2	98%	0.2	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		38.1	36.8	1.3	3.4%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1-L	LKD	28.3	28.1	0.2	0.8%													
		W1-U						38.5	31.0	81%	31.0	81%	0.0	0.0%	48	15	48	15	0.0%	0.0%
Eleventh	R2	W2-L	Bedroom	27.7	27.4	0.3	1.2%													
		W2-U						11.4	10.4	91%	10.4	91%	0.0	0.0%	45	14	45	14	0.0%	0.0%
Eleventh	R3	W3-L	LKD	27.3	26.9	0.4	1.3%													
		W3-U																		
		W4-L		26.9	26.0	0.9	3.3%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	45	15	45	15	0.0%	0.0%
Eleventh	R4	W5-L	Bedroom	28.1	27.3	0.8	2.8%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W6-L	LKD	29.1	28.3	0.8	2.7%													
		W6-U																		
		W7-L		5.6	3.6	2.0	36.0%													
		W7-U																		
		W8-L		6.2	6.0	0.2	3.9%													
		W8-U						28.7	28.0	98%	27.9	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9-L	Bedroom	4.0	3.8	0.3	6.2%													
		W9-U																		
		W10-L		33.2	31.0	2.2	6.6%													
		W10-U						15.1	14.0	93%	14.0	92%	0.0	0.1%	4	0	3	0	25.0%	0.0%
Eleventh	R7	W11-L	LKD	33.3	30.8	2.5	7.4%													
		W11-U																		
		W12-L		33.3	30.8	2.5	7.4%													
		W12-U																		
		W13-L		11.8	11.8	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.3	98%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		38.5	37.1	1.3	3.5%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1-L	LKD	31.0	30.8	0.2	0.7%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	49	17	49	17	0.0%	0.0%
Twelfth	R2	W2-L	Bedroom	30.0	29.7	0.3	1.0%													
		W2-U						11.4	10.4	92%	10.4	92%	0.0	0.0%	47	17	47	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twelfth	R3	W3-L	LKD	29.2	28.8	0.3	1.1%													
		W3-U																		
		W4-L		27.9	27.0	0.8	3.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	46	17	46	17	0.0%	0.0%
Twelfth	R4	W5-L	Bedroom	29.1	28.3	0.8	2.7%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W6-L	LKD	30.2	29.3	0.9	2.9%													
		W6-U																		
		W7-L		5.6	3.6	2.0	35.3%													
		W7-U																		
		W8-L		6.5	6.1	0.4	6.0%													
		W8-U						28.7	28.0	98%	27.9	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9-L	Bedroom	4.0	3.7	0.3	8.1%													
		W9-U																		
		W10-L		34.3	32.0	2.3	6.8%													
		W10-U						15.1	14.1	93%	14.1	93%	0.0	0.1%	4	0	3	0	25.0%	0.0%
Twelfth	R7	W11-L	LKD	34.4	31.8	2.6	7.5%													
		W11-U																		
		W12-L		34.4	31.8	2.6	7.6%													
		W12-U																		
		W13-L		11.2	11.2	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.3	98%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W14-L	Bedroom	2.5	2.5	0.0	0.0%													
		W14-U																		
		W15-L		38.5	37.2	1.4	3.6%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1-L	LKD	33.2	33.0	0.2	0.6%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Thirteenth	R2	W2-L	Bedroom	32.0	31.8	0.3	0.9%													
		W2-U						11.4	10.7	94%	10.7	94%	0.0	0.0%	50	18	50	18	0.0%	0.0%
Thirteenth	R3	W3-L	LKD	31.0	30.7	0.3	1.0%													
		W3-U																		
		W4-L		29.6	28.7	0.8	2.8%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	50	19	50	19	0.0%	0.0%
Thirteenth	R4	W5-L	Bedroom	30.8	30.0	0.8	2.6%													
		W5-U						11.6	8.9	77%	8.9	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W6-L	LKD	32.0	31.0	1.0	3.0%													
		W6-U																		
		W7-L		6.5	4.6	1.9	28.9%													
		W7-U																		
		W8-L		7.9	7.3	0.5	6.9%													
		W8-U						28.7	28.0	98%	27.9	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W9-L	Bedroom	4.5	4.2	0.4	8.6%													
		W9-U																		
		W10-L		35.9	33.5	2.4	6.7%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.2	94%	14.2	94%	0.0	0.0%	4	0	3	0	25.0%	0.0%
Thirteenth	R7	W11-L	LKD	36.0	33.4	2.6	7.3%													
		W11-U																		
		W12-L		36.0	33.3	2.6	7.3%													
		W12-U																		
		W13-L		12.0	12.0	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.3	98%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.1	37.8	1.4	3.5%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1-L	LKD	34.0	33.9	0.2	0.5%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	53	19	53	19	0.0%	0.0%
Fourteenth	R2	W2-L	Bedroom	32.9	32.6	0.3	0.8%													
		W2-U						11.4	10.9	96%	10.9	96%	0.0	0.0%	51	19	51	19	0.0%	0.0%
Fourteenth	R3	W3-L	LKD	31.8	31.5	0.3	0.8%													
		W3-U																		
		W4-L		30.7	29.9	0.8	2.5%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	49	19	49	19	0.0%	0.0%
Fourteenth	R4	W5-L	Bedroom	31.9	31.2	0.8	2.4%													
		W5-U						11.6	9.0	77%	9.0	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W6-L	LKD	33.1	32.1	1.0	2.9%													
		W6-U																		
		W7-L		6.8	5.1	1.8	26.2%													
		W7-U																		
		W8-L		8.4	7.8	0.6	7.2%													
		W8-U						28.7	28.0	98%	27.9	97%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W9-L	Bedroom	4.7	4.3	0.4	8.7%													
		W9-U																		
		W10-L		36.8	34.5	2.4	6.5%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	4	0	3	0	25.0%	0.0%
Fourteenth	R7	W11-L	LKD	36.9	34.3	2.6	7.0%													
		W11-U																		
		W12-L		36.9	34.3	2.6	7.0%													
		W12-U																		
		W13-L		12.0	12.0	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.3	98%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.2	37.9	1.3	3.3%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R1	W1-L	LKD	34.8	34.6	0.1	0.4%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	53	18	53	18	0.0%	0.0%
Fifteenth	R2	W2-L	Bedroom	33.7	33.5	0.2	0.7%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	19	50	19	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifteenth	R3	W3-L	LKD	32.7	32.4	0.2	0.7%												
		W3-U																	
		W4-L		31.7	31.0	0.7	2.1%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	18	48	18	0.0%	0.0%
Fifteenth	R4	W5-L	Bedroom	32.8	32.2	0.7	2.1%												
		W5-U						11.6	9.1	78%	9.1	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W6-L	LKD	33.9	33.1	0.8	2.5%												
		W6-U																	
		W7-L		7.2	5.5	1.7	24.1%												
		W7-U																	
		W8-L		8.5	8.0	0.5	6.0%												
		W8-U						28.7	28.0	98%	27.9	97%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R6	W9-L	Bedroom	4.7	4.3	0.4	7.5%												
		W9-U																	
		W10-L		37.4	35.2	2.2	5.8%												
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fifteenth	R7	W11-L	LKD	37.4	35.1	2.4	6.3%												
		W11-U																	
		W12-L		37.4	35.1	2.4	6.3%												
		W12-U																	
		W13-L		12.1	12.1	0.0	0.0%												
		W13-U						39.2	38.4	98%	38.3	98%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.2	38.0	1.2	3.1%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R1	W1-L	LKD	35.6	35.5	0.1	0.3%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	54	20	54	20	0.0%	0.0%
Sixteenth	R2	W2-L	Bedroom	34.7	34.5	0.2	0.5%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	19	50	19	0.0%	0.0%
Sixteenth	R3	W3-L	LKD	33.7	33.5	0.2	0.6%												
		W3-U																	
		W4-L		32.9	32.3	0.6	1.8%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	18	48	18	0.0%	0.0%
Sixteenth	R4	W5-L	Bedroom	33.9	33.3	0.6	1.7%												
		W5-U						11.6	9.4	81%	9.4	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W6-L	LKD	34.9	34.1	0.7	2.1%												
		W6-U																	
		W7-L		7.5	5.9	1.7	22.0%												
		W7-U																	
		W8-L		8.7	8.2	0.4	5.1%												
		W8-U						28.7	28.0	98%	27.9	97%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R6	W9-L	Bedroom	4.7	4.4	0.3	6.4%												
		W9-U																	
		W10-L		37.9	35.9	2.0	5.3%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Sixteenth	R7	W11-L	LKD	38.0	35.8	2.1	5.6%													
		W11-U																		
		W12-L		38.0	35.8	2.2	5.7%													
		W12-U																		
		W13-L		12.1	12.1	0.0	0.0%													
		W13-U						39.2	38.5	98%	38.4	98%	0.2	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.3	38.1	1.1	2.9%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R1	W1-L	LKD	36.4	36.3	0.1	0.3%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Seventeenth	R2	W2-L	Bedroom	35.7	35.5	0.1	0.4%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Seventeenth	R3	W3-L	LKD	34.9	34.8	0.2	0.5%													
		W3-U																		
		W4-L		34.2	33.8	0.5	1.4%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	47	17	47	17	0.0%	0.0%
Seventeenth	R4	W5-L	Bedroom	35.1	34.6	0.5	1.4%													
		W5-U						11.6	10.0	86%	10.0	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W6-L	LKD	35.9	35.3	0.6	1.8%													
		W6-U																		
		W7-L		7.8	6.2	1.6	20.2%													
		W7-U																		
		W8-L		8.8	8.5	0.4	4.0%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R6	W9-L	Bedroom	4.7	4.5	0.2	5.1%													
		W9-U																		
		W10-L		38.4	36.6	1.8	4.7%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Seventeenth	R7	W11-L	LKD	38.4	36.5	1.9	5.0%													
		W11-U																		
		W12-L		38.5	36.6	1.9	5.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.4	98%	0.2	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.3	38.2	1.1	2.7%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R1	W1-L	LKD	37.0	37.0	0.1	0.2%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	51	17	51	17	0.0%	0.0%
Eighteenth	R2	W2-L	Bedroom	36.5	36.4	0.1	0.3%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	17	50	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighteenth	R3	W3-L	LKD	36.0	35.9	0.1	0.3%													
		W3-U																		
		W4-L		35.5	35.1	0.4	1.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	17	48	17	0.0%	0.0%
Eighteenth	R4	W5-L	Bedroom	36.1	35.7	0.4	1.1%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R5	W6-L	LKD	36.7	36.2	0.5	1.4%													
		W6-U																		
		W7-L		7.5	6.0	1.5	19.9%													
		W7-U																		
		W8-L		8.4	8.1	0.3	3.3%													
		W8-U						28.7	28.1	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R6	W9-L	Bedroom	4.4	4.2	0.2	4.3%													
		W9-U																		
		W10-L		38.5	37.0	1.6	4.1%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighteenth	R7	W11-L	LKD	38.6	36.9	1.7	4.4%													
		W11-U																		
		W12-L		38.7	37.0	1.7	4.4%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.5	98%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R8	W14-L	Bedroom	2.5	2.5	0.0	0.0%													
		W14-U																		
		W15-L		39.0	38.1	1.0	2.5%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R1	W1-L	LKD	38.4	38.3	0.1	0.2%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Nineteenth	R2	W2-L	Bedroom	38.1	38.0	0.1	0.2%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Nineteenth	R3	W3-L	LKD	37.8	37.7	0.1	0.2%													
		W3-U																		
		W4-L		37.5	37.2	0.3	0.8%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Nineteenth	R4	W5-L	Bedroom	37.9	37.6	0.3	0.8%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R5	W6-L	LKD	38.2	37.8	0.4	1.1%													
		W6-U																		
		W7-L		8.2	6.8	1.4	16.9%													
		W7-U																		
		W8-L		9.0	8.8	0.2	2.2%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R6	W9-L	Bedroom	4.7	4.6	0.1	2.8%													
		W9-U																		
		W10-L		39.3	37.9	1.4	3.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Nineteenth	R7	W11-L	LKD	39.3	37.8	1.5	3.8%													
		W11-U																		
		W12-L		39.4	37.9	1.5	3.8%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.5	98%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	38.6	0.9	2.2%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R1	W1-L	LKD	39.2	39.0	0.1	0.4%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twentieth	R2	W2-L	Bedroom	39.1	39.0	0.1	0.4%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twentieth	R3	W3-L	LKD	39.0	38.9	0.1	0.3%													
		W3-U																		
		W4-L		39.0	38.7	0.3	0.8%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twentieth	R4	W5-L	Bedroom	39.1	38.8	0.3	0.8%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R5	W6-L	LKD	39.2	38.8	0.4	1.0%													
		W6-U																		
		W7-L		8.2	7.0	1.3	15.3%													
		W7-U																		
		W8-L		9.0	8.8	0.1	1.4%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W9-L	Bedroom	4.7	4.6	0.1	1.9%													
		W9-U																		
		W10-L		39.4	38.2	1.2	3.1%													
		W10-U						15.1	14.3	95%	14.3	94%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twentieth	R7	W11-L	LKD	39.4	38.1	1.3	3.3%													
		W11-U																		
		W12-L		39.4	38.1	1.3	3.3%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.5	98%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	38.6	0.8	2.1%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R1	W1-L	LKD	39.4	39.3	0.2	0.4%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-First	R2	W2-L	Bedroom	39.5	39.3	0.2	0.5%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twenty-First	R3	W3-L	LKD	39.4	39.3	0.2	0.5%													
		W3-U																		
		W4-L		39.5	39.2	0.3	0.8%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Twenty-First	R4	W5-L	Bedroom	39.5	39.2	0.3	0.7%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R5	W6-L	LKD	39.5	39.2	0.3	0.8%													
		W6-U																		
		W7-L		8.2	7.1	1.1	13.8%													
		W7-U																		
		W8-L		9.0	8.9	0.1	0.6%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W9-L	Bedroom	4.7	4.7	0.0	0.9%													
		W9-U																		
		W10-L		39.5	38.4	1.0	2.6%													
		W10-U						15.1	14.3	95%	14.3	94%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-First	R7	W11-L	LKD	39.5	38.4	1.1	2.8%													
		W11-U																		
		W12-L		39.5	38.4	1.1	2.8%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.5	98%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	38.7	0.7	1.9%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R1	W1-L	LKD	39.4	39.4	0.0	0.1%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twenty-Secc	R2	W2-L	Bedroom	39.4	39.4	0.1	0.1%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Twenty-Secc	R3	W3-L	LKD	39.4	39.4	0.0	0.1%													
		W3-U																		
		W4-L		39.5	39.3	0.1	0.3%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Twenty-Secc	R4	W5-L	Bedroom	39.5	39.3	0.1	0.3%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R5	W6-L	LKD	39.5	39.3	0.1	0.3%													
		W6-U																		
		W7-L		8.2	7.2	1.0	12.2%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	38.6	0.8	2.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						15.1	14.3	95%	14.3	94%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Secc	R7	W11-L	LKD	39.4	38.5	0.9	2.3%												
		W11-U																	
		W12-L		39.4	38.5	0.9	2.3%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	98%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	38.8	0.6	1.6%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R1	W1-L	LKD	39.4	39.4	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Twenty-Thir	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Twenty-Thir	R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.4	39.4	0.0	0.1%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%
Twenty-Thir	R4	W5-L	Bedroom	39.4	39.4	0.0	0.1%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R5	W6-L	LKD	39.4	39.4	0.1	0.2%												
		W6-U																	
		W7-L		8.2	7.3	0.9	10.7%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.4	38.7	0.7	1.8%												
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Thir	R7	W11-L	LKD	39.4	38.6	0.8	1.9%												
		W11-U																	
		W12-L		39.4	38.6	0.8	2.0%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	38.8	0.6	1.4%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R1	W1-L	LKD	39.0	39.0	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Twenty-Four	R2	W2-L	Bedroom	39.1	39.1	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	52	17	52	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-Four	R3	W3-L	LKD	39.1	39.1	0.0	0.0%												
		W3-U																	
		W4-L		39.1	39.1	0.0	0.1%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Twenty-Four	R4	W5-L	Bedroom	39.1	39.0	0.0	0.1%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R5	W6-L	LKD	39.1	39.0	0.0	0.1%												
		W6-U																	
		W7-L		7.6	6.9	0.8	9.9%												
		W7-U																	
		W8-L		8.4	8.4	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R6	W9-L	Bedroom	4.4	4.4	0.0	0.0%												
		W9-U																	
		W10-L		39.1	38.5	0.6	1.5%												
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Twenty-Four	R7	W11-L	LKD	39.0	38.4	0.6	1.7%												
		W11-U																	
		W12-L		39.1	38.4	0.7	1.7%												
		W12-U																	
		W13-L		11.5	11.5	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	98%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%												
		W14-U																	
		W15-L		39.0	38.5	0.5	1.3%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Fifth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Fifth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%												
		W3-U																	
		W4-L		39.5	39.5	0.0	0.1%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Fifth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.1%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R5	W6-L	LKD	39.5	39.5	0.0	0.1%												
		W6-U																	
		W7-L		8.2	7.6	0.7	7.9%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.5	39.0	0.5	1.3%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Fifth	R7	W11-L	LKD	39.5	38.9	0.5	1.4%												
		W11-U																	
		W12-L		39.5	38.9	0.6	1.4%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.5	39.0	0.4	1.1%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Sixth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Sixth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%												
		W3-U																	
		W4-L		39.5	39.5	0.0	0.1%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twenty-Sixth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.1%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R5	W6-L	LKD	39.5	39.5	0.0	0.1%												
		W6-U																	
		W7-L		8.2	7.7	0.6	6.7%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.5	39.0	0.4	1.1%												
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Sixth	R7	W11-L	LKD	39.5	39.0	0.5	1.2%												
		W11-U																	
		W12-L		39.5	39.0	0.5	1.2%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.5	39.1	0.4	0.9%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R1	W1-L	LKD	39.4	39.4	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Seve	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Seve	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.1%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Twenty-Seve	R4	W5-L	Bedroom	39.5	39.5	0.0	0.1%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R5	W6-L	LKD	39.5	39.4	0.0	0.1%													
		W6-U																		
		W7-L		8.2	7.8	0.5	5.5%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.1	0.4	0.9%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Seve	R7	W11-L	LKD	39.5	39.1	0.4	1.0%													
		W11-U																		
		W12-L		39.5	39.1	0.4	1.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.1	0.3	0.7%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twenty-Eigh	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Twenty-Eigh	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.4	0.0	0.1%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Twenty-Eigh	R4	W5-L	Bedroom	39.5	39.4	0.0	0.1%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R5	W6-L	LKD	39.5	39.4	0.0	0.1%													
		W6-U																		
		W7-L		8.2	7.9	0.4	4.3%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	39.2	0.3	0.7%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
	Twenty-Eigh R7	W11-L	LKD	39.4	39.1	0.3	0.8%												
		W11-U																	
		W12-L		39.4	39.1	0.3	0.8%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Eigh R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.2	0.2	0.6%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Nint R1	W1-L	LKD	39.4	39.4	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	54	18	54	18	0.0%	0.0%
	Twenty-Nint R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	54	18	54	18	0.0%	0.0%
	Twenty-Nint R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.4	39.4	0.0	0.0%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%
	Twenty-Nint R4	W5-L	Bedroom	39.4	39.4	0.0	0.0%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Nint R5	W6-L	LKD	39.4	39.4	0.0	0.1%												
		W6-U																	
		W7-L		8.2	8.0	0.3	3.2%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Nint R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.4	39.2	0.2	0.5%												
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
	Twenty-Nint R7	W11-L	LKD	39.4	39.1	0.2	0.6%												
		W11-U																	
		W12-L		39.4	39.2	0.2	0.6%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Nint R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.2	0.2	0.4%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Thirtieth R1	W1-L	LKD	39.0	39.0	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	17	52	17	0.0%	0.0%
	Thirtieth R2	W2-L	Bedroom	39.1	39.1	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	52	17	52	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirtieth	R3	W3-L	LKD	39.1	39.1	0.0	0.0%													
		W3-U																		
		W4-L		39.1	39.1	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Thirtieth	R4	W5-L	Bedroom	39.1	39.0	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R5	W6-L	LKD	39.1	39.1	0.0	0.0%													
		W6-U																		
		W7-L		7.6	7.5	0.2	2.4%													
		W7-U																		
		W8-L		8.4	8.4	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R6	W9-L	Bedroom	4.4	4.4	0.0	0.0%													
		W9-U																		
		W10-L		39.1	38.9	0.1	0.4%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Thirtieth	R7	W11-L	LKD	39.0	38.9	0.1	0.4%													
		W11-U																		
		W12-L		39.1	38.9	0.2	0.4%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.0	38.9	0.1	0.3%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-First	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-First	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-First	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.1	0.1	1.2%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.4	0.1	0.2%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-First	R7	W11-L	LKD	39.5	39.4	0.1	0.2%													
		W11-U																		
		W12-L		39.5	39.4	0.1	0.2%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.4	0.1	0.2%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Secon	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Secon	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Secon	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.4%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.1%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Secon	R7	W11-L	LKD	39.5	39.5	0.0	0.1%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.1%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.4	0.0	0.1%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Third	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirty-Third	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Thirty-Third	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Third	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Fourth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Thirty-Fourth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Thirty-Fourth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Fourth	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Thirty-Fifth	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Thirty-Fifth	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Thirty-Fifth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	39.4	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Fifth	R7	W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R1	W1-L	Bedroom	19.3	19.3	0.0	0.0%													
		W1-U																		
		W2-L		39.4	39.4	0.0	0.0%													
		W2-U						18.4	18.4	100%	18.4	100%	0.0	0.0%	69	20	69	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Thirty-Sixth	R2	W3-L	Bedroom	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		16.8	16.8	0.0	0.0%													
		W4-U						15.3	15.3	100%	15.3	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Thirty-Sixth	R3	W5-L	LKD	18.5	18.5	0.0	0.0%													
		W5-U																		
		W6-L		23.0	23.0	0.0	0.0%													
		W6-U						35.4	33.0	93%	33.0	93%	0.0	0.0%	33	7	33	7	0.0%	0.0%
Thirty-Sixth	R4	W7-L	LKD	39.4	39.4	0.0	0.0%													
		W7-U																		
		W8-L		39.4	39.4	0.0	0.0%													
		W8-U																		
		W9-L		22.0	22.0	0.0	0.0%													
		W9-U																		
		W10-L		15.6	15.6	0.0	0.0%													
		W10-U						40.4	40.2	100%	40.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R5	W11-L	Bedroom	10.8	10.8	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U						14.8	14.6	99%	14.6	99%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Sixth	R6	W13-L	Bedroom	39.4	39.4	0.0	0.0%													
		W13-U																		
		W14-L		19.0	19.0	0.0	0.0%													
		W14-U						15.9	15.8	100%	15.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R7	W15-L	LKD	17.1	17.1	0.0	0.0%													
		W15-U																		
		W16-L		39.4	39.4	0.0	0.0%													
		W16-U						20.9	20.5	98%	20.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Mezzanine	R1	W1-L	Residential	10.9	10.7	0.2	1.5%													
		W1-U																		
		W2-L		11.1	10.8	0.3	2.7%													
		W2-U						56.8	48.3	85%	48.2	85%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Mezzanine	R2	W3-L	Residential	11.9	11.3	0.5	4.5%													
		W3-U																		
		W4-L		14.9	13.7	1.2	8.0%													
		W4-U																		
		W5-L		17.0	16.2	0.9	5.2%													
		W5-U																		
		W6-L		17.3	16.5	0.9	5.0%													
		W6-U																		
		W7-L		18.6	17.0	1.6	8.4%													
		W7-U																		
		W8-L		18.1	16.5	1.6	8.7%													
		W8-U																		
		W9-L		17.8	16.3	1.5	8.2%													
		W9-U																		
		W10-L		20.5	20.1	0.3	1.7%													
		W10-U																		
		W11-L		20.6	20.4	0.2	1.2%													
		W11-U						152.1	151.9	100%	151.9	100%	0.0	0.0%	52	15	51	15	1.9%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ferry Island Building 2																			
First	R1	W1-L	LKD	13.2	13.2	0.0	0.0%												
		W1-U																	
		W2-L		16.7	16.7	0.0	0.0%												
		W2-U																	
		W3		23.3	22.9	0.3	1.5%	33.5	23.6	70%	23.6	70%	0.0	0.0%	40	18	40	18	0.0%	0.0%
First	R2	W4	Bedroom	22.0	21.7	0.4	1.7%	12.4	9.5	77%	9.3	75%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	LKD	8.2	8.0	0.2	2.0%												
		W5-U						32.4	20.6	64%	20.6	63%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W6	Bedroom	16.8	16.1	0.7	4.0%	12.4	6.2	50%	5.5	45%	0.6	10.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7	LKD	16.4	15.6	0.8	4.8%												
		W8-L		7.3	7.0	0.3	4.0%												
		W8-U						35.2	14.1	40%	13.1	37%	1.0	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W9	Bedroom	11.4	10.5	0.9	7.7%	12.2	4.7	38%	3.9	32%	0.8	17.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10	Bedroom	13.3	12.4	0.9	6.6%	11.5	6.0	52%	5.1	45%	0.9	14.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W11-L	Studio	3.3	3.2	0.1	2.7%												
		W11-U						29.1	5.5	19%	5.5	19%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W12	LKD	9.0	8.3	0.7	7.4%												
		W13-L		1.3	1.1	0.2	11.7%												
		W13-U						35.1	6.8	19%	5.5	16%	1.3	18.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R10	W14	Bedroom	5.4	4.8	0.6	11.4%	11.3	2.1	18%	1.6	15%	0.4	20.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W15	Bedroom	6.4	5.8	0.6	9.6%	14.5	1.9	13%	1.7	12%	0.2	11.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R12	W16	Bedroom	6.6	6.0	0.7	10.4%	10.0	1.1	11%	1.0	10%	0.2	15.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W17	Bedroom	7.0	6.3	0.7	9.6%												
		W18		7.8	7.2	0.7	8.6%	11.3	4.3	38%	3.8	34%	0.5	10.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W19	LKD	8.7	8.0	0.7	7.7%												
		W20-L		0.1	0.1	0.0	14.3%												
		W20-U																	
		W21-L		0.9	0.9	0.0	1.1%												
		W21-U																	
		W22-L		5.1	4.8	0.2	4.7%												
		W22-U						43.1	14.4	33%	12.9	30%	1.5	10.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	13.7	13.7	0.0	0.0%												
		W1-U																	
		W2-L		17.3	17.3	0.0	0.0%												
		W2-U																	
		W3		24.5	23.9	0.6	2.3%	33.5	23.6	70%	23.6	70%	0.0	0.1%	40	18	40	18	0.0%	0.0%
Second	R2	W4	Bedroom	23.3	22.6	0.6	2.8%	12.4	9.9	80%	9.4	76%	0.5	4.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	LKD	9.2	8.7	0.4	4.7%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U						32.4	21.6	67%	21.3	66%	0.3	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W6	Bedroom	18.2	17.3	0.9	5.1%	12.4	7.2	58%	6.1	49%	1.1	15.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7	LKD	17.8	16.8	1.0	5.7%													
		W8-L		8.3	7.7	0.6	7.5%													
		W8-U						35.2	16.1	46%	14.7	42%	1.4	8.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W9	Bedroom	12.9	11.8	1.2	9.0%	12.2	5.3	44%	4.2	34%	1.2	21.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10	Bedroom	14.9	13.6	1.3	8.5%	11.5	7.3	64%	6.0	52%	1.3	18.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W11-L	Studio	4.0	3.4	0.5	13.7%													
		W11-U						29.1	6.0	21%	5.7	19%	0.3	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W12	LKD	10.3	9.1	1.1	11.0%													
		W13-L		1.7	1.4	0.3	18.5%													
		W13-U						35.1	8.3	24%	6.1	17%	2.2	26.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W14	Bedroom	6.2	5.5	0.8	12.4%	11.3	2.5	22%	2.0	17%	0.6	22.7%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W15	Bedroom	7.2	6.4	0.8	10.7%	14.5	2.1	15%	1.9	13%	0.2	9.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R12	W16	Bedroom	7.4	6.6	0.8	10.7%	10.0	1.3	13%	1.1	11%	0.2	13.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W17	Bedroom	7.7	6.9	0.8	9.8%													
		W18		8.5	7.8	0.7	8.4%	11.3	4.6	40%	4.0	36%	0.5	11.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W19	LKD	9.3	8.6	0.7	7.6%													
		W20-L		0.1	0.1	0.0	12.5%													
		W20-U																		
		W21-L		0.9	0.9	0.0	1.1%													
		W21-U																		
		W22-L		5.4	5.2	0.3	4.6%													
		W22-U						43.1	15.1	35%	13.3	31%	1.8	11.8%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	13.8	13.8	0.0	0.0%													
		W1-U																		
		W2-L		17.4	17.4	0.0	0.0%													
		W2-U																		
		W3		25.6	24.7	0.8	3.3%	33.5	23.6	70%	23.6	70%	0.0	0.2%	40	18	40	18	0.0%	0.0%
Third	R2	W4	Bedroom	24.4	23.4	1.0	4.0%	12.4	10.0	81%	9.5	77%	0.6	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	LKD	9.9	9.1	0.9	8.8%													
		W5-U						32.4	22.7	70%	21.6	67%	1.1	4.9%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W6	Bedroom	19.6	18.2	1.4	7.2%	12.4	8.5	69%	6.6	53%	1.9	22.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7	LKD	19.2	17.6	1.5	8.0%													
		W8-L		9.3	8.2	1.2	12.3%													
		W8-U						35.2	18.2	52%	15.8	45%	2.4	13.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W9	Bedroom	14.5	12.9	1.7	11.5%	12.2	6.5	53%	4.5	37%	2.0	30.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10	Bedroom	16.5	14.8	1.7	10.6%	11.5	8.0	69%	6.9	60%	1.1	13.5%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R8	W11-L	Studio	5.0	3.9	1.1	22.8%													
		W11-U						29.1	8.3	28%	7.0	24%	1.2	15.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W12	LKD	11.6	10.0	1.7	14.4%													
		W13-L		2.5	1.8	0.7	28.3%													
		W13-U						35.1	11.2	32%	7.3	21%	3.9	34.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W14	Bedroom	7.0	6.2	0.8	11.9%	11.3	3.1	27%	2.4	21%	0.7	21.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W15	Bedroom	8.1	7.2	0.9	11.6%	14.5	2.5	17%	2.4	16%	0.1	5.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R12	W16	Bedroom	8.2	7.3	0.9	10.8%	10.0	1.6	16%	1.4	14%	0.1	9.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W17	Bedroom	8.5	7.7	0.8	9.6%													
		W18		9.2	8.5	0.8	8.1%	11.3	4.9	43%	4.4	39%	0.5	10.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W19	LKD	10.0	9.3	0.7	7.3%													
		W20-L		0.1	0.1	0.0	0.0%													
		W20-U																		
		W21-L		1.0	0.9	0.0	1.1%													
		W21-U																		
		W22-L		5.8	5.6	0.3	4.3%													
		W22-U						43.1	15.6	36%	13.6	32%	2.0	12.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%													
		W1-U																		
		W2-L		17.3	17.3	0.0	0.0%													
		W2-U																		
		W3		26.7	25.6	1.1	4.2%	33.5	23.6	70%	23.6	70%	0.1	0.2%	39	18	39	18	0.0%	0.0%
Fourth	R2	W4	Bedroom	25.7	24.4	1.3	5.1%	12.4	10.1	81%	9.5	77%	0.5	5.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	LKD	10.7	9.4	1.4	12.6%													
		W5-U						32.4	24.0	74%	22.2	68%	1.9	7.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W6	Bedroom	21.2	19.3	1.9	9.0%	12.4	8.8	71%	7.2	58%	1.6	18.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7	LKD	20.7	18.6	2.1	10.3%													
		W8-L		10.5	8.6	1.9	18.2%													
		W8-U						35.2	22.6	64%	17.9	51%	4.7	20.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W9	Bedroom	16.3	13.8	2.5	15.0%	12.2	7.4	61%	4.7	38%	2.7	36.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10	Bedroom	18.3	15.7	2.6	14.1%	11.5	8.0	70%	7.0	61%	1.0	12.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W11-L	Studio	6.9	4.7	2.2	31.7%													
		W11-U						29.1	15.6	54%	11.8	41%	3.7	24.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W12	LKD	13.1	10.8	2.3	17.7%													
		W13-L		4.3	2.8	1.5	34.9%													
		W13-U						35.1	16.4	47%	9.9	28%	6.5	39.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W14	Bedroom	7.7	6.7	1.0	13.4%	11.3	3.5	31%	2.9	25%	0.6	17.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W15	Bedroom	9.1	7.9	1.1	12.5%	14.5	3.1	22%	3.0	21%	0.1	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R12	W16	Bedroom	9.2	8.2	1.0	10.7%	10.0	2.1	21%	2.0	20%	0.1	6.5%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R13	W17	Bedroom	9.4	8.5	0.9	9.4%													
		W18		10.1	9.3	0.8	7.8%	11.3	5.2	47%	4.8	43%	0.5	8.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W19	LKD	10.8	10.0	0.7	6.9%													
		W20-L		0.1	0.1	0.0	0.0%													
		W20-U																		
		W21-L		1.0	1.0	0.0	1.0%													
		W21-U																		
		W22-L		6.3	6.0	0.2	3.8%													
		W22-U						43.1	16.5	38%	14.1	33%	2.4	14.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%													
		W1-U																		
		W2-L		17.3	17.3	0.0	0.0%													
		W2-U																		
		W3		27.9	26.5	1.4	5.0%	33.5	23.6	70%	23.6	70%	0.0	0.1%	39	18	39	18	0.0%	0.0%
Fifth	R2	W4	Bedroom	27.0	25.4	1.6	6.0%	12.4	10.1	82%	9.6	77%	0.5	5.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	LKD	11.4	9.6	1.8	15.8%													
		W5-U						32.4	24.8	76%	22.7	70%	2.1	8.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W6	Bedroom	23.3	20.9	2.4	10.3%	12.4	8.8	71%	7.3	59%	1.6	17.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7	LKD	22.4	19.7	2.7	12.2%													
		W8-L		11.7	9.0	2.7	22.9%													
		W8-U						35.2	29.2	83%	22.2	63%	7.0	23.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W9	Bedroom	18.2	15.0	3.2	17.8%	12.2	7.5	62%	4.8	40%	2.7	35.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10	Bedroom	20.2	16.7	3.4	17.0%	11.5	8.1	70%	7.1	62%	1.0	11.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W11-L	Studio	7.5	4.7	2.8	37.3%													
		W11-U						29.1	22.0	76%	15.9	55%	6.2	27.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W12	LKD	14.5	11.6	3.0	20.3%													
		W13-L		4.7	2.7	2.0	41.8%													
		W13-U						35.1	26.7	76%	14.1	40%	12.6	47.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W14	Bedroom	8.5	7.2	1.2	14.4%	11.3	3.7	33%	3.2	28%	0.5	14.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W15	Bedroom	10.0	8.7	1.3	13.0%	14.5	3.8	26%	3.7	26%	0.1	1.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R12	W16	Bedroom	10.2	9.1	1.1	10.8%	10.0	3.0	30%	2.9	29%	0.1	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W17	Bedroom	10.4	9.4	1.0	9.3%													
		W18		10.9	10.1	0.8	7.6%	11.3	5.7	50%	5.3	47%	0.4	7.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W19	LKD	11.5	10.7	0.8	6.6%													
		W20-L		0.2	0.2	0.0	0.0%													
		W20-U																		
		W21-L		1.0	1.0	0.0	1.0%													
		W21-U																		
		W22-L		6.8	6.5	0.2	3.5%													
		W22-U						43.1	17.8	41%	15.2	35%	2.6	14.4%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%													
		W1-U																		
		W2-L		17.3	17.3	0.0	0.0%													
		W2-U																		
		W3		29.1	27.4	1.7	5.7%	33.5	23.6	70%	23.6	70%	0.0	0.1%	39	18	39	18	0.0%	0.0%
Sixth	R2	W4	Bedroom	28.3	26.3	1.9	6.8%	12.4	10.1	82%	9.6	78%	0.5	5.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W5-L	LKD	26.7	24.3	2.4	8.9%													
		W5-U						32.4	25.0	77%	23.0	71%	2.0	8.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W6	Bedroom	25.6	22.7	2.9	11.2%	12.4	8.9	72%	7.4	59%	1.5	17.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7	LKD	24.0	20.8	3.3	13.7%													
		W8-L		14.0	10.4	3.5	25.3%													
		W8-U						35.2	30.5	87%	24.5	70%	5.9	19.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W9	Bedroom	20.0	16.1	3.9	19.7%	12.2	7.6	63%	5.0	41%	2.7	34.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10	Bedroom	22.0	17.8	4.1	18.8%	11.5	8.3	72%	7.4	64%	0.9	10.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W11-L	Studio	9.7	6.1	3.6	36.9%													
		W11-U						29.1	23.9	82%	16.0	55%	7.9	32.9%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W12	LKD	15.8	12.5	3.4	21.3%													
		W13-L		6.3	3.8	2.6	40.4%													
		W13-U						35.1	29.8	85%	16.8	48%	13.0	43.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W14	Bedroom	8.9	7.5	1.4	16.0%	11.3	3.7	33%	3.3	29%	0.4	12.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W15	Bedroom	11.0	9.6	1.5	13.3%	14.5	3.9	27%	3.9	27%	0.0	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R12	W16	Bedroom	11.2	10.0	1.2	10.7%	10.0	3.5	35%	3.4	34%	0.1	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W17	Bedroom	11.4	10.3	1.0	9.1%													
		W18		11.8	10.9	0.9	7.3%	11.3	6.1	54%	5.7	51%	0.4	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W19	LKD	12.1	11.4	0.8	6.4%													
		W20-L		0.4	0.4	0.0	0.0%													
		W20-U																		
		W21-L		1.1	1.1	0.0	0.9%													
		W21-U																		
		W22-L		7.4	7.1	0.2	3.3%													
		W22-U						43.1	19.6	46%	17.0	39%	2.7	13.6%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	36.1	36.1	0.0	0.0%													
		W1-U																		
		W2-L		33.2	33.2	0.0	0.0%													
		W2-U																		
		W3		25.4	21.9	3.5	13.9%													
		W4-L		14.0	10.1	3.9	27.6%													
		W4-U						39.4	39.4	100%	38.8	98%	0.6	1.6%	72	26	72	26	0.0%	0.0%
Seventh	R2	W5	Bedroom	21.5	17.2	4.2	19.8%	12.3	7.8	64%	5.2	42%	2.6	33.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W6	Bedroom	23.4	19.0	4.4	18.9%	11.2	8.3	74%	7.6	68%	0.8	9.1%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Seventh	R4	W7-L	Studio	9.6	5.8	3.8	39.6%												
		W7-U						29.2	23.7	81%	15.8	54%	7.9	33.3%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8	LKD	17.0	13.5	3.5	20.5%												
		W9-L		6.3	3.6	2.7	42.3%												
		W9-U						34.2	29.9	87%	16.9	49%	13.0	43.6%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10	Bedroom	9.6	8.2	1.4	14.8%	11.1	3.6	33%	3.3	29%	0.4	9.9%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W11	Bedroom	12.0	10.5	1.5	12.7%	14.5	4.0	28%	4.0	28%	0.0	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W12	Bedroom	12.3	11.1	1.2	10.0%	10.1	3.7	36%	3.6	36%	0.1	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R9	W13	Bedroom	12.4	11.3	1.1	8.6%												
		W14		12.7	11.8	0.9	7.0%	11.2	6.5	58%	6.1	54%	0.4	6.6%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R10	W15	LKD	12.9	12.1	0.8	6.1%												
		W16-L		0.6	0.6	0.0	0.0%												
		W16-U																	
		W17-L		1.2	1.2	0.0	0.8%												
		W17-U																	
		W18-L		8.1	7.8	0.3	3.1%												
		W18-U						42.4	21.1	50%	18.8	44%	2.4	11.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1	LKD	37.0	37.0	0.0	0.0%												
		W2-L		38.7	38.7	0.0	0.0%												
		W2-U																	
		W3-L		38.5	38.5	0.0	0.0%												
		W3-U																	
		W4		26.4	22.9	3.5	13.2%	34.8	33.4	96%	31.7	91%	1.7	5.2%	87	30	87	30	0.0%	0.0%
Eighth	R2	W5-L	Bedroom	14.7	10.9	3.8	25.8%												
		W5-U						8.3	7.0	85%	5.8	70%	1.3	18.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W6	Bedroom	22.6	18.4	4.2	18.4%	11.8	7.7	65%	5.9	50%	1.9	24.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W7	Bedroom	24.5	20.2	4.3	17.5%	11.2	8.7	78%	8.2	73%	0.5	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W8-L	Studio	10.3	6.6	3.7	36.2%												
		W8-U						29.2	23.8	81%	15.9	55%	7.8	32.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W9	LKD	17.9	14.5	3.4	19.0%												
		W10-L		6.8	4.1	2.7	39.3%												
		W10-U						34.2	30.2	88%	17.4	51%	12.8	42.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W11	Bedroom	10.1	8.7	1.4	13.9%	11.1	3.6	33%	3.3	30%	0.3	7.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W12	Bedroom	12.8	11.3	1.5	11.6%	14.5	4.0	28%	4.0	28%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W13	Bedroom	13.1	11.9	1.2	9.2%	10.1	3.8	38%	3.8	37%	0.0	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W14	Bedroom	13.2	12.2	1.1	7.9%												
		W15		13.4	12.5	0.9	6.6%	11.2	6.9	62%	6.6	59%	0.4	5.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W16	LKD	13.6	12.8	0.8	5.8%												
		W17-L		0.7	0.7	0.0	0.0%												
		W17-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W18-L		1.3	1.3	0.0	0.8%													
		W18-U																		
		W19-L		8.8	8.5	0.3	2.8%													
		W19-U						42.4	21.6	51%	19.1	45%	2.5	11.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1	LKD	37.2	37.2	0.0	0.0%													
		W2-L		38.8	38.8	0.0	0.0%													
		W2-U																		
		W3-L		38.7	38.7	0.0	0.0%													
		W3-U																		
		W4		27.7	24.2	3.5	12.5%	34.8	33.4	96%	31.7	91%	1.7	5.1%	89	30	89	30	0.0%	0.0%
Ninth	R2	W5-L	Bedroom	15.8	12.0	3.8	23.8%													
		W5-U						8.3	7.2	88%	6.1	74%	1.1	15.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W6	Bedroom	23.9	19.9	4.0	16.9%	11.8	8.4	71%	6.8	57%	1.7	19.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W7	Bedroom	25.9	21.8	4.2	16.0%	11.2	9.3	83%	9.1	82%	0.1	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W8-L	Studio	11.3	7.6	3.7	32.3%													
		W8-U						29.2	23.8	81%	16.2	55%	7.6	31.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9	LKD	19.1	15.8	3.3	17.2%													
		W10-L		7.3	4.6	2.7	36.4%													
		W10-U						34.2	30.6	89%	18.5	54%	12.1	39.5%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W11	Bedroom	10.7	9.2	1.4	13.3%	11.1	3.6	33%	3.4	31%	0.2	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W12	Bedroom	13.6	12.2	1.5	10.7%	14.5	4.1	28%	4.1	28%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W13	Bedroom	13.9	12.7	1.2	8.6%	10.1	4.0	39%	4.0	39%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W14	Bedroom	13.9	12.9	1.0	7.5%													
		W15		14.2	13.3	0.9	6.2%	11.2	7.5	67%	7.2	64%	0.3	4.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W16	LKD	14.4	13.6	0.8	5.6%													
		W17-L		0.8	0.8	0.0	0.0%													
		W17-U																		
		W18-L		1.4	1.4	0.0	1.4%													
		W18-U																		
		W19-L		9.4	9.1	0.3	2.8%													
		W19-U						42.4	22.1	52%	19.7	46%	2.4	11.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1	LKD	37.4	37.4	0.0	0.0%													
		W2-L		39.0	38.9	0.0	0.1%													
		W2-U																		
		W3-L		38.8	38.8	0.0	0.1%													
		W3-U																		
		W4		29.9	26.4	3.5	11.6%	34.8	33.4	96%	31.8	91%	1.7	5.0%	90	30	90	30	0.0%	0.0%
Tenth	R2	W5-L	Bedroom	16.8	13.1	3.7	22.1%													
		W5-U						8.3	7.6	92%	6.7	81%	0.9	11.7%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W6	Bedroom	26.4	22.4	4.0	15.0%	11.8	9.7	82%	8.3	70%	1.4	14.5%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W7	Bedroom	27.5	23.5	4.0	14.6%	11.2	9.6	86%	9.5	85%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Tenth	R5	W8-L	Studio	12.2	8.7	3.6	29.1%													
		W8-U						29.2	24.2	83%	17.1	59%	7.1	29.3%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9	LKD	20.9	17.7	3.2	15.3%													
		W10-L		7.7	5.1	2.6	33.9%													
		W10-U						34.2	30.9	90%	20.2	59%	10.6	34.4%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W11	Bedroom	12.3	10.9	1.5	11.8%	11.1	3.6	33%	3.5	32%	0.1	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W12	Bedroom	14.6	13.2	1.4	9.8%	14.5	4.1	28%	4.1	28%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W13	Bedroom	14.7	13.5	1.2	7.9%	10.1	4.1	41%	4.1	41%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R10	W14	Bedroom	14.7	13.7	1.0	6.9%													
		W15		15.0	14.1	0.9	5.9%	11.2	7.8	70%	7.5	68%	0.2	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R11	W16	LKD	15.2	14.4	0.8	5.3%													
		W17-L		0.9	0.9	0.0	0.0%													
		W17-U																		
		W18-L		1.6	1.5	0.0	1.3%													
		W18-U																		
		W19-L		9.8	9.5	0.3	2.7%													
		W19-U						42.4	22.9	54%	20.4	48%	2.5	10.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1	LKD	37.6	37.6	0.0	0.0%													
		W2-L		39.1	39.1	0.0	0.1%													
		W2-U																		
		W3-L		39.0	38.9	0.0	0.1%													
		W3-U																		
		W4		31.5	28.1	3.5	11.1%	34.8	33.4	96%	31.8	91%	1.6	4.9%	90	30	90	30	0.0%	0.0%
Eleventh	R2	W5-L	Bedroom	30.9	27.2	3.7	11.9%													
		W5-U						8.3	7.6	93%	7.2	87%	0.4	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W6	Bedroom	30.2	26.3	3.8	12.7%	11.8	11.2	95%	10.4	88%	0.8	7.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W7	Bedroom	29.0	25.0	3.9	13.6%	11.2	9.6	86%	9.6	86%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W8-L	Studio	26.0	22.6	3.5	13.3%													
		W8-U						29.2	25.5	87%	20.7	71%	4.8	18.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9	LKD	22.8	19.6	3.2	13.8%													
		W10-L		16.0	13.4	2.5	15.9%													
		W10-U						34.2	31.2	91%	22.0	64%	9.2	29.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W11	Bedroom	15.5	13.7	1.8	11.9%	11.1	3.7	33%	3.6	32%	0.1	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W12	Bedroom	15.4	14.0	1.4	9.1%	14.5	4.1	28%	4.1	28%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W13	Bedroom	15.5	14.3	1.1	7.4%	10.1	4.3	42%	4.3	42%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R10	W14	Bedroom	15.6	14.6	1.0	6.5%													
		W15		15.9	15.0	0.9	5.6%	11.2	8.0	71%	7.9	71%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R11	W16	LKD	16.1	15.3	0.8	5.0%													
		W17-L		0.9	0.9	0.0	0.0%													
		W17-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W18-L		1.7	1.7	0.0	1.8%													
		W18-U																		
		W19-L		10.3	10.0	0.3	2.4%													
		W19-U						42.4	24.1	57%	21.8	51%	2.3	9.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1	LKD	37.7	37.7	0.0	0.0%													
		W2-L		39.2	39.1	0.0	0.1%													
		W2-U																		
		W3-L		39.1	39.1	0.0	0.1%													
		W3-U																		
		W4		32.9	29.4	3.4	10.5%	34.8	33.4	96%	31.8	91%	1.6	4.9%	90	30	90	30	0.0%	0.0%
Twelfth	R2	W5-L	Bedroom	32.1	28.6	3.6	11.1%													
		W5-U						8.3	7.7	93%	7.4	89%	0.3	4.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W6	Bedroom	31.4	27.7	3.7	11.9%	11.8	11.2	95%	10.7	90%	0.5	4.8%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W7	Bedroom	30.1	26.4	3.8	12.5%	11.2	9.6	86%	9.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W8-L	Studio	27.2	23.9	3.3	12.2%													
		W8-U						29.2	25.9	89%	22.7	77%	3.3	12.6%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9	LKD	23.9	20.9	3.0	12.6%													
		W10-L		16.9	14.5	2.4	14.4%													
		W10-U						34.2	31.3	92%	22.7	67%	8.6	27.5%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W11	Bedroom	16.5	14.7	1.8	10.8%	11.1	3.7	33%	3.7	33%	0.1	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W12	Bedroom	16.3	14.9	1.4	8.3%	14.5	4.1	29%	4.1	28%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W13	Bedroom	16.4	15.3	1.1	6.8%	10.1	4.3	43%	4.3	43%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R10	W14	Bedroom	16.5	15.5	1.0	6.0%													
		W15		16.8	16.0	0.9	5.2%	11.2	8.1	73%	8.1	72%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R11	W16	LKD	17.1	16.3	0.8	4.7%													
		W17-L		1.0	1.0	0.0	0.0%													
		W17-U																		
		W18-L		1.8	1.8	0.0	1.7%													
		W18-U																		
		W19-L		10.8	10.6	0.3	2.3%													
		W19-U						42.4	24.5	58%	22.4	53%	2.2	8.8%	N/F	N/F	N/F	N/F	N/F	N/F
The Gessner																				
First	R1	W1-L	LKD	33.9	33.8	0.0	0.1%													
		W1-U																		
		W2-L		33.8	33.8	0.0	0.1%													
		W2-U																		
		W3-L		10.7	7.8	2.9	27.0%													
		W3-U						37.2	28.7	77%	27.4	74%	1.4	4.7%	59	19	55	16	6.8%	15.8%
First	R2	W4-L	Bedroom	13.7	6.2	7.5	54.5%													
		W4-U						12.2	11.3	93%	7.2	59%	4.1	36.3%	26	13	9	8	65.4%	38.5%
First	R3	W5-L	Bedroom	27.3	12.6	14.6	53.7%													
		W5-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W6-L		28.7	13.5	15.2	53.0%												
		W6-U						12.0	11.8	98%	11.1	92%	0.7	6.1%	60	18	29	12	51.7%	33.3%
First	R4	W7-L	Bedroom	13.4	8.2	5.1	38.3%												
		W7-U						11.9	9.3	78%	3.0	26%	6.2	67.2%	33	18	26	12	21.2%	33.3%
First	R5	W8-L	LKD	9.5	3.2	6.4	66.8%												
		W8-U						31.7	24.5	77%	13.8	43%	10.8	43.9%	17	13	6	5	64.7%	61.5%
First	R6	W9-L	Bedroom	15.9	0.5	15.4	96.6%												
		W9-U																		
		W10-L		16.8	4.7	12.0	71.8%												
		W10-U						14.2	12.2	86%	0.6	4%	11.6	95.2%	47	14	9	4	80.9%	71.4%
First	R7	W11-L	Bedroom	25.0	6.7	18.4	73.4%												
		W11-U						12.0	11.0	91%	3.1	26%	7.9	71.7%	53	18	20	7	62.3%	61.1%
First	R8	W12-L	LKD	10.9	3.5	7.3	67.5%												
		W12-U																		
		W13-L		12.3	3.3	9.0	72.9%												
		W13-U						34.1	25.3	74%	11.2	33%	14.0	55.6%	38	20	19	7	50.0%	65.0%
First	R9	W14-L	Bedroom	24.2	4.7	19.6	80.7%												
		W14-U						15.5	11.2	72%	2.9	19%	8.3	74.1%	50	14	12	2	76.0%	85.7%
First	R10	W15-L	Bedroom	24.7	6.2	18.5	74.8%												
		W15-U						13.4	10.5	78%	3.6	27%	6.9	66.0%	52	15	18	4	65.4%	73.3%
First	R11	W16-L	LKD	12.0	3.6	8.4	69.7%												
		W16-U																		
		W17-L		9.1	2.1	7.0	76.9%												
		W17-U																		
		W18-L		24.1	17.5	6.6	27.2%												
		W18-U						42.0	31.2	74%	10.8	26%	20.4	65.5%	48	16	30	5	37.5%	68.8%
First	R12	W19-L	Bedroom	26.5	18.0	8.5	32.2%												
		W19-U						12.2	10.7	88%	4.3	36%	6.4	59.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W20-L	LKD	27.5	18.6	8.8	32.1%												
		W20-U																		
		W21-L		12.7	12.2	0.5	3.9%												
		W21-U																		
		W22-L		11.1	11.1	0.0	0.1%												
		W22-U						42.8	35.7	83%	35.6	83%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W23-L	Bedroom	23.9	23.9	0.0	0.0%												
		W23-U						12.5	10.8	87%	10.8	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R15	W24-L	Bedroom	23.7	23.6	0.0	0.2%												
		W24-U						14.6	12.2	84%	12.2	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R16	W25-L	LKD	11.2	11.1	0.0	0.3%												
		W25-U																		
		W26-L		8.7	8.7	0.0	0.1%												
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R17	W27-L	Bedroom	12.2	12.2	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R18	W28-L	Studio	8.7	8.7	0.0	0.0%													
		W28-U						42.7	21.5	50%	21.5	50%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R19	W29-L	Bedroom	14.3	14.2	0.0	0.3%													
		W29-U						13.1	7.8	59%	6.3	48%	1.4	18.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R20	W30-L	LKD	19.1	18.5	0.5	2.8%													
		W30-U																		
		W31-L		20.7	20.0	0.7	3.3%													
		W31-U						32.3	26.5	82%	17.6	54%	8.9	33.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R21	W32-L	Bedroom	22.1	21.3	0.8	3.6%													
		W32-U						12.7	8.3	65%	7.5	59%	0.9	10.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R22	W33-L	Bedroom	24.6	23.8	0.8	3.3%													
		W33-U						13.8	10.7	78%	10.7	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R23	W34-L	LKD	5.6	5.0	0.6	10.2%													
		W34-U						33.3	18.4	55%	12.4	37%	6.0	32.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R24	W35-L	Studio	28.1	27.0	1.0	3.6%													
		W35-U																		
		W36-L		29.0	28.0	1.1	3.7%													
		W36-U																		
		W37-L		29.5	28.4	1.1	3.6%													
		W37-U						39.0	31.8	81%	30.6	78%	1.2	3.8%	N/F	N/F	N/F	N/F	N/F	N/F
First	R25	W38-L	Bedroom	29.9	28.8	1.1	3.5%													
		W38-U						14.2	12.8	91%	12.7	90%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R26	W39-L	LKD	30.6	29.5	1.1	3.4%													
		W39-U																		
		W40-L		10.0	10.0	0.0	0.0%													
		W40-U						35.5	26.2	74%	25.9	73%	0.4	1.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R27	W41-L	Bedroom	9.9	9.8	0.0	0.5%													
		W41-U						15.1	11.3	75%	11.3	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R28	W42-L	Bedroom	26.1	26.1	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	20	0	20	0	0.0%	0.0%
First	R29	W43-L	LKD	30.2	30.2	0.0	0.0%													
		W43-U																		
		W44-L		35.4	35.4	0.0	0.0%													
		W44-U						41.1	26.0	63%	26.0	63%	0.0	0.0%	55	16	55	16	0.0%	0.0%
Second	R1	W1-L	LKD	34.6	34.5	0.0	0.1%													
		W1-U																		
		W2-L		34.5	34.5	0.0	0.1%													
		W2-U																		
		W3-L		11.2	8.2	3.0	26.4%													
		W3-U						37.2	29.0	78%	28.0	75%	1.0	3.5%	61	20	58	18	4.9%	10.0%
Second	R2	W4-L	Bedroom	14.2	6.6	7.6	53.5%													
		W4-U						12.2	11.3	93%	7.7	63%	3.6	31.9%	27	13	11	9	59.3%	30.8%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R3	W5-L	Bedroom	27.9	13.0	14.9	53.4%												
		W5-U																	
		W6-L		29.3	13.9	15.5	52.7%												
		W6-U						12.0	11.8	98%	11.1	93%	0.7	5.8%	60	18	30	13	50.0%	27.8%
Second	R4	W7-L	Bedroom	13.9	8.5	5.4	38.8%												
		W7-U						11.9	9.3	79%	3.1	26%	6.3	67.2%	33	18	26	12	21.2%	33.3%
Second	R5	W8-L	LKD	10.1	3.5	6.7	65.8%												
		W8-U						31.7	24.8	78%	13.9	44%	11.0	44.1%	19	14	7	5	63.2%	64.3%
Second	R6	W9-L	Bedroom	16.5	0.6	15.9	96.5%												
		W9-U																	
		W10-L		17.1	4.9	12.3	71.6%												
		W10-U						14.2	12.5	88%	0.6	4%	11.9	95.1%	48	15	9	4	81.3%	73.3%
Second	R7	W11-L	Bedroom	25.8	6.8	19.0	73.8%												
		W11-U						12.0	11.1	93%	3.1	26%	8.0	72.1%	55	20	20	7	63.6%	65.0%
Second	R8	W12-L	LKD	11.5	3.7	7.9	68.2%												
		W12-U																	
		W13-L		13.0	3.7	9.3	71.5%												
		W13-U						34.1	25.5	75%	12.3	36%	13.2	51.7%	39	21	19	7	51.3%	66.7%
Second	R9	W14-L	Bedroom	25.2	5.2	20.0	79.5%												
		W14-U						15.5	11.5	74%	3.0	19%	8.5	74.0%	53	16	12	2	77.4%	87.5%
Second	R10	W15-L	Bedroom	25.7	6.5	19.2	74.6%												
		W15-U						13.4	10.9	81%	3.6	27%	7.3	67.2%	56	18	19	5	66.1%	72.2%
Second	R11	W16-L	LKD	12.9	4.0	8.9	68.7%												
		W16-U																	
		W17-L		10.9	3.4	7.6	69.2%												
		W17-U																	
		W18-L		29.5	21.8	7.8	26.3%												
		W18-U						41.9	34.1	81%	14.6	35%	19.5	57.3%	57	19	36	7	36.8%	63.2%
Second	R12	W19-L	Bedroom	29.7	22.1	7.6	25.6%												
		W19-U						12.2	11.1	91%	6.6	54%	4.6	40.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W20-L	LKD	30.0	22.6	7.4	24.6%												
		W20-U																	
		W21-L		13.4	13.2	0.2	1.8%												
		W21-U																	
		W22-L		11.6	11.6	0.0	0.1%												
		W22-U						42.8	35.8	84%	35.6	83%	0.2	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W23-L	Bedroom	24.5	24.5	0.0	0.0%												
		W23-U						12.5	10.9	87%	10.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R15	W24-L	Bedroom	24.2	24.2	0.0	0.0%												
		W24-U						14.6	12.3	84%	12.3	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R16	W25-L	LKD	11.6	11.6	0.0	0.1%												
		W25-U																	
		W26-L		9.1	9.1	0.0	0.1%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R17	W27-L	Bedroom	12.5	12.5	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R18	W28-L	Studio	9.1	9.1	0.0	0.0%													
		W28-U						42.7	23.1	54%	23.1	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R19	W29-L	Bedroom	15.0	15.0	0.0	0.2%													
		W29-U						13.1	7.9	60%	7.8	60%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R20	W30-L	LKD	20.2	19.7	0.5	2.3%													
		W30-U																		
		W31-L		22.0	21.4	0.6	2.6%													
		W31-U						32.3	27.3	85%	21.9	68%	5.5	20.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R21	W32-L	Bedroom	23.5	22.8	0.6	2.8%													
		W32-U						12.7	8.5	67%	8.5	67%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R22	W33-L	Bedroom	26.0	25.4	0.6	2.5%													
		W33-U						13.8	10.8	79%	10.8	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R23	W34-L	LKD	6.3	6.0	0.3	5.4%													
		W34-U						33.3	20.5	62%	17.7	53%	2.8	13.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R24	W35-L	Studio	29.4	28.6	0.9	3.0%													
		W35-U																		
		W36-L		30.4	29.4	1.0	3.3%													
		W36-U																		
		W37-L		30.8	29.8	1.0	3.3%													
		W37-U						39.0	33.7	86%	33.4	86%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R25	W38-L	Bedroom	31.2	30.1	1.0	3.3%													
		W38-U						14.2	13.0	92%	13.0	92%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R26	W39-L	LKD	31.8	30.8	1.0	3.2%													
		W39-U																		
		W40-L		10.5	10.5	0.0	0.0%													
		W40-U						35.5	27.6	78%	27.6	78%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R27	W41-L	Bedroom	10.6	10.6	0.0	0.1%													
		W41-U						15.1	12.6	84%	12.6	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R28	W42-L	Bedroom	26.4	26.4	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	21	0	21	0	0.0%	0.0%
Second	R29	W43-L	LKD	30.4	30.4	0.0	0.0%													
		W43-U																		
		W44-L		35.9	35.9	0.0	0.0%													
		W44-U						41.1	27.1	66%	27.1	66%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Third	R1	W1-L	LKD	35.3	35.3	0.0	0.1%													
		W1-U																		
		W2-L		35.3	35.2	0.0	0.1%													
		W2-U																		
		W3-L		11.6	8.6	3.0	25.5%													
		W3-U						37.2	29.4	79%	29.0	78%	0.4	1.3%	61	20	58	18	4.9%	10.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R2	W4-L	Bedroom	14.7	7.0	7.8	52.7%												
		W4-U						12.2	11.3	93%	7.8	64%	3.5	31.0%	27	13	11	9	59.3%	30.8%
Third	R3	W5-L	Bedroom	28.4	13.3	15.1	53.1%												
		W5-U																	
		W6-L		29.9	14.1	15.7	52.7%												
		W6-U						12.0	11.8	98%	11.4	95%	0.4	3.5%	61	19	30	13	50.8%	31.6%
Third	R4	W7-L	Bedroom	14.3	8.7	5.6	39.4%												
		W7-U						11.9	9.4	79%	3.2	27%	6.2	66.2%	34	19	26	12	23.5%	36.8%
Third	R5	W8-L	LKD	10.6	3.7	6.9	65.2%												
		W8-U						31.7	25.3	80%	13.9	44%	11.3	44.9%	21	15	8	5	61.9%	66.7%
Third	R6	W9-L	Bedroom	16.9	0.6	16.3	96.4%												
		W9-U																	
		W10-L		17.5	5.0	12.5	71.6%												
		W10-U						14.2	12.8	90%	0.6	4%	12.2	95.1%	50	16	9	4	82.0%	75.0%
Third	R7	W11-L	Bedroom	26.3	6.8	19.5	74.0%												
		W11-U						12.0	11.3	94%	3.1	26%	8.2	72.5%	55	20	20	7	63.6%	65.0%
Third	R8	W12-L	LKD	12.1	3.9	8.2	67.5%												
		W12-U																	
		W13-L		13.7	4.2	9.5	69.5%												
		W13-U						34.1	25.7	75%	12.6	37%	13.1	50.9%	41	22	22	9	46.3%	59.1%
Third	R9	W14-L	Bedroom	25.8	5.6	20.2	78.4%												
		W14-U						15.5	11.8	76%	3.0	19%	8.8	74.6%	54	17	14	3	74.1%	82.4%
Third	R10	W15-L	Bedroom	26.3	6.9	19.4	73.9%												
		W15-U						13.4	11.4	85%	3.6	27%	7.8	68.7%	56	18	19	5	66.1%	72.2%
Third	R11	W16-L	LKD	13.5	4.5	9.0	66.5%												
		W16-U																	
		W17-L		11.8	4.4	7.4	62.8%												
		W17-U																	
		W18-L		32.1	26.5	5.6	17.4%												
		W18-U						41.9	34.8	83%	22.0	53%	12.8	36.7%	58	20	39	8	32.8%	60.0%
Third	R12	W19-L	Bedroom	31.8	26.7	5.1	16.0%												
		W19-U						12.2	11.5	94%	10.5	86%	1.0	8.8%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W20-L	LKD	31.5	26.9	4.7	14.8%												
		W20-U																	
		W21-L		14.1	14.0	0.1	0.4%												
		W21-U																	
		W22-L		12.4	12.3	0.0	0.2%												
		W22-U						42.8	35.8	84%	35.8	84%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W23-L	Bedroom	25.0	25.0	0.0	0.0%												
		W23-U						12.5	10.9	87%	10.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R15	W24-L	Bedroom	24.8	24.8	0.0	0.0%												
		W24-U						14.6	12.3	84%	12.3	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R16	W25-L	LKD	12.1	12.1	0.0	0.0%													
		W25-U																		
		W26-L		9.4	9.4	0.0	0.1%													
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R17	W27-L	Bedroom	12.7	12.7	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R18	W28-L	Studio	9.6	9.6	0.0	0.0%													
		W28-U						42.7	26.1	61%	26.1	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R19	W29-L	Bedroom	15.9	15.8	0.0	0.3%													
		W29-U						13.1	7.9	61%	7.9	60%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R20	W30-L	LKD	21.5	21.1	0.4	1.9%													
		W30-U																		
		W31-L		23.4	22.9	0.5	2.1%													
		W31-U						32.3	28.2	87%	27.0	84%	1.2	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R21	W32-L	Bedroom	24.9	24.4	0.5	2.1%													
		W32-U						12.7	8.9	70%	8.9	70%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R22	W33-L	Bedroom	27.7	27.1	0.6	2.0%													
		W33-U						13.8	11.1	81%	11.1	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R23	W34-L	LKD	7.3	7.1	0.2	2.3%													
		W34-U						33.3	22.0	66%	22.0	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R24	W35-L	Studio	30.9	30.1	0.9	2.8%													
		W35-U																		
		W36-L		31.8	30.8	1.0	3.1%													
		W36-U																		
		W37-L		32.1	31.1	1.0	3.2%													
		W37-U						39.0	36.5	94%	36.5	93%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R25	W38-L	Bedroom	32.4	31.4	1.0	3.1%													
		W38-U						14.2	13.4	95%	13.3	94%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R26	W39-L	LKD	33.0	31.9	1.0	3.2%													
		W39-U																		
		W40-L		10.7	10.7	0.0	0.0%													
		W40-U						35.5	28.9	82%	28.9	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R27	W41-L	Bedroom	11.3	11.3	0.0	0.0%													
		W41-U						15.1	14.4	96%	14.4	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R28	W42-L	Bedroom	26.7	26.7	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Third	R29	W43-L	LKD	30.5	30.5	0.0	0.0%													
		W43-U																		
		W44-L		36.4	36.4	0.0	0.0%													
		W44-U						41.1	28.6	70%	28.6	70%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Fourth	R1	W1-L	LKD	36.0	36.0	0.0	0.0%													
		W1-U																		
		W2-L		36.0	36.0	0.0	0.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-U																	
		W3-L		12.0	9.0	3.0	24.7%												
		W3-U						37.2	29.7	80%	29.5	79%	0.2	0.8%	64	21	60	18	6.3%	14.3%
Fourth	R2	W4-L	Bedroom	15.2	7.3	7.9	51.9%												
		W4-U						12.2	11.4	93%	7.9	65%	3.5	30.4%	28	14	11	9	60.7%	35.7%
Fourth	R3	W5-L	Bedroom	28.9	13.6	15.3	52.9%												
		W5-U																	
		W6-L		30.4	14.4	16.0	52.6%												
		W6-U						12.0	11.8	98%	11.4	95%	0.3	2.9%	62	20	30	13	51.6%	35.0%
Fourth	R4	W7-L	Bedroom	14.7	8.9	5.9	39.8%												
		W7-U						11.9	9.5	81%	3.2	27%	6.3	66.3%	34	19	26	12	23.5%	36.8%
Fourth	R5	W8-L	LKD	11.0	3.9	7.1	64.9%												
		W8-U						31.7	25.6	81%	14.0	44%	11.6	45.3%	21	15	8	5	61.9%	66.7%
Fourth	R6	W9-L	Bedroom	17.3	0.7	16.7	96.1%												
		W9-U																	
		W10-L		17.8	5.1	12.7	71.4%												
		W10-U						14.2	13.1	92%	0.6	5%	12.5	95.1%	50	16	9	4	82.0%	75.0%
Fourth	R7	W11-L	Bedroom	26.9	7.0	19.9	73.9%												
		W11-U						12.0	11.6	96%	3.1	26%	8.5	73.2%	56	20	20	7	64.3%	65.0%
Fourth	R8	W12-L	LKD	12.6	4.2	8.5	67.1%												
		W12-U																	
		W13-L		14.3	4.6	9.7	67.7%												
		W13-U						34.1	25.9	76%	12.7	37%	13.1	50.7%	42	22	24	9	42.9%	59.1%
Fourth	R9	W14-L	Bedroom	26.5	6.1	20.4	77.0%												
		W14-U						15.5	12.2	79%	3.0	19%	9.2	75.4%	55	18	14	3	74.5%	83.3%
Fourth	R10	W15-L	Bedroom	27.0	7.4	19.7	72.7%												
		W15-U						13.4	12.0	90%	3.6	27%	8.4	70.2%	57	19	19	5	66.7%	73.7%
Fourth	R11	W16-L	LKD	14.1	5.1	9.0	63.9%												
		W16-U																	
		W17-L		12.4	5.2	7.1	57.8%												
		W17-U																	
		W18-L		33.3	30.3	3.0	9.1%												
		W18-U						41.9	35.1	84%	27.6	66%	7.5	21.4%	62	21	43	8	30.6%	61.9%
Fourth	R12	W19-L	Bedroom	33.1	30.3	2.7	8.3%												
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R13	W20-L	LKD	32.8	30.4	2.4	7.4%												
		W20-U																	
		W21-L		14.4	14.4	0.0	0.1%												
		W21-U																	
		W22-L		13.0	13.0	0.0	0.1%												
		W22-U						42.8	36.0	84%	36.0	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W23-L	Bedroom	25.8	25.8	0.0	0.0%												
		W23-U						12.5	11.0	88%	11.0	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fourth	R15	W24-L	Bedroom	25.5	25.5	0.0	0.0%													
		W24-U						14.6	12.4	85%	12.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R16	W25-L	LKD	12.4	12.4	0.0	0.0%													
		W25-U																		
		W26-L		9.6	9.6	0.0	0.0%													
		W26-U						40.3	37.1	92%	37.1	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R17	W27-L	Bedroom	12.9	12.9	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R18	W28-L	Studio	10.5	10.5	0.0	0.0%													
		W28-U						42.7	28.1	66%	28.1	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R19	W29-L	Bedroom	17.3	17.2	0.0	0.2%													
		W29-U						13.1	8.1	62%	8.1	62%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R20	W30-L	LKD	23.1	22.7	0.4	1.6%													
		W30-U																		
		W31-L		25.2	24.6	0.5	2.1%													
		W31-U						32.3	28.9	90%	28.9	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R21	W32-L	Bedroom	26.8	26.2	0.6	2.2%													
		W32-U						12.7	9.5	75%	9.5	74%	0.0	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R22	W33-L	Bedroom	29.5	28.9	0.6	2.2%													
		W33-U						13.8	11.5	84%	11.5	84%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R23	W34-L	LKD	8.0	7.9	0.1	1.6%													
		W34-U						33.3	23.1	69%	23.1	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R24	W35-L	Studio	32.5	31.4	1.0	3.2%													
		W35-U																		
		W36-L		33.1	32.0	1.1	3.4%													
		W36-U																		
		W37-L		33.4	32.3	1.1	3.4%													
		W37-U						39.0	38.1	98%	38.0	97%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R25	W38-L	Bedroom	33.7	32.6	1.1	3.3%													
		W38-U						14.2	13.5	95%	13.4	94%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R26	W39-L	LKD	34.1	33.0	1.1	3.3%													
		W39-U																		
		W40-L		10.7	10.7	0.0	0.0%													
		W40-U						35.5	29.3	83%	29.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R27	W41-L	Bedroom	12.0	12.0	0.0	0.0%													
		W41-U						15.1	14.7	97%	14.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R28	W42-L	Bedroom	27.0	27.0	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Fourth	R29	W43-L	LKD	30.6	30.6	0.0	0.0%													
		W43-U																		
		W44-L		36.9	36.9	0.0	0.0%													
		W44-U						41.1	30.5	74%	30.5	74%	0.0	0.0%	57	17	57	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifth	R1	W1-L	LKD	36.7	36.7	0.0	0.0%												
		W1-U																	
		W2-L		36.7	36.6	0.0	0.0%												
		W2-U																	
		W3-L		12.3	9.4	3.0	24.0%												
		W3-U						37.2	29.9	80%	29.8	80%	0.1	0.4%	65	22	61	19	6.2%	13.6%
Fifth	R2	W4-L	Bedroom	15.6	7.6	8.0	51.3%												
		W4-U						12.2	11.4	93%	7.9	65%	3.4	30.0%	29	15	12	10	58.6%	33.3%
Fifth	R3	W5-L	Bedroom	29.4	13.9	15.4	52.6%												
		W5-U																	
		W6-L		30.9	14.7	16.2	52.4%												
		W6-U						12.0	11.8	98%	11.4	95%	0.3	2.9%	62	20	30	13	51.6%	35.0%
Fifth	R4	W7-L	Bedroom	15.1	9.0	6.1	40.3%												
		W7-U						11.9	9.8	82%	3.3	27%	6.5	66.7%	35	19	27	12	22.9%	36.8%
Fifth	R5	W8-L	LKD	11.5	4.1	7.4	64.5%												
		W8-U						31.7	25.6	81%	14.0	44%	11.6	45.3%	23	16	10	6	56.5%	62.5%
Fifth	R6	W9-L	Bedroom	17.7	0.8	16.9	95.5%												
		W9-U																	
		W10-L		18.2	5.3	12.9	71.1%												
		W10-U						14.2	13.5	95%	0.7	5%	12.9	95.1%	50	16	9	4	82.0%	75.0%
Fifth	R7	W11-L	Bedroom	28.2	7.6	20.6	73.0%												
		W11-U						12.0	11.7	97%	3.1	26%	8.6	73.2%	56	20	20	7	64.3%	65.0%
Fifth	R8	W12-L	LKD	13.0	4.3	8.7	66.8%												
		W12-U																	
		W13-L		14.7	4.9	9.8	66.7%												
		W13-U						34.1	26.0	76%	12.8	37%	13.2	50.8%	45	23	25	9	44.4%	60.9%
Fifth	R9	W14-L	Bedroom	28.0	7.2	20.8	74.3%												
		W14-U						15.5	12.9	83%	3.0	20%	9.8	76.4%	58	18	17	3	70.7%	83.3%
Fifth	R10	W15-L	Bedroom	28.5	8.6	19.9	70.0%												
		W15-U						13.4	12.3	92%	3.6	27%	8.7	70.6%	62	19	24	5	61.3%	73.7%
Fifth	R11	W16-L	LKD	14.6	5.5	9.0	62.0%												
		W16-U																	
		W17-L		12.8	5.8	7.1	55.0%												
		W17-U																	
		W18-L		34.5	32.5	1.9	5.5%												
		W18-U						41.9	35.3	84%	28.7	69%	6.5	18.5%	67	22	50	10	25.4%	54.5%
Fifth	R12	W19-L	Bedroom	34.3	32.6	1.7	4.8%												
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W20-L	LKD	34.1	32.6	1.4	4.2%												
		W20-U																	
		W21-L		14.7	14.7	0.0	0.1%												
		W21-U																	
		W22-L		13.7	13.7	0.0	0.0%												
		W22-U						42.8	36.5	85%	36.5	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifth	R14	W23-L	Bedroom	27.1	27.1	0.0	0.0%												
		W23-U						12.5	11.1	89%	11.1	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R15	W24-L	Bedroom	26.7	26.7	0.0	0.0%												
		W24-U						14.6	12.5	86%	12.5	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R16	W25-L	LKD	12.6	12.6	0.0	0.1%												
		W25-U																	
		W26-L		9.7	9.7	0.0	0.0%												
		W26-U						40.3	37.2	92%	37.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R17	W27-L	Bedroom	13.4	13.4	0.0	0.0%												
		W27-U						14.4	11.7	81%	11.7	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R18	W28-L	Studio	11.9	11.9	0.0	0.0%												
		W28-U						42.7	29.4	69%	29.4	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R19	W29-L	Bedroom	19.4	19.3	0.1	0.5%												
		W29-U						13.1	8.3	64%	8.3	64%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R20	W30-L	LKD	25.4	24.9	0.6	2.2%												
		W30-U																	
		W31-L		27.6	26.9	0.7	2.6%												
		W31-U						32.3	29.5	91%	29.5	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R21	W32-L	Bedroom	29.3	28.5	0.8	2.8%												
		W32-U						12.7	10.3	81%	10.2	80%	0.1	1.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R22	W33-L	Bedroom	31.7	30.9	0.9	2.7%												
		W33-U						13.8	12.3	89%	12.1	88%	0.2	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R23	W34-L	LKD	8.8	8.7	0.1	1.3%												
		W34-U						33.3	24.5	74%	24.5	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R24	W35-L	Studio	34.0	32.8	1.3	3.7%												
		W35-U																	
		W36-L		34.5	33.2	1.3	3.7%												
		W36-U																	
		W37-L		34.7	33.5	1.2	3.5%												
		W37-U						39.0	38.2	98%	38.1	98%	0.2	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R25	W38-L	Bedroom	34.8	33.7	1.2	3.4%												
		W38-U						14.2	13.5	95%	13.4	95%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R26	W39-L	LKD	35.1	34.0	1.1	3.2%												
		W39-U																	
		W40-L		10.9	10.9	0.0	0.0%												
		W40-U						35.5	29.4	83%	29.4	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R27	W41-L	Bedroom	12.6	12.6	0.0	0.0%												
		W41-U						15.1	14.8	98%	14.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R28	W42-L	Bedroom	27.3	27.3	0.0	0.0%												
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Fifth	R29	W43-L	LKD	30.6	30.6	0.0	0.0%												
		W43-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W44-L		37.4	37.4	0.0	0.0%												
		W44-U						41.1	33.7	82%	33.7	82%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Sixth	R1	W1-L	LKD	37.3	37.3	0.0	0.0%												
		W1-U																	
		W2-L		37.3	37.3	0.0	0.0%												
		W2-U																	
		W3-L		12.7	9.7	3.0	23.6%												
		W3-U						37.2	30.0	81%	29.9	80%	0.1	0.3%	67	24	62	20	7.5%	16.7%
Sixth	R2	W4-L	Bedroom	16.1	8.0	8.1	50.5%												
		W4-U						12.2	11.4	93%	7.9	65%	3.4	30.2%	31	17	13	11	58.1%	35.3%
Sixth	R3	W5-L	Bedroom	30.0	14.3	15.6	52.2%												
		W5-U																	
		W6-L		31.5	15.1	16.4	52.1%												
		W6-U						12.0	11.8	98%	11.5	96%	0.3	2.7%	63	21	30	13	52.4%	38.1%
Sixth	R4	W7-L	Bedroom	15.6	9.2	6.4	40.8%												
		W7-U						11.9	9.9	84%	3.3	28%	6.6	66.8%	35	19	27	12	22.9%	36.8%
Sixth	R5	W8-L	LKD	11.9	4.2	7.7	64.5%												
		W8-U						31.7	25.8	81%	14.1	44%	11.7	45.4%	24	16	11	6	54.2%	62.5%
Sixth	R6	W9-L	Bedroom	18.1	0.9	17.2	95.1%												
		W9-U																	
		W10-L		18.5	5.5	13.1	70.5%												
		W10-U						14.2	13.7	96%	0.7	5%	13.0	95.1%	51	17	9	4	82.4%	76.5%
Sixth	R7	W11-L	Bedroom	31.2	9.0	22.3	71.3%												
		W11-U						12.0	11.7	97%	3.1	26%	8.5	73.1%	69	20	29	7	58.0%	65.0%
Sixth	R8	W12-L	LKD	31.1	8.7	22.4	72.0%												
		W12-U																	
		W13-L		31.0	9.0	22.0	70.8%												
		W13-U						34.1	27.1	80%	13.1	38%	14.0	51.8%	76	24	35	9	53.9%	62.5%
Sixth	R9	W14-L	Bedroom	31.0	9.5	21.5	69.3%												
		W14-U						15.5	13.5	87%	3.1	20%	10.5	77.3%	76	24	31	6	59.2%	75.0%
Sixth	R10	W15-L	Bedroom	31.0	10.8	20.2	65.2%												
		W15-U						13.4	12.3	92%	3.6	27%	8.7	70.4%	75	24	34	7	54.7%	70.8%
Sixth	R11	W16-L	LKD	31.0	12.4	18.6	60.1%												
		W16-U																	
		W17-L		31.4	14.6	16.8	53.6%												
		W17-U																	
		W18-L		35.5	33.9	1.7	4.6%												
		W18-U						41.9	35.5	85%	29.2	70%	6.3	17.8%	79	25	49	11	38.0%	56.0%
Sixth	R12	W19-L	Bedroom	35.4	33.9	1.5	4.1%												
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W20-L	LKD	35.2	34.0	1.3	3.6%												
		W20-U																	
		W21-L		31.2	31.2	0.0	0.0%												
		W21-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W22-L		30.0	30.0	0.0	0.0%												
		W22-U						42.8	37.4	87%	37.4	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W23-L	Bedroom	28.5	28.5	0.0	0.0%												
		W23-U						12.5	11.3	91%	11.3	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R15	W24-L	Bedroom	26.8	26.8	0.0	0.0%												
		W24-U						14.6	12.6	87%	12.6	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R16	W25-L	LKD	25.3	25.3	0.0	0.0%												
		W25-U																	
		W26-L		23.4	23.4	0.0	0.0%												
		W26-U						40.3	37.6	93%	37.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R17	W27-L	Bedroom	14.7	14.7	0.0	0.0%												
		W27-U						14.4	12.8	89%	12.8	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R18	W28-L	Studio	14.8	14.8	0.0	0.0%												
		W28-U						42.7	30.6	72%	30.6	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R19	W29-L	Bedroom	23.3	22.8	0.5	2.1%												
		W29-U						13.1	9.2	70%	9.1	70%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R20	W30-L	LKD	29.1	28.0	1.1	3.8%												
		W30-U																	
		W31-L		31.1	29.9	1.2	3.9%												
		W31-U						32.3	29.6	92%	29.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R21	W32-L	Bedroom	32.4	31.2	1.2	3.8%												
		W32-U						12.7	12.1	95%	11.8	93%	0.3	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R22	W33-L	Bedroom	34.1	32.9	1.2	3.5%												
		W33-U						13.8	12.8	93%	12.4	91%	0.4	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R23	W34-L	LKD	9.4	9.3	0.1	1.3%												
		W34-U						33.3	26.4	79%	26.4	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R24	W35-L	Studio	35.5	34.1	1.4	4.0%												
		W35-U																	
		W36-L		35.7	34.4	1.4	3.9%												
		W36-U																	
		W37-L		35.9	34.5	1.3	3.7%												
		W37-U						39.0	38.3	98%	38.1	98%	0.2	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R25	W38-L	Bedroom	35.9	34.6	1.3	3.6%												
		W38-U						14.2	13.5	95%	13.4	95%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R26	W39-L	LKD	36.1	34.9	1.2	3.3%												
		W39-U																	
		W40-L		10.8	10.8	0.0	0.0%												
		W40-U						35.5	29.4	83%	29.4	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R27	W41-L	Bedroom	13.3	13.3	0.0	0.0%												
		W41-U						15.1	15.0	99%	15.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R28	W42-L	Bedroom	27.6	27.6	0.0	0.0%												
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	23	2	23	2	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R29	W43-L	LKD	30.9	30.9	0.0	0.0%												
		W43-U																	
		W44-L		37.9	37.9	0.0	0.0%												
		W44-U						41.1	36.0	88%	36.0	88%	0.0	0.0%	58	18	58	18	0.0%	0.0%
Seventh	R1	W1-L	LKD	38.0	38.0	0.0	0.0%												
		W1-U																	
		W2-L		38.0	38.0	0.0	0.0%												
		W2-U																	
		W3-L		14.6	10.9	3.7	25.5%												
		W3-U						37.2	30.1	81%	30.0	81%	0.1	0.2%	67	24	62	20	7.5%	16.7%
Seventh	R2	W4-L	Bedroom	17.5	8.7	8.7	50.0%												
		W4-U						12.2	11.4	93%	8.1	66%	3.3	28.9%	34	18	15	12	55.9%	33.3%
Seventh	R3	W5-L	Bedroom	30.7	14.9	15.9	51.6%												
		W5-U																	
		W6-L		32.3	15.7	16.6	51.5%												
		W6-U						11.7	11.5	98%	11.1	95%	0.3	2.7%	63	21	30	13	52.4%	38.1%
Seventh	R4	W7-L	Bedroom	17.0	9.8	7.2	42.5%												
		W7-U						13.0	11.4	88%	4.5	34%	6.9	60.8%	39	21	30	13	23.1%	38.1%
Seventh	R5	W8-L	LKD	13.8	4.8	9.0	65.0%												
		W8-U						31.7	25.9	82%	14.1	44%	11.8	45.6%	25	18	11	7	56.0%	61.1%
Seventh	R6	W9-L	Bedroom	19.2	1.7	17.5	91.0%												
		W9-U																	
		W10-L		22.5	6.1	16.4	72.8%												
		W10-U						14.9	14.7	98%	1.4	9%	13.2	90.4%	51	18	9	4	82.4%	77.8%
Seventh	R7	W11-L	LKD	9.1	2.2	6.9	76.2%												
		W11-U																	
		W12-L		9.0	2.0	7.0	77.4%												
		W12-U						27.3	24.8	91%	13.1	48%	11.7	47.0%	16	16	4	4	75.0%	75.0%
Seventh	R8	W13-L	Bedroom	6.1	1.3	4.8	78.7%												
		W13-U						12.0	9.1	76%	2.0	16%	7.1	78.3%	11	11	2	2	81.8%	81.8%
Seventh	R9	W14-L	Bedroom	20.4	4.8	15.6	76.3%												
		W14-U																	
		W15-L		20.5	5.0	15.5	75.5%												
		W15-U						13.3	13.1	99%	6.1	46%	7.0	53.5%	46	26	13	5	71.7%	80.8%
Seventh	R10	W16-L	Bedroom	21.3	6.0	15.3	71.7%												
		W16-U						11.6	9.8	85%	1.8	16%	8.0	81.3%	44	23	14	6	68.2%	73.9%
Seventh	R11	W17-L	LKD	7.3	2.5	4.7	65.1%												
		W17-U																	
		W18-L		11.1	5.1	5.9	53.6%												
		W18-U																	
		W19-L		36.5	34.9	1.6	4.3%												
		W19-U																	
		W20-L		36.5	35.0	1.5	4.1%												
		W20-U						42.6	35.5	83%	31.7	74%	3.9	10.9%	46	16	34	6	26.1%	62.5%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Seventh	R12	W21-L	LKD	36.4	35.1	1.4	3.8%												
		W21-U																	
		W22-L		36.4	35.1	1.3	3.6%												
		W22-U																	
		W23-L		9.6	9.6	0.0	0.0%												
		W23-U						36.0	32.5	90%	32.5	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R13	W24-L	Bedroom	20.9	20.9	0.0	0.0%												
		W24-U																	
		W25-L		20.4	20.4	0.0	0.0%												
		W25-U						16.2	14.4	89%	14.4	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R14	W26-L	Bedroom	19.3	19.3	0.0	0.0%												
		W26-U						15.7	13.7	87%	13.7	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R15	W27-L	LKD	7.7	7.7	0.0	0.0%												
		W27-U																	
		W28-L		8.5	8.5	0.0	0.0%												
		W28-U						31.0	27.9	90%	27.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R16	W29-L	Bedroom	17.8	17.8	0.0	0.0%												
		W29-U						14.3	13.4	94%	13.4	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R17	W30-L	Studio	22.5	22.4	0.1	0.4%												
		W30-U						42.7	37.0	87%	36.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R18	W31-L	Bedroom	30.8	29.1	1.7	5.5%												
		W31-U						13.1	12.8	97%	12.5	96%	0.2	1.8%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R19	W32-L	LKD	34.2	32.5	1.8	5.2%												
		W32-U																	
		W33-L		35.1	33.3	1.8	5.1%												
		W33-U						32.3	29.6	92%	29.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R20	W34-L	Bedroom	35.6	33.8	1.8	5.1%												
		W34-U						12.7	12.1	95%	11.8	93%	0.3	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R21	W35-L	Bedroom	36.2	34.5	1.7	4.8%												
		W35-U						13.8	12.9	94%	12.5	91%	0.4	3.2%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R22	W36-L	LKD	10.4	10.3	0.2	1.5%												
		W36-U						33.3	27.8	83%	27.8	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R23	W37-L	Studio	36.7	35.1	1.6	4.4%												
		W37-U																	
		W38-L		36.8	35.3	1.5	4.1%												
		W38-U																	
		W39-L		36.8	35.4	1.5	3.9%												
		W39-U						39.0	38.3	98%	38.1	98%	0.2	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R24	W40-L	Bedroom	36.9	35.5	1.4	3.8%												
		W40-U						14.2	13.5	95%	13.4	95%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R25	W41-L	LKD	36.9	35.7	1.2	3.3%												
		W41-U																	
		W42-L		24.4	24.4	0.0	0.0%												
		W42-U						35.5	29.8	84%	29.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R26	W43-L	Bedroom	28.7	28.7	0.0	0.0%													
		W43-U						15.1	15.0	99%	15.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R27	W44-L	Bedroom	27.9	27.9	0.0	0.0%													
		W44-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	24	3	24	3	0.0%	0.0%
Seventh	R28	W45-L	LKD	32.2	32.2	0.0	0.0%													
		W45-U																		
		W46-L		38.4	38.4	0.0	0.0%													
		W46-U						41.1	36.1	88%	36.1	88%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Eighth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		38.6	38.6	0.0	0.0%													
		W2-U																		
		W3-L		13.8	10.3	3.5	25.3%													
		W3-U						37.1	30.8	83%	30.8	83%	0.0	0.0%	69	26	62	20	10.1%	23.1%
Eighth	R2	W4-L	Bedroom	17.4	8.7	8.7	50.1%													
		W4-U						12.2	11.4	94%	8.1	67%	3.3	28.8%	35	18	16	11	54.3%	38.9%
Eighth	R3	W5-L	Bedroom	32.4	16.2	16.2	49.9%													
		W5-U																		
		W6-L		33.9	16.7	17.1	50.6%													
		W6-U						12.0	11.9	99%	11.6	97%	0.3	2.2%	76	23	42	14	44.7%	39.1%
Eighth	R4	W7-L	Bedroom	17.0	9.8	7.1	42.1%													
		W7-U						11.8	10.3	87%	3.3	28%	7.0	68.3%	40	20	31	12	22.5%	40.0%
Eighth	R5	W8-L	LKD	13.2	4.7	8.5	64.4%													
		W8-U																		
		W9-L		35.1	27.1	8.0	22.9%													
		W9-U						31.6	28.2	89%	22.8	72%	5.4	19.1%	48	18	19	7	60.4%	61.1%
Eighth	R7	W12-L	Bedroom	35.1	31.9	3.2	9.2%													
		W12-U						16.2	15.4	95%	15.4	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W13-L	LKD	11.8	11.2	0.5	4.5%													
		W13-U						40.8	29.8	73%	29.0	71%	0.8	2.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W14-L	Bedroom	37.3	34.0	3.3	8.8%													
		W14-U						13.1	12.6	96%	12.2	93%	0.4	3.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W15-L	Bedroom	37.4	34.6	2.8	7.5%													
		W15-U						14.2	13.7	96%	13.4	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W16-L	Bedroom	37.5	35.0	2.5	6.5%													
		W16-U						12.7	12.1	95%	11.8	93%	0.3	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R12	W17-L	Bedroom	37.6	35.4	2.1	5.7%													
		W17-U						12.8	12.3	96%	12.1	95%	0.2	1.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R13	W18-L	LKD	10.6	10.4	0.2	1.6%													
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R14	W19-L	Studio	37.6	35.9	1.7	4.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W19-U																	
		W20-L		37.6	36.0	1.6	4.3%												
		W20-U																	
		W21-L		37.6	36.1	1.5	4.0%												
		W21-U						39.0	38.3	98%	38.1	98%	0.2	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R15	W22-L	Bedroom	37.7	36.2	1.5	3.9%												
		W22-U						12.8	11.9	93%	11.8	92%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R16	W23-L	LKD	37.7	36.4	1.3	3.3%												
		W23-U																	
		W24		39.5	39.5	0.0	0.0%												
		W25-L		39.5	39.5	0.0	0.0%												
		W25-U						35.3	33.3	94%	33.2	94%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R17	W26	Bedroom	39.5	39.5	0.0	0.0%	11.4	10.5	93%	10.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R18	W27-L	LKD	39.5	39.5	0.0	0.0%												
		W27-U																	
		W28-L		38.8	38.8	0.0	0.0%												
		W28-U						32.6	28.8	88%	28.8	88%	0.0	0.0%	61	19	61	19	0.0%	0.0%
Ninth	R1	W1-L	LKD	39.1	39.1	0.0	0.0%												
		W1-U																	
		W2-L		39.1	39.1	0.0	0.0%												
		W2-U																	
		W3-L		35.7	23.0	12.7	35.7%												
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	94	26	67	20	28.7%	23.1%
Ninth	R2	W4-L	Bedroom	35.6	20.6	15.0	42.1%												
		W4-U						12.2	11.4	94%	8.3	68%	3.1	27.4%	83	26	53	18	36.1%	30.8%
Ninth	R3	W5-L	Bedroom	35.6	19.2	16.4	46.1%												
		W5-U																	
		W6-L		35.6	18.0	17.5	49.3%												
		W6-U						12.0	11.8	98%	11.5	96%	0.3	2.6%	83	26	48	16	42.2%	38.5%
Ninth	R4	W7-L	Bedroom	35.3	15.4	19.9	56.3%												
		W7-U						11.8	10.5	89%	3.3	28%	7.2	68.4%	81	24	44	14	45.7%	41.7%
Ninth	R5	W8-L	LKD	35.2	13.7	21.5	61.2%												
		W8-U																	
		W9-L		37.8	29.7	8.1	21.4%												
		W9-U						31.6	28.2	89%	23.0	73%	5.2	18.5%	84	25	45	11	46.4%	56.0%
Ninth	R6	W10-L	Studio	37.9	32.1	5.8	15.2%												
		W10-U																	
		W11-L		37.9	32.7	5.3	13.9%												
		W11-U																	
		W12-L		38.0	33.6	4.3	11.4%												
		W12-U						31.9	31.4	98%	31.1	97%	0.3	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W13-L	LKD	12.6	11.9	0.6	4.9%												
		W13-U						33.0	24.6	74%	24.3	74%	0.3	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	38.1	34.7	3.4	9.0%												
		W14-U						13.7	13.4	97%	13.1	95%	0.3	2.1%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ninth	R9	W15-L	Bedroom	38.1	35.3	2.9	7.5%												
		W15-U						15.2	14.6	96%	14.2	94%	0.4	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W16-L	Bedroom	38.2	35.7	2.5	6.6%												
		W16-U						12.7	12.1	95%	11.8	93%	0.3	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W17-L	Bedroom	38.2	36.1	2.1	5.6%												
		W17-U						12.8	12.3	96%	12.1	95%	0.2	1.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R12	W18-L	LKD	11.1	10.9	0.2	1.5%												
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R13	W19-L	Studio	38.2	36.5	1.7	4.5%												
		W19-U																		
		W20-L		38.3	36.7	1.6	4.1%												
		W20-U																		
		W21-L		38.3	36.8	1.5	3.9%												
		W21-U						39.0	38.3	98%	38.1	98%	0.2	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R14	W22-L	Bedroom	38.3	36.8	1.4	3.7%												
		W22-U						12.8	11.9	93%	11.8	92%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R15	W23-L	LKD	38.3	37.0	1.2	3.2%												
		W23-U																		
		W24		39.5	39.5	0.0	0.0%												
		W25-L		39.5	39.5	0.0	0.0%												
		W25-U						35.3	32.8	93%	32.7	92%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R16	W26	Bedroom	39.5	39.5	0.0	0.0%	11.4	10.5	93%	10.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R17	W27-L	LKD	39.6	39.6	0.0	0.0%												
		W27-U																		
		W28-L		39.2	39.2	0.0	0.0%												
		W28-U						32.6	28.8	88%	28.8	88%	0.0	0.0%	61	19	61	19	0.0%	0.0%
Tenth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%												
		W1-U																		
		W2-L		39.5	39.5	0.0	0.0%												
		W2-U																		
		W3-L		36.1	23.2	12.9	35.8%												
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	95	27	67	20	29.5%	25.9%
Tenth	R2	W4-L	Bedroom	36.0	20.8	15.2	42.2%												
		W4-U						12.2	11.4	94%	8.3	68%	3.1	27.2%	83	26	53	18	36.1%	30.8%
Tenth	R3	W5-L	Bedroom	36.0	19.4	16.6	46.1%												
		W5-U																		
		W6-L		35.9	18.2	17.8	49.4%												
		W6-U						12.0	11.8	98%	11.5	96%	0.3	2.6%	83	26	48	16	42.2%	38.5%
Tenth	R4	W7-L	Bedroom	35.7	15.6	20.1	56.3%												
		W7-U						11.8	10.5	89%	3.3	28%	7.2	68.5%	81	24	44	14	45.7%	41.7%
Tenth	R5	W8-L	LKD	35.6	13.8	21.8	61.2%												
		W8-U																		
		W9-L		38.2	30.1	8.1	21.1%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W9-U						31.6	28.2	89%	23.0	73%	5.2	18.5%	84	25	45	11	46.4%	56.0%
Tenth	R6	W10-L	Studio	38.3	32.6	5.8	15.0%													
		W10-U																		
		W11-L		38.4	33.1	5.2	13.6%													
		W11-U																		
		W12-L		38.4	34.1	4.3	11.2%													
		W12-U						31.9	31.4	98%	31.1	97%	0.3	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W13-L	LKD	12.8	12.2	0.6	4.5%													
		W13-U						33.0	24.6	74%	24.3	74%	0.3	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	38.5	35.2	3.4	8.7%													
		W14-U						13.7	13.4	97%	13.1	95%	0.3	2.1%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W15-L	Bedroom	38.6	35.8	2.8	7.3%													
		W15-U						15.2	14.6	96%	14.2	94%	0.4	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R10	W16-L	Bedroom	38.6	36.2	2.4	6.3%													
		W16-U						12.7	12.1	95%	11.8	93%	0.3	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R11	W17-L	Bedroom	38.6	36.5	2.1	5.4%													
		W17-U						12.8	12.3	96%	12.1	95%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R12	W18-L	LKD	11.4	11.2	0.2	1.4%													
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R13	W19-L	Bedroom	31.6	30.9	0.7	2.3%													
		W19-U																		
		W20-L		31.6	30.9	0.7	2.2%													
		W20-U						13.1	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R14	W21-L	Bedroom	31.6	30.9	0.7	2.2%													
		W21-U																		
		W22-L		31.6	30.9	0.6	2.1%													
		W22-U						11.9	11.8	100%	11.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R15	W23-L	LKD	31.6	31.0	0.6	2.0%													
		W23-U																		
		W24-L		31.6	31.0	0.6	1.9%													
		W24-U																		
		W25-L		5.0	5.0	0.0	0.0%													
		W25-U						33.8	31.5	93%	31.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R16	W26-L	Studio	34.2	34.2	0.0	0.0%													
		W26-U																		
		W27-L		31.3	31.3	0.0	0.0%													
		W27-U																		
		W28-L		31.8	31.8	0.0	0.0%													
		W28-U																		
		W29-L		31.7	31.7	0.0	0.0%													
		W29-U																		
		W30-L		34.2	34.2	0.0	0.0%													
		W30-U						38.0	37.4	98%	37.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R17	W31-L	LKD	4.7	4.7	0.0	0.0%													
		W31-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W32-L		39.5	39.5	0.0	0.0%													
		W32-U																		
		W33-L		39.5	39.5	0.0	0.0%													
		W33-U																		
		W34-L		39.5	39.5	0.0	0.0%													
		W34-U																		
		W35-L		39.5	39.5	0.0	0.0%													
		W35-U						38.4	37.1	97%	37.1	97%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Eleventh	R1	W1-L	LKD	39.6	39.6	0.0	0.0%													
		W1-U																		
		W2-L		39.6	39.6	0.0	0.0%													
		W2-U																		
		W3-L		36.4	23.3	13.1	35.9%													
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	96	28	67	20	30.2%	28.6%
Eleventh	R2	W4-L	Bedroom	36.4	21.0	15.4	42.3%													
		W4-U						12.2	11.4	94%	8.3	68%	3.1	27.0%	84	27	53	18	36.9%	33.3%
Eleventh	R3	W5-L	Bedroom	36.3	19.5	16.8	46.3%													
		W5-U																		
		W6-L		36.3	18.3	18.0	49.5%													
		W6-U						12.0	11.8	98%	11.5	96%	0.3	2.6%	85	28	48	16	43.5%	42.9%
Eleventh	R4	W7-L	Bedroom	36.1	15.8	20.4	56.4%													
		W7-U						11.8	10.5	89%	3.3	28%	7.2	68.4%	82	25	44	14	46.3%	44.0%
Eleventh	R5	W8-L	LKD	36.0	14.0	22.0	61.2%													
		W8-U																		
		W9-L		38.5	30.4	8.1	21.0%													
		W9-U						31.6	28.2	89%	23.0	73%	5.2	18.5%	85	26	45	11	47.1%	57.7%
Eleventh	R6	W10-L	Studio	38.6	32.9	5.7	14.9%													
		W10-U																		
		W11-L		38.7	33.5	5.2	13.4%													
		W11-U																		
		W12-L		38.7	34.5	4.3	11.0%													
		W12-U						31.9	31.4	98%	31.1	97%	0.3	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W13-L	LKD	13.1	12.6	0.5	4.0%													
		W13-U						32.7	24.1	74%	23.9	73%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	30.7	29.2	1.5	4.8%													
		W14-U																		
		W15-L		31.7	30.9	0.8	2.5%													
		W15-U						13.5	13.4	99%	13.4	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W16-L	Bedroom	30.7	29.7	1.0	3.3%													
		W16-U																		
		W17-L		31.7	31.0	0.8	2.4%													
		W17-U						13.4	13.1	98%	13.1	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R10	W18-L	Bedroom	31.7	31.0	0.8	2.4%													
		W18-U																		
		W19-L		30.8	30.2	0.5	1.7%													
		W19-U						11.8	11.7	99%	11.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eleventh	R11	W20-L	Bedroom	31.7	31.0	0.7	2.3%													
		W20-U																		
		W21-L		31.8	31.0	0.7	2.3%													
		W21-U						12.5	12.4	99%	12.4	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R12	W22-L	LKD	23.9	23.7	0.2	0.6%													
		W22-U						33.0	27.6	84%	27.6	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R13	W23-L	Bedroom	30.5	29.8	0.7	2.2%													
		W23-U																		
		W24-L		30.5	29.8	0.6	2.1%													
		W24-U						13.1	13.1	99%	13.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R14	W25-L	Bedroom	30.4	29.8	0.6	2.0%													
		W25-U																		
		W26-L		30.4	29.8	0.6	2.0%													
		W26-U						11.9	11.8	100%	11.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R15	W27-L	LKD	30.5	29.9	0.6	1.9%													
		W27-U																		
		W28-L		30.4	29.9	0.6	1.8%													
		W28-U																		
		W29-L		5.0	5.0	0.0	0.0%													
		W29-U						33.8	31.5	93%	31.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R16	W30-L	Studio	32.5	32.5	0.0	0.0%													
		W30-U																		
		W31-L		32.3	32.3	0.0	0.0%													
		W31-U																		
		W32-L		32.9	32.9	0.0	0.0%													
		W32-U																		
		W33-L		32.8	32.8	0.0	0.0%													
		W33-U																		
		W34-L		32.4	32.4	0.0	0.0%													
		W34-U						38.0	37.4	98%	37.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R17	W35-L	LKD	4.7	4.7	0.0	0.0%													
		W35-U																		
		W36-L		39.6	39.6	0.0	0.0%													
		W36-U																		
		W37-L		39.6	39.6	0.0	0.0%													
		W37-U																		
		W38-L		39.6	39.6	0.0	0.0%													
		W38-U																		
		W39-L		39.6	39.6	0.0	0.0%													
		W39-U						38.4	37.1	97%	37.1	97%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Twelfth	R1	W1-L	LKD	8.6	8.6	0.0	0.0%													
		W1-U																		
		W2-L		36.7	22.7	14.0	38.2%													
		W2-U																		
		W3-L		36.7	21.3	15.4	41.9%													
		W3-U																		
		W4-L		36.6	19.9	16.8	45.7%													
		W4-U						30.7	29.3	96%	29.3	95%	0.0	0.1%	93	29	62	20	33.3%	31.0%
Twelfth	R2	W5-L	Bedroom	36.6	18.4	18.2	49.8%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U																	
		W6-L		36.6	17.1	19.5	53.2%												
		W6-U						12.8	12.7	99%	10.6	83%	2.1	16.8%	85	28	46	15	45.9%	46.4%
Twelfth	R3	W7-L	LKD	36.5	15.7	20.8	56.9%												
		W7-U																	
		W8-L		36.4	14.7	21.8	59.7%												
		W8-U																	
		W9-L		6.9	6.5	0.5	6.6%												
		W9-U																	
		W10-L		4.4	1.6	2.8	63.9%												
		W10-U																	
		W11-L		30.5	25.7	4.8	15.8%												
		W11-U																	
		W12-L		31.7	28.1	3.7	11.5%												
		W12-U						33.7	30.7	91%	28.9	86%	1.8	5.8%	85	26	53	15	37.6%	42.3%
Twelfth	R4	W13-L	Bedroom	31.7	28.8	3.0	9.4%												
		W13-U																	
		W14-L		31.7	29.3	2.4	7.7%												
		W14-U						11.9	11.8	99%	11.7	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W15-L	Bedroom	31.7	30.0	1.7	5.4%												
		W15-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W16-L	LKD	24.9	24.4	0.5	2.0%												
		W16-U						32.0	27.6	86%	27.6	86%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W17-L	Bedroom	29.5	28.1	1.4	4.8%												
		W17-U																	
		W18-L		30.4	29.7	0.7	2.4%												
		W18-U						11.4	11.2	99%	11.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W19-L	Bedroom	29.5	28.5	0.9	3.2%												
		W19-U																	
		W20-L		30.4	29.7	0.7	2.3%												
		W20-U						13.4	13.3	99%	13.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W21-L	Bedroom	30.4	29.7	0.7	2.3%												
		W21-U																	
		W22-L		29.5	29.0	0.5	1.6%												
		W22-U						13.3	13.2	99%	13.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R10	W23-L	LKD	30.4	29.8	0.7	2.2%												
		W23-U																	
		W24-L		30.4	29.8	0.6	2.1%												
		W24-U																	
		W25-L		34.0	34.0	0.0	0.0%												
		W25-U						30.5	28.9	95%	28.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R12	W27-L	LKD	34.1	34.1	0.0	0.0%												
		W27-U																	
		W28-L		9.4	9.4	0.0	0.0%												
		W28-U						28.7	28.6	100%	28.6	100%	0.0	0.0%	20	6	20	6	0.0%	0.0%
Thirteenth	R1	W1-L	LKD	8.7	8.7	0.0	0.0%												
		W1-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		37.0	22.8	14.2	38.3%													
		W2-U																		
		W3-L		36.9	21.4	15.5	42.0%													
		W3-U																		
		W4-L		36.9	20.0	16.9	45.8%													
		W4-U						30.6	29.3	96%	29.2	95%	0.0	0.1%	94	30	62	20	34.0%	33.3%
Thirteenth	R2	W5-L	Bedroom	36.9	18.5	18.4	49.9%													
		W5-U																		
		W6-L		36.9	17.3	19.6	53.2%													
		W6-U						12.7	12.7	99%	10.6	83%	2.1	16.8%	86	29	46	15	46.5%	48.3%
Thirteenth	R3	W7-L	LKD	36.8	15.9	21.0	56.9%													
		W7-U																		
		W8-L		36.8	14.8	22.0	59.7%													
		W8-U																		
		W9-L		6.9	6.4	0.5	7.4%													
		W9-U																		
		W10-L		4.4	1.6	2.8	63.9%													
		W10-U																		
		W11-L		29.3	24.6	4.7	16.1%													
		W11-U																		
		W12-L		30.4	26.8	3.6	11.7%													
		W12-U						33.7	31.1	92%	28.9	86%	2.3	7.3%	86	27	53	15	38.4%	44.4%
Thirteenth	R4	W13-L	Bedroom	30.4	27.5	2.9	9.5%													
		W13-U																		
		W14-L		30.4	28.1	2.3	7.7%													
		W14-U						11.9	11.8	99%	11.7	99%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W15-L	Bedroom	30.4	28.8	1.6	5.3%													
		W15-U						12.1	11.0	91%	11.0	91%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W17-L	Living Room	35.4	35.4	0.0	0.0%													
		W17-U																		
		W18-L		39.6	39.6	0.0	0.0%													
		W18-U																		
		W19-L		39.6	39.6	0.0	0.0%													
		W19-U																		
		W20-L		39.6	39.6	0.0	0.0%													
		W20-U																		
		W21-L		39.6	39.6	0.0	0.0%													
		W21-U						41.1	41.1	100%	41.1	100%	0.0	0.0%	61	19	61	19	0.0%	0.0%
11 Hale Road																				
Ground	R1	W1	Residential	28.1	6.5	21.7	77.0%													
		W2		20.8	3.3	17.5	84.2%													
		W3		8.1	3.1	5.0	61.7%	13.0	12.3	94%	2.7	21%	9.5	77.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W4-L	Bedroom	12.0	1.0	11.0	91.3%													
		W4-U						9.9	7.2	73%	0.6	6%	6.6	92.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	33.9	8.1	25.8	76.1%													
		W1-U																		
		W2-L		17.1	10.5	6.6	38.4%													
		W2-U						11.8	11.3	96%	10.0	84%	1.4	12.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R2	W3-L	Bedroom	22.0	5.7	16.2	73.9%												
		W3-U						9.9	8.9	90%	2.0	21%	6.8	77.1%	N/F	N/F	N/F	N/F	N/F	N/F
13 Hale Road																			
Ground	R1	W1-L	Bedroom	12.2	5.7	6.5	53.2%												
		W1-U						9.9	8.0	81%	2.3	24%	5.7	70.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Residential	9.8	7.1	2.7	28.0%												
		W3		25.9	6.4	19.6	75.5%												
		W4		19.4	5.4	14.0	72.1%	13.0	12.1	93%	4.4	34%	7.7	63.8%	6	0	2	0	66.7%	0.0%
First	R1	W1-L	Bedroom	22.3	9.0	13.3	59.6%												
		W1-U						9.9	9.2	93%	3.6	37%	5.6	60.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	16.2	12.6	3.6	22.3%												
		W2-U																		
		W3-L		33.8	8.4	25.3	75.0%												
		W3-U						11.8	11.3	96%	8.4	71%	3.0	26.1%	16	0	8	0	50.0%	0.0%
15 Hale Road																			
Ground	R1	W1	Residential	29.6	8.4	21.2	71.7%	1.6	1.3	78%	0.6	36%	0.7	54.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	27.9	7.0	20.9	74.9%												
		W3		10.2	4.1	6.1	59.6%	10.8	6.1	56%	2.3	21%	3.8	62.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W4-L	Bedroom	12.8	2.8	10.0	78.1%												
		W4-U						9.9	7.8	79%	1.7	17%	6.2	78.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	33.3	9.7	23.6	71.0%												
		W1-U																		
		W2-L		23.3	13.9	9.4	40.4%												
		W2-U						11.8	11.3	95%	10.5	89%	0.7	6.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W3-L	Bedroom	24.0	8.2	15.8	65.8%												
		W3-U						9.9	9.4	95%	2.9	29%	6.5	69.5%	N/F	N/F	N/F	N/F	N/F	N/F
17 Hale Road																			
Ground	R1	W1-L	Bedroom	12.4	7.1	5.3	42.4%												
		W1-U						9.9	8.0	81%	2.7	28%	5.2	65.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Residential	9.7	7.0	2.6	27.2%												
		W3		29.4	8.8	20.6	70.1%												
		W4		30.8	8.9	21.9	71.0%												
		W5		28.1	7.8	20.3	72.3%	13.0	12.1	93%	4.8	37%	7.3	60.4%	2	0	0	0	100.0%	0.0%
First	R1	W1-L	Bedroom	22.2	10.9	11.2	50.7%												
		W1-U						9.9	9.1	92%	3.9	40%	5.1	56.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	14.5	11.3	3.3	22.5%												
		W2-U																		
		W3-L		33.1	9.8	23.2	70.3%												
		W3-U						11.8	11.3	95%	7.1	60%	4.2	37.3%	12	0	8	0	33.3%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
21 Hale Road																			
Ground	R1	W1-L	Bedroom	12.0	6.2	5.7	47.8%												
		W1-U						9.2	6.9	75%	2.5	27%	4.4	63.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	5.8	3.0	2.8	47.9%	11.4	2.7	24%	1.5	13%	1.2	46.1%	0	0	0	0	0.0%	0.0%
First	R1	W1-L	Bedroom	18.7	9.4	9.3	49.9%												
		W1-U						9.3	7.1	76%	3.1	33%	4.1	57.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W3	Kitchen	32.2	11.0	21.2	65.9%	6.3	6.0	95%	3.1	49%	2.9	48.2%	N/F	N/F	N/F	N/F	N/F	N/F
19 Hale Road																			
Ground	R2	W2	Kitchen	28.9	9.5	19.4	67.2%												
		W3		20.1	5.0	15.1	75.3%												
		W4		10.0	4.3	5.7	57.0%	10.8	6.7	62%	2.3	22%	4.4	65.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W5-L	Bedroom	12.5	4.4	8.1	64.9%												
		W5-U						9.9	7.7	78%	1.9	20%	5.8	74.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	32.4	10.7	21.7	67.0%												
		W1-U																		
		W2-L		23.1	13.2	9.9	42.9%												
		W2-U						11.8	11.3	96%	10.5	89%	0.8	7.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W3-L	Bedroom	23.6	9.8	13.8	58.4%												
		W3-U						9.9	9.4	95%	2.7	27%	6.7	71.2%	N/F	N/F	N/F	N/F	N/F	N/F
1 Hale Road																			
Ground	R1	W1	Bedroom	22.0	19.5	2.6	11.6%	9.8	9.1	93%	9.0	92%	0.1	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	31.0	30.9	0.0	0.1%												
		W3-L		19.0	15.0	3.9	20.7%												
		W3-U						10.8	10.7	99%	10.3	96%	0.4	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	25.9	20.1	5.9	22.6%												
		W1-U						9.8	9.3	94%	9.1	93%	0.1	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	29.0	29.0	0.1	0.2%												
		W2-U																		
		W3-L		35.1	19.9	15.2	43.4%												
		W3-U						12.4	12.1	97%	11.7	94%	0.4	3.3%	N/F	N/F	N/F	N/F	N/F	N/F
3 Hale Road																			
Ground	R1	W1	Residential	24.5	12.7	11.8	48.0%												
		W2		27.6	13.8	13.8	50.2%	4.5	4.2	94%	3.4	76%	0.8	18.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W3	Kitchen	13.4	5.6	7.8	58.2%												
		W4		8.8	4.3	4.4	50.5%												
		W5-L		6.4	2.8	3.6	56.5%												
		W5-U						11.9	9.6	80%	5.3	45%	4.3	44.5%	11	0	3	0	72.7%	0.0%
Ground	R3	W6	Bedroom	12.3	1.7	10.6	86.4%	9.8	7.9	81%	1.8	18%	6.2	77.7%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R1	W1-L	Residential	35.0	18.9	16.1	45.9%												
		W1-U						11.3	11.0	97%	8.3	73%	2.7	24.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	24.2	9.0	15.2	62.8%												
		W2-U						9.8	9.4	95%	4.7	47%	4.7	50.2%	N/F	N/F	N/F	N/F	N/F	N/F
5 Hale Road																			
Ground	R1	W1	Bedroom	13.0	6.1	6.8	52.8%	9.8	7.7	79%	5.8	59%	2.0	25.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	11.1	10.0	1.1	9.9%	9.5	5.1	54%	5.1	54%	0.0	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W3-L	Residential	25.9	9.7	16.1	62.4%												
		W3-U																		
		W4		29.4	10.2	19.2	65.5%	3.3	3.0	90%	2.9	87%	0.1	4.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	23.1	11.4	11.7	50.5%												
		W1-U						9.8	9.1	92%	7.2	73%	1.9	20.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	34.7	11.6	23.1	66.6%												
		W2-U						10.9	10.5	96%	2.4	22%	8.1	76.7%	N/F	N/F	N/F	N/F	N/F	N/F
7 Hale Road																			
Ground	R1	W1	Residential	29.6	8.4	21.2	71.6%												
		W2-L		26.4	7.6	18.8	71.2%												
		W2-U						3.3	3.0	90%	2.5	77%	0.4	14.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W3	Kitchen	10.8	6.8	4.0	36.8%	9.6	4.9	51%	3.9	40%	1.0	21.2%	3	0	3	0	0.0%	0.0%
Ground	R3	W4	Bedroom	12.1	2.0	10.1	83.2%	9.8	7.9	80%	2.0	21%	5.8	74.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Residential	34.6	10.0	24.6	71.2%												
		W1-U						10.9	10.5	96%	3.4	31%	7.1	67.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	24.9	6.5	18.4	73.8%												
		W2-U						9.8	9.3	95%	3.7	37%	5.6	60.6%	N/F	N/F	N/F	N/F	N/F	N/F
9 Hale Road																			
Ground	R1	W1	Bedroom	1.5	0.0	1.5	100.0%	9.8	6.1	62%	0.0	0%	6.1	100.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	5.6	1.0	4.6	82.6%	9.9	5.2	52%	4.1	42%	1.0	19.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W3-L	Residential	27.6	6.7	20.9	75.7%												
		W3-U						4.5	4.3	95%	2.4	53%	1.9	44.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	24.6	6.7	17.9	72.8%												
		W1-U						9.8	9.3	95%	4.1	41%	5.3	56.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	34.2	7.5	26.7	78.0%												
		W2-U						12.4	11.8	95%	2.0	16%	9.8	82.9%	N/F	N/F	N/F	N/F	N/F	N/F
1B Park View Road																			
Ground	R2	W1-L	Living Room	31.4	30.5	0.9	2.8%												
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		32.4	30.0	2.4	7.4%													
		W2-U																		
		W3-L		23.9	21.6	2.4	9.9%													
		W3-U						13.5	13.4	100%	13.4	99%	0.0	0.2%	50	11	46	9	8.0%	18.2%
First	R1	W3-L	Study	31.7	29.3	2.4	7.6%													
		W3-U						5.1	5.0	97%	5.0	97%	0.0	0.0%	43	10	38	7	11.6%	30.0%
First	R2	W1-L	Bedroom	31.9	29.6	2.3	7.2%													
		W1-U																		
		W2-L		31.8	29.4	2.4	7.5%													
		W2-U						12.0	11.9	99%	11.9	99%	0.0	0.0%	45	11	41	8	8.9%	27.3%
Second	R1	W1	Bedroom	82.0	80.1	1.9	2.3%													
		W2		82.2	80.2	2.0	2.4%													
		W3		38.9	38.9	0.0	0.0%	18.8	18.7	100%	18.7	100%	0.0	0.0%	91	21	88	19	3.3%	9.5%
1A Park View Road																				
Ground	R1	W2-L	Living Room	29.8	28.7	1.1	3.6%													
		W2-U																		
		W3-L		32.0	29.3	2.7	8.4%													
		W3-U																		
		W4-L		24.7	22.2	2.5	10.2%													
		W4-U						13.5	13.5	100%	13.5	100%	0.0	0.0%	53	10	51	10	3.8%	0.0%
First	R1	W2-L	Bedroom	31.5	28.9	2.6	8.2%													
		W2-U																		
		W3-L		31.4	28.8	2.6	8.4%													
		W3-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	41	8	39	8	4.9%	0.0%
First	R2	W1-L	Study	31.6	29.0	2.5	8.0%													
		W1-U						5.1	4.9	96%	4.9	95%	0.0	0.8%	43	10	39	8	9.3%	20.0%
Second	R1	W1	Bedroom	81.7	79.6	2.1	2.5%													
		W2		81.4	79.2	2.2	2.6%													
		W3		38.7	38.7	0.0	0.0%	18.9	18.9	100%	18.9	100%	0.0	0.1%	87	17	84	16	3.4%	5.9%
1 Park View Road																				
Ground	R2	W2-L	Living Room	30.8	30.2	0.7	2.2%													
		W2-U																		
		W3-L		33.1	31.1	2.0	6.1%													
		W3-U																		
		W4-L		26.7	24.4	2.3	8.6%													
		W4-U						11.2	11.1	100%	11.1	100%	0.0	0.0%	52	11	48	8	7.7%	27.3%
First	R1	W1-L	Bedroom	33.6	31.7	1.9	5.7%													
		W1-U																		
		W2-L		33.6	31.6	2.0	6.0%													
		W2-U						11.9	11.7	98%	11.7	98%	0.0	0.0%	48	12	44	9	8.3%	25.0%
2 Park View Road																				
Ground	R1	W1-L	Living Room	29.7	29.2	0.5	1.8%													
		W1-U																		
		W2-L		33.5	31.7	1.8	5.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-U																	
		W3-L		26.9	24.8	2.2	8.0%												
		W3-U						20.2	20.1	100%	19.2	95%	1.0	4.8%	52	12	48	9	7.7%	25.0%
First	R1	W1-L	Bedroom	33.7	31.9	1.8	5.3%												
		W1-U																	
		W2-L		33.7	31.8	1.9	5.5%												
		W2-U						12.4	12.2	99%	12.2	99%	0.0	0.0%	47	12	43	9	8.5%	25.0%
The Volunteer																			
First	R2	W2-L	Bedroom	26.4	26.3	0.1	0.3%												
		W2-U						12.3	11.3	92%	11.3	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W3	Kitchen	35.9	35.9	0.0	0.0%												
		W5-L		19.7	18.7	1.0	5.3%												
		W5-U						8.5	8.1	96%	8.1	96%	0.0	0.0%	40	2	39	2	2.5%	0.0%
3 Park View Road																			
Ground	R2	W3-L	Living Room	29.2	28.9	0.3	1.1%												
		W3-U																	
		W4-L		33.1	31.4	1.7	5.2%												
		W4-U																	
		W5-L		22.4	20.5	1.9	8.3%												
		W5-U						12.3	12.3	100%	12.3	100%	0.0	0.0%	50	11	46	8	8.0%	27.3%
First	R1	W1-L	Bedroom	33.8	32.2	1.6	4.8%												
		W1-U																	
		W2-L		33.7	32.0	1.7	5.1%												
		W2-U						12.1	11.9	99%	11.9	99%	0.0	0.0%	47	12	43	9	8.5%	25.0%
5 Park View Road																			
Ground	R1	W1	Kitchen	29.3	28.0	1.3	4.5%												
		W2		27.6	26.3	1.3	4.8%												
		W6-L		12.7	12.7	0.0	0.0%												
		W6-U																	
		W7-L		16.6	16.6	0.0	0.0%												
		W7-U						22.7	18.1	80%	18.1	80%	0.0	0.0%	72	12	68	8	5.6%	33.3%
Ground	R2	W3-L	Living Room	29.3	29.1	0.2	0.8%												
		W3-U																	
		W4-L		33.3	31.9	1.4	4.2%												
		W4-U																	
		W5-L		22.8	21.1	1.7	7.4%												
		W5-U						13.9	13.9	100%	13.9	100%	0.0	0.0%	50	11	46	7	8.0%	36.4%
First	R1	W1-L	Bedroom	34.0	32.6	1.4	4.0%												
		W1-U																	
		W2-L		33.9	32.5	1.4	4.2%												
		W2-U						11.9	11.7	98%	11.7	98%	0.0	0.0%	47	12	42	7	10.6%	41.7%
4 Park View Road																			
Ground	R1	W1-L	Living Room	27.6	27.3	0.3	0.9%												
		W1-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		33.2	31.6	1.5	4.6%													
		W2-U																		
		W3-L		23.0	21.2	1.7	7.6%													
		W3-U																		
		W8		12.7	12.7	0.0	0.0%													
		W9		15.0	15.0	0.0	0.0%	19.1	18.8	98%	18.6	97%	0.2	1.0%	56	13	53	10	5.4%	23.1%
First	R1	W1-L	Bedroom	33.9	32.4	1.5	4.4%													
		W1-U																		
		W2-L		33.8	32.3	1.6	4.6%													
		W2-U						14.0	13.8	98%	13.8	98%	0.0	0.0%	47	12	45	10	4.3%	16.7%
6 Park View Road																				
Ground	R1	W1-L	Living Room	27.2	27.1	0.2	0.6%													
		W1-U																		
		W2-L		33.4	32.2	1.3	3.8%													
		W2-U																		
		W3-L		23.4	21.9	1.6	6.6%													
		W3-U						11.4	11.3	99%	11.3	99%	0.0	0.1%	51	12	49	10	3.9%	16.7%
First	R1	W1-L	Bedroom	34.1	32.9	1.2	3.6%													
		W1-U																		
		W2-L		34.0	32.8	1.3	3.8%													
		W2-U						11.6	11.4	98%	11.3	97%	0.1	0.7%	45	10	43	8	4.4%	20.0%
Second	R1	W1-L	Bedroom	26.7	26.7	0.0	0.0%													
		W1-U																		
		W2		78.3	77.2	1.1	1.4%	14.6	13.9	95%	13.9	95%	0.0	0.0%	83	17	80	14	3.6%	17.6%
7A Park View Road																				
Ground	R2	W7-L	Living Room	30.8	30.6	0.2	0.6%													
		W7-U																		
		W8-L		33.5	32.3	1.2	3.6%													
		W8-U																		
		W9-L		22.4	20.9	1.5	6.7%													
		W9-U						13.9	13.9	100%	13.9	100%	0.0	0.0%	48	10	46	8	4.2%	20.0%
First	R1	W1-L	Bedroom	34.3	33.1	1.2	3.4%													
		W1-U																		
		W2-L		34.1	32.9	1.2	3.6%													
		W2-U						12.1	11.9	98%	11.9	98%	0.0	0.0%	44	10	42	8	4.5%	20.0%
Rosa Luxemburg Apartments																				
Ground	R9	W40-L	LKD	23.6	14.6	9.0	38.2%													
		W40-U																		
		W41-L		25.6	16.6	9.0	35.2%													
		W41-U						34.3	31.5	92%	25.8	75%	5.6	17.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	19.4	9.7	9.7	50.1%													
		W1-U						15.6	14.0	90%	4.1	26%	9.9	70.7%	40	12	20	0	50.0%	100.0%
First	R2	W2-L	Bedroom	21.2	10.9	10.2	48.4%													
		W2-U						9.9	7.8	79%	3.7	38%	4.1	52.3%	42	12	21	0	50.0%	100.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R3	W3-L	LKD	22.0	11.3	10.7	48.6%												
		W3-U																	
		W4-L		19.0	7.9	11.1	58.3%												
		W4-U																	
		W5-L		11.9	6.6	5.3	44.6%												
		W5-U																	
		W6-L		8.8	4.7	4.2	46.9%												
		W6-U						28.8	28.4	99%	12.3	43%	16.2	56.9%	47	14	29	1	38.3%	92.9%
First	R4	W7-L	Bedroom	7.2	4.0	3.2	45.0%												
		W7-U						13.7	3.7	27%	1.4	10%	2.3	62.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W8-L	LKD	4.9	4.7	0.2	4.1%												
		W8-U																	
		W9-L		24.9	13.0	11.9	47.7%												
		W9-U						34.8	28.6	82%	7.4	21%	21.2	74.3%	53	16	31	1	41.5%	93.8%
First	R6	W10-L	Bedroom	21.5	11.7	9.7	45.3%												
		W10-U						13.1	11.7	89%	3.7	28%	8.0	68.5%	47	16	29	0	38.3%	100.0%
First	R7	W11-L	Bedroom	7.7	0.8	6.9	89.9%												
		W11-U						12.8	10.1	79%	0.5	4%	9.6	94.9%	12	9	3	0	75.0%	100.0%
First	R8	W12-L	Bedroom	10.8	6.9	4.0	36.4%												
		W12-U						17.2	13.7	79%	4.5	26%	9.2	67.4%	24	8	17	1	29.2%	87.5%
First	R9	W13-L	Bedroom	13.0	8.9	4.1	31.3%												
		W13-U						14.5	9.4	65%	6.4	44%	3.0	31.7%	29	7	18	1	37.9%	85.7%
First	R10	W14-L	Bedroom	14.1	9.5	4.7	33.0%												
		W14-U						13.5	5.9	43%	3.4	25%	2.5	41.9%	23	4	12	0	47.8%	100.0%
First	R11	W15-L	LKD	5.7	0.7	5.0	88.6%												
		W15-U						29.0	26.9	93%	4.0	14%	22.9	85.2%	16	10	2	0	87.5%	100.0%
First	R12	W16-L	LKD	19.3	11.1	8.3	42.8%												
		W16-U						27.2	26.8	99%	25.4	93%	1.5	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	10.7	2.7	8.0	74.8%												
		W1-U																	
		W2-L		11.1	2.4	8.7	78.3%												
		W2-U																	
		W3-L		27.4	9.6	17.8	64.8%												
		W3-U						26.9	26.7	99%	10.7	40%	16.0	59.8%	78	17	21	2	73.1%	88.2%
Second	R2	W4-L	Bedroom	27.5	8.7	18.8	68.5%												
		W4-U						8.4	7.8	93%	2.1	25%	5.7	72.6%	69	16	18	2	73.9%	87.5%
Second	R3	W5-L	Bedroom	27.7	8.2	19.5	70.5%												
		W5-U						12.0	11.0	92%	2.7	23%	8.3	75.2%	71	15	16	1	77.5%	93.3%
Second	R4	W6-L	LKD	27.6	9.0	18.6	67.4%												
		W6-U																	
		W7-L		7.0	0.7	6.3	89.8%												
		W7-U																	
		W8-L		19.1	12.7	6.5	33.9%												
		W8-U						23.3	22.7	97%	17.1	73%	5.7	24.9%	70	15	27	0	61.4%	100.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R5	W9-L	Bedroom	16.8	11.1	5.7	34.0%												
		W9-U						12.9	10.6	82%	7.3	56%	3.4	31.7%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10-L	Bedroom	19.8	11.6	8.3	41.6%												
		W10-U						14.5	13.2	91%	5.7	40%	7.5	56.7%	40	12	23	2	42.5%	83.3%
Second	R7	W11-L	Bedroom	21.7	13.2	8.5	39.1%												
		W11-U						9.1	7.7	85%	5.2	57%	2.6	32.9%	42	12	25	2	40.5%	83.3%
Second	R8	W12-L	LKD	22.9	14.0	8.9	38.8%												
		W12-U																		
		W13-L		6.7	0.4	6.3	94.3%												
		W13-U																		
		W14-L		10.3	6.1	4.2	40.8%												
		W14-U						27.3	26.9	99%	14.4	53%	12.5	46.6%	47	14	32	3	31.9%	78.6%
Second	R9	W15-L	Bedroom	8.0	4.7	3.3	41.1%												
		W15-U						14.0	3.8	27%	1.8	13%	2.0	52.6%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W16-L	Bedroom	6.0	5.9	0.1	1.5%												
		W16-U						13.0	2.3	18%	2.3	18%	0.0	0.0%	14	2	14	2	0.0%	0.0%
Second	R11	W17-L	LKD	8.3	7.8	0.5	6.0%												
		W17-U																		
		W18-L		11.6	3.8	7.9	67.5%												
		W18-U																		
		W19-L		24.4	14.9	9.4	38.8%												
		W19-U						23.4	23.0	98%	14.3	61%	8.7	37.9%	54	17	36	6	33.3%	64.7%
Second	R12	W20-L	LKD	9.2	3.1	6.1	66.3%												
		W20-U						22.9	22.5	98%	4.9	21%	17.6	78.4%	20	14	10	5	50.0%	64.3%
Second	R13	W21-L	Bedroom	11.6	8.5	3.1	27.0%												
		W21-U						15.3	12.4	81%	6.4	42%	5.9	48.1%	26	9	21	4	19.2%	55.6%
Second	R14	W22-L	Bedroom	13.6	9.9	3.8	27.7%												
		W22-U						14.5	9.8	68%	7.9	55%	1.9	19.4%	30	7	20	2	33.3%	71.4%
Second	R15	W23-L	Bedroom	15.1	10.9	4.2	27.6%												
		W23-U						13.5	6.1	45%	3.9	29%	2.2	36.6%	25	4	19	2	24.0%	50.0%
Second	R16	W24-L	LKD	6.3	1.3	5.0	79.9%												
		W24-U						29.0	27.0	93%	6.7	23%	20.3	75.1%	17	10	3	0	82.4%	100.0%
Second	R17	W25-L	LKD	20.0	11.5	8.5	42.6%												
		W25-U						27.2	26.8	99%	25.4	93%	1.5	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	11.7	4.0	7.6	65.4%												
		W1-U																		
		W2-L		12.1	4.0	8.2	67.2%												
		W2-U																		
		W3-L		28.1	12.3	15.8	56.3%												
		W3-U						26.9	26.8	100%	18.0	67%	8.8	32.9%	79	17	33	4	58.2%	76.5%
Third	R2	W4-L	Bedroom	28.2	11.5	16.7	59.4%												
		W4-U						8.4	7.8	93%	2.8	34%	5.0	63.8%	70	16	29	3	58.6%	81.3%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R3	W5-L	Bedroom	28.3	10.9	17.4	61.5%												
		W5-U						12.0	11.0	92%	3.5	29%	7.5	68.3%	71	15	28	1	60.6%	93.3%
Third	R4	W6-L	LKD	28.3	12.0	16.3	57.5%												
		W6-U																	
		W7-L		7.4	2.1	5.2	71.0%												
		W7-U																	
		W8-L		20.4	14.7	5.6	27.7%												
		W8-U						23.3	22.8	98%	20.1	86%	2.6	11.6%	70	15	35	1	50.0%	93.3%
Third	R5	W9-L	Bedroom	17.7	12.7	5.0	28.4%												
		W9-U						12.9	10.8	83%	8.0	62%	2.8	25.9%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10-L	Bedroom	20.3	13.6	6.7	33.0%												
		W10-U						14.5	13.3	92%	8.6	59%	4.7	35.5%	40	12	28	4	30.0%	66.7%
Third	R7	W11-L	Bedroom	22.3	15.5	6.8	30.4%												
		W11-U						9.1	8.0	88%	7.5	83%	0.5	6.2%	42	12	29	4	31.0%	66.7%
Third	R8	W12-L	LKD	23.6	16.6	7.1	29.9%												
		W12-U																	
		W13-L		7.2	1.8	5.3	74.3%												
		W13-U																	
		W14-L		11.3	7.3	4.0	35.5%												
		W14-U						27.3	26.9	99%	19.7	72%	7.2	26.8%	46	13	35	5	23.9%	61.5%
Third	R9	W15-L	Bedroom	8.9	5.7	3.2	36.0%												
		W15-U						14.0	3.9	28%	2.1	15%	1.8	45.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16-L	Bedroom	7.6	7.5	0.1	0.8%												
		W16-U						13.0	2.8	22%	2.8	22%	0.0	0.0%	15	3	15	3	0.0%	0.0%
Third	R11	W17-L	LKD	10.0	9.8	0.3	2.5%												
		W17-U																	
		W18-L		12.1	5.6	6.5	53.4%												
		W18-U																	
		W19-L		25.4	17.5	7.9	31.1%												
		W19-U						23.4	23.0	98%	19.8	84%	3.2	14.1%	57	19	41	10	28.1%	47.4%
Third	R12	W20-L	LKD	9.7	5.1	4.6	47.5%												
		W20-U						22.9	22.5	98%	8.0	35%	14.5	64.3%	22	14	15	10	31.8%	28.6%
Third	R13	W21-L	Bedroom	12.4	10.4	2.1	16.5%												
		W21-U						15.3	12.7	82%	9.5	62%	3.2	25.0%	27	9	24	6	11.1%	33.3%
Third	R14	W22-L	Bedroom	14.4	10.9	3.5	24.5%												
		W22-U						14.5	10.3	71%	9.0	62%	1.3	12.4%	30	7	23	5	23.3%	28.6%
Third	R15	W23-L	Bedroom	16.1	12.1	4.0	24.9%												
		W23-U						13.5	6.6	49%	4.5	33%	2.1	31.6%	26	4	20	2	23.1%	50.0%
Third	R16	W24-L	LKD	7.0	2.1	5.0	70.6%												
		W24-U						29.0	27.2	94%	10.2	35%	17.0	62.4%	18	10	4	0	77.8%	100.0%
Third	R17	W25-L	LKD	20.2	11.9	8.3	41.0%												
		W25-U						27.2	26.8	99%	25.5	94%	1.4	5.1%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R1	W1-L	LKD	12.3	5.1	7.3	58.8%												
		W1-U																	
		W2-L		14.1	6.0	8.1	57.7%												
		W2-U																	
		W3-L		28.8	15.9	12.8	44.6%												
		W3-U						29.5	28.4	96%	24.6	83%	3.8	13.4%	79	17	44	4	44.3%	76.5%
Fourth	R2	W4-L	Bedroom	28.8	15.9	12.9	44.7%												
		W4-U						12.2	9.0	74%	5.3	43%	3.7	41.3%	71	16	41	3	42.3%	81.3%
Fourth	R3	W5-L	Bedroom	29.0	15.3	13.7	47.3%												
		W5-U						12.6	11.7	93%	4.8	38%	7.0	59.4%	70	15	38	1	45.7%	93.3%
Fourth	R4	W6-L	LKD	29.0	16.6	12.4	42.7%												
		W6-U																	
		W7-L		7.8	4.0	3.8	49.0%												
		W7-U																	
		W8-L		21.8	16.8	5.0	22.9%												
		W8-U						23.3	22.8	98%	21.4	92%	1.3	5.8%	71	15	48	4	32.4%	73.3%
Fourth	R5	W9-L	Bedroom	18.7	14.1	4.6	24.5%												
		W9-U						12.9	11.0	85%	8.6	67%	2.4	21.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W10-L	Bedroom	20.8	15.1	5.7	27.3%												
		W10-U						14.5	13.4	92%	12.4	86%	1.0	7.3%	41	13	31	7	24.4%	46.2%
Fourth	R7	W11-L	Bedroom	23.0	17.2	5.8	25.2%												
		W11-U						9.1	8.3	91%	8.3	91%	0.0	0.1%	43	13	33	7	23.3%	46.2%
Fourth	R8	W12-L	LKD	24.5	18.4	6.1	24.9%												
		W12-U																	
		W13-L		8.5	3.6	4.9	57.5%												
		W13-U																	
		W14-L		12.9	9.1	3.8	29.4%												
		W14-U						27.3	27.0	99%	26.3	96%	0.7	2.4%	48	14	39	8	18.8%	42.9%
Fourth	R9	W15-L	Bedroom	10.3	7.2	3.1	30.0%												
		W15-U						14.0	4.1	29%	2.4	17%	1.7	41.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W16-L	Bedroom	9.9	9.9	0.0	0.5%												
		W16-U						13.0	4.1	32%	4.1	32%	0.0	0.0%	16	3	16	3	0.0%	0.0%
Fourth	R11	W17-L	LKD	12.4	12.2	0.1	1.1%												
		W17-U																	
		W18-L		12.7	7.0	5.6	44.6%												
		W18-U																	
		W19-L		26.6	19.6	7.0	26.4%												
		W19-U						23.4	23.1	98%	22.9	98%	0.1	0.5%	64	20	48	14	25.0%	30.0%
Fourth	R12	W20-L	LKD	10.4	6.5	3.9	37.3%												
		W20-U						22.9	22.5	98%	17.0	74%	5.5	24.6%	24	14	16	11	33.3%	21.4%
Fourth	R13	W21-L	Bedroom	13.8	12.6	1.2	8.6%												
		W21-U						15.3	13.0	85%	12.3	80%	0.7	5.3%	28	9	25	6	10.7%	33.3%
Fourth	R14	W22-L	Bedroom	15.5	12.2	3.3	21.5%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W22-U						14.5	11.0	76%	9.8	68%	1.2	10.8%	34	7	27	5	20.6%	28.6%
Fourth	R15	W23-L	Bedroom	17.4	13.5	3.9	22.3%													
		W23-U						13.5	7.4	55%	5.5	41%	1.9	25.4%	28	4	22	2	21.4%	50.0%
Fourth	R16	W24-L	LKD	8.0	3.6	4.5	55.8%													
		W24-U						29.0	27.7	95%	15.6	54%	12.1	43.8%	21	11	9	4	57.1%	63.6%
Fourth	R17	W25-L	LKD	20.4	14.0	6.4	31.3%													
		W25-U						27.2	26.8	99%	26.1	96%	0.8	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	13.0	6.0	6.9	53.5%													
		W1-U																		
		W2-L		14.7	7.0	7.7	52.1%													
		W2-U																		
		W3-L		29.4	20.9	8.5	28.8%													
		W3-U						29.5	28.6	97%	25.7	87%	3.0	10.4%	82	18	59	9	28.0%	50.0%
Fifth	R2	W4-L	Bedroom	29.5	21.2	8.3	28.2%													
		W4-U						12.2	9.0	74%	8.2	67%	0.9	9.5%	72	17	53	7	26.4%	58.8%
Fifth	R3	W5-L	Bedroom	29.6	21.0	8.6	29.1%													
		W5-U						12.6	11.8	94%	10.4	82%	1.5	12.3%	72	16	52	6	27.8%	62.5%
Fifth	R4	W6-L	LKD	29.6	21.2	8.4	28.5%													
		W6-U																		
		W7-L		8.2	6.5	1.8	21.2%													
		W7-U																		
		W8-L		23.6	19.1	4.4	18.8%													
		W8-U						23.3	22.8	98%	22.0	94%	0.7	3.2%	73	18	53	9	27.4%	50.0%
Fifth	R5	W9-L	Bedroom	19.9	15.7	4.1	20.8%													
		W9-U						12.9	11.3	87%	9.1	70%	2.2	19.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W10-L	Bedroom	21.3	16.4	4.9	23.0%													
		W10-U						14.5	13.5	93%	12.7	88%	0.8	5.7%	41	13	33	8	19.5%	38.5%
Fifth	R7	W11-L	Bedroom	23.9	18.9	5.0	21.1%													
		W11-U						9.1	8.6	95%	8.6	95%	0.0	0.0%	44	13	35	8	20.5%	38.5%
Fifth	R8	W12-L	LKD	25.7	20.4	5.3	20.6%													
		W12-U																		
		W13-L		9.0	4.6	4.4	48.8%													
		W13-U																		
		W14-L		15.3	11.7	3.6	23.3%													
		W14-U						27.3	27.0	99%	26.7	98%	0.3	1.1%	51	16	43	11	15.7%	31.3%
Fifth	R9	W15-L	Bedroom	12.6	9.6	3.0	23.6%													
		W15-U						14.0	4.6	33%	3.3	24%	1.3	27.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W16-L	Bedroom	13.3	13.2	0.0	0.2%													
		W16-U						13.0	6.4	49%	6.4	49%	0.0	0.0%	23	6	23	6	0.0%	0.0%
Fifth	R11	W17-L	LKD	15.6	15.4	0.3	1.8%													
		W17-U																		
		W18-L		13.3	8.2	5.1	38.5%													
		W18-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W19-L		28.0	21.4	6.5	23.3%												
		W19-U						23.4	23.1	99%	23.1	99%	0.0	0.0%	68	22	53	16	22.1%	27.3%
Fifth	R12	W20-L	LKD	11.7	7.7	4.0	34.4%												
		W20-U						22.9	22.6	99%	20.7	90%	1.9	8.4%	26	15	17	12	34.6%	20.0%
Fifth	R13	W21-L	Bedroom	15.6	14.9	0.7	4.5%												
		W21-U						15.3	13.6	89%	13.0	85%	0.6	4.3%	33	11	31	9	6.1%	18.2%
Fifth	R14	W22-L	Bedroom	17.1	13.8	3.3	19.4%												
		W22-U						14.5	11.9	82%	11.4	79%	0.5	4.6%	43	10	34	7	20.9%	30.0%
Fifth	R15	W23-L	Bedroom	19.4	15.7	3.7	19.2%												
		W23-U						13.5	8.5	63%	7.2	53%	1.3	15.8%	39	5	31	2	20.5%	60.0%
Fifth	R16	W24-L	LKD	9.3	5.3	3.9	42.3%												
		W24-U						29.0	28.5	98%	19.6	67%	8.9	31.3%	23	12	13	8	43.5%	33.3%
Fifth	R17	W25-L	LKD	20.5	16.3	4.2	20.6%												
		W25-U						27.2	26.8	99%	26.2	97%	0.6	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	14.9	7.5	7.4	49.6%												
		W1-U																		
		W2-L		16.4	8.5	7.9	48.1%												
		W2-U																		
		W3-L		30.0	24.9	5.1	17.0%												
		W3-U						29.5	28.8	98%	27.9	95%	0.9	3.1%	85	21	63	13	25.9%	38.1%
Sixth	R2	W4-L	Bedroom	30.0	24.8	5.3	17.5%												
		W4-U						12.2	9.1	75%	9.0	74%	0.1	1.0%	75	19	57	11	24.0%	42.1%
Sixth	R3	W5-L	Bedroom	30.1	24.9	5.2	17.3%												
		W5-U						12.6	11.9	95%	11.9	95%	0.0	0.1%	74	18	57	10	23.0%	44.4%
Sixth	R4	W6-L	LKD	30.2	24.8	5.4	17.8%												
		W6-U																		
		W7-L		9.6	8.4	1.3	13.1%												
		W7-U																		
		W8-L		26.0	21.9	4.1	15.6%												
		W8-U						23.3	22.8	98%	22.5	97%	0.2	1.1%	74	18	57	11	23.0%	38.9%
Sixth	R5	W9-L	Bedroom	21.7	17.9	3.8	17.6%												
		W9-U						12.9	11.4	88%	9.4	72%	2.0	17.9%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W10-L	Bedroom	22.1	17.5	4.5	20.5%												
		W10-U						14.5	13.6	94%	12.9	89%	0.7	5.3%	43	13	35	8	18.6%	38.5%
Sixth	R7	W11-L	Bedroom	25.1	20.5	4.7	18.6%												
		W11-U						9.1	8.8	97%	8.8	97%	0.0	0.0%	47	13	39	8	17.0%	38.5%
Sixth	R8	W12-L	LKD	28.0	23.1	4.9	17.5%												
		W12-U																		
		W13-L		26.1	21.0	5.2	19.7%												
		W13-U																		
		W14-L		18.7	15.3	3.4	18.0%												
		W14-U						27.3	27.1	99%	27.1	99%	0.0	0.0%	56	16	49	11	12.5%	31.3%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R9	W15-L	Bedroom	16.6	13.6	3.0	17.9%												
		W15-U						14.0	5.7	41%	4.6	33%	1.0	18.2%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W16-L	Bedroom	17.8	17.8	0.1	0.3%												
		W16-U						13.0	9.6	74%	9.6	74%	0.0	0.0%	26	6	26	6	0.0%	0.0%
Sixth	R11	W17-L	LKD	19.6	18.7	0.9	4.7%												
		W17-U																		
		W18-L		14.9	9.8	5.2	34.5%												
		W18-U																		
		W19-L		29.6	23.2	6.5	21.8%												
		W19-U						23.4	23.1	99%	23.1	99%	0.0	0.0%	72	24	56	18	22.2%	25.0%
Sixth	R12	W20-L	LKD	14.8	9.4	5.4	36.6%												
		W20-U						22.9	22.7	99%	21.7	95%	1.0	4.2%	36	20	22	14	38.9%	30.0%
Sixth	R13	W21-L	Bedroom	17.7	16.5	1.2	7.0%												
		W21-U						15.3	14.0	91%	13.5	88%	0.5	3.7%	36	15	34	13	5.6%	13.3%
Sixth	R14	W22-L	Bedroom	18.7	15.3	3.4	18.2%												
		W22-U						14.5	12.7	88%	12.6	87%	0.1	0.4%	46	13	39	11	15.2%	15.4%
Sixth	R15	W23-L	Bedroom	21.6	17.9	3.7	17.1%												
		W23-U						13.5	9.8	73%	9.3	69%	0.5	5.5%	47	13	39	11	17.0%	15.4%
Sixth	R16	W24-L	LKD	25.9	21.8	4.1	15.8%												
		W24-U						29.0	28.9	100%	24.3	84%	4.7	16.1%	48	14	39	12	18.8%	14.3%
Sixth	R17	W25-L	LKD	38.3	34.7	3.5	9.3%												
		W25-U						27.2	26.9	99%	26.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	28.3	19.0	9.3	32.8%												
		W1-U																		
		W2-L		33.2	23.3	9.9	29.7%												
		W2-U																		
		W3-L		30.6	26.1	4.5	14.6%												
		W3-U						29.5	29.0	98%	29.0	98%	0.0	0.1%	86	21	65	13	24.4%	38.1%
Seventh	R2	W4-L	Bedroom	30.6	26.1	4.6	14.9%												
		W4-U						12.2	9.2	76%	9.1	75%	0.1	0.8%	76	20	60	13	21.1%	35.0%
Seventh	R3	W5-L	Bedroom	30.8	26.1	4.6	15.1%												
		W5-U						12.6	12.1	96%	12.1	96%	0.0	0.0%	73	18	58	11	20.5%	38.9%
Seventh	R4	W6-L	LKD	30.8	26.0	4.8	15.7%												
		W6-U																		
		W7-L		11.0	9.9	1.1	10.1%												
		W7-U																		
		W8-L		29.5	25.8	3.8	12.8%												
		W8-U						23.3	22.8	98%	22.6	97%	0.2	0.8%	74	19	59	12	20.3%	36.8%
Seventh	R5	W9-L	Bedroom	25.9	22.3	3.6	13.8%												
		W9-U						12.9	11.4	88%	9.5	74%	1.9	16.7%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10-L	Bedroom	23.5	19.3	4.3	18.1%												
		W10-U						14.0	13.5	96%	12.9	92%	0.6	4.5%	45	13	37	8	17.8%	38.5%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Seventh	R7	W11-L	LKD	27.1	22.7	4.4	16.2%												
		W11-U																	
		W12-L		29.8	25.2	4.7	15.7%												
		W12-U																	
		W13-L		27.5	24.2	3.3	12.1%												
		W13-U						26.6	26.3	99%	26.3	99%	0.0	0.0%	64	19	58	14	9.4%	26.3%
Seventh	R8	W14-L	Bedroom	23.3	22.4	0.9	3.9%												
		W14-U						13.0	11.4	88%	11.3	87%	0.1	0.4%	34	8	31	8	8.8%	0.0%
Seventh	R9	W15-L	LKD	24.6	22.6	1.9	7.9%												
		W15-U																	
		W16-L		26.2	21.1	5.2	19.7%												
		W16-U																	
		W17-L		31.1	24.7	6.4	20.6%												
		W17-U						23.5	23.2	99%	23.2	99%	0.0	0.1%	74	25	58	18	21.6%	28.0%
Seventh	R10	W18-L	LKD	27.9	21.5	6.3	22.7%												
		W18-U						23.1	22.9	99%	22.6	98%	0.4	1.5%	65	22	48	14	26.2%	36.4%
Seventh	R11	W19-L	Bedroom	20.8	18.6	2.1	10.3%												
		W19-U						15.3	14.4	94%	14.0	91%	0.4	2.9%	51	17	44	14	13.7%	17.6%
Seventh	R12	W20-L	Bedroom	23.5	19.7	3.8	16.1%												
		W20-U																	
		W21-L		33.1	25.3	7.8	23.6%												
		W21-U						11.5	11.4	98%	10.9	94%	0.5	4.3%	83	25	63	15	24.1%	40.0%
Seventh	R13	W22-L	Bedroom	27.9	20.0	7.9	28.4%												
		W22-U						12.0	11.5	96%	10.6	88%	0.9	7.9%	67	24	47	14	29.9%	41.7%
Seventh	R14	W23-L	Bedroom	33.8	25.4	8.4	24.8%												
		W23-U						13.5	12.7	94%	10.0	74%	2.7	21.1%	81	24	62	14	23.5%	41.7%
Seventh	R15	W24-L	LKD	34.0	25.5	8.5	25.0%												
		W24-U																	
		W25-L		38.2	35.9	2.3	6.0%												
		W25-U																	
		W26-L		34.8	32.8	2.0	5.8%												
		W26-U						33.5	33.2	99%	33.2	99%	0.0	0.1%	81	23	66	15	18.5%	34.8%
Eighth	R1	W1-L	LKD	34.9	26.8	8.1	23.2%												
		W1-U						21.6	21.3	98%	21.2	98%	0.1	0.3%	54	15	38	10	29.6%	33.3%
Eighth	R2	W2-L	Bedroom	34.8	26.4	8.4	24.2%												
		W2-U																	
		W3-L		25.2	22.8	2.5	9.8%												
		W3-U						13.8	13.8	100%	13.8	100%	0.0	0.0%	68	18	53	13	22.1%	27.8%
Eighth	R3	W4-L	Bedroom	31.8	27.2	4.6	14.5%												
		W4-U						14.2	14.1	99%	14.0	99%	0.0	0.3%	79	22	62	16	21.5%	27.3%
Eighth	R4	W5-L	LKD	31.9	27.1	4.8	15.1%												
		W5-U																	
		W6-L		30.8	27.4	3.4	11.0%												
		W6-U						22.1	22.0	100%	22.0	100%	0.0	0.0%	75	20	58	12	22.7%	40.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R5	W7-L	Bedroom	26.5	22.6	4.0	15.0%												
		W7-U						9.3	8.5	91%	8.0	86%	0.5	6.0%	50	13	43	8	14.0%	38.5%
Eighth	R6	W8-L	LKD	30.5	26.0	4.5	14.7%												
		W8-U																	
		W9-L		31.1	28.1	3.0	9.6%												
		W9-U																	
		W10-L		31.2	28.5	2.8	8.9%												
		W10-U						28.6	28.2	99%	28.2	99%	0.0	0.1%	66	17	56	12	15.2%	29.4%
Eighth	R7	W11-L	LKD	17.8	17.8	0.0	0.0%												
		W11-U																	
		W12-L		31.9	28.6	3.4	10.6%												
		W12-U																	
		W13-L		32.2	26.1	6.2	19.1%												
		W13-U						33.8	33.7	100%	33.7	100%	0.0	0.0%	84	25	68	18	19.0%	28.0%
Eighth	R8	W14-L	Bedroom	30.1	23.6	6.4	21.4%												
		W14-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	68	22	54	15	20.6%	31.8%
Eighth	R9	W15-L	Bedroom	21.9	19.9	2.1	9.3%												
		W15-U						14.0	12.4	89%	11.7	84%	0.7	5.3%	51	18	44	15	13.7%	16.7%
Eighth	R10	W16-L	Bedroom	26.2	22.4	3.8	14.6%												
		W16-U																	
		W17-L		34.1	26.6	7.5	22.0%												
		W17-U						13.0	12.9	100%	12.0	92%	0.9	7.1%	89	26	70	16	21.3%	38.5%
Eighth	R11	W18-L	Bedroom	34.3	26.6	7.7	22.4%												
		W18-U						11.4	10.9	95%	10.2	89%	0.7	6.6%	83	26	64	16	22.9%	38.5%
Eighth	R12	W19-L	Bedroom	33.3	25.8	7.4	22.4%												
		W19-U						8.3	7.9	96%	7.4	89%	0.5	6.9%	70	22	57	14	18.6%	36.4%
Eighth	R13	W20-L	LKD	34.5	26.8	7.7	22.3%												
		W20-U																	
		W21-L		38.9	37.0	2.0	5.0%												
		W21-U						28.5	28.2	99%	28.2	99%	0.0	0.1%	80	24	69	17	13.8%	29.2%
Ninth	R2	W2-L	LKD	31.4	31.4	0.0	0.0%												
		W2-U																	
		W3-L		35.0	31.1	3.9	11.0%												
		W3-U						33.0	30.5	92%	29.4	89%	1.1	3.6%	54	14	46	11	14.8%	21.4%
Ninth	R3	W4-L	Bedroom	35.1	31.0	4.1	11.6%												
		W4-U																	
		W5-L		33.5	27.6	5.9	17.5%												
		W5-U						14.6	13.6	93%	13.4	92%	0.1	1.0%	90	24	76	17	15.6%	29.2%
Ninth	R5	W7-L	Bedroom	25.4	23.0	2.4	9.5%												
		W7-U						13.8	8.4	60%	6.2	45%	2.2	26.0%	58	19	50	16	13.8%	15.8%
Ninth	R6	W8-L	Bedroom	30.9	27.1	3.8	12.2%												
		W8-U																	
		W9-L		34.5	27.4	7.2	20.7%												
		W9-U						13.3	12.0	90%	11.5	86%	0.5	4.3%	91	26	74	16	18.7%	38.5%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ninth	R7	W10-L	Bedroom	34.7	27.4	7.3	21.1%												
		W10-U						11.1	10.8	97%	9.6	87%	1.1	10.4%	83	27	66	17	20.5%	37.0%
Ninth	R8	W11-L	LKD	34.8	27.6	7.3	20.9%												
		W11-U																	
		W12-L		16.6	14.7	1.9	11.3%												
		W12-U																	
		W13-L		15.7	15.5	0.2	1.5%												
		W13-U						31.6	31.5	100%	31.5	100%	0.0	0.0%	81	24	68	17	16.0%	29.2%
West Apartments																			
First	R1	W1-L	LKD	13.4	9.0	4.4	32.8%												
		W1-U																	
		W2-L		4.9	0.5	4.4	90.2%												
		W2-U																	
		W7-L		1.5	0.0	1.5	100.0%												
		W7-U						30.8	20.1	65%	6.0	19%	14.1	70.2%	27	2	19	0	29.6%	100.0%
First	R2	W3-L	LKD	0.0	0.0	0.0	0.0%												
		W3-U																	
		W4-L		17.3	10.4	6.9	39.9%												
		W4-U																	
		W6-L		0.9	0.0	0.9	100.0%												
		W6-U						30.8	17.2	56%	5.1	17%	12.1	70.2%	32	2	21	0	34.4%	100.0%
First	R3	W5-L	Bedroom	31.6	12.2	19.4	61.3%												
		W5-U						12.8	12.6	98%	5.2	40%	7.4	58.8%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W8-L	Bedroom	17.6	8.6	9.0	51.1%												
		W8-U						12.8	9.3	72%	4.8	37%	4.5	48.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W9-L	Bedroom	6.1	2.0	4.1	67.3%												
		W9-U						12.3	7.9	64%	2.1	17%	5.8	73.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W10-L	Bedroom	15.1	7.7	7.4	49.0%												
		W10-U						13.7	10.0	73%	10.0	73%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W11-L	LKD	13.1	4.7	8.4	64.4%												
		W11-U																	
		W12-L		13.9	5.5	8.4	60.4%												
		W12-U						28.4	24.9	88%	22.5	79%	2.4	9.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W13-L	Bedroom	22.8	13.8	9.0	39.4%												
		W13-U						14.0	12.8	91%	12.6	90%	0.2	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W14-L	LKD	20.2	9.7	10.5	52.1%												
		W14-U																	
		W15-L		18.5	7.3	11.2	60.5%												
		W15-U						28.4	26.1	92%	22.8	80%	3.3	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
First	R10	W16-L	Bedroom	14.1	5.7	8.5	60.0%												
		W16-U						9.7	9.3	96%	5.7	58%	3.6	39.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W17-L	Bedroom	14.4	6.0	8.5	58.7%												
		W17-U						35.6	33.1	93%	26.3	74%	6.7	20.3%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R1	W1-L	LKD	14.6	10.2	4.4	29.9%												
		W1-U																	
		W2-L		5.1	0.6	4.4	87.4%												
		W2-U																	
		W7-L		1.8	0.0	1.8	100.0%												
		W7-U						30.8	20.1	65%	6.7	22%	13.5	66.9%	28	2	20	0	28.6%	100.0%
Second	R2	W3-L	LKD	0.0	0.0	0.0	0.0%												
		W3-U																	
		W4-L		18.6	11.8	6.8	36.8%												
		W4-U																	
		W6-L		1.2	0.0	1.2	100.0%												
		W6-U						30.8	19.4	63%	6.4	21%	13.0	67.0%	34	2	23	0	32.4%	100.0%
Second	R3	W5-L	Bedroom	32.4	14.5	17.9	55.4%												
		W5-U						12.8	12.6	98%	7.0	54%	5.7	44.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W8-L	Bedroom	18.1	10.2	8.0	43.9%												
		W8-U						12.8	9.3	73%	6.1	48%	3.2	34.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W9-L	Bedroom	6.3	2.8	3.5	55.4%												
		W9-U						12.3	7.9	64%	3.2	26%	4.7	59.6%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10-L	Bedroom	16.3	9.3	7.0	43.2%												
		W10-U						13.7	10.4	76%	10.4	76%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W11-L	LKD	15.0	7.1	7.9	52.6%												
		W11-U																	
		W12-L		15.3	7.1	8.2	53.4%												
		W12-U						28.4	25.3	89%	22.9	81%	2.4	9.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W13-L	Bedroom	25.0	15.7	9.2	37.0%												
		W13-U						14.0	13.4	96%	13.3	95%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W14-L	LKD	22.5	11.8	10.6	47.4%												
		W14-U																	
		W15-L		20.2	9.1	11.1	54.8%												
		W15-U						28.4	26.2	92%	22.8	80%	3.3	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W16-L	Bedroom	15.0	6.2	8.8	58.6%												
		W16-U						9.7	9.4	96%	5.7	59%	3.7	39.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W17-L	Bedroom	15.5	6.5	9.0	57.8%												
		W17-U						35.6	33.2	93%	26.7	75%	6.5	19.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	15.7	11.4	4.3	27.2%												
		W1-U																	
		W2-L		5.2	0.8	4.4	84.6%												
		W2-U																	
		W7-L		2.0	0.0	2.0	100.0%												
		W7-U						30.8	20.2	65%	8.8	28%	11.4	56.5%	30	3	23	1	23.3%	66.7%
Third	R2	W3-L	LKD	0.0	0.0	0.0	0.0%												
		W3-U																	
		W4-L		19.9	13.2	6.8	34.0%												
		W4-U																	
		W6-L		1.4	0.0	1.4	100.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W6-U						30.8	21.4	69%	9.0	29%	12.4	58.0%	37	3	27	1	27.0%	66.7%
Third	R3	W5-L	Bedroom	33.1	17.0	16.1	48.7%													
		W5-U						12.8	12.6	98%	9.5	74%	3.1	24.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W8-L	Bedroom	18.7	12.0	6.7	35.9%													
		W8-U						12.8	9.4	73%	8.1	63%	1.3	13.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W9-L	Bedroom	6.5	3.7	2.8	43.3%													
		W9-U						12.3	7.9	64%	4.7	38%	3.2	40.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10-L	Bedroom	18.9	12.4	6.6	34.7%													
		W10-U						13.7	11.9	87%	11.9	86%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W11-L	LKD	18.7	10.8	7.9	42.2%													
		W11-U																		
		W12-L		17.9	9.4	8.5	47.5%													
		W12-U						28.4	25.8	91%	23.5	83%	2.3	9.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W13-L	Bedroom	27.6	18.2	9.5	34.3%													
		W13-U						14.0	13.8	99%	13.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W14-L	LKD	25.0	14.4	10.7	42.5%													
		W14-U																		
		W15-L		22.2	11.4	10.8	48.7%													
		W15-U						28.4	26.2	92%	22.9	80%	3.4	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16-L	Bedroom	15.9	6.9	9.0	56.6%													
		W16-U						9.7	9.4	96%	6.0	61%	3.4	36.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W17-L	Bedroom	16.6	7.2	9.4	56.7%													
		W17-U						35.6	33.2	93%	27.1	76%	6.1	18.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	16.8	12.7	4.1	24.4%													
		W1-U																		
		W2-L		5.3	1.0	4.3	81.7%													
		W2-U																		
		W7-L		2.2	0.1	2.0	94.0%													
		W7-U						30.8	20.5	66%	13.7	44%	6.8	33.0%	33	4	26	2	21.2%	50.0%
Fourth	R2	W3-L	LKD	0.0	0.0	0.0	0.0%													
		W3-U																		
		W4-L		21.2	14.6	6.6	31.1%													
		W4-U																		
		W6-L		1.7	0.1	1.6	94.7%													
		W6-U						30.8	21.6	70%	14.3	46%	7.3	33.8%	39	4	29	2	25.6%	50.0%
Fourth	R3	W5-L	Bedroom	33.8	19.9	13.9	41.1%													
		W5-U						12.8	12.6	98%	11.9	93%	0.7	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W8-L	Bedroom	19.4	14.0	5.4	27.8%													
		W8-U						12.8	9.5	74%	9.5	74%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W9-L	Bedroom	6.8	4.7	2.1	30.2%													
		W9-U						12.3	8.0	65%	6.7	54%	1.3	15.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W10-L	Bedroom	27.3	19.8	7.5	27.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						13.7	13.6	99%	13.6	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W11-L	LKD	25.1	16.2	8.9	35.4%													
		W11-U																		
		W12-L		22.3	13.1	9.2	41.1%													
		W12-U						28.4	26.3	93%	24.1	85%	2.2	8.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W13-L	Bedroom	30.4	20.8	9.7	31.7%													
		W13-U						14.0	13.8	99%	13.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W14-L	LKD	27.3	16.9	10.4	38.1%													
		W14-U																		
		W15-L		24.1	13.6	10.5	43.5%													
		W15-U						28.4	26.3	93%	23.1	81%	3.2	12.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W16-L	Bedroom	16.9	7.9	9.0	53.3%													
		W16-U						9.7	9.4	96%	7.1	73%	2.3	24.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W17-L	Bedroom	17.6	8.1	9.5	54.0%													
		W17-U						35.6	33.3	93%	27.6	77%	5.7	17.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	12.5	10.4	2.2	17.4%													
		W1-U																		
		W2-L		32.9	24.1	8.7	26.6%													
		W2-U																		
		W3-L		28.3	19.6	8.7	30.6%													
		W3-U																		
		W4-L		24.3	15.7	8.5	35.1%													
		W4-U						35.2	30.1	86%	30.0	85%	0.1	0.2%	32	4	29	3	9.4%	25.0%
Fifth	R3	W6-L	Bedroom	34.0	25.0	8.9	26.3%													
		W6-U						11.5	11.5	99%	11.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W7-L	LKD	28.7	19.4	9.3	32.3%													
		W7-U																		
		W8-L		25.0	15.9	9.1	36.4%													
		W8-U						29.6	27.2	92%	25.4	86%	1.9	7.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W9-L	Bedroom	33.2	23.9	9.3	28.0%													
		W9-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W10-L	LKD	29.2	19.3	9.8	33.7%													
		W10-U																		
		W11-L		25.7	15.8	9.9	38.4%													
		W11-U						29.6	27.2	92%	25.0	84%	2.2	8.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W12-L	LKD	18.8	9.5	9.3	49.4%													
		W12-U						46.5	44.4	96%	41.7	90%	2.7	6.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	13.1	11.0	2.1	16.0%													
		W1-U																		
		W2-L		34.5	26.1	8.5	24.5%													
		W2-U																		
		W3-L		22.4	16.9	5.5	24.6%													
		W3-U																		
		W4-L		24.4	16.3	8.1	33.2%													
		W4-U						35.2	29.7	85%	29.7	84%	0.0	0.1%	34	6	32	6	5.9%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R3	W6-L	Bedroom	35.6	27.4	8.2	23.1%												
		W6-U						11.5	11.5	99%	11.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W7-L	LKD	35.9	27.5	8.4	23.5%												
		W7-U																	
		W8-L		35.7	27.4	8.3	23.3%												
		W8-U						29.6	27.3	92%	25.5	86%	1.8	6.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W9-L	Bedroom	35.2	26.9	8.3	23.6%												
		W9-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W10-L	LKD	35.5	26.8	8.7	24.4%												
		W10-U																	
		W11-L		36.1	27.5	8.6	23.8%												
		W11-U						29.6	27.2	92%	25.1	85%	2.0	7.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W12-L	LKD	15.8	8.9	6.9	43.6%												
		W12-U						46.5	43.9	95%	40.9	88%	3.0	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1	LKD	14.0	11.9	2.1	15.0%												
		W2		34.1	26.0	8.1	23.6%												
		W3-L		23.2	17.8	5.4	23.4%												
		W3-U																	
		W4		24.9	17.1	7.8	31.3%	35.2	30.1	86%	30.0	85%	0.1	0.2%	36	6	34	6	5.6%	0.0%
Seventh	R3	W6	Bedroom	35.9	28.2	7.7	21.5%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W7	Bedroom	35.8	28.1	7.7	21.6%	10.5	10.0	95%	9.8	93%	0.2	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8	LKD	25.8	18.2	7.7	29.8%												
		W9		26.7	18.9	7.8	29.3%												
		W10		34.8	30.1	4.7	13.5%	44.0	39.3	89%	39.3	89%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W11	Bedroom	34.2	29.9	4.3	12.6%	13.3	13.1	98%	13.0	98%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W12-L	Bedroom	33.5	29.4	4.1	12.2%												
		W12-U						13.7	13.6	99%	13.5	99%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1	LKD	14.6	12.6	2.0	13.6%												
		W2		35.3	27.7	7.7	21.7%												
		W3-L		23.3	18.3	5.1	21.7%												
		W3-U																	
		W4		25.2	17.7	7.5	29.7%	35.2	29.7	85%	29.7	85%	0.0	0.0%	38	7	36	7	5.3%	0.0%
Eighth	R3	W6	Bedroom	36.2	28.9	7.3	20.2%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W7	Bedroom	36.1	28.7	7.3	20.3%	10.5	10.0	95%	9.8	93%	0.2	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W8-L	LKD	29.2	21.9	7.4	25.2%												
		W8-U																	
		W9		27.0	19.5	7.4	27.6%												
		W10		35.3	31.0	4.3	12.2%	43.6	39.2	90%	39.1	90%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W11	Bedroom	34.7	30.7	4.0	11.6%	12.4	12.2	99%	12.2	98%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W12-L	Bedroom	34.0	30.2	3.8	11.2%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W12-U						12.7	12.5	99%	12.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1	LKD	15.5	13.5	1.9	12.4%													
		W2		34.7	27.5	7.3	20.9%													
		W3-L		23.9	19.0	4.9	20.6%													
		W3-U																		
		W4		25.5	18.4	7.1	27.9%	35.2	30.1	86%	30.1	85%	0.0	0.1%	39	8	37	8	5.1%	0.0%
Ninth	R3	W6	Bedroom	36.5	29.6	6.9	19.0%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W7	Bedroom	36.4	29.5	7.0	19.1%	10.5	10.0	95%	9.8	93%	0.2	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W8-L	LKD	29.5	22.6	7.0	23.6%													
		W8-U																		
		W9		27.2	20.2	7.1	25.9%													
		W10		35.8	31.6	4.2	11.7%	43.6	39.2	90%	39.2	90%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W11	Bedroom	35.2	31.3	3.9	11.2%	12.4	12.2	99%	12.2	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W12-L	Bedroom	34.5	30.7	3.7	10.8%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1	LKD	16.1	14.3	1.8	11.2%													
		W2		36.0	29.1	6.9	19.0%													
		W3-L		23.9	19.4	4.5	18.8%													
		W3-U																		
		W4		25.8	19.1	6.7	25.9%	35.2	29.8	85%	29.8	85%	0.0	0.0%	41	8	39	8	4.9%	0.0%
Tenth	R3	W6	Bedroom	36.9	30.4	6.5	17.7%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W7	Bedroom	36.8	30.2	6.5	17.8%	10.5	10.0	95%	9.8	93%	0.2	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W8-L	LKD	29.8	23.3	6.6	22.0%													
		W8-U																		
		W9		27.5	20.9	6.6	24.1%													
		W10		36.3	32.2	4.1	11.2%	43.6	39.2	90%	39.2	90%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W11	Bedroom	35.7	31.8	3.8	10.7%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W12-L	Bedroom	34.9	31.3	3.6	10.4%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1	LKD	17.2	15.4	1.7	10.1%													
		W2		35.4	29.0	6.4	18.0%													
		W3-L		24.0	19.9	4.1	17.0%													
		W3-U																		
		W4		26.1	19.8	6.3	24.0%	35.2	30.1	86%	30.1	85%	0.0	0.1%	41	8	39	8	4.9%	0.0%
Eleventh	R3	W6	Bedroom	37.3	31.3	6.1	16.3%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W7	Bedroom	37.1	31.0	6.1	16.4%	10.5	10.0	95%	9.8	93%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W8-L	LKD	30.1	24.0	6.1	20.3%													
		W8-U																		
		W9		27.7	21.5	6.2	22.3%													
		W10		36.7	32.8	4.0	10.8%	43.6	39.2	90%	39.2	90%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eleventh	R6	W11	Bedroom	36.1	32.4	3.7	10.3%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W12-L	Bedroom	35.4	31.9	3.5	10.0%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1	LKD	18.0	16.4	1.6	8.8%													
		W2		37.0	31.1	5.9	16.0%													
		W3-L		23.4	20.1	3.3	14.2%													
		W3-U																		
		W4		26.4	20.6	5.8	21.9%	35.2	29.8	85%	29.8	85%	0.0	0.0%	43	8	41	8	4.7%	0.0%
Twelfth	R3	W6	Bedroom	37.9	32.3	5.6	14.8%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W7	Bedroom	37.5	31.9	5.6	15.0%	10.5	10.0	95%	9.9	94%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W8-L	LKD	30.6	24.9	5.7	18.5%													
		W8-U																		
		W9		27.9	22.2	5.7	20.5%													
		W10		37.1	33.2	3.8	10.3%	43.6	39.2	90%	39.2	90%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W11	Bedroom	36.5	32.9	3.6	9.9%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W12-L	Bedroom	35.8	32.3	3.5	9.6%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1	LKD	19.4	17.9	1.5	7.7%													
		W2		38.6	33.2	5.4	14.0%													
		W3-L		31.0	28.2	2.8	9.1%													
		W3-U																		
		W4		38.7	33.5	5.3	13.6%	35.2	30.1	86%	30.1	85%	0.0	0.1%	46	9	45	9	2.2%	0.0%
Thirteenth	R3	W6	Bedroom	38.3	33.2	5.1	13.4%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W7	Bedroom	38.2	33.0	5.1	13.5%	10.5	10.0	95%	10.0	95%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W8-L	LKD	30.8	25.6	5.2	16.9%													
		W8-U																		
		W9		28.1	22.8	5.2	18.6%													
		W10		37.4	33.7	3.7	9.8%	43.6	39.2	90%	39.2	90%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W11	Bedroom	36.9	33.4	3.5	9.5%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W12-L	Bedroom	36.2	32.9	3.3	9.2%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1	LKD	20.8	19.5	1.3	6.3%													
		W2		38.9	34.1	4.8	12.4%													
		W3		39.0	34.3	4.8	12.2%													
		W4		39.1	34.4	4.7	12.1%	35.2	30.2	86%	30.1	86%	0.0	0.2%	50	10	50	10	0.0%	0.0%
Fourteenth	R3	W6	Bedroom	38.7	34.1	4.6	12.0%	14.3	14.2	100%	14.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W7	Bedroom	38.9	34.3	4.6	11.9%	10.5	10.0	96%	10.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W8-L	LKD	39.0	34.3	4.7	12.0%													
		W8-U																		
		W9		39.1	34.4	4.7	12.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10		37.7	34.2	3.5	9.3%	43.6	39.3	90%	39.2	90%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W11	Bedroom	37.2	33.9	3.4	9.0%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W12-L	Bedroom	36.6	33.4	3.2	8.8%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
WalterTull House																				
Second	R1	W1-L	LKD	27.8	27.8	0.0	0.0%													
		W1-U																		
		W2-L		7.6	5.5	2.1	27.5%													
		W2-U																		
		W3-L		25.7	22.8	2.9	11.3%													
		W3-U						34.4	32.2	94%	31.3	91%	0.9	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	29.3	29.3	0.0	0.0%													
		W1-U																		
		W2-L		7.8	5.7	2.1	26.4%													
		W2-U																		
		W3-L		26.2	23.4	2.8	10.7%													
		W3-U						34.4	32.7	95%	32.3	94%	0.4	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R2	W4	LKD	22.0	22.0	0.0	0.0%													
		W5-L		34.6	30.8	3.8	10.9%													
		W5-U																		
		W6-L		34.5	30.6	3.9	11.4%													
		W6-U																		
		W7-L		1.7	1.2	0.5	29.9%													
		W7-U						29.5	26.9	91%	25.8	87%	1.1	4.1%	43	11	33	8	23.3%	27.3%
Third	R3	W8-L	Bedroom	6.2	3.8	2.4	38.6%													
		W8-U						11.9	10.9	92%	9.9	84%	1.0	9.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W9-L	Bedroom	34.3	30.3	4.1	11.9%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W10-L	Bedroom	34.3	30.2	4.2	12.1%													
		W10-U						13.5	13.2	98%	12.7	94%	0.5	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W11-L	LKD	7.5	4.8	2.7	35.6%													
		W11-U																		
		W12-L		35.6	34.0	1.6	4.5%													
		W12-U																		
		W13-L		36.5	35.0	1.5	4.2%													
		W13-U						33.6	30.8	91%	30.7	91%	0.0	0.0%	87	28	80	26	8.0%	7.1%
Fourth	R1	W1-L	LKD	31.6	31.6	0.0	0.0%													
		W1-U																		
		W2-L		8.0	5.9	2.1	26.2%													
		W2-U																		
		W3-L		26.5	23.8	2.7	10.3%													
		W3-U						34.4	32.9	96%	32.6	95%	0.2	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R2	W4	LKD	22.1	22.1	0.0	0.0%													
		W5-L		35.0	31.3	3.7	10.5%													
		W5-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W6-L		34.9	31.1	3.8	10.9%												
		W6-U																	
		W7-L		1.8	1.3	0.6	29.9%												
		W7-U						29.5	26.9	91%	26.0	88%	0.9	3.3%	44	11	35	8	20.5%	27.3%
Fourth	R3	W8-L	Bedroom	6.4	4.0	2.4	37.7%												
		W8-U						11.9	10.9	92%	10.1	85%	0.8	7.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W9-L	Bedroom	34.8	30.8	4.0	11.4%												
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W10-L	Bedroom	34.7	30.7	4.0	11.6%												
		W10-U						13.5	13.2	98%	12.7	95%	0.4	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W11-L	LKD	7.7	5.0	2.7	35.3%												
		W11-U																	
		W12-L		36.0	34.4	1.6	4.4%												
		W12-U																	
		W13-L		36.9	35.4	1.5	4.1%												
		W13-U						33.6	30.8	91%	30.8	91%	0.0	0.0%	89	28	83	26	6.7%	7.1%
Fifth	R1	W1-L	LKD	34.9	34.9	0.0	0.0%												
		W1-U																	
		W2-L		8.2	6.1	2.1	25.7%												
		W2-U																	
		W3-L		26.7	24.1	2.6	9.8%												
		W3-U						34.4	32.9	96%	32.7	95%	0.1	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R2	W4	LKD	22.1	22.1	0.0	0.0%												
		W5-L		35.4	31.8	3.6	10.1%												
		W5-U																	
		W6-L		35.3	31.6	3.7	10.5%												
		W6-U																	
		W7-L		1.9	1.4	0.6	29.4%												
		W7-U						29.5	26.9	91%	26.2	89%	0.7	2.6%	44	11	36	8	18.2%	27.3%
Fifth	R3	W8-L	Bedroom	6.6	4.1	2.4	37.1%												
		W8-U						11.9	10.9	92%	10.2	86%	0.7	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W9-L	Bedroom	35.2	31.3	3.9	11.0%												
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W10-L	Bedroom	35.1	31.2	3.9	11.2%												
		W10-U						13.5	13.2	98%	12.8	95%	0.3	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W11-L	LKD	8.0	5.2	2.8	35.2%												
		W11-U																	
		W12-L		36.1	34.6	1.6	4.3%												
		W12-U																	
		W13-L		37.1	35.6	1.5	4.0%												
		W13-U						33.6	30.8	91%	30.8	91%	0.0	0.0%	89	28	83	26	6.7%	7.1%
Sixth	R1	W1-L	LKD	38.1	38.1	0.0	0.0%												
		W1-U																	
		W2-L		8.4	6.2	2.1	25.6%												
		W2-U																	
		W3-L		27.0	24.4	2.6	9.4%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						34.4	32.9	96%	32.8	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R2	W4	LKD	22.2	22.2	0.0	0.0%													
		W5-L		35.8	32.3	3.5	9.8%													
		W5-U																		
		W6-L		35.7	32.1	3.6	10.0%													
		W6-U																		
		W7-L		2.0	1.4	0.6	29.1%													
		W7-U						29.5	26.8	91%	26.7	91%	0.1	0.5%	45	11	37	8	17.8%	27.3%
Sixth	R3	W8-L	Bedroom	6.7	4.3	2.5	36.6%													
		W8-U						11.9	10.9	92%	10.4	88%	0.5	4.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W9-L	Bedroom	35.6	31.8	3.8	10.5%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W10-L	Bedroom	35.5	31.6	3.9	10.9%													
		W10-U						13.5	13.1	97%	12.6	93%	0.5	4.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W11-L	LKD	8.2	5.3	2.9	35.0%													
		W11-U																		
		W12-L		36.3	34.8	1.5	4.2%													
		W12-U																		
		W13-L		37.3	35.9	1.4	3.8%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	85	26	5.6%	7.1%
Seventh	R1	W1-L	LKD	38.4	38.4	0.0	0.0%													
		W1-U																		
		W2-L		8.6	6.4	2.2	25.1%													
		W2-U																		
		W3-L		27.2	24.8	2.5	9.0%													
		W3-U						34.4	32.9	96%	32.8	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W4	LKD	22.2	22.2	0.0	0.0%													
		W5-L		36.2	32.8	3.4	9.3%													
		W5-U																		
		W6-L		36.1	32.6	3.5	9.6%													
		W6-U																		
		W7-L		2.1	1.5	0.6	28.2%													
		W7-U						29.5	27.0	91%	26.8	91%	0.2	0.6%	45	11	37	8	17.8%	27.3%
Seventh	R3	W8-L	Bedroom	6.9	4.5	2.5	35.4%													
		W8-U						11.9	10.9	92%	10.5	88%	0.4	4.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W9-L	Bedroom	36.0	32.3	3.6	10.1%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W10-L	Bedroom	35.9	32.2	3.7	10.4%													
		W10-U						13.5	13.1	97%	12.8	95%	0.3	2.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W11-L	LKD	8.4	5.5	2.9	34.5%													
		W11-U																		
		W12-L		36.5	35.0	1.5	4.1%													
		W12-U																		
		W13-L		37.5	36.2	1.4	3.6%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	85	26	5.6%	7.1%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		8.7	6.6	2.2	25.1%													
		W2-U																		
		W3-L		27.5	25.1	2.4	8.6%													
		W3-U						34.4	32.9	96%	32.8	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W4	LKD	22.3	22.3	0.0	0.0%													
		W5-L		36.5	33.3	3.3	8.9%													
		W5-U																		
		W6-L		36.5	33.1	3.3	9.1%													
		W6-U																		
		W7-L		2.2	1.6	0.6	27.4%													
		W7-U						29.5	27.0	92%	26.9	91%	0.2	0.6%	46	12	40	9	13.0%	25.0%
Eighth	R3	W8-L	Bedroom	7.1	4.7	2.4	33.2%													
		W8-U						11.9	10.9	92%	10.6	90%	0.3	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W9-L	Bedroom	36.4	32.9	3.5	9.6%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W10-L	Bedroom	36.3	32.7	3.6	9.9%													
		W10-U						13.5	13.1	97%	12.9	96%	0.2	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W11-L	LKD	8.7	5.7	2.9	33.9%													
		W11-U																		
		W12-L		36.6	35.2	1.5	4.0%													
		W12-U																		
		W13-L		37.7	36.4	1.3	3.5%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	86	26	4.4%	7.1%
Ninth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		8.9	6.7	2.2	24.2%													
		W2-U																		
		W3-L		27.7	25.4	2.3	8.2%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R2	W4	LKD	22.4	22.4	0.0	0.0%													
		W5-L		36.9	33.8	3.1	8.5%													
		W5-U																		
		W6-L		36.8	33.6	3.2	8.6%													
		W6-U																		
		W7-L		2.3	1.7	0.6	25.0%													
		W7-U						29.5	27.1	92%	27.0	91%	0.1	0.5%	46	12	41	10	10.9%	16.7%
Ninth	R3	W8-L	Bedroom	7.3	5.0	2.2	30.9%													
		W8-U						11.9	10.9	92%	10.7	90%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W9-L	Bedroom	36.7	33.4	3.3	9.1%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W10-L	Bedroom	36.7	33.2	3.4	9.4%													
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W11-L	LKD	8.9	6.0	2.9	32.7%													
		W11-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W12-L		36.8	35.4	1.4	3.8%													
		W12-U																		
		W13-L		37.8	36.6	1.3	3.4%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	86	26	4.4%	7.1%
Tenth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		9.1	7.0	2.1	22.7%													
		W2-U																		
		W3-L		27.9	25.7	2.2	7.7%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R2	W4	LKD	22.4	22.4	0.0	0.0%													
		W5-L		37.2	34.3	3.0	8.0%													
		W5-U																		
		W6-L		37.2	34.1	3.0	8.2%													
		W6-U																		
		W7-L		2.4	1.9	0.6	22.8%													
		W7-U						29.5	27.1	92%	27.0	92%	0.1	0.5%	46	12	42	10	8.7%	16.7%
Tenth	R3	W8-L	Bedroom	7.4	5.3	2.1	28.7%													
		W8-U						11.9	10.9	92%	10.7	90%	0.2	1.8%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W9-L	Bedroom	37.1	33.9	3.2	8.5%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W10-L	Bedroom	37.0	33.8	3.3	8.8%													
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W11-L	LKD	9.1	6.3	2.8	30.7%													
		W11-U																		
		W12-L		37.0	35.6	1.4	3.7%													
		W12-U																		
		W13-L		38.0	36.8	1.2	3.2%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	86	26	4.4%	7.1%
Eleventh	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.2	7.3	2.0	21.2%													
		W2-U																		
		W3-L		28.1	26.0	2.0	7.2%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R2	W4	LKD	22.5	22.5	0.0	0.0%													
		W5-L		37.6	34.7	2.8	7.5%													
		W5-U																		
		W6-L		37.5	34.6	2.9	7.7%													
		W6-U																		
		W7-L		2.5	2.0	0.5	21.2%													
		W7-U						29.5	27.2	92%	27.0	92%	0.1	0.5%	46	12	42	10	8.7%	16.7%
Eleventh	R3	W8-L	Bedroom	7.6	5.6	2.0	26.5%													
		W8-U						11.9	10.9	92%	10.7	91%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W9-L	Bedroom	37.4	34.4	3.0	8.0%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eleventh	R5	W10-L	Bedroom	37.4	34.3	3.1	8.3%													
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W11-L	LKD	9.2	6.6	2.6	28.6%													
		W11-U																		
		W12-L		37.1	35.8	1.3	3.5%													
		W12-U																		
		W13-L		38.1	37.0	1.2	3.0%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	87	27	3.3%	3.6%
Twelfth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.3	7.5	1.8	19.7%													
		W2-U																		
		W3-L		28.2	26.3	1.9	6.7%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R2	W4	LKD	22.5	22.5	0.0	0.0%													
		W5-L		37.8	35.2	2.7	7.0%													
		W5-U																		
		W6-L		37.8	35.1	2.7	7.1%													
		W6-U																		
		W7-L		2.6	2.1	0.5	19.2%													
		W7-U						29.5	27.2	92%	27.1	92%	0.2	0.6%	46	12	43	10	6.5%	16.7%
Twelfth	R3	W8-L	Bedroom	7.7	5.8	1.9	24.3%													
		W8-U						11.9	10.9	92%	10.8	91%	0.1	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W9-L	Bedroom	37.7	34.9	2.8	7.5%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W10-L	Bedroom	37.7	34.8	2.9	7.7%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W11-L	LKD	9.4	6.9	2.5	26.3%													
		W11-U																		
		W12-L		37.3	36.1	1.2	3.3%													
		W12-U																		
		W13-L		38.3	37.2	1.1	2.9%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	87	27	3.3%	3.6%
Thirteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.4	7.7	1.7	18.1%													
		W2-U																		
		W3-L		28.3	26.6	1.8	6.2%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R2	W4	LKD	22.7	22.7	0.0	0.0%													
		W5-L		38.1	35.6	2.5	6.5%													
		W5-U																		
		W6-L		38.0	35.5	2.5	6.6%													
		W6-U																		
		W7-L		2.7	2.2	0.5	17.5%													
		W7-U						29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	44	11	4.3%	8.3%
Thirteenth	R3	W8-L	Bedroom	7.8	6.0	1.7	22.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W8-U						11.9	10.9	92%	10.8	91%	0.1	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W9-L	Bedroom	37.9	35.3	2.6	6.9%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W10-L	Bedroom	37.9	35.2	2.7	7.1%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W11-L	LKD	9.5	7.2	2.3	24.1%													
		W11-U																		
		W12-L		37.4	36.3	1.2	3.1%													
		W12-U																		
		W13-L		38.4	37.4	1.1	2.7%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Fourteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.5	7.9	1.6	16.6%													
		W2-U																		
		W3-L		28.4	26.8	1.6	5.7%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R2	W4	LKD	23.0	23.0	0.0	0.0%													
		W5-L		38.2	36.0	2.3	6.0%													
		W5-U																		
		W6-L		38.2	35.9	2.3	6.1%													
		W6-U																		
		W7-L		2.8	2.3	0.4	15.8%													
		W7-U						29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	44	11	4.3%	8.3%
Fourteenth	R3	W8-L	Bedroom	7.8	6.3	1.6	19.9%													
		W8-U						11.9	10.9	92%	10.8	91%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W9-L	Bedroom	38.1	35.7	2.4	6.3%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W10-L	Bedroom	38.1	35.6	2.5	6.5%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W11-L	LKD	9.5	7.4	2.1	21.9%													
		W11-U																		
		W12-L		37.6	36.5	1.1	2.9%													
		W12-U																		
		W13-L		38.6	37.6	1.0	2.6%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Fifteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.5	8.1	1.4	15.0%													
		W2-U																		
		W3-L		28.8	27.4	1.5	5.1%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R2	W4	LKD	24.5	24.5	0.0	0.0%													
		W5-L		38.4	36.3	2.1	5.4%													
		W5-U																		
		W6-L		38.4	36.3	2.1	5.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W6-U																	
		W7-L		2.9	2.5	0.4	14.0%												
		W7-U						29.5	27.3	93%	27.1	92%	0.2	0.6%	46	12	46	12	0.0%	0.0%
Fifteenth	R3	W8-L	Bedroom	7.9	6.5	1.4	17.8%												
		W8-U						11.9	10.9	92%	10.8	91%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W9-L	Bedroom	38.3	36.1	2.2	5.7%												
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W10-L	Bedroom	38.3	36.0	2.3	5.9%												
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R6	W11-L	LKD	9.6	7.7	1.9	19.9%												
		W11-U																	
		W12-L		37.7	36.7	1.0	2.7%												
		W12-U																	
		W13-L		38.7	37.8	0.9	2.4%												
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
East Apartments																			
First	R2	W3-L	Bedroom	1.3	0.0	1.3	100.0%												
		W3-U																	
		W4		0.2	0.0	0.2	100.0%	12.2	4.5	37%	0.3	2%	4.2	93.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	LKD	0.0	0.0	0.0	0.0%												
		W5-U																	
		W6-L		18.8	10.3	8.5	45.4%												
		W6-U																	
		W7-L		21.2	10.9	10.3	48.6%												
		W7-U						32.0	24.3	76%	13.7	43%	10.7	43.8%	12	2	9	2	25.0%	0.0%
First	R4	W8-L	LKD	4.9	0.0	4.9	100.0%												
		W8-U																	
		W9		0.4	0.0	0.4	100.0%												
		W10-L		0.0	0.0	0.0	0.0%												
		W10-U																	
		W11-L		25.4	12.6	12.8	50.4%												
		W11-U						34.0	26.6	78%	8.3	24%	18.3	68.7%	14	1	6	1	57.1%	0.0%
First	R5	W12-L	Bedroom	27.0	13.7	13.3	49.2%												
		W12-U						12.2	11.4	94%	5.0	41%	6.5	56.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W13-L	LKD	28.3	15.1	13.2	46.7%												
		W13-U																	
		W14-L		29.0	16.3	12.7	43.8%												
		W14-U																	
		W15-L		20.3	13.2	7.1	35.2%												
		W15-U																	
		W16-L		19.5	11.1	8.4	42.9%												
		W16-U						44.4	38.3	86%	34.6	78%	3.7	9.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W17-L	Bedroom	24.7	14.0	10.7	43.2%												
		W17-U						9.3	8.4	91%	8.4	90%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W18-L	Bedroom	29.5	18.3	11.3	38.1%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W18-U						9.2	8.7	94%	7.4	81%	1.3	14.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W19-L	Bedroom	30.6	18.8	11.9	38.7%													
		W19-U																		
		W20-L		23.3	13.6	9.7	41.8%													
		W20-U						17.9	17.9	100%	17.2	96%	0.7	4.1%	23	0	18	0	21.7%	0.0%
Second	R1	W1-L	LKD	9.7	9.7	0.0	0.0%													
		W1-U																		
		W2-L		12.2	10.1	2.1	17.5%													
		W2-U																		
		W3-L		14.2	11.1	3.2	22.2%													
		W3-U						38.7	23.9	62%	10.3	27%	13.6	57.0%	22	8	22	8	0.0%	0.0%
Second	R2	W4-L	Bedroom	2.7	0.0	2.7	100.0%													
		W4-U						12.2	7.8	64%	0.1	1%	7.7	98.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		20.3	12.9	7.4	36.5%													
		W6-U																		
		W7-L		22.5	13.7	8.7	38.8%													
		W7-U						31.9	24.9	78%	12.9	40%	12.0	48.4%	12	2	9	2	25.0%	0.0%
Second	R4	W8-L	LKD	6.0	0.0	6.0	100.0%													
		W8-U																		
		W9-L		0.3	0.1	0.2	66.7%													
		W9-U																		
		W10-L		26.7	15.8	10.8	40.6%													
		W10-U						34.0	29.7	87%	9.6	28%	20.1	67.6%	15	0	6	0	60.0%	0.0%
Second	R5	W11-L	Bedroom	28.4	17.3	11.1	39.1%													
		W11-U						12.2	11.8	97%	6.9	56%	4.9	41.7%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W12-L	LKD	29.5	18.7	10.8	36.6%													
		W12-U																		
		W13-L		30.3	20.1	10.2	33.6%													
		W13-U																		
		W14-L		16.0	10.6	5.4	33.7%													
		W14-U																		
		W15-L		20.7	10.7	10.1	48.5%													
		W15-U						44.5	39.4	89%	33.8	76%	5.6	14.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W16-L	Bedroom	29.8	19.2	10.6	35.5%													
		W16-U						9.1	8.6	94%	6.8	74%	1.8	21.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W17-L	Bedroom	32.3	21.4	10.9	33.8%													
		W17-U						9.5	9.3	97%	7.5	78%	1.8	19.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W18-L	Bedroom	32.9	21.3	11.6	35.2%													
		W18-U																		
		W19-L		24.0	15.4	8.7	36.1%													
		W19-U						18.0	16.7	93%	15.5	86%	1.2	7.4%	26	2	21	2	19.2%	0.0%
Third	R1	W1-L	LKD	10.6	10.6	0.0	0.1%													
		W1-U																		
		W2-L		13.1	11.5	1.6	12.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		15.1	12.6	2.5	16.5%													
		W3-U						38.7	20.3	52%	13.8	36%	6.6	32.3%	24	7	24	7	0.0%	0.0%
Third	R2	W4-L	Bedroom	1.1	0.2	0.9	85.8%													
		W4-U						12.2	4.6	38%	1.6	13%	3.0	64.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		21.0	15.3	5.8	27.5%													
		W6-U																		
		W7-L		23.2	16.3	6.9	29.8%													
		W7-U						32.0	24.2	76%	16.2	51%	8.1	33.2%	12	2	9	2	25.0%	0.0%
Third	R4	W8-L	LKD	3.8	0.2	3.6	93.9%													
		W8-U																		
		W9-L		0.0	0.0	0.0	0.0%													
		W9-U																		
		W10-L		27.4	18.6	8.7	31.9%													
		W10-U						34.0	27.0	79%	11.8	35%	15.2	56.3%	16	1	7	1	56.3%	0.0%
Third	R5	W11-L	Bedroom	28.9	19.8	9.1	31.5%													
		W11-U						12.2	11.3	93%	6.4	53%	5.0	43.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W12-L	LKD	30.2	21.4	8.8	29.2%													
		W12-U																		
		W13-L		31.0	22.7	8.3	26.8%													
		W13-U																		
		W14-L		20.1	15.3	4.8	23.9%													
		W14-U																		
		W15-L		18.1	12.2	5.9	32.7%													
		W15-U						44.6	39.7	89%	36.1	81%	3.6	9.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W16-L	Bedroom	26.9	17.1	9.8	36.6%													
		W16-U						9.4	8.6	92%	8.6	92%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W17-L	Bedroom	33.0	22.7	10.3	31.1%													
		W17-U						12.1	11.6	96%	11.3	94%	0.3	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W18-L	Bedroom	33.6	22.8	10.8	32.0%													
		W18-U																		
		W19-L		25.9	17.0	8.9	34.3%													
		W19-U						14.3	14.3	100%	14.3	100%	0.0	0.0%	29	2	25	2	13.8%	0.0%
Fourth	R1	W1-L	LKD	11.3	11.3	0.0	0.4%													
		W1-U																		
		W2-L		14.8	13.4	1.4	9.5%													
		W2-U																		
		W3-L		17.1	14.7	2.4	14.2%													
		W3-U						38.7	27.1	70%	19.3	50%	7.7	28.5%	26	8	26	8	0.0%	0.0%
Fourth	R2	W4-L	Bedroom	3.9	1.2	2.6	68.3%													
		W4-U						12.2	9.4	77%	6.1	50%	3.3	34.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		22.7	17.9	4.8	21.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U																		
		W7-L		24.6	19.2	5.4	22.0%													
		W7-U						32.0	25.8	81%	24.2	76%	1.6	6.2%	14	2	11	2	21.4%	0.0%
Fourth	R4	W8-L	LKD	6.8	2.2	4.6	68.1%													
		W8-U																		
		W9-L		0.5	0.4	0.1	27.5%													
		W9-U																		
		W10-L		28.6	21.8	6.8	23.6%													
		W10-U						34.0	30.0	88%	21.0	62%	9.0	30.0%	17	1	11	1	35.3%	0.0%
Fourth	R5	W11-L	Bedroom	30.2	23.2	7.0	23.0%													
		W11-U						12.2	11.8	97%	11.6	95%	0.2	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W12-L	LKD	31.3	24.6	6.7	21.5%													
		W12-U																		
		W13-L		32.0	25.8	6.2	19.4%													
		W13-U																		
		W14-L		18.6	14.2	4.4	23.6%													
		W14-U																		
		W15-L		23.0	14.2	8.9	38.5%													
		W15-U						44.5	39.6	89%	35.5	80%	4.2	10.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W16-L	Bedroom	32.5	23.2	9.3	28.7%													
		W16-U						9.1	8.6	94%	6.8	74%	1.8	21.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W17-L	Bedroom	33.7	24.1	9.6	28.4%													
		W17-U						9.5	9.3	98%	7.5	79%	1.8	19.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W18-L	Bedroom	33.3	22.6	10.7	32.1%													
		W18-U																		
		W19-L		26.4	18.6	7.8	29.6%													
		W19-U						18.0	16.7	93%	16.1	89%	0.6	3.9%	30	2	28	2	6.7%	0.0%
Fifth	R1	W1-L	LKD	12.5	12.4	0.0	0.3%													
		W1-U																		
		W2-L		16.0	15.0	1.0	6.3%													
		W2-U																		
		W3-L		18.3	16.2	2.1	11.5%													
		W3-U						38.7	28.7	74%	23.0	59%	5.7	19.9%	27	8	27	8	0.0%	0.0%
Fifth	R2	W4-L	Bedroom	2.8	1.1	1.8	62.3%													
		W4-U						12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		23.9	20.5	3.4	14.4%													
		W6-U																		
		W7-L		25.7	22.0	3.7	14.4%													
		W7-U						32.0	25.2	79%	25.1	79%	0.1	0.5%	18	3	16	3	11.1%	0.0%
Fifth	R4	W8-L	LKD	4.7	2.1	2.6	55.8%													
		W8-U																		
		W9-L		0.0	0.0	0.0	0.0%													
		W9-U																		
		W10-L		29.4	25.0	4.5	15.1%													
		W10-U						34.0	28.8	85%	28.4	83%	0.4	1.5%	19	2	16	2	15.8%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R5	W11-L	Bedroom	30.9	26.2	4.7	15.1%													
		W11-U						12.2	11.5	94%	11.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W12-L	LKD	32.0	27.3	4.7	14.7%													
		W12-U																		
		W13-L		32.7	28.0	4.7	14.2%													
		W13-U																		
		W14-L		35.8	27.9	7.9	22.1%													
		W14-U																		
		W15-L		35.6	27.2	8.4	23.7%													
		W15-U						44.6	40.8	92%	37.8	85%	3.0	7.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W16-L	Bedroom	35.2	26.3	8.9	25.2%													
		W16-U						9.4	8.6	92%	8.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W17-L	Bedroom	32.8	24.7	8.1	24.7%													
		W17-U						12.1	11.6	96%	11.3	94%	0.3	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W18-L	Bedroom	21.3	15.7	5.6	26.3%													
		W18-U																		
		W19-L		28.1	20.1	8.0	28.5%													
		W19-U						14.3	14.3	100%	14.3	100%	0.0	0.0%	38	3	36	3	5.3%	0.0%
Sixth	R1	W1-L	Bedroom	13.4	13.3	0.1	0.7%													
		W1-U																		
		W2-L		18.0	16.9	1.1	6.1%													
		W2-U						11.7	8.9	76%	8.0	69%	0.9	9.7%	30	10	30	10	0.0%	0.0%
Sixth	R2	W3-L	Bedroom	20.7	18.3	2.4	11.4%													
		W3-U						12.1	8.7	71%	8.4	69%	0.3	3.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W4-L	Bedroom	5.4	3.1	2.3	42.6%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		25.5	22.8	2.6	10.3%													
		W6-U																		
		W7-L		27.2	24.7	2.5	9.1%													
		W7-U						32.1	28.5	89%	28.5	89%	0.0	0.0%	21	3	19	3	9.5%	0.0%
Sixth	R5	W8-L	LKD	7.6	5.3	2.4	31.0%													
		W8-U																		
		W9-L		0.7	0.7	0.0	4.2%													
		W9-U																		
		W10-L		30.8	28.2	2.6	8.5%													
		W10-U																		
		W11-L		36.6	34.1	2.6	7.0%													
		W11-U						31.3	30.7	98%	30.7	98%	0.0	0.0%	23	1	22	1	4.3%	0.0%
Sixth	R6	W12-L	Bedroom	36.8	34.3	2.5	6.8%													
		W12-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W13-L	Bedroom	37.0	34.6	2.4	6.5%													
		W13-U						11.8	11.4	97%	11.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R8	W14-L	Bedroom	35.4	26.4	8.9	25.3%												
		W14-U																	
		W15-L		30.4	24.9	5.5	18.0%												
		W15-U						14.9	14.6	98%	13.9	93%	0.6	4.4%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W16-L	LKD	25.6	15.2	10.4	40.6%												
		W16-U																	
		W17-L		28.7	21.3	7.4	25.9%												
		W17-U																	
		W18-L		27.2	21.0	6.2	22.9%												
		W18-U						36.0	29.0	80%	28.8	80%	0.1	0.4%	38	3	36	3	5.3%	0.0%
Seventh	R1	W1-L	Bedroom	14.8	14.8	0.1	0.5%												
		W1-U																	
		W2-L		19.0	18.2	0.8	4.1%												
		W2-U						11.7	9.0	77%	8.7	74%	0.3	3.0%	29	9	29	9	0.0%	0.0%
Seventh	R2	W3-L	Bedroom	21.3	19.4	1.9	9.0%												
		W3-U						12.1	6.2	51%	5.2	43%	1.1	17.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W4-L	Bedroom	3.6	1.6	2.0	55.6%												
		W4-U						12.4	10.3	83%	10.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W5-L	LKD	0.0	0.0	0.0	0.0%												
		W5-U																	
		W6-L		26.3	24.2	2.1	7.9%												
		W6-U																	
		W7-L		28.0	25.9	2.1	7.3%												
		W7-U						32.1	26.0	81%	26.0	81%	0.1	0.3%	21	3	19	3	9.5%	0.0%
Seventh	R5	W8-L	LKD	5.2	3.3	1.9	35.8%												
		W8-U																	
		W9-L		0.0	0.0	0.0	0.0%												
		W9-U																	
		W10-L		31.3	29.3	2.1	6.5%												
		W10-U																	
		W11-L		37.1	35.0	2.1	5.8%												
		W11-U						31.3	30.7	98%	30.6	98%	0.1	0.2%	27	3	26	3	3.7%	0.0%
Seventh	R6	W12-L	Bedroom	37.4	35.3	2.2	5.8%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W13-L	Bedroom	37.6	35.4	2.2	5.8%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W14-L	Bedroom	37.7	35.5	2.1	5.7%												
		W14-U																	
		W15-L		34.2	25.8	8.5	24.8%												
		W15-U						14.9	14.9	100%	14.4	97%	0.4	3.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R9	W16-L	LKD	22.5	15.9	6.6	29.2%												
		W16-U																	
		W17-L		30.6	22.5	8.1	26.4%												
		W17-U																	
		W18-L		29.3	22.5	6.8	23.2%												
		W18-U						36.0	30.2	84%	30.2	84%	0.0	0.0%	43	5	41	5	4.7%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R1	W1-L	Bedroom	16.1	16.0	0.1	0.5%													
		W1-U																		
		W2-L		20.7	19.8	0.8	4.1%													
		W2-U						11.7	8.9	76%	8.2	70%	0.7	8.3%	31	10	31	10	0.0%	0.0%
Eighth	R2	W3-L	Bedroom	23.1	21.2	2.0	8.6%													
		W3-U						12.1	9.0	74%	8.7	72%	0.2	2.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W4-L	Bedroom	5.6	3.7	1.9	33.8%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		27.6	25.6	2.0	7.3%													
		W6-U																		
		W7-L		29.3	27.3	1.9	6.6%													
		W7-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	23	3	21	3	8.7%	0.0%
Eighth	R5	W8-L	LKD	7.8	6.0	1.8	23.5%													
		W8-U																		
		W9-L		0.9	0.9	0.0	0.0%													
		W9-U																		
		W10-L		32.6	30.7	1.9	5.9%													
		W10-U																		
		W11-L		37.7	35.6	2.1	5.6%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	29	3	28	3	3.4%	0.0%
Eighth	R6	W12-L	Bedroom	37.9	35.9	2.1	5.5%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W13-L	Bedroom	38.1	36.1	2.0	5.3%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W14-L	Bedroom	36.7	27.5	9.1	24.9%													
		W14-U																		
		W15-L		31.7	25.7	6.0	18.8%													
		W15-U						14.9	14.6	98%	14.0	94%	0.6	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W16-L	LKD	26.8	16.0	10.8	40.4%													
		W16-U																		
		W17-L		31.5	24.0	7.5	23.9%													
		W17-U																		
		W18-L		30.2	23.9	6.3	20.8%													
		W18-U						36.0	29.0	81%	28.9	80%	0.1	0.4%	44	4	42	4	4.5%	0.0%
Ninth	R1	W1-L	Bedroom	18.0	17.9	0.1	0.4%													
		W1-U																		
		W2-L		22.1	21.5	0.7	3.1%													
		W2-U						11.7	9.3	80%	9.3	80%	0.0	0.0%	33	9	33	9	0.0%	0.0%
Ninth	R2	W3-L	Bedroom	24.2	22.5	1.7	6.9%													
		W3-U						12.1	7.0	58%	6.3	52%	0.7	10.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W4-L	Bedroom	3.7	1.9	1.8	47.4%													
		W4-U						12.4	10.3	83%	10.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W5-L	LKD	0.1	0.1	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U																	
		W6-L		28.7	26.9	1.8	6.4%												
		W6-U																	
		W7-L		30.3	28.5	1.8	6.0%												
		W7-U						32.1	26.7	83%	26.6	83%	0.1	0.3%	26	3	24	3	7.7%	0.0%
Ninth	R5	W8-L	LKD	5.4	3.8	1.6	30.2%												
		W8-U																	
		W9-L		0.1	0.1	0.0	0.0%												
		W9-U																	
		W10-L		33.3	31.5	1.8	5.4%												
		W10-U																	
		W11-L		38.2	36.2	2.0	5.1%												
		W11-U						31.3	30.7	98%	30.7	98%	0.1	0.2%	30	3	29	3	3.3%	0.0%
Ninth	R6	W12-L	Bedroom	38.4	36.4	2.0	5.2%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W13-L	Bedroom	38.5	36.5	2.0	5.2%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	38.6	36.6	2.0	5.2%												
		W14-U																	
		W15-L		35.3	26.6	8.8	24.8%												
		W15-U						14.9	14.9	100%	14.4	97%	0.4	3.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W16-L	LKD	23.6	16.5	7.1	29.9%												
		W16-U																	
		W17-L		33.6	25.4	8.2	24.3%												
		W17-U																	
		W18-L		32.5	25.7	6.8	21.0%												
		W18-U						36.0	30.2	84%	30.2	84%	0.0	0.0%	49	8	47	8	4.1%	0.0%
Tenth	R1	W1-L	Bedroom	19.7	19.7	0.1	0.3%												
		W1-U																	
		W2-L		24.5	23.8	0.7	3.0%												
		W2-U						11.7	9.0	77%	8.7	74%	0.3	3.3%	36	10	36	10	0.0%	0.0%
Tenth	R2	W3-L	Bedroom	26.6	24.9	1.7	6.4%												
		W3-U						12.1	9.6	79%	9.5	78%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W4-L	Bedroom	5.7	4.1	1.6	28.4%												
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W5-L	LKD	0.9	0.9	0.0	0.0%												
		W5-U																	
		W6-L		30.4	28.7	1.7	5.7%												
		W6-U																	
		W7-L		31.9	30.2	1.7	5.2%												
		W7-U						32.1	29.4	92%	29.4	92%	0.0	0.0%	29	3	27	3	6.9%	0.0%
Tenth	R5	W8-L	LKD	8.2	6.6	1.6	19.4%												
		W8-U																	
		W9-L		1.9	1.9	0.0	0.0%												
		W9-U																	
		W10-L		34.6	32.9	1.7	4.9%												
		W10-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W11-L		38.6	36.7	1.9	4.9%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	33	4	32	4	3.0%	0.0%
Tenth	R6	W12-L	Bedroom	38.8	36.9	1.9	4.9%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W13-L	Bedroom	38.9	37.0	1.9	4.8%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	37.6	28.3	9.2	24.6%													
		W14-U																		
		W15-L		32.6	26.2	6.3	19.4%													
		W15-U						14.9	14.6	98%	14.0	94%	0.6	3.8%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W16-L	LKD	27.7	16.7	11.1	39.9%													
		W16-U																		
		W17-L		34.7	27.2	7.5	21.7%													
		W17-U																		
		W18-L		33.7	27.5	6.3	18.6%													
		W18-U						36.0	29.3	81%	29.3	81%	0.0	0.0%	49	8	48	8	2.0%	0.0%
Eleventh	R1	W1-L	Bedroom	22.2	22.1	0.1	0.3%													
		W1-U																		
		W2-L		27.0	26.4	0.6	2.1%													
		W2-U						11.7	10.3	88%	10.3	88%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Eleventh	R2	W3-L	Bedroom	28.5	27.1	1.4	4.9%													
		W3-U						12.1	9.2	75%	8.9	74%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W4-L	Bedroom	4.4	2.9	1.5	34.2%													
		W4-U						12.4	10.8	87%	10.8	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W5-L	LKD	0.5	0.5	0.0	0.0%													
		W5-U																		
		W6-L		32.0	30.4	1.6	4.9%													
		W6-U																		
		W7-L		33.2	31.6	1.6	4.7%													
		W7-U						32.1	27.9	87%	27.9	87%	0.1	0.3%	31	4	29	4	6.5%	0.0%
Eleventh	R5	W8-L	LKD	6.2	4.8	1.4	22.7%													
		W8-U																		
		W9-L		0.8	0.8	0.0	0.0%													
		W9-U																		
		W10-L		35.4	33.8	1.6	4.4%													
		W10-U																		
		W11-L		38.9	37.1	1.8	4.6%													
		W11-U						31.3	30.7	98%	30.7	98%	0.1	0.2%	34	4	32	4	5.9%	0.0%
Eleventh	R6	W12-L	Bedroom	39.1	37.2	1.9	4.8%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W13-L	Bedroom	39.1	37.3	1.9	4.8%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	39.2	37.3	1.9	4.7%													
		W14-U																		
		W15-L		36.0	27.1	8.9	24.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W15-U						14.9	14.9	100%	14.4	97%	0.4	3.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W16-L	LKD	24.3	16.9	7.5	30.6%													
		W16-U																		
		W17-L		36.5	28.5	8.1	22.1%													
		W17-U																		
		W18-L		35.9	29.2	6.7	18.8%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	56	14	55	14	1.8%	0.0%
Twelfth	R1	W1-L	Bedroom	24.6	24.6	0.1	0.2%													
		W1-U																		
		W2-L		30.2	29.6	0.6	2.0%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Twelfth	R2	W3-L	Bedroom	31.5	30.1	1.4	4.5%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W4-L	Bedroom	7.1	5.8	1.3	18.9%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W5-L	LKD	2.6	2.6	0.0	0.0%													
		W5-U																		
		W6-L		34.0	32.5	1.5	4.3%													
		W6-U																		
		W7-L		34.9	33.5	1.4	4.0%													
		W7-U						32.1	29.8	93%	29.8	93%	0.0	0.0%	33	4	31	4	6.1%	0.0%
Twelfth	R5	W8-L	LKD	9.0	7.6	1.4	15.6%													
		W8-U																		
		W9-L		3.4	3.4	0.1	1.7%													
		W9-U																		
		W10-L		36.6	34.9	1.7	4.5%													
		W10-U																		
		W11-L		39.2	37.3	1.8	4.6%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	35	5	33	4	5.7%	20.0%
Twelfth	R6	W12-L	Bedroom	39.2	37.4	1.8	4.6%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W13-L	Bedroom	39.3	37.5	1.8	4.5%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W14-L	Bedroom	38.0	28.8	9.2	24.2%													
		W14-U																		
		W15-L		33.0	26.4	6.6	19.9%													
		W15-U						14.9	14.6	98%	14.1	94%	0.5	3.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W16-L	LKD	28.1	17.1	11.0	39.1%													
		W16-U																		
		W17-L		37.8	30.4	7.4	19.6%													
		W17-U																		
		W18-L		37.4	31.2	6.2	16.5%													
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	56	14	55	14	1.8%	0.0%
Thirteenth	R1	W1-L	Bedroom	27.4	26.9	0.5	1.7%													
		W1-U																		
		W2-L		33.5	32.5	1.0	2.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	47	10	47	10	0.0%	0.0%
Thirteenth	R2	W3-L	Bedroom	34.2	32.7	1.5	4.3%													
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W4-L	Bedroom	7.6	6.1	1.6	20.3%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W5-L	LKD	1.1	1.1	0.0	0.0%													
		W5-U																		
		W6-L		35.9	34.3	1.5	4.3%													
		W6-U																		
		W7-L		36.5	34.9	1.5	4.2%													
		W7-U						32.1	30.8	96%	30.6	95%	0.2	0.7%	35	5	33	5	5.7%	0.0%
Thirteenth	R5	W8-L	LKD	7.9	6.4	1.5	19.1%													
		W8-U																		
		W9-L		1.6	1.6	0.0	0.0%													
		W9-U																		
		W10-L		37.5	35.8	1.7	4.6%													
		W10-U																		
		W11-L		39.3	37.6	1.7	4.3%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	36	6	34	5	5.6%	16.7%
Thirteenth	R6	W12-L	Bedroom	39.4	37.7	1.7	4.4%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W13-L	Bedroom	39.4	37.7	1.7	4.4%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R8	W14-L	Bedroom	39.5	37.8	1.7	4.3%													
		W14-U																		
		W15-L		36.3	27.5	8.8	24.1%													
		W15-U						14.9	14.9	100%	14.5	97%	0.4	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R9	W16-L	LKD	24.4	16.9	7.5	30.8%													
		W16-U																		
		W17-L		39.1	31.3	7.8	19.9%													
		W17-U																		
		W18-L		39.0	32.5	6.5	16.7%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	56	15	1.8%	0.0%
Fourteenth	R1	W1-L	Bedroom	29.9	29.0	0.9	3.0%													
		W1-U																		
		W2-L		36.6	34.9	1.7	4.6%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	52	13	51	13	1.9%	0.0%
Fourteenth	R2	W3-L	Bedroom	37.0	35.1	1.8	5.0%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W4-L	Bedroom	9.2	7.9	1.2	13.4%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W5-L	LKD	4.4	4.0	0.3	7.1%													
		W5-U																		
		W6-L		37.7	35.9	1.8	4.8%													
		W6-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W7-L		38.0	36.2	1.8	4.6%												
		W7-U						32.1	31.2	97%	31.2	97%	0.0	0.0%	37	7	35	7	5.4%	0.0%
Fourteenth	R5	W8-L	LKD	9.8	8.4	1.4	14.2%												
		W8-U																	
		W9-L		4.9	4.6	0.3	6.9%												
		W9-U																	
		W10-L		38.4	36.7	1.8	4.7%												
		W10-U																	
		W11-L		39.5	37.9	1.7	4.2%												
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	38	8	35	6	7.9%	25.0%
Fourteenth	R6	W12-L	Bedroom	39.5	37.9	1.6	4.1%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W13-L	Bedroom	39.6	38.0	1.6	4.0%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R8	W14-L	Bedroom	38.2	29.4	8.8	23.1%												
		W14-U																	
		W15-L		33.1	26.5	6.6	19.9%												
		W15-U						14.9	14.6	98%	14.2	95%	0.4	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R9	W16-L	LKD	28.2	17.7	10.5	37.3%												
		W16-U																	
		W17-L		39.4	32.4	7.0	17.9%												
		W17-U																	
		W18-L		39.4	33.5	5.9	14.9%												
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	57	15	56	15	1.8%	0.0%
Fifteenth	R1	W1-L	Bedroom	31.2	30.2	1.0	3.2%												
		W1-U																	
		W2-L		37.9	36.1	1.8	4.8%												
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	53	13	52	13	1.9%	0.0%
Fifteenth	R2	W3-L	Bedroom	38.1	36.3	1.8	4.7%												
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W4-L	Bedroom	9.7	8.0	1.7	17.3%												
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W5-L	LKD	1.8	1.8	0.0	0.0%												
		W5-U																	
		W6-L		38.5	36.8	1.7	4.4%												
		W6-U																	
		W7-L		38.6	36.9	1.7	4.4%												
		W7-U						32.1	30.9	96%	30.8	96%	0.1	0.2%	38	8	36	7	5.3%	12.5%
Fifteenth	R5	W8-L	LKD	8.9	7.4	1.5	17.2%												
		W8-U																	
		W9-L		2.2	2.2	0.0	0.0%												
		W9-U																	
		W10-L		38.8	37.2	1.7	4.3%												
		W10-U																	
		W11-L		39.6	38.1	1.5	3.8%												
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	36	7	7.7%	22.2%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifteenth	R6	W12-L	Bedroom	39.6	38.1	1.5	3.7%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W13-L	Bedroom	39.6	38.1	1.5	3.8%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R8	W14-L	Bedroom	39.6	38.1	1.5	3.7%													
		W14-U																		
		W15-L		36.4	28.2	8.2	22.6%													
		W15-U						14.9	14.9	100%	14.6	98%	0.3	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R9	W16-L	LKD	24.5	17.2	7.3	29.8%													
		W16-U																		
		W17-L		39.4	32.2	7.3	18.4%													
		W17-U																		
		W18-L		39.4	33.3	6.1	15.5%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	56	15	1.8%	0.0%
Sixteenth	R1	W1-L	Bedroom	31.8	30.9	0.9	2.8%													
		W1-U																		
		W2-L		38.3	36.7	1.6	4.1%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	55	14	54	14	1.8%	0.0%
Sixteenth	R2	W3-L	Bedroom	38.4	36.8	1.5	4.0%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W4-L	Bedroom	9.5	8.5	1.0	10.0%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R4	W5-L	LKD	5.0	4.7	0.3	5.8%													
		W5-U																		
		W6-L		38.7	37.2	1.5	3.9%													
		W6-U																		
		W7-L		38.8	37.3	1.4	3.7%													
		W7-U						32.1	31.2	97%	31.2	97%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Sixteenth	R5	W8-L	LKD	9.9	8.8	1.1	11.1%													
		W8-U																		
		W9-L		5.4	5.1	0.3	5.8%													
		W9-U																		
		W10-L		39.0	37.6	1.4	3.6%													
		W10-U																		
		W11-L		39.6	38.3	1.3	3.4%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	38	8	2.6%	11.1%
Sixteenth	R6	W12-L	Bedroom	39.6	38.3	1.3	3.3%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W13-L	Bedroom	39.6	38.3	1.3	3.3%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R8	W14-L	Bedroom	38.4	30.3	8.1	21.2%													
		W14-U																		
		W15-L		33.2	26.9	6.3	19.1%													
		W15-U						14.9	14.6	98%	14.4	97%	0.1	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R9	W16-L	LKD	28.3	18.5	9.8	34.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W16-U																	
		W17-L		39.5	32.9	6.5	16.6%												
		W17-U																	
		W18-L		39.5	34.0	5.5	13.9%												
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	57	15	56	15	1.8%	0.0%
Seventeenth	R1	W1-L	Bedroom	32.3	31.6	0.7	2.3%												
		W1-U																	
		W2-L		38.5	37.2	1.3	3.4%												
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	55	14	54	14	1.8%	0.0%
Seventeenth	R2	W3-L	Bedroom	38.6	37.3	1.3	3.3%												
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W4-L	Bedroom	9.7	8.5	1.2	12.5%												
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R4	W5-L	LKD	2.3	2.3	0.0	0.0%												
		W5-U																	
		W6-L		38.9	37.6	1.2	3.2%												
		W6-U																	
		W7-L		38.9	37.7	1.2	3.1%												
		W7-U						32.1	31.0	97%	31.0	97%	0.0	0.0%	38	8	36	7	5.3%	12.5%
Seventeenth	R5	W8-L	LKD	8.9	7.8	1.1	12.4%												
		W8-U																	
		W9-L		2.6	2.6	0.0	0.0%												
		W9-U																	
		W10-L		39.1	37.9	1.2	3.0%												
		W10-U																	
		W11-L		39.6	38.5	1.1	2.9%												
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	38	8	2.6%	11.1%
Seventeenth	R6	W12-L	Bedroom	39.6	38.5	1.1	2.8%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R7	W13-L	Bedroom	39.6	38.5	1.1	2.9%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R8	W14-L	Bedroom	39.6	38.5	1.1	2.9%												
		W14-U																	
		W15-L		37.2	29.7	7.5	20.1%												
		W15-U						14.9	14.9	100%	14.6	98%	0.3	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R9	W16-L	LKD	24.5	17.6	6.9	28.2%												
		W16-U																	
		W17-L		39.5	32.8	6.7	16.9%												
		W17-U																	
		W18-L		39.5	33.9	5.6	14.2%												
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	56	15	1.8%	0.0%
Eighteenth	R1	W1-L	Bedroom	33.0	32.4	0.6	1.8%												
		W1-U																	
		W2-L		38.8	37.8	1.1	2.7%												
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	56	15	56	15	0.0%	0.0%
Eighteenth	R2	W3-L	Bedroom	38.9	37.9	1.0	2.6%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R3	W4-L	Bedroom	13.0	12.3	0.6	4.9%													
		W4-U																		
		W5		2.0	1.5	0.6	27.6%	12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R4	W6-L	LKD	6.4	6.2	0.2	3.1%													
		W6-U																		
		W7-L		39.1	38.1	1.0	2.6%													
		W7-U																		
		W8-L		39.1	38.2	1.0	2.5%													
		W8-U						32.1	31.1	97%	31.1	97%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Eighteenth	R5	W9-L	LKD	13.5	12.8	0.7	5.5%													
		W9-U																		
		W10		2.1	1.5	0.7	30.7%													
		W11-L		6.7	6.5	0.2	3.2%													
		W11-U																		
		W12-L		39.2	38.3	0.9	2.4%													
		W12-U																		
		W13-L		39.6	38.7	0.9	2.4%													
		W13-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	40	10	39	9	2.5%	10.0%
Eighteenth	R6	W14-L	Bedroom	39.6	38.7	0.9	2.3%													
		W14-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W15-L	Bedroom	39.6	38.7	0.9	2.4%													
		W15-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R8	W16-L	Bedroom	39.6	32.4	7.3	18.3%													
		W16-U																		
		W17-L		39.6	31.6	8.0	20.3%													
		W17-U						14.9	14.6	98%	14.5	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R9	W18-L	LKD	39.6	30.8	8.8	22.3%													
		W18-U																		
		W19-L		39.5	33.5	5.9	15.0%													
		W19-U																		
		W20-L		39.5	34.5	5.0	12.6%													
		W20-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	58	15	57	15	1.7%	0.0%
Mezzanine	R1	W1-L	Residential	4.5	4.4	0.1	2.9%													
		W1-U																		
		W2-L		9.3	5.2	4.1	44.5%													
		W2-U						37.9	37.2	98%	35.7	94%	1.5	4.0%	11	4	11	4	0.0%	0.0%
Millstream Tower																				
First	R1	W1-L	LKD	26.3	20.5	5.8	22.1%													
		W1-U																		
		W2-L		8.4	8.4	0.0	0.0%													
		W2-U						33.5	20.6	61%	19.2	57%	1.4	6.9%	7	0	7	0	0.0%	0.0%
First	R2	W3-L	Bedroom	20.9	15.7	5.2	24.9%													
		W3-U						14.8	11.0	74%	10.9	74%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W4-L	LKD	23.5	19.2	4.2	18.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W4-U																	
		W5-L		7.9	7.9	0.0	0.0%												
		W5-U						28.8	14.4	50%	13.1	45%	1.4	9.6%	7	0	7	0	0.0%	0.0%
First	R4	W6-L	Bedroom	18.2	14.5	3.7	20.3%												
		W6-U						14.5	9.7	67%	9.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7-L	LKD	21.1	18.1	2.9	13.9%												
		W7-U																	
		W8-L		7.9	7.9	0.0	0.0%												
		W8-U						28.8	13.1	46%	13.1	46%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R6	W9-L	Bedroom	16.5	13.9	2.6	15.5%												
		W9-U						14.5	9.3	64%	9.3	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10-L	LKD	19.4	17.2	2.2	11.3%												
		W10-U																	
		W11-L		8.5	8.5	0.0	0.0%												
		W11-U						28.8	13.3	46%	13.3	46%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R8	W12-L	Bedroom	14.8	13.2	1.5	10.4%												
		W12-U						14.5	9.0	62%	9.0	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W13-L	LKD	17.5	15.8	1.7	9.7%												
		W13-U																	
		W14-L		8.9	8.9	0.0	0.0%												
		W14-U						28.9	14.9	51%	14.9	51%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R10	W15-L	Bedroom	13.0	12.0	1.1	8.3%												
		W15-U						14.5	8.2	57%	8.2	57%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W16-L	LKD	16.2	14.9	1.3	8.2%												
		W16-U																	
		W17-L		9.3	9.3	0.0	0.0%												
		W17-U						28.9	18.2	63%	18.2	63%	0.0	0.0%	6	0	6	0	0.0%	0.0%
First	R12	W18-L	Bedroom	15.1	14.3	0.8	5.2%												
		W18-U						14.5	13.1	90%	13.1	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W19-L	Bedroom	18.2	17.0	1.3	7.0%												
		W19-U						12.9	11.4	88%	11.4	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W20-L	LKD	19.0	17.8	1.3	6.6%												
		W20-U																	
		W21-L		11.9	11.5	0.4	3.5%												
		W21-U																	
		W22-L		3.2	3.2	0.0	0.0%												
		W22-U																	
		W23-L		1.0	1.0	0.0	0.0%												
		W23-U						40.8	31.6	77%	30.9	76%	0.7	2.3%	19	7	19	7	0.0%	0.0%
Second	R1	W1-L	LKD	28.6	22.7	5.9	20.5%												
		W1-U																	
		W2-L		9.0	9.0	0.0	0.0%												
		W2-U						33.5	24.5	73%	24.3	72%	0.2	1.0%	7	0	7	0	0.0%	0.0%
Second	R2	W3-L	Bedroom	23.1	17.9	5.2	22.6%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						14.8	13.4	91%	13.4	90%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W4-L	LKD	26.0	21.7	4.3	16.7%													
		W4-U																		
		W5-L		8.4	8.4	0.0	0.0%													
		W5-U						28.8	20.2	70%	20.2	70%	0.0	0.2%	7	0	7	0	0.0%	0.0%
Second	R4	W6-L	Bedroom	20.5	16.7	3.8	18.7%													
		W6-U						14.5	12.3	85%	12.3	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7-L	LKD	23.5	20.3	3.2	13.4%													
		W7-U																		
		W8-L		8.2	8.2	0.0	0.0%													
		W8-U						28.8	19.5	68%	19.5	68%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Second	R6	W9-L	Bedroom	18.6	15.9	2.8	14.8%													
		W9-U						14.5	11.4	79%	11.4	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10-L	LKD	21.5	19.1	2.4	11.3%													
		W10-U																		
		W11-L		8.8	8.8	0.0	0.0%													
		W11-U						28.8	18.9	66%	18.9	66%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Second	R8	W12-L	Bedroom	16.6	14.9	1.8	10.5%													
		W12-U						14.5	10.6	73%	10.6	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W13-L	LKD	19.2	17.2	1.9	10.0%													
		W13-U																		
		W14-L		9.2	9.2	0.0	0.0%													
		W14-U						28.9	19.8	68%	19.8	68%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Second	R10	W15-L	Bedroom	14.4	13.1	1.3	8.7%													
		W15-U						14.5	8.7	60%	8.7	60%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W16-L	LKD	17.4	15.9	1.5	8.7%													
		W16-U																		
		W17-L		9.6	9.6	0.0	0.0%													
		W17-U						28.9	21.5	74%	21.5	74%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Second	R12	W18-L	Bedroom	16.2	15.3	0.9	5.6%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W19-L	Bedroom	19.3	17.9	1.4	7.4%													
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W20-L	LKD	20.0	18.6	1.4	7.0%													
		W20-U																		
		W21-L		12.4	11.9	0.4	3.6%													
		W21-U																		
		W22-L		3.3	3.3	0.0	0.0%													
		W22-U																		
		W23-L		1.0	1.0	0.0	0.0%													
		W23-U						40.8	31.7	78%	31.0	76%	0.7	2.2%	19	7	19	7	0.0%	0.0%
Third	R1	W1-L	LKD	30.5	24.9	5.6	18.4%													
		W1-U																		
		W2-L		9.7	9.7	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U						33.5	31.1	93%	30.4	91%	0.7	2.2%	7	0	7	0	0.0%	0.0%
Third	R2	W3-L	Bedroom	25.0	20.0	5.0	20.1%													
		W3-U						14.8	13.5	91%	13.5	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W4-L	LKD	28.3	24.0	4.3	15.1%													
		W4-U																		
		W5-L		8.9	8.9	0.0	0.1%													
		W5-U						28.8	27.3	95%	27.0	94%	0.3	1.1%	7	0	7	0	0.0%	0.0%
Third	R4	W6-L	Bedroom	22.7	18.8	3.9	17.2%													
		W6-U						14.5	12.4	85%	12.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7-L	LKD	25.8	22.5	3.3	12.8%													
		W7-U																		
		W8-L		8.6	8.6	0.0	0.0%													
		W8-U						28.8	25.0	87%	24.7	86%	0.3	1.2%	8	0	8	0	0.0%	0.0%
Third	R6	W9-L	Bedroom	20.7	17.8	2.9	14.2%													
		W9-U						14.5	11.5	79%	11.5	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10-L	LKD	23.6	21.0	2.7	11.3%													
		W10-U																		
		W11-L		9.1	9.1	0.0	0.0%													
		W11-U						28.8	22.8	79%	22.5	78%	0.3	1.5%	9	0	9	0	0.0%	0.0%
Third	R8	W12-L	Bedroom	18.4	16.5	2.0	10.7%													
		W12-U						14.5	10.6	73%	10.6	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W13-L	LKD	20.8	18.7	2.1	10.2%													
		W13-U																		
		W14-L		9.5	9.5	0.0	0.0%													
		W14-U						28.9	22.6	78%	22.5	78%	0.0	0.2%	8	0	8	0	0.0%	0.0%
Third	R10	W15-L	Bedroom	15.7	14.3	1.4	8.9%													
		W15-U						14.5	8.8	61%	8.8	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W16-L	LKD	18.7	17.0	1.7	9.1%													
		W16-U																		
		W17-L		10.0	10.0	0.0	0.0%													
		W17-U						28.9	24.2	84%	24.2	84%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Third	R12	W18-L	Bedroom	17.2	16.2	1.0	5.8%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W19-L	Bedroom	20.4	18.8	1.6	7.7%													
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W20-L	LKD	21.1	19.6	1.5	7.2%													
		W20-U																		
		W21-L		12.8	12.4	0.5	3.8%													
		W21-U																		
		W22-L		3.4	3.4	0.0	0.0%													
		W22-U																		
		W23-L		1.1	1.1	0.0	0.0%													
		W23-U						40.8	31.8	78%	31.1	76%	0.7	2.2%	19	7	19	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R1	W1-L	LKD	31.8	26.3	5.5	17.4%												
		W1-U																	
		W2-L		10.4	10.4	0.0	0.3%												
		W2-U						33.5	31.4	93%	31.0	92%	0.3	1.1%	7	0	7	0	0.0%	0.0%
Fourth	R2	W3-L	Bedroom	26.3	21.3	5.0	19.0%												
		W3-U						14.8	13.6	92%	13.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W4-L	LKD	30.0	25.4	4.5	15.1%												
		W4-U																	
		W5-L		9.5	9.5	0.0	0.3%												
		W5-U						28.8	27.5	95%	27.5	95%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourth	R4	W6-L	Bedroom	24.3	20.1	4.2	17.2%												
		W6-U						14.5	12.4	86%	12.4	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7-L	LKD	27.6	23.9	3.7	13.5%												
		W7-U																	
		W8-L		9.1	9.1	0.0	0.0%												
		W8-U						28.8	25.5	88%	25.4	88%	0.0	0.1%	9	0	9	0	0.0%	0.0%
Fourth	R6	W9-L	Bedroom	22.3	19.0	3.3	14.7%												
		W9-U						14.5	11.6	80%	11.6	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10-L	LKD	25.3	22.2	3.1	12.1%												
		W10-U																	
		W11-L		9.4	9.4	0.0	0.0%												
		W11-U						28.8	23.2	81%	23.2	80%	0.1	0.2%	10	0	10	0	0.0%	0.0%
Fourth	R8	W12-L	Bedroom	19.8	17.5	2.3	11.6%												
		W12-U						14.5	10.6	73%	10.6	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W13-L	LKD	22.1	19.7	2.4	10.7%												
		W13-U																	
		W14-L		9.8	9.8	0.0	0.0%												
		W14-U						28.9	23.0	79%	22.9	79%	0.0	0.2%	8	0	8	0	0.0%	0.0%
Fourth	R10	W15-L	Bedroom	16.7	15.2	1.6	9.4%												
		W15-U						14.5	8.8	61%	8.8	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W16-L	LKD	19.8	17.9	1.9	9.5%												
		W16-U																	
		W17-L		10.3	10.3	0.0	0.0%												
		W17-U						28.9	25.0	87%	25.0	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Fourth	R12	W18-L	Bedroom	18.3	17.2	1.1	6.1%												
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R13	W19-L	Bedroom	21.4	19.8	1.7	7.7%												
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W20-L	LKD	22.1	20.5	1.6	7.3%												
		W20-U																	
		W21-L		13.3	12.8	0.5	3.8%												
		W21-U																	
		W22-L		3.5	3.5	0.0	0.0%												
		W22-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W23-L		1.1	1.1	0.0	0.0%												
		W23-U						40.8	31.9	78%	31.2	77%	0.7	2.1%	19	7	19	7	0.0%	0.0%
Fifth	R1	W1-L	LKD	32.7	27.4	5.3	16.2%												
		W1-U																	
		W2-L		11.2	11.1	0.0	0.4%												
		W2-U						33.5	31.4	94%	31.0	93%	0.3	1.1%	7	0	7	0	0.0%	0.0%
Fifth	R2	W3-L	Bedroom	27.4	22.6	4.7	17.3%												
		W3-U						14.8	13.8	93%	13.8	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W4-L	LKD	30.9	26.6	4.4	14.1%												
		W4-U																	
		W5-L		10.1	10.1	0.0	0.4%												
		W5-U						28.8	27.6	96%	27.6	96%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Fifth	R4	W6-L	Bedroom	25.4	21.4	4.0	15.7%												
		W6-U						14.5	12.5	86%	12.5	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7-L	LKD	28.6	25.0	3.6	12.6%												
		W7-U																	
		W8-L		9.5	9.5	0.0	0.0%												
		W8-U						28.8	25.8	90%	25.8	90%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifth	R6	W9-L	Bedroom	23.4	20.3	3.2	13.4%												
		W9-U						14.5	11.6	80%	11.6	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10-L	LKD	26.2	23.3	3.0	11.3%												
		W10-U																	
		W11-L		9.8	9.8	0.0	0.0%												
		W11-U						28.8	23.7	82%	23.7	82%	0.0	0.1%	10	0	10	0	0.0%	0.0%
Fifth	R8	W12-L	Bedroom	20.8	18.6	2.2	10.7%												
		W12-U						14.5	10.6	73%	10.6	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W13-L	LKD	23.0	20.6	2.4	10.3%												
		W13-U																	
		W14-L		10.2	10.2	0.0	0.0%												
		W14-U						28.9	23.0	80%	23.0	80%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifth	R10	W15-L	Bedroom	17.7	16.1	1.6	9.1%												
		W15-U						14.5	8.9	61%	8.9	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W16-L	LKD	20.8	18.9	1.9	9.3%												
		W16-U																	
		W17-L		10.6	10.6	0.0	0.0%												
		W17-U						28.9	25.2	87%	25.2	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Fifth	R12	W18-L	Bedroom	19.3	18.2	1.1	5.8%												
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W19-L	Bedroom	22.4	20.8	1.7	7.4%												
		W19-U						12.9	11.7	90%	11.7	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W20-L	LKD	23.1	21.5	1.6	6.9%												
		W20-U																	
		W21-L		13.8	13.2	0.5	3.9%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W21-U																	
		W22-L		3.6	3.6	0.0	0.0%												
		W22-U																	
		W23-L		1.1	1.1	0.0	0.0%												
		W23-U						40.8	32.0	78%	31.4	77%	0.6	2.0%	21	7	21	7	0.0%	0.0%
Sixth	R1	W1-L	LKD	33.4	28.4	5.0	14.9%												
		W1-U																	
		W2-L		12.0	12.0	0.0	0.2%												
		W2-U						33.5	31.5	94%	31.1	93%	0.3	1.1%	7	0	7	0	0.0%	0.0%
Sixth	R2	W3-L	Bedroom	29.9	25.5	4.4	14.9%												
		W3-U						14.8	14.3	96%	14.3	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W4-L	LKD	31.7	27.7	4.0	12.7%												
		W4-U																	
		W5-L		10.7	10.7	0.0	0.3%												
		W5-U						28.8	27.6	96%	27.6	96%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Sixth	R4	W6-L	Bedroom	28.0	24.3	3.7	13.3%												
		W6-U						14.5	12.9	89%	12.9	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7-L	LKD	29.4	26.1	3.3	11.3%												
		W7-U																	
		W8-L		10.0	10.0	0.0	0.0%												
		W8-U						28.8	26.1	91%	26.1	91%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Sixth	R6	W9-L	Bedroom	26.0	23.0	2.9	11.2%												
		W9-U						14.5	11.8	82%	11.8	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10-L	LKD	27.1	24.3	2.7	10.1%												
		W10-U																	
		W11-L		10.2	10.2	0.0	0.0%												
		W11-U						28.8	24.4	85%	24.4	85%	0.0	0.0%	11	0	11	0	0.0%	0.0%
Sixth	R8	W12-L	Bedroom	22.7	20.6	2.1	9.0%												
		W12-U						14.5	10.7	74%	10.7	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W13-L	LKD	23.8	21.6	2.2	9.3%												
		W13-U																	
		W14-L		10.5	10.5	0.0	0.0%												
		W14-U						28.9	23.0	80%	23.0	80%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Sixth	R10	W15-L	Bedroom	18.5	17.1	1.5	8.0%												
		W15-U						14.5	8.9	62%	8.9	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W16-L	LKD	21.8	20.0	1.8	8.2%												
		W16-U																	
		W17-L		10.9	10.9	0.0	0.0%												
		W17-U						28.9	25.2	87%	25.2	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Sixth	R12	W18-L	Bedroom	20.2	19.2	1.0	5.1%												
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W19-L	Bedroom	23.4	21.9	1.5	6.5%												
		W19-U						12.9	11.7	90%	11.7	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R14	W20-L	LKD	24.1	22.6	1.5	6.3%												
		W20-U																	
		W21-L		14.2	13.7	0.5	3.7%												
		W21-U																	
		W22-L		3.7	3.7	0.0	0.0%												
		W22-U																	
		W23-L		1.1	1.1	0.0	0.0%												
		W23-U						40.8	32.1	79%	31.5	77%	0.6	1.9%	21	7	21	7	0.0%	0.0%
Seventh	R1	W1-L	LKD	19.1	9.9	9.2	48.1%												
		W1-U																	
		W2-L		32.9	22.9	10.0	30.4%												
		W2-U																	
		W3-L		28.7	26.1	2.6	9.2%												
		W3-U						24.5	24.5	100%	24.3	99%	0.2	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W4-L	Bedroom	25.8	23.4	2.4	9.2%												
		W4-U						14.6	10.8	74%	10.8	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W5-L	LKD	24.8	22.7	2.1	8.3%												
		W5-U																	
		W6-L		10.9	10.9	0.0	0.0%												
		W6-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Seventh	R4	W7-L	Bedroom	19.5	18.1	1.4	7.0%												
		W7-U						14.5	9.0	62%	9.0	62%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8-L	LKD	22.7	21.1	1.7	7.3%												
		W8-U																	
		W9-L		11.2	11.2	0.0	0.0%												
		W9-U						28.7	25.0	87%	25.0	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Seventh	R6	W10-L	Bedroom	21.1	20.2	0.9	4.4%												
		W10-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W11-L	Bedroom	24.3	22.9	1.4	5.8%												
		W11-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W12-L	LKD	25.0	23.6	1.4	5.7%												
		W12-U																	
		W13-L		14.6	14.1	0.5	3.7%												
		W13-U																	
		W14-L		4.1	4.1	0.0	0.0%												
		W14-U																	
		W15-L		1.1	1.1	0.0	0.0%												
		W15-U						40.8	32.3	79%	31.8	78%	0.6	1.8%	23	7	23	7	0.0%	0.0%
Eighth	R1	W1-L	LKD	34.2	23.8	10.4	30.3%												
		W1-U																	
		W2-L		22.3	19.7	2.6	11.7%												
		W2-U																	
		W3-L		33.2	23.6	9.6	29.0%												
		W3-U																	
		W4-L		29.7	27.2	2.5	8.4%												
		W4-U						27.6	27.2	99%	27.0	98%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W5-L	Bedroom	26.8	24.5	2.2	8.4%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U						14.3	10.6	74%	10.6	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W6-L	LKD	25.8	23.9	1.9	7.5%													
		W6-U																		
		W7-L		11.2	11.2	0.0	0.0%													
		W7-U						28.8	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighth	R4	W8-L	Bedroom	20.6	19.3	1.3	6.2%													
		W8-U						14.3	9.1	64%	9.0	63%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W9-L	LKD	23.9	22.3	1.6	6.5%													
		W9-U																		
		W10-L		11.5	11.5	0.0	0.0%													
		W10-U						31.0	26.7	86%	26.7	86%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Eighth	R6	W11-L	Bedroom	22.2	21.3	0.9	3.9%													
		W11-U						12.7	12.2	96%	12.2	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W12-L	Bedroom	25.3	23.9	1.3	5.3%													
		W12-U																		
		W13-L		14.6	14.5	0.1	0.5%													
		W13-U						17.4	16.1	92%	16.1	92%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Ninth	R1	W1-L	LKD	34.9	24.9	10.0	28.6%													
		W1-U																		
		W2-L		22.6	20.1	2.5	10.8%													
		W2-U																		
		W3-L		33.6	24.4	9.2	27.4%													
		W3-U																		
		W4-L		30.8	28.5	2.3	7.6%													
		W4-U						29.2	28.9	99%	28.7	98%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R2	W5-L	Bedroom	27.9	25.8	2.1	7.5%													
		W5-U						14.8	11.1	75%	11.1	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W6-L	LKD	27.1	25.3	1.8	6.7%													
		W6-U																		
		W7-L		11.6	11.6	0.0	0.0%													
		W7-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Ninth	R4	W8-L	Bedroom	21.9	20.6	1.2	5.5%													
		W8-U						14.5	9.2	64%	9.1	63%	0.1	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W9-L	LKD	25.2	23.7	1.5	5.8%													
		W9-U																		
		W10-L		11.8	11.8	0.0	0.0%													
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.2%	6	0	6	0	0.0%	0.0%
Ninth	R6	W11-L	Bedroom	23.5	22.6	0.8	3.5%													
		W11-U						12.1	11.2	92%	11.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W12-L	Bedroom	26.5	25.2	1.2	4.7%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	10.6	74%	10.6	74%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Tenth	R1	W1-L	LKD	35.6	26.1	9.5	26.8%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W1-U																	
		W2-L		22.8	20.6	2.3	10.0%												
		W2-U																	
		W3-L		34.1	25.3	8.8	25.8%												
		W3-U																	
		W4-L		32.1	29.9	2.2	6.7%												
		W4-U						29.2	28.9	99%	28.7	98%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R2	W5-L	Bedroom	29.3	27.3	2.0	6.7%												
		W5-U						14.8	11.4	76%	11.4	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W6-L	LKD	28.6	26.9	1.7	5.8%												
		W6-U																	
		W7-L		12.0	12.0	0.0	0.0%												
		W7-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Tenth	R4	W8-L	Bedroom	23.4	22.2	1.2	4.9%												
		W8-U						14.5	9.5	65%	9.2	64%	0.2	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W9-L	LKD	26.8	25.4	1.4	5.3%												
		W9-U																	
		W10-L		12.1	12.0	0.0	0.2%												
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.1%	6	0	6	0	0.0%	0.0%
Tenth	R6	W11-L	Bedroom	24.9	24.1	0.8	3.1%												
		W11-U						12.1	11.2	92%	11.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W12-L	Bedroom	27.8	26.7	1.2	4.2%												
		W12-U																	
		W13-L		0.0	0.0	0.0	0.0%												
		W13-U						14.2	10.6	75%	10.6	75%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Eleventh	R1	W1-L	LKD	36.4	27.3	9.1	24.9%												
		W1-U																	
		W2-L		23.0	20.9	2.1	9.2%												
		W2-U																	
		W3-L		34.5	26.2	8.3	24.1%												
		W3-U																	
		W4-L		33.4	31.4	2.0	6.0%												
		W4-U						29.2	29.1	100%	28.9	99%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R2	W5-L	Bedroom	30.8	29.0	1.8	5.9%												
		W5-U						14.8	11.9	80%	11.9	80%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W6-L	LKD	30.3	28.7	1.5	5.1%												
		W6-U																	
		W7-L		12.5	12.5	0.0	0.1%												
		W7-U						28.7	22.8	79%	22.8	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eleventh	R4	W8-L	Bedroom	25.1	24.0	1.1	4.4%												
		W8-U						14.5	10.0	69%	9.8	68%	0.2	2.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W9-L	LKD	28.6	27.2	1.4	4.8%												
		W9-U																	
		W10-L		12.4	12.3	0.0	0.3%												
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.1%	7	0	7	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eleventh	R6	W11-L	Bedroom	26.5	25.7	0.8	3.0%												
		W11-U						12.1	11.4	94%	11.4	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W12-L	Bedroom	29.4	28.2	1.1	3.8%												
		W12-U																	
		W13-L		0.0	0.0	0.0	0.0%												
		W13-U						14.2	10.9	77%	10.9	77%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Twelfth	R1	W1-L	LKD	37.2	28.6	8.6	23.1%												
		W1-U																	
		W2-L		23.2	21.3	1.9	8.3%												
		W2-U																	
		W3-L		35.0	27.2	7.8	22.4%												
		W3-U																	
		W4-L		34.7	32.6	2.1	6.1%												
		W4-U						29.2	29.2	100%	29.0	99%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R2	W5-L	Bedroom	32.3	30.4	1.9	6.0%												
		W5-U						14.8	13.2	89%	13.0	88%	0.3	1.9%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W6-L	LKD	32.2	30.5	1.6	5.1%												
		W6-U																	
		W7-L		12.9	12.8	0.1	0.8%												
		W7-U						28.7	22.8	79%	22.8	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Twelfth	R4	W8-L	Bedroom	27.0	25.8	1.2	4.4%												
		W8-U						14.5	11.9	82%	11.8	82%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W9-L	LKD	30.6	29.2	1.4	4.5%												
		W9-U																	
		W10-L		12.6	12.5	0.1	0.6%												
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Twelfth	R6	W11-L	Bedroom	28.2	27.4	0.8	2.9%												
		W11-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W12-L	Bedroom	31.0	29.9	1.1	3.6%												
		W12-U																	
		W13-L		0.0	0.0	0.0	0.0%												
		W13-U						14.2	11.8	83%	11.8	83%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Thirteenth	R1	W1-L	LKD	38.0	30.0	8.0	21.1%												
		W1-U																	
		W2-L		23.4	21.6	1.8	7.5%												
		W2-U																	
		W3-L		35.4	28.1	7.3	20.6%												
		W3-U																	
		W4-L		35.9	33.7	2.2	6.1%												
		W4-U						29.2	29.2	100%	29.1	100%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R2	W5-L	Bedroom	33.7	31.7	2.0	5.9%												
		W5-U						14.8	14.3	96%	14.2	96%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W6-L	LKD	34.1	32.3	1.7	5.1%												
		W6-U																	
		W7-L		13.3	13.2	0.2	1.4%												
		W7-U						28.7	23.8	83%	23.8	83%	0.0	0.1%	9	0	9	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirteenth	R4	W8-L	Bedroom	28.9	27.6	1.3	4.4%													
		W8-U						14.5	14.0	96%	13.8	95%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W9-L	LKD	32.8	31.4	1.4	4.2%													
		W9-U																		
		W10-L		12.9	12.8	0.1	0.9%													
		W10-U						32.3	29.0	90%	29.0	90%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Thirteenth	R6	W11-L	Bedroom	30.0	29.2	0.9	2.9%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W12-L	Bedroom	32.7	31.6	1.2	3.5%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	90%	12.8	90%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fourteenth	R1	W1-L	LKD	38.7	31.3	7.4	19.2%													
		W1-U																		
		W2-L		23.5	22.0	1.6	6.6%													
		W2-U																		
		W3-L		35.8	29.1	6.7	18.7%													
		W3-U																		
		W4-L		36.9	34.7	2.2	6.0%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R2	W5-L	Bedroom	35.0	32.9	2.1	5.9%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W6-L	LKD	35.8	34.0	1.8	4.9%													
		W6-U																		
		W7-L		13.7	13.4	0.2	1.8%													
		W7-U						28.7	28.4	99%	28.0	98%	0.4	1.3%	9	0	9	0	0.0%	0.0%
Fourteenth	R4	W8-L	Bedroom	30.7	29.4	1.3	4.4%													
		W8-U						14.5	14.0	96%	13.9	96%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W9-L	LKD	34.9	33.5	1.4	4.0%													
		W9-U																		
		W10-L		13.1	12.9	0.2	1.2%													
		W10-U						32.3	31.9	99%	31.8	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourteenth	R6	W11-L	Bedroom	31.8	30.9	0.9	3.0%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W12-L	Bedroom	34.4	33.2	1.2	3.4%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	90%	12.8	90%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fifteenth	R1	W1-L	LKD	39.3	32.6	6.8	17.2%													
		W1-U																		
		W2-L		23.6	22.3	1.4	5.8%													
		W2-U																		
		W3-L		36.2	30.1	6.1	16.8%													
		W3-U																		
		W4-L		37.8	35.6	2.3	6.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R2	W5-L	Bedroom	36.1	34.0	2.1	5.8%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W6-L	LKD	37.3	35.5	1.8	4.9%													
		W6-U																		
		W7-L		14.0	13.7	0.3	2.1%													
		W7-U						28.7	28.4	99%	28.1	98%	0.3	0.9%	9	0	9	0	0.0%	0.0%
Fifteenth	R4	W8-L	Bedroom	32.3	30.9	1.4	4.4%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W9-L	LKD	36.9	35.4	1.4	3.9%													
		W9-U																		
		W10-L		13.3	13.1	0.2	1.5%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fifteenth	R6	W11-L	Bedroom	33.4	32.4	1.0	3.1%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W12-L	Bedroom	35.9	34.6	1.2	3.4%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Sixteenth	R1	W1-L	LKD	39.6	33.6	6.1	15.3%													
		W1-U																		
		W2-L		23.6	22.5	1.2	5.0%													
		W2-U																		
		W3-L		36.4	31.0	5.4	14.8%													
		W3-U																		
		W4-L		38.2	36.1	2.2	5.6%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R2	W5-L	Bedroom	36.5	34.5	2.0	5.5%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W6-L	LKD	37.9	36.1	1.8	4.7%													
		W6-U																		
		W7-L		14.2	13.9	0.3	2.4%													
		W7-U						28.7	28.4	99%	28.2	98%	0.2	0.8%	9	0	9	0	0.0%	0.0%
Sixteenth	R4	W8-L	Bedroom	32.9	31.4	1.4	4.4%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W9-L	LKD	37.6	36.1	1.5	3.9%													
		W9-U																		
		W10-L		13.4	13.2	0.2	1.8%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Sixteenth	R6	W11-L	Bedroom	34.0	32.9	1.1	3.2%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W12-L	Bedroom	36.4	35.1	1.3	3.5%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Seventeenth	R1	W1-L	LKD	39.6	34.3	5.3	13.4%													
		W1-U																		
		W2-L		23.7	22.6	1.0	4.3%													
		W2-U																		
		W3-L		36.4	31.7	4.7	12.9%													
		W3-U																		
		W4-L		38.5	36.5	2.0	5.1%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R2	W5-L	Bedroom	36.8	34.9	1.9	5.1%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W6-L	LKD	38.2	36.5	1.7	4.5%													
		W6-U																		
		W7-L		14.6	14.2	0.4	2.5%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Seventeenth	R4	W8-L	Bedroom	33.2	31.8	1.4	4.2%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W9-L	LKD	37.9	36.4	1.5	3.8%													
		W9-U																		
		W10-L		13.6	13.3	0.3	2.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Seventeenth	R6	W11-L	Bedroom	34.3	33.1	1.2	3.4%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R7	W12-L	Bedroom	36.8	35.4	1.3	3.6%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Eighteenth	R1	W1-L	LKD	39.6	35.1	4.5	11.4%													
		W1-U																		
		W2-L		23.7	22.8	0.8	3.5%													
		W2-U																		
		W3-L		36.5	32.5	4.0	10.9%													
		W3-U																		
		W4-L		38.7	36.9	1.8	4.7%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R2	W5-L	Bedroom	37.1	35.4	1.7	4.7%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R3	W6-L	LKD	38.5	36.9	1.6	4.2%													
		W6-U																		
		W7-L		14.9	14.5	0.4	2.8%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighteenth	R4	W8-L	Bedroom	33.7	32.3	1.4	4.2%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R5	W9-L	LKD	38.1	36.7	1.5	3.9%													
		W9-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-L		13.8	13.5	0.3	2.3%												
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Eighteenth	R6	W11-L	Bedroom	34.7	33.4	1.2	3.6%												
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W12-L	Bedroom	37.2	35.8	1.4	3.7%												
		W12-U																	
		W13-L		0.0	0.0	0.0	0.0%												
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Nineteenth	R1	W1-L	LKD	39.6	36.0	3.7	9.3%												
		W1-U																	
		W2-L		23.7	23.1	0.6	2.7%												
		W2-U																	
		W3-L		37.5	34.2	3.2	8.6%												
		W3-U																	
		W4-L		38.9	37.3	1.6	4.2%												
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R2	W5-L	Bedroom	38.0	36.4	1.6	4.2%												
		W5-U						14.8	14.5	98%	14.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R3	W6-L	LKD	38.8	37.2	1.6	4.0%												
		W6-U																	
		W7-L		15.2	14.8	0.4	2.8%												
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Nineteenth	R4	W8-L	Bedroom	35.5	34.1	1.4	3.9%												
		W8-U						14.5	14.2	98%	14.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R5	W9-L	LKD	38.4	37.0	1.5	3.8%												
		W9-U																	
		W10-L		14.0	13.6	0.4	2.5%												
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Nineteenth	R6	W11-L	Bedroom	35.9	34.6	1.3	3.6%												
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R7	W12-L	Bedroom	37.7	36.3	1.4	3.7%												
		W12-U																	
		W13-L		0.0	0.0	0.0	0.0%												
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Twentieth	R1	W1-L	LKD	20.2	17.8	2.4	11.7%												
		W1-U																	
		W2-L		9.7	9.4	0.3	3.0%												
		W2-U																	
		W3-L		39.6	37.2	2.5	6.2%												
		W3-U																	
		W4-L		39.1	37.6	1.5	3.7%												
		W4-U						34.9	34.9	100%	34.9	100%	0.0	0.0%	45	9	44	9	2.2%	0.0%
Twentieth	R2	W5-L	Bedroom	39.0	37.5	1.5	3.7%												
		W5-U						12.9	12.6	98%	12.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R3	W6-L	Bedroom	38.9	37.5	1.4	3.7%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U						12.9	12.7	99%	12.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R4	W7-L	Bedroom	38.8	37.3	1.4	3.7%													
		W7-U						14.6	13.7	94%	13.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R5	W8-L	Bedroom	38.6	37.2	1.4	3.7%													
		W8-U						13.5	12.9	96%	12.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W9-L	Bedroom	38.5	37.1	1.4	3.7%													
		W9-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R7	W10-L	LKD	38.1	36.7	1.4	3.7%													
		W10-U																		
		W11-L		5.9	5.9	0.0	0.0%													
		W11-U						27.4	25.1	92%	25.1	92%	0.0	0.0%	10	4	9	4	10.0%	0.0%
Twenty-First	R1	W1-L	LKD	20.2	18.5	1.7	8.3%													
		W1-U																		
		W2-L		9.7	9.5	0.2	2.2%													
		W2-U																		
		W3-L		39.6	37.9	1.7	4.4%													
		W3-U																		
		W4-L		39.1	37.9	1.2	3.1%													
		W4-U						34.9	34.9	100%	34.9	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%
Twenty-First	R2	W5-L	Bedroom	39.0	37.8	1.2	3.1%													
		W5-U						12.9	12.6	98%	12.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R3	W6-L	Bedroom	38.9	37.7	1.2	3.1%													
		W6-U						12.9	12.7	99%	12.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R4	W7-L	Bedroom	38.8	37.6	1.2	3.1%													
		W7-U						14.6	13.7	94%	13.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R5	W8-L	Bedroom	38.6	37.4	1.2	3.1%													
		W8-U						13.5	12.9	96%	12.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W9-L	Bedroom	38.5	37.3	1.2	3.2%													
		W9-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R7	W10-L	LKD	38.2	36.9	1.2	3.2%													
		W10-U																		
		W11-L		6.1	6.1	0.0	0.0%													
		W11-U						27.4	25.1	92%	25.1	92%	0.0	0.0%	10	4	10	4	0.0%	0.0%
Sessile Apartments																				
Ground	R15	W28-L	Bedroom	13.7	12.2	1.5	10.7%													
		W28-U						9.8	5.2	53%	4.8	49%	0.4	7.7%	31	6	27	2	12.9%	66.7%
Ground	R16	W29-L	LKD	12.3	8.5	3.8	31.1%													
		W29-U																		
		W30-L		36.9	35.9	1.0	2.7%													
		W30-U						41.4	32.9	80%	31.3	76%	1.6	5.0%	43	9	36	4	16.3%	55.6%
First	R1	W1-L	Bedroom	35.7	35.7	0.0	0.0%													
		W1-U						11.3	10.4	92%	10.4	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R2	W2-L	LKD	35.4	35.4	0.0	0.0%												
		W2-U																	
		W3-L		15.5	14.7	0.8	5.0%												
		W3-U																	
		W4		26.8	25.6	1.2	4.3%	27.5	27.5	100%	27.5	100%	0.0	0.0%	45	9	40	5	11.1%	44.4%
First	R3	W5-L	Bedroom	32.5	31.3	1.2	3.7%												
		W5-U						12.0	11.8	98%	11.7	97%	0.1	0.5%	43	8	38	4	11.6%	50.0%
First	R4	W6-L	Bedroom	32.1	31.0	1.1	3.4%												
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.3%	40	6	36	3	10.0%	50.0%
First	R5	W7-L	Bedroom	27.8	27.5	0.3	1.1%												
		W7-U						11.3	10.5	94%	10.5	93%	0.0	0.2%	28	2	27	1	3.6%	50.0%
First	R6	W8-L	LKD	16.0	14.6	1.4	8.9%												
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	28	8	24	4	14.3%	50.0%
First	R7	W9-L	Bedroom	29.7	28.1	1.6	5.3%												
		W9-U						16.9	15.9	94%	15.8	94%	0.1	0.3%	40	5	36	1	10.0%	80.0%
First	R8	W10-L	LKD	15.2	14.0	1.3	8.3%												
		W10-U						23.1	20.3	88%	19.4	84%	0.9	4.6%	23	6	20	3	13.0%	50.0%
First	R9	W11-L	Bedroom	27.9	25.8	2.0	7.2%												
		W11-U						12.7	9.8	77%	9.5	75%	0.4	3.7%	40	6	34	2	15.0%	66.7%
First	R10	W12-L	Bedroom	24.3	23.5	0.8	3.3%												
		W12-U						7.8	6.2	80%	6.2	80%	0.0	0.2%	20	1	19	0	5.0%	100.0%
First	R11	W13-L	LKD	12.3	10.9	1.4	11.6%												
		W13-U																	
		W14-L		7.0	4.7	2.2	31.9%												
		W14-U																	
		W15-L		5.4	4.4	1.0	18.1%												
		W15-U																	
		W16-L		4.1	3.9	0.1	3.4%												
		W16-U						36.2	27.4	76%	26.9	74%	0.5	1.7%	36	7	30	2	16.7%	71.4%
First	R13	W23-L	Bedroom	1.8	1.0	0.8	45.2%												
		W23-U						19.1	4.1	22%	4.0	21%	0.1	3.3%	5	1	5	1	0.0%	0.0%
First	R14	W24-L	Bedroom	13.5	11.4	2.2	16.0%												
		W24-U						14.6	3.9	27%	3.3	23%	0.6	15.4%	28	2	22	0	21.4%	100.0%
First	R15	W25-L	LKD	13.8	11.5	2.3	16.9%												
		W25-U																	
		W26-L		3.0	1.9	1.1	35.2%												
		W26-U																	
		W27-L		5.0	5.0	0.0	0.4%												
		W27-U						48.9	34.0	70%	29.2	60%	4.9	14.3%	41	6	33	3	19.5%	50.0%
First	R16	W28-L	LKD	8.8	6.6	2.2	25.1%												
		W28-U																	
		W29-L		3.3	2.5	0.8	24.5%												
		W29-U						35.0	20.7	59%	17.2	49%	3.5	17.0%	30	3	25	2	16.7%	33.3%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
First	R17	W30-L W30-U	Bedroom	9.5	9.2	0.3	2.8%	11.2	3.5	31%	3.2	29%	0.3	8.8%	23	2	22	2	4.3%	0.0%
First	R18	W31-L W31-U	LKD	2.9	2.3	0.7	22.1%	34.5	3.9	11%	3.3	10%	0.6	15.4%	11	1	9	1	18.2%	0.0%
First	R19	W32-L W32-U	Bedroom	10.0	9.6	0.4	4.2%	12.1	4.7	38%	4.4	36%	0.3	5.4%	25	2	24	2	4.0%	0.0%
First	R20	W33-L W33-U	LKD	4.5	3.6	0.9	20.9%	33.0	6.1	19%	5.2	16%	0.9	15.1%	18	3	15	2	16.7%	33.3%
First	R21	W34-L W34-U	Bedroom	15.4	14.3	1.2	7.7%	11.5	7.5	65%	7.1	62%	0.3	4.5%	36	7	33	4	8.3%	42.9%
First	R22	W35-L W35-U W36-L W36-U	LKD	19.1 38.1	15.5 37.3	3.6 0.9	18.8% 2.3%	36.4	28.2	78%	27.1	74%	1.1	3.9%	53	10	47	5	11.3%	50.0%
First	R23	W37-L W37-U	Bedroom	7.5	7.5	0.0	0.0%	73.9	14.0	19%	14.0	19%	0.0	0.0%	1	0	1	0	0.0%	0.0%
First	R24	W38-L W38-U	Bedroom	1.0	1.0	0.0	0.0%	17.0	11.7	69%	11.7	69%	0.0	0.0%	5	0	5	0	0.0%	0.0%
First	R25	W39-L W39-U	Bedroom	11.6	11.6	0.0	0.0%	12.9	12.6	97%	12.6	97%	0.0	0.0%	6	0	6	0	0.0%	0.0%
First	R26	W40-L W40-U	Bedroom	10.6	10.6	0.0	0.0%	12.0	6.6	55%	6.6	55%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R27	W41-L W41-U	LKD	0.5	0.5	0.0	0.0%	27.9	7.4	26%	7.4	26%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R28	W42-L W42-U	LKD	0.3	0.3	0.0	0.0%	27.9	5.8	21%	5.8	21%	0.0	0.0%	1	0	1	0	0.0%	0.0%
First	R29	W43-L W43-U	Bedroom	10.0	10.0	0.0	0.1%	11.9	5.3	45%	5.3	44%	0.0	0.2%	11	0	11	0	0.0%	0.0%
First	R30	W44-L W44-U	Bedroom	10.7	10.7	0.1	0.6%	12.9	6.7	52%	6.7	52%	0.0	0.0%	15	0	15	0	0.0%	0.0%
First	R31	W45-L W45-U	Bedroom	0.2	0.2	0.0	0.0%	17.0	1.7	10%	1.7	10%	0.0	0.9%	0	0	0	0	0.0%	0.0%
First	R32	W46-L W46-U	Residential	6.5	6.4	0.1	1.8%	76.4	4.4	6%	4.3	6%	0.1	1.5%	13	0	13	0	0.0%	0.0%
Second	R1	W1-L W1-U	Bedroom	31.3	31.3	0.0	0.0%	11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R2	W2-L W2-U W3-L	LKD	19.8 31.9	19.8 30.8	0.0 1.2	0.0% 3.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W3-U																	
		W4		32.6	31.4	1.2	3.7%	34.2	30.4	89%	30.4	89%	0.0	0.0%	50	12	44	7	12.0%	41.7%
Second	R3	W5-L	Bedroom	33.5	32.2	1.3	3.8%													
		W5-U						12.0	11.7	98%	11.7	97%	0.1	0.5%	46	11	40	6	13.0%	45.5%
Second	R4	W6-L	Bedroom	32.9	31.7	1.2	3.5%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.3%	43	9	38	5	11.6%	44.4%
Second	R5	W7-L	Bedroom	28.6	28.1	0.4	1.5%													
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.2%	31	6	29	4	6.5%	33.3%
Second	R6	W8-L	LKD	16.5	15.0	1.5	9.3%													
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	25	6	16.7%	45.5%
Second	R7	W9-L	Bedroom	30.5	28.9	1.7	5.5%													
		W9-U						16.9	16.1	95%	16.0	95%	0.0	0.3%	42	7	36	1	14.3%	85.7%
Second	R8	W10-L	LKD	15.8	14.4	1.4	8.6%													
		W10-U						25.0	20.8	83%	19.9	80%	0.9	4.2%	24	8	19	3	20.8%	62.5%
Second	R9	W11-L	Bedroom	28.7	26.7	2.0	7.1%													
		W11-U						12.7	10.2	80%	9.9	78%	0.3	2.6%	42	8	34	2	19.0%	75.0%
Second	R10	W12-L	Bedroom	25.1	24.3	0.8	3.1%													
		W12-U						7.8	6.5	83%	6.5	83%	0.0	0.3%	24	4	21	1	12.5%	75.0%
Second	R11	W13-L	LKD	13.0	11.7	1.3	10.0%													
		W13-U																		
		W14-L		6.1	5.0	1.1	17.7%													
		W14-U																		
		W15-L		4.6	4.5	0.1	2.2%													
		W15-U						36.4	27.1	74%	27.0	74%	0.1	0.4%	33	5	29	2	12.1%	60.0%
Second	R12	W16	LKD	8.8	8.8	0.0	0.0%													
		W17-L		10.9	9.0	1.8	16.8%													
		W17-U						43.0	34.9	81%	33.6	78%	1.3	3.8%	17	4	15	2	11.8%	50.0%
Second	R13	W18-L	Bedroom	24.8	21.0	3.9	15.5%													
		W18-U						12.1	9.2	76%	7.3	60%	1.9	20.2%	29	3	21	0	27.6%	100.0%
Second	R14	W19-L	LKD	11.8	7.3	4.5	38.2%													
		W19-U						28.4	18.9	67%	8.7	31%	10.2	53.9%	22	8	10	3	54.5%	62.5%
Second	R15	W20-L	Bedroom	26.1	19.5	6.6	25.1%													
		W20-U						13.1	10.9	83%	7.7	59%	3.2	29.4%	38	10	23	4	39.5%	60.0%
Second	R16	W21-L	LKD	25.4	17.7	7.7	30.5%													
		W21-U																		
		W22-L		4.3	2.0	2.2	52.2%													
		W22-U						43.2	30.4	70%	20.5	48%	9.8	32.4%	51	12	34	6	33.3%	50.0%
Second	R17	W23-L	Bedroom	18.3	14.8	3.6	19.4%													
		W23-U						13.6	3.3	24%	3.3	24%	0.0	0.0%	52	7	40	2	23.1%	71.4%
Second	R18	W24-L	Bedroom	18.0	14.5	3.5	19.2%													
		W24-U						11.8	4.1	35%	4.1	34%	0.0	1.0%	48	7	38	2	20.8%	71.4%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R19	W25-L	Bedroom	17.5	14.2	3.3	18.7%												
		W25-U						7.7	2.4	32%	2.4	31%	0.0	1.5%	46	7	37	3	19.6%	57.1%
Second	R20	W26-L	LKD	2.0	1.1	0.9	43.7%												
		W26-U						30.6	6.7	22%	5.7	19%	1.1	15.7%	7	2	7	2	0.0%	0.0%
Second	R21	W27-L	Bedroom	15.6	13.3	2.3	14.7%												
		W27-U						8.0	3.4	43%	2.8	35%	0.6	17.0%	35	3	28	0	20.0%	100.0%
Second	R22	W28-L	Bedroom	15.9	13.5	2.4	15.1%												
		W28-U						11.7	5.5	47%	4.7	40%	0.8	14.8%	38	4	30	0	21.1%	100.0%
Second	R23	W29-L	LKD	3.3	2.3	1.0	30.9%												
		W29-U																		
		W30-L		6.0	6.0	0.0	0.2%												
		W30-U						39.0	24.6	63%	23.8	61%	0.8	3.4%	24	7	21	4	12.5%	42.9%
Second	R24	W31-L	LKD	10.0	7.6	2.3	23.5%												
		W31-U																		
		W32-L		3.7	2.8	0.9	24.4%												
		W32-U						35.2	21.3	61%	18.7	53%	2.6	12.2%	31	3	27	2	12.9%	33.3%
Second	R25	W33-L	Bedroom	11.1	10.8	0.2	2.2%												
		W33-U						11.2	4.2	37%	3.9	35%	0.3	7.4%	25	2	24	2	4.0%	0.0%
Second	R26	W34-L	LKD	3.3	2.5	0.7	22.7%												
		W34-U						34.5	4.7	14%	4.1	12%	0.6	12.7%	12	1	10	1	16.7%	0.0%
Second	R27	W35-L	Bedroom	11.7	11.3	0.4	3.3%												
		W35-U						12.1	5.3	44%	5.1	42%	0.2	3.9%	31	3	30	3	3.2%	0.0%
Second	R28	W36-L	LKD	4.8	3.9	0.9	19.0%												
		W36-U						33.1	6.6	20%	5.9	18%	0.8	11.9%	19	3	16	2	15.8%	33.3%
Second	R29	W37-L	Bedroom	16.3	15.3	1.0	6.0%												
		W37-U						11.5	7.7	66%	7.4	64%	0.2	3.1%	34	7	32	5	5.9%	28.6%
Second	R30	W38-L	LKD	8.4	5.2	3.2	38.2%												
		W38-U																		
		W39-L		38.5	37.7	0.8	2.1%												
		W39-U						37.4	29.2	78%	28.1	75%	1.1	3.8%	41	11	36	6	12.2%	45.5%
Second	R31	W40-L	Bedroom	8.5	8.5	0.0	0.0%												
		W40-U						14.8	8.4	57%	8.4	57%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Second	R32	W41-L	LKD	1.4	1.4	0.0	0.0%												
		W41-U						26.1	18.0	69%	18.0	69%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Second	R33	W42-L	Bedroom	13.3	13.3	0.0	0.0%												
		W42-U						12.5	11.8	95%	11.8	95%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Second	R34	W43-L	Bedroom	12.1	12.1	0.0	0.0%												
		W43-U						11.1	7.6	68%	7.6	68%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Second	R35	W44-L	LKD	0.7	0.7	0.0	0.0%												
		W44-U						34.5	8.8	25%	8.8	25%	0.0	0.0%	1	0	1	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R36	W45-L W45-U	LKD	0.5	0.5	0.0	0.0%	34.4	6.4	19%	6.4	19%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Second	R37	W46-L W46-U	Bedroom	11.3	11.3	0.1	0.7%	11.1	7.7	69%	7.6	68%	0.1	0.8%	13	0	13	0	0.0%	0.0%
Second	R38	W47-L W47-U	Bedroom	12.3	12.2	0.2	1.3%	12.5	8.0	64%	8.0	64%	0.0	0.0%	18	0	18	0	0.0%	0.0%
Second	R39	W48-L W48-U	LKD	0.5	0.5	0.0	1.9%	26.1	2.9	11%	2.9	11%	0.0	0.2%	2	2	2	2	0.0%	0.0%
Second	R40	W49-L W49-U	Bedroom	7.3	7.1	0.2	2.2%	14.8	5.8	39%	5.7	38%	0.1	1.9%	13	0	13	0	0.0%	0.0%
Third	R1	W1-L W1-U	Bedroom	36.4	36.4	0.0	0.0%	11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R2	W2-L W2-U	LKD	36.1	36.1	0.0	0.0%													
		W3-L W3-U		16.7	15.8	0.9	5.5%													
		W4		28.2	27.0	1.2	4.4%	34.2	30.5	89%	30.5	89%	0.0	0.0%	50	12	45	7	10.0%	41.7%
Third	R3	W5-L W5-U	Bedroom	34.0	32.7	1.3	3.9%	12.0	11.7	98%	11.7	97%	0.1	0.5%	46	11	41	6	10.9%	45.5%
Third	R4	W6-L W6-U	Bedroom	33.6	32.4	1.2	3.6%	13.1	12.7	97%	12.7	97%	0.0	0.3%	44	10	40	6	9.1%	40.0%
Third	R5	W7-L W7-U	Bedroom	29.3	28.7	0.5	1.8%	11.3	10.6	94%	10.6	94%	0.0	0.2%	32	7	30	5	6.3%	28.6%
Third	R6	W8-L W8-U	LKD	17.1	15.4	1.6	9.5%	31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	25	6	16.7%	45.5%
Third	R7	W9-L W9-U	Bedroom	31.3	29.5	1.8	5.6%	16.9	16.2	96%	16.2	96%	0.0	0.2%	43	8	37	2	14.0%	75.0%
Third	R8	W10-L W10-U	LKD	16.4	14.9	1.4	8.7%	25.0	21.2	85%	21.2	85%	0.0	0.0%	25	9	20	4	20.0%	55.6%
Third	R9	W11-L W11-U	Bedroom	29.5	27.4	2.1	7.1%	12.7	10.6	83%	10.3	81%	0.3	2.4%	43	9	35	3	18.6%	66.7%
Third	R10	W12-L W12-U	Bedroom	25.9	25.0	0.9	3.4%	7.8	6.9	88%	6.9	88%	0.0	0.1%	25	4	22	1	12.0%	75.0%
Third	R11	W13-L W13-U	LKD	13.7	12.3	1.4	10.1%													
		W14-L W14-U		7.0	5.9	1.1	16.3%													
		W15-L W15-U		5.4	5.4	0.1	1.1%	36.4	27.2	75%	27.1	74%	0.1	0.4%	36	8	31	4	13.9%	50.0%
Third	R12	W16	LKD	9.5	9.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W17-L		12.3	10.5	1.7	14.2%												
		W17-U						43.0	35.2	82%	34.3	80%	1.0	2.7%	21	7	17	3	19.0%	57.1%
Third	R13	W18-L	Bedroom	26.6	23.2	3.4	12.8%												
		W18-U						12.1	9.9	82%	9.2	76%	0.7	6.7%	33	4	24	0	27.3%	100.0%
Third	R14	W19-L	LKD	13.6	9.7	3.9	28.5%												
		W19-U						28.4	19.8	70%	12.2	43%	7.7	38.7%	25	10	16	4	36.0%	60.0%
Third	R15	W20-L	Bedroom	28.1	22.6	5.5	19.6%												
		W20-U						13.1	11.3	86%	10.6	81%	0.6	5.7%	42	10	31	5	26.2%	50.0%
Third	R16	W21-L	LKD	11.0	6.8	4.3	38.7%												
		W21-U																		
		W22-L		19.2	15.0	4.2	21.9%												
		W22-U						43.2	30.4	70%	26.3	61%	4.1	13.4%	68	12	57	7	16.2%	41.7%
Third	R17	W23-L	Bedroom	20.3	16.7	3.7	18.0%												
		W23-U						13.6	4.2	31%	4.2	31%	0.1	1.4%	49	7	38	2	22.4%	71.4%
Third	R18	W24-L	Bedroom	20.1	16.7	3.4	17.1%												
		W24-U						11.8	4.5	38%	4.4	38%	0.1	1.5%	51	7	41	2	19.6%	71.4%
Third	R19	W25-L	Bedroom	19.7	16.4	3.3	16.7%												
		W25-U						7.7	2.9	37%	2.7	36%	0.1	4.3%	55	7	46	3	16.4%	57.1%
Third	R20	W26-L	LKD	2.4	1.4	1.0	42.4%												
		W26-U						30.6	7.3	24%	6.5	21%	0.8	11.4%	8	2	8	2	0.0%	0.0%
Third	R21	W27-L	Bedroom	18.0	15.6	2.4	13.3%												
		W27-U						8.0	4.4	55%	3.8	47%	0.6	14.4%	41	4	35	1	14.6%	75.0%
Third	R22	W28-L	Bedroom	18.2	15.8	2.5	13.5%												
		W28-U						11.7	6.1	52%	5.5	47%	0.5	9.1%	45	6	37	2	17.8%	66.7%
Third	R23	W29-L	LKD	3.9	2.9	1.1	27.1%												
		W29-U																		
		W30-L		7.4	7.4	0.0	0.1%												
		W30-U						39.0	25.6	66%	25.0	64%	0.6	2.4%	27	7	24	4	11.1%	42.9%
Third	R24	W31-L	LKD	11.5	9.0	2.5	21.3%												
		W31-U																		
		W32-L		4.2	3.3	1.0	23.3%												
		W32-U						35.2	22.0	63%	19.6	56%	2.4	11.1%	34	5	30	4	11.8%	20.0%
Third	R25	W33-L	Bedroom	13.0	12.8	0.2	1.8%												
		W33-U						11.2	5.1	46%	4.9	43%	0.3	5.3%	30	2	30	2	0.0%	0.0%
Third	R26	W34-L	LKD	3.8	3.0	0.8	21.1%												
		W34-U						34.5	5.4	16%	4.9	14%	0.5	9.5%	14	3	11	2	21.4%	33.3%
Third	R27	W35-L	Bedroom	13.7	13.3	0.4	2.6%												
		W35-U						12.1	6.1	50%	5.9	49%	0.2	3.2%	34	3	33	3	2.9%	0.0%
Third	R28	W36-L	LKD	5.3	4.4	0.9	17.2%												
		W36-U						33.1	7.5	23%	6.7	20%	0.7	9.8%	20	4	16	2	20.0%	50.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R29	W37-L	Bedroom	18.3	17.5	0.8	4.3%												
		W37-U						11.5	7.9	69%	7.7	67%	0.2	2.9%	42	8	40	6	4.8%	25.0%
Third	R30	W38-L	LKD	21.8	18.6	3.2	14.7%												
		W38-U																	
		W39-L		38.7	38.0	0.7	1.8%												
		W39-U						37.4	29.2	78%	28.4	76%	0.8	2.8%	57	11	52	6	8.8%	45.5%
Third	R31	W40-L	Bedroom	9.5	9.5	0.0	0.0%												
		W40-U						14.8	9.5	64%	9.5	64%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Third	R32	W41-L	LKD	1.9	1.9	0.0	0.0%												
		W41-U						26.1	18.3	70%	18.3	70%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Third	R33	W42-L	Bedroom	15.2	15.2	0.0	0.0%												
		W42-U						12.5	12.1	97%	12.1	97%	0.0	0.0%	16	0	16	0	0.0%	0.0%
Third	R34	W43-L	Bedroom	13.6	13.6	0.0	0.1%												
		W43-U						11.1	8.3	75%	8.3	75%	0.0	0.0%	15	0	14	0	6.7%	0.0%
Third	R35	W44-L	LKD	1.1	1.1	0.0	0.0%												
		W44-U						34.5	10.1	29%	10.1	29%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Third	R36	W45-L	LKD	0.9	0.9	0.0	0.0%												
		W45-U						34.4	7.9	23%	7.9	23%	0.0	0.0%	2	0	2	0	0.0%	0.0%
Third	R37	W46-L	Bedroom	12.8	12.6	0.1	1.0%												
		W46-U						11.1	9.1	82%	9.0	81%	0.1	1.1%	17	0	17	0	0.0%	0.0%
Third	R38	W47-L	Bedroom	14.2	13.9	0.3	1.9%												
		W47-U						12.5	8.9	72%	8.9	72%	0.0	0.0%	22	2	22	2	0.0%	0.0%
Third	R39	W48-L	LKD	1.0	1.0	0.1	4.9%												
		W48-U						26.1	4.2	16%	4.2	16%	0.0	0.0%	3	3	3	3	0.0%	0.0%
Third	R40	W49-L	Bedroom	8.1	7.9	0.2	2.6%												
		W49-U						14.8	6.9	47%	6.9	47%	0.0	0.3%	15	1	15	1	0.0%	0.0%
Fourth	R1	W1-L	Bedroom	31.7	31.7	0.0	0.0%												
		W1-U						11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R2	W2-L	LKD	20.4	20.4	0.0	0.0%												
		W2-U																	
		W3-L		33.3	32.0	1.2	3.7%												
		W3-U																	
		W4		33.9	32.6	1.3	3.8%	34.2	30.5	89%	30.5	89%	0.0	0.0%	52	13	48	9	7.7%	30.8%
Fourth	R3	W5-L	Bedroom	34.8	33.4	1.4	4.0%												
		W5-U						12.0	11.7	98%	11.7	97%	0.0	0.2%	47	12	43	8	8.5%	33.3%
Fourth	R4	W6-L	Bedroom	34.3	33.0	1.3	3.7%												
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.3%	44	10	41	7	6.8%	30.0%
Fourth	R5	W7-L	Bedroom	29.9	29.3	0.6	2.1%												
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.2%	32	7	30	5	6.3%	28.6%
Fourth	R6	W8-L	LKD	17.8	16.1	1.7	9.3%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	26	7	13.3%	36.4%
Fourth	R7	W9-L	Bedroom	32.0	30.2	1.8	5.5%													
		W9-U						16.9	16.3	97%	16.3	96%	0.0	0.1%	43	8	38	3	11.6%	62.5%
Fourth	R8	W10-L	LKD	17.2	15.6	1.5	8.8%													
		W10-U						25.0	21.5	86%	21.5	86%	0.0	0.0%	25	9	20	4	20.0%	55.6%
Fourth	R9	W11-L	Bedroom	30.3	28.2	2.1	7.0%													
		W11-U						12.7	11.0	87%	10.8	85%	0.2	2.2%	43	9	36	3	16.3%	66.7%
Fourth	R10	W12-L	Bedroom	26.7	25.7	1.0	3.6%													
		W12-U						7.8	7.4	94%	7.4	94%	0.0	0.0%	26	5	23	2	11.5%	60.0%
Fourth	R11	W13-L	LKD	14.6	13.1	1.5	10.2%													
		W13-U																		
		W14-L		8.2	7.1	1.2	14.1%													
		W14-U																		
		W15-L		6.6	6.6	0.0	0.8%													
		W15-U						36.4	27.5	76%	27.4	75%	0.1	0.3%	39	9	34	5	12.8%	44.4%
Fourth	R12	W16	LKD	10.6	10.6	0.0	0.0%													
		W17-L		13.8	12.1	1.7	12.6%													
		W17-U						43.0	35.8	83%	35.8	83%	0.0	0.1%	22	8	20	6	9.1%	25.0%
Fourth	R13	W18-L	Bedroom	28.3	25.2	3.1	11.0%													
		W18-U						12.1	10.5	87%	10.3	84%	0.3	2.7%	36	6	30	3	16.7%	50.0%
Fourth	R14	W19-L	LKD	15.4	11.9	3.4	22.3%													
		W19-U						28.4	20.9	74%	19.9	70%	1.0	4.9%	27	11	21	6	22.2%	45.5%
Fourth	R15	W20-L	Bedroom	29.7	24.9	4.8	16.1%													
		W20-U						13.1	11.8	90%	11.8	90%	0.0	0.0%	46	13	38	8	17.4%	38.5%
Fourth	R16	W21-L	LKD	28.7	23.3	5.4	18.7%													
		W21-U																		
		W22-L		5.6	3.4	2.2	39.8%													
		W22-U						43.2	30.5	71%	27.5	64%	3.0	9.8%	58	14	46	9	20.7%	35.7%
Fourth	R17	W23-L	Bedroom	22.8	19.2	3.6	15.8%													
		W23-U						13.6	5.7	42%	5.4	40%	0.3	5.9%	62	9	51	4	17.7%	55.6%
Fourth	R18	W24-L	Bedroom	22.7	19.3	3.4	15.1%													
		W24-U						11.8	5.2	44%	5.1	43%	0.1	2.4%	59	8	49	4	16.9%	50.0%
Fourth	R19	W25-L	Bedroom	22.2	18.9	3.3	15.0%													
		W25-U						7.7	3.4	44%	3.3	42%	0.1	4.0%	56	7	46	3	17.9%	57.1%
Fourth	R20	W26-L	LKD	3.7	2.5	1.2	33.2%													
		W26-U						30.6	9.8	32%	7.4	24%	2.4	24.7%	12	5	11	4	8.3%	20.0%
Fourth	R21	W27-L	Bedroom	20.8	18.3	2.5	12.1%													
		W27-U						8.0	5.7	72%	5.3	66%	0.4	7.8%	44	5	38	2	13.6%	60.0%
Fourth	R22	W28-L	Bedroom	20.9	18.3	2.6	12.5%													
		W28-U						11.7	7.1	61%	6.8	58%	0.3	3.7%	47	7	39	3	17.0%	57.1%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R23	W29-L	LKD	4.8	3.6	1.2	24.7%												
		W29-U																	
		W30-L		9.3	9.3	0.0	0.2%												
		W30-U						39.0	26.3	67%	25.7	66%	0.5	2.0%	29	7	26	4	10.3%	42.9%
Fourth	R24	W31-L	LKD	13.4	10.9	2.5	18.8%												
		W31-U																	
		W32-L		5.3	4.2	1.1	20.3%												
		W32-U						35.2	23.1	66%	21.1	60%	2.1	9.0%	38	8	32	5	15.8%	37.5%
Fourth	R25	W33-L	Bedroom	15.4	15.1	0.2	1.4%												
		W33-U						11.2	6.6	59%	6.3	57%	0.3	4.1%	37	4	37	4	0.0%	0.0%
Fourth	R26	W34-L	LKD	4.6	3.8	0.9	18.8%												
		W34-U						34.5	6.6	19%	6.2	18%	0.4	5.6%	17	6	13	4	23.5%	33.3%
Fourth	R27	W35-L	Bedroom	16.0	15.7	0.3	2.0%												
		W35-U						12.1	7.1	59%	6.9	57%	0.2	2.6%	41	6	40	6	2.4%	0.0%
Fourth	R28	W36-L	LKD	6.0	5.2	0.9	14.6%												
		W36-U						33.1	8.8	27%	8.1	25%	0.7	7.7%	21	6	17	4	19.0%	33.3%
Fourth	R29	W37-L	Bedroom	19.6	18.9	0.7	3.7%												
		W37-U						11.5	8.4	73%	8.0	70%	0.4	4.4%	40	9	38	7	5.0%	22.2%
Fourth	R30	W38-L	LKD	9.2	6.2	3.1	33.1%												
		W38-U																	
		W39-L		38.8	38.2	0.6	1.6%												
		W39-U						37.4	29.2	78%	28.5	76%	0.7	2.4%	42	12	38	8	9.5%	33.3%
Fourth	R31	W40-L	Bedroom	10.9	10.9	0.0	0.0%												
		W40-U						14.8	10.7	73%	10.7	73%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fourth	R32	W41-L	LKD	2.8	2.8	0.0	0.0%												
		W41-U						26.1	18.8	72%	18.8	72%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourth	R33	W42-L	Bedroom	17.3	17.3	0.0	0.0%												
		W42-U						12.5	12.3	99%	12.3	99%	0.0	0.0%	20	0	20	0	0.0%	0.0%
Fourth	R34	W43-L	Bedroom	15.1	15.0	0.1	0.9%												
		W43-U						11.1	9.1	82%	9.1	82%	0.0	0.0%	16	0	16	0	0.0%	0.0%
Fourth	R35	W44-L	LKD	2.0	2.0	0.0	0.5%												
		W44-U						34.5	12.2	35%	12.2	35%	0.0	0.0%	4	2	4	2	0.0%	0.0%
Fourth	R36	W45-L	LKD	1.5	1.5	0.0	0.0%												
		W45-U						34.4	10.1	29%	10.1	29%	0.0	0.0%	2	0	2	0	0.0%	0.0%
Fourth	R37	W46-L	Bedroom	14.3	14.1	0.2	1.1%												
		W46-U						11.1	9.8	88%	9.8	88%	0.0	0.2%	18	1	18	1	0.0%	0.0%
Fourth	R38	W47-L	Bedroom	16.3	15.9	0.4	2.3%												
		W47-U						12.5	10.0	80%	10.0	80%	0.0	0.0%	31	5	31	5	0.0%	0.0%
Fourth	R39	W48-L	LKD	2.2	2.0	0.2	9.1%												
		W48-U						26.1	6.2	24%	6.2	24%	0.0	0.0%	7	4	7	4	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R40	W49-L	Bedroom	9.2	8.8	0.3	3.7%												
		W49-U						14.8	8.1	55%	8.1	55%	0.0	0.0%	18	2	18	2	0.0%	0.0%
Fifth	R1	W1-L	Bedroom	36.7	36.7	0.0	0.0%												
		W1-U						11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R2	W2-L	LKD	36.3	36.3	0.0	0.0%												
		W2-U																	
		W3-L		17.9	16.9	1.1	5.9%												
		W3-U																	
		W4		29.4	28.1	1.3	4.4%	34.2	30.5	89%	30.5	89%	0.0	0.0%	55	15	51	11	7.3%	26.7%
Fifth	R3	W5-L	Bedroom	35.3	33.9	1.4	4.0%												
		W5-U						12.0	11.7	98%	11.7	97%	0.0	0.2%	50	13	46	9	8.0%	30.8%
Fifth	R4	W6-L	Bedroom	34.9	33.6	1.3	3.7%												
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.2%	45	11	42	8	6.7%	27.3%
Fifth	R5	W7-L	Bedroom	30.5	29.8	0.7	2.3%												
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.2%	32	7	30	5	6.3%	28.6%
Fifth	R6	W8-L	LKD	18.6	16.9	1.7	9.1%												
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	32	13	28	9	12.5%	30.8%
Fifth	R7	W9-L	Bedroom	32.6	30.8	1.8	5.5%												
		W9-U						16.9	16.4	97%	16.4	97%	0.0	0.1%	45	10	40	5	11.1%	50.0%
Fifth	R8	W10-L	LKD	18.0	16.4	1.6	8.8%												
		W10-U						25.0	21.7	87%	21.7	87%	0.0	0.0%	27	11	22	6	18.5%	45.5%
Fifth	R9	W11-L	Bedroom	31.2	29.1	2.1	6.8%												
		W11-U						12.7	11.5	91%	11.3	89%	0.2	2.0%	47	10	40	4	14.9%	60.0%
Fifth	R10	W12-L	Bedroom	27.5	26.5	1.1	3.8%												
		W12-U						7.8	7.5	96%	7.5	96%	0.0	0.0%	27	6	24	3	11.1%	50.0%
Fifth	R11	W13-L	LKD	15.4	13.9	1.6	10.2%												
		W13-U																	
		W14-L		10.3	9.0	1.3	12.9%												
		W14-U																	
		W15-L		8.6	8.5	0.1	0.8%												
		W15-U						36.4	27.9	77%	27.8	76%	0.0	0.1%	41	10	36	6	12.2%	40.0%
Fifth	R12	W16	LKD	12.3	12.3	0.0	0.0%												
		W17-L		14.7	12.9	1.8	12.3%												
		W17-U						43.0	36.1	84%	36.1	84%	0.0	0.0%	23	8	21	6	8.7%	25.0%
Fifth	R13	W18-L	Bedroom	29.6	26.8	2.8	9.3%												
		W18-U						12.1	11.2	92%	10.9	90%	0.3	2.3%	36	6	30	3	16.7%	50.0%
Fifth	R14	W19-L	LKD	16.4	13.4	2.9	17.9%												
		W19-U						28.4	22.1	78%	21.8	77%	0.3	1.4%	27	11	21	6	22.2%	45.5%
Fifth	R15	W20-L	Bedroom	30.9	26.9	4.0	13.0%												
		W20-U						13.1	12.3	93%	12.3	93%	0.0	0.0%	50	12	43	7	14.0%	41.7%
Fifth	R16	W21-L	LKD	13.6	11.1	2.5	18.6%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W21-U																	
		W22-L		23.6	19.6	4.1	17.1%												
		W22-U						43.2	30.5	71%	29.9	69%	0.6	2.0%	79	16	69	11	12.7%	31.3%
Fifth	R17	W23-L	Bedroom	25.4	21.8	3.7	14.4%												
		W23-U						13.6	7.4	54%	6.8	50%	0.5	7.4%	60	12	49	7	18.3%	41.7%
Fifth	R18	W24-L	Bedroom	25.4	21.9	3.5	13.8%												
		W24-U						11.8	6.1	52%	6.0	51%	0.0	0.5%	62	12	53	8	14.5%	33.3%
Fifth	R19	W25-L	Bedroom	25.1	21.7	3.4	13.7%												
		W25-U						7.7	4.1	54%	4.1	53%	0.0	1.1%	65	11	56	7	13.8%	36.4%
Fifth	R20	W26-L	LKD	6.8	5.2	1.6	22.9%												
		W26-U						30.6	13.8	45%	9.4	31%	4.4	32.0%	18	10	15	7	16.7%	30.0%
Fifth	R21	W27-L	Bedroom	24.1	21.1	3.0	12.4%												
		W27-U						8.0	6.5	81%	5.9	74%	0.5	8.5%	48	8	43	6	10.4%	25.0%
Fifth	R22	W28-L	Bedroom	24.1	21.0	3.1	12.7%												
		W28-U						11.7	8.2	70%	8.1	69%	0.1	0.8%	52	10	45	7	13.5%	30.0%
Fifth	R23	W29-L	LKD	7.5	5.9	1.6	20.9%												
		W29-U																		
		W30-L		12.1	12.1	0.1	0.7%												
		W30-U						39.0	26.9	69%	26.6	68%	0.4	1.4%	35	10	32	7	8.6%	30.0%
Fifth	R24	W31-L	LKD	16.1	13.6	2.6	16.0%												
		W31-U																		
		W32-L		7.5	6.3	1.2	15.8%												
		W32-U						35.2	24.2	69%	22.5	64%	1.7	6.9%	44	10	39	7	11.4%	30.0%
Fifth	R25	W33-L	Bedroom	18.5	18.1	0.3	1.8%												
		W33-U						11.2	8.3	74%	8.0	72%	0.3	3.1%	42	8	40	6	4.8%	25.0%
Fifth	R26	W34-L	LKD	6.3	5.4	0.9	14.8%												
		W34-U						34.5	8.4	24%	8.4	24%	0.0	0.0%	21	9	16	6	23.8%	33.3%
Fifth	R27	W35-L	Bedroom	19.0	18.6	0.3	1.8%												
		W35-U						12.1	8.6	71%	8.4	70%	0.2	2.1%	47	8	46	8	2.1%	0.0%
Fifth	R28	W36-L	LKD	7.5	6.6	0.9	12.1%												
		W36-U						33.1	11.0	33%	10.8	33%	0.1	1.3%	25	8	22	7	12.0%	12.5%
Fifth	R29	W37-L	Bedroom	22.2	21.5	0.7	3.3%												
		W37-U						11.5	9.0	78%	8.3	72%	0.6	7.1%	50	10	48	8	4.0%	20.0%
Fifth	R30	W38-L	LKD	25.7	22.6	3.1	12.1%												
		W38-U																		
		W39-L		38.9	38.4	0.5	1.4%												
		W39-U						37.4	29.2	78%	28.6	76%	0.7	2.3%	67	15	62	10	7.5%	33.3%
Fifth	R31	W40-L	Bedroom	12.6	12.6	0.0	0.0%												
		W40-U						14.8	12.0	81%	12.0	81%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifth	R32	W41-L	LKD	4.2	4.2	0.0	0.0%												
		W41-U						26.1	19.6	75%	19.6	75%	0.0	0.0%	7	0	7	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R33	W42-L W42-U	Bedroom	19.9	19.6	0.2	1.1%	12.5	12.4	99%	12.4	99%	0.0	0.0%	22	0	21	0	4.5%	0.0%
Fifth	R34	W43-L W43-U	Bedroom	16.9	16.6	0.3	1.8%	11.1	9.8	89%	9.8	89%	0.0	0.0%	20	0	19	0	5.0%	0.0%
Fifth	R35	W44-L W44-U	LKD	3.9	3.8	0.1	3.3%	34.5	14.9	43%	14.9	43%	0.0	0.0%	11	3	11	3	0.0%	0.0%
Fifth	R36	W45-L W45-U	LKD	2.9	2.8	0.1	2.4%	34.4	12.6	36%	12.5	36%	0.0	0.1%	6	1	6	1	0.0%	0.0%
Fifth	R37	W46-L W46-U	Bedroom	16.1	15.9	0.2	1.5%	11.1	10.3	93%	10.3	93%	0.0	0.0%	21	1	21	1	0.0%	0.0%
Fifth	R38	W47-L W47-U	Bedroom	18.7	18.2	0.5	2.8%	12.5	10.7	86%	10.7	86%	0.0	0.0%	37	6	37	6	0.0%	0.0%
Fifth	R39	W48-L W48-U	LKD	3.6	3.3	0.4	10.2%	26.1	8.7	33%	8.7	33%	0.0	0.0%	11	5	11	5	0.0%	0.0%
Fifth	R40	W49-L W49-U	Bedroom	10.4	9.9	0.5	4.6%	14.8	9.1	62%	9.1	62%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Sixth	R1	W1-L W1-U	Bedroom	32.4	32.4	0.0	0.0%	11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R2	W2-L W2-U	LKD	20.7	20.7	0.0	0.0%													
		W3-L W3-U		34.6	33.3	1.3	3.7%													
		W4		35.2	33.9	1.3	3.7%	34.2	30.5	89%	30.5	89%	0.0	0.0%	58	18	55	15	5.2%	16.7%
Sixth	R3	W5-L W5-U	Bedroom	36.1	34.7	1.4	3.9%	12.0	11.7	98%	11.7	97%	0.0	0.1%	54	14	51	11	5.6%	21.4%
Sixth	R4	W6-L W6-U	Bedroom	35.6	34.3	1.3	3.7%	13.1	12.7	97%	12.7	97%	0.0	0.1%	49	13	47	11	4.1%	15.4%
Sixth	R5	W7-L W7-U	Bedroom	31.2	30.4	0.8	2.6%	11.3	10.6	94%	10.6	94%	0.0	0.1%	34	9	32	7	5.9%	22.2%
Sixth	R6	W8-L W8-U	LKD	19.5	17.8	1.7	8.7%	31.4	24.7	79%	24.7	79%	0.0	0.0%	35	14	31	10	11.4%	28.6%
Sixth	R7	W9-L W9-U	Bedroom	33.5	31.7	1.8	5.3%	16.9	16.5	97%	16.5	97%	0.0	0.0%	46	11	41	6	10.9%	45.5%
Sixth	R8	W10-L W10-U	LKD	19.0	17.3	1.7	8.7%	25.0	22.0	88%	22.0	88%	0.0	0.0%	31	14	26	9	16.1%	35.7%
Sixth	R9	W11-L W11-U	Bedroom	32.5	30.4	2.1	6.6%	12.7	12.1	95%	11.9	94%	0.2	1.8%	53	13	46	7	13.2%	46.2%
Sixth	R10	W12-L W12-U	Bedroom	29.1	27.9	1.2	4.0%	7.8	7.5	96%	7.5	96%	0.0	0.0%	28	7	25	4	10.7%	42.9%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R11	W13-L	LKD	16.5	14.8	1.7	10.1%												
		W13-U																	
		W14-L		13.5	11.9	1.6	12.0%												
		W14-U																	
		W15-L		11.9	11.8	0.1	0.8%												
		W15-U						36.4	27.9	77%	27.9	77%	0.0	0.0%	59	14	52	8	11.9%	42.9%
Sixth	R12	W16	LKD	15.3	15.3	0.0	0.0%												
		W17-L		15.7	13.9	1.9	11.9%												
		W17-U						43.0	36.4	85%	36.4	85%	0.0	0.0%	25	9	23	7	8.0%	22.2%
Sixth	R13	W18-L	Bedroom	31.8	29.1	2.7	8.5%												
		W18-U						12.1	11.5	94%	11.2	92%	0.3	2.2%	41	6	35	3	14.6%	50.0%
Sixth	R14	W19-L	LKD	17.5	14.5	2.9	16.7%												
		W19-U						28.4	22.7	80%	22.5	79%	0.2	0.8%	29	11	23	6	20.7%	45.5%
Sixth	R15	W20-L	Bedroom	32.5	28.6	3.9	12.0%												
		W20-U						13.1	12.5	95%	12.5	95%	0.0	0.0%	52	14	45	9	13.5%	35.7%
Sixth	R16	W21-L	LKD	33.7	29.3	4.3	12.8%												
		W21-U																	
		W22-L		10.2	7.5	2.6	25.9%												
		W22-U						43.2	30.8	71%	30.3	70%	0.4	1.4%	66	18	55	12	16.7%	33.3%
Sixth	R17	W23-L	Bedroom	28.1	24.2	3.9	13.8%												
		W23-U						13.6	9.9	72%	9.2	67%	0.7	6.7%	72	16	60	10	16.7%	37.5%
Sixth	R18	W24-L	Bedroom	28.3	24.6	3.7	13.2%												
		W24-U						11.8	8.1	69%	8.1	69%	0.0	0.1%	71	16	62	12	12.7%	25.0%
Sixth	R19	W25-L	Bedroom	28.1	24.4	3.7	13.1%												
		W25-U						7.7	5.7	74%	5.7	74%	0.0	0.0%	70	15	61	11	12.9%	26.7%
Sixth	R20	W26-L	LKD	9.4	7.6	1.8	19.4%												
		W26-U						30.6	16.5	54%	12.8	42%	3.7	22.5%	24	13	21	10	12.5%	23.1%
Sixth	R21	W27-L	Bedroom	27.9	24.4	3.5	12.5%												
		W27-U						8.0	7.3	92%	7.2	90%	0.2	2.3%	60	14	53	10	11.7%	28.6%
Sixth	R22	W28-L	Bedroom	27.9	24.4	3.5	12.6%												
		W28-U						11.7	9.4	80%	9.3	80%	0.1	0.6%	61	14	52	9	14.8%	35.7%
Sixth	R23	W29-L	LKD	10.2	8.1	2.1	20.3%												
		W29-U																	
		W30-L		16.0	15.8	0.2	1.4%												
		W30-U						39.0	27.9	71%	27.4	70%	0.5	1.8%	40	13	36	9	10.0%	30.8%
Sixth	R24	W31-L	LKD	19.7	17.0	2.7	13.5%												
		W31-U																	
		W32-L		10.4	9.1	1.3	12.3%												
		W32-U						35.2	24.6	70%	24.0	68%	0.6	2.3%	55	16	50	13	9.1%	18.8%
Sixth	R25	W33-L	Bedroom	23.1	22.7	0.4	1.8%												
		W33-U						11.2	9.5	85%	9.3	83%	0.2	2.5%	52	12	50	10	3.8%	16.7%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R26	W34-L	LKD	8.6	7.6	1.0	11.7%													
		W34-U						34.5	12.5	36%	12.5	36%	0.0	0.0%	31	12	26	9	16.1%	25.0%
Sixth	R27	W35-L	Bedroom	23.3	22.9	0.5	2.0%													
		W35-U						12.1	9.8	81%	9.6	79%	0.2	2.3%	57	11	56	11	1.8%	0.0%
Sixth	R28	W36-L	LKD	9.4	8.4	1.0	10.3%													
		W36-U						33.1	13.6	41%	13.5	41%	0.1	0.6%	33	12	31	11	6.1%	8.3%
Sixth	R29	W37-L	Bedroom	24.3	23.4	0.9	3.7%													
		W37-U						11.5	9.7	84%	9.1	79%	0.5	5.5%	47	12	46	11	2.1%	8.3%
Sixth	R30	W38-L	LKD	12.3	9.1	3.2	25.8%													
		W38-U																		
		W39-L		39.0	38.6	0.5	1.2%													
		W39-U						37.4	29.2	78%	28.6	76%	0.7	2.2%	50	18	45	14	10.0%	22.2%
Sixth	R31	W40-L	Bedroom	14.5	14.5	0.0	0.0%													
		W40-U						14.8	13.2	89%	13.2	89%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Sixth	R32	W41-L	LKD	6.2	6.2	0.0	0.2%													
		W41-U						26.1	21.1	81%	21.1	81%	0.0	0.1%	10	0	10	0	0.0%	0.0%
Sixth	R33	W42-L	Bedroom	22.7	22.1	0.6	2.5%													
		W42-U						12.5	12.4	99%	12.4	99%	0.0	0.0%	23	0	22	0	4.3%	0.0%
Sixth	R34	W43-L	Bedroom	19.7	19.2	0.5	2.7%													
		W43-U						11.1	10.5	95%	10.5	95%	0.0	0.0%	22	1	21	1	4.5%	0.0%
Sixth	R35	W44-L	LKD	6.2	5.8	0.4	6.8%													
		W44-U						34.5	20.0	58%	20.0	58%	0.0	0.0%	13	4	13	4	0.0%	0.0%
Sixth	R36	W45-L	LKD	5.3	5.0	0.3	5.9%													
		W45-U						34.4	17.9	52%	17.9	52%	0.0	0.0%	9	3	8	2	11.1%	33.3%
Sixth	R37	W46-L	Bedroom	19.2	18.8	0.4	2.3%													
		W46-U						11.1	10.7	96%	10.7	96%	0.0	0.0%	30	2	29	1	3.3%	50.0%
Sixth	R38	W47-L	Bedroom	21.4	20.7	0.7	3.2%													
		W47-U						12.5	11.7	94%	11.7	94%	0.0	0.0%	41	8	41	8	0.0%	0.0%
Sixth	R39	W48-L	LKD	5.3	4.8	0.6	10.3%													
		W48-U						26.1	10.9	42%	10.9	42%	0.0	0.0%	15	7	15	7	0.0%	0.0%
Sixth	R40	W49-L	Bedroom	12.1	11.5	0.6	5.1%													
		W49-U						14.8	10.5	71%	10.5	71%	0.0	0.0%	23	4	22	3	4.3%	25.0%
Seventh	R1	W1-L	Bedroom	39.0	39.0	0.0	0.0%													
		W1-U						11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W2-L	LKD	39.5	39.5	0.0	0.0%													
		W2-U																		
		W3-L		22.3	21.0	1.3	5.7%													
		W3-U																		
		W4		31.2	29.9	1.3	4.2%	34.3	31.0	90%	31.0	90%	0.0	0.0%	59	18	56	15	5.1%	16.7%
Seventh	R3	W5-L	Bedroom	36.7	35.3	1.4	3.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	56	16	53	13	5.4%	18.8%
Seventh	R4	W6-L	Bedroom	36.6	35.2	1.3	3.6%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	53	13	51	11	3.8%	15.4%
Seventh	R5	W7-L	Bedroom	32.8	31.7	1.1	3.2%													
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.1%	34	11	31	8	8.8%	27.3%
Seventh	R6	W8-L	LKD	23.2	21.5	1.7	7.3%													
		W8-U						31.4	24.8	79%	24.8	79%	0.0	0.0%	43	16	39	12	9.3%	25.0%
Seventh	R7	W9-L	Bedroom	34.9	33.2	1.8	5.1%													
		W9-U						16.9	16.5	97%	16.5	97%	0.0	0.0%	53	13	48	8	9.4%	38.5%
Seventh	R8	W10-L	LKD	22.7	20.8	1.9	8.5%													
		W10-U						25.0	22.8	92%	22.8	92%	0.0	0.0%	38	15	33	10	13.2%	33.3%
Seventh	R9	W11-L	Bedroom	34.3	32.1	2.2	6.4%													
		W11-U						12.7	12.3	97%	12.1	95%	0.2	1.8%	55	15	48	9	12.7%	40.0%
Seventh	R10	W12-L	Bedroom	36.0	33.7	2.3	6.5%													
		W12-U						7.8	7.5	96%	7.5	96%	0.0	0.0%	55	15	48	9	12.7%	40.0%
Seventh	R11	W13-L	LKD	36.0	33.5	2.5	7.0%													
		W13-U																		
		W14-L		18.3	16.1	2.2	12.0%													
		W14-U																		
		W15-L		16.9	15.7	1.1	6.8%													
		W15-U						36.4	28.0	77%	28.0	77%	0.0	0.0%	74	16	67	10	9.5%	37.5%
Seventh	R12	W16	LKD	20.8	20.8	0.0	0.0%													
		W17-L		35.4	32.4	3.1	8.6%													
		W17-U						43.0	36.8	86%	36.8	86%	0.0	0.0%	56	14	50	10	10.7%	28.6%
Seventh	R13	W18-L	Bedroom	35.1	31.7	3.4	9.6%													
		W18-U						12.1	11.5	95%	11.3	93%	0.2	1.8%	52	12	44	7	15.4%	41.7%
Seventh	R14	W19-L	LKD	34.3	30.6	3.6	10.6%													
		W19-U						28.4	24.0	85%	23.8	84%	0.2	0.7%	45	11	38	6	15.6%	45.5%
Seventh	R15	W20-L	Bedroom	34.8	31.0	3.8	11.0%													
		W20-U						13.1	12.5	95%	12.5	95%	0.0	0.0%	53	14	46	9	13.2%	35.7%
Seventh	R16	W21-L	LKD	34.6	30.3	4.3	12.3%													
		W21-U																		
		W22-L		31.5	26.9	4.5	14.4%													
		W22-U						43.2	31.6	73%	31.5	73%	0.1	0.3%	88	22	79	18	10.2%	18.2%
Seventh	R17	W23-L	Bedroom	30.9	26.7	4.2	13.5%													
		W23-U						13.6	11.1	81%	9.8	72%	1.2	11.2%	75	18	62	11	17.3%	38.9%
Seventh	R18	W24-L	Bedroom	30.8	26.8	4.0	13.1%													
		W24-U						11.8	10.8	91%	10.8	91%	0.0	0.0%	75	18	65	13	13.3%	27.8%
Seventh	R19	W25-L	Bedroom	30.8	26.9	4.0	12.9%													
		W25-U						7.7	7.1	92%	7.1	92%	0.0	0.0%	76	19	66	13	13.2%	31.6%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R20	W26-L	LKD	27.6	25.4	2.2	8.0%													
		W26-U						30.6	21.3	70%	20.7	68%	0.5	2.5%	58	16	55	13	5.2%	18.8%
Seventh	R21	W27-L	Bedroom	31.5	27.4	4.1	13.1%													
		W27-U						8.0	7.7	97%	7.6	95%	0.1	1.7%	77	21	68	14	11.7%	33.3%
Seventh	R22	W28-L	Bedroom	31.6	27.7	3.9	12.2%													
		W28-U						11.7	11.0	94%	10.9	93%	0.1	0.5%	76	20	66	13	13.2%	35.0%
Seventh	R23	W29-L	LKD	31.4	28.3	3.1	9.9%													
		W29-U																		
		W30-L		21.4	21.0	0.4	2.0%													
		W30-U						39.2	29.0	74%	28.5	73%	0.5	1.7%	73	18	64	13	12.3%	27.8%
Seventh	R24	W31-L	LKD	23.4	20.7	2.8	11.7%													
		W31-U																		
		W32-L		29.7	27.9	1.8	6.0%													
		W32-U						35.2	24.9	71%	24.7	70%	0.2	0.6%	78	21	74	18	5.1%	14.3%
Seventh	R25	W33-L	Bedroom	29.1	27.5	1.6	5.6%													
		W33-U						11.2	10.5	94%	10.3	92%	0.3	2.7%	75	18	71	16	5.3%	11.1%
Seventh	R26	W34-L	LKD	28.8	27.4	1.5	5.2%													
		W34-U						34.5	19.1	55%	19.1	55%	0.0	0.0%	75	18	70	15	6.7%	16.7%
Seventh	R27	W35-L	Bedroom	28.9	27.4	1.5	5.2%													
		W35-U						12.1	11.3	93%	11.0	91%	0.3	2.7%	74	17	70	14	5.4%	17.6%
Seventh	R28	W36-L	LKD	29.4	27.9	1.5	5.2%													
		W36-U						33.0	17.6	53%	17.2	52%	0.5	2.7%	76	19	72	16	5.3%	15.8%
Seventh	R29	W37-L	Bedroom	27.9	26.6	1.3	4.7%													
		W37-U						11.5	11.0	95%	10.9	95%	0.1	0.7%	57	15	55	13	3.5%	13.3%
Seventh	R30	W38-L	LKD	32.8	29.4	3.4	10.2%													
		W38-U																		
		W39-L		39.1	38.7	0.4	1.0%													
		W39-U						37.5	29.6	79%	28.7	77%	0.9	3.0%	78	20	74	17	5.1%	15.0%
Seventh	R31	W40-L	Bedroom	16.5	16.5	0.0	0.0%													
		W40-U						14.8	13.6	92%	13.6	92%	0.0	0.0%	14	0	14	0	0.0%	0.0%
Seventh	R32	W41-L	LKD	11.5	11.2	0.2	2.0%													
		W41-U						26.1	23.8	91%	23.6	91%	0.1	0.6%	16	1	15	0	6.3%	100.0%
Seventh	R33	W42-L	Bedroom	25.5	24.7	0.9	3.4%													
		W42-U						12.5	12.4	100%	12.4	100%	0.0	0.0%	28	3	26	2	7.1%	33.3%
Seventh	R34	W43-L	Bedroom	23.8	23.0	0.8	3.2%													
		W43-U						11.1	10.7	96%	10.7	96%	0.0	0.0%	25	3	24	2	4.0%	33.3%
Seventh	R35	W44-L	LKD	27.5	26.7	0.8	3.0%													
		W44-U						34.6	23.1	67%	23.1	67%	0.0	0.0%	37	6	36	5	2.7%	16.7%
Seventh	R36	W45-L	LKD	27.2	26.3	0.8	3.1%													
		W45-U						34.5	24.4	71%	24.4	71%	0.0	0.1%	41	9	39	7	4.9%	22.2%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Seventh	R37	W46-L W46-U	Bedroom	23.7	22.9	0.8	3.5%	11.1	10.7	96%	10.7	96%	0.0	0.0%	42	10	40	8	4.8%	20.0%
Seventh	R38	W47-L W47-U	Bedroom	24.2	23.3	0.8	3.5%	12.5	12.4	100%	12.4	100%	0.0	0.0%	46	13	45	12	2.2%	7.7%
Seventh	R39	W48-L W48-U	LKD	9.9	9.0	0.9	8.6%	26.1	17.2	66%	17.2	66%	0.0	0.0%	28	14	27	13	3.6%	7.1%
Seventh	R40	W49-L W49-U	Bedroom	14.6	13.7	0.9	5.8%	14.8	11.8	80%	11.8	80%	0.0	0.0%	25	6	24	5	4.0%	16.7%
Eighth	R1	W1-L W1-U	Bedroom	39.6	39.6	0.0	0.0%	11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W2-L W2-U	LKD	39.6	39.6	0.0	0.0%													
		W3-L W3-U		37.9	36.7	1.3	3.4%													
		W4		37.9	36.6	1.3	3.4%	34.1	30.4	89%	30.4	89%	0.0	0.0%	60	18	57	15	5.0%	16.7%
Eighth	R3	W5-L W5-U	Bedroom	37.7	36.3	1.4	3.8%	12.0	11.7	98%	11.7	98%	0.0	0.0%	57	17	54	14	5.3%	17.6%
Eighth	R4	W6-L W6-U	Bedroom	37.6	36.2	1.5	3.9%	13.1	12.7	97%	12.7	97%	0.0	0.0%	57	17	54	14	5.3%	17.6%
Eighth	R5	W7-L W7-U	Bedroom	37.6	36.0	1.6	4.2%	11.3	10.6	94%	10.6	94%	0.0	0.0%	57	17	53	13	7.0%	23.5%
Eighth	R6	W8-L W8-U	LKD	37.4	35.7	1.7	4.5%	31.4	24.9	79%	24.9	79%	0.0	0.0%	57	17	53	13	7.0%	23.5%
Eighth	R7	W9-L W9-U	Bedroom	37.3	35.5	1.8	4.8%	16.9	16.5	97%	16.5	97%	0.0	0.0%	56	16	51	11	8.9%	31.3%
Eighth	R8	W10-L W10-U	LKD	36.0	34.1	2.0	5.4%	25.0	23.4	94%	23.4	94%	0.0	0.0%	56	16	51	11	8.9%	31.3%
Eighth	R9	W11-L W11-U	Bedroom	36.9	34.7	2.2	5.9%	14.5	13.3	92%	13.2	91%	0.1	0.7%	56	16	50	10	10.7%	37.5%
Eighth	R10	W12-L W12-U	Bedroom	34.3	31.9	2.4	7.0%													
		W13-L W13-U		27.9	24.8	3.1	11.0%	13.7	12.0	88%	11.6	85%	0.5	3.9%	82	15	77	11	6.1%	26.7%
Eighth	R11	W14-L W14-U	LKD	29.1	29.1	0.0	0.0%													
		W15-L W15-U		31.0	31.0	0.0	0.0%													
		W16-L W16-U		36.2	33.1	3.1	8.6%	33.3	29.1	87%	29.1	87%	0.0	0.0%	58	16	53	12	8.6%	25.0%
Eighth	R12	W17-L W17-U	Bedroom	36.0	32.6	3.4	9.4%	11.4	10.7	94%	10.2	89%	0.5	4.8%	56	16	49	11	12.5%	31.3%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R13	W18-L	Bedroom	35.9	32.3	3.6	10.1%													
		W18-U						13.1	12.6	97%	12.5	96%	0.1	1.0%	56	16	49	11	12.5%	31.3%
Eighth	R14	W19-L	Bedroom	35.8	31.9	3.8	10.7%													
		W19-U						15.7	14.9	95%	13.8	88%	1.1	7.5%	54	14	47	10	13.0%	28.6%
Eighth	R15	W20-L	LKD	35.7	31.6	4.1	11.4%													
		W20-U																		
		W21-L		33.8	28.8	5.0	14.9%													
		W21-U																		
		W22-L		33.6	28.7	4.9	14.6%													
		W22-U						34.1	31.5	92%	31.4	92%	0.1	0.3%	93	25	84	20	9.7%	20.0%
Eighth	R16	W23-L	Bedroom	33.8	29.1	4.7	13.8%													
		W23-U																		
		W24-L		33.8	29.3	4.6	13.4%													
		W24-U						15.8	15.2	96%	15.0	95%	0.1	0.7%	81	24	73	19	9.9%	20.8%
Eighth	R17	W25-L	Bedroom	33.9	29.4	4.5	13.3%													
		W25-U						11.4	11.1	97%	11.0	96%	0.1	1.0%	81	24	73	18	9.9%	25.0%
Eighth	R18	W26-L	Bedroom	33.8	29.7	4.1	12.1%													
		W26-U						8.5	8.3	98%	8.3	98%	0.0	0.0%	81	24	73	18	9.9%	25.0%
Eighth	R19	W27-L	LKD	33.7	30.0	3.7	10.9%													
		W27-U																		
		W28-L		29.6	28.9	0.7	2.4%													
		W28-U						39.1	30.9	79%	30.5	78%	0.5	1.5%	79	22	71	17	10.1%	22.7%
Eighth	R20	W29-L	LKD	28.3	25.8	2.5	8.8%													
		W29-U																		
		W30-L		29.1	26.5	2.6	8.9%													
		W30-U																		
		W31-L		32.5	30.0	2.5	7.6%													
		W31-U																		
		W32-L		32.5	30.1	2.4	7.4%													
		W32-U						42.1	34.8	83%	34.8	83%	0.0	0.1%	86	25	84	23	2.3%	8.0%
Eighth	R21	W33-L	Bedroom	32.6	30.3	2.3	7.0%													
		W33-U						9.7	8.7	90%	8.6	89%	0.1	0.8%	79	22	76	19	3.8%	13.6%
Eighth	R22	W34-L	Bedroom	32.7	30.4	2.3	7.0%													
		W34-U						10.7	10.3	96%	10.3	96%	0.0	0.0%	76	22	71	18	6.6%	18.2%
Eighth	R23	W35-L	Bedroom	32.2	29.9	2.4	7.3%													
		W35-U						15.2	14.8	97%	14.7	97%	0.1	0.6%	75	24	69	19	8.0%	20.8%
Eighth	R24	W36-L	Bedroom	33.7	31.0	2.7	8.1%													
		W36-U						11.7	11.4	98%	11.3	96%	0.1	1.2%	83	26	77	21	7.2%	19.2%
Eighth	R25	W37-L	LKD	34.7	31.3	3.4	9.9%													
		W37-U																		
		W38-L		39.3	38.9	0.4	1.0%													
		W38-U						43.6	33.4	77%	32.7	75%	0.7	2.1%	85	26	81	23	4.7%	11.5%
Eighth	R26	W39-L	Bedroom	19.3	19.3	0.0	0.0%													
		W39-U						14.8	14.0	95%	14.0	95%	0.0	0.0%	17	1	17	1	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighth	R27	W40-L W40-U	LKD	14.0	13.6	0.4	2.9%	26.1	24.5	94%	24.4	93%	0.1	0.6%	19	2	18	1	5.3%	50.0%
Eighth	R28	W41-L W41-U	Bedroom	29.3	28.1	1.2	4.1%	12.8	12.4	97%	12.4	97%	0.0	0.0%	37	4	34	2	8.1%	50.0%
Eighth	R29	W42-L W42-U	Bedroom	19.8	19.8	0.0	0.0%	6.7	6.4	96%	6.4	96%	0.0	0.0%	16	2	16	2	0.0%	0.0%
Eighth	R30	W43-L W43-U	LKD	29.0	27.8	1.1	3.9%	28.9	21.6	75%	21.6	75%	0.0	0.0%	39	8	37	6	5.1%	25.0%
Eighth	R31	W44-L W44-U	LKD	28.7	27.7	1.1	3.8%	29.1	22.4	77%	21.7	75%	0.6	2.8%	47	11	45	9	4.3%	18.2%
Eighth	R32	W45-L W45-U	Bedroom	20.4	19.3	1.1	5.2%	6.7	6.4	96%	6.3	95%	0.1	1.3%	47	12	45	10	4.3%	16.7%
Eighth	R33	W46-L W46-U	Bedroom	27.6	26.6	1.0	3.6%	12.8	12.5	97%	12.5	97%	0.0	0.0%	51	16	50	15	2.0%	6.3%
Eighth	R34	W47-L W47-U	LKD	12.4	11.4	1.0	8.1%	26.3	23.7	90%	23.7	90%	0.0	0.0%	31	15	30	14	3.2%	6.7%
Eighth	R35	W48-L W48-U	Bedroom	18.2	17.3	1.0	5.3%	14.8	13.8	94%	13.8	94%	0.0	0.0%	36	8	35	7	2.8%	12.5%
Ninth	R1	W1-L W1-U	LKD	34.2	34.2	0.0	0.0%													
		W2-L W2-U		38.8	38.8	0.0	0.0%													
		W3-L W3-U		39.1	39.1	0.0	0.0%													
		W4-L W4-U		38.1	36.8	1.3	3.4%	37.0	36.9	100%	36.9	100%	0.0	0.0%	58	17	55	14	5.2%	17.6%
Ninth	R2	W5-L W5-U	Bedroom	38.0	36.6	1.4	3.6%	10.4	10.2	98%	10.2	98%	0.0	0.0%	57	17	54	14	5.3%	17.6%
Ninth	R3	W6-L W6-U	Bedroom	37.9	36.5	1.4	3.7%	12.9	12.9	99%	12.9	99%	0.0	0.0%	57	17	54	14	5.3%	17.6%
Ninth	R4	W7-L W7-U	Bedroom	37.8	36.3	1.6	4.2%	11.1	11.0	99%	11.0	99%	0.0	0.0%	57	17	53	13	7.0%	23.5%
Ninth	R5	W8-L W8-U	LKD	37.7	36.1	1.7	4.4%													
		W9-L W9-U		37.6	35.9	1.8	4.7%	32.8	29.5	90%	29.4	90%	0.1	0.2%	57	17	52	12	8.8%	29.4%
Ninth	R6	W10-L W10-U	LKD	18.3	17.5	0.8	4.4%													
		W11-L W11-U		18.1	18.1	0.0	0.0%	38.2	27.8	73%	27.8	73%	0.1	0.2%	30	7	27	4	10.0%	42.9%
Ninth	R7	W12-L	Bedroom	36.4	34.0	2.3	6.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W12-U																	
		W13-L		32.6	29.6	3.0	9.1%												
		W13-U						10.9	10.9	100%	10.9	100%	0.0	0.0%	92	24	87	20	5.4%	16.7%
Ninth	R8	W14-L	LKD	33.2	33.2	0.0	0.0%												
		W14-U																	
		W15-L		8.6	8.6	0.0	0.3%												
		W15-U						31.3	28.7	92%	28.7	92%	0.0	0.0%	17	3	17	3	0.0%	0.0%
Ninth	R9	W16-L	Bedroom	6.8	6.8	0.0	0.0%												
		W16-U																	
		W17-L		36.8	33.4	3.3	9.0%												
		W17-U						14.2	12.6	89%	12.6	89%	0.0	0.1%	56	16	50	11	10.7%	31.3%
Ninth	R10	W18-L	Bedroom	36.7	33.1	3.5	9.7%												
		W18-U						13.0	12.1	94%	12.1	94%	0.0	0.0%	56	16	50	11	10.7%	31.3%
Ninth	R11	W19-L	LKD	36.6	32.8	3.8	10.3%												
		W19-U																	
		W20-L		8.1	7.1	1.0	12.4%												
		W20-U																	
		W21-L		0.0	0.0	0.0	0.0%												
		W21-U						31.0	22.3	72%	22.3	72%	0.0	0.0%	63	23	55	18	12.7%	21.7%
Ninth	R12	W22-L	Bedroom	35.4	30.2	5.2	14.6%												
		W22-U						7.9	7.6	95%	7.5	94%	0.1	1.2%	83	26	73	19	12.0%	26.9%
Ninth	R14	W24-L	Bedroom	35.2	30.4	4.9	13.8%												
		W24-U						11.8	11.0	93%	9.8	83%	1.2	10.7%	83	26	74	19	10.8%	26.9%
Ninth	R15	W25-L	Bedroom	35.2	30.6	4.6	13.1%												
		W25-U						10.8	10.6	98%	10.5	97%	0.1	0.9%	83	26	74	19	10.8%	26.9%
Ninth	R16	W26-L	Bedroom	35.1	30.8	4.2	12.1%												
		W26-U																	
		W27-L		7.5	6.5	1.0	13.1%												
		W27-U						7.9	7.8	98%	7.8	98%	0.0	0.0%	82	25	74	19	9.8%	24.0%
Ninth	R17	W28-L	LKD	10.9	8.9	1.9	17.7%												
		W28-U																	
		W29-L		32.7	31.9	0.8	2.6%												
		W29-U																	
		W30-L		32.0	31.2	0.8	2.5%												
		W30-U						32.4	26.7	82%	26.7	82%	0.0	0.0%	42	17	39	14	7.1%	17.6%
Ninth	R18	W31-L	LKD	33.8	31.3	2.5	7.3%												
		W31-U																	
		W32-L		34.0	31.5	2.5	7.4%												
		W32-U																	
		W33-L		10.3	7.9	2.4	23.1%												
		W33-U																	
		W34-L		6.7	5.3	1.4	20.9%												
		W34-U																	
		W35-L		34.6	31.6	3.0	8.6%												
		W35-U						31.9	30.5	96%	30.5	96%	0.0	0.0%	93	26	91	24	2.2%	7.7%
Ninth	R19	W36-L	Bedroom	34.7	31.8	2.9	8.2%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W36-U						11.7	11.5	99%	11.5	99%	0.0	0.0%	84	27	80	23	4.8%	14.8%
Ninth	R20	W37-L	Bedroom	34.8	31.9	2.9	8.3%													
		W37-U						7.3	7.1	97%	7.1	97%	0.0	0.0%	85	28	80	24	5.9%	14.3%
Ninth	R21	W38-L	Bedroom	35.1	32.1	3.0	8.4%													
		W38-U						11.9	11.5	97%	11.5	97%	0.0	0.4%	85	28	80	24	5.9%	14.3%
Ninth	R22	W39-L	LKD	27.6	25.4	2.2	8.0%													
		W39-U																		
		W40-L		35.6	32.3	3.3	9.2%													
		W40-U																		
		W41-L		39.0	38.6	0.4	1.0%													
		W41-U						40.3	38.1	95%	38.0	95%	0.0	0.0%	83	26	79	23	4.8%	11.5%
Ninth	R23	W42-L	Bedroom	24.1	24.1	0.0	0.0%													
		W42-U						14.3	14.0	97%	14.0	97%	0.0	0.0%	19	1	19	1	0.0%	0.0%
Ninth	R24	W43-L	Bedroom	30.1	29.5	0.6	2.1%													
		W43-U						12.1	12.1	100%	12.1	100%	0.0	0.0%	36	2	34	1	5.6%	50.0%
Ninth	R25	W44-L	LKD	33.6	32.1	1.5	4.5%													
		W44-U						42.2	28.0	66%	28.0	66%	0.0	0.0%	50	11	47	9	6.0%	18.2%
Ninth	R26	W45-L	LKD	32.2	31.0	1.2	3.6%													
		W45-U						42.1	27.7	66%	27.5	65%	0.2	0.8%	55	17	54	16	1.8%	5.9%
Ninth	R27	W46-L	Bedroom	28.9	27.8	1.1	3.9%													
		W46-U						11.8	11.8	100%	11.8	100%	0.0	0.0%	53	17	52	16	1.9%	5.9%
Ninth	R28	W47-L	Bedroom	23.6	22.5	1.1	4.6%													
		W47-U						14.3	14.0	98%	13.9	97%	0.1	0.7%	52	17	51	16	1.9%	5.9%
Tenth	R1	W1-L	Studio	39.6	39.6	0.0	0.0%													
		W1-U																		
		W2-L		39.6	39.6	0.0	0.0%													
		W2-U																		
		W3-L		39.6	39.6	0.0	0.0%													
		W3-U																		
		W4-L		39.6	39.6	0.0	0.0%													
		W4-U																		
		W5-L		38.6	37.4	1.3	3.3%													
		W5-U																		
		W6-L		38.6	37.2	1.3	3.5%													
		W6-U																		
		W7-L		38.5	37.1	1.4	3.6%													
		W7-U																		
		W8-L		38.4	37.0	1.5	3.8%													
		W8-U						94.4	94.2	100%	94.2	100%	0.0	0.0%	60	18	57	15	5.0%	16.7%
Tenth	R2	W9-L	Studio	38.4	36.8	1.6	4.1%													
		W9-U																		
		W10-L		38.3	36.6	1.7	4.3%													
		W10-U																		
		W11-L		38.3	36.5	1.7	4.5%													
		W11-U						39.0	36.3	93%	35.6	91%	0.7	1.9%	57	17	53	13	7.0%	23.5%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Tenth	R3	W12-L	Studio	38.2	36.4	1.8	4.7%													
		W12-U																		
		W13-L		38.1	36.1	2.0	5.3%													
		W13-U																		
		W14-L		36.1	32.4	3.7	10.2%													
		W14-U						39.7	38.2	96%	38.2	96%	0.0	0.0%	96	28	90	22	6.3%	21.4%
Tenth	R5	W16-L	LKD	36.9	34.5	2.4	6.6%													
		W16-U																		
		W17-L		36.1	32.7	3.4	9.3%													
		W17-U																		
		W18-L		36.3	32.9	3.4	9.3%													
		W18-U						40.4	38.2	94%	38.2	94%	0.0	0.1%	96	29	92	25	4.2%	13.8%
Tenth	R6	W19-L	Bedroom	36.4	33.0	3.4	9.3%													
		W19-U																		
		W20-L		36.5	33.1	3.4	9.3%													
		W20-U						11.6	11.5	99%	11.5	99%	0.0	0.0%	85	28	80	24	5.9%	14.3%
Tenth	R7	W21-L	LKD	36.5	33.2	3.3	9.1%													
		W21-U																		
		W22-L		36.6	33.2	3.3	9.1%													
		W22-U																		
		W23-L		8.4	8.0	0.4	4.9%													
		W23-U																		
		W24-L		9.3	7.1	2.3	24.1%													
		W24-U						40.6	38.9	96%	38.5	95%	0.4	1.0%	87	28	83	25	4.6%	10.7%
Tenth	R8	W25-L	Bedroom	29.7	29.6	0.0	0.1%													
		W25-U						10.7	10.4	97%	10.4	97%	0.0	0.0%	34	2	34	2	0.0%	0.0%
Tenth	R9	W26-L	Bedroom	34.5	33.5	1.0	2.8%													
		W26-U						7.7	7.4	96%	7.4	96%	0.0	0.0%	50	11	48	9	4.0%	18.2%
Tenth	R10	W27-L	LKD	32.0	30.3	1.6	5.1%													
		W27-U																		
		W28-L		36.0	36.0	0.0	0.0%													
		W28-U						30.8	26.7	87%	26.7	87%	0.0	0.0%	36	6	34	4	5.6%	33.3%
Tenth	R11	W29-L	LKD	35.4	33.9	1.6	4.4%													
		W29-U																		
		W30-L		31.0	29.8	1.2	4.0%													
		W30-U						30.5	26.2	86%	26.2	86%	0.0	0.0%	96	29	94	27	2.1%	6.9%
Tenth	R12	W31-L	Bedroom	33.5	32.3	1.2	3.6%													
		W31-U						7.7	7.4	96%	7.4	96%	0.0	0.3%	58	19	57	18	1.7%	5.3%
Tenth	R13	W32-L	Bedroom	29.0	27.8	1.2	4.1%													
		W32-U						10.7	10.4	97%	10.4	97%	0.0	0.0%	54	19	53	18	1.9%	5.3%
165-195 High cross road																				
Ground	R1	W1-L	Residential	31.9	25.4	6.5	20.4%													
		W1-U																		
		W2-L		2.1	1.2	0.8	40.1%													
		W2-U																		
		W3-L		1.6	1.2	0.4	26.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						14.2	14.1	99%	13.5	95%	0.6	4.5%	27	2	16	2	40.7%	0.0%
Ground	R2	W4-L	Residential	8.2	3.7	4.5	55.1%													
		W4-U																		
		W5-L		7.4	4.0	3.4	46.4%													
		W5-U																		
		W6-L		7.8	4.6	3.2	41.4%													
		W6-U						16.2	15.5	96%	15.1	93%	0.4	2.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W7-L	Residential	6.0	2.3	3.6	61.2%													
		W7-U																		
		W8-L		7.8	4.0	3.7	48.1%													
		W8-U																		
		W9-L		10.6	6.3	4.2	40.1%													
		W9-U						16.2	15.3	95%	13.6	84%	1.7	11.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R4	W10-L	Residential	4.5	4.5	0.0	0.0%													
		W10-U																		
		W11-L		2.4	2.4	0.0	0.0%													
		W11-U																		
		W12-L		31.5	23.6	7.9	25.0%													
		W12-U						14.1	14.1	100%	13.0	92%	1.1	7.5%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R5	W13-L	Residential	31.2	23.1	8.1	26.0%													
		W13-U																		
		W14-L		1.7	1.7	0.0	0.0%													
		W14-U																		
		W15-L		0.9	0.8	0.1	7.9%													
		W15-U						14.1	14.1	100%	13.4	95%	0.7	4.9%	24	3	15	3	37.5%	0.0%
Ground	R6	W16-L	Residential	7.4	2.5	5.0	66.8%													
		W16-U																		
		W17-L		6.7	3.0	3.8	56.0%													
		W17-U																		
		W18-L		7.5	3.7	3.8	50.9%													
		W18-U						16.2	15.2	94%	13.3	82%	1.9	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R7	W19-L	Residential	5.4	1.6	3.8	70.3%													
		W19-U																		
		W20-L		7.1	3.3	3.8	53.2%													
		W20-U																		
		W21-L		10.4	5.5	4.9	47.3%													
		W21-U						16.2	15.2	94%	13.2	81%	2.1	13.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R8	W22-L	Residential	5.3	5.1	0.2	4.3%													
		W22-U																		
		W23-L		5.2	5.2	0.0	0.0%													
		W23-U																		
		W24-L		30.4	21.5	8.9	29.4%													
		W24-U																		
		W25-L		31.4	29.5	1.9	6.1%													
		W25-U						14.1	14.1	100%	13.9	98%	0.2	1.4%	66	22	63	22	4.5%	0.0%
First	R1	W1-L	Residential	32.2	25.8	6.5	20.1%													
		W1-U																		
		W2-L		4.9	4.0	1.0	19.4%													
		W2-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W3-L		3.7	2.2	1.5	40.9%													
		W3-U						14.2	14.1	99%	13.7	97%	0.4	2.6%	27	2	17	2	37.0%	0.0%
First	R2	W4-L	Residential	9.9	4.8	5.1	51.8%													
		W4-U																		
		W5-L		9.5	5.3	4.2	44.6%													
		W5-U																		
		W6-L		10.6	6.4	4.3	40.1%													
		W6-U						15.9	15.3	96%	14.9	94%	0.3	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W7-L	Residential	9.7	5.2	4.5	46.3%													
		W7-U																		
		W8-L		10.7	6.1	4.6	42.8%													
		W8-U																		
		W9-L		13.2	8.6	4.7	35.4%													
		W9-U						15.9	15.2	96%	14.0	88%	1.2	7.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W10-L	Residential	7.9	7.9	0.0	0.0%													
		W10-U																		
		W11-L		7.3	7.3	0.0	0.0%													
		W11-U																		
		W12-L		31.9	24.1	7.8	24.6%													
		W12-U						14.1	14.0	99%	12.9	92%	1.1	7.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W13-L	Residential	31.6	23.5	8.1	25.7%													
		W13-U																		
		W14-L		5.2	5.0	0.2	3.9%													
		W14-U																		
		W15-L		3.6	2.2	1.5	40.2%													
		W15-U						14.1	14.0	100%	13.1	93%	0.9	6.8%	25	3	15	3	40.0%	0.0%
First	R6	W16-L	Residential	9.3	3.7	5.6	59.7%													
		W16-U																		
		W17-L		8.8	4.1	4.8	54.2%													
		W17-U																		
		W18-L		10.0	5.1	4.9	48.7%													
		W18-U						15.9	15.0	94%	13.5	85%	1.5	9.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W19-L	Residential	9.0	4.0	4.9	54.9%													
		W19-U																		
		W20-L		10.0	5.0	4.9	49.4%													
		W20-U																		
		W21-L		12.8	7.5	5.3	41.3%													
		W21-U						15.9	14.9	94%	13.2	83%	1.7	11.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W22-L	Residential	7.9	7.7	0.2	2.3%													
		W22-U																		
		W23-L		7.5	7.5	0.0	0.0%													
		W23-U																		
		W24-L		30.8	21.9	8.9	29.0%													
		W24-U																		
		W25-L		32.4	30.5	1.9	6.0%													
		W25-U						14.1	14.1	100%	13.9	98%	0.2	1.2%	69	24	66	24	4.3%	0.0%
Second	R1	W1-L	Residential	32.7	26.3	6.4	19.7%													
		W1-U																		
		W2-L		2.6	1.9	0.7	27.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		2.0	1.4	0.6	31.0%													
		W3-U						14.2	14.1	99%	13.8	97%	0.3	1.9%	30	3	19	3	36.7%	0.0%
Second	R2	W4-L	Residential	7.6	3.2	4.4	57.5%													
		W4-U																		
		W5-L		6.5	3.3	3.3	49.9%													
		W5-U																		
		W6-L		7.4	4.1	3.3	44.9%													
		W6-U						15.9	15.2	95%	14.9	94%	0.3	1.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W7-L	Residential	6.7	3.2	3.5	51.9%													
		W7-U																		
		W8-L		7.4	3.9	3.6	47.8%													
		W8-U																		
		W9-L		10.4	6.2	4.1	39.9%													
		W9-U						15.9	15.0	94%	13.7	86%	1.3	9.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W10-L	Residential	5.8	5.8	0.0	0.0%													
		W10-U																		
		W11-L		4.9	4.9	0.0	0.0%													
		W11-U																		
		W12-L		32.3	24.5	7.8	24.1%													
		W12-U						14.1	14.0	99%	13.3	94%	0.8	5.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W13-L	Residential	32.1	24.0	8.1	25.2%													
		W13-U																		
		W14-L		2.7	2.6	0.1	5.2%													
		W14-U																		
		W15-L		1.9	1.2	0.7	38.2%													
		W15-U						14.1	14.0	100%	13.2	94%	0.8	5.7%	27	4	18	4	33.3%	0.0%
Second	R6	W16-L	Residential	7.2	2.5	4.7	65.0%													
		W16-U																		
		W17-L		6.0	2.5	3.6	59.4%													
		W17-U																		
		W18-L		6.9	3.3	3.6	52.7%													
		W18-U						15.9	14.9	94%	13.2	83%	1.8	11.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W19-L	Residential	6.1	2.5	3.6	59.1%													
		W19-U																		
		W20-L		6.9	3.3	3.6	52.5%													
		W20-U																		
		W21-L		9.9	5.5	4.5	45.1%													
		W21-U						15.9	14.9	94%	13.0	82%	1.9	12.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W22-L	Residential	5.8	5.6	0.2	3.1%													
		W22-U																		
		W23-L		5.0	5.0	0.0	0.0%													
		W23-U																		
		W24-L		31.3	22.4	8.9	28.5%													
		W24-U																		
		W25-L		33.4	31.5	2.0	5.9%													
		W25-U						14.1	14.1	100%	13.9	98%	0.2	1.2%	71	25	68	25	4.2%	0.0%
Third	R1	W1-L	Residential	32.9	26.5	6.4	19.4%													
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		2.6	2.2	0.4	15.1%												
		W2-U																	
		W3-L		1.6	0.9	0.7	43.9%												
		W3-U						14.2	14.1	99%	13.9	98%	0.2	1.6%	30	4	20	4	33.3%	0.0%
Third	R2	W4-L	Residential	7.5	3.2	4.3	57.3%												
		W4-U																	
		W5-L		5.7	2.8	2.9	51.2%												
		W5-U																	
		W6-L		6.3	3.4	2.9	46.7%												
		W6-U						15.9	15.2	95%	14.8	93%	0.4	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W7-L	Residential	4.9	1.9	3.1	62.4%												
		W7-U																	
		W8-L		6.1	3.0	3.2	51.6%												
		W8-U																	
		W9-L		9.9	5.9	4.1	40.8%												
		W9-U						15.9	14.9	94%	13.4	84%	1.5	10.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W10-L	Residential	5.3	5.3	0.0	0.0%												
		W10-U																	
		W11-L		4.2	4.2	0.0	0.0%												
		W11-U																	
		W12-L		32.4	24.7	7.7	23.9%												
		W12-U						14.1	14.1	100%	13.8	98%	0.3	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W13-L	Residential	32.2	24.2	8.0	25.0%												
		W13-U																	
		W14-L		2.9	2.9	0.0	0.0%												
		W14-U																	
		W15-L		1.4	1.1	0.3	23.8%												
		W15-U						14.1	14.1	100%	13.8	98%	0.3	2.2%	28	5	17	5	39.3%	0.0%
Third	R6	W16-L	Residential	7.0	2.3	4.7	66.8%												
		W16-U																	
		W17-L		5.2	2.1	3.2	60.2%												
		W17-U																	
		W18-L		5.9	2.7	3.2	54.0%												
		W18-U						15.9	14.9	94%	13.0	82%	2.0	13.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W19-L	Residential	4.5	1.3	3.2	70.2%												
		W19-U																	
		W20-L		5.6	2.5	3.1	55.7%												
		W20-U																	
		W21-L		9.5	5.2	4.4	45.8%												
		W21-U						15.9	14.9	94%	12.8	80%	2.1	14.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W22-L	Residential	5.2	5.2	0.0	0.0%												
		W22-U																	
		W23-L		4.3	4.3	0.0	0.0%												
		W23-U																	
		W24-L		31.5	22.6	8.9	28.3%												
		W24-U																	
		W25-L		34.0	32.0	2.0	5.8%												
		W25-U						14.1	14.1	100%	13.9	99%	0.1	1.1%	71	25	67	25	5.6%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R1	W1-L	LKD	30.4	29.4	1.0	3.3%												
		W1-U																	
		W2-L		30.5	29.1	1.5	4.8%												
		W2-U																	
		W3-L		16.8	2.8	14.0	83.1%												
		W3-U						38.0	26.7	70%	26.3	69%	0.4	1.6%	46	13	46	13	0.0%	0.0%
First	R2	W4-L	Bedroom	30.4	2.6	27.8	91.5%												
		W4-U						12.1	10.8	89%	1.6	13%	9.2	85.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	Bedroom	31.0	2.9	28.2	90.8%												
		W5-U						12.5	11.6	93%	1.8	15%	9.8	84.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W6-L	Bedroom	30.5	2.5	28.1	92.0%												
		W6-U						13.0	12.4	96%	0.7	6%	11.7	94.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7-L	LKD	29.7	2.1	27.7	93.1%												
		W7-U																	
		W8-L		8.9	0.0	8.9	99.9%												
		W8-U						39.5	28.9	73%	0.6	2%	28.3	97.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W9-L	Bedroom	14.6	2.1	12.5	85.4%												
		W9-U						13.6	12.6	93%	0.5	4%	12.1	95.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10-L	Studio	12.4	1.1	11.3	91.3%												
		W10-U						37.2	16.5	44%	1.0	3%	15.5	94.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	32.8	31.8	1.0	3.0%												
		W1-U																	
		W2-L		32.9	31.5	1.4	4.3%												
		W2-U																	
		W3-L		18.0	3.1	14.9	83.0%												
		W3-U						38.0	27.9	73%	27.3	72%	0.6	2.0%	48	14	48	14	0.0%	0.0%
Second	R2	W4-L	Bedroom	31.7	3.7	28.0	88.2%												
		W4-U						12.1	10.9	90%	1.0	8%	9.9	90.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	Bedroom	32.4	3.9	28.5	88.0%												
		W5-U						12.5	11.7	93%	1.9	15%	9.7	83.6%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W6-L	Bedroom	31.9	3.2	28.7	90.0%												
		W6-U						13.0	12.4	96%	0.3	2%	12.1	97.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7-L	LKD	31.1	2.6	28.5	91.6%												
		W7-U																	
		W8-L		9.6	0.0	9.6	100.0%												
		W8-U						39.5	29.5	75%	0.6	2%	28.9	97.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W9-L	Bedroom	15.6	2.7	12.9	82.5%												
		W9-U						13.6	12.8	94%	0.7	5%	12.1	94.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10-L	Studio	13.3	1.6	11.7	88.2%												
		W10-U						37.2	17.7	48%	1.2	3%	16.6	93.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	34.7	33.8	0.9	2.7%												
		W1-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		34.8	33.5	1.3	3.6%												
		W2-U																	
		W3-L		19.0	4.1	14.9	78.3%												
		W3-U						38.0	30.4	80%	29.8	78%	0.6	1.9%	50	16	50	16	0.0%	0.0%
Third	R2	W4-L	Bedroom	32.7	4.9	27.8	84.9%												
		W4-U						12.1	10.9	90%	1.6	13%	9.3	85.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	Bedroom	33.4	4.9	28.6	85.5%												
		W5-U						12.5	11.7	94%	2.3	18%	9.5	80.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W6-L	Bedroom	33.0	4.0	29.0	87.8%												
		W6-U						13.0	12.4	96%	0.4	3%	12.1	97.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7-L	LKD	32.2	3.3	28.9	89.8%												
		W7-U																	
		W8-L		10.3	0.0	10.3	100.0%												
		W8-U						39.5	30.1	76%	0.9	2%	29.2	96.9%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W9-L	Bedroom	16.8	3.5	13.3	79.2%												
		W9-U						13.6	12.9	95%	0.9	6%	12.0	93.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10-L	Studio	15.4	3.4	12.0	78.2%												
		W10-U						37.2	18.6	50%	2.2	6%	16.5	88.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	36.4	35.5	0.9	2.4%												
		W1-U																	
		W2-L		36.4	35.3	1.1	3.0%												
		W2-U																	
		W3-L		20.0	5.2	14.8	74.0%												
		W3-U						38.0	32.7	86%	32.2	85%	0.6	1.7%	51	16	51	16	0.0%	0.0%
Fourth	R2	W4-L	Bedroom	33.7	6.2	27.5	81.6%												
		W4-U						12.1	11.0	91%	1.8	15%	9.2	83.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	Bedroom	34.5	5.9	28.6	82.9%												
		W5-U						12.5	11.8	95%	2.4	19%	9.4	80.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W6-L	Bedroom	34.1	4.9	29.2	85.6%												
		W6-U						13.0	12.4	96%	0.6	4%	11.9	95.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7-L	LKD	33.4	4.0	29.3	87.9%												
		W7-U																	
		W8-L		11.0	0.0	11.0	100.0%												
		W8-U						39.5	31.0	78%	1.6	4%	29.4	95.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W9-L	Bedroom	18.1	4.5	13.6	75.1%												
		W9-U						13.6	12.9	95%	1.2	9%	11.7	91.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10-L	Studio	17.2	4.9	12.3	71.4%												
		W10-U						37.2	19.4	52%	3.0	8%	16.4	84.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	37.9	37.1	0.8	2.1%												
		W1-U																	
		W2-L		37.9	36.9	1.0	2.7%												
		W2-U																	
		W3-L		20.8	6.0	14.8	71.3%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W3-U						38.0	32.8	86%	32.3	85%	0.5	1.5%	52	17	52	17	0.0%	0.0%
Fifth	R2	W4-L	Bedroom	34.5	6.9	27.6	80.0%													
		W4-U						12.1	11.0	91%	1.9	15%	9.1	83.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	Bedroom	35.3	6.6	28.7	81.2%													
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W6-L	Bedroom	35.0	5.7	29.3	83.8%													
		W6-U						13.0	12.4	96%	0.8	6%	11.6	93.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7-L	LKD	34.3	4.8	29.5	86.0%													
		W7-U																		
		W8-L		11.5	0.0	11.5	100.0%													
		W8-U						39.5	31.8	81%	2.6	7%	29.3	91.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W9-L	Bedroom	19.4	5.9	13.5	69.6%													
		W9-U						13.6	12.9	95%	1.6	12%	11.3	87.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10-L	Studio	18.6	6.4	12.2	65.5%													
		W10-U						37.2	20.0	54%	4.0	11%	16.0	79.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	38.2	37.6	0.6	1.6%													
		W1-U																		
		W2-L		38.2	37.4	0.8	2.2%													
		W2-U																		
		W3-L		21.2	6.4	14.8	69.8%													
		W3-U						38.0	32.8	86%	32.3	85%	0.4	1.3%	52	16	52	16	0.0%	0.0%
Sixth	R2	W4-L	Bedroom	34.8	7.2	27.6	79.3%													
		W4-U						12.1	11.0	91%	1.9	16%	9.1	83.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W5-L	Bedroom	35.6	7.0	28.6	80.4%													
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W6-L	Bedroom	35.4	6.2	29.2	82.6%													
		W6-U						13.0	12.4	96%	1.1	8%	11.4	91.3%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7-L	LKD	34.8	5.4	29.3	84.4%													
		W7-U																		
		W8-L		11.9	0.1	11.8	99.2%													
		W8-U						39.5	32.5	82%	4.1	10%	28.4	87.3%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W9-L	Bedroom	20.7	7.6	13.1	63.1%													
		W9-U						13.6	12.9	95%	2.0	15%	10.9	84.4%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10-L	Studio	20.1	8.3	11.8	58.5%													
		W10-U						37.2	20.5	55%	5.1	14%	15.4	75.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	38.9	38.1	0.8	2.1%													
		W1-U																		
		W2-L		38.9	37.8	1.0	2.6%													
		W2-U																		
		W3-L		21.6	6.8	14.8	68.4%													
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.6%	56	18	56	18	0.0%	0.0%
Seventh	R2	W4-L	Bedroom	35.5	8.0	27.4	77.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.9%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W5-L	Bedroom	36.3	8.0	28.4	78.0%													
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.7%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W6-L	Bedroom	36.3	7.5	28.8	79.4%													
		W6-U						13.0	12.5	96%	1.5	12%	10.9	87.9%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W7-L	LKD	35.8	6.9	28.9	80.7%													
		W7-U																		
		W8-L		12.7	0.4	12.3	96.6%													
		W8-U						39.5	32.9	83%	6.8	17%	26.1	79.3%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W9-L	Bedroom	22.4	10.1	12.3	54.9%													
		W9-U						13.6	13.0	96%	3.2	24%	9.8	75.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W10-L	Studio	22.0	10.9	11.2	50.7%													
		W10-U						37.2	21.5	58%	8.3	22%	13.2	61.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1-L	LKD	39.0	38.2	0.8	2.1%													
		W1-U																		
		W2-L		39.0	38.0	1.0	2.6%													
		W2-U																		
		W3-L		21.9	7.2	14.8	67.3%													
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.6%	56	18	56	18	0.0%	0.0%
Eighth	R2	W4-L	Bedroom	35.8	8.5	27.3	76.3%													
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W5-L	Bedroom	36.7	8.6	28.1	76.5%													
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W6-L	Bedroom	36.8	8.6	28.3	76.7%													
		W6-U						13.0	12.5	96%	1.6	13%	10.8	86.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W7-L	LKD	36.5	8.3	28.1	77.1%													
		W7-U																		
		W8-L		14.2	2.3	11.9	83.8%													
		W8-U						39.5	33.1	84%	10.2	26%	22.8	69.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W9-L	Bedroom	24.1	12.8	11.3	46.8%													
		W9-U						13.6	13.1	96%	5.6	41%	7.5	57.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W10-L	Studio	24.1	13.4	10.6	44.1%													
		W10-U						37.2	23.2	62%	13.6	36%	9.6	41.5%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1-L	LKD	39.1	38.3	0.8	2.0%													
		W1-U																		
		W2-L		39.1	38.1	1.0	2.5%													
		W2-U																		
		W3-L		22.2	7.5	14.8	66.5%													
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.5%	55	18	55	18	0.0%	0.0%
Ninth	R2	W4-L	Bedroom	36.1	9.0	27.2	75.2%													
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W5-L	Bedroom	37.1	9.3	27.8	74.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W6-L	Bedroom	37.2	9.6	27.6	74.1%													
		W6-U						13.0	12.5	96%	1.7	13%	10.8	86.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W7-L	LKD	36.9	10.0	27.0	73.1%													
		W7-U																		
		W8-L		15.5	5.1	10.3	66.9%													
		W8-U						39.5	33.4	85%	17.3	44%	16.1	48.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9-L	Bedroom	25.8	15.8	10.0	38.8%													
		W9-U						13.6	13.1	96%	10.2	75%	2.9	21.8%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W10-L	LKD	7.4	4.9	2.5	33.9%													
		W10-U						30.3	23.0	76%	17.9	59%	5.1	22.2%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1-L	LKD	39.1	38.4	0.8	1.9%													
		W1-U																		
		W2-L		39.1	38.1	1.0	2.5%													
		W2-U																		
		W3-L		22.5	7.7	14.8	65.7%													
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.6%	55	18	55	18	0.0%	0.0%
Tenth	R2	W4-L	Bedroom	36.4	9.4	27.0	74.2%													
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.9%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W5-L	Bedroom	37.4	9.9	27.4	73.5%													
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.7%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W6-L	Bedroom	37.6	10.7	26.9	71.5%													
		W6-U						13.0	12.5	96%	1.7	13%	10.8	86.6%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W7-L	LKD	37.3	11.5	25.8	69.2%													
		W7-U																		
		W8-L		16.5	7.9	8.6	52.3%													
		W8-U						39.5	35.8	91%	33.4	85%	2.4	6.6%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9-L	Bedroom	27.4	18.6	8.8	32.0%													
		W9-U						13.6	13.1	96%	10.4	76%	2.7	20.8%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W10-L	LKD	9.1	7.0	2.1	23.3%													
		W10-U						30.3	24.4	80%	21.7	72%	2.7	10.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1-L	LKD	39.1	38.4	0.7	1.9%													
		W1-U																		
		W2-L		39.1	38.2	1.0	2.4%													
		W2-U																		
		W3-L		22.8	7.8	14.9	65.6%													
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.6%	54	17	54	17	0.0%	0.0%
Eleventh	R2	W4-L	Bedroom	36.6	9.6	27.0	73.8%													
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W5-L	Bedroom	37.6	10.2	27.4	72.8%													
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W6-L	Bedroom	37.8	11.2	26.6	70.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W6-U						13.0	12.5	96%	1.7	13%	10.8	86.6%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W7-L	LKD	37.6	12.1	25.5	67.7%													
		W7-U																		
		W8-L		17.1	9.1	8.0	46.9%													
		W8-U						39.5	35.9	91%	33.6	85%	2.3	6.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9-L	Bedroom	28.0	19.5	8.5	30.3%													
		W9-U						13.6	13.1	96%	10.4	76%	2.7	20.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W10-L	LKD	9.6	7.6	2.0	21.2%													
		W10-U						30.3	24.5	81%	21.9	72%	2.6	10.7%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1-L	LKD	38.7	38.1	0.6	1.5%													
		W1-U																		
		W2-L		38.7	37.9	0.8	2.0%													
		W2-U																		
		W3-L		22.9	7.9	15.0	65.6%													
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.5%	53	16	53	16	0.0%	0.0%
Twelfth	R2	W4-L	Bedroom	36.6	9.5	27.0	74.0%													
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.9%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W5-L	Bedroom	37.5	10.1	27.4	73.1%													
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.7%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W6-L	Bedroom	37.7	11.1	26.6	70.7%													
		W6-U						13.0	12.5	96%	1.7	13%	10.8	86.6%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W7-L	LKD	37.5	12.1	25.4	67.8%													
		W7-U																		
		W8-L		17.4	9.3	8.1	46.5%													
		W8-U						39.5	35.9	91%	33.6	85%	2.3	6.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9-L	Bedroom	28.3	19.8	8.5	30.1%													
		W9-U						13.6	13.1	96%	10.4	77%	2.7	20.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W10-L	LKD	9.5	7.4	2.1	21.7%													
		W10-U						30.3	24.5	81%	21.9	72%	2.6	10.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1-L	LKD	39.3	38.5	0.8	1.9%													
		W1-U																		
		W2-L		39.3	38.3	1.0	2.5%													
		W2-U																		
		W3-L		23.2	8.0	15.2	65.4%													
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.5%	56	18	56	18	0.0%	0.0%
Thirteenth	R2	W4-L	Bedroom	37.1	10.1	27.0	72.8%													
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.8%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W5-L	Bedroom	38.1	10.7	27.4	71.8%													
		W5-U						12.5	11.9	95%	2.4	19%	9.5	79.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W6-L	Bedroom	38.3	11.7	26.6	69.4%													
		W6-U						13.0	12.5	96%	1.7	13%	10.8	86.4%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W7-L	LKD	38.0	12.7	25.4	66.7%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W7-U																	
		W8-L		17.9	9.7	8.2	45.9%												
		W8-U						39.5	35.9	91%	33.7	85%	2.3	6.3%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W9-L	Bedroom	29.2	20.7	8.6	29.3%												
		W9-U						13.6	13.1	96%	10.5	77%	2.6	19.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W10-L	LKD	10.3	8.2	2.1	20.5%												
		W10-U						30.3	24.6	81%	21.9	72%	2.6	10.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1-L	LKD	39.3	38.6	0.8	1.9%												
		W1-U																	
		W2-L		39.3	38.4	0.9	2.4%												
		W2-U																	
		W3-L		23.4	8.1	15.2	65.3%												
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.6%	56	18	56	18	0.0%	0.0%
Fourteenth	R2	W4-L	Bedroom	37.3	10.4	26.9	72.2%												
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W5-L	Bedroom	38.3	11.0	27.3	71.2%												
		W5-U						12.5	11.9	95%	2.4	20%	9.5	79.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W6-L	Bedroom	38.5	12.1	26.5	68.7%												
		W6-U						13.0	12.5	96%	1.7	13%	10.7	86.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W7-L	LKD	38.3	13.0	25.2	66.0%												
		W7-U																	
		W8-L		18.2	9.9	8.3	45.6%												
		W8-U						39.5	35.9	91%	33.7	85%	2.2	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W9-L	Bedroom	29.8	21.3	8.5	28.6%												
		W9-U						13.6	13.1	96%	10.5	78%	2.5	19.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W10-L	LKD	10.6	8.5	2.1	20.0%												
		W10-U						30.3	24.6	81%	22.0	72%	2.7	10.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R1	W1-L	LKD	39.3	38.6	0.8	1.9%												
		W1-U																	
		W2-L		39.3	38.4	0.9	2.4%												
		W2-U																	
		W3-L		23.5	8.2	15.3	65.1%												
		W3-U						38.0	32.8	86%	32.6	86%	0.2	0.6%	55	18	55	18	0.0%	0.0%
Fifteenth	R2	W4-L	Bedroom	37.6	10.8	26.8	71.2%												
		W4-U						12.1	11.0	91%	1.9	16%	9.1	82.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W5-L	Bedroom	38.6	11.5	27.1	70.3%												
		W5-U						12.5	11.9	95%	2.5	20%	9.4	79.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W6-L	Bedroom	38.7	12.4	26.3	67.9%												
		W6-U						13.0	12.5	96%	1.7	13%	10.7	86.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W7-L	LKD	38.5	13.4	25.0	65.1%												
		W7-U																	
		W8-L		18.5	10.1	8.4	45.3%												
		W8-U						39.5	35.9	91%	33.7	85%	2.2	6.2%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifteenth	R6	W9-L W9-U	Bedroom	30.4	21.9	8.5	27.9%	13.6	13.1	96%	10.6	78%	2.4	18.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W10-L W10-U	LKD	10.8	8.7	2.1	19.4%	30.3	24.7	81%	22.0	73%	2.6	10.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R1	W1-L W1-U	LKD	39.4	38.6	0.7	1.8%													
		W2-L W2-U		39.4	38.4	0.9	2.4%													
		W3-L W3-U		23.6	8.3	15.4	65.0%	38.0	32.8	86%	32.6	86%	0.2	0.6%	55	18	55	18	0.0%	0.0%
Sixteenth	R2	W4-L W4-U	Bedroom	38.3	11.7	26.6	69.4%	12.1	11.0	91%	2.0	16%	9.0	82.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W5-L W5-U	Bedroom	38.8	12.0	26.9	69.2%	12.5	11.9	95%	2.5	20%	9.4	79.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R4	W6-L W6-U	Bedroom	38.9	12.9	26.0	66.9%	13.0	12.5	96%	1.8	14%	10.7	85.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W7-L W7-U	LKD	38.7	14.0	24.8	64.0%													
		W8-L W8-U		18.8	10.3	8.4	45.0%	39.5	36.0	91%	33.8	85%	2.2	6.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R6	W9-L W9-U	Bedroom	31.8	22.9	8.9	28.0%	13.6	13.1	96%	10.7	79%	2.4	18.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W10-L W10-U	LKD	11.0	9.0	2.1	18.9%	30.3	24.7	81%	22.1	73%	2.6	10.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R1	W1-L W1-U	LKD	39.3	38.6	0.7	1.7%													
		W2-L W2-U		39.3	38.4	0.9	2.3%													
		W3-L W3-U		39.1	14.9	24.2	62.0%	38.0	32.8	86%	32.6	86%	0.2	0.6%	53	16	53	16	0.0%	0.0%
Seventeenth	R2	W4-L W4-U	Bedroom	39.0	12.8	26.2	67.2%	12.1	11.0	91%	2.0	17%	9.0	81.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W5-L W5-U	Bedroom	39.0	12.5	26.5	67.9%	12.5	11.9	95%	2.6	21%	9.3	78.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R4	W6-L W6-U	Bedroom	39.0	13.4	25.6	65.7%	13.0	12.5	96%	1.8	14%	10.6	85.3%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W7-L W7-U	LKD	39.0	14.6	24.3	62.4%													
		W8-L W8-U		34.9	22.6	12.3	35.3%	39.5	36.0	91%	34.1	86%	1.9	5.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R6	W9-L W9-U	Bedroom	34.2	23.6	10.7	31.1%	13.6	13.1	96%	10.9	80%	2.2	17.1%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Seventeenth	R7	W10-L W10-U	LKD	11.2	9.2	2.1	18.3%	30.3	24.7	81%	22.2	73%	2.5	10.0%	N/F	N/F	N/F	N/F	N/F	N/F

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 4

Results of the future baseline daylight and sunlight assessments

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
The Hale																			
Ground	R8	W9-L	Residential	32.9	28.6	4.4	13.2%												
		W9-U																	
		W10-L		33.0	29.2	3.8	11.5%												
		W10-U																	
		W11-L		16.1	16.1	0.0	0.0%												
		W11-U						52.3	51.5	99%	51.5	99%	0.0	0.0%	39	12	39	12	0.0%	0.0%
First	R1	W1-L	Bedroom	23.1	16.9	6.3	27.1%												
		W1-U																	
		W2-L		25.3	19.0	6.3	24.9%												
		W2-U						11.2	9.7	87%	8.3	74%	1.4	14.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W3-L	Bedroom	24.4	17.9	6.5	26.8%												
		W3-U																	
		W4-L		26.1	19.4	6.7	25.6%												
		W4-U						10.4	10.3	99%	9.5	91%	0.8	7.8%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	Bedroom	25.1	18.1	7.0	27.8%												
		W5-U																	
		W6-L		26.8	19.8	7.0	26.0%												
		W6-U						10.0	9.9	99%	9.2	92%	0.7	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W7-L	Bedroom	25.8	18.6	7.2	27.8%												
		W7-U																	
		W8-L		27.1	19.9	7.2	26.7%												
		W8-U						10.3	10.2	99%	9.4	91%	0.9	8.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W9-L	Bedroom	25.9	18.4	7.5	28.8%												
		W9-U																	
		W10-L		28.1	20.6	7.5	26.6%												
		W10-U						10.0	10.0	99%	9.3	92%	0.7	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W11-L	Bedroom	27.0	19.3	7.7	28.5%												
		W11-U																	
		W12-L		28.7	20.9	7.8	27.2%												
		W12-U						10.2	10.1	99%	9.1	89%	1.0	10.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W13-L	Bedroom	27.5	19.4	8.1	29.4%												
		W13-U																	
		W14-L		29.2	21.0	8.2	28.0%												
		W14-U						10.1	10.0	99%	9.2	91%	0.8	8.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W15-L	Bedroom	27.9	19.6	8.4	30.0%												
		W15-U																	
		W16-L		29.4	20.9	8.4	28.7%												
		W16-U						10.2	10.1	99%	8.5	84%	1.6	15.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W17-L	Studio	27.8	19.2	8.5	30.7%												
		W17-U																	
		W18-L		29.9	21.2	8.6	28.9%												
		W18-U						15.0	14.7	98%	11.8	79%	2.8	19.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R10	W19-L	Studio	28.5	19.8	8.7	30.6%												
		W19-U																	
		W20-L		30.1	21.4	8.7	28.9%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W20-U						14.0	13.6	98%	12.4	89%	1.2	8.8%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W21-L	Studio	28.8	20.0	8.8	30.5%													
		W21-U																		
		W22-L		30.1	21.3	8.7	29.1%													
		W22-U						14.8	14.0	94%	12.1	81%	1.9	13.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R12	W23-L	Studio	30.8	25.3	5.6	18.0%													
		W23-U																		
		W24-L		32.3	27.1	5.2	16.1%													
		W24-U						14.2	14.1	99%	14.0	99%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W25-L	Studio	31.5	26.3	5.2	16.4%													
		W25-U																		
		W26-L		32.4	27.6	4.8	14.7%													
		W26-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W27-L	Studio	31.5	26.9	4.7	14.8%													
		W27-U																		
		W28-L		32.0	27.8	4.2	13.1%													
		W28-U						14.2	14.1	99%	14.1	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R15	W29-L	Studio	31.0	26.9	4.1	13.1%													
		W29-U																		
		W30-L		32.3	28.7	3.7	11.4%													
		W30-U																		
		W31-L		31.5	27.7	3.8	12.0%													
		W31-U																		
		W32-L		31.8	28.6	3.2	10.2%													
		W32-U						16.7	16.3	97%	16.1	96%	0.2	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	Bedroom	25.9	19.4	6.5	25.1%													
		W1-U																		
		W2-L		27.7	21.2	6.5	23.6%													
		W2-U						11.9	11.1	94%	10.5	88%	0.6	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R2	W3-L	Bedroom	26.6	19.8	6.8	25.4%													
		W3-U																		
		W4-L		28.4	21.5	6.9	24.3%													
		W4-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	Bedroom	27.2	20.0	7.2	26.4%													
		W5-U																		
		W6-L		29.0	21.9	7.2	24.7%													
		W6-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W7-L	Bedroom	27.7	20.3	7.4	26.6%													
		W7-U																		
		W8-L		29.5	22.1	7.4	25.1%													
		W8-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W9-L	Bedroom	28.0	20.4	7.6	27.1%													
		W9-U																		
		W10-L		29.9	22.3	7.6	25.5%													
		W10-U						10.2	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W11-L	Bedroom	28.5	20.7	7.9	27.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W11-U																		
		W12-L		30.4	22.5	8.0	26.2%													
		W12-U						10.1	10.1	99%	10.0	99%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W13-L	Bedroom	28.9	20.7	8.2	28.4%													
		W13-U																		
		W14-L		30.8	22.5	8.3	27.0%													
		W14-U						10.1	10.1	99%	10.0	99%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W15-L	Bedroom	29.3	20.8	8.5	29.1%													
		W15-U																		
		W16-L		31.2	22.7	8.6	27.4%													
		W16-U						10.1	10.1	99%	9.3	92%	0.7	7.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W17-L	Studio	29.9	21.2	8.7	29.0%													
		W17-U																		
		W18-L		31.6	22.8	8.8	27.8%													
		W18-U						14.9	14.6	98%	12.8	86%	1.7	11.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W19-L	Studio	30.2	21.3	8.9	29.4%													
		W19-U																		
		W20-L		31.8	23.0	8.8	27.8%													
		W20-U						14.1	13.7	98%	13.5	96%	0.2	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W21-L	Studio	30.5	21.5	8.9	29.4%													
		W21-U																		
		W22-L		31.9	23.0	8.9	27.9%													
		W22-U						14.7	13.9	94%	12.3	83%	1.7	11.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R12	W23-L	Studio	34.8	29.0	5.8	16.8%													
		W23-U																		
		W24-L		35.3	29.7	5.6	15.8%													
		W24-U						14.2	14.0	99%	13.9	98%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W25-L	Studio	34.7	29.4	5.3	15.2%													
		W25-U																		
		W26-L		35.3	30.3	5.0	14.1%													
		W26-U						14.2	14.0	99%	13.9	99%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W27-L	Studio	34.6	29.8	4.8	13.8%													
		W27-U																		
		W28-L		35.2	30.6	4.6	13.0%													
		W28-U						14.2	14.1	99%	14.0	99%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R15	W29-L	Studio	34.6	30.4	4.2	12.1%													
		W29-U																		
		W30-L		35.1	31.0	4.1	11.7%													
		W30-U																		
		W31-L		34.5	30.7	3.8	11.0%													
		W31-U																		
		W32-L		35.0	31.3	3.7	10.7%													
		W32-U						16.8	16.2	97%	16.0	95%	0.2	1.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	Bedroom	27.2	21.0	6.2	22.7%													
		W1-U																		
		W2-L		29.0	22.8	6.2	21.4%													
		W2-U						11.9	11.8	99%	11.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R2	W3-L	Bedroom	27.9	21.4	6.4	23.1%													
		W3-U																		
		W4-L		29.6	23.0	6.5	22.1%													
		W4-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	Bedroom	28.3	21.5	6.8	24.1%													
		W5-U																		
		W6-L		30.0	23.2	6.8	22.6%													
		W6-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W7-L	Bedroom	28.6	21.7	7.0	24.4%													
		W7-U																		
		W8-L		30.3	23.3	7.0	23.1%													
		W8-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W9-L	Bedroom	28.8	21.6	7.2	25.0%													
		W9-U																		
		W10-L		30.6	23.4	7.3	23.7%													
		W10-U						10.2	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W11-L	Bedroom	29.3	21.8	7.5	25.5%													
		W11-U																		
		W12-L		31.1	23.5	7.6	24.4%													
		W12-U						10.1	10.1	99%	10.0	99%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W13-L	Bedroom	29.5	21.7	7.8	26.5%													
		W13-U																		
		W14-L		31.3	23.4	7.9	25.2%													
		W14-U						10.1	10.1	99%	10.0	99%	0.0	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W15-L	Bedroom	29.8	21.7	8.1	27.2%													
		W15-U																		
		W16-L		31.7	23.6	8.2	25.7%													
		W16-U						10.1	10.1	99%	9.4	93%	0.6	6.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W17-L	Studio	30.4	22.1	8.2	27.1%													
		W17-U																		
		W18-L		32.0	23.7	8.4	26.1%													
		W18-U						14.9	14.6	98%	12.9	87%	1.7	11.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W19-L	Studio	30.6	22.1	8.5	27.7%													
		W19-U																		
		W20-L		32.2	23.7	8.5	26.3%													
		W20-U						14.1	13.7	98%	13.6	96%	0.2	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W21-L	Studio	30.9	22.3	8.6	27.9%													
		W21-U																		
		W22-L		32.3	23.7	8.6	26.6%													
		W22-U						14.7	13.9	94%	12.3	83%	1.6	11.8%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R12	W23-L	Studio	35.2	29.5	5.7	16.2%													
		W23-U																		
		W24-L		35.7	30.2	5.5	15.3%													
		W24-U						14.2	14.0	99%	13.9	98%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W25-L	Studio	35.1	29.9	5.2	14.7%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W25-U																		
		W26-L		35.6	30.7	4.9	13.7%													
		W26-U						14.2	14.0	99%	14.0	99%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W27-L	Studio	35.1	30.4	4.7	13.4%													
		W27-U																		
		W28-L		35.6	31.1	4.5	12.6%													
		W28-U						14.2	14.1	99%	14.0	99%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R15	W29-L	Studio	35.1	31.0	4.1	11.7%													
		W29-U																		
		W30-L		35.5	31.5	4.0	11.4%													
		W30-U																		
		W31-L		35.0	31.3	3.7	10.6%													
		W31-U																		
		W32-L		35.6	31.9	3.7	10.3%													
		W32-U						16.8	16.2	97%	16.0	95%	0.2	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	Bedroom	28.4	22.5	6.0	21.0%													
		W1-U																		
		W2-L		30.1	24.2	6.0	19.9%													
		W2-U						11.9	11.8	99%	11.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R2	W3-L	Bedroom	28.9	22.7	6.2	21.4%													
		W3-U																		
		W4-L		30.6	24.3	6.3	20.6%													
		W4-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	Bedroom	29.2	22.7	6.5	22.3%													
		W5-U																		
		W6-L		30.9	24.4	6.5	21.0%													
		W6-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W7-L	Bedroom	29.5	22.8	6.7	22.6%													
		W7-U																		
		W8-L		31.1	24.4	6.7	21.6%													
		W8-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W9-L	Bedroom	29.6	22.7	6.9	23.3%													
		W9-U																		
		W10-L		31.3	24.4	6.9	22.1%													
		W10-U						10.2	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W11-L	Bedroom	29.9	22.8	7.1	23.7%													
		W11-U																		
		W12-L		31.6	24.4	7.2	22.7%													
		W12-U						10.1	10.1	99%	10.0	99%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W13-L	Bedroom	30.0	22.7	7.4	24.6%													
		W13-U																		
		W14-L		31.8	24.3	7.5	23.5%													
		W14-U						10.1	10.1	99%	10.0	99%	0.0	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W15-L	Bedroom	30.3	22.6	7.7	25.3%													
		W15-U																		
		W16-L		32.1	24.4	7.7	24.0%													
		W16-U						10.1	10.1	99%	9.4	93%	0.6	6.2%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R9	W17-L	Studio	30.8	23.0	7.8	25.5%													
		W17-U																		
		W18-L		32.4	24.5	8.0	24.5%													
		W18-U						14.9	14.6	98%	12.9	87%	1.6	11.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W19-L	Studio	31.1	22.9	8.1	26.2%													
		W19-U																		
		W20-L		32.6	24.5	8.1	24.9%													
		W20-U						14.1	13.7	98%	13.6	97%	0.2	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W21-L	Studio	31.3	23.0	8.3	26.5%													
		W21-U																		
		W22-L		32.7	24.4	8.3	25.3%													
		W22-U						14.7	13.9	94%	12.3	83%	1.6	11.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R12	W23-L	Studio	35.6	30.0	5.6	15.7%													
		W23-U																		
		W24-L		36.1	30.7	5.4	14.9%													
		W24-U						14.2	14.0	99%	13.9	99%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R13	W25-L	Studio	35.4	30.4	5.1	14.3%													
		W25-U																		
		W26-L		36.0	31.2	4.8	13.3%													
		W26-U						14.2	14.0	99%	14.0	99%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W27-L	Studio	35.4	30.8	4.6	13.0%													
		W27-U																		
		W28-L		36.0	31.6	4.4	12.2%													
		W28-U						14.2	14.1	99%	14.0	99%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R15	W29-L	Studio	35.4	31.4	4.0	11.3%													
		W29-U																		
		W30-L		35.8	31.9	3.9	11.0%													
		W30-U																		
		W31-L		35.4	31.8	3.6	10.2%													
		W31-U																		
		W32-L		35.9	32.3	3.6	10.0%													
		W32-U						16.8	16.2	97%	16.0	96%	0.2	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	Bedroom	29.2	23.5	5.7	19.4%													
		W1-U																		
		W2-L		30.8	25.1	5.7	18.5%													
		W2-U						11.9	11.8	99%	11.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R2	W3-L	Bedroom	29.6	23.7	5.9	19.9%													
		W3-U																		
		W4-L		31.2	25.2	6.0	19.2%													
		W4-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	Bedroom	29.9	23.7	6.2	20.8%													
		W5-U																		
		W6-L		31.5	25.3	6.2	19.7%													
		W6-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W7-L	Bedroom	30.1	23.7	6.4	21.2%													
		W7-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W8-L		31.6	25.3	6.4	20.2%												
		W8-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W9-L	Bedroom	30.1	23.6	6.6	21.8%												
		W9-U																	
		W10-L		31.8	25.2	6.6	20.7%												
		W10-U						10.2	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W11-L	Bedroom	30.4	23.6	6.7	22.2%												
		W11-U																	
		W12-L		32.1	25.3	6.8	21.2%												
		W12-U						10.1	10.1	99%	10.0	99%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W13-L	Bedroom	30.5	23.5	7.0	23.0%												
		W13-U																	
		W14-L		32.2	25.1	7.1	22.0%												
		W14-U						10.1	10.1	99%	10.0	99%	0.0	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W15-L	Bedroom	30.7	23.4	7.3	23.7%												
		W15-U																	
		W16-L		32.6	25.2	7.4	22.6%												
		W16-U						10.1	10.1	99%	9.4	93%	0.6	6.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W17-L	Studio	31.2	23.8	7.5	24.0%												
		W17-U																	
		W18-L		32.8	25.2	7.6	23.2%												
		W18-U						14.9	14.6	98%	12.9	87%	1.6	11.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W19-L	Studio	31.5	23.7	7.8	24.8%												
		W19-U																	
		W20-L		33.0	25.2	7.8	23.6%												
		W20-U						14.1	13.7	98%	13.6	97%	0.2	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W21-L	Studio	31.7	23.7	8.0	25.2%												
		W21-U																	
		W22-L		33.1	25.1	8.0	24.1%												
		W22-U						14.7	13.9	95%	12.3	83%	1.6	11.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R12	W23-L	Studio	35.9	30.4	5.4	15.2%												
		W23-U																	
		W24-L		36.3	31.0	5.2	14.4%												
		W24-U						14.2	14.0	99%	14.0	99%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W25-L	Studio	35.7	30.8	5.0	13.9%												
		W25-U																	
		W26-L		36.2	31.5	4.7	12.9%												
		W26-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W27-L	Studio	35.7	31.2	4.5	12.6%												
		W27-U																	
		W28-L		36.2	31.9	4.3	11.9%												
		W28-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R15	W29-L	Studio	35.7	31.8	3.9	10.9%												
		W29-U																	
		W30-L		36.2	32.3	3.9	10.7%												
		W30-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W31-L		35.7	32.2	3.5	9.9%												
		W31-U																	
		W32-L		36.2	32.7	3.5	9.7%												
		W32-U						16.8	16.2	97%	16.1	96%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	Bedroom	29.7	24.3	5.4	18.2%												
		W1-U																	
		W2-L		31.4	26.0	5.4	17.3%												
		W2-U						11.9	11.8	99%	11.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R2	W3-L	Bedroom	30.1	24.5	5.6	18.6%												
		W3-U																	
		W4-L		31.7	26.1	5.7	17.9%												
		W4-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W5-L	Bedroom	30.3	24.4	5.9	19.5%												
		W5-U																	
		W6-L		32.0	26.1	5.9	18.4%												
		W6-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W7-L	Bedroom	30.5	24.4	6.1	19.9%												
		W7-U																	
		W8-L		32.1	26.0	6.1	18.9%												
		W8-U						10.1	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W9-L	Bedroom	30.5	24.3	6.3	20.5%												
		W9-U																	
		W10-L		32.3	26.0	6.3	19.5%												
		W10-U						10.2	10.1	99%	10.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W11-L	Bedroom	30.7	24.3	6.5	21.0%												
		W11-U																	
		W12-L		32.5	25.9	6.6	20.2%												
		W12-U						10.1	10.1	99%	10.0	99%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W13-L	Bedroom	30.9	24.1	6.8	21.9%												
		W13-U																	
		W14-L		32.6	25.8	6.8	21.0%												
		W14-U						10.1	10.1	99%	10.0	99%	0.0	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W15-L	Bedroom	31.2	24.1	7.0	22.6%												
		W15-U																	
		W16-L		33.0	25.8	7.1	21.6%												
		W16-U						10.1	10.1	99%	9.4	93%	0.6	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W17-L	Studio	31.6	24.3	7.3	23.0%												
		W17-U																	
		W18-L		33.3	25.9	7.4	22.3%												
		W18-U						14.9	14.6	98%	12.9	87%	1.6	11.2%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W19-L	Studio	31.8	24.2	7.6	23.9%												
		W19-U																	
		W20-L		33.4	25.8	7.6	22.7%												
		W20-U						14.1	13.7	98%	13.6	97%	0.1	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W21-L	Studio	32.0	24.2	7.8	24.3%												
		W21-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W22-L		33.4	25.7	7.8	23.2%												
		W22-U						14.7	13.9	95%	12.3	84%	1.6	11.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R12	W23-L	Studio	36.2	30.8	5.3	14.7%												
		W23-U																	
		W24-L		36.6	31.4	5.1	14.1%												
		W24-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W25-L	Studio	36.0	31.2	4.8	13.4%												
		W25-U																	
		W26-L		36.5	31.9	4.6	12.6%												
		W26-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W27-L	Studio	36.0	31.6	4.4	12.2%												
		W27-U																	
		W28-L		36.5	32.3	4.2	11.5%												
		W28-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R15	W29-L	Studio	36.1	32.3	3.8	10.5%												
		W29-U																	
		W30-L		36.4	32.7	3.8	10.4%												
		W30-U																	
		W31-L		36.0	32.6	3.4	9.6%												
		W31-U																	
		W32-L		36.5	33.1	3.4	9.4%												
		W32-U						16.8	16.2	97%	16.1	96%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	Residential	20.1	20.1	0.0	0.0%												
		W1-U																	
		W2-L		34.6	28.6	6.0	17.2%												
		W2-U																	
		W3-L		34.2	28.0	6.2	18.0%												
		W3-U																	
		W4-L		34.5	28.2	6.3	18.1%												
		W4-U																	
		W5-L		34.3	27.8	6.5	18.9%												
		W5-U																	
		W6-L		34.6	28.0	6.6	18.9%												
		W6-U																	
		W7-L		34.5	27.8	6.8	19.6%												
		W7-U																	
		W8-L		34.9	28.1	6.8	19.6%												
		W8-U																	
		W9-L		35.0	28.0	7.0	20.0%												
		W9-U																	
		W10-L		35.2	28.1	7.1	20.2%												
		W10-U																	
		W11-L		35.2	27.9	7.3	20.8%												
		W11-U																	
		W12-L		35.3	28.0	7.3	20.8%												
		W12-U																	
		W25-L		8.3	8.3	0.0	0.0%												
		W25-U						105.6	104.2	99%	104.2	99%	0.0	0.0%	35	6	35	6	0.0%	0.0%
Seventh	R2	W13-L	Studio	35.3	27.8	7.6	21.4%												
		W13-U																	
		W14-L		35.3	27.8	7.6	21.4%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W14-U						14.7	14.0	95%	12.4	84%	1.6	11.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W15-L	Studio	36.3	31.1	5.2	14.3%													
		W15-U																		
		W16-L		36.8	31.8	5.0	13.6%													
		W16-U						14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W17-L	Studio	36.2	31.5	4.7	13.0%													
		W17-U																		
		W18-L		36.8	32.4	4.5	12.1%													
		W18-U						14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W19-L	Studio	36.3	32.0	4.3	11.7%													
		W19-U																		
		W20-L		36.8	32.7	4.1	11.1%													
		W20-U						14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W21-L	Studio	36.5	32.8	3.7	10.1%													
		W21-U																		
		W22-L		36.8	33.2	3.7	10.0%													
		W22-U																		
		W23-L		36.4	33.1	3.3	9.2%													
		W23-U																		
		W24-L		36.9	33.6	3.3	9.0%													
		W24-U						16.8	16.2	97%	16.1	96%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1-L	Kitchen	22.7	22.7	0.0	0.0%													
		W1-U																		
		W2-L		35.0	29.3	5.7	16.4%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	31	7	31	7	0.0%	0.0%
Eighth	R2	W3-L	Bedroom	31.9	25.9	5.9	18.6%													
		W3-U																		
		W4-L		33.4	27.4	6.0	18.0%													
		W4-U						10.0	10.0	99%	9.9	99%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W5-L	Bedroom	31.9	25.6	6.2	19.6%													
		W5-U																		
		W6-L		33.3	27.0	6.3	19.0%													
		W6-U						10.0	10.0	99%	9.9	99%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W7-L	Bedroom	32.0	25.5	6.5	20.4%													
		W7-U																		
		W8-L		33.6	27.0	6.6	19.7%													
		W8-U						10.1	10.0	99%	9.4	93%	0.6	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W9-L	Studio	32.1	25.4	6.8	21.1%													
		W9-U																		
		W10-L		33.7	26.8	6.9	20.5%													
		W10-U						14.9	14.6	98%	12.8	86%	1.8	12.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W11-L	Studio	32.9	25.7	7.1	21.7%													
		W11-U																		
		W12-L		34.2	27.0	7.1	20.9%													
		W12-U						14.1	13.6	97%	13.4	96%	0.2	1.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W13-L	Studio	33.0	25.7	7.4	22.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W13-U																		
		W14-L		34.3	26.9	7.4	21.5%													
		W14-U						14.7	13.8	93%	12.0	81%	1.8	13.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W15-L	Studio	34.5	29.5	5.0	14.6%													
		W15-U																		
		W16-L		35.6	30.7	4.9	13.7%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W17-L	Studio	34.5	30.0	4.6	13.2%													
		W17-U																		
		W18-L		35.7	31.4	4.3	12.0%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W19-L	Studio	34.6	30.5	4.1	11.9%													
		W19-U																		
		W20-L		35.7	31.9	3.9	10.8%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W21-L	Studio	34.9	31.3	3.6	10.3%													
		W21-U																		
		W22-L		35.7	32.3	3.3	9.4%													
		W22-U																		
		W23-L		34.7	31.5	3.2	9.3%													
		W23-U																		
		W24-L		35.8	32.8	3.0	8.3%													
		W24-U						16.8	16.2	97%	16.2	96%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1-L	Kitchen	23.8	23.8	0.0	0.0%													
		W1-U																		
		W2-L		35.4	29.9	5.5	15.5%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	33	8	33	8	0.0%	0.0%
Ninth	R2	W3-L	Bedroom	32.3	26.6	5.7	17.6%													
		W3-U																		
		W4-L		33.7	27.9	5.8	17.1%													
		W4-U						10.0	10.0	99%	9.9	99%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W5-L	Bedroom	32.2	26.3	6.0	18.6%													
		W5-U																		
		W6-L		33.6	27.6	6.1	18.0%													
		W6-U						10.0	10.0	99%	9.9	99%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W7-L	Bedroom	32.4	26.1	6.3	19.3%													
		W7-U																		
		W8-L		33.9	27.6	6.4	18.7%													
		W8-U						10.1	10.0	99%	9.4	93%	0.6	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W9-L	Studio	32.5	26.0	6.5	20.1%													
		W9-U																		
		W10-L		34.0	27.4	6.7	19.5%													
		W10-U						14.9	14.6	98%	12.8	86%	1.8	12.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W11-L	Studio	33.2	26.3	6.9	20.8%													
		W11-U																		
		W12-L		34.5	27.6	6.9	20.0%													
		W12-U						14.1	13.6	97%	13.4	96%	0.2	1.3%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ninth	R7	W13-L	Studio	33.3	26.2	7.1	21.4%													
		W13-U																		
		W14-L		34.6	27.4	7.1	20.6%													
		W14-U						14.7	13.8	93%	12.0	81%	1.8	13.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W15-L	Studio	34.8	29.9	4.9	14.0%													
		W15-U																		
		W16-L		35.8	31.1	4.7	13.1%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W17-L	Studio	34.7	30.3	4.4	12.7%													
		W17-U																		
		W18-L		35.8	31.7	4.1	11.6%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W19-L	Studio	34.8	30.8	4.0	11.4%													
		W19-U																		
		W20-L		35.9	32.2	3.7	10.4%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W21-L	Studio	35.1	31.6	3.5	9.8%													
		W21-U																		
		W22-L		35.9	32.6	3.2	9.0%													
		W22-U																		
		W23-L		34.9	31.8	3.1	8.9%													
		W23-U																		
		W24-L		36.0	33.1	2.9	7.9%													
		W24-U						16.8	16.2	97%	16.2	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1-L	Kitchen	24.6	24.6	0.0	0.0%													
		W1-U																		
		W2-L		34.1	28.9	5.2	15.3%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	33	8	33	8	0.0%	0.0%
Tenth	R2	W3-L	Bedroom	32.3	26.9	5.4	16.7%													
		W3-U																		
		W4-L		33.6	28.2	5.5	16.3%													
		W4-U						10.0	9.9	99%	9.9	98%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W5-L	Bedroom	32.3	26.6	5.7	17.6%													
		W5-U																		
		W6-L		33.6	27.8	5.8	17.2%													
		W6-U						10.0	9.9	99%	9.8	98%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W7-L	Bedroom	32.4	26.4	6.0	18.5%													
		W7-U																		
		W8-L		33.9	27.8	6.1	17.9%													
		W8-U						10.1	10.0	99%	9.3	93%	0.6	6.3%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W9-L	Studio	32.5	26.3	6.2	19.2%													
		W9-U																		
		W10-L		33.9	27.6	6.4	18.8%													
		W10-U						14.9	14.4	96%	12.6	84%	1.8	12.6%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W11-L	Studio	33.4	26.7	6.6	19.8%													
		W11-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W12-L		34.6	28.0	6.6	19.1%												
		W12-U						14.1	13.5	96%	13.3	95%	0.2	1.4%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W13-L	Studio	33.5	26.7	6.8	20.4%												
		W13-U																	
		W14-L		34.7	27.8	6.8	19.7%												
		W14-U						14.7	13.6	92%	11.8	80%	1.8	13.2%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W15-L	Studio	34.8	30.2	4.7	13.4%												
		W15-U																	
		W16-L		35.8	31.3	4.5	12.6%												
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W17-L	Studio	34.8	30.6	4.2	12.2%												
		W17-U																	
		W18-L		35.9	31.9	4.0	11.1%												
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R10	W19-L	Studio	34.9	31.1	3.8	11.0%												
		W19-U																	
		W20-L		36.0	32.4	3.6	9.9%												
		W20-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R11	W21-L	Studio	35.2	31.8	3.3	9.4%												
		W21-U																	
		W22-L		35.9	32.9	3.1	8.6%												
		W22-U																	
		W23-L		35.1	32.1	3.0	8.6%												
		W23-U																	
		W24-L		36.0	33.3	2.7	7.6%												
		W24-U						16.8	16.1	96%	16.1	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1-L	Kitchen	26.0	26.0	0.0	0.0%												
		W1-U																	
		W2-L		36.2	31.3	4.9	13.5%												
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	39	10	39	10	0.0%	0.0%
Eleventh	R2	W3-L	Bedroom	32.9	27.8	5.1	15.5%												
		W3-U																	
		W4-L		34.3	29.1	5.2	15.1%												
		W4-U						10.0	10.0	99%	9.9	99%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W5-L	Bedroom	32.9	27.5	5.4	16.4%												
		W5-U																	
		W6-L		34.2	28.7	5.5	16.0%												
		W6-U						10.0	10.0	99%	9.9	99%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W7-L	Bedroom	33.0	27.3	5.7	17.2%												
		W7-U																	
		W8-L		34.5	28.7	5.8	16.7%												
		W8-U						10.1	10.0	99%	9.4	93%	0.6	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W9-L	Studio	33.1	27.2	5.9	17.9%												
		W9-U																	
		W10-L		34.6	28.5	6.1	17.5%												
		W10-U						14.9	14.6	98%	12.8	86%	1.8	12.4%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eleventh	R6	W11-L	Studio	33.8	27.5	6.3	18.6%												
		W11-U																	
		W12-L		35.0	28.7	6.3	18.0%												
		W12-U						14.1	13.6	97%	13.4	96%	0.2	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W13-L	Studio	33.9	27.4	6.5	19.3%												
		W13-U																	
		W14-L		35.1	28.5	6.5	18.6%												
		W14-U						14.7	13.8	93%	12.0	81%	1.8	13.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W15-L	Studio	35.1	30.7	4.5	12.7%												
		W15-U																	
		W16-L		36.1	31.8	4.3	11.9%												
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W17-L	Studio	35.1	31.1	4.0	11.5%												
		W17-U																	
		W18-L		36.2	32.4	3.8	10.4%												
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R10	W19-L	Studio	35.2	31.6	3.6	10.3%												
		W19-U																	
		W20-L		36.3	32.9	3.4	9.3%												
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R11	W21-L	Studio	35.5	32.3	3.2	8.9%												
		W21-U																	
		W22-L		36.3	33.3	2.9	8.1%												
		W22-U																	
		W23-L		35.4	32.5	2.9	8.1%												
		W23-U																	
		W24-L		36.3	33.8	2.6	7.1%												
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1-L	Kitchen	27.1	27.1	0.0	0.0%												
		W1-U																	
		W2-L		36.6	32.0	4.6	12.6%												
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	42	11	42	11	0.0%	0.0%
Twelfth	R2	W3-L	Bedroom	33.2	28.4	4.8	14.3%												
		W3-U																	
		W4-L		34.5	29.6	4.8	14.0%												
		W4-U						10.0	10.0	99%	9.9	99%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W5-L	Bedroom	33.2	28.1	5.0	15.2%												
		W5-U																	
		W6-L		34.4	29.3	5.1	14.9%												
		W6-U						10.0	10.0	99%	9.9	99%	0.0	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W7-L	Bedroom	33.3	27.9	5.3	16.0%												
		W7-U																	
		W8-L		34.7	29.3	5.4	15.6%												
		W8-U						10.1	10.0	99%	9.4	93%	0.6	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W9-L	Studio	33.4	27.8	5.6	16.7%												
		W9-U																	
		W10-L		34.8	29.1	5.7	16.4%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						14.9	14.6	98%	12.8	86%	1.8	12.4%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W11-L	Studio	34.0	28.1	5.9	17.5%													
		W11-U																		
		W12-L		35.2	29.2	6.0	16.9%													
		W12-U						14.1	13.6	97%	13.4	96%	0.2	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W13-L	Studio	34.2	28.0	6.2	18.1%													
		W13-U																		
		W14-L		35.3	29.1	6.2	17.5%													
		W14-U						14.7	13.8	94%	12.0	81%	1.8	13.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W15-L	Studio	35.3	31.1	4.2	11.9%													
		W15-U																		
		W16-L		36.3	32.2	4.1	11.2%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W17-L	Studio	35.3	31.5	3.8	10.8%													
		W17-U																		
		W18-L		36.4	32.8	3.6	9.8%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R10	W19-L	Studio	35.4	31.9	3.4	9.7%													
		W19-U																		
		W20-L		36.5	33.3	3.2	8.7%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R11	W21-L	Studio	35.6	32.7	3.0	8.3%													
		W21-U																		
		W22-L		36.4	33.7	2.8	7.6%													
		W22-U																		
		W23-L		35.5	32.9	2.7	7.5%													
		W23-U																		
		W24-L		36.5	34.1	2.4	6.7%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1-L	Kitchen	28.2	28.2	0.0	0.0%													
		W1-U																		
		W2-L		36.8	32.6	4.3	11.5%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	46	13	46	13	0.0%	0.0%
Thirteenth	R2	W3-L	Bedroom	33.4	29.0	4.4	13.2%													
		W3-U																		
		W4-L		34.7	30.2	4.5	12.9%													
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W5-L	Bedroom	33.4	28.7	4.7	14.0%													
		W5-U																		
		W6-L		34.6	29.8	4.7	13.7%													
		W6-U						10.0	10.0	99%	9.9	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W7-L	Bedroom	33.5	28.6	4.9	14.8%													
		W7-U																		
		W8-L		34.9	29.8	5.0	14.4%													
		W8-U						10.1	10.0	99%	9.4	93%	0.6	5.9%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W9-L	Studio	33.6	28.4	5.2	15.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W9-U																		
		W10-L		34.9	29.6	5.3	15.2%													
		W10-U						14.9	14.6	98%	12.8	86%	1.8	12.3%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W11-L	Studio	34.3	28.7	5.5	16.1%													
		W11-U																		
		W12-L		35.4	29.8	5.6	15.7%													
		W12-U						14.1	13.6	97%	13.4	96%	0.2	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W13-L	Studio	34.4	28.6	5.8	16.8%													
		W13-U																		
		W14-L		35.4	29.7	5.8	16.3%													
		W14-U						14.7	13.8	94%	12.0	81%	1.8	13.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R8	W15-L	Studio	35.4	31.5	3.9	11.1%													
		W15-U																		
		W16-L		36.4	32.7	3.8	10.4%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R9	W17-L	Studio	35.4	31.9	3.5	10.0%													
		W17-U																		
		W18-L		36.5	33.2	3.3	9.1%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R10	W19-L	Studio	35.5	32.3	3.2	9.0%													
		W19-U																		
		W20-L		36.6	33.6	3.0	8.1%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R11	W21-L	Studio	35.8	33.0	2.8	7.7%													
		W21-U																		
		W22-L		36.6	34.0	2.6	7.0%													
		W22-U																		
		W23-L		35.7	33.2	2.5	7.0%													
		W23-U																		
		W24-L		36.7	34.4	2.3	6.2%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1-L	Kitchen	29.3	29.3	0.0	0.0%													
		W1-U																		
		W2-L		37.1	33.2	3.9	10.5%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	49	14	49	14	0.0%	0.0%
Fourteenth	R2	W3-L	Bedroom	33.7	29.6	4.1	12.0%													
		W3-U																		
		W4-L		34.9	30.7	4.1	11.8%													
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W5-L	Bedroom	33.6	29.3	4.3	12.8%													
		W5-U																		
		W6-L		34.7	30.4	4.4	12.6%													
		W6-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W7-L	Bedroom	33.7	29.2	4.5	13.4%													
		W7-U																		
		W8-L		35.0	30.4	4.6	13.2%													
		W8-U						10.1	10.0	99%	9.5	94%	0.5	4.8%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourteenth	R5	W9-L	Studio	33.8	29.0	4.8	14.1%													
		W9-U																		
		W10-L		35.1	30.2	4.9	13.9%													
		W10-U						14.9	14.6	98%	12.8	86%	1.8	12.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W11-L	Studio	34.4	29.3	5.1	14.8%													
		W11-U																		
		W12-L		35.5	30.4	5.1	14.4%													
		W12-U						14.1	13.6	97%	13.5	96%	0.2	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W13-L	Studio	34.5	29.2	5.3	15.4%													
		W13-U																		
		W14-L		35.6	30.3	5.3	14.9%													
		W14-U						14.7	13.8	94%	12.0	81%	1.8	13.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R8	W15-L	Studio	35.6	32.0	3.6	10.1%													
		W15-U																		
		W16-L		36.6	33.1	3.5	9.5%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R9	W17-L	Studio	35.6	32.3	3.2	9.1%													
		W17-U																		
		W18-L		36.6	33.6	3.1	8.3%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R10	W19-L	Studio	35.6	32.7	2.9	8.2%													
		W19-U																		
		W20-L		36.7	34.0	2.7	7.4%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R11	W21-L	Studio	35.9	33.4	2.5	7.0%													
		W21-U																		
		W22-L		36.7	34.4	2.3	6.4%													
		W22-U																		
		W23-L		35.8	33.6	2.3	6.3%													
		W23-U																		
		W24-L		36.8	34.7	2.1	5.7%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R1	W1-L	Kitchen	30.4	30.4	0.0	0.0%													
		W1-U																		
		W2-L		37.2	33.7	3.5	9.5%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	51	16	51	16	0.0%	0.0%
Fifteenth	R2	W3-L	Bedroom	33.9	30.2	3.7	10.8%													
		W3-U																		
		W4-L		35.0	31.3	3.7	10.6%													
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W5-L	Bedroom	33.8	29.9	3.9	11.5%													
		W5-U																		
		W6-L		34.9	30.9	3.9	11.3%													
		W6-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W7-L	Bedroom	33.9	29.8	4.1	12.2%													
		W7-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W8-L		35.2	31.0	4.2	11.9%												
		W8-U						10.1	10.0	99%	9.6	96%	0.4	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W9-L	Studio	33.9	29.6	4.3	12.8%												
		W9-U																	
		W10-L		35.2	30.8	4.4	12.6%												
		W10-U						14.9	14.6	98%	12.9	87%	1.6	11.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R6	W11-L	Studio	34.6	30.0	4.6	13.4%												
		W11-U																	
		W12-L		35.7	31.0	4.7	13.0%												
		W12-U						14.1	13.6	97%	13.5	96%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W13-L	Studio	34.7	29.9	4.8	14.0%												
		W13-U																	
		W14-L		35.7	30.9	4.8	13.5%												
		W14-U						14.7	13.8	94%	12.0	82%	1.8	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R8	W15-L	Studio	35.7	32.4	3.3	9.2%												
		W15-U																	
		W16-L		36.7	33.5	3.2	8.6%												
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R9	W17-L	Studio	35.7	32.7	2.9	8.2%												
		W17-U																	
		W18-L		36.8	34.0	2.8	7.5%												
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R10	W19-L	Studio	35.8	33.1	2.6	7.4%												
		W19-U																	
		W20-L		36.9	34.4	2.4	6.6%												
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R11	W21-L	Studio	36.1	33.8	2.3	6.3%												
		W21-U																	
		W22-L		36.9	34.7	2.1	5.8%												
		W22-U																	
		W23-L		36.0	33.9	2.0	5.7%												
		W23-U																	
		W24-L		36.9	35.1	1.9	5.1%												
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R1	W1-L	Kitchen	31.0	31.0	0.0	0.0%												
		W1-U																	
		W2-L		35.7	32.6	3.2	8.8%												
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	49	16	49	16	0.0%	0.0%
Sixteenth	R2	W3-L	Bedroom	33.8	30.5	3.3	9.7%												
		W3-U																	
		W4-L		34.8	31.5	3.3	9.5%												
		W4-U						10.0	9.9	99%	9.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W5-L	Bedroom	33.7	30.2	3.5	10.3%												
		W5-U																	
		W6-L		34.7	31.2	3.5	10.1%												
		W6-U						10.0	9.9	99%	9.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixteenth	R4	W7-L	Bedroom	33.8	30.1	3.7	10.9%												
		W7-U																	
		W8-L		34.9	31.2	3.7	10.7%												
		W8-U						10.1	10.0	99%	9.7	96%	0.3	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W9-L	Studio	33.8	29.9	3.9	11.4%												
		W9-U																	
		W10-L		35.0	31.0	4.0	11.3%												
		W10-U						14.9	14.4	96%	12.9	86%	1.5	10.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R6	W11-L	Studio	34.6	30.5	4.1	12.0%												
		W11-U																	
		W12-L		35.6	31.5	4.2	11.6%												
		W12-U						14.1	13.5	96%	13.4	95%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W13-L	Studio	34.7	30.4	4.3	12.5%												
		W13-U																	
		W14-L		35.7	31.4	4.3	12.1%												
		W14-U						14.7	13.6	92%	11.9	81%	1.7	12.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R8	W15-L	Studio	35.7	32.7	2.9	8.2%												
		W15-U																	
		W16-L		36.7	33.8	2.8	7.7%												
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R9	W17-L	Studio	35.7	33.1	2.6	7.3%												
		W17-U																	
		W18-L		36.7	34.3	2.5	6.7%												
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R10	W19-L	Studio	35.8	33.4	2.4	6.6%												
		W19-U																	
		W20-L		36.8	34.7	2.2	5.9%												
		W20-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R11	W21-L	Studio	36.0	34.0	2.0	5.6%												
		W21-U																	
		W22-L		36.8	35.0	1.9	5.1%												
		W22-U																	
		W23-L		36.0	34.1	1.8	5.1%												
		W23-U																	
		W24-L		36.9	35.3	1.7	4.5%												
		W24-U						16.8	16.1	96%	16.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R1	W1-L	Kitchen	32.0	32.0	0.0	0.0%												
		W1-U																	
		W2-L		37.7	34.9	2.8	7.3%												
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	55	18	55	18	0.0%	0.0%
Seventeenth	R2	W3-L	Bedroom	34.2	31.4	2.9	8.3%												
		W3-U																	
		W4-L		35.3	32.4	2.9	8.2%												
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W5-L	Bedroom	34.1	31.1	3.0	8.9%												
		W5-U																	
		W6-L		35.2	32.1	3.1	8.8%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W6-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R4	W7-L	Bedroom	34.2	31.0	3.2	9.4%													
		W7-U																		
		W8-L		35.4	32.2	3.3	9.2%													
		W8-U						10.1	10.0	99%	10.0	99%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W9-L	Studio	34.3	30.9	3.4	9.9%													
		W9-U																		
		W10-L		35.5	32.0	3.5	9.8%													
		W10-U						14.9	14.6	98%	13.4	90%	1.2	8.3%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R6	W11-L	Studio	34.9	31.3	3.6	10.4%													
		W11-U																		
		W12-L		35.9	32.3	3.7	10.2%													
		W12-U						14.1	13.6	97%	13.6	96%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R7	W13-L	Studio	35.0	31.2	3.8	10.9%													
		W13-U																		
		W14-L		36.0	32.2	3.8	10.6%													
		W14-U						14.7	13.8	94%	12.4	84%	1.4	10.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R8	W15-L	Studio	35.8	33.2	2.6	7.2%													
		W15-U																		
		W16-L		36.8	34.3	2.5	6.7%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R9	W17-L	Studio	35.8	33.5	2.3	6.4%													
		W17-U																		
		W18-L		36.9	34.7	2.2	5.8%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R10	W19-L	Studio	35.9	33.8	2.1	5.7%													
		W19-U																		
		W20-L		37.0	35.1	1.9	5.1%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R11	W21-L	Studio	36.2	34.4	1.8	4.9%													
		W21-U																		
		W22-L		37.0	35.3	1.7	4.5%													
		W22-U																		
		W23-L		36.1	34.5	1.6	4.4%													
		W23-U																		
		W24-L		37.1	35.6	1.5	3.9%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R1	W1-L	Kitchen	32.6	32.6	0.0	0.0%													
		W1-U																		
		W2-L		37.7	35.4	2.4	6.2%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	55	18	55	18	0.0%	0.0%
Eighteenth	R2	W3-L	Bedroom	34.4	31.9	2.4	7.1%													
		W3-U																		
		W4-L		35.5	33.0	2.5	7.0%													
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R3	W5-L	Bedroom	34.3	31.7	2.6	7.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U																		
		W6-L		35.3	32.7	2.6	7.4%													
		W6-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R4	W7-L	Bedroom	34.4	31.6	2.8	8.0%													
		W7-U																		
		W8-L		35.6	32.8	2.8	7.9%													
		W8-U						10.1	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R5	W9-L	Studio	34.4	31.5	2.9	8.4%													
		W9-U																		
		W10-L		35.6	32.6	3.0	8.3%													
		W10-U						14.9	14.6	98%	13.7	92%	0.9	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R6	W11-L	Studio	35.1	31.9	3.1	8.9%													
		W11-U																		
		W12-L		36.0	32.9	3.1	8.7%													
		W12-U						14.1	13.6	97%	13.6	96%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W13-L	Studio	35.1	31.8	3.3	9.3%													
		W13-U																		
		W14-L		36.1	32.8	3.3	9.1%													
		W14-U						14.7	13.8	94%	12.8	87%	1.0	7.3%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R8	W15-L	Studio	35.8	33.6	2.2	6.1%													
		W15-U																		
		W16-L		36.8	34.7	2.1	5.7%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R9	W17-L	Studio	35.8	33.8	2.0	5.5%													
		W17-U																		
		W18-L		36.9	35.0	1.8	5.0%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R10	W19-L	Studio	35.9	34.1	1.8	4.9%													
		W19-U																		
		W20-L		37.0	35.4	1.6	4.4%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R11	W21-L	Studio	36.2	34.7	1.5	4.2%													
		W21-U																		
		W22-L		37.0	35.6	1.4	3.8%													
		W22-U																		
		W23-L		36.1	34.7	1.4	3.7%													
		W23-U																		
		W24-L		37.1	35.8	1.2	3.3%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R1	W1-L	Kitchen	32.9	32.9	0.0	0.0%													
		W1-U																		
		W2-L		36.2	34.2	1.9	5.4%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Nineteenth	R2	W3-L	Bedroom	34.2	32.2	2.0	5.9%													
		W3-U																		
		W4-L		35.3	33.2	2.0	5.8%													
		W4-U						10.0	9.9	99%	9.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Nineteenth	R3	W5-L	Bedroom	34.1	32.0	2.1	6.3%													
		W5-U																		
		W6-L		35.1	32.9	2.2	6.2%													
		W6-U						10.0	9.9	99%	9.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R4	W7-L	Bedroom	34.2	31.9	2.3	6.6%													
		W7-U																		
		W8-L		35.3	33.0	2.3	6.5%													
		W8-U						10.1	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R5	W9-L	Studio	34.2	31.8	2.4	7.0%													
		W9-U																		
		W10-L		35.4	32.9	2.5	7.0%													
		W10-U						14.9	14.4	96%	14.0	94%	0.4	2.8%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R6	W11-L	Studio	35.0	32.4	2.6	7.4%													
		W11-U																		
		W12-L		36.0	33.4	2.6	7.2%													
		W12-U						14.1	13.5	96%	13.5	96%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R7	W13-L	Studio	35.1	32.4	2.7	7.7%													
		W13-U																		
		W14-L		36.0	33.3	2.7	7.5%													
		W14-U						14.7	13.6	92%	13.2	89%	0.4	3.2%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R8	W15-L	Studio	35.7	33.9	1.8	5.1%													
		W15-U																		
		W16-L		36.7	34.9	1.7	4.7%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R9	W17-L	Studio	35.7	34.1	1.6	4.5%													
		W17-U																		
		W18-L		36.8	35.2	1.5	4.1%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R10	W19-L	Studio	35.8	34.3	1.4	4.0%													
		W19-U																		
		W20-L		36.9	35.5	1.3	3.6%													
		W20-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R11	W21-L	Studio	36.1	34.8	1.2	3.4%													
		W21-U																		
		W22-L		36.9	35.7	1.2	3.2%													
		W22-U																		
		W23-L		36.0	34.9	1.1	3.1%													
		W23-U																		
		W24-L		37.0	35.9	1.0	2.8%													
		W24-U						16.8	16.1	96%	16.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R1	W1-L	Kitchen	33.8	33.8	0.0	0.0%													
		W1-U																		
		W2-L		38.2	36.6	1.5	4.0%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	55	18	55	18	0.0%	0.0%
Twentieth	R2	W3-L	Bedroom	34.7	33.1	1.6	4.6%													
		W3-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W4-L		35.8	34.2	1.6	4.5%													
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R3	W5-L	Bedroom	34.6	32.9	1.7	4.9%													
		W5-U																		
		W6-L		35.6	33.9	1.7	4.8%													
		W6-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R4	W7-L	Bedroom	34.6	32.8	1.8	5.2%													
		W7-U																		
		W8-L		35.8	34.0	1.8	5.1%													
		W8-U						10.1	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R5	W9-L	Studio	34.7	32.7	1.9	5.5%													
		W9-U																		
		W10-L		35.9	33.9	2.0	5.4%													
		W10-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W11-L	Studio	35.3	33.3	2.1	5.8%													
		W11-U																		
		W12-L		36.3	34.2	2.1	5.7%													
		W12-U						14.1	13.6	97%	13.6	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R7	W13-L	Studio	35.3	33.2	2.2	6.1%													
		W13-U																		
		W14-L		36.3	34.1	2.2	5.9%													
		W14-U						14.7	13.8	94%	13.8	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R8	W15-L	Studio	35.8	34.4	1.4	4.0%													
		W15-U																		
		W16-L		36.8	35.4	1.4	3.8%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R9	W17-L	Studio	35.8	34.5	1.3	3.6%													
		W17-U																		
		W18-L		36.9	35.7	1.2	3.3%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R10	W19-L	Studio	35.9	34.8	1.1	3.2%													
		W19-U																		
		W20-L		37.0	35.9	1.1	2.8%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R11	W21-L	Studio	36.2	35.2	1.0	2.7%													
		W21-U																		
		W22-L		37.0	36.1	0.9	2.5%													
		W22-U																		
		W23-L		36.1	35.2	0.9	2.4%													
		W23-U																		
		W24-L		37.1	36.3	0.8	2.2%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R1	W1-L	Kitchen	34.4	34.4	0.0	0.0%													
		W1-U																		
		W2-L		38.3	37.2	1.1	3.0%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	57	18	57	18	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-First	R2	W3-L	Bedroom	34.8	33.6	1.2	3.4%													
		W3-U																		
		W4-L		35.9	34.7	1.2	3.3%													
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R3	W5-L	Bedroom	34.7	33.5	1.3	3.6%													
		W5-U																		
		W6-L		35.7	34.4	1.3	3.6%													
		W6-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R4	W7-L	Bedroom	34.8	33.4	1.3	3.8%													
		W7-U																		
		W8-L		35.9	34.6	1.4	3.8%													
		W8-U						10.1	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R5	W9-L	Studio	34.8	33.3	1.4	4.1%													
		W9-U																		
		W10-L		36.0	34.5	1.5	4.0%													
		W10-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W11-L	Studio	35.4	33.9	1.5	4.3%													
		W11-U																		
		W12-L		36.4	34.8	1.5	4.2%													
		W12-U						14.1	13.6	97%	13.6	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R7	W13-L	Studio	35.4	33.8	1.6	4.5%													
		W13-U																		
		W14-L		36.4	34.8	1.6	4.4%													
		W14-U						14.7	13.8	94%	13.8	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R8	W15-L	Studio	35.8	34.7	1.1	3.0%													
		W15-U																		
		W16-L		36.8	35.8	1.0	2.8%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R9	W17-L	Studio	35.8	34.9	0.9	2.6%													
		W17-U																		
		W18-L		36.9	36.0	0.9	2.4%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R10	W19-L	Studio	35.9	35.0	0.9	2.4%													
		W19-U																		
		W20-L		37.0	36.2	0.8	2.1%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R11	W21-L	Studio	36.2	35.5	0.7	2.0%													
		W21-U																		
		W22-L		37.0	36.3	0.7	1.8%													
		W22-U																		
		W23-L		36.1	35.4	0.6	1.8%													
		W23-U																		
		W24-L		37.1	36.5	0.6	1.6%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R1	W1-L	Kitchen	34.8	34.8	0.0	0.0%													
		W1-U																		
		W2-L		38.4	37.6	0.8	2.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	58	19	58	19	0.0%	0.0%
Twenty-Secc	R2	W3-L	Bedroom	34.9	34.1	0.8	2.3%													
		W3-U																		
		W4-L		36.0	35.2	0.8	2.2%													
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R3	W5-L	Bedroom	34.8	33.9	0.8	2.4%													
		W5-U																		
		W6-L		35.8	34.9	0.9	2.4%													
		W6-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R4	W7-L	Bedroom	34.8	33.9	0.9	2.6%													
		W7-U																		
		W8-L		36.0	35.1	0.9	2.5%													
		W8-U						10.1	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R5	W9-L	Studio	34.8	33.9	1.0	2.7%													
		W9-U																		
		W10-L		36.0	35.0	1.0	2.7%													
		W10-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R6	W11-L	Studio	35.5	34.5	1.0	2.9%													
		W11-U																		
		W12-L		36.4	35.4	1.0	2.8%													
		W12-U						14.1	13.6	97%	13.6	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R7	W13-L	Studio	35.5	34.4	1.1	3.0%													
		W13-U																		
		W14-L		36.4	35.4	1.1	3.0%													
		W14-U						14.7	13.8	94%	13.8	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R8	W15-L	Studio	35.8	35.1	0.7	2.0%													
		W15-U																		
		W16-L		36.8	36.1	0.7	1.8%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R9	W17-L	Studio	35.8	35.2	0.6	1.8%													
		W17-U																		
		W18-L		36.9	36.3	0.6	1.7%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R10	W19-L	Studio	35.9	35.3	0.6	1.6%													
		W19-U																		
		W20-L		37.0	36.5	0.5	1.4%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R11	W21-L	Studio	36.2	35.7	0.5	1.4%													
		W21-U																		
		W22-L		37.0	36.5	0.5	1.3%													
		W22-U																		
		W23-L		36.1	35.7	0.4	1.2%													
		W23-U																		
		W24-L		37.1	36.7	0.4	1.1%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R1	W1-L	Kitchen	35.3	35.3	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W1-U																		
		W2-L		38.2	37.8	0.4	1.1%													
		W2-U						17.1	17.1	100%	17.1	100%	0.0	0.0%	58	19	58	19	0.0%	0.0%
Twenty-Thir	R2	W3-L	Bedroom	34.9	34.5	0.4	1.3%													
		W3-U																		
		W4-L		36.0	35.6	0.4	1.2%													
		W4-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R3	W5-L	Bedroom	34.8	34.4	0.5	1.3%													
		W5-U																		
		W6-L		35.9	35.4	0.5	1.3%													
		W6-U						10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R4	W7-L	Bedroom	34.9	34.4	0.5	1.4%													
		W7-U																		
		W8-L		36.1	35.6	0.5	1.4%													
		W8-U						10.1	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R5	W9-L	Studio	34.9	34.4	0.5	1.5%													
		W9-U																		
		W10-L		36.1	35.6	0.5	1.5%													
		W10-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R6	W11-L	Studio	35.6	35.0	0.6	1.5%													
		W11-U																		
		W12-L		36.5	36.0	0.6	1.5%													
		W12-U						14.1	13.6	97%	13.6	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R7	W13-L	Studio	35.6	35.0	0.6	1.6%													
		W13-U																		
		W14-L		36.5	35.9	0.6	1.6%													
		W14-U						14.7	13.8	94%	13.8	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R8	W15-L	Studio	35.8	35.4	0.4	1.1%													
		W15-U																		
		W16-L		36.8	36.4	0.4	1.0%													
		W16-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R9	W17-L	Studio	35.8	35.5	0.3	0.9%													
		W17-U																		
		W18-L		36.9	36.6	0.3	0.9%													
		W18-U						14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R10	W19-L	Studio	35.9	35.6	0.3	0.9%													
		W19-U																		
		W20-L		37.0	36.7	0.3	0.8%													
		W20-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R11	W21-L	Studio	36.2	35.9	0.3	0.7%													
		W21-U																		
		W22-L		37.0	36.7	0.3	0.7%													
		W22-U																		
		W23-L		36.1	35.9	0.3	0.7%													
		W23-U																		
		W24-L		37.1	36.9	0.2	0.6%													
		W24-U						16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-Four	R1	W1-L	Residential	20.1	20.1	0.0	0.1%												
		W1-U						73.0	70.3	96%	70.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R2	W2-L	Residential	26.4	26.4	0.0	0.0%												
		W2-U																	
		W3-L		29.0	29.0	0.0	0.0%												
		W3-U						34.6	34.4	100%	34.4	100%	0.0	0.0%	50	17	50	17	0.0%	0.0%
Berol Quarter																			
First	R1	W1-L	Residential	20.4	20.4	0.0	0.0%												
		W1-U																	
		W2-L		33.8	33.8	0.0	0.0%												
		W2-U																	
		W3-L		25.3	25.2	0.1	0.2%												
		W3-U						51.9	51.9	100%	51.9	100%	0.0	0.0%	65	19	62	19	4.6%	0.0%
First	R2	W4-L	Residential	23.6	23.5	0.1	0.3%												
		W4-U																	
		W5-L		21.9	21.9	0.1	0.3%												
		W5-U																	
		W6-L		16.8	16.8	0.1	0.5%												
		W6-U																	
		W7-L		13.3	13.2	0.1	0.7%												
		W7-U																	
		W8-L		11.1	11.0	0.1	1.1%												
		W8-U																	
		W9-L		10.3	10.2	0.1	1.3%												
		W9-U																	
		W10-L		9.8	9.7	0.1	1.4%												
		W10-U																	
		W11-L		20.6	18.7	1.9	9.2%												
		W11-U																	
		W12-L		0.6	0.6	0.0	0.0%												
		W12-U																	
		W13-L		2.1	2.1	0.0	0.0%												
		W13-U																	
		W14-L		4.8	4.8	0.0	0.0%												
		W14-U						160.1	160.1	100%	159.6	100%	0.5	0.3%	68	20	66	20	2.9%	0.0%
First	R3	W15-L	Residential	17.9	15.9	2.1	11.4%												
		W15-U																	
		W16-L		14.3	12.6	1.7	12.1%												
		W16-U																	
		W17-L		15.3	13.8	1.6	10.2%												
		W17-U																	
		W18-L		15.3	14.4	0.9	5.9%												
		W18-U																	
		W19-L		14.6	14.4	0.2	1.2%												
		W19-U																	
		W20-L		13.6	13.6	0.0	0.0%												
		W20-U						165.5	137.2	83%	76.0	46%	61.2	44.6%	30	2	25	0	16.7%	100.0%
First	R4	W21-L	Bedroom	0.0	0.0	0.0	0.0%												
		W21-U						12.0	0.8	6%	0.8	6%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
First	R5	W22-L	LKD	0.0	0.0	0.0	0.0%													
		W22-U																		
		W23-L		0.1	0.1	0.0	0.0%													
		W23-U																		
		W24-L		16.3	16.3	0.0	0.0%													
		W24-U						29.0	4.5	15%	4.5	15%	0.0	0.0%	14	0	14	0	0.0%	0.0%
First	R6	W25-L	Bedroom	16.1	16.1	0.0	0.0%													
		W25-U						14.1	4.0	29%	4.0	29%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W26-L	Bedroom	15.8	15.8	0.0	0.0%													
		W26-U						9.1	3.4	37%	3.4	37%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W27-L	Bedroom	15.6	15.6	0.0	0.0%													
		W27-U																		
		W28-L		0.3	0.3	0.0	0.0%													
		W28-U						12.5	5.6	45%	5.6	45%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W29-L	LKD	0.5	0.5	0.0	0.0%													
		W29-U																		
		W30-L		13.7	13.7	0.0	0.0%													
		W30-U																		
		W31-L		10.6	10.6	0.0	0.0%													
		W31-U						43.7	18.2	41%	18.2	41%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R10	W32-L	Bedroom	2.0	2.0	0.0	0.0%													
		W32-U																		
		W33-L		0.2	0.2	0.0	0.0%													
		W33-U						13.7	4.5	33%	4.5	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W34-L	LKD	0.0	0.0	0.0	0.0%													
		W34-U																		
		W35-L		12.6	12.6	0.0	0.0%													
		W35-U						27.9	8.6	31%	8.6	31%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R12	W36-L	Bedroom	14.6	14.6	0.0	0.0%													
		W36-U						14.5	9.7	67%	9.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W37-L	LKD	16.5	16.5	0.0	0.0%													
		W37-U																		
		W38-L		0.4	0.4	0.0	0.0%													
		W38-U																		
		W39-L		2.0	2.0	0.0	0.0%													
		W39-U						28.6	24.4	85%	24.4	85%	0.0	0.0%	18	2	18	2	0.0%	0.0%
First	R14	W40-L	Bedroom	3.0	3.0	0.0	0.0%													
		W40-U						8.4	8.3	98%	8.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R15	W41-L	Residential	1.1	1.1	0.0	0.0%													
		W41-U						34.8	7.5	21%	7.5	21%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R16	W42-L	LKD	22.3	22.3	0.0	0.0%													
		W42-U																		
		W43-L		23.6	23.6	0.0	0.0%													
		W43-U																		
		W44-L		4.4	4.4	0.0	0.0%													
		W44-U						31.1	28.2	90%	28.2	90%	0.0	0.0%	29	7	29	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R17	W45-L	Bedroom	1.9	1.9	0.0	0.0%												
		W45-U																	
		W46-L		27.2	27.2	0.0	0.0%												
		W46-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	52	8	52	8	0.0%	0.0%
Second	R1	W1-L	LKD	4.3	4.3	0.0	0.0%												
		W1-U																	
		W2-L		20.7	20.7	0.0	0.0%												
		W2-U																	
		W3-L		34.6	34.6	0.0	0.0%												
		W3-U																	
		W4-L		34.6	34.6	0.0	0.0%												
		W4-U																	
		W5-L		4.2	4.2	0.0	0.0%												
		W5-U						30.1	28.9	96%	28.9	96%	0.0	0.0%	56	17	56	17	0.0%	0.0%
Second	R2	W6-L	Studio	22.6	22.5	0.1	0.3%												
		W6-U																	
		W7-L		0.5	0.5	0.0	0.0%												
		W7-U																	
		W8-L		0.7	0.7	0.0	0.0%												
		W8-U																	
		W9-L		1.4	1.4	0.0	0.0%												
		W9-U																	
		W10-L		5.1	5.1	0.0	0.0%												
		W10-U						34.9	31.3	90%	31.3	90%	0.0	0.0%	55	18	52	18	5.5%	0.0%
Second	R3	W11-L	Bedroom	11.7	11.6	0.1	1.0%												
		W11-U																	
		W12-L		1.3	0.9	0.4	32.3%												
		W12-U						14.3	10.3	72%	10.3	72%	0.1	0.7%	36	3	33	3	8.3%	0.0%
Second	R4	W13-L	LKD	0.4	0.2	0.2	55.3%												
		W13-U																	
		W14-L		22.4	20.6	1.8	8.0%												
		W14-U																	
		W15-L		22.4	20.6	1.8	7.9%												
		W15-U																	
		W16-L		0.7	0.7	0.0	0.0%												
		W16-U						36.9	30.8	83%	29.5	80%	1.3	4.1%	11	0	8	0	27.3%	0.0%
Second	R5	W17-L	Bedroom	3.0	1.9	1.1	36.8%												
		W17-U																	
		W18-L		1.1	1.1	0.0	0.0%												
		W18-U						19.0	17.8	94%	15.9	84%	1.9	10.6%	4	0	2	0	50.0%	0.0%
Second	R6	W19-L	LKD	0.0	0.0	0.0	0.0%												
		W19-U																	
		W20-L		15.6	14.1	1.6	10.0%												
		W20-U						44.2	28.5	65%	24.2	55%	4.4	15.3%	12	0	10	0	16.7%	0.0%
Second	R7	W21-L	Bedroom	17.4	15.7	1.6	9.3%												
		W21-U						14.2	11.3	80%	11.0	77%	0.3	2.8%	20	1	18	0	10.0%	100.0%
Second	R8	W22-L	LKD	17.9	16.7	1.2	6.8%												
		W22-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W23-L		0.3	0.3	0.0	0.0%													
		W23-U						29.7	13.9	47%	12.9	43%	1.1	7.7%	25	1	23	0	8.0%	100.0%
Second	R9	W24-L	Bedroom	0.3	0.3	0.0	0.0%													
		W24-U																		
		W25-L		16.4	16.2	0.2	1.2%													
		W25-U						9.0	5.8	64%	5.5	61%	0.2	3.9%	14	0	14	0	0.0%	0.0%
Second	R10	W26-L	Bedroom	0.5	0.5	0.0	0.0%													
		W26-U						12.0	1.8	15%	1.8	15%	0.0	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W27-L	LKD	1.0	0.6	0.3	34.4%													
		W27-U																		
		W28-L		0.2	0.2	0.0	0.0%													
		W28-U																		
		W29-L		21.7	21.4	0.3	1.6%													
		W29-U						29.0	8.7	30%	8.7	30%	0.0	0.5%	19	0	18	0	5.3%	0.0%
Second	R12	W30-L	Bedroom	21.2	21.0	0.1	0.7%													
		W30-U						14.1	6.8	48%	6.0	43%	0.7	11.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W31-L	Bedroom	20.8	20.8	0.0	0.0%													
		W31-U						9.1	5.2	57%	5.2	57%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W32-L	Bedroom	20.6	20.6	0.0	0.0%													
		W32-U																		
		W33-L		0.7	0.7	0.0	0.0%													
		W33-U						12.5	5.9	47%	5.9	47%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R15	W34-L	LKD	0.8	0.8	0.0	0.0%													
		W34-U																		
		W35-L		16.3	16.3	0.0	0.0%													
		W35-U																		
		W36-L		13.0	13.0	0.0	0.0%													
		W36-U						43.7	21.4	49%	21.4	49%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R16	W37-L	Bedroom	2.9	2.9	0.0	0.0%													
		W37-U																		
		W38-L		0.5	0.5	0.0	0.0%													
		W38-U						13.7	5.0	36%	5.0	36%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R17	W39-L	LKD	0.0	0.0	0.0	0.0%													
		W39-U																		
		W40-L		14.0	14.0	0.0	0.0%													
		W40-U						27.9	9.0	32%	9.0	32%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R18	W41-L	Bedroom	16.1	16.1	0.0	0.0%													
		W41-U						14.5	9.8	68%	9.8	68%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R19	W42-L	LKD	18.0	18.0	0.0	0.0%													
		W42-U																		
		W43-L		0.4	0.4	0.0	0.0%													
		W43-U																		
		W44-L		3.5	3.5	0.0	0.0%													
		W44-U						29.8	27.7	93%	27.7	93%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Second	R20	W45-L	Bedroom	1.4	1.4	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W45-U						12.4	7.1	58%	7.1	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R21	W46-L	LKD	23.8	23.8	0.0	0.0%													
		W46-U																		
		W47-L		25.9	25.9	0.0	0.0%													
		W47-U																		
		W48-L		4.9	4.9	0.0	0.0%													
		W48-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	30	7	30	7	0.0%	0.0%
Second	R22	W49-L	Bedroom	2.6	2.6	0.0	0.0%													
		W49-U																		
		W50-L		29.7	29.7	0.0	0.0%													
		W50-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	58	11	58	11	0.0%	0.0%
Third	R1	W1-L	LKD	4.7	4.7	0.0	0.0%													
		W1-U																		
		W2-L		21.1	21.1	0.0	0.0%													
		W2-U																		
		W3-L		35.2	35.2	0.0	0.0%													
		W3-U																		
		W4-L		35.2	35.2	0.0	0.0%													
		W4-U																		
		W5-L		4.3	4.3	0.0	0.0%													
		W5-U						30.1	29.0	96%	29.0	96%	0.0	0.0%	57	18	57	18	0.0%	0.0%
Third	R2	W6-L	Studio	23.2	23.2	0.1	0.3%													
		W6-U																		
		W7-L		0.6	0.6	0.0	0.0%													
		W7-U																		
		W8-L		0.7	0.7	0.0	0.0%													
		W8-U																		
		W9-L		1.6	1.6	0.0	0.0%													
		W9-U																		
		W10-L		5.4	5.4	0.0	0.0%													
		W10-U						34.9	31.3	90%	31.3	90%	0.0	0.0%	56	18	52	18	7.1%	0.0%
Third	R3	W11-L	Bedroom	13.4	13.2	0.1	1.0%													
		W11-U																		
		W12-L		1.5	1.1	0.4	28.3%													
		W12-U						14.3	11.0	77%	10.9	76%	0.0	0.2%	41	6	37	6	9.8%	0.0%
Third	R4	W13-L	LKD	0.5	0.3	0.2	42.6%													
		W13-U																		
		W14-L		23.4	21.7	1.7	7.3%													
		W14-U																		
		W15-L		23.5	21.8	1.7	7.3%													
		W15-U																		
		W16-L		0.8	0.8	0.0	0.0%													
		W16-U						36.9	32.0	87%	30.9	84%	1.1	3.4%	13	0	10	0	23.1%	0.0%
Third	R5	W17-L	Bedroom	3.6	2.4	1.2	33.6%													
		W17-U																		
		W18-L		1.2	1.2	0.0	0.0%													
		W18-U						19.0	17.8	94%	17.4	92%	0.4	2.2%	6	0	3	0	50.0%	0.0%
Third	R6	W19-L	LKD	0.0	0.0	0.0	0.0%													
		W19-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W20-L		16.7	15.3	1.5	8.8%													
		W20-U						44.2	30.1	68%	28.3	64%	1.7	5.8%	16	0	14	0	12.5%	0.0%
Third	R7	W21-L	Bedroom	19.0	17.4	1.6	8.6%													
		W21-U						14.2	11.4	80%	11.2	79%	0.1	0.9%	26	1	23	0	11.5%	100.0%
Third	R8	W22-L	LKD	20.0	18.6	1.5	7.4%													
		W22-U																		
		W23-L		1.0	1.0	0.0	0.0%													
		W23-U						29.7	14.2	48%	14.1	47%	0.1	1.0%	33	2	31	1	6.1%	50.0%
Third	R9	W24-L	Bedroom	0.8	0.8	0.0	0.0%													
		W24-U																		
		W25-L		20.5	19.9	0.6	3.0%													
		W25-U						9.0	7.6	84%	7.6	84%	0.0	0.1%	18	1	18	1	0.0%	0.0%
Third	R10	W26-L	Bedroom	2.3	2.3	0.0	0.9%													
		W26-U						12.0	7.1	59%	7.1	59%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W27-L	LKD	2.8	1.8	1.0	36.0%													
		W27-U																		
		W28-L		0.4	0.4	0.0	2.7%													
		W28-U																		
		W29-L		27.1	26.0	1.0	3.8%													
		W29-U						29.0	22.4	77%	21.5	74%	0.9	3.9%	24	2	24	2	0.0%	0.0%
Third	R12	W30-L	Bedroom	26.5	26.0	0.5	1.8%													
		W30-U						14.1	10.7	76%	9.6	68%	1.1	10.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W31-L	Bedroom	26.1	25.9	0.2	0.8%													
		W31-U						9.1	8.1	89%	8.1	89%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W32-L	Bedroom	26.0	25.8	0.2	0.7%													
		W32-U																		
		W33-L		1.1	1.1	0.0	0.0%													
		W33-U						12.5	10.0	80%	10.0	80%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R15	W34-L	LKD	1.4	1.3	0.1	4.3%													
		W34-U																		
		W35-L		18.9	18.9	0.0	0.0%													
		W35-U																		
		W36-L		15.3	15.3	0.0	0.0%													
		W36-U						43.7	25.4	58%	25.4	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R16	W37-L	Bedroom	3.9	3.9	0.0	0.0%													
		W37-U																		
		W38-L		0.6	0.6	0.0	0.0%													
		W38-U						13.7	5.1	37%	5.1	37%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R17	W39-L	LKD	0.2	0.2	0.0	0.0%													
		W39-U																		
		W40-L		15.6	15.6	0.0	0.0%													
		W40-U						27.9	9.5	34%	9.5	34%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R18	W41-L	Bedroom	17.7	17.7	0.0	0.0%													
		W41-U						14.5	9.9	69%	9.9	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Third	R19	W42-L	LKD	19.4	19.4	0.0	0.0%													
		W42-U																		
		W43-L		0.4	0.4	0.0	0.0%													
		W43-U																		
		W44-L		3.7	3.7	0.0	0.0%													
		W44-U						29.8	27.9	94%	27.9	94%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Third	R20	W45-L	Bedroom	1.4	1.4	0.0	0.0%													
		W45-U						12.4	7.1	57%	7.1	57%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R21	W46-L	LKD	24.8	24.8	0.0	0.0%													
		W46-U																		
		W47-L		26.8	26.8	0.0	0.0%													
		W47-U																		
		W48-L		5.2	5.2	0.0	0.0%													
		W48-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	31	7	31	7	0.0%	0.0%
Third	R22	W49-L	Bedroom	2.8	2.8	0.0	0.0%													
		W49-U																		
		W50-L		31.4	31.4	0.0	0.0%													
		W50-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	63	14	63	14	0.0%	0.0%
Fourth	R1	W1-L	LKD	4.9	4.9	0.0	0.0%													
		W1-U																		
		W2-L		21.5	21.5	0.0	0.0%													
		W2-U																		
		W3-L		35.9	35.9	0.0	0.0%													
		W3-U																		
		W4-L		35.9	35.9	0.0	0.0%													
		W4-U																		
		W5-L		4.5	4.5	0.0	0.0%													
		W5-U						30.1	29.0	96%	29.0	96%	0.0	0.0%	57	18	57	18	0.0%	0.0%
Fourth	R2	W6-L	Studio	24.0	23.9	0.1	0.2%													
		W6-U																		
		W7-L		0.7	0.7	0.0	0.0%													
		W7-U																		
		W8-L		1.1	1.1	0.0	0.0%													
		W8-U																		
		W9-L		1.7	1.7	0.0	0.0%													
		W9-U																		
		W10-L		5.5	5.5	0.0	0.0%													
		W10-U						34.9	32.5	93%	32.5	93%	0.0	0.0%	56	18	52	18	7.1%	0.0%
Fourth	R3	W11-L	Bedroom	15.2	15.1	0.1	0.9%													
		W11-U																		
		W12-L		1.7	1.3	0.4	21.7%													
		W12-U						14.3	11.3	79%	11.3	79%	0.0	0.1%	45	8	41	8	8.9%	0.0%
Fourth	R4	W13-L	LKD	0.5	0.3	0.2	36.5%													
		W13-U																		
		W14-L		24.2	22.6	1.6	6.6%													
		W14-U																		
		W15-L		24.5	22.8	1.7	6.8%													
		W15-U																		
		W16-L		0.9	0.9	0.0	0.0%													
		W16-U						36.9	32.3	88%	32.2	87%	0.1	0.2%	14	0	11	0	21.4%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fourth	R5	W17-L	Bedroom	4.1	2.7	1.4	33.5%													
		W17-U																		
		W18-L		1.3	1.3	0.0	0.0%													
		W18-U						19.0	17.9	94%	17.8	94%	0.1	0.7%	6	0	3	0	50.0%	0.0%
Fourth	R6	W19-L	LKD	0.0	0.0	0.0	0.0%													
		W19-U																		
		W20-L		18.1	16.7	1.4	7.7%													
		W20-U						44.2	30.8	70%	29.9	68%	0.9	3.0%	20	0	18	0	10.0%	0.0%
Fourth	R7	W21-L	Bedroom	20.6	19.0	1.6	7.5%													
		W21-U						14.2	11.4	81%	11.4	80%	0.0	0.2%	34	2	32	1	5.9%	50.0%
Fourth	R8	W22-L	LKD	21.7	20.1	1.6	7.6%													
		W22-U																		
		W23-L		2.1	1.8	0.2	10.2%													
		W23-U						29.7	14.8	50%	14.7	50%	0.1	0.5%	39	3	37	2	5.1%	33.3%
Fourth	R9	W24-L	Bedroom	1.3	1.3	0.1	6.0%													
		W24-U																		
		W25-L		23.9	22.7	1.2	5.1%													
		W25-U						9.0	7.6	85%	7.6	84%	0.0	0.1%	22	3	21	2	4.5%	33.3%
Fourth	R10	W26-L	Bedroom	4.7	4.4	0.3	6.7%													
		W26-U						12.0	11.2	93%	11.2	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W27-L	LKD	4.1	2.4	1.7	41.9%													
		W27-U																		
		W28-L		0.5	0.5	0.0	2.0%													
		W28-U																		
		W29-L		31.7	30.1	1.6	5.2%													
		W29-U						29.0	24.6	85%	24.5	85%	0.0	0.1%	30	3	30	3	0.0%	0.0%
Fourth	R12	W30-L	Bedroom	31.5	30.2	1.3	4.1%													
		W30-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R13	W31-L	Bedroom	31.2	30.2	1.0	3.1%													
		W31-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W32-L	Bedroom	31.1	30.2	0.9	2.8%													
		W32-U																		
		W33-L		1.3	1.3	0.0	0.0%													
		W33-U						12.5	12.3	99%	12.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R15	W34-L	LKD	3.8	3.3	0.4	11.7%													
		W34-U																		
		W35-L		21.6	21.6	0.0	0.0%													
		W35-U																		
		W36-L		18.1	18.1	0.0	0.0%													
		W36-U						43.7	29.2	67%	29.2	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R16	W37-L	Bedroom	5.3	5.3	0.0	0.0%													
		W37-U																		
		W38-L		0.7	0.7	0.0	0.0%													
		W38-U						13.7	5.5	40%	5.5	40%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R17	W39-L	LKD	0.3	0.3	0.0	0.0%													
		W39-U																		
		W40-L		17.8	17.8	0.0	0.0%													
		W40-U						27.9	10.4	37%	10.4	37%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R18	W41-L	Bedroom	19.6	19.6	0.0	0.0%													
		W41-U						14.5	10.2	71%	10.2	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R19	W42-L	LKD	21.1	21.1	0.0	0.0%													
		W42-U																		
		W43-L		0.5	0.5	0.0	0.0%													
		W43-U																		
		W44-L		3.8	3.8	0.0	0.0%													
		W44-U						29.8	27.9	94%	27.9	94%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Fourth	R20	W45-L	Bedroom	1.4	1.4	0.0	0.0%													
		W45-U						12.4	7.1	57%	7.1	57%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R21	W46-L	LKD	25.9	25.9	0.0	0.0%													
		W46-U																		
		W47-L		27.8	27.8	0.0	0.0%													
		W47-U																		
		W48-L		5.6	5.6	0.0	0.0%													
		W48-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	31	7	31	7	0.0%	0.0%
Fourth	R22	W49-L	Bedroom	2.9	2.9	0.0	0.0%													
		W49-U																		
		W50-L		33.2	33.2	0.0	0.0%													
		W50-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	65	16	65	16	0.0%	0.0%
Fifth	R1	W1-L	LKD	5.2	5.2	0.0	0.0%													
		W1-U																		
		W2-L		22.0	22.0	0.0	0.0%													
		W2-U																		
		W3-L		36.6	36.6	0.0	0.0%													
		W3-U																		
		W4-L		36.6	36.6	0.0	0.0%													
		W4-U																		
		W5-L		4.7	4.7	0.0	0.0%													
		W5-U						30.1	29.0	96%	29.0	96%	0.0	0.0%	57	18	57	18	0.0%	0.0%
Fifth	R2	W6-L	Studio	24.9	24.8	0.1	0.2%													
		W6-U																		
		W7-L		0.8	0.8	0.0	0.0%													
		W7-U																		
		W8-L		1.7	1.7	0.0	0.0%													
		W8-U																		
		W9-L		1.8	1.8	0.0	0.0%													
		W9-U																		
		W10-L		5.6	5.6	0.0	0.0%													
		W10-U						34.9	32.6	93%	32.6	93%	0.0	0.0%	59	18	56	18	5.1%	0.0%
Fifth	R3	W11-L	Bedroom	17.0	16.9	0.1	0.8%													
		W11-U																		
		W12-L		1.7	1.5	0.2	12.9%													
		W12-U						14.3	11.3	79%	11.3	79%	0.0	0.1%	47	9	43	9	8.5%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifth	R4	W13-L	LKD	0.6	0.4	0.2	32.1%												
		W13-U																	
		W14-L		24.9	23.5	1.3	5.4%												
		W14-U																	
		W15-L		25.1	23.7	1.4	5.5%												
		W15-U																	
		W16-L		1.0	1.0	0.0	0.0%												
		W16-U						36.9	32.3	88%	32.3	88%	0.0	0.0%	15	0	12	0	20.0%	0.0%
Fifth	R5	W17-L	Bedroom	4.2	3.1	1.2	27.5%												
		W17-U																	
		W18-L		1.3	1.3	0.0	0.0%												
		W18-U						19.0	17.9	94%	17.8	94%	0.1	0.5%	7	0	4	0	42.9%	0.0%
Fifth	R6	W19-L	LKD	0.0	0.0	0.0	0.0%												
		W19-U																	
		W20-L		20.7	19.6	1.1	5.4%												
		W20-U						44.2	31.7	72%	30.8	70%	0.8	2.6%	32	1	30	1	6.3%	0.0%
Fifth	R7	W21-L	Bedroom	22.0	20.8	1.2	5.6%												
		W21-U						14.2	11.5	81%	11.4	81%	0.0	0.1%	39	4	38	4	2.6%	0.0%
Fifth	R8	W22-L	LKD	22.9	21.7	1.3	5.6%												
		W22-U																	
		W23-L		2.5	2.3	0.2	6.0%												
		W23-U						29.7	15.3	52%	15.3	52%	0.0	0.1%	43	7	42	7	2.3%	0.0%
Fifth	R9	W24-L	Bedroom	1.6	1.6	0.0	2.5%												
		W24-U																	
		W25-L		24.9	23.8	1.2	4.7%												
		W25-U						9.0	7.6	85%	7.6	85%	0.0	0.1%	23	3	23	3	0.0%	0.0%
Fifth	R10	W26-L	Bedroom	5.6	5.4	0.2	3.6%												
		W26-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W27-L	LKD	4.4	2.8	1.6	36.7%												
		W27-U																	
		W28-L		0.7	0.6	0.0	1.5%												
		W28-U																	
		W29-L		33.9	32.2	1.7	4.9%												
		W29-U						29.0	24.6	85%	24.6	85%	0.0	0.0%	30	3	30	3	0.0%	0.0%
Fifth	R12	W30-L	Bedroom	34.0	32.4	1.6	4.7%												
		W30-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W31-L	Bedroom	34.1	32.5	1.5	4.5%												
		W31-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W32-L	Bedroom	34.0	32.5	1.5	4.4%												
		W32-U																	
		W33-L		1.4	1.4	0.0	0.0%												
		W33-U						12.5	12.3	99%	12.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R15	W34-L	LKD	5.2	4.4	0.7	14.3%												
		W34-U																	
		W35-L		24.7	24.7	0.0	0.0%												
		W35-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W36-L		21.8	21.8	0.0	0.0%													
		W36-U						43.7	31.0	71%	31.0	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R16	W37-L	Bedroom	7.2	7.2	0.0	0.0%													
		W37-U																		
		W38-L		0.9	0.9	0.0	0.0%													
		W38-U						13.7	6.7	49%	6.7	49%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R17	W39-L	LKD	1.2	1.2	0.0	0.0%													
		W39-U																		
		W40-L		20.4	20.4	0.0	0.0%													
		W40-U						27.9	11.4	41%	11.4	41%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R18	W41-L	Bedroom	21.9	21.9	0.0	0.0%													
		W41-U						14.5	10.8	75%	10.8	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R19	W42-L	LKD	23.0	23.0	0.0	0.0%													
		W42-U																		
		W43-L		0.5	0.5	0.0	0.0%													
		W43-U																		
		W44-L		4.0	4.0	0.0	0.0%													
		W44-U						29.8	28.3	95%	28.3	95%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Fifth	R20	W45-L	Bedroom	1.4	1.4	0.0	0.0%													
		W45-U						12.4	7.3	59%	7.3	59%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R21	W46-L	LKD	27.1	27.1	0.0	0.0%													
		W46-U																		
		W47-L		28.9	28.9	0.0	0.0%													
		W47-U																		
		W48-L		5.9	5.9	0.0	0.0%													
		W48-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	31	7	31	7	0.0%	0.0%
Fifth	R22	W49-L	Bedroom	3.0	3.0	0.0	0.0%													
		W49-U																		
		W50-L		34.9	34.9	0.0	0.0%													
		W50-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	70	21	70	21	0.0%	0.0%
Sixth	R1	W1-L	LKD	34.1	34.1	0.0	0.0%													
		W1-U																		
		W2-L		33.0	33.0	0.0	0.0%													
		W2-U																		
		W3-L		2.4	2.4	0.0	0.4%													
		W3-U						32.1	28.6	89%	28.6	89%	0.0	0.0%	63	15	63	15	0.0%	0.0%
Sixth	R2	W4-L	Bedroom	1.5	1.5	0.0	0.0%													
		W4-U																		
		W5-L		22.6	21.8	0.8	3.5%													
		W5-U						12.8	12.5	98%	12.5	98%	0.0	0.0%	40	7	37	7	7.5%	0.0%
Sixth	R3	W6-L	Bedroom	23.0	22.1	0.8	3.7%													
		W6-U						13.4	12.9	97%	12.9	96%	0.0	0.0%	42	6	40	6	4.8%	0.0%
Sixth	R4	W7-L	Bedroom	23.5	22.6	0.9	4.0%													
		W7-U						14.2	11.7	83%	11.7	83%	0.0	0.0%	45	8	44	8	2.2%	0.0%
Sixth	R5	W8-L	LKD	24.2	23.3	1.0	4.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W8-U																	
		W9-L		2.7	2.7	0.0	0.0%												
		W9-U																	
		W10-L		3.2	2.3	0.9	27.0%												
		W10-U						29.7	25.9	87%	24.5	82%	1.5	5.6%	47	10	46	10	2.1%	0.0%
Sixth	R6	W11-L	Bedroom	2.9	2.9	0.0	0.0%												
		W11-U																	
		W12-L		25.6	24.8	0.8	3.3%												
		W12-U						9.0	7.7	85%	7.7	85%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Sixth	R7	W13-L	Bedroom	5.7	5.7	0.0	0.0%												
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W14-L	LKD	4.3	3.0	1.3	30.3%												
		W14-U																	
		W15-L		0.8	0.8	0.0	1.3%												
		W15-U																	
		W16-L		35.0	33.6	1.4	3.9%												
		W16-U						29.0	24.9	86%	24.9	86%	0.0	0.0%	32	4	32	4	0.0%	0.0%
Sixth	R9	W17-L	Bedroom	35.1	33.8	1.3	3.8%												
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W18-L	Bedroom	35.3	34.0	1.3	3.7%												
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W19-L	Bedroom	35.3	34.0	1.3	3.6%												
		W19-U																	
		W20-L		1.6	1.6	0.0	0.0%												
		W20-U						12.5	12.3	99%	12.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R12	W21-L	LKD	5.9	5.2	0.8	12.7%												
		W21-U																	
		W22-L		28.7	28.7	0.0	0.0%												
		W22-U																	
		W23-L		26.8	26.8	0.0	0.0%												
		W23-U						43.7	31.8	73%	31.8	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W24-L	Bedroom	9.5	9.5	0.0	0.0%												
		W24-U																	
		W25-L		1.6	1.6	0.0	0.0%												
		W25-U						13.7	9.8	72%	9.8	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W26-L	LKD	3.1	3.1	0.0	0.0%												
		W26-U																	
		W27-L		23.7	23.7	0.0	0.0%												
		W27-U						27.9	13.9	50%	13.9	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R15	W28-L	Bedroom	24.7	24.7	0.0	0.0%												
		W28-U						14.5	11.1	77%	11.1	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R16	W29-L	LKD	25.3	25.3	0.0	0.0%												
		W29-U																	
		W30-L		0.6	0.6	0.0	0.0%												
		W30-U																	
		W31-L		4.2	4.2	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W31-U						29.8	28.3	95%	28.3	95%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Sixth	R17	W32-L	Bedroom	1.4	1.4	0.0	0.0%													
		W32-U						12.4	7.9	64%	7.9	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R18	W33-L	LKD	28.7	28.7	0.0	0.0%													
		W33-U																		
		W34-L		30.3	30.3	0.0	0.0%													
		W34-U																		
		W35-L		6.1	6.1	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	31	7	31	7	0.0%	0.0%
Sixth	R19	W36-L	Bedroom	3.2	3.2	0.0	0.0%													
		W36-U																		
		W37-L		36.5	36.5	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	70	21	70	21	0.0%	0.0%
Seventh	R1	W1-L	LKD	34.7	34.7	0.0	0.0%													
		W1-U																		
		W2-L		33.8	33.8	0.0	0.0%													
		W2-U																		
		W3-L		2.5	2.5	0.0	0.0%													
		W3-U						32.1	28.7	90%	28.7	90%	0.0	0.0%	67	18	67	18	0.0%	0.0%
Seventh	R2	W4-L	Bedroom	1.6	1.6	0.0	0.0%													
		W4-U																		
		W5-L		23.6	22.9	0.7	2.9%													
		W5-U						12.8	12.5	98%	12.5	98%	0.0	0.0%	43	9	40	9	7.0%	0.0%
Seventh	R3	W6-L	Bedroom	24.0	23.2	0.7	3.1%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	44	9	42	9	4.5%	0.0%
Seventh	R4	W7-L	Bedroom	24.4	23.6	0.8	3.3%													
		W7-U						14.2	12.0	85%	12.0	85%	0.0	0.0%	46	9	45	9	2.2%	0.0%
Seventh	R5	W8-L	LKD	25.2	24.3	0.9	3.5%													
		W8-U																		
		W9-L		2.9	2.9	0.0	0.0%													
		W9-U																		
		W10-L		3.3	2.5	0.8	24.3%													
		W10-U						29.7	26.5	89%	25.4	85%	1.1	4.3%	48	10	47	10	2.1%	0.0%
Seventh	R6	W11-L	Bedroom	3.1	3.1	0.0	0.0%													
		W11-U																		
		W12-L		26.2	25.4	0.8	2.9%													
		W12-U						9.0	7.7	85%	7.7	85%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Seventh	R7	W13-L	Bedroom	6.1	6.1	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W14-L	LKD	4.4	3.2	1.2	27.9%													
		W14-U																		
		W15-L		0.9	0.9	0.0	0.0%													
		W15-U																		
		W16-L		35.7	34.4	1.3	3.6%													
		W16-U						29.0	24.9	86%	24.9	86%	0.0	0.0%	32	4	32	4	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R9	W17-L	Bedroom	35.9	34.7	1.3	3.5%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R10	W18-L	Bedroom	36.1	34.9	1.2	3.4%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R11	W19-L	Bedroom	36.2	35.0	1.2	3.3%													
		W19-U																		
		W20-L		2.4	2.4	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R12	W21-L	LKD	6.4	5.7	0.7	11.2%													
		W21-U																		
		W22-L		31.8	31.8	0.0	0.0%													
		W22-U																		
		W23-L		30.7	30.7	0.0	0.0%													
		W23-U						43.7	35.8	82%	35.8	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R13	W24-L	Bedroom	11.3	11.3	0.0	0.0%													
		W24-U																		
		W25-L		2.2	2.2	0.0	0.0%													
		W25-U						13.7	10.1	74%	10.1	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R14	W26-L	LKD	4.5	4.5	0.0	0.0%													
		W26-U																		
		W27-L		26.4	26.4	0.0	0.0%													
		W27-U						27.9	18.4	66%	18.4	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R15	W28-L	Bedroom	27.1	27.1	0.0	0.0%													
		W28-U						14.5	11.1	77%	11.1	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R16	W29-L	LKD	27.4	27.4	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.4	4.4	0.0	0.0%													
		W31-U						29.8	28.4	95%	28.4	95%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Seventh	R17	W32-L	Bedroom	1.4	1.4	0.0	0.0%													
		W32-U						12.4	8.1	65%	8.1	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R18	W33-L	LKD	30.2	30.2	0.0	0.0%													
		W33-U																		
		W34-L		31.6	31.6	0.0	0.0%													
		W34-U																		
		W35-L		6.3	6.3	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Seventh	R19	W36-L	Bedroom	3.3	3.3	0.0	0.0%													
		W36-U																		
		W37-L		37.1	37.1	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	72	22	72	22	0.0%	0.0%
Eighth	R1	W1-L	LKD	35.5	35.5	0.0	0.0%													
		W1-U																		
		W2-L		34.7	34.7	0.0	0.0%													
		W2-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-L		2.6	2.6	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	67	19	67	19	0.0%	0.0%
Eighth	R2	W4-L	Bedroom	1.7	1.7	0.0	0.0%													
		W4-U																		
		W5-L		24.7	24.0	0.6	2.6%													
		W5-U						12.8	12.6	98%	12.6	98%	0.0	0.0%	48	12	46	12	4.2%	0.0%
Eighth	R3	W6-L	Bedroom	25.0	24.3	0.7	2.8%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	47	10	45	10	4.3%	0.0%
Eighth	R4	W7-L	Bedroom	25.4	24.7	0.8	3.0%													
		W7-U						14.2	12.5	88%	12.5	88%	0.0	0.0%	46	9	45	9	2.2%	0.0%
Eighth	R5	W8-L	LKD	26.2	25.4	0.8	3.1%													
		W8-U																		
		W9-L		3.0	3.0	0.0	0.0%													
		W9-U																		
		W10-L		3.5	2.7	0.8	22.7%													
		W10-U						29.7	27.2	91%	26.7	90%	0.4	1.6%	51	11	50	11	2.0%	0.0%
Eighth	R6	W11-L	Bedroom	3.2	3.2	0.0	0.0%													
		W11-U																		
		W12-L		26.6	25.9	0.7	2.8%													
		W12-U						9.0	7.7	86%	7.7	86%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Eighth	R7	W13-L	Bedroom	6.4	6.4	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W14-L	LKD	4.4	3.3	1.1	25.7%													
		W14-U																		
		W15-L		1.0	1.0	0.0	0.0%													
		W15-U																		
		W16-L		36.4	35.2	1.2	3.3%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	33	4	33	4	0.0%	0.0%
Eighth	R9	W17-L	Bedroom	36.6	35.5	1.2	3.2%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W18-L	Bedroom	36.8	35.7	1.1	3.1%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W19-L	Bedroom	37.0	35.8	1.1	3.1%													
		W19-U																		
		W20-L		2.9	2.9	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R12	W21-L	LKD	6.8	6.1	0.7	9.9%													
		W21-U																		
		W22-L		34.1	34.1	0.0	0.0%													
		W22-U																		
		W23-L		33.2	33.2	0.0	0.0%													
		W23-U						43.7	36.4	83%	36.4	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R13	W24-L	Bedroom	12.1	12.1	0.0	0.0%													
		W24-U																		
		W25-L		2.5	2.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W25-U						13.7	10.3	75%	10.3	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R14	W26-L	LKD	5.4	5.4	0.0	0.0%													
		W26-U																		
		W27-L		28.6	28.6	0.0	0.0%													
		W27-U						27.9	18.6	67%	18.6	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R15	W28-L	Bedroom	29.1	29.1	0.0	0.0%													
		W28-U						14.5	11.2	77%	11.2	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R16	W29-L	LKD	29.3	29.3	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.5	4.5	0.0	0.0%													
		W31-U						29.8	28.6	96%	28.6	96%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Eighth	R17	W32-L	Bedroom	1.5	1.5	0.0	0.0%													
		W32-U						12.4	8.2	66%	8.2	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R18	W33-L	LKD	31.7	31.7	0.0	0.0%													
		W33-U																		
		W34-L		33.0	33.0	0.0	0.0%													
		W34-U																		
		W35-L		6.6	6.6	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Eighth	R19	W36-L	Bedroom	3.4	3.4	0.0	0.0%													
		W36-U																		
		W37-L		37.6	37.6	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	72	22	72	22	0.0%	0.0%
Ninth	R1	W1-L	LKD	36.3	36.3	0.0	0.0%													
		W1-U																		
		W2-L		35.5	35.5	0.0	0.0%													
		W2-U																		
		W3-L		2.6	2.6	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	68	19	68	19	0.0%	0.0%
Ninth	R2	W4-L	Bedroom	2.1	2.1	0.0	0.0%													
		W4-U																		
		W5-L		25.9	25.3	0.6	2.3%													
		W5-U						12.8	12.6	98%	12.6	98%	0.0	0.0%	50	13	48	13	4.0%	0.0%
Ninth	R3	W6-L	Bedroom	26.1	25.5	0.7	2.5%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	50	11	48	11	4.0%	0.0%
Ninth	R4	W7-L	Bedroom	26.5	25.8	0.7	2.7%													
		W7-U						14.2	13.3	94%	13.3	94%	0.0	0.0%	49	11	48	11	2.0%	0.0%
Ninth	R5	W8-L	LKD	27.2	26.5	0.8	2.8%													
		W8-U																		
		W9-L		3.1	3.1	0.0	0.0%													
		W9-U																		
		W10-L		3.7	2.9	0.8	20.9%													
		W10-U						29.7	28.1	95%	28.1	94%	0.1	0.3%	53	13	52	13	1.9%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Ninth	R6	W11-L	Bedroom	3.4	3.4	0.0	0.0%													
		W11-U																		
		W12-L		27.0	26.4	0.7	2.5%													
		W12-U						9.0	7.8	86%	7.8	86%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Ninth	R7	W13-L	Bedroom	6.7	6.7	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	LKD	4.5	3.4	1.1	23.8%													
		W14-U																		
		W15-L		1.1	1.1	0.0	0.0%													
		W15-U																		
		W16-L		37.0	35.9	1.1	3.0%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	35	5	35	5	0.0%	0.0%
Ninth	R9	W17-L	Bedroom	37.3	36.2	1.1	2.9%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W18-L	Bedroom	37.4	36.4	1.1	2.8%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W19-L	Bedroom	37.6	36.5	1.1	2.8%													
		W19-U																		
		W20-L		3.0	3.0	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R12	W21-L	LKD	7.0	6.4	0.6	9.0%													
		W21-U																		
		W22-L		35.3	35.3	0.0	0.0%													
		W22-U																		
		W23-L		34.6	34.6	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R13	W24-L	Bedroom	12.3	12.3	0.0	0.0%													
		W24-U																		
		W25-L		2.6	2.6	0.0	0.0%													
		W25-U						13.7	10.5	76%	10.5	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R14	W26-L	LKD	5.6	5.6	0.0	0.0%													
		W26-U																		
		W27-L		30.5	30.5	0.0	0.0%													
		W27-U						27.9	18.7	67%	18.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R15	W28-L	Bedroom	31.0	31.0	0.0	0.0%													
		W28-U						14.5	11.4	78%	11.4	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R16	W29-L	LKD	31.1	31.1	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.7	4.7	0.0	0.0%													
		W31-U						29.8	28.6	96%	28.6	96%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Ninth	R17	W32-L	Bedroom	1.6	1.6	0.0	0.0%													
		W32-U						12.4	8.6	69%	8.6	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R18	W33-L	LKD	33.3	33.3	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W33-U																	
		W34-L		34.4	34.4	0.0	0.0%												
		W34-U																	
		W35-L		6.9	6.9	0.0	0.0%												
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Ninth	R19	W36-L	Bedroom	3.5	3.5	0.0	0.0%												
		W36-U																	
		W37-L		38.1	38.1	0.0	0.0%												
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	73	23	73	23	0.0%	0.0%
Tenth	R1	W1-L	LKD	36.9	36.9	0.0	0.0%												
		W1-U																	
		W2-L		36.3	36.3	0.0	0.0%												
		W2-U																	
		W3-L		2.7	2.7	0.0	0.0%												
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	69	20	69	20	0.0%	0.0%
Tenth	R2	W4-L	Bedroom	2.4	2.4	0.0	0.0%												
		W4-U																	
		W5-L		27.2	26.6	0.6	2.1%												
		W5-U						12.8	12.6	99%	12.6	99%	0.0	0.0%	53	14	51	14	3.8%	0.0%
Tenth	R3	W6-L	Bedroom	27.3	26.7	0.6	2.2%												
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	53	14	51	14	3.8%	0.0%
Tenth	R4	W7-L	Bedroom	27.6	26.9	0.7	2.5%												
		W7-U						14.2	13.6	96%	13.6	96%	0.0	0.0%	53	14	52	14	1.9%	0.0%
Tenth	R5	W8-L	LKD	28.3	27.6	0.7	2.5%												
		W8-U																	
		W9-L		3.2	3.2	0.0	0.0%												
		W9-U																	
		W10-L		3.9	3.1	0.7	18.7%												
		W10-U						29.7	28.5	96%	28.4	96%	0.0	0.1%	57	15	56	15	1.8%	0.0%
Tenth	R6	W11-L	Bedroom	3.5	3.5	0.0	0.0%												
		W11-U																	
		W12-L		27.3	26.7	0.6	2.3%												
		W12-U						9.0	7.8	87%	7.8	87%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Tenth	R7	W13-L	Bedroom	6.8	6.8	0.0	0.0%												
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	LKD	4.5	3.6	1.0	21.8%												
		W14-U																	
		W15-L		1.3	1.3	0.0	0.0%												
		W15-U																	
		W16-L		37.5	36.4	1.0	2.8%												
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	35	5	35	5	0.0%	0.0%
Tenth	R9	W17-L	Bedroom	37.7	36.7	1.0	2.7%												
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R10	W18-L	Bedroom	37.9	36.9	1.0	2.6%												
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Tenth	R11	W19-L	Bedroom	38.0	37.0	1.0	2.6%													
		W19-U																		
		W20-L		3.1	3.1	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R12	W21-L	LKD	7.1	6.5	0.6	8.1%													
		W21-U																		
		W22-L		36.6	36.6	0.0	0.0%													
		W22-U																		
		W23-L		36.0	36.0	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R13	W24-L	Bedroom	12.5	12.5	0.0	0.0%													
		W24-U																		
		W25-L		2.9	2.9	0.0	0.0%													
		W25-U						13.7	10.6	77%	10.6	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R14	W26-L	LKD	5.9	5.9	0.0	0.0%													
		W26-U																		
		W27-L		32.7	32.7	0.0	0.0%													
		W27-U						27.9	18.9	68%	18.9	68%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R15	W28-L	Bedroom	33.0	33.0	0.0	0.0%													
		W28-U						14.5	12.1	83%	12.1	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R16	W29-L	LKD	33.0	33.0	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.7	4.7	0.0	0.0%													
		W31-U						29.8	28.7	96%	28.7	96%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Tenth	R17	W32-L	Bedroom	2.6	2.6	0.0	0.0%													
		W32-U						12.4	9.3	75%	9.3	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R18	W33-L	LKD	34.9	34.9	0.0	0.0%													
		W33-U																		
		W34-L		35.8	35.8	0.0	0.0%													
		W34-U																		
		W35-L		7.1	7.1	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Tenth	R19	W36-L	Bedroom	3.6	3.6	0.0	0.0%													
		W36-U																		
		W37-L		38.4	38.4	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	73	23	73	23	0.0%	0.0%
Eleventh	R1	W1-L	LKD	37.5	37.5	0.0	0.0%													
		W1-U																		
		W2-L		37.1	37.1	0.0	0.0%													
		W2-U																		
		W3-L		2.7	2.7	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	71	22	71	22	0.0%	0.0%
Eleventh	R2	W4-L	Bedroom	2.7	2.7	0.0	0.0%													
		W4-U																		
		W5-L		28.5	27.9	0.5	1.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U						12.8	12.6	99%	12.6	99%	0.0	0.0%	57	17	55	17	3.5%	0.0%
Eleventh	R3	W6-L	Bedroom	28.5	28.0	0.6	2.0%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	57	15	55	15	3.5%	0.0%
Eleventh	R4	W7-L	Bedroom	28.7	28.1	0.6	2.2%													
		W7-U						14.2	13.6	96%	13.6	96%	0.0	0.0%	56	15	55	15	1.8%	0.0%
Eleventh	R5	W8-L	LKD	29.4	28.7	0.7	2.2%													
		W8-U																		
		W9-L		3.3	3.3	0.0	0.0%													
		W9-U																		
		W10-L		4.0	3.3	0.7	16.5%													
		W10-U						29.7	28.6	96%	28.6	96%	0.0	0.0%	58	16	57	16	1.7%	0.0%
Eleventh	R6	W11-L	Bedroom	3.6	3.6	0.0	0.0%													
		W11-U																		
		W12-L		27.4	26.8	0.6	2.2%													
		W12-U						9.0	7.9	87%	7.9	87%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Eleventh	R7	W13-L	Bedroom	6.9	6.9	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	LKD	4.6	3.7	0.9	19.8%													
		W14-U																		
		W15-L		1.4	1.4	0.0	0.0%													
		W15-U																		
		W16-L		37.8	36.8	0.9	2.5%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	35	5	35	5	0.0%	0.0%
Eleventh	R9	W17-L	Bedroom	38.0	37.0	0.9	2.4%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R10	W18-L	Bedroom	38.1	37.2	0.9	2.4%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R11	W19-L	Bedroom	38.3	37.4	0.9	2.4%													
		W19-U																		
		W20-L		3.2	3.2	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R12	W21-L	LKD	7.2	6.6	0.5	7.4%													
		W21-U																		
		W22-L		37.8	37.8	0.0	0.0%													
		W22-U																		
		W23-L		37.4	37.4	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R13	W24-L	Bedroom	12.6	12.6	0.0	0.0%													
		W24-U																		
		W25-L		4.3	4.3	0.0	0.0%													
		W25-U						13.7	11.6	84%	11.6	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R14	W26-L	LKD	6.0	6.0	0.0	0.0%													
		W26-U																		
		W27-L		35.1	35.1	0.0	0.0%													
		W27-U						27.9	20.1	72%	20.1	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eleventh	R15	W28-L	Bedroom	35.3	35.3	0.0	0.0%													
		W28-U						14.5	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R16	W29-L	LKD	35.1	35.1	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.8	4.8	0.0	0.0%													
		W31-U						29.8	28.7	97%	28.7	97%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Eleventh	R17	W32-L	Bedroom	4.0	4.0	0.0	0.0%													
		W32-U						12.4	12.1	97%	12.1	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R18	W33-L	LKD	36.6	36.6	0.0	0.0%													
		W33-U																		
		W34-L		37.1	37.1	0.0	0.0%													
		W34-U																		
		W35-L		7.2	7.2	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Eleventh	R19	W36-L	Bedroom	3.6	3.6	0.0	0.0%													
		W36-U																		
		W37-L		38.6	38.6	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	73	23	73	23	0.0%	0.0%
Twelfth	R1	W1-L	LKD	38.0	38.0	0.0	0.0%													
		W1-U																		
		W2-L		37.7	37.7	0.0	0.0%													
		W2-U																		
		W3-L		2.8	2.8	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	71	22	71	22	0.0%	0.0%
Twelfth	R2	W4-L	Bedroom	3.0	3.0	0.0	0.0%													
		W4-U																		
		W5-L		29.8	29.3	0.5	1.7%													
		W5-U						12.8	12.6	99%	12.6	99%	0.0	0.0%	58	17	56	17	3.4%	0.0%
Twelfth	R3	W6-L	Bedroom	29.8	29.2	0.5	1.7%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	59	16	58	16	1.7%	0.0%
Twelfth	R4	W7-L	Bedroom	29.9	29.3	0.6	1.9%													
		W7-U						14.2	13.7	96%	13.7	96%	0.0	0.0%	60	16	59	16	1.7%	0.0%
Twelfth	R5	W8-L	LKD	30.5	29.9	0.6	2.0%													
		W8-U																		
		W9-L		3.3	3.3	0.0	0.0%													
		W9-U																		
		W10-L		4.1	3.5	0.6	15.0%													
		W10-U						29.7	28.6	96%	28.6	96%	0.0	0.0%	59	16	58	16	1.7%	0.0%
Twelfth	R6	W11-L	Bedroom	3.7	3.7	0.0	0.0%													
		W11-U																		
		W12-L		27.5	26.9	0.5	2.0%													
		W12-U						9.0	7.9	87%	7.9	87%	0.0	0.0%	24	4	24	4	0.0%	0.0%
Twelfth	R7	W13-L	Bedroom	6.9	6.9	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W14-L	LKD	4.7	3.8	0.9	18.3%													
		W14-U																		
		W15-L		1.5	1.5	0.0	0.0%													
		W15-U																		
		W16-L		38.0	37.1	0.9	2.3%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	37	7	37	7	0.0%	0.0%
Twelfth	R9	W17-L	Bedroom	38.2	37.3	0.9	2.2%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R10	W18-L	Bedroom	38.3	37.5	0.8	2.1%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R11	W19-L	Bedroom	38.5	37.6	0.8	2.1%													
		W19-U																		
		W20-L		3.2	3.2	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R12	W21-L	LKD	7.2	6.7	0.5	6.8%													
		W21-U																		
		W22-L		38.8	38.8	0.0	0.0%													
		W22-U																		
		W23-L		38.5	38.5	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R13	W24-L	Bedroom	12.7	12.7	0.0	0.0%													
		W24-U																		
		W25-L		6.0	6.0	0.0	0.0%													
		W25-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R14	W26-L	LKD	6.2	6.2	0.0	0.0%													
		W26-U																		
		W27-L		37.4	37.4	0.0	0.0%													
		W27-U						27.9	23.8	85%	23.8	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R15	W28-L	Bedroom	37.4	37.4	0.0	0.0%													
		W28-U						14.5	14.5	100%	14.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R16	W29-L	LKD	37.1	37.1	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.8	4.8	0.0	0.0%													
		W31-U						29.8	29.4	99%	29.4	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Twelfth	R17	W32-L	Bedroom	5.5	5.5	0.0	0.0%													
		W32-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R18	W33-L	LKD	38.2	38.2	0.0	0.0%													
		W33-U																		
		W34-L		38.4	38.4	0.0	0.0%													
		W34-U																		
		W35-L		7.3	7.3	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twelfth	R19	W36-L	Bedroom	3.6	3.6	0.0	0.0%													
		W36-U																		
		W37-L		38.7	38.7	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	73	23	73	23	0.0%	0.0%
Thirteenth	R1	W1-L	LKD	38.3	38.3	0.0	0.0%													
		W1-U																		
		W2-L		38.1	38.1	0.0	0.0%													
		W2-U																		
		W3-L		3.0	3.0	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	74	24	74	24	0.0%	0.0%
Thirteenth	R2	W4-L	Bedroom	3.2	3.2	0.0	0.0%													
		W4-U																		
		W5-L		31.1	30.6	0.4	1.4%													
		W5-U						12.8	12.6	99%	12.6	99%	0.0	0.0%	59	17	58	17	1.7%	0.0%
Thirteenth	R3	W6-L	Bedroom	31.0	30.5	0.5	1.6%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	61	16	60	16	1.6%	0.0%
Thirteenth	R4	W7-L	Bedroom	31.1	30.6	0.5	1.7%													
		W7-U						14.2	13.7	96%	13.7	96%	0.0	0.0%	61	16	60	16	1.6%	0.0%
Thirteenth	R5	W8-L	LKD	31.7	31.1	0.6	1.8%													
		W8-U																		
		W9-L		3.3	3.3	0.0	0.0%													
		W9-U																		
		W10-L		4.3	3.7	0.6	13.1%													
		W10-U						29.7	28.6	96%	28.6	96%	0.0	0.0%	61	16	60	16	1.6%	0.0%
Thirteenth	R6	W11-L	Bedroom	3.8	3.8	0.0	0.0%													
		W11-U																		
		W12-L		27.5	27.0	0.5	1.8%													
		W12-U						9.0	7.9	87%	7.9	87%	0.0	0.0%	24	4	24	4	0.0%	0.0%
Thirteenth	R7	W13-L	Bedroom	7.0	7.0	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R8	W14-L	LKD	4.7	3.9	0.8	16.4%													
		W14-U																		
		W15-L		1.6	1.6	0.0	0.0%													
		W15-U																		
		W16-L		38.2	37.5	0.8	2.0%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	38	8	38	8	0.0%	0.0%
Thirteenth	R9	W17-L	Bedroom	38.4	37.6	0.8	2.0%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R10	W18-L	Bedroom	38.5	37.8	0.7	1.9%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R11	W19-L	Bedroom	38.6	37.9	0.7	1.9%													
		W19-U																		
		W20-L		3.2	3.2	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R12	W21-L	LKD	7.2	6.8	0.4	6.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W21-U																		
		W22-L		39.5	39.5	0.0	0.0%													
		W22-U																		
		W23-L		39.4	39.4	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R13	W24-L	Bedroom	12.8	12.8	0.0	0.0%													
		W24-U																		
		W25-L		7.4	7.4	0.0	0.0%													
		W25-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R14	W26-L	LKD	6.3	6.3	0.0	0.0%													
		W26-U																		
		W27-L		39.3	39.3	0.0	0.0%													
		W27-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R15	W28-L	Bedroom	39.2	39.2	0.0	0.0%													
		W28-U						14.5	14.5	100%	14.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R16	W29-L	LKD	38.7	38.7	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.8	4.8	0.0	0.0%													
		W31-U						29.8	29.4	99%	29.4	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Thirteenth	R17	W32-L	Bedroom	6.7	6.7	0.0	0.0%													
		W32-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R18	W33-L	LKD	39.5	39.5	0.0	0.0%													
		W33-U																		
		W34-L		39.5	39.5	0.0	0.0%													
		W34-U																		
		W35-L		7.3	7.3	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Thirteenth	R19	W36-L	Bedroom	3.6	3.6	0.0	0.0%													
		W36-U																		
		W37-L		38.8	38.8	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	73	23	73	23	0.0%	0.0%
Fourteenth	R1	W1-L	LKD	38.4	38.4	0.0	0.0%													
		W1-U																		
		W2-L		38.3	38.3	0.0	0.0%													
		W2-U																		
		W3-L		3.4	3.4	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	74	24	74	24	0.0%	0.0%
Fourteenth	R2	W4-L	Bedroom	3.2	3.2	0.0	0.0%													
		W4-U																		
		W5-L		32.1	31.7	0.4	1.3%													
		W5-U						12.8	12.7	99%	12.7	99%	0.0	0.0%	62	18	61	18	1.6%	0.0%
Fourteenth	R3	W6-L	Bedroom	32.1	31.6	0.4	1.4%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	61	16	60	16	1.6%	0.0%
Fourteenth	R4	W7-L	Bedroom	32.2	31.7	0.5	1.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W7-U						14.2	13.7	96%	13.7	96%	0.0	0.0%	62	16	61	16	1.6%	0.0%
Fourteenth	R5	W8-L	LKD	32.7	32.1	0.5	1.6%													
		W8-U																		
		W9-L		3.3	3.3	0.0	0.0%													
		W9-U																		
		W10-L		4.4	3.9	0.5	11.6%													
		W10-U						29.7	28.7	97%	28.7	97%	0.0	0.0%	62	16	61	16	1.6%	0.0%
Fourteenth	R6	W11-L	Bedroom	4.0	4.0	0.0	0.0%													
		W11-U																		
		W12-L		27.5	27.1	0.4	1.6%													
		W12-U						9.0	7.9	88%	7.9	88%	0.0	0.0%	24	4	24	4	0.0%	0.0%
Fourteenth	R7	W13-L	Bedroom	7.2	7.2	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R8	W14-L	LKD	4.8	4.1	0.7	14.5%													
		W14-U																		
		W15-L		1.7	1.7	0.0	0.0%													
		W15-U																		
		W16-L		38.5	37.8	0.7	1.8%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	38	8	38	8	0.0%	0.0%
Fourteenth	R9	W17-L	Bedroom	38.6	37.9	0.7	1.8%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R10	W18-L	Bedroom	38.7	38.0	0.7	1.7%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R11	W19-L	Bedroom	38.8	38.2	0.6	1.7%													
		W19-U																		
		W20-L		3.2	3.2	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R12	W21-L	LKD	7.2	6.9	0.4	5.4%													
		W21-U																		
		W22-L		39.6	39.6	0.0	0.0%													
		W22-U																		
		W23-L		39.5	39.5	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R13	W24-L	Bedroom	12.8	12.8	0.0	0.0%													
		W24-U																		
		W25-L		7.5	7.5	0.0	0.0%													
		W25-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R14	W26-L	LKD	6.3	6.3	0.0	0.0%													
		W26-U																		
		W27-L		39.3	39.3	0.0	0.0%													
		W27-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R15	W28-L	Bedroom	39.2	39.2	0.0	0.0%													
		W28-U						14.5	14.5	100%	14.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R16	W29-L	LKD	38.7	38.7	0.0	0.0%													
		W29-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.8	4.8	0.0	0.0%													
		W31-U						29.8	29.4	99%	29.4	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Fourteenth	R17	W32-L	Bedroom	6.8	6.8	0.0	0.0%													
		W32-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R18	W33-L	LKD	39.6	39.6	0.0	0.0%													
		W33-U																		
		W34-L		39.6	39.6	0.0	0.0%													
		W34-U																		
		W35-L		7.3	7.3	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Fourteenth	R19	W36-L	Bedroom	3.6	3.6	0.0	0.0%													
		W36-U																		
		W37-L		38.9	38.9	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	74	24	74	24	0.0%	0.0%
Fifteenth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		38.4	38.4	0.0	0.0%													
		W2-U																		
		W3-L		4.1	4.1	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	74	24	74	24	0.0%	0.0%
Fifteenth	R2	W4-L	Bedroom	3.2	3.2	0.0	0.0%													
		W4-U																		
		W5-L		33.2	32.8	0.4	1.1%													
		W5-U						12.8	12.8	100%	12.8	100%	0.0	0.0%	64	19	63	19	1.6%	0.0%
Fifteenth	R3	W6-L	Bedroom	33.1	32.7	0.4	1.1%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	63	17	62	17	1.6%	0.0%
Fifteenth	R4	W7-L	Bedroom	33.2	32.7	0.4	1.3%													
		W7-U						14.2	13.7	97%	13.7	97%	0.0	0.0%	62	16	61	16	1.6%	0.0%
Fifteenth	R5	W8-L	LKD	33.6	33.2	0.5	1.3%													
		W8-U																		
		W9-L		3.3	3.3	0.0	0.0%													
		W9-U																		
		W10-L		4.5	4.0	0.4	9.9%													
		W10-U						29.7	28.7	97%	28.7	97%	0.0	0.0%	63	17	62	17	1.6%	0.0%
Fifteenth	R6	W11-L	Bedroom	4.5	4.5	0.0	0.0%													
		W11-U																		
		W12-L		27.6	27.2	0.4	1.5%													
		W12-U						9.0	8.0	89%	8.0	89%	0.0	0.0%	24	4	24	4	0.0%	0.0%
Fifteenth	R7	W13-L	Bedroom	7.3	7.3	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R8	W14-L	LKD	4.8	4.2	0.6	12.9%													
		W14-U																		
		W15-L		1.8	1.8	0.0	0.0%													
		W15-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W16-L		38.7	38.1	0.6	1.6%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	38	8	38	8	0.0%	0.0%
Fifteenth	R9	W17-L	Bedroom	38.8	38.2	0.6	1.5%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R10	W18-L	Bedroom	38.9	38.3	0.6	1.5%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R11	W19-L	Bedroom	39.0	38.4	0.6	1.5%													
		W19-U																		
		W20-L		3.2	3.2	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R12	W21-L	LKD	7.3	6.9	0.4	4.8%													
		W21-U																		
		W22-L		39.6	39.6	0.0	0.0%													
		W22-U																		
		W23-L		39.5	39.5	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R13	W24-L	Bedroom	12.8	12.8	0.0	0.0%													
		W24-U																		
		W25-L		7.5	7.5	0.0	0.0%													
		W25-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R14	W26-L	LKD	6.3	6.3	0.0	0.0%													
		W26-U																		
		W27-L		39.3	39.3	0.0	0.0%													
		W27-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R15	W28-L	Bedroom	39.2	39.2	0.0	0.0%													
		W28-U						14.5	14.5	100%	14.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R16	W29-L	LKD	38.7	38.7	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.8	4.8	0.0	0.0%													
		W31-U						29.8	29.4	99%	29.4	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Fifteenth	R17	W32-L	Bedroom	6.8	6.8	0.0	0.0%													
		W32-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R18	W33-L	LKD	39.6	39.6	0.0	0.0%													
		W33-U																		
		W34-L		39.6	39.6	0.0	0.0%													
		W34-U																		
		W35-L		7.3	7.3	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Fifteenth	R19	W36-L	Bedroom	3.6	3.6	0.0	0.0%													
		W36-U																		
		W37-L		38.9	38.9	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	74	24	74	24	0.0%	0.0%
Sixteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W1-U																		
		W2-L		38.4	38.4	0.0	0.0%													
		W2-U																		
		W3-L		4.9	4.9	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	75	24	75	24	0.0%	0.0%
Sixteenth	R2	W4-L	Bedroom	3.2	3.2	0.0	0.0%													
		W4-U																		
		W5-L		34.2	33.9	0.3	0.9%													
		W5-U						12.8	12.8	100%	12.8	100%	0.0	0.0%	66	20	65	20	1.5%	0.0%
Sixteenth	R3	W6-L	Bedroom	34.1	33.8	0.3	1.0%													
		W6-U						13.4	13.2	99%	13.2	99%	0.0	0.0%	65	19	65	19	0.0%	0.0%
Sixteenth	R4	W7-L	Bedroom	34.2	33.8	0.4	1.1%													
		W7-U						14.2	14.1	100%	14.1	100%	0.0	0.0%	64	18	63	18	1.6%	0.0%
Sixteenth	R5	W8-L	LKD	34.6	34.2	0.4	1.1%													
		W8-U																		
		W9-L		3.3	3.3	0.0	0.0%													
		W9-U																		
		W10-L		4.5	4.1	0.4	8.4%													
		W10-U						29.7	28.8	97%	28.8	97%	0.0	0.0%	64	18	64	18	0.0%	0.0%
Sixteenth	R6	W11-L	Bedroom	5.1	5.1	0.0	0.0%													
		W11-U																		
		W12-L		27.6	27.3	0.4	1.3%													
		W12-U						9.0	8.8	97%	8.8	97%	0.0	0.0%	25	5	25	5	0.0%	0.0%
Sixteenth	R7	W13-L	Bedroom	7.4	7.4	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R8	W14-L	LKD	4.8	4.3	0.5	11.0%													
		W14-U																		
		W15-L		1.9	1.9	0.0	0.0%													
		W15-U																		
		W16-L		38.9	38.3	0.5	1.4%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	38	8	38	8	0.0%	0.0%
Sixteenth	R9	W17-L	Bedroom	38.9	38.4	0.5	1.3%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R10	W18-L	Bedroom	39.0	38.5	0.5	1.3%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R11	W19-L	Bedroom	39.1	38.6	0.5	1.3%													
		W19-U																		
		W20-L		3.2	3.2	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R12	W21-L	LKD	7.3	7.0	0.3	4.1%													
		W21-U																		
		W22-L		39.6	39.6	0.0	0.0%													
		W22-U																		
		W23-L		39.5	39.5	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixteenth	R13	W24-L	Bedroom	12.8	12.8	0.0	0.0%													
		W24-U																		
		W25-L		7.5	7.5	0.0	0.0%													
		W25-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R14	W26-L	LKD	6.3	6.3	0.0	0.0%													
		W26-U																		
		W27-L		39.3	39.3	0.0	0.0%													
		W27-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R15	W28-L	Bedroom	39.2	39.2	0.0	0.0%													
		W28-U						14.5	14.5	100%	14.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R16	W29-L	LKD	38.7	38.7	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.8	4.8	0.0	0.0%													
		W31-U						29.8	29.4	99%	29.4	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Sixteenth	R17	W32-L	Bedroom	6.8	6.8	0.0	0.0%													
		W32-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R18	W33-L	LKD	39.6	39.6	0.0	0.0%													
		W33-U																		
		W34-L		39.6	39.6	0.0	0.0%													
		W34-U																		
		W35-L		7.3	7.3	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Sixteenth	R19	W36-L	Bedroom	3.6	3.6	0.0	0.0%													
		W36-U																		
		W37-L		38.9	38.9	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	74	24	74	24	0.0%	0.0%
Seventeenth	R1	W1-L	LKD	38.7	38.7	0.0	0.0%													
		W1-U																		
		W2-L		38.5	38.5	0.0	0.0%													
		W2-U																		
		W3-L		5.7	5.7	0.0	0.0%													
		W3-U						32.1	29.1	91%	29.1	91%	0.0	0.0%	76	25	76	25	0.0%	0.0%
Seventeenth	R2	W4-L	Bedroom	3.2	3.2	0.0	0.0%													
		W4-U																		
		W5-L		35.2	35.0	0.3	0.7%													
		W5-U						12.8	12.8	100%	12.8	100%	0.0	0.0%	67	21	67	21	0.0%	0.0%
Seventeenth	R3	W6-L	Bedroom	35.2	34.9	0.3	0.8%													
		W6-U						13.4	13.4	100%	13.4	100%	0.0	0.0%	66	20	66	20	0.0%	0.0%
Seventeenth	R4	W7-L	Bedroom	35.2	34.9	0.3	0.9%													
		W7-U						14.2	14.1	100%	14.1	100%	0.0	0.0%	65	19	65	19	0.0%	0.0%
Seventeenth	R5	W8-L	LKD	35.5	35.2	0.3	0.9%													
		W8-U																		
		W9-L		3.3	3.3	0.0	0.0%													
		W9-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-L		4.6	4.2	0.3	6.8%													
		W10-U						29.7	29.2	98%	29.2	98%	0.0	0.0%	65	19	65	19	0.0%	0.0%
Seventeenth	R6	W11-L	Bedroom	5.7	5.7	0.0	0.0%													
		W11-U																		
		W12-L		27.6	27.4	0.3	1.0%													
		W12-U						9.0	9.0	99%	9.0	99%	0.0	0.0%	26	6	26	6	0.0%	0.0%
Seventeenth	R7	W13-L	Bedroom	7.6	7.6	0.0	0.0%													
		W13-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R8	W14-L	LKD	4.9	4.5	0.4	9.0%													
		W14-U																		
		W15-L		2.0	2.0	0.0	0.0%													
		W15-U																		
		W16-L		39.0	38.6	0.4	1.1%													
		W16-U						29.0	25.0	86%	25.0	86%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Seventeenth	R9	W17-L	Bedroom	39.1	38.6	0.4	1.1%													
		W17-U						14.1	13.8	98%	13.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R10	W18-L	Bedroom	39.1	38.7	0.4	1.0%													
		W18-U						9.1	9.1	100%	9.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R11	W19-L	Bedroom	39.2	38.8	0.4	1.0%													
		W19-U																		
		W20-L		3.2	3.2	0.0	0.0%													
		W20-U						12.5	12.5	100%	12.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R12	W21-L	LKD	7.3	7.0	0.3	3.4%													
		W21-U																		
		W22-L		39.6	39.6	0.0	0.0%													
		W22-U																		
		W23-L		39.5	39.5	0.0	0.0%													
		W23-U						43.7	36.5	83%	36.5	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R13	W24-L	Bedroom	12.8	12.8	0.0	0.0%													
		W24-U																		
		W25-L		7.5	7.5	0.0	0.0%													
		W25-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R14	W26-L	LKD	6.3	6.3	0.0	0.0%													
		W26-U																		
		W27-L		39.3	39.3	0.0	0.0%													
		W27-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R15	W28-L	Bedroom	39.2	39.2	0.0	0.0%													
		W28-U						14.5	10.7	74%	10.7	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R16	W29-L	LKD	38.7	38.7	0.0	0.0%													
		W29-U																		
		W30-L		0.6	0.6	0.0	0.0%													
		W30-U																		
		W31-L		4.8	4.8	0.0	0.0%													
		W31-U						29.8	26.3	88%	26.3	88%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Seventeenth	R17	W32-L	Bedroom	6.8	6.8	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W32-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R18	W33-L	LKD	39.6	39.6	0.0	0.0%													
		W33-U																		
		W34-L		39.6	39.6	0.0	0.0%													
		W34-U																		
		W35-L		7.3	7.3	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Seventeenth	R19	W36-L	Bedroom	3.6	3.6	0.0	0.0%													
		W36-U																		
		W37-L		39.0	39.0	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Eighteenth	R1	W1-L	Bedroom	38.9	38.9	0.0	0.0%													
		W1-U																		
		W2-L		2.4	2.4	0.0	0.0%													
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	74	24	74	24	0.0%	0.0%
Eighteenth	R2	W3-L	LKD	6.8	6.8	0.0	0.0%													
		W3-U																		
		W4-L		31.4	31.3	0.1	0.3%													
		W4-U																		
		W5-L		34.9	34.8	0.1	0.3%													
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	75	27	75	27	0.0%	0.0%
Eighteenth	R3	W6-L	Residential	34.3	34.2	0.1	0.3%													
		W6-U																		
		W7-L		34.0	33.9	0.1	0.4%													
		W7-U																		
		W8-L		33.0	32.8	0.1	0.4%													
		W8-U						17.9	15.9	89%	15.9	89%	0.0	0.0%	68	22	68	22	0.0%	0.0%
Eighteenth	R4	W9-L	Studio	32.0	31.9	0.1	0.2%													
		W9-U																		
		W10-L		30.0	29.9	0.1	0.4%													
		W10-U																		
		W11-L		8.6	8.4	0.2	2.7%													
		W11-U																		
		W12-L		2.6	2.6	0.0	0.0%													
		W12-U																		
		W13-L		39.2	38.9	0.3	0.9%													
		W13-U						36.9	36.4	99%	36.4	99%	0.0	0.0%	68	22	68	22	0.0%	0.0%
Eighteenth	R5	W14-L	Bedroom	39.2	38.9	0.3	0.9%													
		W14-U						15.7	15.6	100%	15.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R6	W15-L	Bedroom	39.2	38.9	0.3	0.8%													
		W15-U						13.2	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W16-L	Bedroom	39.3	39.0	0.3	0.8%													
		W16-U																		
		W17-L		3.4	3.4	0.0	0.0%													
		W17-U						14.4	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R8	W18-L	LKD	6.5	6.4	0.1	2.0%													
		W18-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W19-L		39.5	39.5	0.0	0.0%												
		W19-U																	
		W20-L		39.5	39.5	0.0	0.0%												
		W20-U						37.7	34.2	91%	34.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R9	W21-L	Bedroom	12.8	12.8	0.0	0.0%												
		W21-U																	
		W22-L		7.5	7.5	0.0	0.0%												
		W22-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R10	W23-L	LKD	6.3	6.3	0.0	0.0%												
		W23-U																	
		W24-L		39.3	39.3	0.0	0.0%												
		W24-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R11	W25-L	Bedroom	39.2	39.2	0.0	0.0%												
		W25-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R12	W26-L	LKD	38.7	38.7	0.0	0.0%												
		W26-U																	
		W27-L		0.6	0.6	0.0	0.0%												
		W27-U																	
		W28-L		4.8	4.8	0.0	0.0%												
		W28-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Eighteenth	R13	W29-L	Bedroom	6.8	6.8	0.0	0.0%												
		W29-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R14	W30-L	LKD	39.6	39.6	0.0	0.0%												
		W30-U																	
		W31-L		39.6	39.6	0.0	0.0%												
		W31-U																	
		W32-L		7.3	7.3	0.0	0.0%												
		W32-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Eighteenth	R15	W33-L	Bedroom	3.6	3.6	0.0	0.0%												
		W33-U																	
		W34-L		39.1	39.1	0.0	0.0%												
		W34-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Nineteenth	R1	W1-L	Bedroom	39.0	39.0	0.0	0.0%												
		W1-U																	
		W2-L		2.6	2.6	0.0	0.0%												
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Nineteenth	R2	W3-L	LKD	6.8	6.8	0.0	0.0%												
		W3-U																	
		W4-L		36.8	36.7	0.1	0.4%												
		W4-U																	
		W5-L		36.8	36.6	0.2	0.4%												
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	76	28	76	28	0.0%	0.0%
Nineteenth	R3	W6-L	Residential	36.7	36.5	0.2	0.4%												
		W6-U																	
		W7-L		36.3	36.1	0.2	0.5%												
		W7-U						17.9	11.6	65%	11.6	65%	0.0	0.0%	69	23	69	23	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Nineteenth	R4	W8-L	Studio	34.2	34.1	0.1	0.2%													
		W8-U																		
		W9-L		35.0	34.9	0.1	0.3%													
		W9-U																		
		W10-L		8.7	8.5	0.2	2.0%													
		W10-U																		
		W11-L		2.8	2.8	0.0	0.0%													
		W11-U																		
		W12-L		39.3	39.0	0.3	0.7%													
		W12-U						36.7	36.2	99%	36.2	99%	0.0	0.0%	73	24	73	24	0.0%	0.0%
Nineteenth	R5	W13-L	Bedroom	39.3	39.1	0.3	0.6%													
		W13-U						15.7	15.6	100%	15.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R6	W14-L	Bedroom	39.3	39.1	0.2	0.6%													
		W14-U						13.2	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R7	W15-L	Bedroom	39.4	39.1	0.2	0.6%													
		W15-U																		
		W16-L		3.4	3.4	0.0	0.0%													
		W16-U						14.4	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R8	W17-L	LKD	6.5	6.4	0.1	1.5%													
		W17-U																		
		W18-L		39.5	39.5	0.0	0.0%													
		W18-U																		
		W19-L		39.5	39.5	0.0	0.0%													
		W19-U						37.7	34.2	91%	34.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R9	W20-L	Bedroom	12.9	12.9	0.0	0.0%													
		W20-U																		
		W21-L		7.5	7.5	0.0	0.0%													
		W21-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R10	W22-L	LKD	6.3	6.3	0.0	0.0%													
		W22-U																		
		W23-L		39.3	39.3	0.0	0.0%													
		W23-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R11	W24-L	Bedroom	39.2	39.2	0.0	0.0%													
		W24-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R12	W25-L	LKD	38.7	38.7	0.0	0.0%													
		W25-U																		
		W26-L		0.6	0.6	0.0	0.0%													
		W26-U																		
		W27-L		4.8	4.8	0.0	0.0%													
		W27-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Nineteenth	R13	W28-L	Bedroom	6.8	6.8	0.0	0.0%													
		W28-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R14	W29-L	LKD	39.6	39.6	0.0	0.0%													
		W29-U																		
		W30-L		39.6	39.6	0.0	0.0%													
		W30-U																		
		W31-L		7.3	7.3	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W31-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Nineteenth	R15	W32-L	Bedroom	3.6	3.6	0.0	0.0%													
		W32-U																		
		W33-L		39.1	39.1	0.0	0.0%													
		W33-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twentieth	R1	W1-L	Bedroom	39.0	39.0	0.0	0.0%													
		W1-U																		
		W2-L		2.7	2.7	0.0	0.0%													
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Twentieth	R2	W3-L	LKD	6.8	6.8	0.0	0.0%													
		W3-U																		
		W4-L		37.2	37.1	0.1	0.3%													
		W4-U																		
		W5-L		37.1	37.0	0.1	0.3%													
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	77	29	77	29	0.0%	0.0%
Twentieth	R3	W6-L	Residential	37.0	36.9	0.1	0.3%													
		W6-U																		
		W7-L		36.6	36.5	0.1	0.3%													
		W7-U						17.9	11.6	65%	11.6	65%	0.0	0.0%	70	24	70	24	0.0%	0.0%
Twentieth	R4	W8-L	Studio	34.4	34.4	0.1	0.2%													
		W8-U																		
		W9-L		35.2	35.2	0.1	0.2%													
		W9-U																		
		W10-L		8.8	8.6	0.1	1.4%													
		W10-U																		
		W11-L		2.9	2.9	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.2	0.2	0.4%													
		W12-U						36.7	36.2	99%	36.2	99%	0.0	0.0%	74	25	74	25	0.0%	0.0%
Twentieth	R5	W13-L	Bedroom	39.4	39.2	0.2	0.4%													
		W13-U						15.7	15.6	100%	15.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W14-L	Bedroom	39.4	39.2	0.2	0.4%													
		W14-U						13.2	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R7	W15-L	Bedroom	39.4	39.3	0.2	0.4%													
		W15-U																		
		W16-L		3.4	3.4	0.0	0.0%													
		W16-U						14.4	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R8	W17-L	LKD	6.5	6.5	0.1	1.1%													
		W17-U																		
		W18-L		39.5	39.5	0.0	0.0%													
		W18-U																		
		W19-L		39.5	39.5	0.0	0.0%													
		W19-U						37.7	34.2	91%	34.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R9	W20-L	Bedroom	12.9	12.9	0.0	0.0%													
		W20-U																		
		W21-L		7.5	7.5	0.0	0.0%													
		W21-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twentieth	R10	W22-L	LKD	6.3	6.3	0.0	0.0%													
		W22-U																		
		W23-L		39.3	39.3	0.0	0.0%													
		W23-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R11	W24-L	Bedroom	39.2	39.2	0.0	0.0%													
		W24-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R12	W25-L	LKD	38.7	38.7	0.0	0.0%													
		W25-U																		
		W26-L		0.6	0.6	0.0	0.0%													
		W26-U																		
		W27-L		4.8	4.8	0.0	0.0%													
		W27-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Twentieth	R13	W28-L	Bedroom	6.8	6.8	0.0	0.0%													
		W28-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R14	W29-L	LKD	39.6	39.6	0.0	0.0%													
		W29-U																		
		W30-L		39.6	39.6	0.0	0.0%													
		W30-U																		
		W31-L		7.3	7.3	0.0	0.0%													
		W31-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Twentieth	R15	W32-L	Bedroom	3.6	3.6	0.0	0.0%													
		W32-U																		
		W33-L		39.1	39.1	0.0	0.0%													
		W33-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-First	R1	W1-L	Bedroom	39.1	39.1	0.0	0.0%													
		W1-U																		
		W2-L		2.8	2.8	0.0	0.0%													
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Twenty-First	R2	W3-L	LKD	6.9	6.9	0.0	0.0%													
		W3-U																		
		W4-L		37.4	37.4	0.1	0.2%													
		W4-U																		
		W5-L		37.4	37.4	0.1	0.2%													
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	77	29	77	29	0.0%	0.0%
Twenty-First	R3	W6-L	Residential	37.3	37.2	0.1	0.2%													
		W6-U																		
		W7-L		36.9	36.8	0.1	0.2%													
		W7-U						17.9	11.7	65%	11.7	65%	0.0	0.0%	70	24	70	24	0.0%	0.0%
Twenty-First	R4	W8-L	Studio	34.6	34.6	0.0	0.1%													
		W8-U																		
		W9-L		35.5	35.4	0.0	0.1%													
		W9-U																		
		W10-L		8.8	8.7	0.1	0.7%													
		W10-U																		
		W11-L		2.9	2.9	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.1	0.2%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W12-U						36.7	36.2	99%	36.2	99%	0.0	0.0%	73	24	73	24	0.0%	0.0%
Twenty-First	R5	W13-L	Bedroom	39.5	39.4	0.1	0.2%													
		W13-U						15.7	15.6	100%	15.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W14-L	Bedroom	39.5	39.4	0.1	0.2%													
		W14-U						13.2	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R7	W15-L	Bedroom	39.5	39.4	0.1	0.2%													
		W15-U																		
		W16-L		3.4	3.4	0.0	0.0%													
		W16-U						14.4	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R8	W17-L	LKD	6.5	6.5	0.0	0.6%													
		W17-U																		
		W18-L		39.5	39.5	0.0	0.0%													
		W18-U																		
		W19-L		39.5	39.5	0.0	0.0%													
		W19-U						37.7	34.2	91%	34.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R9	W20-L	Bedroom	12.9	12.9	0.0	0.0%													
		W20-U																		
		W21-L		7.5	7.5	0.0	0.0%													
		W21-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R10	W22-L	LKD	6.3	6.3	0.0	0.0%													
		W22-U																		
		W23-L		39.3	39.3	0.0	0.0%													
		W23-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R11	W24-L	Bedroom	39.2	39.2	0.0	0.0%													
		W24-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R12	W25-L	LKD	38.7	38.7	0.0	0.0%													
		W25-U																		
		W26-L		0.6	0.6	0.0	0.0%													
		W26-U																		
		W27-L		4.8	4.8	0.0	0.0%													
		W27-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Twenty-First	R13	W28-L	Bedroom	6.8	6.8	0.0	0.0%													
		W28-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R14	W29-L	LKD	39.6	39.6	0.0	0.0%													
		W29-U																		
		W30-L		39.6	39.6	0.0	0.0%													
		W30-U																		
		W31-L		7.3	7.3	0.0	0.0%													
		W31-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Twenty-First	R15	W32-L	Bedroom	3.6	3.6	0.0	0.0%													
		W32-U																		
		W33-L		39.2	39.2	0.0	0.0%													
		W33-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-Secc	R1	W1-L	Bedroom	39.1	39.1	0.0	0.0%													
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-L		2.8	2.8	0.0	0.0%													
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Twenty-Secc	R2	W3-L	LKD	6.9	6.9	0.0	0.0%													
		W3-U																		
		W4-L		37.6	37.6	0.0	0.1%													
		W4-U																		
		W5-L		37.6	37.6	0.0	0.1%													
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	77	29	77	29	0.0%	0.0%
Twenty-Secc	R3	W6-L	Residential	37.5	37.5	0.0	0.1%													
		W6-U																		
		W7-L		37.2	37.1	0.0	0.1%													
		W7-U						17.9	11.6	65%	11.6	65%	0.0	0.0%	70	24	70	24	0.0%	0.0%
Twenty-Secc	R4	W8-L	Studio	34.8	34.8	0.0	0.0%													
		W8-U																		
		W9-L		35.6	35.6	0.0	0.0%													
		W9-U																		
		W10-L		8.8	8.8	0.0	0.2%													
		W10-U																		
		W11-L		3.0	3.0	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.1%													
		W12-U						36.7	36.2	99%	36.2	99%	0.0	0.0%	74	25	74	25	0.0%	0.0%
Twenty-Secc	R5	W13-L	Bedroom	39.5	39.5	0.0	0.1%													
		W13-U						15.7	15.6	100%	15.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R6	W14-L	Bedroom	39.5	39.5	0.0	0.1%													
		W14-U						13.2	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R7	W15-L	Bedroom	39.5	39.5	0.0	0.1%													
		W15-U																		
		W16-L		3.4	3.4	0.0	0.0%													
		W16-U						14.4	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R8	W17-L	LKD	6.5	6.5	0.0	0.3%													
		W17-U																		
		W18-L		39.5	39.5	0.0	0.0%													
		W18-U																		
		W19-L		39.5	39.5	0.0	0.0%													
		W19-U						37.7	34.2	91%	34.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R9	W20-L	Bedroom	13.0	13.0	0.0	0.0%													
		W20-U																		
		W21-L		7.5	7.5	0.0	0.0%													
		W21-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R10	W22-L	LKD	6.3	6.3	0.0	0.0%													
		W22-U																		
		W23-L		39.3	39.3	0.0	0.0%													
		W23-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R11	W24-L	Bedroom	39.2	39.2	0.0	0.0%													
		W24-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-Secc	R12	W25-L	LKD	38.7	38.7	0.0	0.0%												
		W25-U																	
		W26-L		0.6	0.6	0.0	0.0%												
		W26-U																	
		W27-L		4.8	4.8	0.0	0.0%												
		W27-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Twenty-Secc	R13	W28-L	Bedroom	6.8	6.8	0.0	0.0%												
		W28-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R14	W29-L	LKD	39.6	39.6	0.0	0.0%												
		W29-U																	
		W30-L		39.6	39.6	0.0	0.0%												
		W30-U																	
		W31-L		7.3	7.3	0.0	0.0%												
		W31-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Twenty-Secc	R15	W32-L	Bedroom	3.6	3.6	0.0	0.0%												
		W32-U																	
		W33-L		39.2	39.2	0.0	0.0%												
		W33-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-Thir	R1	W1-L	Bedroom	39.1	39.1	0.0	0.0%												
		W1-U																	
		W2-L		2.8	2.8	0.0	0.0%												
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Twenty-Thir	R2	W3-L	LKD	6.9	6.9	0.0	0.0%												
		W3-U																	
		W4-L		37.8	37.8	0.0	0.0%												
		W4-U																	
		W5-L		37.8	37.8	0.0	0.0%												
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	77	29	77	29	0.0%	0.0%
Twenty-Thir	R3	W6-L	Residential	37.8	37.8	0.0	0.0%												
		W6-U																	
		W7-L		37.5	37.5	0.0	0.0%												
		W7-U						17.9	11.6	65%	11.6	65%	0.0	0.0%	70	24	70	24	0.0%	0.0%
Twenty-Thir	R4	W8-L	Studio	34.9	34.9	0.0	0.0%												
		W8-U																	
		W9-L		35.8	35.8	0.0	0.0%												
		W9-U																	
		W10-L		8.8	8.8	0.0	0.0%												
		W10-U																	
		W11-L		3.0	3.0	0.0	0.0%												
		W11-U																	
		W12-L		39.5	39.5	0.0	0.0%												
		W12-U						36.7	36.2	99%	36.2	99%	0.0	0.0%	74	25	74	25	0.0%	0.0%
Twenty-Thir	R5	W13-L	Bedroom	39.5	39.5	0.0	0.0%												
		W13-U						15.7	15.6	100%	15.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R6	W14-L	Bedroom	39.5	39.5	0.0	0.0%												
		W14-U						13.2	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R7	W15-L	Bedroom	39.6	39.6	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W15-U																		
		W16-L		3.4	3.4	0.0	0.0%													
		W16-U						14.4	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R8	W17-L	LKD	6.5	6.5	0.0	0.0%													
		W17-U																		
		W18-L		39.5	39.5	0.0	0.0%													
		W18-U																		
		W19-L		39.5	39.5	0.0	0.0%													
		W19-U						37.7	34.2	91%	34.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R9	W20-L	Bedroom	13.3	13.3	0.0	0.0%													
		W20-U																		
		W21-L		7.5	7.5	0.0	0.0%													
		W21-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R10	W22-L	LKD	6.3	6.3	0.0	0.0%													
		W22-U																		
		W23-L		39.3	39.3	0.0	0.0%													
		W23-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R11	W24-L	Bedroom	39.2	39.2	0.0	0.0%													
		W24-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R12	W25-L	LKD	38.7	38.7	0.0	0.0%													
		W25-U																		
		W26-L		0.6	0.6	0.0	0.0%													
		W26-U																		
		W27-L		4.8	4.8	0.0	0.0%													
		W27-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Twenty-Thir	R13	W28-L	Bedroom	6.8	6.8	0.0	0.0%													
		W28-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R14	W29-L	LKD	39.6	39.6	0.0	0.0%													
		W29-U																		
		W30-L		39.6	39.6	0.0	0.0%													
		W30-U																		
		W31-L		7.3	7.3	0.0	0.0%													
		W31-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Twenty-Thir	R15	W32-L	Bedroom	3.6	3.6	0.0	0.0%													
		W32-U																		
		W33-L		39.2	39.2	0.0	0.0%													
		W33-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-Four	R1	W1-L	Bedroom	39.1	39.1	0.0	0.0%													
		W1-U																		
		W2-L		2.8	2.8	0.0	0.0%													
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Twenty-Four	R2	W3-L	LKD	6.9	6.9	0.0	0.0%													
		W3-U																		
		W4-L		38.0	38.0	0.0	0.0%													
		W4-U																		
		W5-L		38.0	38.0	0.0	0.0%													
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	77	29	77	29	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-Four	R3	W6-L	Residential	38.0	38.0	0.0	0.0%												
		W6-U																	
		W7-L		37.9	37.9	0.0	0.0%												
		W7-U						17.9	11.7	65%	11.7	65%	0.0	0.0%	70	24	70	24	0.0%	0.0%
Twenty-Four	R4	W8-L	Studio	35.0	35.0	0.0	0.0%												
		W8-U																	
		W9-L		35.9	35.9	0.0	0.0%												
		W9-U																	
		W10-L		8.8	8.8	0.0	0.0%												
		W10-U																	
		W11-L		3.0	3.0	0.0	0.0%												
		W11-U																	
		W12-L		39.5	39.5	0.0	0.0%												
		W12-U						36.7	36.2	99%	36.2	99%	0.0	0.0%	74	25	74	25	0.0%	0.0%
Twenty-Four	R5	W13-L	Bedroom	39.5	39.5	0.0	0.0%												
		W13-U						15.7	15.6	100%	15.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R6	W14-L	Bedroom	39.5	39.5	0.0	0.0%												
		W14-U						13.2	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R7	W15-L	Bedroom	39.6	39.6	0.0	0.0%												
		W15-U																	
		W16-L		3.4	3.4	0.0	0.0%												
		W16-U						14.4	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R8	W17-L	LKD	6.5	6.5	0.0	0.0%												
		W17-U																	
		W18-L		39.5	39.5	0.0	0.0%												
		W18-U																	
		W19-L		39.5	39.5	0.0	0.0%												
		W19-U						37.7	34.2	91%	34.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R9	W20-L	Bedroom	15.8	15.8	0.0	0.0%												
		W20-U																	
		W21-L		7.5	7.5	0.0	0.0%												
		W21-U						13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R10	W22-L	LKD	6.3	6.3	0.0	0.0%												
		W22-U																	
		W23-L		39.4	39.4	0.0	0.0%												
		W23-U						27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R11	W24-L	Bedroom	39.2	39.2	0.0	0.0%												
		W24-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R12	W25-L	LKD	38.7	38.7	0.0	0.0%												
		W25-U																	
		W26-L		0.6	0.6	0.0	0.0%												
		W26-U																	
		W27-L		4.8	4.8	0.0	0.0%												
		W27-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Twenty-Four	R13	W28-L	Bedroom	6.8	6.8	0.0	0.0%												
		W28-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-Four	R14	W29-L	LKD	39.6	39.6	0.0	0.0%												
		W29-U																	
		W30-L		39.6	39.6	0.0	0.0%												
		W30-U																	
		W31-L		7.3	7.3	0.0	0.0%												
		W31-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Twenty-Four	R15	W32-L	Bedroom	3.6	3.6	0.0	0.0%												
		W32-U																	
		W33-L		39.3	39.3	0.0	0.0%												
		W33-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-Fifth	R1	W1-L	Bedroom	39.2	39.2	0.0	0.0%												
		W1-U																	
		W2-L		2.8	2.8	0.0	0.0%												
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Twenty-Fifth	R2	W3-L	LKD	6.9	6.9	0.0	0.0%												
		W3-U																	
		W4-L		38.2	38.2	0.0	0.0%												
		W4-U																	
		W5-L		38.2	38.2	0.0	0.0%												
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	77	29	77	29	0.0%	0.0%
Twenty-Fifth	R3	W6-L	Residential	38.3	38.3	0.0	0.0%												
		W6-U																	
		W7-L		38.3	38.3	0.0	0.0%												
		W7-U																	
		W8-L		39.4	39.4	0.0	0.0%												
		W8-U						17.4	17.3	99%	17.3	99%	0.0	0.0%	70	24	70	24	0.0%	0.0%
Twenty-Fifth	R4	W9-L	Residential	23.7	23.7	0.0	0.0%												
		W9-U						32.6	21.7	67%	21.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R5	W10-L	Studio	39.5	39.5	0.0	0.0%												
		W10-U																	
		W11-L		39.5	39.5	0.0	0.0%												
		W11-U																	
		W12-L		7.8	7.8	0.0	0.0%												
		W12-U																	
		W13-L		7.4	7.4	0.0	0.0%												
		W13-U																	
		W14-L		39.4	39.4	0.0	0.0%												
		W14-U						36.4	36.4	100%	36.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R6	W15-L	Bedroom	39.3	39.3	0.0	0.0%												
		W15-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R7	W16-L	LKD	38.8	38.8	0.0	0.0%												
		W16-U																	
		W17-L		0.6	0.6	0.0	0.0%												
		W17-U																	
		W18-L		4.8	4.8	0.0	0.0%												
		W18-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Twenty-Fifth	R8	W19-L	Bedroom	6.8	6.8	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W19-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R9	W20-L	LKD	39.6	39.6	0.0	0.0%													
		W20-U																		
		W21-L		39.6	39.6	0.0	0.0%													
		W21-U																		
		W22-L		7.3	7.3	0.0	0.0%													
		W22-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Twenty-Fifth	R10	W23-L	Bedroom	3.6	3.6	0.0	0.0%													
		W23-U																		
		W24-L		39.3	39.3	0.0	0.0%													
		W24-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-Sixth	R1	W1-L	Bedroom	39.2	39.2	0.0	0.0%													
		W1-U																		
		W2-L		2.9	2.9	0.0	0.0%													
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Twenty-Sixth	R2	W3-L	LKD	6.9	6.9	0.0	0.0%													
		W3-U																		
		W4-L		38.3	38.3	0.0	0.0%													
		W4-U																		
		W5-L		38.3	38.3	0.0	0.0%													
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	78	30	78	30	0.0%	0.0%
Twenty-Sixth	R3	W6-L	Residential	38.4	38.4	0.0	0.0%													
		W6-U																		
		W7-L		38.5	38.5	0.0	0.0%													
		W7-U																		
		W8-L		39.4	39.4	0.0	0.0%													
		W8-U						17.4	17.3	99%	17.3	99%	0.0	0.0%	70	24	70	24	0.0%	0.0%
Twenty-Sixth	R4	W9-L	Residential	23.7	23.7	0.0	0.0%													
		W9-U						32.6	21.7	67%	21.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R5	W10-L	Studio	39.5	39.5	0.0	0.0%													
		W10-U																		
		W11-L		39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		7.8	7.8	0.0	0.0%													
		W12-U																		
		W13-L		7.4	7.4	0.0	0.0%													
		W13-U																		
		W14-L		39.4	39.4	0.0	0.0%													
		W14-U						36.4	36.4	100%	36.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R6	W15-L	Bedroom	39.3	39.3	0.0	0.0%													
		W15-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R7	W16-L	LKD	38.8	38.8	0.0	0.0%													
		W16-U																		
		W17-L		0.6	0.6	0.0	0.0%													
		W17-U																		
		W18-L		4.8	4.8	0.0	0.0%													
		W18-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-Sixth	R8	W19-L	Bedroom	6.8	6.8	0.0	0.0%												
		W19-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R9	W20-L	LKD	39.6	39.6	0.0	0.0%												
		W20-U																	
		W21-L		39.6	39.6	0.0	0.0%												
		W21-U																	
		W22-L		7.3	7.3	0.0	0.0%												
		W22-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Twenty-Sixth	R10	W23-L	Bedroom	3.6	3.6	0.0	0.0%												
		W23-U																	
		W24-L		39.3	39.3	0.0	0.0%												
		W24-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-Seve	R1	W1-L	Bedroom	39.2	39.2	0.0	0.0%												
		W1-U																	
		W2-L		2.9	2.9	0.0	0.0%												
		W2-U						11.9	11.9	100%	11.9	100%	0.0	0.0%	76	26	76	26	0.0%	0.0%
Twenty-Seve	R2	W3-L	LKD	7.0	7.0	0.0	0.0%												
		W3-U																	
		W4-L		38.4	38.4	0.0	0.0%												
		W4-U																	
		W5-L		38.4	38.4	0.0	0.0%												
		W5-U						34.8	34.7	100%	34.7	100%	0.0	0.0%	78	30	78	30	0.0%	0.0%
Twenty-Seve	R3	W6-L	Residential	38.5	38.5	0.0	0.0%												
		W6-U																	
		W7-L		38.6	38.6	0.0	0.0%												
		W7-U																	
		W8-L		39.5	39.5	0.0	0.0%												
		W8-U						17.4	17.3	99%	17.3	99%	0.0	0.0%	71	25	71	25	0.0%	0.0%
Twenty-Seve	R4	W9-L	Residential	23.8	23.8	0.0	0.0%												
		W9-U						32.6	21.7	67%	21.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R5	W10-L	Studio	39.5	39.5	0.0	0.0%												
		W10-U																	
		W11-L		39.5	39.5	0.0	0.0%												
		W11-U																	
		W12-L		7.8	7.8	0.0	0.0%												
		W12-U																	
		W13-L		7.4	7.4	0.0	0.0%												
		W13-U																	
		W14-L		39.4	39.4	0.0	0.0%												
		W14-U						36.4	36.4	100%	36.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R6	W15-L	Bedroom	39.3	39.3	0.0	0.0%												
		W15-U						14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R7	W16-L	LKD	38.8	38.8	0.0	0.0%												
		W16-U																	
		W17-L		0.6	0.6	0.0	0.0%												
		W17-U																	
		W18-L		4.8	4.8	0.0	0.0%												
		W18-U						29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Seve	R8	W19-L	Bedroom	6.8	6.8	0.0	0.0%													
		W19-U						12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R9	W20-L	LKD	39.6	39.6	0.0	0.0%													
		W20-U																		
		W21-L		39.6	39.6	0.0	0.0%													
		W21-U																		
		W22-L		7.3	7.3	0.0	0.0%													
		W22-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
Twenty-Seve	R10	W23-L	Bedroom	3.6	3.6	0.0	0.0%													
		W23-U																		
		W24-L		39.3	39.3	0.0	0.0%													
		W24-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-Eigh	R1	W1-L	Studio	39.2	39.2	0.0	0.0%													
		W1-U																		
		W2-L		5.7	5.7	0.0	0.0%													
		W2-U																		
		W3-L		6.7	6.7	0.0	0.0%													
		W3-U																		
		W4-L		38.5	38.5	0.0	0.0%													
		W4-U																		
		W5-L		38.6	38.6	0.0	0.0%													
		W5-U						39.0	38.6	99%	38.6	99%	0.0	0.0%	100	30	100	30	0.0%	0.0%
Twenty-Eigh	R2	W6-L	Residential	38.6	38.6	0.0	0.0%													
		W6-U																		
		W7-L		38.7	38.7	0.0	0.0%													
		W7-U																		
		W8-L		39.5	39.5	0.0	0.0%													
		W8-U						17.4	17.3	99%	17.3	99%	0.0	0.0%	71	25	71	25	0.0%	0.0%
Twenty-Eigh	R3	W9-L	Residential	23.8	23.8	0.0	0.0%													
		W9-U						32.5	21.7	67%	21.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R4	W10-L	Studio	39.6	39.6	0.0	0.0%													
		W10-U																		
		W11-L		39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		7.6	7.6	0.0	0.0%													
		W12-U																		
		W13-L		7.5	7.5	0.0	0.0%													
		W13-U																		
		W14-L		39.4	39.4	0.0	0.0%													
		W14-U						36.4	36.4	100%	36.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R5	W15-L	Bedroom	39.3	39.3	0.0	0.0%													
		W15-U						14.5	14.5	100%	14.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R6	W16-L	LKD	38.8	38.8	0.0	0.0%													
		W16-U																		
		W17-L		0.6	0.6	0.0	0.0%													
		W17-U																		
		W18-L		3.6	3.6	0.0	0.0%													
		W18-U						28.6	28.2	98%	28.2	98%	0.0	0.0%	20	2	20	2	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Eigh	R7	W19-L	Bedroom	7.6	7.6	0.0	0.0%													
		W19-U						8.4	8.4	100%	8.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R8	W20-L	LKD	39.6	39.6	0.0	0.0%													
		W20-U																		
		W21-L		39.5	39.5	0.0	0.0%													
		W21-U																		
		W22-L		7.7	7.7	0.0	0.0%													
		W22-U						28.9	28.1	97%	28.1	97%	0.0	0.0%	33	9	33	9	0.0%	0.0%
Twenty-Eigh	R9	W23-L	Bedroom	7.5	7.5	0.0	0.0%													
		W23-U																		
		W24-L		39.3	39.3	0.0	0.0%													
		W24-U						13.1	13.1	100%	13.1	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Twenty-Nint	R1	W1-L	Studio	39.3	39.3	0.0	0.0%													
		W1-U																		
		W2-L		5.7	5.7	0.0	0.0%													
		W2-U																		
		W3-L		6.7	6.7	0.0	0.0%													
		W3-U																		
		W4-L		38.6	38.6	0.0	0.0%													
		W4-U																		
		W5-L		38.6	38.6	0.0	0.0%													
		W5-U						39.0	38.6	99%	38.6	99%	0.0	0.0%	100	30	100	30	0.0%	0.0%
Twenty-Nint	R2	W6-L	Residential	38.7	38.7	0.0	0.0%													
		W6-U																		
		W7-L		38.7	38.7	0.0	0.0%													
		W7-U																		
		W8-L		39.5	39.5	0.0	0.0%													
		W8-U						17.4	17.3	99%	17.3	99%	0.0	0.0%	71	25	71	25	0.0%	0.0%
Twenty-Nint	R3	W9-L	Residential	24.1	24.1	0.0	0.0%													
		W9-U						32.5	21.7	67%	21.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Nint	R4	W10-L	Studio	39.6	39.6	0.0	0.0%													
		W10-U																		
		W11-L		39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		7.6	7.6	0.0	0.0%													
		W12-U																		
		W13-L		7.5	7.5	0.0	0.0%													
		W13-U																		
		W14-L		39.5	39.5	0.0	0.0%													
		W14-U						36.4	36.4	100%	36.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Nint	R5	W15-L	Bedroom	39.4	39.4	0.0	0.0%													
		W15-U						14.5	14.5	100%	14.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Nint	R6	W16-L	LKD	38.9	38.9	0.0	0.0%													
		W16-U																		
		W17-L		0.6	0.6	0.0	0.0%													
		W17-U																		
		W18-L		3.6	3.6	0.0	0.0%													
		W18-U						28.6	28.2	98%	28.2	98%	0.0	0.0%	21	2	21	2	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Nint	R7	W19-L	Bedroom	7.6	7.6	0.0	0.0%													
		W19-U						8.4	8.4	100%	8.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Nint	R8	W20-L	LKD	39.6	39.6	0.0	0.0%													
		W20-U																		
		W21-L		39.5	39.5	0.0	0.0%													
		W21-U																		
		W22-L		7.6	7.6	0.0	0.0%													
		W22-U						28.9	28.1	97%	28.1	97%	0.0	0.0%	33	9	33	9	0.0%	0.0%
Twenty-Nint	R9	W23-L	Bedroom	7.5	7.5	0.0	0.0%													
		W23-U																		
		W24-L		39.3	39.3	0.0	0.0%													
		W24-U						13.1	13.1	100%	13.1	100%	0.0	0.0%	75	25	75	25	0.0%	0.0%
Thirtieth	R1	W1-L	Living Room	10.4	10.4	0.0	0.0%													
		W1-U																		
		W2-L		39.4	39.4	0.0	0.0%													
		W2-U																		
		W3-L		39.2	39.2	0.0	0.0%													
		W3-U																		
		W4-L		39.4	39.4	0.0	0.0%													
		W4-U																		
		W5-L		3.4	3.4	0.0	0.0%													
		W5-U						79.0	79.0	100%	79.0	100%	0.0	0.0%	77	27	77	27	0.0%	0.0%
Thirtieth	R2	W6-L	Residential	9.0	9.0	0.0	0.0%													
		W6-U																		
		W7-L		38.9	38.9	0.0	0.0%													
		W7-U																		
		W8-L		38.9	38.9	0.0	0.0%													
		W8-U																		
		W9-L		39.6	39.6	0.0	0.0%													
		W9-U						17.4	17.4	100%	17.4	100%	0.0	0.0%	73	27	73	27	0.0%	0.0%
Thirtieth	R3	W10	Residential	38.5	38.5	0.0	0.0%													
		W11-L		38.9	38.9	0.0	0.0%													
		W11-U																		
		W12		11.3	11.3	0.0	0.0%	29.6	29.3	99%	29.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 5

Results of the consented baseline daylight and sunlight assessments

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ferry Island Building 1																			
First	R1	W1-L	LKD	11.6	11.4	0.2	1.4%												
		W1-U						34.9	18.9	54%	18.9	54%	0.0	0.0%	21	10	21	10	0.0%	0.0%
First	R2	W2	Bedroom	12.1	11.7	0.3	2.7%	13.5	6.6	49%	6.6	49%	0.0	0.0%	19	7	19	7	0.0%	0.0%
First	R3	W3	Residential	12.9	12.3	0.5	4.1%	19.7	11.7	60%	11.7	59%	0.0	0.3%	22	9	22	9	0.0%	0.0%
First	R4	W4	Residential	16.8	15.7	1.0	6.2%													
		W5		18.4	17.6	0.8	4.1%	18.4	13.1	71%	12.9	70%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W6	Residential	18.4	18.0	0.4	2.2%													
		W7		20.2	20.1	0.1	0.5%	14.1	13.6	96%	13.5	96%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W8	Residential	19.9	19.9	-0.1	-0.3%	17.0	13.3	79%	13.4	79%	0.0	-0.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W9	Bedroom	19.6	19.6	-0.1	-0.4%	15.1	12.2	81%	12.3	81%	-0.1	-0.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W10	LKD	18.8	18.9	-0.1	-0.4%													
		W11		31.0	31.0	0.0	0.0%	24.2	22.4	93%	22.4	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	12.2	12.0	0.2	1.3%													
		W1-U						34.9	18.9	54%	18.9	54%	0.0	0.0%	22	10	22	10	0.0%	0.0%
Second	R2	W2	Bedroom	12.7	12.4	0.3	2.7%	13.5	6.8	51%	6.8	51%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Second	R3	W3	Bedroom	13.5	13.0	0.5	3.9%	14.9	10.4	69%	10.4	69%	0.0	0.2%	23	9	23	9	0.0%	0.0%
Second	R4	W4	Bedroom	17.5	16.5	1.0	5.9%	10.9	4.7	43%	4.7	43%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W5	LKD	19.2	18.4	0.8	4.0%													
		W6		19.3	18.9	0.4	2.1%													
		W7		21.4	21.3	0.1	0.5%	41.8	37.3	89%	36.9	88%	0.4	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W8	Bedroom	21.2	21.3	-0.1	-0.3%	13.6	11.9	88%	11.9	88%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W9	Bedroom	21.0	21.0	-0.1	-0.3%	15.1	12.7	84%	12.7	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W10	LKD	20.3	20.4	-0.1	-0.3%													
		W11		31.8	31.8	0.0	0.0%	24.2	23.3	96%	23.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	12.8	12.7	0.2	1.2%													
		W1-U						34.9	18.8	54%	18.8	54%	0.0	0.0%	22	10	22	10	0.0%	0.0%
Third	R2	W2	Bedroom	13.5	13.2	0.3	2.4%	13.5	7.1	53%	7.1	53%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Third	R3	W3	Bedroom	14.3	13.8	0.5	3.7%	14.9	10.7	72%	10.7	72%	0.0	0.1%	24	9	24	9	0.0%	0.0%
Third	R4	W4	Bedroom	18.4	17.3	1.0	5.7%	10.9	5.0	46%	5.0	46%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W5	LKD	20.0	19.2	0.8	3.9%													
		W6		20.1	19.7	0.4	2.0%													
		W7		22.6	22.5	0.1	0.5%	41.8	37.8	90%	37.3	89%	0.5	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W8	Bedroom	22.5	22.5	-0.1	-0.2%	13.6	12.0	88%	12.0	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R7	W9	Bedroom	22.4	22.4	0.0	-0.2%	15.1	12.8	84%	12.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W10	LKD	21.9	21.9	0.0	-0.2%													
		W11		32.7	32.7	0.0	0.0%	24.2	23.6	97%	23.6	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	13.7	13.4	0.2	1.5%													
		W1-U						34.9	18.8	54%	18.8	54%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Fourth	R2	W2	Bedroom	14.4	14.0	0.4	2.5%	13.5	7.6	56%	7.6	56%	0.0	0.1%	21	7	21	7	0.0%	0.0%
Fourth	R3	W3	Bedroom	15.3	14.7	0.5	3.5%	14.9	11.1	74%	11.1	74%	0.0	0.1%	25	9	25	9	0.0%	0.0%
Fourth	R4	W4	Bedroom	19.3	18.2	1.0	5.4%	10.9	5.5	50%	5.5	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W5	LKD	20.8	20.0	0.8	3.7%													
		W6		21.1	20.7	0.4	2.0%													
		W7		23.7	23.6	0.1	0.6%	41.8	38.0	91%	37.5	90%	0.5	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W8	Bedroom	23.7	23.7	0.0	0.0%	13.6	12.1	89%	12.1	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W9	Bedroom	23.7	23.7	0.0	0.0%	15.1	12.9	85%	12.9	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W10	LKD	23.4	23.4	0.0	0.0%													
		W11		33.6	33.6	0.0	0.0%	24.2	23.8	98%	23.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	14.6	14.4	0.3	1.7%													
		W1-U						34.9	18.7	54%	18.7	54%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Fifth	R2	W2	Bedroom	15.4	15.0	0.4	2.8%	13.5	7.9	59%	7.9	59%	0.0	0.2%	22	7	22	7	0.0%	0.0%
Fifth	R3	W3	Bedroom	16.3	15.8	0.5	3.2%	14.9	11.4	76%	11.4	76%	0.0	0.0%	27	9	27	9	0.0%	0.0%
Fifth	R4	W4	Bedroom	20.2	19.2	1.0	5.1%	10.9	5.9	54%	5.9	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W5	LKD	21.7	20.9	0.8	3.5%													
		W6		22.0	21.6	0.4	1.9%													
		W7		24.9	24.7	0.2	0.6%	41.8	38.1	91%	37.7	90%	0.5	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W8	Bedroom	24.8	24.8	0.0	0.0%	13.6	12.2	90%	12.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W9	Bedroom	24.8	24.8	0.0	0.0%	15.1	13.0	86%	13.0	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W10	LKD	24.7	24.7	0.0	0.0%													
		W11		34.3	34.3	0.0	0.0%	24.2	23.8	99%	23.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	15.6	15.3	0.3	1.9%													
		W1-U						34.9	18.7	54%	18.7	54%	0.0	0.0%	24	10	24	10	0.0%	0.0%
Sixth	R2	W2	Bedroom	16.3	15.9	0.5	2.9%	13.5	8.2	60%	8.1	60%	0.0	0.2%	22	7	22	7	0.0%	0.0%
Sixth	R3	W3	Bedroom	17.2	16.7	0.5	3.0%	14.9	11.6	77%	11.6	77%	0.0	0.0%	28	9	28	9	0.0%	0.0%
Sixth	R4	W4	Bedroom	20.8	19.8	1.0	4.8%	10.9	6.3	58%	6.3	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W5	LKD	22.3	21.5	0.7	3.3%													
		W6		22.6	22.2	0.4	1.8%													
		W7		25.7	25.5	0.2	0.6%	41.8	38.3	92%	37.8	91%	0.5	1.2%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R6	W8	Bedroom	25.7	25.7	0.0	0.0%	13.6	12.4	91%	12.4	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W9	Bedroom	25.7	25.7	0.0	0.0%	15.1	13.1	87%	13.1	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W10	LKD	25.6	25.6	0.0	0.0%													
		W11		34.6	34.6	0.0	0.0%	24.2	23.8	98%	23.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W1-L	LKD	9.3	9.3	0.0	0.0%													
		W1-U						36.5	18.2	50%	18.2	50%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Seventh	R8	W2-L	Bedroom	10.7	10.7	0.0	0.0%													
		W2-U						11.7	6.6	57%	6.6	57%	0.0	0.0%	11	0	11	0	0.0%	0.0%
Seventh	R9	W3-L	Bedroom	10.6	9.6	0.9	8.8%													
		W3-U						15.1	4.8	32%	4.8	32%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R10	W4-L	LKD	12.1	11.4	0.7	5.4%													
		W4-U																		
		W5-L		14.0	13.5	0.5	3.3%													
		W5-U																		
		W6-L		15.1	14.9	0.1	0.9%													
		W6-U						35.8	31.2	87%	30.5	85%	0.7	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R11	W7-L	Bedroom	14.8	14.8	0.0	0.0%													
		W7-U						10.3	7.5	73%	7.5	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R12	W8-L	Bedroom	14.2	14.2	0.0	0.0%													
		W8-U						10.9	9.7	89%	9.7	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W1-L	LKD	3.4	3.4	0.0	0.0%													
		W1-U						36.5	16.6	45%	16.6	45%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Eighth	R8	W2-L	Bedroom	4.4	4.4	0.0	0.0%													
		W2-U						11.7	5.8	50%	5.8	50%	0.0	0.1%	4	0	4	0	0.0%	0.0%
Eighth	R9	W3-L	Bedroom	5.0	4.1	0.9	17.3%													
		W3-U						15.1	4.3	29%	4.3	29%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W4-L	LKD	6.3	5.7	0.6	9.6%													
		W4-U																		
		W5-L		6.8	6.4	0.4	6.2%													
		W5-U																		
		W6-L		6.7	6.6	0.1	1.8%													
		W6-U						35.8	30.3	85%	29.4	82%	0.9	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W7-L	Bedroom	6.9	6.9	0.0	0.0%													
		W7-U						10.3	6.8	65%	6.8	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R12	W8-L	Bedroom	6.2	6.2	0.0	0.0%													
		W8-U						10.9	8.9	81%	8.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1-L	LKD	22.2	22.0	0.3	1.1%													
		W1-U						38.5	22.6	59%	22.6	59%	0.0	0.0%	37	10	37	10	0.0%	0.0%
Ninth	R2	W2-L	Bedroom	22.5	22.1	0.4	1.8%													
		W2-U						11.4	9.9	87%	9.9	87%	0.0	0.0%	38	9	38	9	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Ninth	R3	W3-L	LKD	22.8	22.4	0.4	1.8%													
		W3-U																		
		W4-L		24.4	23.6	0.9	3.5%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	42	12	42	12	0.0%	0.0%
Ninth	R4	W5-L	Bedroom	25.7	25.0	0.7	2.7%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W6-L	LKD	26.6	26.2	0.4	1.5%													
		W6-U																		
		W7-L		4.6	4.6	0.0	0.0%													
		W7-U																		
		W8-L		4.6	4.5	0.1	1.3%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9-L	Bedroom	3.5	3.4	0.1	2.0%													
		W9-U																		
		W10-L		30.3	30.3	0.0	0.0%													
		W10-U						15.1	13.9	92%	13.9	92%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Ninth	R7	W11-L	LKD	30.4	30.4	0.0	0.0%													
		W11-U																		
		W12-L		30.4	30.4	0.0	0.0%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.1	97%	38.1	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		37.6	37.6	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1-L	LKD	25.3	25.1	0.2	0.9%													
		W1-U						38.5	27.0	70%	27.0	70%	0.0	0.0%	43	12	43	12	0.0%	0.0%
Tenth	R2	W2-L	Bedroom	25.1	24.7	0.4	1.4%													
		W2-U						11.4	10.4	91%	10.4	91%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Tenth	R3	W3-L	LKD	25.0	24.7	0.4	1.5%													
		W3-U																		
		W4-L		25.6	24.8	0.8	3.2%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	44	14	44	14	0.0%	0.0%
Tenth	R4	W5-L	Bedroom	26.9	26.2	0.7	2.5%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W6-L	LKD	27.8	27.4	0.4	1.5%													
		W6-U																		
		W7-L		5.1	5.1	0.0	0.0%													
		W7-U																		
		W8-L		5.4	5.3	0.1	2.0%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9-L	Bedroom	3.8	3.7	0.1	2.7%													
		W9-U																		
		W10-L		31.8	31.7	0.0	0.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	13.9	92%	13.9	92%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Tenth	R7	W11-L	LKD	31.9	31.9	0.0	0.0%													
		W11-U																		
		W12-L		31.9	31.8	0.0	0.0%													
		W12-U																		
		W13-L		11.7	11.7	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		38.1	38.1	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1-L	LKD	28.3	28.1	0.2	0.8%													
		W1-U						38.5	31.0	81%	31.0	81%	0.0	0.0%	48	15	48	15	0.0%	0.0%
Eleventh	R2	W2-L	Bedroom	27.7	27.4	0.3	1.2%													
		W2-U						11.4	10.4	91%	10.4	91%	0.0	0.0%	45	14	45	14	0.0%	0.0%
Eleventh	R3	W3-L	LKD	27.3	26.9	0.4	1.3%													
		W3-U																		
		W4-L		26.9	26.1	0.8	3.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	45	15	45	15	0.0%	0.0%
Eleventh	R4	W5-L	Bedroom	28.1	27.4	0.7	2.5%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W6-L	LKD	29.1	28.6	0.5	1.8%													
		W6-U																		
		W7-L		5.6	5.6	0.0	0.0%													
		W7-U																		
		W8-L		6.2	6.0	0.2	3.9%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9-L	Bedroom	4.0	3.9	0.2	4.2%													
		W9-U																		
		W10-L		33.2	33.0	0.2	0.5%													
		W10-U						15.1	14.0	93%	14.0	93%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Eleventh	R7	W11-L	LKD	33.3	33.1	0.1	0.5%													
		W11-U																		
		W12-L		33.3	33.1	0.2	0.5%													
		W12-U																		
		W13-L		11.8	11.8	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		38.5	38.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1-L	LKD	31.0	30.8	0.2	0.7%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	49	17	49	17	0.0%	0.0%
Twelfth	R2	W2-L	Bedroom	30.0	29.7	0.3	1.0%													
		W2-U						11.4	10.4	92%	10.4	92%	0.0	0.0%	47	17	47	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twelfth	R3	W3-L	LKD	29.2	28.8	0.3	1.1%													
		W3-U																		
		W4-L		27.9	27.1	0.8	2.8%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	46	17	46	17	0.0%	0.0%
Twelfth	R4	W5-L	Bedroom	29.1	28.4	0.7	2.5%													
		W5-U						11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W6-L	LKD	30.2	29.6	0.6	2.0%													
		W6-U																		
		W7-L		5.6	5.6	0.0	0.0%													
		W7-U																		
		W8-L		6.5	6.1	0.4	6.0%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9-L	Bedroom	4.0	3.7	0.2	6.0%													
		W9-U																		
		W10-L		34.3	33.9	0.4	1.1%													
		W10-U						15.1	14.1	93%	14.1	93%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Twelfth	R7	W11-L	LKD	34.4	34.0	0.4	1.0%													
		W11-U																		
		W12-L		34.4	34.1	0.4	1.0%													
		W12-U																		
		W13-L		11.2	11.2	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W14-L	Bedroom	2.5	2.5	0.0	0.0%													
		W14-U																		
		W15-L		38.5	38.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1-L	LKD	33.2	33.0	0.2	0.6%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Thirteenth	R2	W2-L	Bedroom	32.0	31.8	0.3	0.9%													
		W2-U						11.4	10.7	94%	10.7	94%	0.0	0.0%	50	18	50	18	0.0%	0.0%
Thirteenth	R3	W3-L	LKD	31.0	30.7	0.3	1.0%													
		W3-U																		
		W4-L		29.6	28.8	0.8	2.6%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	50	19	50	19	0.0%	0.0%
Thirteenth	R4	W5-L	Bedroom	30.8	30.1	0.7	2.4%													
		W5-U						11.6	8.9	77%	8.9	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W6-L	LKD	32.0	31.3	0.7	2.2%													
		W6-U																		
		W7-L		6.5	6.5	0.0	0.0%													
		W7-U																		
		W8-L		7.9	7.3	0.5	6.9%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W9-L	Bedroom	4.5	4.2	0.3	7.0%													
		W9-U																		
		W10-L		35.9	35.4	0.6	1.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.2	94%	14.2	94%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Thirteenth	R7	W11-L	LKD	36.0	35.5	0.5	1.5%													
		W11-U																		
		W12-L		36.0	35.5	0.5	1.4%													
		W12-U																		
		W13-L		12.0	12.0	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.1	39.1	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1-L	LKD	34.0	33.9	0.2	0.5%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	53	19	53	19	0.0%	0.0%
Fourteenth	R2	W2-L	Bedroom	32.9	32.6	0.3	0.8%													
		W2-U						11.4	10.9	96%	10.9	96%	0.0	0.0%	51	19	51	19	0.0%	0.0%
Fourteenth	R3	W3-L	LKD	31.8	31.5	0.3	0.8%													
		W3-U																		
		W4-L		30.7	30.0	0.7	2.3%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	49	19	49	19	0.0%	0.0%
Fourteenth	R4	W5-L	Bedroom	31.9	31.2	0.7	2.2%													
		W5-U						11.6	9.0	77%	9.0	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W6-L	LKD	33.1	32.4	0.7	2.2%													
		W6-U																		
		W7-L		6.8	6.8	0.0	0.0%													
		W7-U																		
		W8-L		8.4	7.8	0.6	7.2%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W9-L	Bedroom	4.7	4.3	0.4	7.5%													
		W9-U																		
		W10-L		36.8	36.2	0.7	1.8%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Fourteenth	R7	W11-L	LKD	36.9	36.3	0.6	1.7%													
		W11-U																		
		W12-L		36.9	36.3	0.6	1.5%													
		W12-U																		
		W13-L		12.0	12.0	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.2	39.2	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R1	W1-L	LKD	34.8	34.6	0.1	0.4%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	53	18	53	18	0.0%	0.0%
Fifteenth	R2	W2-L	Bedroom	33.7	33.5	0.2	0.7%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	19	50	19	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifteenth	R3	W3-L	LKD	32.7	32.4	0.2	0.7%													
		W3-U																		
		W4-L		31.7	31.1	0.6	1.9%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	18	48	18	0.0%	0.0%
Fifteenth	R4	W5-L	Bedroom	32.8	32.2	0.6	1.9%													
		W5-U						11.6	9.1	78%	9.1	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W6-L	LKD	33.9	33.3	0.6	1.9%													
		W6-U																		
		W7-L		7.2	7.2	0.0	0.0%													
		W7-U																		
		W8-L		8.5	8.0	0.5	6.0%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R6	W9-L	Bedroom	4.7	4.4	0.3	6.4%													
		W9-U																		
		W10-L		37.4	36.8	0.5	1.5%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fifteenth	R7	W11-L	LKD	37.4	36.9	0.5	1.4%													
		W11-U																		
		W12-L		37.4	36.9	0.5	1.3%													
		W12-U																		
		W13-L		12.1	12.1	0.0	0.0%													
		W13-U						39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.2	39.2	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R1	W1-L	LKD	35.6	35.5	0.1	0.3%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	54	20	54	20	0.0%	0.0%
Sixteenth	R2	W2-L	Bedroom	34.7	34.5	0.2	0.5%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	19	50	19	0.0%	0.0%
Sixteenth	R3	W3-L	LKD	33.7	33.5	0.2	0.6%													
		W3-U																		
		W4-L		32.9	32.4	0.5	1.6%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	18	48	18	0.0%	0.0%
Sixteenth	R4	W5-L	Bedroom	33.9	33.4	0.5	1.5%													
		W5-U						11.6	9.4	81%	9.4	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W6-L	LKD	34.9	34.3	0.5	1.5%													
		W6-U																		
		W7-L		7.5	7.5	0.0	0.0%													
		W7-U																		
		W8-L		8.7	8.2	0.4	5.1%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R6	W9-L	Bedroom	4.7	4.4	0.3	5.3%													
		W9-U																		
		W10-L		37.9	37.4	0.5	1.2%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Sixteenth	R7	W11-L	LKD	38.0	37.5	0.4	1.2%													
		W11-U																		
		W12-L		38.0	37.6	0.4	1.1%													
		W12-U																		
		W13-L		12.1	12.1	0.0	0.0%													
		W13-U						39.2	38.5	98%	38.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.3	39.3	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R1	W1-L	LKD	36.4	36.3	0.1	0.3%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Seventeenth	R2	W2-L	Bedroom	35.7	35.5	0.1	0.4%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Seventeenth	R3	W3-L	LKD	34.9	34.8	0.2	0.5%													
		W3-U																		
		W4-L		34.2	33.8	0.4	1.2%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	47	17	47	17	0.0%	0.0%
Seventeenth	R4	W5-L	Bedroom	35.1	34.7	0.4	1.2%													
		W5-U						11.6	10.0	86%	10.0	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W6-L	LKD	35.9	35.5	0.4	1.2%													
		W6-U																		
		W7-L		7.8	7.8	0.0	0.0%													
		W7-U																		
		W8-L		8.8	8.5	0.4	4.0%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R6	W9-L	Bedroom	4.7	4.5	0.2	4.3%													
		W9-U																		
		W10-L		38.4	38.0	0.4	1.0%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Seventeenth	R7	W11-L	LKD	38.4	38.1	0.4	0.9%													
		W11-U																		
		W12-L		38.5	38.2	0.3	0.9%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.3	39.3	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R1	W1-L	LKD	37.0	37.0	0.1	0.2%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	51	17	51	17	0.0%	0.0%
Eighteenth	R2	W2-L	Bedroom	36.5	36.4	0.1	0.3%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	17	50	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighteenth	R3	W3-L	LKD	36.0	35.9	0.1	0.3%													
		W3-U																		
		W4-L		35.5	35.2	0.3	0.9%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	48	17	48	17	0.0%	0.0%
Eighteenth	R4	W5-L	Bedroom	36.1	35.8	0.3	0.9%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R5	W6-L	LKD	36.7	36.4	0.3	0.9%													
		W6-U																		
		W7-L		7.5	7.5	0.0	0.0%													
		W7-U																		
		W8-L		8.4	8.1	0.3	3.3%													
		W8-U						28.7	28.1	98%	28.1	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R6	W9-L	Bedroom	4.4	4.2	0.2	3.7%													
		W9-U																		
		W10-L		38.5	38.3	0.3	0.8%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighteenth	R7	W11-L	LKD	38.6	38.4	0.3	0.7%													
		W11-U																		
		W12-L		38.7	38.4	0.3	0.7%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R8	W14-L	Bedroom	2.5	2.5	0.0	0.0%													
		W14-U																		
		W15-L		39.0	39.0	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R1	W1-L	LKD	38.4	38.3	0.1	0.2%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Nineteenth	R2	W2-L	Bedroom	38.1	38.0	0.1	0.2%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Nineteenth	R3	W3-L	LKD	37.8	37.7	0.1	0.2%													
		W3-U																		
		W4-L		37.5	37.3	0.2	0.6%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Nineteenth	R4	W5-L	Bedroom	37.9	37.7	0.2	0.6%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R5	W6-L	LKD	38.2	38.0	0.2	0.6%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	8.8	0.2	2.2%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R6	W9-L	Bedroom	4.7	4.6	0.1	2.3%													
		W9-U																		
		W10-L		39.3	39.1	0.2	0.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Nineteenth	R7	W11-L	LKD	39.3	39.1	0.2	0.5%													
		W11-U																		
		W12-L		39.4	39.2	0.2	0.5%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R1	W1-L	LKD	39.2	39.1	0.0	0.1%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twentieth	R2	W2-L	Bedroom	39.1	39.1	0.1	0.1%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twentieth	R3	W3-L	LKD	39.0	39.0	0.1	0.1%													
		W3-U																		
		W4-L		39.0	38.9	0.1	0.4%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twentieth	R4	W5-L	Bedroom	39.1	38.9	0.1	0.4%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R5	W6-L	LKD	39.2	39.0	0.1	0.4%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	8.8	0.1	1.4%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W9-L	Bedroom	4.7	4.6	0.1	1.5%													
		W9-U																		
		W10-L		39.4	39.3	0.1	0.3%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twentieth	R7	W11-L	LKD	39.4	39.3	0.1	0.3%													
		W11-U																		
		W12-L		39.4	39.3	0.1	0.3%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R1	W1-L	LKD	39.4	39.4	0.0	0.1%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-First	R2	W2-L	Bedroom	39.5	39.4	0.0	0.1%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twenty-First	R3	W3-L	LKD	39.4	39.4	0.0	0.1%													
		W3-U																		
		W4-L		39.5	39.4	0.1	0.2%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Twenty-First	R4	W5-L	Bedroom	39.5	39.4	0.1	0.2%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R5	W6-L	LKD	39.5	39.4	0.1	0.2%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	8.9	0.1	0.6%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W9-L	Bedroom	4.7	4.7	0.0	0.6%													
		W9-U																		
		W10-L		39.5	39.4	0.1	0.2%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-First	R7	W11-L	LKD	39.5	39.4	0.1	0.1%													
		W11-U																		
		W12-L		39.5	39.4	0.1	0.1%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twenty-Secc	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Twenty-Secc	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Twenty-Secc	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	39.4	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Secc	R7	W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Secc	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Twenty-Thir	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Twenty-Thir	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.4	39.4	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%
Twenty-Thir	R4	W5-L	Bedroom	39.4	39.4	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R5	W6-L	LKD	39.4	39.4	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	39.4	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Thir	R7	W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Thir	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R1	W1-L	LKD	39.0	39.0	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Twenty-Four	R2	W2-L	Bedroom	39.1	39.1	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	52	17	52	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Four	R3	W3-L	LKD	39.1	39.1	0.0	0.0%													
		W3-U																		
		W4-L		39.1	39.1	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Twenty-Four	R4	W5-L	Bedroom	39.1	39.1	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R5	W6-L	LKD	39.1	39.1	0.0	0.0%													
		W6-U																		
		W7-L		7.6	7.6	0.0	0.0%													
		W7-U																		
		W8-L		8.4	8.4	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R6	W9-L	Bedroom	4.4	4.4	0.0	0.0%													
		W9-U																		
		W10-L		39.1	39.1	0.0	0.0%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Twenty-Four	R7	W11-L	LKD	39.0	39.0	0.0	0.0%													
		W11-U																		
		W12-L		39.1	39.1	0.0	0.0%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.0	39.0	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Fifth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Fifth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Fifth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Fifth	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Fifth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Sixth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Sixth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twenty-Sixth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Sixth	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Sixth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twenty-Seve	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Twenty-Seve	R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.5	39.5	0.0	0.0%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Twenty-Seve	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R5	W6-L	LKD	39.5	39.5	0.0	0.0%												
		W6-U																	
		W7-L		8.2	8.2	0.0	0.0%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.5	39.5	0.0	0.0%												
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Twenty-Seve	R7	W11-L	LKD	39.5	39.5	0.0	0.0%												
		W11-U																	
		W12-L		39.5	39.5	0.0	0.0%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Seve	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.4	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R1	W1-L	LKD	39.4	39.4	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Twenty-Eigh	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Twenty-Eigh	R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.5	39.5	0.0	0.0%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Twenty-Eigh	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R5	W6-L	LKD	39.5	39.5	0.0	0.0%												
		W6-U																	
		W7-L		8.2	8.2	0.0	0.0%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Eigh	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.4	39.4	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
	Twenty-Eigh R7	W11-L	LKD	39.4	39.4	0.0	0.0%												
		W11-U																	
		W12-L		39.4	39.4	0.0	0.0%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Eigh R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.4	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Nint R1	W1-L	LKD	39.4	39.4	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	54	18	54	18	0.0%	0.0%
	Twenty-Nint R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	54	18	54	18	0.0%	0.0%
	Twenty-Nint R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.4	39.4	0.0	0.0%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%
	Twenty-Nint R4	W5-L	Bedroom	39.4	39.4	0.0	0.0%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Nint R5	W6-L	LKD	39.4	39.4	0.0	0.0%												
		W6-U																	
		W7-L		8.2	8.2	0.0	0.0%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Nint R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.4	39.4	0.0	0.0%												
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
	Twenty-Nint R7	W11-L	LKD	39.4	39.4	0.0	0.0%												
		W11-U																	
		W12-L		39.4	39.4	0.0	0.0%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Twenty-Nint R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.4	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	Thirtieth R1	W1-L	LKD	39.0	39.0	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	17	52	17	0.0%	0.0%
	Thirtieth R2	W2-L	Bedroom	39.1	39.1	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	52	17	52	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirtieth	R3	W3-L	LKD	39.1	39.1	0.0	0.0%													
		W3-U																		
		W4-L		39.1	39.1	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Thirtieth	R4	W5-L	Bedroom	39.1	39.1	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R5	W6-L	LKD	39.1	39.1	0.0	0.0%													
		W6-U																		
		W7-L		7.6	7.6	0.0	0.0%													
		W7-U																		
		W8-L		8.4	8.4	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R6	W9-L	Bedroom	4.4	4.4	0.0	0.0%													
		W9-U																		
		W10-L		39.1	39.1	0.0	0.0%													
		W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Thirtieth	R7	W11-L	LKD	39.0	39.0	0.0	0.0%													
		W11-U																		
		W12-L		39.1	39.1	0.0	0.0%													
		W12-U																		
		W13-L		11.5	11.5	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirtieth	R8	W14-L	Bedroom	2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		39.0	39.0	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-First	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-First	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-First	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-First	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-First	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Secon	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Secon	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Secon	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Secon	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Secon	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Third	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirty-Third	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Thirty-Third	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Third	R7	W11-L	LKD	39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
		W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Third	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Thirty-Fourth	R2	W2-L	Bedroom	39.5	39.5	0.0	0.0%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Thirty-Fourth	R3	W3-L	LKD	39.5	39.5	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Thirty-Fourth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%													
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.5	39.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Fourth	R7	W11-L	LKD	39.5	39.5	0.0	0.0%												
		W11-U																	
		W12-L		39.5	39.5	0.0	0.0%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fourth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.4	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R1	W1-L	LKD	39.4	39.4	0.0	0.0%												
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	56	20	56	20	0.0%	0.0%
Thirty-Fifth	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%												
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	55	19	55	19	0.0%	0.0%
Thirty-Fifth	R3	W3-L	LKD	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		39.5	39.5	0.0	0.0%												
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Thirty-Fifth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%												
		W5-U						11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%												
		W6-U																	
		W7-L		8.2	8.2	0.0	0.0%												
		W7-U																	
		W8-L		9.0	9.0	0.0	0.0%												
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R6	W9-L	Bedroom	4.7	4.7	0.0	0.0%												
		W9-U																	
		W10-L		39.4	39.4	0.0	0.0%												
		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Fifth	R7	W11-L	LKD	39.4	39.4	0.0	0.0%												
		W11-U																	
		W12-L		39.4	39.4	0.0	0.0%												
		W12-U																	
		W13-L		12.2	12.2	0.0	0.0%												
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%												
		W14-U																	
		W15-L		39.4	39.4	0.0	0.0%												
		W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R1	W1-L	Bedroom	19.3	19.3	0.0	0.0%												
		W1-U																	
		W2-L		39.4	39.4	0.0	0.0%												
		W2-U						18.4	18.4	100%	18.4	100%	0.0	0.0%	69	20	69	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Thirty-Sixth	R2	W3-L	Bedroom	39.4	39.4	0.0	0.0%												
		W3-U																	
		W4-L		16.8	16.8	0.0	0.0%												
		W4-U						15.3	15.3	100%	15.3	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
Thirty-Sixth	R3	W5-L	LKD	18.5	18.5	0.0	0.0%												
		W5-U																	
		W6-L		23.0	23.0	0.0	0.0%												
		W6-U						35.4	33.0	93%	33.0	93%	0.0	0.0%	33	7	33	7	0.0%	0.0%
Thirty-Sixth	R4	W7-L	LKD	39.4	39.4	0.0	0.0%												
		W7-U																	
		W8-L		39.4	39.4	0.0	0.0%												
		W8-U																	
		W9-L		22.0	22.0	0.0	0.0%												
		W9-U																	
		W10-L		15.6	15.6	0.0	0.0%												
		W10-U						40.4	40.2	100%	40.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R5	W11-L	Bedroom	10.8	10.8	0.0	0.0%												
		W11-U																	
		W12-L		39.4	39.4	0.0	0.0%												
		W12-U						14.8	14.6	99%	14.6	99%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Sixth	R6	W13-L	Bedroom	39.4	39.4	0.0	0.0%												
		W13-U																	
		W14-L		19.0	19.0	0.0	0.0%												
		W14-U						15.9	15.8	100%	15.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R7	W15-L	LKD	17.1	17.1	0.0	0.0%												
		W15-U																	
		W16-L		39.4	39.4	0.0	0.0%												
		W16-U						20.9	20.5	98%	20.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Mezzanine	R1	W1-L	Residential	10.8	10.7	0.2	1.4%												
		W1-U																	
		W2-L		11.1	10.8	0.3	2.7%												
		W2-U						56.8	48.3	85%	48.2	85%	0.0	0.0%	23	10	23	10	0.0%	0.0%
Mezzanine	R2	W3-L	Residential	11.9	11.3	0.5	4.4%												
		W3-U																	
		W4-L		14.9	13.8	1.1	7.4%												
		W4-U																	
		W5-L		17.0	16.2	0.8	4.5%												
		W5-U																	
		W6-L		17.3	16.9	0.4	2.3%												
		W6-U																	
		W7-L		18.4	18.3	0.1	0.5%												
		W7-U																	
		W8-L		17.9	18.0	-0.1	-0.3%												
		W8-U																	
		W9-L		17.6	17.6	-0.1	-0.3%												
		W9-U																	
		W10-L		20.5	20.5	0.0	0.0%												
		W10-U																	
		W11-L		20.6	20.6	0.0	0.0%												
		W11-U						152.1	151.9	100%	151.9	100%	0.0	0.0%	52	15	52	15	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ferry Island Building 2																			
First	R1	W1-L	LKD	13.2	13.2	0.0	0.0%												
		W1-U																	
		W2-L		16.7	16.7	0.0	0.0%												
		W2-U																	
		W3		23.3	23.3	0.0	0.1%	33.5	23.6	70%	23.6	70%	0.0	0.0%	40	18	40	18	0.0%	0.0%
First	R2	W4	Bedroom	22.0	22.0	0.0	0.0%	12.4	9.5	77%	9.5	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	LKD	8.2	8.2	0.0	0.0%												
		W5-U						32.4	20.6	64%	20.6	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W6	Bedroom	16.8	16.8	0.0	0.0%	12.4	6.2	50%	6.2	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7	LKD	16.4	16.4	0.0	0.0%												
		W8-L		7.3	7.3	0.0	0.0%												
		W8-U						35.2	14.1	40%	14.1	40%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W9	Bedroom	11.4	11.4	0.0	0.0%	12.2	4.7	38%	4.7	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10	Bedroom	13.3	13.3	0.0	0.0%	11.5	6.0	52%	6.0	52%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W11-L	Studio	3.3	3.3	0.0	0.0%												
		W11-U						29.1	5.5	19%	5.5	19%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W12	LKD	9.0	9.0	0.0	0.0%												
		W13-L		1.3	1.3	0.0	0.0%												
		W13-U						35.1	6.8	19%	6.8	19%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R10	W14	Bedroom	5.4	5.4	0.0	0.0%	11.3	2.1	18%	2.1	18%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W15	Bedroom	6.4	6.4	0.0	0.0%	14.5	1.9	13%	1.9	13%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R12	W16	Bedroom	6.6	6.6	0.0	0.0%	10.0	1.1	11%	1.1	11%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W17	Bedroom	7.0	7.0	0.0	0.0%												
		W18		7.8	7.8	0.0	0.0%	11.3	4.3	38%	4.3	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W19	LKD	8.7	8.7	0.0	0.0%												
		W20-L		0.1	0.1	0.0	14.3%												
		W20-U																	
		W21-L		0.9	0.9	0.0	0.0%												
		W21-U																	
		W22-L		5.1	5.1	0.0	0.0%												
		W22-U						43.1	14.3	33%	14.4	33%	0.0	-0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	13.7	13.7	0.0	0.0%												
		W1-U																	
		W2-L		17.3	17.3	0.0	0.0%												
		W2-U																	
		W3		24.5	24.3	0.2	0.7%	33.5	23.6	70%	23.6	70%	0.0	0.1%	40	18	40	18	0.0%	0.0%
Second	R2	W4	Bedroom	23.3	23.1	0.2	0.7%	12.4	9.9	80%	9.9	80%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	LKD	9.2	9.1	0.1	1.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U						32.4	21.6	67%	21.3	66%	0.3	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W6	Bedroom	18.2	18.2	0.1	0.4%	12.4	7.2	58%	7.2	58%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7	LKD	17.8	17.8	0.0	0.1%													
		W8-L		8.3	8.3	0.0	0.0%													
		W8-U						35.2	16.1	46%	16.1	46%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W9	Bedroom	12.9	12.9	0.0	0.0%	12.2	5.3	44%	5.3	44%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10	Bedroom	14.9	14.9	0.0	0.0%	11.5	7.3	64%	7.3	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W11-L	Studio	4.0	4.0	0.0	0.0%													
		W11-U						29.1	6.0	21%	6.0	21%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W12	LKD	10.3	10.3	0.0	0.0%													
		W13-L		1.7	1.7	0.0	0.0%													
		W13-U						35.1	8.3	24%	8.3	24%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W14	Bedroom	6.2	6.2	0.0	0.0%	11.3	2.5	22%	2.5	22%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W15	Bedroom	7.2	7.2	0.0	0.0%	14.5	2.1	15%	2.1	15%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R12	W16	Bedroom	7.4	7.4	0.0	0.0%	10.0	1.3	13%	1.3	13%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W17	Bedroom	7.7	7.7	0.0	0.0%													
		W18		8.5	8.5	0.0	0.0%	11.3	4.6	40%	4.6	40%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W19	LKD	9.3	9.3	0.0	0.0%													
		W20-L		0.1	0.1	0.0	0.0%													
		W20-U																		
		W21-L		0.9	0.9	0.0	1.1%													
		W21-U																		
		W22-L		5.4	5.4	0.0	0.0%													
		W22-U						43.1	15.0	35%	15.1	35%	0.0	-0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	13.8	13.8	0.0	0.0%													
		W1-U																		
		W2-L		17.4	17.4	0.0	0.0%													
		W2-U																		
		W3		25.6	25.2	0.4	1.5%	33.5	23.6	70%	23.6	70%	0.0	0.2%	40	18	40	18	0.0%	0.0%
Third	R2	W4	Bedroom	24.4	24.0	0.4	1.6%	12.4	10.0	81%	10.0	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	LKD	9.9	9.6	0.4	3.5%													
		W5-U						32.4	22.7	70%	22.0	68%	0.7	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W6	Bedroom	19.6	19.3	0.3	1.7%	12.4	8.5	69%	8.5	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7	LKD	19.2	18.9	0.3	1.4%													
		W8-L		9.3	9.2	0.2	1.9%													
		W8-U						35.2	18.2	52%	18.0	51%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W9	Bedroom	14.5	14.4	0.1	1.0%	12.2	6.5	53%	6.5	53%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10	Bedroom	16.5	16.4	0.0	0.3%	11.5	8.0	69%	8.0	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Third	R8	W11-L	Studio	5.0	5.0	0.0	0.0%													
		W11-U						29.1	8.3	28%	8.3	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W12	LKD	11.6	11.6	0.0	0.0%													
		W13-L		2.5	2.5	0.0	0.0%													
		W13-U						35.1	11.2	32%	11.2	32%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W14	Bedroom	7.0	7.0	0.0	0.0%	11.3	3.1	27%	3.1	27%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W15	Bedroom	8.1	8.1	0.0	0.0%	14.5	2.5	17%	2.5	17%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R12	W16	Bedroom	8.2	8.2	0.0	0.0%	10.0	1.6	16%	1.6	16%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W17	Bedroom	8.5	8.5	0.0	0.0%													
		W18		9.2	9.2	0.0	0.0%	11.3	4.9	43%	4.9	43%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W19	LKD	10.0	10.0	0.0	0.0%													
		W20-L		0.1	0.1	0.0	0.0%													
		W20-U																		
		W21-L		1.0	1.0	0.0	0.0%													
		W21-U																		
		W22-L		5.8	5.8	0.0	0.0%													
		W22-U						43.1	15.6	36%	15.6	36%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%													
		W1-U																		
		W2-L		17.3	17.3	0.0	0.0%													
		W2-U																		
		W3		26.7	26.1	0.6	2.3%	33.5	23.6	70%	23.6	70%	0.0	0.2%	39	18	39	18	0.0%	0.0%
Fourth	R2	W4	Bedroom	25.7	25.0	0.6	2.5%	12.4	10.1	81%	10.1	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	LKD	10.7	10.1	0.6	5.8%													
		W5-U						32.4	24.0	74%	24.0	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W6	Bedroom	21.2	20.6	0.6	2.9%	12.4	8.8	71%	8.8	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7	LKD	20.7	20.1	0.6	2.9%													
		W8-L		10.5	10.0	0.5	5.0%													
		W8-U						35.2	22.6	64%	22.1	63%	0.5	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W9	Bedroom	16.3	15.8	0.5	3.2%	12.2	7.4	61%	7.4	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10	Bedroom	18.3	17.9	0.4	2.3%	11.5	8.0	70%	8.0	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W11-L	Studio	6.9	6.8	0.1	0.9%													
		W11-U						29.1	15.6	54%	15.5	53%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W12	LKD	13.1	13.1	0.0	0.0%													
		W13-L		4.3	4.3	0.0	0.0%													
		W13-U						35.1	16.4	47%	16.4	47%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W14	Bedroom	7.7	7.7	0.0	0.0%	11.3	3.5	31%	3.5	31%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W15	Bedroom	9.1	9.1	0.0	0.0%	14.5	3.1	22%	3.1	22%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R12	W16	Bedroom	9.2	9.2	0.0	0.0%	10.0	2.1	21%	2.1	21%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R13	W17	Bedroom	9.4	9.4	0.0	0.0%												
		W18		10.1	10.1	0.0	0.0%	11.3	5.2	47%	5.2	47%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W19	LKD	10.8	10.8	0.0	0.0%												
		W20-L		0.1	0.1	0.0	0.0%												
		W20-U																	
		W21-L		1.0	1.0	0.0	0.0%												
		W21-U																	
		W22-L		6.3	6.3	0.0	0.0%												
		W22-U						43.1	16.5	38%	16.5	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%												
		W1-U																	
		W2-L		17.3	17.3	0.0	0.0%												
		W2-U																	
		W3		27.9	27.1	0.8	3.0%	33.5	23.6	70%	23.6	70%	0.0	0.1%	39	18	39	18	0.0%	0.0%
Fifth	R2	W4	Bedroom	27.0	26.1	0.9	3.2%	12.4	10.1	82%	10.1	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	LKD	11.4	10.6	0.9	7.6%												
		W5-U						32.4	24.8	76%	24.8	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W6	Bedroom	23.3	22.4	0.9	3.9%	12.4	8.8	71%	8.8	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7	LKD	22.4	21.5	0.9	4.1%												
		W8-L		11.7	10.8	0.9	7.6%												
		W8-U						35.2	29.2	83%	27.4	78%	1.8	6.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W9	Bedroom	18.2	17.3	0.9	5.1%	12.2	7.5	62%	7.5	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10	Bedroom	20.2	19.4	0.8	4.0%	11.5	8.1	70%	8.1	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W11-L	Studio	7.5	7.2	0.2	3.0%												
		W11-U						29.1	22.0	76%	21.9	75%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W12	LKD	14.5	14.5	0.0	0.0%												
		W13-L		4.7	4.7	0.0	0.0%												
		W13-U						35.1	26.7	76%	26.7	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W14	Bedroom	8.5	8.5	0.0	0.0%	11.3	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W15	Bedroom	10.0	10.0	0.0	0.0%	14.5	3.8	26%	3.8	26%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R12	W16	Bedroom	10.2	10.2	0.0	0.0%	10.0	3.0	30%	3.0	30%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W17	Bedroom	10.4	10.4	0.0	0.0%												
		W18		10.9	10.9	0.0	0.0%	11.3	5.7	50%	5.7	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W19	LKD	11.5	11.5	0.0	0.0%												
		W20-L		0.2	0.2	0.0	0.0%												
		W20-U																	
		W21-L		1.0	1.0	0.0	0.0%												
		W21-U																	
		W22-L		6.8	6.8	0.0	0.0%												
		W22-U						43.1	17.8	41%	17.8	41%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%													
		W1-U																		
		W2-L		17.3	17.3	0.0	0.0%													
		W2-U																		
		W3		29.1	28.0	1.0	3.5%	33.5	23.6	70%	23.6	70%	0.0	0.0%	39	18	39	18	0.0%	0.0%
Sixth	R2	W4	Bedroom	28.3	27.2	1.1	3.8%	12.4	10.1	82%	10.1	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W5-L	LKD	26.7	25.6	1.1	4.2%													
		W5-U						32.4	25.0	77%	25.0	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W6	Bedroom	25.6	24.4	1.1	4.5%	12.4	8.9	72%	8.9	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7	LKD	24.0	22.8	1.2	5.0%													
		W8-L		14.0	12.8	1.2	8.6%													
		W8-U						35.2	30.5	87%	29.0	82%	1.5	4.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W9	Bedroom	20.0	18.7	1.3	6.3%	12.2	7.6	63%	7.6	63%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10	Bedroom	22.0	20.8	1.1	5.2%	11.5	8.3	72%	8.3	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W11-L	Studio	9.7	9.3	0.4	3.6%													
		W11-U						29.1	23.9	82%	23.7	82%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W12	LKD	15.8	15.8	0.0	0.0%													
		W13-L		6.3	6.3	0.0	0.0%													
		W13-U						35.1	29.8	85%	29.8	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W14	Bedroom	8.9	8.9	0.0	0.0%	11.3	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W15	Bedroom	11.0	11.0	0.0	0.0%	14.5	3.9	27%	3.9	27%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R12	W16	Bedroom	11.2	11.2	0.0	0.0%	10.0	3.5	35%	3.5	35%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W17	Bedroom	11.4	11.4	0.0	0.0%													
		W18		11.8	11.8	0.0	0.0%	11.3	6.1	54%	6.1	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W19	LKD	12.1	12.1	0.0	0.0%													
		W20-L		0.4	0.4	0.0	0.0%													
		W20-U																		
		W21-L		1.1	1.1	0.0	0.0%													
		W21-U																		
		W22-L		7.4	7.4	0.0	0.0%													
		W22-U						43.1	19.6	46%	19.6	46%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	36.1	36.1	0.0	0.0%													
		W1-U																		
		W2-L		33.2	33.2	0.0	0.0%													
		W2-U																		
		W3		25.4	24.1	1.3	5.1%													
		W4-L		14.0	12.6	1.3	9.6%													
		W4-U						39.4	39.4	100%	39.3	100%	0.1	0.2%	72	26	72	26	0.0%	0.0%
Seventh	R2	W5	Bedroom	21.5	20.1	1.4	6.3%	12.3	7.8	64%	7.8	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W6	Bedroom	23.4	22.2	1.3	5.4%	11.2	8.3	74%	8.3	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R4	W7-L	Studio	9.6	9.2	0.4	4.4%													
		W7-U						29.2	23.7	81%	23.6	81%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8	LKD	17.0	17.0	0.0	0.0%													
		W9-L		6.3	6.3	0.0	0.0%													
		W9-U						34.2	29.9	87%	29.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10	Bedroom	9.6	9.6	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W11	Bedroom	12.0	12.0	0.0	0.0%	14.5	4.0	28%	4.0	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W12	Bedroom	12.3	12.3	0.0	0.0%	10.1	3.7	36%	3.7	36%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R9	W13	Bedroom	12.4	12.4	0.0	0.0%													
		W14		12.7	12.7	0.0	0.0%	11.2	6.5	58%	6.5	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R10	W15	LKD	12.9	12.9	0.0	0.0%													
		W16-L		0.6	0.6	0.0	0.0%													
		W16-U																		
		W17-L		1.2	1.2	0.0	0.0%													
		W17-U																		
		W18-L		8.1	8.1	0.0	0.0%													
		W18-U						42.4	21.1	50%	21.1	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1	LKD	37.0	37.0	0.0	0.0%													
		W2-L		38.7	38.7	0.0	0.0%													
		W2-U																		
		W3-L		38.5	38.5	0.0	0.0%													
		W3-U																		
		W4		26.4	25.2	1.2	4.6%	34.8	33.4	96%	33.4	96%	0.0	0.0%	87	30	87	30	0.0%	0.0%
Eighth	R2	W5-L	Bedroom	14.7	13.5	1.3	8.5%													
		W5-U						8.3	7.0	85%	7.0	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W6	Bedroom	22.6	21.3	1.3	5.6%	11.8	7.7	65%	7.7	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W7	Bedroom	24.5	23.3	1.2	4.8%	11.2	8.7	78%	8.7	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W8-L	Studio	10.3	10.0	0.4	3.8%													
		W8-U						29.2	23.8	81%	23.6	81%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W9	LKD	17.9	17.9	0.0	0.0%													
		W10-L		6.8	6.8	0.0	0.0%													
		W10-U						34.2	30.2	88%	30.2	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W11	Bedroom	10.1	10.1	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W12	Bedroom	12.8	12.8	0.0	0.0%	14.5	4.0	28%	4.0	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W13	Bedroom	13.1	13.1	0.0	0.0%	10.1	3.8	38%	3.8	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W14	Bedroom	13.2	13.2	0.0	0.0%													
		W15		13.4	13.4	0.0	0.0%	11.2	6.9	62%	6.9	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W16	LKD	13.6	13.6	0.0	0.0%													
		W17-L		0.7	0.7	0.0	0.0%													
		W17-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W18-L		1.3	1.3	0.0	0.0%												
		W18-U																	
		W19-L		8.8	8.8	0.0	0.0%												
		W19-U						42.4	21.6	51%	21.6	51%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1	LKD	37.2	37.2	0.0	0.0%												
		W2-L		38.8	38.8	0.0	0.0%												
		W2-U																	
		W3-L		38.7	38.7	0.0	0.0%												
		W3-U																	
		W4		27.7	26.5	1.1	4.0%	34.8	33.4	96%	33.4	96%	0.0	0.0%	89	30	89	30	0.0%	0.0%
Ninth	R2	W5-L	Bedroom	15.8	14.6	1.2	7.3%												
		W5-U						8.3	7.2	88%	7.2	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W6	Bedroom	23.9	22.8	1.2	4.9%	11.8	8.4	71%	8.4	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W7	Bedroom	25.9	24.8	1.1	4.2%	11.2	9.3	83%	9.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W8-L	Studio	11.3	10.9	0.4	3.3%												
		W8-U						29.2	23.8	81%	23.7	81%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9	LKD	19.1	19.1	0.0	0.0%												
		W10-L		7.3	7.3	0.0	0.0%												
		W10-U						34.2	30.6	89%	30.6	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W11	Bedroom	10.7	10.7	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W12	Bedroom	13.6	13.6	0.0	0.0%	14.5	4.1	28%	4.1	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W13	Bedroom	13.9	13.9	0.0	0.0%	10.1	4.0	39%	4.0	39%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W14	Bedroom	13.9	13.9	0.0	0.0%												
		W15		14.2	14.2	0.0	0.0%	11.2	7.5	67%	7.5	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W16	LKD	14.4	14.4	0.0	0.0%												
		W17-L		0.8	0.8	0.0	0.0%												
		W17-U																	
		W18-L		1.4	1.4	0.0	0.0%												
		W18-U																	
		W19-L		9.4	9.4	0.0	0.0%												
		W19-U						42.4	22.1	52%	22.1	52%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1	LKD	37.4	37.4	0.0	0.0%												
		W2-L		39.0	39.0	0.0	0.0%												
		W2-U																	
		W3-L		38.8	38.8	0.0	0.0%												
		W3-U																	
		W4		29.9	28.9	1.0	3.4%	34.8	33.4	96%	33.4	96%	0.0	0.0%	90	30	90	30	0.0%	0.0%
Tenth	R2	W5-L	Bedroom	16.8	15.8	1.1	6.4%												
		W5-U						8.3	7.6	92%	7.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W6	Bedroom	26.4	25.3	1.1	4.1%	11.8	9.7	82%	9.7	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W7	Bedroom	27.5	26.5	1.0	3.6%	11.2	9.6	86%	9.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Tenth	R5	W8-L	Studio	12.2	11.9	0.3	2.8%													
		W8-U						29.2	24.2	83%	24.1	82%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9	LKD	20.9	20.9	0.0	0.0%													
		W10-L		7.7	7.7	0.0	0.0%													
		W10-U						34.2	30.9	90%	30.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W11	Bedroom	12.3	12.3	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W12	Bedroom	14.6	14.6	0.0	0.0%	14.5	4.1	28%	4.1	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W13	Bedroom	14.7	14.7	0.0	0.0%	10.1	4.1	41%	4.1	41%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R10	W14	Bedroom	14.7	14.7	0.0	0.0%													
		W15		15.0	15.0	0.0	0.0%	11.2	7.8	70%	7.8	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R11	W16	LKD	15.2	15.2	0.0	0.0%													
		W17-L		0.9	0.9	0.0	0.0%													
		W17-U																		
		W18-L		1.6	1.6	0.0	0.0%													
		W18-U																		
		W19-L		9.8	9.8	0.0	0.0%													
		W19-U						42.4	22.9	54%	22.9	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1	LKD	37.6	37.6	0.0	0.0%													
		W2-L		39.1	39.1	0.0	0.0%													
		W2-U																		
		W3-L		39.0	39.0	0.0	0.0%													
		W3-U																		
		W4		31.5	30.6	0.9	3.0%	34.8	33.4	96%	33.4	96%	0.0	0.0%	90	30	90	30	0.0%	0.0%
Eleventh	R2	W5-L	Bedroom	30.9	29.9	1.0	3.2%													
		W5-U						8.3	7.6	93%	7.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W6	Bedroom	30.2	29.2	1.0	3.3%	11.8	11.2	95%	11.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W7	Bedroom	29.0	28.0	0.9	3.2%	11.2	9.6	86%	9.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W8-L	Studio	26.0	25.7	0.3	1.2%													
		W8-U						29.2	25.5	87%	25.5	87%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9	LKD	22.8	22.8	0.0	0.0%													
		W10-L		16.0	16.0	0.0	0.0%													
		W10-U						34.2	31.2	91%	31.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W11	Bedroom	15.5	15.5	0.0	0.0%	11.1	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W12	Bedroom	15.4	15.4	0.0	0.0%	14.5	4.1	28%	4.1	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W13	Bedroom	15.5	15.5	0.0	0.0%	10.1	4.3	42%	4.3	42%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R10	W14	Bedroom	15.6	15.6	0.0	0.0%													
		W15		15.9	15.9	0.0	0.0%	11.2	8.0	71%	8.0	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R11	W16	LKD	16.1	16.1	0.0	0.0%													
		W17-L		0.9	0.9	0.0	0.0%													
		W17-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W18-L		1.7	1.7	0.0	0.0%													
		W18-U																		
		W19-L		10.3	10.3	0.0	0.0%													
		W19-U						42.4	24.1	57%	24.1	57%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1	LKD	37.7	37.7	0.0	0.0%													
		W2-L		39.2	39.2	0.0	0.0%													
		W2-U																		
		W3-L		39.1	39.1	0.0	0.0%													
		W3-U																		
		W4		32.9	32.0	0.9	2.6%	34.8	33.4	96%	33.4	96%	0.0	0.0%	90	30	90	30	0.0%	0.0%
Twelfth	R2	W5-L	Bedroom	32.1	31.3	0.9	2.7%													
		W5-U						8.3	7.7	93%	7.7	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W6	Bedroom	31.4	30.5	0.9	2.8%	11.8	11.2	95%	11.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W7	Bedroom	30.1	29.3	0.8	2.8%	11.2	9.6	86%	9.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W8-L	Studio	27.2	26.9	0.3	1.0%													
		W8-U						29.2	25.9	89%	25.9	89%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9	LKD	23.9	23.9	0.0	0.0%													
		W10-L		16.9	16.9	0.0	0.0%													
		W10-U						34.2	31.3	92%	31.3	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W11	Bedroom	16.5	16.5	0.0	0.0%	11.1	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W12	Bedroom	16.3	16.3	0.0	0.0%	14.5	4.1	29%	4.1	29%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W13	Bedroom	16.4	16.4	0.0	0.0%	10.1	4.3	43%	4.3	43%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R10	W14	Bedroom	16.5	16.5	0.0	0.0%													
		W15		16.8	16.8	0.0	0.0%	11.2	8.1	73%	8.1	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R11	W16	LKD	17.1	17.1	0.0	0.0%													
		W17-L		1.0	1.0	0.0	0.0%													
		W17-U																		
		W18-L		1.8	1.8	0.0	0.0%													
		W18-U																		
		W19-L		10.8	10.8	0.0	0.0%													
		W19-U						42.4	24.5	58%	24.5	58%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
The Gessner																				
First	R1	W1-L	LKD	33.9	33.9	0.0	0.0%													
		W1-U																		
		W2-L		33.8	33.8	0.0	0.0%													
		W2-U																		
		W3-L		10.4	10.2	0.2	1.5%													
		W3-U						37.2	28.7	77%	28.7	77%	0.0	0.0%	58	18	58	18	0.0%	0.0%
First	R2	W4-L	Bedroom	13.4	13.0	0.3	2.5%													
		W4-U						12.2	11.3	93%	11.3	93%	0.0	0.0%	25	12	25	12	0.0%	0.0%
First	R3	W5-L	Bedroom	26.9	26.6	0.3	1.3%													
		W5-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-L		28.4	28.1	0.3	0.9%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	59	17	59	17	0.0%	0.0%
First	R4	W7-L	Bedroom	13.0	12.8	0.2	1.5%													
		W7-U						11.9	9.2	78%	9.2	78%	0.0	0.1%	32	17	32	17	0.0%	0.0%
First	R5	W8-L	LKD	9.1	8.7	0.4	4.4%													
		W8-U						31.7	24.5	77%	24.5	77%	0.0	0.0%	16	12	16	12	0.0%	0.0%
First	R6	W9-L	Bedroom	15.6	15.3	0.2	1.4%													
		W9-U																		
		W10-L		16.8	16.8	0.0	0.0%													
		W10-U						14.2	12.2	86%	12.2	86%	0.0	0.0%	46	13	46	13	0.0%	0.0%
First	R7	W11-L	Bedroom	24.6	24.4	0.2	0.9%													
		W11-U						12.0	11.0	91%	11.0	91%	0.0	0.0%	52	17	51	17	1.9%	0.0%
First	R8	W12-L	LKD	10.4	10.2	0.3	2.8%													
		W12-U																		
		W13-L		11.9	11.4	0.5	4.2%													
		W13-U						34.1	25.2	74%	25.2	74%	0.0	0.0%	37	19	36	19	2.7%	0.0%
First	R9	W14-L	Bedroom	23.8	23.3	0.5	2.2%													
		W14-U						15.5	11.2	72%	11.2	72%	0.0	0.0%	50	14	48	13	4.0%	7.1%
First	R10	W15-L	Bedroom	24.3	24.0	0.3	1.2%													
		W15-U						13.4	10.5	78%	10.5	78%	0.0	0.0%	52	15	50	14	3.8%	6.7%
First	R11	W16-L	LKD	11.7	11.4	0.3	2.7%													
		W16-U																		
		W17-L		8.9	8.5	0.4	4.6%													
		W17-U																		
		W18-L		24.0	24.0	0.0	0.0%													
		W18-U						42.0	29.7	71%	30.0	71%	-0.3	-0.9%	48	16	46	15	4.2%	6.3%
First	R12	W19-L	Bedroom	26.5	26.2	0.3	1.2%													
		W19-U						12.2	10.7	88%	10.7	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W20-L	LKD	27.5	27.0	0.5	1.7%													
		W20-U																		
		W21-L		12.7	12.7	0.0	0.0%													
		W21-U																		
		W22-L		11.1	11.1	0.0	0.0%													
		W22-U						42.8	35.7	83%	35.6	83%	0.1	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W23-L	Bedroom	23.9	23.9	0.0	0.0%													
		W23-U						12.5	10.8	87%	10.8	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R15	W24-L	Bedroom	23.7	23.7	0.0	0.0%													
		W24-U						14.6	12.2	84%	12.2	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R16	W25-L	LKD	11.2	11.2	0.0	0.0%													
		W25-U																		
		W26-L		8.7	8.7	0.0	0.0%													
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R17	W27-L	Bedroom	12.2	12.2	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R18	W28-L	Studio	8.7	8.7	0.0	0.0%													
		W28-U						42.7	21.5	50%	21.5	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R19	W29-L	Bedroom	14.3	14.3	0.0	0.0%													
		W29-U						13.1	7.8	59%	7.8	59%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R20	W30-L	LKD	19.1	19.1	0.0	0.0%													
		W30-U																		
		W31-L		20.7	20.7	0.0	0.0%													
		W31-U						32.3	26.5	82%	26.5	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R21	W32-L	Bedroom	22.1	22.1	0.0	0.0%													
		W32-U						12.7	8.3	65%	8.3	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R22	W33-L	Bedroom	24.6	24.6	0.0	0.0%													
		W33-U						13.8	10.7	78%	10.7	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R23	W34-L	LKD	5.6	5.5	0.0	0.7%													
		W34-U						33.3	18.4	55%	18.4	55%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R24	W35-L	Studio	28.1	27.8	0.3	0.9%													
		W35-U																		
		W36-L		29.0	28.6	0.3	1.2%													
		W36-U																		
		W37-L		29.4	29.1	0.4	1.2%													
		W37-U						39.0	31.8	81%	31.7	81%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R25	W38-L	Bedroom	29.9	29.5	0.3	1.1%													
		W38-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R26	W39-L	LKD	30.5	30.2	0.3	1.0%													
		W39-U																		
		W40-L		10.0	10.0	0.0	0.0%													
		W40-U						35.5	26.2	74%	26.2	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R27	W41-L	Bedroom	9.9	9.9	0.0	0.0%													
		W41-U						15.1	11.3	75%	11.3	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R28	W42-L	Bedroom	26.1	26.1	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	20	0	20	0	0.0%	0.0%
First	R29	W43-L	LKD	30.2	30.2	0.0	0.0%													
		W43-U																		
		W44-L		35.4	35.4	0.0	0.0%													
		W44-U						41.1	26.0	63%	26.0	63%	0.0	0.0%	55	16	55	16	0.0%	0.0%
Second	R1	W1-L	LKD	34.6	34.6	0.0	0.0%													
		W1-U																		
		W2-L		34.5	34.5	0.0	0.0%													
		W2-U																		
		W3-L		10.9	10.7	0.2	1.8%													
		W3-U						37.2	29.0	78%	29.0	78%	0.0	0.0%	60	19	60	19	0.0%	0.0%
Second	R2	W4-L	Bedroom	13.9	13.6	0.3	2.4%													
		W4-U						12.2	11.3	93%	11.3	93%	0.0	0.0%	26	12	26	12	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Second	R3	W5-L	Bedroom	27.5	27.2	0.4	1.3%												
		W5-U																	
		W6-L		29.0	28.7	0.3	1.0%												
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	60	18	59	17	1.7%	5.6%
Second	R4	W7-L	Bedroom	13.5	13.3	0.2	1.7%												
		W7-U						11.9	9.3	79%	9.3	78%	0.0	0.4%	33	18	32	17	3.0%	5.6%
Second	R5	W8-L	LKD	9.7	9.3	0.4	4.3%												
		W8-U						31.7	24.8	78%	24.8	78%	0.0	-0.2%	18	13	18	13	0.0%	0.0%
Second	R6	W9-L	Bedroom	16.1	15.8	0.2	1.4%												
		W9-U																	
		W10-L		17.1	17.1	0.0	0.0%												
		W10-U						14.2	12.5	88%	12.5	88%	0.0	0.0%	47	14	47	14	0.0%	0.0%
Second	R7	W11-L	Bedroom	25.3	25.0	0.3	1.1%												
		W11-U						12.0	11.1	93%	11.1	93%	0.0	0.0%	54	19	53	19	1.9%	0.0%
Second	R8	W12-L	LKD	11.0	10.6	0.4	3.3%												
		W12-U																	
		W13-L		12.5	11.9	0.5	4.3%												
		W13-U						34.1	25.5	75%	25.5	75%	0.0	0.0%	38	20	37	20	2.6%	0.0%
Second	R9	W14-L	Bedroom	24.6	24.0	0.6	2.3%												
		W14-U						15.5	11.5	74%	11.5	74%	0.0	0.0%	52	15	50	14	3.8%	6.7%
Second	R10	W15-L	Bedroom	25.1	24.7	0.3	1.4%												
		W15-U						13.4	10.9	81%	10.9	81%	0.0	0.0%	55	17	53	16	3.6%	5.9%
Second	R11	W16-L	LKD	12.3	11.9	0.4	3.0%												
		W16-U																	
		W17-L		10.3	9.8	0.5	5.1%												
		W17-U																	
		W18-L		29.3	28.8	0.5	1.7%												
		W18-U						41.9	34.1	81%	33.3	79%	0.8	2.2%	55	17	53	16	3.6%	5.9%
Second	R12	W19-L	Bedroom	29.7	29.0	0.6	2.2%												
		W19-U						12.2	11.1	91%	11.1	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W20-L	LKD	29.8	29.2	0.6	1.9%												
		W20-U																	
		W21-L		13.4	13.4	0.0	0.0%												
		W21-U																	
		W22-L		11.6	11.6	0.0	0.0%												
		W22-U						42.8	35.8	84%	35.8	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W23-L	Bedroom	24.5	24.5	0.0	0.0%												
		W23-U						12.5	10.9	87%	10.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R15	W24-L	Bedroom	24.2	24.2	0.0	0.0%												
		W24-U						14.6	12.3	84%	12.3	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R16	W25-L	LKD	11.6	11.6	0.0	0.0%												
		W25-U																	
		W26-L		9.1	9.1	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R17	W27-L	Bedroom	12.5	12.5	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R18	W28-L	Studio	9.1	9.1	0.0	0.0%													
		W28-U						42.7	23.1	54%	23.1	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R19	W29-L	Bedroom	15.0	15.0	0.0	0.0%													
		W29-U						13.1	7.9	60%	7.9	60%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R20	W30-L	LKD	20.2	20.2	0.0	0.0%													
		W30-U																		
		W31-L		22.0	22.0	0.0	0.0%													
		W31-U						32.3	27.3	85%	27.3	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R21	W32-L	Bedroom	23.5	23.5	0.0	0.0%													
		W32-U						12.7	8.5	67%	8.5	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R22	W33-L	Bedroom	26.0	26.0	0.0	0.0%													
		W33-U						13.8	10.8	79%	10.8	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R23	W34-L	LKD	6.3	6.3	0.0	0.6%													
		W34-U						33.3	20.5	62%	20.5	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R24	W35-L	Studio	29.4	29.1	0.3	1.0%													
		W35-U																		
		W36-L		30.3	29.9	0.4	1.3%													
		W36-U																		
		W37-L		30.7	30.3	0.4	1.3%													
		W37-U						39.0	33.7	86%	33.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R25	W38-L	Bedroom	31.1	30.7	0.4	1.2%													
		W38-U						14.2	13.0	92%	13.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R26	W39-L	LKD	31.7	31.4	0.3	1.0%													
		W39-U																		
		W40-L		10.5	10.5	0.0	0.0%													
		W40-U						35.5	27.6	78%	27.6	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R27	W41-L	Bedroom	10.6	10.6	0.0	0.0%													
		W41-U						15.1	12.6	84%	12.6	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R28	W42-L	Bedroom	26.4	26.4	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	21	0	21	0	0.0%	0.0%
Second	R29	W43-L	LKD	30.4	30.4	0.0	0.0%													
		W43-U																		
		W44-L		35.9	35.9	0.0	0.0%													
		W44-U						41.1	27.1	66%	27.1	66%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Third	R1	W1-L	LKD	35.3	35.3	0.0	0.0%													
		W1-U																		
		W2-L		35.3	35.3	0.0	0.0%													
		W2-U																		
		W3-L		11.3	11.1	0.2	1.9%													
		W3-U						37.2	29.4	79%	29.4	79%	0.0	0.0%	61	20	61	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R2	W4-L	Bedroom	14.4	14.1	0.3	2.3%												
		W4-U						12.2	11.3	93%	11.3	93%	0.0	0.0%	27	13	27	13	0.0%	0.0%
Third	R3	W5-L	Bedroom	28.1	27.7	0.4	1.2%												
		W5-U																	
		W6-L		29.5	29.2	0.3	1.0%												
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	61	19	61	19	0.0%	0.0%
Third	R4	W7-L	Bedroom	14.0	13.7	0.3	1.9%												
		W7-U						11.9	9.4	79%	9.3	79%	0.0	0.5%	34	19	34	19	0.0%	0.0%
Third	R5	W8-L	LKD	10.2	9.8	0.4	4.1%												
		W8-U						31.7	25.2	79%	25.2	79%	0.0	-0.1%	21	15	20	14	4.8%	6.7%
Third	R6	W9-L	Bedroom	16.5	16.3	0.2	1.4%												
		W9-U																	
		W10-L		17.5	17.5	0.0	0.0%												
		W10-U						14.2	12.8	90%	12.8	90%	0.0	0.0%	50	16	49	15	2.0%	6.3%
Third	R7	W11-L	Bedroom	25.9	25.5	0.3	1.2%												
		W11-U						12.0	11.3	94%	11.3	94%	0.0	0.0%	55	20	53	19	3.6%	5.0%
Third	R8	W12-L	LKD	11.6	11.2	0.4	3.4%												
		W12-U																	
		W13-L		13.2	12.7	0.5	4.1%												
		W13-U						34.1	25.7	75%	25.7	75%	0.0	0.0%	41	22	39	21	4.9%	4.5%
Third	R9	W14-L	Bedroom	25.3	24.7	0.6	2.3%												
		W14-U						15.5	11.8	76%	11.8	76%	0.0	0.0%	54	17	51	15	5.6%	11.8%
Third	R10	W15-L	Bedroom	25.8	25.4	0.4	1.6%												
		W15-U						13.4	11.4	85%	11.4	85%	0.0	0.0%	56	18	53	16	5.4%	11.1%
Third	R11	W16-L	LKD	13.0	12.5	0.5	3.5%												
		W16-U																	
		W17-L		11.2	10.5	0.7	6.1%												
		W17-U																	
		W18-L		31.6	30.5	1.1	3.4%												
		W18-U						41.9	34.8	83%	34.1	81%	0.7	2.0%	57	19	54	17	5.3%	10.5%
Third	R12	W19-L	Bedroom	31.4	30.6	0.8	2.7%												
		W19-U						12.2	11.5	94%	11.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W20-L	LKD	31.3	30.6	0.6	2.1%												
		W20-U																	
		W21-L		14.1	14.1	0.0	0.0%												
		W21-U																	
		W22-L		12.4	12.4	0.0	0.0%												
		W22-U						42.8	35.8	84%	35.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W23-L	Bedroom	25.0	25.0	0.0	0.0%												
		W23-U						12.5	10.9	87%	10.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R15	W24-L	Bedroom	24.8	24.8	0.0	0.0%												
		W24-U						14.6	12.3	84%	12.3	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R16	W25-L	LKD	12.1	12.1	0.0	0.0%													
		W25-U																		
		W26-L		9.4	9.4	0.0	0.0%													
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R17	W27-L	Bedroom	12.7	12.7	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R18	W28-L	Studio	9.6	9.6	0.0	0.0%													
		W28-U						42.7	26.1	61%	26.1	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R19	W29-L	Bedroom	15.9	15.9	0.0	0.0%													
		W29-U						13.1	7.9	61%	7.9	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R20	W30-L	LKD	21.5	21.5	0.0	0.0%													
		W30-U																		
		W31-L		23.4	23.4	0.0	0.0%													
		W31-U						32.3	28.2	87%	28.2	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R21	W32-L	Bedroom	24.9	24.9	0.0	0.0%													
		W32-U						12.7	8.9	70%	8.9	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R22	W33-L	Bedroom	27.7	27.7	0.0	0.0%													
		W33-U						13.8	11.1	81%	11.1	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R23	W34-L	LKD	7.3	7.2	0.1	0.8%													
		W34-U						33.3	22.0	66%	22.0	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R24	W35-L	Studio	30.9	30.6	0.3	1.1%													
		W35-U																		
		W36-L		31.7	31.3	0.4	1.4%													
		W36-U																		
		W37-L		32.1	31.7	0.4	1.4%													
		W37-U						39.0	36.5	94%	36.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R25	W38-L	Bedroom	32.4	32.0	0.4	1.3%													
		W38-U						14.2	13.4	95%	13.4	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R26	W39-L	LKD	32.9	32.5	0.4	1.1%													
		W39-U																		
		W40-L		10.7	10.7	0.0	0.0%													
		W40-U						35.5	28.9	82%	28.9	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R27	W41-L	Bedroom	11.3	11.3	0.0	0.0%													
		W41-U						15.1	14.4	96%	14.4	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R28	W42-L	Bedroom	26.7	26.7	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Third	R29	W43-L	LKD	30.5	30.5	0.0	0.0%													
		W43-U																		
		W44-L		36.4	36.4	0.0	0.0%													
		W44-U						41.1	28.6	70%	28.6	70%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Fourth	R1	W1-L	LKD	36.0	36.0	0.0	0.0%													
		W1-U																		
		W2-L		36.0	36.0	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		11.7	11.5	0.2	1.9%													
		W3-U						37.2	29.7	80%	29.7	80%	0.0	0.0%	64	21	64	21	0.0%	0.0%
Fourth	R2	W4-L	Bedroom	14.9	14.6	0.3	2.1%													
		W4-U						12.2	11.4	93%	11.4	93%	0.0	0.0%	28	14	28	14	0.0%	0.0%
Fourth	R3	W5-L	Bedroom	28.6	28.3	0.3	1.2%													
		W5-U																		
		W6-L		30.1	29.8	0.3	1.0%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	62	20	62	20	0.0%	0.0%
Fourth	R4	W7-L	Bedroom	14.4	14.2	0.3	1.9%													
		W7-U						11.9	9.5	80%	9.5	80%	0.0	0.5%	34	19	34	19	0.0%	0.0%
Fourth	R5	W8-L	LKD	10.7	10.3	0.4	3.9%													
		W8-U						31.7	25.6	81%	25.6	81%	0.0	0.0%	21	15	21	15	0.0%	0.0%
Fourth	R6	W9-L	Bedroom	17.0	16.8	0.2	1.3%													
		W9-U																		
		W10-L		17.8	17.8	0.0	0.0%													
		W10-U						14.2	13.1	92%	13.1	92%	0.0	0.0%	50	16	49	15	2.0%	6.3%
Fourth	R7	W11-L	Bedroom	26.6	26.3	0.4	1.3%													
		W11-U						12.0	11.6	96%	11.6	96%	0.0	0.0%	56	20	54	19	3.6%	5.0%
Fourth	R8	W12-L	LKD	12.3	11.8	0.4	3.5%													
		W12-U																		
		W13-L		13.9	13.4	0.5	3.9%													
		W13-U						34.1	25.9	76%	25.9	76%	0.0	0.0%	42	22	41	21	2.4%	4.5%
Fourth	R9	W14-L	Bedroom	26.2	25.6	0.6	2.2%													
		W14-U						15.5	12.2	79%	12.2	79%	0.0	0.0%	55	18	52	16	5.5%	11.1%
Fourth	R10	W15-L	Bedroom	26.7	26.2	0.4	1.6%													
		W15-U						13.4	12.0	90%	12.0	90%	0.0	0.0%	57	19	54	17	5.3%	10.5%
Fourth	R11	W16-L	LKD	13.7	13.2	0.5	3.5%													
		W16-U																		
		W17-L		12.0	11.3	0.7	5.6%													
		W17-U																		
		W18-L		32.9	31.9	1.1	3.3%													
		W18-U						41.9	35.1	84%	34.8	83%	0.3	0.9%	61	20	59	19	3.3%	5.0%
Fourth	R12	W19-L	Bedroom	32.8	31.9	0.9	2.7%													
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R13	W20-L	LKD	32.7	32.0	0.7	2.2%													
		W20-U																		
		W21-L		14.4	14.4	0.0	0.0%													
		W21-U																		
		W22-L		13.0	13.0	0.0	0.0%													
		W22-U						42.8	36.0	84%	36.0	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W23-L	Bedroom	25.8	25.8	0.0	0.0%													
		W23-U						12.5	11.0	88%	11.0	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fourth	R15	W24-L	Bedroom	25.5	25.5	0.0	0.0%													
		W24-U						14.6	12.4	85%	12.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R16	W25-L	LKD	12.4	12.4	0.0	0.0%													
		W25-U																		
		W26-L		9.6	9.6	0.0	0.0%													
		W26-U						40.3	37.1	92%	37.1	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R17	W27-L	Bedroom	12.9	12.9	0.0	0.0%													
		W27-U						14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R18	W28-L	Studio	10.5	10.5	0.0	0.0%													
		W28-U						42.7	28.1	66%	28.1	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R19	W29-L	Bedroom	17.3	17.3	0.0	0.0%													
		W29-U						13.1	8.1	62%	8.1	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R20	W30-L	LKD	23.1	23.1	0.0	0.0%													
		W30-U																		
		W31-L		25.2	25.2	0.0	0.0%													
		W31-U						32.3	28.9	90%	28.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R21	W32-L	Bedroom	26.8	26.8	0.0	0.0%													
		W32-U						12.7	9.5	75%	9.5	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R22	W33-L	Bedroom	29.5	29.5	0.0	0.0%													
		W33-U						13.8	11.5	84%	11.5	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R23	W34-L	LKD	8.0	7.9	0.1	1.0%													
		W34-U						33.3	23.1	69%	23.1	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R24	W35-L	Studio	32.5	32.1	0.4	1.2%													
		W35-U																		
		W36-L		33.1	32.7	0.5	1.4%													
		W36-U																		
		W37-L		33.4	32.9	0.5	1.4%													
		W37-U						39.0	38.1	98%	38.1	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R25	W38-L	Bedroom	33.7	33.2	0.5	1.4%													
		W38-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R26	W39-L	LKD	34.0	33.6	0.4	1.1%													
		W39-U																		
		W40-L		10.7	10.7	0.0	0.0%													
		W40-U						35.5	29.3	83%	29.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R27	W41-L	Bedroom	12.0	12.0	0.0	0.0%													
		W41-U						15.1	14.7	97%	14.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R28	W42-L	Bedroom	27.0	27.0	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Fourth	R29	W43-L	LKD	30.6	30.6	0.0	0.0%													
		W43-U																		
		W44-L		36.9	36.9	0.0	0.0%													
		W44-U						41.1	30.5	74%	30.5	74%	0.0	0.0%	57	17	57	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R1	W1-L	LKD	36.7	36.7	0.0	0.0%													
		W1-U																		
		W2-L		36.7	36.7	0.0	0.0%													
		W2-U																		
		W3-L		12.2	11.9	0.2	2.0%													
		W3-U						37.2	29.9	80%	29.9	80%	0.0	0.0%	65	22	65	22	0.0%	0.0%
Fifth	R2	W4-L	Bedroom	15.4	15.1	0.3	2.1%													
		W4-U						12.2	11.4	93%	11.4	93%	0.0	0.0%	29	15	29	15	0.0%	0.0%
Fifth	R3	W5-L	Bedroom	29.2	28.8	0.3	1.2%													
		W5-U																		
		W6-L		30.7	30.4	0.3	0.9%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	62	20	62	20	0.0%	0.0%
Fifth	R4	W7-L	Bedroom	14.9	14.6	0.3	1.9%													
		W7-U						11.9	9.7	82%	9.7	82%	0.0	0.5%	35	19	35	19	0.0%	0.0%
Fifth	R5	W8-L	LKD	11.3	10.9	0.4	3.6%													
		W8-U						31.7	25.6	81%	25.6	81%	0.0	0.0%	23	16	23	16	0.0%	0.0%
Fifth	R6	W9-L	Bedroom	17.5	17.3	0.2	1.2%													
		W9-U																		
		W10-L		18.2	18.2	0.0	0.0%													
		W10-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	50	16	49	15	2.0%	6.3%
Fifth	R7	W11-L	Bedroom	28.0	27.6	0.4	1.3%													
		W11-U						12.0	11.7	97%	11.7	97%	0.0	0.0%	56	20	54	19	3.6%	5.0%
Fifth	R8	W12-L	LKD	12.8	12.3	0.4	3.5%													
		W12-U																		
		W13-L		14.5	14.0	0.5	3.5%													
		W13-U						34.1	25.9	76%	26.0	76%	0.0	0.0%	45	23	43	22	4.4%	4.3%
Fifth	R9	W14-L	Bedroom	27.7	27.2	0.6	2.0%													
		W14-U						15.5	12.9	83%	12.9	83%	0.0	0.0%	58	18	55	16	5.2%	11.1%
Fifth	R10	W15-L	Bedroom	28.2	27.8	0.4	1.6%													
		W15-U						13.4	12.3	92%	12.3	92%	0.0	0.0%	62	19	59	17	4.8%	10.5%
Fifth	R11	W16-L	LKD	14.3	13.8	0.5	3.4%													
		W16-U																		
		W17-L		12.6	11.9	0.6	4.9%													
		W17-U																		
		W18-L		34.2	33.1	1.1	3.1%													
		W18-U						41.9	35.3	84%	35.2	84%	0.1	0.3%	67	22	64	20	4.5%	9.1%
Fifth	R12	W19-L	Bedroom	34.1	33.2	0.9	2.6%													
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W20-L	LKD	33.9	33.2	0.7	2.2%													
		W20-U																		
		W21-L		14.7	14.7	0.0	0.0%													
		W21-U																		
		W22-L		13.7	13.7	0.0	0.0%													
		W22-U						42.8	36.5	85%	36.5	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R14	W23-L	Bedroom	27.1	27.1	0.0	0.0%													
		W23-U						12.5	11.1	89%	11.1	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R15	W24-L	Bedroom	26.7	26.7	0.0	0.0%													
		W24-U						14.6	12.5	86%	12.5	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R16	W25-L	LKD	12.6	12.6	0.0	0.0%													
		W25-U																		
		W26-L		9.7	9.7	0.0	0.0%													
		W26-U						40.3	37.2	92%	37.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R17	W27-L	Bedroom	13.4	13.4	0.0	0.0%													
		W27-U						14.4	11.7	81%	11.7	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R18	W28-L	Studio	11.9	11.9	0.0	0.0%													
		W28-U						42.7	29.4	69%	29.4	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R19	W29-L	Bedroom	19.4	19.4	0.0	0.0%													
		W29-U						13.1	8.3	64%	8.3	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R20	W30-L	LKD	25.4	25.4	0.0	0.0%													
		W30-U																		
		W31-L		27.6	27.6	0.0	0.0%													
		W31-U						32.3	29.5	91%	29.5	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R21	W32-L	Bedroom	29.3	29.3	0.0	0.0%													
		W32-U						12.7	10.3	81%	10.3	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R22	W33-L	Bedroom	31.7	31.7	0.0	0.1%													
		W33-U						13.8	12.3	89%	12.3	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R23	W34-L	LKD	8.8	8.7	0.1	1.1%													
		W34-U						33.3	24.5	74%	24.5	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R24	W35-L	Studio	34.0	33.6	0.4	1.3%													
		W35-U																		
		W36-L		34.5	34.0	0.5	1.5%													
		W36-U																		
		W37-L		34.7	34.2	0.5	1.4%													
		W37-U						39.0	38.2	98%	38.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R25	W38-L	Bedroom	34.8	34.3	0.5	1.4%													
		W38-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R26	W39-L	LKD	35.1	34.7	0.4	1.2%													
		W39-U																		
		W40-L		10.9	10.9	0.0	0.0%													
		W40-U						35.5	29.4	83%	29.4	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R27	W41-L	Bedroom	12.6	12.6	0.0	0.0%													
		W41-U						15.1	14.8	98%	14.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R28	W42-L	Bedroom	27.3	27.3	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Fifth	R29	W43-L	LKD	30.6	30.6	0.0	0.0%													
		W43-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W44-L		37.4	37.4	0.0	0.0%													
		W44-U						41.1	33.7	82%	33.7	82%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Sixth	R1	W1-L	LKD	37.3	37.3	0.0	0.0%													
		W1-U																		
		W2-L		37.3	37.3	0.0	0.0%													
		W2-U																		
		W3-L		12.6	12.4	0.3	2.1%													
		W3-U						37.2	30.0	81%	30.0	81%	0.0	0.0%	67	24	67	24	0.0%	0.0%
Sixth	R2	W4-L	Bedroom	16.0	15.7	0.3	2.0%													
		W4-U						12.2	11.4	93%	11.4	93%	0.0	0.0%	31	17	31	17	0.0%	0.0%
Sixth	R3	W5-L	Bedroom	29.9	29.5	0.4	1.2%													
		W5-U																		
		W6-L		31.4	31.1	0.3	1.0%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	63	21	63	21	0.0%	0.0%
Sixth	R4	W7-L	Bedroom	15.5	15.2	0.3	2.1%													
		W7-U						11.9	9.9	84%	9.9	84%	0.0	0.5%	35	19	35	19	0.0%	0.0%
Sixth	R5	W8-L	LKD	11.8	11.4	0.4	3.5%													
		W8-U						31.7	25.8	81%	25.8	81%	0.0	0.0%	24	16	24	16	0.0%	0.0%
Sixth	R6	W9-L	Bedroom	18.0	17.7	0.3	1.6%													
		W9-U																		
		W10-L		18.5	18.5	0.0	0.0%													
		W10-U						14.2	13.7	96%	13.7	96%	0.0	0.0%	51	17	50	16	2.0%	5.9%
Sixth	R7	W11-L	Bedroom	31.1	30.6	0.5	1.5%													
		W11-U						12.0	11.7	97%	11.7	97%	0.0	0.0%	69	20	68	19	1.4%	5.0%
Sixth	R8	W12-L	LKD	30.9	30.4	0.5	1.6%													
		W12-U																		
		W13-L		30.9	30.4	0.5	1.6%													
		W13-U						34.1	27.1	80%	27.1	80%	0.0	0.0%	76	24	75	23	1.3%	4.2%
Sixth	R9	W14-L	Bedroom	30.9	30.3	0.5	1.7%													
		W14-U						15.5	13.5	87%	13.5	87%	0.0	0.0%	76	24	73	22	3.9%	8.3%
Sixth	R10	W15-L	Bedroom	30.9	30.3	0.6	1.8%													
		W15-U						13.4	12.3	92%	12.3	92%	0.0	0.0%	75	24	72	22	4.0%	8.3%
Sixth	R11	W16-L	LKD	30.9	30.3	0.6	1.9%													
		W16-U																		
		W17-L		31.3	30.7	0.6	1.9%													
		W17-U																		
		W18-L		35.4	34.3	1.0	2.9%													
		W18-U						41.9	35.5	85%	35.5	85%	0.0	0.1%	79	25	76	23	3.8%	8.0%
Sixth	R12	W19-L	Bedroom	35.3	34.4	0.9	2.6%													
		W19-U						12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W20-L	LKD	35.2	34.4	0.8	2.2%													
		W20-U																		
		W21-L		31.2	31.2	0.0	0.0%													
		W21-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W22-L		30.0	30.0	0.0	0.0%													
		W22-U						42.8	37.4	87%	37.4	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W23-L	Bedroom	28.5	28.5	0.0	0.0%													
		W23-U						12.5	11.3	91%	11.3	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R15	W24-L	Bedroom	26.8	26.8	0.0	0.0%													
		W24-U						14.6	12.6	87%	12.6	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R16	W25-L	LKD	25.3	25.3	0.0	0.0%													
		W25-U																		
		W26-L		23.4	23.4	0.0	0.0%													
		W26-U						40.3	37.6	93%	37.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R17	W27-L	Bedroom	14.7	14.7	0.0	0.0%													
		W27-U						14.4	12.8	89%	12.8	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R18	W28-L	Studio	14.8	14.8	0.0	0.0%													
		W28-U						42.7	30.6	72%	30.6	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R19	W29-L	Bedroom	23.3	23.3	0.0	0.0%													
		W29-U						13.1	9.2	70%	9.2	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R20	W30-L	LKD	29.1	29.1	0.0	0.0%													
		W30-U																		
		W31-L		31.1	31.1	0.0	0.0%													
		W31-U						32.3	29.6	92%	29.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R21	W32-L	Bedroom	32.4	32.4	0.0	0.0%													
		W32-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R22	W33-L	Bedroom	34.1	34.1	0.1	0.2%													
		W33-U						13.8	12.8	93%	12.8	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R23	W34-L	LKD	9.4	9.3	0.1	1.3%													
		W34-U						33.3	26.4	79%	26.4	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R24	W35-L	Studio	35.5	35.0	0.5	1.4%													
		W35-U																		
		W36-L		35.7	35.2	0.5	1.5%													
		W36-U																		
		W37-L		35.8	35.3	0.5	1.5%													
		W37-U						39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R25	W38-L	Bedroom	35.9	35.4	0.5	1.4%													
		W38-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R26	W39-L	LKD	36.1	35.6	0.4	1.2%													
		W39-U																		
		W40-L		10.8	10.8	0.0	0.0%													
		W40-U						35.5	29.4	83%	29.4	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R27	W41-L	Bedroom	13.3	13.3	0.0	0.0%													
		W41-U						15.1	15.0	99%	15.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R28	W42-L	Bedroom	27.6	27.6	0.0	0.0%													
		W42-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	23	2	23	2	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R29	W43-L	LKD	30.9	30.9	0.0	0.0%												
		W43-U																	
		W44-L		37.9	37.9	0.0	0.0%												
		W44-U						41.1	36.0	88%	36.0	88%	0.0	0.0%	58	18	58	18	0.0%	0.0%
Seventh	R1	W1-L	LKD	38.0	38.0	0.0	0.0%												
		W1-U																	
		W2-L		38.0	38.0	0.0	0.0%												
		W2-U																	
		W3-L		14.5	14.2	0.3	2.1%												
		W3-U						37.2	30.1	81%	30.1	81%	0.0	0.0%	67	24	67	24	0.0%	0.0%
Seventh	R2	W4-L	Bedroom	17.4	17.1	0.3	1.8%												
		W4-U						12.2	11.4	93%	11.4	93%	0.0	0.0%	34	18	34	18	0.0%	0.0%
Seventh	R3	W5-L	Bedroom	30.7	30.4	0.3	1.1%												
		W5-U																	
		W6-L		32.3	31.9	0.3	1.1%												
		W6-U						11.7	11.5	98%	11.5	98%	0.0	0.0%	63	21	63	21	0.0%	0.0%
Seventh	R4	W7-L	Bedroom	17.0	16.6	0.4	2.2%												
		W7-U						13.0	11.4	87%	11.4	87%	0.0	0.3%	39	21	39	21	0.0%	0.0%
Seventh	R5	W8-L	LKD	13.8	13.4	0.4	3.0%												
		W8-U						31.7	25.9	82%	25.9	82%	0.0	0.0%	25	18	25	18	0.0%	0.0%
Seventh	R6	W9-L	Bedroom	19.1	18.7	0.4	2.2%												
		W9-U																	
		W10-L		22.5	22.0	0.5	2.0%												
		W10-U						14.9	14.7	98%	14.6	98%	0.0	0.2%	51	18	50	17	2.0%	5.6%
Seventh	R7	W11-L	LKD	9.0	8.7	0.4	4.2%												
		W11-U																	
		W12-L		8.9	8.6	0.3	3.4%												
		W12-U						27.3	24.8	91%	24.8	91%	0.0	0.0%	16	16	15	15	6.3%	6.3%
Seventh	R8	W13-L	Bedroom	6.1	6.1	0.0	0.0%												
		W13-U						12.0	9.1	76%	9.1	76%	0.0	0.0%	11	11	11	11	0.0%	0.0%
Seventh	R9	W14-L	Bedroom	20.3	19.8	0.5	2.7%												
		W14-U																	
		W15-L		20.5	19.9	0.6	2.7%												
		W15-U						13.3	13.1	99%	13.1	99%	0.0	0.0%	46	26	44	24	4.3%	7.7%
Seventh	R10	W16-L	Bedroom	21.2	20.6	0.6	2.8%												
		W16-U						11.6	9.8	85%	9.8	85%	0.0	0.0%	44	23	41	21	6.8%	8.7%
Seventh	R11	W17-L	LKD	7.2	6.6	0.6	8.0%												
		W17-U																	
		W18-L		11.0	10.4	0.7	5.9%												
		W18-U																	
		W19-L		36.5	35.4	1.1	2.9%												
		W19-U																	
		W20-L		36.5	35.4	1.0	2.8%												
		W20-U						42.6	35.5	83%	35.1	82%	0.4	1.2%	46	16	43	14	6.5%	12.5%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Seventh	R12	W21-L	LKD	36.4	35.5	1.0	2.6%												
		W21-U																	
		W22-L		36.4	35.5	0.9	2.4%												
		W22-U																	
		W23-L		9.6	9.6	0.0	0.0%												
		W23-U						36.0	32.5	90%	32.5	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R13	W24-L	Bedroom	20.9	20.9	0.0	0.0%												
		W24-U																	
		W25-L		20.4	20.4	0.0	0.0%												
		W25-U						16.2	14.4	89%	14.4	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R14	W26-L	Bedroom	19.3	19.3	0.0	0.0%												
		W26-U						15.7	13.7	87%	13.7	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R15	W27-L	LKD	7.7	7.7	0.0	0.0%												
		W27-U																	
		W28-L		8.5	8.5	0.0	0.0%												
		W28-U						31.0	27.9	90%	27.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R16	W29-L	Bedroom	17.8	17.8	0.0	0.0%												
		W29-U						14.3	13.4	94%	13.4	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R17	W30-L	Studio	22.5	22.5	0.0	0.0%												
		W30-U						42.7	37.0	87%	37.0	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R18	W31-L	Bedroom	30.8	30.8	0.0	0.0%												
		W31-U						13.1	12.8	97%	12.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R19	W32-L	LKD	34.2	34.2	0.0	0.0%												
		W32-U																	
		W33-L		35.1	35.0	0.1	0.4%												
		W33-U						32.3	29.6	92%	29.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R20	W34-L	Bedroom	35.6	35.3	0.3	0.7%												
		W34-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R21	W35-L	Bedroom	36.2	35.8	0.4	1.1%												
		W35-U						13.8	12.9	94%	12.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R22	W36-L	LKD	10.4	10.3	0.2	1.5%												
		W36-U						33.3	27.8	83%	27.8	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R23	W37-L	Studio	36.7	36.1	0.6	1.5%												
		W37-U																	
		W38-L		36.8	36.2	0.6	1.5%												
		W38-U																	
		W39-L		36.8	36.3	0.5	1.5%												
		W39-U						39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R24	W40-L	Bedroom	36.9	36.3	0.5	1.5%												
		W40-U						14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R25	W41-L	LKD	36.9	36.4	0.5	1.2%												
		W41-U																	
		W42-L		24.4	24.4	0.0	0.0%												
		W42-U						35.5	29.8	84%	29.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R26	W43-L	Bedroom	28.7	28.7	0.0	0.0%													
		W43-U						15.1	15.0	99%	15.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R27	W44-L	Bedroom	27.9	27.9	0.0	0.0%													
		W44-U						11.9	11.6	98%	11.6	98%	0.0	0.0%	24	3	24	3	0.0%	0.0%
Seventh	R28	W45-L	LKD	32.2	32.2	0.0	0.0%													
		W45-U																		
		W46-L		38.4	38.4	0.0	0.0%													
		W46-U						41.1	36.1	88%	36.1	88%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Eighth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		38.6	38.6	0.0	0.0%													
		W2-U																		
		W3-L		13.8	13.5	0.3	2.3%													
		W3-U						37.1	30.8	83%	30.8	83%	0.0	0.0%	69	26	69	26	0.0%	0.0%
Eighth	R2	W4-L	Bedroom	17.4	17.1	0.3	1.9%													
		W4-U						12.2	11.4	94%	11.4	94%	0.0	0.0%	35	18	35	18	0.0%	0.0%
Eighth	R3	W5-L	Bedroom	32.4	32.0	0.4	1.1%													
		W5-U																		
		W6-L		33.9	33.5	0.4	1.1%													
		W6-U						12.0	11.9	99%	11.9	99%	0.0	0.0%	76	23	76	23	0.0%	0.0%
Eighth	R4	W7-L	Bedroom	17.0	16.6	0.4	2.2%													
		W7-U						11.8	10.3	87%	10.2	86%	0.0	0.3%	40	20	40	20	0.0%	0.0%
Eighth	R5	W8-L	LKD	13.2	12.8	0.4	3.1%													
		W8-U																		
		W9-L		35.1	34.3	0.8	2.3%													
		W9-U						31.6	28.2	89%	28.1	89%	0.1	0.4%	48	18	48	18	0.0%	0.0%
Eighth	R7	W12-L	Bedroom	35.1	34.8	0.3	0.9%													
		W12-U						16.2	15.4	95%	15.4	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W13-L	LKD	11.8	11.2	0.5	4.5%													
		W13-U						40.8	29.8	73%	29.0	71%	0.8	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W14-L	Bedroom	37.3	36.7	0.6	1.6%													
		W14-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R10	W15-L	Bedroom	37.4	36.8	0.6	1.6%													
		W15-U						14.2	13.7	96%	13.7	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R11	W16-L	Bedroom	37.5	36.9	0.6	1.7%													
		W16-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R12	W17-L	Bedroom	37.6	36.9	0.6	1.7%													
		W17-U						12.8	12.3	96%	12.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R13	W18-L	LKD	10.6	10.4	0.2	1.6%													
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R14	W19-L	Studio	37.6	37.0	0.6	1.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W19-U																	
		W20-L		37.6	37.1	0.6	1.5%												
		W20-U																	
		W21-L		37.6	37.1	0.6	1.5%												
		W21-U						39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R15	W22-L	Bedroom	37.7	37.1	0.6	1.5%												
		W22-U						12.8	11.9	93%	11.9	93%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R16	W23-L	LKD	37.7	37.2	0.5	1.3%												
		W23-U																	
		W24		39.5	39.5	0.0	0.0%												
		W25-L		39.5	39.5	0.0	0.0%												
		W25-U						35.3	33.3	94%	33.3	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R17	W26	Bedroom	39.5	39.5	0.0	0.0%	11.4	10.5	93%	10.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R18	W27-L	LKD	39.5	39.5	0.0	0.0%												
		W27-U																	
		W28-L		38.8	38.8	0.0	0.0%												
		W28-U						32.6	28.8	88%	28.8	88%	0.0	0.0%	61	19	61	19	0.0%	0.0%
Ninth	R1	W1-L	LKD	39.1	39.1	0.0	0.0%												
		W1-U																	
		W2-L		39.1	39.1	0.0	0.0%												
		W2-U																	
		W3-L		35.7	35.4	0.3	0.8%												
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	94	26	94	26	0.0%	0.0%
Ninth	R2	W4-L	Bedroom	35.6	35.3	0.3	0.9%												
		W4-U						12.2	11.4	94%	11.4	94%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Ninth	R3	W5-L	Bedroom	35.6	35.2	0.3	0.9%												
		W5-U																	
		W6-L		35.6	35.2	0.3	1.0%												
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Ninth	R4	W7-L	Bedroom	35.3	34.9	0.4	1.0%												
		W7-U						11.8	10.5	89%	10.5	89%	0.0	0.0%	81	24	81	24	0.0%	0.0%
Ninth	R5	W8-L	LKD	35.2	34.8	0.4	1.1%												
		W8-U																	
		W9-L		37.8	37.0	0.8	2.0%												
		W9-U						31.6	28.2	89%	28.1	89%	0.1	0.4%	84	25	84	25	0.0%	0.0%
Ninth	R6	W10-L	Studio	37.9	37.2	0.7	1.9%												
		W10-U																	
		W11-L		37.9	37.2	0.8	2.0%												
		W11-U																	
		W12-L		38.0	37.3	0.7	1.8%												
		W12-U						31.9	31.4	98%	31.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W13-L	LKD	12.6	11.9	0.6	4.9%												
		W13-U						33.0	24.6	74%	24.3	74%	0.3	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	38.1	37.4	0.7	1.8%												
		W14-U						13.7	13.4	97%	13.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Ninth	R9	W15-L	Bedroom	38.1	37.5	0.7	1.7%												
		W15-U						15.2	14.6	96%	14.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W16-L	Bedroom	38.2	37.5	0.6	1.7%												
		W16-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W17-L	Bedroom	38.2	37.6	0.6	1.6%												
		W17-U						12.8	12.3	96%	12.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R12	W18-L	LKD	11.1	10.9	0.2	1.5%												
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R13	W19-L	Studio	38.2	37.7	0.6	1.5%												
		W19-U																		
		W20-L		38.3	37.7	0.6	1.5%												
		W20-U																		
		W21-L		38.3	37.7	0.6	1.5%												
		W21-U						39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R14	W22-L	Bedroom	38.3	37.7	0.5	1.4%												
		W22-U						12.8	11.9	93%	11.9	93%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R15	W23-L	LKD	38.3	37.8	0.5	1.3%												
		W23-U																		
		W24		39.5	39.5	0.0	0.0%												
		W25-L		39.5	39.5	0.0	0.0%												
		W25-U						35.3	32.8	93%	32.8	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R16	W26	Bedroom	39.5	39.5	0.0	0.0%	11.4	10.5	93%	10.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R17	W27-L	LKD	39.6	39.6	0.0	0.0%												
		W27-U																		
		W28-L		39.2	39.2	0.0	0.0%												
		W28-U						32.6	28.8	88%	28.8	88%	0.0	0.0%	61	19	61	19	0.0%	0.0%
Tenth	R1	W1-L	LKD	39.5	39.5	0.0	0.0%												
		W1-U																		
		W2-L		39.5	39.5	0.0	0.0%												
		W2-U																		
		W3-L		36.1	35.8	0.3	0.8%												
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	95	27	95	27	0.0%	0.0%
Tenth	R2	W4-L	Bedroom	36.0	35.7	0.3	0.8%												
		W4-U						12.2	11.4	94%	11.4	94%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Tenth	R3	W5-L	Bedroom	36.0	35.6	0.3	0.9%												
		W5-U																		
		W6-L		35.9	35.6	0.3	0.9%												
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Tenth	R4	W7-L	Bedroom	35.7	35.4	0.3	1.0%												
		W7-U						11.8	10.5	89%	10.5	89%	0.0	0.0%	81	24	81	24	0.0%	0.0%
Tenth	R5	W8-L	LKD	35.6	35.2	0.4	1.0%												
		W8-U																		
		W9-L		38.2	37.5	0.7	1.8%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W9-U						31.6	28.2	89%	28.1	89%	0.1	0.4%	84	25	84	25	0.0%	0.0%
Tenth	R6	W10-L	Studio	38.3	37.7	0.7	1.7%													
		W10-U																		
		W11-L		38.4	37.7	0.7	1.8%													
		W11-U																		
		W12-L		38.4	37.8	0.6	1.7%													
		W12-U						31.9	31.4	98%	31.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W13-L	LKD	12.8	12.2	0.6	4.5%													
		W13-U						33.0	24.6	74%	24.3	74%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	38.5	37.9	0.6	1.6%													
		W14-U						13.7	13.4	97%	13.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W15-L	Bedroom	38.6	38.0	0.6	1.6%													
		W15-U						15.2	14.6	96%	14.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R10	W16-L	Bedroom	38.6	38.0	0.6	1.6%													
		W16-U						12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R11	W17-L	Bedroom	38.6	38.1	0.6	1.5%													
		W17-U						12.8	12.3	96%	12.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R12	W18-L	LKD	11.4	11.2	0.2	1.4%													
		W18-U						33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R13	W19-L	Bedroom	31.6	31.1	0.5	1.7%													
		W19-U																		
		W20-L		31.6	31.1	0.5	1.7%													
		W20-U						13.1	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R14	W21-L	Bedroom	31.6	31.1	0.5	1.7%													
		W21-U																		
		W22-L		31.6	31.1	0.5	1.6%													
		W22-U						11.9	11.8	100%	11.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R15	W23-L	LKD	31.6	31.1	0.5	1.6%													
		W23-U																		
		W24-L		31.6	31.1	0.5	1.5%													
		W24-U																		
		W25-L		5.0	5.0	0.0	0.0%													
		W25-U						33.8	31.5	93%	31.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R16	W26-L	Studio	34.2	34.2	0.0	0.0%													
		W26-U																		
		W27-L		31.3	31.3	0.0	0.0%													
		W27-U																		
		W28-L		31.8	31.8	0.0	0.0%													
		W28-U																		
		W29-L		31.7	31.7	0.0	0.0%													
		W29-U																		
		W30-L		34.2	34.2	0.0	0.0%													
		W30-U						38.0	37.4	98%	37.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R17	W31-L	LKD	4.7	4.7	0.0	0.0%													
		W31-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W32-L		39.5	39.5	0.0	0.0%													
		W32-U																		
		W33-L		39.5	39.5	0.0	0.0%													
		W33-U																		
		W34-L		39.5	39.5	0.0	0.0%													
		W34-U																		
		W35-L		39.5	39.5	0.0	0.0%													
		W35-U						38.4	37.1	97%	37.1	97%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Eleventh	R1	W1-L	LKD	39.6	39.6	0.0	0.0%													
		W1-U																		
		W2-L		39.6	39.6	0.0	0.0%													
		W2-U																		
		W3-L		36.4	36.2	0.3	0.7%													
		W3-U						37.1	30.0	81%	30.0	81%	0.0	0.0%	96	28	96	28	0.0%	0.0%
Eleventh	R2	W4-L	Bedroom	36.4	36.1	0.3	0.7%													
		W4-U						12.2	11.4	94%	11.4	94%	0.0	0.0%	84	27	84	27	0.0%	0.0%
Eleventh	R3	W5-L	Bedroom	36.3	36.0	0.3	0.8%													
		W5-U																		
		W6-L		36.3	36.0	0.3	0.8%													
		W6-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	85	28	85	28	0.0%	0.0%
Eleventh	R4	W7-L	Bedroom	36.1	35.8	0.3	0.9%													
		W7-U						11.8	10.5	89%	10.5	89%	0.0	0.0%	82	25	82	25	0.0%	0.0%
Eleventh	R5	W8-L	LKD	36.0	35.7	0.3	0.9%													
		W8-U																		
		W9-L		38.5	37.9	0.6	1.7%													
		W9-U						31.6	28.2	89%	28.1	89%	0.1	0.4%	85	26	85	26	0.0%	0.0%
Eleventh	R6	W10-L	Studio	38.6	38.0	0.6	1.6%													
		W10-U																		
		W11-L		38.7	38.0	0.6	1.7%													
		W11-U																		
		W12-L		38.7	38.1	0.6	1.5%													
		W12-U						31.9	31.4	98%	31.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W13-L	LKD	13.1	12.6	0.5	4.0%													
		W13-U						32.7	24.1	74%	23.9	73%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	30.7	30.1	0.6	1.9%													
		W14-U																		
		W15-L		31.7	31.2	0.6	1.8%													
		W15-U						13.5	13.4	99%	13.4	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W16-L	Bedroom	30.7	30.2	0.6	1.8%													
		W16-U																		
		W17-L		31.7	31.2	0.5	1.7%													
		W17-U						13.4	13.1	98%	13.1	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R10	W18-L	Bedroom	31.7	31.2	0.5	1.7%													
		W18-U																		
		W19-L		30.8	30.2	0.5	1.7%													
		W19-U						11.8	11.7	99%	11.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eleventh	R11	W20-L	Bedroom	31.7	31.2	0.5	1.6%													
		W20-U																		
		W21-L		31.8	31.2	0.5	1.6%													
		W21-U						12.5	12.4	99%	12.4	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R12	W22-L	LKD	23.9	23.7	0.2	0.6%													
		W22-U						33.0	27.6	84%	27.6	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R13	W23-L	Bedroom	30.5	29.9	0.5	1.7%													
		W23-U																		
		W24-L		30.5	30.0	0.5	1.6%													
		W24-U						13.1	13.1	99%	13.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R14	W25-L	Bedroom	30.4	30.0	0.5	1.6%													
		W25-U																		
		W26-L		30.4	30.0	0.5	1.5%													
		W26-U						11.9	11.8	100%	11.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R15	W27-L	LKD	30.5	30.0	0.5	1.5%													
		W27-U																		
		W28-L		30.4	30.0	0.4	1.4%													
		W28-U																		
		W29-L		5.0	5.0	0.0	0.0%													
		W29-U						33.8	31.5	93%	31.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R16	W30-L	Studio	32.5	32.5	0.0	0.0%													
		W30-U																		
		W31-L		32.3	32.3	0.0	0.0%													
		W31-U																		
		W32-L		32.9	32.9	0.0	0.0%													
		W32-U																		
		W33-L		32.8	32.8	0.0	0.0%													
		W33-U																		
		W34-L		32.4	32.4	0.0	0.0%													
		W34-U						38.0	37.4	98%	37.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R17	W35-L	LKD	4.7	4.7	0.0	0.0%													
		W35-U																		
		W36-L		39.6	39.6	0.0	0.0%													
		W36-U																		
		W37-L		39.6	39.6	0.0	0.0%													
		W37-U																		
		W38-L		39.6	39.6	0.0	0.0%													
		W38-U																		
		W39-L		39.6	39.6	0.0	0.0%													
		W39-U						38.4	37.1	97%	37.1	97%	0.0	0.0%	59	19	59	19	0.0%	0.0%
Twelfth	R1	W1-L	LKD	8.6	8.6	0.0	0.0%													
		W1-U																		
		W2-L		36.7	36.5	0.2	0.6%													
		W2-U																		
		W3-L		36.7	36.4	0.2	0.7%													
		W3-U																		
		W4-L		36.6	36.4	0.3	0.7%													
		W4-U						30.7	29.3	96%	29.3	96%	0.0	0.0%	93	29	93	29	0.0%	0.0%
Twelfth	R2	W5-L	Bedroom	36.6	36.3	0.3	0.7%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U																	
		W6-L		36.6	36.3	0.3	0.8%												
		W6-U						12.8	12.7	99%	12.7	99%	0.0	0.0%	85	28	85	28	0.0%	0.0%
Twelfth	R3	W7-L	LKD	36.5	36.2	0.3	0.8%												
		W7-U																	
		W8-L		36.4	36.1	0.3	0.8%												
		W8-U																	
		W9-L		6.9	6.9	0.0	0.0%												
		W9-U																	
		W10-L		4.4	4.0	0.3	7.6%												
		W10-U																	
		W11-L		30.5	29.9	0.6	1.8%												
		W11-U																	
		W12-L		31.7	31.2	0.6	1.8%												
		W12-U						33.7	30.7	91%	30.7	91%	0.0	0.0%	85	26	85	26	0.0%	0.0%
Twelfth	R4	W13-L	Bedroom	31.7	31.2	0.5	1.7%												
		W13-U																	
		W14-L		31.7	31.2	0.6	1.8%												
		W14-U						11.9	11.8	99%	11.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W15-L	Bedroom	31.7	31.2	0.6	1.8%												
		W15-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W16-L	LKD	24.9	24.4	0.5	2.0%												
		W16-U						32.0	27.6	86%	27.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W17-L	Bedroom	29.5	28.9	0.5	1.8%												
		W17-U																	
		W18-L		30.4	29.9	0.5	1.7%												
		W18-U						11.4	11.2	99%	11.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W19-L	Bedroom	29.5	29.0	0.5	1.7%												
		W19-U																	
		W20-L		30.4	29.9	0.5	1.6%												
		W20-U						13.4	13.3	99%	13.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W21-L	Bedroom	30.4	29.9	0.5	1.6%												
		W21-U																	
		W22-L		29.5	29.0	0.5	1.6%												
		W22-U						13.3	13.2	99%	13.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R10	W23-L	LKD	30.4	30.0	0.5	1.6%												
		W23-U																	
		W24-L		30.4	30.0	0.5	1.5%												
		W24-U																	
		W25-L		34.0	34.0	0.0	0.0%												
		W25-U						30.5	28.9	95%	28.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R12	W27-L	LKD	34.1	34.1	0.0	0.0%												
		W27-U																	
		W28-L		9.4	9.4	0.0	0.0%												
		W28-U						28.7	28.6	100%	28.6	100%	0.0	0.0%	20	6	20	6	0.0%	0.0%
Thirteenth	R1	W1-L	LKD	8.7	8.7	0.0	0.0%												
		W1-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-L		37.0	36.8	0.2	0.6%													
		W2-U																		
		W3-L		36.9	36.7	0.2	0.6%													
		W3-U																		
		W4-L		36.9	36.7	0.2	0.7%													
		W4-U						30.6	29.3	96%	29.3	96%	0.0	0.0%	94	30	94	30	0.0%	0.0%
Thirteenth	R2	W5-L	Bedroom	36.9	36.6	0.2	0.7%													
		W5-U																		
		W6-L		36.9	36.6	0.3	0.7%													
		W6-U						12.7	12.7	99%	12.7	99%	0.0	0.0%	86	29	86	29	0.0%	0.0%
Thirteenth	R3	W7-L	LKD	36.8	36.5	0.3	0.7%													
		W7-U																		
		W8-L		36.8	36.5	0.3	0.7%													
		W8-U																		
		W9-L		6.9	6.9	0.0	0.0%													
		W9-U																		
		W10-L		4.4	4.1	0.3	6.8%													
		W10-U																		
		W11-L		29.3	28.8	0.5	1.7%													
		W11-U																		
		W12-L		30.4	29.9	0.5	1.7%													
		W12-U						33.7	31.1	92%	31.1	92%	0.0	0.0%	86	27	86	27	0.0%	0.0%
Thirteenth	R4	W13-L	Bedroom	30.4	29.9	0.5	1.7%													
		W13-U																		
		W14-L		30.4	29.9	0.5	1.7%													
		W14-U						11.9	11.8	99%	11.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W15-L	Bedroom	30.4	29.9	0.5	1.6%													
		W15-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W17-L	Living Room	35.4	35.4	0.0	0.0%													
		W17-U																		
		W18-L		39.6	39.6	0.0	0.0%													
		W18-U																		
		W19-L		39.6	39.6	0.0	0.0%													
		W19-U																		
		W20-L		39.6	39.6	0.0	0.0%													
		W20-U																		
		W21-L		39.6	39.6	0.0	0.0%													
		W21-U						41.1	41.1	100%	41.1	100%	0.0	0.0%	61	19	61	19	0.0%	0.0%
11 Hale Road																				
Ground	R1	W1	Residential	9.6	6.5	3.1	32.5%													
		W2		6.1	3.3	2.9	46.4%													
		W3		4.4	3.1	1.3	29.0%	13.0	3.1	24%	2.8	21%	0.3	10.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W4-L	Bedroom	4.4	1.0	3.3	76.1%													
		W4-U						9.9	1.4	14%	0.6	6%	0.8	60.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	12.0	8.4	3.6	30.0%													
		W1-U																		
		W2-L		12.6	10.7	2.0	15.5%													
		W2-U						11.8	10.6	90%	10.0	85%	0.6	5.5%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
First	R2	W3-L	Bedroom	10.2	5.7	4.5	43.8%													
		W3-U						9.9	2.3	24%	2.0	21%	0.3	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
13 Hale Road																				
Ground	R1	W1-L	Bedroom	6.4	5.7	0.7	11.2%													
		W1-U						9.9	2.6	27%	2.3	24%	0.3	11.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Residential	7.3	7.1	0.2	2.2%													
		W3		9.1	6.6	2.5	27.2%													
		W4		7.2	5.7	1.5	20.8%	13.0	4.9	38%	4.8	37%	0.1	2.9%	2	0	2	0	0.0%	0.0%
First	R1	W1-L	Bedroom	13.0	9.6	3.3	25.8%													
		W1-U						9.9	4.3	44%	3.8	39%	0.5	10.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	13.5	13.4	0.0	0.1%													
		W2-U																		
		W3-L		12.2	8.8	3.4	27.8%													
		W3-U						11.8	8.5	71%	8.4	71%	0.0	0.3%	12	0	12	0	0.0%	0.0%
15 Hale Road																				
Ground	R1	W1	Residential	11.2	8.7	2.5	22.2%	1.6	0.7	44%	0.6	36%	0.1	18.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	9.7	7.3	2.4	24.7%													
		W3		6.1	4.1	2.0	32.7%	10.8	2.6	24%	2.3	21%	0.3	13.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W4-L	Bedroom	5.3	2.8	2.5	47.3%													
		W4-U						9.9	1.9	19%	1.7	17%	0.2	10.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	13.2	10.1	3.0	23.0%													
		W1-U																		
		W2-L		17.3	14.2	3.1	17.6%													
		W2-U						11.8	11.2	95%	10.7	90%	0.5	4.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W3-L	Bedroom	12.1	8.2	3.9	32.2%													
		W3-U						9.9	3.3	34%	2.9	29%	0.4	13.4%	N/F	N/F	N/F	N/F	N/F	N/F
17 Hale Road																				
Ground	R1	W1-L	Bedroom	7.6	7.1	0.5	6.1%													
		W1-U						9.9	3.1	31%	2.7	28%	0.4	11.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Residential	7.2	7.2	0.0	0.3%													
		W3		11.7	9.2	2.5	21.5%													
		W4		12.0	9.3	2.7	22.2%													
		W5		10.6	8.1	2.4	23.0%	13.0	5.3	41%	5.4	41%	0.0	-0.6%	0	0	0	0	0.0%	0.0%
First	R1	W1-L	Bedroom	14.2	11.6	2.6	18.1%													
		W1-U						9.9	4.5	46%	4.2	42%	0.3	7.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	11.9	12.0	-0.1	-0.9%													
		W2-U																		
		W3-L		13.5	10.3	3.2	23.5%													
		W3-U						11.8	7.8	66%	7.1	60%	0.7	8.8%	10	0	10	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
21 Hale Road																			
Ground	R1	W1-L	Bedroom	6.5	6.2	0.3	3.9%												
		W1-U						9.2	2.6	29%	2.5	27%	0.1	4.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	3.2	3.5	-0.3	-7.8%	11.4	1.8	16%	1.9	17%	-0.1	-5.4%	0	0	0	0	0.0%	0.0%
First	R1	W1-L	Bedroom	12.1	9.4	2.8	22.8%												
		W1-U						9.3	3.2	34%	3.1	33%	0.2	4.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W3	Kitchen	14.7	11.6	3.1	21.0%	6.3	4.3	69%	3.1	49%	1.2	28.1%	N/F	N/F	N/F	N/F	N/F	N/F
19 Hale Road																			
Ground	R2	W2	Kitchen	12.6	9.8	2.8	22.2%												
		W3		7.6	5.0	2.7	34.9%												
		W4		6.3	4.3	2.0	32.0%	10.8	2.8	26%	2.3	22%	0.5	17.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W5-L	Bedroom	6.6	4.4	2.2	33.4%												
		W5-U						9.9	2.4	25%	1.9	20%	0.5	20.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	14.4	11.3	3.1	21.8%												
		W1-U																		
		W2-L		17.5	13.8	3.7	21.0%												
		W2-U						11.8	11.2	95%	10.6	89%	0.6	5.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W3-L	Bedroom	13.8	9.8	4.0	28.8%												
		W3-U						9.9	3.7	37%	2.7	27%	1.0	26.2%	N/F	N/F	N/F	N/F	N/F	N/F
1 Hale Road																			
Ground	R1	W1	Bedroom	21.7	19.5	2.3	10.4%	9.8	9.1	93%	9.0	92%	0.1	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	31.0	30.9	0.0	0.1%												
		W3-L		17.3	15.0	2.3	13.1%												
		W3-U						10.8	10.7	99%	10.3	96%	0.4	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	24.1	20.1	4.1	16.9%												
		W1-U						9.8	9.2	94%	9.1	93%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	29.0	29.0	0.0	0.1%												
		W2-U																		
		W3-L		24.4	19.9	4.5	18.4%												
		W3-U						12.4	11.8	95%	11.8	95%	0.0	-0.4%	N/F	N/F	N/F	N/F	N/F	N/F
3 Hale Road																			
Ground	R1	W1	Residential	15.4	12.8	2.7	17.3%												
		W2		16.4	13.8	2.6	15.9%	4.5	3.7	83%	3.4	76%	0.3	9.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W3	Kitchen	7.7	6.3	1.4	17.8%												
		W4		5.7	4.3	1.4	24.1%												
		W5-L		4.0	2.8	1.2	30.8%												
		W5-U						11.9	5.8	49%	5.7	48%	0.1	1.6%	7	0	7	0	0.0%	0.0%
Ground	R3	W6	Bedroom	5.1	1.7	3.4	67.3%	9.8	3.4	34%	1.8	18%	1.6	47.5%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R1	W1-L	Residential	23.1	19.0	4.1	17.8%												
		W1-U						11.3	9.3	82%	8.3	73%	1.0	10.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	14.0	9.3	4.7	33.5%												
		W2-U						9.8	5.4	55%	4.8	49%	0.5	10.1%	N/F	N/F	N/F	N/F	N/F	N/F
5 Hale Road																			
Ground	R1	W1	Bedroom	8.9	6.1	2.8	31.4%	9.8	6.8	69%	5.8	59%	1.0	15.2%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	10.7	10.0	0.7	6.3%	9.5	5.1	54%	5.1	54%	0.0	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W3-L	Residential	13.5	9.8	3.7	27.6%												
		W3-U																		
		W4		14.3	10.2	4.1	28.6%	3.3	2.9	87%	2.9	87%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	16.4	11.4	5.0	30.5%												
		W1-U						9.8	8.1	82%	7.2	73%	0.9	11.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	16.9	11.8	5.1	30.2%												
		W2-U						10.9	3.2	29%	2.5	23%	0.7	21.3%	N/F	N/F	N/F	N/F	N/F	N/F
7 Hale Road																			
Ground	R1	W1	Residential	12.4	8.5	3.9	31.2%												
		W2-L		11.2	7.7	3.5	31.2%												
		W2-U						3.3	2.8	83%	2.7	81%	0.1	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W3	Kitchen	7.5	6.8	0.7	9.2%	9.6	4.0	42%	3.9	40%	0.1	3.0%	3	0	3	0	0.0%	0.0%
Ground	R3	W4	Bedroom	5.2	2.0	3.2	61.0%	9.8	2.7	27%	2.0	21%	0.6	23.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Residential	15.0	10.1	4.9	32.4%												
		W1-U						10.9	4.5	41%	3.4	31%	1.1	24.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Bedroom	11.8	6.9	4.9	41.4%												
		W2-U						9.8	4.1	42%	3.7	38%	0.4	9.6%	N/F	N/F	N/F	N/F	N/F	N/F
9 Hale Road																			
Ground	R1	W1	Bedroom	0.0	0.0	0.0	0.0%	9.8	0.0	0%	0.0	0%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	2.0	1.0	1.0	51.3%	9.9	4.4	45%	4.1	42%	0.3	7.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W3-L	Residential	9.9	6.8	3.0	30.7%												
		W3-U						4.5	2.7	60%	2.4	54%	0.2	9.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	12.1	6.7	5.4	44.9%												
		W1-U						9.8	5.1	52%	4.1	41%	1.1	20.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L	Residential	11.7	7.8	4.0	33.8%												
		W2-U						12.4	2.3	19%	2.1	17%	0.2	10.6%	N/F	N/F	N/F	N/F	N/F	N/F
1B Park View Road																			
Ground	R2	W1-L	Living Room	31.2	30.8	0.4	1.2%												
		W1-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		32.1	31.1	1.1	3.3%													
		W2-U																		
		W3-L		23.7	22.7	1.0	4.3%													
		W3-U						13.5	13.4	100%	13.4	100%	0.0	0.1%	50	11	48	10	4.0%	9.1%
First	R1	W3-L	Study	31.4	30.4	1.1	3.3%													
		W3-U						5.1	5.0	97%	5.0	97%	0.0	0.0%	43	10	40	8	7.0%	20.0%
First	R2	W1-L	Bedroom	31.6	30.7	1.0	3.1%													
		W1-U																		
		W2-L		31.6	30.5	1.0	3.3%													
		W2-U						12.0	11.9	99%	11.9	99%	0.0	0.0%	45	11	43	9	4.4%	18.2%
Second	R1	W1	Bedroom	81.9	81.0	0.9	1.1%													
		W2		82.0	81.2	0.9	1.1%													
		W3		38.9	38.9	0.0	0.0%	18.8	18.7	100%	18.7	100%	0.0	0.0%	91	21	90	20	1.1%	4.8%
1A Park View Road																				
Ground	R1	W2-L	Living Room	29.6	29.1	0.5	1.7%													
		W2-U																		
		W3-L		31.7	30.4	1.3	3.9%													
		W3-U																		
		W4-L		24.5	23.4	1.1	4.5%													
		W4-U						13.5	13.5	100%	13.5	100%	0.0	0.0%	53	10	52	10	1.9%	0.0%
First	R1	W2-L	Bedroom	31.2	30.0	1.2	3.8%													
		W2-U																		
		W3-L		31.1	29.9	1.2	3.8%													
		W3-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	41	8	40	8	2.4%	0.0%
First	R2	W1-L	Study	31.3	30.2	1.1	3.6%													
		W1-U						5.1	4.9	96%	4.9	95%	0.0	0.8%	43	10	41	9	4.7%	10.0%
Second	R1	W1	Bedroom	81.6	80.6	1.0	1.2%													
		W2		81.2	80.2	1.0	1.2%													
		W3		38.7	38.7	0.0	0.0%	18.9	18.9	100%	18.9	100%	0.0	0.0%	87	17	86	17	1.1%	0.0%
1 Park View Road																				
Ground	R2	W2-L	Living Room	30.7	30.5	0.3	0.9%													
		W2-U																		
		W3-L		32.9	32.0	0.9	2.6%													
		W3-U																		
		W4-L		26.6	25.6	1.0	3.7%													
		W4-U						11.2	11.1	100%	11.1	100%	0.0	0.0%	51	10	50	9	2.0%	10.0%
First	R1	W1-L	Bedroom	33.5	32.7	0.8	2.4%													
		W1-U																		
		W2-L		33.4	32.6	0.9	2.6%													
		W2-U						11.9	11.7	98%	11.7	98%	0.0	0.0%	48	12	46	10	4.2%	16.7%
2 Park View Road																				
Ground	R1	W1-L	Living Room	29.6	29.4	0.2	0.6%													
		W1-U																		
		W2-L		33.4	32.6	0.8	2.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		26.8	25.9	0.9	3.3%													
		W3-U						20.2	20.1	100%	20.1	100%	0.0	0.0%	51	11	50	10	2.0%	9.1%
First	R1	W1-L	Bedroom	33.6	32.9	0.7	2.1%													
		W1-U																		
		W2-L		33.5	32.8	0.8	2.3%													
		W2-U						12.4	12.2	99%	12.2	99%	0.0	0.0%	47	12	45	10	4.3%	16.7%
The Volunteer																				
First	R2	W2-L	Bedroom	26.4	26.4	0.0	0.0%													
		W2-U						12.3	11.3	92%	11.3	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W3	Kitchen	35.9	35.9	0.0	0.0%													
		W5-L		19.5	19.2	0.3	1.5%													
		W5-U						8.5	8.1	96%	8.1	96%	0.0	0.0%	40	2	40	2	0.0%	0.0%
3 Park View Road																				
Ground	R2	W3-L	Living Room	29.2	29.1	0.1	0.2%													
		W3-U																		
		W4-L		33.0	32.3	0.7	2.1%													
		W4-U																		
		W5-L		22.3	21.5	0.8	3.4%													
		W5-U						12.3	12.3	100%	12.3	100%	0.0	0.0%	49	10	48	9	2.0%	10.0%
First	R1	W1-L	Bedroom	33.7	33.1	0.6	1.9%													
		W1-U																		
		W2-L		33.6	32.9	0.7	2.0%													
		W2-U						12.1	11.9	99%	11.9	99%	0.0	0.0%	47	12	45	10	4.3%	16.7%
5 Park View Road																				
Ground	R1	W1	Kitchen	29.2	28.7	0.6	1.9%													
		W2		27.5	27.0	0.5	2.0%													
		W6-L		12.7	12.7	0.0	0.0%													
		W6-U																		
		W7-L		16.6	16.6	0.0	0.0%													
		W7-U						22.7	18.1	80%	18.1	80%	0.0	0.0%	72	12	70	10	2.8%	16.7%
Ground	R2	W3-L	Living Room	29.3	29.3	0.0	0.1%													
		W3-U																		
		W4-L		33.2	32.6	0.6	1.7%													
		W4-U																		
		W5-L		22.7	22.1	0.7	2.9%													
		W5-U						13.9	13.9	100%	13.9	100%	0.0	0.0%	50	11	48	9	4.0%	18.2%
First	R1	W1-L	Bedroom	33.9	33.4	0.5	1.6%													
		W1-U																		
		W2-L		33.8	33.3	0.6	1.7%													
		W2-U						11.9	11.7	98%	11.7	98%	0.0	0.0%	47	12	45	10	4.3%	16.7%
4 Park View Road																				
Ground	R1	W1-L	Living Room	27.5	27.5	0.0	0.1%													
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		33.1	32.4	0.6	1.9%													
		W2-U																		
		W3-L		22.9	22.2	0.7	3.0%													
		W3-U																		
		W8		12.7	12.7	0.0	0.0%													
		W9		15.0	15.0	0.0	0.0%	19.1	18.7	98%	18.6	97%	0.2	0.8%	55	12	55	12	0.0%	0.0%
First	R1	W1-L	Bedroom	33.8	33.2	0.6	1.7%													
		W1-U																		
		W2-L		33.8	33.1	0.6	1.8%													
		W2-U						14.0	13.8	98%	13.8	98%	0.0	0.0%	47	12	46	11	2.1%	8.3%
6 Park View Road																				
Ground	R1	W1-L	Living Room	27.2	27.2	0.0	0.1%													
		W1-U																		
		W2-L		33.4	32.9	0.5	1.5%													
		W2-U																		
		W3-L		23.4	22.8	0.6	2.6%													
		W3-U						11.4	11.3	99%	11.3	99%	0.0	0.1%	51	12	51	12	0.0%	0.0%
First	R1	W1-L	Bedroom	34.0	33.6	0.4	1.3%													
		W1-U																		
		W2-L		34.0	33.5	0.5	1.4%													
		W2-U						11.6	11.4	98%	11.4	98%	0.0	0.0%	45	10	45	10	0.0%	0.0%
Second	R1	W1-L	Bedroom	26.7	26.7	0.0	0.0%													
		W1-U																		
		W2		78.3	77.9	0.4	0.5%	14.6	13.9	95%	13.9	95%	0.0	0.0%	83	17	82	16	1.2%	5.9%
7A Park View Road																				
Ground	R2	W7-L	Living Room	30.7	30.7	0.0	0.1%													
		W7-U																		
		W8-L		33.5	33.0	0.5	1.4%													
		W8-U																		
		W9-L		22.4	21.8	0.6	2.5%													
		W9-U						13.9	13.9	100%	13.9	100%	0.0	0.0%	48	10	48	10	0.0%	0.0%
First	R1	W1-L	Bedroom	34.2	33.8	0.4	1.2%													
		W1-U																		
		W2-L		34.1	33.6	0.5	1.3%													
		W2-U						12.1	11.9	98%	11.9	98%	0.0	0.0%	44	10	44	10	0.0%	0.0%
Rosa Luxemburg Apartments																				
Ground	R9	W40-L	LKD	19.8	14.6	5.2	26.3%													
		W40-U																		
		W41-L		20.6	16.6	4.0	19.3%													
		W41-U						34.3	29.6	86%	25.8	75%	3.8	12.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L	Bedroom	12.7	9.7	3.0	23.9%													
		W1-U						15.6	7.8	50%	4.1	26%	3.7	47.6%	26	2	20	0	23.1%	100.0%
First	R2	W2-L	Bedroom	14.3	10.9	3.4	23.8%													
		W2-U						9.9	5.9	60%	3.7	38%	2.2	37.1%	28	3	21	0	25.0%	100.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R3	W3-L	LKD	15.1	11.3	3.8	25.0%													
		W3-U																		
		W4-L		11.8	7.9	3.9	32.7%													
		W4-U																		
		W5-L		7.3	6.6	0.8	10.2%													
		W5-U																		
		W6-L		5.7	4.7	1.0	18.0%													
		W6-U						28.8	17.9	62%	12.3	43%	5.6	31.3%	33	4	29	1	12.1%	75.0%
First	R4	W7-L	Bedroom	5.0	4.0	1.0	20.4%													
		W7-U						13.7	2.2	16%	1.4	10%	0.8	36.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W8-L	LKD	4.8	4.7	0.1	2.3%													
		W8-U																		
		W9-L		16.0	13.1	3.0	18.5%													
		W9-U						34.8	12.2	35%	7.4	21%	4.8	39.4%	34	3	31	1	8.8%	66.7%
First	R6	W10-L	Bedroom	13.9	12.0	1.9	13.8%													
		W10-U						13.1	5.7	43%	3.7	28%	2.0	35.0%	33	4	30	0	9.1%	100.0%
First	R7	W11-L	Bedroom	2.2	0.9	1.2	56.9%													
		W11-U						12.8	2.9	23%	0.5	4%	2.4	82.0%	6	4	3	0	50.0%	100.0%
First	R8	W12-L	Bedroom	7.7	6.9	0.8	10.1%													
		W12-U						17.2	6.5	38%	4.5	26%	2.1	31.6%	19	4	17	1	10.5%	75.0%
First	R9	W13-L	Bedroom	11.5	10.9	0.6	5.2%													
		W13-U						14.5	9.0	62%	8.1	56%	0.9	10.2%	28	6	25	3	10.7%	50.0%
First	R10	W14-L	Bedroom	12.7	11.9	0.8	5.9%													
		W14-U						13.5	5.9	43%	5.9	43%	0.0	0.0%	22	3	18	1	18.2%	66.7%
First	R11	W15-L	LKD	3.2	2.7	0.5	14.5%													
		W15-U						29.0	25.8	89%	25.8	89%	0.0	-0.1%	6	0	6	0	0.0%	0.0%
First	R12	W16-L	LKD	14.6	11.1	3.5	24.2%													
		W16-U						27.2	26.4	97%	25.4	93%	1.0	3.8%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	10.7	10.7	0.0	0.0%													
		W1-U																		
		W2-L		11.0	11.0	0.0	0.0%													
		W2-U																		
		W3-L		12.5	11.5	1.1	8.5%													
		W3-U						26.9	26.0	97%	26.0	97%	0.0	0.0%	41	6	39	6	4.9%	0.0%
Second	R2	W4-L	Bedroom	12.0	10.2	1.7	14.3%													
		W4-U						8.4	2.5	30%	2.1	25%	0.4	14.7%	30	4	27	4	10.0%	0.0%
Second	R3	W5-L	Bedroom	11.6	9.5	2.2	18.6%													
		W5-U						12.0	3.9	33%	2.7	23%	1.2	30.2%	34	4	26	3	23.5%	25.0%
Second	R4	W6-L	LKD	12.6	10.0	2.5	20.2%													
		W6-U																		
		W7-L		1.3	0.7	0.6	46.2%													
		W7-U																		
		W8-L		14.3	12.7	1.7	11.5%													
		W8-U						23.3	14.2	61%	17.1	73%	-2.9	-20.6%	45	5	37	2	17.8%	60.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Second	R5	W9-L	Bedroom	12.7	11.1	1.7	13.0%													
		W9-U						12.9	10.0	77%	7.3	56%	2.7	27.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10-L	Bedroom	15.0	11.6	3.5	23.1%													
		W10-U						14.5	11.6	80%	5.7	40%	5.9	50.8%	33	6	23	2	30.3%	66.7%
Second	R7	W11-L	Bedroom	17.1	13.2	3.8	22.5%													
		W11-U						9.1	7.5	82%	5.2	57%	2.3	30.4%	33	6	25	2	24.2%	66.7%
Second	R8	W12-L	LKD	18.2	14.0	4.2	22.9%													
		W12-U																		
		W13-L		2.3	0.4	1.9	83.2%													
		W13-U																		
		W14-L		7.4	6.1	1.2	16.6%													
		W14-U						27.3	24.4	89%	14.4	53%	10.0	40.9%	37	7	32	3	13.5%	57.1%
Second	R9	W15-L	Bedroom	6.0	4.8	1.3	20.9%													
		W15-U						14.0	3.0	21%	1.9	14%	1.1	35.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W16-L	Bedroom	5.9	5.9	0.0	0.5%													
		W16-U						13.0	2.3	18%	2.3	18%	0.0	0.0%	14	2	14	2	0.0%	0.0%
Second	R11	W17-L	LKD	8.0	7.8	0.2	3.0%													
		W17-U																		
		W18-L		5.9	3.8	2.1	35.9%													
		W18-U																		
		W19-L		17.3	15.1	2.2	12.4%													
		W19-U						23.4	21.2	90%	15.1	64%	6.1	28.8%	43	9	38	6	11.6%	33.3%
Second	R12	W20-L	LKD	4.1	3.3	0.7	18.0%													
		W20-U						22.9	8.3	36%	4.9	21%	3.4	41.2%	13	8	11	5	15.4%	37.5%
Second	R13	W21-L	Bedroom	9.2	8.5	0.6	7.0%													
		W21-U						15.3	7.6	50%	6.4	42%	1.2	15.8%	21	4	21	4	0.0%	0.0%
Second	R14	W22-L	Bedroom	12.6	12.1	0.5	4.3%													
		W22-U						14.5	9.8	67%	9.2	64%	0.5	5.6%	30	7	27	4	10.0%	42.9%
Second	R15	W23-L	Bedroom	14.0	13.6	0.4	3.2%													
		W23-U						13.5	6.1	45%	6.1	45%	0.0	0.0%	24	3	24	3	0.0%	0.0%
Second	R16	W24-L	LKD	4.2	3.7	0.5	12.1%													
		W24-U						29.0	26.3	91%	26.4	91%	-0.1	-0.3%	8	1	7	0	12.5%	100.0%
Second	R17	W25-L	LKD	17.2	11.5	5.7	33.0%													
		W25-U						27.2	26.5	98%	25.4	93%	1.1	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	11.7	11.7	0.0	0.0%													
		W1-U																		
		W2-L		12.1	12.1	0.0	0.0%													
		W2-U																		
		W3-L		16.1	13.9	2.2	13.5%													
		W3-U						26.9	26.1	97%	26.1	97%	0.0	0.0%	55	6	47	6	14.5%	0.0%
Third	R2	W4-L	Bedroom	15.9	12.9	3.1	19.2%													
		W4-U						8.4	3.6	43%	2.8	34%	0.7	20.9%	44	4	37	5	15.9%	-25.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R3	W5-L	Bedroom	15.8	12.1	3.7	23.4%												
		W5-U						12.0	5.1	43%	3.5	29%	1.6	31.6%	48	4	38	3	20.8%	25.0%
Third	R4	W6-L	LKD	16.9	13.0	3.9	23.0%												
		W6-U																	
		W7-L		2.7	2.1	0.6	21.0%												
		W7-U																	
		W8-L		16.8	14.7	2.1	12.3%												
		W8-U						23.3	17.3	74%	20.1	86%	-2.9	-16.6%	57	7	44	3	22.8%	57.1%
Third	R5	W9-L	Bedroom	14.7	12.7	2.0	13.5%												
		W9-U						12.9	10.8	83%	8.2	64%	2.6	23.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10-L	Bedroom	17.2	13.8	3.4	19.9%												
		W10-U						14.5	12.9	89%	8.8	61%	4.1	31.7%	34	7	28	4	17.6%	42.9%
Third	R7	W11-L	Bedroom	19.2	15.7	3.5	18.2%												
		W11-U						9.1	8.0	88%	7.5	83%	0.5	6.0%	36	7	29	4	19.4%	42.9%
Third	R8	W12-L	LKD	20.3	16.8	3.6	17.5%												
		W12-U																	
		W13-L		3.7	2.2	1.5	41.1%												
		W13-U																	
		W14-L		8.9	7.4	1.4	16.2%												
		W14-U						27.3	26.8	98%	20.4	75%	6.4	23.9%	41	9	35	5	14.6%	44.4%
Third	R9	W15-L	Bedroom	7.2	5.9	1.4	19.0%												
		W15-U						14.0	3.5	25%	2.2	16%	1.4	38.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16-L	Bedroom	7.5	7.5	0.0	0.3%												
		W16-U						13.0	2.8	22%	2.8	22%	0.0	0.0%	15	3	15	3	0.0%	0.0%
Third	R11	W17-L	LKD	9.9	9.8	0.1	1.2%												
		W17-U																	
		W18-L		7.8	5.9	1.9	24.6%												
		W18-U																	
		W19-L		19.9	17.9	2.0	9.9%												
		W19-U						23.4	22.8	98%	19.9	85%	3.0	13.0%	49	12	42	10	14.3%	16.7%
Third	R12	W20-L	LKD	5.6	5.5	0.1	1.3%												
		W20-U						22.9	12.9	56%	8.3	36%	4.6	36.0%	16	8	18	10	-12.5%	-25.0%
Third	R13	W21-L	Bedroom	10.6	10.4	0.1	1.3%												
		W21-U						15.3	8.7	57%	9.5	62%	-0.8	-9.2%	24	6	24	6	0.0%	0.0%
Third	R14	W22-L	Bedroom	13.8	13.4	0.4	2.9%												
		W22-U						14.5	10.3	71%	10.2	70%	0.1	0.7%	30	7	30	7	0.0%	0.0%
Third	R15	W23-L	Bedroom	15.5	15.1	0.4	2.8%												
		W23-U						13.5	6.6	49%	6.6	49%	0.0	0.0%	26	4	25	3	3.8%	25.0%
Third	R16	W24-L	LKD	5.6	4.9	0.7	12.4%												
		W24-U						29.0	27.1	93%	26.7	92%	0.4	1.4%	11	3	8	0	27.3%	100.0%
Third	R17	W25-L	LKD	18.9	11.9	7.0	36.9%												
		W25-U						27.2	26.8	99%	25.5	94%	1.4	5.1%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fourth	R1	W1-L	LKD	12.3	12.3	0.0	0.0%													
		W1-U																		
		W2-L		14.1	14.1	0.0	0.1%													
		W2-U																		
		W3-L		21.7	17.4	4.3	19.8%													
		W3-U						29.5	27.2	92%	27.2	92%	0.0	0.0%	68	8	58	6	14.7%	25.0%
Fourth	R2	W4-L	Bedroom	21.6	17.2	4.4	20.3%													
		W4-U						12.2	7.3	60%	5.4	44%	1.9	26.5%	59	6	49	5	16.9%	16.7%
Fourth	R3	W5-L	Bedroom	21.7	16.4	5.3	24.5%													
		W5-U						12.6	7.5	60%	4.8	38%	2.7	36.2%	60	6	47	3	21.7%	50.0%
Fourth	R4	W6-L	LKD	22.6	17.7	4.9	21.8%													
		W6-U																		
		W7-L		5.9	4.2	1.7	28.3%													
		W7-U																		
		W8-L		19.3	17.0	2.3	12.1%													
		W8-U						23.3	21.5	92%	21.4	92%	0.0	0.1%	67	12	59	7	11.9%	41.7%
Fourth	R5	W9-L	Bedroom	16.6	14.4	2.2	13.5%													
		W9-U						12.9	11.0	85%	9.1	71%	1.9	16.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W10-L	Bedroom	18.8	15.7	3.1	16.5%													
		W10-U						14.5	13.3	92%	12.9	89%	0.5	3.4%	38	10	32	8	15.8%	20.0%
Fourth	R7	W11-L	Bedroom	20.9	17.9	3.1	14.7%													
		W11-U						9.1	8.3	91%	8.3	91%	0.0	0.0%	40	10	34	8	15.0%	20.0%
Fourth	R8	W12-L	LKD	22.1	19.0	3.0	13.8%													
		W12-U																		
		W13-L		5.9	4.3	1.5	25.8%													
		W13-U																		
		W14-L		11.0	9.4	1.7	15.0%													
		W14-U						27.3	26.9	98%	26.9	98%	0.0	-0.1%	45	11	40	9	11.1%	18.2%
Fourth	R9	W15-L	Bedroom	9.0	7.5	1.6	17.3%													
		W15-U						14.0	3.8	27%	2.4	18%	1.4	35.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W16-L	Bedroom	9.9	9.9	0.0	0.2%													
		W16-U						13.0	4.1	32%	4.1	32%	0.0	0.0%	16	3	16	3	0.0%	0.0%
Fourth	R11	W17-L	LKD	12.3	12.2	0.1	0.6%													
		W17-U																		
		W18-L		9.6	7.7	2.0	20.2%													
		W18-U																		
		W19-L		22.6	20.4	2.2	9.8%													
		W19-U						23.4	23.0	98%	22.9	98%	0.1	0.4%	59	15	51	14	13.6%	6.7%
Fourth	R12	W20-L	LKD	7.3	7.4	0.0	-0.3%													
		W20-U						22.9	19.2	84%	18.2	79%	1.0	5.2%	20	11	20	11	0.0%	0.0%
Fourth	R13	W21-L	Bedroom	12.4	12.8	-0.3	-2.7%													
		W21-U						15.3	11.6	76%	12.9	84%	-1.3	-11.1%	25	6	25	6	0.0%	0.0%
Fourth	R14	W22-L	Bedroom	15.3	15.0	0.3	2.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W22-U						14.5	11.0	76%	11.0	76%	0.0	0.0%	34	7	34	7	0.0%	0.0%
Fourth	R15	W23-L	Bedroom	17.1	16.7	0.4	2.3%													
		W23-U						13.5	7.4	55%	7.4	55%	0.0	0.0%	28	4	28	4	0.0%	0.0%
Fourth	R16	W24-L	LKD	7.1	6.7	0.4	5.9%													
		W24-U						29.0	27.7	95%	27.6	95%	0.1	0.4%	15	5	15	5	0.0%	0.0%
Fourth	R17	W25-L	LKD	19.7	14.0	5.7	28.9%													
		W25-U						27.2	26.8	99%	26.1	96%	0.8	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	13.0	13.0	0.0	0.0%													
		W1-U																		
		W2-L		14.7	14.7	0.0	0.1%													
		W2-U																		
		W3-L		27.9	22.3	5.6	20.0%													
		W3-U						29.5	28.4	96%	27.8	94%	0.6	2.1%	80	16	72	11	10.0%	31.3%
Fifth	R2	W4-L	Bedroom	27.9	22.4	5.5	19.6%													
		W4-U						12.2	9.0	74%	8.3	68%	0.8	8.4%	69	15	61	9	11.6%	40.0%
Fifth	R3	W5-L	Bedroom	27.9	22.1	5.8	20.9%													
		W5-U						12.6	11.8	94%	10.4	83%	1.4	12.2%	69	14	62	8	10.1%	42.9%
Fifth	R4	W6-L	LKD	28.1	22.9	5.2	18.5%													
		W6-U																		
		W7-L		7.7	7.3	0.5	5.8%													
		W7-U																		
		W8-L		22.0	19.6	2.4	11.1%													
		W8-U						23.3	22.8	98%	22.1	95%	0.7	3.1%	70	16	65	14	7.1%	12.5%
Fifth	R5	W9-L	Bedroom	18.5	16.2	2.4	12.7%													
		W9-U						12.9	11.3	87%	9.5	74%	1.8	15.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W10-L	Bedroom	20.1	17.4	2.7	13.3%													
		W10-U						14.5	13.5	93%	13.1	90%	0.4	2.6%	39	11	35	10	10.3%	9.1%
Fifth	R7	W11-L	Bedroom	22.6	19.9	2.7	11.8%													
		W11-U						9.1	8.6	95%	8.6	95%	0.0	0.0%	42	11	37	10	11.9%	9.1%
Fifth	R8	W12-L	LKD	24.2	21.4	2.7	11.3%													
		W12-U																		
		W13-L		7.2	5.7	1.6	21.7%													
		W13-U																		
		W14-L		14.0	12.1	1.9	13.7%													
		W14-U						27.3	26.9	99%	27.0	99%	0.0	0.0%	48	13	45	13	6.3%	0.0%
Fifth	R9	W15-L	Bedroom	11.7	9.9	1.8	15.3%													
		W15-U						14.0	4.6	33%	3.3	24%	1.2	27.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W16-L	Bedroom	13.2	13.2	0.0	0.0%													
		W16-U						13.0	6.4	49%	6.4	49%	0.0	0.0%	23	6	23	6	0.0%	0.0%
Fifth	R11	W17-L	LKD	15.6	15.6	0.0	0.3%													
		W17-U																		
		W18-L		11.3	9.2	2.1	18.4%													
		W18-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W19-L		25.3	22.7	2.6	10.2%												
		W19-U						23.4	23.1	99%	23.1	99%	0.0	0.0%	65	19	58	17	10.8%	10.5%
Fifth	R12	W20-L	LKD	9.7	8.9	0.9	8.8%												
		W20-U						22.9	22.0	96%	22.2	97%	-0.1	-0.7%	25	14	22	13	12.0%	7.1%
Fifth	R13	W21-L	Bedroom	14.7	15.2	-0.5	-3.3%												
		W21-U						15.3	13.4	87%	13.4	88%	0.0	-0.3%	32	10	32	10	0.0%	0.0%
Fifth	R14	W22-L	Bedroom	17.1	16.9	0.1	0.7%												
		W22-U						14.5	11.9	82%	11.9	82%	0.0	0.0%	43	10	42	9	2.3%	10.0%
Fifth	R15	W23-L	Bedroom	19.3	19.1	0.1	0.7%												
		W23-U						13.5	8.5	63%	8.5	63%	0.0	0.0%	39	5	38	4	2.6%	20.0%
Fifth	R16	W24-L	LKD	9.0	8.8	0.2	2.1%												
		W24-U						29.0	28.5	98%	28.5	98%	0.0	0.0%	19	8	21	10	-10.5%	-25.0%
Fifth	R17	W25-L	LKD	20.0	16.3	3.7	18.6%												
		W25-U						27.2	26.8	99%	26.2	97%	0.6	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	14.9	14.9	0.0	0.0%												
		W1-U																		
		W2-L		16.4	16.4	0.0	0.0%												
		W2-U																		
		W3-L		29.5	27.0	2.5	8.5%												
		W3-U						29.5	28.7	97%	28.8	97%	0.0	0.0%	85	21	79	18	7.1%	14.3%
Sixth	R2	W4-L	Bedroom	29.5	26.8	2.7	9.0%												
		W4-U						12.2	9.1	75%	9.1	75%	0.0	0.1%	75	19	69	16	8.0%	15.8%
Sixth	R3	W5-L	Bedroom	29.6	26.8	2.8	9.5%												
		W5-U						12.6	11.9	95%	11.9	95%	0.0	0.0%	74	18	69	15	6.8%	16.7%
Sixth	R4	W6-L	LKD	29.6	26.9	2.6	8.9%												
		W6-U																		
		W7-L		9.4	9.5	0.0	-0.3%												
		W7-U																		
		W8-L		25.1	22.5	2.6	10.4%												
		W8-U						23.3	22.8	98%	22.5	97%	0.2	1.1%	73	17	69	16	5.5%	5.9%
Sixth	R5	W9-L	Bedroom	21.0	18.4	2.6	12.1%												
		W9-U						12.9	11.4	88%	9.7	75%	1.7	14.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W10-L	Bedroom	21.4	18.7	2.7	12.6%												
		W10-U						14.5	13.6	94%	13.2	91%	0.3	2.4%	42	12	37	10	11.9%	16.7%
Sixth	R7	W11-L	Bedroom	24.4	21.6	2.8	11.3%												
		W11-U						9.1	8.8	97%	8.8	97%	0.0	0.0%	46	12	41	10	10.9%	16.7%
Sixth	R8	W12-L	LKD	27.2	24.3	2.9	10.7%												
		W12-U																		
		W13-L		25.2	22.2	3.0	11.9%												
		W13-U																		
		W14-L		17.9	15.7	2.2	12.3%												
		W14-U						27.3	27.1	99%	27.1	99%	0.0	0.0%	54	14	51	13	5.6%	7.1%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R9	W15-L	Bedroom	16.0	13.9	2.1	13.1%												
		W15-U						14.0	5.7	41%	4.7	33%	1.0	17.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W16-L	Bedroom	17.8	17.8	0.0	0.0%												
		W16-U						13.0	9.6	74%	9.6	74%	0.0	0.0%	26	6	26	6	0.0%	0.0%
Sixth	R11	W17-L	LKD	19.6	19.6	0.0	0.0%												
		W17-U																		
		W18-L		13.9	11.1	2.7	19.6%												
		W18-U																		
		W19-L		28.0	24.7	3.3	11.8%												
		W19-U						23.4	23.1	99%	23.1	99%	0.0	0.0%	71	23	63	20	11.3%	13.0%
Sixth	R12	W20-L	LKD	13.5	10.7	2.8	20.6%												
		W20-U						22.9	22.7	99%	22.4	98%	0.3	1.4%	34	18	29	16	14.7%	11.1%
Sixth	R13	W21-L	Bedroom	17.3	17.1	0.2	1.1%												
		W21-U						15.3	14.0	91%	13.9	90%	0.2	1.2%	36	15	36	15	0.0%	0.0%
Sixth	R14	W22-L	Bedroom	18.6	18.7	0.0	-0.2%												
		W22-U						14.5	12.7	88%	12.7	88%	0.0	0.0%	45	12	46	13	-2.2%	-8.3%
Sixth	R15	W23-L	Bedroom	21.6	21.6	-0.1	-0.2%												
		W23-U						13.5	9.8	73%	9.8	73%	0.0	0.0%	46	12	47	13	-2.2%	-8.3%
Sixth	R16	W24-L	LKD	25.7	25.8	-0.1	-0.2%												
		W24-U						29.0	28.9	100%	28.9	100%	0.0	0.0%	46	12	48	14	-4.3%	-16.7%
Sixth	R17	W25-L	LKD	38.0	34.7	3.3	8.6%												
		W25-U						27.2	26.9	99%	26.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	28.3	28.3	0.0	0.0%												
		W1-U																		
		W2-L		33.2	33.2	0.0	0.0%												
		W2-U																		
		W3-L		30.4	28.6	1.8	5.9%												
		W3-U						29.5	29.0	98%	29.0	98%	0.0	0.0%	86	21	82	19	4.7%	9.5%
Seventh	R2	W4-L	Bedroom	30.4	28.4	2.0	6.7%												
		W4-U						12.2	9.2	76%	9.2	76%	0.0	0.0%	76	20	72	18	5.3%	10.0%
Seventh	R3	W5-L	Bedroom	30.5	28.3	2.2	7.2%												
		W5-U						12.6	12.1	96%	12.1	96%	0.0	0.0%	73	18	69	16	5.5%	11.1%
Seventh	R4	W6-L	LKD	30.6	28.1	2.5	8.0%												
		W6-U																		
		W7-L		11.0	11.0	-0.1	-0.7%												
		W7-U																		
		W8-L		29.3	26.4	2.9	9.9%												
		W8-U						23.3	22.8	98%	22.6	97%	0.2	0.8%	74	19	70	17	5.4%	10.5%
Seventh	R5	W9-L	Bedroom	25.6	22.9	2.8	10.8%												
		W9-U						12.9	11.4	88%	9.8	76%	1.6	14.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10-L	Bedroom	23.3	20.5	2.8	12.1%												
		W10-U						14.0	13.5	96%	13.2	94%	0.3	2.0%	45	13	39	10	13.3%	23.1%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Seventh	R7	W11-L	LKD	26.8	23.9	2.9	10.8%													
		W11-U																		
		W12-L		29.5	26.4	3.1	10.6%													
		W12-U																		
		W13-L		27.3	24.7	2.6	9.6%													
		W13-U						26.6	26.3	99%	26.3	99%	0.0	0.0%	64	19	60	16	6.3%	15.8%
Seventh	R8	W14-L	Bedroom	23.3	23.3	0.0	0.0%													
		W14-U						13.0	11.4	88%	11.4	88%	0.0	0.0%	34	8	34	8	0.0%	0.0%
Seventh	R9	W15-L	LKD	24.6	24.6	0.0	0.0%													
		W15-U																		
		W16-L		25.9	22.7	3.3	12.6%													
		W16-U																		
		W17-L		30.6	26.3	4.3	14.0%													
		W17-U						23.5	23.2	99%	23.2	99%	0.0	0.0%	74	25	66	21	10.8%	16.0%
Seventh	R10	W18-L	LKD	27.3	23.0	4.4	16.0%													
		W18-U						23.1	22.9	99%	22.8	99%	0.1	0.4%	65	22	57	17	12.3%	22.7%
Seventh	R11	W19-L	Bedroom	20.6	19.9	0.7	3.3%													
		W19-U						15.3	14.4	94%	14.3	93%	0.2	1.1%	51	17	51	17	0.0%	0.0%
Seventh	R12	W20-L	Bedroom	23.5	23.5	0.0	-0.1%													
		W20-U																		
		W21-L		31.2	26.3	5.0	15.9%													
		W21-U						11.5	11.4	98%	10.9	94%	0.5	4.0%	81	23	71	18	12.3%	21.7%
Seventh	R13	W22-L	Bedroom	26.7	20.8	5.9	22.0%													
		W22-U						12.0	11.5	96%	10.7	89%	0.8	6.9%	67	24	54	17	19.4%	29.2%
Seventh	R14	W23-L	Bedroom	33.1	26.1	7.1	21.3%													
		W23-U						13.5	12.7	94%	10.6	78%	2.1	16.3%	81	24	67	16	17.3%	33.3%
Seventh	R15	W24-L	LKD	33.5	26.0	7.5	22.4%													
		W24-U																		
		W25-L		38.1	35.9	2.2	5.8%													
		W25-U																		
		W26-L		34.7	32.8	1.9	5.5%													
		W26-U						33.5	33.2	99%	33.2	99%	0.0	0.1%	80	22	72	18	10.0%	18.2%
Eighth	R1	W1-L	LKD	34.9	34.9	0.0	0.0%													
		W1-U						21.6	21.3	98%	21.3	98%	0.0	0.0%	54	15	54	15	0.0%	0.0%
Eighth	R2	W2-L	Bedroom	34.8	34.8	0.0	0.0%													
		W2-U																		
		W3-L		25.2	25.2	0.0	0.0%													
		W3-U						13.8	13.8	100%	13.8	100%	0.0	0.0%	68	18	68	18	0.0%	0.0%
Eighth	R3	W4-L	Bedroom	31.8	29.6	2.2	6.9%													
		W4-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	79	22	75	20	5.1%	9.1%
Eighth	R4	W5-L	LKD	31.9	29.2	2.7	8.5%													
		W5-U																		
		W6-L		30.8	27.9	2.9	9.3%													
		W6-U						22.1	22.0	100%	22.0	100%	0.0	0.0%	75	20	69	17	8.0%	15.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R5	W7-L	Bedroom	26.5	23.7	2.9	10.8%												
		W7-U						9.3	8.5	91%	8.0	86%	0.5	6.0%	50	13	45	10	10.0%	23.1%
Eighth	R6	W8-L	LKD	30.5	27.4	3.1	10.1%												
		W8-U																	
		W9-L		31.1	28.6	2.6	8.2%												
		W9-U																	
		W10-L		31.2	28.9	2.4	7.7%												
		W10-U						28.6	28.2	99%	28.2	99%	0.0	0.0%	66	17	62	14	6.1%	17.6%
Eighth	R7	W11-L	LKD	17.8	17.8	0.0	0.0%												
		W11-U																	
		W12-L		31.9	31.9	0.0	0.0%												
		W12-U																	
		W13-L		32.2	27.7	4.6	14.2%												
		W13-U						33.8	33.7	100%	33.7	100%	0.0	0.0%	84	25	76	20	9.5%	20.0%
Eighth	R8	W14-L	Bedroom	30.1	25.1	5.0	16.6%												
		W14-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	68	22	60	17	11.8%	22.7%
Eighth	R9	W15-L	Bedroom	21.9	21.1	0.8	3.8%												
		W15-U						14.0	12.4	89%	11.9	85%	0.5	4.2%	51	18	51	18	0.0%	0.0%
Eighth	R10	W16-L	Bedroom	26.2	26.2	0.0	0.0%												
		W16-U																	
		W17-L		34.1	27.6	6.5	19.1%												
		W17-U						13.0	12.9	100%	12.2	94%	0.7	5.7%	89	26	78	19	12.4%	26.9%
Eighth	R11	W18-L	Bedroom	34.3	27.4	6.9	20.0%												
		W18-U						11.4	10.9	95%	10.3	90%	0.6	5.8%	83	26	70	19	15.7%	26.9%
Eighth	R12	W19-L	Bedroom	33.3	26.2	7.1	21.3%												
		W19-U						8.3	7.9	96%	7.4	89%	0.5	6.8%	70	22	57	14	18.6%	36.4%
Eighth	R13	W20-L	LKD	34.5	27.2	7.2	21.0%												
		W20-U																	
		W21-L		38.9	37.0	1.9	5.0%												
		W21-U						28.5	28.2	99%	28.2	99%	0.0	0.0%	80	24	72	19	10.0%	20.8%
Ninth	R2	W2-L	LKD	31.4	31.4	0.0	0.0%												
		W2-U																	
		W3-L		35.0	35.0	0.0	0.0%												
		W3-U						33.0	30.5	92%	30.5	92%	0.0	0.0%	54	14	54	14	0.0%	0.0%
Ninth	R3	W4-L	Bedroom	35.1	35.1	0.0	0.0%												
		W4-U																	
		W5-L		33.5	29.2	4.3	12.9%												
		W5-U						14.6	13.6	93%	13.6	93%	0.0	0.0%	90	24	82	19	8.9%	20.8%
Ninth	R5	W7-L	Bedroom	25.4	24.2	1.3	4.9%												
		W7-U						13.8	8.4	60%	6.3	45%	2.1	25.2%	58	19	57	19	1.7%	0.0%
Ninth	R6	W8-L	Bedroom	30.9	30.9	0.0	0.0%												
		W8-U																	
		W9-L		34.5	28.3	6.2	18.0%												
		W9-U						13.3	12.0	90%	11.5	86%	0.5	4.2%	91	26	81	19	11.0%	26.9%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Ninth	R7	W10-L	Bedroom	34.7	28.2	6.5	18.8%													
		W10-U						11.1	10.8	97%	9.7	87%	1.1	10.2%	83	27	72	20	13.3%	25.9%
Ninth	R8	W11-L	LKD	34.8	28.0	6.9	19.7%													
		W11-U																		
		W12-L		16.6	14.7	1.9	11.2%													
		W12-U																		
		W13-L		15.7	15.5	0.2	1.4%													
		W13-U						31.6	31.5	100%	31.5	100%	0.0	0.0%	81	24	71	18	12.3%	25.0%
West Apartments																				
First	R1	W1-L	LKD	13.4	13.4	0.0	0.0%													
		W1-U																		
		W2-L		4.9	4.9	0.0	0.0%													
		W2-U																		
		W7-L		0.0	0.0	0.0	0.0%													
		W7-U						30.8	12.6	41%	12.6	41%	0.0	0.0%	27	2	27	2	0.0%	0.0%
First	R2	W3-L	LKD	0.0	0.0	0.0	0.0%													
		W3-U																		
		W4-L		17.3	17.3	0.0	0.0%													
		W4-U																		
		W6-L		0.0	0.0	0.0	0.0%													
		W6-U						30.8	8.1	26%	8.1	26%	0.0	0.0%	32	2	32	2	0.0%	0.0%
First	R3	W5-L	Bedroom	15.5	12.9	2.7	17.1%													
		W5-U						12.8	6.6	51%	5.2	41%	1.4	21.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W8-L	Bedroom	9.0	8.6	0.4	4.3%													
		W8-U						12.8	4.2	33%	4.8	37%	-0.6	-14.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W9-L	Bedroom	1.4	2.0	-0.6	-41.4%													
		W9-U						12.3	1.4	12%	2.1	17%	-0.7	-45.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W10-L	Bedroom	11.2	7.7	3.5	30.9%													
		W10-U						13.7	10.0	73%	10.0	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W11-L	LKD	8.0	4.7	3.4	42.0%													
		W11-U																		
		W12-L		8.2	5.5	2.7	33.0%													
		W12-U						28.4	22.5	79%	22.5	79%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W13-L	Bedroom	17.2	14.1	3.1	18.0%													
		W13-U						14.0	12.7	91%	12.7	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W14-L	LKD	13.2	10.0	3.2	24.1%													
		W14-U																		
		W15-L		9.4	7.4	2.0	21.2%													
		W15-U						28.4	22.9	80%	22.8	80%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R10	W16-L	Bedroom	7.5	5.8	1.7	22.4%													
		W16-U						9.7	6.5	66%	5.7	58%	0.8	12.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W17-L	Bedroom	7.6	6.2	1.4	17.9%													
		W17-U						35.6	22.2	62%	26.4	74%	-4.1	-18.6%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Second	R1	W1-L	LKD	14.6	14.6	0.0	0.0%													
		W1-U																		
		W2-L		5.1	5.1	0.0	0.0%													
		W2-U																		
		W7-L		0.0	0.0	0.0	0.0%													
		W7-U						30.8	12.5	40%	12.5	40%	0.0	0.0%	28	2	28	2	0.0%	0.0%
Second	R2	W3-L	LKD	0.0	0.0	0.0	0.0%													
		W3-U																		
		W4-L		18.6	18.6	0.0	0.0%													
		W4-U																		
		W6-L		0.0	0.0	0.0	0.0%													
		W6-U						30.8	8.9	29%	8.8	29%	0.1	1.1%	34	2	34	2	0.0%	0.0%
Second	R3	W5-L	Bedroom	18.7	15.4	3.3	17.6%													
		W5-U						12.8	9.0	70%	7.0	54%	2.1	23.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W8-L	Bedroom	10.6	10.2	0.4	3.9%													
		W8-U						12.8	5.1	40%	6.1	48%	-1.0	-20.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W9-L	Bedroom	2.2	2.8	-0.6	-28.4%													
		W9-U						12.3	2.1	17%	3.2	26%	-1.1	-49.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10-L	Bedroom	12.9	9.3	3.6	28.0%													
		W10-U						13.7	10.4	76%	10.4	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W11-L	LKD	10.6	7.1	3.5	32.6%													
		W11-U																		
		W12-L		10.4	7.4	3.0	29.2%													
		W12-U						28.4	23.0	81%	22.9	81%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W13-L	Bedroom	20.2	16.6	3.6	17.7%													
		W13-U						14.0	13.4	96%	13.4	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W14-L	LKD	16.1	12.7	3.4	21.1%													
		W14-U																		
		W15-L		12.1	9.8	2.3	19.1%													
		W15-U						28.4	23.0	81%	22.8	80%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W16-L	Bedroom	8.7	6.5	2.1	24.6%													
		W16-U						9.7	7.1	73%	5.7	59%	1.4	20.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W17-L	Bedroom	9.0	7.2	1.8	19.5%													
		W17-U						35.6	22.6	63%	26.7	75%	-4.2	-18.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	15.7	15.7	0.0	0.0%													
		W1-U																		
		W2-L		5.2	5.2	0.0	0.0%													
		W2-U																		
		W7-L		0.0	0.0	0.0	0.0%													
		W7-U						30.8	12.5	41%	13.3	43%	-0.8	-6.2%	30	3	30	3	0.0%	0.0%
Third	R2	W3-L	LKD	0.0	0.0	0.0	0.0%													
		W3-U																		
		W4-L		19.9	19.9	0.0	0.0%													
		W4-U																		
		W6-L		0.0	0.0	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U						30.8	11.6	38%	10.6	34%	1.1	9.0%	37	3	37	3	0.0%	0.0%
Third	R3	W5-L	Bedroom	22.2	18.2	4.0	17.8%													
		W5-U						12.8	12.6	98%	9.5	74%	3.0	24.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W8-L	Bedroom	12.4	12.0	0.5	3.7%													
		W8-U						12.8	6.3	49%	8.1	63%	-1.9	-29.8%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W9-L	Bedroom	3.0	3.7	-0.7	-22.1%													
		W9-U						12.3	3.1	26%	4.7	38%	-1.6	-50.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10-L	Bedroom	16.1	12.4	3.7	23.1%													
		W10-U						13.7	11.9	87%	11.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W11-L	LKD	15.0	11.5	3.5	23.5%													
		W11-U																		
		W12-L		14.0	10.7	3.3	23.7%													
		W12-U						28.4	24.3	86%	23.5	83%	0.8	3.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W13-L	Bedroom	23.6	19.9	3.7	15.8%													
		W13-U						14.0	13.8	99%	13.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W14-L	LKD	19.4	15.9	3.5	18.2%													
		W14-U																		
		W15-L		15.4	12.8	2.6	16.9%													
		W15-U						28.4	23.6	83%	22.9	80%	0.7	3.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16-L	Bedroom	10.0	7.6	2.4	24.1%													
		W16-U						9.7	8.2	85%	6.0	61%	2.3	27.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W17-L	Bedroom	10.5	8.4	2.1	19.9%													
		W17-U						35.6	23.1	65%	27.1	76%	-4.0	-17.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	16.8	16.8	0.0	0.0%													
		W1-U																		
		W2-L		5.3	5.3	0.0	0.0%													
		W2-U																		
		W7-L		0.0	0.1	-0.1	0.0%													
		W7-U						30.8	14.0	45%	16.5	54%	-2.5	-17.8%	33	4	33	4	0.0%	0.0%
Fourth	R2	W3-L	LKD	0.0	0.0	0.0	0.0%													
		W3-U																		
		W4-L		21.2	21.2	0.0	0.0%													
		W4-U																		
		W6-L		0.5	0.1	0.4	81.6%													
		W6-U						30.8	17.5	57%	15.1	49%	2.4	13.6%	39	4	39	4	0.0%	0.0%
Fourth	R3	W5-L	Bedroom	26.0	21.4	4.6	17.6%													
		W5-U						12.8	12.6	98%	11.9	93%	0.7	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W8-L	Bedroom	14.5	14.0	0.5	3.6%													
		W8-U						12.8	8.3	65%	9.5	74%	-1.1	-13.8%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W9-L	Bedroom	4.0	4.7	-0.7	-18.2%													
		W9-U						12.3	4.9	39%	6.7	54%	-1.9	-38.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W10-L	Bedroom	25.2	21.4	3.8	15.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W10-U						13.7	13.6	99%	13.6	99%	0.0	-0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W11-L	LKD	22.4	18.7	3.7	16.4%													
		W11-U																		
		W12-L		19.4	15.8	3.6	18.4%													
		W12-U						28.4	26.0	92%	24.1	85%	1.9	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W13-L	Bedroom	27.2	23.4	3.8	13.8%													
		W13-U						14.0	13.8	99%	13.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W14-L	LKD	22.6	19.2	3.4	14.9%													
		W14-U																		
		W15-L		18.6	15.8	2.8	15.2%													
		W15-U						28.4	25.5	90%	23.1	81%	2.4	9.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W16-L	Bedroom	11.6	9.1	2.5	21.8%													
		W16-U						9.7	8.3	85%	7.1	73%	1.2	14.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W17-L	Bedroom	12.1	9.8	2.3	18.6%													
		W17-U						35.6	24.5	69%	27.6	77%	-3.1	-12.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	12.5	12.5	0.0	0.0%													
		W1-U																		
		W2-L		32.1	28.3	3.9	12.0%													
		W2-U																		
		W3-L		27.5	23.6	3.9	14.3%													
		W3-U																		
		W4-L		23.4	19.3	4.1	17.4%													
		W4-U						35.2	30.1	86%	30.1	86%	0.0	0.0%	32	4	32	4	0.0%	0.0%
Fifth	R3	W6-L	Bedroom	32.6	28.7	3.9	11.8%													
		W6-U						11.5	11.4	99%	11.5	99%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W7-L	LKD	26.9	23.1	3.9	14.3%													
		W7-U																		
		W8-L		23.2	19.3	3.9	16.9%													
		W8-U						29.6	27.2	92%	25.4	86%	1.9	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W9-L	Bedroom	30.9	27.1	3.8	12.2%													
		W9-U						11.7	11.6	99%	11.6	99%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W10-L	LKD	25.8	22.4	3.4	13.3%													
		W10-U																		
		W11-L		21.8	18.7	3.1	14.3%													
		W11-U						29.6	26.8	91%	25.0	84%	1.9	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W12-L	LKD	14.0	11.8	2.2	15.5%													
		W12-U						46.5	39.2	84%	41.8	90%	-2.6	-6.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	13.1	13.1	0.0	0.0%													
		W1-U																		
		W2-L		34.1	30.1	4.0	11.6%													
		W2-U																		
		W3-L		22.4	19.5	2.8	12.6%													
		W3-U																		
		W4-L		23.9	19.7	4.2	17.6%													
		W4-U						35.2	29.7	85%	29.7	85%	0.0	0.0%	34	6	34	6	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R3	W6-L	Bedroom	34.9	30.9	4.0	11.5%												
		W6-U						11.5	11.5	99%	11.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W7-L	LKD	35.0	30.9	4.0	11.5%												
		W7-U																	
		W8-L		34.8	30.7	4.0	11.6%												
		W8-U						29.6	27.3	92%	25.5	86%	1.8	6.5%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W9-L	Bedroom	33.9	30.0	3.9	11.4%												
		W9-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W10-L	LKD	33.7	30.0	3.7	11.0%												
		W10-U																	
		W11-L		33.9	30.5	3.4	10.1%												
		W11-U						29.6	27.1	91%	25.1	85%	1.9	7.1%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W12-L	LKD	12.5	11.0	1.5	12.2%												
		W12-U						46.5	39.3	85%	41.0	88%	-1.8	-4.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1	LKD	14.0	14.0	0.0	0.0%												
		W2		34.0	29.9	4.0	11.8%												
		W3-L		23.2	20.4	2.8	12.1%												
		W3-U																	
		W4		24.8	20.5	4.3	17.3%	35.2	30.1	86%	30.1	86%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Seventh	R3	W6	Bedroom	35.7	31.5	4.2	11.8%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W7	Bedroom	35.6	31.3	4.3	12.1%	10.5	10.0	95%	9.8	93%	0.2	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8	LKD	25.6	21.2	4.4	17.2%												
		W9		26.3	21.8	4.5	17.0%												
		W10		29.9	33.0	-3.0	-10.2%	44.0	37.5	85%	39.3	89%	-1.8	-4.9%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W11	Bedroom	29.1	32.7	-3.5	-12.0%	13.3	13.1	98%	13.0	98%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W12-L	Bedroom	28.4	32.1	-3.6	-12.8%												
		W12-U						13.7	13.6	99%	13.5	99%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1	LKD	14.6	14.6	0.0	0.0%												
		W2		35.3	31.4	3.9	11.0%												
		W3-L		23.3	20.7	2.6	11.1%												
		W3-U																	
		W4		25.2	21.0	4.2	16.6%	35.2	29.7	85%	29.7	85%	0.0	0.0%	38	7	38	7	0.0%	0.0%
Eighth	R3	W6	Bedroom	36.2	32.1	4.1	11.4%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W7	Bedroom	36.1	31.8	4.3	11.9%	10.5	10.0	95%	9.8	93%	0.2	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W8-L	LKD	29.2	24.7	4.5	15.4%												
		W8-U																	
		W9		27.0	22.3	4.7	17.3%												
		W10		35.3	33.9	1.4	4.1%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W11	Bedroom	34.7	33.4	1.3	3.7%	12.4	12.2	99%	12.2	98%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W12-L	Bedroom	34.0	32.8	1.1	3.3%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W12-U						12.7	12.5	99%	12.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1	LKD	15.5	15.5	0.0	0.0%													
		W2		34.7	31.1	3.7	10.6%													
		W3-L		23.9	21.4	2.5	10.5%													
		W3-U																		
		W4		25.5	21.6	3.9	15.5%	35.2	30.1	86%	30.1	86%	0.0	0.0%	39	8	39	8	0.0%	0.0%
Ninth	R3	W6	Bedroom	36.5	32.6	3.9	10.7%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W7	Bedroom	36.4	32.4	4.0	11.1%	10.5	10.0	95%	9.8	93%	0.2	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W8-L	LKD	29.5	25.3	4.2	14.4%													
		W8-U																		
		W9		27.2	22.8	4.4	16.2%													
		W10		35.8	34.5	1.4	3.8%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W11	Bedroom	35.2	34.0	1.2	3.4%	12.4	12.2	99%	12.2	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W12-L	Bedroom	34.5	33.4	1.1	3.1%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1	LKD	16.1	16.1	0.0	0.0%													
		W2		36.0	32.6	3.4	9.5%													
		W3-L		23.9	21.7	2.3	9.4%													
		W3-U																		
		W4		25.8	22.1	3.7	14.3%	35.2	29.8	85%	29.8	85%	0.0	0.0%	41	8	41	8	0.0%	0.0%
Tenth	R3	W6	Bedroom	36.9	33.2	3.7	9.9%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W7	Bedroom	36.8	33.0	3.8	10.3%	10.5	10.0	95%	9.8	93%	0.2	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W8-L	LKD	29.8	25.8	4.0	13.4%													
		W8-U																		
		W9		27.5	23.3	4.1	15.1%													
		W10		36.3	35.0	1.3	3.5%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W11	Bedroom	35.7	34.6	1.1	3.1%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W12-L	Bedroom	34.9	34.0	1.0	2.8%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1	LKD	17.2	17.2	0.0	0.0%													
		W2		35.4	32.2	3.2	9.0%													
		W3-L		24.0	22.0	2.0	8.4%													
		W3-U																		
		W4		26.1	22.7	3.4	13.1%	35.2	30.1	86%	30.1	86%	0.0	0.0%	41	8	41	8	0.0%	0.0%
Eleventh	R3	W6	Bedroom	37.3	33.9	3.4	9.1%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W7	Bedroom	37.1	33.6	3.5	9.5%	10.5	10.0	95%	9.8	93%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W8-L	LKD	30.1	26.4	3.7	12.3%													
		W8-U																		
		W9		27.7	23.8	3.9	13.9%													
		W10		36.7	35.5	1.2	3.2%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eleventh	R6	W11	Bedroom	36.1	35.1	1.0	2.9%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W12-L	Bedroom	35.4	34.5	0.9	2.6%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1	LKD	18.0	18.0	0.0	0.0%													
		W2		37.0	34.1	2.9	7.8%													
		W3-L		23.4	21.8	1.6	6.7%													
		W3-U																		
		W4		26.4	23.2	3.1	11.8%	35.2	29.8	85%	29.8	85%	0.0	0.0%	43	8	43	8	0.0%	0.0%
Twelfth	R3	W6	Bedroom	37.9	34.7	3.1	8.2%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W7	Bedroom	37.5	34.3	3.2	8.6%	10.5	10.0	95%	9.9	94%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W8-L	LKD	30.6	27.1	3.4	11.2%													
		W8-U																		
		W9		27.9	24.3	3.6	12.8%													
		W10		37.1	36.0	1.1	2.9%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W11	Bedroom	36.5	35.5	1.0	2.6%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W12-L	Bedroom	35.8	35.0	0.8	2.3%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1	LKD	19.4	19.4	0.0	0.0%													
		W2		38.6	36.0	2.6	6.8%													
		W3-L		31.0	29.7	1.3	4.2%													
		W3-U																		
		W4		38.7	35.9	2.8	7.3%	35.2	30.1	86%	30.1	86%	0.0	0.0%	46	9	46	9	0.0%	0.0%
Thirteenth	R3	W6	Bedroom	38.3	35.5	2.8	7.4%	14.3	14.2	99%	14.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W7	Bedroom	38.2	35.2	3.0	7.7%	10.5	10.0	95%	10.0	95%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W8-L	LKD	30.8	27.7	3.1	10.2%													
		W8-U																		
		W9		28.1	24.8	3.3	11.6%													
		W10		37.4	36.4	1.0	2.6%	43.6	39.2	90%	39.2	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W11	Bedroom	36.9	36.0	0.9	2.4%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W12-L	Bedroom	36.2	35.4	0.8	2.1%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1	LKD	20.8	20.8	0.0	0.0%													
		W2		38.9	36.6	2.3	6.0%													
		W3		39.0	36.6	2.4	6.2%													
		W4		39.1	36.6	2.5	6.4%	35.2	30.2	86%	30.2	86%	0.0	0.0%	50	10	50	10	0.0%	0.0%
Fourteenth	R3	W6	Bedroom	38.7	36.2	2.6	6.6%	14.3	14.2	100%	14.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W7	Bedroom	38.9	36.3	2.6	6.8%	10.5	10.0	96%	10.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W8-L	LKD	39.0	36.2	2.8	7.2%													
		W8-U																		
		W9		39.1	36.2	2.9	7.5%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10		37.7	36.8	0.9	2.4%	43.6	39.3	90%	39.3	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W11	Bedroom	37.2	36.5	0.8	2.1%	12.4	12.2	99%	12.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W12-L	Bedroom	36.6	36.0	0.7	1.9%													
		W12-U						12.7	12.5	99%	12.5	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
WalterTull House																				
Second	R1	W1-L	LKD	27.8	27.8	0.0	0.0%													
		W1-U																		
		W2-L		7.3	6.2	1.2	15.8%													
		W2-U																		
		W3-L		25.4	23.4	2.0	8.0%													
		W3-U						34.4	32.2	94%	32.0	93%	0.2	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	29.3	29.3	0.0	0.0%													
		W1-U																		
		W2-L		7.6	6.4	1.2	15.5%													
		W2-U																		
		W3-L		26.0	24.0	2.0	7.6%													
		W3-U						34.4	32.7	95%	32.7	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R2	W4	LKD	22.0	22.0	0.0	0.0%													
		W5-L		34.4	32.2	2.1	6.2%													
		W5-U																		
		W6-L		34.2	31.8	2.3	6.8%													
		W6-U																		
		W7-L		1.7	1.7	0.0	0.0%													
		W7-U						29.5	26.8	91%	26.3	89%	0.5	1.9%	43	11	37	11	14.0%	0.0%
Third	R3	W8-L	Bedroom	5.9	4.0	1.9	31.6%													
		W8-U						11.9	10.9	92%	10.1	85%	0.8	7.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W9-L	Bedroom	34.0	31.4	2.6	7.5%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W10-L	Bedroom	33.9	31.3	2.6	7.7%													
		W10-U						13.5	13.2	98%	12.7	94%	0.5	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W11-L	LKD	7.0	5.2	1.8	25.5%													
		W11-U																		
		W12-L		35.5	35.4	0.2	0.5%													
		W12-U																		
		W13-L		36.5	36.2	0.2	0.6%													
		W13-U						33.6	30.8	91%	30.8	91%	0.0	0.0%	87	28	84	28	3.4%	0.0%
Fourth	R1	W1-L	LKD	31.6	31.6	0.0	0.0%													
		W1-U																		
		W2-L		7.8	6.6	1.2	15.8%													
		W2-U																		
		W3-L		26.3	24.4	2.0	7.4%													
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R2	W4	LKD	22.1	22.1	0.0	0.0%													
		W5-L		34.8	32.7	2.1	6.0%													
		W5-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-L		34.7	32.3	2.3	6.7%													
		W6-U																		
		W7-L		1.8	1.8	0.0	0.0%													
		W7-U						29.5	26.8	91%	26.4	90%	0.4	1.5%	44	11	38	11	13.6%	0.0%
Fourth	R3	W8-L	Bedroom	6.1	4.2	2.0	31.9%													
		W8-U						11.9	10.9	92%	10.3	87%	0.7	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W9-L	Bedroom	34.5	31.9	2.6	7.4%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W10-L	Bedroom	34.4	31.8	2.6	7.6%													
		W10-U						13.5	13.2	98%	12.7	95%	0.4	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W11-L	LKD	7.4	5.5	1.9	26.2%													
		W11-U																		
		W12-L		35.9	35.8	0.2	0.5%													
		W12-U																		
		W13-L		36.9	36.7	0.2	0.6%													
		W13-U						33.6	30.8	91%	30.8	91%	0.0	0.0%	89	28	86	28	3.4%	0.0%
Fifth	R1	W1-L	LKD	34.9	34.9	0.0	0.0%													
		W1-U																		
		W2-L		8.1	6.8	1.3	16.5%													
		W2-U																		
		W3-L		26.6	24.7	1.9	7.2%													
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R2	W4	LKD	22.1	22.1	0.0	0.0%													
		W5-L		35.3	33.2	2.1	5.8%													
		W5-U																		
		W6-L		35.1	32.8	2.3	6.5%													
		W6-U																		
		W7-L		1.9	1.9	0.0	0.0%													
		W7-U						29.5	26.8	91%	26.5	90%	0.3	1.1%	44	11	39	11	11.4%	0.0%
Fifth	R3	W8-L	Bedroom	6.4	4.3	2.1	32.2%													
		W8-U						11.9	10.9	92%	10.5	88%	0.4	3.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W9-L	Bedroom	35.0	32.4	2.5	7.3%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W10-L	Bedroom	34.9	32.3	2.6	7.5%													
		W10-U						13.5	13.2	98%	12.8	95%	0.3	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W11-L	LKD	7.7	5.6	2.1	26.8%													
		W11-U																		
		W12-L		36.1	35.9	0.2	0.5%													
		W12-U																		
		W13-L		37.1	36.9	0.2	0.6%													
		W13-U						33.6	30.8	91%	30.8	91%	0.0	0.0%	89	28	86	28	3.4%	0.0%
Sixth	R1	W1-L	LKD	38.1	38.1	0.0	0.0%													
		W1-U																		
		W2-L		8.3	6.9	1.4	16.8%													
		W2-U																		
		W3-L		26.9	25.0	1.9	7.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R2	W4	LKD	22.2	22.2	0.0	0.0%													
		W5-L		35.7	33.6	2.1	5.9%													
		W5-U																		
		W6-L		35.6	33.3	2.2	6.3%													
		W6-U																		
		W7-L		2.0	2.0	0.0	0.0%													
		W7-U						29.5	26.8	91%	26.7	91%	0.1	0.3%	45	11	40	11	11.1%	0.0%
Sixth	R3	W8-L	Bedroom	6.6	4.5	2.1	32.3%													
		W8-U						11.9	10.9	92%	10.6	90%	0.3	2.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W9-L	Bedroom	35.5	32.9	2.5	7.1%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W10-L	Bedroom	35.4	32.7	2.6	7.4%													
		W10-U						13.5	13.1	97%	12.8	95%	0.4	2.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W11-L	LKD	8.0	5.8	2.2	27.5%													
		W11-U																		
		W12-L		36.3	36.1	0.2	0.5%													
		W12-U																		
		W13-L		37.3	37.1	0.2	0.5%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	87	28	3.3%	0.0%
Seventh	R1	W1-L	LKD	38.4	38.4	0.0	0.0%													
		W1-U																		
		W2-L		8.5	7.1	1.5	17.1%													
		W2-U																		
		W3-L		27.2	25.3	1.8	6.8%													
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W4	LKD	22.2	22.2	0.0	0.0%													
		W5-L		36.1	34.1	2.1	5.7%													
		W5-U																		
		W6-L		36.0	33.8	2.2	6.1%													
		W6-U																		
		W7-L		2.1	2.1	0.0	0.0%													
		W7-U						29.5	27.0	91%	26.8	91%	0.1	0.4%	45	11	40	11	11.1%	0.0%
Seventh	R3	W8-L	Bedroom	6.9	4.7	2.2	31.9%													
		W8-U						11.9	10.9	92%	10.7	90%	0.2	1.8%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W9-L	Bedroom	35.9	33.4	2.5	6.9%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W10-L	Bedroom	35.8	33.2	2.6	7.3%													
		W10-U						13.5	13.1	97%	12.9	96%	0.2	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W11-L	LKD	8.4	6.0	2.3	27.9%													
		W11-U																		
		W12-L		36.5	36.3	0.2	0.5%													
		W12-U																		
		W13-L		37.5	37.3	0.2	0.5%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	87	28	3.3%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		8.7	7.2	1.5	17.5%													
		W2-U																		
		W3-L		27.5	25.7	1.8	6.5%													
		W3-U						34.4	32.9	96%	32.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W4	LKD	22.3	22.3	0.0	0.0%													
		W5-L		36.5	34.5	2.0	5.5%													
		W5-U																		
		W6-L		36.4	34.3	2.1	5.8%													
		W6-U																		
		W7-L		2.2	2.2	0.0	0.0%													
		W7-U						29.5	27.0	92%	26.9	91%	0.1	0.5%	46	12	43	12	6.5%	0.0%
Eighth	R3	W8-L	Bedroom	7.1	4.9	2.2	30.6%													
		W8-U						11.9	10.9	92%	10.8	91%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W9-L	Bedroom	36.4	33.9	2.4	6.7%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W10-L	Bedroom	36.3	33.7	2.6	7.1%													
		W10-U						13.5	13.1	97%	13.0	96%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W11-L	LKD	8.7	6.2	2.4	28.1%													
		W11-U																		
		W12-L		36.6	36.5	0.2	0.5%													
		W12-U																		
		W13-L		37.7	37.5	0.2	0.5%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Ninth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%													
		W1-U																		
		W2-L		8.9	7.4	1.5	17.1%													
		W2-U																		
		W3-L		27.7	26.0	1.7	6.1%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R2	W4	LKD	22.4	22.4	0.0	0.0%													
		W5-L		36.9	35.0	1.9	5.2%													
		W5-U																		
		W6-L		36.8	34.8	2.0	5.5%													
		W6-U																		
		W7-L		2.3	2.3	0.0	0.0%													
		W7-U						29.5	27.1	92%	27.0	91%	0.1	0.5%	46	12	43	12	6.5%	0.0%
Ninth	R3	W8-L	Bedroom	7.3	5.2	2.1	28.2%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W9-L	Bedroom	36.7	34.4	2.3	6.3%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W10-L	Bedroom	36.7	34.2	2.4	6.6%													
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W11-L	LKD	8.9	6.4	2.4	27.3%													
		W11-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W12-L		36.8	36.6	0.2	0.5%												
		W12-U																	
		W13-L		37.8	37.6	0.2	0.5%												
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Tenth	R1	W1-L	LKD	38.5	38.5	0.0	0.0%												
		W1-U																	
		W2-L		9.1	7.6	1.5	16.0%												
		W2-U																	
		W3-L		27.9	26.3	1.6	5.8%												
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R2	W4	LKD	22.4	22.4	0.0	0.0%												
		W5-L		37.2	35.4	1.8	4.9%												
		W5-U																	
		W6-L		37.2	35.2	1.9	5.2%												
		W6-U																	
		W7-L		2.4	2.4	0.0	0.0%												
		W7-U						29.5	27.1	92%	27.0	92%	0.1	0.5%	46	12	44	12	4.3%	0.0%
Tenth	R3	W8-L	Bedroom	7.4	5.5	2.0	26.3%												
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W9-L	Bedroom	37.1	34.9	2.2	5.9%												
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W10-L	Bedroom	37.0	34.7	2.3	6.2%												
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W11-L	LKD	9.1	6.8	2.3	25.5%												
		W11-U																	
		W12-L		37.0	36.8	0.2	0.4%												
		W12-U																	
		W13-L		38.0	37.8	0.2	0.4%												
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Eleventh	R1	W1-L	LKD	38.6	38.6	0.0	0.0%												
		W1-U																	
		W2-L		9.2	7.8	1.4	14.8%												
		W2-U																	
		W3-L		28.1	26.6	1.5	5.4%												
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R2	W4	LKD	22.5	22.5	0.0	0.0%												
		W5-L		37.6	35.9	1.7	4.5%												
		W5-U																	
		W6-L		37.5	35.7	1.8	4.8%												
		W6-U																	
		W7-L		2.5	2.5	0.0	0.0%												
		W7-U						29.5	27.2	92%	27.0	92%	0.1	0.5%	46	12	44	12	4.3%	0.0%
Eleventh	R3	W8-L	Bedroom	7.6	5.7	1.8	24.1%												
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W9-L	Bedroom	37.4	35.4	2.1	5.5%												
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eleventh	R5	W10-L	Bedroom	37.4	35.2	2.2	5.8%													
		W10-U						13.5	13.1	97%	13.0	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W11-L	LKD	9.2	7.1	2.2	23.6%													
		W11-U																		
		W12-L		37.1	37.0	0.1	0.4%													
		W12-U																		
		W13-L		38.1	38.0	0.2	0.4%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Twelfth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.3	8.1	1.3	13.5%													
		W2-U																		
		W3-L		28.2	26.8	1.4	5.0%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R2	W4	LKD	22.5	22.5	0.0	0.0%													
		W5-L		37.8	36.3	1.6	4.2%													
		W5-U																		
		W6-L		37.8	36.1	1.7	4.4%													
		W6-U																		
		W7-L		2.6	2.6	0.0	0.0%													
		W7-U						29.5	27.2	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
Twelfth	R3	W8-L	Bedroom	7.7	6.0	1.7	22.1%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W9-L	Bedroom	37.7	35.8	1.9	5.0%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W10-L	Bedroom	37.7	35.7	2.0	5.3%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W11-L	LKD	9.4	7.4	2.0	21.6%													
		W11-U																		
		W12-L		37.3	37.1	0.1	0.4%													
		W12-U																		
		W13-L		38.3	38.1	0.2	0.4%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Thirteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.4	8.2	1.2	12.3%													
		W2-U																		
		W3-L		28.3	27.0	1.3	4.6%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R2	W4	LKD	22.7	22.7	0.0	0.0%													
		W5-L		38.1	36.6	1.5	3.8%													
		W5-U																		
		W6-L		38.0	36.5	1.5	4.0%													
		W6-U																		
		W7-L		2.7	2.7	0.0	0.0%													
		W7-U						29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
Thirteenth	R3	W8-L	Bedroom	7.8	6.2	1.6	20.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W9-L	Bedroom	37.9	36.2	1.8	4.6%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W10-L	Bedroom	37.9	36.0	1.9	4.9%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W11-L	LKD	9.5	7.6	1.9	19.6%													
		W11-U																		
		W12-L		37.4	37.3	0.1	0.3%													
		W12-U																		
		W13-L		38.4	38.3	0.1	0.4%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Fourteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.5	8.4	1.1	11.2%													
		W2-U																		
		W3-L		28.4	27.2	1.2	4.1%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R2	W4	LKD	23.0	23.0	0.0	0.0%													
		W5-L		38.2	36.9	1.3	3.4%													
		W5-U																		
		W6-L		38.2	36.8	1.4	3.7%													
		W6-U																		
		W7-L		2.8	2.8	0.0	0.0%													
		W7-U						29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
Fourteenth	R3	W8-L	Bedroom	7.8	6.4	1.4	18.0%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W9-L	Bedroom	38.1	36.5	1.6	4.2%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W10-L	Bedroom	38.1	36.4	1.7	4.4%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W11-L	LKD	9.5	7.9	1.7	17.6%													
		W11-U																		
		W12-L		37.6	37.5	0.1	0.3%													
		W12-U																		
		W13-L		38.6	38.4	0.1	0.3%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Fifteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%													
		W1-U																		
		W2-L		9.5	8.6	0.9	10.0%													
		W2-U																		
		W3-L		28.8	27.8	1.1	3.6%													
		W3-U						34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R2	W4	LKD	24.5	24.5	0.0	0.0%													
		W5-L		38.4	37.2	1.2	3.1%													
		W5-U																		
		W6-L		38.4	37.1	1.3	3.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U																		
		W7-L		2.9	2.9	0.0	0.0%													
		W7-U						29.5	27.3	93%	27.1	92%	0.2	0.6%	46	12	46	12	0.0%	0.0%
Fifteenth	R3	W8-L	Bedroom	7.9	6.6	1.3	16.1%													
		W8-U						11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W9-L	Bedroom	38.3	36.9	1.4	3.7%													
		W9-U						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W10-L	Bedroom	38.3	36.8	1.5	3.9%													
		W10-U						13.5	13.1	97%	13.1	97%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R6	W11-L	LKD	9.6	8.1	1.5	15.7%													
		W11-U																		
		W12-L		37.7	37.6	0.1	0.3%													
		W12-U																		
		W13-L		38.7	38.6	0.1	0.3%													
		W13-U						33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
East Apartments																				
First	R2	W3-L	Bedroom	0.0	0.0	0.0	0.0%													
		W3-U																		
		W4		0.0	0.0	0.0	0.0%	12.2	0.2	2%	0.3	2%	-0.1	-36.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		10.0	10.3	-0.3	-2.8%													
		W6-U																		
		W7-L		10.6	10.9	-0.3	-2.6%													
		W7-U						32.0	14.0	44%	13.7	43%	0.3	2.2%	9	2	9	2	0.0%	0.0%
First	R4	W8-L	LKD	0.0	0.0	0.0	0.0%													
		W8-U																		
		W9		0.0	0.0	0.0	0.0%													
		W10-L		0.0	0.0	0.0	0.0%													
		W10-U																		
		W11-L		12.8	12.6	0.3	1.9%													
		W11-U						34.0	8.2	24%	8.3	24%	-0.1	-1.7%	6	1	6	1	0.0%	0.0%
First	R5	W12-L	Bedroom	14.6	13.7	0.9	6.0%													
		W12-U						12.2	5.5	45%	5.0	41%	0.5	9.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W13-L	LKD	16.7	15.1	1.7	9.9%													
		W13-U																		
		W14-L		18.9	16.3	2.6	13.5%													
		W14-U																		
		W15-L		19.3	18.8	0.5	2.8%													
		W15-U																		
		W16-L		18.7	18.3	0.4	2.2%													
		W16-U						44.4	36.3	82%	35.1	79%	1.2	3.4%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W17-L	Bedroom	24.0	23.6	0.4	1.6%													
		W17-U						9.3	8.4	90%	8.4	90%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W18-L	Bedroom	29.0	28.6	0.3	1.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W18-U						9.2	8.7	94%	8.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W19-L	Bedroom	30.2	29.9	0.3	0.9%													
		W19-U																		
		W20-L		23.3	23.3	0.0	0.0%													
		W20-U						17.9	17.9	100%	17.9	100%	0.0	0.0%	22	0	23	0	-4.5%	0.0%
Second	R1	W1-L	LKD	9.7	9.7	0.0	-0.1%													
		W1-U																		
		W2-L		9.8	10.1	-0.3	-3.1%													
		W2-U																		
		W3-L		10.7	11.1	-0.4	-3.5%													
		W3-U						38.7	10.5	27%	10.3	27%	0.2	2.0%	22	8	22	8	0.0%	0.0%
Second	R2	W4-L	Bedroom	0.0	0.0	0.0	0.0%													
		W4-U						12.2	0.0	0%	0.1	1%	-0.1	-2818.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		12.3	12.9	-0.6	-5.0%													
		W6-U																		
		W7-L		13.0	13.7	-0.7	-5.6%													
		W7-U						31.9	13.0	41%	12.9	40%	0.1	0.7%	9	2	9	2	0.0%	0.0%
Second	R4	W8-L	LKD	0.0	0.0	0.0	0.0%													
		W8-U																		
		W9-L		0.1	0.1	0.0	-57.1%													
		W9-U																		
		W10-L		15.5	15.8	-0.3	-1.9%													
		W10-U						34.0	10.9	32%	9.6	28%	1.3	12.0%	6	0	6	0	0.0%	0.0%
Second	R5	W11-L	Bedroom	17.5	17.3	0.3	1.4%													
		W11-U						12.2	8.1	67%	6.9	56%	1.2	15.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W12-L	LKD	19.8	18.7	1.1	5.5%													
		W12-U																		
		W13-L		22.1	20.1	2.0	9.0%													
		W13-U																		
		W14-L		15.6	15.0	0.5	3.4%													
		W14-U																		
		W15-L		20.4	20.0	0.4	1.9%													
		W15-U						44.5	33.9	76%	35.0	79%	-1.1	-3.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W16-L	Bedroom	29.5	29.2	0.3	1.0%													
		W16-U						9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W17-L	Bedroom	32.0	31.8	0.2	0.7%													
		W17-U						9.5	9.3	97%	9.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W18-L	Bedroom	32.7	32.5	0.1	0.5%													
		W18-U																		
		W19-L		24.0	24.0	0.0	0.0%													
		W19-U						18.0	16.7	93%	16.7	93%	0.0	0.0%	26	2	26	2	0.0%	0.0%
Third	R1	W1-L	LKD	10.6	10.6	0.0	0.1%													
		W1-U																		
		W2-L		11.3	11.5	-0.3	-2.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		12.4	12.6	-0.2	-1.9%													
		W3-U						38.7	14.1	37%	13.8	36%	0.4	2.8%	24	7	24	7	0.0%	0.0%
Third	R2	W4-L	Bedroom	0.2	0.2	0.1	28.6%													
		W4-U						12.2	1.7	14%	1.6	13%	0.0	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		14.6	15.3	-0.7	-4.5%													
		W6-U																		
		W7-L		15.4	16.3	-0.9	-6.0%													
		W7-U						32.0	15.0	47%	16.2	51%	-1.2	-7.9%	9	2	9	2	0.0%	0.0%
Third	R4	W8-L	LKD	0.0	0.2	-0.2	0.0%													
		W8-U																		
		W9-L		0.0	0.0	0.0	0.0%													
		W9-U																		
		W10-L		17.9	18.6	-0.8	-4.3%													
		W10-U						34.0	9.5	28%	11.8	35%	-2.3	-24.4%	7	1	7	1	0.0%	0.0%
Third	R5	W11-L	Bedroom	19.6	19.8	-0.2	-1.1%													
		W11-U						12.2	5.9	49%	6.4	53%	-0.5	-7.8%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W12-L	LKD	21.8	21.4	0.4	1.7%													
		W12-U																		
		W13-L		23.7	22.7	1.1	4.5%													
		W13-U																		
		W14-L		19.9	19.6	0.3	1.3%													
		W14-U																		
		W15-L		17.9	17.7	0.2	0.8%													
		W15-U						44.6	36.9	83%	36.4	82%	0.5	1.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W16-L	Bedroom	26.7	26.6	0.1	0.4%													
		W16-U						9.4	8.6	92%	8.6	92%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W17-L	Bedroom	32.9	32.8	0.1	0.2%													
		W17-U						12.1	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W18-L	Bedroom	33.4	33.4	0.0	0.1%													
		W18-U																		
		W19-L		25.9	25.9	0.0	0.0%													
		W19-U						14.3	14.3	100%	14.3	100%	0.0	0.0%	29	2	29	2	0.0%	0.0%
Fourth	R1	W1-L	LKD	11.3	11.3	0.0	0.3%													
		W1-U																		
		W2-L		13.3	13.4	-0.1	-0.7%													
		W2-U																		
		W3-L		14.9	14.7	0.2	1.4%													
		W3-U						38.7	18.4	47%	19.3	50%	-1.0	-5.2%	26	8	26	8	0.0%	0.0%
Fourth	R2	W4-L	Bedroom	1.6	1.2	0.4	23.8%													
		W4-U						12.2	6.3	52%	6.1	50%	0.2	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		17.6	17.9	-0.3	-1.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U																		
		W7-L		18.5	19.2	-0.8	-4.1%													
		W7-U						32.0	21.6	68%	24.2	76%	-2.5	-11.8%	11	2	11	2	0.0%	0.0%
Fourth	R4	W8-L	LKD	1.6	2.2	-0.5	-33.3%													
		W8-U																		
		W9-L		0.3	0.4	-0.1	-23.3%													
		W9-U																		
		W10-L		21.2	21.8	-0.6	-3.1%													
		W10-U						34.0	16.6	49%	21.0	62%	-4.4	-26.6%	11	1	11	1	0.0%	0.0%
Fourth	R5	W11-L	Bedroom	23.0	23.3	-0.2	-1.0%													
		W11-U						12.2	9.6	79%	11.6	95%	-2.0	-20.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W12-L	LKD	25.0	24.7	0.3	1.0%													
		W12-U																		
		W13-L		26.8	26.0	0.8	2.8%													
		W13-U																		
		W14-L		18.4	18.4	0.0	0.2%													
		W14-U																		
		W15-L		22.9	22.9	0.0	0.0%													
		W15-U						44.5	35.5	80%	35.6	80%	-0.2	-0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W16-L	Bedroom	32.4	32.4	0.0	0.0%													
		W16-U						9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W17-L	Bedroom	33.6	33.6	0.0	0.0%													
		W17-U						9.5	9.3	98%	9.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W18-L	Bedroom	33.2	33.2	0.0	0.0%													
		W18-U																		
		W19-L		26.4	26.4	0.0	0.0%													
		W19-U						18.0	16.7	93%	16.7	93%	0.0	0.0%	30	2	29	2	3.3%	0.0%
Fifth	R1	W1-L	LKD	12.4	12.4	0.0	0.2%													
		W1-U																		
		W2-L		15.1	15.0	0.1	0.7%													
		W2-U																		
		W3-L		17.0	16.2	0.8	4.5%													
		W3-U						38.7	28.1	72%	23.0	59%	5.0	18.0%	27	8	27	8	0.0%	0.0%
Fifth	R2	W4-L	Bedroom	2.3	1.1	1.2	53.1%													
		W4-U						12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		20.7	20.5	0.3	1.2%													
		W6-U																		
		W7-L		21.8	22.0	-0.2	-0.9%													
		W7-U						32.0	25.1	79%	25.1	79%	0.0	-0.1%	16	3	16	3	0.0%	0.0%
Fifth	R4	W8-L	LKD	2.7	2.1	0.6	22.5%													
		W8-U																		
		W9-L		0.0	0.0	0.0	0.0%													
		W9-U																		
		W10-L		24.6	25.0	-0.3	-1.4%													
		W10-U						34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R5	W11-L	Bedroom	26.2	26.3	-0.1	-0.3%													
		W11-U						12.2	11.5	94%	11.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W12-L	LKD	27.8	27.6	0.3	1.0%													
		W12-U																		
		W13-L		29.2	28.4	0.8	2.6%													
		W13-U																		
		W14-L		35.7	35.7	0.0	0.0%													
		W14-U																		
		W15-L		35.5	35.5	0.0	0.0%													
		W15-U						44.6	37.6	84%	37.9	85%	-0.2	-0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W16-L	Bedroom	35.1	35.1	0.0	0.0%													
		W16-U						9.4	8.6	92%	8.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W17-L	Bedroom	32.7	32.7	0.0	0.0%													
		W17-U						12.1	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W18-L	Bedroom	21.3	21.3	0.0	0.0%													
		W18-U																		
		W19-L		28.1	28.1	0.0	0.0%													
		W19-U						14.3	14.3	100%	14.3	100%	0.0	0.0%	38	3	37	3	2.6%	0.0%
Sixth	R1	W1-L	Bedroom	13.4	13.3	0.1	0.4%													
		W1-U																		
		W2-L		17.4	16.9	0.5	2.9%													
		W2-U						11.7	8.9	76%	8.0	69%	0.9	9.7%	30	10	30	10	0.0%	0.0%
Sixth	R2	W3-L	Bedroom	19.9	18.3	1.6	7.9%													
		W3-U						12.1	8.7	71%	8.4	69%	0.3	3.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W4-L	Bedroom	4.6	3.1	1.5	32.5%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		24.0	22.8	1.2	5.0%													
		W6-U																		
		W7-L		25.5	24.7	0.8	3.1%													
		W7-U						32.1	28.5	89%	28.5	89%	0.0	0.0%	20	3	19	3	5.0%	0.0%
Sixth	R5	W8-L	LKD	6.2	5.3	0.9	14.9%													
		W8-U																		
		W9-L		0.6	0.7	-0.1	-9.5%													
		W9-U																		
		W10-L		28.7	28.2	0.5	1.8%													
		W10-U																		
		W11-L		35.3	34.6	0.7	1.9%													
		W11-U						31.3	30.7	98%	30.7	98%	0.0	0.0%	23	1	22	1	4.3%	0.0%
Sixth	R6	W12-L	Bedroom	35.9	35.0	1.0	2.8%													
		W12-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W13-L	Bedroom	36.4	35.3	1.1	3.1%													
		W13-U						11.8	11.4	97%	11.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R8	W14-L	Bedroom	35.4	35.3	0.0	0.1%												
		W14-U																	
		W15-L		30.4	30.4	0.0	0.1%												
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W16-L	LKD	25.6	25.6	0.0	0.0%												
		W16-U																	
		W17-L		28.7	28.7	0.0	0.0%												
		W17-U																	
		W18-L		27.2	27.2	0.0	0.0%												
		W18-U						36.0	29.0	80%	29.0	80%	0.0	0.0%	38	3	37	3	2.6%	0.0%
Seventh	R1	W1-L	Bedroom	14.8	14.8	0.1	0.5%												
		W1-U																	
		W2-L		19.0	18.2	0.8	4.1%												
		W2-U						11.7	9.0	77%	8.7	74%	0.3	3.0%	29	9	29	9	0.0%	0.0%
Seventh	R2	W3-L	Bedroom	21.3	19.4	1.9	9.0%												
		W3-U						12.1	6.2	51%	5.2	43%	1.1	17.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W4-L	Bedroom	3.6	1.6	2.0	55.6%												
		W4-U						12.4	10.3	83%	10.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W5-L	LKD	0.0	0.0	0.0	0.0%												
		W5-U																	
		W6-L		26.3	24.2	2.1	7.9%												
		W6-U																	
		W7-L		28.0	25.9	2.1	7.3%												
		W7-U						32.1	26.0	81%	26.0	81%	0.1	0.3%	21	3	19	3	9.5%	0.0%
Seventh	R5	W8-L	LKD	5.2	3.3	1.9	35.8%												
		W8-U																	
		W9-L		0.0	0.0	0.0	0.0%												
		W9-U																	
		W10-L		31.3	29.3	2.1	6.5%												
		W10-U																	
		W11-L		37.1	35.4	1.7	4.6%												
		W11-U						31.3	30.7	98%	30.6	98%	0.1	0.2%	27	3	26	3	3.7%	0.0%
Seventh	R6	W12-L	Bedroom	37.4	35.9	1.5	4.1%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W13-L	Bedroom	37.6	36.1	1.4	3.8%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W14-L	Bedroom	37.7	36.3	1.3	3.6%												
		W14-U																	
		W15-L		34.2	34.2	0.0	0.1%												
		W15-U						14.9	14.9	100%	14.8	99%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R9	W16-L	LKD	22.5	22.5	0.0	0.1%												
		W16-U																	
		W17-L		30.6	30.6	0.0	0.0%												
		W17-U																	
		W18-L		29.3	29.3	0.0	0.0%												
		W18-U						36.0	30.2	84%	30.2	84%	0.0	0.0%	43	5	42	5	2.3%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R1	W1-L	Bedroom	16.1	16.0	0.1	0.5%													
		W1-U																		
		W2-L		20.7	19.8	0.8	4.1%													
		W2-U						11.7	8.9	76%	8.2	70%	0.7	8.3%	31	10	31	10	0.0%	0.0%
Eighth	R2	W3-L	Bedroom	23.1	21.2	2.0	8.6%													
		W3-U						12.1	9.0	74%	8.7	72%	0.2	2.5%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W4-L	Bedroom	5.6	3.7	1.9	33.8%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W5-L	LKD	0.0	0.0	0.0	0.0%													
		W5-U																		
		W6-L		27.6	25.6	2.0	7.3%													
		W6-U																		
		W7-L		29.3	27.3	1.9	6.6%													
		W7-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	23	3	21	3	8.7%	0.0%
Eighth	R5	W8-L	LKD	7.8	6.0	1.8	23.5%													
		W8-U																		
		W9-L		0.9	0.9	0.0	0.0%													
		W9-U																		
		W10-L		32.6	30.7	1.9	5.9%													
		W10-U																		
		W11-L		37.7	36.2	1.6	4.1%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	29	3	28	3	3.4%	0.0%
Eighth	R6	W12-L	Bedroom	37.9	36.5	1.5	3.8%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W13-L	Bedroom	38.1	36.8	1.3	3.4%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R8	W14-L	Bedroom	36.7	36.6	0.0	0.1%													
		W14-U																		
		W15-L		31.7	31.6	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R9	W16-L	LKD	26.8	26.8	0.0	0.1%													
		W16-U																		
		W17-L		31.5	31.5	0.0	0.0%													
		W17-U																		
		W18-L		30.2	30.2	0.0	0.0%													
		W18-U						36.0	29.0	81%	29.0	81%	0.0	0.0%	44	4	43	4	2.3%	0.0%
Ninth	R1	W1-L	Bedroom	18.0	17.9	0.1	0.4%													
		W1-U																		
		W2-L		22.1	21.5	0.7	3.1%													
		W2-U						11.7	9.3	80%	9.3	80%	0.0	0.0%	33	9	33	9	0.0%	0.0%
Ninth	R2	W3-L	Bedroom	24.2	22.5	1.7	6.9%													
		W3-U						12.1	7.0	58%	6.3	52%	0.7	10.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W4-L	Bedroom	3.7	1.9	1.8	47.4%													
		W4-U						12.4	10.3	83%	10.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W5-L	LKD	0.1	0.1	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W5-U																	
		W6-L		28.7	26.9	1.8	6.4%												
		W6-U																	
		W7-L		30.3	28.5	1.8	6.0%												
		W7-U						32.1	26.7	83%	26.6	83%	0.1	0.3%	26	3	24	3	7.7%	0.0%
Ninth	R5	W8-L	LKD	5.4	3.8	1.6	30.2%												
		W8-U																	
		W9-L		0.1	0.1	0.0	0.0%												
		W9-U																	
		W10-L		33.3	31.5	1.8	5.4%												
		W10-U																	
		W11-L		38.2	36.6	1.5	4.0%												
		W11-U						31.3	30.7	98%	30.7	98%	0.1	0.2%	30	3	29	3	3.3%	0.0%
Ninth	R6	W12-L	Bedroom	38.4	37.0	1.4	3.6%												
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W13-L	Bedroom	38.5	37.3	1.3	3.3%												
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W14-L	Bedroom	38.6	37.4	1.2	3.1%												
		W14-U																	
		W15-L		35.3	35.3	0.0	0.1%												
		W15-U						14.9	14.9	100%	14.8	99%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W16-L	LKD	23.6	23.6	0.0	0.1%												
		W16-U																	
		W17-L		33.6	33.6	0.0	0.0%												
		W17-U																	
		W18-L		32.5	32.5	0.0	0.0%												
		W18-U						36.0	30.2	84%	30.2	84%	0.0	0.0%	49	8	48	8	2.0%	0.0%
Tenth	R1	W1-L	Bedroom	19.7	19.7	0.1	0.3%												
		W1-U																	
		W2-L		24.5	23.8	0.7	3.0%												
		W2-U						11.7	9.0	77%	8.7	74%	0.3	3.3%	36	10	36	10	0.0%	0.0%
Tenth	R2	W3-L	Bedroom	26.6	24.9	1.7	6.4%												
		W3-U						12.1	9.6	79%	9.5	78%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W4-L	Bedroom	5.7	4.1	1.6	28.4%												
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W5-L	LKD	0.9	0.9	0.0	0.0%												
		W5-U																	
		W6-L		30.4	28.7	1.7	5.7%												
		W6-U																	
		W7-L		31.9	30.2	1.7	5.2%												
		W7-U						32.1	29.4	92%	29.4	92%	0.0	0.0%	29	3	27	3	6.9%	0.0%
Tenth	R5	W8-L	LKD	8.2	6.6	1.6	19.4%												
		W8-U																	
		W9-L		1.9	1.9	0.0	0.0%												
		W9-U																	
		W10-L		34.6	32.9	1.7	4.9%												
		W10-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W11-L		38.6	37.3	1.4	3.5%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	33	4	32	4	3.0%	0.0%
Tenth	R6	W12-L	Bedroom	38.8	37.5	1.3	3.3%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W13-L	Bedroom	38.9	37.8	1.2	3.0%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R8	W14-L	Bedroom	37.6	37.6	0.0	0.1%													
		W14-U																		
		W15-L		32.6	32.5	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R9	W16-L	LKD	27.7	27.7	0.0	0.1%													
		W16-U																		
		W17-L		34.7	34.7	0.0	0.0%													
		W17-U																		
		W18-L		33.7	33.7	0.0	0.0%													
		W18-U						36.0	29.3	81%	29.3	81%	0.0	0.0%	49	8	49	8	0.0%	0.0%
Eleventh	R1	W1-L	Bedroom	22.2	22.1	0.1	0.3%													
		W1-U																		
		W2-L		27.0	26.4	0.6	2.1%													
		W2-U						11.7	10.3	88%	10.3	88%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Eleventh	R2	W3-L	Bedroom	28.5	27.1	1.4	4.9%													
		W3-U						12.1	9.2	75%	8.9	74%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W4-L	Bedroom	4.4	2.9	1.5	34.2%													
		W4-U						12.4	10.8	87%	10.8	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W5-L	LKD	0.5	0.5	0.0	0.0%													
		W5-U																		
		W6-L		32.0	30.4	1.6	4.9%													
		W6-U																		
		W7-L		33.2	31.6	1.6	4.7%													
		W7-U						32.1	27.9	87%	27.9	87%	0.1	0.3%	31	4	29	4	6.5%	0.0%
Eleventh	R5	W8-L	LKD	6.2	4.8	1.4	22.7%													
		W8-U																		
		W9-L		0.8	0.8	0.0	0.0%													
		W9-U																		
		W10-L		35.4	33.8	1.6	4.4%													
		W10-U																		
		W11-L		38.9	37.6	1.3	3.4%													
		W11-U						31.3	30.7	98%	30.7	98%	0.1	0.2%	34	4	33	4	2.9%	0.0%
Eleventh	R6	W12-L	Bedroom	39.1	37.9	1.2	3.0%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W13-L	Bedroom	39.1	38.0	1.1	2.8%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R8	W14-L	Bedroom	39.2	38.2	1.0	2.7%													
		W14-U																		
		W15-L		36.0	36.0	0.0	0.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W15-U						14.9	14.9	100%	14.8	99%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R9	W16-L	LKD	24.3	24.3	0.0	0.1%													
		W16-U																		
		W17-L		36.5	36.5	0.0	0.0%													
		W17-U																		
		W18-L		35.9	35.9	0.0	0.0%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	56	14	56	14	0.0%	0.0%
Twelfth	R1	W1-L	Bedroom	24.6	24.6	0.1	0.2%													
		W1-U																		
		W2-L		30.2	29.6	0.6	2.0%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Twelfth	R2	W3-L	Bedroom	31.5	30.1	1.4	4.5%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W4-L	Bedroom	7.1	5.8	1.3	18.9%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W5-L	LKD	2.6	2.6	0.0	0.0%													
		W5-U																		
		W6-L		34.0	32.5	1.5	4.3%													
		W6-U																		
		W7-L		34.9	33.5	1.4	4.0%													
		W7-U						32.1	29.8	93%	29.8	93%	0.0	0.0%	33	4	31	4	6.1%	0.0%
Twelfth	R5	W8-L	LKD	9.0	7.7	1.4	15.0%													
		W8-U																		
		W9-L		3.4	3.4	0.0	0.0%													
		W9-U																		
		W10-L		36.6	35.2	1.4	3.9%													
		W10-U																		
		W11-L		39.2	38.0	1.2	3.0%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	35	5	34	5	2.9%	0.0%
Twelfth	R6	W12-L	Bedroom	39.2	38.1	1.1	2.8%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W13-L	Bedroom	39.3	38.3	1.0	2.5%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R8	W14-L	Bedroom	38.0	38.0	0.0	0.1%													
		W14-U																		
		W15-L		33.0	32.9	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R9	W16-L	LKD	28.1	28.0	0.0	0.1%													
		W16-U																		
		W17-L		37.8	37.8	0.0	0.0%													
		W17-U																		
		W18-L		37.4	37.4	0.0	0.0%													
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	56	14	56	14	0.0%	0.0%
Thirteenth	R1	W1-L	Bedroom	27.4	27.2	0.1	0.5%													
		W1-U																		
		W2-L		33.5	32.8	0.7	2.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	47	10	47	10	0.0%	0.0%
Thirteenth	R2	W3-L	Bedroom	34.2	33.0	1.2	3.4%													
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W4-L	Bedroom	7.6	6.4	1.2	15.9%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W5-L	LKD	1.1	1.1	0.0	0.0%													
		W5-U																		
		W6-L		35.9	34.6	1.3	3.6%													
		W6-U																		
		W7-L		36.5	35.2	1.3	3.5%													
		W7-U						32.1	30.8	96%	30.8	96%	0.0	0.0%	35	5	33	5	5.7%	0.0%
Thirteenth	R5	W8-L	LKD	7.9	6.7	1.2	14.8%													
		W8-U																		
		W9-L		1.6	1.6	0.0	0.0%													
		W9-U																		
		W10-L		37.5	36.2	1.3	3.5%													
		W10-U																		
		W11-L		39.3	38.2	1.1	2.8%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	36	6	35	6	2.8%	0.0%
Thirteenth	R6	W12-L	Bedroom	39.4	38.4	1.0	2.5%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W13-L	Bedroom	39.4	38.5	0.9	2.4%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R8	W14-L	Bedroom	39.5	38.6	0.9	2.2%													
		W14-U																		
		W15-L		36.3	36.3	0.0	0.1%													
		W15-U						14.9	14.9	100%	14.8	99%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R9	W16-L	LKD	24.4	24.4	0.0	0.1%													
		W16-U																		
		W17-L		39.1	39.1	0.0	0.0%													
		W17-U																		
		W18-L		39.0	39.0	0.0	0.0%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Fourteenth	R1	W1-L	Bedroom	29.9	29.6	0.3	1.0%													
		W1-U																		
		W2-L		36.6	35.6	1.0	2.7%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	52	13	51	13	1.9%	0.0%
Fourteenth	R2	W3-L	Bedroom	37.0	35.8	1.1	3.1%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W4-L	Bedroom	9.2	8.1	1.1	11.7%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W5-L	LKD	4.4	4.4	0.0	0.0%													
		W5-U																		
		W6-L		37.7	36.6	1.2	3.1%													
		W6-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W7-L		38.0	36.9	1.1	2.9%													
		W7-U						32.1	31.2	97%	31.2	97%	0.0	0.0%	37	7	35	7	5.4%	0.0%
Fourteenth	R5	W8-L	LKD	9.8	8.7	1.1	11.2%													
		W8-U																		
		W9-L		4.9	4.9	0.0	0.0%													
		W9-U																		
		W10-L		38.4	37.3	1.2	3.0%													
		W10-U																		
		W11-L		39.5	38.6	1.0	2.4%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Fourteenth	R6	W12-L	Bedroom	39.5	38.6	0.9	2.3%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W13-L	Bedroom	39.6	38.7	0.8	2.1%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R8	W14-L	Bedroom	38.2	38.2	0.0	0.1%													
		W14-U																		
		W15-L		33.1	33.1	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R9	W16-L	LKD	28.2	28.2	0.0	0.1%													
		W16-U																		
		W17-L		39.4	39.4	0.0	0.0%													
		W17-U																		
		W18-L		39.4	39.4	0.0	0.0%													
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Fifteenth	R1	W1-L	Bedroom	31.2	30.9	0.3	0.9%													
		W1-U																		
		W2-L		37.9	37.0	1.0	2.6%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	53	13	52	13	1.9%	0.0%
Fifteenth	R2	W3-L	Bedroom	38.1	37.1	1.0	2.6%													
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W4-L	Bedroom	9.7	8.7	0.9	9.7%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W5-L	LKD	1.8	1.8	0.0	0.0%													
		W5-U																		
		W6-L		38.5	37.5	1.0	2.6%													
		W6-U																		
		W7-L		38.6	37.6	1.0	2.6%													
		W7-U						32.1	30.9	96%	30.9	96%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Fifteenth	R5	W8-L	LKD	8.9	8.0	0.9	10.3%													
		W8-U																		
		W9-L		2.2	2.2	0.0	0.0%													
		W9-U																		
		W10-L		38.8	37.8	1.0	2.7%													
		W10-U																		
		W11-L		39.6	38.7	0.9	2.2%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	38	9	2.6%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifteenth	R6	W12-L	Bedroom	39.6	38.8	0.8	2.0%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W13-L	Bedroom	39.6	38.9	0.7	1.9%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R8	W14-L	Bedroom	39.6	38.9	0.7	1.8%													
		W14-U																		
		W15-L		36.4	36.3	0.0	0.1%													
		W15-U						14.9	14.9	100%	14.9	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R9	W16-L	LKD	24.5	24.5	0.0	0.0%													
		W16-U																		
		W17-L		39.4	39.4	0.0	0.0%													
		W17-U																		
		W18-L		39.4	39.4	0.0	0.0%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Sixteenth	R1	W1-L	Bedroom	31.8	31.6	0.3	0.8%													
		W1-U																		
		W2-L		38.3	37.4	0.9	2.2%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	55	14	54	14	1.8%	0.0%
Sixteenth	R2	W3-L	Bedroom	38.4	37.5	0.8	2.2%													
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W4-L	Bedroom	9.5	8.7	0.8	8.4%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R4	W5-L	LKD	5.0	5.0	0.0	0.0%													
		W5-U																		
		W6-L		38.7	37.8	0.9	2.2%													
		W6-U																		
		W7-L		38.8	37.9	0.9	2.2%													
		W7-U						32.1	31.2	97%	31.2	97%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Sixteenth	R5	W8-L	LKD	9.9	9.1	0.8	8.3%													
		W8-U																		
		W9-L		5.4	5.4	0.0	0.0%													
		W9-U																		
		W10-L		39.0	38.1	0.9	2.3%													
		W10-U																		
		W11-L		39.6	38.9	0.7	1.8%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Sixteenth	R6	W12-L	Bedroom	39.6	38.9	0.7	1.7%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W13-L	Bedroom	39.6	39.0	0.6	1.6%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R8	W14-L	Bedroom	38.4	38.4	0.0	0.1%													
		W14-U																		
		W15-L		33.2	33.2	0.0	0.1%													
		W15-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R9	W16-L	LKD	28.3	28.3	0.0	0.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W16-U																		
		W17-L		39.5	39.5	0.0	0.0%													
		W17-U																		
		W18-L		39.5	39.5	0.0	0.0%													
		W18-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Seventeenth	R1	W1-L	Bedroom	32.3	32.1	0.2	0.7%													
		W1-U																		
		W2-L		38.5	37.8	0.7	1.8%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	55	14	54	14	1.8%	0.0%
Seventeenth	R2	W3-L	Bedroom	38.6	37.9	0.7	1.8%													
		W3-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W4-L	Bedroom	9.7	9.0	0.7	6.9%													
		W4-U						12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R4	W5-L	LKD	2.3	2.3	0.0	0.0%													
		W5-U																		
		W6-L		38.9	38.1	0.7	1.8%													
		W6-U																		
		W7-L		38.9	38.2	0.7	1.8%													
		W7-U						32.1	31.0	97%	31.0	97%	0.0	0.0%	38	8	37	8	2.6%	0.0%
Seventeenth	R5	W8-L	LKD	8.9	8.3	0.7	7.3%													
		W8-U																		
		W9-L		2.6	2.6	0.0	0.0%													
		W9-U																		
		W10-L		39.1	38.4	0.7	1.8%													
		W10-U																		
		W11-L		39.6	39.0	0.6	1.6%													
		W11-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Seventeenth	R6	W12-L	Bedroom	39.6	39.0	0.6	1.4%													
		W12-U						13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R7	W13-L	Bedroom	39.6	39.1	0.5	1.3%													
		W13-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R8	W14-L	Bedroom	39.6	39.1	0.5	1.3%													
		W14-U																		
		W15-L		37.2	37.2	0.0	0.0%													
		W15-U						14.9	14.9	100%	14.9	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R9	W16-L	LKD	24.5	24.5	0.0	0.1%													
		W16-U																		
		W17-L		39.5	39.5	0.0	0.0%													
		W17-U																		
		W18-L		39.5	39.5	0.0	0.0%													
		W18-U						36.0	30.3	84%	30.3	84%	0.0	0.0%	57	15	57	15	0.0%	0.0%
Eighteenth	R1	W1-L	Bedroom	33.0	32.9	0.2	0.5%													
		W1-U																		
		W2-L		38.8	38.3	0.6	1.4%													
		W2-U						11.7	11.6	99%	11.6	99%	0.0	0.0%	56	15	56	15	0.0%	0.0%
Eighteenth	R2	W3-L	Bedroom	38.9	38.3	0.6	1.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R3	W4-L	Bedroom	13.0	12.4	0.5	4.2%													
		W4-U																		
		W5		2.0	1.6	0.5	23.2%	12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R4	W6-L	LKD	6.4	6.4	0.0	0.0%													
		W6-U																		
		W7-L		39.1	38.5	0.6	1.5%													
		W7-U																		
		W8-L		39.1	38.6	0.5	1.4%													
		W8-U						32.1	31.1	97%	31.1	97%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Eighteenth	R5	W9-L	LKD	13.5	13.0	0.5	4.0%													
		W9-U																		
		W10		2.1	1.6	0.5	22.6%													
		W11-L		6.7	6.7	0.0	0.0%													
		W11-U																		
		W12-L		39.2	38.7	0.6	1.5%													
		W12-U																		
		W13-L		39.6	39.1	0.5	1.2%													
		W13-U						31.3	30.8	98%	30.8	98%	0.0	0.0%	40	10	40	10	0.0%	0.0%
Eighteenth	R6	W14-L	Bedroom	39.6	39.2	0.5	1.1%													
		W14-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W15-L	Bedroom	39.6	39.2	0.4	1.0%													
		W15-U						11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R8	W16-L	Bedroom	39.6	39.6	0.0	0.0%													
		W16-U																		
		W17-L		39.6	39.6	0.0	0.0%													
		W17-U						14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R9	W18-L	LKD	39.6	39.6	0.0	0.0%													
		W18-U																		
		W19-L		39.5	39.5	0.0	0.0%													
		W19-U																		
		W20-L		39.5	39.5	0.0	0.0%													
		W20-U						36.0	30.9	86%	30.9	86%	0.0	0.0%	58	15	58	15	0.0%	0.0%
Mezzanine	R1	W1-L	Residential	4.4	4.4	0.0	-0.2%													
		W1-U																		
		W2-L		4.9	5.2	-0.2	-4.5%													
		W2-U						37.9	35.7	94%	35.7	94%	0.0	0.0%	11	4	11	4	0.0%	0.0%
Millstream Tower																				
First	R1	W1-L	LKD	24.2	20.5	3.7	15.3%													
		W1-U																		
		W2-L		8.4	8.4	0.0	0.0%													
		W2-U						33.5	20.5	61%	19.3	57%	1.3	6.3%	7	0	7	0	0.0%	0.0%
First	R2	W3-L	Bedroom	19.0	15.7	3.4	17.6%													
		W3-U						14.8	11.0	74%	10.9	74%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W4-L	LKD	22.2	19.2	3.0	13.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W4-U																		
		W5-L		7.9	7.9	0.0	0.0%													
		W5-U						28.8	13.5	47%	13.1	45%	0.5	3.5%	7	0	7	0	0.0%	0.0%
First	R4	W6-L	Bedroom	17.3	14.5	2.8	16.1%													
		W6-U						14.5	9.7	67%	9.7	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7-L	LKD	20.6	18.1	2.4	11.8%													
		W7-U																		
		W8-L		7.9	7.9	0.0	0.0%													
		W8-U						28.8	13.1	46%	13.1	46%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R6	W9-L	Bedroom	16.1	13.9	2.2	13.4%													
		W9-U						14.5	9.3	64%	9.3	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10-L	LKD	19.2	17.2	2.0	10.4%													
		W10-U																		
		W11-L		8.5	8.5	0.0	0.0%													
		W11-U						28.8	13.3	46%	13.3	46%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R8	W12-L	Bedroom	14.7	13.2	1.5	10.2%													
		W12-U						14.5	9.0	62%	9.0	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W13-L	LKD	17.4	15.8	1.6	9.4%													
		W13-U																		
		W14-L		8.9	8.9	0.0	0.0%													
		W14-U						28.9	14.9	51%	14.9	51%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R10	W15-L	Bedroom	13.0	12.0	1.1	8.3%													
		W15-U						14.5	8.2	57%	8.2	57%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W16-L	LKD	16.2	14.9	1.3	8.2%													
		W16-U																		
		W17-L		9.3	9.3	0.0	0.0%													
		W17-U						28.9	18.2	63%	18.2	63%	0.0	0.0%	6	0	6	0	0.0%	0.0%
First	R12	W18-L	Bedroom	15.1	14.4	0.7	4.9%													
		W18-U						14.5	13.1	90%	13.1	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W19-L	Bedroom	18.2	17.0	1.2	6.5%													
		W19-U						12.9	11.4	88%	11.4	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R14	W20-L	LKD	19.0	18.0	1.1	5.6%													
		W20-U																		
		W21-L		11.9	11.9	0.0	0.1%													
		W21-U																		
		W22-L		3.2	3.2	0.0	0.0%													
		W22-U																		
		W23-L		1.0	1.0	0.0	0.0%													
		W23-U						40.8	31.6	77%	31.0	76%	0.7	2.1%	19	7	19	7	0.0%	0.0%
Second	R1	W1-L	LKD	26.7	22.8	3.9	14.6%													
		W1-U																		
		W2-L		9.0	9.0	0.0	0.0%													
		W2-U						33.5	24.5	73%	24.5	73%	0.0	-0.1%	7	0	7	0	0.0%	0.0%
Second	R2	W3-L	Bedroom	21.4	17.9	3.5	16.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						14.8	13.4	91%	13.4	90%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W4-L	LKD	24.8	21.7	3.2	12.7%													
		W4-U																		
		W5-L		8.4	8.4	0.0	0.0%													
		W5-U						28.8	20.1	70%	20.2	70%	0.0	-0.2%	7	0	7	0	0.0%	0.0%
Second	R4	W6-L	Bedroom	19.7	16.7	3.0	15.1%													
		W6-U						14.5	12.3	85%	12.3	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7-L	LKD	23.0	20.3	2.7	11.6%													
		W7-U																		
		W8-L		8.2	8.2	0.0	0.0%													
		W8-U						28.8	19.5	68%	19.5	68%	0.0	-0.1%	8	0	8	0	0.0%	0.0%
Second	R6	W9-L	Bedroom	18.2	15.9	2.4	13.0%													
		W9-U						14.5	11.4	79%	11.4	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10-L	LKD	21.4	19.1	2.3	10.6%													
		W10-U																		
		W11-L		8.8	8.8	0.0	0.0%													
		W11-U						28.8	18.9	66%	18.9	66%	0.0	-0.1%	9	0	9	0	0.0%	0.0%
Second	R8	W12-L	Bedroom	16.6	14.9	1.7	10.3%													
		W12-U						14.5	10.6	73%	10.6	73%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W13-L	LKD	19.1	17.2	1.9	9.7%													
		W13-U																		
		W14-L		9.2	9.2	0.0	0.0%													
		W14-U						28.9	19.8	68%	19.8	68%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Second	R10	W15-L	Bedroom	14.4	13.1	1.2	8.6%													
		W15-U						14.5	8.7	60%	8.7	60%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W16-L	LKD	17.4	15.9	1.5	8.7%													
		W16-U																		
		W17-L		9.6	9.6	0.0	0.0%													
		W17-U						28.9	21.5	74%	21.5	74%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Second	R12	W18-L	Bedroom	16.2	15.3	0.9	5.3%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W19-L	Bedroom	19.3	18.0	1.3	6.9%													
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W20-L	LKD	20.0	18.8	1.2	6.0%													
		W20-U																		
		W21-L		12.4	12.4	0.0	0.0%													
		W21-U																		
		W22-L		3.3	3.3	0.0	0.0%													
		W22-U																		
		W23-L		1.0	1.0	0.0	0.0%													
		W23-U						40.8	31.7	78%	31.1	76%	0.7	2.1%	19	7	19	7	0.0%	0.0%
Third	R1	W1-L	LKD	28.8	25.0	3.8	13.3%													
		W1-U																		
		W2-L		9.6	9.7	0.0	-0.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U						33.5	28.9	86%	30.9	92%	-1.9	-6.7%	7	0	7	0	0.0%	0.0%
Third	R2	W3-L	Bedroom	23.4	20.0	3.5	14.8%													
		W3-U						14.8	13.5	91%	13.5	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W4-L	LKD	27.1	24.0	3.1	11.5%													
		W4-U																		
		W5-L		8.9	8.9	0.0	-0.2%													
		W5-U						28.8	25.2	87%	27.0	94%	-1.8	-7.2%	7	0	7	0	0.0%	0.0%
Third	R4	W6-L	Bedroom	21.7	18.8	2.9	13.4%													
		W6-U						14.5	12.4	85%	12.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7-L	LKD	25.1	22.5	2.6	10.4%													
		W7-U																		
		W8-L		8.6	8.6	0.0	0.0%													
		W8-U						28.8	23.0	80%	24.7	86%	-1.7	-7.3%	8	0	8	0	0.0%	0.0%
Third	R6	W9-L	Bedroom	20.0	17.8	2.3	11.3%													
		W9-U						14.5	11.5	79%	11.5	79%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10-L	LKD	23.2	21.0	2.2	9.4%													
		W10-U																		
		W11-L		9.1	9.1	0.0	0.0%													
		W11-U						28.8	21.4	74%	22.5	78%	-1.0	-4.8%	9	0	9	0	0.0%	0.0%
Third	R8	W12-L	Bedroom	18.0	16.5	1.6	8.8%													
		W12-U						14.5	10.6	73%	10.6	73%	0.0	-0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W13-L	LKD	20.5	18.7	1.8	8.9%													
		W13-U																		
		W14-L		9.5	9.5	0.0	0.0%													
		W14-U						28.9	22.5	78%	22.5	78%	-0.1	-0.3%	8	0	8	0	0.0%	0.0%
Third	R10	W15-L	Bedroom	15.5	14.3	1.2	7.9%													
		W15-U						14.5	8.8	61%	8.8	61%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R11	W16-L	LKD	18.6	17.0	1.6	8.6%													
		W16-U																		
		W17-L		10.0	10.0	0.0	0.0%													
		W17-U						28.9	24.2	84%	24.2	84%	0.0	-0.1%	6	0	6	0	0.0%	0.0%
Third	R12	W18-L	Bedroom	17.2	16.3	0.9	5.2%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R13	W19-L	Bedroom	20.3	18.9	1.4	6.8%													
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R14	W20-L	LKD	21.0	19.7	1.2	5.9%													
		W20-U																		
		W21-L		12.8	12.8	0.0	0.0%													
		W21-U																		
		W22-L		3.4	3.4	0.0	0.0%													
		W22-U																		
		W23-L		1.1	1.1	0.0	0.0%													
		W23-U						40.8	31.8	78%	31.2	76%	0.7	2.1%	19	7	19	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R1	W1-L	LKD	30.3	26.4	3.9	13.0%												
		W1-U																	
		W2-L		10.3	10.4	0.0	-0.4%												
		W2-U						33.5	31.3	93%	31.4	93%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourth	R2	W3-L	Bedroom	24.9	21.3	3.6	14.4%												
		W3-U						14.8	13.6	92%	13.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W4-L	LKD	28.7	25.4	3.2	11.3%												
		W4-U																	
		W5-L		9.5	9.5	0.0	-0.2%												
		W5-U						28.8	27.4	95%	27.5	95%	0.0	-0.1%	7	0	7	0	0.0%	0.0%
Fourth	R4	W6-L	Bedroom	23.1	20.1	3.0	12.9%												
		W6-U						14.5	12.4	86%	12.4	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7-L	LKD	26.5	23.9	2.7	10.1%												
		W7-U																	
		W8-L		9.1	9.1	0.0	-0.1%												
		W8-U						28.8	25.2	88%	25.4	88%	-0.2	-0.9%	9	0	9	0	0.0%	0.0%
Fourth	R6	W9-L	Bedroom	21.3	19.0	2.4	11.0%												
		W9-U						14.5	11.5	80%	11.6	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10-L	LKD	24.4	22.2	2.2	9.2%												
		W10-U																	
		W11-L		9.4	9.4	0.0	0.0%												
		W11-U						28.8	23.0	80%	23.2	80%	-0.2	-1.0%	10	0	10	0	0.0%	0.0%
Fourth	R8	W12-L	Bedroom	19.2	17.5	1.7	8.7%												
		W12-U						14.5	10.6	73%	10.6	73%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W13-L	LKD	21.6	19.7	1.9	8.7%												
		W13-U																	
		W14-L		9.8	9.8	0.0	0.0%												
		W14-U						28.9	22.9	79%	22.9	79%	0.0	-0.1%	8	0	8	0	0.0%	0.0%
Fourth	R10	W15-L	Bedroom	16.5	15.2	1.3	7.9%												
		W15-U						14.5	8.8	61%	8.8	61%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W16-L	LKD	19.6	17.9	1.6	8.3%												
		W16-U																	
		W17-L		10.3	10.3	0.0	0.0%												
		W17-U						28.9	25.0	87%	25.0	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Fourth	R12	W18-L	Bedroom	18.1	17.2	0.9	5.1%												
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R13	W19-L	Bedroom	21.2	19.8	1.4	6.6%												
		W19-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W20-L	LKD	21.9	20.7	1.3	5.7%												
		W20-U																	
		W21-L		13.3	13.3	0.0	0.0%												
		W21-U																	
		W22-L		3.5	3.5	0.0	0.0%												
		W22-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W23-L		1.1	1.1	0.0	0.0%													
		W23-U						40.8	31.9	78%	31.3	77%	0.6	1.9%	19	7	19	7	0.0%	0.0%
Fifth	R1	W1-L	LKD	31.6	27.5	4.1	12.9%													
		W1-U																		
		W2-L		11.1	11.1	0.0	-0.3%													
		W2-U						33.5	31.4	94%	31.4	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fifth	R2	W3-L	Bedroom	26.3	22.6	3.7	14.0%													
		W3-U						14.8	13.8	93%	13.8	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W4-L	LKD	29.9	26.6	3.3	11.2%													
		W4-U																		
		W5-L		10.0	10.1	0.0	-0.1%													
		W5-U						28.8	27.5	96%	27.6	96%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Fifth	R4	W6-L	Bedroom	24.5	21.4	3.1	12.7%													
		W6-U						14.5	12.5	86%	12.5	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7-L	LKD	27.8	25.0	2.8	10.0%													
		W7-U																		
		W8-L		9.5	9.5	0.0	0.0%													
		W8-U						28.8	25.7	89%	25.8	90%	0.0	-0.2%	9	0	9	0	0.0%	0.0%
Fifth	R6	W9-L	Bedroom	22.7	20.3	2.5	10.8%													
		W9-U						14.5	11.6	80%	11.6	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10-L	LKD	25.6	23.3	2.3	9.1%													
		W10-U																		
		W11-L		9.8	9.8	0.0	0.0%													
		W11-U						28.8	23.6	82%	23.7	82%	-0.1	-0.3%	10	0	10	0	0.0%	0.0%
Fifth	R8	W12-L	Bedroom	20.4	18.6	1.8	8.6%													
		W12-U						14.5	10.6	73%	10.6	73%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W13-L	LKD	22.6	20.6	2.0	8.8%													
		W13-U																		
		W14-L		10.2	10.2	0.0	0.0%													
		W14-U						28.9	23.0	80%	23.0	80%	0.0	-0.1%	9	0	9	0	0.0%	0.0%
Fifth	R10	W15-L	Bedroom	17.5	16.1	1.4	7.9%													
		W15-U						14.5	8.9	61%	8.9	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W16-L	LKD	20.6	18.9	1.7	8.1%													
		W16-U																		
		W17-L		10.6	10.6	0.0	0.0%													
		W17-U						28.9	25.2	87%	25.2	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Fifth	R12	W18-L	Bedroom	19.1	18.2	0.9	5.0%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W19-L	Bedroom	22.2	20.8	1.4	6.4%													
		W19-U						12.9	11.7	90%	11.7	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W20-L	LKD	22.9	21.7	1.3	5.5%													
		W20-U																		
		W21-L		13.8	13.8	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W21-U																		
		W22-L		3.6	3.6	0.0	0.0%													
		W22-U																		
		W23-L		1.1	1.1	0.0	0.0%													
		W23-U						40.8	32.0	78%	31.4	77%	0.6	1.8%	21	7	21	7	0.0%	0.0%
Sixth	R1	W1-L	LKD	32.7	28.5	4.2	12.9%													
		W1-U																		
		W2-L		12.0	12.0	0.0	-0.2%													
		W2-U						33.5	31.5	94%	31.5	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Sixth	R2	W3-L	Bedroom	29.3	25.5	3.8	13.0%													
		W3-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W4-L	LKD	31.2	27.7	3.5	11.1%													
		W4-U																		
		W5-L		10.7	10.7	0.0	-0.1%													
		W5-U						28.8	27.6	96%	27.6	96%	0.0	0.0%	8	0	8	0	0.0%	0.0%
Sixth	R4	W6-L	Bedroom	27.5	24.3	3.2	11.7%													
		W6-U						14.5	12.9	89%	12.9	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7-L	LKD	29.0	26.1	2.9	10.0%													
		W7-U																		
		W8-L		10.0	10.0	0.0	0.0%													
		W8-U						28.8	26.1	91%	26.1	91%	0.0	-0.1%	10	0	10	0	0.0%	0.0%
Sixth	R6	W9-L	Bedroom	25.6	23.1	2.6	10.0%													
		W9-U						14.5	11.8	82%	11.8	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10-L	LKD	26.8	24.3	2.5	9.2%													
		W10-U																		
		W11-L		10.2	10.2	0.0	0.0%													
		W11-U						28.8	24.4	85%	24.4	85%	0.0	-0.1%	11	0	11	0	0.0%	0.0%
Sixth	R8	W12-L	Bedroom	22.5	20.6	1.9	8.3%													
		W12-U						14.5	10.7	74%	10.7	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W13-L	LKD	23.7	21.6	2.0	8.5%													
		W13-U																		
		W14-L		10.5	10.5	0.0	0.0%													
		W14-U						28.9	23.0	80%	23.0	80%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Sixth	R10	W15-L	Bedroom	18.4	17.1	1.4	7.3%													
		W15-U						14.5	8.9	62%	8.9	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W16-L	LKD	21.6	20.0	1.6	7.6%													
		W16-U																		
		W17-L		10.9	10.9	0.0	0.0%													
		W17-U						28.9	25.2	87%	25.2	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Sixth	R12	W18-L	Bedroom	20.1	19.2	0.9	4.7%													
		W18-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W19-L	Bedroom	23.3	21.9	1.4	6.1%													
		W19-U						12.9	11.7	90%	11.7	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R14	W20-L	LKD	24.0	22.7	1.3	5.3%													
		W20-U																		
		W21-L		14.2	14.2	0.0	0.0%													
		W21-U																		
		W22-L		3.7	3.7	0.0	0.0%													
		W22-U																		
		W23-L		1.1	1.1	0.0	0.0%													
		W23-U						40.8	32.1	79%	31.5	77%	0.6	1.8%	21	7	21	7	0.0%	0.0%
Seventh	R1	W1-L	LKD	19.1	16.6	2.5	13.1%													
		W1-U																		
		W2-L		32.8	30.1	2.7	8.3%													
		W2-U																		
		W3-L		28.6	26.2	2.5	8.6%													
		W3-U						24.5	24.5	100%	24.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W4-L	Bedroom	25.7	23.5	2.2	8.7%													
		W4-U						14.6	10.8	74%	10.8	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W5-L	LKD	24.7	22.7	2.0	8.1%													
		W5-U																		
		W6-L		10.9	10.9	0.0	0.0%													
		W6-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Seventh	R4	W7-L	Bedroom	19.4	18.1	1.3	6.8%													
		W7-U						14.5	9.0	62%	9.0	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W8-L	LKD	22.7	21.1	1.6	7.1%													
		W8-U																		
		W9-L		11.2	11.2	0.0	0.0%													
		W9-U						28.7	25.0	87%	25.0	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Seventh	R6	W10-L	Bedroom	21.1	20.2	0.9	4.3%													
		W10-U						14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W11-L	Bedroom	24.3	22.9	1.4	5.7%													
		W11-U						12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R8	W12-L	LKD	25.0	23.8	1.2	5.0%													
		W12-U																		
		W13-L		14.6	14.6	0.0	0.0%													
		W13-U																		
		W14-L		4.1	4.1	0.0	0.0%													
		W14-U																		
		W15-L		1.1	1.1	0.0	0.0%													
		W15-U						40.8	32.3	79%	31.8	78%	0.5	1.7%	23	7	23	7	0.0%	0.0%
Eighth	R1	W1-L	LKD	34.2	31.7	2.5	7.2%													
		W1-U																		
		W2-L		22.3	19.8	2.5	11.3%													
		W2-U																		
		W3-L		33.2	30.5	2.6	8.0%													
		W3-U																		
		W4-L		29.7	27.3	2.4	8.0%													
		W4-U						27.6	27.2	99%	27.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W5-L	Bedroom	26.8	24.6	2.2	8.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U						14.3	10.6	74%	10.6	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W6-L	LKD	25.8	23.9	1.9	7.5%													
		W6-U																		
		W7-L		11.2	11.2	0.0	0.0%													
		W7-U						28.8	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighth	R4	W8-L	Bedroom	20.6	19.3	1.3	6.2%													
		W8-U						14.3	9.1	64%	9.1	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W9-L	LKD	23.9	22.3	1.6	6.5%													
		W9-U																		
		W10-L		11.5	11.5	0.0	0.0%													
		W10-U						31.0	26.7	86%	26.7	86%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Eighth	R6	W11-L	Bedroom	22.2	21.3	0.9	3.9%													
		W11-U						12.7	12.2	96%	12.2	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W12-L	Bedroom	25.3	23.9	1.3	5.3%													
		W12-U																		
		W13-L		14.6	14.6	0.0	0.0%													
		W13-U						17.4	16.1	92%	16.1	92%	0.0	0.0%	23	3	23	3	0.0%	0.0%
Ninth	R1	W1-L	LKD	34.9	32.6	2.3	6.6%													
		W1-U																		
		W2-L		22.6	20.2	2.4	10.5%													
		W2-U																		
		W3-L		33.6	31.1	2.5	7.3%													
		W3-U																		
		W4-L		30.8	28.6	2.3	7.3%													
		W4-U						29.2	28.9	99%	28.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R2	W5-L	Bedroom	27.9	25.9	2.0	7.2%													
		W5-U						14.8	11.1	75%	11.1	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W6-L	LKD	27.1	25.3	1.8	6.7%													
		W6-U																		
		W7-L		11.6	11.6	0.0	0.0%													
		W7-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Ninth	R4	W8-L	Bedroom	21.9	20.7	1.2	5.5%													
		W8-U						14.5	9.2	64%	9.2	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W9-L	LKD	25.2	23.8	1.4	5.7%													
		W9-U																		
		W10-L		11.8	11.8	0.0	0.0%													
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.2%	6	0	6	0	0.0%	0.0%
Ninth	R6	W11-L	Bedroom	23.5	22.6	0.8	3.5%													
		W11-U						12.1	11.2	92%	11.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W12-L	Bedroom	26.5	25.2	1.2	4.7%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	10.6	74%	10.6	74%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Tenth	R1	W1-L	LKD	35.6	33.5	2.1	6.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W1-U																	
		W2-L		22.8	20.6	2.2	9.6%												
		W2-U																	
		W3-L		34.1	31.8	2.3	6.7%												
		W3-U																	
		W4-L		32.1	30.0	2.1	6.5%												
		W4-U						29.2	28.9	99%	28.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R2	W5-L	Bedroom	29.3	27.4	1.9	6.4%												
		W5-U						14.8	11.4	76%	11.4	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W6-L	LKD	28.6	26.9	1.7	5.8%												
		W6-U																	
		W7-L		12.0	12.0	0.0	0.0%												
		W7-U						28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Tenth	R4	W8-L	Bedroom	23.4	22.3	1.1	4.8%												
		W8-U						14.5	9.5	65%	9.5	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W9-L	LKD	26.8	25.4	1.3	5.0%												
		W9-U																	
		W10-L		12.1	12.1	0.0	0.0%												
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.1%	6	0	6	0	0.0%	0.0%
Tenth	R6	W11-L	Bedroom	24.9	24.1	0.8	3.0%												
		W11-U						12.1	11.2	92%	11.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W12-L	Bedroom	27.8	26.7	1.2	4.2%												
		W12-U																	
		W13-L		0.0	0.0	0.0	0.0%												
		W13-U						14.2	10.6	75%	10.6	75%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Eleventh	R1	W1-L	LKD	36.4	34.4	2.0	5.4%												
		W1-U																	
		W2-L		23.0	21.0	2.0	8.8%												
		W2-U																	
		W3-L		34.5	32.4	2.1	6.1%												
		W3-U																	
		W4-L		33.4	31.5	1.9	5.8%												
		W4-U						29.2	29.1	100%	29.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R2	W5-L	Bedroom	30.8	29.0	1.7	5.6%												
		W5-U						14.8	11.9	80%	11.9	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W6-L	LKD	30.3	28.7	1.5	5.1%												
		W6-U																	
		W7-L		12.5	12.5	0.0	0.0%												
		W7-U						28.7	22.8	79%	22.8	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eleventh	R4	W8-L	Bedroom	25.1	24.0	1.0	4.1%												
		W8-U						14.5	10.0	69%	10.0	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W9-L	LKD	28.6	27.4	1.2	4.3%												
		W9-U																	
		W10-L		12.4	12.4	0.0	0.0%												
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.1%	7	0	7	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eleventh	R6	W11-L	Bedroom	26.5	25.8	0.7	2.6%													
		W11-U						12.1	11.4	94%	11.4	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W12-L	Bedroom	29.4	28.3	1.1	3.6%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	10.9	77%	10.9	77%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Twelfth	R1	W1-L	LKD	37.2	35.4	1.8	4.8%													
		W1-U																		
		W2-L		23.2	21.4	1.9	8.0%													
		W2-U																		
		W3-L		35.0	33.0	1.9	5.5%													
		W3-U																		
		W4-L		34.7	33.0	1.8	5.0%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R2	W5-L	Bedroom	32.3	30.7	1.6	4.9%													
		W5-U						14.8	13.2	89%	13.2	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W6-L	LKD	32.2	30.8	1.4	4.4%													
		W6-U																		
		W7-L		12.9	12.9	0.0	0.0%													
		W7-U						28.7	22.8	79%	22.8	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Twelfth	R4	W8-L	Bedroom	27.0	26.0	0.9	3.5%													
		W8-U						14.5	11.9	82%	11.9	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W9-L	LKD	30.6	29.5	1.1	3.7%													
		W9-U																		
		W10-L		12.6	12.6	0.0	0.0%													
		W10-U						32.3	28.2	87%	28.2	87%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Twelfth	R6	W11-L	Bedroom	28.2	27.6	0.6	2.3%													
		W11-U						12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W12-L	Bedroom	31.0	30.1	1.0	3.1%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	11.8	83%	11.8	83%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Thirteenth	R1	W1-L	LKD	38.0	36.4	1.6	4.3%													
		W1-U																		
		W2-L		23.4	21.7	1.7	7.2%													
		W2-U																		
		W3-L		35.4	33.7	1.8	4.9%													
		W3-U																		
		W4-L		35.9	34.3	1.6	4.4%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R2	W5-L	Bedroom	33.7	32.3	1.4	4.2%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W6-L	LKD	34.1	32.8	1.3	3.7%													
		W6-U																		
		W7-L		13.3	13.3	0.0	0.0%													
		W7-U						28.7	23.8	83%	23.8	83%	0.0	0.0%	9	0	9	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Thirteenth	R4	W8-L	Bedroom	28.9	28.1	0.8	2.9%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W9-L	LKD	32.8	31.8	1.0	3.1%													
		W9-U																		
		W10-L		12.9	12.9	0.0	0.0%													
		W10-U						32.3	29.0	90%	29.0	90%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Thirteenth	R6	W11-L	Bedroom	30.0	29.5	0.6	1.9%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W12-L	Bedroom	32.7	31.9	0.9	2.7%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	90%	12.8	90%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fourteenth	R1	W1-L	LKD	38.7	37.3	1.5	3.7%													
		W1-U																		
		W2-L		23.5	22.0	1.5	6.4%													
		W2-U																		
		W3-L		35.8	34.3	1.6	4.4%													
		W3-U																		
		W4-L		36.9	35.5	1.4	3.8%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R2	W5-L	Bedroom	35.0	33.7	1.3	3.6%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W6-L	LKD	35.8	34.7	1.1	3.2%													
		W6-U																		
		W7-L		13.7	13.7	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fourteenth	R4	W8-L	Bedroom	30.7	29.9	0.8	2.4%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W9-L	LKD	34.9	34.0	0.9	2.6%													
		W9-U																		
		W10-L		13.1	13.1	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.8	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourteenth	R6	W11-L	Bedroom	31.8	31.3	0.5	1.6%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W12-L	Bedroom	34.4	33.6	0.8	2.3%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	90%	12.8	90%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fifteenth	R1	W1-L	LKD	39.3	38.1	1.3	3.2%													
		W1-U																		
		W2-L		23.6	22.3	1.3	5.6%													
		W2-U																		
		W3-L		36.2	34.8	1.4	3.8%													
		W3-U																		
		W4-L		37.8	36.6	1.2	3.3%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R2	W5-L	Bedroom	36.1	35.0	1.1	3.1%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W6-L	LKD	37.3	36.3	1.0	2.7%													
		W6-U																		
		W7-L		14.0	14.0	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifteenth	R4	W8-L	Bedroom	32.3	31.6	0.7	2.0%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W9-L	LKD	36.9	36.1	0.8	2.2%													
		W9-U																		
		W10-L		13.3	13.3	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fifteenth	R6	W11-L	Bedroom	33.4	32.9	0.5	1.3%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W12-L	Bedroom	35.9	35.2	0.7	1.9%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Sixteenth	R1	W1-L	LKD	39.6	38.5	1.1	2.8%													
		W1-U																		
		W2-L		23.6	22.5	1.1	4.8%													
		W2-U																		
		W3-L		36.4	35.2	1.2	3.2%													
		W3-U																		
		W4-L		38.2	37.2	1.1	2.8%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R2	W5-L	Bedroom	36.5	35.5	1.0	2.6%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W6-L	LKD	37.9	37.1	0.9	2.3%													
		W6-U																		
		W7-L		14.2	14.2	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Sixteenth	R4	W8-L	Bedroom	32.9	32.3	0.6	1.7%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W9-L	LKD	37.6	36.9	0.7	1.8%													
		W9-U																		
		W10-L		13.4	13.4	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Sixteenth	R6	W11-L	Bedroom	34.0	33.6	0.4	1.1%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W12-L	Bedroom	36.4	35.8	0.6	1.6%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Seventeenth	R1	W1-L	LKD	39.6	38.7	0.9	2.3%													
		W1-U																		
		W2-L		23.7	22.7	1.0	4.1%													
		W2-U																		
		W3-L		36.4	35.4	1.0	2.7%													
		W3-U																		
		W4-L		38.5	37.6	0.9	2.3%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R2	W5-L	Bedroom	36.8	36.0	0.8	2.2%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W6-L	LKD	38.2	37.5	0.7	1.9%													
		W6-U																		
		W7-L		14.6	14.6	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Seventeenth	R4	W8-L	Bedroom	33.2	32.7	0.5	1.4%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W9-L	LKD	37.9	37.3	0.6	1.5%													
		W9-U																		
		W10-L		13.6	13.6	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Seventeenth	R6	W11-L	Bedroom	34.3	34.0	0.3	1.0%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R7	W12-L	Bedroom	36.8	36.3	0.5	1.3%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Eighteenth	R1	W1-L	LKD	39.6	38.9	0.8	1.9%													
		W1-U																		
		W2-L		23.7	22.9	0.8	3.3%													
		W2-U																		
		W3-L		36.5	35.7	0.8	2.2%													
		W3-U																		
		W4-L		38.7	38.0	0.7	1.9%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R2	W5-L	Bedroom	37.1	36.5	0.7	1.8%													
		W5-U						14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R3	W6-L	LKD	38.5	37.9	0.6	1.5%													
		W6-U																		
		W7-L		14.9	14.9	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighteenth	R4	W8-L	Bedroom	33.7	33.3	0.4	1.2%													
		W8-U						14.5	14.0	96%	14.0	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R5	W9-L	LKD	38.1	37.7	0.5	1.2%													
		W9-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W10-L		13.8	13.8	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Eighteenth	R6	W11-L	Bedroom	34.7	34.4	0.3	0.8%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W12-L	Bedroom	37.2	36.7	0.4	1.1%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Nineteenth	R1	W1-L	LKD	39.6	39.0	0.6	1.5%													
		W1-U																		
		W2-L		23.7	23.1	0.6	2.6%													
		W2-U																		
		W3-L		37.5	36.8	0.6	1.7%													
		W3-U																		
		W4-L		38.9	38.4	0.6	1.5%													
		W4-U						29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R2	W5-L	Bedroom	38.0	37.5	0.5	1.4%													
		W5-U						14.8	14.5	98%	14.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R3	W6-L	LKD	38.8	38.3	0.5	1.2%													
		W6-U																		
		W7-L		15.2	15.2	0.0	0.0%													
		W7-U						28.7	28.4	99%	28.4	99%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Nineteenth	R4	W8-L	Bedroom	35.5	35.2	0.3	0.9%													
		W8-U						14.5	14.2	98%	14.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R5	W9-L	LKD	38.4	38.1	0.4	1.0%													
		W9-U																		
		W10-L		14.0	14.0	0.0	0.0%													
		W10-U						32.3	31.9	99%	31.9	99%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Nineteenth	R6	W11-L	Bedroom	35.9	35.7	0.2	0.6%													
		W11-U						12.1	12.0	99%	12.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Nineteenth	R7	W12-L	Bedroom	37.7	37.4	0.3	0.8%													
		W12-U																		
		W13-L		0.0	0.0	0.0	0.0%													
		W13-U						14.2	12.8	91%	12.8	91%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Twentieth	R1	W1-L	LKD	20.2	19.9	0.3	1.3%													
		W1-U																		
		W2-L		9.7	9.7	0.0	0.0%													
		W2-U																		
		W3-L		39.6	39.2	0.5	1.2%													
		W3-U																		
		W4-L		39.1	38.7	0.4	1.1%													
		W4-U						34.9	34.9	100%	34.9	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%
Twentieth	R2	W5-L	Bedroom	39.0	38.6	0.4	1.0%													
		W5-U						12.9	12.6	98%	12.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R3	W6-L	Bedroom	38.9	38.5	0.3	0.9%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U						12.9	12.7	99%	12.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R4	W7-L	Bedroom	38.8	38.5	0.3	0.8%													
		W7-U						14.6	13.7	94%	13.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R5	W8-L	Bedroom	38.6	38.3	0.3	0.7%													
		W8-U						13.5	12.9	96%	12.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W9-L	Bedroom	38.5	38.2	0.3	0.7%													
		W9-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R7	W10-L	LKD	38.1	37.9	0.2	0.6%													
		W10-U																		
		W11-L		5.9	5.9	0.0	0.0%													
		W11-U						27.4	25.1	92%	25.1	92%	0.0	0.0%	10	4	10	4	0.0%	0.0%
Twenty-First	R1	W1-L	LKD	20.2	20.0	0.2	0.9%													
		W1-U																		
		W2-L		9.7	9.7	0.0	0.0%													
		W2-U																		
		W3-L		39.6	39.3	0.3	0.8%													
		W3-U																		
		W4-L		39.1	38.8	0.3	0.7%													
		W4-U						34.9	34.9	100%	34.9	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%
Twenty-First	R2	W5-L	Bedroom	39.0	38.7	0.3	0.7%													
		W5-U						12.9	12.6	98%	12.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R3	W6-L	Bedroom	38.9	38.7	0.2	0.6%													
		W6-U						12.9	12.7	99%	12.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R4	W7-L	Bedroom	38.8	38.6	0.2	0.5%													
		W7-U						14.6	13.7	94%	13.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R5	W8-L	Bedroom	38.6	38.4	0.2	0.5%													
		W8-U						13.5	12.9	96%	12.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W9-L	Bedroom	38.5	38.3	0.2	0.5%													
		W9-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R7	W10-L	LKD	38.2	38.0	0.1	0.4%													
		W10-U																		
		W11-L		6.1	6.1	0.0	0.0%													
		W11-U						27.4	25.1	92%	25.1	92%	0.0	0.0%	10	4	10	4	0.0%	0.0%
Sessile Apartments																				
Ground	R15	W28-L	Bedroom	13.1	12.2	0.8	6.4%													
		W28-U						9.8	5.1	52%	4.8	49%	0.4	7.4%	29	4	27	2	6.9%	50.0%
Ground	R16	W29-L	LKD	11.0	8.7	2.3	20.8%													
		W29-U																		
		W30-L		36.5	35.9	0.6	1.7%													
		W30-U						41.4	31.8	77%	31.3	76%	0.5	1.6%	42	8	37	4	11.9%	50.0%
First	R1	W1-L	Bedroom	35.7	35.7	0.0	0.0%													
		W1-U						11.3	10.4	92%	10.4	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
First	R2	W2-L	LKD	35.4	35.4	0.0	0.0%													
		W2-U																		
		W3-L		15.5	15.5	0.0	0.0%													
		W3-U																		
		W4		26.8	26.8	0.0	0.0%	27.5	27.5	100%	27.5	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%
First	R3	W5-L	Bedroom	32.5	32.5	0.0	0.0%													
		W5-U						12.0	11.8	98%	11.8	98%	0.0	0.0%	43	8	43	8	0.0%	0.0%
First	R4	W6-L	Bedroom	32.1	32.1	0.0	0.0%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	40	6	40	6	0.0%	0.0%
First	R5	W7-L	Bedroom	27.8	27.8	0.0	0.0%													
		W7-U						11.3	10.5	94%	10.5	94%	0.0	0.0%	28	2	28	2	0.0%	0.0%
First	R6	W8-L	LKD	16.0	16.0	0.0	0.0%													
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	28	8	28	8	0.0%	0.0%
First	R7	W9-L	Bedroom	29.7	29.7	0.0	0.0%													
		W9-U						16.9	15.9	94%	15.9	94%	0.0	0.0%	40	5	40	5	0.0%	0.0%
First	R8	W10-L	LKD	15.2	15.2	0.0	0.0%													
		W10-U						23.1	20.3	88%	20.3	88%	0.0	0.0%	23	6	23	6	0.0%	0.0%
First	R9	W11-L	Bedroom	27.9	27.9	0.0	0.0%													
		W11-U						12.7	9.8	77%	9.8	77%	0.0	0.0%	40	6	40	6	0.0%	0.0%
First	R10	W12-L	Bedroom	24.3	24.3	0.0	0.0%													
		W12-U						7.8	6.2	80%	6.2	80%	0.0	0.0%	20	1	20	1	0.0%	0.0%
First	R11	W13-L	LKD	12.3	12.3	0.0	0.0%													
		W13-U																		
		W14-L		7.0	7.0	0.0	0.0%													
		W14-U																		
		W15-L		5.4	5.4	0.0	0.0%													
		W15-U																		
		W16-L		4.1	4.1	0.0	0.0%													
		W16-U						36.2	27.4	76%	27.4	76%	0.0	0.0%	36	7	36	7	0.0%	0.0%
First	R13	W23-L	Bedroom	1.8	1.8	0.0	0.0%													
		W23-U						19.1	4.1	22%	4.1	22%	0.0	0.0%	5	1	5	1	0.0%	0.0%
First	R14	W24-L	Bedroom	13.5	13.5	0.0	0.2%													
		W24-U						14.6	3.8	26%	3.5	24%	0.3	7.0%	28	2	28	2	0.0%	0.0%
First	R15	W25-L	LKD	13.7	13.7	0.0	0.0%													
		W25-U																		
		W26-L		3.0	2.9	0.1	2.7%													
		W26-U																		
		W27-L		5.0	5.0	0.0	0.2%													
		W27-U						48.9	33.4	68%	31.9	65%	1.5	4.5%	41	6	41	6	0.0%	0.0%
First	R16	W28-L	LKD	8.8	8.8	0.0	0.0%													
		W28-U																		
		W29-L		3.3	3.3	0.0	0.0%													
		W29-U						35.0	20.7	59%	20.7	59%	0.0	0.0%	30	3	30	3	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
First	R17	W30-L W30-U	Bedroom	9.5	9.5	0.0	0.0%	11.2	3.5	31%	3.5	31%	0.0	0.0%	23	2	23	2	0.0%	0.0%
First	R18	W31-L W31-U	LKD	2.9	2.9	0.0	0.0%	34.5	3.9	11%	3.9	11%	0.0	0.0%	11	1	11	1	0.0%	0.0%
First	R19	W32-L W32-U	Bedroom	10.0	9.9	0.1	0.8%	12.1	4.6	38%	4.6	38%	0.0	0.9%	25	2	25	2	0.0%	0.0%
First	R20	W33-L W33-U	LKD	4.4	4.1	0.3	6.2%	33.0	6.1	19%	5.9	18%	0.2	4.1%	17	2	17	2	0.0%	0.0%
First	R21	W34-L W34-U	Bedroom	15.0	14.3	0.8	5.2%	11.5	7.4	65%	7.1	62%	0.3	4.4%	35	6	33	4	5.7%	33.3%
First	R22	W35-L W35-U W36-L W36-U	LKD	18.1 37.9	15.8 37.3	2.3 0.6	12.9% 1.6%	36.4	27.7	76%	27.1	74%	0.6	2.2%	53	10	48	5	9.4%	50.0%
First	R23	W37-L W37-U	Bedroom	7.5	7.5	0.0	0.0%	73.9	14.0	19%	14.0	19%	0.0	0.0%	1	0	1	0	0.0%	0.0%
First	R24	W38-L W38-U	Bedroom	1.0	1.0	0.0	0.0%	17.0	11.7	69%	11.7	69%	0.0	0.0%	5	0	5	0	0.0%	0.0%
First	R25	W39-L W39-U	Bedroom	11.6	11.6	0.0	0.0%	12.9	12.6	97%	12.6	97%	0.0	0.0%	6	0	6	0	0.0%	0.0%
First	R26	W40-L W40-U	Bedroom	10.6	10.6	0.0	0.0%	12.0	6.6	55%	6.6	55%	0.0	0.0%	8	0	8	0	0.0%	0.0%
First	R27	W41-L W41-U	LKD	0.5	0.5	0.0	0.0%	27.9	7.4	26%	7.4	26%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R28	W42-L W42-U	LKD	0.3	0.3	0.0	0.0%	27.9	5.8	21%	5.8	21%	0.0	0.0%	1	0	1	0	0.0%	0.0%
First	R29	W43-L W43-U	Bedroom	10.0	10.0	0.0	0.0%	11.9	5.3	45%	5.3	45%	0.0	0.0%	11	0	11	0	0.0%	0.0%
First	R30	W44-L W44-U	Bedroom	10.7	10.7	0.0	0.0%	12.9	6.7	52%	6.7	52%	0.0	0.0%	15	0	15	0	0.0%	0.0%
First	R31	W45-L W45-U	Bedroom	0.2	0.2	0.0	0.0%	17.0	1.7	10%	1.7	10%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R32	W46-L W46-U	Residential	6.5	6.5	0.0	0.0%	76.4	4.4	6%	4.4	6%	0.0	0.0%	13	0	13	0	0.0%	0.0%
Second	R1	W1-L W1-U	Bedroom	31.3	31.3	0.0	0.0%	11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R2	W2-L W2-U W3-L	LKD	19.8 31.9	19.8 31.9	0.0 0.0	0.0% 0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U																		
		W4		32.6	32.6	0.0	0.0%	34.2	30.4	89%	30.4	89%	0.0	0.0%	50	12	50	12	0.0%	0.0%
Second	R3	W5-L	Bedroom	33.5	33.5	0.0	0.0%													
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	46	11	46	11	0.0%	0.0%
Second	R4	W6-L	Bedroom	32.9	32.9	0.0	0.0%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	43	9	43	9	0.0%	0.0%
Second	R5	W7-L	Bedroom	28.6	28.6	0.0	0.0%													
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.0%	31	6	31	6	0.0%	0.0%
Second	R6	W8-L	LKD	16.5	16.5	0.0	0.0%													
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	30	11	0.0%	0.0%
Second	R7	W9-L	Bedroom	30.5	30.5	0.0	0.0%													
		W9-U						16.9	16.1	95%	16.1	95%	0.0	0.0%	42	7	42	7	0.0%	0.0%
Second	R8	W10-L	LKD	15.8	15.8	0.0	0.0%													
		W10-U						25.0	20.8	83%	20.8	83%	0.0	0.0%	24	8	24	8	0.0%	0.0%
Second	R9	W11-L	Bedroom	28.7	28.7	0.0	0.0%													
		W11-U						12.7	10.2	80%	10.2	80%	0.0	0.0%	42	8	42	8	0.0%	0.0%
Second	R10	W12-L	Bedroom	25.1	25.1	0.0	0.0%													
		W12-U						7.8	6.5	83%	6.5	83%	0.0	0.0%	24	4	24	4	0.0%	0.0%
Second	R11	W13-L	LKD	13.0	13.0	0.0	0.0%													
		W13-U																		
		W14-L		6.1	6.1	0.0	0.0%													
		W14-U																		
		W15-L		4.6	4.6	0.0	0.0%													
		W15-U						36.4	27.1	74%	27.1	74%	0.0	0.0%	33	5	33	5	0.0%	0.0%
Second	R12	W16	LKD	8.8	8.8	0.0	0.0%													
		W17-L		10.9	10.9	0.0	0.0%													
		W17-U						43.0	34.9	81%	34.9	81%	0.0	0.0%	17	4	17	4	0.0%	0.0%
Second	R13	W18-L	Bedroom	24.8	24.8	0.0	0.0%													
		W18-U						12.1	9.2	76%	9.2	76%	0.0	0.0%	29	3	29	3	0.0%	0.0%
Second	R14	W19-L	LKD	11.8	11.8	0.0	0.0%													
		W19-U						28.4	18.9	67%	18.9	67%	0.0	0.0%	22	8	22	8	0.0%	0.0%
Second	R15	W20-L	Bedroom	26.1	26.1	0.0	0.0%													
		W20-U						13.1	10.9	83%	10.9	83%	0.0	0.0%	38	10	38	10	0.0%	0.0%
Second	R16	W21-L	LKD	25.4	25.4	0.0	0.0%													
		W21-U																		
		W22-L		4.3	4.3	0.0	0.0%													
		W22-U						43.2	30.4	70%	30.4	70%	0.0	0.0%	51	12	51	12	0.0%	0.0%
Second	R17	W23-L	Bedroom	18.3	18.3	0.0	0.0%													
		W23-U						13.6	3.3	24%	3.3	24%	0.0	0.0%	52	7	52	7	0.0%	0.0%
Second	R18	W24-L	Bedroom	18.0	18.0	0.0	0.0%													
		W24-U						11.8	4.1	35%	4.1	34%	0.0	0.8%	48	7	48	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Second	R19	W25-L W25-U	Bedroom	17.5	17.5	0.0	0.0%	7.7	2.4	32%	2.4	31%	0.0	1.5%	46	7	46	7	0.0%	0.0%
Second	R20	W26-L W26-U	LKD	2.0	1.9	0.0	1.5%	30.6	6.7	22%	6.7	22%	0.0	0.0%	7	2	7	2	0.0%	0.0%
Second	R21	W27-L W27-U	Bedroom	15.6	15.5	0.1	0.5%	8.0	3.3	42%	3.0	38%	0.3	9.4%	35	3	35	3	0.0%	0.0%
Second	R22	W28-L W28-U	Bedroom	15.8	15.8	0.0	0.1%	11.7	5.5	47%	5.5	47%	0.0	0.1%	38	4	38	4	0.0%	0.0%
Second	R23	W29-L W29-U W30-L W30-U	LKD	3.3 6.0	3.3 6.0	0.0 0.0	0.3% 0.0%	39.0	24.6	63%	24.3	62%	0.2	0.9%	24	7	24	7	0.0%	0.0%
Second	R24	W31-L W31-U W32-L W32-U	LKD	10.0 3.7	10.0 3.7	0.0 0.0	0.0% 0.0%	35.2	21.3	61%	21.3	61%	0.0	0.0%	31	3	31	3	0.0%	0.0%
Second	R25	W33-L W33-U	Bedroom	11.1	11.1	0.0	0.0%	11.2	4.2	37%	4.2	37%	0.0	0.0%	25	2	25	2	0.0%	0.0%
Second	R26	W34-L W34-U	LKD	3.3	3.3	0.0	0.0%	34.5	4.7	14%	4.7	14%	0.0	0.0%	12	1	12	1	0.0%	0.0%
Second	R27	W35-L W35-U	Bedroom	11.7	11.6	0.1	0.5%	12.1	5.3	44%	5.3	44%	0.0	0.3%	31	3	31	3	0.0%	0.0%
Second	R28	W36-L W36-U	LKD	4.8	4.5	0.2	5.0%	33.1	6.6	20%	6.6	20%	0.1	1.1%	19	3	18	2	5.3%	33.3%
Second	R29	W37-L W37-U	Bedroom	16.0	15.3	0.8	4.7%	11.5	7.6	66%	7.4	64%	0.2	3.1%	34	7	32	5	5.9%	28.6%
Second	R30	W38-L W38-U W39-L W39-U	LKD	7.6 38.3	5.4 37.7	2.2 0.6	29.2% 1.6%	37.4	28.7	77%	28.1	75%	0.7	2.3%	41	11	37	7	9.8%	36.4%
Second	R31	W40-L W40-U	Bedroom	8.5	8.5	0.0	0.0%	14.8	8.4	57%	8.4	57%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Second	R32	W41-L W41-U	LKD	1.4	1.4	0.0	0.0%	26.1	18.0	69%	18.0	69%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Second	R33	W42-L W42-U	Bedroom	13.3	13.3	0.0	0.0%	12.5	11.8	95%	11.8	95%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Second	R34	W43-L W43-U	Bedroom	12.1	12.1	0.0	0.0%	11.1	7.6	68%	7.6	68%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Second	R35	W44-L W44-U	LKD	0.7	0.7	0.0	0.0%	34.5	8.8	25%	8.8	25%	0.0	0.0%	1	0	1	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Second	R36	W45-L W45-U	LKD	0.5	0.5	0.0	0.0%	34.4	6.4	19%	6.4	19%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Second	R37	W46-L W46-U	Bedroom	11.3	11.3	0.0	0.0%	11.1	7.7	69%	7.7	69%	0.0	0.0%	13	0	13	0	0.0%	0.0%
Second	R38	W47-L W47-U	Bedroom	12.3	12.3	0.0	0.0%	12.5	8.0	64%	8.0	64%	0.0	0.0%	18	0	18	0	0.0%	0.0%
Second	R39	W48-L W48-U	LKD	0.5	0.5	0.0	0.0%	26.1	2.9	11%	2.9	11%	0.0	0.0%	2	2	2	2	0.0%	0.0%
Second	R40	W49-L W49-U	Bedroom	7.3	7.3	0.0	0.0%	14.8	5.8	39%	5.8	39%	0.0	0.0%	13	0	13	0	0.0%	0.0%
Third	R1	W1-L W1-U	Bedroom	36.4	36.4	0.0	0.0%	11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R2	W2-L W2-U W3-L W3-U W4	LKD	36.1 16.7 28.2	36.1 16.7 28.2	0.0 0.0 0.0	0.0% 0.0% 0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	50	12	50	12	0.0%	0.0%
Third	R3	W5-L W5-U	Bedroom	34.0	34.0	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	46	11	46	11	0.0%	0.0%
Third	R4	W6-L W6-U	Bedroom	33.6	33.6	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	44	10	44	10	0.0%	0.0%
Third	R5	W7-L W7-U	Bedroom	29.3	29.3	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	32	7	32	7	0.0%	0.0%
Third	R6	W8-L W8-U	LKD	17.1	17.1	0.0	0.0%	31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	30	11	0.0%	0.0%
Third	R7	W9-L W9-U	Bedroom	31.3	31.3	0.0	0.0%	16.9	16.2	96%	16.2	96%	0.0	0.0%	43	8	43	8	0.0%	0.0%
Third	R8	W10-L W10-U	LKD	16.4	16.4	0.0	0.0%	25.0	21.2	85%	21.2	85%	0.0	0.0%	25	9	25	9	0.0%	0.0%
Third	R9	W11-L W11-U	Bedroom	29.5	29.5	0.0	0.0%	12.7	10.6	83%	10.6	83%	0.0	0.0%	43	9	43	9	0.0%	0.0%
Third	R10	W12-L W12-U	Bedroom	25.9	25.9	0.0	0.0%	7.8	6.9	88%	6.9	88%	0.0	0.0%	25	4	25	4	0.0%	0.0%
Third	R11	W13-L W13-U W14-L W14-U W15-L W15-U	LKD	13.7 7.0 5.4	13.7 7.0 5.4	0.0 0.0 0.0	0.0% 0.0% 0.0%	36.4	27.2	75%	27.2	75%	0.0	0.0%	36	8	36	8	0.0%	0.0%
Third	R12	W16	LKD	9.5	9.5	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W17-L		12.3	12.3	0.0	0.0%												
		W17-U						43.0	35.2	82%	35.2	82%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Third	R13	W18-L	Bedroom	26.6	26.6	0.0	0.0%												
		W18-U						12.1	9.9	82%	9.9	82%	0.0	0.0%	33	4	33	4	0.0%	0.0%
Third	R14	W19-L	LKD	13.6	13.6	0.0	0.0%												
		W19-U						28.4	19.8	70%	19.8	70%	0.0	0.0%	25	10	25	10	0.0%	0.0%
Third	R15	W20-L	Bedroom	28.1	28.1	0.0	0.0%												
		W20-U						13.1	11.3	86%	11.3	86%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Third	R16	W21-L	LKD	11.0	11.0	0.0	0.0%												
		W21-U																		
		W22-L		19.2	19.2	0.0	0.0%												
		W22-U						43.2	30.4	70%	30.4	70%	0.0	0.0%	68	12	68	12	0.0%	0.0%
Third	R17	W23-L	Bedroom	20.3	20.3	0.0	0.0%												
		W23-U						13.6	4.2	31%	4.2	31%	0.1	1.4%	49	7	49	7	0.0%	0.0%
Third	R18	W24-L	Bedroom	20.1	20.1	0.0	0.2%												
		W24-U						11.8	4.5	38%	4.4	38%	0.1	1.5%	51	7	51	7	0.0%	0.0%
Third	R19	W25-L	Bedroom	19.7	19.6	0.1	0.4%												
		W25-U						7.7	2.9	37%	2.7	36%	0.1	4.3%	55	7	55	7	0.0%	0.0%
Third	R20	W26-L	LKD	2.4	2.2	0.2	7.8%												
		W26-U						30.6	7.3	24%	7.3	24%	0.0	0.6%	8	2	8	2	0.0%	0.0%
Third	R21	W27-L	Bedroom	18.0	17.8	0.2	1.0%												
		W27-U						8.0	4.3	54%	3.9	49%	0.4	10.3%	41	4	41	4	0.0%	0.0%
Third	R22	W28-L	Bedroom	18.2	18.1	0.1	0.4%												
		W28-U						11.7	6.1	52%	6.1	52%	0.0	0.0%	45	6	45	6	0.0%	0.0%
Third	R23	W29-L	LKD	3.9	3.9	0.0	0.0%												
		W29-U																		
		W30-L		7.4	7.4	0.0	0.0%												
		W30-U						39.0	25.6	65%	25.6	65%	0.0	0.0%	27	7	27	7	0.0%	0.0%
Third	R24	W31-L	LKD	11.5	11.5	0.0	0.0%												
		W31-U																		
		W32-L		4.2	4.2	0.0	0.0%												
		W32-U						35.2	22.0	63%	22.0	63%	0.0	0.0%	34	5	34	5	0.0%	0.0%
Third	R25	W33-L	Bedroom	13.0	13.0	0.0	0.0%												
		W33-U						11.2	5.1	46%	5.1	46%	0.0	0.0%	30	2	30	2	0.0%	0.0%
Third	R26	W34-L	LKD	3.8	3.8	0.0	0.0%												
		W34-U						34.5	5.4	16%	5.4	16%	0.0	0.0%	14	3	14	3	0.0%	0.0%
Third	R27	W35-L	Bedroom	13.6	13.6	0.1	0.4%												
		W35-U						12.1	6.1	50%	6.1	50%	0.0	0.1%	34	3	34	3	0.0%	0.0%
Third	R28	W36-L	LKD	5.3	5.0	0.2	4.4%												
		W36-U						33.1	7.5	23%	7.4	22%	0.0	0.7%	20	4	19	3	5.0%	25.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Third	R29	W37-L	Bedroom	18.2	17.5	0.7	3.9%													
		W37-U						11.5	7.9	69%	7.7	67%	0.2	2.9%	42	8	40	6	4.8%	25.0%
Third	R30	W38-L	LKD	21.4	19.0	2.3	10.9%													
		W38-U																		
		W39-L		38.6	38.0	0.6	1.6%													
		W39-U						37.4	29.0	78%	28.4	76%	0.6	2.1%	57	11	53	7	7.0%	36.4%
Third	R31	W40-L	Bedroom	9.5	9.5	0.0	0.0%													
		W40-U						14.8	9.5	64%	9.5	64%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Third	R32	W41-L	LKD	1.9	1.9	0.0	0.0%													
		W41-U						26.1	18.3	70%	18.3	70%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Third	R33	W42-L	Bedroom	15.2	15.2	0.0	0.0%													
		W42-U						12.5	12.1	97%	12.1	97%	0.0	0.0%	16	0	16	0	0.0%	0.0%
Third	R34	W43-L	Bedroom	13.6	13.6	0.0	0.0%													
		W43-U						11.1	8.3	75%	8.3	75%	0.0	0.0%	15	0	15	0	0.0%	0.0%
Third	R35	W44-L	LKD	1.1	1.1	0.0	0.0%													
		W44-U						34.5	10.1	29%	10.1	29%	0.0	0.0%	1	0	1	0	0.0%	0.0%
Third	R36	W45-L	LKD	0.9	0.9	0.0	0.0%													
		W45-U						34.4	7.9	23%	7.9	23%	0.0	0.0%	2	0	2	0	0.0%	0.0%
Third	R37	W46-L	Bedroom	12.8	12.8	0.0	0.0%													
		W46-U						11.1	9.1	82%	9.1	82%	0.0	0.0%	17	0	17	0	0.0%	0.0%
Third	R38	W47-L	Bedroom	14.2	14.2	0.0	0.0%													
		W47-U						12.5	8.9	72%	8.9	72%	0.0	0.0%	22	2	22	2	0.0%	0.0%
Third	R39	W48-L	LKD	1.0	1.0	0.0	0.0%													
		W48-U						26.1	4.2	16%	4.2	16%	0.0	0.0%	3	3	3	3	0.0%	0.0%
Third	R40	W49-L	Bedroom	8.1	8.1	0.0	0.0%													
		W49-U						14.8	6.9	47%	6.9	47%	0.0	0.0%	15	1	15	1	0.0%	0.0%
Fourth	R1	W1-L	Bedroom	31.7	31.7	0.0	0.0%													
		W1-U						11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R2	W2-L	LKD	20.4	20.4	0.0	0.0%													
		W2-U																		
		W3-L		33.3	33.3	0.0	0.0%													
		W3-U																		
		W4		33.9	33.9	0.0	0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	52	13	52	13	0.0%	0.0%
Fourth	R3	W5-L	Bedroom	34.8	34.8	0.0	0.0%													
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	47	12	47	12	0.0%	0.0%
Fourth	R4	W6-L	Bedroom	34.3	34.3	0.0	0.0%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	44	10	44	10	0.0%	0.0%
Fourth	R5	W7-L	Bedroom	29.9	29.9	0.0	0.0%													
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.0%	32	7	32	7	0.0%	0.0%
Fourth	R6	W8-L	LKD	17.8	17.8	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	30	11	0.0%	0.0%
Fourth	R7	W9-L	Bedroom	32.0	32.0	0.0	0.0%													
		W9-U						16.9	16.3	97%	16.3	97%	0.0	0.0%	43	8	43	8	0.0%	0.0%
Fourth	R8	W10-L	LKD	17.2	17.2	0.0	0.0%													
		W10-U						25.0	21.5	86%	21.5	86%	0.0	0.0%	25	9	25	9	0.0%	0.0%
Fourth	R9	W11-L	Bedroom	30.3	30.3	0.0	0.0%													
		W11-U						12.7	11.0	87%	11.0	87%	0.0	0.0%	43	9	43	9	0.0%	0.0%
Fourth	R10	W12-L	Bedroom	26.7	26.7	0.0	0.0%													
		W12-U						7.8	7.4	94%	7.4	94%	0.0	0.0%	26	5	26	5	0.0%	0.0%
Fourth	R11	W13-L	LKD	14.6	14.6	0.0	0.0%													
		W13-U																		
		W14-L		8.2	8.2	0.0	0.0%													
		W14-U																		
		W15-L		6.6	6.6	0.0	0.0%													
		W15-U						36.4	27.5	76%	27.5	76%	0.0	0.0%	39	9	39	9	0.0%	0.0%
Fourth	R12	W16	LKD	10.6	10.6	0.0	0.0%													
		W17-L		13.8	13.8	0.0	0.0%													
		W17-U						43.0	35.8	83%	35.8	83%	0.0	0.0%	22	8	22	8	0.0%	0.0%
Fourth	R13	W18-L	Bedroom	28.3	28.3	0.0	0.0%													
		W18-U						12.1	10.5	87%	10.5	87%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Fourth	R14	W19-L	LKD	15.4	15.4	0.0	0.0%													
		W19-U						28.4	20.9	74%	20.9	74%	0.0	0.0%	27	11	27	11	0.0%	0.0%
Fourth	R15	W20-L	Bedroom	29.7	29.7	0.0	0.0%													
		W20-U						13.1	11.8	90%	11.8	90%	0.0	0.0%	46	13	46	13	0.0%	0.0%
Fourth	R16	W21-L	LKD	28.7	28.7	0.0	0.0%													
		W21-U																		
		W22-L		5.6	5.6	0.0	0.0%													
		W22-U						43.2	30.5	71%	30.5	71%	0.0	0.0%	58	14	58	14	0.0%	0.0%
Fourth	R17	W23-L	Bedroom	22.8	22.8	0.0	0.2%													
		W23-U						13.6	5.7	42%	5.4	40%	0.3	5.9%	62	9	62	9	0.0%	0.0%
Fourth	R18	W24-L	Bedroom	22.7	22.6	0.1	0.4%													
		W24-U						11.8	5.2	44%	5.1	43%	0.1	2.4%	59	8	58	8	1.7%	0.0%
Fourth	R19	W25-L	Bedroom	22.2	22.0	0.2	0.9%													
		W25-U						7.7	3.4	44%	3.3	42%	0.1	4.0%	56	7	55	7	1.8%	0.0%
Fourth	R20	W26-L	LKD	3.7	3.3	0.4	11.5%													
		W26-U						30.6	9.8	32%	8.1	26%	1.7	17.1%	12	5	11	4	8.3%	20.0%
Fourth	R21	W27-L	Bedroom	20.8	20.4	0.3	1.7%													
		W27-U						8.0	5.7	72%	5.5	69%	0.2	3.0%	44	5	44	5	0.0%	0.0%
Fourth	R22	W28-L	Bedroom	20.9	20.7	0.2	1.0%													
		W28-U						11.7	7.1	61%	7.1	61%	0.0	0.0%	47	7	47	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R23	W29-L	LKD	4.8	4.8	0.0	0.6%													
		W29-U																		
		W30-L		9.3	9.3	0.0	0.1%													
		W30-U						39.0	26.3	67%	26.3	67%	0.0	0.0%	29	7	29	7	0.0%	0.0%
Fourth	R24	W31-L	LKD	13.4	13.4	0.0	0.0%													
		W31-U																		
		W32-L		5.3	5.3	0.0	0.0%													
		W32-U						35.2	23.1	66%	23.1	66%	0.0	0.0%	38	8	38	8	0.0%	0.0%
Fourth	R25	W33-L	Bedroom	15.4	15.4	0.0	0.0%													
		W33-U						11.2	6.6	59%	6.6	59%	0.0	0.0%	37	4	37	4	0.0%	0.0%
Fourth	R26	W34-L	LKD	4.6	4.6	0.0	0.0%													
		W34-U						34.5	6.6	19%	6.6	19%	0.0	0.0%	17	6	17	6	0.0%	0.0%
Fourth	R27	W35-L	Bedroom	16.0	16.0	0.1	0.3%													
		W35-U						12.1	7.1	59%	7.1	59%	0.0	0.0%	41	6	41	6	0.0%	0.0%
Fourth	R28	W36-L	LKD	6.0	5.9	0.2	2.8%													
		W36-U						33.1	8.8	27%	8.8	27%	0.0	0.2%	21	6	20	5	4.8%	16.7%
Fourth	R29	W37-L	Bedroom	19.6	18.9	0.7	3.7%													
		W37-U						11.5	8.4	73%	8.0	70%	0.4	4.4%	40	9	38	7	5.0%	22.2%
Fourth	R30	W38-L	LKD	8.9	6.5	2.4	26.7%													
		W38-U																		
		W39-L		38.8	38.2	0.6	1.4%													
		W39-U						37.4	29.1	78%	28.5	76%	0.6	2.0%	42	12	39	9	7.1%	25.0%
Fourth	R31	W40-L	Bedroom	10.9	10.9	0.0	0.0%													
		W40-U						14.8	10.7	73%	10.7	73%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fourth	R32	W41-L	LKD	2.8	2.8	0.0	0.0%													
		W41-U						26.1	18.8	72%	18.8	72%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourth	R33	W42-L	Bedroom	17.3	17.3	0.0	0.0%													
		W42-U						12.5	12.3	99%	12.3	99%	0.0	0.0%	20	0	20	0	0.0%	0.0%
Fourth	R34	W43-L	Bedroom	15.1	15.1	0.0	0.0%													
		W43-U						11.1	9.1	82%	9.1	82%	0.0	0.0%	16	0	16	0	0.0%	0.0%
Fourth	R35	W44-L	LKD	2.0	2.0	0.0	0.0%													
		W44-U						34.5	12.2	35%	12.2	35%	0.0	0.0%	4	2	4	2	0.0%	0.0%
Fourth	R36	W45-L	LKD	1.5	1.5	0.0	0.0%													
		W45-U						34.4	10.1	29%	10.1	29%	0.0	0.0%	2	0	2	0	0.0%	0.0%
Fourth	R37	W46-L	Bedroom	14.3	14.3	0.0	0.0%													
		W46-U						11.1	9.8	88%	9.8	88%	0.0	0.0%	18	1	18	1	0.0%	0.0%
Fourth	R38	W47-L	Bedroom	16.3	16.3	0.0	0.0%													
		W47-U						12.5	10.0	80%	10.0	80%	0.0	0.0%	31	5	31	5	0.0%	0.0%
Fourth	R39	W48-L	LKD	2.2	2.2	0.0	0.0%													
		W48-U						26.1	6.2	24%	6.2	24%	0.0	0.0%	7	4	7	4	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fourth	R40	W49-L	Bedroom	9.2	9.2	0.0	0.0%												
		W49-U						14.8	8.1	55%	8.1	55%	0.0	0.0%	18	2	18	2	0.0%	0.0%
Fifth	R1	W1-L	Bedroom	36.7	36.7	0.0	0.0%												
		W1-U						11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R2	W2-L	LKD	36.3	36.3	0.0	0.0%												
		W2-U																	
		W3-L		17.9	17.9	0.0	0.0%												
		W3-U																	
		W4		29.4	29.4	0.0	0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	55	15	55	15	0.0%	0.0%
Fifth	R3	W5-L	Bedroom	35.3	35.3	0.0	0.0%												
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	50	13	50	13	0.0%	0.0%
Fifth	R4	W6-L	Bedroom	34.9	34.9	0.0	0.0%												
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	45	11	45	11	0.0%	0.0%
Fifth	R5	W7-L	Bedroom	30.5	30.5	0.0	0.0%												
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.0%	32	7	32	7	0.0%	0.0%
Fifth	R6	W8-L	LKD	18.6	18.6	0.0	0.0%												
		W8-U						31.4	24.7	79%	24.7	79%	0.0	0.0%	32	13	32	13	0.0%	0.0%
Fifth	R7	W9-L	Bedroom	32.6	32.6	0.0	0.0%												
		W9-U						16.9	16.4	97%	16.4	97%	0.0	0.0%	45	10	45	10	0.0%	0.0%
Fifth	R8	W10-L	LKD	18.0	18.0	0.0	0.0%												
		W10-U						25.0	21.7	87%	21.7	87%	0.0	0.0%	27	11	27	11	0.0%	0.0%
Fifth	R9	W11-L	Bedroom	31.2	31.2	0.0	0.0%												
		W11-U						12.7	11.5	91%	11.5	91%	0.0	0.0%	47	10	47	10	0.0%	0.0%
Fifth	R10	W12-L	Bedroom	27.5	27.5	0.0	0.0%												
		W12-U						7.8	7.5	96%	7.5	96%	0.0	0.0%	27	6	27	6	0.0%	0.0%
Fifth	R11	W13-L	LKD	15.4	15.4	0.0	0.0%												
		W13-U																	
		W14-L		10.3	10.3	0.0	0.0%												
		W14-U																	
		W15-L		8.6	8.6	0.0	0.0%												
		W15-U						36.4	27.9	77%	27.9	77%	0.0	0.0%	41	10	41	10	0.0%	0.0%
Fifth	R12	W16	LKD	12.3	12.3	0.0	0.0%												
		W17-L		14.7	14.7	0.0	0.0%												
		W17-U						43.0	36.1	84%	36.1	84%	0.0	0.0%	23	8	23	8	0.0%	0.0%
Fifth	R13	W18-L	Bedroom	29.6	29.6	0.0	0.0%												
		W18-U						12.1	11.2	92%	11.2	92%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Fifth	R14	W19-L	LKD	16.4	16.4	0.0	0.0%												
		W19-U						28.4	22.1	78%	22.1	78%	0.0	0.0%	27	11	27	11	0.0%	0.0%
Fifth	R15	W20-L	Bedroom	30.9	30.9	0.0	0.0%												
		W20-U						13.1	12.3	93%	12.3	93%	0.0	0.0%	50	12	50	12	0.0%	0.0%
Fifth	R16	W21-L	LKD	13.6	13.6	0.0	0.0%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W21-U																		
		W22-L		23.6	23.6	0.1	0.3%													
		W22-U						43.2	30.5	71%	30.5	71%	0.0	0.0%	79	16	79	16	0.0%	0.0%
Fifth	R17	W23-L	Bedroom	25.4	25.2	0.2	0.7%													
		W23-U						13.6	7.4	54%	6.8	50%	0.5	7.4%	60	12	60	12	0.0%	0.0%
Fifth	R18	W24-L	Bedroom	25.4	25.1	0.3	1.1%													
		W24-U						11.8	6.1	52%	6.0	51%	0.0	0.5%	62	12	62	12	0.0%	0.0%
Fifth	R19	W25-L	Bedroom	25.1	24.7	0.4	1.7%													
		W25-U						7.7	4.1	54%	4.1	53%	0.0	1.1%	65	11	64	10	1.5%	9.1%
Fifth	R20	W26-L	LKD	6.8	6.1	0.8	11.0%													
		W26-U						30.6	13.8	45%	10.2	33%	3.6	26.3%	18	10	15	7	16.7%	30.0%
Fifth	R21	W27-L	Bedroom	24.1	23.5	0.6	2.6%													
		W27-U						8.0	6.5	81%	6.3	79%	0.2	2.7%	48	8	48	8	0.0%	0.0%
Fifth	R22	W28-L	Bedroom	24.0	23.6	0.5	2.0%													
		W28-U						11.7	8.2	70%	8.2	70%	0.0	0.0%	52	10	52	10	0.0%	0.0%
Fifth	R23	W29-L	LKD	7.5	7.3	0.2	2.9%													
		W29-U																		
		W30-L		12.1	12.1	0.1	0.7%													
		W30-U						39.0	26.9	69%	26.9	69%	0.0	0.0%	35	10	35	10	0.0%	0.0%
Fifth	R24	W31-L	LKD	16.1	16.1	0.0	0.0%													
		W31-U																		
		W32-L		7.5	7.5	0.0	0.0%													
		W32-U						35.2	24.2	69%	24.2	69%	0.0	0.0%	44	10	44	10	0.0%	0.0%
Fifth	R25	W33-L	Bedroom	18.5	18.5	0.0	0.0%													
		W33-U						11.2	8.3	74%	8.3	74%	0.0	0.0%	42	8	42	8	0.0%	0.0%
Fifth	R26	W34-L	LKD	6.3	6.3	0.0	0.0%													
		W34-U						34.5	8.4	24%	8.4	24%	0.0	0.0%	21	9	21	9	0.0%	0.0%
Fifth	R27	W35-L	Bedroom	19.0	19.0	0.0	0.1%													
		W35-U						12.1	8.6	71%	8.6	71%	0.0	0.0%	47	8	47	8	0.0%	0.0%
Fifth	R28	W36-L	LKD	7.5	7.3	0.1	1.6%													
		W36-U						33.1	11.0	33%	11.0	33%	0.0	0.0%	25	8	25	8	0.0%	0.0%
Fifth	R29	W37-L	Bedroom	22.2	21.5	0.7	3.3%													
		W37-U						11.5	9.0	78%	8.3	72%	0.6	7.1%	50	10	48	8	4.0%	20.0%
Fifth	R30	W38-L	LKD	25.5	23.1	2.4	9.3%													
		W38-U																		
		W39-L		38.9	38.4	0.5	1.3%													
		W39-U						37.4	29.2	78%	28.6	76%	0.6	2.1%	67	15	63	11	6.0%	26.7%
Fifth	R31	W40-L	Bedroom	12.6	12.6	0.0	0.0%													
		W40-U						14.8	12.0	81%	12.0	81%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifth	R32	W41-L	LKD	4.2	4.2	0.0	0.0%													
		W41-U						26.1	19.6	75%	19.6	75%	0.0	0.0%	7	0	7	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R33	W42-L W42-U	Bedroom	19.9	19.9	0.0	0.0%	12.5	12.4	99%	12.4	99%	0.0	0.0%	22	0	22	0	0.0%	0.0%
Fifth	R34	W43-L W43-U	Bedroom	16.9	16.9	0.0	0.0%	11.1	9.8	89%	9.8	89%	0.0	0.0%	20	0	20	0	0.0%	0.0%
Fifth	R35	W44-L W44-U	LKD	3.9	3.9	0.0	0.0%	34.5	14.9	43%	14.9	43%	0.0	0.0%	11	3	11	3	0.0%	0.0%
Fifth	R36	W45-L W45-U	LKD	2.9	2.9	0.0	0.0%	34.4	12.6	36%	12.6	36%	0.0	0.0%	6	1	6	1	0.0%	0.0%
Fifth	R37	W46-L W46-U	Bedroom	16.1	16.1	0.0	0.0%	11.1	10.3	93%	10.3	93%	0.0	0.0%	21	1	21	1	0.0%	0.0%
Fifth	R38	W47-L W47-U	Bedroom	18.7	18.7	0.0	0.0%	12.5	10.7	86%	10.7	86%	0.0	0.0%	37	6	37	6	0.0%	0.0%
Fifth	R39	W48-L W48-U	LKD	3.6	3.6	0.0	0.0%	26.1	8.7	33%	8.7	33%	0.0	0.0%	11	5	11	5	0.0%	0.0%
Fifth	R40	W49-L W49-U	Bedroom	10.4	10.4	0.0	0.0%	14.8	9.1	62%	9.1	62%	0.0	0.0%	20	2	20	2	0.0%	0.0%
Sixth	R1	W1-L W1-U	Bedroom	32.4	32.4	0.0	0.0%	11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R2	W2-L W2-U W3-L W3-U W4	LKD	20.7 34.6 35.2	20.7 34.6 35.2	0.0 0.0 0.0	0.0% 0.0% 0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	58	18	58	18	0.0%	0.0%
Sixth	R3	W5-L W5-U	Bedroom	36.1	36.1	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	54	14	54	14	0.0%	0.0%
Sixth	R4	W6-L W6-U	Bedroom	35.6	35.6	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	49	13	49	13	0.0%	0.0%
Sixth	R5	W7-L W7-U	Bedroom	31.2	31.2	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	34	9	34	9	0.0%	0.0%
Sixth	R6	W8-L W8-U	LKD	19.5	19.5	0.0	0.0%	31.4	24.7	79%	24.7	79%	0.0	0.0%	35	14	35	14	0.0%	0.0%
Sixth	R7	W9-L W9-U	Bedroom	33.5	33.5	0.0	0.0%	16.9	16.5	97%	16.5	97%	0.0	0.0%	46	11	46	11	0.0%	0.0%
Sixth	R8	W10-L W10-U	LKD	19.0	19.0	0.0	0.0%	25.0	22.0	88%	22.0	88%	0.0	0.0%	31	14	31	14	0.0%	0.0%
Sixth	R9	W11-L W11-U	Bedroom	32.5	32.5	0.0	0.0%	12.7	12.1	95%	12.1	95%	0.0	0.0%	53	13	53	13	0.0%	0.0%
Sixth	R10	W12-L W12-U	Bedroom	29.1	29.1	0.0	0.0%	7.8	7.5	96%	7.5	96%	0.0	0.0%	28	7	28	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Sixth	R11	W13-L	LKD	16.5	16.5	0.0	0.0%												
		W13-U																	
		W14-L		13.5	13.5	0.0	0.0%												
		W14-U																	
		W15-L		11.9	11.9	0.0	0.0%												
		W15-U						36.4	27.9	77%	27.9	77%	0.0	0.0%	59	14	59	14	0.0%	0.0%
Sixth	R12	W16	LKD	15.3	15.3	0.0	0.0%												
		W17-L		15.7	15.7	0.0	0.0%												
		W17-U						43.0	36.4	85%	36.4	85%	0.0	0.0%	25	9	25	9	0.0%	0.0%
Sixth	R13	W18-L	Bedroom	31.8	31.8	0.0	0.0%												
		W18-U						12.1	11.5	94%	11.5	94%	0.0	0.0%	41	6	41	6	0.0%	0.0%
Sixth	R14	W19-L	LKD	17.5	17.5	0.0	0.0%												
		W19-U						28.4	22.7	80%	22.7	80%	0.0	0.0%	29	11	29	11	0.0%	0.0%
Sixth	R15	W20-L	Bedroom	32.5	32.5	0.0	0.0%												
		W20-U						13.1	12.5	95%	12.5	95%	0.0	0.0%	52	14	52	14	0.0%	0.0%
Sixth	R16	W21-L	LKD	33.7	33.7	0.0	0.0%												
		W21-U																	
		W22-L		10.2	9.8	0.4	3.4%												
		W22-U						43.2	30.8	71%	30.8	71%	0.0	0.0%	66	18	65	17	1.5%	5.6%
Sixth	R17	W23-L	Bedroom	28.1	27.6	0.5	1.6%												
		W23-U						13.6	9.9	72%	9.2	67%	0.7	6.7%	72	16	71	15	1.4%	6.3%
Sixth	R18	W24-L	Bedroom	28.3	27.7	0.6	2.0%												
		W24-U						11.8	8.1	69%	8.1	69%	0.0	0.1%	71	16	70	15	1.4%	6.3%
Sixth	R19	W25-L	Bedroom	28.1	27.4	0.7	2.6%												
		W25-U						7.7	5.7	74%	5.7	74%	0.0	0.0%	70	15	69	14	1.4%	6.7%
Sixth	R20	W26-L	LKD	9.4	8.4	1.0	11.0%												
		W26-U						30.6	16.5	54%	14.8	48%	1.7	10.3%	24	13	21	10	12.5%	23.1%
Sixth	R21	W27-L	Bedroom	27.9	27.0	0.9	3.2%												
		W27-U						8.0	7.3	92%	7.2	90%	0.1	2.0%	60	14	59	13	1.7%	7.1%
Sixth	R22	W28-L	Bedroom	27.9	27.1	0.8	2.7%												
		W28-U						11.7	9.4	80%	9.4	80%	0.0	0.0%	61	14	60	13	1.6%	7.1%
Sixth	R23	W29-L	LKD	10.2	9.6	0.5	5.2%												
		W29-U																	
		W30-L		16.0	15.8	0.2	1.4%												
		W30-U						39.0	27.9	71%	27.9	71%	0.0	0.0%	40	13	39	12	2.5%	7.7%
Sixth	R24	W31-L	LKD	19.7	19.7	0.0	0.0%												
		W31-U																	
		W32-L		10.4	10.4	0.0	0.0%												
		W32-U						35.2	24.6	70%	24.6	70%	0.0	0.0%	55	16	55	16	0.0%	0.0%
Sixth	R25	W33-L	Bedroom	23.1	23.1	0.0	0.0%												
		W33-U						11.2	9.5	85%	9.5	85%	0.0	0.1%	52	12	52	12	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Sixth	R26	W34-L	LKD	8.6	8.6	0.0	0.0%													
		W34-U						34.5	12.5	36%	12.5	36%	0.0	0.0%	31	12	31	12	0.0%	0.0%
Sixth	R27	W35-L	Bedroom	23.3	23.3	0.0	0.2%													
		W35-U						12.1	9.8	81%	9.7	80%	0.1	0.8%	57	11	57	11	0.0%	0.0%
Sixth	R28	W36-L	LKD	9.4	9.3	0.1	1.2%													
		W36-U						33.1	13.6	41%	13.6	41%	0.0	0.0%	33	12	33	12	0.0%	0.0%
Sixth	R29	W37-L	Bedroom	24.3	23.4	0.9	3.7%													
		W37-U						11.5	9.7	84%	9.1	79%	0.5	5.5%	47	12	46	11	2.1%	8.3%
Sixth	R30	W38-L	LKD	12.1	9.7	2.4	20.0%													
		W38-U																		
		W39-L		39.0	38.6	0.4	1.1%													
		W39-U						37.4	29.2	78%	28.6	76%	0.6	2.1%	50	18	47	15	6.0%	16.7%
Sixth	R31	W40-L	Bedroom	14.5	14.5	0.0	0.0%													
		W40-U						14.8	13.2	89%	13.2	89%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Sixth	R32	W41-L	LKD	6.2	6.2	0.0	0.0%													
		W41-U						26.1	21.1	81%	21.1	81%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Sixth	R33	W42-L	Bedroom	22.7	22.7	0.0	0.0%													
		W42-U						12.5	12.4	99%	12.4	99%	0.0	0.0%	23	0	23	0	0.0%	0.0%
Sixth	R34	W43-L	Bedroom	19.7	19.7	0.0	0.0%													
		W43-U						11.1	10.5	95%	10.5	95%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Sixth	R35	W44-L	LKD	6.2	6.2	0.0	0.0%													
		W44-U						34.5	20.0	58%	20.0	58%	0.0	0.0%	13	4	13	4	0.0%	0.0%
Sixth	R36	W45-L	LKD	5.3	5.3	0.0	0.0%													
		W45-U						34.4	17.9	52%	17.9	52%	0.0	0.0%	9	3	9	3	0.0%	0.0%
Sixth	R37	W46-L	Bedroom	19.2	19.2	0.0	0.0%													
		W46-U						11.1	10.7	96%	10.7	96%	0.0	0.0%	30	2	30	2	0.0%	0.0%
Sixth	R38	W47-L	Bedroom	21.4	21.4	0.0	0.0%													
		W47-U						12.5	11.7	94%	11.7	94%	0.0	0.0%	41	8	41	8	0.0%	0.0%
Sixth	R39	W48-L	LKD	5.3	5.3	0.0	0.0%													
		W48-U						26.1	10.9	42%	10.9	42%	0.0	0.0%	15	7	15	7	0.0%	0.0%
Sixth	R40	W49-L	Bedroom	12.1	12.1	0.0	0.0%													
		W49-U						14.8	10.5	71%	10.5	71%	0.0	0.0%	23	4	23	4	0.0%	0.0%
Seventh	R1	W1-L	Bedroom	39.0	39.0	0.0	0.0%													
		W1-U						11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R2	W2-L	LKD	39.5	39.5	0.0	0.0%													
		W2-U																		
		W3-L		22.3	22.3	0.0	0.0%													
		W3-U																		
		W4		31.2	31.2	0.0	0.0%	34.3	31.0	90%	31.0	90%	0.0	0.0%	59	18	59	18	0.0%	0.0%
Seventh	R3	W5-L	Bedroom	36.7	36.7	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U						12.0	11.7	98%	11.7	98%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Seventh	R4	W6-L	Bedroom	36.6	36.6	0.0	0.0%													
		W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	53	13	53	13	0.0%	0.0%
Seventh	R5	W7-L	Bedroom	32.8	32.8	0.0	0.0%													
		W7-U						11.3	10.6	94%	10.6	94%	0.0	0.0%	34	11	34	11	0.0%	0.0%
Seventh	R6	W8-L	LKD	23.2	23.2	0.0	0.0%													
		W8-U						31.4	24.8	79%	24.8	79%	0.0	0.0%	43	16	43	16	0.0%	0.0%
Seventh	R7	W9-L	Bedroom	34.9	34.9	0.0	0.0%													
		W9-U						16.9	16.5	97%	16.5	97%	0.0	0.0%	53	13	53	13	0.0%	0.0%
Seventh	R8	W10-L	LKD	22.7	22.7	0.0	0.0%													
		W10-U						25.0	22.8	92%	22.8	92%	0.0	0.0%	38	15	38	15	0.0%	0.0%
Seventh	R9	W11-L	Bedroom	34.3	34.3	0.0	0.0%													
		W11-U						12.7	12.3	97%	12.3	97%	0.0	0.0%	55	15	55	15	0.0%	0.0%
Seventh	R10	W12-L	Bedroom	36.0	36.0	0.0	0.0%													
		W12-U						7.8	7.5	96%	7.5	96%	0.0	0.0%	55	15	55	15	0.0%	0.0%
Seventh	R11	W13-L	LKD	36.0	36.0	0.0	0.0%													
		W13-U																		
		W14-L		18.3	18.3	0.0	0.0%													
		W14-U																		
		W15-L		16.9	16.9	0.0	0.0%													
		W15-U						36.4	28.0	77%	28.0	77%	0.0	0.0%	74	16	74	16	0.0%	0.0%
Seventh	R12	W16	LKD	20.8	20.8	0.0	0.0%													
		W17-L		35.4	35.4	0.0	0.0%													
		W17-U						43.0	36.8	86%	36.8	86%	0.0	0.0%	56	14	56	14	0.0%	0.0%
Seventh	R13	W18-L	Bedroom	35.1	35.1	0.0	0.0%													
		W18-U						12.1	11.5	95%	11.5	95%	0.0	0.0%	52	12	52	12	0.0%	0.0%
Seventh	R14	W19-L	LKD	34.3	34.3	0.0	0.0%													
		W19-U						28.4	24.0	85%	24.0	85%	0.0	0.0%	45	11	45	11	0.0%	0.0%
Seventh	R15	W20-L	Bedroom	34.8	34.8	0.0	0.0%													
		W20-U						13.1	12.5	95%	12.5	95%	0.0	0.0%	53	14	53	14	0.0%	0.0%
Seventh	R16	W21-L	LKD	34.6	34.6	0.0	0.0%													
		W21-U																		
		W22-L		31.5	30.8	0.7	2.2%													
		W22-U						43.2	31.6	73%	31.6	73%	0.0	0.0%	88	22	88	22	0.0%	0.0%
Seventh	R17	W23-L	Bedroom	30.9	30.1	0.8	2.6%													
		W23-U						13.6	11.1	81%	10.2	75%	0.9	7.8%	75	18	73	16	2.7%	11.1%
Seventh	R18	W24-L	Bedroom	30.8	29.9	0.9	3.0%													
		W24-U						11.8	10.8	91%	10.8	91%	0.0	0.0%	75	18	73	16	2.7%	11.1%
Seventh	R19	W25-L	Bedroom	30.8	29.8	1.1	3.4%													
		W25-U						7.7	7.1	92%	7.1	92%	0.0	0.0%	76	19	73	16	3.9%	15.8%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R20	W26-L	LKD	27.6	26.3	1.3	4.6%													
		W26-U						30.6	21.3	70%	21.3	70%	0.0	0.0%	58	16	55	13	5.2%	18.8%
Seventh	R21	W27-L	Bedroom	31.5	30.4	1.1	3.6%													
		W27-U						8.0	7.7	97%	7.6	95%	0.1	1.6%	77	21	74	18	3.9%	14.3%
Seventh	R22	W28-L	Bedroom	31.6	30.6	1.0	3.3%													
		W28-U						11.7	11.0	94%	11.0	94%	0.0	0.0%	76	20	73	17	3.9%	15.0%
Seventh	R23	W29-L	LKD	31.4	30.6	0.8	2.7%													
		W29-U																		
		W30-L		21.4	21.0	0.4	1.9%													
		W30-U						39.2	29.0	74%	29.0	74%	0.0	0.0%	73	18	71	16	2.7%	11.1%
Seventh	R24	W31-L	LKD	23.4	23.4	0.0	0.0%													
		W31-U																		
		W32-L		29.7	29.3	0.4	1.4%													
		W32-U						35.2	24.9	71%	24.9	71%	0.0	0.0%	78	21	78	21	0.0%	0.0%
Seventh	R25	W33-L	Bedroom	29.1	28.7	0.4	1.3%													
		W33-U						11.2	10.5	94%	10.5	94%	0.1	0.5%	75	18	75	18	0.0%	0.0%
Seventh	R26	W34-L	LKD	28.8	28.4	0.4	1.4%													
		W34-U						34.5	19.1	55%	19.1	55%	0.0	0.0%	75	18	74	17	1.3%	5.6%
Seventh	R27	W35-L	Bedroom	28.9	28.4	0.5	1.7%													
		W35-U						12.1	11.3	93%	11.1	92%	0.2	1.5%	74	17	73	16	1.4%	5.9%
Seventh	R28	W36-L	LKD	29.4	28.9	0.6	2.0%													
		W36-U						33.0	17.6	53%	17.2	52%	0.4	2.4%	76	19	75	18	1.3%	5.3%
Seventh	R29	W37-L	Bedroom	27.9	26.6	1.3	4.7%													
		W37-U						11.5	11.0	95%	10.9	95%	0.1	0.7%	57	15	55	13	3.5%	13.3%
Seventh	R30	W38-L	LKD	32.7	30.2	2.6	7.8%													
		W38-U																		
		W39-L		39.1	38.7	0.4	1.0%													
		W39-U						37.5	29.6	79%	28.7	77%	0.9	3.0%	78	20	76	18	2.6%	10.0%
Seventh	R31	W40-L	Bedroom	16.5	16.5	0.0	0.0%													
		W40-U						14.8	13.6	92%	13.6	92%	0.0	0.0%	14	0	14	0	0.0%	0.0%
Seventh	R32	W41-L	LKD	11.5	11.5	0.0	0.0%													
		W41-U						26.1	23.8	91%	23.8	91%	0.0	0.0%	16	1	16	1	0.0%	0.0%
Seventh	R33	W42-L	Bedroom	25.5	25.5	0.0	0.0%													
		W42-U						12.5	12.4	100%	12.4	100%	0.0	0.0%	28	3	28	3	0.0%	0.0%
Seventh	R34	W43-L	Bedroom	23.8	23.8	0.0	0.0%													
		W43-U						11.1	10.7	96%	10.7	96%	0.0	0.0%	25	3	25	3	0.0%	0.0%
Seventh	R35	W44-L	LKD	27.5	27.5	0.0	0.0%													
		W44-U						34.6	23.1	67%	23.1	67%	0.0	0.0%	37	6	37	6	0.0%	0.0%
Seventh	R36	W45-L	LKD	27.2	27.2	0.0	0.0%													
		W45-U						34.5	24.4	71%	24.4	71%	0.0	0.0%	41	9	41	9	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R37	W46-L W46-U	Bedroom	23.7	23.7	0.0	0.0%	11.1	10.7	96%	10.7	96%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Seventh	R38	W47-L W47-U	Bedroom	24.2	24.2	0.0	0.0%	12.5	12.4	100%	12.4	100%	0.0	0.0%	46	13	46	13	0.0%	0.0%
Seventh	R39	W48-L W48-U	LKD	9.9	9.9	0.0	0.0%	26.1	17.2	66%	17.2	66%	0.0	0.0%	28	14	28	14	0.0%	0.0%
Seventh	R40	W49-L W49-U	Bedroom	14.6	14.6	0.0	0.0%	14.8	11.8	80%	11.8	80%	0.0	0.0%	25	6	25	6	0.0%	0.0%
Eighth	R1	W1-L W1-U	Bedroom	39.6	39.6	0.0	0.0%	11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W2-L W2-U	LKD	39.6	39.6	0.0	0.0%													
		W3-L W3-U		37.9	37.9	0.0	0.0%													
		W4		37.9	37.9	0.0	0.0%	34.1	30.4	89%	30.4	89%	0.0	0.0%	60	18	60	18	0.0%	0.0%
Eighth	R3	W5-L W5-U	Bedroom	37.7	37.7	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R4	W6-L W6-U	Bedroom	37.6	37.6	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R5	W7-L W7-U	Bedroom	37.6	37.6	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R6	W8-L W8-U	LKD	37.4	37.4	0.0	0.0%	31.4	24.9	79%	24.9	79%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R7	W9-L W9-U	Bedroom	37.3	37.3	0.0	0.0%	16.9	16.5	97%	16.5	97%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R8	W10-L W10-U	LKD	36.0	36.0	0.0	0.0%	25.0	23.4	94%	23.4	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R9	W11-L W11-U	Bedroom	36.9	36.9	0.0	0.0%	14.5	13.3	92%	13.3	92%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R10	W12-L W12-U	Bedroom	34.3	34.3	0.0	0.0%													
		W13-L W13-U		27.9	27.9	0.0	0.0%	13.7	12.0	88%	12.0	88%	0.0	0.0%	82	15	82	15	0.0%	0.0%
Eighth	R11	W14-L W14-U	LKD	29.1	29.1	0.0	0.0%													
		W15-L W15-U		31.0	31.0	0.0	0.0%													
		W16-L W16-U		36.2	36.2	0.0	0.0%	33.3	29.1	87%	29.1	87%	0.0	0.0%	58	16	58	16	0.0%	0.0%
Eighth	R12	W17-L W17-U	Bedroom	36.0	36.0	0.0	0.0%	11.4	10.7	94%	10.7	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighth	R13	W18-L	Bedroom	35.9	35.9	0.0	0.0%													
		W18-U						13.1	12.6	97%	12.6	97%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R14	W19-L	Bedroom	35.8	35.8	0.0	0.0%													
		W19-U						15.7	14.9	95%	14.9	95%	0.0	0.0%	54	14	54	14	0.0%	0.0%
Eighth	R15	W20-L	LKD	35.7	35.7	0.0	0.0%													
		W20-U																		
		W21-L		33.8	32.7	1.1	3.2%													
		W21-U																		
		W22-L		33.6	32.5	1.1	3.4%													
		W22-U						34.1	31.5	92%	31.5	92%	0.0	0.0%	93	25	92	24	1.1%	4.0%
Eighth	R16	W23-L	Bedroom	33.8	32.4	1.3	4.0%													
		W23-U																		
		W24-L		33.8	32.4	1.4	4.2%													
		W24-U						15.8	15.2	96%	15.2	96%	0.0	0.0%	81	24	79	22	2.5%	8.3%
Eighth	R17	W25-L	Bedroom	33.9	32.5	1.4	4.2%													
		W25-U						11.4	11.1	97%	11.1	97%	0.0	0.0%	81	24	79	22	2.5%	8.3%
Eighth	R18	W26-L	Bedroom	33.8	32.5	1.3	3.9%													
		W26-U						8.5	8.3	98%	8.3	98%	0.0	0.0%	81	24	79	22	2.5%	8.3%
Eighth	R19	W27-L	LKD	33.7	32.5	1.2	3.5%													
		W27-U																		
		W28-L		29.6	29.0	0.6	2.0%													
		W28-U						39.1	30.9	79%	30.7	79%	0.2	0.7%	79	22	77	20	2.5%	9.1%
Eighth	R20	W29-L	LKD	28.3	28.3	0.0	0.0%													
		W29-U																		
		W30-L		29.1	29.1	0.0	0.0%													
		W30-U																		
		W31-L		32.5	31.4	1.1	3.3%													
		W31-U																		
		W32-L		32.5	31.4	1.1	3.4%													
		W32-U						42.1	34.8	83%	34.8	83%	0.0	0.0%	86	25	85	24	1.2%	4.0%
Eighth	R21	W33-L	Bedroom	32.6	31.4	1.2	3.6%													
		W33-U						9.7	8.7	90%	8.6	89%	0.1	0.8%	79	22	78	21	1.3%	4.5%
Eighth	R22	W34-L	Bedroom	32.7	31.5	1.2	3.8%													
		W34-U						10.7	10.3	96%	10.3	96%	0.0	0.0%	76	22	74	20	2.6%	9.1%
Eighth	R23	W35-L	Bedroom	32.2	30.9	1.3	4.1%													
		W35-U						15.2	14.8	97%	14.8	97%	0.0	0.0%	75	24	72	21	4.0%	12.5%
Eighth	R24	W36-L	Bedroom	33.7	31.9	1.8	5.4%													
		W36-U						11.7	11.4	98%	11.3	97%	0.1	0.9%	83	26	80	23	3.6%	11.5%
Eighth	R25	W37-L	LKD	34.7	32.1	2.6	7.6%													
		W37-U																		
		W38-L		39.3	38.9	0.4	1.0%													
		W38-U						43.6	33.4	77%	32.7	75%	0.7	2.0%	85	26	84	25	1.2%	3.8%
Eighth	R26	W39-L	Bedroom	19.3	19.3	0.0	0.0%													
		W39-U						14.8	14.0	95%	14.0	95%	0.0	0.0%	17	1	17	1	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Eighth	R27	W40-L	LKD	14.0	14.0	0.0	0.0%													
		W40-U						26.1	24.5	94%	24.5	94%	0.0	0.0%	19	2	19	2	0.0%	0.0%
Eighth	R28	W41-L	Bedroom	29.3	29.3	0.0	0.0%													
		W41-U						12.8	12.4	97%	12.4	97%	0.0	0.0%	37	4	37	4	0.0%	0.0%
Eighth	R29	W42-L	Bedroom	19.8	19.8	0.0	0.0%													
		W42-U						6.7	6.4	96%	6.4	96%	0.0	0.0%	16	2	16	2	0.0%	0.0%
Eighth	R30	W43-L	LKD	29.0	29.0	0.0	0.0%													
		W43-U						28.9	21.6	75%	21.6	75%	0.0	0.0%	39	8	39	8	0.0%	0.0%
Eighth	R31	W44-L	LKD	28.7	28.7	0.0	0.0%													
		W44-U						29.1	22.4	77%	22.4	77%	0.0	0.0%	47	11	47	11	0.0%	0.0%
Eighth	R32	W45-L	Bedroom	20.4	20.4	0.0	0.0%													
		W45-U						6.7	6.4	96%	6.4	96%	0.0	0.0%	47	12	47	12	0.0%	0.0%
Eighth	R33	W46-L	Bedroom	27.6	27.6	0.0	0.0%													
		W46-U						12.8	12.5	97%	12.5	97%	0.0	0.0%	51	16	51	16	0.0%	0.0%
Eighth	R34	W47-L	LKD	12.4	12.4	0.0	0.0%													
		W47-U						26.3	23.7	90%	23.7	90%	0.0	0.0%	31	15	31	15	0.0%	0.0%
Eighth	R35	W48-L	Bedroom	18.2	18.2	0.0	0.0%													
		W48-U						14.8	13.8	94%	13.8	94%	0.0	0.0%	36	8	36	8	0.0%	0.0%
Ninth	R1	W1-L	LKD	34.2	34.2	0.0	0.0%													
		W1-U																		
		W2-L		38.8	38.8	0.0	0.0%													
		W2-U																		
		W3-L		39.1	39.1	0.0	0.0%													
		W3-U																		
		W4-L		38.1	38.1	0.0	0.0%													
		W4-U						37.0	36.9	100%	36.9	100%	0.0	0.0%	58	17	58	17	0.0%	0.0%
Ninth	R2	W5-L	Bedroom	38.0	38.0	0.0	0.0%													
		W5-U						10.4	10.2	98%	10.2	98%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Ninth	R3	W6-L	Bedroom	37.9	37.9	0.0	0.0%													
		W6-U						12.9	12.9	99%	12.9	99%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Ninth	R4	W7-L	Bedroom	37.8	37.8	0.0	0.0%													
		W7-U						11.1	11.0	99%	11.0	99%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Ninth	R5	W8-L	LKD	37.7	37.7	0.0	0.0%													
		W8-U																		
		W9-L		37.6	37.6	0.0	0.0%													
		W9-U						32.8	29.5	90%	29.5	90%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Ninth	R6	W10-L	LKD	18.3	18.3	0.0	0.0%													
		W10-U																		
		W11-L		18.1	18.1	0.0	0.0%													
		W11-U						38.2	27.8	73%	27.8	73%	0.0	0.0%	30	7	30	7	0.0%	0.0%
Ninth	R7	W12-L	Bedroom	36.4	36.4	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W12-U																	
		W13-L		32.6	32.6	0.0	0.0%												
		W13-U						10.9	10.9	100%	10.9	100%	0.0	0.0%	92	24	92	24	0.0%	0.0%
Ninth	R8	W14-L	LKD	33.2	33.2	0.0	0.0%												
		W14-U																	
		W15-L		8.6	8.6	0.0	0.0%												
		W15-U						31.3	28.7	92%	28.7	92%	0.0	0.0%	17	3	17	3	0.0%	0.0%
Ninth	R9	W16-L	Bedroom	6.8	6.8	0.0	0.0%												
		W16-U																	
		W17-L		36.8	36.8	0.0	0.0%												
		W17-U						14.2	12.6	89%	12.6	89%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Ninth	R10	W18-L	Bedroom	36.7	36.7	0.0	0.0%												
		W18-U						13.0	12.1	94%	12.1	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Ninth	R11	W19-L	LKD	36.6	36.6	0.0	0.0%												
		W19-U																	
		W20-L		8.1	8.0	0.1	1.4%												
		W20-U																	
		W21-L		0.0	0.0	0.0	0.0%												
		W21-U						31.0	22.3	72%	22.3	72%	0.0	0.0%	63	23	63	23	0.0%	0.0%
Ninth	R12	W22-L	Bedroom	35.4	33.9	1.4	4.0%												
		W22-U						7.9	7.6	95%	7.6	95%	0.0	0.0%	83	26	81	24	2.4%	7.7%
Ninth	R14	W24-L	Bedroom	35.2	33.8	1.5	4.2%												
		W24-U						11.8	11.0	93%	11.0	93%	0.0	0.0%	83	26	80	23	3.6%	11.5%
Ninth	R15	W25-L	Bedroom	35.2	33.7	1.5	4.3%												
		W25-U						10.8	10.6	98%	10.6	98%	0.0	0.0%	83	26	80	23	3.6%	11.5%
Ninth	R16	W26-L	Bedroom	35.1	33.5	1.5	4.4%												
		W26-U																	
		W27-L		7.5	6.7	0.8	10.9%												
		W27-U						7.9	7.8	98%	7.8	98%	0.0	0.0%	82	25	80	23	2.4%	8.0%
Ninth	R17	W28-L	LKD	10.9	9.4	1.4	13.1%												
		W28-U																	
		W29-L		32.7	32.0	0.7	2.2%												
		W29-U																	
		W30-L		32.0	31.3	0.7	2.2%												
		W30-U						32.4	26.7	82%	26.7	82%	0.0	0.0%	42	17	39	14	7.1%	17.6%
Ninth	R18	W31-L	LKD	33.8	33.8	0.0	0.0%												
		W31-U																	
		W32-L		34.0	34.0	0.0	0.0%												
		W32-U																	
		W33-L		10.3	8.9	1.4	14.0%												
		W33-U																	
		W34-L		6.7	6.7	0.0	0.0%												
		W34-U																	
		W35-L		34.6	33.0	1.5	4.4%												
		W35-U						31.9	30.5	96%	30.5	96%	0.0	0.0%	93	26	92	25	1.1%	3.8%
Ninth	R19	W36-L	Bedroom	34.7	33.1	1.6	4.6%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W36-U						11.7	11.5	99%	11.5	99%	0.0	0.0%	84	27	82	25	2.4%	7.4%
Ninth	R20	W37-L	Bedroom	34.8	33.1	1.7	4.9%													
		W37-U						7.3	7.1	97%	7.1	97%	0.0	0.0%	85	28	83	26	2.4%	7.1%
Ninth	R21	W38-L	Bedroom	35.1	33.2	1.9	5.3%													
		W38-U						11.9	11.5	97%	11.5	97%	0.0	0.0%	85	28	83	26	2.4%	7.1%
Ninth	R22	W39-L	LKD	27.6	25.5	2.1	7.5%													
		W39-U																		
		W40-L		35.6	33.3	2.3	6.4%													
		W40-U																		
		W41-L		39.0	38.6	0.4	0.9%													
		W41-U						40.3	38.1	95%	38.0	95%	0.0	0.0%	83	26	82	25	1.2%	3.8%
Ninth	R23	W42-L	Bedroom	24.1	24.1	0.0	0.0%													
		W42-U						14.3	14.0	97%	14.0	97%	0.0	0.0%	19	1	19	1	0.0%	0.0%
Ninth	R24	W43-L	Bedroom	30.1	30.1	0.0	0.0%													
		W43-U						12.1	12.1	100%	12.1	100%	0.0	0.0%	36	2	36	2	0.0%	0.0%
Ninth	R25	W44-L	LKD	33.6	33.6	0.0	0.0%													
		W44-U						42.2	28.0	66%	28.0	66%	0.0	0.0%	50	11	50	11	0.0%	0.0%
Ninth	R26	W45-L	LKD	32.2	32.2	0.0	0.0%													
		W45-U						42.1	27.7	66%	27.7	66%	0.0	0.0%	55	17	55	17	0.0%	0.0%
Ninth	R27	W46-L	Bedroom	28.9	28.9	0.0	0.0%													
		W46-U						11.8	11.8	100%	11.8	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%
Ninth	R28	W47-L	Bedroom	23.6	23.6	0.0	0.0%													
		W47-U						14.3	14.0	98%	14.0	98%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Tenth	R1	W1-L	Studio	39.6	39.6	0.0	0.0%													
		W1-U																		
		W2-L		39.6	39.6	0.0	0.0%													
		W2-U																		
		W3-L		39.6	39.6	0.0	0.0%													
		W3-U																		
		W4-L		39.6	39.6	0.0	0.0%													
		W4-U																		
		W5-L		38.6	38.6	0.0	0.0%													
		W5-U																		
		W6-L		38.6	38.6	0.0	0.0%													
		W6-U																		
		W7-L		38.5	38.5	0.0	0.0%													
		W7-U																		
		W8-L		38.4	38.4	0.0	0.0%													
		W8-U						94.4	94.2	100%	94.2	100%	0.0	0.0%	60	18	60	18	0.0%	0.0%
Tenth	R2	W9-L	Studio	38.4	38.4	0.0	0.0%													
		W9-U																		
		W10-L		38.3	38.3	0.0	0.0%													
		W10-U																		
		W11-L		38.3	38.3	0.0	0.0%													
		W11-U						39.0	36.3	93%	36.3	93%	0.0	0.0%	57	17	57	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Tenth	R3	W12-L	Studio	38.2	38.2	0.0	0.0%													
		W12-U																		
		W13-L		38.1	38.1	0.0	0.0%													
		W13-U																		
		W14-L		36.1	35.4	0.7	1.9%													
		W14-U						39.7	38.2	96%	38.2	96%	0.0	0.0%	96	28	94	26	2.1%	7.1%
Tenth	R5	W16-L	LKD	36.9	36.9	0.0	0.0%													
		W16-U																		
		W17-L		36.1	34.2	1.9	5.1%													
		W17-U																		
		W18-L		36.3	34.3	2.0	5.5%													
		W18-U						40.4	38.2	94%	38.2	94%	0.0	0.0%	96	29	94	27	2.1%	6.9%
Tenth	R6	W19-L	Bedroom	36.4	34.3	2.1	5.8%													
		W19-U																		
		W20-L		36.5	34.3	2.2	6.0%													
		W20-U						11.6	11.5	99%	11.5	99%	0.0	0.0%	85	28	83	26	2.4%	7.1%
Tenth	R7	W21-L	LKD	36.5	34.3	2.2	6.1%													
		W21-U																		
		W22-L		36.6	34.3	2.3	6.2%													
		W22-U																		
		W23-L		8.4	8.0	0.4	4.9%													
		W23-U																		
		W24-L		9.3	7.2	2.1	23.0%													
		W24-U						40.6	38.9	96%	38.9	96%	0.0	0.0%	87	28	86	27	1.1%	3.6%
Tenth	R8	W25-L	Bedroom	29.7	29.7	0.0	0.0%													
		W25-U						10.7	10.4	97%	10.4	97%	0.0	0.0%	34	2	34	2	0.0%	0.0%
Tenth	R9	W26-L	Bedroom	34.5	34.5	0.0	0.0%													
		W26-U						7.7	7.4	96%	7.4	96%	0.0	0.0%	50	11	50	11	0.0%	0.0%
Tenth	R10	W27-L	LKD	32.0	32.0	0.0	0.0%													
		W27-U																		
		W28-L		36.0	36.0	0.0	0.0%													
		W28-U						30.8	26.7	87%	26.7	87%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Tenth	R11	W29-L	LKD	35.4	34.9	0.5	1.4%													
		W29-U																		
		W30-L		31.0	31.0	0.0	0.0%													
		W30-U						30.5	26.2	86%	26.2	86%	0.0	0.0%	96	29	95	28	1.0%	3.4%
Tenth	R12	W31-L	Bedroom	33.5	33.5	0.0	0.0%													
		W31-U						7.7	7.4	96%	7.4	96%	0.0	0.0%	58	19	58	19	0.0%	0.0%
Tenth	R13	W32-L	Bedroom	29.0	29.0	0.0	0.0%													
		W32-U						10.7	10.4	97%	10.4	97%	0.0	0.0%	54	19	54	19	0.0%	0.0%
165-195 High cross road																				
Ground	R1	W1-L	Residential	30.9	27.8	3.1	10.0%													
		W1-U																		
		W2-L		2.1	2.1	0.0	0.0%													
		W2-U																		
		W3-L		1.6	1.6	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	27	2	27	2	0.0%	0.0%
Ground	R2	W4-L	Residential	7.3	4.7	2.5	34.9%													
		W4-U																		
		W5-L		6.4	4.9	1.5	23.6%													
		W5-U																		
		W6-L		6.8	5.3	1.5	22.3%													
		W6-U						16.2	15.5	96%	15.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W7-L	Residential	5.0	3.5	1.5	30.1%													
		W7-U																		
		W8-L		6.8	5.3	1.5	22.0%													
		W8-U																		
		W9-L		9.6	7.2	2.5	25.7%													
		W9-U						16.2	15.3	95%	15.3	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R4	W10-L	Residential	4.5	4.5	0.0	0.0%													
		W10-U																		
		W11-L		2.4	2.4	0.0	0.0%													
		W11-U																		
		W12-L		30.5	27.6	3.0	9.7%													
		W12-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R5	W13-L	Residential	30.3	27.4	2.9	9.6%													
		W13-U																		
		W14-L		1.7	1.7	0.0	0.0%													
		W14-U																		
		W15-L		0.9	0.9	0.0	0.0%													
		W15-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	24	3	24	3	0.0%	0.0%
Ground	R6	W16-L	Residential	6.5	4.5	2.1	31.5%													
		W16-U																		
		W17-L		5.9	4.5	1.4	24.1%													
		W17-U																		
		W18-L		6.7	5.3	1.4	21.2%													
		W18-U						16.2	15.2	94%	15.2	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R7	W19-L	Residential	4.6	3.2	1.4	30.2%													
		W19-U																		
		W20-L		6.3	5.0	1.4	21.4%													
		W20-U																		
		W21-L		9.6	7.4	2.2	23.3%													
		W21-U						16.2	15.2	94%	15.2	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R8	W22-L	Residential	5.3	5.1	0.2	4.2%													
		W22-U																		
		W23-L		5.2	5.2	0.0	0.0%													
		W23-U																		
		W24-L		29.6	26.9	2.7	9.1%													
		W24-U																		
		W25-L		31.4	31.4	0.0	0.0%													
		W25-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	66	22	66	22	0.0%	0.0%
First	R1	W1-L	Residential	31.4	28.2	3.1	10.0%													
		W1-U																		
		W2-L		4.9	4.9	0.0	0.0%													
		W2-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-L		3.7	3.7	0.0	0.0%													
		W3-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	27	2	27	2	0.0%	0.0%
First	R2	W4-L	Residential	9.0	6.0	3.0	33.6%													
		W4-U																		
		W5-L		8.6	6.3	2.3	26.7%													
		W5-U																		
		W6-L		9.8	7.5	2.3	23.6%													
		W6-U						15.9	15.3	96%	15.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W7-L	Residential	8.8	6.5	2.3	25.9%													
		W7-U																		
		W8-L		9.9	7.6	2.3	23.2%													
		W8-U																		
		W9-L		12.4	9.4	3.0	24.3%													
		W9-U						15.9	15.2	96%	15.2	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W10-L	Residential	7.9	7.9	0.0	0.0%													
		W10-U																		
		W11-L		7.3	7.3	0.0	0.0%													
		W11-U																		
		W12-L		31.1	28.1	3.0	9.7%													
		W12-U						14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W13-L	Residential	30.8	27.9	3.0	9.6%													
		W13-U																		
		W14-L		5.2	5.2	0.0	0.0%													
		W14-U																		
		W15-L		3.6	3.6	0.0	0.0%													
		W15-U						14.1	14.0	100%	14.0	100%	0.0	0.0%	25	3	25	3	0.0%	0.0%
First	R6	W16-L	Residential	8.5	6.2	2.4	27.6%													
		W16-U																		
		W17-L		8.1	6.0	2.2	26.5%													
		W17-U																		
		W18-L		9.3	7.1	2.2	23.2%													
		W18-U						15.9	15.0	94%	15.0	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W19-L	Residential	8.2	6.1	2.1	25.6%													
		W19-U																		
		W20-L		9.3	7.2	2.1	22.2%													
		W20-U																		
		W21-L		12.1	9.4	2.7	22.3%													
		W21-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W22-L	Residential	7.9	7.7	0.2	2.3%													
		W22-U																		
		W23-L		7.5	7.5	0.0	0.0%													
		W23-U																		
		W24-L		30.1	27.4	2.7	9.1%													
		W24-U																		
		W25-L		32.4	32.4	0.0	0.0%													
		W25-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	69	24	69	24	0.0%	0.0%
Second	R1	W1-L	Residential	32.0	28.8	3.2	10.0%													
		W1-U																		
		W2-L		2.6	2.6	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-U																		
		W3-L		2.0	2.0	0.0	0.0%													
		W3-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	30	3	30	3	0.0%	0.0%
Second	R2	W4-L	Residential	6.9	4.3	2.6	37.7%													
		W4-U																		
		W5-L		5.8	4.2	1.6	27.1%													
		W5-U																		
		W6-L		6.7	5.1	1.6	23.7%													
		W6-U						15.9	15.2	95%	15.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W7-L	Residential	6.0	4.4	1.6	26.1%													
		W7-U																		
		W8-L		6.8	5.2	1.6	23.0%													
		W8-U																		
		W9-L		9.7	7.1	2.6	26.6%													
		W9-U						15.9	15.0	94%	15.0	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W10-L	Residential	5.8	5.8	0.0	0.0%													
		W10-U																		
		W11-L		4.9	4.9	0.0	0.0%													
		W11-U																		
		W12-L		31.6	28.6	3.1	9.7%													
		W12-U						14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W13-L	Residential	31.4	28.4	3.0	9.6%													
		W13-U																		
		W14-L		2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		1.9	1.9	0.0	0.0%													
		W15-U						14.1	14.0	100%	14.0	100%	0.0	0.0%	27	4	27	4	0.0%	0.0%
Second	R6	W16-L	Residential	6.6	4.6	2.0	30.6%													
		W16-U																		
		W17-L		5.4	4.0	1.5	26.7%													
		W17-U																		
		W18-L		6.3	4.8	1.5	23.1%													
		W18-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W19-L	Residential	5.6	4.1	1.4	25.7%													
		W19-U																		
		W20-L		6.3	4.9	1.4	22.1%													
		W20-U																		
		W21-L		9.4	7.1	2.3	24.8%													
		W21-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W22-L	Residential	5.8	5.6	0.2	3.1%													
		W22-U																		
		W23-L		5.0	5.0	0.0	0.0%													
		W23-U																		
		W24-L		30.8	28.0	2.8	9.0%													
		W24-U																		
		W25-L		33.4	33.4	0.0	0.0%													
		W25-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	71	25	71	25	0.0%	0.0%
Third	R1	W1-L	Residential	32.3	29.0	3.3	10.1%													
		W1-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W2-L		2.6	2.6	0.0	0.0%													
		W2-U																		
		W3-L		1.6	1.6	0.0	0.0%													
		W3-U						14.2	14.1	99%	14.1	99%	0.0	0.0%	30	4	30	4	0.0%	0.0%
Third	R2	W4-L	Residential	6.9	4.3	2.6	38.2%													
		W4-U																		
		W5-L		5.1	3.7	1.4	27.2%													
		W5-U																		
		W6-L		5.8	4.4	1.4	24.2%													
		W6-U						15.9	15.2	95%	15.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W7-L	Residential	4.4	3.0	1.4	31.3%													
		W7-U																		
		W8-L		5.6	4.2	1.4	24.4%													
		W8-U																		
		W9-L		9.4	6.8	2.6	27.7%													
		W9-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W10-L	Residential	5.3	5.3	0.0	0.0%													
		W10-U																		
		W11-L		4.2	4.2	0.0	0.0%													
		W11-U																		
		W12-L		31.8	28.7	3.1	9.8%													
		W12-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W13-L	Residential	31.7	28.6	3.1	9.7%													
		W13-U																		
		W14-L		2.9	2.9	0.0	0.0%													
		W14-U																		
		W15-L		1.4	1.4	0.0	0.0%													
		W15-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	28	5	28	5	0.0%	0.0%
Third	R6	W16-L	Residential	6.5	4.4	2.1	32.6%													
		W16-U																		
		W17-L		4.8	3.5	1.3	26.7%													
		W17-U																		
		W18-L		5.4	4.2	1.3	23.4%													
		W18-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W19-L	Residential	4.1	2.8	1.2	30.6%													
		W19-U																		
		W20-L		5.2	4.0	1.2	23.5%													
		W20-U																		
		W21-L		9.1	6.7	2.4	25.9%													
		W21-U						15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R8	W22-L	Residential	5.2	5.2	0.0	0.0%													
		W22-U																		
		W23-L		4.3	4.3	0.0	0.0%													
		W23-U																		
		W24-L		31.1	28.2	2.8	9.0%													
		W24-U																		
		W25-L		34.0	34.0	0.0	0.0%													
		W25-U						14.1	14.1	100%	14.1	100%	0.0	0.0%	71	25	71	25	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
First	R1	W1-L	LKD	30.4	30.4	0.0	0.0%												
		W1-U																	
		W2-L		30.5	30.5	0.0	0.0%												
		W2-U																	
		W3-L		15.7	13.9	1.8	11.3%												
		W3-U						38.0	26.7	70%	26.7	70%	0.0	0.0%	46	13	46	13	0.0%	0.0%
First	R2	W4-L	Bedroom	29.2	26.6	2.6	8.9%												
		W4-U						12.1	10.8	89%	10.8	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	Bedroom	29.8	27.2	2.6	8.9%												
		W5-U						12.5	11.6	93%	11.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W6-L	Bedroom	29.2	26.5	2.7	9.3%												
		W6-U						13.0	12.4	95%	12.1	93%	0.3	2.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7-L	LKD	28.4	25.6	2.8	9.8%												
		W7-U																	
		W8-L		7.7	6.2	1.5	19.3%												
		W8-U						39.5	27.1	69%	26.3	67%	0.8	3.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W9-L	Bedroom	13.4	10.9	2.5	18.5%												
		W9-U						13.6	12.1	89%	10.7	78%	1.5	12.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10-L	Studio	11.4	9.1	2.3	20.2%												
		W10-U						37.2	13.3	36%	12.5	33%	0.8	5.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L	LKD	32.8	32.8	0.0	0.0%												
		W1-U																	
		W2-L		32.9	32.9	0.0	0.0%												
		W2-U																	
		W3-L		16.9	14.9	2.0	11.7%												
		W3-U						38.0	27.9	73%	27.9	73%	0.0	0.0%	48	14	48	14	0.0%	0.0%
Second	R2	W4-L	Bedroom	30.6	27.9	2.7	8.8%												
		W4-U						12.1	10.9	90%	10.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	Bedroom	31.2	28.4	2.8	8.9%												
		W5-U						12.5	11.7	93%	11.7	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W6-L	Bedroom	30.6	27.8	2.8	9.3%												
		W6-U						13.0	12.4	96%	12.1	93%	0.3	2.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7-L	LKD	29.7	26.8	2.9	9.8%												
		W7-U																	
		W8-L		8.4	6.7	1.7	20.0%												
		W8-U						39.5	27.7	70%	26.8	68%	0.8	3.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W9-L	Bedroom	14.4	11.9	2.6	17.9%												
		W9-U						13.6	12.8	94%	11.9	87%	0.9	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10-L	Studio	12.3	9.9	2.4	19.5%												
		W10-U						37.2	14.6	39%	13.6	37%	1.0	6.8%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	34.7	34.7	0.0	0.0%												
		W1-U																	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W2-L		34.8	34.8	0.0	0.0%												
		W2-U																	
		W3-L		18.0	15.8	2.2	12.0%												
		W3-U						38.0	30.4	80%	30.4	80%	0.0	0.0%	50	16	50	16	0.0%	0.0%
Third	R2	W4-L	Bedroom	31.6	28.9	2.8	8.8%												
		W4-U						12.1	10.9	90%	10.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	Bedroom	32.3	29.4	2.8	8.8%												
		W5-U						12.5	11.7	94%	11.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W6-L	Bedroom	31.8	28.8	3.0	9.3%												
		W6-U						13.0	12.4	96%	12.1	93%	0.3	2.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7-L	LKD	30.9	27.9	3.0	9.8%												
		W7-U																	
		W8-L		9.1	7.2	1.9	20.8%												
		W8-U						39.5	28.0	71%	27.4	69%	0.6	2.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W9-L	Bedroom	15.6	12.9	2.7	17.2%												
		W9-U						13.6	12.9	95%	12.1	89%	0.8	6.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10-L	Studio	14.4	11.9	2.5	17.3%												
		W10-U						37.2	16.6	45%	15.4	41%	1.2	7.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1-L	LKD	36.4	36.4	0.0	0.0%												
		W1-U																	
		W2-L		36.4	36.4	0.0	0.0%												
		W2-U																	
		W3-L		19.0	16.7	2.3	12.2%												
		W3-U						38.0	32.7	86%	32.7	86%	0.0	0.0%	51	16	51	16	0.0%	0.0%
Fourth	R2	W4-L	Bedroom	32.7	29.9	2.8	8.6%												
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R3	W5-L	Bedroom	33.3	30.4	2.9	8.6%												
		W5-U						12.5	11.8	95%	11.8	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R4	W6-L	Bedroom	32.9	29.9	3.0	9.1%												
		W6-U						13.0	12.4	96%	12.1	93%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7-L	LKD	32.0	29.0	3.1	9.6%												
		W7-U																	
		W8-L		9.8	7.7	2.1	21.1%												
		W8-U						39.5	29.4	74%	28.2	71%	1.2	4.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W9-L	Bedroom	16.9	14.2	2.7	16.2%												
		W9-U						13.6	12.9	95%	12.1	89%	0.8	6.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R7	W10-L	Studio	16.1	13.6	2.5	15.8%												
		W10-U						37.2	18.1	49%	17.3	46%	0.8	4.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L	LKD	37.9	37.9	0.0	0.0%												
		W1-U																	
		W2-L		37.9	37.9	0.0	0.0%												
		W2-U																	
		W3-L		19.9	17.4	2.5	12.4%												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Fifth	R2	W4-L	Bedroom	33.6	30.7	2.8	8.5%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L	Bedroom	34.2	31.3	2.9	8.5%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W6-L	Bedroom	33.8	30.8	3.0	8.9%													
		W6-U						13.0	12.4	96%	12.1	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7-L	LKD	33.1	30.0	3.1	9.4%													
		W7-U																		
		W8-L		10.3	8.1	2.2	21.3%													
		W8-U						39.5	31.4	80%	30.9	78%	0.5	1.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W9-L	Bedroom	18.4	15.6	2.8	15.0%													
		W9-U						13.6	12.9	95%	12.1	89%	0.8	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10-L	Studio	17.6	15.0	2.6	14.6%													
		W10-U						37.2	19.4	52%	18.8	50%	0.6	3.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1-L	LKD	38.2	38.2	0.0	0.0%													
		W1-U																		
		W2-L		38.2	38.2	0.0	0.0%													
		W2-U																		
		W3-L		20.5	17.8	2.6	12.8%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	52	16	52	16	0.0%	0.0%
Sixth	R2	W4-L	Bedroom	34.0	31.1	2.9	8.4%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W5-L	Bedroom	34.7	31.8	2.9	8.4%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W6-L	Bedroom	34.4	31.4	3.0	8.8%													
		W6-U						13.0	12.4	96%	12.1	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7-L	LKD	33.8	30.7	3.1	9.3%													
		W7-U																		
		W8-L		10.9	8.6	2.4	21.5%													
		W8-U						39.5	32.0	81%	32.4	82%	-0.3	-1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W9-L	Bedroom	19.9	17.1	2.8	14.1%													
		W9-U						13.6	12.9	95%	12.1	89%	0.8	6.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10-L	Studio	19.3	16.7	2.6	13.5%													
		W10-U						37.2	20.2	54%	19.5	52%	0.8	3.8%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	38.9	38.9	0.0	0.0%													
		W1-U																		
		W2-L		38.9	38.9	0.0	0.0%													
		W2-U																		
		W3-L		21.0	18.3	2.7	12.9%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	56	18	56	18	0.0%	0.0%
Seventh	R2	W4-L	Bedroom	34.9	31.9	2.9	8.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W5-L	Bedroom	35.7	32.7	3.0	8.3%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R4	W6-L	Bedroom	35.6	32.5	3.1	8.7%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R5	W7-L	LKD	35.0	31.8	3.2	9.0%													
		W7-U																		
		W8-L		12.0	9.5	2.5	20.8%													
		W8-U						39.5	32.6	82%	32.9	83%	-0.3	-1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W9-L	Bedroom	21.8	19.0	2.8	12.9%													
		W9-U						13.6	13.0	96%	12.3	90%	0.8	5.8%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R7	W10-L	Studio	21.4	18.7	2.6	12.4%													
		W10-U						37.2	21.4	57%	20.5	55%	0.9	4.1%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R1	W1-L	LKD	39.0	39.0	0.0	0.0%													
		W1-U																		
		W2-L		39.0	39.0	0.0	0.0%													
		W2-U																		
		W3-L		21.5	18.7	2.8	13.0%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	56	18	56	18	0.0%	0.0%
Eighth	R2	W4-L	Bedroom	35.4	32.4	2.9	8.3%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R3	W5-L	Bedroom	36.2	33.2	3.0	8.3%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R4	W6-L	Bedroom	36.3	33.1	3.1	8.6%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W7-L	LKD	35.9	32.7	3.2	9.0%													
		W7-U																		
		W8-L		13.7	11.0	2.7	19.7%													
		W8-U						39.5	33.0	83%	33.1	84%	-0.1	-0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R6	W9-L	Bedroom	23.7	20.8	2.8	12.0%													
		W9-U						13.6	13.1	96%	12.3	91%	0.7	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W10-L	Studio	23.6	20.9	2.7	11.4%													
		W10-U						37.2	23.1	62%	22.2	60%	0.9	3.9%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R1	W1-L	LKD	39.1	39.1	0.0	0.0%													
		W1-U																		
		W2-L		39.1	39.1	0.0	0.0%													
		W2-U																		
		W3-L		22.0	19.2	2.8	12.8%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	55	18	55	18	0.0%	0.0%
Ninth	R2	W4-L	Bedroom	35.9	32.9	2.9	8.2%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W5-L	Bedroom	36.8	33.8	3.0	8.2%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W6-L	Bedroom	36.9	33.7	3.2	8.6%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W7-L	LKD	36.6	33.4	3.3	8.9%													
		W7-U																		
		W8-L		15.1	12.3	2.8	18.6%													
		W8-U						39.5	33.4	85%	33.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W9-L	Bedroom	25.6	22.7	2.9	11.2%													
		W9-U						13.6	13.1	96%	12.3	91%	0.7	5.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W10-L	LKD	7.2	5.5	1.7	23.8%													
		W10-U						30.3	23.0	76%	21.2	70%	1.8	7.7%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R1	W1-L	LKD	39.1	39.1	0.0	0.0%													
		W1-U																		
		W2-L		39.1	39.1	0.0	0.0%													
		W2-U																		
		W3-L		22.4	19.6	2.8	12.4%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	55	18	55	18	0.0%	0.0%
Tenth	R2	W4-L	Bedroom	36.3	33.4	2.9	8.1%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R3	W5-L	Bedroom	37.2	34.2	3.0	8.1%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W6-L	Bedroom	37.4	34.3	3.2	8.5%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R5	W7-L	LKD	37.2	34.0	3.3	8.7%													
		W7-U																		
		W8-L		16.4	13.5	2.9	17.7%													
		W8-U						39.5	35.8	91%	35.8	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R6	W9-L	Bedroom	27.3	24.4	2.9	10.5%													
		W9-U						13.6	13.1	96%	12.4	91%	0.7	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R7	W10-L	LKD	9.0	7.2	1.8	20.1%													
		W10-U						30.3	24.4	80%	22.6	74%	1.8	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W1-L	LKD	39.1	39.1	0.0	0.0%													
		W1-U																		
		W2-L		39.1	39.1	0.0	0.0%													
		W2-U																		
		W3-L		22.8	20.0	2.8	12.1%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	54	17	54	17	0.0%	0.0%
Eleventh	R2	W4-L	Bedroom	36.6	33.7	2.9	7.9%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R3	W5-L	Bedroom	37.6	34.6	3.0	7.9%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R4	W6-L	Bedroom	37.8	34.7	3.1	8.2%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W7-L	LKD	37.6	34.4	3.2	8.6%													
		W7-U																		
		W8-L		17.1	14.2	2.9	16.9%													
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W9-L	Bedroom	28.0	25.2	2.8	10.0%													
		W9-U						13.6	13.1	96%	12.4	91%	0.7	5.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W10-L	LKD	9.6	7.8	1.8	19.0%													
		W10-U						30.3	24.5	81%	22.7	75%	1.8	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W1-L	LKD	38.7	38.7	0.0	0.0%													
		W1-U																		
		W2-L		38.7	38.7	0.0	0.0%													
		W2-U																		
		W3-L		22.9	20.3	2.6	11.3%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	53	16	53	16	0.0%	0.0%
Twelfth	R2	W4-L	Bedroom	36.6	33.9	2.7	7.4%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W5-L	Bedroom	37.5	34.7	2.8	7.4%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W6-L	Bedroom	37.7	34.8	2.9	7.8%													
		W6-U						13.0	12.5	96%	12.2	94%	0.3	2.1%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W7-L	LKD	37.5	34.5	3.0	8.0%													
		W7-U																		
		W8-L		17.4	14.7	2.7	15.6%													
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W9-L	Bedroom	28.3	25.7	2.6	9.3%													
		W9-U						13.6	13.1	96%	12.4	91%	0.7	5.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W10-L	LKD	9.5	7.7	1.7	18.2%													
		W10-U						30.3	24.5	81%	22.7	75%	1.8	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%													
		W1-U																		
		W2-L		39.3	39.3	0.0	0.0%													
		W2-U																		
		W3-L		23.2	20.8	2.4	10.5%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	56	18	56	18	0.0%	0.0%
Thirteenth	R2	W4-L	Bedroom	37.1	34.6	2.5	6.8%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W5-L	Bedroom	38.1	35.5	2.6	6.9%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R4	W6-L	Bedroom	38.3	35.6	2.7	7.2%													
		W6-U						13.0	12.5	96%	12.2	94%	0.2	1.9%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R5	W7-L	LKD	38.0	35.2	2.8	7.4%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL m^2	Existing NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Existing APSH Total	Existing APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W7-U																	
		W8-L		17.9	15.3	2.5	14.2%												
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W9-L	Bedroom	29.2	26.8	2.5	8.4%												
		W9-U						13.6	13.1	96%	12.5	92%	0.6	4.6%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R7	W10-L	LKD	10.3	8.7	1.6	15.5%												
		W10-U						30.3	24.6	81%	22.8	75%	1.7	7.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%												
		W1-U																	
		W2-L		39.3	39.3	0.0	0.0%												
		W2-U																	
		W3-L		23.4	21.1	2.3	9.7%												
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	56	18	56	18	0.0%	0.0%
Fourteenth	R2	W4-L	Bedroom	37.3	35.0	2.4	6.3%												
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R3	W5-L	Bedroom	38.3	35.9	2.4	6.3%												
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R4	W6-L	Bedroom	38.5	36.0	2.5	6.6%												
		W6-U						13.0	12.5	96%	12.3	94%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R5	W7-L	LKD	38.3	35.6	2.6	6.8%												
		W7-U																	
		W8-L		18.2	15.8	2.4	12.9%												
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R6	W9-L	Bedroom	29.8	27.5	2.3	7.7%												
		W9-U						13.6	13.1	96%	12.5	92%	0.5	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourteenth	R7	W10-L	LKD	10.6	9.1	1.5	14.1%												
		W10-U						30.3	24.6	81%	22.9	76%	1.7	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%												
		W1-U																	
		W2-L		39.3	39.3	0.0	0.0%												
		W2-U																	
		W3-L		23.5	21.4	2.1	8.9%												
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	55	18	55	18	0.0%	0.0%
Fifteenth	R2	W4-L	Bedroom	37.6	35.5	2.2	5.7%												
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R3	W5-L	Bedroom	38.6	36.4	2.2	5.8%												
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R4	W6-L	Bedroom	38.7	36.4	2.3	6.0%												
		W6-U						13.0	12.5	96%	12.3	95%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R5	W7-L	LKD	38.5	36.1	2.4	6.2%												
		W7-U																	
		W8-L		18.5	16.3	2.2	11.7%												
		W8-U						39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Fifteenth	R6	W9-L	Bedroom	30.4	28.3	2.1	6.9%													
		W9-U						13.6	13.1	96%	12.7	93%	0.4	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifteenth	R7	W10-L	LKD	10.8	9.5	1.4	12.6%													
		W10-U						30.3	24.7	81%	23.0	76%	1.7	6.8%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R1	W1-L	LKD	39.4	39.4	0.0	0.0%													
		W1-U																		
		W2-L		39.4	39.4	0.0	0.0%													
		W2-U																		
		W3-L		23.6	21.7	1.9	8.1%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	55	18	55	18	0.0%	0.0%
Sixteenth	R2	W4-L	Bedroom	38.3	36.3	2.0	5.1%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R3	W5-L	Bedroom	38.8	36.8	2.0	5.2%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R4	W6-L	Bedroom	38.9	36.8	2.1	5.5%													
		W6-U						13.0	12.5	96%	12.4	95%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R5	W7-L	LKD	38.7	36.5	2.2	5.7%													
		W7-U																		
		W8-L		18.8	16.8	2.0	10.5%													
		W8-U						39.5	36.0	91%	36.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R6	W9-L	Bedroom	31.8	29.9	1.9	6.0%													
		W9-U						13.6	13.1	96%	12.9	95%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixteenth	R7	W10-L	LKD	11.0	9.8	1.2	11.2%													
		W10-U						30.3	24.7	81%	23.1	76%	1.6	6.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%													
		W1-U																		
		W2-L		39.3	39.3	0.0	0.0%													
		W2-U																		
		W3-L		39.1	37.4	1.7	4.4%													
		W3-U						38.0	32.8	86%	32.8	86%	0.0	0.0%	53	16	53	16	0.0%	0.0%
Seventeenth	R2	W4-L	Bedroom	39.0	37.3	1.8	4.6%													
		W4-U						12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R3	W5-L	Bedroom	39.0	37.2	1.8	4.7%													
		W5-U						12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R4	W6-L	Bedroom	39.0	37.1	1.9	4.9%													
		W6-U						13.0	12.5	96%	12.4	96%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R5	W7-L	LKD	39.0	37.0	2.0	5.1%													
		W7-U																		
		W8-L		34.9	33.1	1.8	5.1%													
		W8-U						39.5	36.0	91%	36.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventeenth	R6	W9-L	Bedroom	34.2	32.5	1.7	5.0%													
		W9-U						13.6	13.1	96%	13.0	96%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
									m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Seventeenth	R7	W10-L W10-U	LKD	11.2	10.1	1.1	10.0%	30.3	24.7	81%	23.3	77%	1.4	5.7%	N/F	N/F	N/F	N/F	N/F	N/F

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 6

Results of the mirrored assessment for Rosa Luxemburg Apartments



2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
dla-design_2026-07-03_pre-design-freeze-pack-of-information-to-team_2026-07-03_1904
Received 06/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key
- Proposed Development
- Mirrored Building
- Cumulative Development
- Surrounding Context
- Mirrored line

Project: Ashley Road
Tottenham Hale

Title: Mirrored baseline
Plan View

Drawn	JG	Checked	--
Date	10/07/2026	Project	10106
Rel no.	Prefix	Page no.	
06	DS03		01

eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)



eb7 © copyright 2026

Note: All heights are shown in meters Above Ordnance Datum (AOD)

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
dla-design_2026-07-03_pre-design-freeze-pack-of-information-to-team_2026-07-03_1904
Received 06/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Key
- Proposed Development
- Mirrored Building
- Cumulative Development
- Surrounding Context
- Mirrored line

Project: Ashley Road
Tottenham Hale

Title: Mirrored baseline
3D View

Drawn	JG	Checked	--
Date	10/07/2026	Project	10106

Rel no.	Prefix	Page no.
06	DS03	02

Daylight and Sunlight Analysis
(Mirror Rosa Luxemburg Apartments vs Proposed Development)

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Mirror VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Mirror NSL m^2	Mirror NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Mirror APSH Total	Mirror APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Rosa Luxemburg Apartments																			
Ground	R9	W40	LKD	25.1	14.5	10.6	42.2%												
		W41		26.3	16.6	9.7	36.8%	34.3	31.5	92%	25.8	75%	5.6	17.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1	Bedroom	8.2	9.8	-1.6	-19.7%	15.6	4.9	31%	4.1	26%	0.8	16.1%	0	0	0	0	0.0%	0.0%
First	R2	W2	Bedroom	9.3	11.1	-1.8	-19.8%	9.9	4.5	45%	3.7	38%	0.8	17.0%	0	0	0	0	0.0%	0.0%
First	R3	W3	LKD	9.7	11.3	-1.6	-16.4%													
		W4		6.4	7.9	-1.4	-21.9%													
		W5		5.6	6.5	-1.0	-17.2%													
		W6		4.3	4.8	-0.5	-11.1%	28.8	22.9	79%	12.3	43%	10.6	46.3%	0	0	0	0	0.0%	0.0%
First	R4	W7	Bedroom	3.8	4.0	-0.2	-4.7%	13.7	1.3	9%	1.4	10%	-0.1	-9.8%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W8	LKD	4.6	4.8	-0.2	-4.1%													
		W9		11.1	13.0	-2.0	-17.9%	34.8	11.3	33%	7.4	21%	3.9	34.7%	0	0	0	0	0.0%	0.0%
First	R6	W10	Bedroom	9.4	11.9	-2.5	-26.3%	13.1	3.9	30%	3.7	28%	0.2	6.3%	0	0	0	0	0.0%	0.0%
First	R7	W11	Bedroom	0.4	0.9	-0.5	-150.0%	12.8	1.2	9%	0.5	4%	0.6	54.0%	2	1	3	0	-50.0%	100.0%
First	R8	W12	Bedroom	5.2	6.9	-1.7	-33.5%	17.2	3.1	18%	4.5	26%	-1.3	-43.0%	12	0	17	1	-41.7%	0.0%
First	R9	W13	Bedroom	9.9	10.9	-1.0	-10.2%	14.5	7.2	50%	8.1	56%	-0.9	-13.1%	0	0	0	0	0.0%	0.0%
First	R10	W14	Bedroom	11.1	12.0	-0.9	-8.5%	13.5	5.9	43%	5.9	43%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R11	W15	LKD	2.1	2.7	-0.6	-29.4%	29.0	25.8	89%	25.8	89%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R12	W16	LKD	18.0	11.0	7.0	38.7%	27.2	26.8	99%	25.4	93%	1.5	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1	LKD	10.7	10.7	0.0	0.0%													
		W2		10.9	9.8	1.1	10.4%													
		W3		10.7	11.5	-0.8	-7.9%	26.9	26.0	97%	26.0	97%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Second	R2	W4	Bedroom	9.7	10.2	-0.5	-5.0%	8.4	2.2	27%	2.1	25%	0.1	4.4%	0	0	0	0	0.0%	0.0%
Second	R3	W5	Bedroom	8.9	9.5	-0.6	-6.7%	12.0	2.9	24%	2.8	23%	0.2	5.3%	0	0	0	0	0.0%	0.0%
Second	R4	W6	LKD	8.7	10.0	-1.3	-15.5%													
		W7		0.2	0.7	-0.5	-331.3%													
		W8		11.1	12.7	-1.6	-14.8%	23.3	9.9	42%	17.1	73%	-7.3	-73.6%	0	0	0	0	0.0%	0.0%
Second	R5	W9	Bedroom	9.8	11.2	-1.3	-13.6%	12.9	6.4	50%	7.3	56%	-0.8	-13.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10	Bedroom	9.6	11.7	-2.1	-21.5%	14.5	5.9	41%	5.7	40%	0.1	2.3%	0	0	0	0	0.0%	0.0%
Second	R7	W11	Bedroom	10.9	13.4	-2.5	-22.4%	9.1	4.8	53%	5.2	57%	-0.4	-8.5%	0	0	0	0	0.0%	0.0%
Second	R8	W12	LKD	11.9	14.0	-2.1	-17.9%													
		W13		1.0	0.4	0.6	62.1%													
		W14		5.7	6.3	-0.6	-9.6%	27.3	22.0	81%	14.4	53%	7.6	34.6%	0	0	0	0	0.0%	0.0%
Second	R9	W15	Bedroom	4.7	4.8	-0.1	-2.8%	14.0	1.4	10%	1.9	14%	-0.5	-32.7%	N/F	N/F	N/F	N/F	N/F	N/F

Daylight and Sunlight Analysis
(Mirror Rosa Luxemburg Apartments vs Proposed Development)

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Mirror	Proposed	Loss	Loss	Room	Mirror NSL		Proposed NSL		Loss	Loss	Mirror APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m^2	%	m^2	%	m^2	%	Total	Winter	Total	Winter	Total	Winter
Second	R10	W16	Bedroom	5.7	5.9	-0.2	-3.5%	13.0	2.3	17%	2.3	18%	-0.1	-2.7%	0	0	0	0	0.0%	0.0%
Second	R11	W17	LKD	7.3	7.8	-0.5	-6.1%													
		W18		2.1	3.7	-1.6	-78.5%													
		W19		12.2	15.2	-3.0	-24.3%	23.4	16.3	70%	15.1	64%	1.2	7.4%	0	0	0	0	0.0%	0.0%
Second	R12	W20	LKD	1.1	3.3	-2.2	-198.2%	22.9	4.7	20%	4.9	21%	-0.2	-4.7%	0	0	0	0	0.0%	0.0%
Second	R13	W21	Bedroom	6.3	8.6	-2.3	-36.4%	15.3	4.0	26%	6.4	42%	-2.4	-61.1%	0	0	0	0	0.0%	0.0%
Second	R14	W22	Bedroom	11.1	12.2	-1.1	-9.5%	14.5	8.1	56%	9.2	64%	-1.1	-13.9%	0	0	0	0	0.0%	0.0%
Second	R15	W23	Bedroom	12.5	13.6	-1.2	-9.3%	13.5	6.1	45%	6.1	45%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Second	R16	W24	LKD	2.8	3.7	-0.9	-33.6%	29.0	26.0	89%	26.4	91%	-0.4	-1.5%	0	0	0	0	0.0%	0.0%
Second	R17	W25	LKD	18.7	11.5	7.2	38.5%	27.2	26.8	99%	25.4	93%	1.5	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1	LKD	11.6	11.6	0.0	0.0%													
		W2		12.0	10.7	1.3	11.2%													
		W3		12.2	14.0	-1.8	-14.5%	26.9	26.1	97%	26.1	97%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Third	R2	W4	Bedroom	11.3	12.9	-1.6	-13.7%	8.4	2.5	29%	2.8	34%	-0.4	-15.1%	0	0	0	0	0.0%	0.0%
Third	R3	W5	Bedroom	10.6	12.1	-1.6	-14.7%	12.0	3.6	30%	3.5	29%	0.1	3.2%	0	0	0	0	0.0%	0.0%
Third	R4	W6	LKD	10.5	13.0	-2.5	-23.4%													
		W7		0.3	2.1	-1.8	-529.4%													
		W8		13.2	14.8	-1.6	-12.1%	23.3	13.3	57%	20.1	86%	-6.8	-51.3%	0	0	0	0	0.0%	0.0%
Third	R5	W9	Bedroom	11.5	12.8	-1.3	-11.1%	12.9	7.5	58%	8.2	64%	-0.7	-9.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10	Bedroom	11.4	13.9	-2.6	-22.6%	14.5	7.6	52%	8.9	61%	-1.3	-16.8%	0	0	0	0	0.0%	0.0%
Third	R7	W11	Bedroom	13.0	15.9	-2.9	-22.2%	9.1	5.4	60%	7.5	83%	-2.1	-38.5%	0	0	0	0	0.0%	0.0%
Third	R8	W12	LKD	14.2	16.7	-2.5	-17.8%													
		W13		1.4	2.1	-0.7	-52.1%													
		W14		7.0	7.6	-0.6	-8.0%	27.3	23.1	84%	20.4	75%	2.7	11.5%	0	0	0	0	0.0%	0.0%
Third	R9	W15	Bedroom	5.9	5.9	0.0	0.0%	14.0	1.9	14%	2.2	16%	-0.3	-14.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16	Bedroom	7.5	7.6	-0.1	-1.7%	13.0	2.8	21%	2.8	22%	0.0	-0.2%	0	0	0	0	0.0%	0.0%
Third	R11	W17	LKD	9.3	9.7	-0.4	-4.4%													
		W18		2.9	5.8	-2.9	-101.4%													
		W19		14.2	18.0	-3.8	-26.4%	23.4	17.5	75%	19.8	85%	-2.3	-13.1%	0	0	0	0	0.0%	0.0%
Third	R12	W20	LKD	1.8	5.4	-3.7	-205.1%	22.9	5.4	24%	8.3	36%	-2.9	-52.5%	0	0	0	0	0.0%	0.0%
Third	R13	W21	Bedroom	7.4	10.4	-3.0	-40.9%	15.3	5.2	34%	9.5	62%	-4.3	-84.2%	0	0	0	0	0.0%	0.0%
Third	R14	W22	Bedroom	12.4	13.5	-1.1	-9.1%	14.5	9.0	62%	10.2	70%	-1.2	-13.4%	0	0	0	0	0.0%	0.0%
Third	R15	W23	Bedroom	14.0	15.1	-1.1	-7.9%	13.5	6.6	49%	6.6	49%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Third	R16	W24	LKD	3.8	4.9	-1.1	-27.8%	29.0	26.4	91%	26.7	92%	-0.3	-1.1%	0	0	0	0	0.0%	0.0%

10106 - Ashley House
R06 - Mirr vs Pr

Daylight and Sunlight Analysis
(Mirror Rosa Luxemburg Apartments vs Proposed Development)

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Mirror VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Mirror NSL m^2	Mirror NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Mirror APSH Total	Mirror APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Third	R17	W25	LKD	18.9	11.9	6.9	36.8%	27.2	26.8	99%	25.5	94%	1.4	5.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1	LKD	12.3	12.3	0.0	0.0%													
		W2		14.0	12.5	1.4	10.2%													
		W3		14.5	17.4	-2.9	-20.0%	29.5	27.2	92%	27.2	92%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fourth	R2	W4	Bedroom	13.7	17.1	-3.5	-25.6%	12.2	4.1	34%	5.4	45%	-1.3	-31.6%	0	0	0	0	0.0%	0.0%
Fourth	R3	W5	Bedroom	13.1	16.3	-3.2	-24.4%	12.6	2.9	23%	4.6	37%	-1.8	-61.2%	0	0	0	0	0.0%	0.0%
Fourth	R4	W6	LKD	13.2	17.6	-4.4	-33.2%													
		W7		0.8	4.3	-3.5	-450.0%													
		W8		15.5	17.0	-1.4	-9.3%	23.3	18.0	77%	21.4	92%	-3.4	-19.1%	0	0	0	0	0.0%	0.0%
Fourth	R5	W9	Bedroom	13.4	14.4	-1.1	-7.9%	12.9	8.9	69%	9.1	71%	-0.3	-3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W10	Bedroom	13.3	15.9	-2.5	-19.0%	14.5	10.1	70%	12.9	89%	-2.8	-27.2%	0	0	0	0	0.0%	0.0%
Fourth	R7	W11	Bedroom	15.3	18.0	-2.6	-17.1%	9.1	6.3	69%	8.3	91%	-2.0	-31.2%	0	0	0	0	0.0%	0.0%
Fourth	R8	W12	LKD	16.9	19.0	-2.1	-12.4%													
		W13		2.4	4.3	-2.0	-83.4%													
		W14		9.0	9.5	-0.5	-6.0%	27.3	24.8	91%	26.9	98%	-2.1	-8.5%	0	0	0	0	0.0%	0.0%
Fourth	R9	W15	Bedroom	7.7	7.6	0.2	2.2%	14.0	2.9	21%	2.5	18%	0.4	14.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W16	Bedroom	9.9	9.9	-0.1	-0.5%	13.0	4.1	32%	4.1	32%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fourth	R11	W17	LKD	11.9	12.2	-0.3	-2.6%													
		W18		4.4	7.6	-3.3	-74.2%													
		W19		16.5	20.5	-4.0	-24.3%	23.4	19.3	83%	22.9	98%	-3.6	-18.6%	0	0	0	0	0.0%	0.0%
Fourth	R12	W20	LKD	2.6	7.3	-4.7	-182.5%	22.9	6.7	29%	18.2	80%	-11.5	-171.2%	0	0	0	0	0.0%	0.0%
Fourth	R13	W21	Bedroom	8.8	12.8	-4.1	-46.3%	15.3	6.7	43%	12.9	84%	-6.3	-94.3%	0	0	0	0	0.0%	0.0%
Fourth	R14	W22	Bedroom	13.8	15.1	-1.3	-9.3%	14.5	10.3	71%	11.0	76%	-0.7	-7.3%	0	0	0	0	0.0%	0.0%
Fourth	R15	W23	Bedroom	15.7	16.8	-1.1	-7.1%	13.5	7.4	55%	7.4	55%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fourth	R16	W24	LKD	5.1	6.7	-1.5	-30.0%	29.0	27.3	94%	27.6	95%	-0.3	-1.0%	0	0	0	0	0.0%	0.0%
Fourth	R17	W25	LKD	19.0	14.0	5.0	26.2%	27.2	26.8	99%	26.1	96%	0.8	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1	LKD	12.9	12.9	0.0	-0.2%													
		W2		14.6	13.2	1.4	9.3%													
		W3		17.4	22.4	-5.0	-28.8%	29.5	27.4	93%	27.8	94%	-0.3	-1.2%	0	0	0	0	0.0%	0.0%
Fifth	R2	W4	Bedroom	16.8	22.3	-5.5	-32.7%	12.2	4.8	39%	8.6	70%	-3.8	-78.7%	0	0	0	0	0.0%	0.0%
Fifth	R3	W5	Bedroom	16.6	21.8	-5.2	-31.1%	12.6	3.7	30%	10.0	80%	-6.3	-169.6%	0	0	0	0	0.0%	0.0%
Fifth	R4	W6	LKD	16.8	22.9	-6.2	-36.6%													
		W7		1.6	7.4	-5.7	-354.3%													
		W8		18.5	19.6	-1.1	-6.2%	23.3	20.7	89%	22.1	95%	-1.5	-7.1%	0	0	0	0	0.0%	0.0%

Daylight and Sunlight Analysis
(Mirror Rosa Luxemburg Apartments vs Proposed Development)

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Mirror VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Mirror NSL m^2	Mirror NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Mirror APSH Total	Mirror APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Fifth	R5	W9	Bedroom	15.5	16.2	-0.7	-4.8%	12.9	10.0	77%	9.5	74%	0.5	4.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W10	Bedroom	15.6	17.8	-2.2	-13.9%	14.5	11.5	79%	13.1	90%	-1.6	-14.2%	0	0	0	0	0.0%	0.0%
Fifth	R7	W11	Bedroom	18.0	20.2	-2.2	-12.0%	9.1	7.2	80%	8.6	95%	-1.4	-19.2%	0	0	0	0	0.0%	0.0%
Fifth	R8	W12	LKD	20.0	21.6	-1.6	-8.0%													
		W13		3.6	5.9	-2.2	-60.7%													
		W14		11.8	12.2	-0.4	-3.3%	27.3	26.4	97%	27.0	99%	-0.6	-2.1%	0	0	0	0	0.0%	0.0%
Fifth	R9	W15	Bedroom	10.3	10.0	0.3	2.4%	14.0	3.9	28%	3.4	24%	0.5	13.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W16	Bedroom	13.3	13.3	0.0	-0.1%	13.0	6.4	49%	6.4	49%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fifth	R11	W17	LKD	15.5	15.6	-0.2	-1.2%													
		W18		6.2	9.4	-3.2	-51.0%													
		W19		19.0	23.0	-4.0	-21.3%	23.4	22.0	94%	23.1	99%	-1.1	-5.2%	0	0	0	0	0.0%	0.0%
Fifth	R12	W20	LKD	4.1	8.9	-4.9	-119.7%	22.9	8.6	37%	22.2	97%	-13.6	-159.2%	0	0	0	0	0.0%	0.0%
Fifth	R13	W21	Bedroom	10.5	15.3	-4.8	-45.9%	15.3	7.9	51%	13.4	88%	-5.5	-70.1%	0	0	0	0	0.0%	0.0%
Fifth	R14	W22	Bedroom	15.6	17.0	-1.3	-8.6%	14.5	11.6	80%	11.9	82%	-0.4	-3.2%	0	0	0	0	0.0%	0.0%
Fifth	R15	W23	Bedroom	18.1	19.2	-1.1	-6.0%	13.5	8.5	63%	8.5	63%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fifth	R16	W24	LKD	6.8	8.8	-2.0	-29.2%	29.0	28.2	97%	28.5	98%	-0.3	-1.0%	0	0	0	0	0.0%	0.0%
Fifth	R17	W25	LKD	19.2	16.4	2.8	14.7%	27.2	26.8	99%	26.3	97%	0.6	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1	LKD	14.8	14.9	0.0	-0.3%													
		W2		16.3	15.1	1.3	7.8%													
		W3		21.1	27.0	-6.0	-28.2%	29.5	27.7	94%	28.8	97%	-1.0	-3.7%	0	0	0	0	0.0%	0.0%
Sixth	R2	W4	Bedroom	20.6	27.0	-6.4	-31.2%	12.2	6.6	55%	9.1	75%	-2.5	-37.5%	0	0	0	0	0.0%	0.0%
Sixth	R3	W5	Bedroom	20.5	26.8	-6.3	-30.6%	12.6	5.1	40%	11.9	95%	-6.8	-135.4%	0	0	0	0	0.0%	0.0%
Sixth	R4	W6	LKD	20.9	27.3	-6.4	-30.3%													
		W7		4.5	9.9	-5.4	-118.8%													
		W8		22.0	22.6	-0.6	-2.7%	23.3	21.6	93%	22.5	97%	-1.0	-4.4%	0	0	0	0	0.0%	0.0%
Sixth	R5	W9	Bedroom	18.4	18.5	-0.2	-1.0%	12.9	10.9	84%	9.7	75%	1.2	10.9%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W10	Bedroom	18.2	19.4	-1.2	-6.3%	14.5	12.7	88%	13.2	92%	-0.5	-4.3%	0	0	0	0	0.0%	0.0%
Sixth	R7	W11	Bedroom	21.2	22.3	-1.1	-5.2%	9.1	8.6	95%	8.8	97%	-0.2	-2.4%	0	0	0	0	0.0%	0.0%
Sixth	R8	W12	LKD	24.2	24.8	-0.6	-2.3%													
		W13		22.0	22.4	-0.5	-2.2%													
		W14		15.8	15.8	0.0	0.2%	27.3	27.0	99%	27.1	99%	-0.1	-0.5%	0	0	0	0	0.0%	0.0%
Sixth	R9	W15	Bedroom	14.5	13.9	0.7	4.5%	14.0	5.6	40%	4.7	33%	0.9	15.9%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W16	Bedroom	17.7	17.6	0.1	0.6%	13.0	9.5	74%	9.5	73%	0.1	0.6%	0	0	0	0	0.0%	0.0%
Sixth	R11	W17	LKD	19.4	19.5	-0.1	-0.7%													

10106 - Ashley House
R06 - Mirr vs Pr

Daylight and Sunlight Analysis
(Mirror Rosa Luxemburg Apartments vs Proposed Development)

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Mirror VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Mirror NSL m^2	Mirror NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Mirror APSH Total	Mirror APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
		W18		9.4	11.6	-2.2	-23.6%												
		W19		21.7	25.3	-3.5	-16.3%	23.4	23.1	99%	23.1	99%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Sixth	R12	W20	LKD	7.1	11.1	-4.0	-55.5%	22.9	11.5	50%	22.4	98%	-10.8	-94.0%	0	0	0	0	0.0%	0.0%
Sixth	R13	W21	Bedroom	12.8	17.6	-4.8	-37.4%	15.3	9.3	61%	13.9	90%	-4.5	-48.6%	0	0	0	0	0.0%	0.0%
Sixth	R14	W22	Bedroom	17.6	18.7	-1.1	-6.3%	14.5	12.5	86%	12.7	88%	-0.2	-1.9%	0	0	0	0	0.0%	0.0%
Sixth	R15	W23	Bedroom	20.3	21.7	-1.4	-6.8%	13.5	9.8	73%	9.8	73%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Sixth	R16	W24	LKD	23.3	25.7	-2.4	-10.2%	29.0	28.8	99%	28.9	100%	-0.1	-0.3%	0	0	0	0	0.0%	0.0%
Sixth	R17	W25	LKD	37.8	34.7	3.2	8.4%	27.2	26.9	99%	26.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1	LKD	28.1	28.1	0.0	-0.1%													
		W2		33.0	31.8	1.2	3.6%													
		W3		25.2	29.0	-3.8	-15.1%	29.5	28.4	96%	29.0	98%	-0.6	-2.2%	0	0	0	0	0.0%	0.0%
Seventh	R2	W4	Bedroom	24.5	28.9	-4.4	-18.1%	12.2	8.6	71%	9.2	76%	-0.6	-6.8%	0	0	0	0	0.0%	0.0%
Seventh	R3	W5	Bedroom	24.4	28.6	-4.3	-17.4%	12.6	8.2	65%	12.1	96%	-3.9	-48.2%	0	0	0	0	0.0%	0.0%
Seventh	R4	W6	LKD	25.1	28.5	-3.4	-13.3%													
		W7		8.2	11.5	-3.3	-40.1%													
		W8		26.6	26.3	0.3	1.3%	23.3	22.0	94%	22.6	97%	-0.6	-2.7%	0	0	0	0	0.0%	0.0%
Seventh	R5	W9	Bedroom	23.6	23.0	0.6	2.5%	12.9	11.4	88%	9.8	76%	1.6	14.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10	Bedroom	21.1	21.0	0.2	0.8%	14.0	13.4	96%	13.2	94%	0.2	1.3%	0	0	0	0	0.0%	0.0%
Seventh	R7	W11	LKD	24.6	24.4	0.2	0.8%													
		W12		27.3	26.7	0.5	1.9%													
		W13		25.4	24.9	0.6	2.2%	26.6	26.3	99%	26.3	99%	0.0	-0.1%	0	0	0	0	0.0%	0.0%
Seventh	R8	W14	Bedroom	23.0	22.5	0.6	2.4%	13.0	11.4	87%	11.4	87%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Seventh	R9	W15	LKD	24.3	24.3	-0.1	-0.2%													
		W16		22.2	23.1	-0.9	-4.1%													
		W17		25.0	26.9	-2.0	-7.9%	23.5	23.2	99%	23.2	99%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Seventh	R10	W18	LKD	21.6	23.5	-1.9	-8.6%	23.1	17.0	74%	22.8	99%	-5.8	-34.4%	0	0	0	0	0.0%	0.0%
Seventh	R11	W19	Bedroom	16.8	20.4	-3.6	-21.4%	15.3	12.0	78%	14.3	93%	-2.2	-18.7%	0	0	0	0	0.0%	0.0%
Seventh	R12	W20	Bedroom	22.8	23.7	-0.9	-4.0%													
		W21		19.2	26.9	-7.8	-40.5%	11.5	10.8	94%	10.9	94%	-0.1	-0.9%	0	0	0	0	0.0%	0.0%
Seventh	R13	W22	Bedroom	14.3	21.5	-7.2	-50.4%	12.0	6.6	55%	10.7	89%	-4.1	-62.1%	0	0	0	0	0.0%	0.0%
Seventh	R14	W23	Bedroom	18.0	26.6	-8.6	-47.9%	13.5	6.6	49%	10.6	79%	-4.1	-61.7%	0	0	0	0	0.0%	0.0%
Seventh	R15	W24	LKD	21.1	26.3	-5.2	-24.4%													
		W25		37.9	35.8	2.1	5.5%													
		W26		34.8	33.0	1.8	5.1%	33.5	32.7	98%	33.2	99%	-0.5	-1.6%	0	0	0	0	0.0%	0.0%
Eighth	R1	W1	LKD	34.7	33.3	1.4	4.0%	21.6	21.3	98%	21.3	98%	0.0	0.0%	0	0	0	0	0.0%	0.0%

Daylight and Sunlight Analysis
(Mirror Rosa Luxemburg Apartments vs Proposed Development)

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Mirror VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Mirror NSL m^2	Mirror NSL %	Proposed NSL m^2	Proposed NSL %	Loss m^2	Loss %	Mirror APSH Total	Mirror APSH Winter	Proposed APSH Total	Proposed APSH Winter	% Reduction Total	% Reduction Winter
Eighth	R2	W2	Bedroom	34.6	33.3	1.3	3.8%													
		W3		24.3	25.5	-1.2	-4.8%	13.8	13.8	100%	13.8	100%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R3	W4	Bedroom	29.7	30.0	-0.4	-1.2%	14.2	14.1	99%	14.1	99%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R4	W5	LKD	30.4	29.5	0.9	2.9%													
		W6		29.3	27.9	1.4	4.8%	22.1	22.0	100%	22.0	100%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R5	W7	Bedroom	25.3	24.0	1.3	5.0%	9.3	8.5	91%	8.0	86%	0.5	6.0%	0	0	0	0	0.0%	0.0%
Eighth	R6	W8	LKD	29.2	27.7	1.4	4.9%													
		W9		29.6	28.4	1.3	4.3%													
		W10		29.9	28.8	1.1	3.6%	28.6	28.2	99%	28.2	99%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R7	W11	LKD	17.8	17.1	0.7	3.8%													
		W12		31.9	31.3	0.6	2.0%													
		W13		28.1	28.1	0.0	0.1%	33.8	33.6	100%	33.7	100%	-0.1	-0.2%	0	0	0	0	0.0%	0.0%
Eighth	R8	W14	Bedroom	25.8	25.4	0.4	1.6%	12.5	11.9	95%	11.9	95%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R9	W15	Bedroom	19.4	21.3	-1.9	-9.9%	14.0	12.4	89%	11.9	85%	0.5	4.2%	0	0	0	0	0.0%	0.0%
Eighth	R10	W16	Bedroom	26.0	26.4	-0.4	-1.5%													
		W17		24.6	28.1	-3.6	-14.4%	13.0	11.9	92%	12.2	94%	-0.2	-2.1%	0	0	0	0	0.0%	0.0%
Eighth	R11	W18	Bedroom	24.4	27.9	-3.5	-14.5%	11.4	8.9	78%	10.3	90%	-1.3	-14.8%	0	0	0	0	0.0%	0.0%
Eighth	R12	W19	Bedroom	25.8	26.9	-1.0	-3.9%	8.3	7.9	96%	7.4	89%	0.5	6.7%	0	0	0	0	0.0%	0.0%
Eighth	R13	W20	LKD	28.7	27.7	1.0	3.4%													
		W21		38.8	37.1	1.7	4.5%	28.5	25.8	91%	28.2	99%	-2.4	-9.2%	0	0	0	0	0.0%	0.0%
Ninth	R2	W2	LKD	31.3	30.6	0.7	2.1%													
		W3		34.7	33.7	0.9	2.7%	33.0	30.6	93%	30.6	93%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Ninth	R3	W4	Bedroom	34.8	33.9	0.9	2.5%													
		W5		31.4	29.5	1.9	6.1%	14.6	13.6	93%	13.4	92%	0.2	1.8%	0	0	0	0	0.0%	0.0%
Ninth	R5	W7	Bedroom	24.1	24.3	-0.2	-0.9%	13.8	8.4	60%	6.3	45%	2.1	25.0%	0	0	0	0	0.0%	0.0%
Ninth	R6	W8	Bedroom	30.7	30.8	-0.1	-0.2%													
		W9		30.0	28.6	1.4	4.6%	13.3	12.0	90%	11.5	86%	0.5	4.1%	0	0	0	0	0.0%	0.0%
Ninth	R7	W10	Bedroom	30.2	28.4	1.8	6.1%	11.1	10.8	97%	9.7	87%	1.1	10.2%	0	0	0	0	0.0%	0.0%
Ninth	R8	W11	LKD	32.1	28.3	3.9	12.0%													
		W12		16.6	14.8	1.7	10.5%													
		W13		15.7	15.5	0.2	1.2%	31.6	31.5	100%	31.5	100%	-0.1	-0.2%	0	0	0	0	0.0%	0.0%

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 7

Results of the sunlight amenity assessments



Existing Scenario - March 21st

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key

- Existing Building
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project: Ashley Road
Tottenham Hale

Title: Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn	Checked
TR	--

Date	Project
10/08/2026	10106

Rel no.	Prefix	Page no.
08	SA01	01



Proposed Scenario - March 21st

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key

- Existing Building
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project: Ashley Road
Tottenham Hale

Title: Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn	Checked
TR	--

Date	Project
10/08/2026	10106

Rel no.	Prefix	Page no.
08	SA01	02

Area	Total Area (sq.m)	Existing Scenario Area recieving more than two hours of sun		Proposed Scenario Area recieving more than two hours of sun		Proportion Retained
		(m^2)	%	(m^2)	%	
1 - Playground	1520.76	1520.76	100%	1435.87	94%	0.94
2 - Playground	1614.80	1614.80	100%	1614.80	100%	1.00
3 - Playground	1380.94	1366.53	99%	1366.53	99%	1.00
4 - Playground	1176.81	1176.81	100%	1176.81	100%	1.00
5 - Playground	9586.31	9539.11	100%	9509.85	99%	1.00
6 - 1 Hale Road	27.17	0.00	0%	0.00	0%	1.00
7 - 3 Hale Road	24.85	0.00	0%	0.00	0%	1.00
8 - 5 Hale Road	30.07	0.00	0%	0.00	0%	1.00
9 - 7 Hale Road	31.41	0.00	0%	0.00	0%	1.00
10 - 9 Hale Road	29.21	0.00	0%	0.00	0%	1.00
11 - 11 Hale Road	49.39	0.00	0%	0.00	0%	1.00
12 - 13 Hale Road	32.51	0.00	0%	0.00	0%	1.00
13 - 15 Hale Road	36.20	0.00	0%	0.00	0%	1.00
14 - 17 Hale Road	36.70	0.00	0%	0.00	0%	1.00
15 - 19 Hale Road	35.03	0.00	0%	0.00	0%	1.00
16 - 21 Hale Road	37.88	0.00	0%	0.00	0%	1.00
17 - Rosa Luxemburg Apartments	295.26	229.46	78%	0.00	0%	0.00
18 - The Gessner	761.99	129.35	17%	101.08	13%	0.78
19 - Sessile Apartments	1145.33	13.44	1%	13.44	1%	1.00

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key

- Existing Building
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project: Ashley Road
Tottenham Hale

Title: Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn	Checked
TR	--

Date	Project
10/08/2026	10106

Rel no.	Prefix	Page no.
08	SA01	03

Cumulative Scenario



Existing Scenario - March 21st

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key

- Cumulative Development
- Existing Building
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project: Ashley Road
Tottenham Hale

Title: Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn	Checked
TR	--

Date	Project
10/08/2026	10106

Rel no.	Prefix	Page no.
08	SA02	01



Proposed Scenario - March 21st

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key

- Cumulative Development
- Existing Building
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project: Ashley Road
Tottenham Hale

Title: Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn	TR	Checked	--
Date	10/08/2026	Project	10106

Rel no.	Prefix	Page no.
08	SA02	02

Consented Scenario



Consented Scenario - March 21st

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key

- Consented
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project: Ashley Road
Tottenham Hale

Title: Sunlight Amenity Study
Consented vs Proposed
21st March

Drawn	Checked
TR	--

Date	Project
11/08/2026	10106

Rel no.	Prefix	Page no.
08	SA04	01



Proposed Scenario - March 21st

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key

- Consented
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project: Ashley Road
Tottenham Hale

Title: Sunlight Amenity Study
Consented vs Proposed
21st March

Drawn	TR	Checked	--
Date	11/08/2026	Project	10106

Rel no.	Prefix	Page no.
08	SA04	02

Area	Total Area (sq.m)	Existing Scenario Area recieving more than two hours of sun		Proposed Scenario Area recieving more than two hours of sun		Proportion Retained
		(m^2)	%	(m^2)	%	
1 - Playground	1520.76	1472.75	97%	1436.38	94%	0.98
2 - Playground	1614.80	1614.80	100%	1614.80	100%	1.00
3 - Playground	1380.94	1366.53	99%	1366.53	99%	1.00
4 - Playground	1176.81	1176.81	100%	1176.81	100%	1.00
5 - Playground	9586.31	9531.54	99%	9508.35	99%	1.00
6 - 1 Hale Road	27.17	0.00	0%	0.00	0%	1.00
7 - 3 Hale Road	24.85	0.00	0%	0.00	0%	1.00
8 - 5 Hale Road	30.07	0.00	0%	0.00	0%	1.00
9 - 7 Hale Road	31.41	0.00	0%	0.00	0%	1.00
10 - 9 Hale Road	29.21	0.00	0%	0.00	0%	1.00
11 - 11 Hale Road	49.39	0.00	0%	0.00	0%	1.00
12 - 13 Hale Road	32.51	0.00	0%	0.00	0%	1.00
13 - 15 Hale Road	36.20	0.00	0%	0.00	0%	1.00
14 - 17 Hale Road	36.70	0.00	0%	0.00	0%	1.00
15 - 19 Hale Road	35.03	0.00	0%	0.00	0%	1.00
16 - 21 Hale Road	37.88	0.00	0%	0.00	0%	1.00
17 - Rosa Luxemburg Apartments	295.26	0.00	0%	0.00	0%	0.00
18 - The Gessner	761.99	129.35	17%	101.08	13%	0.78
19 - Sessile Apartments	1145.33	13.44	1%	13.44	1%	1.00

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Key

- Consented
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project: Ashley Road
Tottenham Hale


Title: Sunlight Amenity Study
Consented vs Proposed
21st March

Drawn: TR | Checked: --

Date: 11/08/2026 | Project: 10106

Rel no.: 08 | Prefix: SA04 | Page no.: 03

Solar Radiation Assessment to Solar Panels

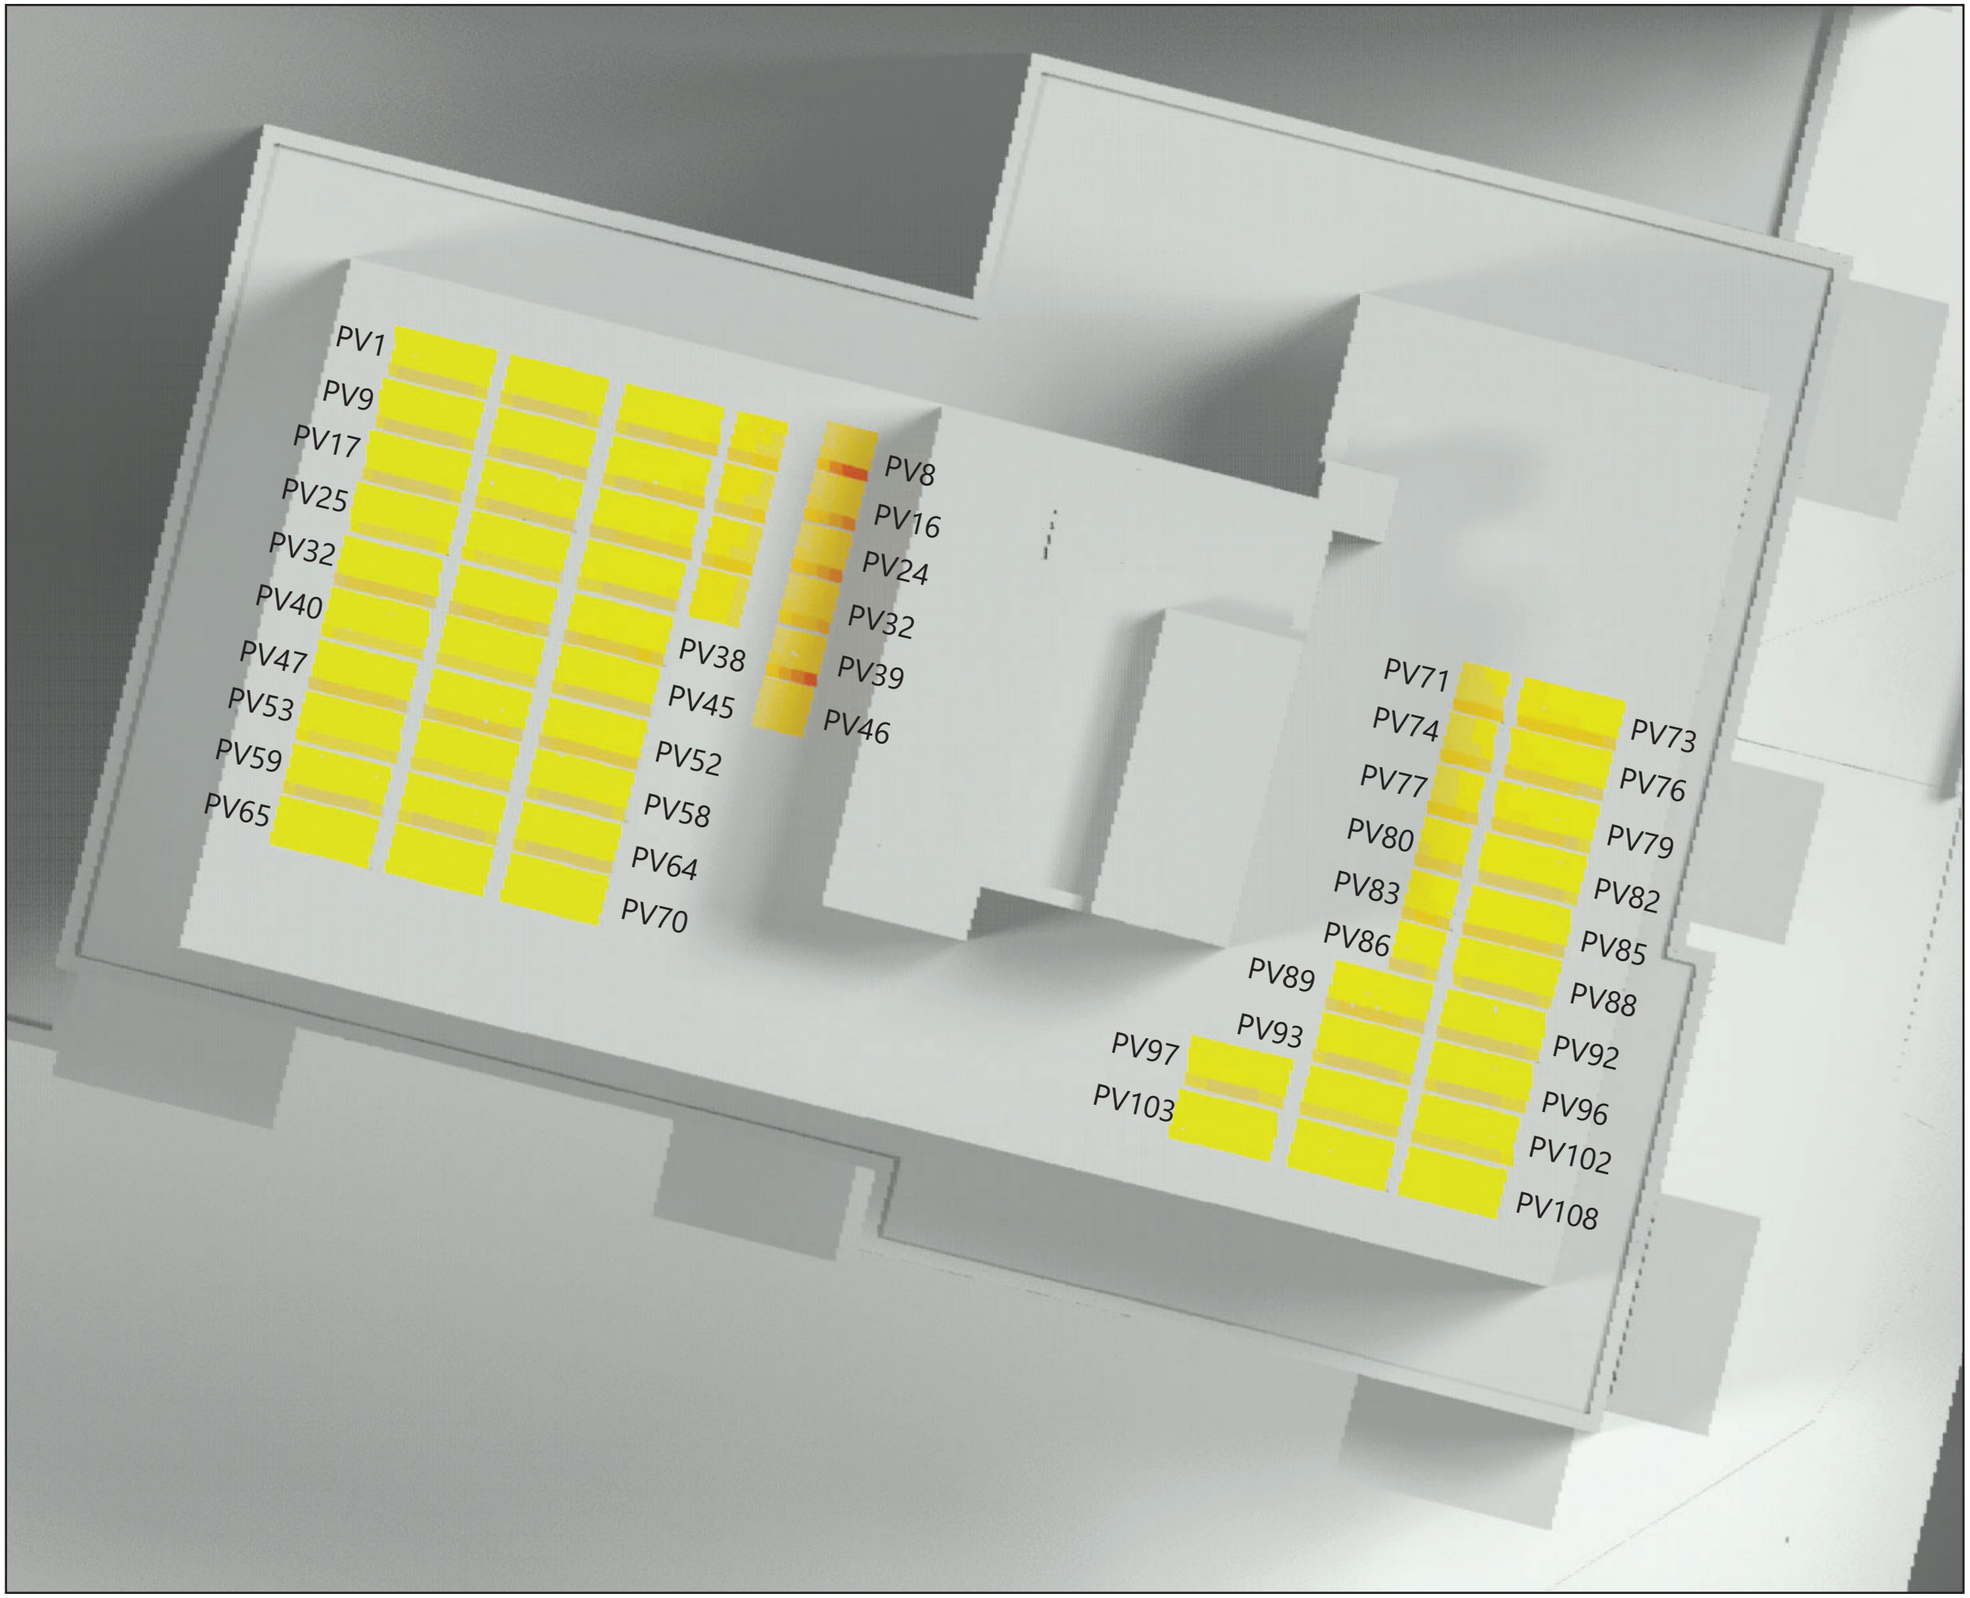

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Sessile Apartments
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV01	01

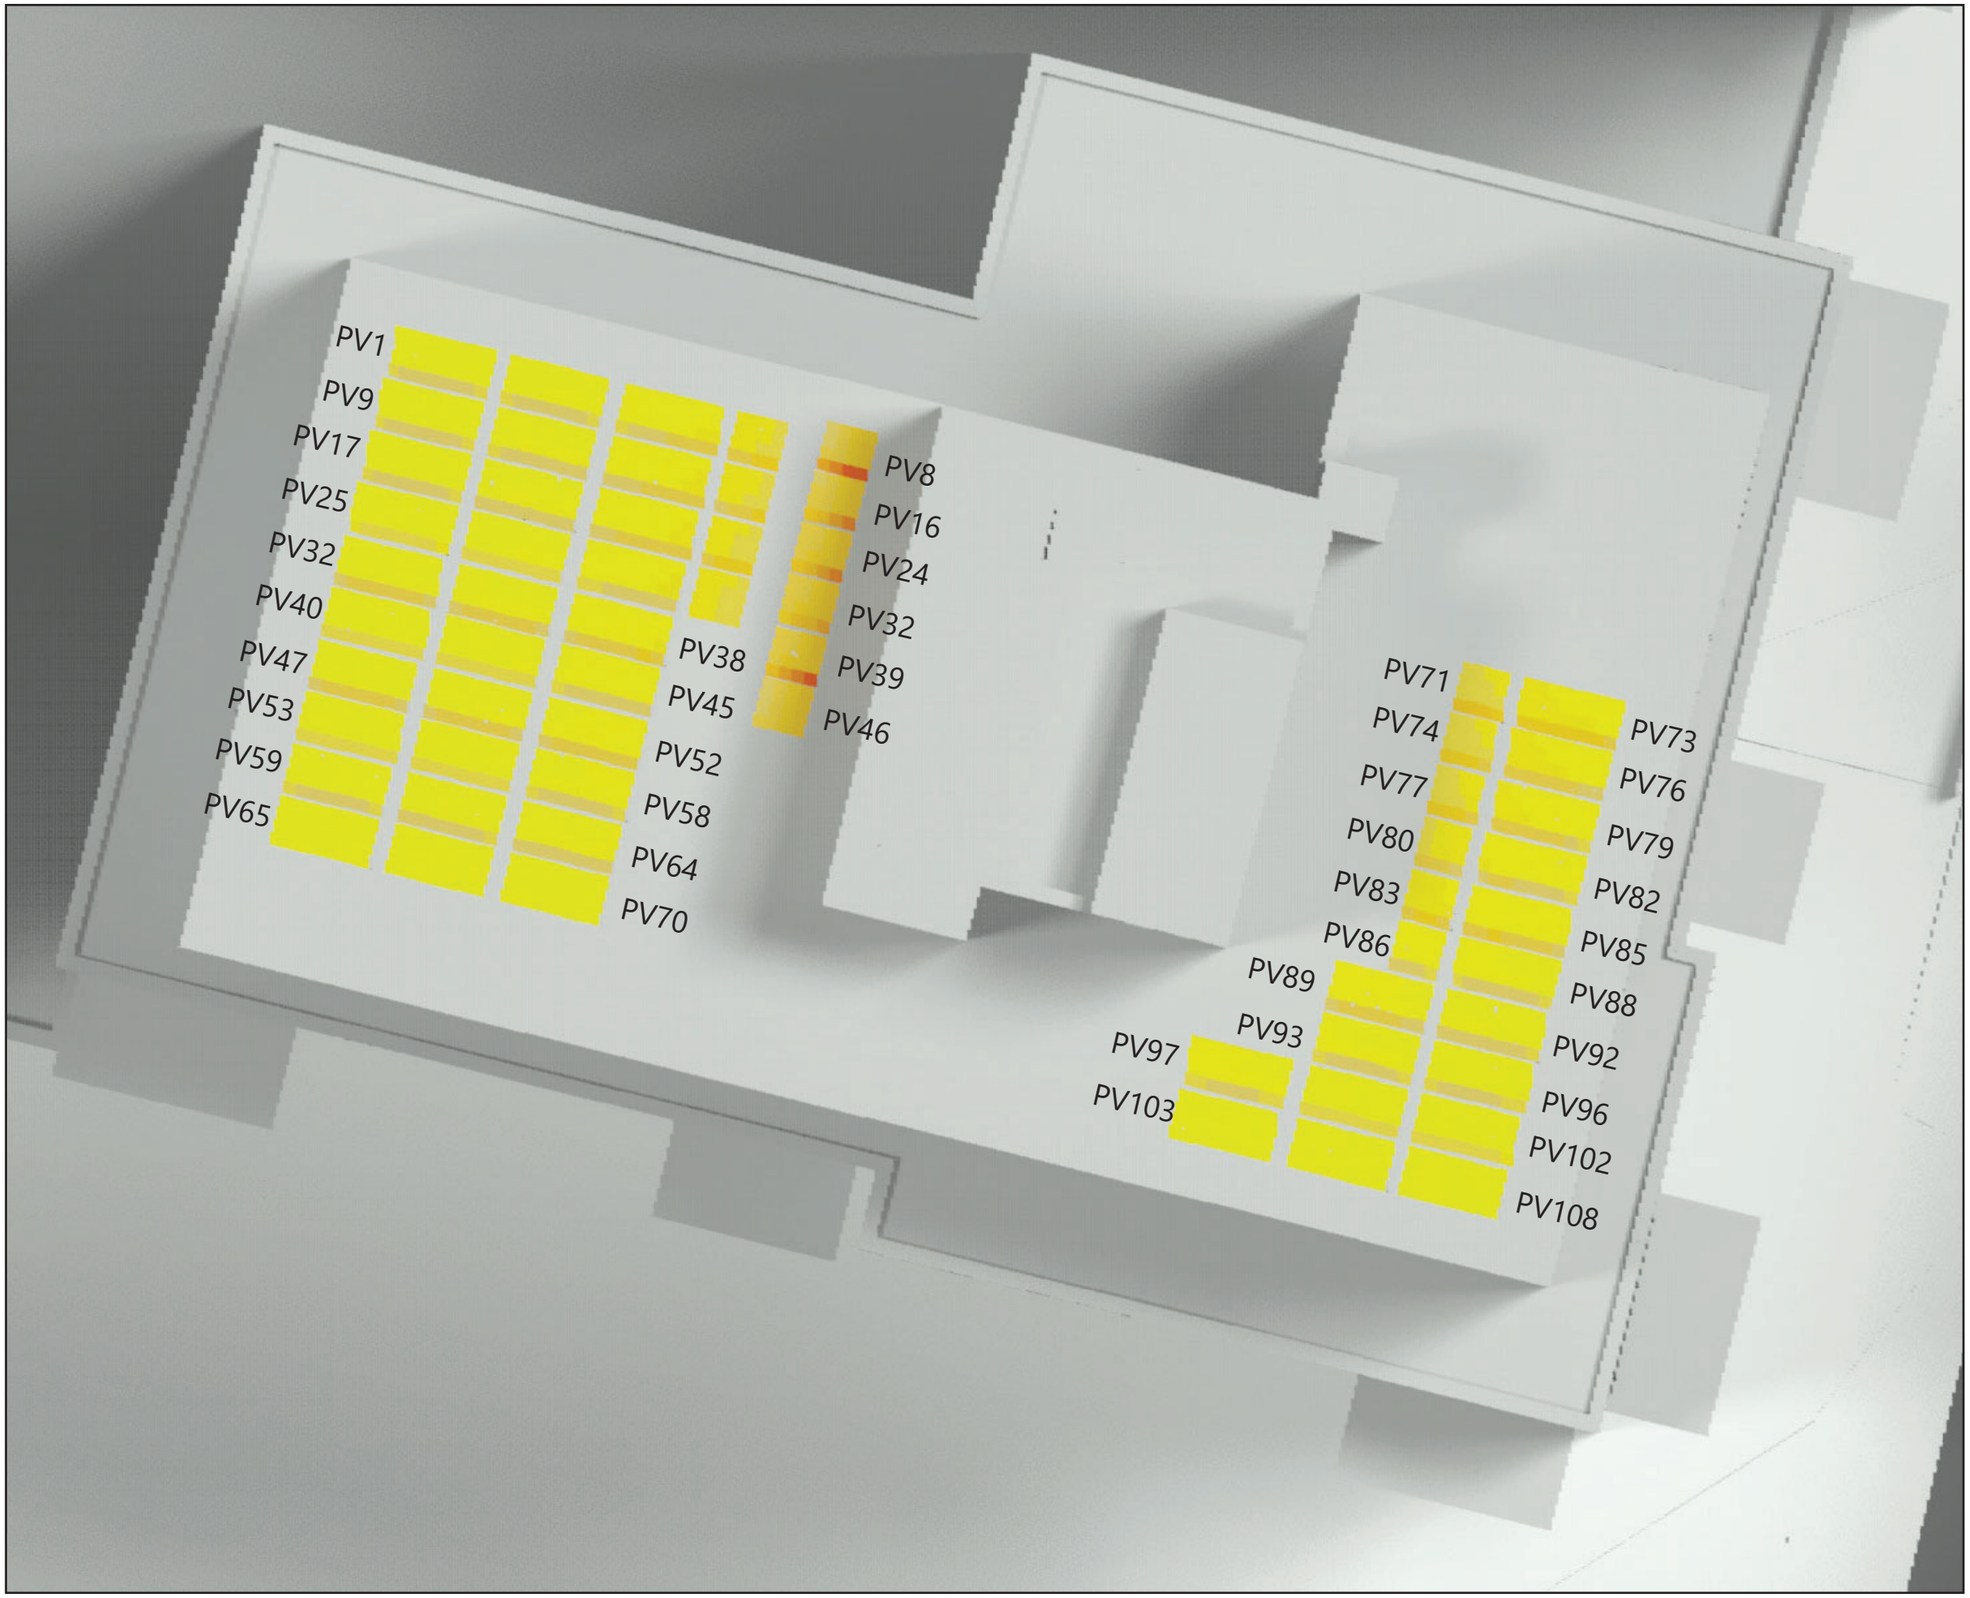

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Sessile Apartments
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV01	02

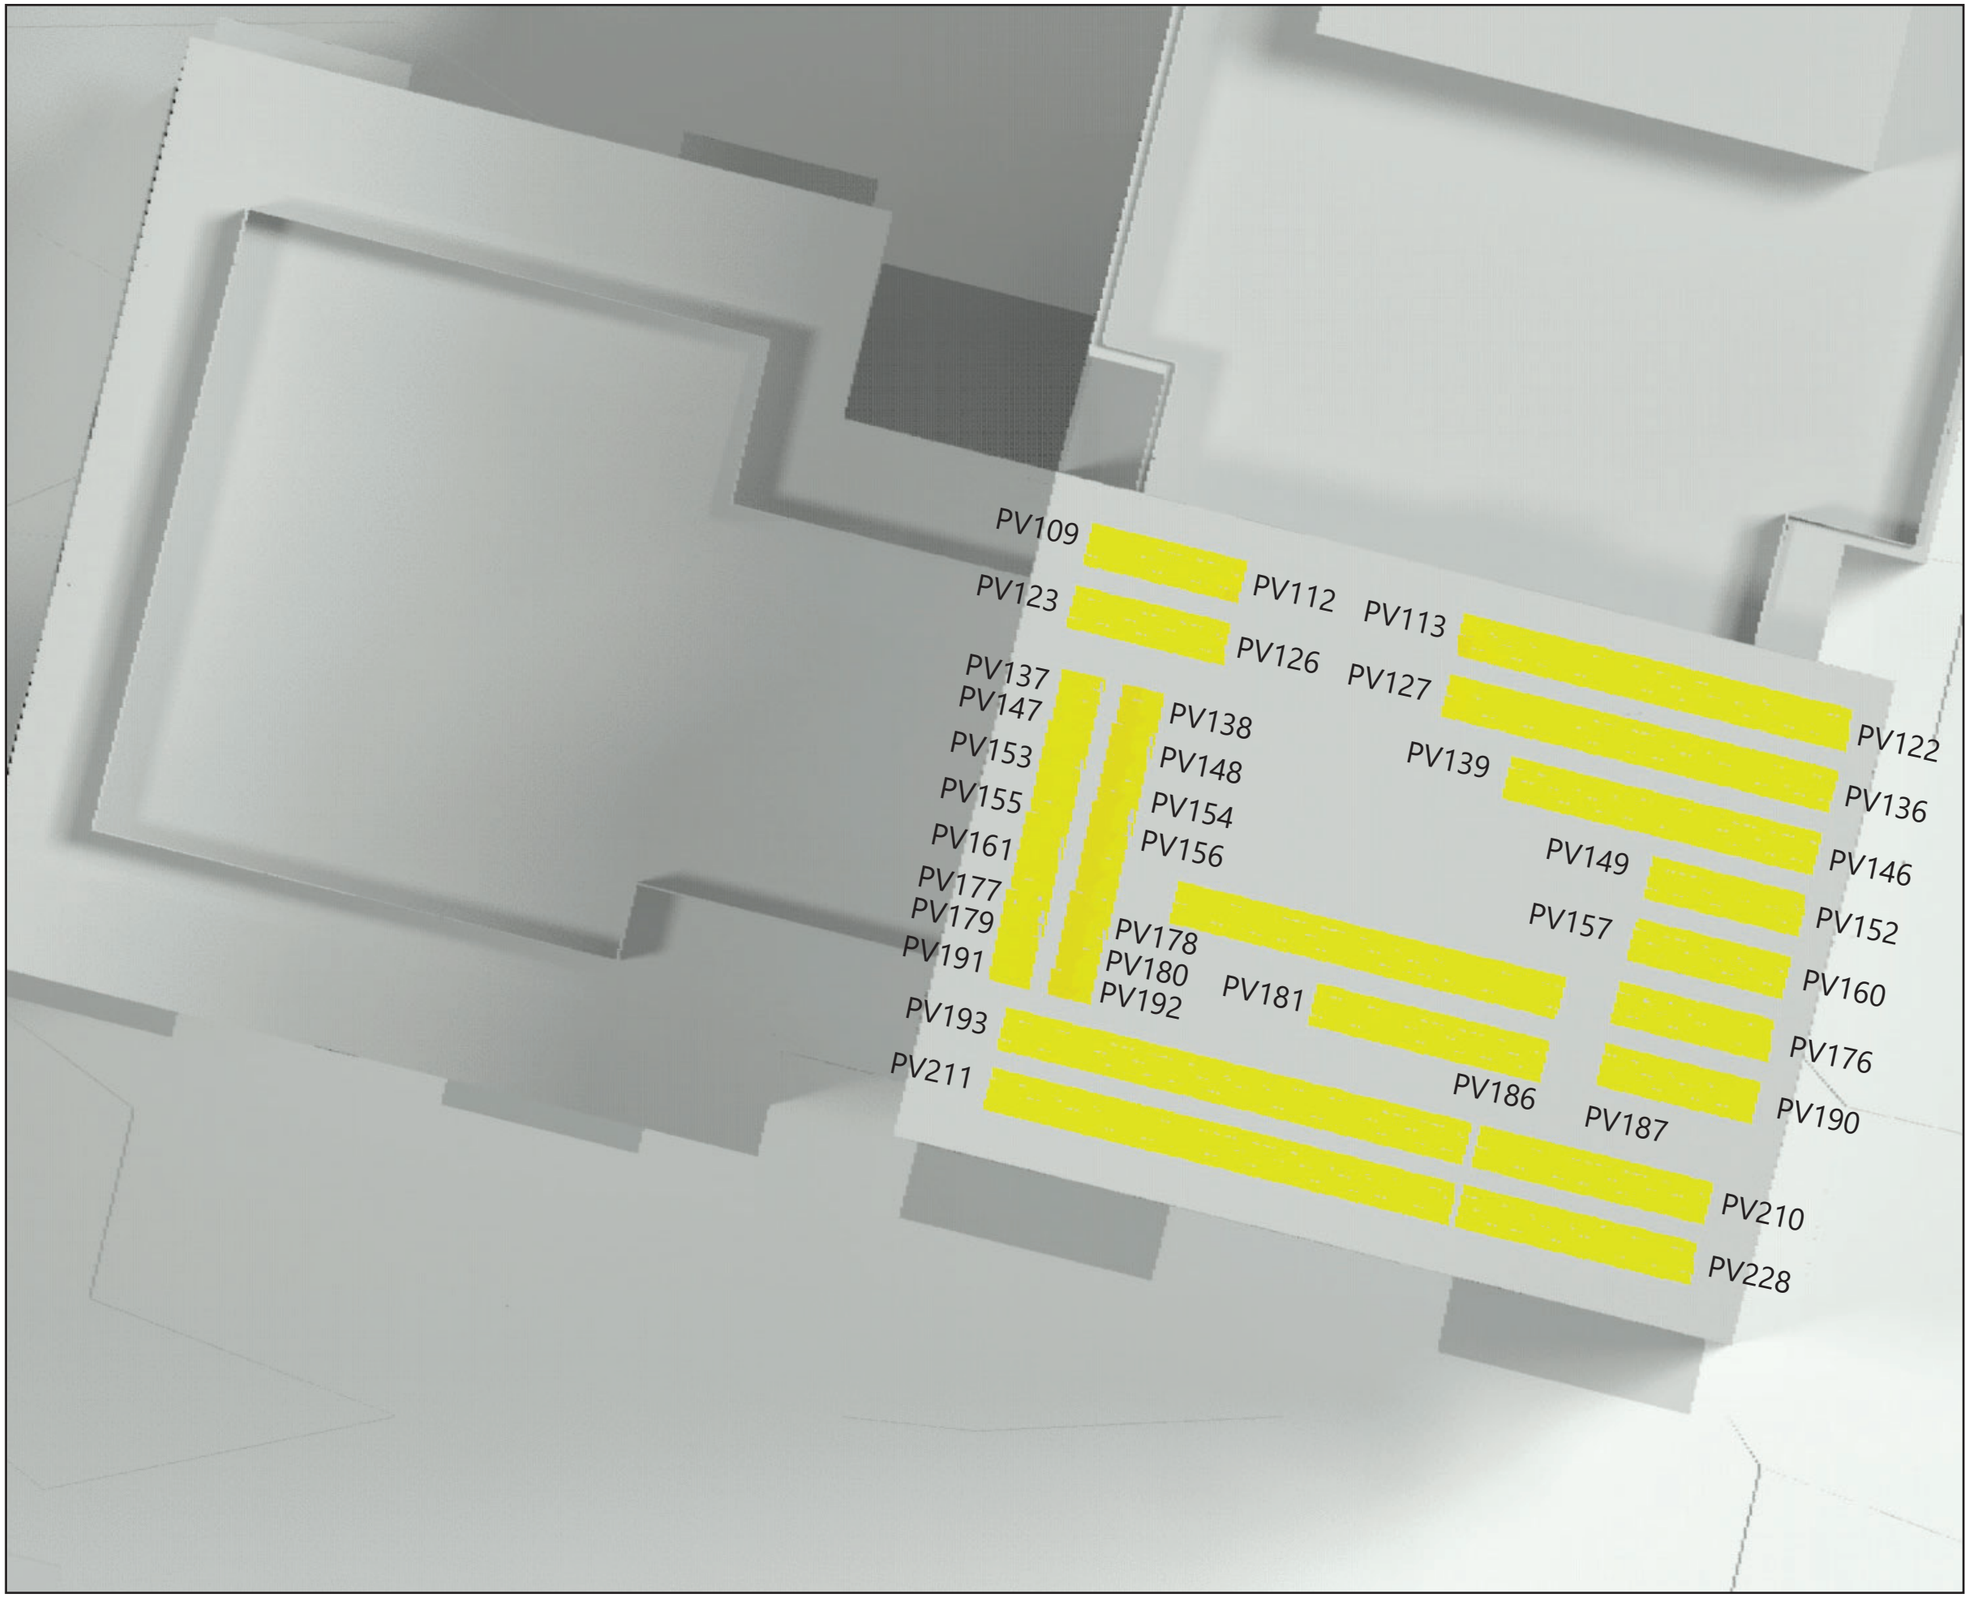

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
The Gessner
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV01
Page no.: 03

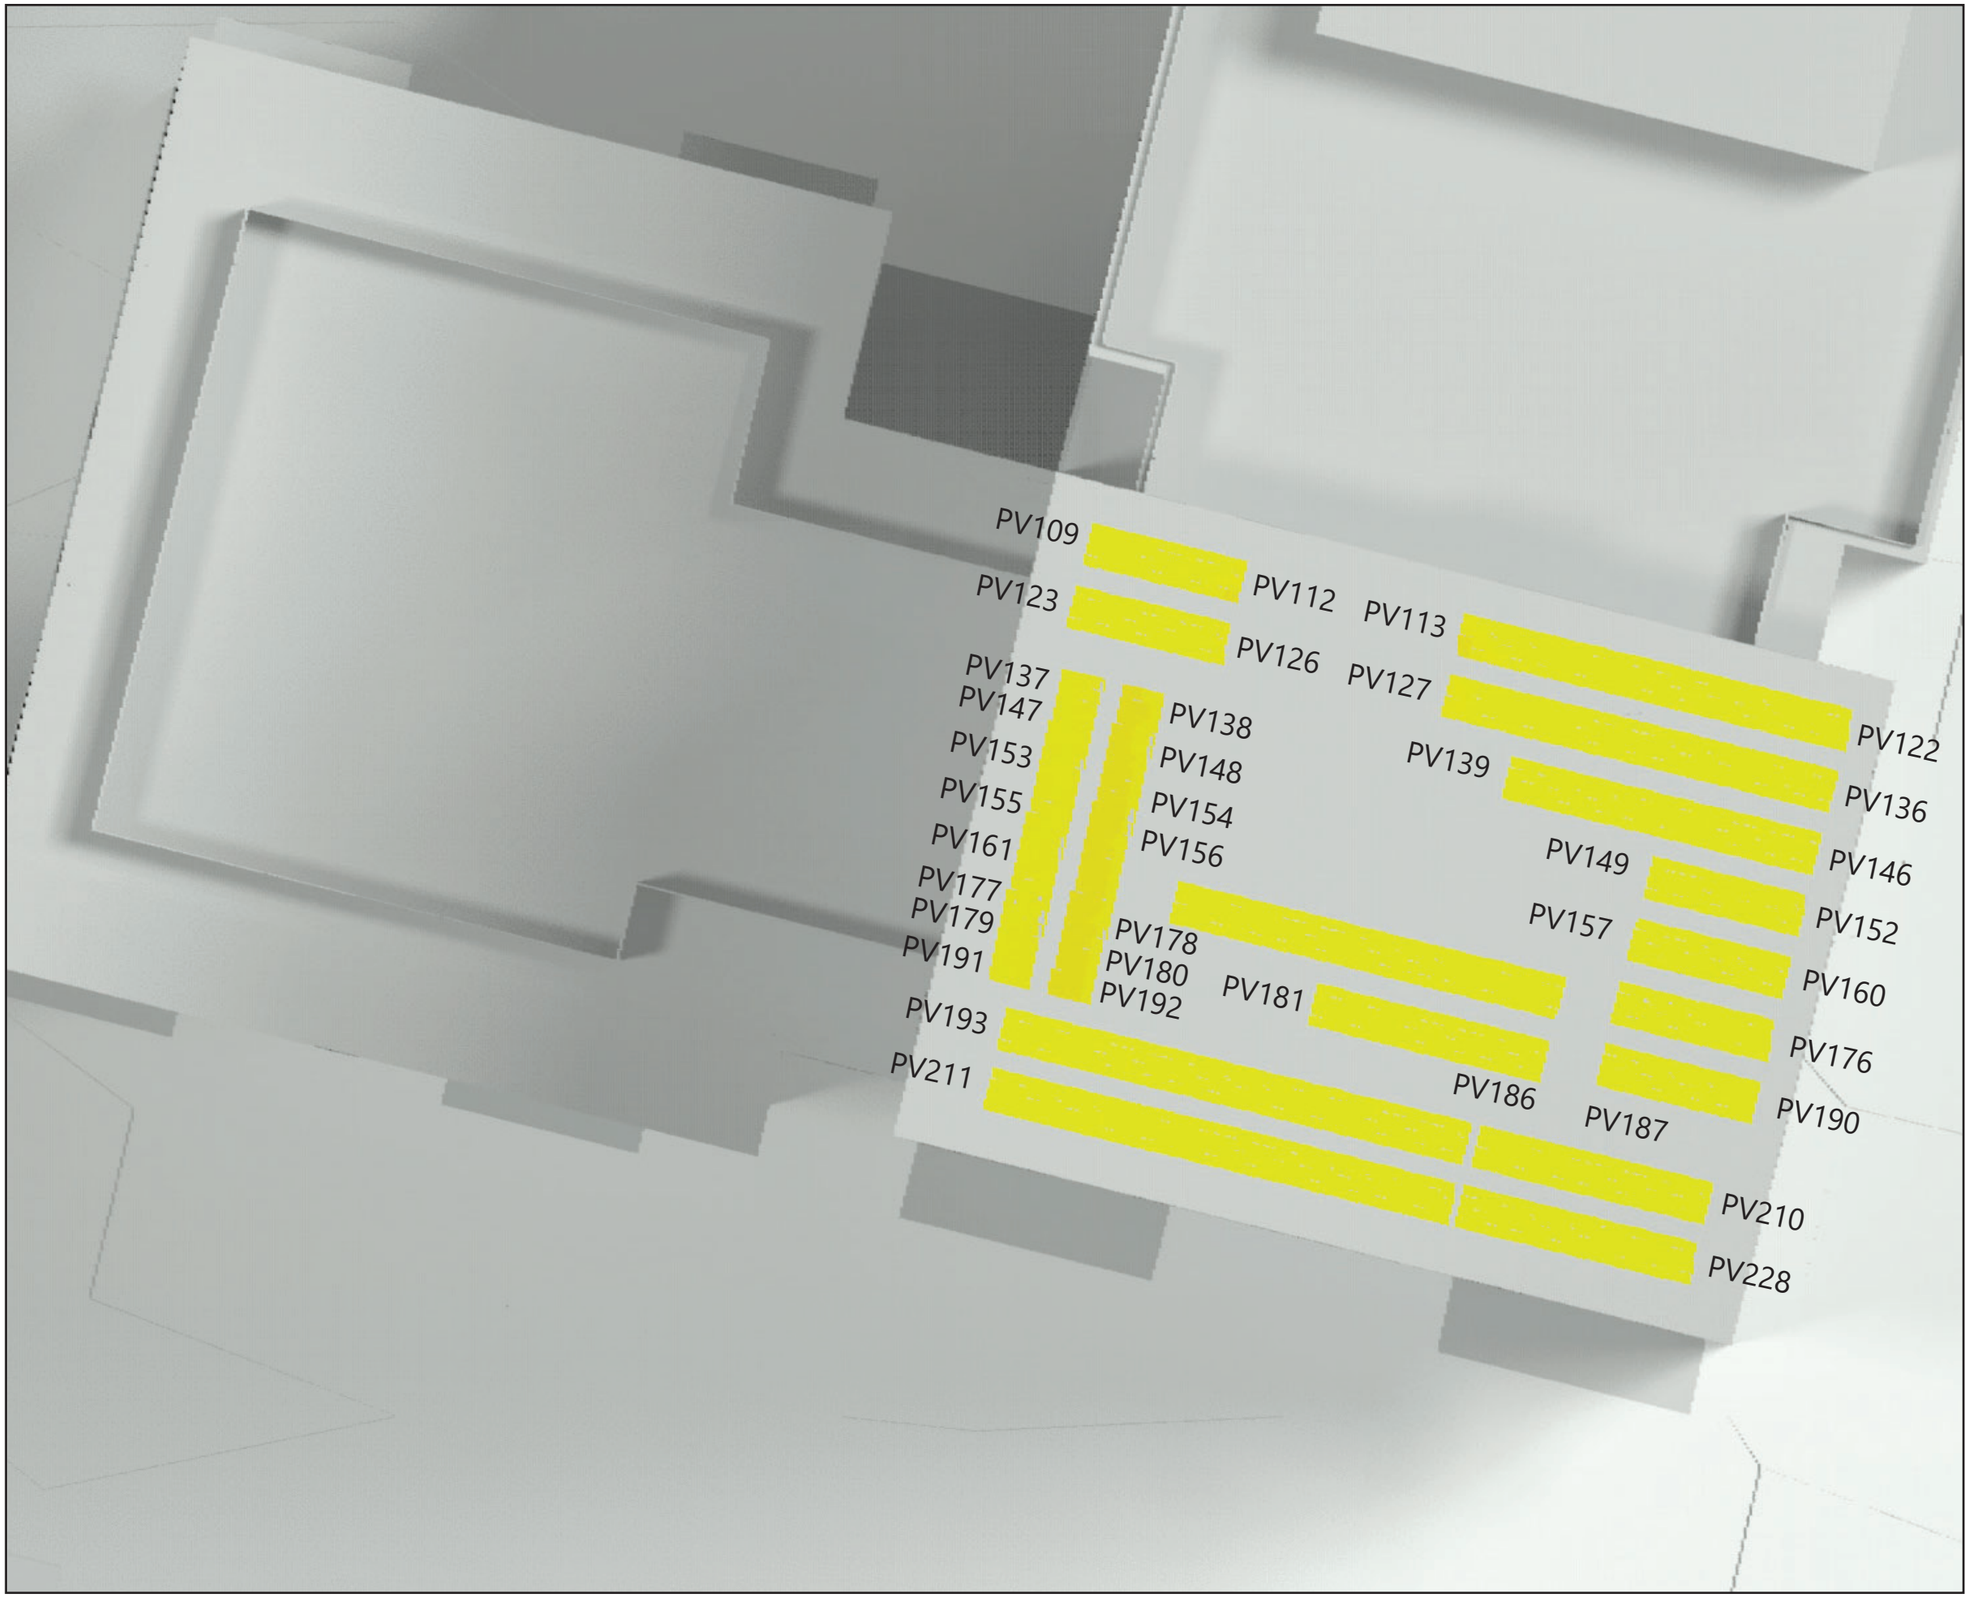

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

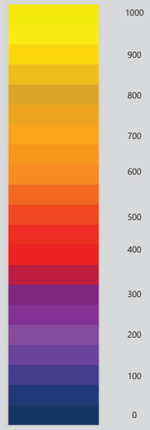

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
The Gessner
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV01	04

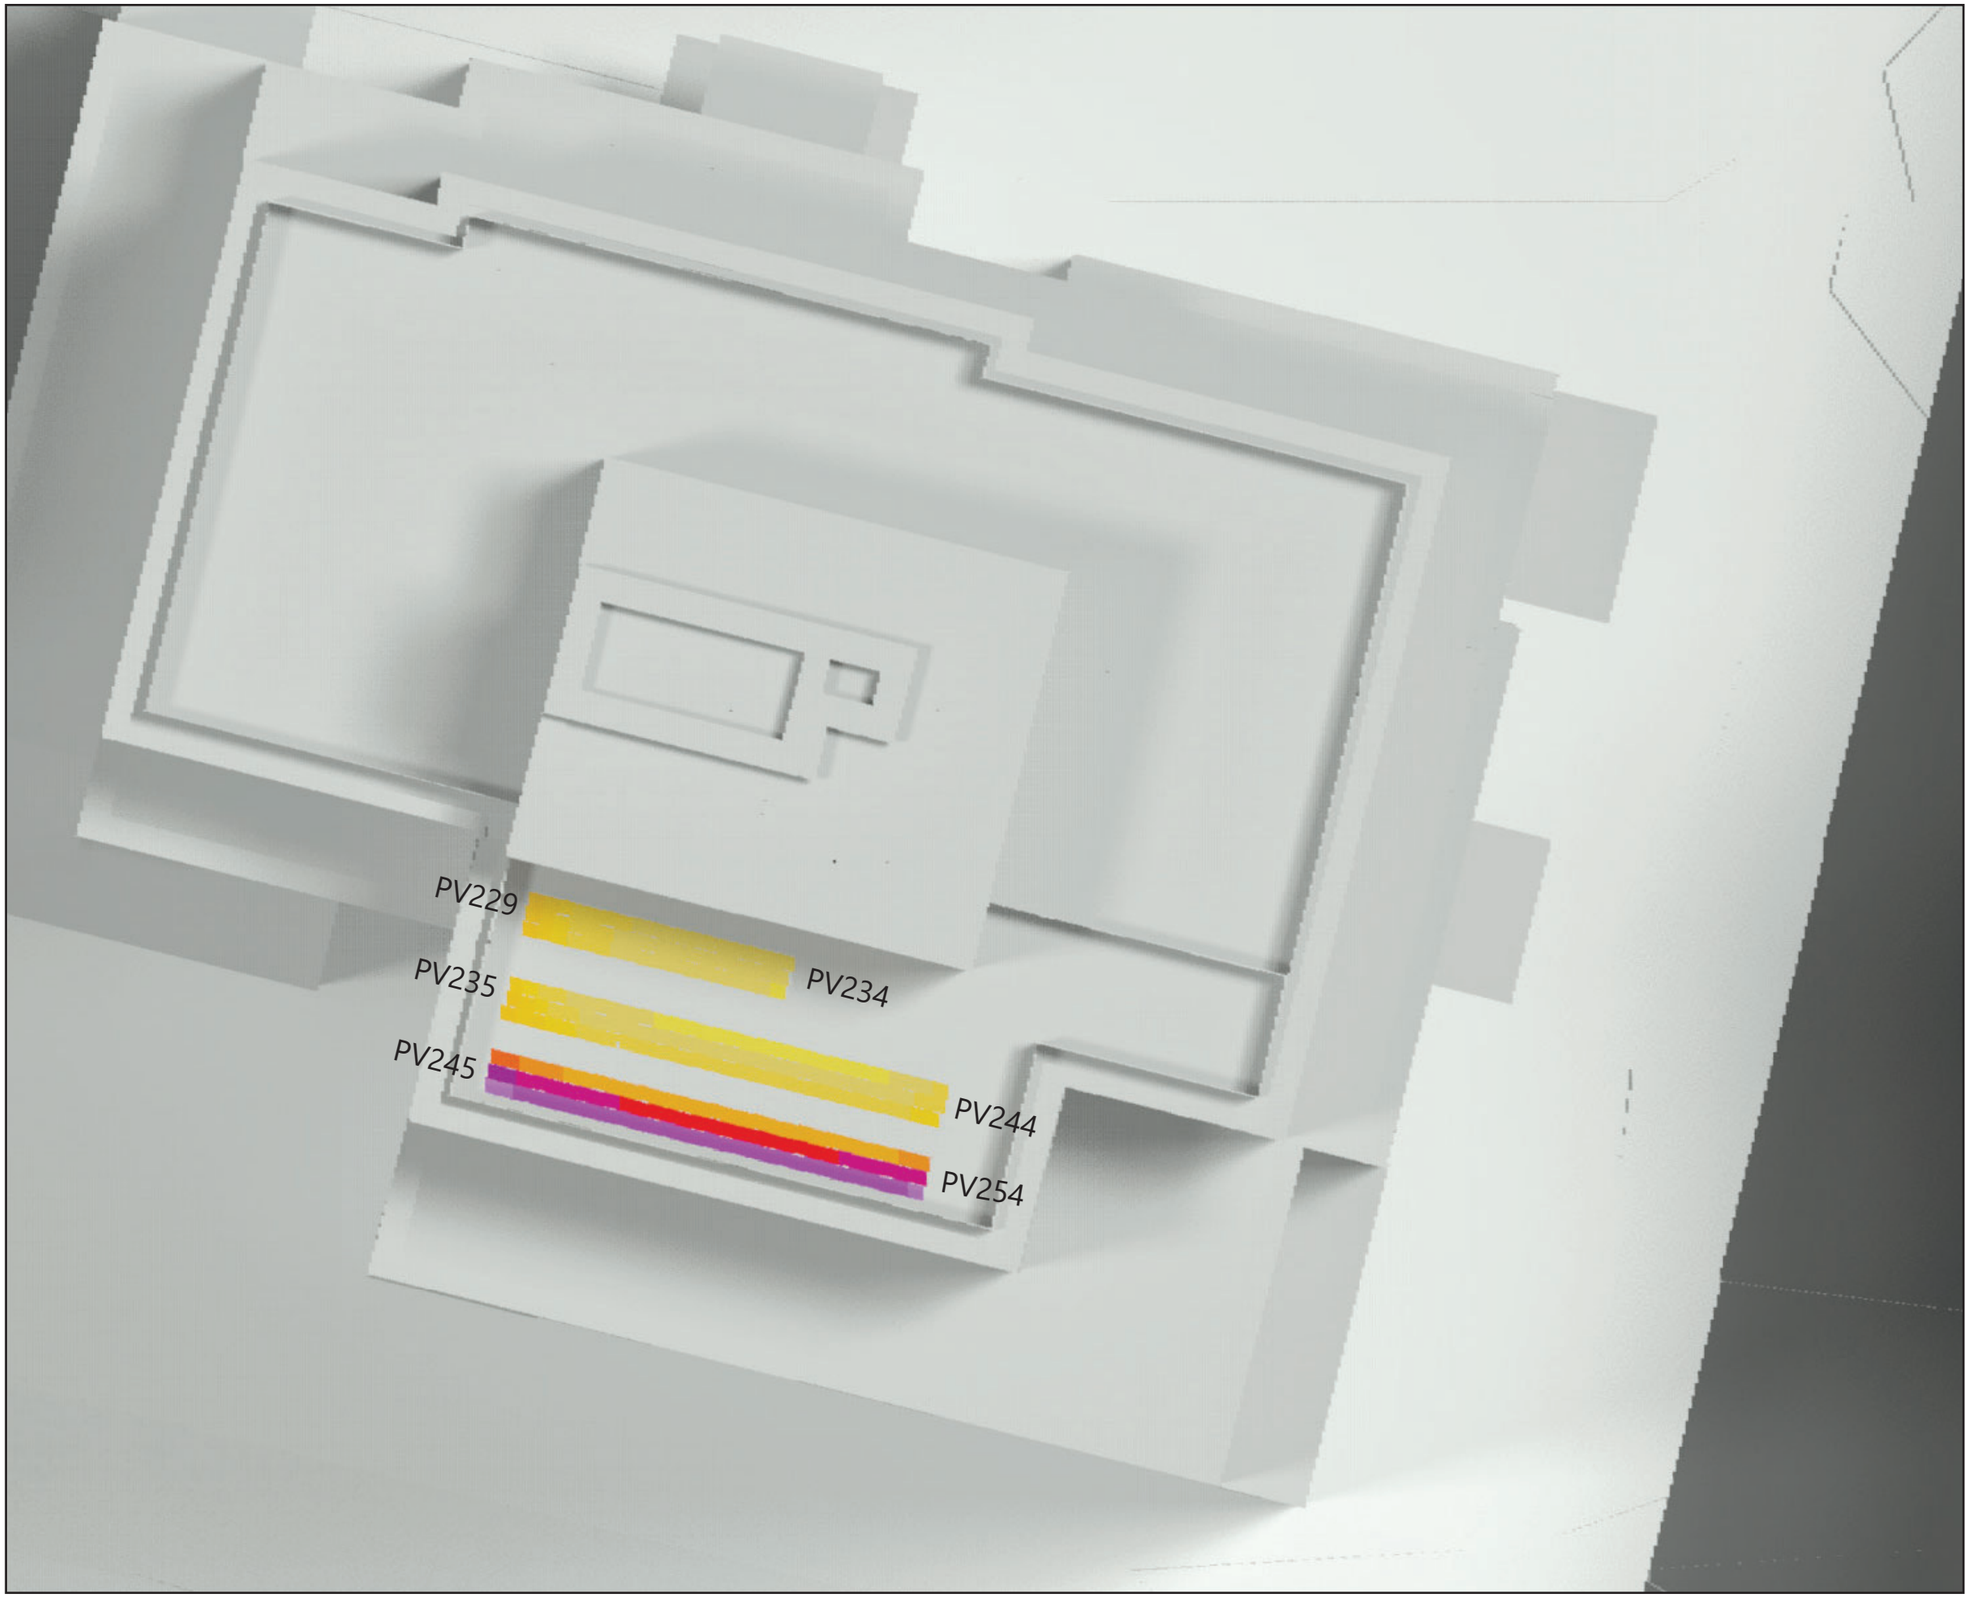

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV01
Page no.: 05

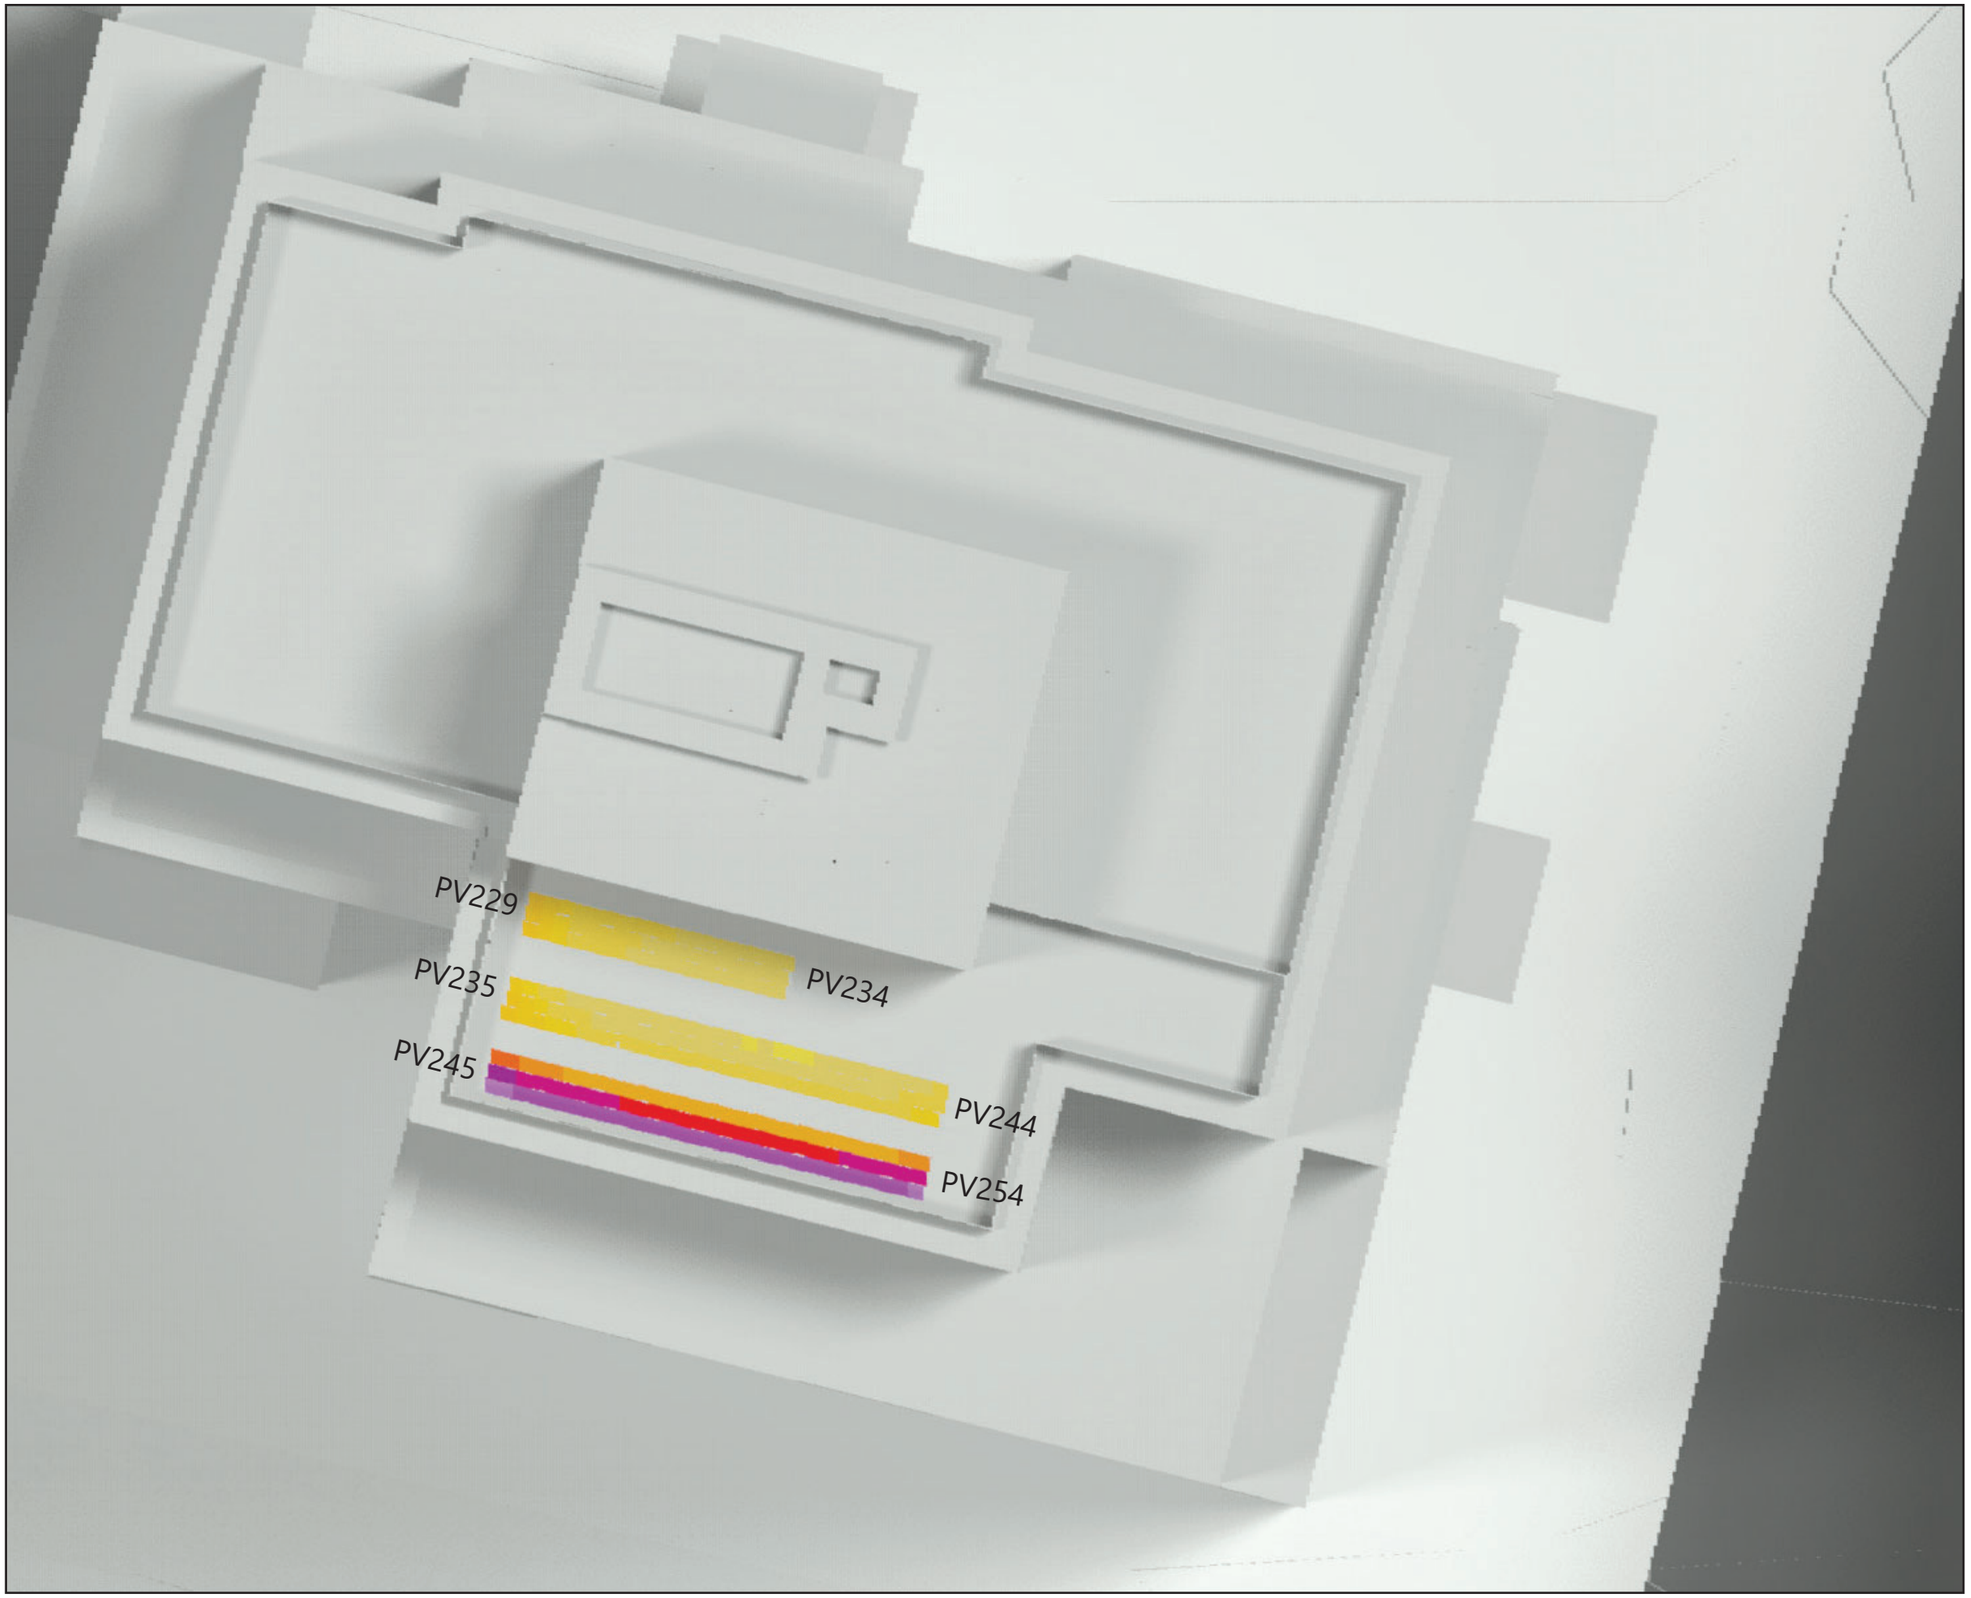

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)


1000
900
800
700
600
500
400
300
200
100
0

NORTH

Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn: TR
Checked: --
Date: 07/08/2026
Project: 10106
Rel no.: 08
Prefix: PV01
Page no.: 06

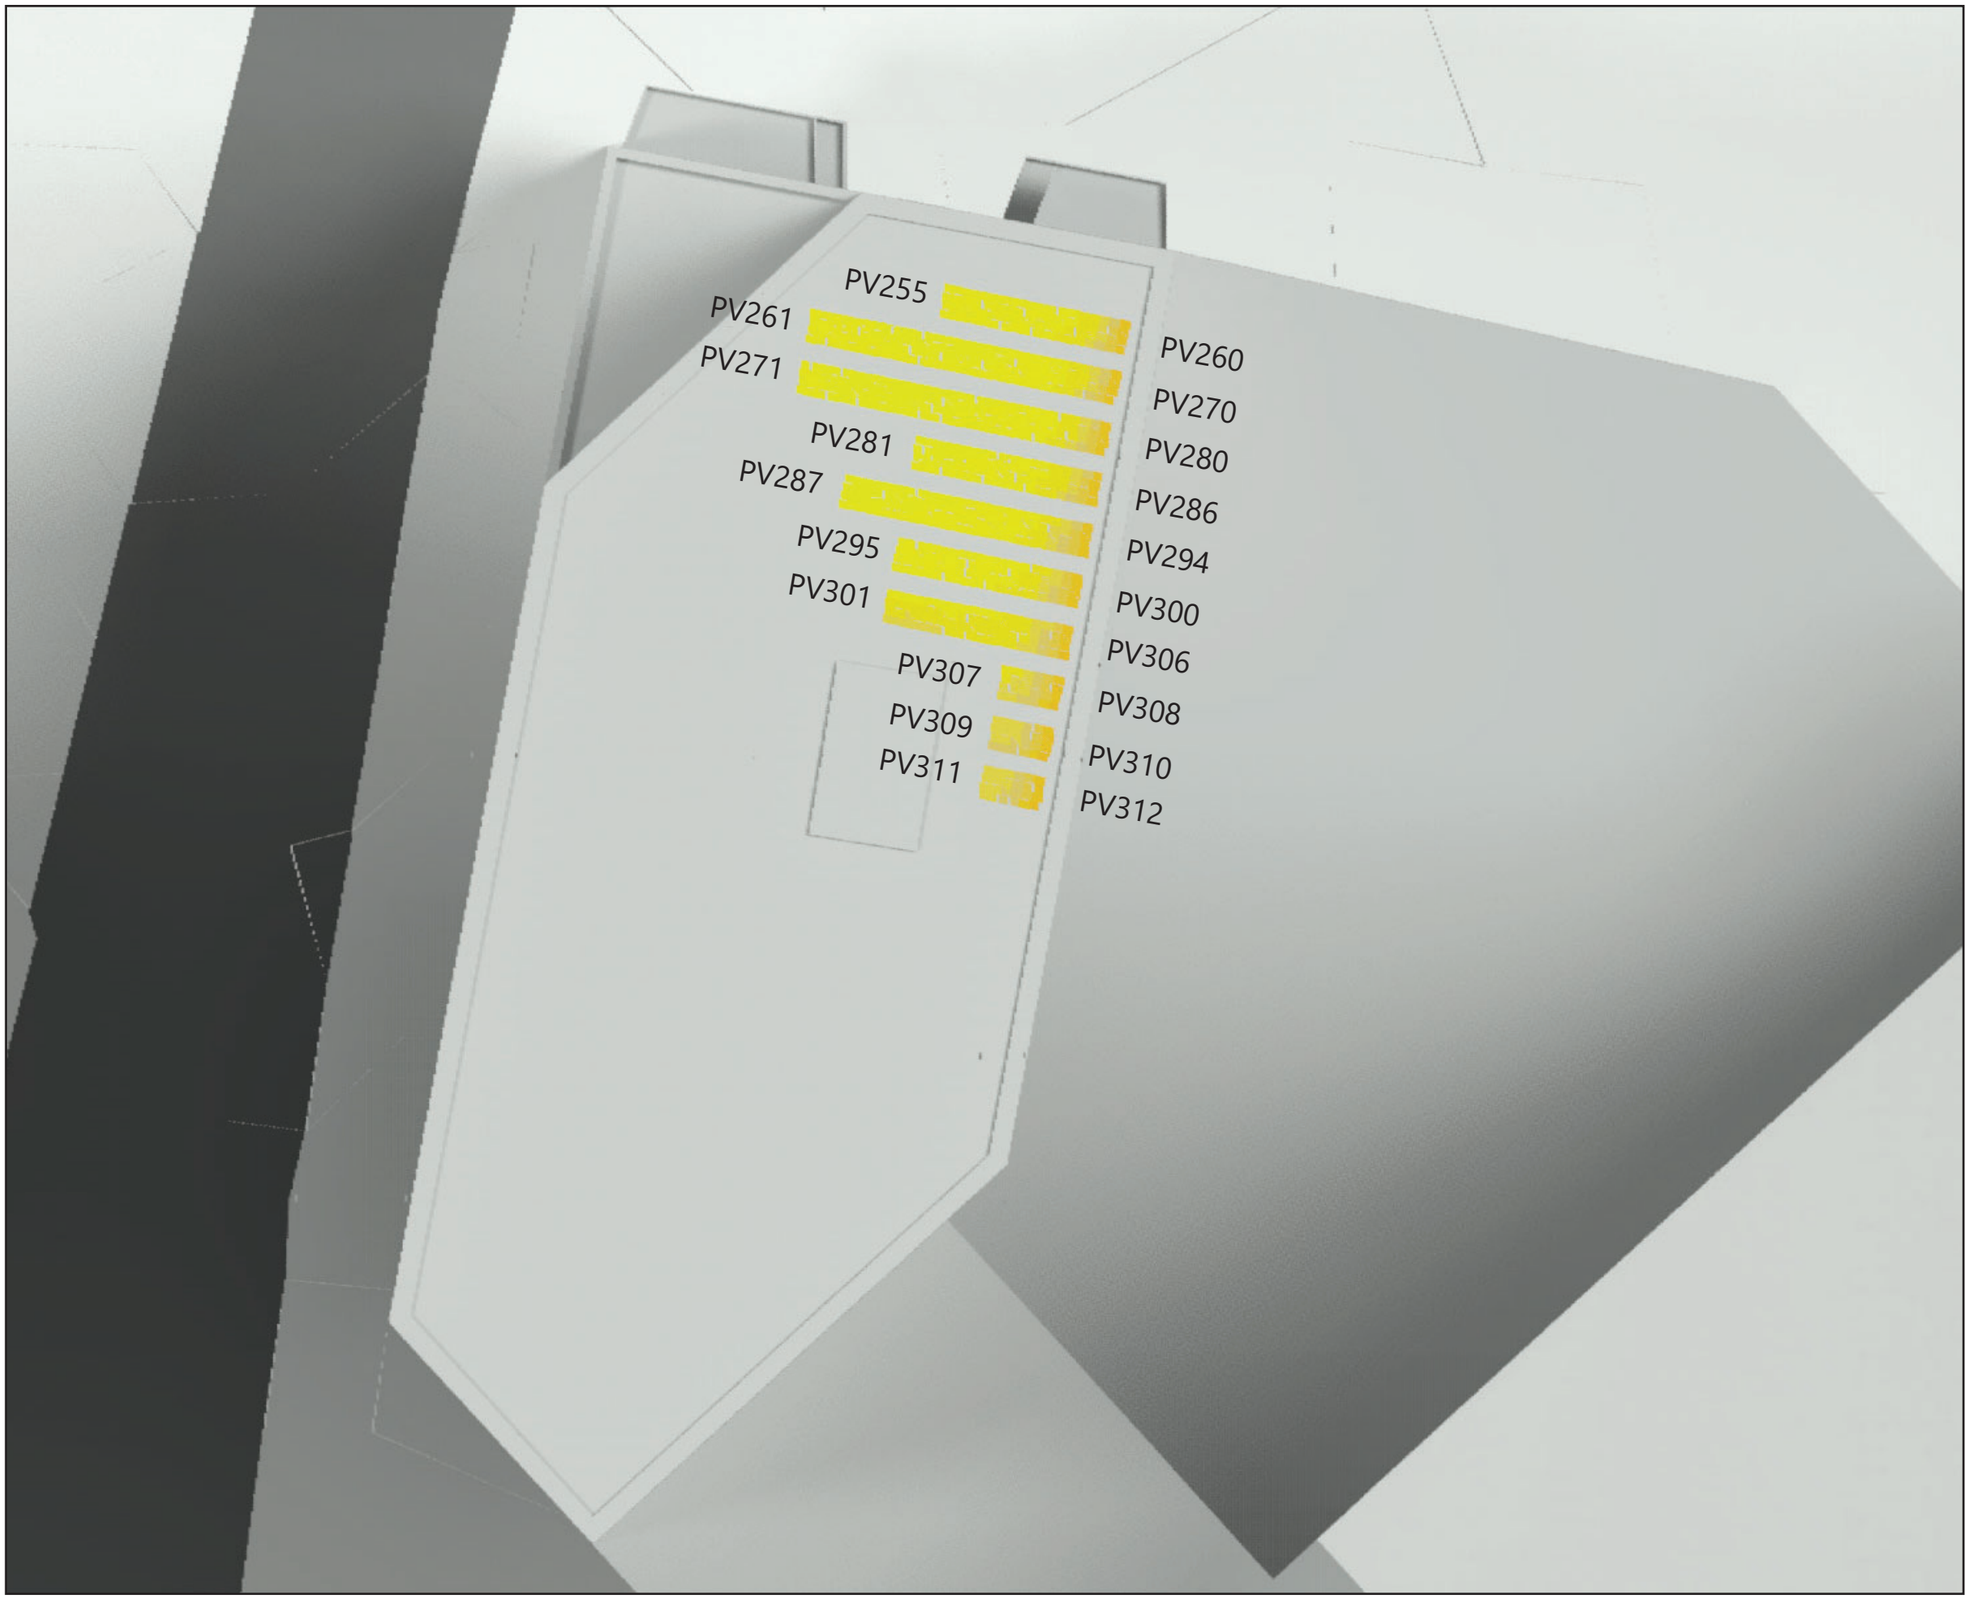

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
East Apartments
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV01
Page no.: 07

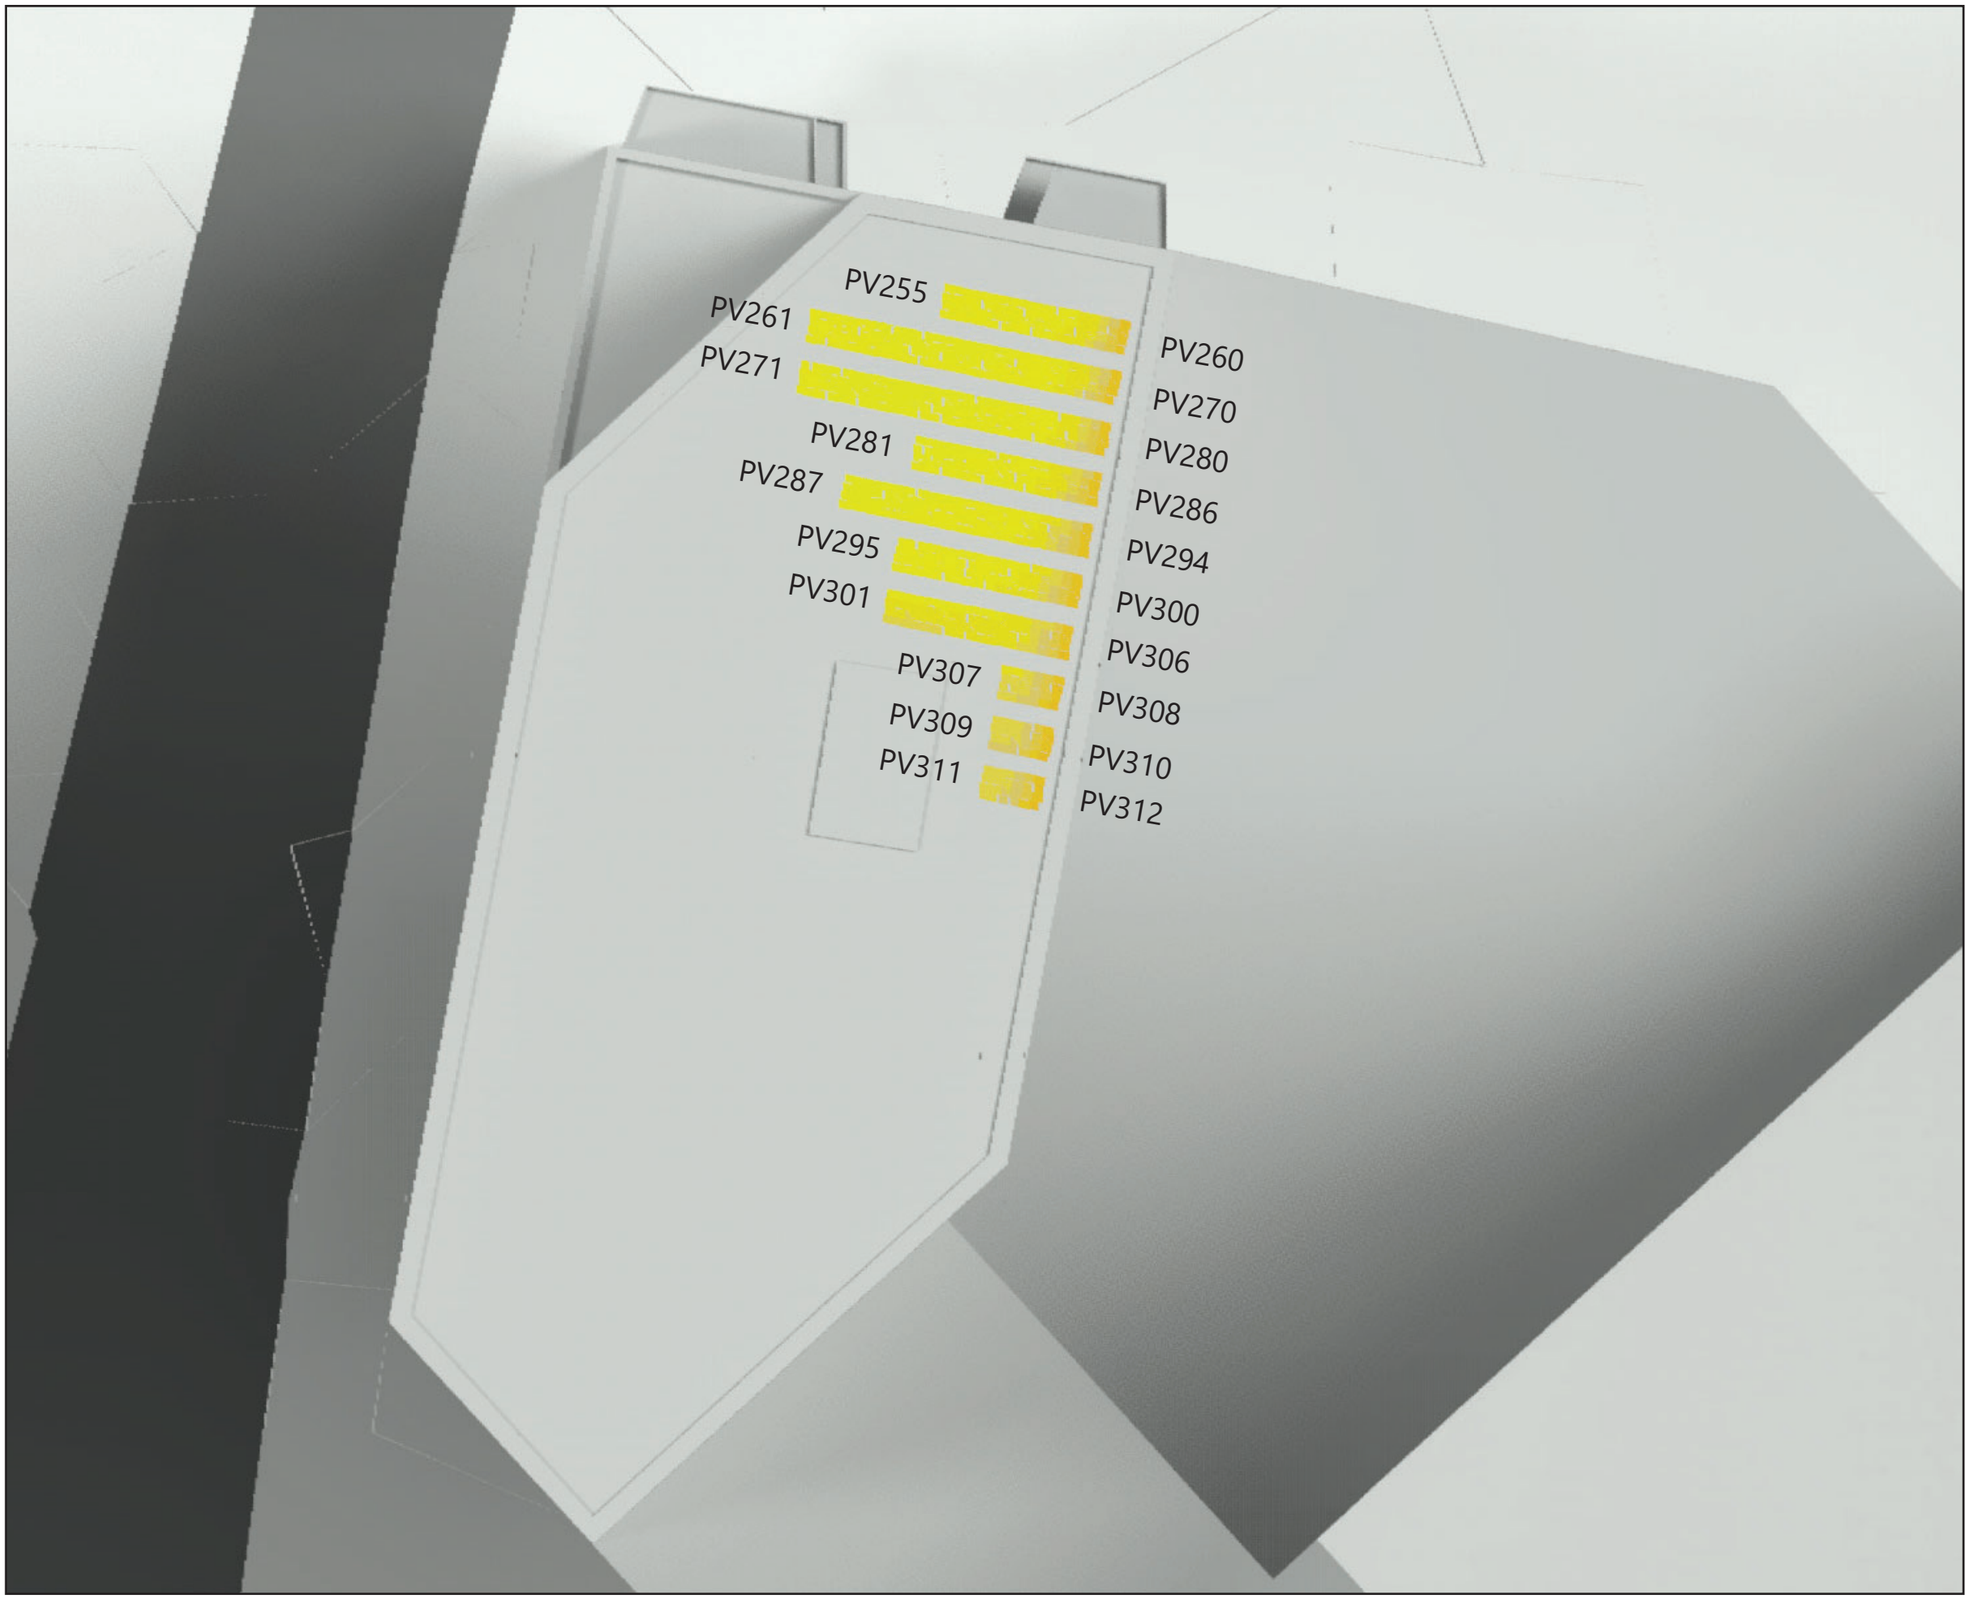

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
East Apartments
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV01	08

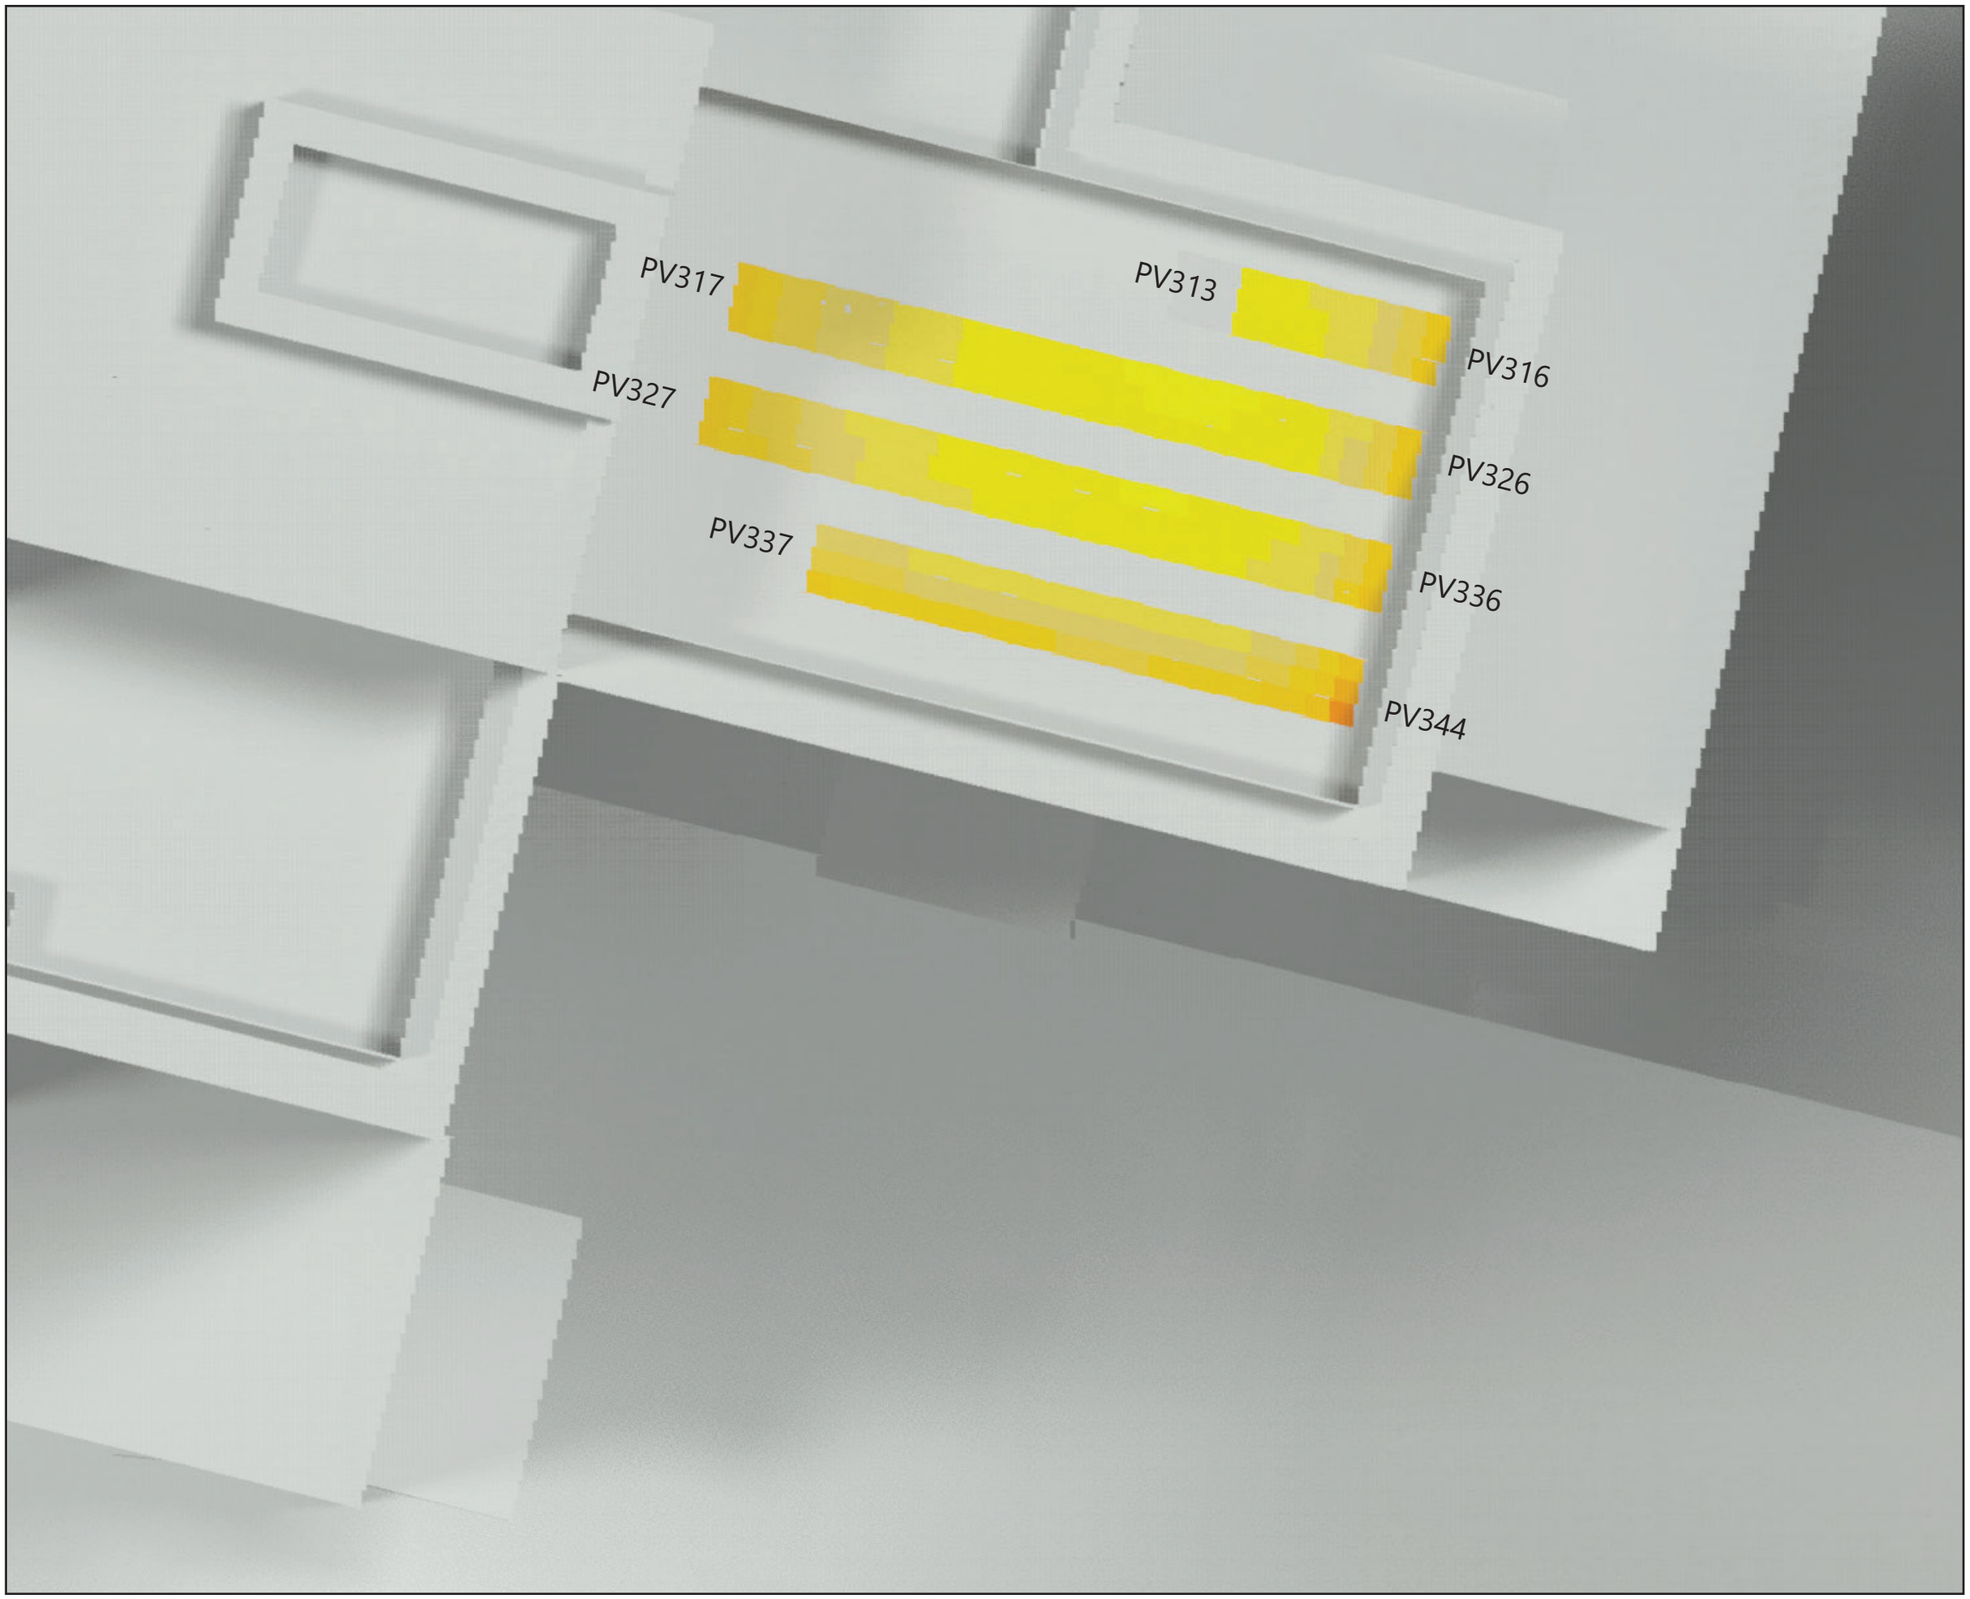

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0


NORTH

Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn	TR	Checked	--
Date	07/08/2026	Project	10106

Rel no.	Prefix	Page no.
08	PV01	09

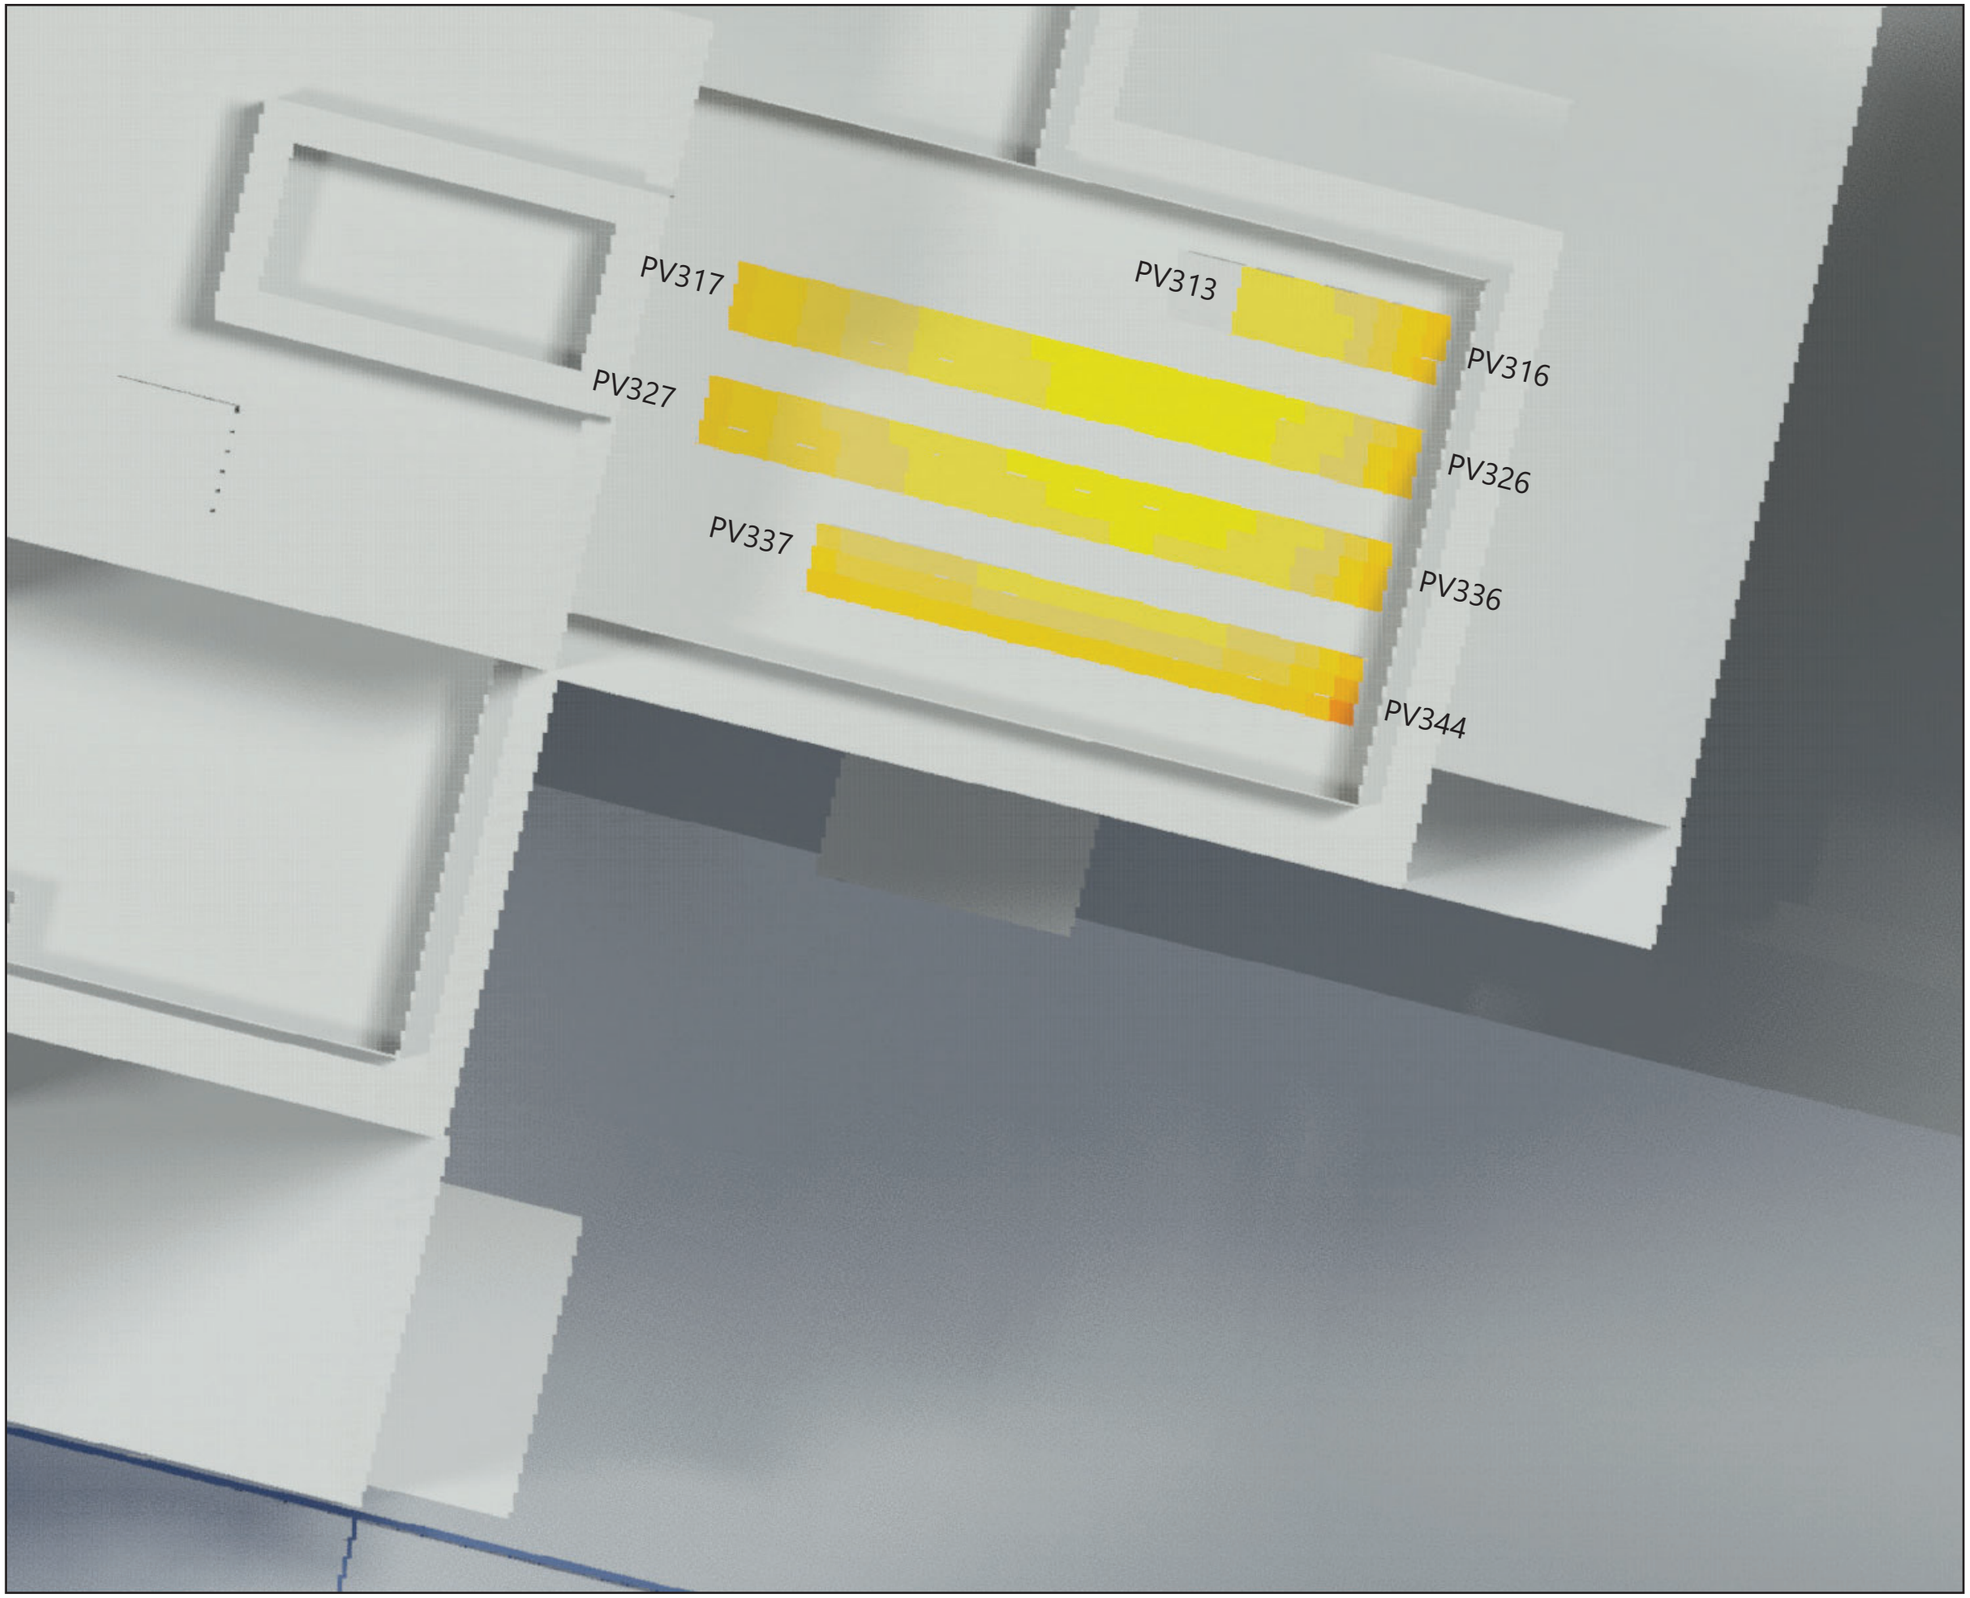

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH

Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV01	10

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV01	1.0	981.8	973.8	0.99
PV02	1.0	978.1	971.2	0.99
PV03	1.0	974.3	966.7	0.99
PV04	1.0	967.1	960.3	0.99
PV05	1.0	953.7	946.0	0.99
PV06	1.0	927.8	921.4	0.99
PV07	1.0	878.2	870.8	0.99
PV08	1.0	695.9	689.1	0.99
PV09	1.0	980.0	972.1	0.99
PV10	1.0	976.2	969.1	0.99
PV11	1.0	971.6	963.9	0.99
PV12	1.0	963.4	956.6	0.99
PV13	1.0	948.3	940.4	0.99
PV14	1.0	921.1	914.5	0.99
PV15	1.0	876.8	869.4	0.99
PV16	1.0	711.5	704.4	0.99
PV17	1.0	978.7	970.2	0.99
PV18	1.0	974.8	967.6	0.99
PV19	1.0	970.0	962.0	0.99
PV20	1.0	961.8	954.8	0.99
PV21	1.0	946.1	938.4	0.99
PV22	1.0	919.5	912.8	0.99
PV23	1.0	870.0	862.1	0.99
PV24	1.0	708.3	700.6	0.99
PV25	1.0	993.0	984.5	0.99
PV26	1.0	989.3	981.8	0.99
PV27	1.0	984.3	976.2	0.99
PV28	1.0	976.9	969.7	0.99
PV29	1.0	960.9	952.7	0.99
PV30	1.0	934.9	928.0	0.99
PV31	1.0	915.7	905.1	0.99
PV32	1.0	717.5	709.6	0.99
PV33	1.0	972.9	964.3	0.99
PV34	1.0	968.9	961.6	0.99
PV35	1.0	964.5	956.4	0.99
PV36	1.0	957.4	950.3	0.99
PV37	1.0	943.1	935.1	0.99
PV38	1.0	919.0	912.1	0.99
PV39	1.0	698.9	691.2	0.99
PV40	1.0	992.0	983.2	0.99
PV41	1.0	988.7	980.7	0.99
PV42	1.0	984.2	975.8	0.99
PV43	1.0	978.5	970.8	0.99
PV44	1.0	964.3	956.0	0.99
PV45	1.0	943.2	935.8	0.99
PV46	1.0	754.4	743.6	0.99
PV47	1.0	973.7	965.0	0.99
PV48	1.0	970.1	962.4	0.99
PV49	1.0	966.6	958.0	0.99
PV50	1.0	961.2	953.7	0.99
PV51	1.0	950.1	941.8	0.99
PV52	1.0	932.7	925.5	0.99
PV53	1.0	993.3	984.0	0.99
PV54	1.0	990.0	981.9	0.99
PV55	1.0	986.8	977.9	0.99
PV56	1.0	982.8	975.0	0.99
PV57	1.0	973.9	965.2	0.99
PV58	1.0	961.7	954.2	0.99
PV59	1.0	983.0	973.8	0.99
PV60	1.0	980.4	971.9	0.99
PV61	1.0	978.4	969.0	0.99
PV62	1.0	974.8	967.1	0.99
PV63	1.0	969.4	960.4	0.99
PV64	1.0	961.3	953.5	0.99
PV65	1.0	1039.8	1026.5	0.99
PV66	1.0	1039.1	1025.9	0.99
PV67	1.0	1037.6	1024.4	0.99
PV68	1.0	1035.2	1022.4	0.99
PV69	1.0	1030.7	1018.2	0.99
PV70	1.0	1025.8	1013.4	0.99
PV71	1.0	838.6	837.2	1.00
PV72	1.0	887.7	883.5	1.00
PV73	1.0	915.1	910.3	0.99
PV74	1.0	855.1	851.7	1.00
PV75	1.0	906.1	900.3	0.99
PV76	1.0	932.3	927.2	0.99
PV77	1.0	863.4	857.5	0.99
PV78	1.0	912.6	906.8	0.99
PV79	1.0	936.8	931.6	0.99
PV80	1.0	884.7	877.9	0.99
PV81	1.0	927.1	921.0	0.99
PV82	1.0	947.5	942.2	0.99
PV83	1.0	897.7	891.2	0.99
PV84	1.0	925.1	919.0	0.99
PV85	1.0	940.3	935.4	0.99
PV86	1.0	940.1	934.5	0.99
PV87	1.0	959.2	953.0	0.99
PV88	1.0	970.2	964.9	0.99
PV89	1.0	944.0	937.3	0.99
PV90	1.0	954.3	948.6	0.99
PV91	1.0	964.9	958.4	0.99
PV92	1.0	971.4	965.9	0.99
PV93	1.0	965.8	958.9	0.99
PV94	1.0	972.5	966.5	0.99
PV95	1.0	979.4	973.1	0.99
PV96	1.0	984.5	979.0	0.99
PV97	1.0	966.3	958.6	0.99
PV98	1.0	971.6	965.3	0.99
PV99	1.0	979.3	971.9	0.99
PV100	1.0	982.8	976.8	0.99
PV101	1.0	987.3	980.8	0.99
PV102	1.0	990.8	985.2	0.99
PV103	1.0	1022.8	1012.5	0.99
PV104	1.0	1025.8	1016.0	0.99
PV105	1.0	1030.3	1020.3	0.99
PV106	1.0	1032.7	1022.9	0.99
PV107	1.0	1035.2	1025.5	0.99
PV108	1.0	1036.8	1027.5	0.99
PV109	0.9	1039.0	1037.5	1.00
PV110	0.9	1034.5	1033.5	1.00
PV111	0.9	1024.7	1023.6	1.00
PV112	0.9	989.5	988.8	1.00
PV113	0.9	980.0	980.0	1.00
PV114	0.9	1021.5	1021.5	1.00
PV115	0.9	1033.6	1033.6	1.00
PV116	0.9	1037.6	1037.1	1.00
PV117	0.9	1039.0	1038.7	1.00
PV118	0.9	1040.2	1039.5	1.00
PV119	0.9	1040.9	1040.0	1.00
PV120	0.9	1041.2	1040.4	1.00
PV121	0.9	1042.1	1041.6	1.00
PV122	0.9	1044.9	1044.1	1.00
PV123	0.9	1045.8	1044.3	1.00
PV124	0.9	1044.0	1042.6	1.00
PV125	0.9	1036.2	1035.1	1.00
PV126	0.9	1005.7	1004.1	1.00

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Project: Ashley Road
Tottenham Hale

Title:

Drawn: TR | Checked: --

Date: 07/08/2026 | Project: 10106

Rel no.: 08 | Prefix: PV01 | Page no.: 11

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV127	0.9	994.3	994.3	1.00
PV128	0.9	1032.1	1031.5	1.00
PV129	0.9	1038.4	1037.4	1.00
PV130	0.9	1040.4	1039.2	1.00
PV131	0.9	1041.2	1040.4	1.00
PV132	0.9	1041.9	1041.2	1.00
PV133	0.9	1042.4	1041.5	1.00
PV134	0.9	1042.7	1041.7	1.00
PV135	0.9	1043.4	1042.7	1.00
PV136	0.9	1045.9	1045.1	1.00
PV137	0.9	955.4	953.4	1.00
PV138	0.9	945.6	944.5	1.00
PV139	0.9	1048.1	1046.8	1.00
PV140	0.9	1048.7	1047.9	1.00
PV141	0.9	1049.1	1047.9	1.00
PV142	0.9	1047.1	1046.0	1.00
PV143	0.9	1042.9	1041.5	1.00
PV144	0.9	1041.9	1040.9	1.00
PV145	0.9	1042.1	1041.5	1.00
PV146	0.9	1044.8	1043.8	1.00
PV147	0.9	955.2	953.1	1.00
PV148	0.9	944.6	943.7	1.00
PV149	0.9	1043.4	1042.5	1.00
PV150	0.9	1042.6	1041.6	1.00
PV151	0.9	1042.9	1042.2	1.00
PV152	0.9	1045.5	1044.7	1.00
PV153	0.9	954.7	953.0	1.00
PV154	0.9	944.4	943.2	1.00
PV155	0.9	955.0	952.8	1.00
PV156	0.9	944.2	943.2	1.00
PV157	0.9	1043.2	1042.2	1.00
PV158	0.9	1042.6	1041.6	1.00
PV159	0.9	1043.1	1042.2	1.00
PV160	0.9	1045.4	1044.8	1.00
PV161	0.9	954.7	952.6	1.00
PV162	0.9	944.1	942.9	1.00
PV163	0.9	1045.9	1045.0	1.00
PV164	0.9	1046.7	1045.1	1.00
PV165	0.9	1046.7	1045.4	1.00
PV166	0.9	1045.2	1043.8	1.00
PV167	0.9	1042.1	1040.8	1.00
PV168	0.9	1041.2	1040.1	1.00
PV169	0.9	994.3	994.3	1.00
PV170	0.9	1032.1	1031.5	1.00
PV171	0.9	1038.4	1037.4	1.00
PV172	0.9	1040.4	1039.2	1.00
PV173	0.9	1041.2	1040.4	1.00
PV174	0.9	1041.9	1041.2	1.00
PV175	0.9	1042.4	1041.5	1.00
PV176	0.9	1042.7	1041.7	1.00
PV177	0.9	1043.4	1042.7	1.00
PV178	0.9	1045.9	1045.1	1.00
PV179	0.9	955.4	953.4	1.00
PV180	0.9	945.6	944.5	1.00
PV181	0.9	1048.1	1046.8	1.00
PV182	0.9	1048.7	1047.9	1.00
PV183	0.9	1049.1	1047.9	1.00
PV184	0.9	1047.1	1046.0	1.00
PV185	0.9	1042.9	1041.5	1.00
PV186	0.9	1041.9	1040.9	1.00
PV187	0.8	1042.1	1041.5	1.00
PV188	0.8	1044.8	1043.8	1.00
PV189	0.8	955.2	953.1	1.00
PV190	0.8	944.6	943.7	1.00
PV191	0.8	1043.4	1042.5	1.00
PV192	0.8	1042.6	1041.6	1.00
PV193	0.8	1042.9	1042.2	1.00
PV194	0.8	1045.5	1044.7	1.00
PV195	0.8	954.7	953.0	1.00
PV196	0.8	944.4	943.2	1.00
PV197	0.8	955.0	952.8	1.00
PV198	0.8	944.2	943.2	1.00
PV199	0.8	1043.2	1042.2	1.00
PV200	0.8	1042.6	1041.6	1.00
PV201	0.8	1043.1	1042.2	1.00
PV202	0.8	1045.4	1044.8	1.00
PV203	0.8	954.7	952.6	1.00
PV204	0.8	944.1	942.9	1.00
PV205	0.8	1045.9	1045.0	1.00
PV206	0.8	1046.7	1045.1	1.00
PV207	0.8	1046.7	1045.4	1.00
PV208	0.8	1045.2	1043.8	1.00
PV209	0.8	1042.1	1040.8	1.00
PV210	0.8	1041.2	1040.1	1.00
PV211	0.9	1046.1	1044.6	1.00
PV212	0.9	1046.3	1045.1	1.00
PV213	0.9	1046.4	1045.2	1.00
PV214	0.9	1047.1	1045.2	1.00
PV215	0.9	1047.2	1045.6	1.00
PV216	0.9	1047.5	1046.1	1.00
PV217	0.9	1047.6	1046.2	1.00
PV218	0.9	1048.0	1046.5	1.00
PV219	0.9	1048.1	1046.8	1.00
PV220	0.9	1048.4	1047.0	1.00
PV221	0.9	1048.8	1047.2	1.00
PV222	0.9	1048.5	1047.5	1.00
PV223	0.9	1049.0	1047.9	1.00
PV224	0.9	1049.1	1048.0	1.00
PV225	0.9	1049.2	1048.1	1.00
PV226	0.9	1049.6	1048.3	1.00
PV227	0.9	1049.7	1048.6	1.00
PV228	0.9	1050.0	1048.8	1.00
PV229	0.8	681.8	681.8	1.00
PV230	0.8	777.0	771.5	0.99
PV231	0.8	812.4	797.2	0.98
PV232	0.8	826.9	808.9	0.98
PV233	0.8	835.1	816.1	0.98
PV234	0.8	840.5	821.4	0.98
PV235	0.8	687.7	687.7	1.00
PV236	0.8	778.7	774.4	0.99
PV237	0.8	810.6	802.2	0.99
PV238	0.8	823.8	814.6	0.99
PV239	0.8	830.3	821.4	0.99
PV240	0.8	833.1	824.8	0.99
PV241	0.8	833.8	825.3	0.99
PV242	0.8	831.0	822.9	0.99
PV243	0.8	820.0	812.1	0.99
PV244	0.8	783.2	775.2	0.99
PV245	0.8	358.3	358.3	1.00
PV246	0.8	397.8	397.8	1.00
PV247	0.8	413.1	413.1	1.00
PV248	0.8	420.1	420.1	1.00
PV249	0.8	423.4	423.4	1.00
PV250	0.8	424.3	424.3	1.00
PV251	0.8	423.7	423.7	1.00
PV252	0.8	420.8	420.8	1.00

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Project: Ashley Road
Tottenham Hale

Title:

Drawn: TR | Checked: --

Date: 07/08/2026 | Project: 10106

Rel no.: 08 | Prefix: PV01 | Page no.: 12

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV253	0.8	412.2	412.2	1.00
PV254	0.8	387.5	387.5	1.00
PV255	0.9	994.4	994.4	1.00
PV256	0.9	993.1	993.1	1.00
PV257	0.9	986.3	986.3	1.00
PV258	0.9	970.8	970.8	1.00
PV259	0.9	923.7	923.7	1.00
PV260	0.9	767.4	767.6	1.00
PV261	0.9	969.8	969.8	1.00
PV262	0.9	991.4	991.4	1.00
PV263	0.9	999.6	999.6	1.00
PV264	0.9	1002.9	1002.9	1.00
PV265	0.9	1002.6	1002.6	1.00
PV266	0.9	1000.0	1000.0	1.00
PV267	0.9	992.8	992.8	1.00
PV268	0.9	976.5	976.5	1.00
PV269	0.9	928.2	928.3	1.00
PV270	0.9	770.9	771.1	1.00
PV271	0.9	996.9	996.9	1.00
PV272	0.9	1004.7	1004.7	1.00
PV273	0.9	1007.2	1007.2	1.00
PV274	0.9	1007.1	1007.1	1.00
PV275	0.9	1003.6	1003.6	1.00
PV276	0.9	999.3	999.3	1.00
PV277	0.9	991.5	991.5	1.00
PV278	0.9	974.9	975.1	1.00
PV279	0.9	926.6	926.7	1.00
PV280	0.9	769.0	769.1	1.00
PV281	0.9	1001.1	1001.1	1.00
PV282	0.9	997.6	997.6	1.00
PV283	0.9	989.3	989.4	1.00
PV284	0.9	972.8	972.8	1.00
PV285	0.9	924.4	924.3	1.00
PV286	0.9	766.8	766.5	1.00
PV287	0.9	1003.3	1003.3	1.00
PV288	0.9	1002.5	1002.5	1.00
PV289	0.9	998.6	998.7	1.00
PV290	0.9	993.9	993.9	1.00
PV291	0.9	985.1	985.2	1.00
PV292	0.9	968.3	968.2	1.00
PV293	0.9	920.2	920.1	1.00
PV294	0.9	763.2	763.2	1.00
PV295	0.9	985.2	985.2	1.00
PV296	0.9	982.7	982.5	1.00
PV297	0.9	974.0	974.0	1.00
PV298	0.9	958.7	958.6	1.00
PV299	0.9	914.1	913.9	1.00
PV300	0.9	759.0	758.8	1.00
PV301	0.9	915.6	915.4	1.00
PV302	0.9	926.6	926.6	1.00
PV303	0.9	934.7	934.7	1.00
PV304	0.9	934.0	933.9	1.00
PV305	0.9	901.1	901.2	1.00
PV306	0.9	751.1	751.2	1.00
PV307	0.9	877.1	876.9	1.00
PV308	0.9	740.8	740.8	1.00
PV309	0.9	861.0	861.0	1.00
PV310	0.9	733.2	733.2	1.00
PV311	0.9	862.6	862.6	1.00
PV312	0.9	735.5	735.5	1.00
PV313	0.8	920.5	886.1	0.96
PV314	0.8	917.4	883.7	0.96
PV315	0.8	884.5	851.1	0.96
PV316	0.8	750.2	717.1	0.96
PV317	0.8	721.5	716.6	0.99
PV318	0.8	804.8	788.1	0.98
PV319	0.8	864.5	837.8	0.97
PV320	0.8	907.6	874.8	0.96
PV321	0.8	931.8	897.7	0.96
PV322	0.8	945.0	911.6	0.96
PV323	0.8	952.6	919.1	0.96
PV324	0.8	945.7	912.9	0.97
PV325	0.8	908.8	876.4	0.96
PV326	0.8	768.4	736.1	0.96
PV327	0.8	718.3	708.6	0.99
PV328	0.8	801.3	779.3	0.97
PV329	0.8	861.5	832.5	0.97
PV330	0.8	899.0	869.5	0.97
PV331	0.8	921.5	892.6	0.97
PV332	0.8	934.5	905.7	0.97
PV333	0.8	939.5	910.8	0.97
PV334	0.8	930.8	902.9	0.97
PV335	0.8	893.9	866.3	0.97
PV336	0.8	755.6	728.4	0.96
PV337	0.8	766.8	753.2	0.98
PV338	0.8	792.7	779.5	0.98
PV339	0.8	808.9	795.7	0.98
PV340	0.8	818.2	805.7	0.98
PV341	0.8	821.7	808.8	0.98
PV342	0.8	815.5	802.6	0.98
PV343	0.8	785.9	773.6	0.98
PV344	0.8	666.2	653.9	0.98

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey


NORTH

Project: Ashley Road
Tottenham Hale

Title:

Drawn: TR
Checked: --
Date: 07/08/2026
Project: 10106
Rel no.: 08
Prefix: PV01
Page no.: 13

Cumulative Scenario

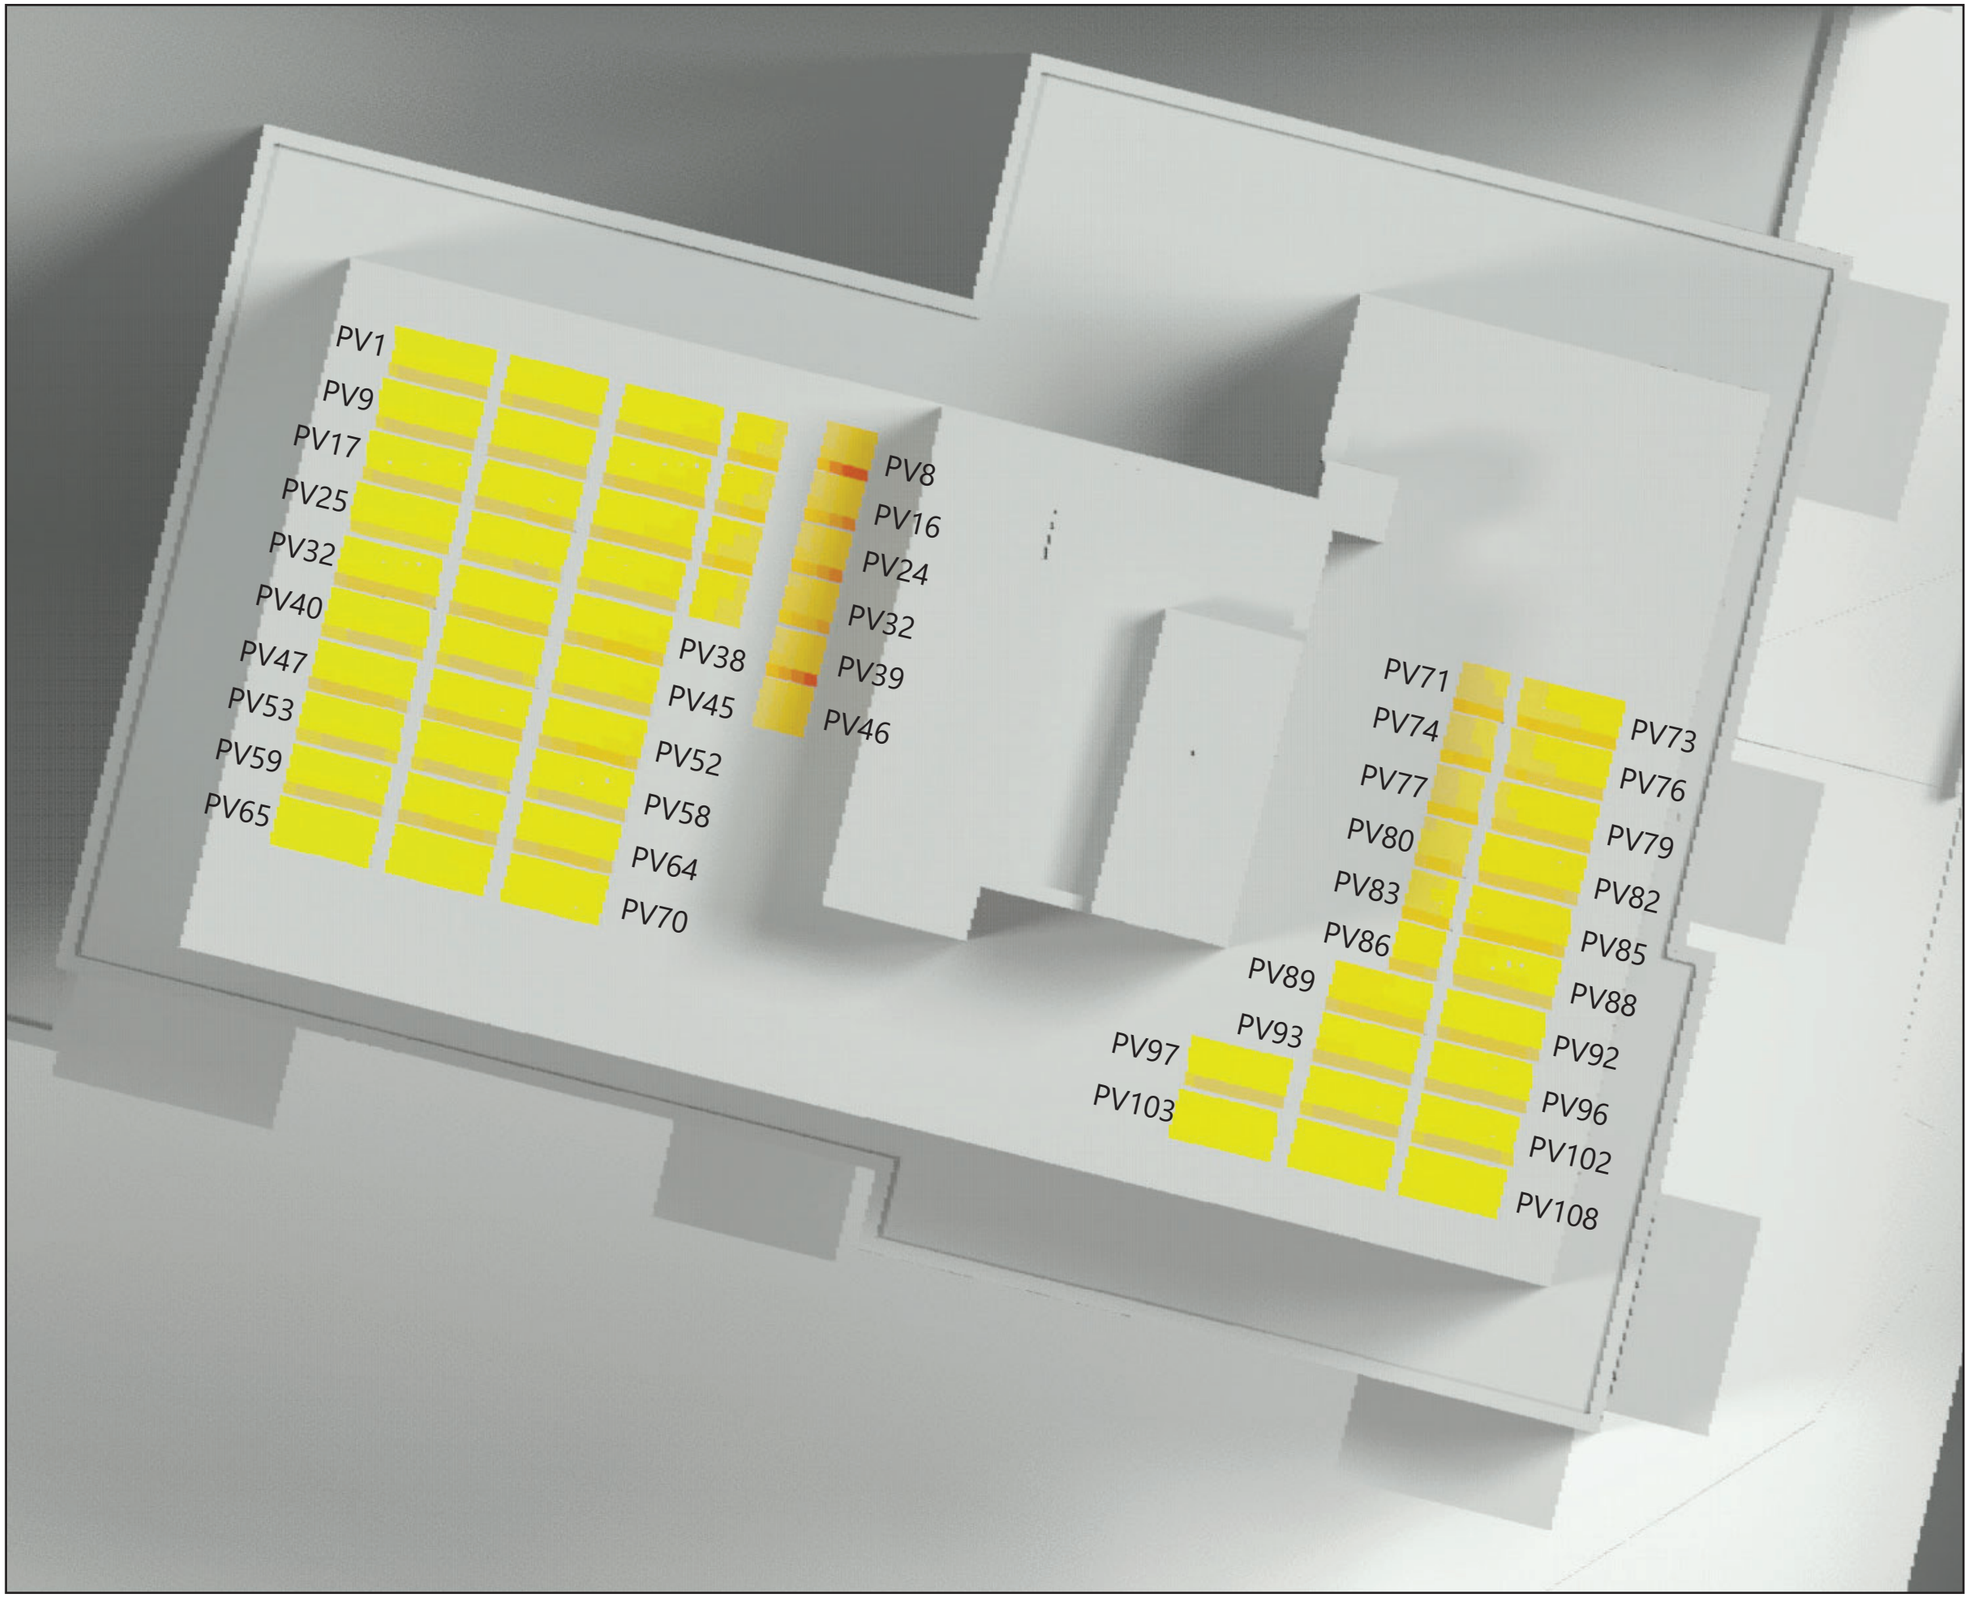

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Sessile Apartments
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV02	01

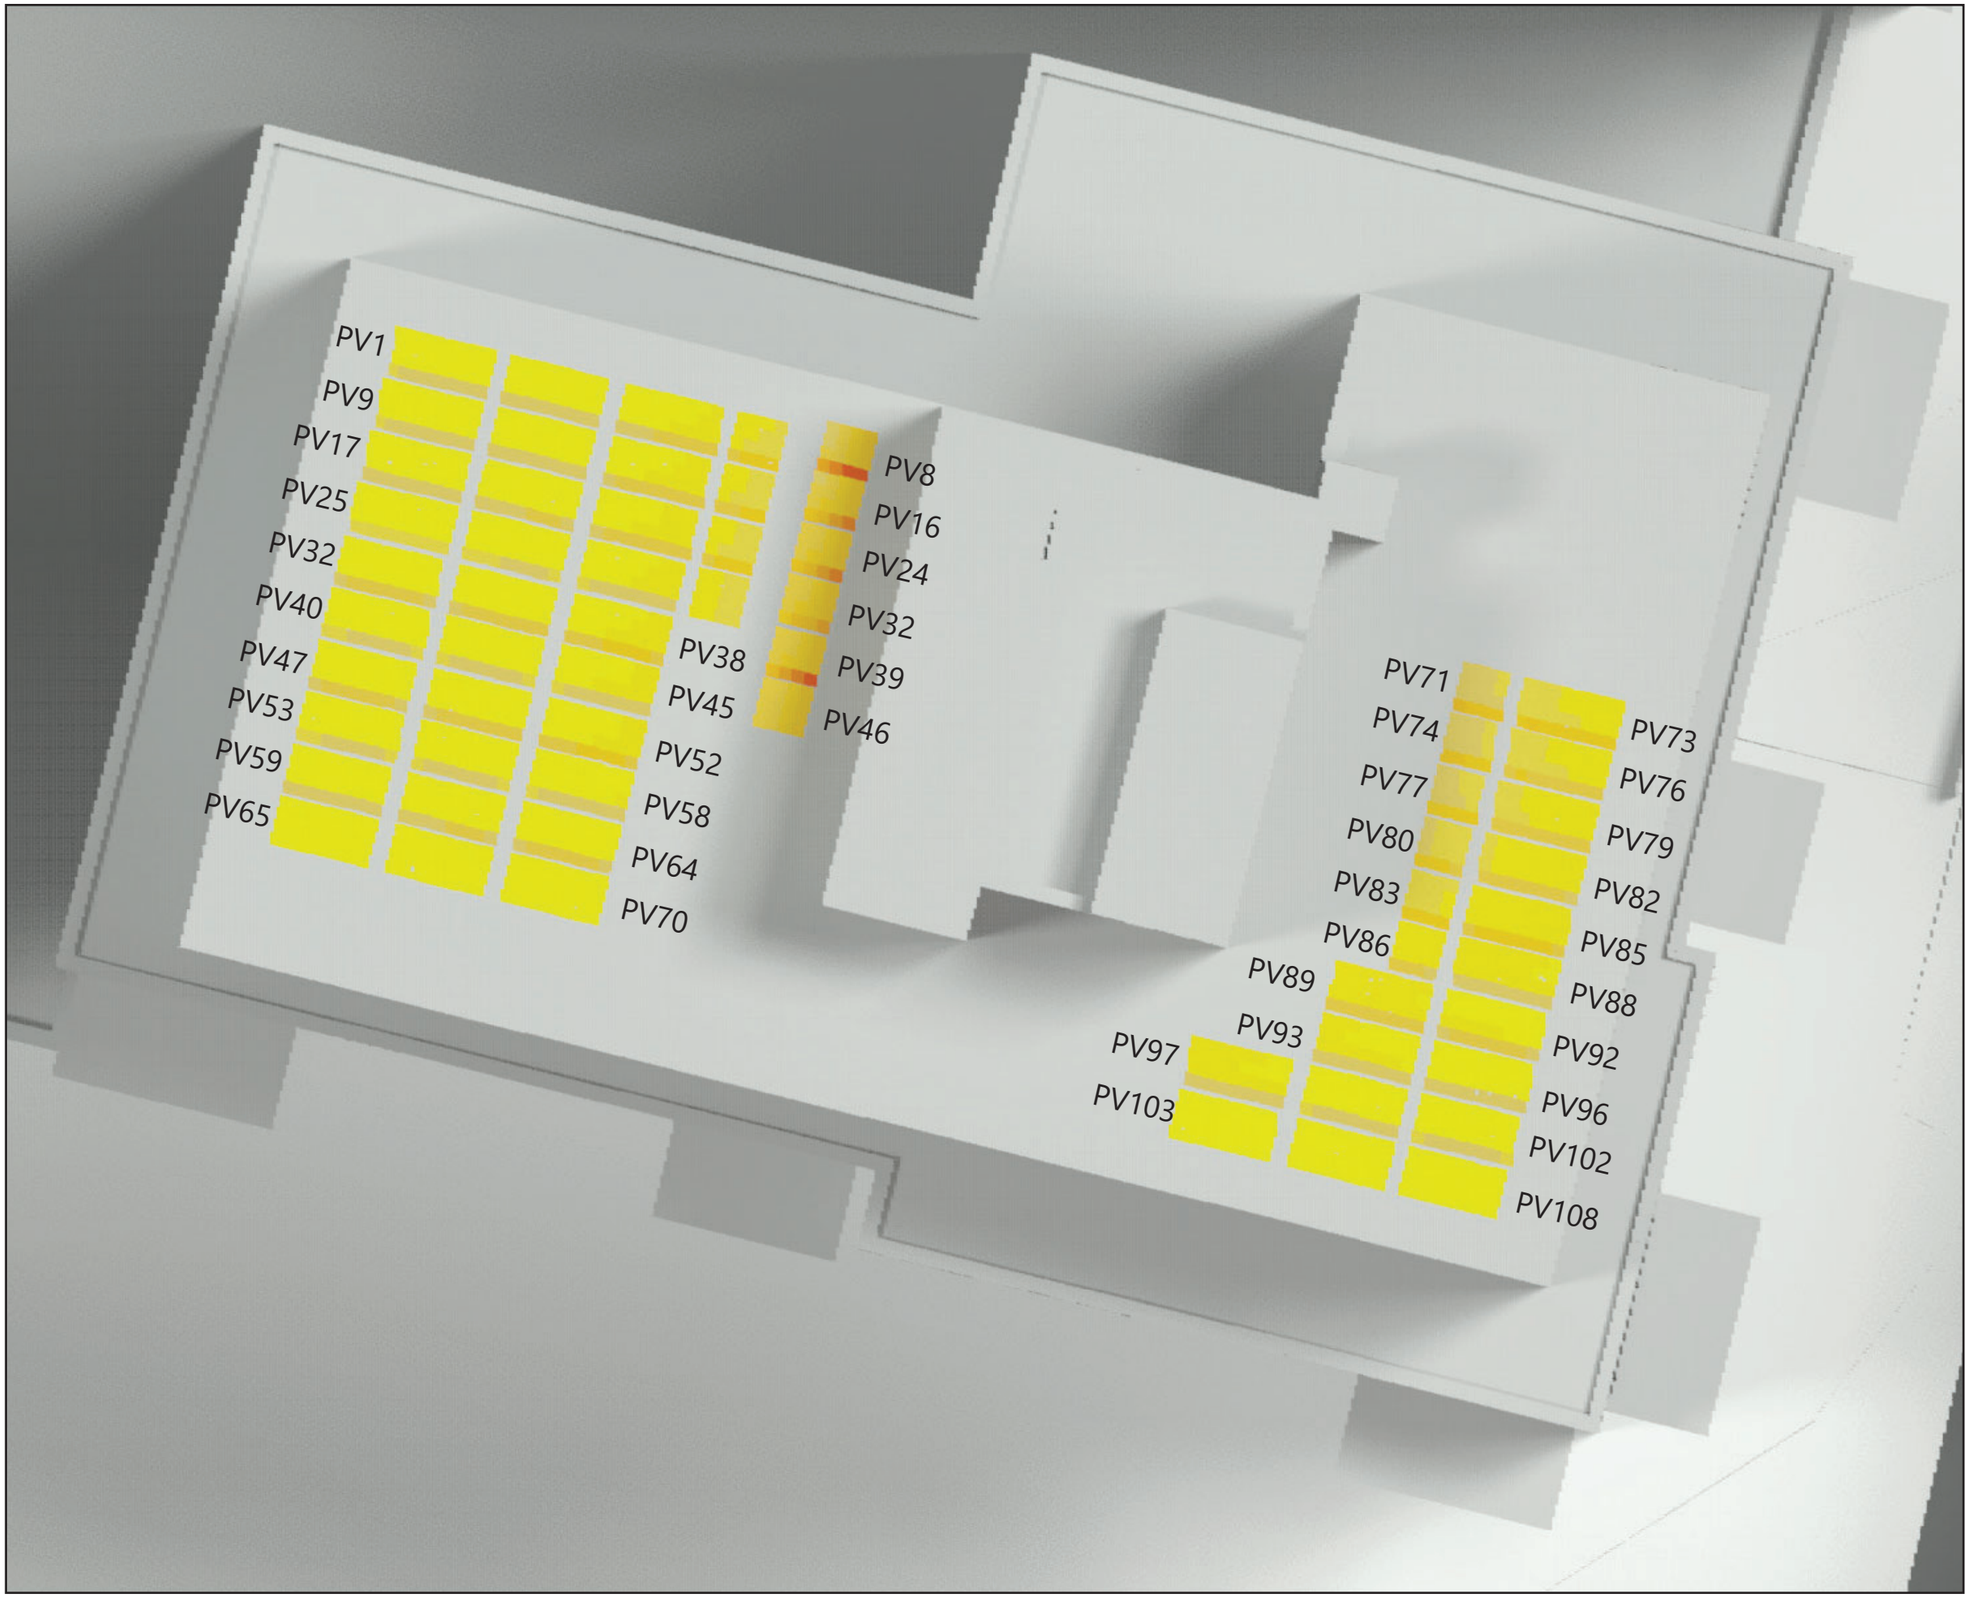

Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Sessile Apartments
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV02	02

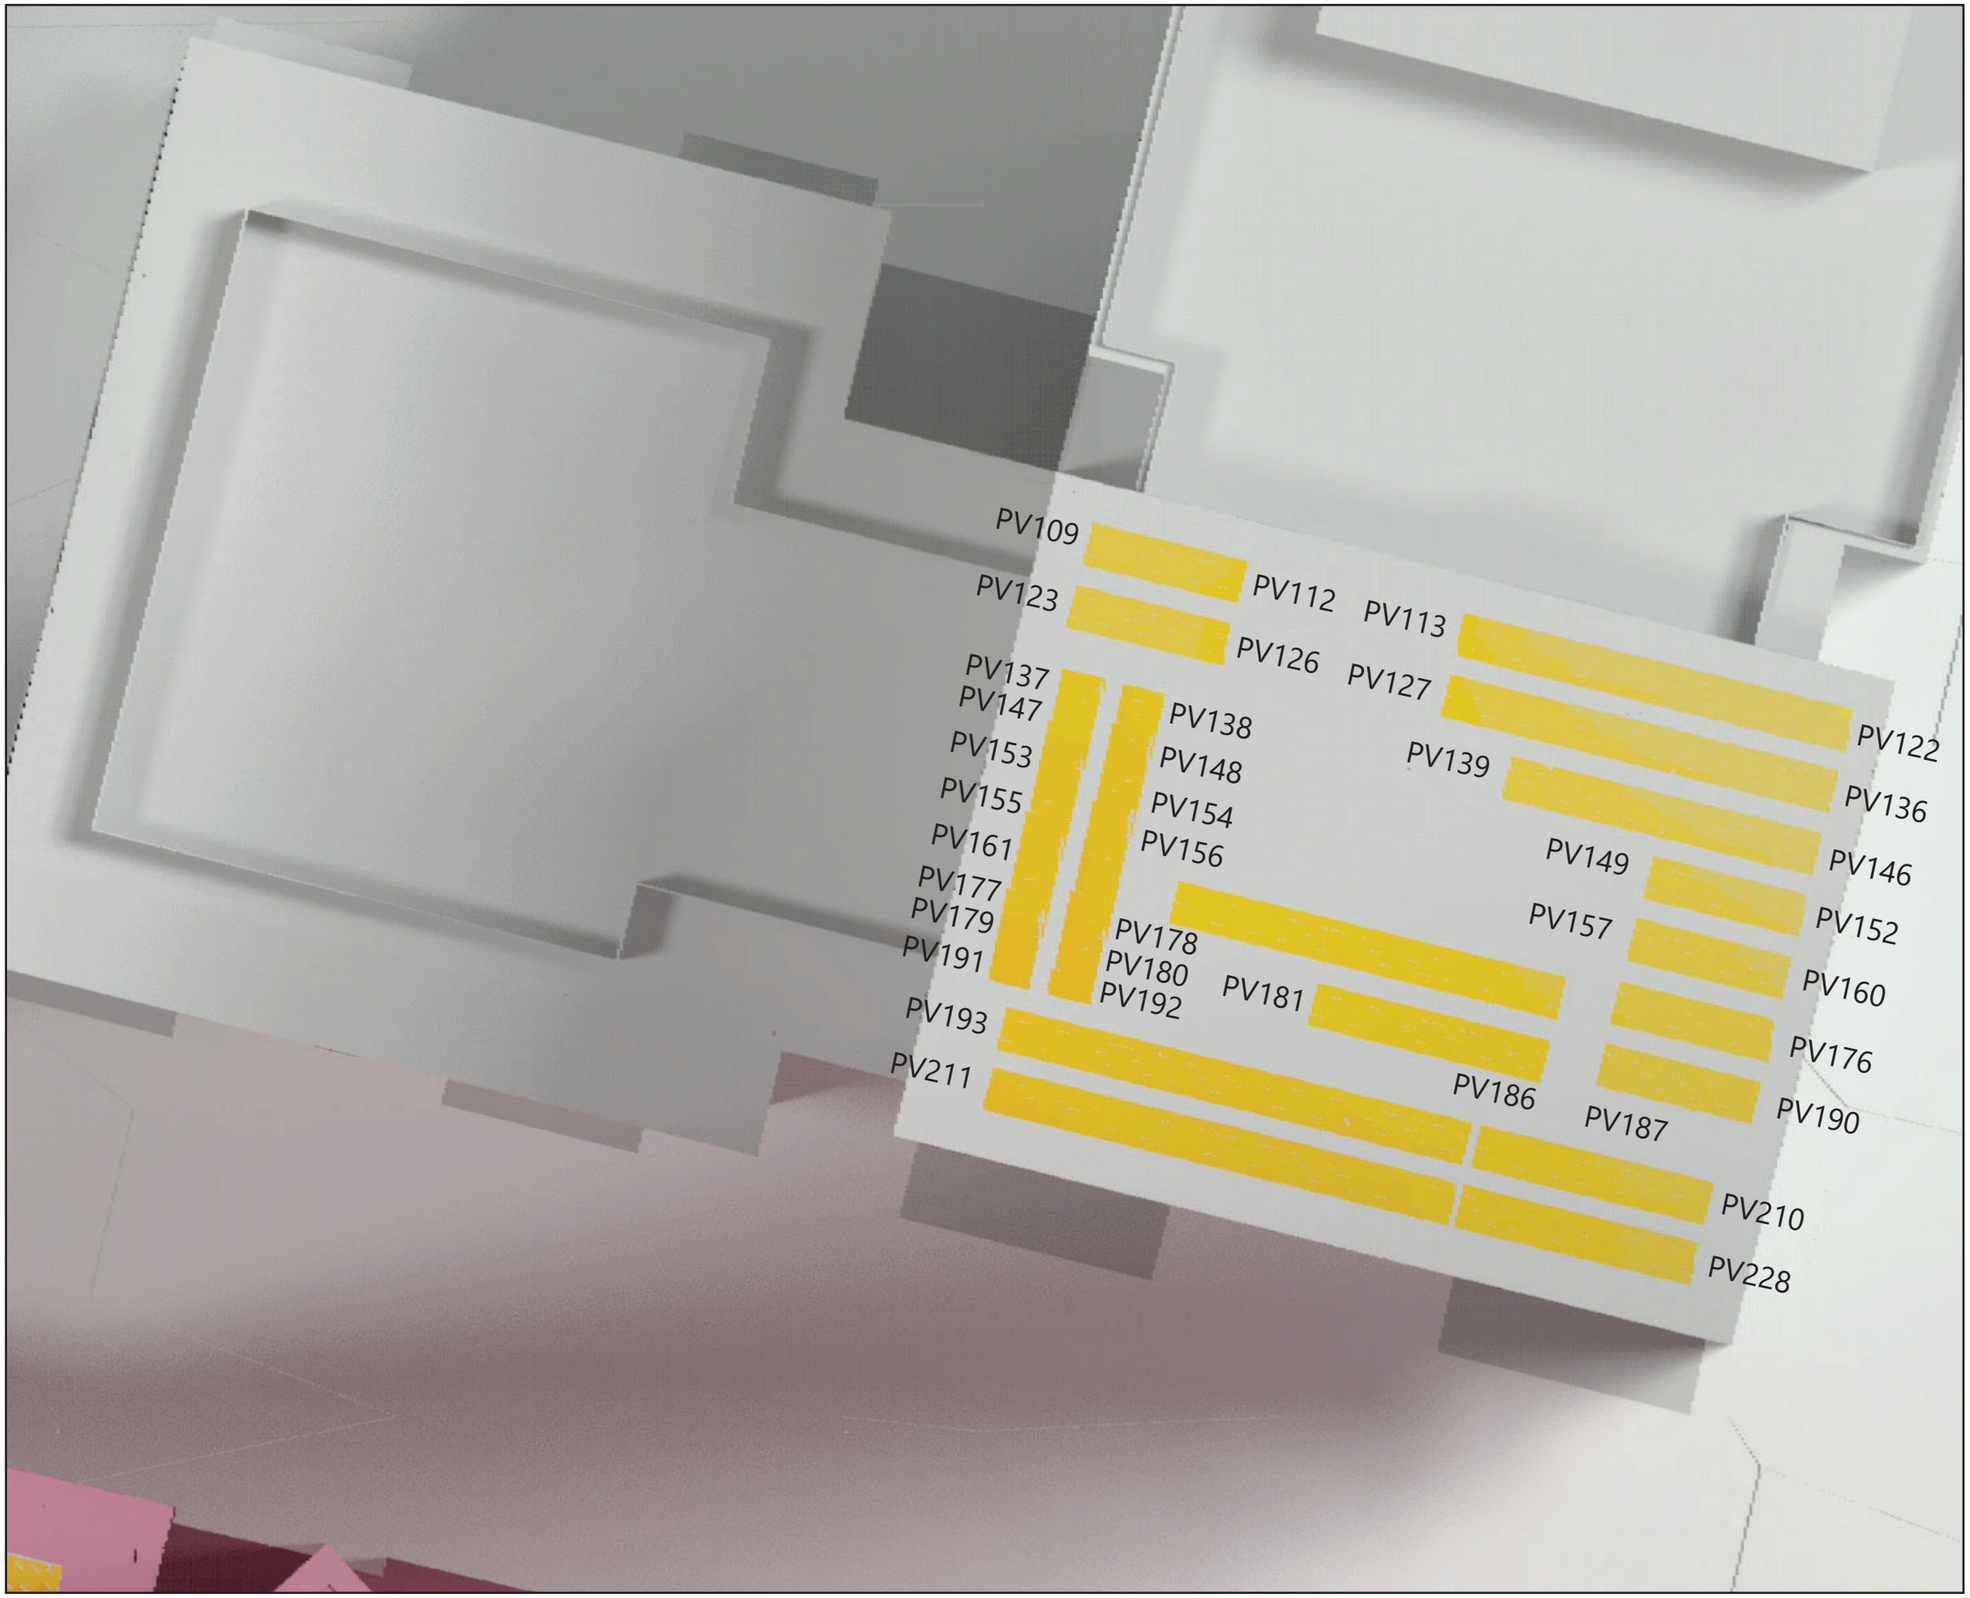

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
The Gessner
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV02
Page no.: 03

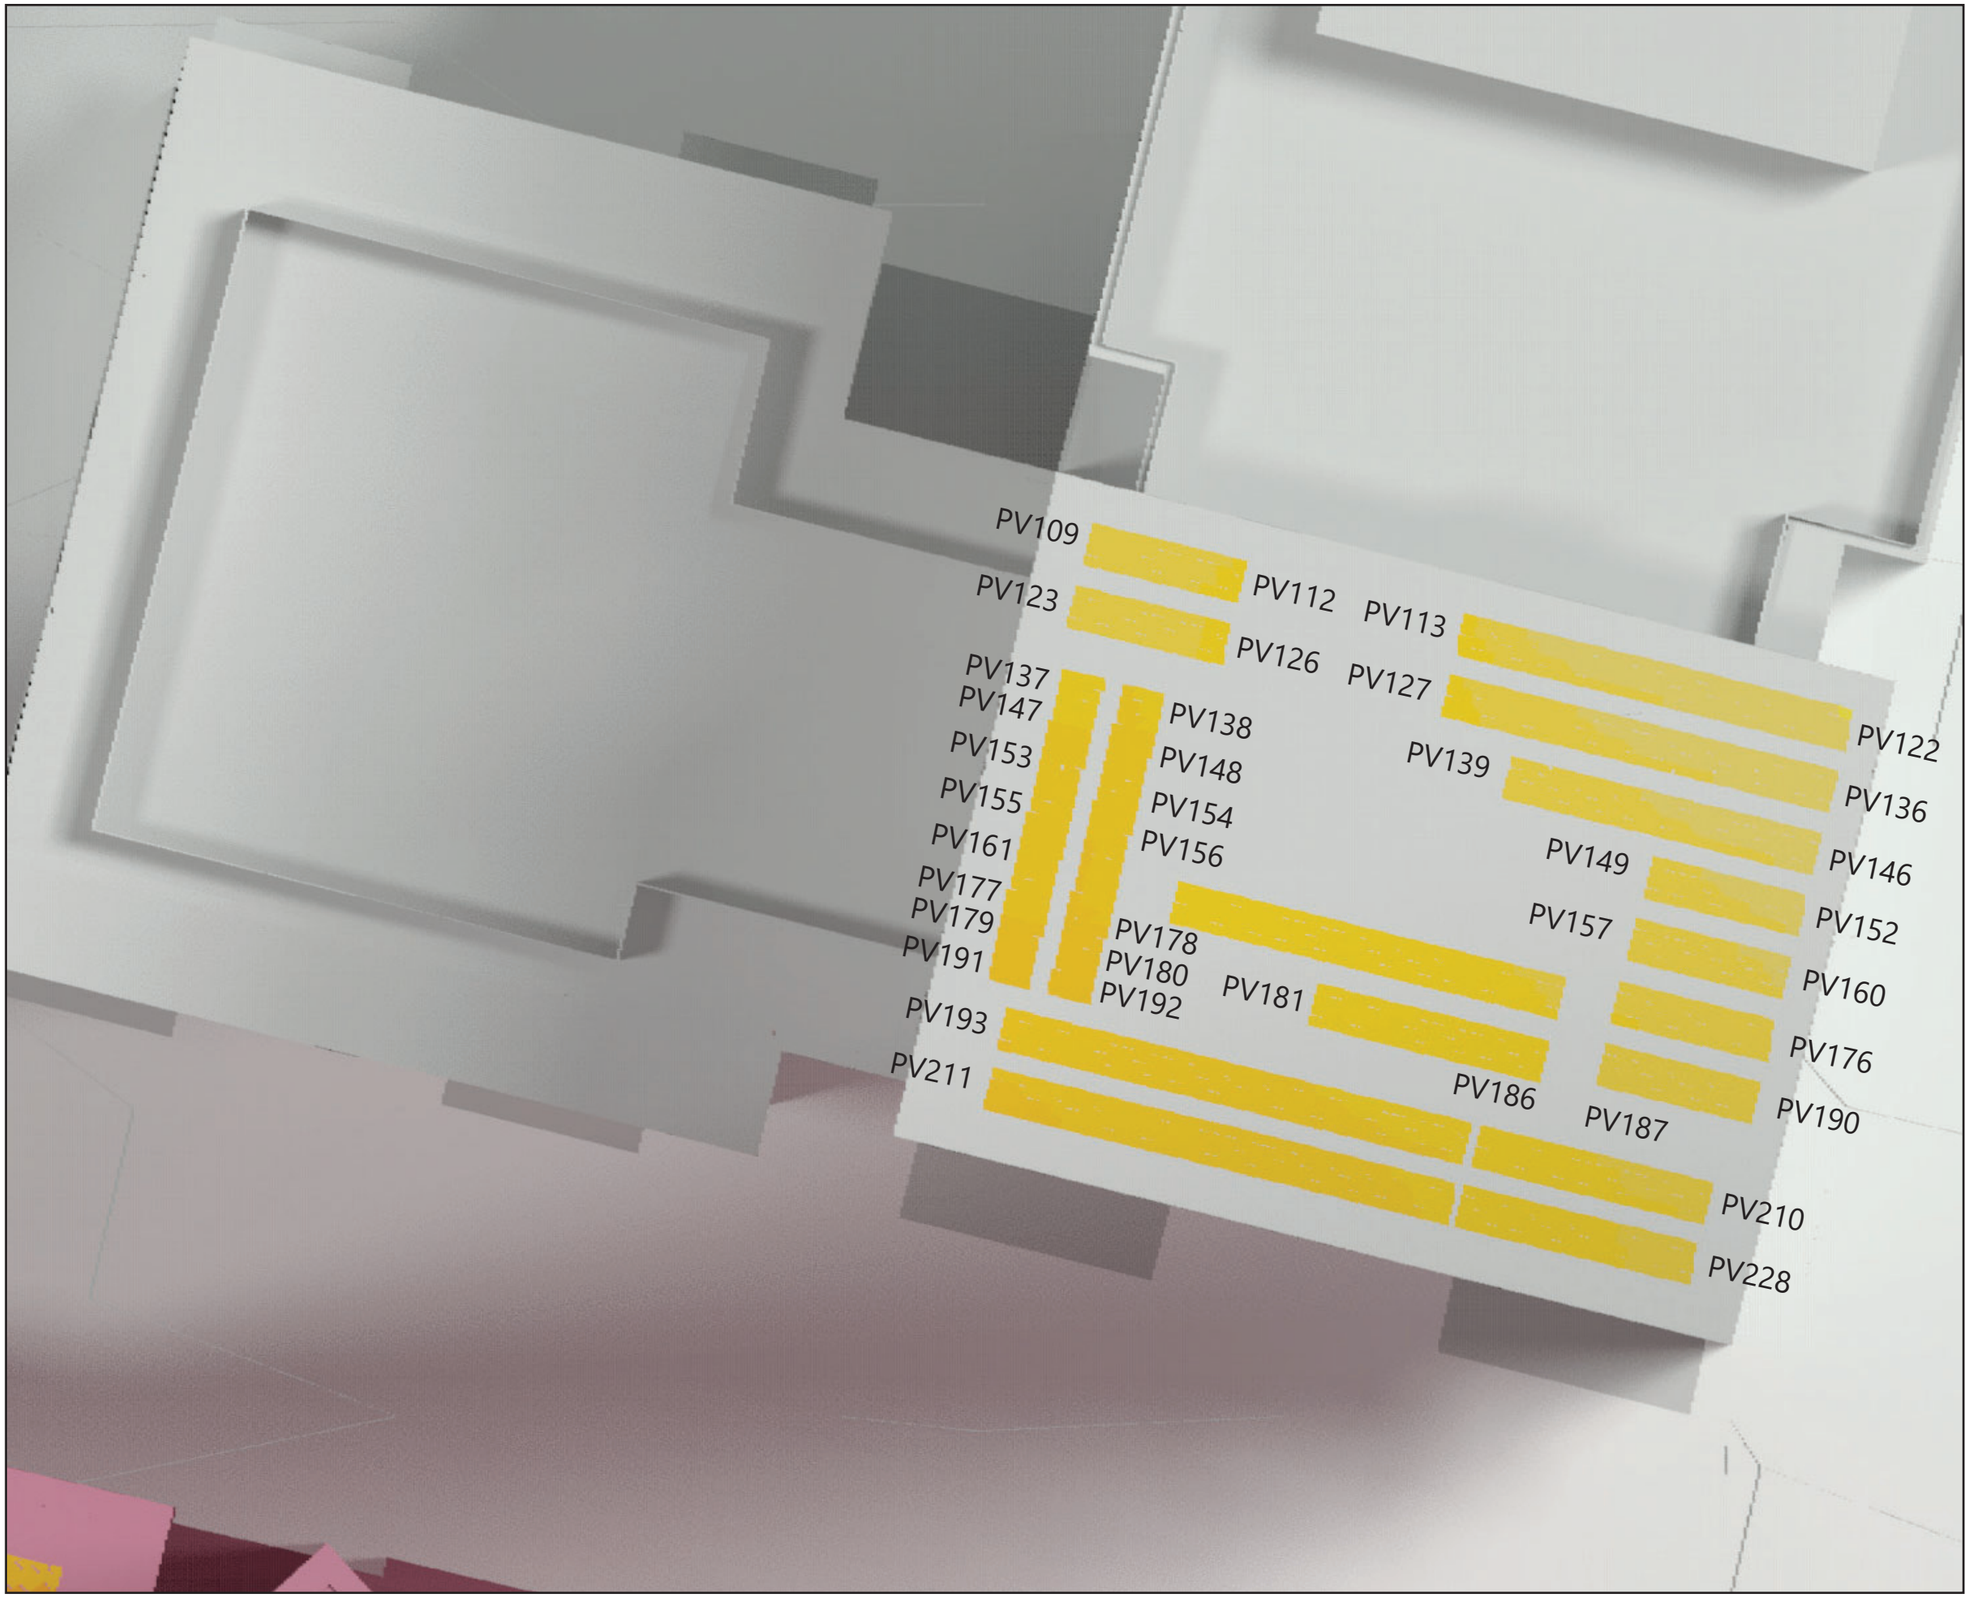

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
The Gessner
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV02
Page no.: 04

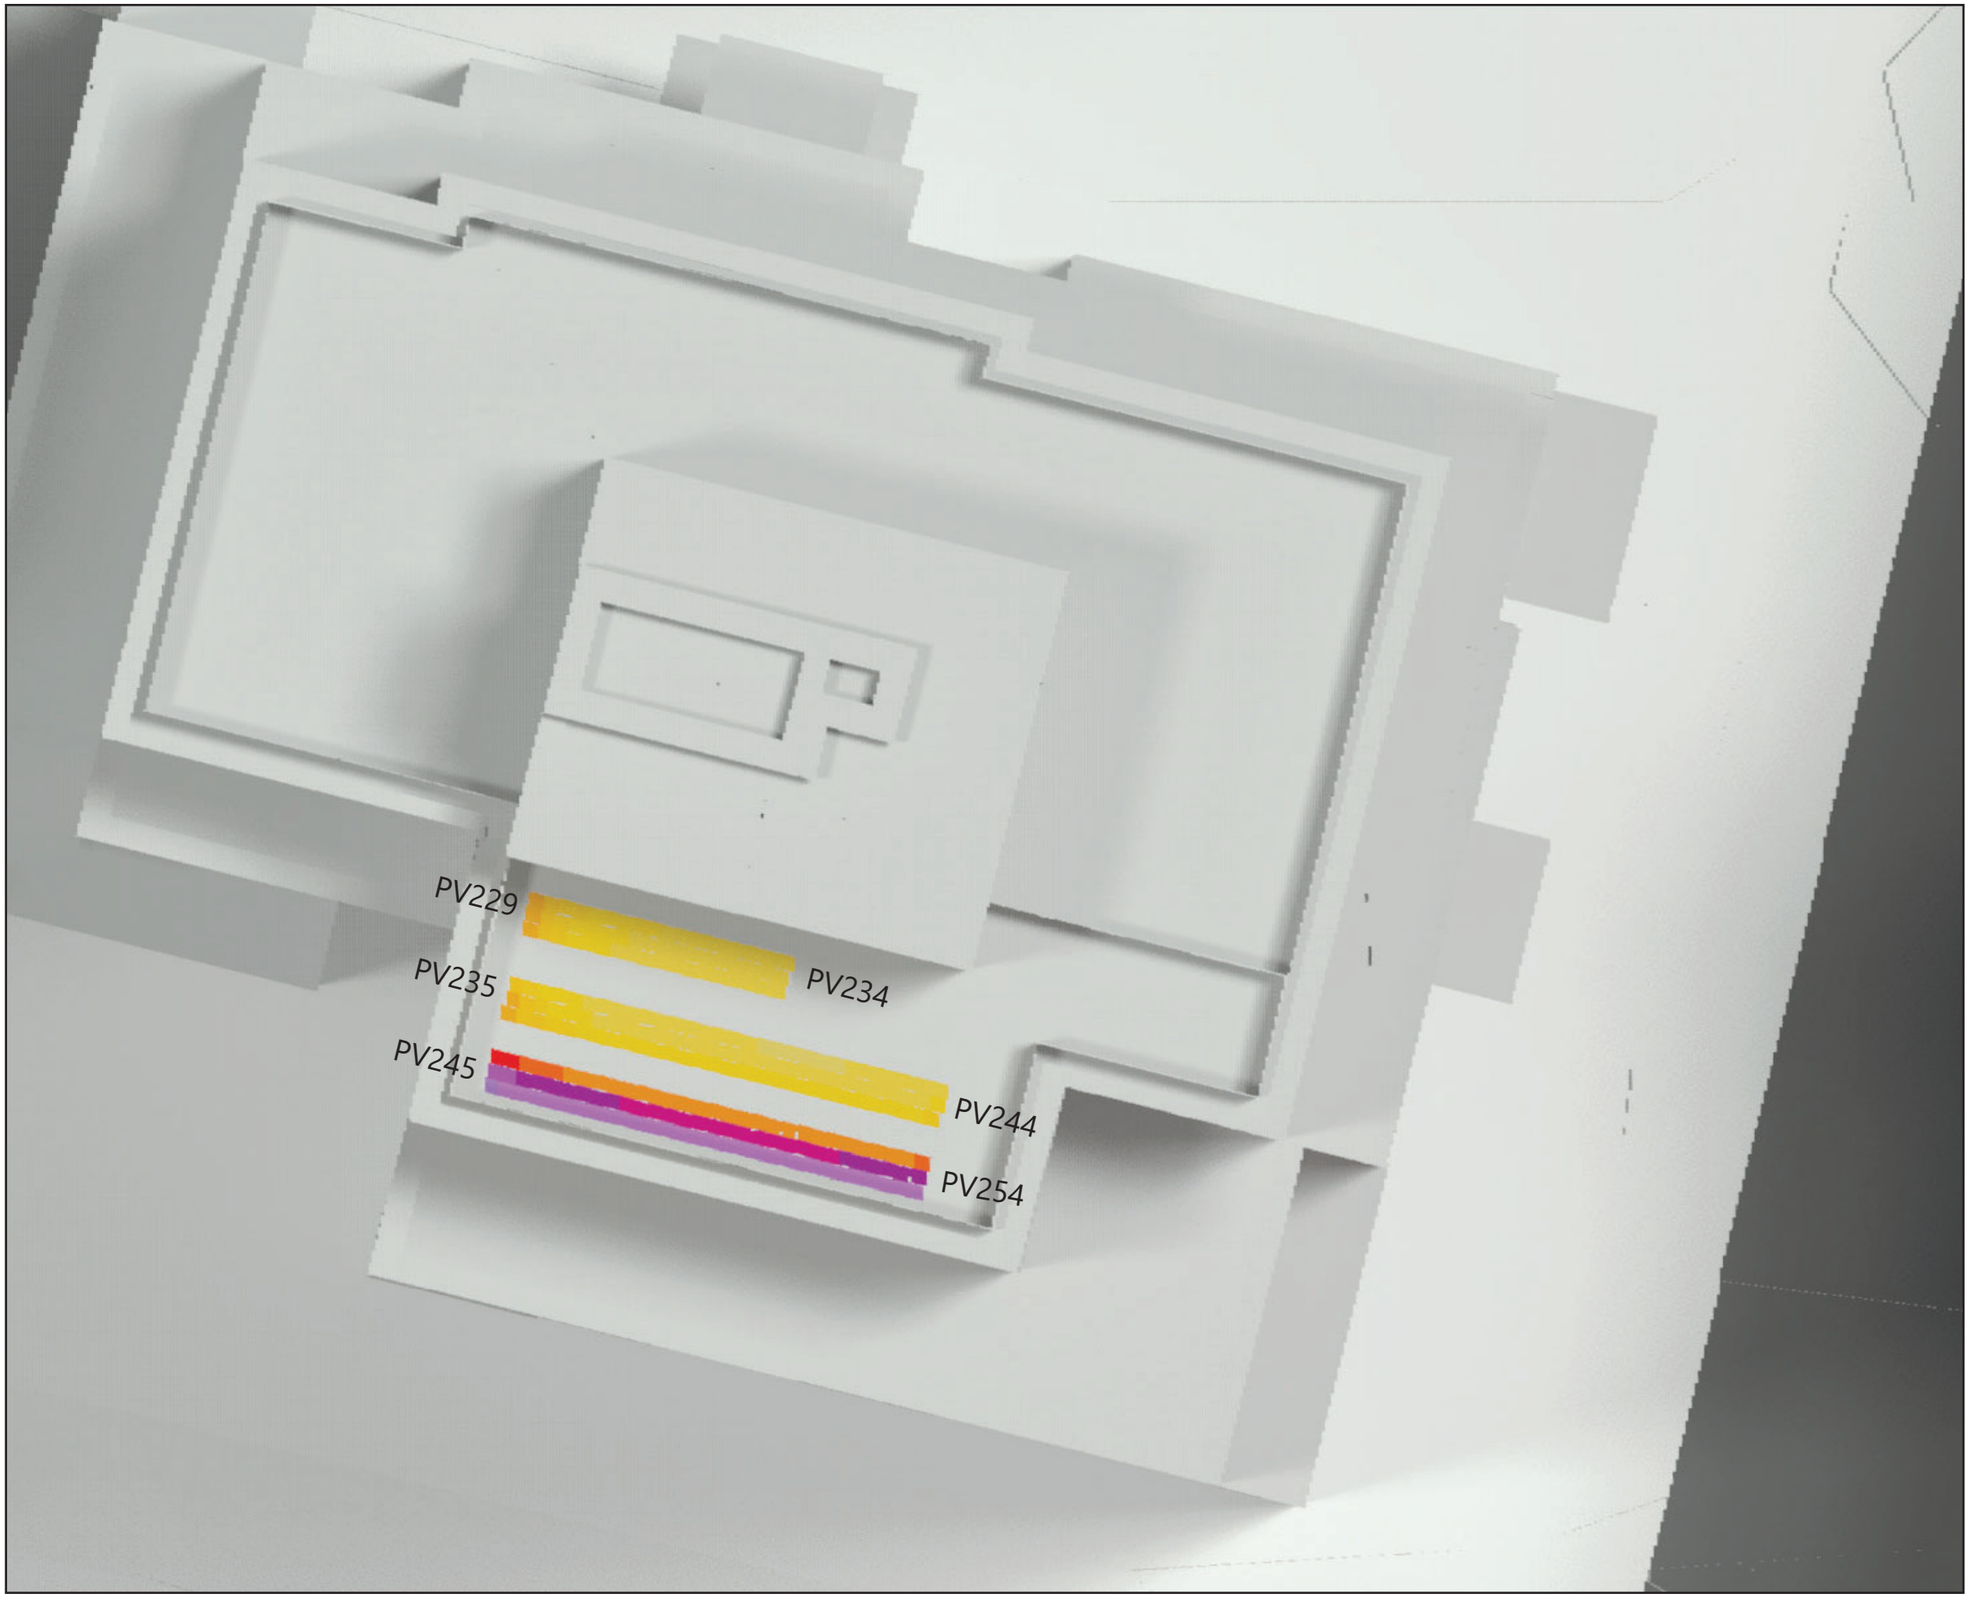

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project
Ashley Road
Tottenham Hale

Title
Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV02	05

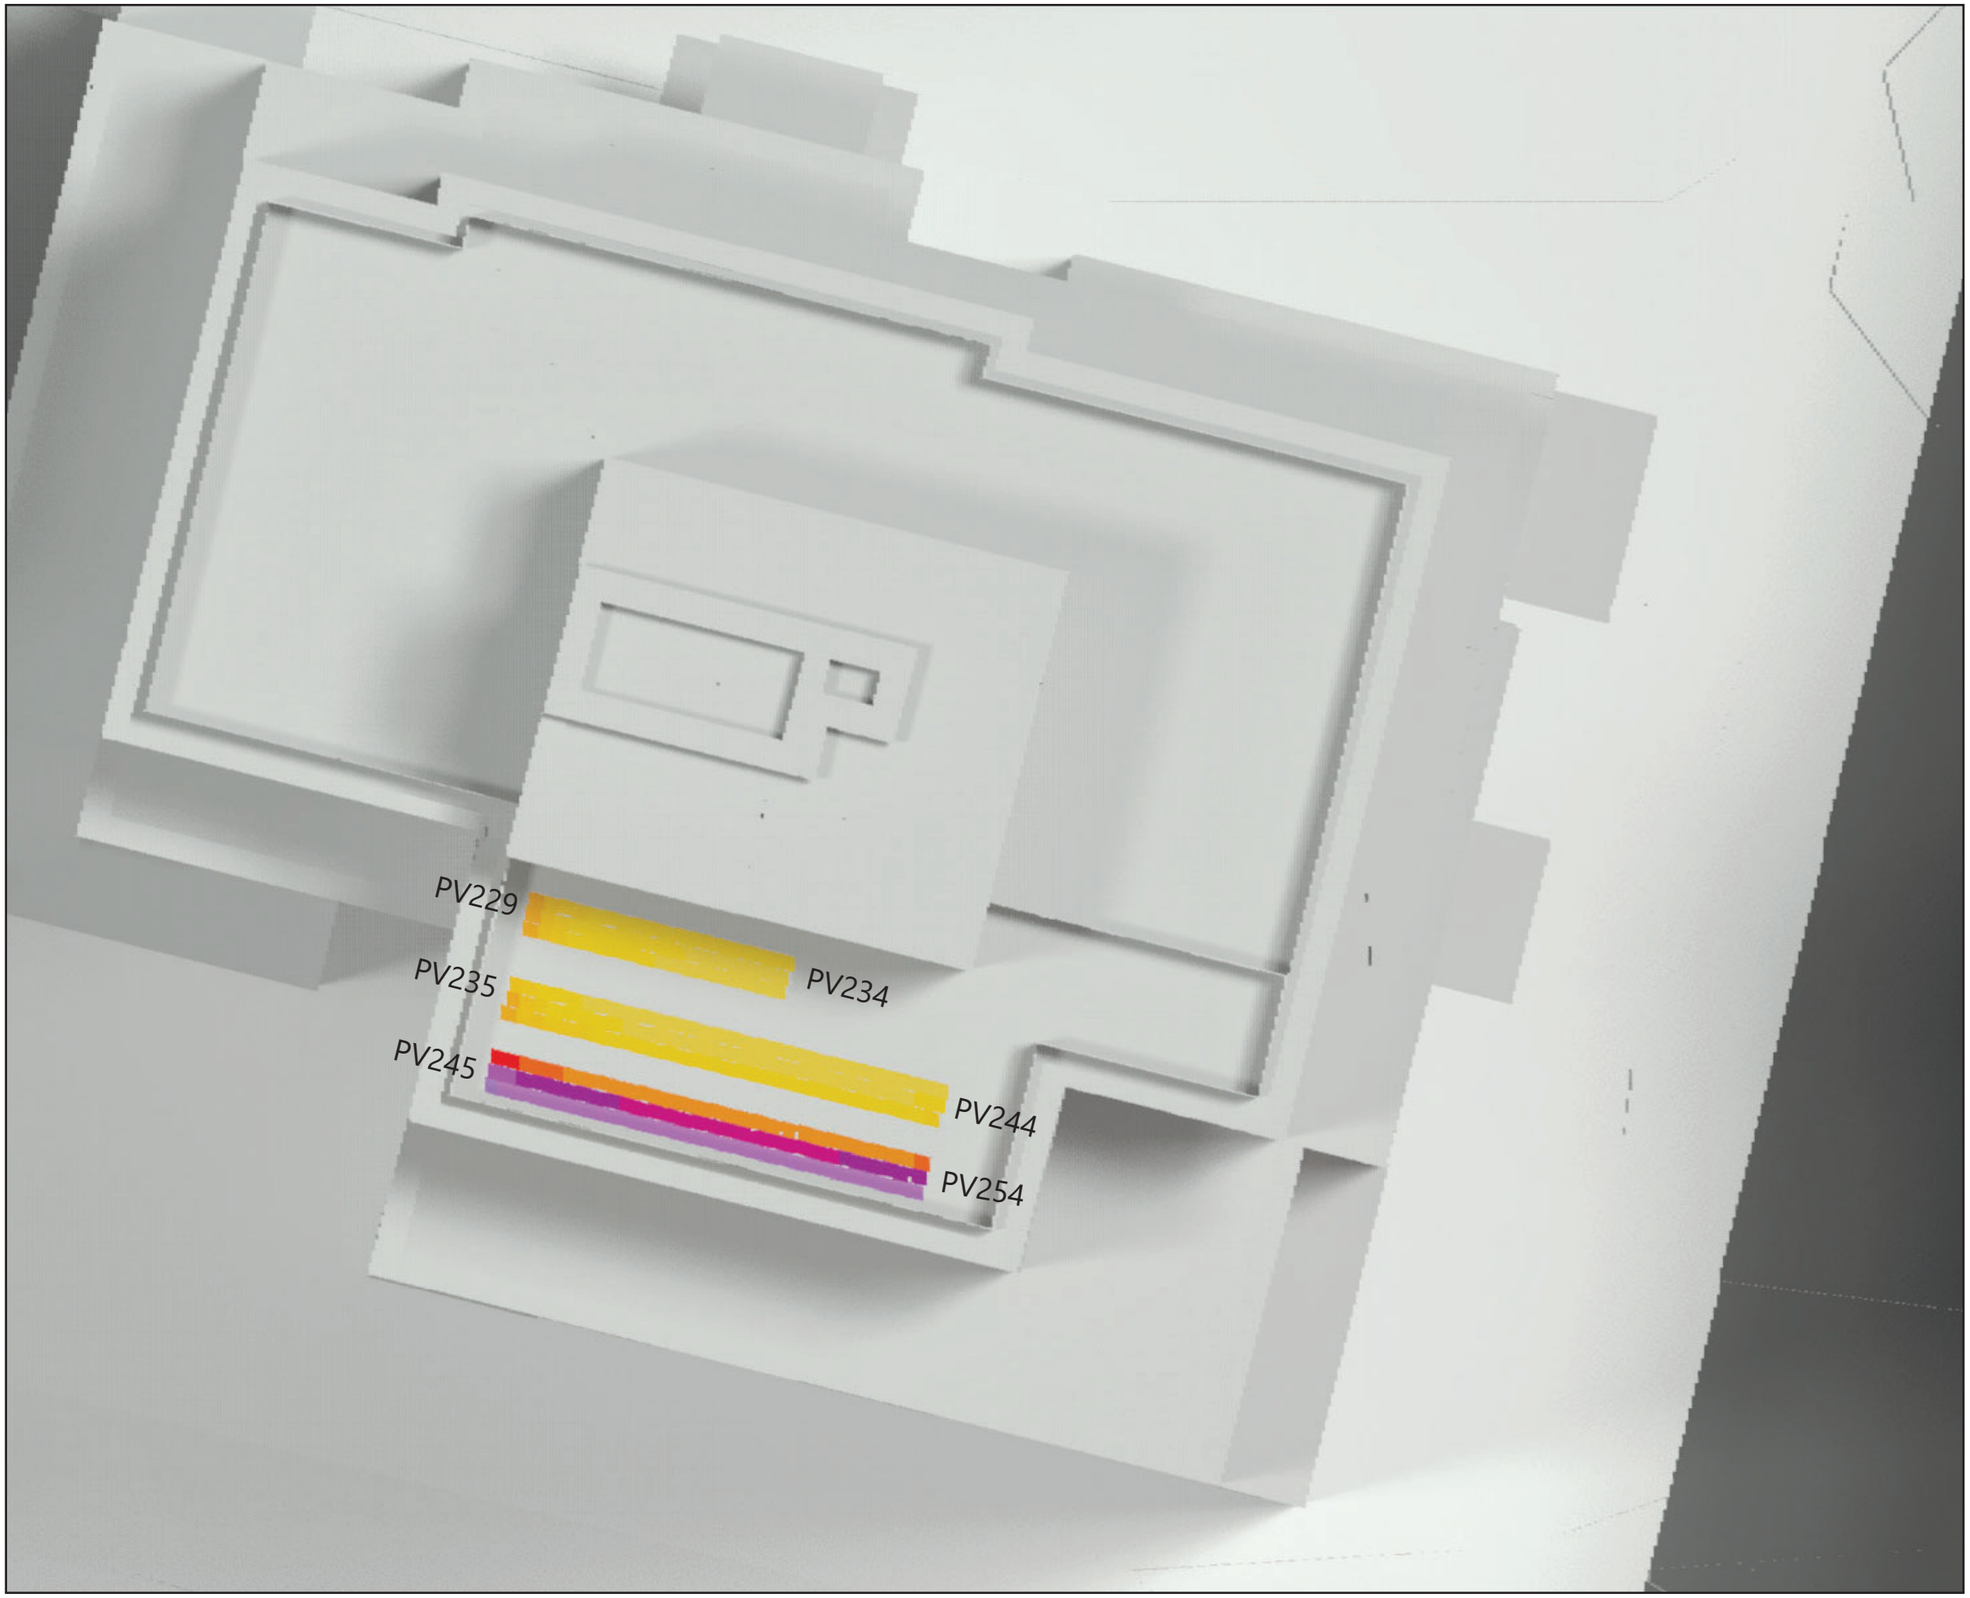

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project
Ashley Road
Tottenham Hale

Title
Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn	Checked
TR	--

Date	Project
07/08/2026	10106

Rel no.	Prefix	Page no.
08	PV02	06

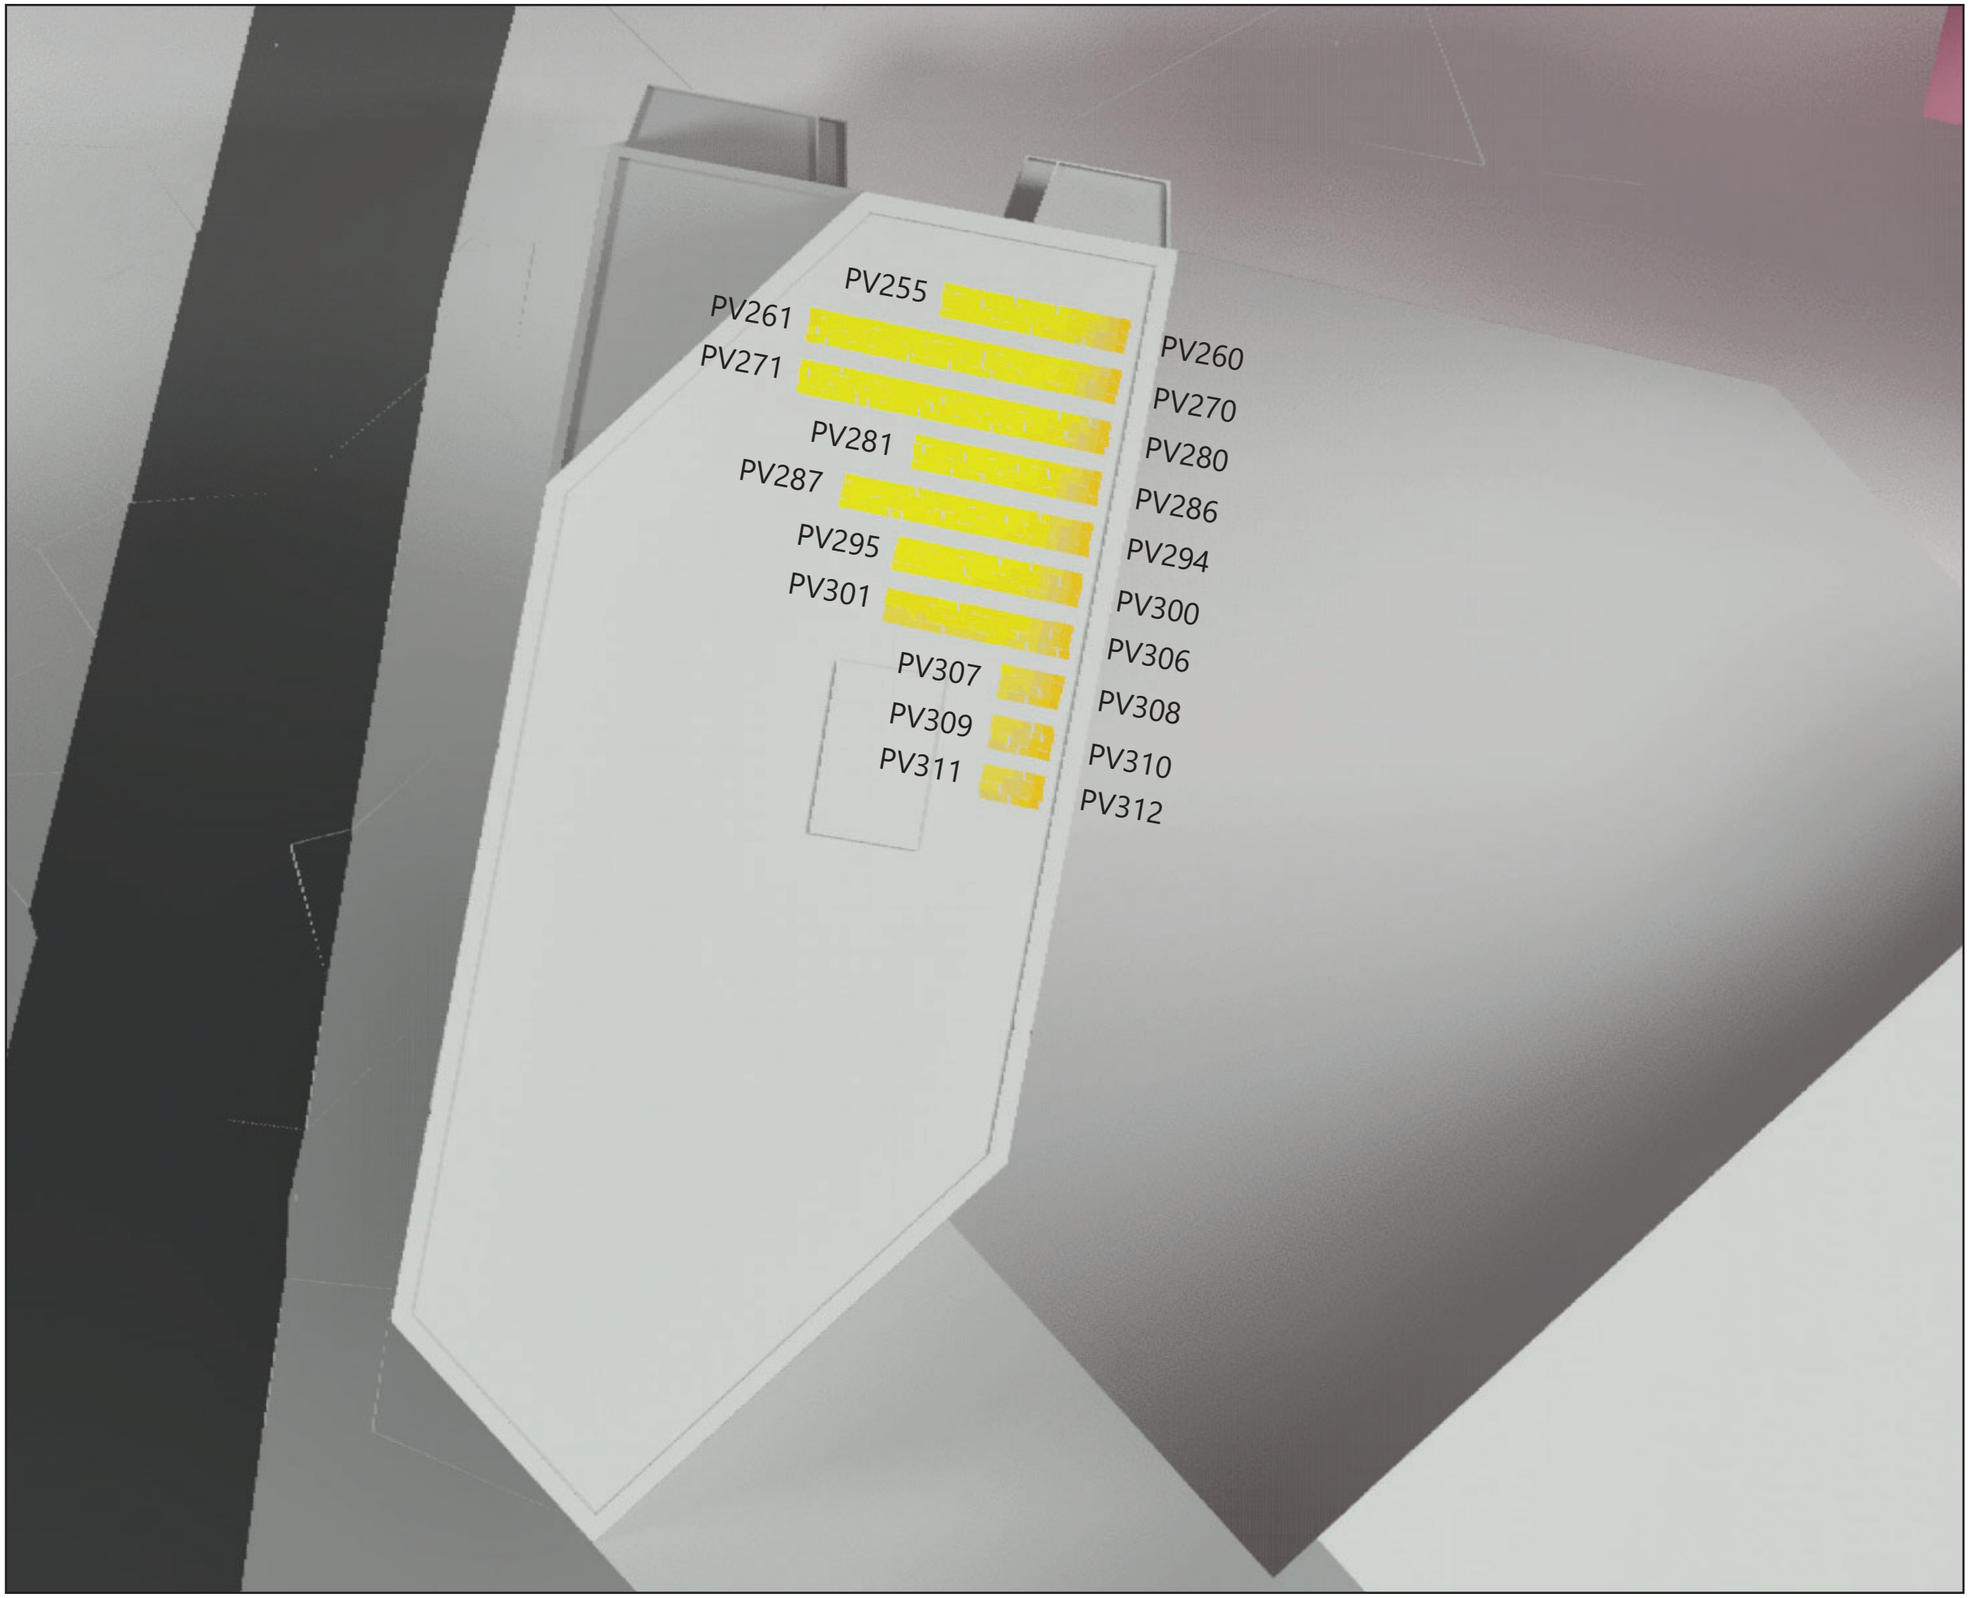

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026


EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH

Project	Ashley Road Tottenham Hale
Title	Sunlight Study East Apartments 21st March
Drawn	TR
Checked	--
Date	07/08/2026
Project	10106
Rel no.	08
Prefix	PV02
Page no.	07

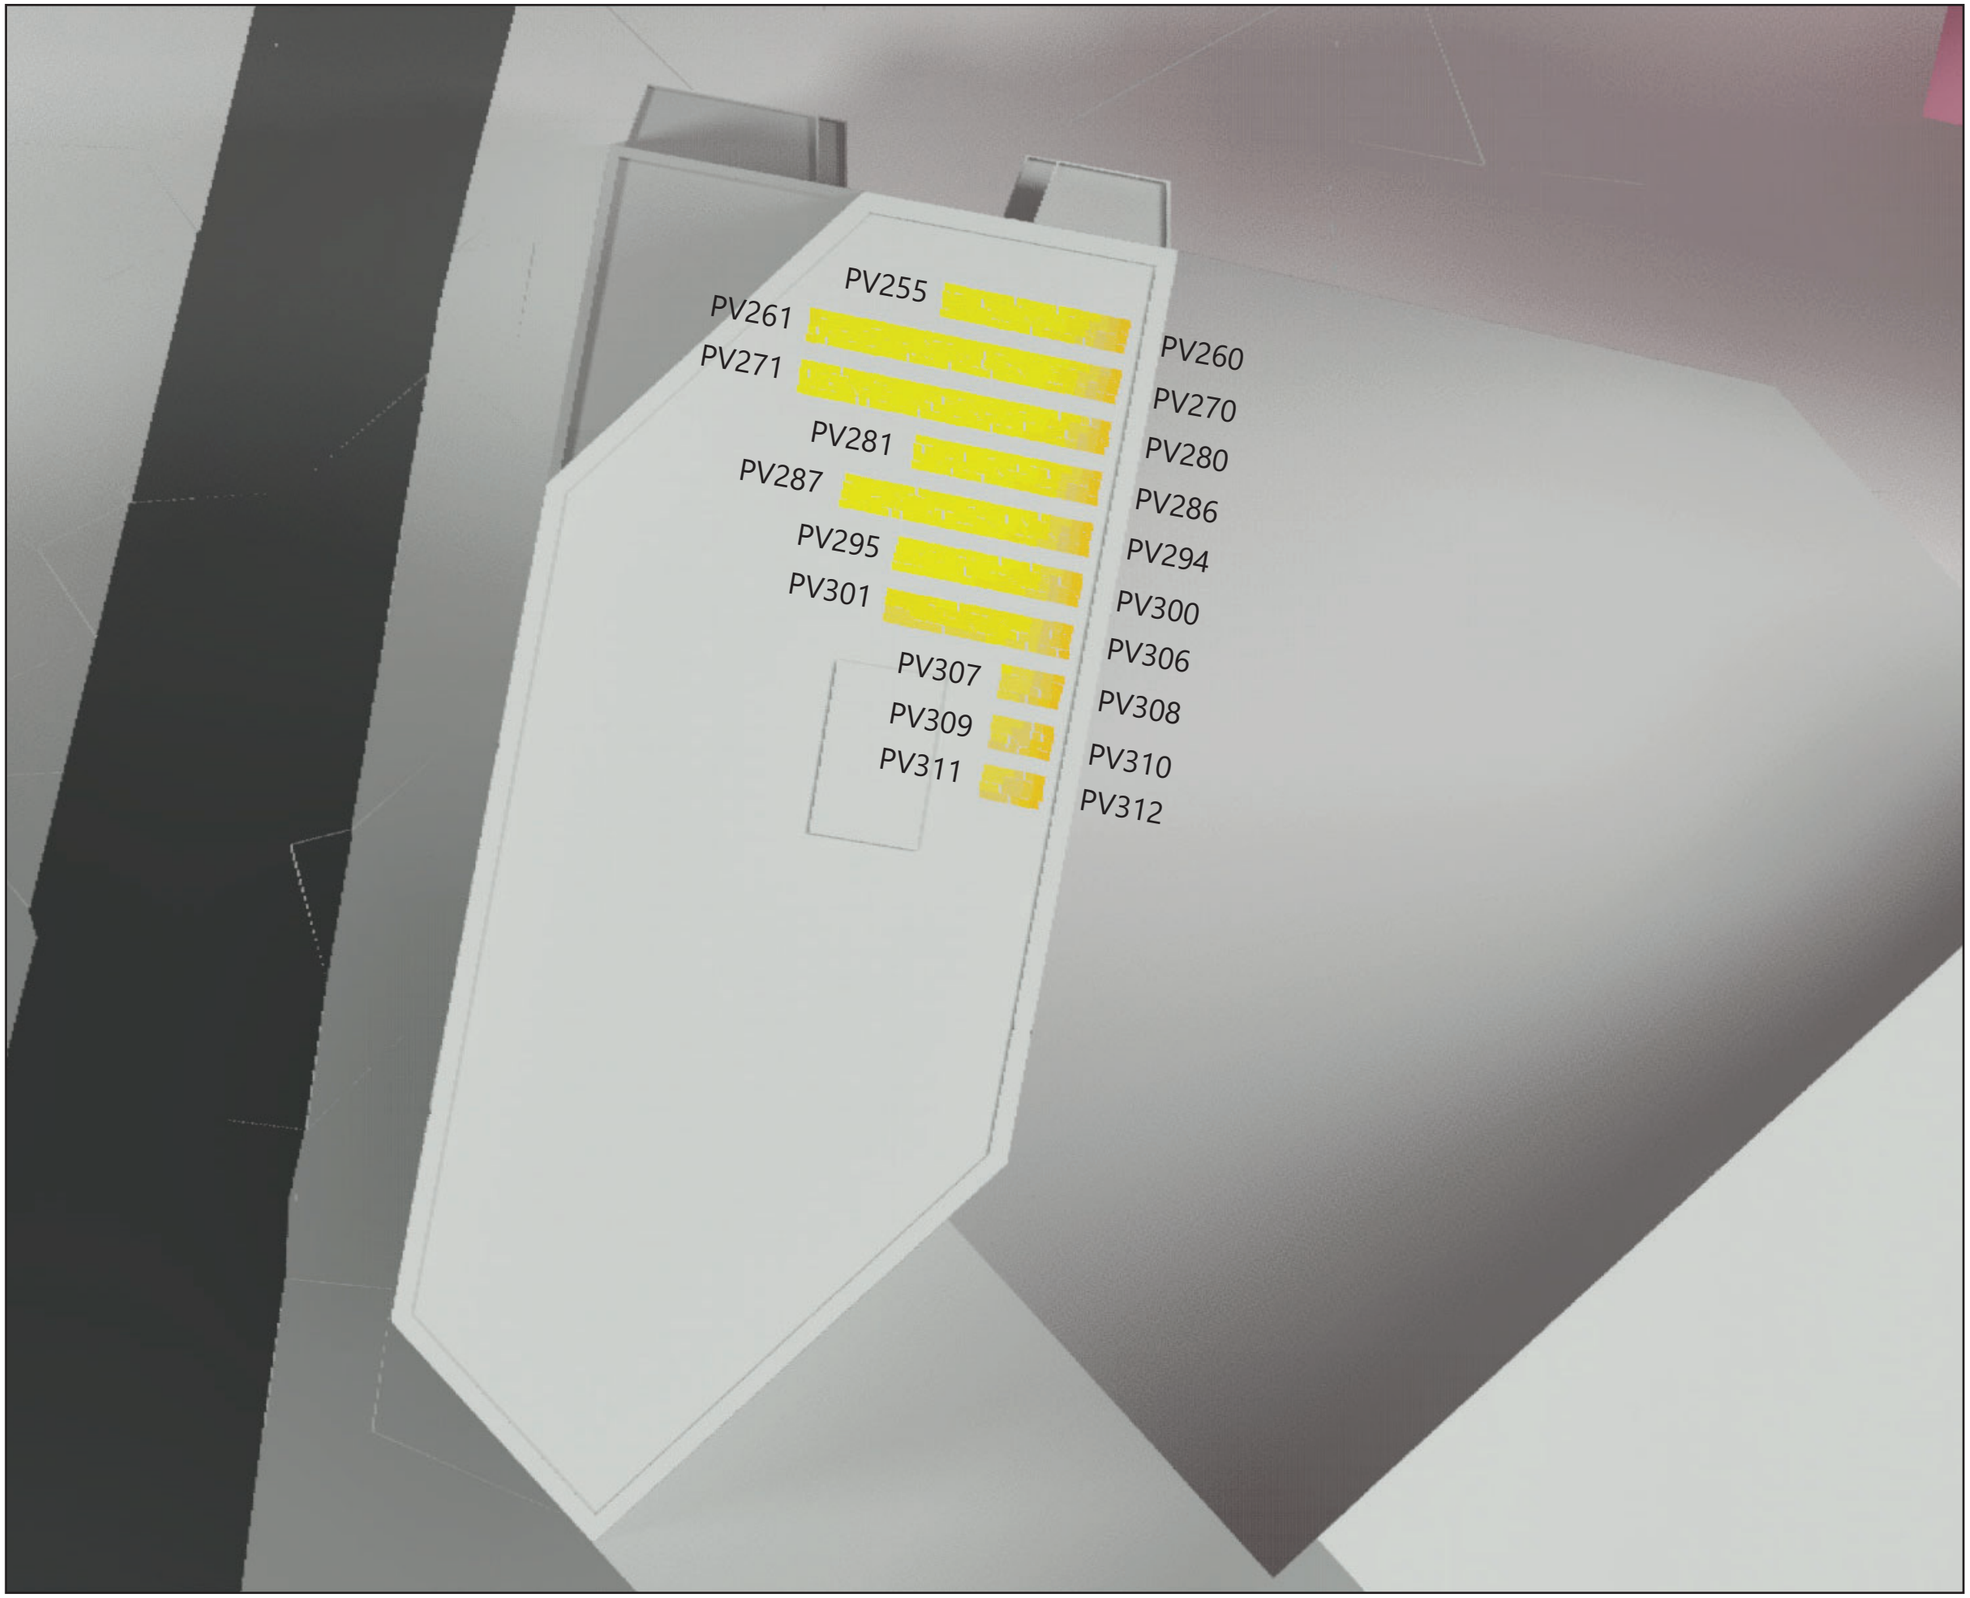

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
East Apartments
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV02
Page no.: 08

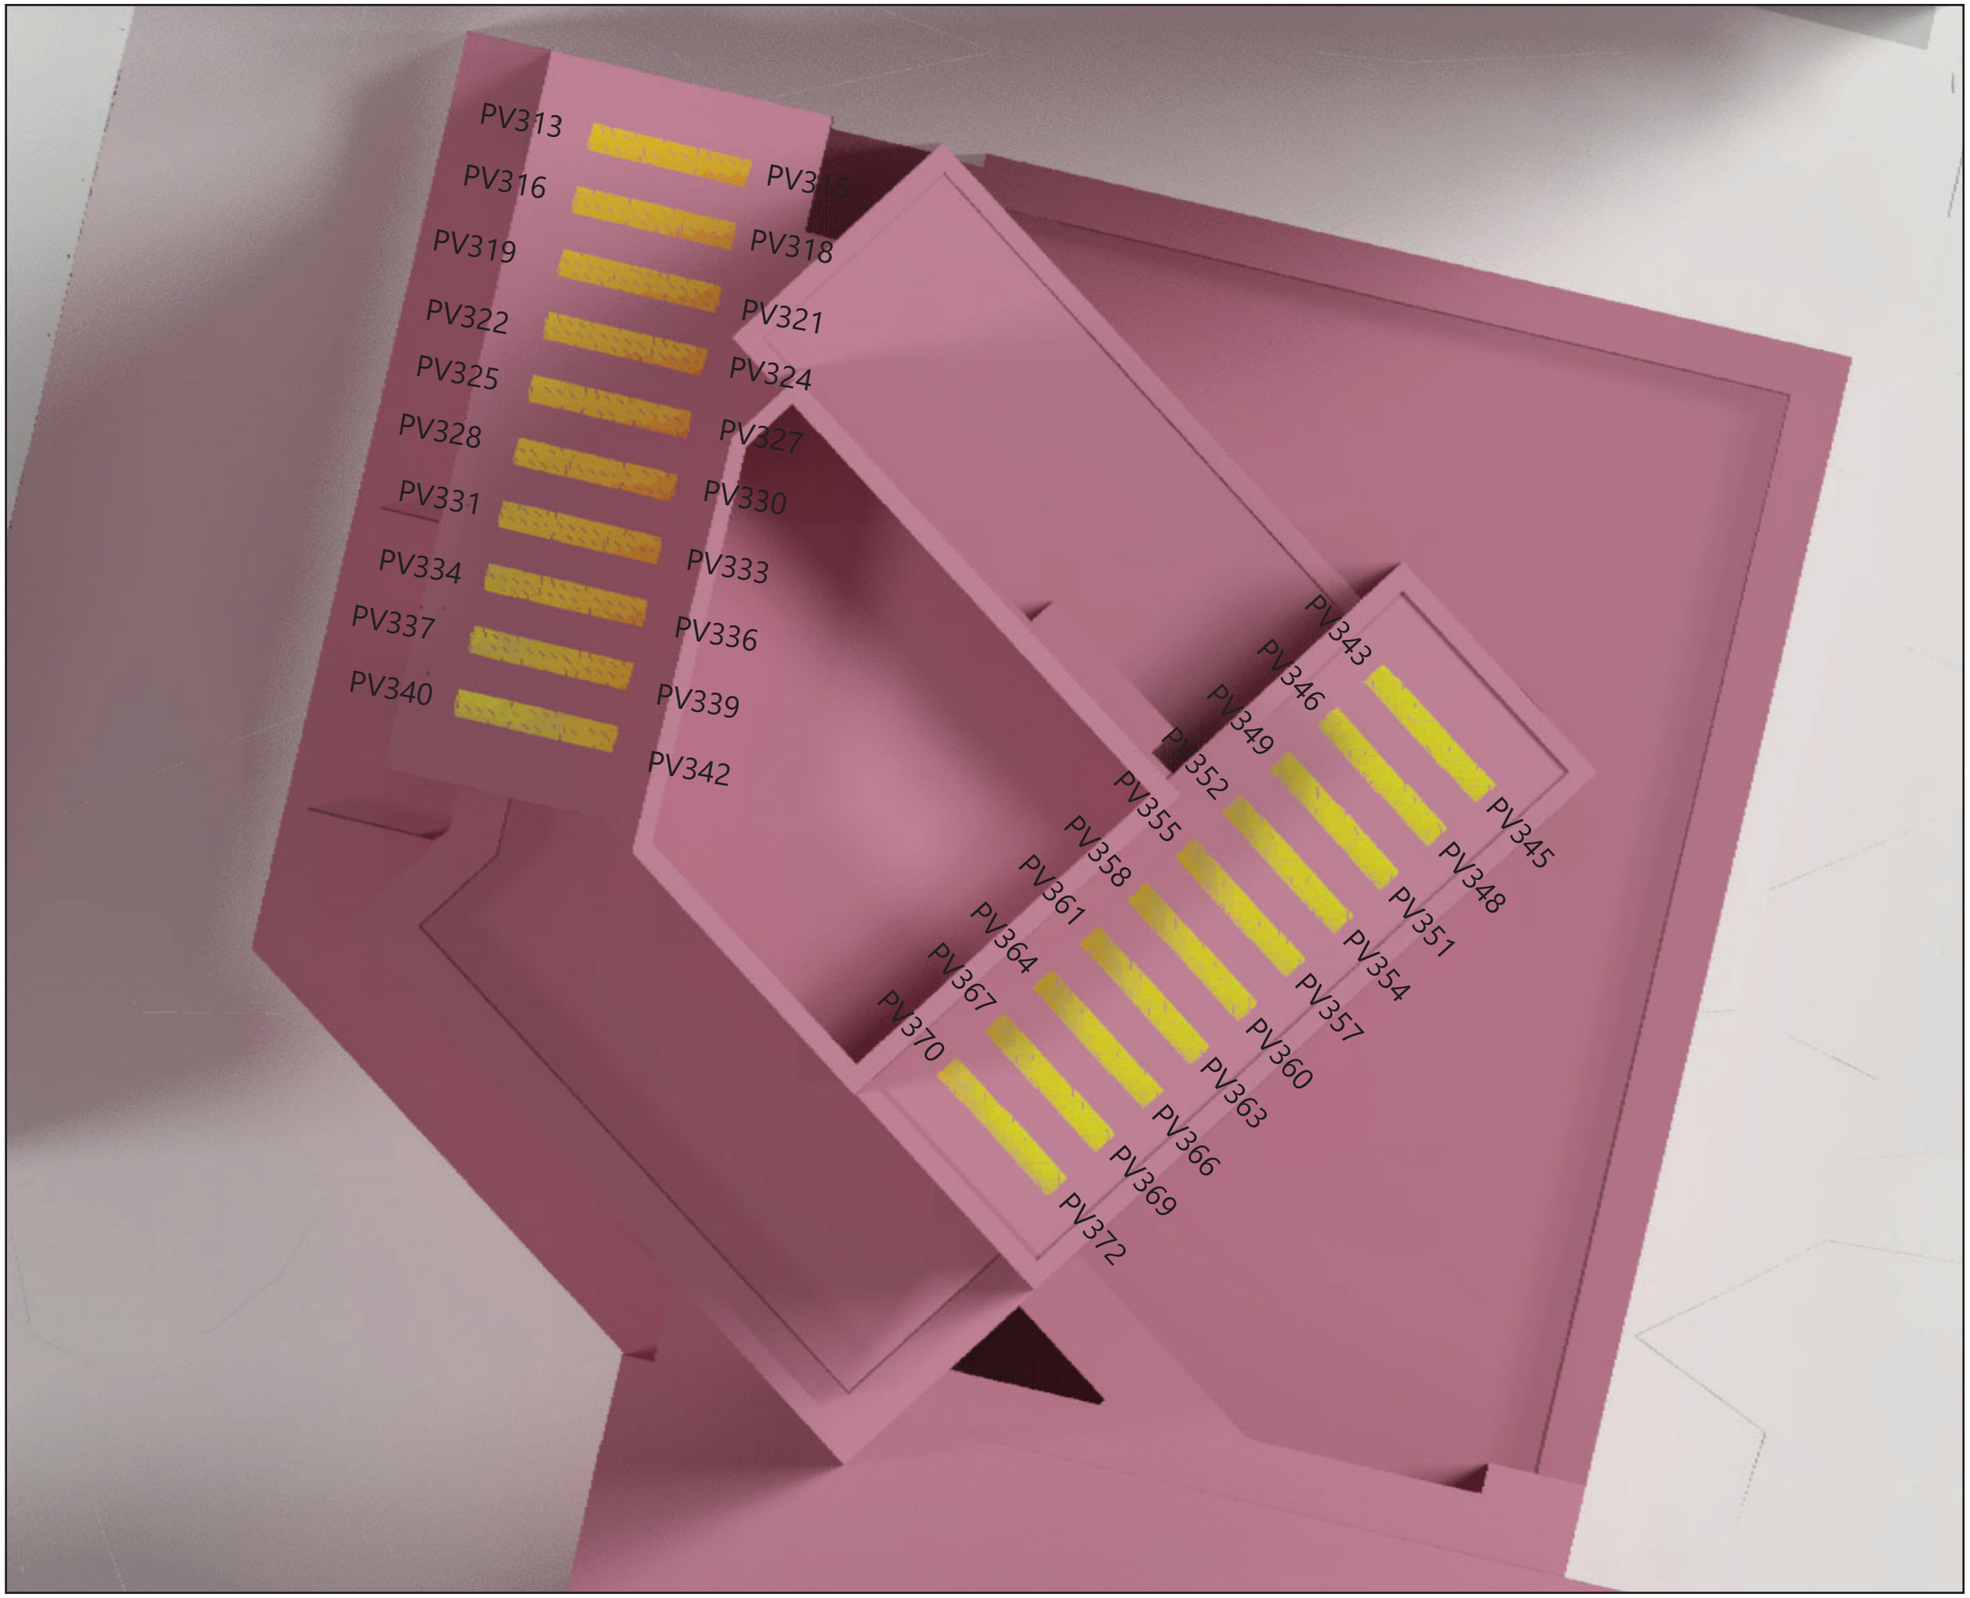

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Berol Quarter
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV02
Page no.: 09

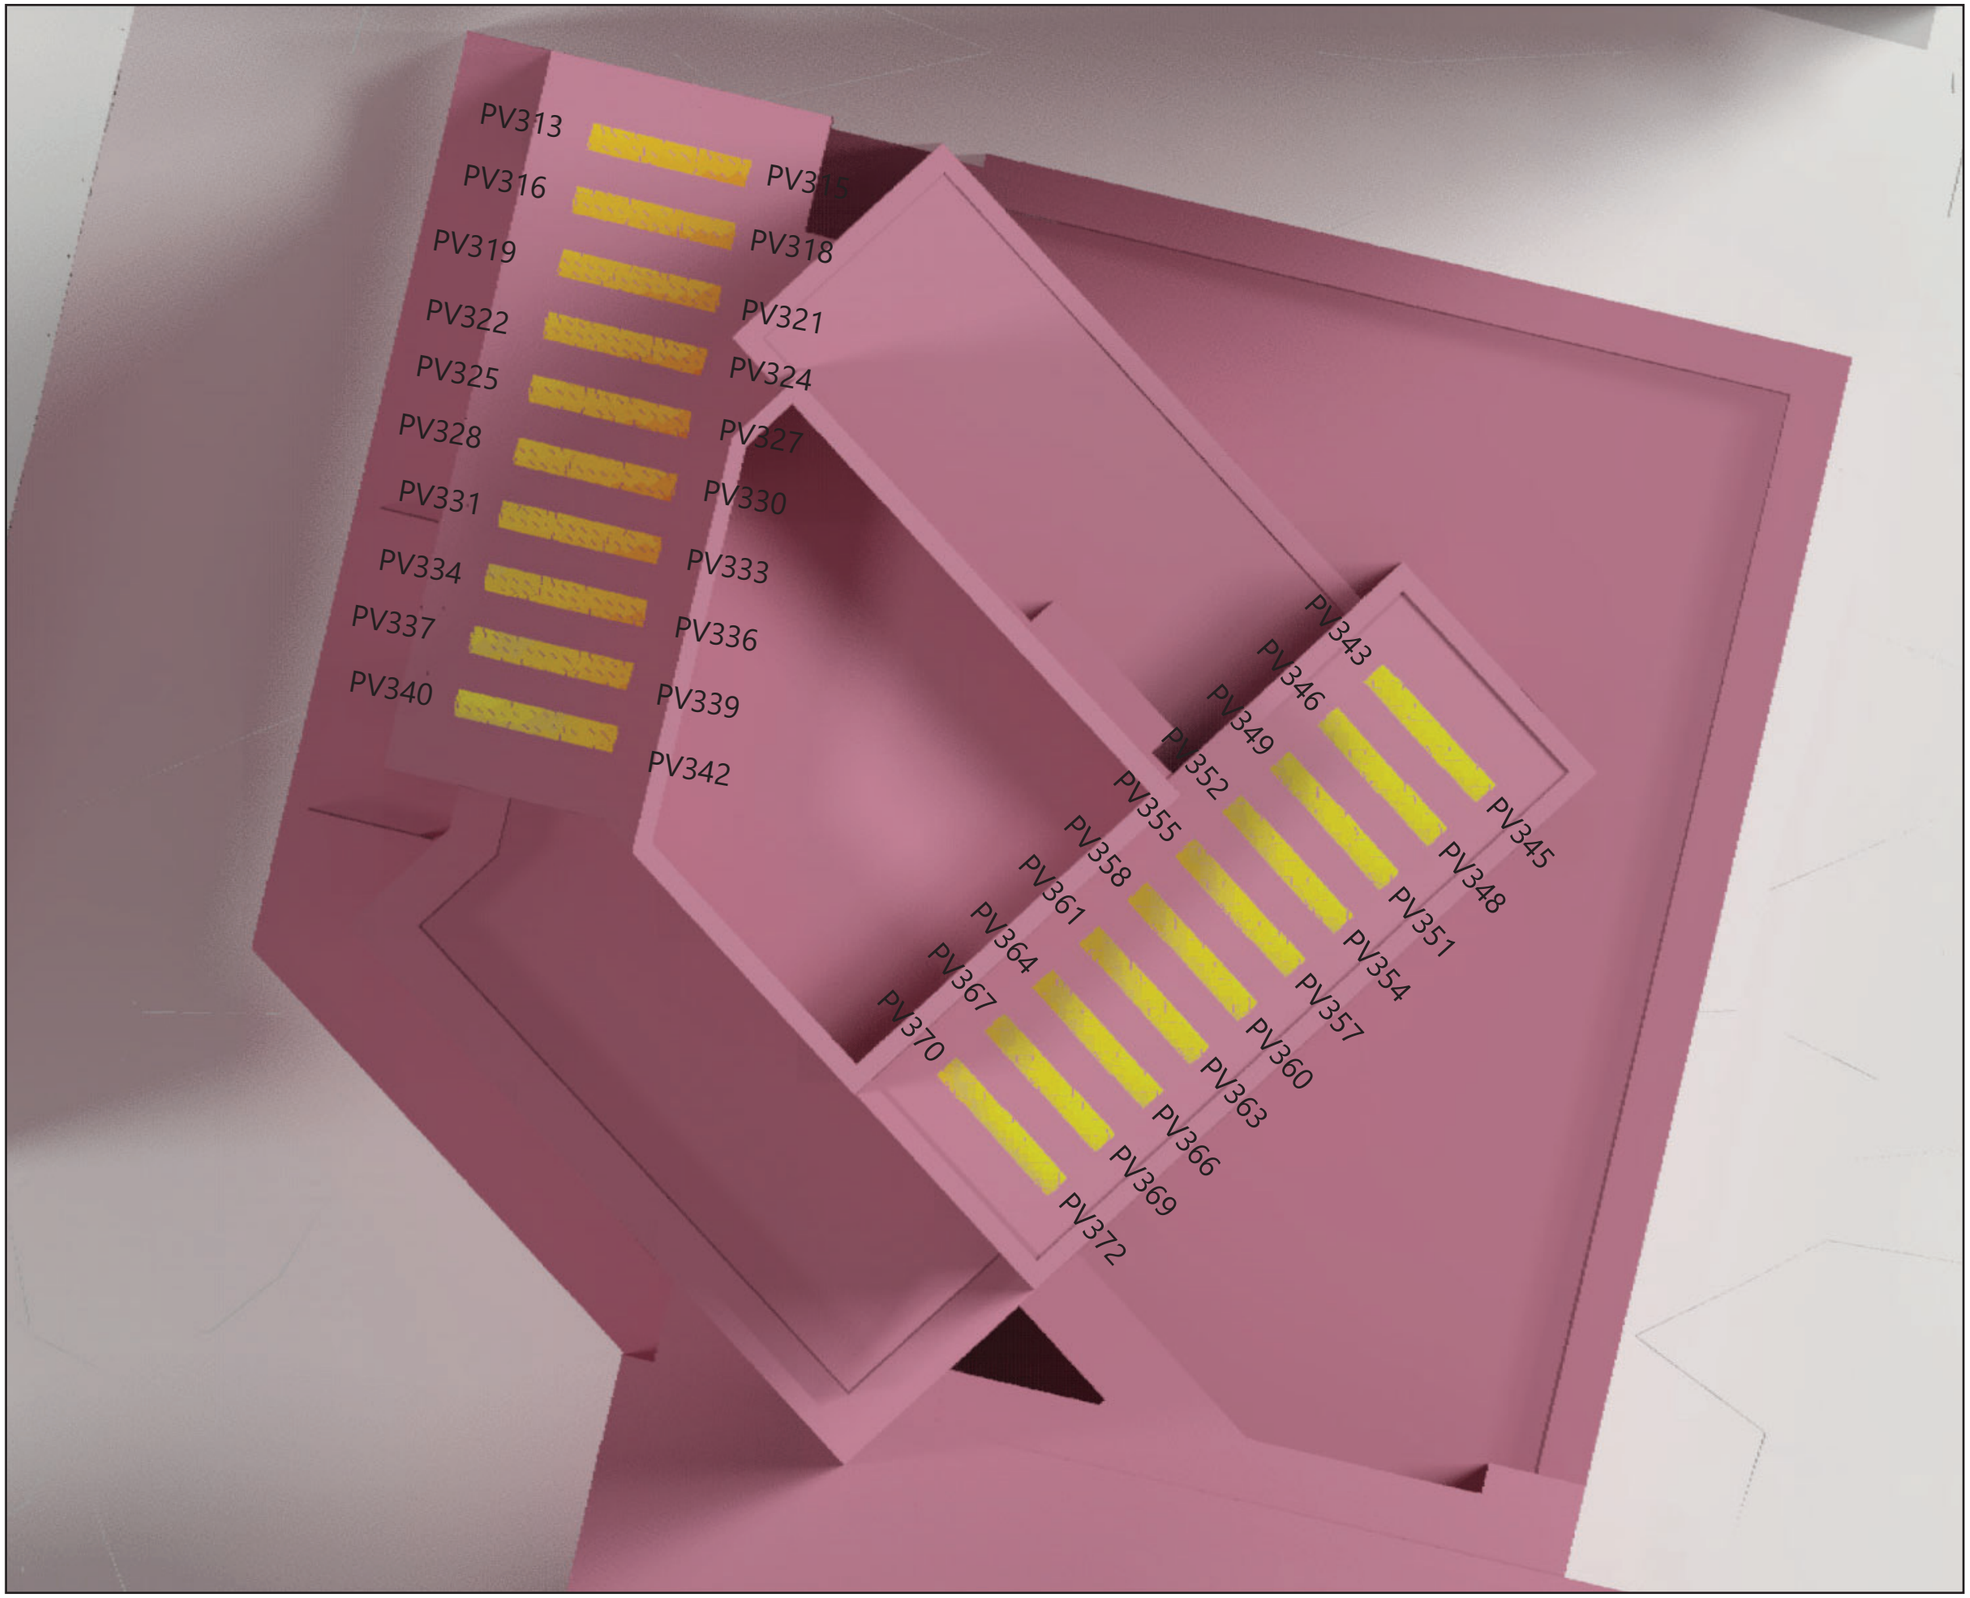

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Berol Quarter
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV02
Page no.: 10

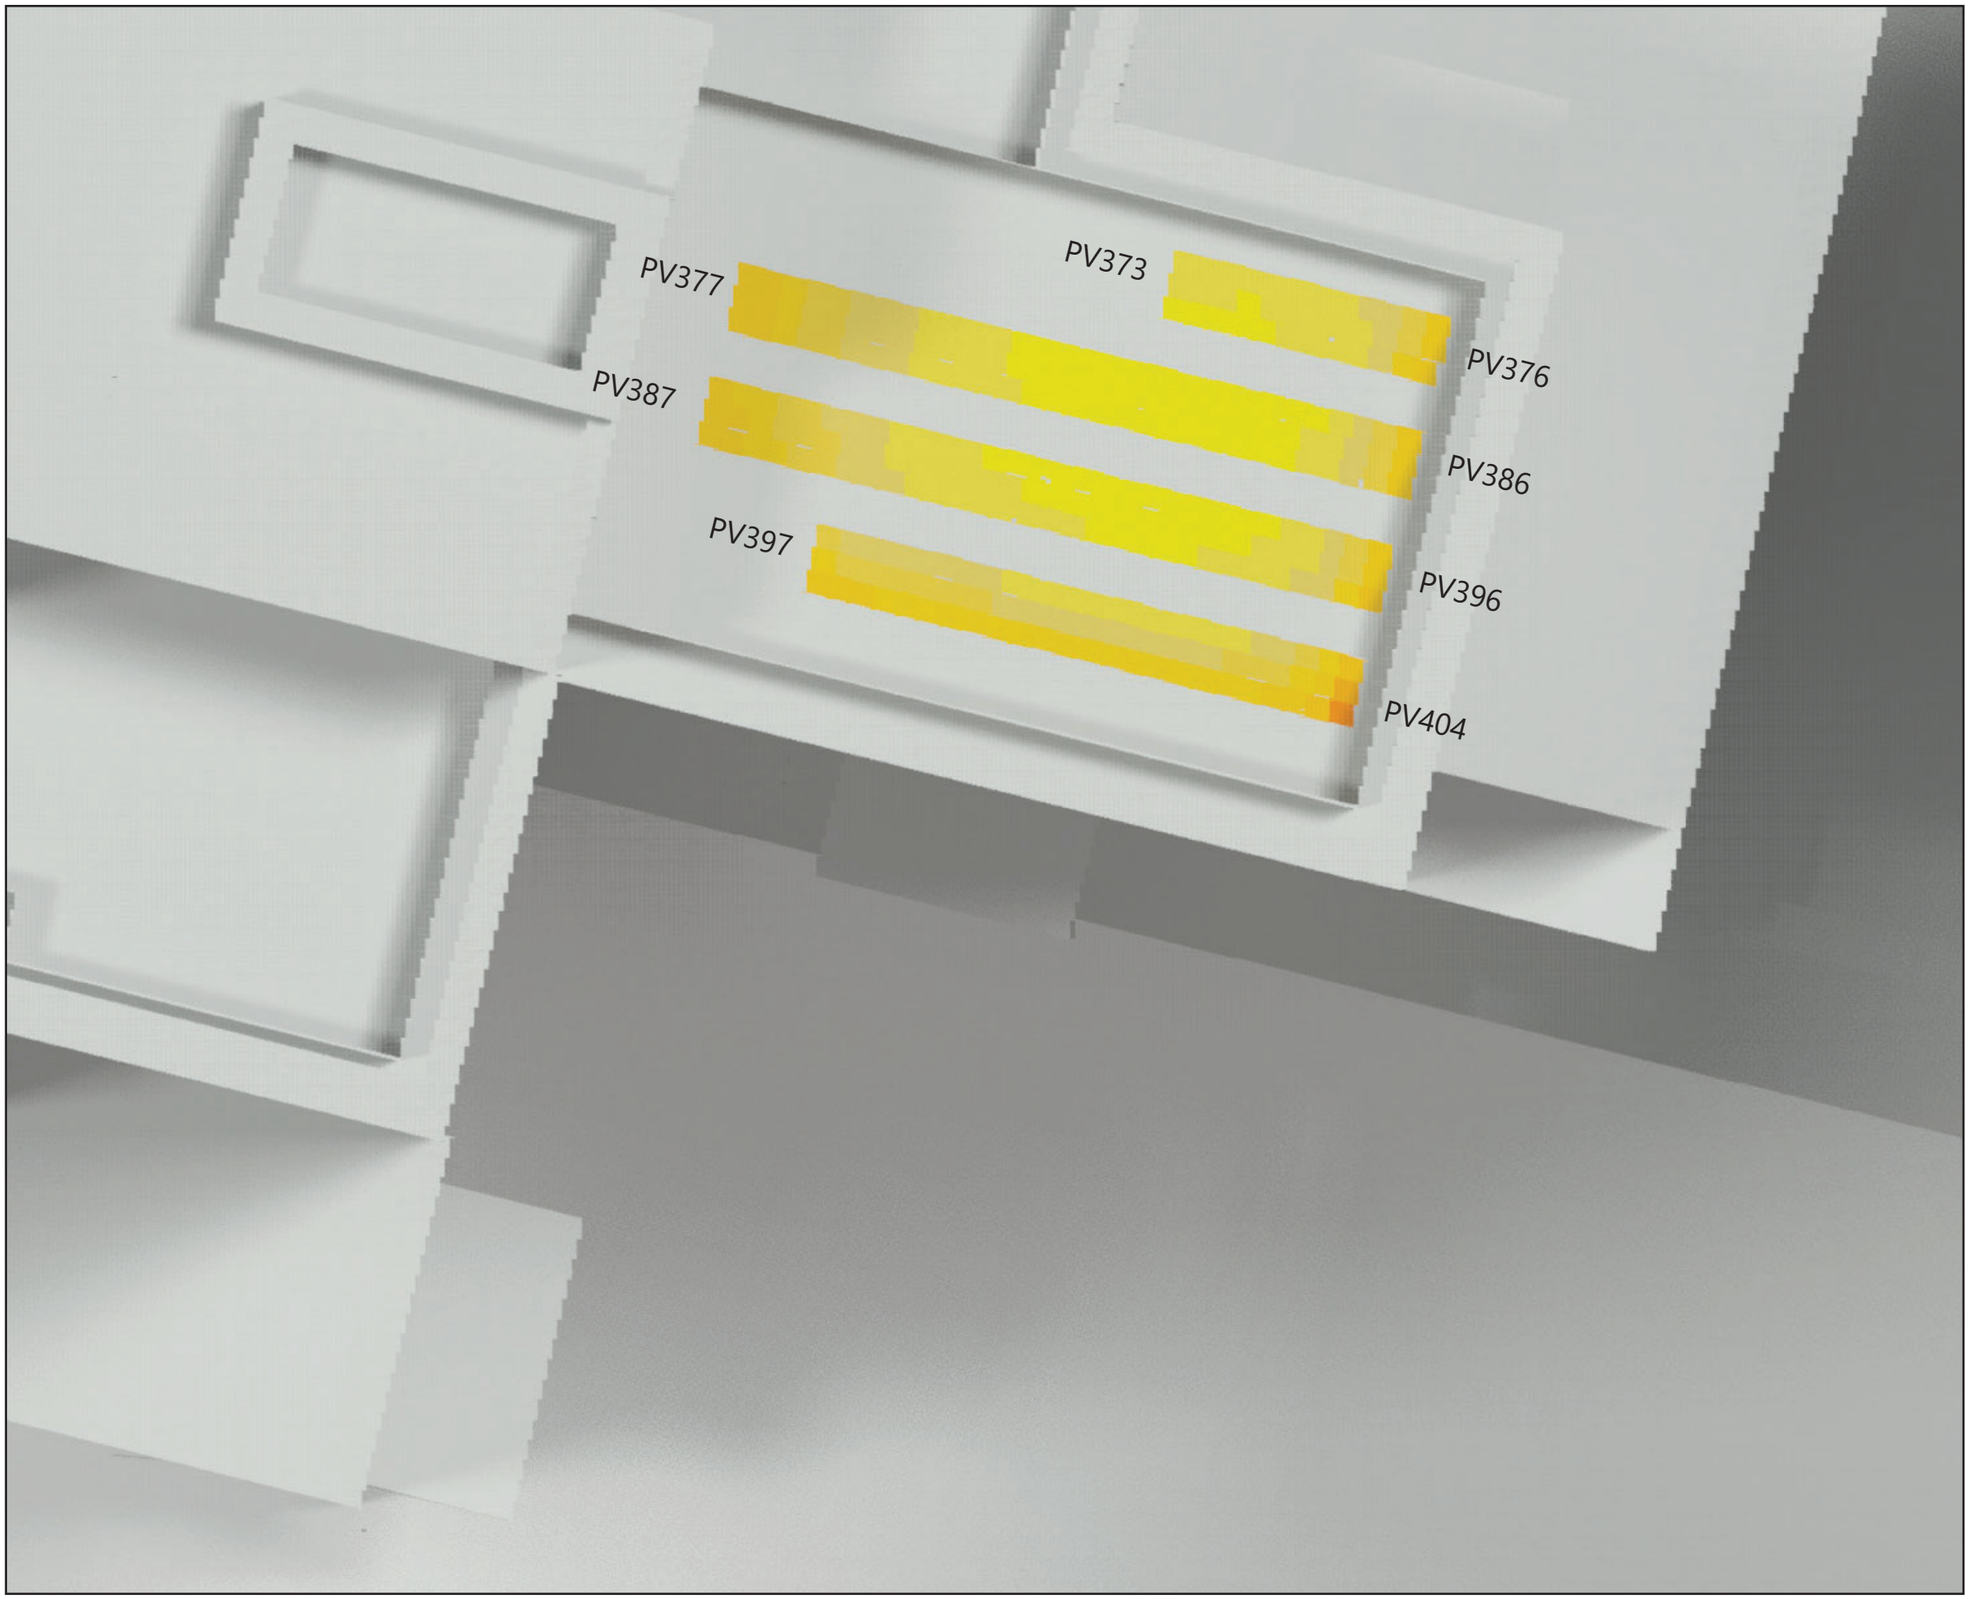

Existing Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery
Exchange, 10 Furnival
Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

1000
900
800
700
600
500
400
300
200
100
0

NORTH


Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV02
Page no.: 11

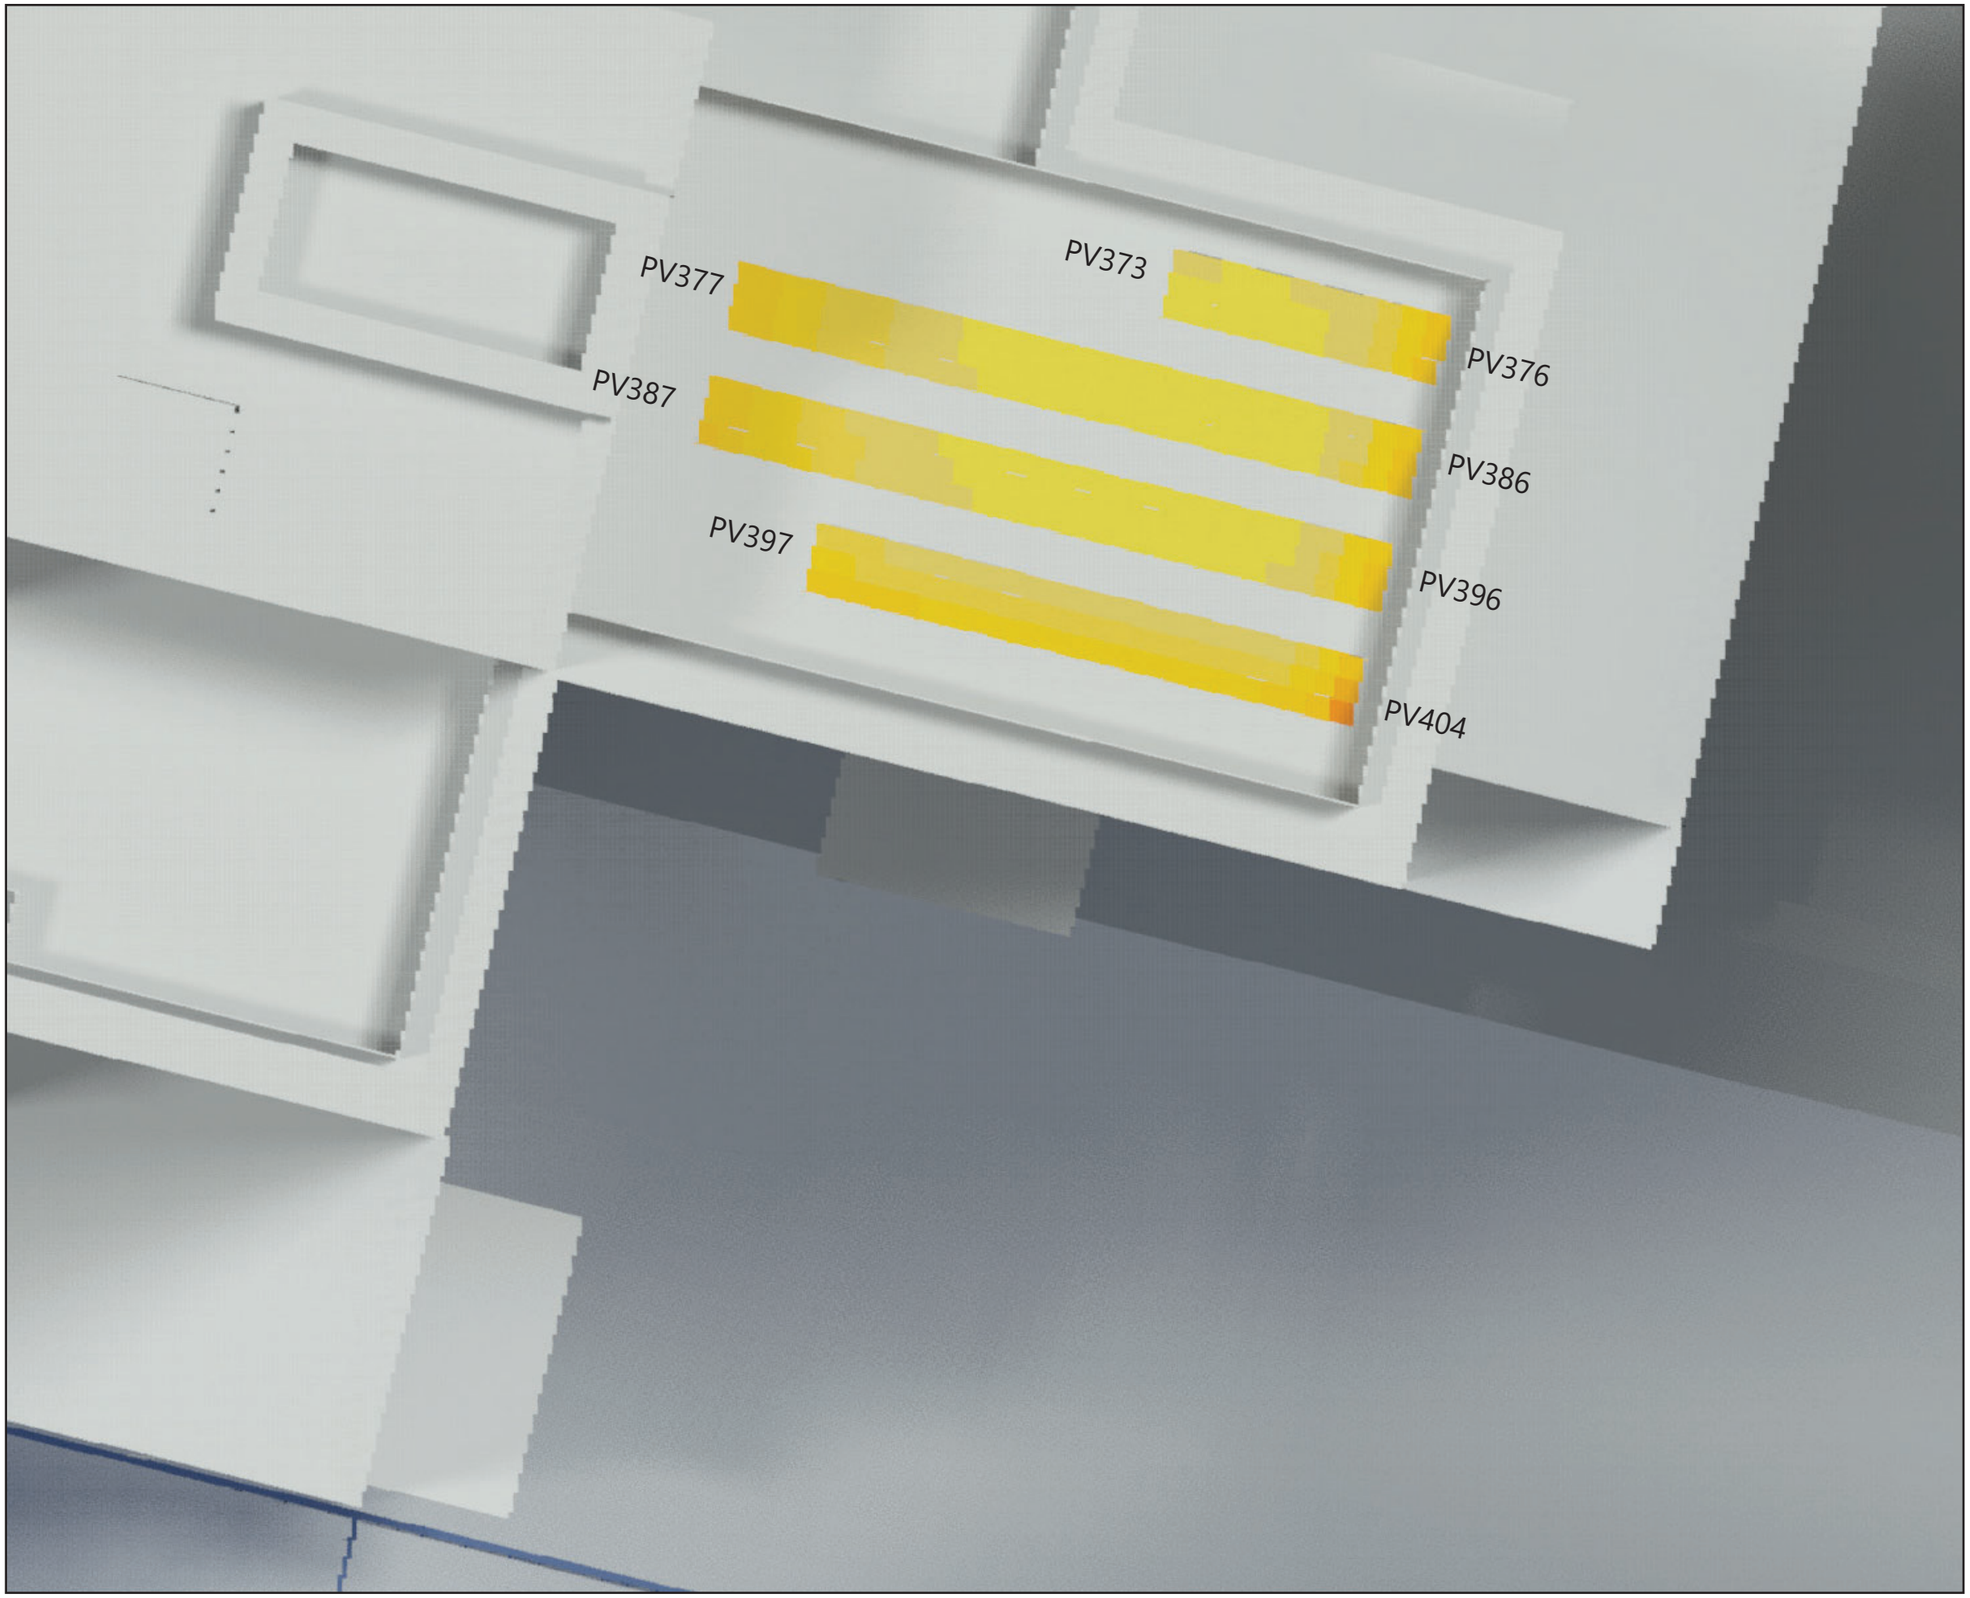

Proposed Scenario - Sunlight Exposure

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk


Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

Values (KWh/m2)

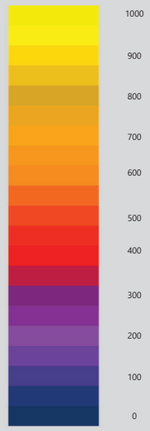

NORTH

Project: Ashley Road
Tottenham Hale

Title: Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn: TR
Checked: --

Date: 07/08/2026
Project: 10106

Rel no.: 08
Prefix: PV02
Page no.: 12

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV01	1.0	959.5	952.1	0.99
PV02	1.0	955.2	949.0	0.99
PV03	1.0	953.1	946.2	0.99
PV04	1.0	946.8	940.4	0.99
PV05	1.0	935.8	928.7	0.99
PV06	1.0	913.2	907.1	0.99
PV07	1.0	870.0	863.5	0.99
PV08	1.0	693.8	687.5	0.99
PV09	1.0	957.0	949.6	0.99
PV10	1.0	952.5	946.0	0.99
PV11	1.0	949.9	942.5	0.99
PV12	1.0	942.8	936.3	0.99
PV13	1.0	930.0	923.0	0.99
PV14	1.0	906.3	900.3	0.99
PV15	1.0	868.8	861.7	0.99
PV16	1.0	709.5	702.5	0.99
PV17	1.0	954.9	947.1	0.99
PV18	1.0	950.1	943.4	0.99
PV19	1.0	947.2	939.6	0.99
PV20	1.0	939.5	933.0	0.99
PV21	1.0	927.8	920.9	0.99
PV22	1.0	904.5	898.3	0.99
PV23	1.0	861.4	854.4	0.99
PV24	1.0	706.1	699.0	0.99
PV25	1.0	967.5	959.5	0.99
PV26	1.0	962.5	955.9	0.99
PV27	1.0	958.9	951.1	0.99
PV28	1.0	951.8	945.1	0.99
PV29	1.0	939.9	932.4	0.99
PV30	1.0	919.3	912.7	0.99
PV31	1.0	905.5	895.8	0.99
PV32	1.0	715.1	707.9	0.99
PV33	1.0	948.2	940.6	0.99
PV34	1.0	943.1	935.9	0.99
PV35	1.0	938.9	931.3	0.99
PV36	1.0	931.1	924.5	0.99
PV37	1.0	920.3	912.9	0.99
PV38	1.0	901.0	894.3	0.99
PV39	1.0	696.7	689.3	0.99
PV40	1.0	965.7	957.7	0.99
PV41	1.0	960.8	953.9	0.99
PV42	1.0	956.8	948.7	0.99
PV43	1.0	949.5	942.2	0.99
PV44	1.0	936.3	928.7	0.99
PV45	1.0	917.6	910.9	0.99
PV46	1.0	750.4	740.3	0.99
PV47	1.0	948.3	940.1	0.99
PV48	1.0	943.2	936.0	0.99
PV49	1.0	939.9	932.2	0.99
PV50	1.0	933.1	926.2	0.99
PV51	1.0	922.1	914.4	0.99
PV52	1.0	902.0	895.5	0.99
PV53	1.0	966.0	957.6	0.99
PV54	1.0	961.6	953.9	0.99
PV55	1.0	958.6	950.1	0.99
PV56	1.0	953.2	945.6	0.99
PV57	1.0	944.1	935.9	0.99
PV58	1.0	929.4	922.3	0.99
PV59	1.0	956.3	947.7	0.99
PV60	1.0	952.1	944.3	0.99
PV61	1.0	950.2	941.8	0.99
PV62	1.0	945.4	938.0	0.99
PV63	1.0	939.9	931.1	0.99
PV64	1.0	929.3	922.0	0.99
PV65	1.0	1006.4	994.3	0.99
PV66	1.0	1004.7	992.6	0.99
PV67	1.0	1002.1	990.1	0.99
PV68	1.0	999.3	987.7	0.99
PV69	1.0	993.5	982.1	0.99
PV70	1.0	988.1	976.3	0.99
PV71	1.0	795.2	794.2	1.00
PV72	1.0	845.6	841.3	0.99
PV73	1.0	869.1	864.3	0.99
PV74	1.0	810.0	806.8	1.00
PV75	1.0	861.8	855.8	0.99
PV76	1.0	884.2	879.4	0.99
PV77	1.0	817.9	811.9	0.99
PV78	1.0	867.4	861.8	0.99
PV79	1.0	888.1	882.8	0.99
PV80	1.0	838.2	831.4	0.99
PV81	1.0	880.9	874.8	0.99
PV82	1.0	897.4	892.3	0.99
PV83	1.0	851.9	845.6	0.99
PV84	1.0	880.2	874.0	0.99
PV85	1.0	891.2	886.1	0.99
PV86	1.0	893.2	887.4	0.99
PV87	1.0	912.1	905.9	0.99
PV88	1.0	919.1	913.7	0.99
PV89	1.0	899.8	893.3	0.99
PV90	1.0	907.3	901.6	0.99
PV91	1.0	917.8	911.3	0.99
PV92	1.0	920.2	914.7	0.99
PV93	1.0	920.1	913.2	0.99
PV94	1.0	924.0	918.2	0.99
PV95	1.0	930.7	924.3	0.99
PV96	1.0	932.3	926.4	0.99
PV97	1.0	922.4	914.6	0.99
PV98	1.0	924.7	918.5	0.99
PV99	1.0	932.2	925.0	0.99
PV100	1.0	933.2	927.0	0.99
PV101	1.0	937.4	930.7	0.99
PV102	1.0	937.6	932.0	0.99
PV103	1.0	970.4	960.1	0.99
PV104	1.0	972.2	962.1	0.99
PV105	1.0	974.6	964.7	0.99
PV106	1.0	975.5	965.7	0.99
PV107	1.0	976.0	966.9	0.99
PV108	1.0	976.0	966.9	0.99
PV109	0.9	788.1	786.5	1.00
PV110	0.9	784.4	783.1	1.00
PV111	0.9	774.6	773.5	1.00
PV112	0.9	739.5	738.4	1.00
PV113	0.9	748.9	748.9	1.00
PV114	0.9	783.8	783.8	1.00
PV115	0.9	797.4	797.4	1.00
PV116	0.9	805.1	805.2	1.00
PV117	0.9	811.5	811.0	1.00
PV118	0.9	817.3	816.6	1.00
PV119	0.9	823.0	822.1	1.00
PV120	0.9	828.5	827.6	1.00
PV121	0.9	834.3	833.4	1.00
PV122	0.9	842.3	841.6	1.00
PV123	0.9	777.4	776.1	1.00
PV124	0.9	775.7	774.3	1.00
PV125	0.9	768.6	767.4	1.00
PV126	0.9	738.0	736.7	1.00

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Project: Ashley Road Tottenham Hale

Title:

Drawn: TR | Checked: --

Date: 07/08/2026 | Project: 10106

Rel no.: 08 | Prefix: PV02 | Page no.: 13

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV127	0.9	740.1	740.0	1.00
PV128	0.9	774.3	773.7	1.00
PV129	0.9	786.1	785.2	1.00
PV130	0.9	794.2	792.8	1.00
PV131	0.9	800.2	799.3	1.00
PV132	0.9	806.3	805.4	1.00
PV133	0.9	812.0	811.5	1.00
PV134	0.9	817.7	817.2	1.00
PV135	0.9	824.2	823.4	1.00
PV136	0.9	832.6	832.0	1.00
PV137	0.9	709.8	707.8	1.00
PV138	0.9	699.3	698.3	1.00
PV139	0.9	779.6	778.4	1.00
PV140	0.9	786.0	784.9	1.00
PV141	0.9	791.9	791.1	1.00
PV142	0.9	795.8	794.9	1.00
PV143	0.9	798.8	798.2	1.00
PV144	0.9	805.1	804.3	1.00
PV145	0.9	811.5	810.8	1.00
PV146	0.9	820.5	819.9	1.00
PV147	0.9	700.8	698.8	1.00
PV148	0.9	689.5	688.4	1.00
PV149	0.9	787.2	786.7	1.00
PV150	0.9	793.8	792.9	1.00
PV151	0.9	800.6	800.3	1.00
PV152	0.9	809.9	809.6	1.00
PV153	0.9	691.1	689.3	1.00
PV154	0.9	680.3	679.3	1.00
PV155	0.9	681.3	679.4	1.00
PV156	0.9	670.6	669.8	1.00
PV157	0.9	775.3	774.8	1.00
PV158	0.9	782.1	781.6	1.00
PV159	0.9	789.5	789.4	1.00
PV160	0.9	799.5	799.1	1.00
PV161	0.9	671.0	669.2	1.00
PV162	0.9	660.5	659.3	1.00
PV163	0.9	718.7	717.9	1.00
PV164	0.9	721.3	720.4	1.00
PV165	0.9	723.9	722.8	1.00
PV166	0.9	725.1	724.0	1.00
PV167	0.9	726.8	725.6	1.00
PV168	0.9	729.8	729.3	1.00
PV169	0.9	732.9	732.4	1.00
PV170	0.9	737.1	736.3	1.00
PV171	0.9	742.2	741.8	1.00
PV172	0.9	750.3	749.7	1.00
PV173	0.9	764.4	764.1	1.00
PV174	0.9	771.3	770.8	1.00
PV175	0.9	778.8	778.5	1.00
PV176	0.9	788.9	788.7	1.00
PV177	0.9	660.3	658.2	1.00
PV178	0.9	650.0	648.9	1.00
PV179	0.9	648.6	646.8	1.00
PV180	0.9	639.6	638.4	1.00
PV181	0.9	715.5	714.8	1.00
PV182	0.9	719.5	718.7	1.00
PV183	0.9	723.0	722.7	1.00
PV184	0.9	727.7	727.2	1.00
PV185	0.9	733.2	732.9	1.00
PV186	0.9	740.2	740.1	1.00
PV187	0.9	759.3	759.4	1.00
PV188	0.9	767.5	767.3	1.00
PV189	0.9	776.4	776.2	1.00
PV190	0.9	785.7	785.4	1.00
PV191	0.9	636.8	634.9	1.00
PV192	0.9	629.8	628.6	1.00
PV193	0.9	663.3	662.4	1.00
PV194	0.9	666.7	665.6	1.00
PV195	0.9	669.6	668.8	1.00
PV196	0.9	672.9	672.4	1.00
PV197	0.9	676.6	676.0	1.00
PV198	0.9	680.4	680.0	1.00
PV199	0.9	684.4	683.9	1.00
PV200	0.9	688.7	688.6	1.00
PV201	0.9	693.3	693.1	1.00
PV202	0.9	698.0	697.5	1.00
PV203	0.9	702.7	702.6	1.00
PV204	0.9	709.3	709.0	1.00
PV205	0.9	718.1	717.8	1.00
PV206	0.9	726.6	726.6	1.00
PV207	0.9	735.5	735.5	1.00
PV208	0.9	744.2	744.3	1.00
PV209	0.9	753.4	753.4	1.00
PV210	0.9	765.6	765.6	1.00
PV211	0.9	648.2	647.6	1.00
PV212	0.9	652.6	652.1	1.00
PV213	0.9	657.0	656.3	1.00
PV214	0.9	661.2	660.5	1.00
PV215	0.9	665.7	665.1	1.00
PV216	0.9	670.6	670.2	1.00
PV217	0.9	675.8	675.5	1.00
PV218	0.9	680.8	680.9	1.00
PV219	0.9	686.3	686.2	1.00
PV220	0.9	691.9	691.7	1.00
PV221	0.9	697.9	697.8	1.00
PV222	0.9	705.0	704.8	1.00
PV223	0.9	716.0	715.8	1.00
PV224	0.9	725.7	725.7	1.00
PV225	0.9	735.5	735.5	1.00
PV226	0.9	745.1	745.1	1.00
PV227	0.9	754.9	754.9	1.00
PV228	0.9	765.0	765.0	1.00
PV229	0.8	624.7	624.7	1.00
PV230	0.8	717.7	712.4	0.99
PV231	0.8	751.9	736.9	0.98
PV232	0.8	765.3	746.9	0.98
PV233	0.8	772.5	753.5	0.98
PV234	0.8	777.5	758.5	0.98
PV235	0.8	631.0	631.0	1.00
PV236	0.8	720.3	716.4	0.99
PV237	0.8	751.2	742.6	0.99
PV238	0.8	763.4	753.9	0.99
PV239	0.8	768.3	759.7	0.99
PV240	0.8	770.9	762.1	0.99
PV241	0.8	771.8	763.5	0.99
PV242	0.8	770.9	763.0	0.99
PV243	0.8	766.3	758.6	0.99
PV244	0.8	746.5	738.6	0.99
PV245	0.8	314.3	314.3	1.00
PV246	0.8	352.9	352.9	1.00
PV247	0.8	367.3	367.3	1.00
PV248	0.8	372.9	372.9	1.00
PV249	0.8	375.3	375.3	1.00
PV250	0.8	376.0	376.0	1.00
PV251	0.8	374.9	374.9	1.00
PV252	0.8	372.6	372.6	1.00

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Project: Ashley Road
Tottenham Hale

Title:

Drawn: TR | Checked: --

Date: 07/08/2026 | Project: 10106

Rel no.: 08 | Prefix: PV02 | Page no.: 14

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV253	0.8	367.1	367.1	1.00
PV254	0.8	353.8	353.8	1.00
PV255	0.9	982.4	982.4	1.00
PV256	0.9	980.9	980.9	1.00
PV257	0.9	973.8	973.8	1.00
PV258	0.9	958.3	958.3	1.00
PV259	0.9	912.2	912.2	1.00
PV260	0.9	762.5	762.7	1.00
PV261	0.9	957.5	957.5	1.00
PV262	0.9	978.9	978.9	1.00
PV263	0.9	986.8	986.8	1.00
PV264	0.9	989.8	989.8	1.00
PV265	0.9	989.5	989.5	1.00
PV266	0.9	986.9	986.9	1.00
PV267	0.9	979.3	979.3	1.00
PV268	0.9	963.1	963.1	1.00
PV269	0.9	916.5	916.5	1.00
PV270	0.9	766.0	766.2	1.00
PV271	0.9	985.3	985.3	1.00
PV272	0.9	992.7	992.7	1.00
PV273	0.9	995.1	995.1	1.00
PV274	0.9	994.9	994.9	1.00
PV275	0.9	990.9	990.9	1.00
PV276	0.9	986.5	986.5	1.00
PV277	0.9	978.9	978.9	1.00
PV278	0.9	962.4	962.2	1.00
PV279	0.9	915.4	915.2	1.00
PV280	0.9	764.6	764.3	1.00
PV281	0.9	989.4	989.4	1.00
PV282	0.9	985.9	985.9	1.00
PV283	0.9	977.6	977.5	1.00
PV284	0.9	960.7	960.9	1.00
PV285	0.9	913.7	913.5	1.00
PV286	0.9	762.5	762.2	1.00
PV287	0.9	993.0	993.0	1.00
PV288	0.9	992.0	992.0	1.00
PV289	0.9	987.9	988.0	1.00
PV290	0.9	982.9	983.0	1.00
PV291	0.9	974.1	973.8	1.00
PV292	0.9	957.5	957.3	1.00
PV293	0.9	910.2	910.3	1.00
PV294	0.9	759.1	759.0	1.00

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV295	0.9	974.8	975.0	1.00
PV296	0.9	971.7	972.0	1.00
PV297	0.9	963.8	963.7	1.00
PV298	0.9	948.6	948.6	1.00
PV299	0.9	904.8	904.8	1.00
PV300	0.9	755.5	755.2	1.00
PV301	0.9	906.1	906.1	1.00
PV302	0.9	916.7	916.9	1.00
PV303	0.9	925.3	925.0	1.00
PV304	0.9	924.8	924.6	1.00
PV305	0.9	892.8	892.6	1.00
PV306	0.9	748.3	747.8	1.00
PV307	0.9	869.2	869.4	1.00
PV308	0.9	737.9	737.7	1.00
PV309	0.9	853.8	853.8	1.00
PV310	0.9	730.2	730.2	1.00
PV311	0.9	856.1	856.1	1.00
PV312	0.9	732.9	732.9	1.00
PV313	1.6	682.7	682.7	1.00
PV314	1.6	652.6	652.6	1.00
PV315	1.6	615.9	615.9	1.00
PV316	1.6	671.4	671.4	1.00
PV317	1.6	640.4	640.4	1.00
PV318	1.6	602.8	602.8	1.00
PV319	1.6	669.4	669.4	1.00
PV320	1.6	636.3	636.3	1.00
PV321	1.6	596.9	596.9	1.00
PV322	1.6	672.0	672.0	1.00
PV323	1.6	636.8	636.8	1.00
PV324	1.6	594.9	594.9	1.00
PV325	1.6	680.2	680.2	1.00
PV326	1.6	640.9	640.9	1.00
PV327	1.6	593.8	593.8	1.00
PV328	1.6	697.1	697.1	1.00
PV329	1.6	649.2	649.2	1.00
PV330	1.6	597.5	597.5	1.00
PV331	1.6	724.6	724.6	1.00
PV332	1.6	665.8	665.8	1.00
PV333	1.6	606.6	606.6	1.00
PV334	1.6	765.3	765.3	1.00
PV335	1.6	697.5	697.5	1.00
PV336	1.6	622.6	622.6	1.00

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV337	1.6	823.4	823.4	1.00
PV338	1.6	751.7	751.7	1.00
PV339	1.6	654.1	654.1	1.00
PV340	1.6	877.3	877.3	1.00
PV341	1.6	833.1	833.1	1.00
PV342	1.6	719.1	719.1	1.00
PV343	1.6	929.9	929.9	1.00
PV344	1.6	951.9	951.9	1.00
PV345	1.6	940.1	940.1	1.00
PV346	1.6	890.1	890.1	1.00
PV347	1.6	929.6	929.6	1.00
PV348	1.6	927.4	927.4	1.00
PV349	1.6	862.7	862.7	1.00
PV350	1.6	916.6	916.6	1.00
PV351	1.6	920.1	920.1	1.00
PV352	1.6	841.8	841.8	1.00
PV353	1.6	904.8	904.8	1.00
PV354	1.6	913.8	913.8	1.00
PV355	1.6	816.8	816.8	1.00
PV356	1.6	892.3	892.3	1.00
PV357	1.6	908.1	908.1	1.00
PV358	1.6	808.4	808.4	1.00
PV359	1.6	887.8	887.8	1.00
PV360	1.6	907.1	907.1	1.00
PV361	1.6	810.5	810.5	1.00
PV362	1.6	891.5	891.5	1.00
PV363	1.6	911.2	911.2	1.00
PV364	1.6	818.3	818.3	1.00
PV365	1.6	900.9	900.9	1.00
PV366	1.6	920.6	920.6	1.00
PV367	1.6	837.0	837.0	1.00
PV368	1.6	920.6	920.6	1.00
PV369	1.6	941.7	941.7	1.00
PV370	1.6	833.5	833.5	1.00
PV371	1.6	902.9	902.9	1.00
PV372	1.6	907.0	907.0	1.00
PV373	0.8	893.9	861.8	0.96
PV374	0.8	894.1	862.1	0.96
PV375	0.8	868.1	836.3	0.96
PV376	0.8	740.8	710.0	0.96
PV377	0.8	696.2	692.8	1.00
PV378	0.8	778.3	763.9	0.98

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Project: Ashley Road
Tottenham Hale

Title:

Drawn: TR | Checked: --

Date: 07/08/2026 | Project: 10106

Rel no.: 08 | Prefix: PV02 | Page no.: 15

Area	Total Area (sq.m)	Mean Solar Value Existing (KWh/m2)	Mean Solar Value Proposed (KWh/m2)	Proportion Retained
PV379	0.8	837.9	813.5	0.97
PV380	0.8	880.8	850.0	0.97
PV381	0.8	905.1	872.8	0.96
PV382	0.8	919.4	887.1	0.96
PV383	0.8	927.6	895.7	0.97
PV384	0.8	924.6	892.9	0.97
PV385	0.8	894.2	863.2	0.97
PV386	0.8	761.0	729.9	0.96
PV387	0.8	694.0	685.6	0.99
PV388	0.8	776.5	756.2	0.97
PV389	0.8	836.9	808.9	0.97
PV390	0.8	874.0	845.7	0.97
PV391	0.8	896.6	868.7	0.97
PV392	0.8	910.3	882.6	0.97
PV393	0.8	916.1	888.5	0.97
PV394	0.8	910.9	883.9	0.97
PV395	0.8	880.8	853.9	0.97
PV396	0.8	749.7	723.5	0.96
PV397	0.8	746.1	732.7	0.98
PV398	0.8	771.5	758.4	0.98
PV399	0.8	787.8	774.7	0.98
PV400	0.8	797.3	784.6	0.98
PV401	0.8	801.8	788.9	0.98
PV402	0.8	798.8	786.2	0.98
PV403	0.8	775.9	763.4	0.98
PV404	0.8	663.4	651.2	0.98

eb7 © copyright 2026

2nd Floor, Chancery Exchange, 10 Furnival Street, EC4A 1AB
T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_ selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

NORTH

Project: Ashley Road
Tottenham Hale

Title:

Drawn: TR | Checked: --

Date: 07/08/2026 | Project: 10106

Rel no.: 08 | Prefix: PV02 | Page no.: 16

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 8

Transient Shadow images

2nd Floor, Chancery Exchange
10 Furnival Street
London EC4A 1AB

T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Transient Overshadowing


Ashley Road
Tottenham Hale


31 July 2026


Ref. 10106-R08-TS01


21st March (equinox)
Hourly Shadows


Proposed

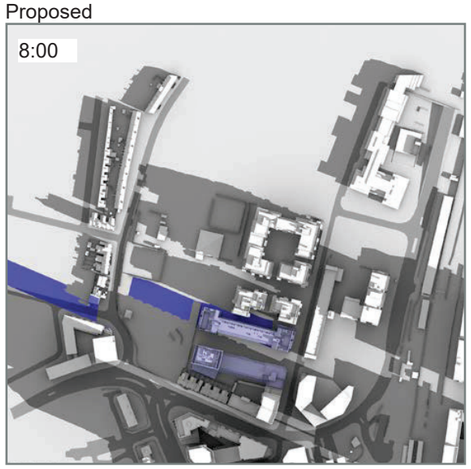




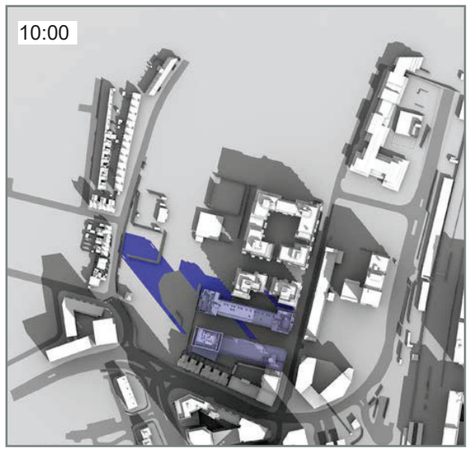



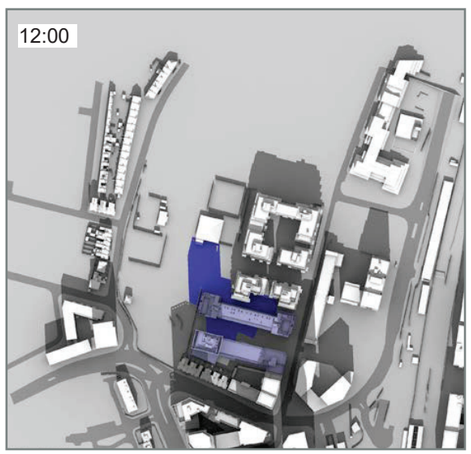

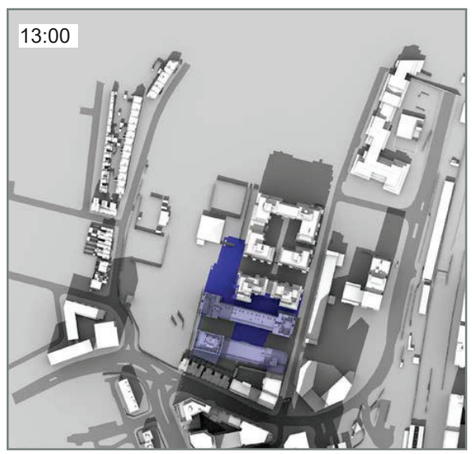

Ashley Road
Tottenham Hale
Transient Overshadowing


Proposed


NORTH


Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)


21st March (equinox)
Hourly Shadows

Proposed

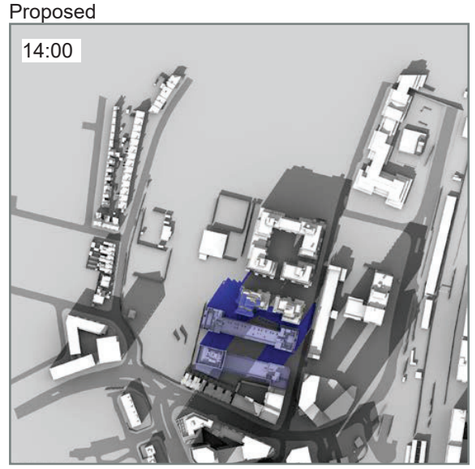



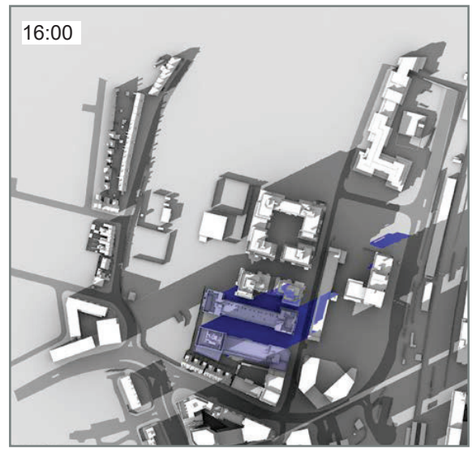



Ashley Road
Tottenham Hale
Transient Overshadowing


Proposed


NORTH


Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)


21st June (summer solstice)
Hourly Shadows


Proposed

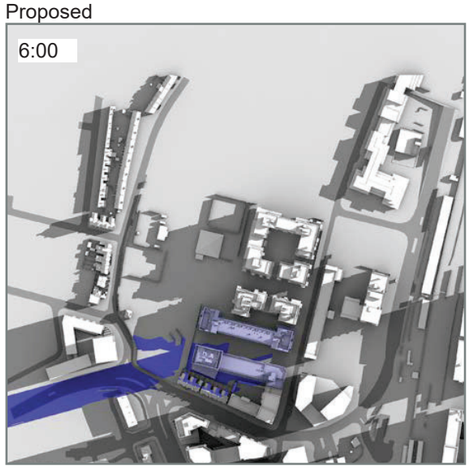




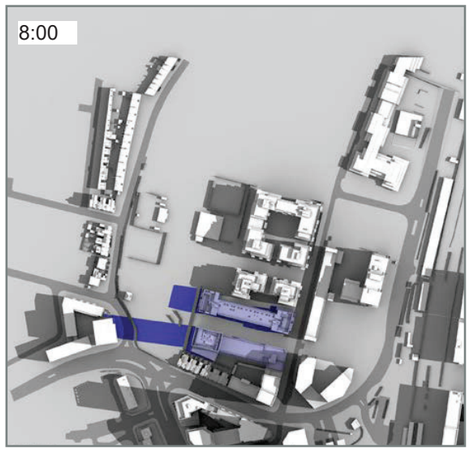



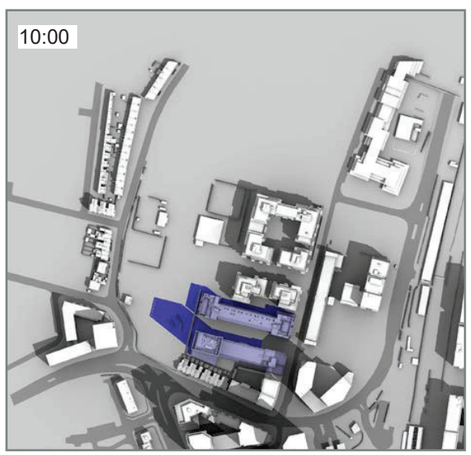

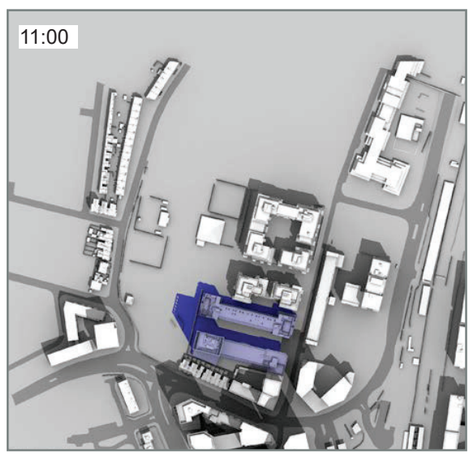

Ashley Road
Tottenham Hale
Transient Overshadowing

Proposed

NORTH


Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)


21st June (summer solstice)
Hourly Shadows


Proposed






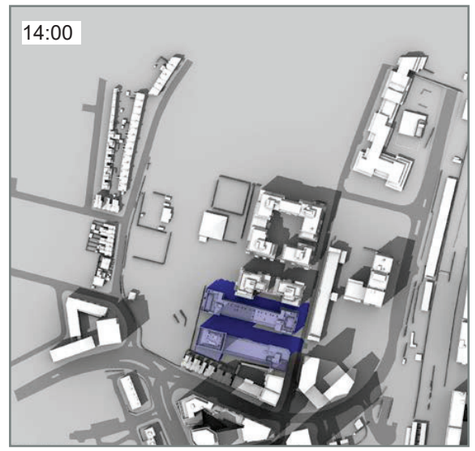

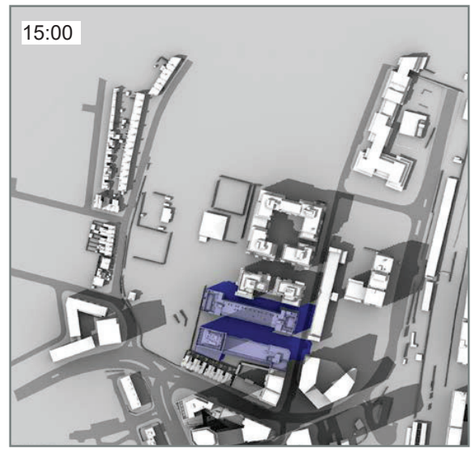

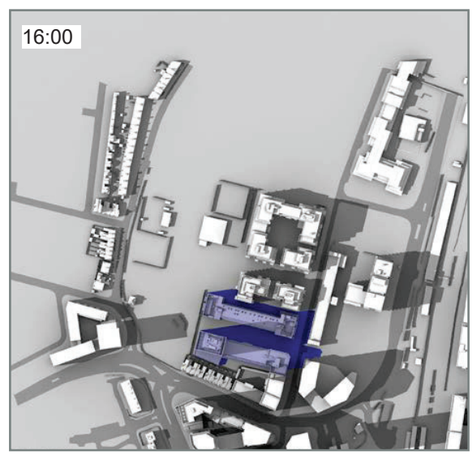

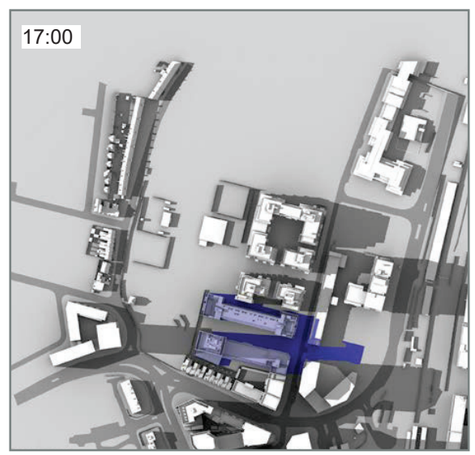

Ashley Road
Tottenham Hale
Transient Overshadowing


Proposed

NORTH

Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)


21st June (summer solstice)
Hourly Shadows


Proposed





21st December (winter solstice)
Hourly Shadows


Proposed









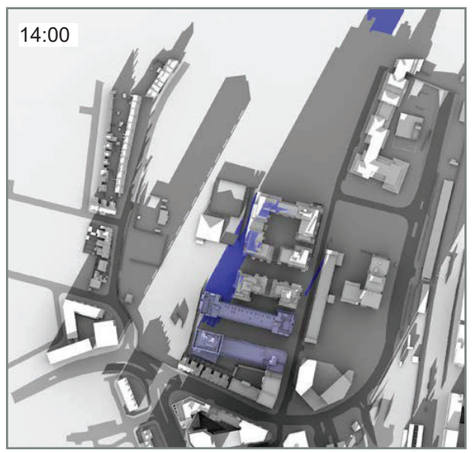

Cumulative Scenario

2nd Floor, Chancery Exchange
10 Furnival Street
London EC4A 1AB

T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Transient Overshadowing


Ashley Road
Tottenham Hale


11 August 2026


Ref. 10106-R08-TS02

21st March (equinox)
Hourly Shadows


Proposed







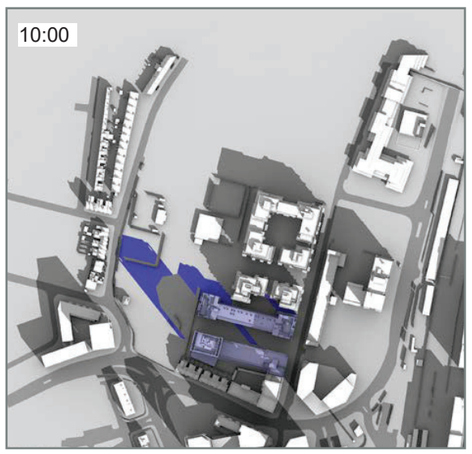

Cumulative





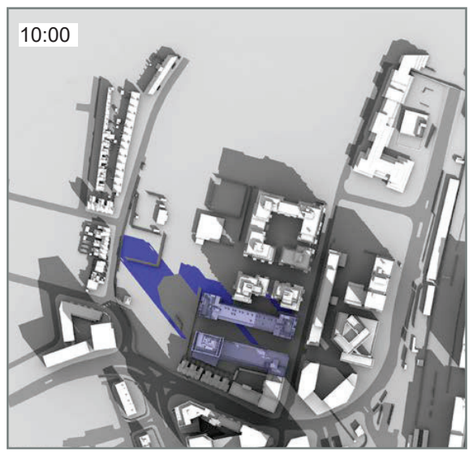

Ashley Road
Tottenham Hale
Transient Overshadowing

Proposed


NORTH


Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)

21st March (equinox)
Hourly Shadows


Proposed







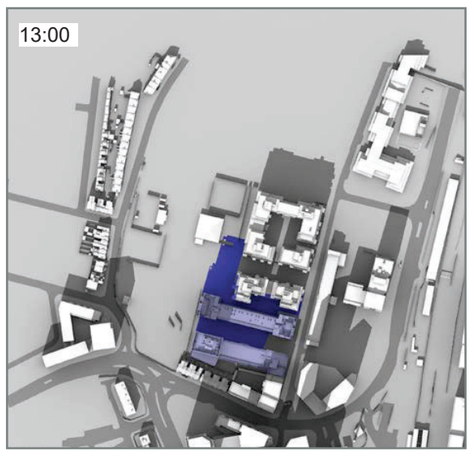

Cumulative





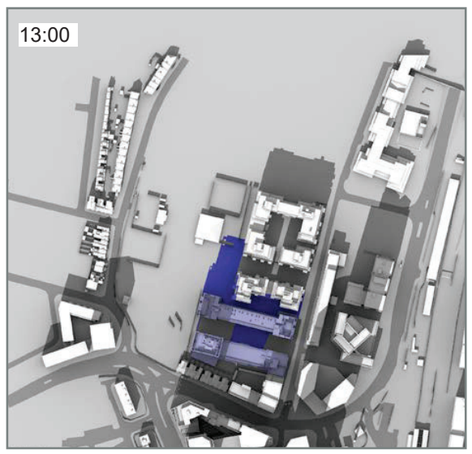

Ashley Road
Tottenham Hale
Transient Overshadowing


Proposed


NORTH


Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)

21st March (equinox)
Hourly Shadows


Proposed







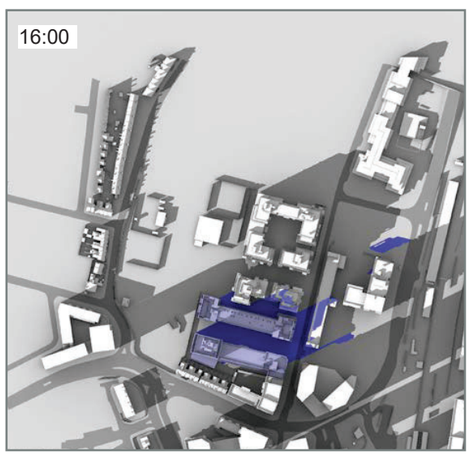

Cumulative






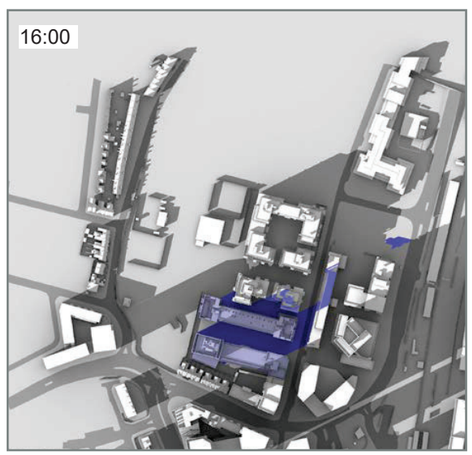


21st March (equinox)
Hourly Shadows

Proposed





Cumulative




21st June (summer solstice)
Hourly Shadows


Proposed




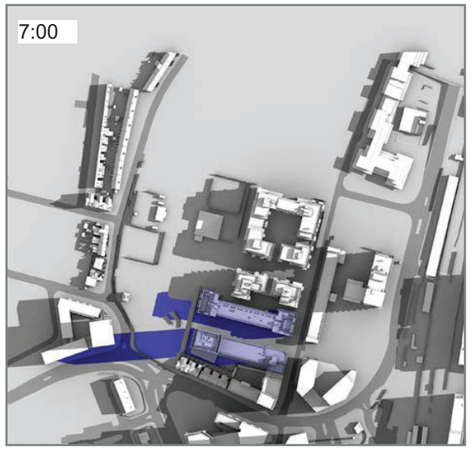


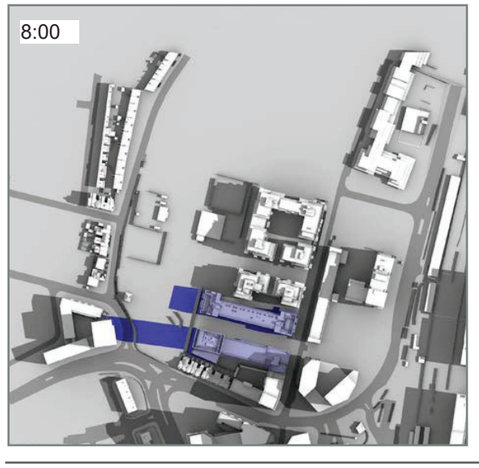

Cumulative




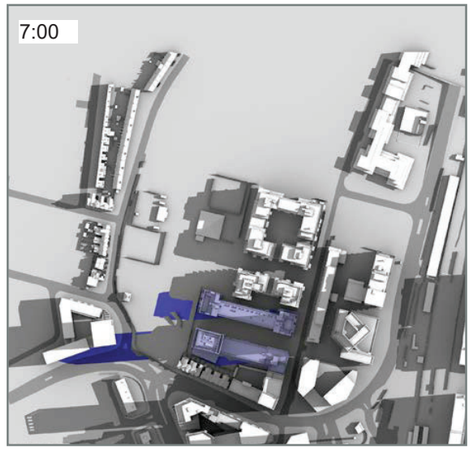


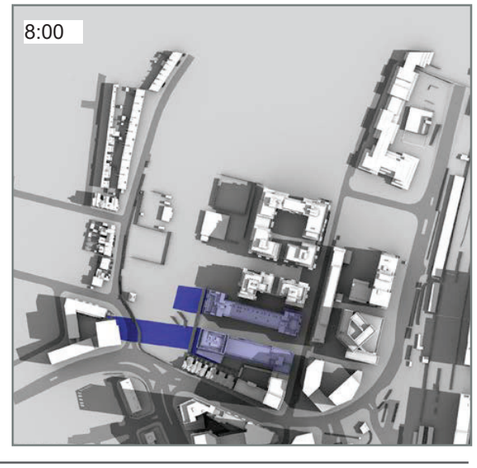


21st June (summer solstice)
Hourly Shadows


Proposed




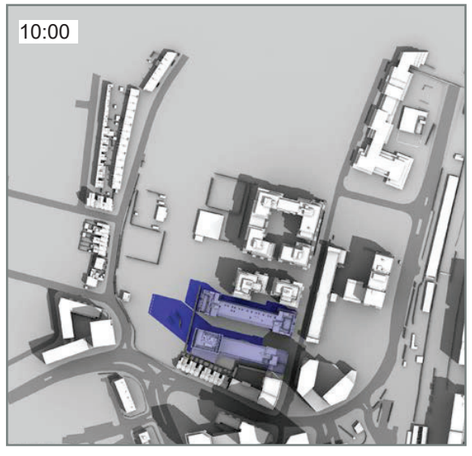


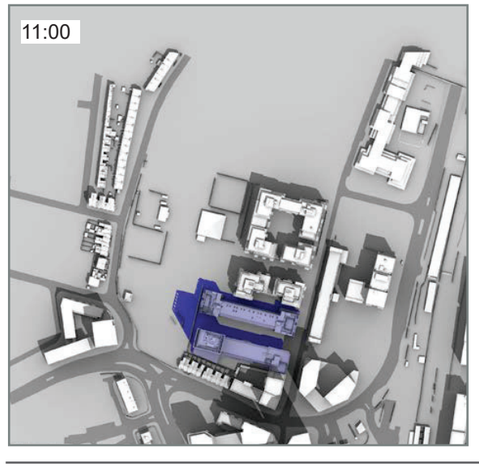

Cumulative




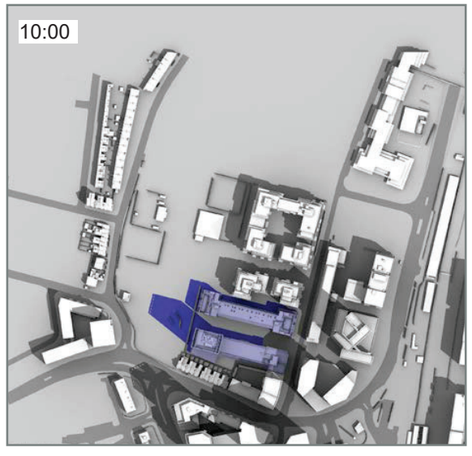


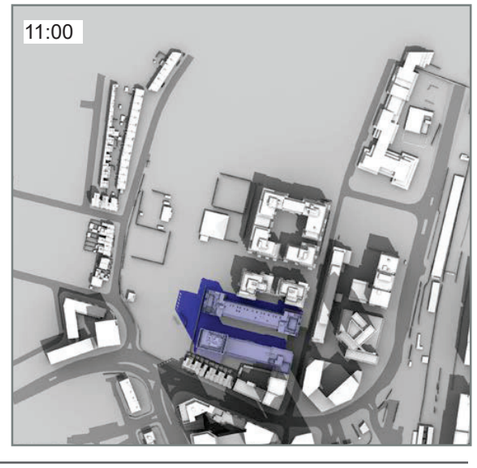


21st June (summer solstice)
Hourly Shadows

Proposed







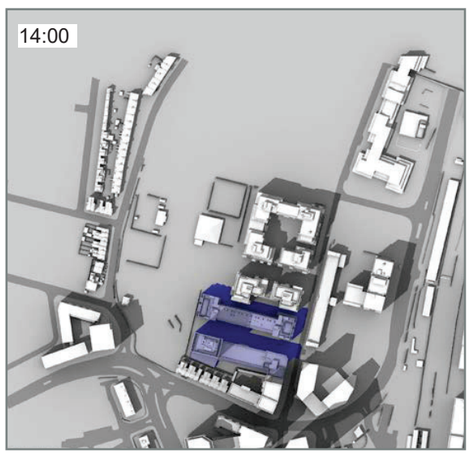

Cumulative







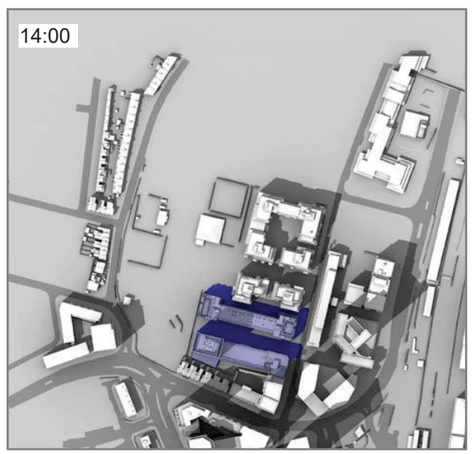


21st June (summer solstice)
Hourly Shadows


Proposed







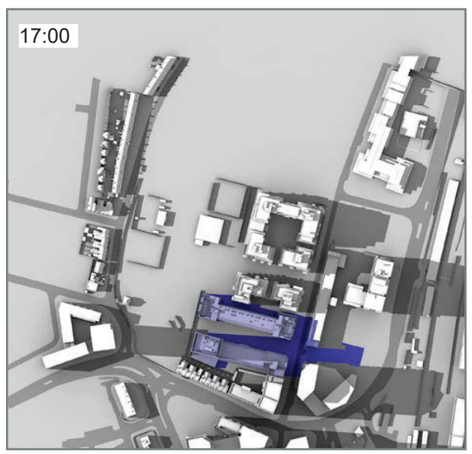

Cumulative






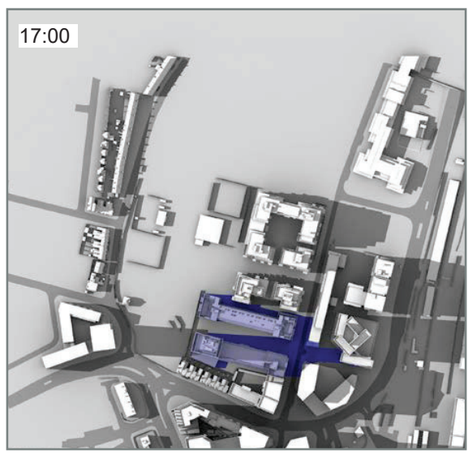


21st June (summer solstice)
Hourly Shadows

Proposed



Cumulative

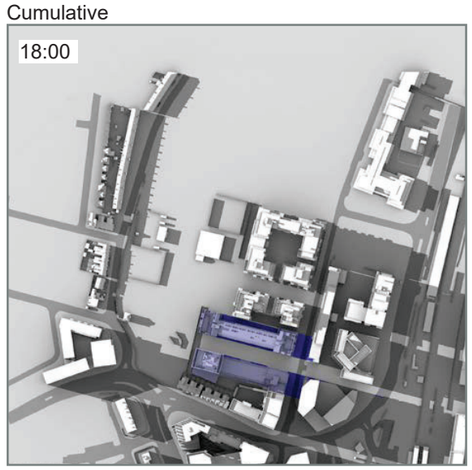

Ashley Road
Tottenham Hale
Transient Overshadowing


Proposed


NORTH


Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)

21st December (winter solstice)
Hourly Shadows


Proposed

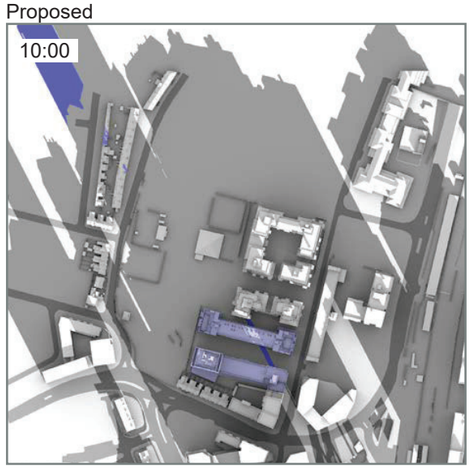


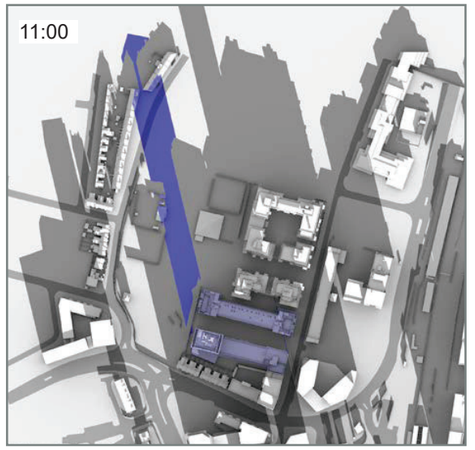


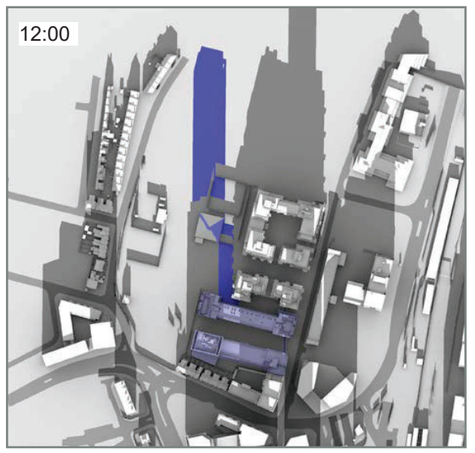

Cumulative

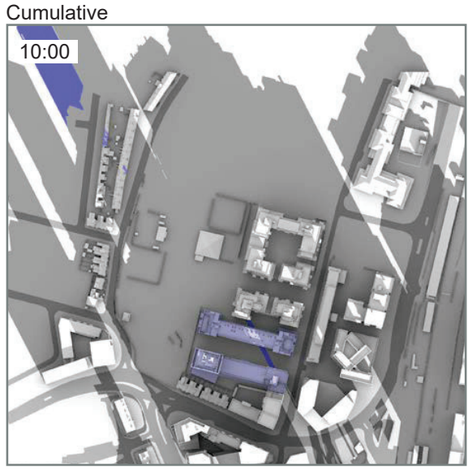

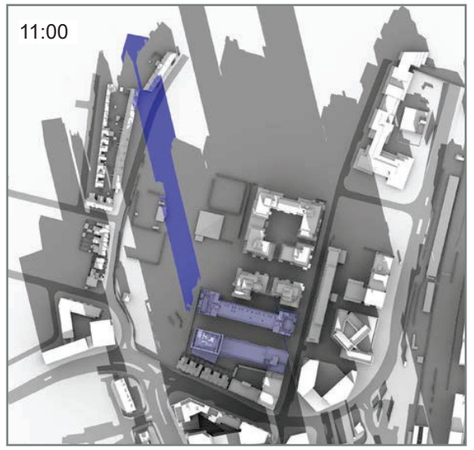

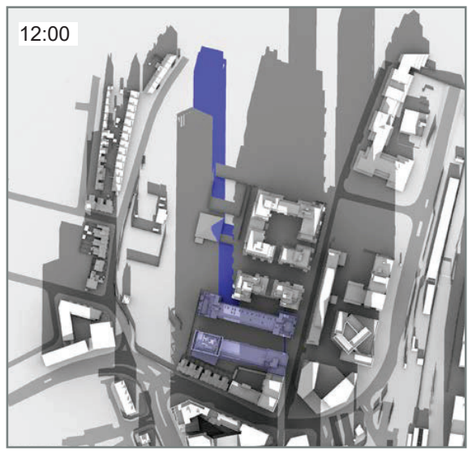


Ashley Road
Tottenham Hale
Transient Overshadowing


Proposed


NORTH


Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)

21st December (winter solstice)
Hourly Shadows





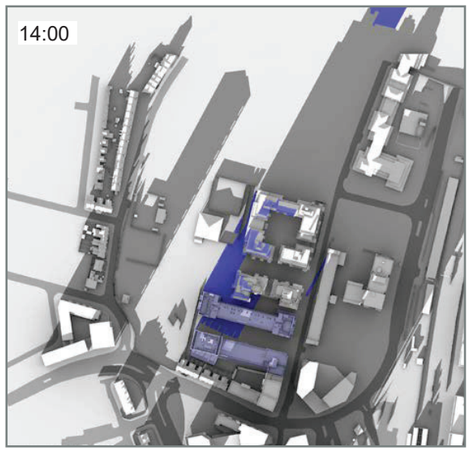

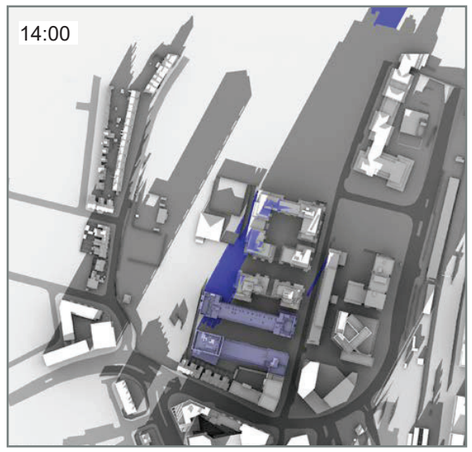

Ashley Road
Tottenham Hale
Transient Overshadowing

Proposed

NORTH

Latitude: 51.6N
Min. solar altitude 10 degrees (BR209 3.3.8)
Intervals displaying solar times (LAT)

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 9

Solar Glare images

2nd Floor, Chancery Exchange
10 Furnival Street
London EC4A 1AB


T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Reflected Solar Glare

Ashley Road
Tottenham Hale

Our ref. 10106-R08-SG01


11 August 2026

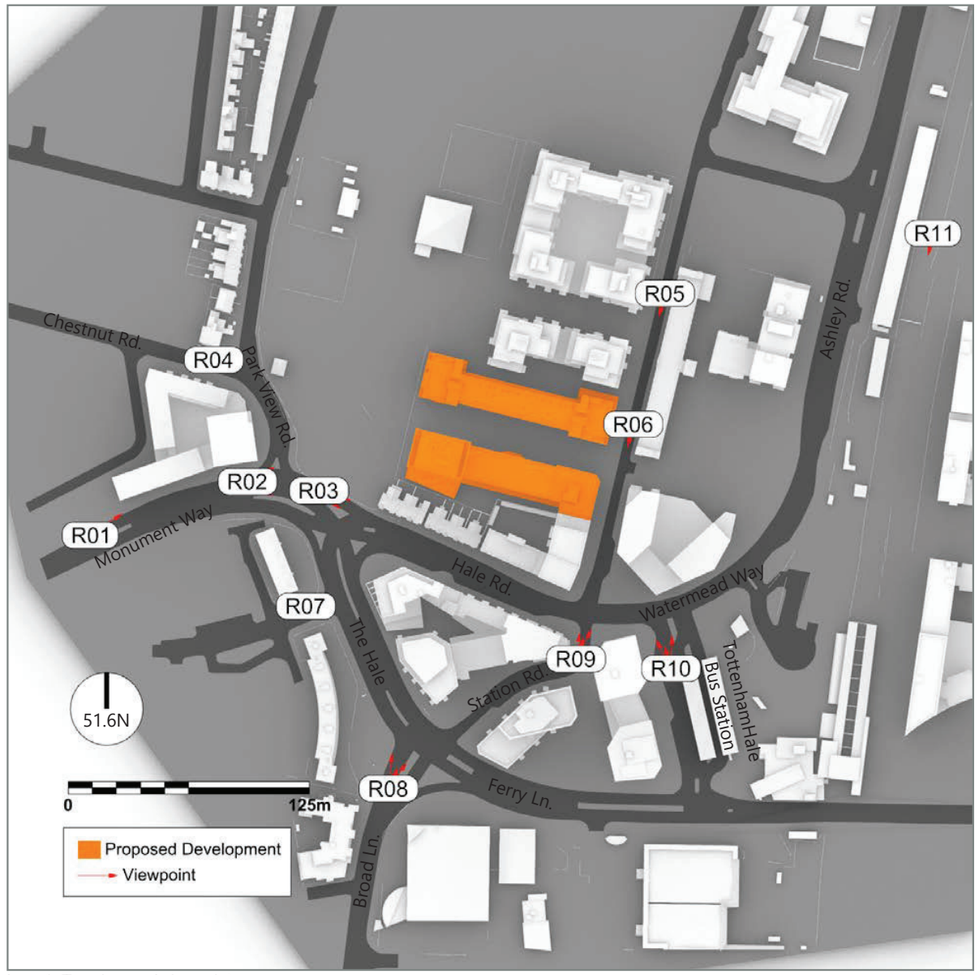

Img. 1: Top view and viewpoints




Img. 2: Bird's eye view from southwest

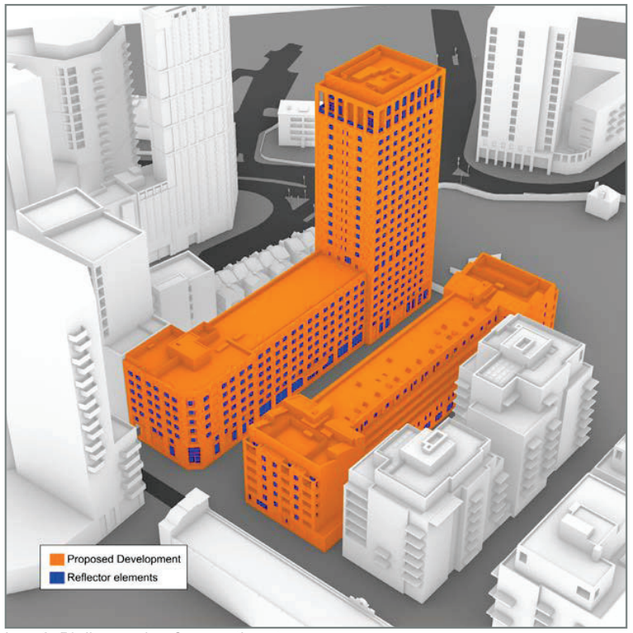


Img. 3: Bird's eye view from northeast

Viewpoint R01 (looking ahead)


Frequency of Reflections

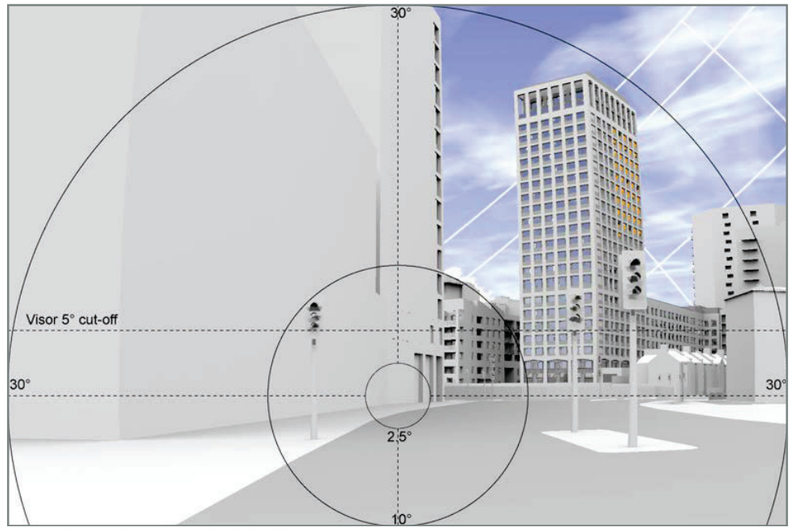


Img. 4: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

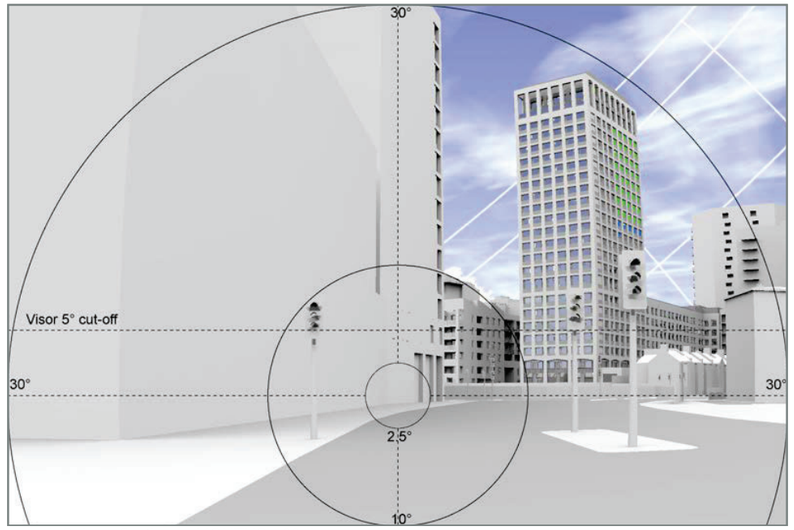


Img. 5: Solar reflections - MONTHS - 60 degrees view




Viewpoint R01 (looking to left signal)


Frequency of Reflections

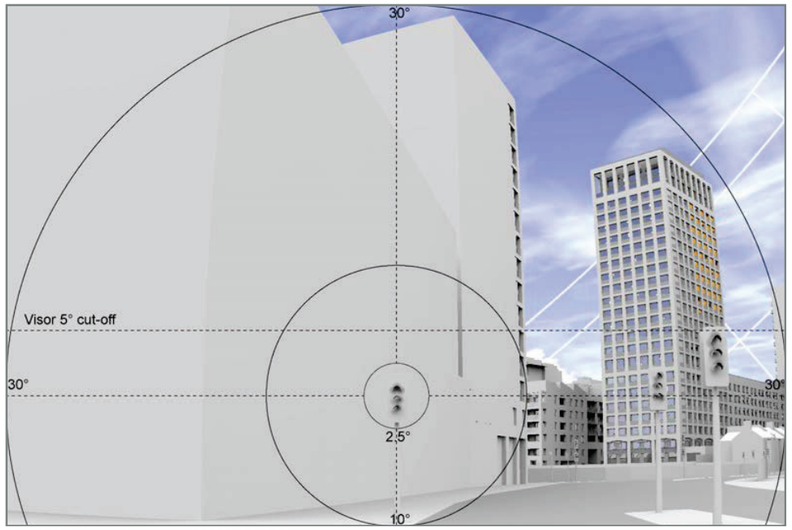


Img. 6: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

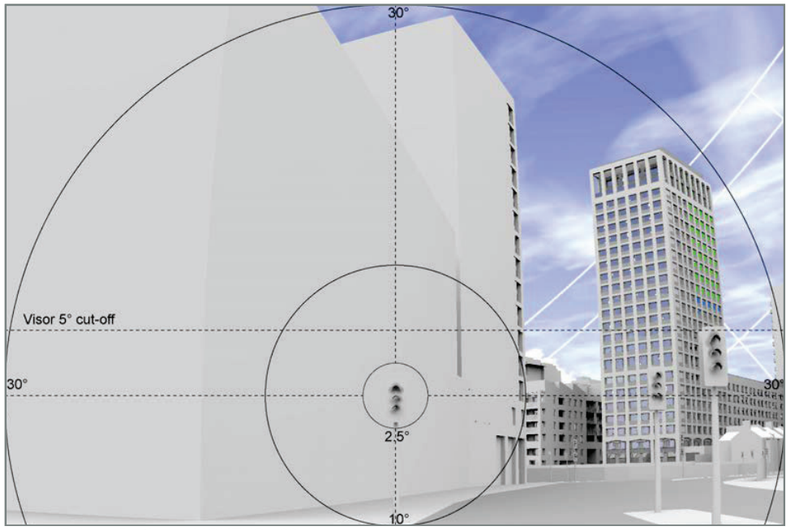


Img. 7: Solar reflections - MONTHS - 60 degrees view




Viewpoint R1 (looking to right signal)


Frequency of Reflections

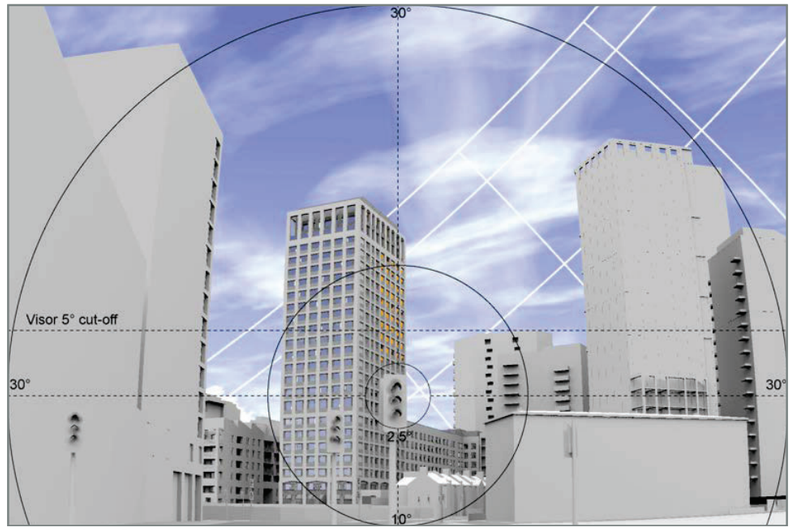


Img. 8: Solar reflections - HOURS - 60 degrees view




*Add one hour for British Summer Time

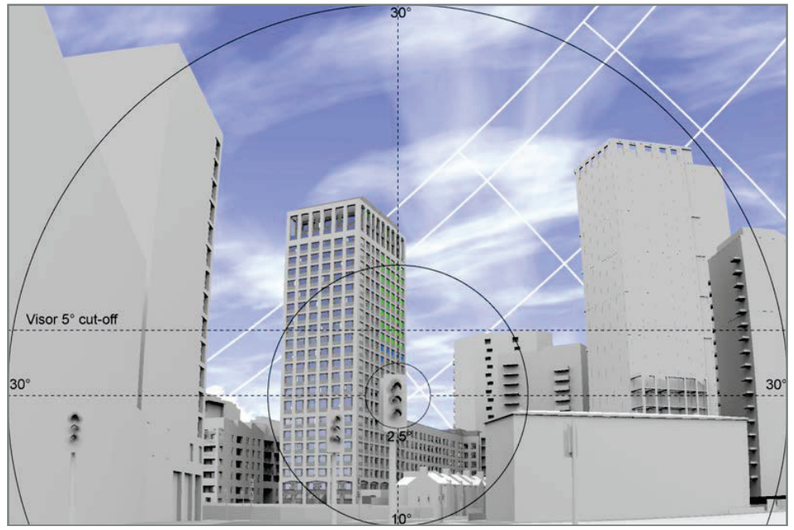


Img. 9: Solar reflections - MONTHS - 60 degrees view




Viewpoint R02 (looking ahead)
Frequency of Reflections

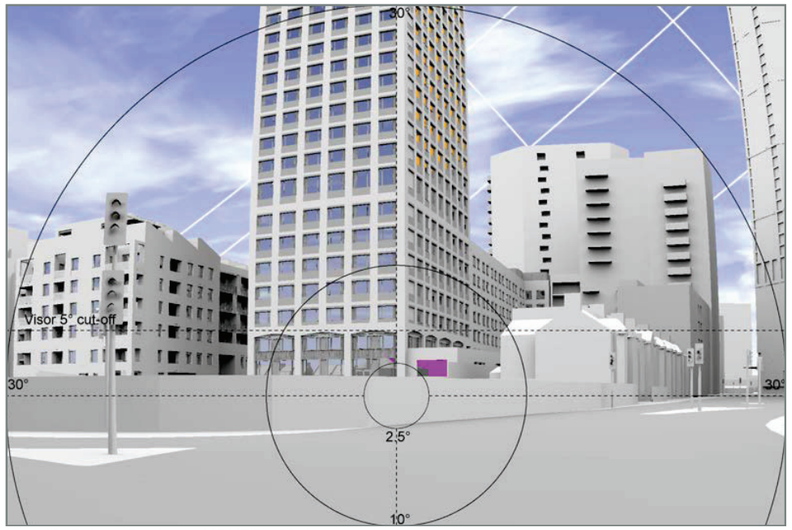


Img. 10: Solar reflections - HOURS - 60 degrees view




*Add one hour for British Summer Time

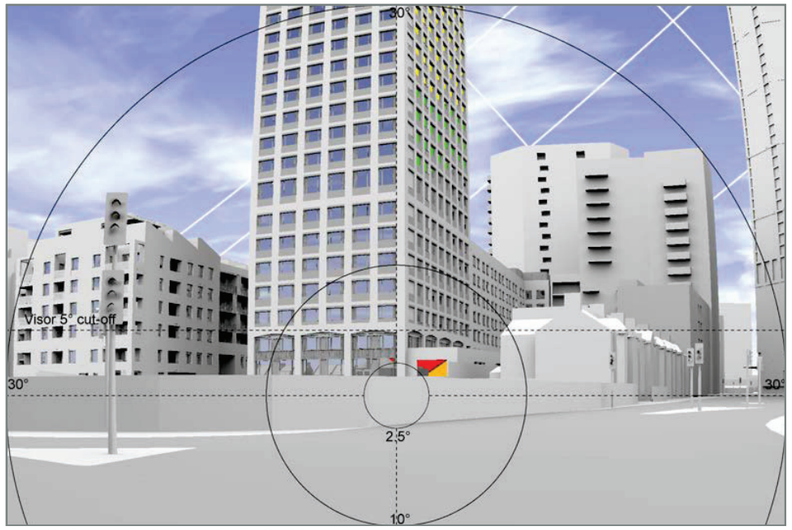


Img. 11: Solar reflections - MONTHS - 60 degrees view




Viewpoint R02 (looking to left signal)
Frequency of Reflections

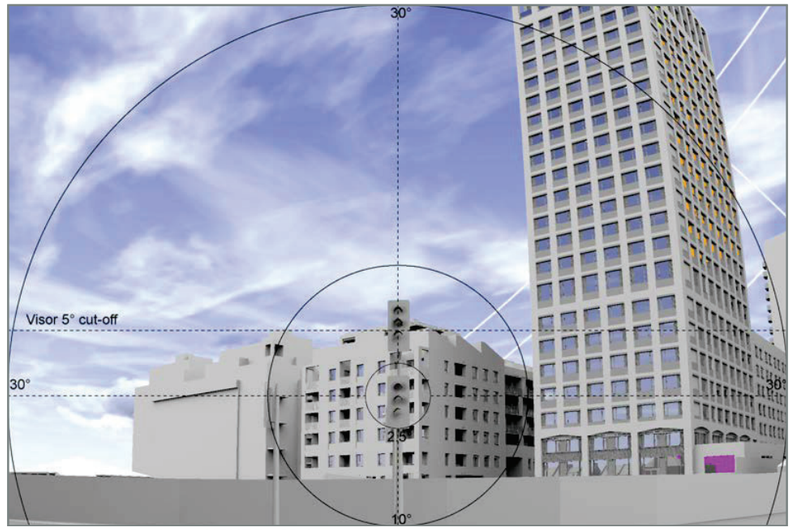


Img. 12: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

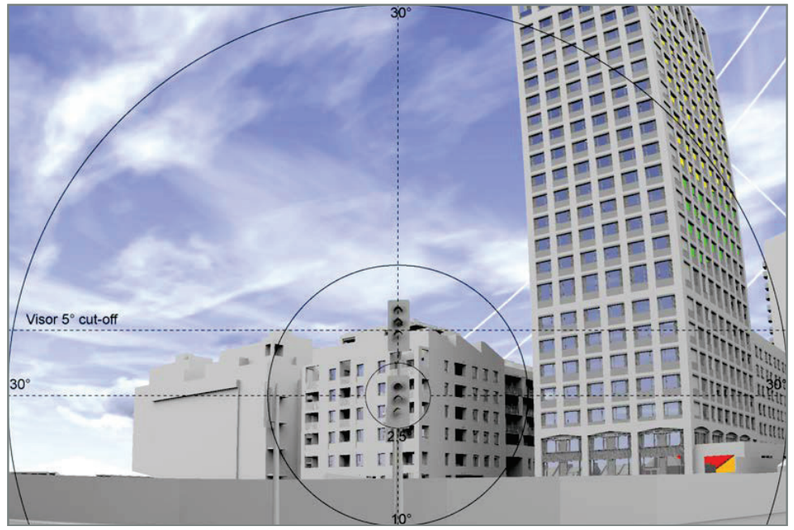


Img. 13: Solar reflections - MONTHS - 60 degrees view




Viewpoint R02 (looking to right signal)


Frequency of Reflections

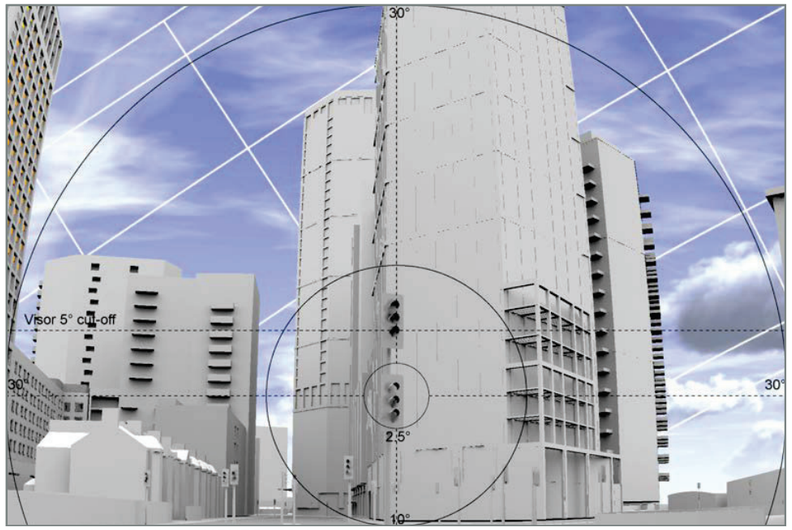


Img. 14: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

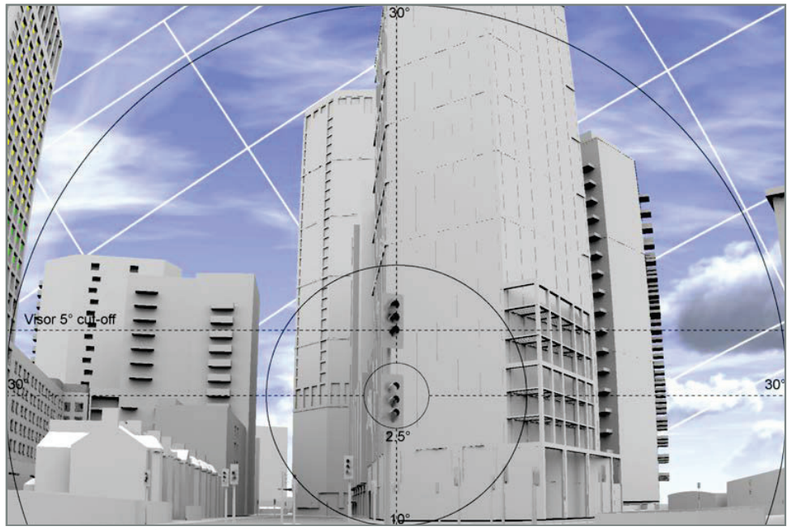


Img. 15: Solar reflections - MONTHS - 60 degrees view




Viewpoint R03 (looking ahead)


Frequency of Reflections

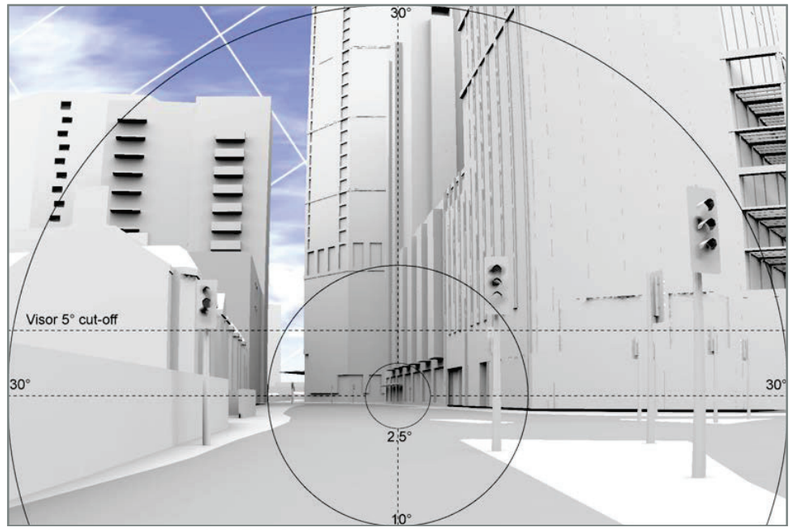


Img. 16: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

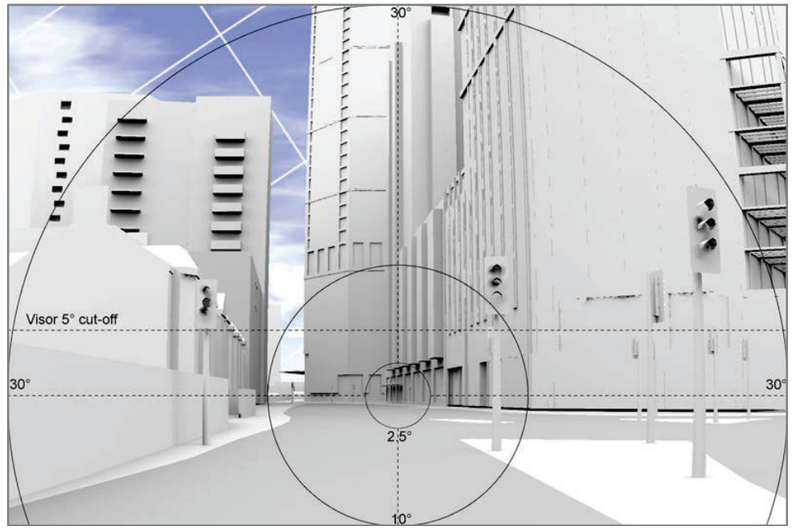


Img. 17: Solar reflections - MONTHS - 60 degrees view




Viewpoint R03 (looking to left signal)


Frequency of Reflections

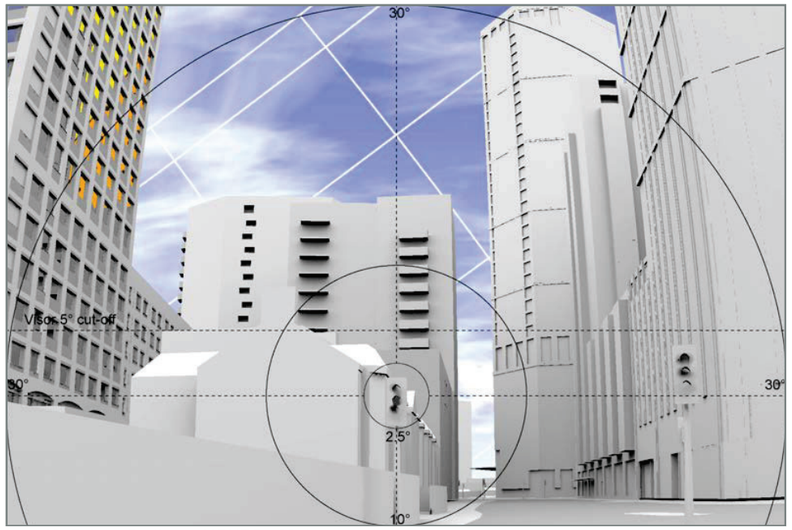


Img. 18: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

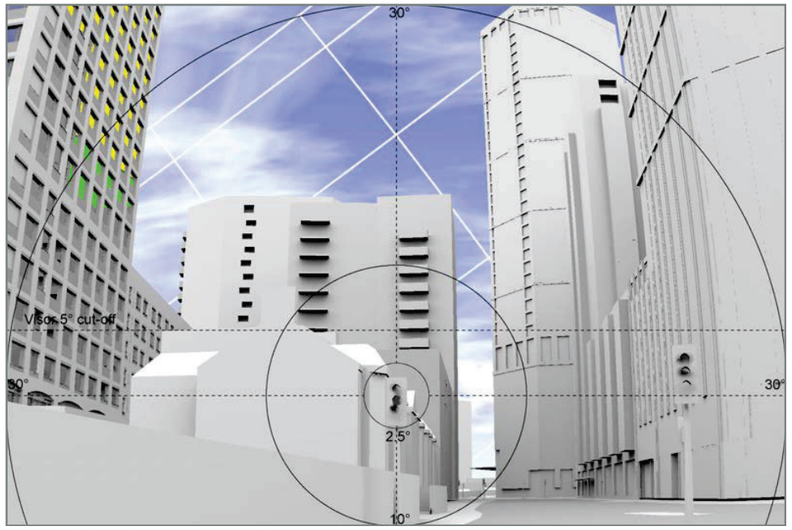


Img. 19: Solar reflections - MONTHS - 60 degrees view




Viewpoint R03 (looking to right signal)


Frequency of Reflections

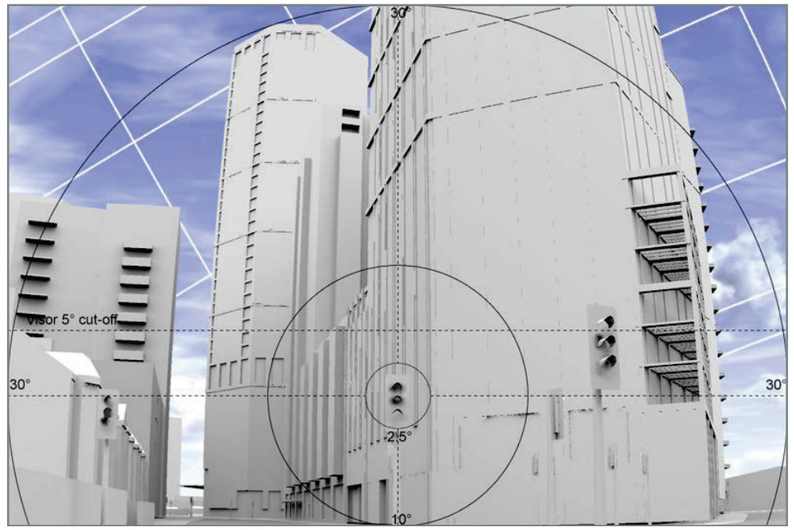


Img. 20: Solar reflections - HOURS - 60 degrees view




*Add one hour for British Summer Time

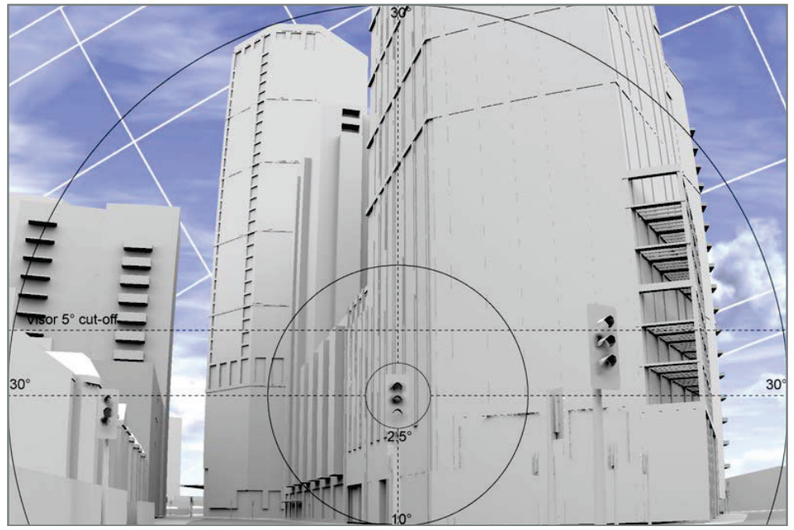


Img. 21: Solar reflections - MONTHS - 60 degrees view




Viewpoint R04
Frequency of Reflections

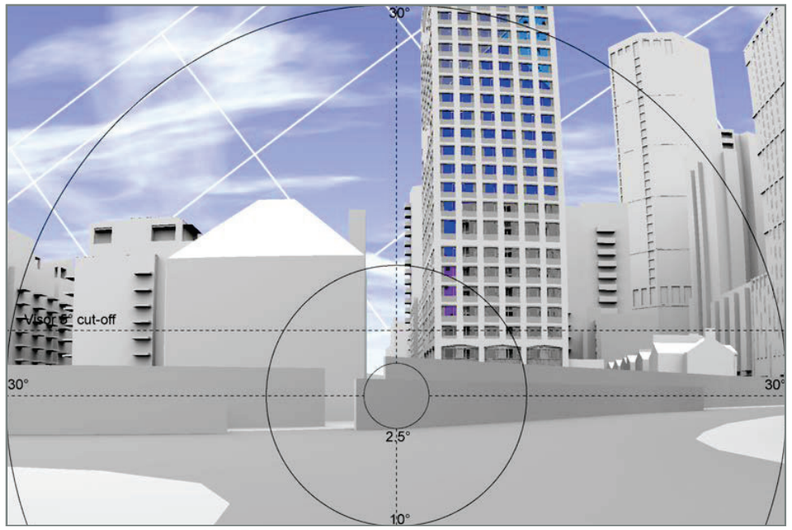


Img. 22: Solar reflections - HOURS - 60 degrees view




*Add one hour for British Summer Time

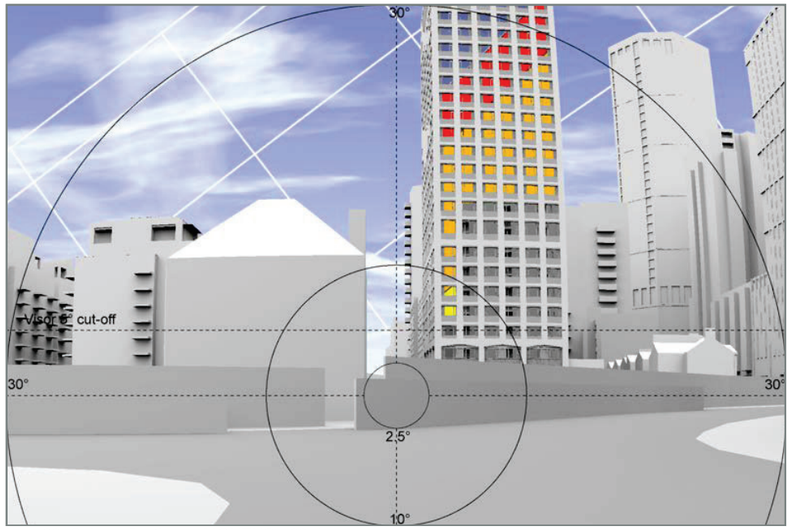


Img. 23: Solar reflections - MONTHS - 60 degrees view




Viewpoint R05
Frequency of Reflections

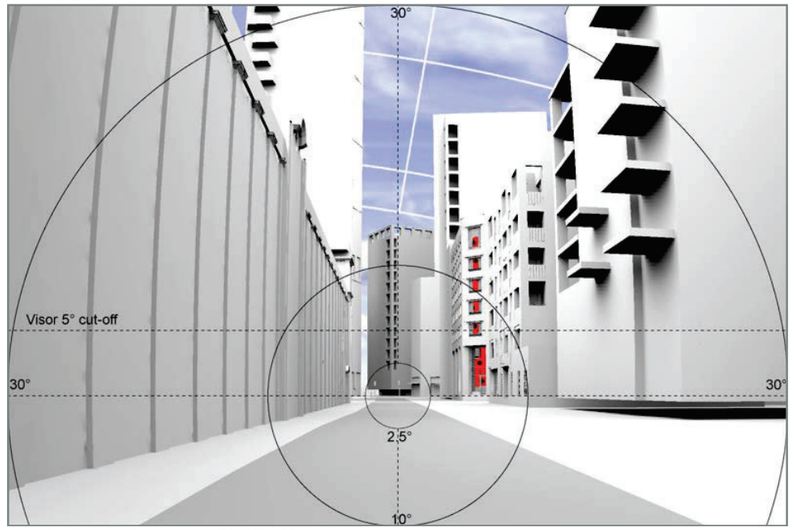


Img. 24: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

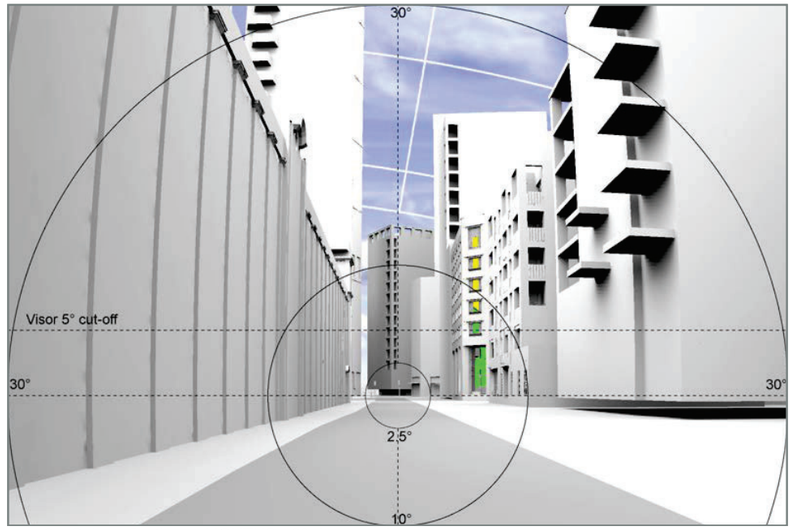


Img. 25: Solar reflections - MONTHS - 60 degrees view




Viewpoint R06


Frequency of Reflections

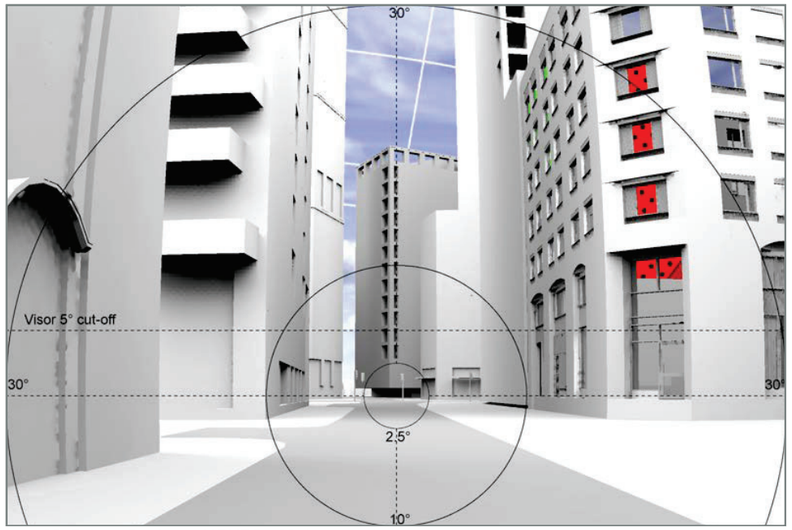


Img. 26: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

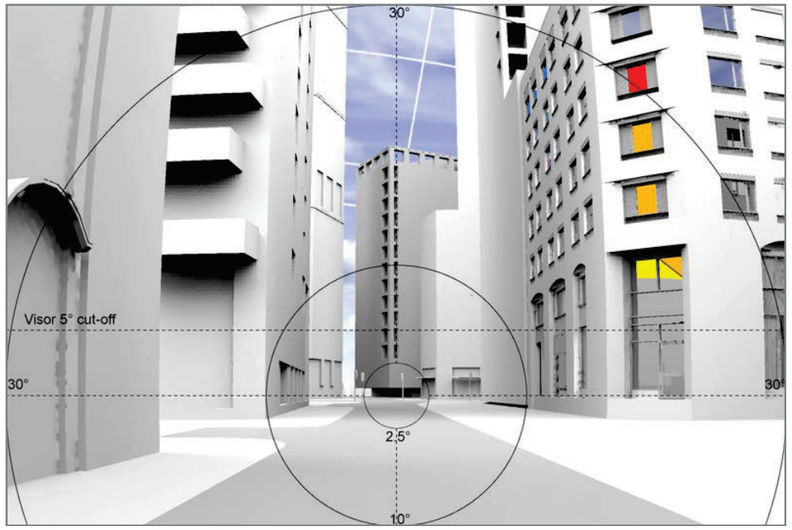


Img. 27: Solar reflections - MONTHS - 60 degrees view




Viewpoint R07


Frequency of Reflections

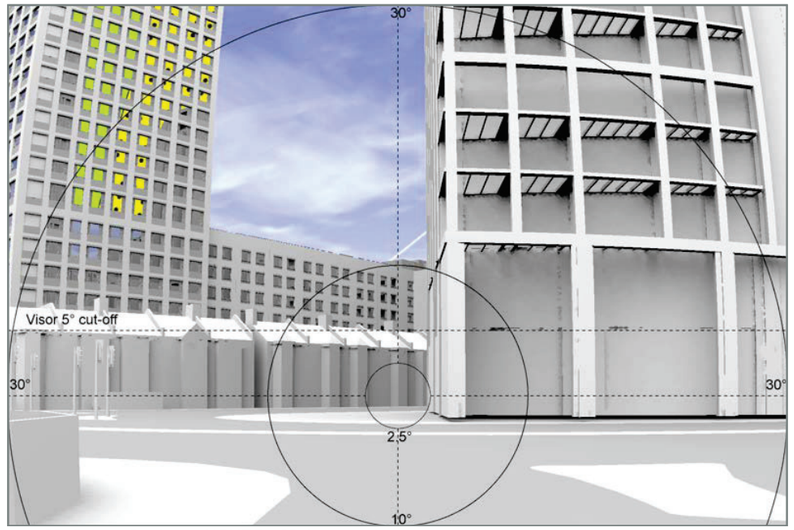


Img. 28: Solar reflections - HOURS - 60 degrees view




*Add one hour for British Summer Time

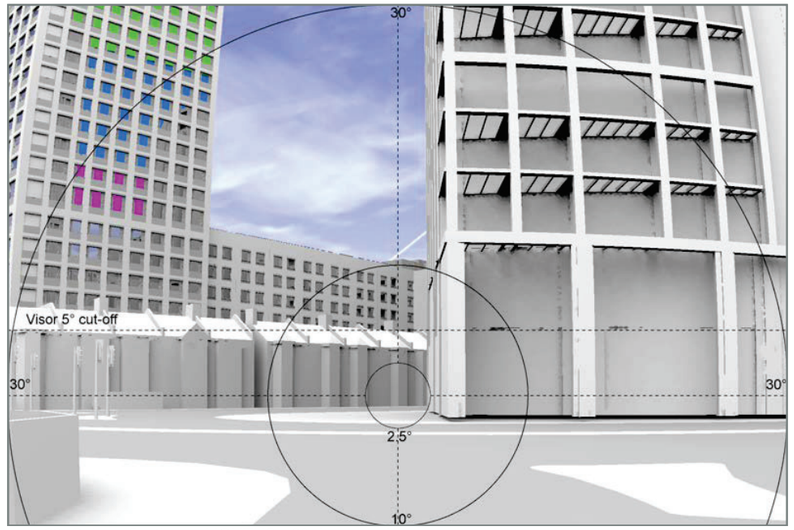


Img. 29: Solar reflections - MONTHS - 60 degrees view




Viewpoint R08 (looking ahead)
Frequency of Reflections

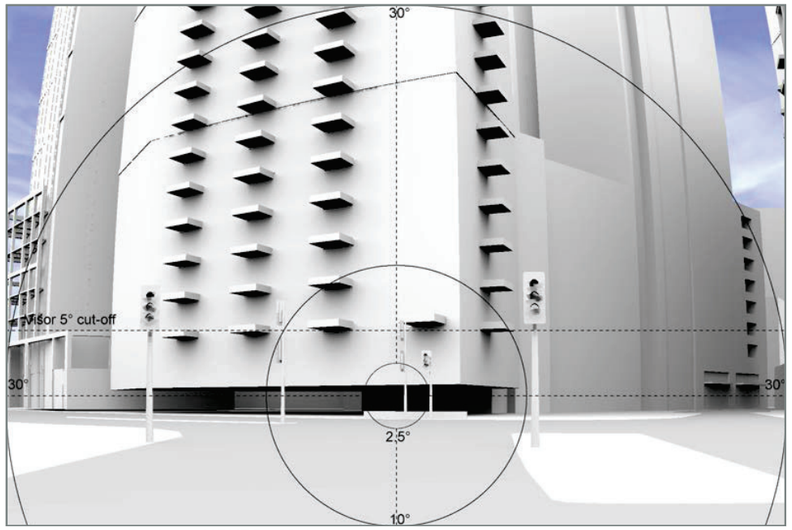


Img. 30: Solar reflections - HOURS - 60 degrees view




*Add one hour for British Summer Time

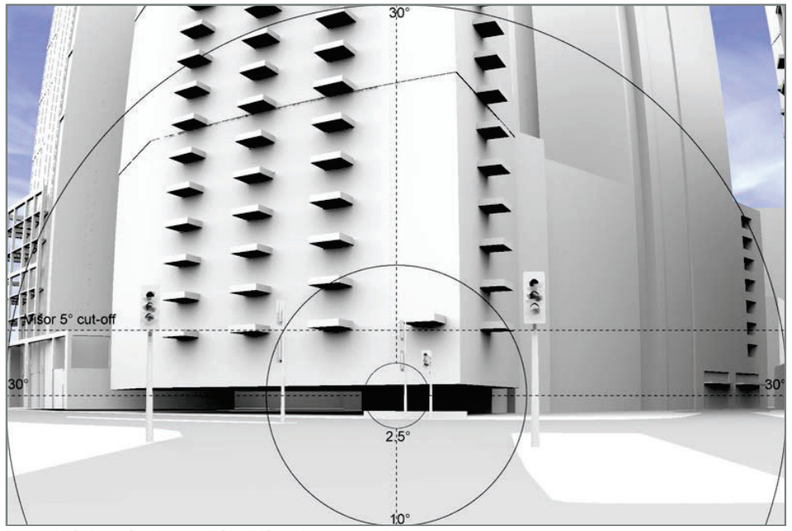


Img. 31: Solar reflections - MONTHS - 60 degrees view




Viewpoint R08 (looking to left signal)
Frequency of Reflections

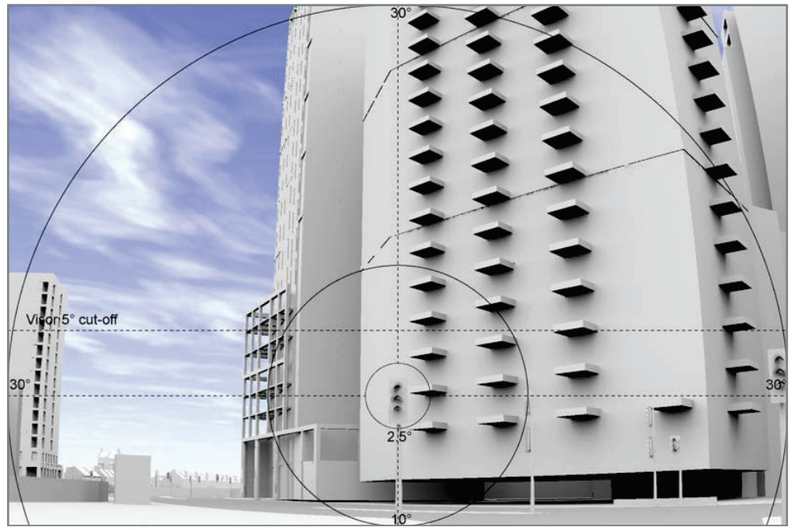


Img. 32: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

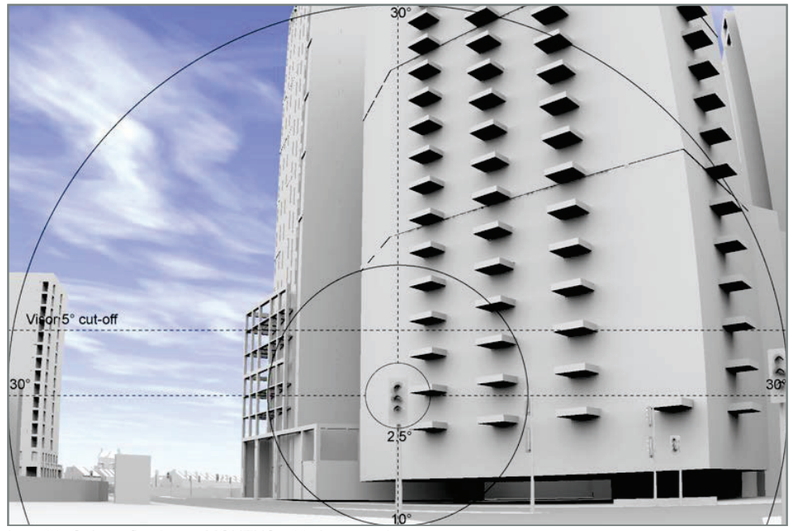

Img. 33: Solar reflections - MONTHS - 60 degrees view




Viewpoint R08 (looking to right signal)

Frequency of Reflections




Img. 34: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time




Img. 35: Solar reflections - MONTHS - 60 degrees view




Viewpoint R09 (looking ahead)


Frequency of Reflections

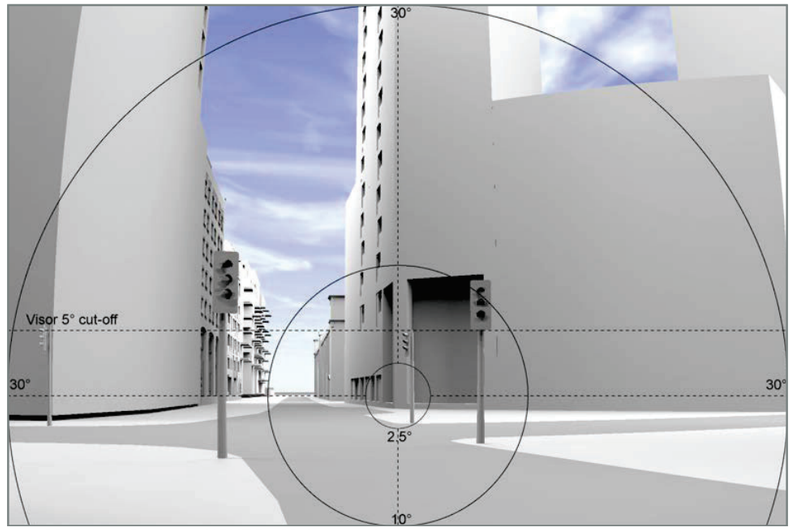


Img. 36: Solar reflections - HOURS - 60 degrees view




*Add one hour for British Summer Time

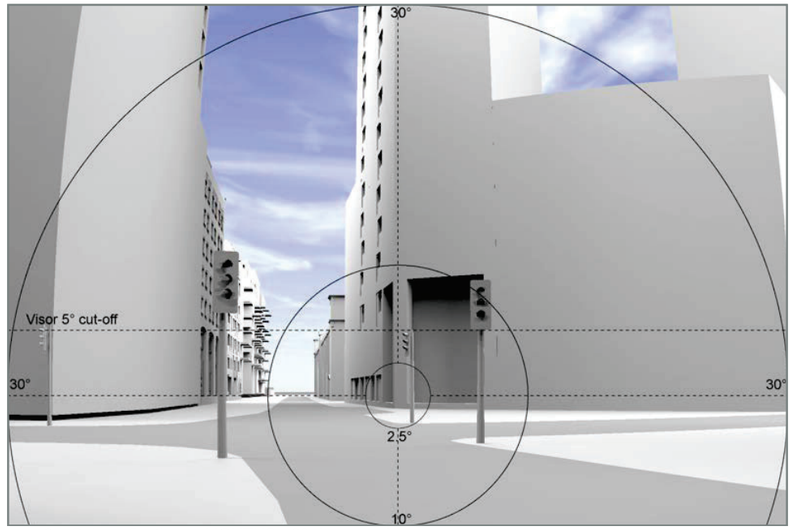


Img. 37: Solar reflections - MONTHS - 60 degrees view




Viewpoint R09 (looking to left signal)
Frequency of Reflections

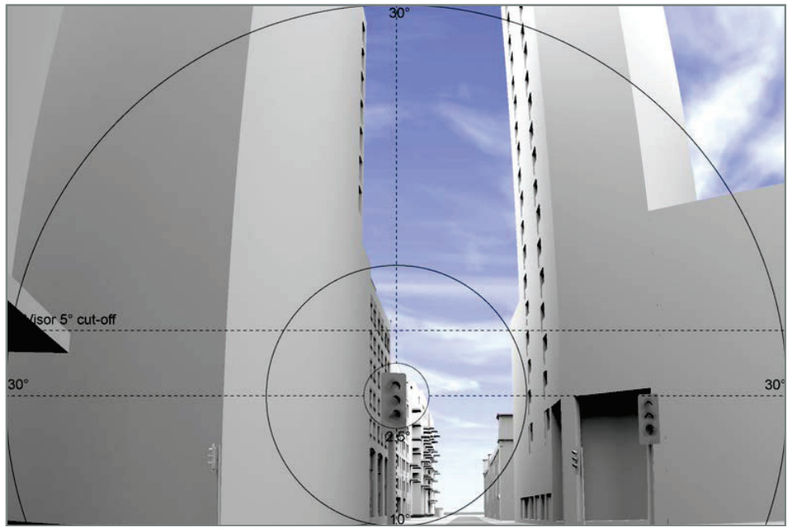


Img. 38: Solar reflections - HOURS - 60 degrees view




*Add one hour for British Summer Time

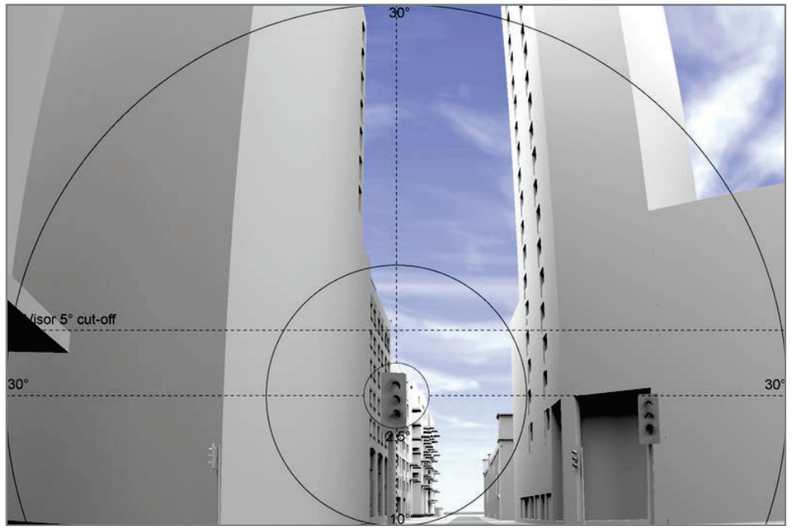


Img. 39: Solar reflections - MONTHS - 60 degrees view




Viewpoint R09 (looking to left signal)
Frequency of Reflections

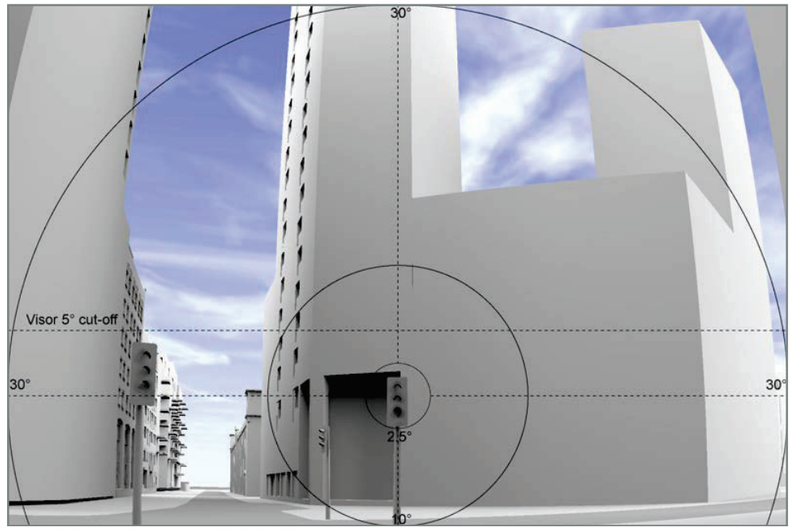


Img. 40: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

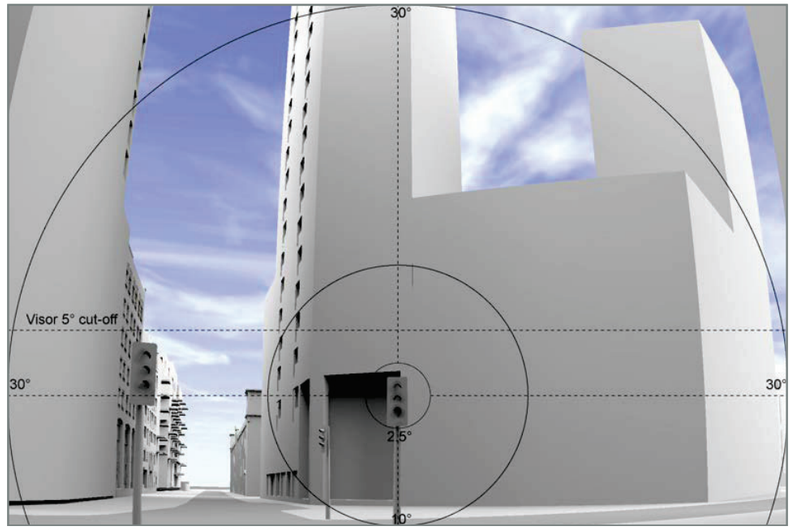


Img. 41: Solar reflections - MONTHS - 60 degrees view




Viewpoint R10 (looking ahead)


Frequency of Reflections

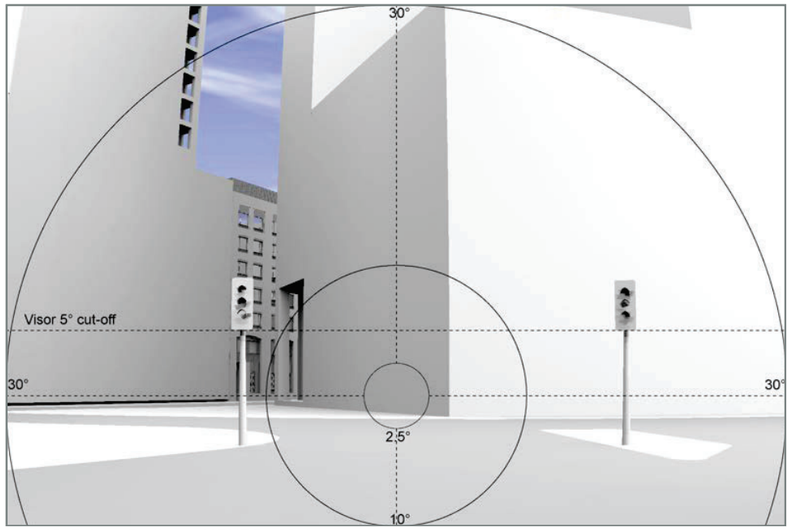


Img. 42: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

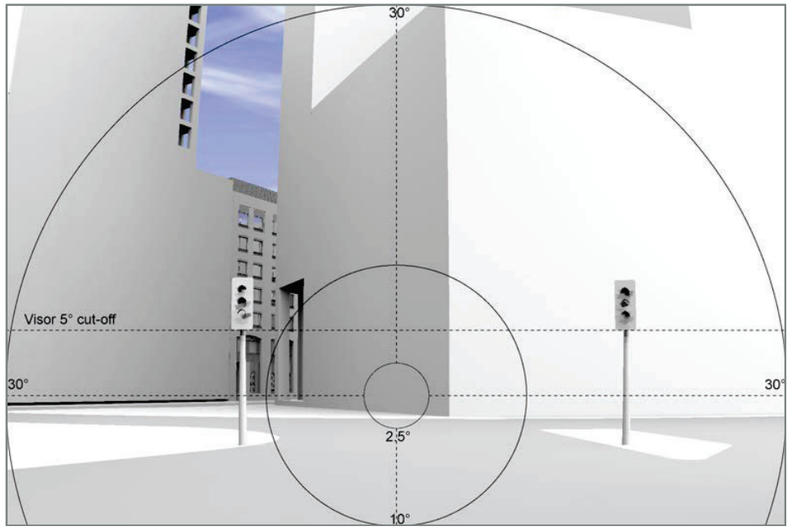


Img. 43: Solar reflections - MONTHS - 60 degrees view




Viewpoint R10 (looking to left signal)


Frequency of Reflections

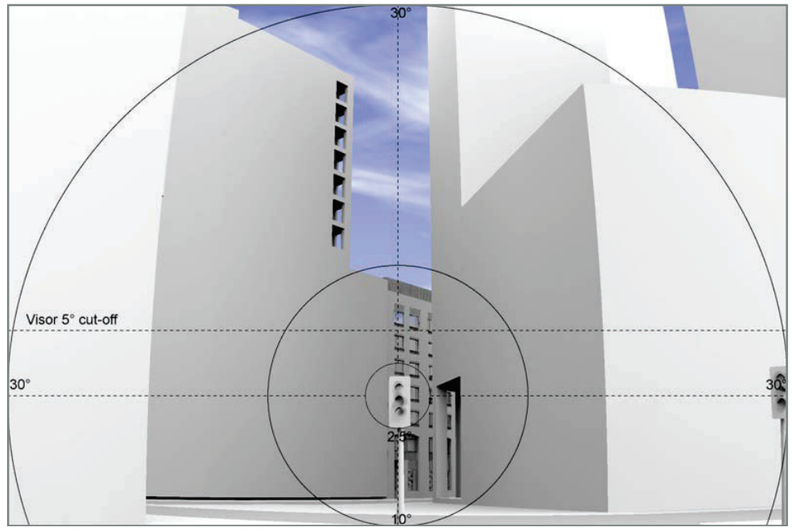


Img. 44: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

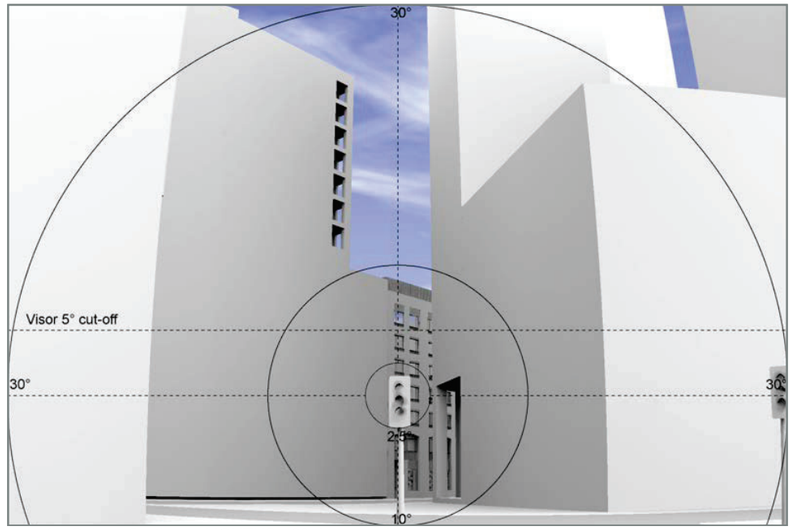


Img. 45: Solar reflections - MONTHS - 60 degrees view




Viewpoint R10 (looking to right signal)


Frequency of Reflections

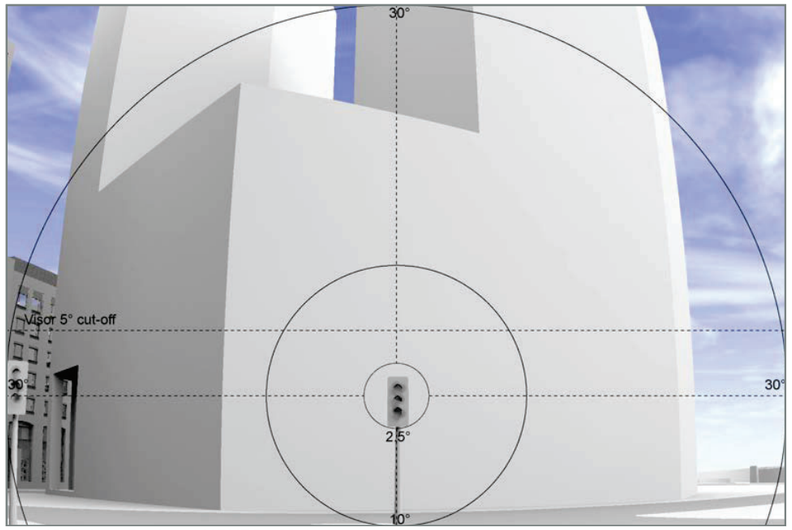


Img. 46: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

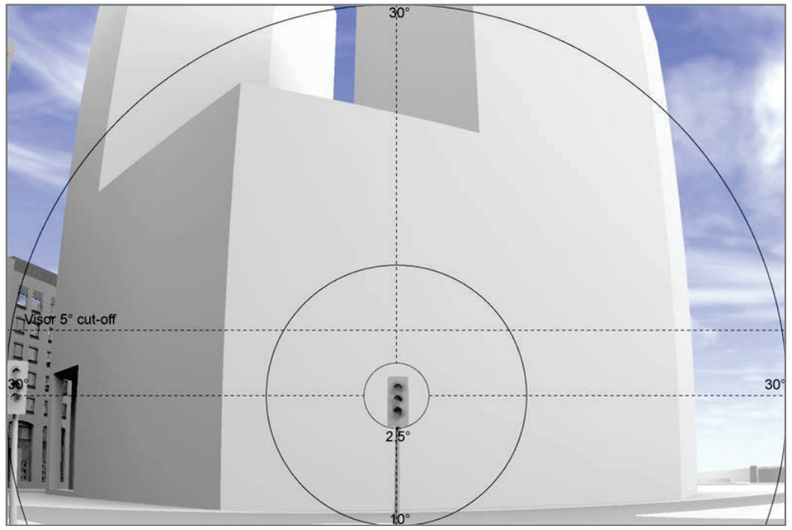


Img. 47: Solar reflections - MONTHS - 60 degrees view




Viewpoint R11


Frequency of Reflections

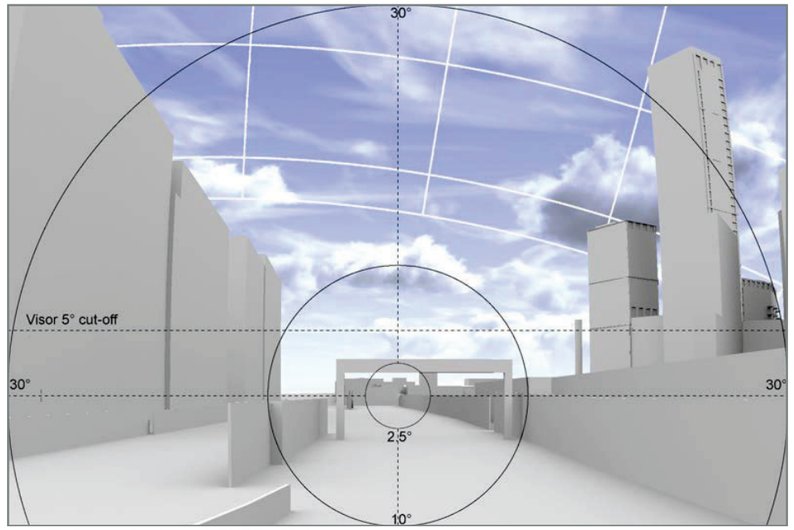


Img. 48: Solar reflections - HOURS - 60 degrees view



*Add one hour for British Summer Time

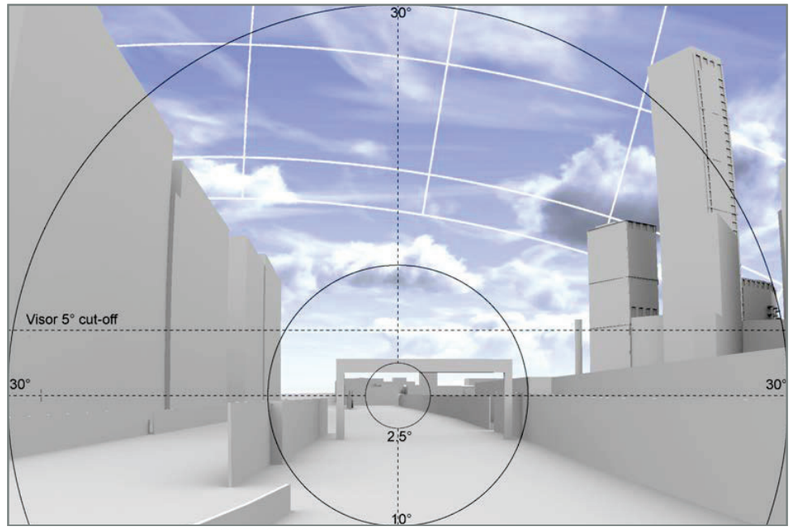

Img. 49: Solar reflections - MONTHS - 60 degrees view



Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 10

Policy and Legislation Review

National Planning Policy and Guidance

The National Planning Policy Framework - Department for Housing, Communities and Local Government (August 2026)

X.1 The latest National Planning Policy Framework was published on 17 August 2026, replacing the version published in December 2024. The framework sets out both plan-making and decision-making policies across the country including a presumption towards development in many cases unless the benefits of the proposals are substantially outweighed by specific types of harm.

X.2 Policy P3 is a national decision-making policy of applying to all types of development and stating that development proposals should:

"a. Provide healthy living conditions for occupiers and users in terms of adequate access to light […]

b. Not give rise to, or contribute to, an unacceptable level of access to daylight and sunlight for neighbouring residents and occupiers […] Adverse impacts of this nature should be avoided where possible, or else mitigated to an acceptable degree."

X.3 Policy P3 does not adopt numerical daylight or sunlight standard and determining whether amenity levels remain "adequate" or may be considered "unacceptable" requires a judgement to be formed about the particular development within the site context.

X.4 This may be interpreted by reference to the Planning Practice Guidance 'Making Effective Use of Land' (February 2025) which plays an important supporting role to the policy. It similarly states that local planning authorities will need to consider whether the proposed development "would have an unreasonable impact on the daylight and sunlight levels enjoyed by neighbouring occupiers", as well as assessing "whether daylight and sunlight within the development itself will provide satisfactory living conditions for future occupants".

X.5 On the standard to be applied, the guidance states that all developments should maintain acceptable living standards, and that:

"What this means in practice, in relation to assessing appropriate levels of sunlight and daylight, will depend to some extent on the context for the development as well as its detailed design. For example, in areas of high-density historic buildings, or city centre locations where tall modern buildings predominate, lower daylight and daylight and sunlight levels at some windows may be unavoidable if new developments are to be in keeping with the general form of their surroundings."

X.6 Policy L1 to L3 of the NPPF deal with Making effective use of land' set out further considerations which apply, in addition to Policy P3, to defined categories of development.

X.7 Policy L2 affords substantial weight to the benefits of development proposal which would remediate land, make better use of vacant and underutilised buildings and provide temporary uses on previously developed land and buildings prior to their redevelopment. It also affords such weigh to proposals creating additional homes or floorspace within a settlement by using the airspace above existing residential or commercial premises, or through sensitive redevelopment or additional development within existing plots. Examples include the addition of mansard roofs, proposals to fill gaps in an existing roof line, the introduction of higher buildings at street corners, and additional units within residential curtilages.

X.8 Section L2 (d)(ii) notes that such developments should maintain *"acceptable living standards for residents and neighbours in terms of access to daylight, sunlight, privacy and external amenity space."*

X.9 Policy L3 requires development proposals to make efficient use of land and to be refused where this is not achieved. Guidance is given regarding increasing density of areas within settlements, on allocated / consented sites to the edge of settlements and in proximity to well-connected stations.

X.10 Within settlements the existing character of an area should be taken into account, in accordance with policy DP3, but should not preclude development which makes the most of an area's potential.

Planning Practice Guidance

X.11 With respect to daylight and sunlight the Planning Practice Guide (PPG): Design, paragraph 026 states:

"Account should be taken of local climatic conditions, including daylight and sunlight…"

Local Planning Guidance

London Borough of Haringey - Draft Local Plan (2025)

X.12 Whilst the draft local plan is in for submission, the policies contained are a useful indicator for what future policy is likely to be implemented. Relevant policies have been extracted below.

Policy D11: High-Quality Housing

(2) ensure good orientation, and daylight and sunlight access and meet or exceed the aspect, orientation, daylight and sunlight standards for private internal space as set out in the London Plan and associated guidance;

Aspect, orientation, daylight and sunlight

L. The design and layout of buildings must enable sufficient sunlight and daylight to penetrate into and between buildings whilst also ensuring that adjoining land or properties are protected from unacceptable overshadowing. Proposals should be consistent with BRE guidance and with British Standard BS EN 17037 'Daylight in buildings.

Policy D10: Tall and Mid-Rise Buildings

(E) Mitigating microclimate impacts Proposals for tall and mid-rise buildings should avoid negative impacts on neighbouring sites and areas. Proposals should be designed to:

(1) minimise overshadowing of existing buildings and amenity spaces and avoid significant negative impact on existing renewable energy installations on adjacent sites;

2) avoid negative microclimate impacts on nearby sites and public realm including wind tunnels, overheating, daylight access, 601 | Design | Haringey Draft Local Plan : Part 3 glare, pollution and overshadowing;

The Haringey Local Plan (2017)

SP0: Presumption in Favour of Sustainable Development

"The Council will promote the most efficient use of land in Haringey and buildings while also seeking to improve the quality of our environment protect the amenity of occupiers and neighbours and meet other planning objectives."

SP1: Managing Growth

"The Council will expect development in the growth areas to maximise site opportunities and the opportunities and benefits for the borough and the local area within the context of the full range of Haringey's planning policies and objectives, including those relating to amenity, sustainability, heritage/ built environment, open space, community safety and sustainable transport.

SP2: Housing

"Good quality housing design can improve social well-being and quality of life by reducing crime, improving public health, easing transport problems and increasing property values."

"Haringey will ensure that CABE's Building for Life criteria are used to evaluate the quality of new housing developments across the borough and that all new affordable housing funded through the Affordable Housing Programme meets or exceeds the minimum standards set by the Mayor."

"The Council will expect good quality housing design to be contextually sensitive so that it positively contributes to the local and historic character of an area/neighbourhood."

The London Plan – The Mayor of London (March 2021)

X.13 The mayor of London's Plan gives the Following -

Policy D6 Housing quality and standards

"C. Housing development should maximise the provision of dual aspect dwellings and normally avoid the provision of single aspect dwellings. A single aspect dwelling should only be provided where it is considered a more appropriate design solution to meet the requirements of Part B in Policy D3 Optimising site capacity through the design-led approach than a dual aspect dwelling, and it can be demonstrated that it will have adequate passive ventilation, daylight and privacy, and avoid overheating."

"D. The design of development should provide sufficient daylight and sunlight to new and surrounding housing that is appropriate for its context, whilst avoiding overheating, minimising overshadowing and maximising the usability of outside amenity space."

The Housing SPG – The Mayor of London (March 2016)

X.14 The London Plan Housing SPG confirms that the flexibility that should be applied in the interpretation of the BRE guidelines having regard to the 'need to optimise capacity; and scope for the character and form of an area to change over time.;

1.3.45. Policy 7.6Bd requires new development to avoid causing 'unacceptable harm' to the amenity of surrounding land and buildings, particularly in relation to privacy and overshadowing and where tall buildings are proposed. An appropriate degree of flexibility needs to be applied when using BRE guidelines to assess the daylight and sunlight impacts of new development on surrounding properties, as well as within new developments themselves. Guidelines should be applied sensitively to higher density development, especially in opportunity areas, town centres, large sites and accessible locations, where BRE advice suggests considering the use of alternative targets. This should take into account local circumstances; the need to optimise housing capacity; and scope for the character and form of an area to change over time.

1.3.46 The degree of harm on adjacent properties and the daylight targets within a proposed scheme should be assessed drawing on broadly comparable residential typologies within the area and of a similar nature across London. Decision makers should recognise that fully optimising housing potential on large sites may necessitate standards which depart from those presently experienced, but which still achieve satisfactory levels of residential amenity and avoid unacceptable harm.

Guidance

Building Research Establishment Site Layout Planning for Daylight and Sunlight: A Guide to Good Practice, 2022

X.15 The BRE 'Site Layout Planning for Daylight and Sunlight: A Guide to Good Practice' document provides advice on site layout planning to achieve good sunlighting and daylighting within buildings, and in the open spaces between them (hereafter referred to as the 'BRE guidelines'). It is intended to be used in conjunction with the interior daylight recommendations in the BS EN17037(2018) and the guide, LG10: Daylighting – a guide for designers from the Chartered Institute of Building Services Engineers (CIBSE).

X.16 The BRE guidelines are intended for building designers, developers, consultants, and planning officials. The guidance is not mandatory and should not be used as an instrument of planning policy. In this regard the guidelines state the following:

"The guide is intended for building designers and their clients, consultants, and planning officials. The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly since natural lighting is only one of many factors in site layout design. In special circumstances the developer or planning authority may wish to use different target values. For example, in a historic city centre, or in an area with modern high rise buildings, a higher degree of obstruction may be unavoidable if new Developments are to match the heights and proportions of existing buildings."

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings
Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring Properties
Annex 3: Results of the Cumulative Daylight and Sunlight Assessments
Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments
Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments
Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments
Annex 7: Results of the Sunlight Amenity Assessments
Annex 8: Transient Shadow Images
Annex 9: Solar Glare Images
Annex 10: Policy and Legislation Review
Annex 11: Hale Road Properties

Annex 11

Hale Road Properties

Baseline Conditions

Daylight and Sunlight

X.1 Table 9.1 to Table 9.3, summarise the baseline daylight and sunlight results for 11-17 Hale Road. Full results of the baseline assessments can be found in ***ES Volume 3, Appendix: Daylight, Sunlight, Overshadowing and Solar Glare - Annex 2***.

Table 9.1 Baseline VSC Summary

Receptor (all residential use)	Total Number of Windows	Total Number of Windows that Achieve or Exceed VSC Levels Suggested in the BRE Guidance	Total Number of Windows that Achieve VSC Levels Below those Suggested in the BRE Guidance
11 Hale Road	7	2	5
13 Hale Road	7	1	6
15 Hale Road	7	3	4
17 Hale Road	8	4	4
Grand Total	**29**	**10**	**19**

Table 9.2 Baseline NSL Summary

Receptor (all residential use)	Total Number of Rooms	Total Number of Rooms that Achieve or Exceed NSL Levels Suggested in the BRE Guidance	Total Number of Rooms that Achieve NSL levels below those suggested in the BRE Guidance
11 Hale Road	4	3	1
13 Hale Road	4	4	0
15 Hale Road	5	2	3
17 Hale Road	4	4	0
Grand Total	**17**	**13**	**4**

Table 9.3 Baseline APSH Summary

Receptor (all residential use)	Total Number of Rooms Facing the Site Within 90° of Due South	Total Number of Rooms that Achieve or Exceed both Annual and Winter APSH Levels Suggested in the BRE Guidance	Total Number of Rooms that Achieve Annual or Winter APSH Levels Below those Suggested in the BRE Guidance
11 Hale Road	0	0	0
13 Hale Road	1	0	1
15 Hale Road	0	0	0
17 Hale Road	1	0	1
Grand Total	**2**	**0**	**2**

Completed Development Scenario

Daylight and Sunlight

X.2 Full Details of the VSC, NSL and APSH assessments for the Proposed Development can be found within ES ***Volume 3, Appendix: Daylight, Sunlight, Overshadowing and Glare - Annex 2***. A summary of these can be found in Table 9.4 to Table 9.6 below.

Table 9.4 VSC in relation to BRE Guidance

Receptor (all residential use)	Total number of Windows	Total number of windows that achieve or exceed VSC levels suggested in the BRE Guidance	Total number of windows that achieve VSC levels below those suggested in the BRE Guidance			
			20% - 29.9% reduction	30% - 39.9% reduction	≥40% reduction	Total
11 Hale Road	7	0	0	1	6	7
13 Hale Road	7	1	1	0	5	6
15 Hale Road	7	0	0	1	6	7
17 Hale Road	8	1	1	0	6	7
Grand Total	**29**	**2**	**2**	**2**	**23**	**27**

Table 9.5 NSL in relation to BRE Guidance

Receptor (all residential use)	Total number of rooms	Total number of rooms that achieve or exceed NSC levels suggested in the BRE Guidance	Total number of rooms that achieve NSL levels below those suggested in the BRE Guidance			
			20% - 29.9% reduction	30% - 39.9% reduction	≥40% reduction	Total
11 Hale Road	4	1	0	0	3	3
13 Hale Road	4	0	1	0	3	4
15 Hale Road	5	1	0	0	4	4
17 Hale Road	4	0	0	1	3	4
Grand Total	**17**	**2**	**1**	**1**	**13**	**15**

Table 9.6 APSH in relation to the BRE Guidance

Receptor (all residential use)	Total Number of Main Living Rooms Facing the Site Within 90° of Due South	Total number of rooms that achieve or exceed both Annual and Winter APSH levels suggested in the BRE Guidance	Total number of rooms that achieve Annual APSH levels below those suggested in the BRE Guidance				Total number of rooms that achieve Winter APSH levels below those suggested in the BRE Guidance			
			20% - 29.9% reduction	30% - 39.9% reduction	≥40% reduction	Total	20% - 29.9% reduction	30% - 39.9% reduction	≥40% reduction	Total
11 Hale Road	0	0	0	0	0	0	0	0	0	0
13 Hale Road	1	1	0	0	0	0	0	0	0	0
15 Hale Road	0	0	0	0	0	0	0	0	0	0
17 Hale Road	1	1	0	0	0	0	0	0	0	0
Totals	**2**	**2**	0	0	0	0	0	0	0	0

11, 13, 15 and 17 Hale Road

X.3 These two-storey terrace houses are located directly to the south of the Proposed Development, with a clear view over the undeveloped site from the northern elevation of the property. These properties are currently unoccupied and boarded up. As per the methodology stated paragraph 88.3 of the main chapter, it is not considered appropriate to discuss the impact on these properties in the main body of this assessment. Notwithstanding this, full details of the assessment to these properties is provided within Annex 3.

11 Hale Road

X.4 This two-storey terrace house is located directly to the south of the Proposed Development, with a clear view over the undeveloped site from the northern elevation of the property.

Daylight

X.5 The results of the VSC assessment show that with the Proposed Development in place, none (0%) of 7 windows would not see a noticeable reduction and therefore are in line with the BRE Guidance. Of the remaining deviating windows, 1 would experience a moderate adverse impact and 6 would experience a major adverse impact.

X.6 The results of the NSL assessment show that with the Proposed Development in place, one (25%) of the four rooms assessed would show full compliance with the BRE Guidance. Of the remaining rooms, all three would experience a Major Adverse reduction.

X.7 Based on the above, considering the VSC and NSL compliance, the effect on this property is considered to be local, long-term, direct, and Major Adverse **(Significant).**

Sunlight

X.8 As set out in Table 9.8 the results of the APSH there are no main living rooms deemed relevant for assessment within this property and therefore is fully compliant with the BRE Guidance. As such, the impacts to sunlight at this property results in a direct, local, permanent, long-term, Negligible (**Not Significant**) effect.

13 Hale Road

X.9 This two-storey terrace house is located directly to the south of the Proposed Development, with a clear view over the undeveloped site from the northern elevation of the property.

Daylight

X.10 The results of the VSC assessment show that with the Proposed Development in place, 1 (14%) of 7 windows would not see a noticeable reduction and therefore are in line with the BRE Guidance. Of the remaining deviating windows, 1 would experience a minor impact and 5 would experience a major adverse impact.

X.11 The results of the NSL assessment show that with the Proposed Development in place, all four of the rooms assessed would experience deviations from the BRE Guidance. Of these deviating rooms, one would experience a Minor Adverse Reduction, and the remaining three a Major Adverse Reduction.

X.12 Based on the above, considering the VSC and NSL compliance, the effect on this property is considered to be local, long-term, direct, and Major Adverse **(Significant).**

Sunlight

X.13 As set out in Table 9.8 the results of the APSH for this property are fully compliant with the BRE Guidance and as such, result in a direct, local, permanent, long-term, Negligible (**Not Significant**) effect.

15 Hale Road

X.14 This two-storey terrace house is located directly to the south of the Proposed Development, with a clear view over the undeveloped site from the northern elevation of the property.

Daylight

X.15 The results of the VSC assessment show that with the Proposed Development in place, 0 (0%) of 7 windows would not see a noticeable reduction and therefore are in line with the BRE Guidance. Of the remaining deviating windows, 1 would experience a moderate adverse impact and 6 would experience a major adverse impact.

X.16 The results of the NSL assessment show that with the Proposed Development in place, one (20%) of the five rooms assessed would show full compliance with the BRE Guidance. Of the remaining rooms, all four would experience a Major Adverse reduction.

X.17 Based on the above, considering the VSC and NSL compliance, the effect on this property is considered to be local, long-term, direct, and Major Adverse **(Significant).**

Sunlight

X.18 As set out in Table 9.8 the results of the APSH there are no main living rooms deemed relevant for assessment within this property and therefore is fully compliant with the BRE Guidance. As such, the impacts to sunlight at this property results in a direct, local, permanent, long-term, Negligible (**Not Significant**) effect.

17 Hale Road

X.19 This two-storey terrace house is located directly to the south of the Proposed Development, with a clear view over the undeveloped site from the northern elevation of the property.

Daylight

X.20 The results of the VSC assessment show that with the Proposed Development in place, 1 (13%) of 8 windows would not see a noticeable reduction and therefore are in line with the BRE Guidance. Of the remaining deviating windows, 1 would experience a minor impact and 6 would experience a major adverse impact.

X.21 The results of the NSL assessment show that with the Proposed Development in place, all four of the rooms assessed would experience deviations from the BRE Guidance. Of these deviating rooms, one would experience a Moderate Adverse Reduction, and the remaining three a Major Adverse Reduction.

X.22 Based on the above, considering the VSC and NSL compliance, the effect on this property is considered to be local, long-term, direct, and Major Adverse **(Significant).**

Secondary Assessments

X.23 As noted above, as the Site is subject to two extant permissions, an additional assessment has been undertaken as per the BRE, drawing comparison to between the retained levels with the Proposed Development in place, to the retained levels with both consented extant permissions in place. Full details of this assessment can be found in Annex 5.

X.24 With the previously consented massing in place, this receptor also experienced each window retaining VSC levels below 15%. Each impacted window within this property would see an absolute VSC shift of 3.1% or less compared to the consented levels, which is within the range considered to be *"virtually imperceptible"* within the Buckle Street Appeal Decision (APP/E5900/W/17/3191757). As such the VSC levels with Proposed Development in place are in line with those that would occur with both consented schemes in place.

Sunlight

X.25 As set out in Table 9.8 the results of the APSH for this property are fully compliant with the BRE Guidance and as such, result in a direct, local, permanent, long-term, Negligible (**Not Significant**) effect.

Cumulative Effects Assessment

Daylight and Sunlight

X.26 Full details of the VSC, NSL, APSH assessments for the Cumulative Assessments can be found within ES Volume 3, Appendix: Daylight, Sunlight, Overshadowing and Glare - Annex 3. A summary of these can be found in Table 9.7 to Table 9.9 below.

Table 9.7 Cumulative Scenario Tier 1 – VSC in relation to BRE Guidance

Receptor (all residential use)	Total number of Windows	Total number of windows that achieve or exceed VSC levels suggested in the BRE Guidance	Total number of windows that achieve VSC levels below those suggested in the BRE Guidance			
			20% - 29.9% reduction	30% - 39.9% reduction	≥40% reduction	Total
11 Hale Road	7	0	0	1	6	7
13 Hale Road	7	0	2	0	5	7
15 Hale Road	7	0	0	0	7	7
17 Hale Road	8	0	2	0	6	8
Grand Totals	29	0	4	1	24	29

Table 9.8 Cumulative Scenario Tier 1 – NSL in relation to BRE Guidance

Receptor (all residential use)	Total number of rooms	Total number of rooms that achieve or exceed NSC levels suggested in the BRE Guidance	Total number of rooms that achieve NSL levels below those suggested in the BRE Guidance			
			20% - 29.9% reduction	30% - 39.9% reduction	≥40% reduction	Total
11 Hale Road	4	1	0	0	3	3
13 Hale Road	4	0	1	0	3	4
15 Hale Road	5	1	0	0	4	4
17 Hale Road	4	0	0	1	3	4
Grand Total	**17**	**2**	**1**	**1**	**13**	**15**

Table 9.9 Cumulative Scenario Tier 1 – APSH in relation to BRE Guidance

Receptor (all residential use)	Total Number of Main Living Rooms Facing the Site Within 90° of Due South	Total number of rooms that achieve or exceed both Annual and Winter APSH levels suggested in the BRE Guidance	Total number of rooms that achieve Annual APSH levels below those suggested in the BRE Guidance				Total number of rooms that achieve Winter APSH levels below those suggested in the BRE Guidance			
			20% - 29.9% reduction	30% - 39.9% reduction	≥40% reduction	Total	20% - 29.9% reduction	30% - 39.9% reduction	≥40% reduction	Total
11 Hale Road	0	0	0	0	0	0	0	0	0	0
13 Hale Road	1	2	0	0	0	0	0	0	0	0
15 Hale Road	0	0	0	0	0	0	0	0	0	0
17 Hale Road	1	1	0	0	0	0	0	0	0	0
Grand Totals	**2**	**3**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**

11 Hale Road

X.27 As described in the Completed Development Scenario, this residential property is located to the south of the Proposed Development with no direct view of the Cumulative schemes from the site facing elevation.

Daylight

X.28 The results of the VSC assessment show that with the Tier 1 Cumulative Scenario, 0 (0%) of the seven windows would not see a noticeable reduction. Of the deviating windows, one would experience a moderate adverse impact, and six a major adverse impact. This does not present any additional impact compared to the Completed Development Scenario.

X.29 The results of the NSL assessment show that within the Tier 1 Cumulative Scenario, one (25%) of the four rooms assessed would experience deviations from the BRE Guidance. Of these deviating rooms, all three would experience a Major Adverse Reduction. This does not present any additional impact compared to the Completed Development Scenario.

X.30 Therefore, based on the non-material change between the Cumulative Scenarios and the Completed Development Scenario, the effect on daylight within this property is considered to be in line with what was identified within the Completed Development Scenario, to be local, direct, permanent, long term and Major Adverse (**Significant**).

Sunlight

X.31 As set out in paragraph 316.3 the results of the APSH for this property are fully compliant with the BRE Guidance and as such, result in a local, direct, permanent, long-term and Negligible (**Not Significant**) effect.

13 Hale Road

X.32 As described in the Completed Development Scenario, this residential property is located to the south of the Proposed Development with no direct view of the Cumulative schemes from the site facing elevation.

Daylight

X.33 The results of the VSC assessment show that with the Tier 1 Cumulative Scenario, 0 (0%) of the seven windows would not see a noticeable reduction. Of the deviating windows, one would experience a moderate adverse impact, and six a major adverse impact. This does not present any additional impact compared to the Completed Development Scenario.

X.34 The results of the NSL assessment show that within the Tier 1 Cumulative Scenario, all four rooms assessed would experience a deviation from the BRE Guidance. Of these deviating rooms, all four would experience a Major Adverse Reduction. This does not present any additional impact compared to the Completed Development Scenario.

X.35 Therefore, based on the non-material change between the Cumulative Scenarios and the Completed Development Scenario, the effect on daylight within this property is considered to be in line with what was identified within the Completed Development Scenario, to be local, direct, permanent, long term and Major Adverse (**Significant**).

Sunlight

X.36 As set out in paragraph 316.3 the results of the APSH for this property are fully compliant with the BRE Guidance and as such, result in a local, direct, permanent, long-term and Negligible (**Not Significant**) effect.

15 Hale Road

X.37 As described in the Completed Development Scenario, this residential property is located to the south of the Proposed Development with no direct view of the Cumulative schemes from the site facing elevation.

Daylight

X.38 The results of the VSC assessment show that within the Tier 1 Cumulative Scenario, all seven windows would see a noticeable reduction. Each of the deviating windows would experience a major adverse impact. This does not present any additional impact compared to the Completed Development Scenario.

X.39 The results of the NSL assessment show that within the Tier 1 Cumulative Scenario, one (20%) of the five rooms assessed would show full compliance with the BRE Guidance. Of the remaining rooms, all four would experience a Major Adverse reduction. This does not present any additional impact compared to the Completed Development Scenario.

X.40 Therefore, based on the non-material change between the Cumulative Scenarios and the Completed Development Scenario, the effect on daylight within this property is considered to be in line with what was identified within the Completed Development Scenario, to be local, direct, permanent, long term and Major Adverse (**Significant**).

Sunlight

X.41 As set out in paragraph 316.3 the results of the APSH for this property are fully compliant with the BRE Guidance and as such, result in a local, direct, permanent, long-term and Negligible (**Not Significant**) effect.

17 Hale Road

X.42 As described in the Completed Development Scenario, this residential property is located to the south of the Proposed Development with no direct view of the Cumulative schemes from the site facing elevation.

Daylight

X.43 The results of the VSC assessment show that with the Proposed Development in place, 1 (13%) of 8 windows would not see a noticeable reduction and therefore are in line with the BRE Guidance. Of the remaining deviating windows, 1 would experience a minor impact and 6 would experience a major adverse impact.

X.44 The results of the NSL assessment show that within the Tier 1 Cumulative Scenario, one (20%) of the five rooms assessed would experience deviations from the BRE Guidance. Of these deviating rooms, one would experience a minor adverse reduction and three would experience a Major Adverse Reduction. This does not present any additional impact compared to the Completed Development Scenario.

X.45 Therefore, based on the non-material change between the Cumulative Scenarios and the Completed Development Scenario, the effect on daylight within this property is considered to be in line with what was identified within the Completed Development Scenario, to be local, direct, permanent, long term and Major Adverse (**Significant**).

Sunlight

X.46 As set out in paragraph 316.3 the results of the APSH for this property are fully compliant with the BRE Guidance and as such, result in a local, direct, permanent, long-term and Negligible (**Not Significant**) effect.