

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Twenty-First R2	W3-L W3-U W4-L W4-U	Bedroom	34.8	33.6	1.2	3.4%	10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			35.9	34.7	1.2	3.3%														
Twenty-First R3	W5-L W5-U W6-L W6-U	Bedroom	34.7	33.5	1.3	3.6%	10.0	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			35.7	34.4	1.3	3.6%														
Twenty-First R4	W7-L W7-U W8-L W8-U	Bedroom	34.8	33.4	1.3	3.8%	10.1	10.0	99%	10.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			35.9	34.6	1.4	3.8%														
Twenty-First R5	W9-L W9-U W10-L W10-U	Studio	34.8	33.3	1.4	4.1%	14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			36.0	34.5	1.5	4.0%														
Twenty-First R6	W11-L W11-U W12-L W12-U	Studio	35.4	33.9	1.5	4.3%	14.1	13.6	97%	13.6	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			36.4	34.8	1.5	4.2%														
Twenty-First R7	W13-L W13-U W14-L W14-U	Studio	35.4	33.8	1.6	4.5%	14.7	13.8	94%	13.8	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			36.4	34.8	1.6	4.4%														
Twenty-First R8	W15-L W15-U W16-L W16-U	Studio	35.8	34.7	1.1	3.0%	14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			36.8	35.8	1.0	2.8%														
Twenty-First R9	W17-L W17-U W18-L W18-U	Studio	35.8	34.9	0.9	2.6%	14.2	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			36.9	36.0	0.9	2.4%														
Twenty-First R10	W19-L W19-U W20-L W20-U	Studio	35.9	35.0	0.9	2.4%	14.2	14.1	99%	14.1	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			37.0	36.2	0.8	2.1%														
Twenty-First R11	W21-L W21-U W22-L W22-U W23-L W23-U W24-L W24-U	Studio	36.2	35.5	0.7	2.0%	16.8	16.2	97%	16.2	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			37.0	36.3	0.7	1.8%														
			36.1	35.4	0.6	1.8%														
			37.1	36.5	0.6	1.6%														
Twenty-Secc R1	W1-L W1-U W2-L	Kitchen	34.8	34.8	0.0	0.0%														
			38.4	37.6	0.8	2.0%														

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Eighth	R14	W25-U	LKD					13.7	10.3	75%	10.3	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W26-L		5.4	5.4	0.0	0.0%													
		W26-U																		
		W27-L		28.6	28.6	0.0	0.0%													
Eighth	R15	W27-U	Bedroom					27.9	18.6	67%	18.6	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W28-L		29.1	29.1	0.0	0.0%													
		W28-U						14.5	11.2	77%	11.2	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R16	W29-L	LKD	29.3	29.3	0.0	0.0%													
		W29-U		0.6	0.6	0.0	0.0%													
		W30-L																		
		W30-U		0.6	0.6	0.0	0.0%													
Eighth	R17	W31-L	Bedroom	4.5	4.5	0.0	0.0%													
		W31-U						29.8	28.6	96%	28.6	96%	0.0	0.0%	20	2	20	2	0.0%	0.0%
		W32-L		1.5	1.5	0.0	0.0%													
		W32-U						12.4	8.2	66%	8.2	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R18	W33-L	LKD	31.7	31.7	0.0	0.0%													
		W33-U																		
		W34-L		33.0	33.0	0.0	0.0%													
		W34-U																		
Eighth	R19	W35-L	Bedroom	6.6	6.6	0.0	0.0%													
		W35-U						31.1	28.2	91%	28.2	91%	0.0	0.0%	32	8	32	8	0.0%	0.0%
		W36-L		3.4	3.4	0.0	0.0%													
		W36-U																		
Ninth	R1	W37-L	LKD	37.6	37.6	0.0	0.0%													
		W37-U						12.9	12.9	100%	12.9	100%	0.0	0.0%	72	22	72	22	0.0%	0.0%
		W1-L		36.3	36.3	0.0	0.0%													
		W1-U																		
Ninth	R2	W2-L	Bedroom	35.5	35.5	0.0	0.0%													
		W2-U																		
		W3-L		2.6	2.6	0.0	0.0%													
		W3-U						32.1	28.8	90%	28.8	90%	0.0	0.0%	68	19	68	19	0.0%	0.0%
Ninth	R3	W4-L	Bedroom	2.1	2.1	0.0	0.0%													
		W4-U																		
		W5-L		25.9	25.3	0.6	2.3%													
		W5-U						12.8	12.6	98%	12.6	98%	0.0	0.0%	50	13	48	13	4.0%	0.0%
Ninth	R4	W6-L	Bedroom	26.1	25.5	0.7	2.5%													
		W6-U						13.4	13.0	97%	13.0	97%	0.0	0.0%	50	11	48	11	4.0%	0.0%
Ninth	R5	W7-L	Bedroom	26.5	25.8	0.7	2.7%													
		W7-U						14.2	13.3	94%	13.3	94%	0.0	0.0%	49	11	48	11	2.0%	0.0%
Ninth	R5	W8-L	LKD	27.2	26.5	0.8	2.8%													
		W8-U																		
		W9-L		3.1	3.1	0.0	0.0%													
		W9-U																		
Ninth	R5	W10-L	Bedroom	3.7	2.9	0.8	20.9%													
		W10-U						29.7	28.1	95%	28.1	94%	0.1	0.3%	53	13	52	13	1.9%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				Room Area	No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss		Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m ²	%	m ²	%	m ²	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Four R3	W6-L W6-U W7-L W7-U		Residential	38.0	38.0	0.0	0.0%	17.9	11.7	65%	11.7	65%	0.0	0.0%	70	24	70	24	0.0%	0.0%
				37.9	37.9	0.0	0.0%													
Twenty-Four R4	W8-L W8-U W9-L W9-U W10-L W10-U W11-L W11-U W12-L W12-U		Studio	35.0	35.0	0.0	0.0%	36.7	36.2	99%	36.2	99%	0.0	0.0%	74	25	74	25	0.0%	0.0%
				35.9	35.9	0.0	0.0%													
				8.8	8.8	0.0	0.0%													
				3.0	3.0	0.0	0.0%													
				39.5	39.5	0.0	0.0%													
Twenty-Four R5	W13-L W13-U		Bedroom	39.5	39.5	0.0	0.0%	15.7	15.6	100%	15.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four R6	W14-L W14-U		Bedroom	39.5	39.5	0.0	0.0%	13.2	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four R7	W15-L W15-U W16-L W16-U		Bedroom	39.6	39.6	0.0	0.0%	14.4	14.4	100%	14.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
				3.4	3.4	0.0	0.0%													
Twenty-Four R8	W17-L W17-U W18-L W18-U W19-L W19-U		LKD	6.5	6.5	0.0	0.0%	37.7	34.2	91%	34.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
				39.5	39.5	0.0	0.0%													
				39.5	39.5	0.0	0.0%													
Twenty-Four R9	W20-L W20-U W21-L W21-U		Bedroom	15.8	15.8	0.0	0.0%	13.7	13.1	96%	13.1	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
				7.5	7.5	0.0	0.0%													
Twenty-Four R10	W22-L W22-U W23-L W23-U		LKD	6.3	6.3	0.0	0.0%	27.9	23.9	86%	23.9	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
				39.4	39.4	0.0	0.0%													
Twenty-Four R11	W24-L W24-U		Bedroom	39.2	39.2	0.0	0.0%	14.6	14.6	100%	14.6	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-Four R12	W25-L W25-U W26-L W26-U W27-L W27-U		LKD	38.7	38.7	0.0	0.0%	29.7	29.3	99%	29.3	99%	0.0	0.0%	20	2	20	2	0.0%	0.0%
				0.6	0.6	0.0	0.0%													
				4.8	4.8	0.0	0.0%													
Twenty-Four R13	W28-L W28-U		Bedroom	6.8	6.8	0.0	0.0%	12.4	12.2	98%	12.2	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings

**Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring
Properties**

Annex 3: Results of the Cumulative Daylight and Sunlight Assessments

Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments

Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments

Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments

Annex 7: Results of the Sunlight Amenity Assessments

Annex 8: Transient Shadow Images

Annex 9: Solar Glare Images

Annex 10: Policy and Legislation Review

Annex 11: Hale Road Properties



Annex 5

Results of the consented baseline daylight and
sunlight assessments

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Ferry Island Building 1																				
First	R1	W1-L W1-U	LKD	11.6	11.4	0.2	1.4%	34.9	18.9	54%	18.9	54%	0.0	0.0%	21	10	21	10	0.0%	0.0%
First	R2	W2	Bedroom	12.1	11.7	0.3	2.7%	13.5	6.6	49%	6.6	49%	0.0	0.0%	19	7	19	7	0.0%	0.0%
First	R3	W3	Residential	12.9	12.3	0.5	4.1%	19.7	11.7	60%	11.7	59%	0.0	0.3%	22	9	22	9	0.0%	0.0%
First	R4	W4 W5	Residential	16.8 18.4	15.7 17.6	1.0 0.8	6.2% 4.1%	18.4	13.1	71%	12.9	70%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W6 W7	Residential	18.4 20.2	18.0 20.1	0.4 0.1	2.2% 0.5%	14.1	13.6	96%	13.5	96%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W8	Residential	19.9	19.9	-0.1	-0.3%	17.0	13.3	79%	13.4	79%	0.0	-0.2%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W9	Bedroom	19.6	19.6	-0.1	-0.4%	15.1	12.2	81%	12.3	81%	-0.1	-0.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W10 W11	LKD	18.8 31.0	18.9 31.0	-0.1 0.0	-0.4% 0.0%	24.2	22.4	93%	22.4	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1-L W1-U	LKD	12.2	12.0	0.2	1.3%	34.9	18.9	54%	18.9	54%	0.0	0.0%	22	10	22	10	0.0%	0.0%
Second	R2	W2	Bedroom	12.7	12.4	0.3	2.7%	13.5	6.8	51%	6.8	51%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Second	R3	W3	Bedroom	13.5	13.0	0.5	3.9%	14.9	10.4	69%	10.4	69%	0.0	0.2%	23	9	23	9	0.0%	0.0%
Second	R4	W4	Bedroom	17.5	16.5	1.0	5.9%	10.9	4.7	43%	4.7	43%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W5 W6 W7	LKD	19.2 19.3 21.4	18.4 18.9 21.3	0.8 0.4 0.1	4.0% 2.1% 0.5%	41.8	37.3	89%	36.9	88%	0.4	1.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W8	Bedroom	21.2	21.3	-0.1	-0.3%	13.6	11.9	88%	11.9	88%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W9	Bedroom	21.0	21.0	-0.1	-0.3%	15.1	12.7	84%	12.7	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W10 W11	LKD	20.3 31.8	20.4 31.8	-0.1 0.0	-0.3% 0.0%	24.2	23.3	96%	23.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L W1-U	LKD	12.8	12.7	0.2	1.2%	34.9	18.8	54%	18.8	54%	0.0	0.0%	22	10	22	10	0.0%	0.0%
Third	R2	W2	Bedroom	13.5	13.2	0.3	2.4%	13.5	7.1	53%	7.1	53%	0.0	0.0%	21	7	21	7	0.0%	0.0%
Third	R3	W3	Bedroom	14.3	13.8	0.5	3.7%	14.9	10.7	72%	10.7	72%	0.0	0.1%	24	9	24	9	0.0%	0.0%
Third	R4	W4	Bedroom	18.4	17.3	1.0	5.7%	10.9	5.0	46%	5.0	46%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W5 W6 W7	LKD	20.0 20.1 22.6	19.2 19.7 22.5	0.8 0.4 0.1	3.9% 2.0% 0.5%	41.8	37.8	90%	37.3	89%	0.5	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W8	Bedroom	22.5	22.5	-0.1	-0.2%	13.6	12.0	88%	12.0	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)								Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction		
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter	
Sixth	R6	W8	Bedroom	25.7	25.7	0.0	0.0%	13.6	12.4	91%	12.4	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Sixth	R7	W9	Bedroom	25.7	25.7	0.0	0.0%	15.1	13.1	87%	13.1	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Sixth	R8	W10 W11	LKD	25.6	25.6	0.0	0.0%	24.2	23.8	98%	23.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
				34.6	34.6	0.0	0.0%														
Seventh	R7	W1-L W1-U	LKD	9.3	9.3	0.0	0.0%	36.5	18.2	50%	18.2	50%	0.0	0.0%	8	0	8	0	0.0%	0.0%	
Seventh	R8	W2-L W2-U	Bedroom	10.7	10.7	0.0	0.0%	11.7	6.6	57%	6.6	57%	0.0	0.0%	11	0	11	0	0.0%	0.0%	
Seventh	R9	W3-L W3-U	Bedroom	10.6	9.6	0.9	8.8%	15.1	4.8	32%	4.8	32%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Seventh	R10	W4-L	LKD	12.1	11.4	0.7	5.4%	35.8	31.2	87%	30.5	85%	0.7	2.3%	N/F	N/F	N/F	N/F	N/F	N/F	
		W4-U		14.0	13.5	0.5	3.3%														
		W5-L		15.1	14.9	0.1	0.9%														
		W5-U W6-L W6-U																			
Seventh	R11	W7-L W7-U	Bedroom	14.8	14.8	0.0	0.0%	10.3	7.5	73%	7.5	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Seventh	R12	W8-L W8-U	Bedroom	14.2	14.2	0.0	0.0%	10.9	9.7	89%	9.7	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Eighth	R7	W1-L W1-U	LKD	3.4	3.4	0.0	0.0%	36.5	16.6	45%	16.6	45%	0.0	0.0%	5	0	5	0	0.0%	0.0%	
Eighth	R8	W2-L W2-U	Bedroom	4.4	4.4	0.0	0.0%	11.7	5.8	50%	5.8	50%	0.0	0.1%	4	0	4	0	0.0%	0.0%	
Eighth	R9	W3-L W3-U	Bedroom	5.0	4.1	0.9	17.3%	15.1	4.3	29%	4.3	29%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Eighth	R10	W4-L	LKD	6.3	5.7	0.6	9.6%	35.8	30.3	85%	29.4	82%	0.9	3.1%	N/F	N/F	N/F	N/F	N/F	N/F	
		W4-U		6.8	6.4	0.4	6.2%														
		W5-L		6.7	6.6	0.1	1.8%														
		W5-U W6-L W6-U																			
Eighth	R11	W7-L W7-U	Bedroom	6.9	6.9	0.0	0.0%	10.3	6.8	65%	6.8	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Eighth	R12	W8-L W8-U	Bedroom	6.2	6.2	0.0	0.0%	10.9	8.9	81%	8.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Ninth	R1	W1-L W1-U	LKD	22.2	22.0	0.3	1.1%	38.5	22.6	59%	22.6	59%	0.0	0.0%	37	10	37	10	0.0%	0.0%	
Ninth	R2	W2-L W2-U	Bedroom	22.5	22.1	0.4	1.8%	11.4	9.9	87%	9.9	87%	0.0	0.0%	38	9	38	9	0.0%	0.0%	

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Tenth	R7	W10-U	LKD					15.1	13.9	92%	13.9	92%	0.0	0.0%	4	0	4	0	0.0%	0.0%
		W11-L		31.9	31.9	0.0	0.0%													
		W11-U																		
		W12-L		31.9	31.8	0.0	0.0%													
		W12-U																		
Tenth	R8	W13-L	Bedroom	11.7	11.7	0.0	0.0%	39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
		W14-L		2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		38.1	38.1	0.0	0.0%	12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R1	W15-U	LKD																	
		W1-L		28.3	28.1	0.2	0.8%	38.5	31.0	81%	31.0	81%	0.0	0.0%	48	15	48	15	0.0%	0.0%
		W1-U																		
		W2-L		27.7	27.4	0.3	1.2%	11.4	10.4	91%	10.4	91%	0.0	0.0%	45	14	45	14	0.0%	0.0%
		W2-U																		
Eleventh	R3	W3-L	LKD	27.3	26.9	0.4	1.3%													
		W3-U																		
		W4-L		26.9	26.1	0.8	3.0%	29.1	29.0	100%	29.0	100%	0.0	0.0%	45	15	45	15	0.0%	0.0%
		W4-U																		
		W5-L		28.1	27.4	0.7	2.5%	11.6	8.9	76%	8.9	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R5	W5-U	LKD																	
		W6-L		29.1	28.6	0.5	1.8%													
		W6-U																		
		W7-L		5.6	5.6	0.0	0.0%													
		W7-U																		
Eleventh	R6	W8-L	Bedroom	6.2	6.0	0.2	3.9%	28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W8-U																		
		W9-L		4.0	3.9	0.2	4.2%													
		W9-U																		
		W10-L		33.2	33.0	0.2	0.5%	15.1	14.0	93%	14.0	93%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Eleventh	R7	W10-U	LKD																	
		W11-L		33.3	33.1	0.1	0.5%													
		W11-U																		
		W12-L		33.3	33.1	0.2	0.5%													
		W12-U																		
Eleventh	R8	W13-L	Bedroom	11.8	11.8	0.0	0.0%	39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
		W14-L		2.6	2.6	0.0	0.0%													
		W14-U																		
		W15-L		38.5	38.5	0.0	0.0%	12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R1	W15-U	LKD																	
		W1-L		31.0	30.8	0.2	0.7%	38.5	31.3	81%	31.3	81%	0.0	0.0%	49	17	49	17	0.0%	0.0%
Twelfth	R2	W1-U	Bedroom																	
		W2-L		30.0	29.7	0.3	1.0%	11.4	10.4	92%	10.4	92%	0.0	0.0%	47	17	47	17	0.0%	0.0%
		W2-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																			
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction														
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter													
Fifteenth	R3	W3-L	LKD	32.7	32.4	0.2	0.7%	29.1	29.0	100%	29.0	100%	0.0	0.0%	48	18	48	18	0.0%	0.0%													
		W3-U		31.7	31.1	0.6	1.9%																										
		W4-L																															
W4-U																																	
Fifteenth	R4	W5-L	Bedroom	32.8	32.2	0.6	1.9%	11.6	9.1	78%	9.1	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W5-U																															
Fifteenth	R5	W6-L	LKD	33.9	33.3	0.6	1.9%	28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W6-U		7.2	7.2	0.0	0.0%																										
		W7-L																															
		W7-U																															
		W8-L		8.5	8.0	0.5	6.0%																										
W8-U																																	
Fifteenth	R6	W9-L	Bedroom	4.7	4.4	0.3	6.4%	15.1	14.3	94%	14.3	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%													
		W9-U		37.4	36.8	0.5	1.5%																										
		W10-L																															
		W10-U																															
Fifteenth	R7	W11-L	LKD	37.4	36.9	0.5	1.4%	39.2	38.4	98%	38.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W11-U		37.4	36.9	0.5	1.3%																										
		W12-L																															
		W12-U																															
		W13-L		12.1	12.1	0.0	0.0%																										
W13-U																																	
Fifteenth	R8	W14-L	Bedroom	2.7	2.7	0.0	0.0%	12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W14-U		39.2	39.2	0.0	0.0%																										
		W15-L																															
		W15-U																															
Sixteenth	R1	W1-L	LKD	35.6	35.5	0.1	0.3%	38.5	31.3	81%	31.3	81%	0.0	0.0%	54	20	54	20	0.0%	0.0%													
W1-U																																	
Sixteenth	R2	W2-L	Bedroom	34.7	34.5	0.2	0.5%	11.4	11.0	97%	11.0	97%	0.0	0.0%	50	19	50	19	0.0%	0.0%													
		W2-U																															
Sixteenth	R3	W3-L	LKD	33.7	33.5	0.2	0.6%	29.1	29.0	100%	29.0	100%	0.0	0.0%	48	18	48	18	0.0%	0.0%													
		W3-U		32.9	32.4	0.5	1.6%																										
		W4-L																															
		W4-U																															
Sixteenth	R4	W5-L	Bedroom	33.9	33.4	0.5	1.5%	11.6	9.4	81%	9.4	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W5-U																															
Sixteenth	R5	W6-L	LKD	34.9	34.3	0.5	1.5%	28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W6-U		7.5	7.5	0.0	0.0%																										
		W7-L																															
		W7-U																															
		W8-L		8.7	8.2	0.4	5.1%																										
W8-U																																	
Sixteenth	R6	W9-L	Bedroom	4.7	4.4	0.3	5.3%																										
		W9-U		37.9	37.4	0.5	1.2%																										
		W10-L																															

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Sixteenth	R7	W10-U	LKD					15.1	14.3	94%	14.3	94%	0.0	0.0%	9	0	9	0	0.0%	0.0%
		W11-L		38.0	37.5	0.4	1.2%													
		W11-U																		
		W12-L		38.0	37.6	0.4	1.1%													
		W12-U																		
Sixteenth	R8	W13-L		12.1	12.1	0.0	0.0%													
		W13-U						39.2	38.5	98%	38.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.3	39.3	0.0	0.0%													
Seventeenth	R1	W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-L	LKD	36.4	36.3	0.1	0.3%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	52	18	52	18	0.0%	0.0%
		W2-L	Bedroom	35.7	35.5	0.1	0.4%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	52	18	52	18	0.0%	0.0%
Seventeenth	R3	W3-L	LKD	34.9	34.8	0.2	0.5%													
		W3-U																		
		W4-L		34.2	33.8	0.4	1.2%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	47	17	47	17	0.0%	0.0%
		W5-L	Bedroom	35.1	34.7	0.4	1.2%													
Seventeenth	R4	W5-U						11.6	10.0	86%	10.0	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-L	LKD	35.9	35.5	0.4	1.2%													
		W6-U																		
		W7-L		7.8	7.8	0.0	0.0%													
		W7-U																		
Seventeenth	R5	W8-L		8.8	8.5	0.4	4.0%													
		W8-U						28.7	28.0	98%	28.0	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L	Bedroom	4.7	4.5	0.2	4.3%													
		W9-U																		
		W10-L		38.4	38.0	0.4	1.0%													
Seventeenth	R6	W10-U						15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%
		W11-L	LKD	38.4	38.1	0.4	0.9%													
		W11-U																		
		W12-L		38.5	38.2	0.3	0.9%													
		W12-U																		
Seventeenth	R7	W13-L		12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.3	39.3	0.0	0.0%													
Seventeenth	R8	W15-U						12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-L	LKD	37.0	37.0	0.1	0.2%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	51	17	51	17	0.0%	0.0%
		W2-L	Bedroom	36.5	36.4	0.1	0.3%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	50	17	50	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Nineteenth	R7	W10-U	LKD					15.1	14.3	94%	14.3	94%	0.0	0.0%	12	0	12	0	0.0%	0.0%
		W11-L		39.3	39.1	0.2	0.5%													
		W11-U																		
		W12-L		39.4	39.2	0.2	0.5%													
		W12-U																		
Nineteenth	R8	W13-L	Bedroom	12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-L		2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
Twentieth	R1	W15-U	LKD					12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-L		39.2	39.1	0.0	0.1%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
		W2-L		39.1	39.1	0.1	0.1%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%
Twentieth	R3	W3-L	LKD	39.0	39.0	0.1	0.1%													
		W3-U																		
		W4-L		39.0	38.9	0.1	0.4%													
		W4-U						29.1	29.0	100%	29.0	100%	0.0	0.0%	56	20	56	20	0.0%	0.0%
		W5-L		39.1	38.9	0.1	0.4%													
Twentieth	R4	W5-U	Bedroom					11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-L		39.2	39.0	0.1	0.4%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
Twentieth	R5	W8-L	LKD	9.0	8.8	0.1	1.4%													
		W8-U						28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L		4.7	4.6	0.1	1.5%													
		W9-U																		
		W10-L		39.4	39.3	0.1	0.3%													
Twentieth	R6	W10-U	Bedroom					15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
		W11-L		39.4	39.3	0.1	0.3%													
		W11-U																		
		W12-L		39.4	39.3	0.1	0.3%													
		W12-U																		
Twentieth	R7	W13-L	LKD	12.2	12.2	0.0	0.0%													
		W13-U						39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-L		2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.5	39.5	0.0	0.0%													
Twenty-First	R1	W15-U	LKD					12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-L		39.4	39.4	0.0	0.1%													
		W1-U						38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%
		W2-L		39.5	39.4	0.0	0.1%													
		W2-U						11.4	11.0	97%	11.0	97%	0.0	0.0%	56	20	56	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Secc R7	W10-U					15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%		
	W11-L	LKD	39.4	39.4	0.0	0.0%														
	W11-U		39.4	39.4	0.0	0.0%														
	W12-L		39.4	39.4	0.0	0.0%														
	W12-U		12.2	12.2	0.0	0.0%														
Twenty-Secc R8	W13-L		12.2	12.2	0.0	0.0%	39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
	W13-U																			
	W14-L	Bedroom	2.7	2.7	0.0	0.0%														
	W14-U		39.4	39.4	0.0	0.0%														
	W15-L					12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F		
Twenty-Thir R1	W15-U																			
	W1-L	LKD	39.4	39.4	0.0	0.0%														
Twenty-Thir R2	W1-U					38.5	31.3	81%	31.3	81%	0.0	0.0%	54	18	54	18	0.0%	0.0%		
	W2-L	Bedroom	39.4	39.4	0.0	0.0%														
Twenty-Thir R3	W2-U					11.4	11.0	97%	11.0	97%	0.0	0.0%	54	18	54	18	0.0%	0.0%		
	W3-L	LKD	39.4	39.4	0.0	0.0%														
Twenty-Thir R4	W3-U																			
	W4-L		39.4	39.4	0.0	0.0%														
	W4-U					29.1	29.0	100%	29.0	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%		
	W5-L	Bedroom	39.4	39.4	0.0	0.0%														
Twenty-Thir R5	W5-U					11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F		
	W6-L	LKD	39.4	39.4	0.0	0.0%														
Twenty-Thir R6	W6-U																			
	W7-L		8.2	8.2	0.0	0.0%														
	W7-U																			
	W8-L		9.0	9.0	0.0	0.0%														
	W8-U					28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F		
Twenty-Thir R7	W9-L	Bedroom	4.7	4.7	0.0	0.0%														
	W9-U																			
	W10-L		39.4	39.4	0.0	0.0%														
	W10-U					15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%		
Twenty-Thir R8	W11-L	LKD	39.4	39.4	0.0	0.0%														
	W11-U																			
	W12-L		39.4	39.4	0.0	0.0%														
	W12-U		12.2	12.2	0.0	0.0%														
	W13-L					39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F		
Twenty-Thir R9	W13-U																			
	W14-L	Bedroom	2.7	2.7	0.0	0.0%														
	W14-U																			
	W15-L		39.4	39.4	0.0	0.0%														
Twenty-Four R1	W15-U					12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F		
	W1-L	LKD	39.0	39.0	0.0	0.0%														
Twenty-Four R2	W1-U					38.5	31.3	81%	31.3	81%	0.0	0.0%	52	17	52	17	0.0%	0.0%		
	W2-L	Bedroom	39.1	39.1	0.0	0.0%														
	W2-U					11.4	11.0	97%	11.0	97%	0.0	0.0%	52	17	52	17	0.0%	0.0%		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Twenty-Four R3	W3-L W3-U W4-L W4-U	LKD	39.1	39.1	0.0	0.0%	29.1	29.0	100%	29.0	100%	0.0	0.0%	52	17	52	17	0.0%	0.0%	
			39.1	39.1	0.0	0.0%														
Twenty-Four R4	W5-L W5-U	Bedroom	39.1	39.1	0.0	0.0%	11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Twenty-Four R5	W6-L W6-U W7-L W7-U W8-L W8-U	LKD	39.1	39.1	0.0	0.0%	28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			7.6	7.6	0.0	0.0%														
			8.4	8.4	0.0	0.0%														
Twenty-Four R6	W9-L W9-U W10-L W10-U	Bedroom	4.4	4.4	0.0	0.0%	15.1	14.3	94%	14.3	94%	0.0	0.0%	10	0	10	0	0.0%	0.0%	
			39.1	39.1	0.0	0.0%														
Twenty-Four R7	W11-L W11-U W12-L W12-U W13-L W13-U	LKD	39.0	39.0	0.0	0.0%	39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			39.1	39.1	0.0	0.0%														
			11.5	11.5	0.0	0.0%														
Twenty-Four R8	W14-L W14-U W15-L W15-U	Bedroom	2.6	2.6	0.0	0.0%	12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			39.0	39.0	0.0	0.0%														
Twenty-Fifth R1	W1-L W1-U	LKD	39.5	39.5	0.0	0.0%	38.5	31.3	81%	31.3	81%	0.0	0.0%	57	20	57	20	0.0%	0.0%	
Twenty-Fifth R2	W2-L W2-U	Bedroom	39.5	39.5	0.0	0.0%	11.4	11.0	97%	11.0	97%	0.0	0.0%	57	20	57	20	0.0%	0.0%	
Twenty-Fifth R3	W3-L W3-U W4-L W4-U	LKD	39.5	39.5	0.0	0.0%	29.1	29.0	100%	29.0	100%	0.0	0.0%	57	20	57	20	0.0%	0.0%	
			39.5	39.5	0.0	0.0%														
Twenty-Fifth R4	W5-L W5-U	Bedroom	39.5	39.5	0.0	0.0%	11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Twenty-Fifth R5	W6-L W6-U W7-L W7-U W8-L W8-U	LKD	39.5	39.5	0.0	0.0%	28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			8.2	8.2	0.0	0.0%														
			9.0	9.0	0.0	0.0%														
Twenty-Fifth R6	W9-L W9-U W10-L	Bedroom	4.7	4.7	0.0	0.0%														
			39.5	39.5	0.0	0.0%														

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Twenty-Seve R3	W3-L W3-U W4-L W4-U	LKD	39.4	39.4	0.0	0.0%	29.1	29.0	100%	29.0	100%	0.0	0.0%	55	19	55	19	0.0%	0.0%	
			39.5	39.5	0.0	0.0%														
Twenty-Seve R4	W5-L W5-U	Bedroom	39.5	39.5	0.0	0.0%	11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Twenty-Seve R5	W6-L W6-U W7-L W7-U W8-L W8-U	LKD	39.5	39.5	0.0	0.0%	28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			8.2	8.2	0.0	0.0%														
			9.0	9.0	0.0	0.0%														
Twenty-Seve R6	W9-L W9-U W10-L W10-U	Bedroom	4.7	4.7	0.0	0.0%	15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%	
			39.5	39.5	0.0	0.0%														
Twenty-Seve R7	W11-L W11-U W12-L W12-U W13-L W13-U	LKD	39.5	39.5	0.0	0.0%	39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			39.5	39.5	0.0	0.0%														
			12.2	12.2	0.0	0.0%														
Twenty-Seve R8	W14-L W14-U W15-L W15-U	Bedroom	2.7	2.7	0.0	0.0%	12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			39.4	39.4	0.0	0.0%														
Twenty-Eigh R1	W1-L W1-U	LKD	39.4	39.4	0.0	0.0%	38.5	31.3	81%	31.3	81%	0.0	0.0%	56	20	56	20	0.0%	0.0%	
Twenty-Eigh R2	W2-L W2-U	Bedroom	39.4	39.4	0.0	0.0%	11.4	11.0	97%	11.0	97%	0.0	0.0%	55	19	55	19	0.0%	0.0%	
Twenty-Eigh R3	W3-L W3-U W4-L W4-U	LKD	39.4	39.4	0.0	0.0%	29.1	29.0	100%	29.0	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%	
			39.5	39.5	0.0	0.0%														
Twenty-Eigh R4	W5-L W5-U	Bedroom	39.5	39.5	0.0	0.0%	11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Twenty-Eigh R5	W6-L W6-U W7-L W7-U W8-L W8-U	LKD	39.5	39.5	0.0	0.0%	28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
			8.2	8.2	0.0	0.0%														
			9.0	9.0	0.0	0.0%														
Twenty-Eigh R6	W9-L W9-U W10-L	Bedroom	4.7	4.7	0.0	0.0%														
			39.4	39.4	0.0	0.0%														

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Twenty-Eigh R7		W10-U						15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
		W11-L	LKD	39.4	39.4	0.0	0.0%													
		W11-U		39.4	39.4	0.0	0.0%													
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U		12.2	12.2	0.0	0.0%													
Twenty-Eigh R8		W13-L		12.2	12.2	0.0	0.0%	39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
		W14-L	Bedroom	2.7	2.7	0.0	0.0%													
		W14-U		39.4	39.4	0.0	0.0%													
		W15-L		39.4	39.4	0.0	0.0%	12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
W15-U																				
Twenty-Nint R1		W1-L	LKD	39.4	39.4	0.0	0.0%													
	W1-U		38.5	31.3	81%	31.3	81%	0.0	0.0%	54	18	54	18	0.0%	0.0%					
Twenty-Nint R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%														
	W2-U		11.4	11.0	97%	11.0	97%	0.0	0.0%	54	18	54	18	0.0%	0.0%					
Twenty-Nint R3	W3-L	LKD	39.4	39.4	0.0	0.0%														
	W3-U		39.4	39.4	0.0	0.0%														
	W4-L		39.4	39.4	0.0	0.0%														
	W4-U		29.1	29.0	100%	29.0	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%					
Twenty-Nint R4	W5-L	Bedroom	39.4	39.4	0.0	0.0%														
	W5-U		11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	N/F	N/F			
Twenty-Nint R5	W6-L	LKD	39.4	39.4	0.0	0.0%														
	W6-U		8.2	8.2	0.0	0.0%														
	W7-L		9.0	9.0	0.0	0.0%														
	W7-U																			
	W8-L		28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	N/F	N/F			
Twenty-Nint R6	W8-U																			
	W9-L	Bedroom	4.7	4.7	0.0	0.0%														
	W9-U		39.4	39.4	0.0	0.0%														
	W10-L		39.4	39.4	0.0	0.0%														
Twenty-Nint R7	W10-U		15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%					
	W11-L	LKD	39.4	39.4	0.0	0.0%														
	W11-U		39.4	39.4	0.0	0.0%														
	W12-L		39.4	39.4	0.0	0.0%														
	W12-U		12.2	12.2	0.0	0.0%														
Twenty-Nint R8	W13-L		39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	N/F	N/F			
	W13-U																			
	W14-L	Bedroom	2.7	2.7	0.0	0.0%														
	W14-U		39.4	39.4	0.0	0.0%														
	W15-L		12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	N/F	N/F			
Thirtieth	R1	W15-U																		
		W1-L	LKD	39.0	39.0	0.0	0.0%													
		W1-U		38.5	31.3	81%	31.3	81%	0.0	0.0%	52	17	52	17	0.0%	0.0%				
		Thirtieth	R2	W2-L	Bedroom	39.1	39.1	0.0	0.0%											
W2-U				11.4	11.0	97%	11.0	97%	0.0	0.0%	52	17	52	17	0.0%	0.0%				

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Thirty-Fourth	R7	W10-U	LKD					15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
		W11-L		39.5	39.5	0.0	0.0%													
		W11-U																		
		W12-L		39.5	39.5	0.0	0.0%													
		W12-U																		
Thirty-Fourth	R8	W13-L	Bedroom	12.2	12.2	0.0	0.0%	39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
		W14-L		2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%	12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R1	W1-L	LKD	39.4	39.4	0.0	0.0%	38.5	31.3	81%	31.3	81%	0.0	0.0%	56	20	56	20	0.0%	0.0%
		W1-U																		
Thirty-Fifth	R2	W2-L	Bedroom	39.4	39.4	0.0	0.0%	11.4	11.0	97%	11.0	97%	0.0	0.0%	55	19	55	19	0.0%	0.0%
		W2-U																		
Thirty-Fifth	R3	W3-L	LKD	39.4	39.4	0.0	0.0%													
		W3-U																		
		W4-L		39.5	39.5	0.0	0.0%	29.1	29.0	100%	29.0	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
		W4-U																		
Thirty-Fifth	R4	W5-L	Bedroom	39.5	39.5	0.0	0.0%	11.6	11.0	95%	11.0	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W5-U																		
Thirty-Fifth	R5	W6-L	LKD	39.5	39.5	0.0	0.0%													
		W6-U																		
		W7-L		8.2	8.2	0.0	0.0%													
		W7-U																		
		W8-L		9.0	9.0	0.0	0.0%	28.7	28.3	99%	28.3	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Fifth	R6	W8-U	Bedroom																	
		W9-L		4.7	4.7	0.0	0.0%													
		W9-U																		
		W10-L		39.4	39.4	0.0	0.0%	15.1	14.3	95%	14.3	95%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Thirty-Fifth	R7	W10-U	LKD																	
		W11-L		39.4	39.4	0.0	0.0%													
		W11-U																		
		W12-L		39.4	39.4	0.0	0.0%													
		W12-U																		
Thirty-Fifth	R8	W13-L	Bedroom	12.2	12.2	0.0	0.0%	39.2	38.6	99%	38.6	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
		W14-L		2.7	2.7	0.0	0.0%													
		W14-U																		
		W15-L		39.4	39.4	0.0	0.0%	12.4	12.3	100%	12.3	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirty-Sixth	R1	W15-U	Bedroom																	
		W1-L		19.3	19.3	0.0	0.0%													
		W1-U																		
		W2-L		39.4	39.4	0.0	0.0%	18.4	18.4	100%	18.4	100%	0.0	0.0%	69	20	69	20	0.0%	0.0%
		W2-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Thirty-Sixth	R2	W3-L	Bedroom	39.4	39.4	0.0	0.0%	15.3	15.3	100%	15.3	100%	0.0	0.0%	54	18	54	18	0.0%	0.0%
		W3-U																		
		W4-L																		
		W4-U																		
Thirty-Sixth	R3	W5-L	LKD	18.5	18.5	0.0	0.0%	35.4	33.0	93%	33.0	93%	0.0	0.0%	33	7	33	7	0.0%	0.0%
		W5-U																		
		W6-L																		
		W6-U																		
Thirty-Sixth	R4	W7-L	LKD	39.4	39.4	0.0	0.0%	40.4	40.2	100%	40.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W7-U																		
		W8-L																		
		W8-U																		
		W9-L																		
		W9-U																		
W10-L																				
W10-U																				
Thirty-Sixth	R5	W11-L	Bedroom	10.8	10.8	0.0	0.0%	14.8	14.6	99%	14.6	99%	0.0	0.0%	12	0	12	0	0.0%	0.0%
		W11-U																		
		W12-L																		
		W12-U																		
Thirty-Sixth	R6	W13-L	Bedroom	39.4	39.4	0.0	0.0%	15.9	15.8	100%	15.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
		W14-L																		
W14-U																				
Thirty-Sixth	R7	W15-L	LKD	17.1	17.1	0.0	0.0%	20.9	20.5	98%	20.5	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-U																		
		W16-L																		
		W16-U																		
Mezzanine	R1	W1-L	Residential	10.8	10.7	0.2	1.4%	56.8	48.3	85%	48.2	85%	0.0	0.0%	23	10	23	10	0.0%	0.0%
		W1-U																		
		W2-L																		
		W2-U																		
Mezzanine	R2	W3-L	Residential	11.9	11.3	0.5	4.4%	152.1	151.9	100%	151.9	100%	0.0	0.0%	52	15	52	15	0.0%	0.0%
		W3-U																		
		W4-L																		
		W4-U																		
		W5-L																		
		W5-U																		
		W6-L																		
		W6-U																		
		W7-L																		
		W7-U																		
		W8-L																		
		W8-U																		
		W9-L																		
		W9-U																		
W10-L																				
W10-U																				
W11-L																				
W11-U																				

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Ferry Island Building 2																				
First	R1	W1-L	LKD	13.2	13.2	0.0	0.0%	33.5	23.6	70%	23.6	70%	0.0	0.0%	40	18	40	18	0.0%	0.0%
		W1-U																		
		W2-L																		
		W2-U	16.7	16.7	0.0	0.0%														
		W3	23.3	23.3	0.0	0.1%														
First	R2	W4	Bedroom	22.0	22.0	0.0	0.0%	12.4	9.5	77%	9.5	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W5-L	LKD	8.2	8.2	0.0	0.0%	32.4	20.6	64%	20.6	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W5-U																		
First	R4	W6	Bedroom	16.8	16.8	0.0	0.0%	12.4	6.2	50%	6.2	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W7	LKD	16.4	16.4	0.0	0.0%	35.2	14.1	40%	14.1	40%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W8-L																		
		W8-U																		
First	R6	W9	Bedroom	11.4	11.4	0.0	0.0%	12.2	4.7	38%	4.7	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W10	Bedroom	13.3	13.3	0.0	0.0%	11.5	6.0	52%	6.0	52%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R8	W11-L	Studio	3.3	3.3	0.0	0.0%	29.1	5.5	19%	5.5	19%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W11-U																		
First	R9	W12	LKD	9.0	9.0	0.0	0.0%	35.1	6.8	19%	6.8	19%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-L																		
		W13-U																		
First	R10	W14	Bedroom	5.4	5.4	0.0	0.0%	11.3	2.1	18%	2.1	18%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W15	Bedroom	6.4	6.4	0.0	0.0%	14.5	1.9	13%	1.9	13%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R12	W16	Bedroom	6.6	6.6	0.0	0.0%	10.0	1.1	11%	1.1	11%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R13	W17	Bedroom	7.0	7.0	0.0	0.0%	11.3	4.3	38%	4.3	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W18																		
First	R14	W19	LKD	8.7	8.7	0.0	0.0%	43.1	14.3	33%	14.4	33%	0.0	-0.3%	N/F	N/F	N/F	N/F	N/F	N/F
		W20-L																		
		W20-U																		
		W21-L																		
		W21-U																		
		W22-L	5.1	5.1	0.0	0.0%														
		W22-U																		
Second	R1	W1-L	LKD	13.7	13.7	0.0	0.0%	33.5	23.6	70%	23.6	70%	0.0	0.1%	40	18	40	18	0.0%	0.0%
		W1-U																		
		W2-L																		
		W2-U	17.3	17.3	0.0	0.0%														
		W3	24.5	24.3	0.2	0.7%														
Second	R2	W4	Bedroom	23.3	23.1	0.2	0.7%	12.4	9.9	80%	9.9	80%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R3	W5-L	LKD	9.2	9.1	0.1	1.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
		W5-U						32.4	21.6	67%	21.3	66%	0.3	1.3%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R4	W6	Bedroom	18.2	18.2	0.1	0.4%	12.4	7.2	58%	7.2	58%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R5	W7	LKD	17.8	17.8	0.0	0.1%													
		W8-L		8.3	8.3	0.0	0.0%													
		W8-U						35.2	16.1	46%	16.1	46%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W9	Bedroom	12.9	12.9	0.0	0.0%	12.2	5.3	44%	5.3	44%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R7	W10	Bedroom	14.9	14.9	0.0	0.0%	11.5	7.3	64%	7.3	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R8	W11-L	Studio	4.0	4.0	0.0	0.0%													
		W11-U						29.1	6.0	21%	6.0	21%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R9	W12	LKD	10.3	10.3	0.0	0.0%													
		W13-L		1.7	1.7	0.0	0.0%													
		W13-U						35.1	8.3	24%	8.3	24%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W14	Bedroom	6.2	6.2	0.0	0.0%	11.3	2.5	22%	2.5	22%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R11	W15	Bedroom	7.2	7.2	0.0	0.0%	14.5	2.1	15%	2.1	15%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R12	W16	Bedroom	7.4	7.4	0.0	0.0%	10.0	1.3	13%	1.3	13%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R13	W17	Bedroom	7.7	7.7	0.0	0.0%													
		W18		8.5	8.5	0.0	0.0%	11.3	4.6	40%	4.6	40%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R14	W19	LKD	9.3	9.3	0.0	0.0%													
		W20-L		0.1	0.1	0.0	0.0%													
		W20-U																		
		W21-L		0.9	0.9	0.0	1.1%													
		W21-U																		
		W22-L		5.4	5.4	0.0	0.0%													
		W22-U						43.1	15.0	35%	15.1	35%	0.0	-0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L	LKD	13.8	13.8	0.0	0.0%													
		W1-U																		
		W2-L		17.4	17.4	0.0	0.0%													
		W2-U																		
		W3		25.6	25.2	0.4	1.5%	33.5	23.6	70%	23.6	70%	0.0	0.2%	40	18	40	18	0.0%	0.0%
Third	R2	W4	Bedroom	24.4	24.0	0.4	1.6%	12.4	10.0	81%	10.0	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R3	W5-L	LKD	9.9	9.6	0.4	3.5%													
		W5-U						32.4	22.7	70%	22.0	68%	0.7	3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R4	W6	Bedroom	19.6	19.3	0.3	1.7%	12.4	8.5	69%	8.5	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R5	W7	LKD	19.2	18.9	0.3	1.4%													
		W8-L		9.3	9.2	0.2	1.9%													
		W8-U						35.2	18.2	52%	18.0	51%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W9	Bedroom	14.5	14.4	0.1	1.0%	12.2	6.5	53%	6.5	53%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R7	W10	Bedroom	16.5	16.4	0.0	0.3%	11.5	8.0	69%	8.0	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)							Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Third	R8	W11-L W11-U	Studio	5.0	5.0	0.0	0.0%	29.1	8.3	28%	8.3	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R9	W12 W13-L W13-U	LKD	11.6 2.5	11.6 2.5	0.0 0.0	0.0% 0.0%													
Third	R10	W14	Bedroom	7.0	7.0	0.0	0.0%													
Third	R11	W15	Bedroom	8.1	8.1	0.0	0.0%													
Third	R12	W16	Bedroom	8.2	8.2	0.0	0.0%													
Third	R13	W17 W18	Bedroom	8.5 9.2	8.5 9.2	0.0 0.0	0.0% 0.0%													
Third	R14	W19	LKD	10.0	10.0	0.0	0.0%	43.1	15.6	36%	15.6	36%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
		W20-L W20-U W21-L W21-U W22-L W22-U		0.1	0.1	0.0	0.0%													
		1.0		1.0	0.0	0.0%														
		5.8		5.8	0.0	0.0%														
Fourth	R1	W1-L W1-U W2-L W2-U W3	LKD	13.7 17.3 26.7	13.7 17.3 26.1	0.0 0.0 0.6	0.0% 0.0% 2.3%													
		25.7	25.0	0.6	2.5%	12.4	10.1	81%	10.1	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F		
		10.7	10.1	0.6	5.8%	32.4	24.0	74%	24.0	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F		
Fourth	R4	W6	Bedroom	21.2	20.6	0.6	2.9%	12.4	8.8	71%	8.8	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R5	W7 W8-L W8-U	LKD	20.7 10.5	20.1 10.0	0.6 0.5	2.9% 5.0%	35.2	22.6	64%	22.1	63%	0.5	2.3%	N/F	N/F	N/F	N/F	N/F	N/F
		16.3	15.8	0.5	3.2%	12.2	7.4													
Fourth	R7	W10	Bedroom	18.3	17.9	0.4	2.3%	11.5	8.0	70%	8.0	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R8	W11-L W11-U	Studio	6.9	6.8	0.1	0.9%	29.1	15.6	54%	15.5	53%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R9	W12 W13-L W13-U	LKD	13.1 4.3	13.1 4.3	0.0 0.0	0.0% 0.0%													
Fourth	R10	W14	Bedroom	7.7	7.7	0.0	0.0%	11.3	3.5	31%	3.5	31%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R11	W15	Bedroom	9.1	9.1	0.0	0.0%	14.5	3.1	22%	3.1	22%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R12	W16	Bedroom	9.2	9.2	0.0	0.0%	10.0	2.1	21%	2.1	21%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Fourth	R13	W17 W18	Bedroom	9.4 10.1	9.4 10.1	0.0 0.0	0.0% 0.0%	11.3	5.2	47%	5.2	47%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R14	W19 W20-L W20-U W21-L W21-U W22-L W22-U	LKD	10.8 0.1 1.0 6.3	10.8 0.1 1.0 6.3	0.0 0.0 0.0 0.0	0.0% 0.0% 0.0% 0.0%	43.1	16.5	38%	16.5	38%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1-L W1-U W2-L W2-U W3	LKD	13.7 17.3 27.9	13.7 17.3 27.1	0.0 0.0 0.8	0.0% 0.0% 3.0%	33.5	23.6	70%	23.6	70%	0.0	0.1%	39	18	39	18	0.0%	0.0%
Fifth	R2	W4	Bedroom	27.0	26.1	0.9	3.2%	12.4	10.1	82%	10.1	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R3	W5-L W5-U	LKD	11.4	10.6	0.9	7.6%	32.4	24.8	76%	24.8	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W6	Bedroom	23.3	22.4	0.9	3.9%	12.4	8.8	71%	8.8	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R5	W7 W8-L W8-U	LKD	22.4 11.7	21.5 10.8	0.9 0.9	4.1% 7.6%	35.2	29.2	83%	27.4	78%	1.8	6.3%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W9	Bedroom	18.2	17.3	0.9	5.1%	12.2	7.5	62%	7.5	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R7	W10	Bedroom	20.2	19.4	0.8	4.0%	11.5	8.1	70%	8.1	70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W11-L W11-U	Studio	7.5	7.2	0.2	3.0%	29.1	22.0	76%	21.9	75%	0.2	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W12 W13-L W13-U	LKD	14.5 4.7	14.5 4.7	0.0 0.0	0.0% 0.0%	35.1	26.7	76%	26.7	76%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W14	Bedroom	8.5	8.5	0.0	0.0%	11.3	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R11	W15	Bedroom	10.0	10.0	0.0	0.0%	14.5	3.8	26%	3.8	26%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R12	W16	Bedroom	10.2	10.2	0.0	0.0%	10.0	3.0	30%	3.0	30%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R13	W17 W18	Bedroom	10.4 10.9	10.4 10.9	0.0 0.0	0.0% 0.0%	11.3	5.7	50%	5.7	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R14	W19 W20-L W20-U W21-L W21-U W22-L W22-U	LKD	11.5 0.2 1.0 6.8	11.5 0.2 1.0 6.8	0.0 0.0 0.0 0.0	0.0% 0.0% 0.0% 0.0%	43.1	17.8	41%	17.8	41%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Sixth	R1	W1-L	LKD	13.7	13.7	0.0	0.0%													
		W1-U																		
		W2-L		17.3	17.3	0.0	0.0%													
		W2-U																		
		W3		29.1	28.0	1.0	3.5%	33.5	23.6	70%	23.6	70%	0.0	0.0%	39	18	39	18	0.0%	0.0%
Sixth	R2	W4	Bedroom	28.3	27.2	1.1	3.8%	12.4	10.1	82%	10.1	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W5-L	LKD	26.7	25.6	1.1	4.2%													
		W5-U						32.4	25.0	77%	25.0	77%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W6	Bedroom	25.6	24.4	1.1	4.5%	12.4	8.9	72%	8.9	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R5	W7	LKD	24.0	22.8	1.2	5.0%													
		W8-L	14.0	12.8	1.2	8.6%														
		W8-U					35.2	30.5	87%	29.0	82%	1.5	4.8%	N/F	N/F	N/F	N/F	N/F	N/F	
Sixth	R6	W9	Bedroom	20.0	18.7	1.3	6.3%	12.2	7.6	63%	7.6	63%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W10	Bedroom	22.0	20.8	1.1	5.2%	11.5	8.3	72%	8.3	72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R8	W11-L	Studio	9.7	9.3	0.4	3.6%													
		W11-U						29.1	23.9	82%	23.7	82%	0.1	0.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R9	W12	LKD	15.8	15.8	0.0	0.0%													
		W13-L	6.3	6.3	0.0	0.0%														
		W13-U					35.1	29.8	85%	29.8	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Sixth	R10	W14	Bedroom	8.9	8.9	0.0	0.0%	11.3	3.7	33%	3.7	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R11	W15	Bedroom	11.0	11.0	0.0	0.0%	14.5	3.9	27%	3.9	27%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R12	W16	Bedroom	11.2	11.2	0.0	0.0%	10.0	3.5	35%	3.5	35%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R13	W17	Bedroom	11.4	11.4	0.0	0.0%													
		W18		11.8	11.8	0.0	0.0%	11.3	6.1	54%	6.1	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R14	W19	LKD	12.1	12.1	0.0	0.0%													
		W20-L	0.4	0.4	0.0	0.0%														
		W20-U																		
		W21-L	1.1	1.1	0.0	0.0%														
		W21-U																		
		W22-L	7.4	7.4	0.0	0.0%														
		W22-U					43.1	19.6	46%	19.6	46%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Seventh	R1	W1-L	LKD	36.1	36.1	0.0	0.0%													
		W1-U																		
		W2-L																		
		W2-U																		
		W3	25.4	24.1	1.3	5.1%														
		W4-L	14.0	12.6	1.3	9.6%														
		W4-U					39.4	39.4	100%	39.3	100%	0.1	0.2%	72	26	72	26	0.0%	0.0%	
Seventh	R2	W5	Bedroom	21.5	20.1	1.4	6.3%	12.3	7.8	64%	7.8	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R3	W6	Bedroom	23.4	22.2	1.3	5.4%	11.2	8.3	74%	8.3	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Ninth	R1	W18-L	LKD	1.3	1.3	0.0	0.0%	42.4	21.6	51%	21.6	51%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W18-U		8.8	8.8	0.0	0.0%													
		W19-L																		
		W19-U																		
		W1		37.2	37.2	0.0	0.0%													
		W2-L		38.8	38.8	0.0	0.0%													
Ninth	R2	W2-U	Bedroom	38.7	38.7	0.0	0.0%	34.8	33.4	96%	33.4	96%	0.0	0.0%	89	30	89	30	0.0%	0.0%
		W3-L		27.7	26.5	1.1	4.0%													
		W3-U																		
		W4																		
		W5-L		15.8	14.6	1.2	7.3%													
		W5-U																		
Ninth	R3	W6	Bedroom	23.9	22.8	1.2	4.9%	11.8	8.4	71%	8.4	71%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R4	W7	Bedroom	25.9	24.8	1.1	4.2%	11.2	9.3	83%	9.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W8-L	Studio	11.3	10.9	0.4	3.3%	29.2	23.8	81%	23.7	81%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R6	W8-U																		
Ninth	R6	W9	LKD	19.1	19.1	0.0	0.0%	34.2	30.6	89%	30.6	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-L		7.3	7.3	0.0	0.0%													
		W10-U																		
Ninth	R7	W11	Bedroom	10.7	10.7	0.0	0.0%	11.1	3.6	33%	3.6	33%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R8	W12	Bedroom	13.6	13.6	0.0	0.0%	14.5	4.1	28%	4.1	28%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W13	Bedroom	13.9	13.9	0.0	0.0%	10.1	4.0	39%	4.0	39%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W14	Bedroom	13.9	13.9	0.0	0.0%	11.2	7.5	67%	7.5	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15		14.2	14.2	0.0	0.0%													
Ninth	R11	W16	LKD	14.4	14.4	0.0	0.0%	42.4	22.1	52%	22.1	52%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W17-L		0.8	0.8	0.0	0.0%													
		W17-U																		
		W18-L		1.4	1.4	0.0	0.0%													
		W18-U																		
		W19-L		9.4	9.4	0.0	0.0%													
Tenth	R1	W19-U	LKD					34.8	33.4	96%	33.4	96%	0.0	0.0%	90	30	90	30	0.0%	0.0%
		W1		37.4	37.4	0.0	0.0%													
		W2-L		39.0	39.0	0.0	0.0%													
		W2-U																		
		W3-L		38.8	38.8	0.0	0.0%													
Tenth	R2	W3-U	Bedroom	29.9	28.9	1.0	3.4%	8.3	7.6	92%	7.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W4																		
		W5-L		16.8	15.8	1.1	6.4%													
		W5-U																		
		W6		26.4	25.3	1.1	4.1%	11.8	9.7	82%	9.7	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R4	W7	Bedroom	27.5	26.5	1.0	3.6%	11.2	9.6	86%	9.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room												
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction							
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter						
First	R18	W27-U	Studio	8.7	8.7	0.0	0.0%	14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F						
		W28-L W28-U						42.7	21.5	50%	21.5	50%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F						
First	R19	W29-L W29-U	Bedroom	14.3	14.3	0.0	0.0%	13.1	7.8	59%	7.8	59%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F						
First	R20	W30-L W30-U W31-L W31-U	LKD	19.1	19.1	0.0	0.0%														20.7	20.7	0.0	0.0%	32.3	26.5
First	R21	W32-L W32-U	Bedroom	22.1	22.1	0.0	0.0%	12.7	8.3	65%	8.3	65%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F						
First	R22	W33-L W33-U	Bedroom	24.6	24.6	0.0	0.0%														13.8	10.7	78%	10.7	78%	0.0
First	R23	W34-L W34-U	LKD	5.6	5.5	0.0	0.7%	33.3	18.4	55%	18.4	55%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F						
First	R24	W35-L W35-U W36-L W36-U W37-L W37-U	Studio	28.1	27.8	0.3	0.9%														29.0	28.6	0.3	1.2%	29.4	29.1
First	R25	W38-L W38-U	Bedroom	29.9	29.5	0.3	1.1%	14.2	12.8	91%	12.8	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F						
First	R26	W39-L W39-U W40-L W40-U	LKD	30.5	30.2	0.3	1.0%														10.0	10.0	0.0	0.0%	35.5	26.2
First	R27	W41-L W41-U	Bedroom	9.9	9.9	0.0	0.0%	15.1	11.3	75%	11.3	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F						
First	R28	W42-L W42-U	Bedroom	26.1	26.1	0.0	0.0%														11.9	11.6	98%	11.6	98%	0.0
First	R29	W43-L W43-U	LKD	30.2	30.2	0.0	0.0%	41.1	26.0	63%	26.0	63%	0.0	0.0%	55	16	55	16	0.0%	0.0%						
		W44-L W44-U		35.4	35.4	0.0	0.0%																			
Second	R1	W1-L	LKD	34.6	34.6	0.0	0.0%	37.2	29.0	78%	29.0	78%	0.0	0.0%	60	19	60	19	0.0%	0.0%						
		W1-U		34.5	34.5	0.0	0.0%																			
		W2-L W2-U		10.9	10.7	0.2	1.8%																			
		W3-L W3-U																								
Second	R2	W4-L W4-U	Bedroom	13.9	13.6	0.3	2.4%	12.2	11.3	93%	11.3	93%	0.0	0.0%	26	12	26	12	0.0%	0.0%						

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
		W26-U						40.3	37.0	92%	37.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R17	W27-L W27-U	Bedroom	12.5	12.5	0.0	0.0%	14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R18	W28-L W28-U	Studio	9.1	9.1	0.0	0.0%	42.7	23.1	54%	23.1	54%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R19	W29-L W29-U	Bedroom	15.0	15.0	0.0	0.0%	13.1	7.9	60%	7.9	60%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R20	W30-L W30-U W31-L W31-U	LKD	20.2	20.2	0.0	0.0%	32.3	27.3	85%	27.3	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R21	W32-L W32-U	Bedroom	23.5	23.5	0.0	0.0%	12.7	8.5	67%	8.5	67%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R22	W33-L W33-U	Bedroom	26.0	26.0	0.0	0.0%	13.8	10.8	79%	10.8	79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R23	W34-L W34-U	LKD	6.3	6.3	0.0	0.6%	33.3	20.5	62%	20.5	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R24	W35-L W35-U W36-L W36-U W37-L W37-U	Studio	29.4	29.1	0.3	1.0%	39.0	33.7	86%	33.6	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R25	W38-L W38-U	Bedroom	31.1	30.7	0.4	1.2%	14.2	13.0	92%	13.0	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R26	W39-L W39-U W40-L W40-U	LKD	31.7	31.4	0.3	1.0%	35.5	27.6	78%	27.6	78%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R27	W41-L W41-U	Bedroom	10.6	10.6	0.0	0.0%	15.1	12.6	84%	12.6	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R28	W42-L W42-U	Bedroom	26.4	26.4	0.0	0.0%	11.9	11.6	98%	11.6	98%	0.0	0.0%	21	0	21	0	0.0%	0.0%
Second	R29	W43-L W43-U W44-L W44-U	LKD	30.4	30.4	0.0	0.0%	41.1	27.1	66%	27.1	66%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Third	R1	W1-L W1-U W2-L W2-U W3-L W3-U	LKD	35.3	35.3	0.0	0.0%	37.2	29.4	79%	29.4	79%	0.0	0.0%	61	20	61	20	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																		
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction													
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter												
Third	R2	W4-L W4-U	Bedroom	14.4	14.1	0.3	2.3%	12.2	11.3	93%	11.3	93%	0.0	0.0%	27	13	27	13	0.0%	0.0%												
Third	R3	W5-L W5-U W6-L W6-U	Bedroom	28.1	27.7	0.4	1.2%														29.5	29.2	0.3	1.0%	12.0	11.8	98%	11.8	98%	0.0	0.0%	61
Third	R4	W7-L W7-U	Bedroom	14.0	13.7	0.3	1.9%	11.9	9.4	79%	9.3	79%	0.0	0.5%	34	19	34	19	0.0%	0.0%												
Third	R5	W8-L W8-U	LKD	10.2	9.8	0.4	4.1%	31.7	25.2	79%	25.2	79%	0.0	-0.1%	21	15	20	14	4.8%	6.7%												
Third	R6	W9-L W9-U W10-L W10-U	Bedroom	16.5	16.3	0.2	1.4%	14.2	12.8	90%	12.8	90%	0.0	0.0%	50	16	49	15	2.0%	6.3%												
Third	R7	W11-L W11-U	Bedroom	25.9	25.5	0.3	1.2%														12.0	11.3	94%	11.3	94%	0.0	0.0%	55	20	53	19	3.6%
Third	R8	W12-L W12-U W13-L W13-U	LKD	11.6	11.2	0.4	3.4%	34.1	25.7	75%	25.7	75%	0.0	0.0%	41	22	39	21	4.9%	4.5%												
Third	R9	W14-L W14-U	Bedroom	25.3	24.7	0.6	2.3%														15.5	11.8	76%	11.8	76%	0.0	0.0%	54	17	51	15	5.6%
Third	R10	W15-L W15-U	Bedroom	25.8	25.4	0.4	1.6%	13.4	11.4	85%	11.4	85%	0.0	0.0%	56	18	53	16	5.4%	11.1%												
Third	R11	W16-L W16-U W17-L W17-U W18-L W18-U	LKD	13.0	12.5	0.5	3.5%	41.9	34.8	83%	34.1	81%	0.7	2.0%	57	19	54	17	5.3%	10.5%												
				11.2	10.5	0.7	6.1%																									
				31.6	30.5	1.1	3.4%																									
Third	R12	W19-L W19-U	Bedroom	31.4	30.6	0.8	2.7%	12.2	11.5	94%	11.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F												
Third	R13	W20-L W20-U W21-L W21-U W22-L W22-U	LKD	31.3	30.6	0.6	2.1%	42.8	35.8	84%	35.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F												
				14.1	14.1	0.0	0.0%																									
				12.4	12.4	0.0	0.0%																									
Third	R14	W23-L W23-U	Bedroom	25.0	25.0	0.0	0.0%	12.5	10.9	87%	10.9	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F												
Third	R15	W24-L W24-U	Bedroom	24.8	24.8	0.0	0.0%	14.6	12.3	84%	12.3	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F												

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Fourth	R2	W2-U	Bedroom	11.7	11.5	0.2	1.9%	37.2	29.7	80%	29.7	80%	0.0	0.0%	64	21	64	21	0.0%	0.0%
		W3-L																		
		W3-U																		
Fourth	R2	W4-L	Bedroom	14.9	14.6	0.3	2.1%	12.2	11.4	93%	11.4	93%	0.0	0.0%	28	14	28	14	0.0%	0.0%
		W4-U																		
Fourth	R3	W5-L	Bedroom	28.6	28.3	0.3	1.2%	12.0	11.8	98%	11.8	98%	0.0	0.0%	62	20	62	20	0.0%	0.0%
		W5-U																		
		W6-L																		
Fourth	R4	W7-L	Bedroom	14.4	14.2	0.3	1.9%	11.9	9.5	80%	9.5	80%	0.0	0.5%	34	19	34	19	0.0%	0.0%
		W7-U																		
Fourth	R5	W8-L	LKD	10.7	10.3	0.4	3.9%	31.7	25.6	81%	25.6	81%	0.0	0.0%	21	15	21	15	0.0%	0.0%
		W8-U																		
Fourth	R6	W9-L	Bedroom	17.0	16.8	0.2	1.3%	14.2	13.1	92%	13.1	92%	0.0	0.0%	50	16	49	15	2.0%	6.3%
		W9-U																		
		W10-L																		
Fourth	R7	W11-L	Bedroom	26.6	26.3	0.4	1.3%	12.0	11.6	96%	11.6	96%	0.0	0.0%	56	20	54	19	3.6%	5.0%
		W11-U																		
Fourth	R8	W12-L	LKD	12.3	11.8	0.4	3.5%	34.1	25.9	76%	25.9	76%	0.0	0.0%	42	22	41	21	2.4%	4.5%
		W12-U																		
		W13-L																		
Fourth	R9	W14-L	Bedroom	26.2	25.6	0.6	2.2%	15.5	12.2	79%	12.2	79%	0.0	0.0%	55	18	52	16	5.5%	11.1%
		W14-U																		
Fourth	R10	W15-L	Bedroom	26.7	26.2	0.4	1.6%	13.4	12.0	90%	12.0	90%	0.0	0.0%	57	19	54	17	5.3%	10.5%
		W15-U																		
Fourth	R11	W16-L	LKD	13.7	13.2	0.5	3.5%	41.9	35.1	84%	34.8	83%	0.3	0.9%	61	20	59	19	3.3%	5.0%
		W16-U																		
		W17-L																		
Fourth	R12	W17-U	Bedroom	12.0	11.3	0.7	5.6%	12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W18-L																		
		W18-U																		
Fourth	R13	W20-L	LKD	32.7	32.0	0.7	2.2%	42.8	36.0	84%	36.0	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W20-U																		
		W21-L																		
Fourth	R14	W21-U	Bedroom	14.4	14.4	0.0	0.0%	12.5	11.0	88%	11.0	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W22-L																		
		W22-U																		
Fourth	R14	W23-L	Bedroom	25.8	25.8	0.0	0.0%	12.5	11.0	88%	11.0	88%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W23-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Fourth	R15	W24-L W24-U	Bedroom	25.5	25.5	0.0	0.0%	14.6	12.4	85%	12.4	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
				12.4	12.4	0.0	0.0%													
Fourth	R16	W25-L W25-U W26-L W26-U	LKD	9.6	9.6	0.0	0.0%	40.3	37.1	92%	37.1	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R17	W27-L W27-U	Bedroom	12.9	12.9	0.0	0.0%	14.4	11.6	81%	11.6	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R18	W28-L W28-U	Studio	10.5	10.5	0.0	0.0%	42.7	28.1	66%	28.1	66%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R19	W29-L W29-U	Bedroom	17.3	17.3	0.0	0.0%	13.1	8.1	62%	8.1	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R20	W30-L W30-U W31-L W31-U	LKD	23.1	23.1	0.0	0.0%													
				25.2	25.2	0.0	0.0%	32.3	28.9	90%	28.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R21	W32-L W32-U	Bedroom	26.8	26.8	0.0	0.0%	12.7	9.5	75%	9.5	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R22	W33-L W33-U	Bedroom	29.5	29.5	0.0	0.0%	13.8	11.5	84%	11.5	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R23	W34-L W34-U	LKD	8.0	7.9	0.1	1.0%	33.3	23.1	69%	23.1	69%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R24	W35-L W35-U W36-L W36-U W37-L W37-U	Studio	32.5	32.1	0.4	1.2%													
				33.1	32.7	0.5	1.4%													
				33.4	32.9	0.5	1.4%	39.0	38.1	98%	38.1	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R25	W38-L W38-U	Bedroom	33.7	33.2	0.5	1.4%	14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R26	W39-L W39-U W40-L W40-U	LKD	34.0	33.6	0.4	1.1%													
				10.7	10.7	0.0	0.0%	35.5	29.3	83%	29.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R27	W41-L W41-U	Bedroom	12.0	12.0	0.0	0.0%	15.1	14.7	97%	14.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R28	W42-L W42-U	Bedroom	27.0	27.0	0.0	0.0%	11.9	11.6	98%	11.6	98%	0.0	0.0%	22	1	22	1	0.0%	0.0%
Fourth	R29	W43-L W43-U W44-L W44-U	LKD	30.6	30.6	0.0	0.0%													
				36.9	36.9	0.0	0.0%	41.1	30.5	74%	30.5	74%	0.0	0.0%	57	17	57	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R1	W1-L	LKD	36.7	36.7	0.0	0.0%	37.2	29.9	80%	29.9	80%	0.0	0.0%	65	22	65	22	0.0%	0.0%
		W1-U																		
		W2-L																		
		W2-U																		
Fifth	R2	W3-L	Bedroom	12.2	11.9	0.2	2.0%	12.2	11.4	93%	11.4	93%	0.0	0.0%	29	15	29	15	0.0%	0.0%
		W3-U																		
		W4-L																		
		W4-U																		
Fifth	R3	W5-L	Bedroom	15.4	15.1	0.3	2.1%	12.0	11.8	98%	11.8	98%	0.0	0.0%	62	20	62	20	0.0%	0.0%
		W5-U																		
		W6-L																		
		W6-U																		
Fifth	R4	W7-L	Bedroom	29.2	28.8	0.3	1.2%	11.9	9.7	82%	9.7	82%	0.0	0.5%	35	19	35	19	0.0%	0.0%
		W7-U																		
Fifth	R5	W8-L	LKD	14.9	14.6	0.3	1.9%	31.7	25.6	81%	25.6	81%	0.0	0.0%	23	16	23	16	0.0%	0.0%
		W8-U																		
Fifth	R6	W9-L	Bedroom	11.3	10.9	0.4	3.6%	14.2	13.5	95%	13.5	95%	0.0	0.0%	50	16	49	15	2.0%	6.3%
		W9-U																		
		W10-L																		
		W10-U																		
Fifth	R7	W11-L	Bedroom	17.5	17.3	0.2	1.2%	12.0	11.7	97%	11.7	97%	0.0	0.0%	56	20	54	19	3.6%	5.0%
		W11-U																		
Fifth	R8	W12-L	LKD	28.0	27.6	0.4	1.3%	34.1	25.9	76%	26.0	76%	0.0	0.0%	45	23	43	22	4.4%	4.3%
		W12-U																		
		W13-L																		
		W13-U																		
Fifth	R9	W14-L	Bedroom	14.5	14.0	0.5	3.5%	15.5	12.9	83%	12.9	83%	0.0	0.0%	58	18	55	16	5.2%	11.1%
		W14-U																		
Fifth	R10	W15-L	Bedroom	27.7	27.2	0.6	2.0%	13.4	12.3	92%	12.3	92%	0.0	0.0%	62	19	59	17	4.8%	10.5%
		W15-U																		
Fifth	R11	W16-L	LKD	28.2	27.8	0.4	1.6%	41.9	35.3	84%	35.2	84%	0.1	0.3%	67	22	64	20	4.5%	9.1%
		W16-U																		
		W17-L																		
		W17-U																		
		W18-L																		
Fifth	R12	W18-U	Bedroom	14.3	13.8	0.5	3.4%	12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W19-L																		
		W19-U																		
Fifth	R13	W20-L	LKD	34.1	33.2	0.9	2.6%	42.8	36.5	85%	36.5	85%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W20-U																		
		W21-L																		
		W21-U																		
		W22-L																		
		W22-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																			
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction														
				VSC	VSC	VSC	%		m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter													
Sixth	R1	W44-L	LKD	37.4	37.4	0.0	0.0%	41.1	33.7	82%	33.7	82%	0.0	0.0%	57	17	57	17	0.0%	0.0%													
		W44-U																															
		W1-L		37.3	37.3	0.0	0.0%																										
		W1-U																															
		W2-L		37.3	37.3	0.0	0.0%																										
Sixth	R2	W2-U	Bedroom					37.2	30.0	81%	30.0	81%	0.0	0.0%	67	24	67	24	0.0%	0.0%													
		W3-L		12.6	12.4	0.3	2.1%																										
		W3-U																															
		W4-L		16.0	15.7	0.3	2.0%														12.2	11.4	93%	11.4	93%	0.0	0.0%	31	17	31	17	0.0%	0.0%
		W4-U																															
Sixth	R3	W5-L	Bedroom	29.9	29.5	0.4	1.2%	12.0	11.8	98%	11.8	98%	0.0	0.0%	63	21	63	21	0.0%	0.0%													
		W5-U																															
		W6-L		31.4	31.1	0.3	1.0%																										
Sixth	R4	W6-U	Bedroom					11.9	9.9	84%	9.9	84%	0.0	0.5%	35	19	35	19	0.0%	0.0%													
		W7-L		15.5	15.2	0.3	2.1%																										
Sixth	R5	W7-U	LKD					31.7	25.8	81%	25.8	81%	0.0	0.0%	24	16	24	16	0.0%	0.0%													
		W8-L		11.8	11.4	0.4	3.5%																										
Sixth	R6	W8-U	Bedroom					14.2	13.7	96%	13.7	96%	0.0	0.0%	51	17	50	16	2.0%	5.9%													
		W9-L		18.0	17.7	0.3	1.6%																										
		W9-U																															
		W10-L		18.5	18.5	0.0	0.0%																										
Sixth	R7	W10-U	Bedroom					12.0	11.7	97%	11.7	97%	0.0	0.0%	69	20	68	19	1.4%	5.0%													
		W11-L		31.1	30.6	0.5	1.5%																										
Sixth	R8	W11-U	LKD					34.1	27.1	80%	27.1	80%	0.0	0.0%	76	24	75	23	1.3%	4.2%													
		W12-L		30.9	30.4	0.5	1.6%																										
		W12-U																															
Sixth	R9	W13-L	Bedroom	30.9	30.3	0.5	1.7%	15.5	13.5	87%	13.5	87%	0.0	0.0%	76	24	73	22	3.9%	8.3%													
		W13-U		30.9	30.4	0.5	1.6%																										
		W14-L																															
Sixth	R10	W14-U	Bedroom					13.4	12.3	92%	12.3	92%	0.0	0.0%	75	24	72	22	4.0%	8.3%													
		W15-L		30.9	30.3	0.6	1.8%																										
Sixth	R11	W15-U	LKD					41.9	35.5	85%	35.5	85%	0.0	0.1%	79	25	76	23	3.8%	8.0%													
		W16-L		30.9	30.3	0.6	1.9%																										
		W16-U																															
		W17-L		31.3	30.7	0.6	1.9%																										
		W17-U																															
Sixth	R12	W18-L	Bedroom	35.4	34.3	1.0	2.9%	12.2	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W18-U																															
		W19-L		35.3	34.4	0.9	2.6%																										
Sixth	R13	W19-U	LKD																														
		W20-L		35.2	34.4	0.8	2.2%																										
		W20-U																															
Sixth		W21-L		31.2	31.2	0.0	0.0%																										
		W21-U																															

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																			
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction														
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter													
		W22-L	Bedroom	30.0	30.0	0.0	0.0%																										
		W22-U		42.8	37.4	87%	37.4														87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R14	W23-L	Bedroom	28.5	28.5	0.0	0.0%																										
		W23-U		12.5	11.3	91%	11.3														91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R15	W24-L	Bedroom	26.8	26.8	0.0	0.0%																										
		W24-U		14.6	12.6	87%	12.6														87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R16	W25-L	LKD	25.3	25.3	0.0	0.0%																										
		W25-U		23.4	23.4	0.0	0.0%														40.3	37.6	93%	37.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W26-L																															
		W26-U																															
Sixth	R17	W27-L	Bedroom	14.7	14.7	0.0	0.0%																										
		W27-U		14.4	12.8	89%	12.8														89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R18	W28-L	Studio	14.8	14.8	0.0	0.0%																										
		W28-U		42.7	30.6	72%	30.6														72%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R19	W29-L	Bedroom	23.3	23.3	0.0	0.0%																										
		W29-U		13.1	9.2	70%	9.2														70%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R20	W30-L	LKD	29.1	29.1	0.0	0.0%																										
		W30-U		31.1	31.1	0.0	0.0%														32.3	29.6	92%	29.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W31-L																															
		W31-U																															
Sixth	R21	W32-L	Bedroom	32.4	32.4	0.0	0.0%																										
		W32-U		12.7	12.1	95%	12.1														95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R22	W33-L	Bedroom	34.1	34.1	0.1	0.2%																										
		W33-U		13.8	12.8	93%	12.8														93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R23	W34-L	LKD	9.4	9.3	0.1	1.3%																										
		W34-U		33.3	26.4	79%	26.4														79%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R24	W35-L	Studio	35.5	35.0	0.5	1.4%																										
		W35-U		35.7	35.2	0.5	1.5%														39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W36-L																															
		W36-U																															
		W37-L																															
		W37-U																															
Sixth	R25	W38-L	Bedroom	35.9	35.4	0.5	1.4%																										
		W38-U		14.2	13.5	95%	13.5														95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R26	W39-L	LKD	36.1	35.6	0.4	1.2%																										
		W39-U		10.8	10.8	0.0	0.0%														35.5	29.4	83%	29.4	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W40-L																															
		W40-U																															
Sixth	R27	W41-L	Bedroom	13.3	13.3	0.0	0.0%																										
		W41-U		15.1	15.0	99%	15.0														99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
Sixth	R28	W42-L	Bedroom	27.6	27.6	0.0	0.0%																										
		W42-U		11.9	11.6	98%	11.6														98%	0.0	0.0%	23	2	23	2	0.0%	0.0%				

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																			
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction														
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter													
Seventh	R12	W21-L	LKD	36.4	35.5	1.0	2.6%	36.0	32.5	90%	32.5	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W21-U		36.4	35.5	0.9	2.4%																										
		W22-L		9.6	9.6	0.0	0.0%																										
		W22-U																															
		W23-L																															
W23-U																																	
Seventh	R13	W24-L	Bedroom	20.9	20.9	0.0	0.0%	16.2	14.4	89%	14.4	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W24-U		20.4	20.4	0.0	0.0%																										
		W25-L		19.3	19.3	0.0	0.0%																										
		W25-U																															
Seventh	R14	W26-L	Bedroom	19.3	19.3	0.0	0.0%	15.7	13.7	87%	13.7	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W26-U																															
Seventh	R15	W27-L	LKD	7.7	7.7	0.0	0.0%	31.0	27.9	90%	27.9	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W27-U		8.5	8.5	0.0	0.0%																										
		W28-L		17.8	17.8	0.0	0.0%																										
		W28-U																															
Seventh	R16	W29-L	Bedroom	17.8	17.8	0.0	0.0%	14.3	13.4	94%	13.4	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W29-U																															
Seventh	R17	W30-L	Studio	22.5	22.5	0.0	0.0%	42.7	37.0	87%	37.0	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W30-U																															
Seventh	R18	W31-L	Bedroom	30.8	30.8	0.0	0.0%	13.1	12.8	97%	12.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W31-U																															
Seventh	R19	W32-L	LKD	34.2	34.2	0.0	0.0%	32.3	29.6	92%	29.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W32-U		35.1	35.0	0.1	0.4%																										
		W33-L		35.6	35.3	0.3	0.7%																										
		W33-U																															
Seventh	R20	W34-L	Bedroom	35.6	35.3	0.3	0.7%	12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W34-U																															
Seventh	R21	W35-L	Bedroom	36.2	35.8	0.4	1.1%	13.8	12.9	94%	12.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W35-U																															
Seventh	R22	W36-L	LKD	10.4	10.3	0.2	1.5%	33.3	27.8	83%	27.8	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W36-U																															
Seventh	R23	W37-L	Studio	36.7	36.1	0.6	1.5%	39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W37-U		36.8	36.2	0.6	1.5%																										
		W38-L		36.8	36.3	0.5	1.5%																										
		W38-U																															
		W39-L																															
W39-U																																	
Seventh	R24	W40-L	Bedroom	36.9	36.3	0.5	1.5%	14.2	13.5	95%	13.5	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W40-U																															
Seventh	R25	W41-L	LKD	36.9	36.4	0.5	1.2%	35.5	29.8	84%	29.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W41-U		24.4	24.4	0.0	0.0%																										
		W42-L		19.3	19.3	0.0	0.0%																										
		W42-U																															

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Ninth	R9	W15-L W15-U	Bedroom	38.1	37.5	0.7	1.7%	15.2	14.6	96%	14.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R10	W16-L W16-U	Bedroom	38.2	37.5	0.6	1.7%	12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R11	W17-L W17-U	Bedroom	38.2	37.6	0.6	1.6%	12.8	12.3	96%	12.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R12	W18-L W18-U	LKD	11.1	10.9	0.2	1.5%	33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R13	W19-L W19-U	Studio	38.2	37.7	0.6	1.5%	39.0	38.3	98%	38.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W20-L W20-U		38.3	37.7	0.6	1.5%													
		W21-L W21-U		38.3	37.7	0.6	1.5%													
Ninth	R14	W22-L W22-U	Bedroom	38.3	37.7	0.5	1.4%	12.8	11.9	93%	11.9	93%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R15	W23-L W23-U	LKD	38.3	37.8	0.5	1.3%	35.3	32.8	93%	32.8	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W24 W25-L W25-U		39.5 39.5	39.5 39.5	0.0 0.0	0.0% 0.0%													
Ninth	R16	W26	Bedroom	39.5	39.5	0.0	0.0%	11.4	10.5	93%	10.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R17	W27-L W27-U	LKD	39.6	39.6	0.0	0.0%	32.6	28.8	88%	28.8	88%	0.0	0.0%	61	19	61	19	0.0%	0.0%
		W28-L W28-U		39.2	39.2	0.0	0.0%													
Tenth	R1	W1-L W1-U	LKD	39.5	39.5	0.0	0.0%	37.1	30.0	81%	30.0	81%	0.0	0.0%	95	27	95	27	0.0%	0.0%
		W2-L W2-U		39.5	39.5	0.0	0.0%													
		W3-L W3-U		36.1	35.8	0.3	0.8%													
Tenth	R2	W4-L W4-U	Bedroom	36.0	35.7	0.3	0.8%	12.2	11.4	94%	11.4	94%	0.0	0.0%	83	26	83	26	0.0%	0.0%
Tenth	R3	W5-L W5-U	Bedroom	36.0	35.6	0.3	0.9%	12.0	11.8	98%	11.8	98%	0.0	0.0%	83	26	83	26	0.0%	0.0%
		W6-L W6-U		35.9	35.6	0.3	0.9%													
Tenth	R4	W7-L W7-U	Bedroom	35.7	35.4	0.3	1.0%	11.8	10.5	89%	10.5	89%	0.0	0.0%	81	24	81	24	0.0%	0.0%
Tenth	R5	W8-L W8-U	LKD	35.6	35.2	0.4	1.0%													
		W9-L		38.2	37.5	0.7	1.8%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Tenth	R6	W9-U					31.6	28.2	89%	28.1	89%	0.1	0.4%	84	25	84	25	0.0%	0.0%	
		W10-L	38.3	37.7	0.7	1.7%														
		W10-U																		
		W11-L	38.4	37.7	0.7	1.8%														
		W11-U																		
Tenth	R7	W12-L	38.4	37.8	0.6	1.7%	31.9	31.4	98%	31.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
		W12-U																		
		W13-L	12.8	12.2	0.6	4.5%														
		W13-U					33.0	24.6	74%	24.3	74%	0.2	1.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Tenth	R8	W14-L	Bedroom	38.5	37.9	0.6	1.6%	13.7	13.4	97%	13.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-U																		
Tenth	R9	W15-L	Bedroom	38.6	38.0	0.6	1.6%	15.2	14.6	96%	14.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-U																		
Tenth	R10	W16-L	Bedroom	38.6	38.0	0.6	1.6%	12.7	12.1	95%	12.1	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W16-U																		
Tenth	R11	W17-L	Bedroom	38.6	38.1	0.6	1.5%	12.8	12.3	96%	12.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W17-U																		
Tenth	R12	W18-L	LKD	11.4	11.2	0.2	1.4%	33.3	27.8	84%	27.8	84%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W18-U																		
Tenth	R13	W19-L	Bedroom	31.6	31.1	0.5	1.7%													
		W19-U																		
		W20-L		31.6	31.1	0.5	1.7%	13.1	13.0	99%	13.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W20-U																		
Tenth	R14	W21-L	Bedroom	31.6	31.1	0.5	1.7%													
		W21-U																		
		W22-L		31.6	31.1	0.5	1.6%	11.9	11.8	100%	11.8	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W22-U																		
Tenth	R15	W23-L	LKD	31.6	31.1	0.5	1.6%													
		W23-U																		
		W24-L		31.6	31.1	0.5	1.5%													
		W24-U																		
		W25-L		5.0	5.0	0.0	0.0%	33.8	31.5	93%	31.5	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W25-U																		
Tenth	R16	W26-L	Studio	34.2	34.2	0.0	0.0%													
		W26-U																		
		W27-L		31.3	31.3	0.0	0.0%													
		W27-U																		
		W28-L		31.8	31.8	0.0	0.0%													
		W28-U																		
		W29-L		31.7	31.7	0.0	0.0%													
		W29-U																		
		W30-L		34.2	34.2	0.0	0.0%													
		W30-U						38.0	37.4	98%	37.4	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Tenth	R17	W31-L	LKD	4.7	4.7	0.0	0.0%													
		W31-U																		

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				Room Area	No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss		Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
First 13 Hale Road	R2	W3-L W3-U	Bedroom	10.2	5.7	4.5	43.8%	9.9	2.3	24%	2.0	21%	0.3	12.8%	N/F	N/F	N/F	N/F	N/F	N/F
	Ground	R1 W1-L W1-U	Bedroom	6.4	5.7	0.7	11.2%	9.9	2.6	27%	2.3	24%	0.3	11.1%	N/F	N/F	N/F	N/F	N/F	N/F
	Ground	R2 W2 W3 W4	Residential	7.3 9.1 7.2	7.1 6.6 5.7	0.2 2.5 1.5	2.2% 27.2% 20.8%	13.0	4.9	38%	4.8	37%	0.1	2.9%	2	0	2	0	0.0%	0.0%
First	R1	W1-L W1-U	Bedroom	13.0	9.6	3.3	25.8%	9.9	4.3	44%	3.8	39%	0.5	10.9%	N/F	N/F	N/F	N/F	N/F	N/F
First 15 Hale Road	R2	W2-L W2-U W3-L W3-U	Bedroom	13.5 12.2	13.4 8.8	0.0 3.4	0.1% 27.8%	11.8	8.5	71%	8.4	71%	0.0	0.3%	12	0	12	0	0.0%	0.0%
	Ground	R1 W1	Residential	11.2	8.7	2.5	22.2%	1.6	0.7	44%	0.6	36%	0.1	18.7%	N/F	N/F	N/F	N/F	N/F	N/F
	Ground	R2 W2 W3	Kitchen	9.7 6.1	7.3 4.1	2.4 2.0	24.7% 32.7%	10.8	2.6	24%	2.3	21%	0.3	13.3%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R3	W4-L W4-U	Bedroom	5.3	2.8	2.5	47.3%	9.9	1.9	19%	1.7	17%	0.2	10.0%	N/F	N/F	N/F	N/F	N/F	N/F
First 17 Hale Road	R1	W1-L W1-U W2-L W2-U	Bedroom	13.2 17.3	10.1 14.2	3.0 3.1	23.0% 17.6%	11.8	11.2	95%	10.7	90%	0.5	4.9%	N/F	N/F	N/F	N/F	N/F	N/F
	First	R2 W3-L W3-U	Bedroom	12.1	8.2	3.9	32.2%	9.9	3.3	34%	2.9	29%	0.4	13.4%	N/F	N/F	N/F	N/F	N/F	N/F
	Ground	R1 W1-L W1-U	Bedroom	7.6	7.1	0.5	6.1%	9.9	3.1	31%	2.7	28%	0.4	11.7%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2 W3 W4 W5	Residential	7.2 11.7 12.0 10.6	7.2 9.2 9.3 8.1	0.0 2.5 2.7 2.4	0.3% 21.5% 22.2% 23.0%	13.0	5.3	41%	5.4	41%	0.0	-0.6%	0	0	0	0	0.0%	0.0%
First	R1	W1-L W1-U	Bedroom	14.2	11.6	2.6	18.1%	9.9	4.5	46%	4.2	42%	0.3	7.6%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L W2-U W3-L W3-U	Bedroom	11.9 13.5	12.0 10.3	-0.1 3.2	-0.9% 23.5%	11.8	7.8	66%	7.1	60%	0.7	8.8%	10	0	10	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
21 Hale Road																				
Ground	R1	W1-L W1-U	Bedroom	6.5	6.2	0.3	3.9%	9.2	2.6	29%	2.5	27%	0.1	4.1%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	3.2	3.5	-0.3	-7.8%	11.4	1.8	16%	1.9	17%	-0.1	-5.4%	0	0	0	0	0.0%	0.0%
First	R1	W1-L W1-U	Bedroom	12.1	9.4	2.8	22.8%	9.3	3.2	34%	3.1	33%	0.2	4.7%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W3	Kitchen	14.7	11.6	3.1	21.0%	6.3	4.3	69%	3.1	49%	1.2	28.1%	N/F	N/F	N/F	N/F	N/F	N/F
19 Hale Road																				
Ground	R2	W2	Kitchen	12.6	9.8	2.8	22.2%	10.8	2.8	26%	2.3	22%	0.5	17.3%	N/F	N/F	N/F	N/F	N/F	N/F
		W3		7.6	5.0	2.7	34.9%													
		W4		6.3	4.3	2.0	32.0%													
Ground	R3	W5-L W5-U	Bedroom	6.6	4.4	2.2	33.4%	9.9	2.4	25%	1.9	20%	0.5	20.1%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1-L W1-U	Bedroom	14.4	11.3	3.1	21.8%	11.8	11.2	95%	10.6	89%	0.6	5.6%	N/F	N/F	N/F	N/F	N/F	N/F
		W2-L W2-U		17.5	13.8	3.7	21.0%													
First	R2	W3-L W3-U	Bedroom	13.8	9.8	4.0	28.8%	9.9	3.7	37%	2.7	27%	1.0	26.2%	N/F	N/F	N/F	N/F	N/F	N/F
1 Hale Road																				
Ground	R1	W1	Bedroom	21.7	19.5	2.3	10.4%	9.8	9.1	93%	9.0	92%	0.1	1.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ground	R2	W2	Kitchen	31.0	30.9	0.0	0.1%	10.8	10.7	99%	10.3	96%	0.4	3.7%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-L W3-U		17.3	15.0	2.3	13.1%													
First	R1	W1-L W1-U	Bedroom	24.1	20.1	4.1	16.9%	9.8	9.2	94%	9.1	93%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R2	W2-L W2-U	Residential	29.0	29.0	0.0	0.1%	12.4	11.8	95%	11.8	95%	0.0	-0.4%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-L W3-U		24.4	19.9	4.5	18.4%													
3 Hale Road																				
Ground	R1	W1	Residential	15.4	12.8	2.7	17.3%	4.5	3.7	83%	3.4	76%	0.3	9.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W2		16.4	13.8	2.6	15.9%													
Ground	R2	W3	Kitchen	7.7	6.3	1.4	17.8%	11.9	5.8	49%	5.7	48%	0.1	1.6%	7	0	7	0	0.0%	0.0%
		W4		5.7	4.3	1.4	24.1%													
		W5-L W5-U		4.0	2.8	1.2	30.8%													
Ground	R3	W6	Bedroom	5.1	1.7	3.4	67.3%	9.8	3.4	34%	1.8	18%	1.6	47.5%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
First	R1	W2-L	Study	32.1	31.1	1.1	3.3%	13.5	13.4	100%	13.4	100%	0.0	0.1%	50	11	48	10	4.0%	9.1%
		W2-U																		
		W3-L		23.7	22.7	1.0	4.3%													
		W3-U		31.4	30.4	1.1	3.3%													
First	R2	W1-L	Bedroom	31.6	30.7	1.0	3.1%	5.1	5.0	97%	5.0	97%	0.0	0.0%	43	10	40	8	7.0%	20.0%
		W1-U		31.6	30.5	1.0	3.3%													
Second	R1	W2-L	Bedroom	12.0	11.9	99%	11.9	99%	0.0	0.0%	45	11	43	9	4.4%	18.2%				
		W2-U																		
		W2-L															81.9	81.0	0.9	1.1%
		W2-U															82.0	81.2	0.9	1.1%
	R1	W3	Bedroom	38.9	38.9	0.0	0.0%	18.8	18.7	100%	18.7	100%	0.0	0.0%	91	21	90	20	1.1%	4.8%
1A Park View Road																				
Ground	R1	W2-L	Living Room	29.6	29.1	0.5	1.7%	13.5	13.5	100%	13.5	100%	0.0	0.0%	53	10	52	10	1.9%	0.0%
		W2-U																		
		W3-L		31.7	30.4	1.3	3.9%													
		W3-U		24.5	23.4	1.1	4.5%													
First	R1	W4-L	Bedroom	12.1	12.0	99%	12.0	99%	0.0	0.0%	41	8	40	8	2.4%	0.0%				
		W4-U																		
		W2-L															31.2	30.0	1.2	3.8%
		W2-U															31.1	29.9	1.2	3.8%
First	R2	W3-L	Study	5.1	4.9	96%	4.9	95%	0.0	0.8%	43	10	41	9	4.7%	10.0%				
		W3-U																		
		W1-L															31.3	30.2	1.1	3.6%
		W1-U																		
Second	R1	W2-L	Bedroom	81.6	80.6	1.0	1.2%	18.9	18.9	100%	18.9	100%	0.0	0.0%	87	17	86	17	1.1%	0.0%
		W2-U		81.2	80.2	1.0	1.2%													
		W3		38.7	38.7	0.0	0.0%													
1 Park View Road																				
Ground	R2	W1	Living Room	30.7	30.5	0.3	0.9%	11.2	11.1	100%	11.1	100%	0.0	0.0%	51	10	50	9	2.0%	10.0%
		W2		32.9	32.0	0.9	2.6%													
		W3-L		26.6	25.6	1.0	3.7%													
		W3-U																		
First	R1	W4-L	Bedroom	11.9	11.7	98%	11.7	98%	0.0	0.0%	48	12	46	10	4.2%	16.7%				
		W4-U																		
		W1-L															33.5	32.7	0.8	2.4%
		W1-U															33.4	32.6	0.9	2.6%
2 Park View Road																				
Ground	R1	W2-L	Living Room	29.6	29.4	0.2	0.6%													
		W1-L		33.4	32.6	0.8	2.3%													
		W2-L																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																								
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction																			
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter																		
6 Park View Road	First	R1	W2-L W2-U W3-L W3-U W8 W9	Bedroom	33.1	32.4	0.6	1.9%	19.1	18.7	98%	18.6	97%	0.2	0.8%	55	12	55	12	0.0%	0.0%																	
					22.9	22.2	0.7	3.0%																														
					12.7	12.7	0.0	0.0%																														
					15.0	15.0	0.0	0.0%																														
	W1-L W1-U W2-L W2-U	33.8	33.2	0.6	1.7%	14.0	13.8	98%	13.8	98%	0.0	0.0%	47	12	46	11	2.1%	8.3%																				
		33.8	33.1	0.6	1.8%																																	
		Ground	R1	W1-L W1-U W2-L W2-U W3-L W3-U	Living Room														27.2	27.2	0.0	0.1%	11.4	11.3	99%	11.3	99%	0.0	0.1%	51	12	51	12	0.0%	0.0%			
																			33.4	32.9	0.5	1.5%																
23.4	22.8					0.6	2.6%																															
34.0	33.6					0.4	1.3%																															
First	R1	W1-L W1-U W2-L W2-U	Bedroom	34.0	33.5	0.5	1.4%	11.6	11.4	98%	11.4	98%	0.0	0.0%	45	10	45	10	0.0%	0.0%																		
				26.7	26.7	0.0	0.0%																															
				78.3	77.9	0.4	0.5%																															
				7A Park View Road	Ground	R2	W7-L W7-U W8-L W8-U W9-L W9-U														Living Room	30.7	30.7	0.0	0.1%	13.9	13.9	100%	13.9	100%	0.0	0.0%	48	10	48	10	0.0%	0.0%
33.5	33.0	0.5	1.4%																																			
22.4	21.8	0.6	2.5%																																			
34.2	33.8	0.4	1.2%																																			
First	R1	W1-L W1-U W2-L W2-U	Bedroom	34.1	33.6	0.5	1.3%	12.1	11.9	98%	11.9	98%	0.0	0.0%	44	10	44	10	0.0%	0.0%																		
				Rosa Luxemburg Apartments	Ground	R9	W40-L W40-U W41-L W41-U														LKD	19.8	14.6	5.2	26.3%	34.3	29.6	86%	25.8	75%	3.8	12.9%	N/F	N/F	N/F	N/F	N/F	N/F
																						20.6	16.6	4.0	19.3%													
																						12.7	9.7	3.0	23.9%													
15.6	7.8	50%	4.1					26%	3.7	47.6%	26	2	20	0	23.1%	100.0%																						
First	R2	W2-L W2-U	Bedroom	14.3	10.9	3.4	23.8%	9.9	5.9	60%	3.7	38%	2.2	37.1%	28	3	21	0	25.0%	100.0%																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Second	R5	W9-L W9-U	Bedroom	12.7	11.1	1.7	13.0%	12.9	10.0	77%	7.3	56%	2.7	27.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10-L W10-U	Bedroom	15.0	11.6	3.5	23.1%	14.5	11.6	80%	5.7	40%	5.9	50.8%	33	6	23	2	30.3%	66.7%
Second	R7	W11-L W11-U	Bedroom	17.1	13.2	3.8	22.5%	9.1	7.5	82%	5.2	57%	2.3	30.4%	33	6	25	2	24.2%	66.7%
Second	R8	W12-L W12-U	LKD	18.2	14.0	4.2	22.9%	27.3	24.4	89%	14.4	53%	10.0	40.9%	37	7	32	3	13.5%	57.1%
		W13-L W13-U		2.3	0.4	1.9	83.2%													
		W14-L W14-U		7.4	6.1	1.2	16.6%													
Second	R9	W15-L W15-U	Bedroom	6.0	4.8	1.3	20.9%	14.0	3.0	21%	1.9	14%	1.1	35.9%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R10	W16-L W16-U	Bedroom	5.9	5.9	0.0	0.5%	13.0	2.3	18%	2.3	18%	0.0	0.0%	14	2	14	2	0.0%	0.0%
Second	R11	W17-L W17-U	LKD	8.0	7.8	0.2	3.0%	23.4	21.2	90%	15.1	64%	6.1	28.8%	43	9	38	6	11.6%	33.3%
		W18-L W18-U		5.9	3.8	2.1	35.9%													
		W19-L W19-U		17.3	15.1	2.2	12.4%													
Second	R12	W20-L W20-U	LKD	4.1	3.3	0.7	18.0%	22.9	8.3	36%	4.9	21%	3.4	41.2%	13	8	11	5	15.4%	37.5%
Second	R13	W21-L W21-U	Bedroom	9.2	8.5	0.6	7.0%	15.3	7.6	50%	6.4	42%	1.2	15.8%	21	4	21	4	0.0%	0.0%
Second	R14	W22-L W22-U	Bedroom	12.6	12.1	0.5	4.3%	14.5	9.8	67%	9.2	64%	0.5	5.6%	30	7	27	4	10.0%	42.9%
Second	R15	W23-L W23-U	Bedroom	14.0	13.6	0.4	3.2%	13.5	6.1	45%	6.1	45%	0.0	0.0%	24	3	24	3	0.0%	0.0%
Second	R16	W24-L W24-U	LKD	4.2	3.7	0.5	12.1%	29.0	26.3	91%	26.4	91%	-0.1	-0.3%	8	1	7	0	12.5%	100.0%
Second	R17	W25-L W25-U	LKD	17.2	11.5	5.7	33.0%	27.2	26.5	98%	25.4	93%	1.1	4.2%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1-L W1-U	LKD	11.7	11.7	0.0	0.0%	26.9	26.1	97%	26.1	97%	0.0	0.0%	55	6	47	6	14.5%	0.0%
		W2-L W2-U		12.1	12.1	0.0	0.0%													
		W3-L W3-U		16.1	13.9	2.2	13.5%													
Third	R2	W4-L W4-U	Bedroom	15.9	12.9	3.1	19.2%	8.4	3.6	43%	2.8	34%	0.7	20.9%	44	4	37	5	15.9%	-25.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Third	R3	W5-L W5-U	Bedroom	15.8	12.1	3.7	23.4%	12.0	5.1	43%	3.5	29%	1.6	31.6%	48	4	38	3	20.8%	25.0%
Third	R4	W6-L	LKD	16.9	13.0	3.9	23.0%	23.3	17.3	74%	20.1	86%	-2.9	-16.6%	57	7	44	3	22.8%	57.1%
		W6-U		2.7	2.1	0.6	21.0%													
		W7-L W7-U W8-L W8-U		16.8	14.7	2.1	12.3%													
Third	R5	W9-L W9-U	Bedroom	14.7	12.7	2.0	13.5%	12.9	10.8	83%	8.2	64%	2.6	23.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10-L W10-U	Bedroom	17.2	13.8	3.4	19.9%	14.5	12.9	89%	8.8	61%	4.1	31.7%	34	7	28	4	17.6%	42.9%
Third	R7	W11-L W11-U	Bedroom	19.2	15.7	3.5	18.2%	9.1	8.0	88%	7.5	83%	0.5	6.0%	36	7	29	4	19.4%	42.9%
Third	R8	W12-L	LKD	20.3	16.8	3.6	17.5%	27.3	26.8	98%	20.4	75%	6.4	23.9%	41	9	35	5	14.6%	44.4%
		W12-U		3.7	2.2	1.5	41.1%													
		W13-L W13-U W14-L W14-U		8.9	7.4	1.4	16.2%													
Third	R9	W15-L W15-U	Bedroom	7.2	5.9	1.4	19.0%	14.0	3.5	25%	2.2	16%	1.4	38.4%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16-L W16-U	Bedroom	7.5	7.5	0.0	0.3%	13.0	2.8	22%	2.8	22%	0.0	0.0%	15	3	15	3	0.0%	0.0%
Third	R11	W17-L	LKD	9.9	9.8	0.1	1.2%	23.4	22.8	98%	19.9	85%	3.0	13.0%	49	12	42	10	14.3%	16.7%
		W17-U		7.8	5.9	1.9	24.6%													
		W18-L W18-U W19-L W19-U		19.9	17.9	2.0	9.9%													
Third	R12	W20-L W20-U	LKD	5.6	5.5	0.1	1.3%	22.9	12.9	56%	8.3	36%	4.6	36.0%	16	8	18	10	-12.5%	-25.0%
Third	R13	W21-L W21-U	Bedroom	10.6	10.4	0.1	1.3%	15.3	8.7	57%	9.5	62%	-0.8	-9.2%	24	6	24	6	0.0%	0.0%
Third	R14	W22-L W22-U	Bedroom	13.8	13.4	0.4	2.9%	14.5	10.3	71%	10.2	70%	0.1	0.7%	30	7	30	7	0.0%	0.0%
Third	R15	W23-L W23-U	Bedroom	15.5	15.1	0.4	2.8%	13.5	6.6	49%	6.6	49%	0.0	0.0%	26	4	25	3	3.8%	25.0%
Third	R16	W24-L W24-U	LKD	5.6	4.9	0.7	12.4%	29.0	27.1	93%	26.7	92%	0.4	1.4%	11	3	8	0	27.3%	100.0%
Third	R17	W25-L W25-U	LKD	18.9	11.9	7.0	36.9%	27.2	26.8	99%	25.5	94%	1.4	5.1%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Sixth	R9	W15-L W15-U	Bedroom	16.0	13.9	2.1	13.1%	14.0	5.7	41%	4.7	33%	1.0	17.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W16-L W16-U	Bedroom	17.8	17.8	0.0	0.0%	13.0	9.6	74%	9.6	74%	0.0	0.0%	26	6	26	6	0.0%	0.0%
Sixth	R11	W17-L	LKD	19.6	19.6	0.0	0.0%	23.4	23.1	99%	23.1	99%	0.0	0.0%	71	23	63	20	11.3%	13.0%
		W17-U		13.9	11.1	2.7	19.6%													
		W18-L W18-U W19-L W19-U		28.0	24.7	3.3	11.8%													
Sixth	R12	W20-L W20-U	LKD	13.5	10.7	2.8	20.6%	22.9	22.7	99%	22.4	98%	0.3	1.4%	34	18	29	16	14.7%	11.1%
Sixth	R13	W21-L W21-U	Bedroom	17.3	17.1	0.2	1.1%	15.3	14.0	91%	13.9	90%	0.2	1.2%	36	15	36	15	0.0%	0.0%
Sixth	R14	W22-L W22-U	Bedroom	18.6	18.7	0.0	-0.2%	14.5	12.7	88%	12.7	88%	0.0	0.0%	45	12	46	13	-2.2%	-8.3%
Sixth	R15	W23-L W23-U	Bedroom	21.6	21.6	-0.1	-0.2%	13.5	9.8	73%	9.8	73%	0.0	0.0%	46	12	47	13	-2.2%	-8.3%
Sixth	R16	W24-L W24-U	LKD	25.7	25.8	-0.1	-0.2%	29.0	28.9	100%	28.9	100%	0.0	0.0%	46	12	48	14	-4.3%	-16.7%
Sixth	R17	W25-L W25-U	LKD	38.0	34.7	3.3	8.6%	27.2	26.9	99%	26.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1-L	LKD	28.3	28.3	0.0	0.0%	29.5	29.0	98%	29.0	98%	0.0	0.0%	86	21	82	19	4.7%	9.5%
		W1-U		33.2	33.2	0.0	0.0%													
		W2-L W2-U W3-L W3-U		30.4	28.6	1.8	5.9%													
Seventh	R2	W4-L W4-U	Bedroom	30.4	28.4	2.0	6.7%	12.2	9.2	76%	9.2	76%	0.0	0.0%	76	20	72	18	5.3%	10.0%
Seventh	R3	W5-L W5-U	Bedroom	30.5	28.3	2.2	7.2%	12.6	12.1	96%	12.1	96%	0.0	0.0%	73	18	69	16	5.5%	11.1%
Seventh	R4	W6-L	LKD	30.6	28.1	2.5	8.0%	23.3	22.8	98%	22.6	97%	0.2	0.8%	74	19	70	17	5.4%	10.5%
		W6-U		11.0	11.0	-0.1	-0.7%													
		W7-L W7-U W8-L W8-U		29.3	26.4	2.9	9.9%													
Seventh	R5	W9-L W9-U	Bedroom	25.6	22.9	2.8	10.8%	12.9	11.4	88%	9.8	76%	1.6	14.5%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10-L W10-U	Bedroom	23.3	20.5	2.8	12.1%	14.0	13.5	96%	13.2	94%	0.3	2.0%	45	13	39	10	13.3%	23.1%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Seventh	R7	W11-L	LKD	26.8	23.9	2.9	10.8%	26.6	26.3	99%	26.3	99%	0.0	0.0%	64	19	60	16	6.3%	15.8%
		W11-U																		
		W12-L																		
		W12-U																		
Seventh	R8	W13-L	Bedroom	27.3	24.7	2.6	9.6%	13.0	11.4	88%	11.4	88%	0.0	0.0%	34	8	34	8	0.0%	0.0%
		W13-U																		
		W14-L																		
		W14-U																		
Seventh	R9	W15-L	LKD	23.3	23.3	0.0	0.0%	23.5	23.2	99%	23.2	99%	0.0	0.0%	74	25	66	21	10.8%	16.0%
		W15-U																		
		W16-L																		
		W16-U																		
Seventh	R10	W17-L	LKD	25.9	22.7	3.3	12.6%	23.1	22.9	99%	22.8	99%	0.1	0.4%	65	22	57	17	12.3%	22.7%
		W17-U																		
		W18-L																		
		W18-U																		
Seventh	R11	W19-L	Bedroom	27.3	23.0	4.4	16.0%	15.3	14.4	94%	14.3	93%	0.2	1.1%	51	17	51	17	0.0%	0.0%
		W19-U																		
Seventh	R12	W20-L	Bedroom	20.6	19.9	0.7	3.3%	11.5	11.4	98%	10.9	94%	0.5	4.0%	81	23	71	18	12.3%	21.7%
		W20-U																		
		W21-L																		
Seventh	R13	W21-U	Bedroom	31.2	26.3	5.0	15.9%	12.0	11.5	96%	10.7	89%	0.8	6.9%	67	24	54	17	19.4%	29.2%
		W22-L																		
		W22-U																		
Seventh	R14	W23-L	Bedroom	26.7	20.8	5.9	22.0%	13.5	12.7	94%	10.6	78%	2.1	16.3%	81	24	67	16	17.3%	33.3%
		W23-U																		
Seventh	R15	W24-L	LKD	33.1	26.1	7.1	21.3%	33.5	33.2	99%	33.2	99%	0.0	0.1%	80	22	72	18	10.0%	18.2%
		W24-U																		
		W25-L																		
		W25-U																		
Eighth	R1	W26-L	LKD	34.7	32.8	1.9	5.5%	21.6	21.3	98%	21.3	98%	0.0	0.0%	54	15	54	15	0.0%	0.0%
		W26-U																		
		W1-L																		
		W1-U																		
Eighth	R2	W2-L	Bedroom	34.9	34.9	0.0	0.0%	13.8	13.8	100%	13.8	100%	0.0	0.0%	68	18	68	18	0.0%	0.0%
		W2-U																		
		W3-L																		
Eighth	R3	W3-U	Bedroom	25.2	25.2	0.0	0.0%	14.2	14.1	99%	14.1	99%	0.0	0.0%	79	22	75	20	5.1%	9.1%
		W4-L																		
		W4-U																		
Eighth	R4	W5-L	LKD	31.8	29.6	2.2	6.9%	22.1	22.0	100%	22.0	100%	0.0	0.0%	75	20	69	17	8.0%	15.0%
		W5-U																		
		W6-L																		
Eighth	R4	W6-U	LKD	31.9	29.2	2.7	8.5%	22.1	22.0	100%	22.0	100%	0.0	0.0%	75	20	69	17	8.0%	15.0%
		W6-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Eighth	R5	W7-L W7-U	Bedroom	26.5	23.7	2.9	10.8%	9.3	8.5	91%	8.0	86%	0.5	6.0%	50	13	45	10	10.0%	23.1%
Eighth	R6	W8-L	LKD	30.5	27.4	3.1	10.1%	28.6	28.2	99%	28.2	99%	0.0	0.0%	66	17	62	14	6.1%	17.6%
		W8-U		31.1	28.6	2.6	8.2%													
		W9-L		31.2	28.9	2.4	7.7%													
		W9-U		31.2	28.9	2.4	7.7%													
Eighth	R7	W10-L	LKD	31.2	28.9	2.4	7.7%	33.8	33.7	100%	33.7	100%	0.0	0.0%	84	25	76	20	9.5%	20.0%
		W10-U		31.2	28.9	2.4	7.7%													
		W11-L		17.8	17.8	0.0	0.0%													
		W11-U		31.9	31.9	0.0	0.0%													
Eighth	R8	W12-L	Bedroom	32.2	27.7	4.6	14.2%	12.5	11.9	95%	11.9	95%	0.0	0.0%	68	22	60	17	11.8%	22.7%
		W12-U		30.1	25.1	5.0	16.6%													
		W13-L		21.9	21.1	0.8	3.8%													
		W13-U		34.1	27.6	6.5	19.1%													
Eighth	R9	W14-L	Bedroom	34.1	27.6	6.5	19.1%	14.0	12.4	89%	11.9	85%	0.5	4.2%	51	18	51	18	0.0%	0.0%
		W14-U		26.2	26.2	0.0	0.0%													
		W15-L		26.2	26.2	0.0	0.0%													
		W15-U		34.1	27.6	6.5	19.1%													
Eighth	R10	W16-L	Bedroom	34.1	27.6	6.5	19.1%	13.0	12.9	100%	12.2	94%	0.7	5.7%	89	26	78	19	12.4%	26.9%
		W16-U		34.3	27.4	6.9	20.0%													
		W17-L		34.3	27.4	6.9	20.0%													
		W17-U		34.3	27.4	6.9	20.0%													
Eighth	R11	W18-L	Bedroom	34.3	27.4	6.9	20.0%	11.4	10.9	95%	10.3	90%	0.6	5.8%	83	26	70	19	15.7%	26.9%
		W18-U		33.3	26.2	7.1	21.3%													
		W19-L		33.3	26.2	7.1	21.3%													
		W19-U		33.3	26.2	7.1	21.3%													
Eighth	R12	W20-L	LKD	33.3	26.2	7.1	21.3%	8.3	7.9	96%	7.4	89%	0.5	6.8%	70	22	57	14	18.6%	36.4%
		W20-U		34.5	27.2	7.2	21.0%													
		W21-L		34.5	27.2	7.2	21.0%													
		W21-U		34.5	27.2	7.2	21.0%													
Ninth	R2	W2-L	LKD	34.5	27.2	7.2	21.0%	28.5	28.2	99%	28.2	99%	0.0	0.0%	80	24	72	19	10.0%	20.8%
		W2-U		31.4	31.4	0.0	0.0%													
		W3-L		31.4	31.4	0.0	0.0%													
		W3-U		31.4	31.4	0.0	0.0%													
Ninth	R3	W4-L	Bedroom	35.0	35.0	0.0	0.0%	33.0	30.5	92%	30.5	92%	0.0	0.0%	54	14	54	14	0.0%	0.0%
		W4-U		35.1	35.1	0.0	0.0%													
		W5-L		35.1	35.1	0.0	0.0%													
		W5-U		35.1	35.1	0.0	0.0%													
Ninth	R5	W7-L	Bedroom	33.5	29.2	4.3	12.9%	14.6	13.6	93%	13.6	93%	0.0	0.0%	90	24	82	19	8.9%	20.8%
		W7-U		25.4	24.2	1.3	4.9%													
		W8-L		25.4	24.2	1.3	4.9%													
		W8-U		25.4	24.2	1.3	4.9%													
Ninth	R6	W9-L	Bedroom	25.4	24.2	1.3	4.9%	13.8	8.4	60%	6.3	45%	2.1	25.2%	58	19	57	19	1.7%	0.0%
		W9-U		30.9	30.9	0.0	0.0%													
		W9-L		30.9	30.9	0.0	0.0%													
		W9-U		30.9	30.9	0.0	0.0%													
Ninth	R6	W9-L	Bedroom	30.9	30.9	0.0	0.0%	13.3	12.0	90%	11.5	86%	0.5	4.2%	91	26	81	19	11.0%	26.9%
		W9-U		34.5	28.3	6.2	18.0%													
		W9-L		34.5	28.3	6.2	18.0%													
		W9-U		34.5	28.3	6.2	18.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Ninth	R7	W10-L W10-U	Bedroom	34.7	28.2	6.5	18.8%	11.1	10.8	97%	9.7	87%	1.1	10.2%	83	27	72	20	13.3%	25.9%
Ninth	R8	W11-L	LKD	34.8	28.0	6.9	19.7%	31.6	31.5	100%	31.5	100%	0.0	0.0%	81	24	71	18	12.3%	25.0%
		W11-U		16.6	14.7	1.9	11.2%													
		W12-L W12-U W13-L W13-U		15.7	15.5	0.2	1.4%													
West Apartments																				
First	R1	W1-L	LKD	13.4	13.4	0.0	0.0%	30.8	12.6	41%	12.6	41%	0.0	0.0%	27	2	27	2	0.0%	0.0%
		W1-U		4.9	4.9	0.0	0.0%													
		W2-L W2-U W7-L W7-U		0.0	0.0	0.0	0.0%													
First	R2	W3-L	LKD	0.0	0.0	0.0	0.0%	30.8	8.1	26%	8.1	26%	0.0	0.0%	32	2	32	2	0.0%	0.0%
		W3-U		17.3	17.3	0.0	0.0%													
		W4-L W4-U W6-L W6-U		0.0	0.0	0.0	0.0%													
First	R3	W5-L W5-U	Bedroom	15.5	12.9	2.7	17.1%	12.8	6.6	51%	5.2	41%	1.4	21.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R4	W8-L W8-U	Bedroom	9.0	8.6	0.4	4.3%	12.8	4.2	33%	4.8	37%	-0.6	-14.3%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W9-L W9-U	Bedroom	1.4	2.0	-0.6	-41.4%	12.3	1.4	12%	2.1	17%	-0.7	-45.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R6	W10-L W10-U	Bedroom	11.2	7.7	3.5	30.9%	13.7	10.0	73%	10.0	73%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R7	W11-L	LKD	8.0	4.7	3.4	42.0%	28.4	22.5	79%	22.5	79%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
		W11-U		8.2	5.5	2.7	33.0%													
		W12-L W12-U																		
First	R8	W13-L W13-U	Bedroom	17.2	14.1	3.1	18.0%	14.0	12.7	91%	12.7	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R9	W14-L	LKD	13.2	10.0	3.2	24.1%	28.4	22.9	80%	22.8	80%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-U		9.4	7.4	2.0	21.2%													
		W15-L W15-U																		
First	R10	W16-L W16-U	Bedroom	7.5	5.8	1.7	22.4%	9.7	6.5	66%	5.7	58%	0.8	12.0%	N/F	N/F	N/F	N/F	N/F	N/F
First	R11	W17-L W17-U	Bedroom	7.6	6.2	1.4	17.9%	35.6	22.2	62%	26.4	74%	-4.1	-18.6%	N/F	N/F	N/F	N/F	N/F	N/F

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Fourth	R7	W10-U	LKD					13.7	13.6	99%	13.6	99%	0.0	-0.2%	N/F	N/F	N/F	N/F	N/F	N/F
		W11-L		22.4	18.7	3.7	16.4%													
		W11-U																		
		W12-L		19.4	15.8	3.6	18.4%													
Fourth	R8	W12-U	Bedroom					28.4	26.0	92%	24.1	85%	1.9	7.2%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-L		27.2	23.4	3.8	13.8%													
Fourth	R9	W13-U	LKD					14.0	13.8	99%	13.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-L		22.6	19.2	3.4	14.9%													
Fourth	R10	W14-U	Bedroom																	
		W15-L		18.6	15.8	2.8	15.2%													
		W15-U						28.4	25.5	90%	23.1	81%	2.4	9.6%	N/F	N/F	N/F	N/F	N/F	N/F
		W16-L		11.6	9.1	2.5	21.8%													
Fourth	R11	W16-U	Bedroom					9.7	8.3	85%	7.1	73%	1.2	14.9%	N/F	N/F	N/F	N/F	N/F	N/F
		W17-L		12.1	9.8	2.3	18.6%													
Fifth	R1	W17-U	LKD					35.6	24.5	69%	27.6	77%	-3.1	-12.6%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-L		12.5	12.5	0.0	0.0%													
		W1-U																		
		W2-L		32.1	28.3	3.9	12.0%													
		W2-U																		
		W3-L		27.5	23.6	3.9	14.3%													
Fifth	R3	W3-U	Bedroom																	
		W4-L		23.4	19.3	4.1	17.4%													
		W4-U						35.2	30.1	86%	30.1	86%	0.0	0.0%	32	4	32	4	0.0%	0.0%
		W6-L		32.6	28.7	3.9	11.8%													
		W6-U						11.5	11.4	99%	11.5	99%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R4	W7-L	LKD	26.9	23.1	3.9	14.3%													
		W7-U																		
		W8-L		23.2	19.3	3.9	16.9%													
Fifth	R5	W8-U	Bedroom					29.6	27.2	92%	25.4	86%	1.9	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L		30.9	27.1	3.8	12.2%													
Fifth	R6	W9-U	LKD					11.7	11.6	99%	11.6	99%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-L		25.8	22.4	3.4	13.3%													
		W10-U																		
		W11-L		21.8	18.7	3.1	14.3%													
Fifth	R7	W11-U	LKD					29.6	26.8	91%	25.0	84%	1.9	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
		W12-L		14.0	11.8	2.2	15.5%													
Sixth	R1	W12-U	LKD					46.5	39.2	84%	41.8	90%	-2.6	-6.8%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-L		13.1	13.1	0.0	0.0%													
		W1-U																		
		W2-L		34.1	30.1	4.0	11.6%													
		W2-U																		
		W3-L		22.4	19.5	2.8	12.6%													
Sixth	R1	W3-U	LKD																	
		W4-L		23.9	19.7	4.2	17.6%													
		W4-U																		
								35.2	29.7	85%	29.7	85%	0.0	0.0%	34	6	34	6	0.0%	0.0%

[illegible]

[illegible]

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Eleventh	R5	W10-L W10-U	Bedroom	37.4	35.2	2.2	5.8%	13.5	13.1	97%	13.0	97%	0.1	0.4%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R6	W11-L W11-U W12-L W12-U W13-L W13-U	LKD	9.2	7.1	2.2	23.6%													
Twelfth	R1	W1-L W1-U W2-L W2-U W3-L W3-U	LKD	38.6	38.6	0.0	0.0%	34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R2	W4 W5-L W5-U W6-L W6-U W7-L W7-U	LKD	22.5 37.8	22.5 36.3	0.0 1.6	0.0% 4.2%													
Twelfth	R3	W8-L W8-U	Bedroom	7.7	6.0	1.7	22.1%	11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W9-L W9-U	Bedroom	37.7	35.8	1.9	5.0%	13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W10-L W10-U	Bedroom	37.7	35.7	2.0	5.3%	13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R6	W11-L W11-U W12-L W12-U W13-L W13-U	LKD	9.4 37.3 38.3	7.4 37.1 38.1	2.0 0.1 0.2	21.6% 0.4% 0.4%	33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
Thirteenth	R1	W1-L W1-U W2-L W2-U W3-L W3-U	LKD	38.6 9.4 28.3	38.6 8.2 27.0	0.0 1.2 1.3	0.0% 12.3% 4.6%													
Thirteenth	R2	W4 W5-L W5-U W6-L W6-U W7-L W7-U	LKD	22.7 38.1 38.0 2.7	22.7 36.6 36.5 2.7	0.0 1.5 1.5 0.0	0.0% 3.8% 4.0% 0.0%	29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
Thirteenth	R3	W8-L	Bedroom	7.8	6.2	1.6	20.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Thirteenth	R4	W8-U	Bedroom	37.9	36.2	1.8	4.6%	11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L						13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
	W9-U																			
Thirteenth	R5	W10-L W10-U	Bedroom	37.9	36.0	1.9	4.9%	13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R6	W11-L	LKD	9.5	7.6	1.9	19.6%	33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
		W11-U		37.4	37.3	0.1	0.3%													
		W12-L		38.4	38.3	0.1	0.4%													
		W12-U																		
Thirteenth	R6	W13-L	LKD	38.4	38.3	0.1	0.4%	33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
		W13-U																		
		W11-L		38.6	38.6	0.0	0.0%													
		W11-U																		
Fourteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%	34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-U		9.5	8.4	1.1	11.2%													
		W2-L		28.4	27.2	1.2	4.1%													
		W2-U																		
Fourteenth	R1	W3-L	LKD	28.4	27.2	1.2	4.1%	34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-U																		
		W4		23.0	23.0	0.0	0.0%													
		W5-L		38.2	36.9	1.3	3.4%													
Fourteenth	R2	W5-U	LKD	38.2	36.8	1.4	3.7%	29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
		W6-L		2.8	2.8	0.0	0.0%													
		W6-U																		
		W7-L																		
Fourteenth	R2	W7-U	LKD	2.8	2.8	0.0	0.0%	29.5	27.3	92%	27.1	92%	0.2	0.6%	46	12	45	12	2.2%	0.0%
		W7-L																		
		W7-U																		
		W7-U																		
Fourteenth	R3	W8-L	Bedroom	7.8	6.4	1.4	18.0%	11.9	10.9	92%	10.9	92%	0.0	0.2%	N/F	N/F	N/F	N/F	N/F	N/F
		W8-U																		
Fourteenth	R4	W9-L	Bedroom	38.1	36.5	1.6	4.2%	13.1	12.8	98%	12.8	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-U																		
Fourteenth	R5	W10-L	Bedroom	38.1	36.4	1.7	4.4%	13.5	13.1	97%	13.1	97%	0.0	0.3%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-U																		
Fourteenth	R6	W11-L	LKD	9.5	7.9	1.7	17.6%	33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
		W11-U		37.6	37.5	0.1	0.3%													
		W12-L		38.6	38.4	0.1	0.3%													
		W12-U																		
Fourteenth	R6	W13-L	LKD	38.6	38.4	0.1	0.3%	33.6	30.4	90%	30.4	90%	0.0	0.0%	90	28	88	28	2.2%	0.0%
		W13-U																		
		W11-L		38.6	38.6	0.0	0.0%													
		W11-U																		
Fifteenth	R1	W1-L	LKD	38.6	38.6	0.0	0.0%	34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-U		9.5	8.6	0.9	10.0%													
		W2-L		28.8	27.8	1.1	3.6%													
		W2-U																		
Fifteenth	R1	W3-L	LKD	28.8	27.8	1.1	3.6%	34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-U																		
		W4		24.5	24.5	0.0	0.0%													
		W5-L		38.4	37.2	1.2	3.1%													
Fifteenth	R2	W5-U	LKD	38.4	37.1	1.3	3.3%	34.2	33.3	97%	33.3	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-L																		

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Fourth	R4	W6-U	LKD	18.5	19.2	-0.8	-4.1%	32.0	21.6	68%	24.2	76%	-2.5	-11.8%	11	2	11	2	0.0%	0.0%
		W7-L																		
		W7-U																		
		W8-L																		
Fourth	R5	W8-U	Bedroom	1.6	2.2	-0.5	-33.3%	34.0	16.6	49%	21.0	62%	-4.4	-26.6%	11	1	11	1	0.0%	0.0%
		W9-L																		
		W9-U																		
		W10-L																		
Fourth	R6	W10-U	LKD	21.2	21.8	-0.6	-3.1%	44.5	35.5	80%	35.6	80%	-0.2	-0.4%	N/F	N/F	N/F	N/F	N/F	N/F
		W11-L																		
		W11-U																		
		W12-L																		
Fourth	R7	W12-U	Bedroom	25.0	24.7	0.3	1.0%	9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-L																		
		W13-U																		
		W14-L																		
Fourth	R8	W14-U	Bedroom	18.4	18.4	0.0	0.2%	9.5	9.3	98%	9.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-L																		
		W15-U																		
		W16-L																		
Fourth	R9	W16-U	Bedroom	32.4	32.4	0.0	0.0%	18.0	16.7	93%	16.7	93%	0.0	0.0%	30	2	29	2	3.3%	0.0%
		W17-L																		
		W17-U																		
		W18-L																		
Fifth	R1	W18-U	LKD	33.2	33.2	0.0	0.0%	38.7	28.1	72%	23.0	59%	5.0	18.0%	27	8	27	8	0.0%	0.0%
		W19-L																		
		W19-U																		
		W2-L																		
Fifth	R2	W2-U	Bedroom	12.4	12.4	0.0	0.2%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-L																		
		W3-U																		
		W4-L																		
Fifth	R3	W4-U	LKD	2.3	1.1	1.2	53.1%	32.0	25.1	79%	25.1	79%	0.0	-0.1%	16	3	16	3	0.0%	0.0%
		W5-L																		
		W5-U																		
		W6-L																		
Fifth	R4	W6-U	LKD	20.7	20.5	0.3	1.2%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W7-L																		
		W7-U																		
		W8-L																		
Fifth	R5	W8-U	Bedroom	2.7	2.1	0.6	22.5%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L																		
		W9-U																		
		W10-L																		
Fifth	R6	W10-U	LKD	24.6	25.0	-0.3	-1.4%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W11-L																		
		W11-U																		
		W12-L																		
Fifth	R7	W12-U	Bedroom	23.0	23.3	-0.2	-1.0%	9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-L																		
		W13-U																		
		W14-L																		
Fifth	R8	W14-U	LKD	18.4	18.4	0.0	0.2%	9.5	9.3	98%	9.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-L																		
		W15-U																		
		W16-L																		
Fifth	R9	W16-U	Bedroom	32.4	32.4	0.0	0.0%	18.0	16.7	93%	16.7	93%	0.0	0.0%	30	2	29	2	3.3%	0.0%
		W17-L																		
		W17-U																		
		W18-L																		
Fifth	R1	W18-U	LKD	33.2	33.2	0.0	0.0%	38.7	28.1	72%	23.0	59%	5.0	18.0%	27	8	27	8	0.0%	0.0%
		W19-L																		
		W19-U																		
		W2-L																		
Fifth	R2	W2-U	Bedroom	12.4	12.4	0.0	0.2%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-L																		
		W3-U																		
		W4-L																		
Fifth	R3	W4-U	LKD	2.3	1.1	1.2	53.1%	32.0	25.1	79%	25.1	79%	0.0	-0.1%	16	3	16	3	0.0%	0.0%
		W5-L																		
		W5-U																		
		W6-L																		
Fifth	R4	W6-U	LKD	20.7	20.5	0.3	1.2%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W7-L																		
		W7-U																		
		W8-L																		
Fifth	R5	W8-U	Bedroom	2.7	2.1	0.6	22.5%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L																		
		W9-U																		
		W10-L																		
Fifth	R6	W10-U	LKD	24.6	25.0	-0.3	-1.4%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W11-L																		
		W11-U																		
		W12-L																		
Fifth	R7	W12-U	Bedroom	23.0	23.3	-0.2	-1.0%	9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-L																		
		W13-U																		
		W14-L																		
Fifth	R8	W14-U	LKD	18.4	18.4	0.0	0.2%	9.5	9.3	98%	9.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-L																		
		W15-U																		
		W16-L																		
Fifth	R9	W16-U	Bedroom	32.4	32.4	0.0	0.0%	18.0	16.7	93%	16.7	93%	0.0	0.0%	30	2	29	2	3.3%	0.0%
		W17-L																		
		W17-U																		
		W18-L																		
Fifth	R1	W18-U	LKD	33.2	33.2	0.0	0.0%	38.7	28.1	72%	23.0	59%	5.0	18.0%	27	8	27	8	0.0%	0.0%
		W19-L																		
		W19-U																		
		W2-L																		
Fifth	R2	W2-U	Bedroom	12.4	12.4	0.0	0.2%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-L																		
		W3-U																		
		W4-L																		
Fifth	R3	W4-U	LKD	2.3	1.1	1.2	53.1%	32.0	25.1	79%	25.1	79%	0.0	-0.1%	16	3	16	3	0.0%	0.0%
		W5-L																		
		W5-U																		
		W6-L																		
Fifth	R4	W6-U	LKD	20.7	20.5	0.3	1.2%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W7-L																		
		W7-U																		
		W8-L																		
Fifth	R5	W8-U	Bedroom	2.7	2.1	0.6	22.5%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L																		
		W9-U																		
		W10-L																		
Fifth	R6	W10-U	LKD	24.6	25.0	-0.3	-1.4%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W11-L																		
		W11-U																		
		W12-L																		
Fifth	R7	W12-U	Bedroom	23.0	23.3	-0.2	-1.0%	9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-L																		
		W13-U																		
		W14-L																		
Fifth	R8	W14-U	LKD	18.4	18.4	0.0	0.2%	9.5	9.3	98%	9.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-L																		
		W15-U																		
		W16-L																		
Fifth	R9	W16-U	Bedroom	32.4	32.4	0.0	0.0%	18.0	16.7	93%	16.7	93%	0.0	0.0%	30	2	29	2	3.3%	0.0%
		W17-L																		
		W17-U																		
		W18-L																		
Fifth	R1	W18-U	LKD	33.2	33.2	0.0	0.0%	38.7	28.1	72%	23.0	59%	5.0	18.0%	27	8	27	8	0.0%	0.0%
		W19-L																		
		W19-U																		
		W2-L																		
Fifth	R2	W2-U	Bedroom	12.4	12.4	0.0	0.2%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-L																		
		W3-U																		
		W4-L																		
Fifth	R3	W4-U	LKD	2.3	1.1	1.2	53.1%	32.0	25.1	79%	25.1	79%	0.0	-0.1%	16	3	16	3	0.0%	0.0%
		W5-L																		
		W5-U																		
		W6-L																		
Fifth	R4	W6-U	LKD	20.7	20.5	0.3	1.2%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W7-L																		
		W7-U																		
		W8-L																		
Fifth	R5	W8-U	Bedroom	2.7	2.1	0.6	22.5%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L																		
		W9-U																		
		W10-L																		
Fifth	R6	W10-U	LKD	24.6	25.0	-0.3	-1.4%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W11-L																		
		W11-U																		
		W12-L																		
Fifth	R7	W12-U	Bedroom	23.0	23.3	-0.2	-1.0%	9.1	8.6	94%	8.6	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-L																		
		W13-U																		
		W14-L																		
Fifth	R8	W14-U	LKD	18.4	18.4	0.0	0.2%	9.5	9.3	98%	9.3	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-L																		
		W15-U																		
		W16-L																		
Fifth	R9	W16-U	Bedroom	32.4	32.4	0.0	0.0%	18.0	16.7	93%	16.7	93%	0.0	0.0%	30	2	29	2	3.3%	0.0%
		W17-L																		
		W17-U																		
		W18-L																		
Fifth	R1	W18-U	LKD	33.2	33.2	0.0	0.0%	38.7	28.1	72%	23.0	59%	5.0	18.0%	27	8	27	8	0.0%	0.0%
		W19-L																		
		W19-U																		
		W2-L																		
Fifth	R2	W2-U	Bedroom	12.4	12.4	0.0	0.2%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-L																		
		W3-U																		
		W4-L																		
Fifth	R3	W4-U	LKD	2.3	1.1	1.2	53.1%	32.0	25.1	79%	25.1	79%	0.0	-0.1%	16	3	16	3	0.0%	0.0%
		W5-L																		
		W5-U																		
		W6-L																		
Fifth	R4	W6-U	LKD	20.7	20.5	0.3	1.2%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W7-L																		
		W7-U																		
		W8-L																		
Fifth	R5	W8-U	Bedroom	2.7	2.1	0.6	22.5%	12.2	9.9	81%	9.9	81%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-L																		
		W9-U																		
		W10-L																		
Fifth	R6	W10-U	LKD	24.6	25.0	-0.3	-1.4%	34.0	23.7	70%	28.4	83%	-4.7	-20.0%	15	2	16	2	-6.7%	0.0%
		W11-L																		
		W11-U																		
		W12-L																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Fifth	R5	W11-L W11-U	Bedroom	26.2	26.3	-0.1	-0.3%	12.2	11.5	94%	11.5	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W12-L	LKD	27.8	27.6	0.3	1.0%	44.6	37.6	84%	37.9	85%	-0.2	-0.6%	N/F	N/F	N/F	N/F	N/F	N/F
		W12-U		29.2	28.4	0.8	2.6%													
		W13-L		35.7	35.7	0.0	0.0%													
		W13-U		35.5	35.5	0.0	0.0%													
		W14-L																		
W14-U																				
W15-L	35.5	35.5	0.0	0.0%																
W15-U																				
Fifth	R7	W16-L W16-U	Bedroom	35.1	35.1	0.0	0.0%	9.4	8.6	92%	8.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R8	W17-L W17-U	Bedroom	32.7	32.7	0.0	0.0%	12.1	11.6	96%	11.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R9	W18-L	Bedroom	21.3	21.3	0.0	0.0%	14.3	14.3	100%	14.3	100%	0.0	0.0%	38	3	37	3	2.6%	0.0%
		W18-U		28.1	28.1	0.0	0.0%													
		W19-L																		
W19-U																				
Sixth	R1	W1-L	Bedroom	13.4	13.3	0.1	0.4%	11.7	8.9	76%	8.0	69%	0.9	9.7%	30	10	30	10	0.0%	0.0%
		W1-U		17.4	16.9	0.5	2.9%													
W2-L																				
W2-U																				
Sixth	R2	W3-L W3-U	Bedroom	19.9	18.3	1.6	7.9%	12.1	8.7	71%	8.4	69%	0.3	3.6%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R3	W4-L W4-U	Bedroom	4.6	3.1	1.5	32.5%	12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R4	W5-L	LKD	0.0	0.0	0.0	0.0%	32.1	28.5	89%	28.5	89%	0.0	0.0%	20	3	19	3	5.0%	0.0%
		W5-U		24.0	22.8	1.2	5.0%													
		W6-L		25.5	24.7	0.8	3.1%													
		W6-U																		
W7-L																				
W7-U																				
Sixth	R5	W8-L	LKD	6.2	5.3	0.9	14.9%	31.3	30.7	98%	30.7	98%	0.0	0.0%	23	1	22	1	4.3%	0.0%
		W8-U		0.6	0.7	-0.1	-9.5%													
		W9-L		28.7	28.2	0.5	1.8%													
		W9-U		35.3	34.6	0.7	1.9%													
		W10-L																		
W10-U																				
W11-L																				
W11-U																				
Sixth	R6	W12-L W12-U	Bedroom	35.9	35.0	1.0	2.8%	13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R7	W13-L W13-U	Bedroom	36.4	35.3	1.1	3.1%	11.8	11.4	97%	11.4	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																			
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction														
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter													
Sixth	R8	W14-L	Bedroom	35.4	35.3	0.0	0.1%	14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W14-U		30.4	30.4	0.0	0.1%																										
		W15-L																															
		W15-U																															
Sixth	R9	W16-L	LKD	25.6	25.6	0.0	0.0%	36.0	29.0	80%	29.0	80%	0.0	0.0%	38	3	37	3	2.6%	0.0%													
		W16-U		28.7	28.7	0.0	0.0%																										
		W17-L																															
		W17-U																															
Seventh	R1	W1-L	Bedroom	14.8	14.8	0.1	0.5%	11.7	9.0	77%	8.7	74%	0.3	3.0%	29	9	29	9	0.0%	0.0%													
		W1-U		19.0	18.2	0.8	4.1%																										
		W2-L																															
		W2-U																															
Seventh	R2	W3-L	Bedroom	21.3	19.4	1.9	9.0%	12.1	6.2	51%	5.2	43%	1.1	17.0%	N/F	N/F	N/F	N/F	N/F	N/F													
W3-U																																	
Seventh	R3	W4-L	Bedroom	3.6	1.6	2.0	55.6%	12.4	10.3	83%	10.3	83%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
W4-U																																	
Seventh	R4	W5-L	LKD	0.0	0.0	0.0	0.0%	32.1	26.0	81%	26.0	81%	0.1	0.3%	21	3	19	3	9.5%	0.0%													
		W5-U		26.3	24.2	2.1	7.9%																										
		W6-L																															
		W6-U																															
Seventh	R5	W7-L	LKD	28.0	25.9	2.1	7.3%	31.3	30.7	98%	30.6	98%	0.1	0.2%	27	3	26	3	3.7%	0.0%													
		W7-U																															
		W8-L		5.2	3.3	1.9	35.8%														0.0	0.0	0.0	0.0%									
		W8-U																															
W9-L																																	
Seventh	R6	W9-U	Bedroom	31.3	29.3	2.1	6.5%	13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W10-L		37.1	35.4	1.7	4.6%																										
		W10-U																															
		W11-L																															
Seventh	R7	W11-U	Bedroom	37.4	35.9	1.5	4.1%	11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W12-L																															
Seventh	R8	W12-U	Bedroom	37.6	36.1	1.4	3.8%	14.9	14.9	100%	14.8	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F													
		W13-L																															
Seventh	R9	W13-U	LKD	37.7	36.3	1.3	3.6%	36.0	30.2	84%	30.2	84%	0.0	0.0%	43	5	42	5	2.3%	0.0%													
		W14-L		34.2	34.2	0.0	0.1%																										
		W14-U																															
		W15-L																															
Seventh	R9	W15-U	LKD	22.5	22.5	0.0	0.1%	36.0	30.2	84%	30.2	84%	0.0	0.0%	43	5	42	5	2.3%	0.0%													
		W16-L		30.6	30.6	0.0	0.0%																										
		W16-U																															
		W17-L																															
Seventh	R9	W17-U	LKD	29.3	29.3	0.0	0.0%	36.0	30.2	84%	30.2	84%	0.0	0.0%	43	5	42	5	2.3%	0.0%													
		W18-L																															
		W18-U																															

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Ninth	R5	W5-U	LKD	28.7	26.9	1.8	6.4%	32.1	26.7	83%	26.6	83%	0.1	0.3%	26	3	24	3	7.7%	0.0%
		W6-L																		
		W6-U																		
		W7-L																		
		W7-U																		
		W8-L																		
		W8-U																		
		W9-L																		
Ninth	R6	W9-U	Bedroom	0.1	0.1	0.0	0.0%	13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-L																		
		W10-U																		
		W11-L																		
		W11-U																		
		W12-L																		
		W12-U																		
		W13-L																		
Ninth	R7	W13-U	Bedroom	38.5	37.3	1.3	3.3%	11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-L																		
		W14-U																		
		W15-L																		
		W15-U																		
		W16-L																		
		W16-U																		
		W17-L																		
Ninth	R8	W17-U	Bedroom	38.6	37.4	1.2	3.1%	14.9	14.9	100%	14.8	99%	0.1	0.7%	N/F	N/F	N/F	N/F	N/F	N/F
		W18-L																		
		W18-U																		
		W19-L																		
		W19-U																		
		W20-L																		
		W20-U																		
		W21-L																		
Tenth	R1	W21-U	Bedroom	19.7	19.7	0.1	0.3%	11.7	9.0	77%	8.7	74%	0.3	3.3%	36	10	36	10	0.0%	0.0%
		W2-L																		
		W2-U																		
		W3-L																		
		W3-U																		
		W4-L																		
		W4-U																		
		W5-L																		
Tenth	R2	W5-U	Bedroom	26.6	24.9	1.7	6.4%	12.1	9.6	79%	9.5	78%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-L																		
		W6-U																		
		W7-L																		
		W7-U																		
		W8-L																		
		W8-U																		
		W9-L																		
Tenth	R3	W9-U	Bedroom	5.7	4.1	1.6	28.4%	12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-L																		
		W10-U																		
		W11-L																		
		W11-U																		
		W12-L																		
		W12-U																		
		W13-L																		
Tenth	R4	W13-U	LKD	0.9	0.9	0.0	0.0%	32.1	29.4	92%	29.4	92%	0.0	0.0%	29	3	27	3	6.9%	0.0%
		W6-L																		
		W6-U																		
		W7-L																		
		W7-U																		
		W8-L																		
		W8-U																		
		W9-L																		
Tenth	R5	W9-U	LKD	1.9	1.9	0.0	0.0%													
		W10-L																		
		W10-U																		
		W11-L																		
		W11-U																		
		W12-L																		
		W12-U																		
		W13-L																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Tenth	R6	W11-L	Bedroom	38.6	37.3	1.4	3.5%	31.3	30.8	98%	30.8	98%	0.0	0.0%	33	4	32	4	3.0%	0.0%
		W11-U																		
		W12-L	Bedroom	38.8	37.5	1.3	3.3%	13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W12-U																		
Tenth	R7	W13-L	Bedroom	38.9	37.8	1.2	3.0%	11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
Tenth	R8	W14-L	Bedroom	37.6	37.6	0.0	0.1%	14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W14-U																		
Tenth	R9	W15-L	LKD	32.6	32.5	0.0	0.1%	36.0	29.3	81%	29.3	81%	0.0	0.0%	49	8	49	8	0.0%	0.0%
		W15-U																		
		W16-L																		
		W16-U																		
		W17-L		34.7	34.7	0.0	0.0%	36.0	29.3	81%	29.3	81%	0.0	0.0%	49	8	49	8	0.0%	0.0%
		W17-U																		
		W18-L		33.7	33.7	0.0	0.0%	36.0	29.3	81%	29.3	81%	0.0	0.0%	49	8	49	8	0.0%	0.0%
		W18-U																		
Eleventh	R1	W1-L	Bedroom	22.2	22.1	0.1	0.3%	11.7	10.3	88%	10.3	88%	0.0	0.0%	39	9	39	9	0.0%	0.0%
		W1-U																		
		W2-L		27.0	26.4	0.6	2.1%	12.1	9.2	75%	8.9	74%	0.2	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
		W2-U																		
Eleventh	R2	W3-L	Bedroom	28.5	27.1	1.4	4.9%	12.4	10.8	87%	10.8	87%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W3-U																		
Eleventh	R3	W4-L	Bedroom	4.4	2.9	1.5	34.2%	32.1	27.9	87%	27.9	87%	0.1	0.3%	31	4	29	4	6.5%	0.0%
		W4-U																		
Eleventh	R4	W5-L	LKD	0.5	0.5	0.0	0.0%	31.3	30.7	98%	30.7	98%	0.1	0.2%	34	4	33	4	2.9%	0.0%
		W5-U																		
		W6-L																		
		W6-U																		
		W7-L		33.2	31.6	1.6	4.7%	31.3	30.7	98%	30.7	98%	0.1	0.2%	34	4	33	4	2.9%	0.0%
		W7-U																		
Eleventh	R5	W8-L	LKD	6.2	4.8	1.4	22.7%	13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W8-U																		
		W9-L																		
		W9-U																		
		W10-L		35.4	33.8	1.6	4.4%	11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-U																		
		W11-L		38.9	37.6	1.3	3.4%	11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W11-U																		
Eleventh	R6	W12-L	Bedroom	39.1	37.9	1.2	3.0%	13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W12-U																		
Eleventh	R7	W13-L	Bedroom	39.1	38.0	1.1	2.8%	11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
Eleventh	R8	W14-L	Bedroom	39.2	38.2	1.0	2.7%	36.0	36.0	0.0	0.1%									
		W14-U																		
		W15-L																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Eleventh	R9	W15-U						14.9	14.9	100%	14.8	99%	0.1	0.8%	N/F	N/F	N/F	N/F	N/F	N/F
		W16-L	LKD	24.3	24.3	0.0	0.1%													
		W16-U																		
		W17-L		36.5	36.5	0.0	0.0%													
		W17-U																		
Twelfth	R1	W18-L		35.9	35.9	0.0	0.0%	36.0	30.3	84%	30.3	84%	0.0	0.0%	56	14	56	14	0.0%	0.0%
		W18-U																		
		W1-L	Bedroom	24.6	24.6	0.1	0.2%													
		W1-U																		
		W2-L		30.2	29.6	0.6	2.0%	11.7	11.6	99%	11.6	99%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Twelfth	R2	W2-U																		
		W3-L	Bedroom	31.5	30.1	1.4	4.5%	12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W3-U																		
		W4-L	Bedroom	7.1	5.8	1.3	18.9%	12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R4	W4-U																		
		W5-L	LKD	2.6	2.6	0.0	0.0%													
		W5-U		34.0	32.5	1.5	4.3%													
		W6-L		34.9	33.5	1.4	4.0%	32.1	29.8	93%	29.8	93%	0.0	0.0%	33	4	31	4	6.1%	0.0%
		W6-U																		
Twelfth	R5	W7-L																		
		W7-U																		
		W8-L	LKD	9.0	7.7	1.4	15.0%													
		W8-U		3.4	3.4	0.0	0.0%													
		W9-L		36.6	35.2	1.4	3.9%													
Twelfth	R6	W9-U		39.2	38.0	1.2	3.0%	31.3	30.8	98%	30.8	98%	0.0	0.0%	35	5	34	5	2.9%	0.0%
		W10-L																		
		W10-U																		
		W11-L																		
		W11-U																		
Twelfth	R7	W12-L	Bedroom	39.2	38.1	1.1	2.8%	13.1	12.5	96%	12.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W12-U																		
Twelfth	R8	W13-L	Bedroom	39.3	38.3	1.0	2.5%	11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W13-U																		
Twelfth	R9	W14-L	Bedroom	38.0	38.0	0.0	0.1%													
		W14-U		33.0	32.9	0.0	0.1%	14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-L																		
Thirteenth	R1	W15-U																		
		W16-L	LKD	28.1	28.0	0.0	0.1%													
		W16-U		37.8	37.8	0.0	0.0%													
		W17-L		37.4	37.4	0.0	0.0%	36.0	30.9	86%	30.9	86%	0.0	0.0%	56	14	56	14	0.0%	0.0%
		W17-U																		
Thirteenth	R1	W18-L																		
		W18-U																		
Thirteenth	R1	W1-L	Bedroom	27.4	27.2	0.1	0.5%													
		W1-U		33.5	32.8	0.7	2.0%													
Thirteenth	R1	W2-L																		
		W2-U																		

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Eighteenth	R3	W3-U	Bedroom					12.1	11.8	97%	11.8	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W4-L		13.0	12.4	0.5	4.2%													
		W4-U																		
Eighteenth	R4	W5	LKD	2.0	1.6	0.5	23.2%	12.4	12.4	100%	12.4	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-L		6.4	6.4	0.0	0.0%													
		W6-U																		
Eighteenth	R4	W7-L	LKD	39.1	38.5	0.6	1.5%													
		W7-U																		
		W8-L		39.1	38.6	0.5	1.4%													
Eighteenth	R5	W8-U	LKD					32.1	31.1	97%	31.1	97%	0.0	0.0%	39	9	39	9	0.0%	0.0%
		W9-L		13.5	13.0	0.5	4.0%													
		W9-U																		
Eighteenth	R5	W10	LKD	2.1	1.6	0.5	22.6%													
		W11-L		6.7	6.7	0.0	0.0%													
		W11-U																		
Eighteenth	R5	W12-L	LKD	39.2	38.7	0.6	1.5%													
		W12-U																		
		W13-L		39.6	39.1	0.5	1.2%													
Eighteenth	R6	W13-U	LKD					31.3	30.8	98%	30.8	98%	0.0	0.0%	40	10	40	10	0.0%	0.0%
		W14-L		39.6	39.2	0.5	1.1%													
		W14-U						13.1	12.6	96%	12.6	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighteenth	R7	W15-L	Bedroom																	
		W15-U		39.6	39.2	0.4	1.0%													
Eighteenth	R8	W16-L	Bedroom					11.8	11.3	96%	11.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W16-U		39.6	39.6	0.0	0.0%													
		W17-L																		
Eighteenth	R8	W17-U	Bedroom					14.9	14.6	98%	14.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W18-L		39.6	39.6	0.0	0.0%													
		W18-U																		
Eighteenth	R9	W19-L	LKD	39.5	39.5	0.0	0.0%													
		W19-U																		
		W20-L		39.5	39.5	0.0	0.0%													
Eighteenth	R9	W20-U	LKD					36.0	30.9	86%	30.9	86%	0.0	0.0%	58	15	58	15	0.0%	0.0%
		W21-L		4.4	4.4	0.0	-0.2%													
		W21-U																		
Mezzanine	R1	W2-L	Residential	4.9	5.2	-0.2	-4.5%													
		W2-U						37.9	35.7	94%	35.7	94%	0.0	0.0%	11	4	11	4	0.0%	0.0%
		W3-L																		
Millstream Tower																				
First	R1	W1-L	LKD																	
		W1-U		24.2	20.5	3.7	15.3%													
		W2-L		8.4	8.4	0.0	0.0%													
First	R2	W2-U	Bedroom					33.5	20.5	61%	19.3	57%	1.3	6.3%	7	0	7	0	0.0%	0.0%
		W3-L		19.0	15.7	3.4	17.6%													
		W3-U						14.8	11.0	74%	10.9	74%	0.1	0.5%	N/F	N/F	N/F	N/F	N/F	N/F
First	R3	W4-L	LKD	22.2	19.2	3.0	13.4%													

[illegible]

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room										
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction					
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter				
Fifth	R1	W23-L	LKD	1.1	1.1	0.0	0.0%	40.8	31.9	78%	31.3	77%	0.6	1.9%	19	7	19	7	0.0%	0.0%				
		W23-U		31.6	27.5	4.1	12.9%																	
		W1-L		11.1	11.1	0.0	-0.3%																	
Fifth	R2	W2-L	Bedroom	26.3	22.6	3.7	14.0%	33.5	31.4	94%	31.4	94%	0.0	0.0%	7	0	7	0	0.0%	0.0%				
		W2-U																			11.1	11.1	0.0	-0.3%
		W3-L																			14.8	13.8	93%	13.8
Fifth	R3	W3-U	LKD	29.9	26.6	3.3	11.2%	28.8	27.5	96%	27.6	96%	0.0	0.0%	8	0	8	0	0.0%	0.0%				
		W4-L																			10.0	10.1	0.0	-0.1%
		W4-U																			28.8	27.5	96%	27.6
Fifth	R4	W5-L	Bedroom	24.5	21.4	3.1	12.7%	14.5	12.5	86%	12.5	86%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
		W5-U																			24.5	21.4	3.1	12.7%
		W6-L																			14.5	12.5	86%	12.5
Fifth	R5	W6-U	LKD	27.8	25.0	2.8	10.0%	28.8	25.7	89%	25.8	90%	0.0	-0.2%	9	0	9	0	0.0%	0.0%				
		W7-L																			9.5	9.5	0.0	0.0%
		W7-U																			28.8	25.7	89%	25.8
Fifth	R6	W8-L	Bedroom	22.7	20.3	2.5	10.8%	14.5	11.6	80%	11.6	80%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
		W8-U																			22.7	20.3	2.5	10.8%
		W9-L																			14.5	11.6	80%	11.6
Fifth	R7	W9-U	LKD	25.6	23.3	2.3	9.1%	28.8	23.6	82%	23.7	82%	-0.1	-0.3%	10	0	10	0	0.0%	0.0%				
		W10-L																			9.8	9.8	0.0	0.0%
		W10-U																			28.8	23.6	82%	23.7
Fifth	R8	W11-L	Bedroom	20.4	18.6	1.8	8.6%	14.5	10.6	73%	10.6	73%	0.0	-0.1%	N/F	N/F	N/F	N/F	N/F	N/F				
		W11-U																			20.4	18.6	1.8	8.6%
		W12-L																			14.5	10.6	73%	10.6
Fifth	R9	W12-U	LKD	22.6	20.6	2.0	8.8%	28.9	23.0	80%	23.0	80%	0.0	-0.1%	9	0	9	0	0.0%	0.0%				
		W13-L																			10.2	10.2	0.0	0.0%
		W13-U																			28.9	23.0	80%	23.0
Fifth	R10	W14-L	Bedroom	17.5	16.1	1.4	7.9%	14.5	8.9	61%	8.9	61%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
		W14-U																			17.5	16.1	1.4	7.9%
		W15-L																			14.5	8.9	61%	8.9
Fifth	R11	W15-U	LKD	20.6	18.9	1.7	8.1%	28.9	25.2	87%	25.2	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%				
		W16-L																			10.6	10.6	0.0	0.0%
		W16-U																			28.9	25.2	87%	25.2
Fifth	R12	W17-L	Bedroom	19.1	18.2	0.9	5.0%	14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
		W17-U																			19.1	18.2	0.9	5.0%
		W18-L																			14.5	13.2	91%	13.2
Fifth	R13	W18-U	Bedroom	22.2	20.8	1.4	6.4%	12.9	11.7	90%	11.7	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F				
		W19-L																			22.2	20.8	1.4	6.4%
		W19-U																			12.9	11.7	90%	11.7
Fifth	R14	W20-L	LKD	22.9	21.7	1.3	5.5%																	
		W20-U																			22.9	21.7	1.3	5.5%
		W21-L																			13.8	13.8	0.0	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Sixth	R14	W20-L	LKD	24.0	22.7	1.3	5.3%	40.8	32.1	79%	31.5	77%	0.6	1.8%	21	7	21	7	0.0%	0.0%
		W20-U																		
		W21-L																		
		W21-U																		
		W22-L																		
		W22-U																		
W23-L																				
W23-U																				
Seventh	R1	W1-L	LKD	19.1	16.6	2.5	13.1%	24.5	24.5	100%	24.5	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-U																		
		W2-L																		
		W2-U																		
		W3-L																		
		W3-U																		
Seventh	R2	W4-L	Bedroom	25.7	23.5	2.2	8.7%	14.6	10.8	74%	10.8	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W4-U																		
Seventh	R3	W5-L	LKD	24.7	22.7	2.0	8.1%	28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
		W5-U																		
		W6-L																		
		W6-U																		
Seventh	R4	W7-L	Bedroom	19.4	18.1	1.3	6.8%	14.5	9.0	62%	9.0	62%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W7-U																		
Seventh	R5	W8-L	LKD	22.7	21.1	1.6	7.1%	28.7	25.0	87%	25.0	87%	0.0	0.0%	6	0	6	0	0.0%	0.0%
		W8-U																		
		W9-L																		
		W9-U																		
Seventh	R6	W10-L	Bedroom	21.1	20.2	0.9	4.3%	14.5	13.2	91%	13.2	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-U																		
Seventh	R7	W11-L	Bedroom	24.3	22.9	1.4	5.7%	12.9	11.6	90%	11.6	90%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W11-U																		
Seventh	R8	W12-L	LKD	25.0	23.8	1.2	5.0%	40.8	32.3	79%	31.8	78%	0.5	1.7%	23	7	23	7	0.0%	0.0%
		W12-U																		
		W13-L																		
		W13-U																		
		W14-L																		
		W14-U																		
W15-L																				
W15-U																				
Eighth	R1	W1-L	LKD	34.2	31.7	2.5	7.2%	27.6	27.2	99%	27.2	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-U																		
		W2-L																		
		W2-U																		
		W3-L																		
		W3-U																		
W4-L																				
W4-U																				
Eighth	R2	W5-L	Bedroom	26.8	24.6	2.2	8.1%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Eighth	R3	W5-U	LKD					14.3	10.6	74%	10.6	74%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-L	LKD	25.8	23.9	1.9	7.5%													
		W6-U																		
		W7-L		11.2	11.2	0.0	0.0%	28.8	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Eighth	R4	W7-U																		
		W8-L	Bedroom	20.6	19.3	1.3	6.2%	14.3	9.1	64%	9.1	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R5	W8-U																		
		W9-L	LKD	23.9	22.3	1.6	6.5%													
Eighth	R6	W9-U																		
		W10-L		11.5	11.5	0.0	0.0%	31.0	26.7	86%	26.7	86%	0.0	0.0%	6	0	6	0	0.0%	0.0%
		W10-U																		
		W11-L	Bedroom	22.2	21.3	0.9	3.9%	12.7	12.2	96%	12.2	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R7	W11-U																		
		W12-L	Bedroom	25.3	23.9	1.3	5.3%													
Ninth	R1	W12-U																		
		W13-L		14.6	14.6	0.0	0.0%	17.4	16.1	92%	16.1	92%	0.0	0.0%	23	3	23	3	0.0%	0.0%
		W13-U																		
		W1-L	LKD	34.9	32.6	2.3	6.6%													
Ninth	R2	W1-U																		
		W2-L		22.6	20.2	2.4	10.5%													
		W2-U																		
		W3-L		33.6	31.1	2.5	7.3%	29.2	28.9	99%	28.9	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R3	W3-U																		
		W4-L		30.8	28.6	2.3	7.3%													
Ninth	R4	W4-U																		
		W5-L	Bedroom	27.9	25.9	2.0	7.2%	14.8	11.1	75%	11.1	75%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R5	W5-U																		
		W6-L	LKD	27.1	25.3	1.8	6.7%													
Ninth	R6	W6-U																		
		W7-L		11.6	11.6	0.0	0.0%	28.7	22.7	79%	22.7	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
		W7-U																		
		W8-L	Bedroom	21.9	20.7	1.2	5.5%	14.5	9.2	64%	9.2	64%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R7	W8-U																		
		W9-L	LKD	25.2	23.8	1.4	5.7%													
Ninth	R8	W9-U																		
		W10-L		11.8	11.8	0.0	0.0%	32.3	28.2	87%	28.2	87%	0.0	0.2%	6	0	6	0	0.0%	0.0%
		W10-U																		
		W11-L	Bedroom	23.5	22.6	0.8	3.5%	12.1	11.2	92%	11.2	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Ninth	R9	W11-U																		
		W12-L	Bedroom	26.5	25.2	1.2	4.7%													
Tenth	R10	W12-U																		
		W13-L		0.0	0.0	0.0	0.0%	14.2	10.6	74%	10.6	74%	0.0	0.0%	4	0	4	0	0.0%	0.0%
		W13-U																		
		W1-L	LKD	35.6	33.5	2.1	6.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Eleventh	R6	W11-L W11-U	Bedroom	26.5	25.8	0.7	2.6%	12.1	11.4	94%	11.4	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eleventh	R7	W12-L W12-U	Bedroom	29.4	28.3	1.1	3.6%	14.2	10.9	77%	10.9	77%	0.0	0.0%	4	0	4	0	0.0%	0.0%
		W13-L W13-U		0.0	0.0	0.0	0.0%													
Twelfth	R1	W1-L W1-U	LKD	37.2	35.4	1.8	4.8%	29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W2-L W2-U		23.2	21.4	1.9	8.0%													
		W3-L W3-U		35.0	33.0	1.9	5.5%													
		W4-L W4-U		34.7	33.0	1.8	5.0%													
Twelfth	R2	W5-L W5-U	Bedroom	32.3	30.7	1.6	4.9%	14.8	13.2	89%	13.2	89%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R3	W6-L W6-U	LKD	32.2	30.8	1.4	4.4%	28.7	22.8	79%	22.8	79%	0.0	0.0%	9	0	9	0	0.0%	0.0%
		W7-L W7-U		12.9	12.9	0.0	0.0%													
Twelfth	R4	W8-L W8-U	Bedroom	27.0	26.0	0.9	3.5%	14.5	11.9	82%	11.9	82%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R5	W9-L W9-U	LKD	30.6	29.5	1.1	3.7%	32.3	28.2	87%	28.2	87%	0.0	0.0%	7	0	7	0	0.0%	0.0%
		W10-L W10-U		12.6	12.6	0.0	0.0%													
Twelfth	R6	W11-L W11-U	Bedroom	28.2	27.6	0.6	2.3%	12.1	11.7	97%	11.7	97%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twelfth	R7	W12-L W12-U	Bedroom	31.0	30.1	1.0	3.1%	14.2	11.8	83%	11.8	83%	0.0	0.0%	5	0	5	0	0.0%	0.0%
		W13-L W13-U		0.0	0.0	0.0	0.0%													
Thirteenth	R1	W1-L W1-U	LKD	38.0	36.4	1.6	4.3%	29.2	29.2	100%	29.2	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W2-L W2-U		23.4	21.7	1.7	7.2%													
		W3-L W3-U		35.4	33.7	1.8	4.9%													
		W4-L W4-U		35.9	34.3	1.6	4.4%													
Thirteenth	R2	W5-L W5-U	Bedroom	33.7	32.3	1.4	4.2%	14.8	14.3	96%	14.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Thirteenth	R3	W6-L W6-U	LKD	34.1	32.8	1.3	3.7%	28.7	23.8	83%	23.8	83%	0.0	0.0%	9	0	9	0	0.0%	0.0%
		W7-L W7-U		13.3	13.3	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Twentieth	R4	W6-U	Bedroom	38.8	38.5	0.3	0.8%	12.9	12.7	99%	12.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W7-L W7-U						14.6	13.7	94%	13.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R5	W8-L W8-U	Bedroom	38.6	38.3	0.3	0.7%	13.5	12.9	96%	12.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R6	W9-L W9-U	Bedroom	38.5	38.2	0.3	0.7%	12.0	11.7	98%	11.7	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twentieth	R7	W10-L W10-U W11-L W11-U	LKD	38.1	37.9	0.2	0.6%	27.4	25.1	92%	25.1	92%	0.0	0.0%	10	4	10	4	0.0%	0.0%
		5.9		5.9	0.0	0.0%														
Twenty-First	R1	W1-L W1-U W2-L W2-U W3-L W3-U W4-L W4-U	LKD	20.2	20.0	0.2	0.9%	34.9	34.9	100%	34.9	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%
		9.7		9.7	0.0	0.0%														
		39.6		39.3	0.3	0.8%														
		39.1		38.8	0.3	0.7%														
Twenty-First	R2	W5-L W5-U	Bedroom	39.0	38.7	0.3	0.7%	12.9	12.6	98%	12.6	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R3	W6-L W6-U	Bedroom	38.9	38.7	0.2	0.6%	12.9	12.7	99%	12.7	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R4	W7-L W7-U	Bedroom	38.8	38.6	0.2	0.5%	14.6	13.7	94%	13.7	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R5	W8-L W8-U	Bedroom	38.6	38.4	0.2	0.5%	13.5	12.9	96%	12.9	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R6	W9-L W9-U	Bedroom	38.5	38.3	0.2	0.5%	12.0	11.7	98%	11.7	98%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Twenty-First	R7	W10-L W10-U W11-L W11-U	LKD	38.2	38.0	0.1	0.4%	27.4	25.1	92%	25.1	92%	0.0	0.0%	10	4	10	4	0.0%	0.0%
		6.1		6.1	0.0	0.0%														
Sessile Apartments																				
Ground	R15	W28-L W28-U	Bedroom	13.1	12.2	0.8	6.4%	9.8	5.1	52%	4.8	49%	0.4	7.4%	29	4	27	2	6.9%	50.0%
Ground	R16	W29-L W29-U W30-L W30-U	LKD	11.0	8.7	2.3	20.8%	41.4	31.8	77%	31.3	76%	0.5	1.6%	42	8	37	4	11.9%	50.0%
		36.5		35.9	0.6	1.7%														
First	R1	W1-L W1-U	Bedroom	35.7	35.7	0.0	0.0%	11.3	10.4	92%	10.4	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)								Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction		
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter	
First	R2	W2-L	LKD	35.4	35.4	0.0	0.0%														
		W2-U		15.5	15.5	0.0	0.0%														
		W3-L W3-U W4		26.8	26.8	0.0	0.0%	27.5	27.5	100%	27.5	100%	0.0	0.0%	45	9	45	9	0.0%	0.0%	
First	R3	W5-L W5-U	Bedroom	32.5	32.5	0.0	0.0%	12.0	11.8	98%	11.8	98%	0.0	0.0%	43	8	43	8	0.0%	0.0%	
First	R4	W6-L W6-U	Bedroom	32.1	32.1	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	40	6	40	6	0.0%	0.0%	
First	R5	W7-L W7-U	Bedroom	27.8	27.8	0.0	0.0%	11.3	10.5	94%	10.5	94%	0.0	0.0%	28	2	28	2	0.0%	0.0%	
First	R6	W8-L W8-U	LKD	16.0	16.0	0.0	0.0%	31.4	24.7	79%	24.7	79%	0.0	0.0%	28	8	28	8	0.0%	0.0%	
First	R7	W9-L W9-U	Bedroom	29.7	29.7	0.0	0.0%	16.9	15.9	94%	15.9	94%	0.0	0.0%	40	5	40	5	0.0%	0.0%	
First	R8	W10-L W10-U	LKD	15.2	15.2	0.0	0.0%	23.1	20.3	88%	20.3	88%	0.0	0.0%	23	6	23	6	0.0%	0.0%	
First	R9	W11-L W11-U	Bedroom	27.9	27.9	0.0	0.0%	12.7	9.8	77%	9.8	77%	0.0	0.0%	40	6	40	6	0.0%	0.0%	
First	R10	W12-L W12-U	Bedroom	24.3	24.3	0.0	0.0%	7.8	6.2	80%	6.2	80%	0.0	0.0%	20	1	20	1	0.0%	0.0%	
First	R11	W13-L	LKD	12.3	12.3	0.0	0.0%														
		W13-U		7.0	7.0	0.0	0.0%														
		W14-L		5.4	5.4	0.0	0.0%														
		W14-U		4.1	4.1	0.0	0.0%														
		W15-L W15-U W16-L W16-U		36.2	27.4	76%	27.4	76%	0.0	0.0%	36	7	36	7	0.0%	0.0%					
First	R13	W23-L W23-U	Bedroom	1.8	1.8	0.0	0.0%	19.1	4.1	22%	4.1	22%	0.0	0.0%	5	1	5	1	0.0%	0.0%	
First	R14	W24-L W24-U	Bedroom	13.5	13.5	0.0	0.2%	14.6	3.8	26%	3.5	24%	0.3	7.0%	28	2	28	2	0.0%	0.0%	
First	R15	W25-L	LKD	13.7	13.7	0.0	0.0%														
		W25-U		3.0	2.9	0.1	2.7%														
		W26-L		5.0	5.0	0.0	0.2%														
		W26-U W27-L W27-U		48.9	33.4	68%	31.9	65%	1.5	4.5%	41	6	41	6	0.0%	0.0%					
First	R16	W28-L	LKD	8.8	8.8	0.0	0.0%														
		W28-U		3.3	3.3	0.0	0.0%														
		W29-L W29-U		35.0	20.7	59%	20.7	59%	0.0	0.0%	30	3	30	3	0.0%	0.0%					

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Second	R3	W3-U	Bedroom	32.6	32.6	0.0	0.0%	34.2	30.4	89%	30.4	89%	0.0	0.0%	50	12	50	12	0.0%	0.0%
		W4		33.5	33.5	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	46	11	46	11	0.0%	0.0%
Second	R4	W5-L W5-U	Bedroom	32.9	32.9	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	43	9	43	9	0.0%	0.0%
Second	R5	W6-L W6-U	Bedroom	28.6	28.6	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	31	6	31	6	0.0%	0.0%
Second	R6	W7-L W7-U	Bedroom	16.5	16.5	0.0	0.0%	31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	30	11	0.0%	0.0%
Second	R7	W8-L W8-U	LKD	30.5	30.5	0.0	0.0%	16.9	16.1	95%	16.1	95%	0.0	0.0%	42	7	42	7	0.0%	0.0%
Second	R8	W9-L W9-U	Bedroom	15.8	15.8	0.0	0.0%	25.0	20.8	83%	20.8	83%	0.0	0.0%	24	8	24	8	0.0%	0.0%
Second	R9	W10-L W10-U	LKD	28.7	28.7	0.0	0.0%	12.7	10.2	80%	10.2	80%	0.0	0.0%	42	8	42	8	0.0%	0.0%
Second	R10	W11-L W11-U	Bedroom	25.1	25.1	0.0	0.0%	7.8	6.5	83%	6.5	83%	0.0	0.0%	24	4	24	4	0.0%	0.0%
Second	R11	W12-L W12-U	Bedroom	13.0	13.0	0.0	0.0%	36.4	27.1	74%	27.1	74%	0.0	0.0%	33	5	33	5	0.0%	0.0%
Second		W13-L W13-U		6.1	6.1	0.0	0.0%													
		W14-L W14-U		4.6	4.6	0.0	0.0%													
		W15-L W15-U		8.8	8.8	0.0	0.0%													
Second	R12	W16 W17-L W17-U	LKD	10.9	10.9	0.0	0.0%	43.0	34.9	81%	34.9	81%	0.0	0.0%	17	4	17	4	0.0%	0.0%
Second	R13	W18-L W18-U	Bedroom	24.8	24.8	0.0	0.0%	12.1	9.2	76%	9.2	76%	0.0	0.0%	29	3	29	3	0.0%	0.0%
Second	R14	W19-L W19-U	LKD	11.8	11.8	0.0	0.0%	28.4	18.9	67%	18.9	67%	0.0	0.0%	22	8	22	8	0.0%	0.0%
Second	R15	W20-L W20-U	Bedroom	26.1	26.1	0.0	0.0%	13.1	10.9	83%	10.9	83%	0.0	0.0%	38	10	38	10	0.0%	0.0%
Second	R16	W21-L W21-U	LKD	25.4	25.4	0.0	0.0%	43.2	30.4	70%	30.4	70%	0.0	0.0%	51	12	51	12	0.0%	0.0%
Second		W22-L W22-U		4.3	4.3	0.0	0.0%													
		W23-L W23-U		18.3	18.3	0.0	0.0%	13.6	3.3	24%	3.3	24%	0.0	0.0%	52	7	52	7	0.0%	0.0%
Second	R18	W24-L W24-U	Bedroom	18.0	18.0	0.0	0.0%	11.8	4.1	35%	4.1	34%	0.0	0.8%	48	7	48	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Second	R19	W25-L W25-U	Bedroom	17.5	17.5	0.0	0.0%	7.7	2.4	32%	2.4	31%	0.0	1.5%	46	7	46	7	0.0%	0.0%
Second	R20	W26-L W26-U	LKD	2.0	1.9	0.0	1.5%	30.6	6.7	22%	6.7	22%	0.0	0.0%	7	2	7	2	0.0%	0.0%
Second	R21	W27-L W27-U	Bedroom	15.6	15.5	0.1	0.5%	8.0	3.3	42%	3.0	38%	0.3	9.4%	35	3	35	3	0.0%	0.0%
Second	R22	W28-L W28-U	Bedroom	15.8	15.8	0.0	0.1%	11.7	5.5	47%	5.5	47%	0.0	0.1%	38	4	38	4	0.0%	0.0%
Second	R23	W29-L W29-U	LKD	3.3	3.3	0.0	0.3%	39.0	24.6	63%	24.3	62%	0.2	0.9%	24	7	24	7	0.0%	0.0%
		W30-L W30-U		6.0	6.0	0.0	0.0%													
Second	R24	W31-L W31-U	LKD	10.0	10.0	0.0	0.0%	35.2	21.3	61%	21.3	61%	0.0	0.0%	31	3	31	3	0.0%	0.0%
		W32-L W32-U		3.7	3.7	0.0	0.0%													
Second	R25	W33-L W33-U	Bedroom	11.1	11.1	0.0	0.0%	11.2	4.2	37%	4.2	37%	0.0	0.0%	25	2	25	2	0.0%	0.0%
Second	R26	W34-L W34-U	LKD	3.3	3.3	0.0	0.0%	34.5	4.7	14%	4.7	14%	0.0	0.0%	12	1	12	1	0.0%	0.0%
Second	R27	W35-L W35-U	Bedroom	11.7	11.6	0.1	0.5%	12.1	5.3	44%	5.3	44%	0.0	0.3%	31	3	31	3	0.0%	0.0%
Second	R28	W36-L W36-U	LKD	4.8	4.5	0.2	5.0%	33.1	6.6	20%	6.6	20%	0.1	1.1%	19	3	18	2	5.3%	33.3%
Second	R29	W37-L W37-U	Bedroom	16.0	15.3	0.8	4.7%	11.5	7.6	66%	7.4	64%	0.2	3.1%	34	7	32	5	5.9%	28.6%
Second	R30	W38-L W38-U	LKD	7.6	5.4	2.2	29.2%	37.4	28.7	77%	28.1	75%	0.7	2.3%	41	11	37	7	9.8%	36.4%
		W39-L W39-U		38.3	37.7	0.6	1.6%													
Second	R31	W40-L W40-U	Bedroom	8.5	8.5	0.0	0.0%	14.8	8.4	57%	8.4	57%	0.0	0.0%	4	0	4	0	0.0%	0.0%
Second	R32	W41-L W41-U	LKD	1.4	1.4	0.0	0.0%	26.1	18.0	69%	18.0	69%	0.0	0.0%	6	0	6	0	0.0%	0.0%
Second	R33	W42-L W42-U	Bedroom	13.3	13.3	0.0	0.0%	12.5	11.8	95%	11.8	95%	0.0	0.0%	10	0	10	0	0.0%	0.0%
Second	R34	W43-L W43-U	Bedroom	12.1	12.1	0.0	0.0%	11.1	7.6	68%	7.6	68%	0.0	0.0%	12	0	12	0	0.0%	0.0%
Second	R35	W44-L W44-U	LKD	0.7	0.7	0.0	0.0%	34.5	8.8	25%	8.8	25%	0.0	0.0%	1	0	1	0	0.0%	0.0%

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
		W17-L	Bedroom	12.3	12.3	0.0	0.0%	43.0	35.2	82%	35.2	82%	0.0	0.0%	21	7	21	7	0.0%	0.0%
		W17-U																		
Third	R13	W18-L	Bedroom	26.6	26.6	0.0	0.0%	12.1	9.9	82%	9.9	82%	0.0	0.0%	33	4	33	4	0.0%	0.0%
		W18-U																		
Third	R14	W19-L	LKD	13.6	13.6	0.0	0.0%	28.4	19.8	70%	19.8	70%	0.0	0.0%	25	10	25	10	0.0%	0.0%
		W19-U																		
Third	R15	W20-L	Bedroom	28.1	28.1	0.0	0.0%	13.1	11.3	86%	11.3	86%	0.0	0.0%	42	10	42	10	0.0%	0.0%
		W20-U																		
Third	R16	W21-L	LKD	11.0	11.0	0.0	0.0%	43.2	30.4	70%	30.4	70%	0.0	0.0%	68	12	68	12	0.0%	0.0%
		W21-U																		
		W22-L		19.2	19.2	0.0	0.0%													
		W22-U																		
Third	R17	W23-L	Bedroom	20.3	20.3	0.0	0.0%	13.6	4.2	31%	4.2	31%	0.1	1.4%	49	7	49	7	0.0%	0.0%
		W23-U																		
Third	R18	W24-L	Bedroom	20.1	20.1	0.0	0.2%	11.8	4.5	38%	4.4	38%	0.1	1.5%	51	7	51	7	0.0%	0.0%
		W24-U																		
Third	R19	W25-L	Bedroom	19.7	19.6	0.1	0.4%	7.7	2.9	37%	2.7	36%	0.1	4.3%	55	7	55	7	0.0%	0.0%
		W25-U																		
Third	R20	W26-L	LKD	2.4	2.2	0.2	7.8%	30.6	7.3	24%	7.3	24%	0.0	0.6%	8	2	8	2	0.0%	0.0%
		W26-U																		
Third	R21	W27-L	Bedroom	18.0	17.8	0.2	1.0%	8.0	4.3	54%	3.9	49%	0.4	10.3%	41	4	41	4	0.0%	0.0%
		W27-U																		
Third	R22	W28-L	Bedroom	18.2	18.1	0.1	0.4%	11.7	6.1	52%	6.1	52%	0.0	0.0%	45	6	45	6	0.0%	0.0%
		W28-U																		
Third	R23	W29-L	LKD	3.9	3.9	0.0	0.0%	39.0	25.6	65%	25.6	65%	0.0	0.0%	27	7	27	7	0.0%	0.0%
		W29-U																		
		W30-L		7.4	7.4	0.0	0.0%													
		W30-U																		
Third	R24	W31-L	LKD	11.5	11.5	0.0	0.0%	35.2	22.0	63%	22.0	63%	0.0	0.0%	34	5	34	5	0.0%	0.0%
		W31-U																		
		W32-L		4.2	4.2	0.0	0.0%													
		W32-U																		
Third	R25	W33-L	Bedroom	13.0	13.0	0.0	0.0%	11.2	5.1	46%	5.1	46%	0.0	0.0%	30	2	30	2	0.0%	0.0%
		W33-U																		
Third	R26	W34-L	LKD	3.8	3.8	0.0	0.0%	34.5	5.4	16%	5.4	16%	0.0	0.0%	14	3	14	3	0.0%	0.0%
		W34-U																		
Third	R27	W35-L	Bedroom	13.6	13.6	0.1	0.4%	12.1	6.1	50%	6.1	50%	0.0	0.1%	34	3	34	3	0.0%	0.0%
		W35-U																		
Third	R28	W36-L	LKD	5.3	5.0	0.2	4.4%	33.1	7.5	23%	7.4	22%	0.0	0.7%	20	4	19	3	5.0%	25.0%
		W36-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Fourth	R7	W8-U	Bedroom	32.0	32.0	0.0	0.0%	31.4	24.7	79%	24.7	79%	0.0	0.0%	30	11	30	11	0.0%	0.0%
		W9-L W9-U						16.9	16.3	97%	16.3	97%	0.0	0.0%	43	8	43	8	0.0%	0.0%
Fourth	R8	W10-L W10-U	LKD	17.2	17.2	0.0	0.0%	25.0	21.5	86%	21.5	86%	0.0	0.0%	25	9	25	9	0.0%	0.0%
Fourth	R9	W11-L W11-U	Bedroom	30.3	30.3	0.0	0.0%	12.7	11.0	87%	11.0	87%	0.0	0.0%	43	9	43	9	0.0%	0.0%
Fourth	R10	W12-L W12-U	Bedroom	26.7	26.7	0.0	0.0%	7.8	7.4	94%	7.4	94%	0.0	0.0%	26	5	26	5	0.0%	0.0%
Fourth	R11	W13-L W13-U	LKD	14.6	14.6	0.0	0.0%	36.4	27.5	76%	27.5	76%	0.0	0.0%	39	9	39	9	0.0%	0.0%
		W14-L W14-U		8.2	8.2	0.0	0.0%													
		W15-L W15-U		6.6	6.6	0.0	0.0%													
Fourth	R12	W16 W17-L W17-U	LKD	10.6 13.8	10.6 13.8	0.0 0.0	0.0% 0.0%	43.0	35.8	83%	35.8	83%	0.0	0.0%	22	8	22	8	0.0%	0.0%
		W18-L W18-U		28.3	28.3	0.0	0.0%	12.1	10.5	87%	10.5	87%	0.0	0.0%	36	6	36	6	0.0%	0.0%
Fourth	R14	W19-L W19-U	LKD	15.4	15.4	0.0	0.0%	28.4	20.9	74%	20.9	74%	0.0	0.0%	27	11	27	11	0.0%	0.0%
Fourth	R15	W20-L W20-U	Bedroom	29.7	29.7	0.0	0.0%	13.1	11.8	90%	11.8	90%	0.0	0.0%	46	13	46	13	0.0%	0.0%
Fourth	R16	W21-L W21-U	LKD	28.7	28.7	0.0	0.0%	43.2	30.5	71%	30.5	71%	0.0	0.0%	58	14	58	14	0.0%	0.0%
		W22-L W22-U		5.6	5.6	0.0	0.0%													
Fourth	R17	W23-L W23-U	Bedroom	22.8	22.8	0.0	0.2%	13.6	5.7	42%	5.4	40%	0.3	5.9%	62	9	62	9	0.0%	0.0%
Fourth	R18	W24-L W24-U	Bedroom	22.7	22.6	0.1	0.4%	11.8	5.2	44%	5.1	43%	0.1	2.4%	59	8	58	8	1.7%	0.0%
Fourth	R19	W25-L W25-U	Bedroom	22.2	22.0	0.2	0.9%	7.7	3.4	44%	3.3	42%	0.1	4.0%	56	7	55	7	1.8%	0.0%
Fourth	R20	W26-L W26-U	LKD	3.7	3.3	0.4	11.5%	30.6	9.8	32%	8.1	26%	1.7	17.1%	12	5	11	4	8.3%	20.0%
Fourth	R21	W27-L W27-U	Bedroom	20.8	20.4	0.3	1.7%	8.0	5.7	72%	5.5	69%	0.2	3.0%	44	5	44	5	0.0%	0.0%
Fourth	R22	W28-L W28-U	Bedroom	20.9	20.7	0.2	1.0%	11.7	7.1	61%	7.1	61%	0.0	0.0%	47	7	47	7	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Fourth	R23	W29-L	LKD	4.8	4.8	0.0	0.6%	39.0	26.3	67%	26.3	67%	0.0	0.0%	29	7	29	7	0.0%	0.0%
		W29-U																		
		W30-L W30-U																		
Fourth	R24	W31-L	LKD	13.4	13.4	0.0	0.0%	35.2	23.1	66%	23.1	66%	0.0	0.0%	38	8	38	8	0.0%	0.0%
		W31-U																		
		W32-L W32-U																		
Fourth	R25	W33-L W33-U	Bedroom	15.4	15.4	0.0	0.0%	11.2	6.6	59%	6.6	59%	0.0	0.0%	37	4	37	4	0.0%	0.0%
Fourth	R26	W34-L W34-U	LKD	4.6	4.6	0.0	0.0%	34.5	6.6	19%	6.6	19%	0.0	0.0%	17	6	17	6	0.0%	0.0%
Fourth	R27	W35-L W35-U	Bedroom	16.0	16.0	0.1	0.3%	12.1	7.1	59%	7.1	59%	0.0	0.0%	41	6	41	6	0.0%	0.0%
Fourth	R28	W36-L W36-U	LKD	6.0	5.9	0.2	2.8%	33.1	8.8	27%	8.8	27%	0.0	0.2%	21	6	20	5	4.8%	16.7%
Fourth	R29	W37-L W37-U	Bedroom	19.6	18.9	0.7	3.7%	11.5	8.4	73%	8.0	70%	0.4	4.4%	40	9	38	7	5.0%	22.2%
Fourth	R30	W38-L	LKD	8.9	6.5	2.4	26.7%	37.4	29.1	78%	28.5	76%	0.6	2.0%	42	12	39	9	7.1%	25.0%
		W38-U																		
		W39-L W39-U																		
Fourth	R31	W40-L W40-U	Bedroom	10.9	10.9	0.0	0.0%	14.8	10.7	73%	10.7	73%	0.0	0.0%	5	0	5	0	0.0%	0.0%
Fourth	R32	W41-L W41-U	LKD	2.8	2.8	0.0	0.0%	26.1	18.8	72%	18.8	72%	0.0	0.0%	7	0	7	0	0.0%	0.0%
Fourth	R33	W42-L W42-U	Bedroom	17.3	17.3	0.0	0.0%	12.5	12.3	99%	12.3	99%	0.0	0.0%	20	0	20	0	0.0%	0.0%
Fourth	R34	W43-L W43-U	Bedroom	15.1	15.1	0.0	0.0%	11.1	9.1	82%	9.1	82%	0.0	0.0%	16	0	16	0	0.0%	0.0%
Fourth	R35	W44-L W44-U	LKD	2.0	2.0	0.0	0.0%	34.5	12.2	35%	12.2	35%	0.0	0.0%	4	2	4	2	0.0%	0.0%
Fourth	R36	W45-L W45-U	LKD	1.5	1.5	0.0	0.0%	34.4	10.1	29%	10.1	29%	0.0	0.0%	2	0	2	0	0.0%	0.0%
Fourth	R37	W46-L W46-U	Bedroom	14.3	14.3	0.0	0.0%	11.1	9.8	88%	9.8	88%	0.0	0.0%	18	1	18	1	0.0%	0.0%
Fourth	R38	W47-L W47-U	Bedroom	16.3	16.3	0.0	0.0%	12.5	10.0	80%	10.0	80%	0.0	0.0%	31	5	31	5	0.0%	0.0%
Fourth	R39	W48-L W48-U	LKD	2.2	2.2	0.0	0.0%	26.1	6.2	24%	6.2	24%	0.0	0.0%	7	4	7	4	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				Room Area	No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Existing	Proposed	Loss	Loss		Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Fifth	R17	W21-U	Bedroom	23.6	23.6	0.1	0.3%	43.2	30.5	71%	30.5	71%	0.0	0.0%	79	16	79	16	0.0%	0.0%
		W22-L W22-U																		
Fifth	R17	W23-L W23-U	Bedroom	25.4	25.2	0.2	0.7%	13.6	7.4	54%	6.8	50%	0.5	7.4%	60	12	60	12	0.0%	0.0%
Fifth	R18	W24-L W24-U	Bedroom	25.4	25.1	0.3	1.1%	11.8	6.1	52%	6.0	51%	0.0	0.5%	62	12	62	12	0.0%	0.0%
Fifth	R19	W25-L W25-U	Bedroom	25.1	24.7	0.4	1.7%	7.7	4.1	54%	4.1	53%	0.0	1.1%	65	11	64	10	1.5%	9.1%
Fifth	R20	W26-L W26-U	LKD	6.8	6.1	0.8	11.0%	30.6	13.8	45%	10.2	33%	3.6	26.3%	18	10	15	7	16.7%	30.0%
Fifth	R21	W27-L W27-U	Bedroom	24.1	23.5	0.6	2.6%	8.0	6.5	81%	6.3	79%	0.2	2.7%	48	8	48	8	0.0%	0.0%
Fifth	R22	W28-L W28-U	Bedroom	24.0	23.6	0.5	2.0%	11.7	8.2	70%	8.2	70%	0.0	0.0%	52	10	52	10	0.0%	0.0%
Fifth	R23	W29-L	LKD	7.5	7.3	0.2	2.9%													
		W29-U W30-L W30-U		12.1	12.1	0.1	0.7%													
Fifth	R24	W31-L	LKD	16.1	16.1	0.0	0.0%													
		W31-U W32-L W32-U		7.5	7.5	0.0	0.0%													
Fifth	R25	W33-L W33-U	Bedroom	18.5	18.5	0.0	0.0%	11.2	8.3	74%	8.3	74%	0.0	0.0%	42	8	42	8	0.0%	0.0%
Fifth	R26	W34-L W34-U	LKD	6.3	6.3	0.0	0.0%	34.5	8.4	24%	8.4	24%	0.0	0.0%	21	9	21	9	0.0%	0.0%
Fifth	R27	W35-L W35-U	Bedroom	19.0	19.0	0.0	0.1%	12.1	8.6	71%	8.6	71%	0.0	0.0%	47	8	47	8	0.0%	0.0%
Fifth	R28	W36-L W36-U	LKD	7.5	7.3	0.1	1.6%	33.1	11.0	33%	11.0	33%	0.0	0.0%	25	8	25	8	0.0%	0.0%
Fifth	R29	W37-L W37-U	Bedroom	22.2	21.5	0.7	3.3%	11.5	9.0	78%	8.3	72%	0.6	7.1%	50	10	48	8	4.0%	20.0%
Fifth	R30	W38-L	LKD	25.5	23.1	2.4	9.3%													
		W38-U W39-L W39-U		38.9	38.4	0.5	1.3%													
Fifth	R31	W40-L W40-U	Bedroom	12.6	12.6	0.0	0.0%	14.8	12.0	81%	12.0	81%	0.0	0.0%	9	0	9	0	0.0%	0.0%
Fifth	R32	W41-L W41-U	LKD	4.2	4.2	0.0	0.0%	26.1	19.6	75%	19.6	75%	0.0	0.0%	7	0	7	0	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)								Annual Probable Sunlight Hours (APSH) by Room					
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction		
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter	
Fifth	R33	W42-L W42-U	Bedroom	19.9	19.9	0.0	0.0%	12.5	12.4	99%	12.4	99%	0.0	0.0%	22	0	22	0	0.0%	0.0%	
Fifth	R34	W43-L W43-U	Bedroom	16.9	16.9	0.0	0.0%	11.1	9.8	89%	9.8	89%	0.0	0.0%	20	0	20	0	0.0%	0.0%	
Fifth	R35	W44-L W44-U	LKD	3.9	3.9	0.0	0.0%	34.5	14.9	43%	14.9	43%	0.0	0.0%	11	3	11	3	0.0%	0.0%	
Fifth	R36	W45-L W45-U	LKD	2.9	2.9	0.0	0.0%	34.4	12.6	36%	12.6	36%	0.0	0.0%	6	1	6	1	0.0%	0.0%	
Fifth	R37	W46-L W46-U	Bedroom	16.1	16.1	0.0	0.0%	11.1	10.3	93%	10.3	93%	0.0	0.0%	21	1	21	1	0.0%	0.0%	
Fifth	R38	W47-L W47-U	Bedroom	18.7	18.7	0.0	0.0%	12.5	10.7	86%	10.7	86%	0.0	0.0%	37	6	37	6	0.0%	0.0%	
Fifth	R39	W48-L W48-U	LKD	3.6	3.6	0.0	0.0%	26.1	8.7	33%	8.7	33%	0.0	0.0%	11	5	11	5	0.0%	0.0%	
Fifth	R40	W49-L W49-U	Bedroom	10.4	10.4	0.0	0.0%	14.8	9.1	62%	9.1	62%	0.0	0.0%	20	2	20	2	0.0%	0.0%	
Sixth	R1	W1-L W1-U	Bedroom	32.4	32.4	0.0	0.0%	11.4	10.6	92%	10.6	92%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F	
Sixth	R2	W2-L	LKD	20.7	20.7	0.0	0.0%	34.6	34.6	0.0	0.0%	34.2	30.5	89%	30.5	89%	0.0	0.0%	58	18	
		W2-U																			
		W3-L W3-U W4																			
Sixth	R3	W5-L W5-U	Bedroom	36.1	36.1	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	54	14	54	14	0.0%	0.0%	
Sixth	R4	W6-L W6-U	Bedroom	35.6	35.6	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	49	13	49	13	0.0%	0.0%	
Sixth	R5	W7-L W7-U	Bedroom	31.2	31.2	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	34	9	34	9	0.0%	0.0%	
Sixth	R6	W8-L W8-U	LKD	19.5	19.5	0.0	0.0%	31.4	24.7	79%	24.7	79%	0.0	0.0%	35	14	35	14	0.0%	0.0%	
Sixth	R7	W9-L W9-U	Bedroom	33.5	33.5	0.0	0.0%	16.9	16.5	97%	16.5	97%	0.0	0.0%	46	11	46	11	0.0%	0.0%	
Sixth	R8	W10-L W10-U	LKD	19.0	19.0	0.0	0.0%	25.0	22.0	88%	22.0	88%	0.0	0.0%	31	14	31	14	0.0%	0.0%	
Sixth	R9	W11-L W11-U	Bedroom	32.5	32.5	0.0	0.0%	12.7	12.1	95%	12.1	95%	0.0	0.0%	53	13	53	13	0.0%	0.0%	
Sixth	R10	W12-L W12-U	Bedroom	29.1	29.1	0.0	0.0%	7.8	7.5	96%	7.5	96%	0.0	0.0%	28	7	28	7	0.0%	0.0%	

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																			
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction														
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter													
Sixth	R11	W13-L	LKD	16.5	16.5	0.0	0.0%	36.4	27.9	77%	27.9	77%	0.0	0.0%	59	14	59	14	0.0%	0.0%													
		W13-U																															
		W14-L																															
		W14-U																															
Sixth	R12	W15-L	LKD	11.9	11.9	0.0	0.0%	43.0	36.4	85%	36.4	85%	0.0	0.0%	25	9	25	9	0.0%	0.0%													
		W15-U																															
		W16-L																															
		W16-U																															
Sixth	R13	W17-L	Bedroom	15.3	15.3	0.0	0.0%	12.1	11.5	94%	11.5	94%	0.0	0.0%	41	6	41	6	0.0%	0.0%													
		W17-U																															
Sixth	R14	W18-L	LKD	31.8	31.8	0.0	0.0%	28.4	22.7	80%	22.7	80%	0.0	0.0%	29	11	29	11	0.0%	0.0%													
		W18-U																															
Sixth	R15	W19-L	Bedroom	17.5	17.5	0.0	0.0%	13.1	12.5	95%	12.5	95%	0.0	0.0%	52	14	52	14	0.0%	0.0%													
		W19-U																															
Sixth	R16	W20-L	LKD	32.5	32.5	0.0	0.0%	43.2	30.8	71%	30.8	71%	0.0	0.0%	66	18	65	17	1.5%	5.6%													
		W20-U																															
		W21-L																															
		W21-U																															
Sixth	R17	W22-L	LKD	10.2	9.8	0.4	3.4%	13.6	9.9	72%	9.2	67%	0.7	6.7%	72	16	71	15	1.4%	6.3%													
		W22-U																															
		W23-L	Bedroom	28.1	27.6	0.5	1.6%														11.8	8.1	69%	8.1	69%	0.0	0.1%	71	16	70	15	1.4%	6.3%
		W23-U																															
Sixth	R18	W24-L	Bedroom	28.3	27.7	0.6	2.0%	7.7	5.7	74%	5.7	74%	0.0	0.0%	70	15	69	14	1.4%	6.7%													
		W24-U																															
Sixth	R19	W25-L	Bedroom	28.1	27.4	0.7	2.6%	30.6	16.5	54%	14.8	48%	1.7	10.3%	24	13	21	10	12.5%	23.1%													
		W25-U																															
Sixth	R20	W26-L	LKD	9.4	8.4	1.0	11.0%	8.0	7.3	92%	7.2	90%	0.1	2.0%	60	14	59	13	1.7%	7.1%													
		W26-U																															
Sixth	R21	W27-L	Bedroom	27.9	27.0	0.9	3.2%	11.7	9.4	80%	9.4	80%	0.0	0.0%	61	14	60	13	1.6%	7.1%													
		W27-U																															
Sixth	R22	W28-L	Bedroom	27.9	27.1	0.8	2.7%	39.0	27.9	71%	27.9	71%	0.0	0.0%	40	13	39	12	2.5%	7.7%													
		W28-U																															
		W29-L	LKD	10.2	9.6	0.5	5.2%														35.2	24.6	70%	24.6	70%	0.0	0.0%	55	16	55	16	0.0%	0.0%
		W29-U																															
Sixth	R23	W30-L	LKD	16.0	15.8	0.2	1.4%	11.2	9.5	85%	9.5	85%	0.0	0.1%	52	12	52	12	0.0%	0.0%													
		W30-U																															
		W31-L	LKD	19.7	19.7	0.0	0.0%														35.2	24.6	70%	24.6	70%	0.0	0.0%	55	16	55	16	0.0%	0.0%
		W31-U																															
Sixth	R24	W32-L	LKD	10.4	10.4	0.0	0.0%	11.2	9.5	85%	9.5	85%	0.0	0.1%	52	12	52	12	0.0%	0.0%													
		W32-U																															
		W33-L	Bedroom	23.1	23.1	0.0	0.0%														35.2	24.6	70%	24.6	70%	0.0	0.0%	55	16	55	16	0.0%	0.0%
		W33-U																															
Sixth	R25	W34-L	Bedroom	23.1	23.1	0.0	0.0%	11.2	9.5	85%	9.5	85%	0.0	0.1%	52	12	52	12	0.0%	0.0%													
		W34-U																															

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Seventh	R4	W5-U	Bedroom	36.6	36.6	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	56	16	56	16	0.0%	0.0%
		W6-L W6-U						13.1	12.7	97%	12.7	97%	0.0	0.0%	53	13	53	13	0.0%	0.0%
Seventh	R5	W7-L W7-U	Bedroom	32.8	32.8	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	34	11	34	11	0.0%	0.0%
Seventh	R6	W8-L W8-U	LKD	23.2	23.2	0.0	0.0%	31.4	24.8	79%	24.8	79%	0.0	0.0%	43	16	43	16	0.0%	0.0%
Seventh	R7	W9-L W9-U	Bedroom	34.9	34.9	0.0	0.0%	16.9	16.5	97%	16.5	97%	0.0	0.0%	53	13	53	13	0.0%	0.0%
Seventh	R8	W10-L W10-U	LKD	22.7	22.7	0.0	0.0%	25.0	22.8	92%	22.8	92%	0.0	0.0%	38	15	38	15	0.0%	0.0%
Seventh	R9	W11-L W11-U	Bedroom	34.3	34.3	0.0	0.0%	12.7	12.3	97%	12.3	97%	0.0	0.0%	55	15	55	15	0.0%	0.0%
Seventh	R10	W12-L W12-U	Bedroom	36.0	36.0	0.0	0.0%	7.8	7.5	96%	7.5	96%	0.0	0.0%	55	15	55	15	0.0%	0.0%
Seventh	R11	W13-L	LKD	36.0	36.0	0.0	0.0%	36.4	28.0	77%	28.0	77%	0.0	0.0%	74	16	74	16	0.0%	0.0%
		W13-U		18.3	18.3	0.0	0.0%													
		W14-L W14-U W15-L W15-U		16.9	16.9	0.0	0.0%													
Seventh	R12	W16	LKD	20.8	20.8	0.0	0.0%	43.0	36.8	86%	36.8	86%	0.0	0.0%	56	14	56	14	0.0%	0.0%
		W17-L W17-U		35.4	35.4	0.0	0.0%													
Seventh	R13	W18-L W18-U	Bedroom	35.1	35.1	0.0	0.0%	12.1	11.5	95%	11.5	95%	0.0	0.0%	52	12	52	12	0.0%	0.0%
Seventh	R14	W19-L W19-U	LKD	34.3	34.3	0.0	0.0%	28.4	24.0	85%	24.0	85%	0.0	0.0%	45	11	45	11	0.0%	0.0%
Seventh	R15	W20-L W20-U	Bedroom	34.8	34.8	0.0	0.0%	13.1	12.5	95%	12.5	95%	0.0	0.0%	53	14	53	14	0.0%	0.0%
Seventh	R16	W21-L	LKD	34.6	34.6	0.0	0.0%	43.2	31.6	73%	31.6	73%	0.0	0.0%	88	22	88	22	0.0%	0.0%
		W21-U W22-L W22-U		31.5	30.8	0.7	2.2%													
Seventh	R17	W23-L W23-U	Bedroom	30.9	30.1	0.8	2.6%	13.6	11.1	81%	10.2	75%	0.9	7.8%	75	18	73	16	2.7%	11.1%
Seventh	R18	W24-L W24-U	Bedroom	30.8	29.9	0.9	3.0%	11.8	10.8	91%	10.8	91%	0.0	0.0%	75	18	73	16	2.7%	11.1%
Seventh	R19	W25-L W25-U	Bedroom	30.8	29.8	1.1	3.4%	7.7	7.1	92%	7.1	92%	0.0	0.0%	76	19	73	16	3.9%	15.8%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Seventh	R20	W26-L W26-U	LKD	27.6	26.3	1.3	4.6%	30.6	21.3	70%	21.3	70%	0.0	0.0%	58	16	55	13	5.2%	18.8%
Seventh	R21	W27-L W27-U	Bedroom	31.5	30.4	1.1	3.6%	8.0	7.7	97%	7.6	95%	0.1	1.6%	77	21	74	18	3.9%	14.3%
Seventh	R22	W28-L W28-U	Bedroom	31.6	30.6	1.0	3.3%	11.7	11.0	94%	11.0	94%	0.0	0.0%	76	20	73	17	3.9%	15.0%
Seventh	R23	W29-L W29-U	LKD	31.4	30.6	0.8	2.7%	39.2	29.0	74%	29.0	74%	0.0	0.0%	73	18	71	16	2.7%	11.1%
		W30-L W30-U		21.4	21.0	0.4	1.9%													
Seventh	R24	W31-L W31-U	LKD	23.4	23.4	0.0	0.0%	35.2	24.9	71%	24.9	71%	0.0	0.0%	78	21	78	21	0.0%	0.0%
		W32-L W32-U		29.7	29.3	0.4	1.4%													
Seventh	R25	W33-L W33-U	Bedroom	29.1	28.7	0.4	1.3%	11.2	10.5	94%	10.5	94%	0.1	0.5%	75	18	75	18	0.0%	0.0%
Seventh	R26	W34-L W34-U	LKD	28.8	28.4	0.4	1.4%	34.5	19.1	55%	19.1	55%	0.0	0.0%	75	18	74	17	1.3%	5.6%
Seventh	R27	W35-L W35-U	Bedroom	28.9	28.4	0.5	1.7%	12.1	11.3	93%	11.1	92%	0.2	1.5%	74	17	73	16	1.4%	5.9%
Seventh	R28	W36-L W36-U	LKD	29.4	28.9	0.6	2.0%	33.0	17.6	53%	17.2	52%	0.4	2.4%	76	19	75	18	1.3%	5.3%
Seventh	R29	W37-L W37-U	Bedroom	27.9	26.6	1.3	4.7%	11.5	11.0	95%	10.9	95%	0.1	0.7%	57	15	55	13	3.5%	13.3%
Seventh	R30	W38-L W38-U	LKD	32.7	30.2	2.6	7.8%	37.5	29.6	79%	28.7	77%	0.9	3.0%	78	20	76	18	2.6%	10.0%
		W39-L W39-U		39.1	38.7	0.4	1.0%													
Seventh	R31	W40-L W40-U	Bedroom	16.5	16.5	0.0	0.0%	14.8	13.6	92%	13.6	92%	0.0	0.0%	14	0	14	0	0.0%	0.0%
Seventh	R32	W41-L W41-U	LKD	11.5	11.5	0.0	0.0%	26.1	23.8	91%	23.8	91%	0.0	0.0%	16	1	16	1	0.0%	0.0%
Seventh	R33	W42-L W42-U	Bedroom	25.5	25.5	0.0	0.0%	12.5	12.4	100%	12.4	100%	0.0	0.0%	28	3	28	3	0.0%	0.0%
Seventh	R34	W43-L W43-U	Bedroom	23.8	23.8	0.0	0.0%	11.1	10.7	96%	10.7	96%	0.0	0.0%	25	3	25	3	0.0%	0.0%
Seventh	R35	W44-L W44-U	LKD	27.5	27.5	0.0	0.0%	34.6	23.1	67%	23.1	67%	0.0	0.0%	37	6	37	6	0.0%	0.0%
Seventh	R36	W45-L W45-U	LKD	27.2	27.2	0.0	0.0%	34.5	24.4	71%	24.4	71%	0.0	0.0%	41	9	41	9	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Seventh	R37	W46-L W46-U	Bedroom	23.7	23.7	0.0	0.0%	11.1	10.7	96%	10.7	96%	0.0	0.0%	42	10	42	10	0.0%	0.0%
Seventh	R38	W47-L W47-U	Bedroom	24.2	24.2	0.0	0.0%	12.5	12.4	100%	12.4	100%	0.0	0.0%	46	13	46	13	0.0%	0.0%
Seventh	R39	W48-L W48-U	LKD	9.9	9.9	0.0	0.0%	26.1	17.2	66%	17.2	66%	0.0	0.0%	28	14	28	14	0.0%	0.0%
Seventh	R40	W49-L W49-U	Bedroom	14.6	14.6	0.0	0.0%	14.8	11.8	80%	11.8	80%	0.0	0.0%	25	6	25	6	0.0%	0.0%
Eighth	R1	W1-L W1-U	Bedroom	39.6	39.6	0.0	0.0%	11.4	10.6	93%	10.6	93%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
Eighth	R2	W2-L	LKD	39.6	39.6	0.0	0.0%	34.1	30.4	89%	30.4	89%	0.0	0.0%	60	18	60	18	0.0%	0.0%
		W2-U		37.9	37.9	0.0	0.0%													
		W3-L W3-U W4		37.9	37.9	0.0	0.0%													
Eighth	R3	W5-L W5-U	Bedroom	37.7	37.7	0.0	0.0%	12.0	11.7	98%	11.7	98%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R4	W6-L W6-U	Bedroom	37.6	37.6	0.0	0.0%	13.1	12.7	97%	12.7	97%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R5	W7-L W7-U	Bedroom	37.6	37.6	0.0	0.0%	11.3	10.6	94%	10.6	94%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R6	W8-L W8-U	LKD	37.4	37.4	0.0	0.0%	31.4	24.9	79%	24.9	79%	0.0	0.0%	57	17	57	17	0.0%	0.0%
Eighth	R7	W9-L W9-U	Bedroom	37.3	37.3	0.0	0.0%	16.9	16.5	97%	16.5	97%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R8	W10-L W10-U	LKD	36.0	36.0	0.0	0.0%	25.0	23.4	94%	23.4	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R9	W11-L W11-U	Bedroom	36.9	36.9	0.0	0.0%	14.5	13.3	92%	13.3	92%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R10	W12-L	Bedroom	34.3	34.3	0.0	0.0%	13.7	12.0	88%	12.0	88%	0.0	0.0%	82	15	82	15	0.0%	0.0%
		W12-U		27.9	27.9	0.0	0.0%													
		W13-L W13-U																		
Eighth	R11	W14-L	LKD	29.1	29.1	0.0	0.0%	33.3	29.1	87%	29.1	87%	0.0	0.0%	58	16	58	16	0.0%	0.0%
		W14-U		31.0	31.0	0.0	0.0%													
		W15-L																		
		W15-U W16-L W16-U		36.2	36.2	0.0	0.0%													
Eighth	R12	W17-L W17-U	Bedroom	36.0	36.0	0.0	0.0%	11.4	10.7	94%	10.7	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Eighth	R13	W18-L W18-U	Bedroom	35.9	35.9	0.0	0.0%	13.1	12.6	97%	12.6	97%	0.0	0.0%	56	16	56	16	0.0%	0.0%
Eighth	R14	W19-L W19-U	Bedroom	35.8	35.8	0.0	0.0%	15.7	14.9	95%	14.9	95%	0.0	0.0%	54	14	54	14	0.0%	0.0%
Eighth	R15	W20-L W20-U	LKD	35.7	35.7	0.0	0.0%	34.1	31.5	92%	31.5	92%	0.0	0.0%	93	25	92	24	1.1%	4.0%
		W21-L W21-U		33.8	32.7	1.1	3.2%													
		W22-L W22-U		33.6	32.5	1.1	3.4%													
Eighth	R16	W23-L W23-U	Bedroom	33.8	32.4	1.3	4.0%	15.8	15.2	96%	15.2	96%	0.0	0.0%	81	24	79	22	2.5%	8.3%
		W24-L W24-U		33.8	32.4	1.4	4.2%													
Eighth	R17	W25-L W25-U	Bedroom	33.9	32.5	1.4	4.2%	11.4	11.1	97%	11.1	97%	0.0	0.0%	81	24	79	22	2.5%	8.3%
Eighth	R18	W26-L W26-U	Bedroom	33.8	32.5	1.3	3.9%	8.5	8.3	98%	8.3	98%	0.0	0.0%	81	24	79	22	2.5%	8.3%
Eighth	R19	W27-L W27-U	LKD	33.7	32.5	1.2	3.5%	39.1	30.9	79%	30.7	79%	0.2	0.7%	79	22	77	20	2.5%	9.1%
		W28-L W28-U		29.6	29.0	0.6	2.0%													
Eighth	R20	W29-L W29-U	LKD	28.3	28.3	0.0	0.0%	42.1	34.8	83%	34.8	83%	0.0	0.0%	86	25	85	24	1.2%	4.0%
		W30-L W30-U		29.1	29.1	0.0	0.0%													
		W31-L W31-U		32.5	31.4	1.1	3.3%													
		W32-L W32-U		32.5	31.4	1.1	3.4%													
Eighth	R21	W33-L W33-U	Bedroom	32.6	31.4	1.2	3.6%	9.7	8.7	90%	8.6	89%	0.1	0.8%	79	22	78	21	1.3%	4.5%
Eighth	R22	W34-L W34-U	Bedroom	32.7	31.5	1.2	3.8%	10.7	10.3	96%	10.3	96%	0.0	0.0%	76	22	74	20	2.6%	9.1%
Eighth	R23	W35-L W35-U	Bedroom	32.2	30.9	1.3	4.1%	15.2	14.8	97%	14.8	97%	0.0	0.0%	75	24	72	21	4.0%	12.5%
Eighth	R24	W36-L W36-U	Bedroom	33.7	31.9	1.8	5.4%	11.7	11.4	98%	11.3	97%	0.1	0.9%	83	26	80	23	3.6%	11.5%
Eighth	R25	W37-L W37-U	LKD	34.7	32.1	2.6	7.6%	43.6	33.4	77%	32.7	75%	0.7	2.0%	85	26	84	25	1.2%	3.8%
		W38-L W38-U		39.3	38.9	0.4	1.0%													
Eighth	R26	W39-L W39-U	Bedroom	19.3	19.3	0.0	0.0%	14.8	14.0	95%	14.0	95%	0.0	0.0%	17	1	17	1	0.0%	0.0%

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Ninth	R8	W12-U	LKD	32.6	32.6	0.0	0.0%	10.9	10.9	100%	10.9	100%	0.0	0.0%	92	24	92	24	0.0%	0.0%
		W13-L																		
		W13-U																		
Ninth	R8	W14-L	LKD	33.2	33.2	0.0	0.0%	31.3	28.7	92%	28.7	92%	0.0	0.0%	17	3	17	3	0.0%	0.0%
		W14-U																		
		W15-L																		
Ninth	R9	W16-L	Bedroom	6.8	6.8	0.0	0.0%	14.2	12.6	89%	12.6	89%	0.0	0.0%	56	16	56	16	0.0%	0.0%
		W16-U																		
		W17-L																		
Ninth	R10	W18-L	Bedroom	36.8	36.8	0.0	0.0%	13.0	12.1	94%	12.1	94%	0.0	0.0%	56	16	56	16	0.0%	0.0%
		W17-U																		
		W18-U																		
Ninth	R11	W19-L	LKD	36.7	36.7	0.0	0.0%	31.0	22.3	72%	22.3	72%	0.0	0.0%	63	23	63	23	0.0%	0.0%
		W19-U																		
		W20-L																		
Ninth	R12	W20-L	Bedroom	8.1	8.0	0.1	1.4%	7.9	7.6	95%	7.6	95%	0.0	0.0%	83	26	81	24	2.4%	7.7%
		W20-U																		
		W21-L																		
Ninth	R14	W21-L	Bedroom	0.0	0.0	0.0	0.0%	11.8	11.0	93%	11.0	93%	0.0	0.0%	83	26	80	23	3.6%	11.5%
		W21-U																		
		W22-L																		
Ninth	R15	W22-L	Bedroom	35.4	33.9	1.4	4.0%	10.8	10.6	98%	10.6	98%	0.0	0.0%	83	26	80	23	3.6%	11.5%
		W22-U																		
		W24-L																		
Ninth	R16	W24-L	Bedroom	35.2	33.8	1.5	4.2%	7.9	7.8	98%	7.8	98%	0.0	0.0%	82	25	80	23	2.4%	8.0%
		W24-U																		
		W25-L																		
Ninth	R17	W25-L	Bedroom	35.2	33.7	1.5	4.3%	32.4	26.7	82%	26.7	82%	0.0	0.0%	42	17	39	14	7.1%	17.6%
		W25-U																		
		W26-L																		
Ninth	R18	W26-L	LKD	35.1	33.5	1.5	4.4%	31.9	30.5	96%	30.5	96%	0.0	0.0%	93	26	92	25	1.1%	3.8%
		W26-U																		
		W27-L																		
Ninth	R19	W27-L	Bedroom	7.5	6.7	0.8	10.9%	34.6	33.0	1.5	4.4%									
		W27-U																		
		W28-L																		
Ninth	R17	W28-L	LKD	10.9	9.4	1.4	13.1%	34.7	33.1	1.6	4.6%									
		W28-U																		
		W29-L																		
Ninth	R18	W29-L	LKD	32.7	32.0	0.7	2.2%	34.0	34.0	0.0	0.0%									
		W29-U																		
		W30-L																		
Ninth	R18	W30-L	LKD	32.0	31.3	0.7	2.2%	10.3	8.9	1.4	14.0%									
		W30-U																		
		W31-L																		
Ninth	R18	W31-L	LKD	33.8	33.8	0.0	0.0%	6.7	6.7	0.0	0.0%									
		W31-U																		
		W32-L																		
Ninth	R18	W32-L	LKD	34.0	34.0	0.0	0.0%	34.6	33.0	1.5	4.4%									
		W32-U																		
		W33-L																		
Ninth	R18	W33-L	LKD	10.3	8.9	1.4	14.0%	31.9	30.5	96%	30.5	96%	0.0	0.0%	93	26	92	25	1.1%	3.8%
		W33-U																		
		W34-L																		
Ninth	R18	W34-L	LKD	6.7	6.7	0.0	0.0%	34.7	33.1	1.6	4.6%									
		W34-U																		
		W35-L																		
Ninth	R18	W35-L	LKD	34.6	33.0	1.5	4.4%	34.7	33.1	1.6	4.6%									
		W35-U																		
		W36-L																		
Ninth	R19	W36-L	Bedroom	34.7	33.1	1.6	4.6%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
		W36-U						11.7	11.5	99%	11.5	99%	0.0	0.0%	84	27	82	25	2.4%	7.4%
Ninth	R20	W37-L W37-U	Bedroom	34.8	33.1	1.7	4.9%	7.3	7.1	97%	7.1	97%	0.0	0.0%	85	28	83	26	2.4%	7.1%
Ninth	R21	W38-L W38-U	Bedroom	35.1	33.2	1.9	5.3%	11.9	11.5	97%	11.5	97%	0.0	0.0%	85	28	83	26	2.4%	7.1%
Ninth	R22	W39-L W39-U W40-L W40-U W41-L W41-U	LKD	27.6	25.5	2.1	7.5%													
				35.6	33.3	2.3	6.4%													
				39.0	38.6	0.4	0.9%	40.3	38.1	95%	38.0	95%	0.0	0.0%	83	26	82	25	1.2%	3.8%
Ninth	R23	W42-L W42-U	Bedroom	24.1	24.1	0.0	0.0%	14.3	14.0	97%	14.0	97%	0.0	0.0%	19	1	19	1	0.0%	0.0%
Ninth	R24	W43-L W43-U	Bedroom	30.1	30.1	0.0	0.0%	12.1	12.1	100%	12.1	100%	0.0	0.0%	36	2	36	2	0.0%	0.0%
Ninth	R25	W44-L W44-U	LKD	33.6	33.6	0.0	0.0%	42.2	28.0	66%	28.0	66%	0.0	0.0%	50	11	50	11	0.0%	0.0%
Ninth	R26	W45-L W45-U	LKD	32.2	32.2	0.0	0.0%	42.1	27.7	66%	27.7	66%	0.0	0.0%	55	17	55	17	0.0%	0.0%
Ninth	R27	W46-L W46-U	Bedroom	28.9	28.9	0.0	0.0%	11.8	11.8	100%	11.8	100%	0.0	0.0%	53	17	53	17	0.0%	0.0%
Ninth	R28	W47-L W47-U	Bedroom	23.6	23.6	0.0	0.0%	14.3	14.0	98%	14.0	98%	0.0	0.0%	52	17	52	17	0.0%	0.0%
Tenth	R1	W1-L W1-U W2-L W2-U W3-L W3-U W4-L W4-U W5-L W5-U W6-L W6-U W7-L W7-U W8-L W8-U	Studio	39.6	39.6	0.0	0.0%													
				39.6	39.6	0.0	0.0%													
				39.6	39.6	0.0	0.0%													
				39.6	39.6	0.0	0.0%													
				39.6	39.6	0.0	0.0%													
				38.6	38.6	0.0	0.0%													
				38.6	38.6	0.0	0.0%													
				38.5	38.5	0.0	0.0%													
				38.4	38.4	0.0	0.0%	94.4	94.2	100%	94.2	100%	0.0	0.0%	60	18	60	18	0.0%	0.0%
Tenth	R2	W9-L W9-U W10-L W10-U W11-L W11-U	Studio	38.4	38.4	0.0	0.0%													
				38.3	38.3	0.0	0.0%													
				38.3	38.3	0.0	0.0%	39.0	36.3	93%	36.3	93%	0.0	0.0%	57	17	57	17	0.0%	0.0%

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%	Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Tenth	R3	W12-L	Studio	38.2	38.2	0.0	0.0%	39.7	38.2	96%	38.2	96%	0.0	0.0%	96	28	94	26	2.1%	7.1%
		W12-U		38.1	38.1	0.0	0.0%													
		W13-L		36.1	35.4	0.7	1.9%													
		W14-L																		
Tenth	R5	W16-L	LKD	36.9	36.9	0.0	0.0%	40.4	38.2	94%	38.2	94%	0.0	0.0%	96	29	94	27	2.1%	6.9%
		W16-U		36.1	34.2	1.9	5.1%													
		W17-L		36.3	34.3	2.0	5.5%													
		W18-L																		
Tenth	R6	W19-L	Bedroom	36.4	34.3	2.1	5.8%	11.6	11.5	99%	11.5	99%	0.0	0.0%	85	28	83	26	2.4%	7.1%
		W19-U		36.5	34.3	2.2	6.0%													
		W20-L																		
		W20-U																		
Tenth	R7	W21-L	LKD	36.5	34.3	2.2	6.1%	40.6	38.9	96%	38.9	96%	0.0	0.0%	87	28	86	27	1.1%	3.6%
		W21-U		36.6	34.3	2.3	6.2%													
		W22-L		8.4	8.0	0.4	4.9%													
		W22-U		9.3	7.2	2.1	23.0%													
Tenth	R8	W23-L	Bedroom					10.7	10.4	97%	10.4	97%	0.0	0.0%	34	2	34	2	0.0%	0.0%
		W23-U																		
		W24-L																		
		W24-U																		
Tenth	R9	W25-L	Bedroom	29.7	29.7	0.0	0.0%	7.7	7.4	96%	7.4	96%	0.0	0.0%	50	11	50	11	0.0%	0.0%
		W25-U																		
Tenth	R10	W26-L	Bedroom	34.5	34.5	0.0	0.0%	30.8	26.7	87%	26.7	87%	0.0	0.0%	36	6	36	6	0.0%	0.0%
		W26-U																		
		W27-L		32.0	32.0	0.0	0.0%													
		W27-U		36.0	36.0	0.0	0.0%													
Tenth	R11	W28-L	LKD					30.5	26.2	86%	26.2	86%	0.0	0.0%	96	29	95	28	1.0%	3.4%
		W28-U																		
		W29-L		35.4	34.9	0.5	1.4%													
		W29-U		31.0	31.0	0.0	0.0%													
Tenth	R12	W30-L	Bedroom					7.7	7.4	96%	7.4	96%	0.0	0.0%	58	19	58	19	0.0%	0.0%
		W30-U																		
Tenth	R13	W31-L	Bedroom	33.5	33.5	0.0	0.0%	10.7	10.4	97%	10.4	97%	0.0	0.0%	54	19	54	19	0.0%	0.0%
165-195 High cross road																				
Ground	R1	W31-U	Residential																	
		W32-L		30.9	27.8	3.1	10.0%													
		W32-U		2.1	2.1	0.0	0.0%													
		W3-L		1.6	1.6	0.0	0.0%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room																
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction											
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter										
Ground	R2	W3-U	Residential					14.2	14.1	99%	14.1	99%	0.0	0.0%	27	2	27	2	0.0%	0.0%										
		W4-L		7.3	4.7	2.5	34.9%																							
		W4-U																												
		W5-L		6.4	4.9	1.5	23.6%																							
		W5-U																												
Ground	R3	W6-L	Residential	6.8	5.3	1.5	22.3%	16.2	15.5	96%	15.5	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F										
		W6-U																												
		W7-L		5.0	3.5	1.5	30.1%																							
		W7-U																												
		W8-L		6.8	5.3	1.5	22.0%																							
Ground	R4	W8-U	Residential	9.6	7.2	2.5	25.7%	16.2	15.3	95%	15.3	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F										
		W9-L																												
		W9-U																												
		W10-L		4.5	4.5	0.0	0.0%																							
		W10-U																												
Ground	R5	W11-L	Residential	2.4	2.4	0.0	0.0%	14.1	14.1	100%	14.1	100%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F										
		W11-U																												
		W12-L		30.5	27.6	3.0	9.7%																							
		W12-U																												
		W13-L		30.3	27.4	2.9	9.6%																							
Ground	R6	W13-U	Residential					14.1	14.1	100%	14.1	100%	0.0	0.0%	24	3	24	3	0.0%	0.0%										
		W14-L		1.7	1.7	0.0	0.0%																							
		W14-U																												
		W15-L		0.9	0.9	0.0	0.0%																							
		W15-U																												
Ground	R7	W16-L	Residential	6.5	4.5	2.1	31.5%	16.2	15.2	94%	15.2	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F										
		W16-U																												
		W17-L		5.9	4.5	1.4	24.1%																							
		W17-U																												
		W18-L		6.7	5.3	1.4	21.2%																							
Ground	R8	W18-U	Residential					16.2	15.2	94%	15.2	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F										
		W19-L		4.6	3.2	1.4	30.2%																							
		W19-U																												
		W20-L		6.3	5.0	1.4	21.4%																							
		W20-U																												
Ground	R9	W21-L	Residential	9.6	7.4	2.2	23.3%	16.2	15.2	94%	15.2	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F										
		W21-U																												
		W22-L		5.3	5.1	0.2	4.2%																							
		W22-U																												
		W23-L		5.2	5.2	0.0	0.0%																							
Ground	R10	W23-U	Residential					14.1	14.1	100%	14.1	100%	0.0	0.0%	66	22	66	22	0.0%	0.0%										
		W24-L		29.6	26.9	2.7	9.1%																							
		W24-U																												
		W25-L		31.4	31.4	0.0	0.0%																							
		W25-U																												
First	R1	W1-L	Residential	31.4	28.2	3.1	10.0%																							
		W1-U																												
		W2-L		4.9	4.9	0.0	0.0%																							
		W2-U																												

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
First	R2	W3-L	Residential	3.7	3.7	0.0	0.0%	14.2	14.1	99%	14.1	99%	0.0	0.0%	27	2	27	2	0.0%	0.0%
		W3-U																		
		W4-L																		
		W4-U																		
		W5-L																		
First	R3	W5-U	Residential	8.6	6.3	2.3	26.7%	15.9	15.3	96%	15.3	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-L																		
		W6-U																		
		W7-L																		
		W7-U																		
First	R4	W8-L	Residential	9.9	7.6	2.3	23.2%	15.9	15.2	96%	15.2	96%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W8-U																		
		W9-L																		
		W9-U																		
		W10-L																		
First	R5	W10-U	Residential	7.9	7.9	0.0	0.0%	14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W11-L																		
		W11-U																		
		W12-L																		
		W12-U																		
First	R6	W13-L	Residential	31.1	28.1	3.0	9.7%	14.1	14.0	100%	14.0	100%	0.0	0.0%	25	3	25	3	0.0%	0.0%
		W13-U																		
		W14-L																		
		W14-U																		
		W15-L																		
First	R7	W15-U	Residential	5.2	5.2	0.0	0.0%	15.9	15.0	94%	15.0	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W16-L																		
		W16-U																		
		W17-L																		
		W17-U																		
First	R8	W18-L	Residential	9.3	7.1	2.2	23.2%	15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W18-U																		
		W19-L																		
		W19-U																		
		W20-L																		
First	R9	W20-U	Residential	9.3	7.2	2.1	22.2%	14.1	14.1	100%	14.1	100%	0.0	0.0%	69	24	69	24	0.0%	0.0%
		W21-L																		
		W21-U																		
		W22-L																		
		W22-U																		
Second	R1	W23-L	Residential	30.1	27.4	2.7	9.1%	14.1	14.1	100%	14.1	100%	0.0	0.0%	69	24	69	24	0.0%	0.0%
		W23-U																		
		W24-L																		
		W24-U																		
		W25-L																		
Second	R1	W25-U	Residential	32.4	32.4	0.0	0.0%	14.1	14.1	100%	14.1	100%	0.0	0.0%	69	24	69	24	0.0%	0.0%
		W1-L																		
Second	R1	W1-U	Residential	32.0	28.8	3.2	10.0%	14.1	14.1	100%	14.1	100%	0.0	0.0%	69	24	69	24	0.0%	0.0%
		W2-L																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room Area	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Second	R2	W2-U	Residential	2.0	2.0	0.0	0.0%	14.2	14.1	99%	14.1	99%	0.0	0.0%	30	3	30	3	0.0%	0.0%
		W3-L																		
		W3-U																		
		W4-L																		
		W4-U																		
Second	R3	W5-L	Residential	6.9	4.3	2.6	37.7%	15.9	15.2	95%	15.2	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W5-U																		
		W6-L																		
		W6-U																		
		W7-L																		
Second	R4	W7-U	Residential	6.0	4.4	1.6	26.1%	15.9	15.0	94%	15.0	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W8-L																		
		W8-U																		
		W9-L																		
		W9-U																		
Second	R5	W10-L	Residential	5.8	5.8	0.0	0.0%	14.1	14.0	99%	14.0	99%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-U																		
		W11-L																		
		W11-U																		
		W12-L																		
Second	R6	W12-U	Residential	4.9	4.9	0.0	0.0%	14.1	14.0	100%	14.0	100%	0.0	0.0%	27	4	27	4	0.0%	0.0%
		W13-L																		
		W13-U																		
		W14-L																		
		W14-U																		
Second	R7	W15-L	Residential	31.6	28.6	3.1	9.7%	15.9	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W15-U																		
		W16-L																		
		W16-U																		
		W17-L																		
Second	R8	W17-U	Residential	6.6	4.6	2.0	30.6%	14.1	14.1	100%	14.1	100%	0.0	0.0%	71	25	71	25	0.0%	0.0%
		W18-L																		
		W18-U																		
		W19-L																		
		W19-U																		
Third	R1	W20-L	Residential	5.6	4.1	1.4	25.7%	14.1	14.9	94%	14.9	94%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W20-U																		
		W21-L																		
		W21-U																		
		W22-L																		
Third	R2	W22-U	Residential	5.8	5.6	0.2	3.1%	14.1	14.1	100%	14.1	100%	0.0	0.0%	71	25	71	25	0.0%	0.0%
		W23-L																		
		W23-U																		
		W24-L																		
		W24-U																		
Third	R3	W25-L	Residential	33.4	33.4	0.0	0.0%	14.1	14.1	100%	14.1	100%	0.0	0.0%	71	25	71	25	0.0%	0.0%
		W25-U																		
		W1-L																		
		W1-U																		

[illegible]

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Existing NSL		Proposed NSL		Loss m²	Loss %	Existing APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Thirteenth	R6	W7-U	Bedroom	17.9	15.3	2.5	14.2%	39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W8-L																		
		W8-U																		
		W9-L																		
Thirteenth	R7	W9-U	LKD	29.2	26.8	2.5	8.4%	13.6	13.1	96%	12.5	92%	0.6	4.6%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-L																		
Thirteenth	R7	W10-U	LKD	10.3	8.7	1.6	15.5%	30.3	24.6	81%	22.8	75%	1.7	7.1%	N/F	N/F	N/F	N/F	N/F	N/F
		W10-U																		
Fourteenth	R1	W1-L	LKD	39.3	39.3	0.0	0.0%	38.0	32.8	86%	32.8	86%	0.0	0.0%	56	18	56	18	0.0%	0.0%
		W1-U																		
		W2-L																		
		W2-U																		
Fourteenth	R2	W3-L	Bedroom	23.4	21.1	2.3	9.7%	38.0	32.8	86%	32.8	86%	0.0	0.0%	56	18	56	18	0.0%	0.0%
		W3-U																		
		W4-L																		
		W4-U																		
Fourteenth	R3	W5-L	Bedroom	37.3	35.0	2.4	6.3%	12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W5-U																		
Fourteenth	R4	W6-L	Bedroom	38.3	35.9	2.4	6.3%	12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-U																		
Fourteenth	R5	W7-L	LKD	38.5	36.0	2.5	6.6%	13.0	12.5	96%	12.3	94%	0.2	1.6%	N/F	N/F	N/F	N/F	N/F	N/F
		W7-U																		
		W8-L																		
		W8-U																		
Fourteenth	R6	W9-L	Bedroom	38.3	35.6	2.6	6.8%	39.5	35.9	91%	35.9	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W9-U																		
		W10-L																		
		W10-U																		
Fifteenth	R1	W1-L	LKD	10.6	9.1	1.5	14.1%	30.3	24.6	81%	22.9	76%	1.7	6.9%	N/F	N/F	N/F	N/F	N/F	N/F
		W1-U																		
		W2-L																		
		W2-U																		
Fifteenth	R2	W3-L	Bedroom	39.3	39.3	0.0	0.0%	38.0	32.8	86%	32.8	86%	0.0	0.0%	55	18	55	18	0.0%	0.0%
		W3-U																		
		W4-L																		
		W4-U																		
Fifteenth	R3	W5-L	Bedroom	37.6	35.5	2.2	5.7%	12.1	11.0	91%	11.0	91%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W5-U																		
Fifteenth	R4	W6-L	Bedroom	38.6	36.4	2.2	5.8%	12.5	11.9	95%	11.9	95%	0.0	0.0%	N/F	N/F	N/F	N/F	N/F	N/F
		W6-U																		
Fifteenth	R5	W7-L	LKD	38.7	36.4	2.3	6.0%	13.0	12.5	96%	12.3	95%	0.1	0.9%	N/F	N/F	N/F	N/F	N/F	N/F
		W7-U																		
		W8-L																		
		W8-U																		

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Existing	Proposed	Loss	Loss	Room	Existing NSL		Proposed NSL		Loss	Loss	Existing APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%			m²	%	Total	Winter	Total	Winter
Seventeenth R7	W10-L W10-U	LKD		11.2	10.1	1.1	10.0%													
							30.3	24.7	81%	23.3	77%	1.4	5.7%	N/F	N/F	N/F	N/F	N/F	N/F	

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings

**Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring
Properties**

Annex 3: Results of the Cumulative Daylight and Sunlight Assessments

Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments

Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments

Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments

Annex 7: Results of the Sunlight Amenity Assessments

Annex 8: Transient Shadow Images

Annex 9: Solar Glare Images

Annex 10: Policy and Legislation Review

Annex 11: Hale Road Properties



Annex 6

Results of the mirrored assessment for Rosa
Luxemburg Apartments



Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
dla-design_2026-07-03_pre-design-
freeze-pack-of-information-to-
team_2026-07-03_1904
Received 06/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Key	Proposed Development
	Mirrored Building
	Cumulative Development
	Surrounding Context
	Mirrored line


Project Ashley Road
Tottenham Hale

Title Mirrored baseline
Plan View

Drawn JG Checked --

Date 10/07/2026 Project 10106

Rel no. 06 Prefix DS03 Page no. 01

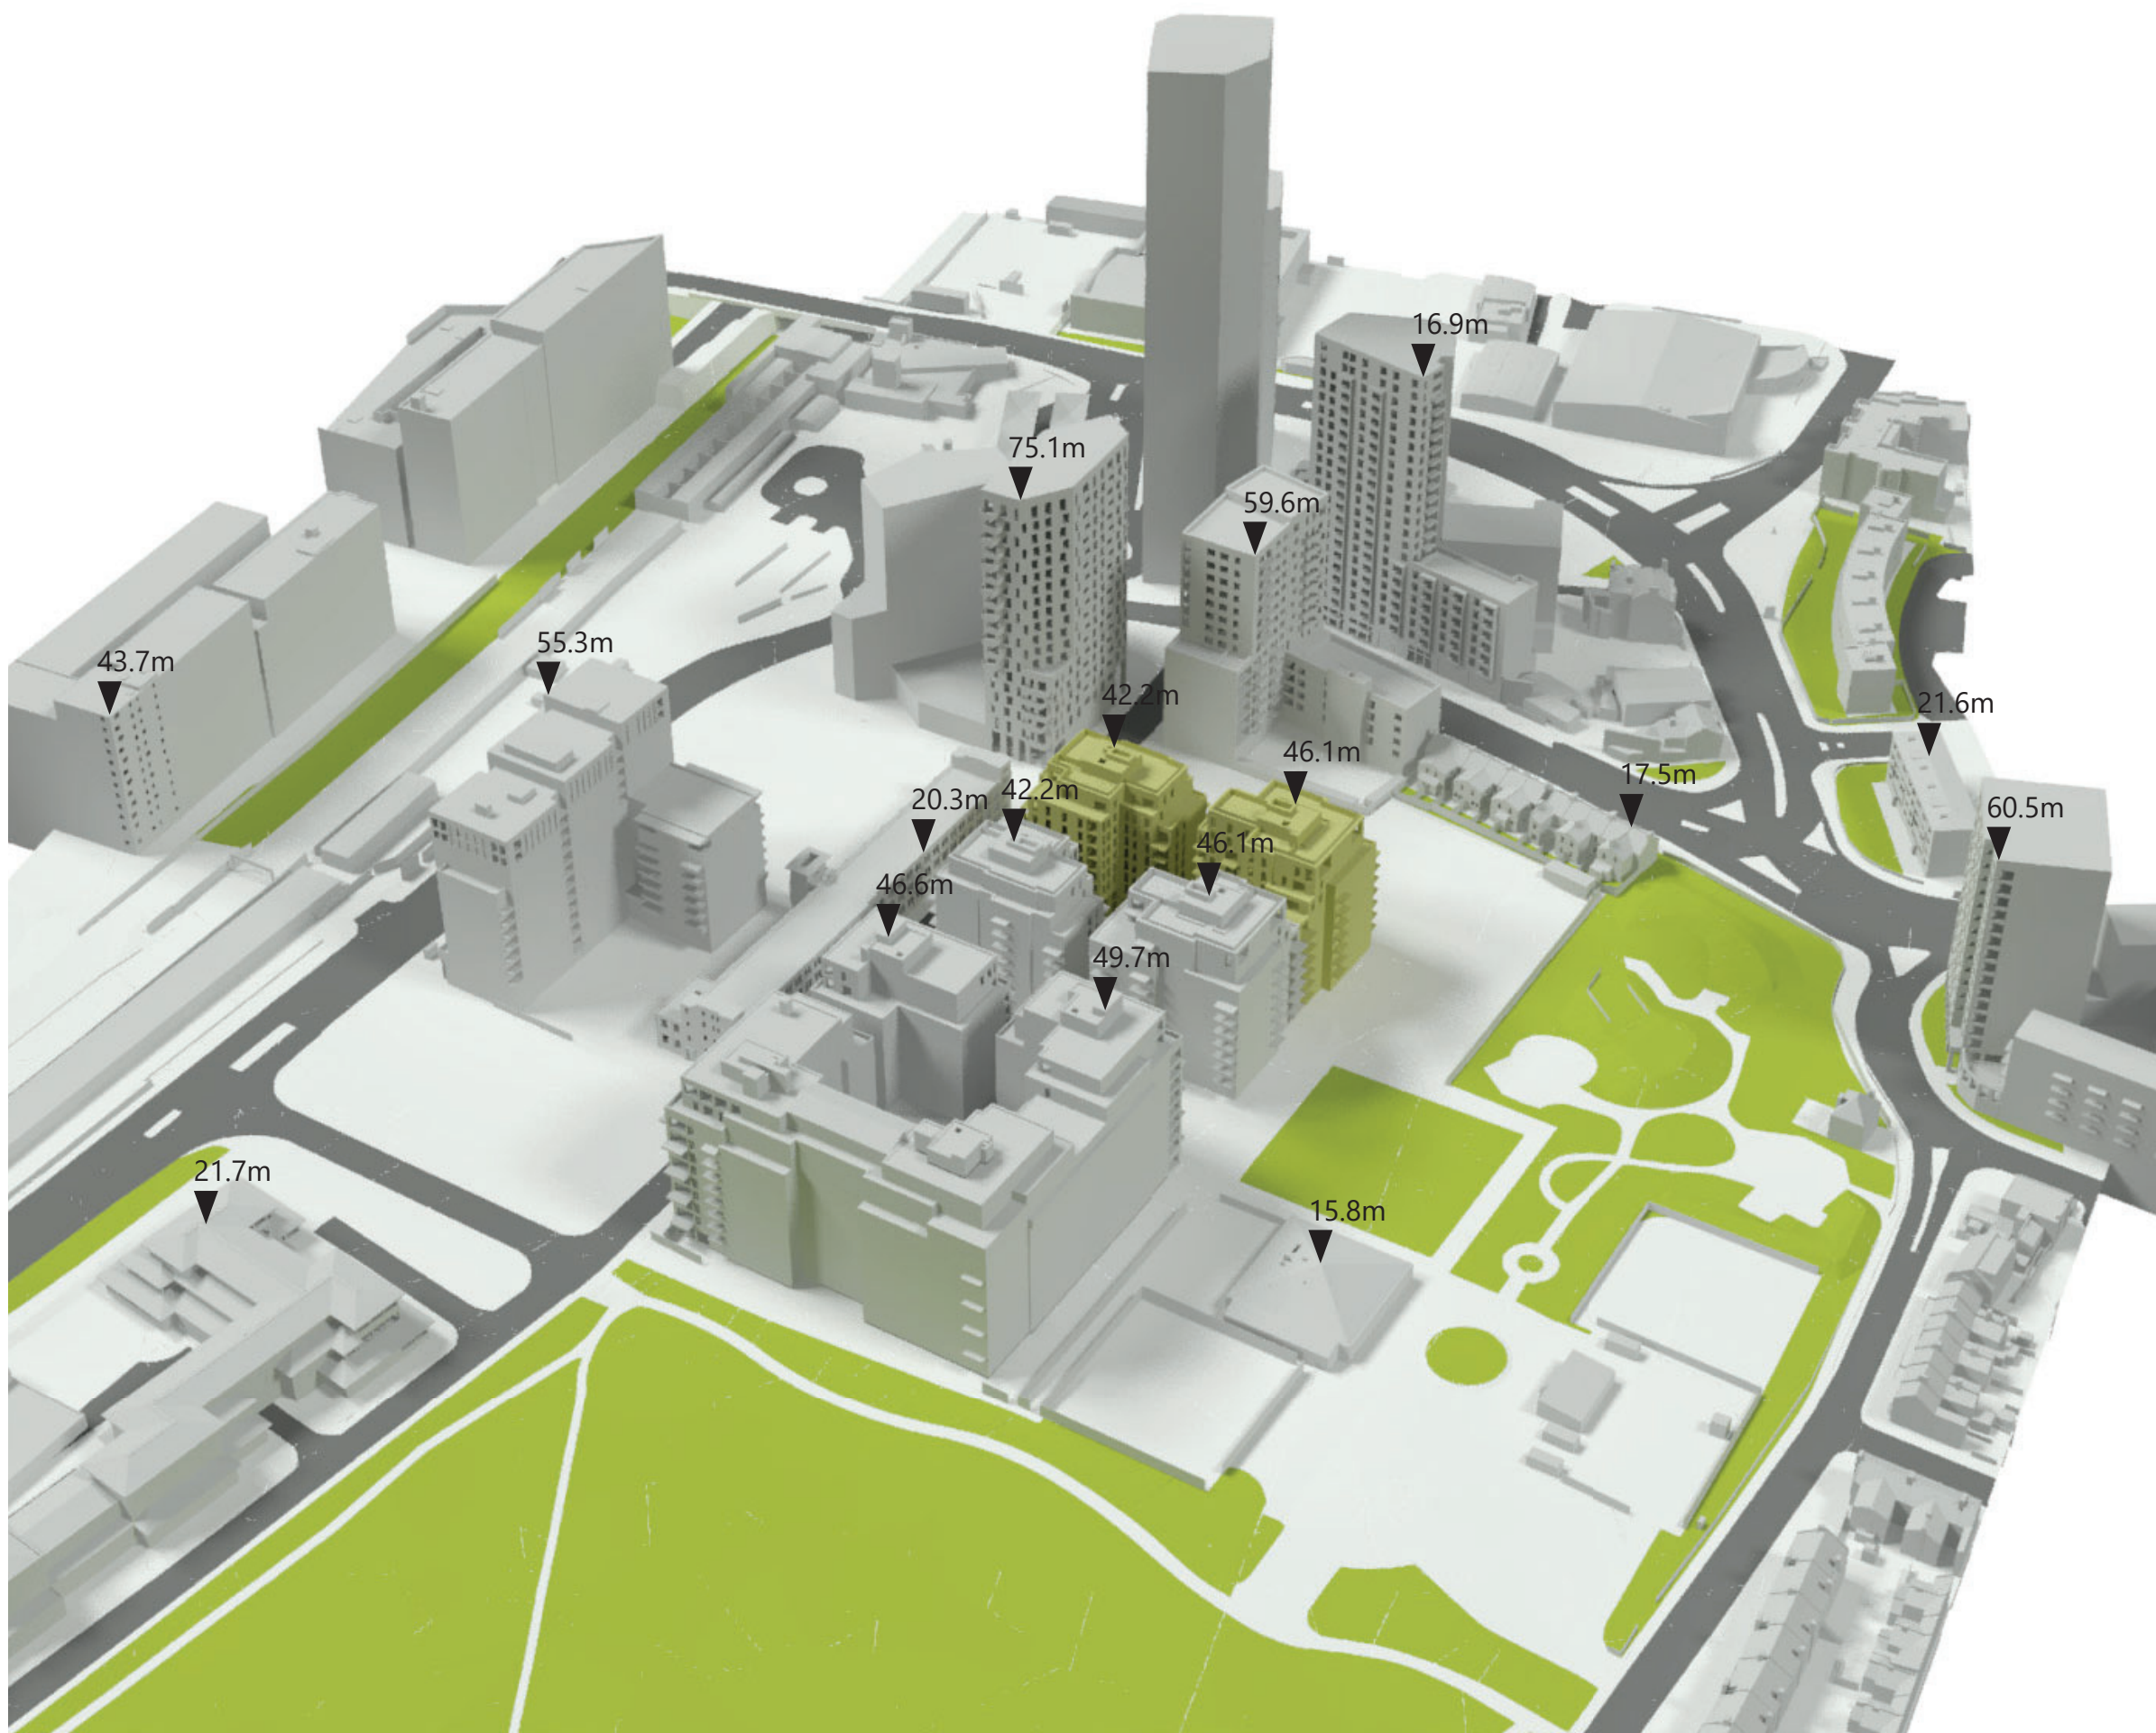

Sources of information

Cloud 10

Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA

dla-design_2026-07-03_pre-design-
freeze-pack-of-information-to-
team_2026-07-03_1904
Received 06/07/2026

EB7 Ltd

Site Photographs
Ordnance Survey

Key		Proposed Development
		Mirrored Building
		Cumulative Development
		Surrounding Context
		Mirrored line

Project Ashley Road
Tottenham Hale

Title Mirrored baseline
3D View

Drawn	JG	Checked	--
-------	----	---------	----

Date	10/07/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
06	DS03	02

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Mirror VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Mirror NSL		Proposed NSL		Loss m²	Loss %	Mirror APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Rosa Luxemburg Apartments																				
Ground	R9	W40 W41	LKD	25.1 26.3	14.5 16.6	10.6 9.7	42.2% 36.8%	34.3	31.5	92%	25.8	75%	5.6	17.9%	N/F	N/F	N/F	N/F	N/F	N/F
First	R1	W1	Bedroom	8.2	9.8	-1.6	-19.7%	15.6	4.9	31%	4.1	26%	0.8	16.1%	0	0	0	0	0.0%	0.0%
First	R2	W2	Bedroom	9.3	11.1	-1.8	-19.8%	9.9	4.5	45%	3.7	38%	0.8	17.0%	0	0	0	0	0.0%	0.0%
First	R3	W3 W4 W5 W6	LKD	9.7 6.4 5.6 4.3	11.3 7.9 6.5 4.8	-1.6 -1.4 -1.0 -0.5	-16.4% -21.9% -17.2% -11.1%	28.8	22.9	79%	12.3	43%	10.6	46.3%	0	0	0	0	0.0%	0.0%
First	R4	W7	Bedroom	3.8	4.0	-0.2	-4.7%	13.7	1.3	9%	1.4	10%	-0.1	-9.8%	N/F	N/F	N/F	N/F	N/F	N/F
First	R5	W8 W9	LKD	4.6 11.1	4.8 13.0	-0.2 -2.0	-4.1% -17.9%	34.8	11.3	33%	7.4	21%	3.9	34.7%	0	0	0	0	0.0%	0.0%
First	R6	W10	Bedroom	9.4	11.9	-2.5	-26.3%	13.1	3.9	30%	3.7	28%	0.2	6.3%	0	0	0	0	0.0%	0.0%
First	R7	W11	Bedroom	0.4	0.9	-0.5	-150.0%	12.8	1.2	9%	0.5	4%	0.6	54.0%	2	1	3	0	-50.0%	100.0%
First	R8	W12	Bedroom	5.2	6.9	-1.7	-33.5%	17.2	3.1	18%	4.5	26%	-1.3	-43.0%	12	0	17	1	-41.7%	0.0%
First	R9	W13	Bedroom	9.9	10.9	-1.0	-10.2%	14.5	7.2	50%	8.1	56%	-0.9	-13.1%	0	0	0	0	0.0%	0.0%
First	R10	W14	Bedroom	11.1	12.0	-0.9	-8.5%	13.5	5.9	43%	5.9	43%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R11	W15	LKD	2.1	2.7	-0.6	-29.4%	29.0	25.8	89%	25.8	89%	0.0	0.0%	0	0	0	0	0.0%	0.0%
First	R12	W16	LKD	18.0	11.0	7.0	38.7%	27.2	26.8	99%	25.4	93%	1.5	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R1	W1 W2 W3	LKD	10.7 10.9 10.7	10.7 9.8 11.5	0.0 1.1 -0.8	0.0% 10.4% -7.9%	26.9	26.0	97%	26.0	97%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Second	R2	W4	Bedroom	9.7	10.2	-0.5	-5.0%	8.4	2.2	27%	2.1	25%	0.1	4.4%	0	0	0	0	0.0%	0.0%
Second	R3	W5	Bedroom	8.9	9.5	-0.6	-6.7%	12.0	2.9	24%	2.8	23%	0.2	5.3%	0	0	0	0	0.0%	0.0%
Second	R4	W6 W7 W8	LKD	8.7 0.2 11.1	10.0 0.7 12.7	-1.3 -0.5 -1.6	-15.5% -331.3% -14.8%	23.3	9.9	42%	17.1	73%	-7.3	-73.6%	0	0	0	0	0.0%	0.0%
Second	R5	W9	Bedroom	9.8	11.2	-1.3	-13.6%	12.9	6.4	50%	7.3	56%	-0.8	-13.2%	N/F	N/F	N/F	N/F	N/F	N/F
Second	R6	W10	Bedroom	9.6	11.7	-2.1	-21.5%	14.5	5.9	41%	5.7	40%	0.1	2.3%	0	0	0	0	0.0%	0.0%
Second	R7	W11	Bedroom	10.9	13.4	-2.5	-22.4%	9.1	4.8	53%	5.2	57%	-0.4	-8.5%	0	0	0	0	0.0%	0.0%
Second	R8	W12 W13 W14	LKD	11.9 1.0 5.7	14.0 0.4 6.3	-2.1 0.6 -0.6	-17.9% 62.1% -9.6%	27.3	22.0	81%	14.4	53%	7.6	34.6%	0	0	0	0	0.0%	0.0%
Second	R9	W15	Bedroom	4.7	4.8	-0.1	-2.8%	14.0	1.4	10%	1.9	14%	-0.5	-32.7%	N/F	N/F	N/F	N/F	N/F	N/F

Address	Room	Window	Room use	Vertical Sky Component (VSC)				Room Area	No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room					
				Mirror	Proposed	Loss	Loss		Mirror NSL		Proposed NSL		Loss	Loss	Mirror APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Second	R10	W16	Bedroom	5.7	5.9	-0.2	-3.5%	13.0	2.3	17%	2.3	18%	-0.1	-2.7%	0	0	0	0	0.0%	0.0%
Second	R11	W17	LKD	7.3	7.8	-0.5	-6.1%	23.4	16.3	70%	15.1	64%	1.2	7.4%	0	0	0	0	0.0%	0.0%
		W18		2.1	3.7	-1.6	-78.5%													
		W19		12.2	15.2	-3.0	-24.3%													
Second	R12	W20	LKD	1.1	3.3	-2.2	-198.2%	22.9	4.7	20%	4.9	21%	-0.2	-4.7%	0	0	0	0	0.0%	0.0%
Second	R13	W21	Bedroom	6.3	8.6	-2.3	-36.4%	15.3	4.0	26%	6.4	42%	-2.4	-61.1%	0	0	0	0	0.0%	0.0%
Second	R14	W22	Bedroom	11.1	12.2	-1.1	-9.5%	14.5	8.1	56%	9.2	64%	-1.1	-13.9%	0	0	0	0	0.0%	0.0%
Second	R15	W23	Bedroom	12.5	13.6	-1.2	-9.3%	13.5	6.1	45%	6.1	45%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Second	R16	W24	LKD	2.8	3.7	-0.9	-33.6%	29.0	26.0	89%	26.4	91%	-0.4	-1.5%	0	0	0	0	0.0%	0.0%
Second	R17	W25	LKD	18.7	11.5	7.2	38.5%	27.2	26.8	99%	25.4	93%	1.5	5.5%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R1	W1	LKD	11.6	11.6	0.0	0.0%	26.9	26.1	97%	26.1	97%	0.0	0.0%	0	0	0	0	0.0%	0.0%
		W2		12.0	10.7	1.3	11.2%													
		W3		12.2	14.0	-1.8	-14.5%													
Third	R2	W4	Bedroom	11.3	12.9	-1.6	-13.7%	8.4	2.5	29%	2.8	34%	-0.4	-15.1%	0	0	0	0	0.0%	0.0%
Third	R3	W5	Bedroom	10.6	12.1	-1.6	-14.7%	12.0	3.6	30%	3.5	29%	0.1	3.2%	0	0	0	0	0.0%	0.0%
Third	R4	W6	LKD	10.5	13.0	-2.5	-23.4%	23.3	13.3	57%	20.1	86%	-6.8	-51.3%	0	0	0	0	0.0%	0.0%
		W7		0.3	2.1	-1.8	-529.4%													
		W8		13.2	14.8	-1.6	-12.1%													
Third	R5	W9	Bedroom	11.5	12.8	-1.3	-11.1%	12.9	7.5	58%	8.2	64%	-0.7	-9.7%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R6	W10	Bedroom	11.4	13.9	-2.6	-22.6%	14.5	7.6	52%	8.9	61%	-1.3	-16.8%	0	0	0	0	0.0%	0.0%
Third	R7	W11	Bedroom	13.0	15.9	-2.9	-22.2%	9.1	5.4	60%	7.5	83%	-2.1	-38.5%	0	0	0	0	0.0%	0.0%
Third	R8	W12	LKD	14.2	16.7	-2.5	-17.8%	27.3	23.1	84%	20.4	75%	2.7	11.5%	0	0	0	0	0.0%	0.0%
		W13		1.4	2.1	-0.7	-52.1%													
		W14		7.0	7.6	-0.6	-8.0%													
Third	R9	W15	Bedroom	5.9	5.9	0.0	0.0%	14.0	1.9	14%	2.2	16%	-0.3	-14.3%	N/F	N/F	N/F	N/F	N/F	N/F
Third	R10	W16	Bedroom	7.5	7.6	-0.1	-1.7%	13.0	2.8	21%	2.8	22%	0.0	-0.2%	0	0	0	0	0.0%	0.0%
Third	R11	W17	LKD	9.3	9.7	-0.4	-4.4%	23.4	17.5	75%	19.8	85%	-2.3	-13.1%	0	0	0	0	0.0%	0.0%
		W18		2.9	5.8	-2.9	-101.4%													
		W19		14.2	18.0	-3.8	-26.4%													
Third	R12	W20	LKD	1.8	5.4	-3.7	-205.1%	22.9	5.4	24%	8.3	36%	-2.9	-52.5%	0	0	0	0	0.0%	0.0%
Third	R13	W21	Bedroom	7.4	10.4	-3.0	-40.9%	15.3	5.2	34%	9.5	62%	-4.3	-84.2%	0	0	0	0	0.0%	0.0%
Third	R14	W22	Bedroom	12.4	13.5	-1.1	-9.1%	14.5	9.0	62%	10.2	70%	-1.2	-13.4%	0	0	0	0	0.0%	0.0%
Third	R15	W23	Bedroom	14.0	15.1	-1.1	-7.9%	13.5	6.6	49%	6.6	49%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Third	R16	W24	LKD	3.8	4.9	-1.1	-27.8%	29.0	26.4	91%	26.7	92%	-0.3	-1.1%	0	0	0	0	0.0%	0.0%

10106 - Ashley House
R06 - Mirr vs Pr

Daylight and Sunlight Analysis (Mirror Rosa Luxemburg Apartments vs Proposed Development)

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Mirror	Proposed	Loss	Loss	Room Area	Mirror NSL		Proposed NSL		Loss	Loss	Mirror APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total	Winter
Third	R17	W25	LKD	18.9	11.9	6.9	36.8%	27.2	26.8	99%	25.5	94%	1.4	5.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R1	W1	LKD	12.3	12.3	0.0	0.0%													
		W2		14.0	12.5	1.4	10.2%													
		W3		14.5	17.4	-2.9	-20.0%													
Fourth	R2	W4	Bedroom	13.7	17.1	-3.5	-25.6%	12.2	4.1	34%	5.4	45%	-1.3	-31.6%	0	0	0	0	0.0%	0.0%
Fourth	R3	W5	Bedroom	13.1	16.3	-3.2	-24.4%	12.6	2.9	23%	4.6	37%	-1.8	-61.2%	0	0	0	0	0.0%	0.0%
Fourth	R4	W6	LKD	13.2	17.6	-4.4	-33.2%													
		W7		0.8	4.3	-3.5	-450.0%													
		W8		15.5	17.0	-1.4	-9.3%													
Fourth	R5	W9	Bedroom	13.4	14.4	-1.1	-7.9%	12.9	8.9	69%	9.1	71%	-0.3	-3.1%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R6	W10	Bedroom	13.3	15.9	-2.5	-19.0%	14.5	10.1	70%	12.9	89%	-2.8	-27.2%	0	0	0	0	0.0%	0.0%
Fourth	R7	W11	Bedroom	15.3	18.0	-2.6	-17.1%	9.1	6.3	69%	8.3	91%	-2.0	-31.2%	0	0	0	0	0.0%	0.0%
Fourth	R8	W12	LKD	16.9	19.0	-2.1	-12.4%													
		W13		2.4	4.3	-2.0	-83.4%													
		W14		9.0	9.5	-0.5	-6.0%													
Fourth	R9	W15	Bedroom	7.7	7.6	0.2	2.2%	14.0	2.9	21%	2.5	18%	0.4	14.2%	N/F	N/F	N/F	N/F	N/F	N/F
Fourth	R10	W16	Bedroom	9.9	9.9	-0.1	-0.5%	13.0	4.1	32%	4.1	32%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fourth	R11	W17	LKD	11.9	12.2	-0.3	-2.6%													
		W18		4.4	7.6	-3.3	-74.2%													
		W19		16.5	20.5	-4.0	-24.3%													
Fourth	R12	W20	LKD	2.6	7.3	-4.7	-182.5%	22.9	6.7	29%	18.2	80%	-11.5	-171.2%	0	0	0	0	0.0%	0.0%
Fourth	R13	W21	Bedroom	8.8	12.8	-4.1	-46.3%	15.3	6.7	43%	12.9	84%	-6.3	-94.3%	0	0	0	0	0.0%	0.0%
Fourth	R14	W22	Bedroom	13.8	15.1	-1.3	-9.3%	14.5	10.3	71%	11.0	76%	-0.7	-7.3%	0	0	0	0	0.0%	0.0%
Fourth	R15	W23	Bedroom	15.7	16.8	-1.1	-7.1%	13.5	7.4	55%	7.4	55%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fourth	R16	W24	LKD	5.1	6.7	-1.5	-30.0%	29.0	27.3	94%	27.6	95%	-0.3	-1.0%	0	0	0	0	0.0%	0.0%
Fourth	R17	W25	LKD	19.0	14.0	5.0	26.2%	27.2	26.8	99%	26.1	96%	0.8	2.9%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R1	W1	LKD	12.9	12.9	0.0	-0.2%													
		W2		14.6	13.2	1.4	9.3%													
		W3		17.4	22.4	-5.0	-28.8%													
Fifth	R2	W4	Bedroom	16.8	22.3	-5.5	-32.7%	12.2	4.8	39%	8.6	70%	-3.8	-78.7%	0	0	0	0	0.0%	0.0%
Fifth	R3	W5	Bedroom	16.6	21.8	-5.2	-31.1%	12.6	3.7	30%	10.0	80%	-6.3	-169.6%	0	0	0	0	0.0%	0.0%
Fifth	R4	W6	LKD	16.8	22.9	-6.2	-36.6%													
		W7		1.6	7.4	-5.7	-354.3%													
		W8		18.5	19.6	-1.1	-6.2%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Mirror	Proposed	Loss	Loss	Room	Mirror NSL		Proposed NSL		Loss	Loss	Mirror APSH		Proposed APSH		% Reduction	
				VSC	VSC	VSC	%		Area	m²	%	m²	%	m²	%	Total	Winter	Total	Winter	Total
Fifth	R5	W9	Bedroom	15.5	16.2	-0.7	-4.8%	12.9	10.0	77%	9.5	74%	0.5	4.7%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R6	W10	Bedroom	15.6	17.8	-2.2	-13.9%	14.5	11.5	79%	13.1	90%	-1.6	-14.2%	0	0	0	0	0.0%	0.0%
Fifth	R7	W11	Bedroom	18.0	20.2	-2.2	-12.0%	9.1	7.2	80%	8.6	95%	-1.4	-19.2%	0	0	0	0	0.0%	0.0%
Fifth	R8	W12 W13 W14	LKD	20.0 3.6 11.8	21.6 5.9 12.2	-1.6 -2.2 -0.4	-8.0% -60.7% -3.3%	27.3	26.4	97%	27.0	99%	-0.6	-2.1%	0	0	0	0	0.0%	0.0%
Fifth	R9	W15	Bedroom	10.3	10.0	0.3	2.4%	14.0	3.9	28%	3.4	24%	0.5	13.5%	N/F	N/F	N/F	N/F	N/F	N/F
Fifth	R10	W16	Bedroom	13.3	13.3	0.0	-0.1%	13.0	6.4	49%	6.4	49%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fifth	R11	W17 W18 W19	LKD	15.5 6.2 19.0	15.6 9.4 23.0	-0.2 -3.2 -4.0	-1.2% -51.0% -21.3%	23.4	22.0	94%	23.1	99%	-1.1	-5.2%	0	0	0	0	0.0%	0.0%
Fifth	R12	W20	LKD	4.1	8.9	-4.9	-119.7%	22.9	8.6	37%	22.2	97%	-13.6	-159.2%	0	0	0	0	0.0%	0.0%
Fifth	R13	W21	Bedroom	10.5	15.3	-4.8	-45.9%	15.3	7.9	51%	13.4	88%	-5.5	-70.1%	0	0	0	0	0.0%	0.0%
Fifth	R14	W22	Bedroom	15.6	17.0	-1.3	-8.6%	14.5	11.6	80%	11.9	82%	-0.4	-3.2%	0	0	0	0	0.0%	0.0%
Fifth	R15	W23	Bedroom	18.1	19.2	-1.1	-6.0%	13.5	8.5	63%	8.5	63%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Fifth	R16	W24	LKD	6.8	8.8	-2.0	-29.2%	29.0	28.2	97%	28.5	98%	-0.3	-1.0%	0	0	0	0	0.0%	0.0%
Fifth	R17	W25	LKD	19.2	16.4	2.8	14.7%	27.2	26.8	99%	26.3	97%	0.6	2.2%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R1	W1 W2 W3	LKD	14.8 16.3 21.1	14.9 15.1 27.0	0.0 1.3 -6.0	-0.3% 7.8% -28.2%	29.5	27.7	94%	28.8	97%	-1.0	-3.7%	0	0	0	0	0.0%	0.0%
Sixth	R2	W4	Bedroom	20.6	27.0	-6.4	-31.2%	12.2	6.6	55%	9.1	75%	-2.5	-37.5%	0	0	0	0	0.0%	0.0%
Sixth	R3	W5	Bedroom	20.5	26.8	-6.3	-30.6%	12.6	5.1	40%	11.9	95%	-6.8	-135.4%	0	0	0	0	0.0%	0.0%
Sixth	R4	W6 W7 W8	LKD	20.9 4.5 22.0	27.3 9.9 22.6	-6.4 -5.4 -0.6	-30.3% -118.8% -2.7%	23.3	21.6	93%	22.5	97%	-1.0	-4.4%	0	0	0	0	0.0%	0.0%
Sixth	R5	W9	Bedroom	18.4	18.5	-0.2	-1.0%	12.9	10.9	84%	9.7	75%	1.2	10.9%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R6	W10	Bedroom	18.2	19.4	-1.2	-6.3%	14.5	12.7	88%	13.2	92%	-0.5	-4.3%	0	0	0	0	0.0%	0.0%
Sixth	R7	W11	Bedroom	21.2	22.3	-1.1	-5.2%	9.1	8.6	95%	8.8	97%	-0.2	-2.4%	0	0	0	0	0.0%	0.0%
Sixth	R8	W12 W13 W14	LKD	24.2 22.0 15.8	24.8 22.4 15.8	-0.6 -0.5 0.0	-2.3% -2.2% 0.2%	27.3	27.0	99%	27.1	99%	-0.1	-0.5%	0	0	0	0	0.0%	0.0%
Sixth	R9	W15	Bedroom	14.5	13.9	0.7	4.5%	14.0	5.6	40%	4.7	33%	0.9	15.9%	N/F	N/F	N/F	N/F	N/F	N/F
Sixth	R10	W16	Bedroom	17.7	17.6	0.1	0.6%	13.0	9.5	74%	9.5	73%	0.1	0.6%	0	0	0	0	0.0%	0.0%
Sixth	R11	W17	LKD	19.4	19.5	-0.1	-0.7%													

Address	Room	Window	Room use	Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Mirror VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Mirror NSL		Proposed NSL		Loss m²	Loss %	Mirror APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
		W18		9.4	11.6	-2.2	-23.6%	23.4	23.1	99%	23.1	99%	0.0	0.0%	0	0	0	0	0.0%	0.0%
		W19		21.7	25.3	-3.5	-16.3%													
		Sixth		R12	W20	LKD	7.1													
Sixth	R13	W21	Bedroom	12.8	17.6	-4.8	-37.4%	15.3	9.3	61%	13.9	90%	-4.5	-48.6%	0	0	0	0	0.0%	0.0%
Sixth	R14	W22	Bedroom	17.6	18.7	-1.1	-6.3%	14.5	12.5	86%	12.7	88%	-0.2	-1.9%	0	0	0	0	0.0%	0.0%
Sixth	R15	W23	Bedroom	20.3	21.7	-1.4	-6.8%	13.5	9.8	73%	9.8	73%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Sixth	R16	W24	LKD	23.3	25.7	-2.4	-10.2%	29.0	28.8	99%	28.9	100%	-0.1	-0.3%	0	0	0	0	0.0%	0.0%
Sixth	R17	W25	LKD	37.8	34.7	3.2	8.4%	27.2	26.9	99%	26.8	99%	0.0	0.1%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R1	W1	LKD	28.1	28.1	0.0	-0.1%	29.5	28.4	96%	29.0	98%	-0.6	-2.2%	0	0	0	0	0.0%	0.0%
		W2		33.0	31.8	1.2	3.6%													
		W3		25.2	29.0	-3.8	-15.1%													
Seventh	R2	W4	Bedroom	24.5	28.9	-4.4	-18.1%	12.2	8.6	71%	9.2	76%	-0.6	-6.8%	0	0	0	0	0.0%	0.0%
Seventh	R3	W5	Bedroom	24.4	28.6	-4.3	-17.4%	12.6	8.2	65%	12.1	96%	-3.9	-48.2%	0	0	0	0	0.0%	0.0%
Seventh	R4	W6	LKD	25.1	28.5	-3.4	-13.3%	23.3	22.0	94%	22.6	97%	-0.6	-2.7%	0	0	0	0	0.0%	0.0%
		W7		8.2	11.5	-3.3	-40.1%													
		W8		26.6	26.3	0.3	1.3%													
Seventh	R5	W9	Bedroom	23.6	23.0	0.6	2.5%	12.9	11.4	88%	9.8	76%	1.6	14.4%	N/F	N/F	N/F	N/F	N/F	N/F
Seventh	R6	W10	Bedroom	21.1	21.0	0.2	0.8%	14.0	13.4	96%	13.2	94%	0.2	1.3%	0	0	0	0	0.0%	0.0%
Seventh	R7	W11	LKD	24.6	24.4	0.2	0.8%	26.6	26.3	99%	26.3	99%	0.0	-0.1%	0	0	0	0	0.0%	0.0%
		W12		27.3	26.7	0.5	1.9%													
		W13		25.4	24.9	0.6	2.2%													
Seventh	R8	W14	Bedroom	23.0	22.5	0.6	2.4%	13.0	11.4	87%	11.4	87%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Seventh	R9	W15	LKD	24.3	24.3	-0.1	-0.2%	23.5	23.2	99%	23.2	99%	0.0	0.0%	0	0	0	0	0.0%	0.0%
		W16		22.2	23.1	-0.9	-4.1%													
		W17		25.0	26.9	-2.0	-7.9%													
Seventh	R10	W18	LKD	21.6	23.5	-1.9	-8.6%	23.1	17.0	74%	22.8	99%	-5.8	-34.4%	0	0	0	0	0.0%	0.0%
Seventh	R11	W19	Bedroom	16.8	20.4	-3.6	-21.4%	15.3	12.0	78%	14.3	93%	-2.2	-18.7%	0	0	0	0	0.0%	0.0%
Seventh	R12	W20	Bedroom	22.8	23.7	-0.9	-4.0%	11.5	10.8	94%	10.9	94%	-0.1	-0.9%	0	0	0	0	0.0%	0.0%
		W21		19.2	26.9	-7.8	-40.5%													
Seventh	R13	W22	Bedroom	14.3	21.5	-7.2	-50.4%	12.0	6.6	55%	10.7	89%	-4.1	-62.1%	0	0	0	0	0.0%	0.0%
Seventh	R14	W23	Bedroom	18.0	26.6	-8.6	-47.9%	13.5	6.6	49%	10.6	79%	-4.1	-61.7%	0	0	0	0	0.0%	0.0%
Seventh	R15	W24	LKD	21.1	26.3	-5.2	-24.4%	33.5	32.7	98%	33.2	99%	-0.5	-1.6%	0	0	0	0	0.0%	0.0%
		W25		37.9	35.8	2.1	5.5%													
		W26		34.8	33.0	1.8	5.1%													
Eighth	R1	W1	LKD	34.7	33.3	1.4	4.0%	21.6	21.3	98%	21.3	98%	0.0	0.0%	0	0	0	0	0.0%	0.0%

AddressRoomWindowRoom use				Vertical Sky Component (VSC)				No-Sky Line (NSL)						Annual Probable Sunlight Hours (APSH) by Room						
				Mirror VSC	Proposed VSC	Loss VSC	Loss %	Room Area	Mirror NSL		Proposed NSL		Loss m²	Loss %	Mirror APSH		Proposed APSH		% Reduction	
									m²	%	m²	%			Total	Winter	Total	Winter	Total	Winter
Eighth	R2	W2 W3	Bedroom	34.6 24.3	33.3 25.5	1.3 -1.2	3.8% -4.8%	13.8	13.8	100%	13.8	100%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R3	W4	Bedroom	29.7	30.0	-0.4	-1.2%	14.2	14.1	99%	14.1	99%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R4	W5 W6	LKD	30.4 29.3	29.5 27.9	0.9 1.4	2.9% 4.8%	22.1	22.0	100%	22.0	100%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R5	W7	Bedroom	25.3	24.0	1.3	5.0%	9.3	8.5	91%	8.0	86%	0.5	6.0%	0	0	0	0	0.0%	0.0%
Eighth	R6	W8 W9 W10	LKD	29.2 29.6 29.9	27.7 28.4 28.8	1.4 1.3 1.1	4.9% 4.3% 3.6%	28.6	28.2	99%	28.2	99%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R7	W11 W12 W13	LKD	17.8 31.9 28.1	17.1 31.3 28.1	0.7 0.6 0.0	3.8% 2.0% 0.1%	33.8	33.6	100%	33.7	100%	-0.1	-0.2%	0	0	0	0	0.0%	0.0%
Eighth	R8	W14	Bedroom	25.8	25.4	0.4	1.6%	12.5	11.9	95%	11.9	95%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Eighth	R9	W15	Bedroom	19.4	21.3	-1.9	-9.9%	14.0	12.4	89%	11.9	85%	0.5	4.2%	0	0	0	0	0.0%	0.0%
Eighth	R10	W16 W17	Bedroom	26.0 24.6	26.4 28.1	-0.4 -3.6	-1.5% -14.4%	13.0	11.9	92%	12.2	94%	-0.2	-2.1%	0	0	0	0	0.0%	0.0%
Eighth	R11	W18	Bedroom	24.4	27.9	-3.5	-14.5%	11.4	8.9	78%	10.3	90%	-1.3	-14.8%	0	0	0	0	0.0%	0.0%
Eighth	R12	W19	Bedroom	25.8	26.9	-1.0	-3.9%	8.3	7.9	96%	7.4	89%	0.5	6.7%	0	0	0	0	0.0%	0.0%
Eighth	R13	W20 W21	LKD	28.7 38.8	27.7 37.1	1.0 1.7	3.4% 4.5%	28.5	25.8	91%	28.2	99%	-2.4	-9.2%	0	0	0	0	0.0%	0.0%
Ninth	R2	W2 W3	LKD	31.3 34.7	30.6 33.7	0.7 0.9	2.1% 2.7%	33.0	30.6	93%	30.6	93%	0.0	0.0%	0	0	0	0	0.0%	0.0%
Ninth	R3	W4 W5	Bedroom	34.8 31.4	33.9 29.5	0.9 1.9	2.5% 6.1%	14.6	13.6	93%	13.4	92%	0.2	1.8%	0	0	0	0	0.0%	0.0%
Ninth	R5	W7	Bedroom	24.1	24.3	-0.2	-0.9%	13.8	8.4	60%	6.3	45%	2.1	25.0%	0	0	0	0	0.0%	0.0%
Ninth	R6	W8 W9	Bedroom	30.7 30.0	30.8 28.6	-0.1 1.4	-0.2% 4.6%	13.3	12.0	90%	11.5	86%	0.5	4.1%	0	0	0	0	0.0%	0.0%
Ninth	R7	W10	Bedroom	30.2	28.4	1.8	6.1%	11.1	10.8	97%	9.7	87%	1.1	10.2%	0	0	0	0	0.0%	0.0%
Ninth	R8	W11 W12 W13	LKD	32.1 16.6 15.7	28.3 14.8 15.5	3.9 1.7 0.2	12.0% 10.5% 1.2%	31.6	31.5	100%	31.5	100%	-0.1	-0.2%	0	0	0	0	0.0%	0.0%

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings

**Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring
Properties**

Annex 3: Results of the Cumulative Daylight and Sunlight Assessments

Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments

Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments

Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments

Annex 7: Results of the Sunlight Amenity Assessments

Annex 8: Transient Shadow Images

Annex 9: Solar Glare Images

Annex 10: Policy and Legislation Review

Annex 11: Hale Road Properties



Annex 7

Results of the sunlight amenity assessments

Sources of information

Cloud 10

Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA

03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd

Site Photographs
Ordnance Survey

NORTH



Key

- Existing Building
- Proposed Development
- Area of assesment
- Area receiving more than two hours of sun on March 21st
- Area receiving less than two hours of sun on March 21st

Project Ashley Road
Tottenham Hale

Title Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn TR Checked --

Date 10/08/2026 Project 10106

Rel no. 08 Prefix SA01 Page no. 01



Existing Scenario - March 21st



Proposed Scenario - March 21st

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



- Key
-  Existing Building
 -  Proposed Development
 -  Area of assesment
 -  Area receiving more than two hours of sun on March 21st
 -  Area receiving less than two hours of sun on March 21st

Project Ashley Road
Tottenham Hale

Title Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn TR Checked --

Date 10/08/2026 Project 10106

Rel no. 08 Prefix SA01 Page no. 02

Area	Total Area (sq.m)	Existing Scenario Area recieving more than two hours of sun		Proposed Scenario Area recieving more than two hours of sun		Proportion Retained
		(m²)	%	(m²)	%	
1 - Playground	1520.76	1520.76	100%	1435.87	94%	0.94
2 - Playground	1614.80	1614.80	100%	1614.80	100%	1.00
3 - Playground	1380.94	1366.53	99%	1366.53	99%	1.00
4 - Playground	1176.81	1176.81	100%	1176.81	100%	1.00
5 - Playground	9586.31	9539.11	100%	9509.85	99%	1.00
6 - 1 Hale Road	27.17	0.00	0%	0.00	0%	1.00
7 - 3 Hale Road	24.85	0.00	0%	0.00	0%	1.00
8 - 5 Hale Road	30.07	0.00	0%	0.00	0%	1.00
9 - 7 Hale Road	31.41	0.00	0%	0.00	0%	1.00
10 - 9 Hale Road	29.21	0.00	0%	0.00	0%	1.00
11 - 11 Hale Road	49.39	0.00	0%	0.00	0%	1.00
12 - 13 Hale Road	32.51	0.00	0%	0.00	0%	1.00
13 - 15 Hale Road	36.20	0.00	0%	0.00	0%	1.00
14 - 17 Hale Road	36.70	0.00	0%	0.00	0%	1.00
15 - 19 Hale Road	35.03	0.00	0%	0.00	0%	1.00
16 - 21 Hale Road	37.88	0.00	0%	0.00	0%	1.00
17 - Rosa Luxemburg Apartments	295.26	229.46	78%	0.00	0%	0.00
18 - The Gessner	761.99	129.35	17%	101.08	13%	0.78
19 - Sessile Apartments	1145.33	13.44	1%	13.44	1%	1.00

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Key

Existing Building

Proposed Development

Area of assesment

Area receiving more than two hours of sun on March 21st

Area receiving less than two hours of sun on March 21st

Project Ashley Road
Tottenham Hale

Title Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn TR Checked --

Date 10/08/2026 Project 10106

Rel no. 08 Prefix SA01 Page no. 03



Cumulative Scenario

Sources of information

Cloud 10

Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA

03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd

Site Photographs
Ordnance Survey

NORTH



Key

-  Cumulative Development
-  Existing Building
-  Proposed Development
-  Area of assesment
-  Area receiving more than two hours of sun on March 21st
-  Area receiving less than two hours of sun on March 21st

Project Ashley Road
Tottenham Hale

Title Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn TR Checked --

Date 10/08/2026 Project 10106

Rel no. 08 Prefix SA02 Page no. 01



Existing Scenario - March 21st



Proposed Scenario - March 21st

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



- Key
- Cumulative Development
 - Existing Building
 - Proposed Development
 - Area of assesment
 - Area receiving more than two hours of sun on March 21st
 - Area receiving less than two hours of sun on March 21st

Project Ashley Road
Tottenham Hale

Title Sunlight Amenity Study
Existing vs Proposed
21st March

Drawn TR Checked --

Date 10/08/2026 Project 10106

Rel no. 08 Prefix SA02 Page no. 02



Consented Scenario



Consented Scenario - March 21st

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Key		Consented
		Proposed Development
		Area of assesment
		Area receiving more than two hours of sun on March 21st
		Area receiving less than two hours of sun on March 21st

Project Ashley Road
Tottenham Hale

Title Sunlight Amenity Study
Consented vs Proposed
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	11/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	SA04	01



Proposed Scenario - March 21st

Sources of information

- Cloud 10**
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Key		Consented
		Proposed Development
		Area of assesment
		Area receiving more than two hours of sun on March 21st
		Area receiving less than two hours of sun on March 21st

Project Ashley Road
Tottenham Hale

Title Sunlight Amenity Study
Consented vs Proposed
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	11/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	SA04	02

Area	Total Area (sq.m)	Existing Scenario Area recieving more than two hours of sun		Proposed Scenario Area recieving more than two hours of sun		Proportion Retained
		(m²)	%	(m²)	%	
1 - Playground	1520.76	1472.75	97%	1436.38	94%	0.98
2 - Playground	1614.80	1614.80	100%	1614.80	100%	1.00
3 - Playground	1380.94	1366.53	99%	1366.53	99%	1.00
4 - Playground	1176.81	1176.81	100%	1176.81	100%	1.00
5 - Playground	9586.31	9531.54	99%	9508.35	99%	1.00
6 - 1 Hale Road	27.17	0.00	0%	0.00	0%	1.00
7 - 3 Hale Road	24.85	0.00	0%	0.00	0%	1.00
8 - 5 Hale Road	30.07	0.00	0%	0.00	0%	1.00
9 - 7 Hale Road	31.41	0.00	0%	0.00	0%	1.00
10 - 9 Hale Road	29.21	0.00	0%	0.00	0%	1.00
11 - 11 Hale Road	49.39	0.00	0%	0.00	0%	1.00
12 - 13 Hale Road	32.51	0.00	0%	0.00	0%	1.00
13 - 15 Hale Road	36.20	0.00	0%	0.00	0%	1.00
14 - 17 Hale Road	36.70	0.00	0%	0.00	0%	1.00
15 - 19 Hale Road	35.03	0.00	0%	0.00	0%	1.00
16 - 21 Hale Road	37.88	0.00	0%	0.00	0%	1.00
17 - Rosa Luxemburg Apartments	295.26	0.00	0%	0.00	0%	0.00
18 - The Gessner	761.99	129.35	17%	101.08	13%	0.78
19 - Sessile Apartments	1145.33	13.44	1%	13.44	1%	1.00

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Key

Consented

Proposed Development

Area of assesment

Area receiving more than two hours of sun on March 21st

Area receiving less than two hours of sun on March 21st

Project Ashley Road
Tottenham Hale

Title Sunlight Amenity Study
Consented vs Proposed
21st March

Drawn TR Checked --

Date 11/08/2026 Project 10106

Rel no. 08 Prefix SA04 Page no. 03



Solar Radiation Assessment to Solar Panels

Sources of information

Cloud 10

Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


DLA

03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd

Site Photographs
Ordnance Survey

Values (KWh/m2)

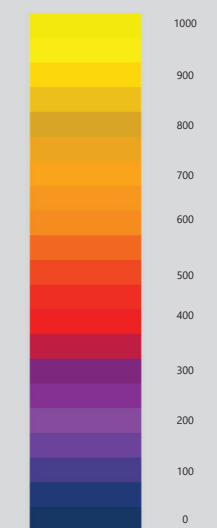


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Sessile Apartments
21st March

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV01 Page no. 01

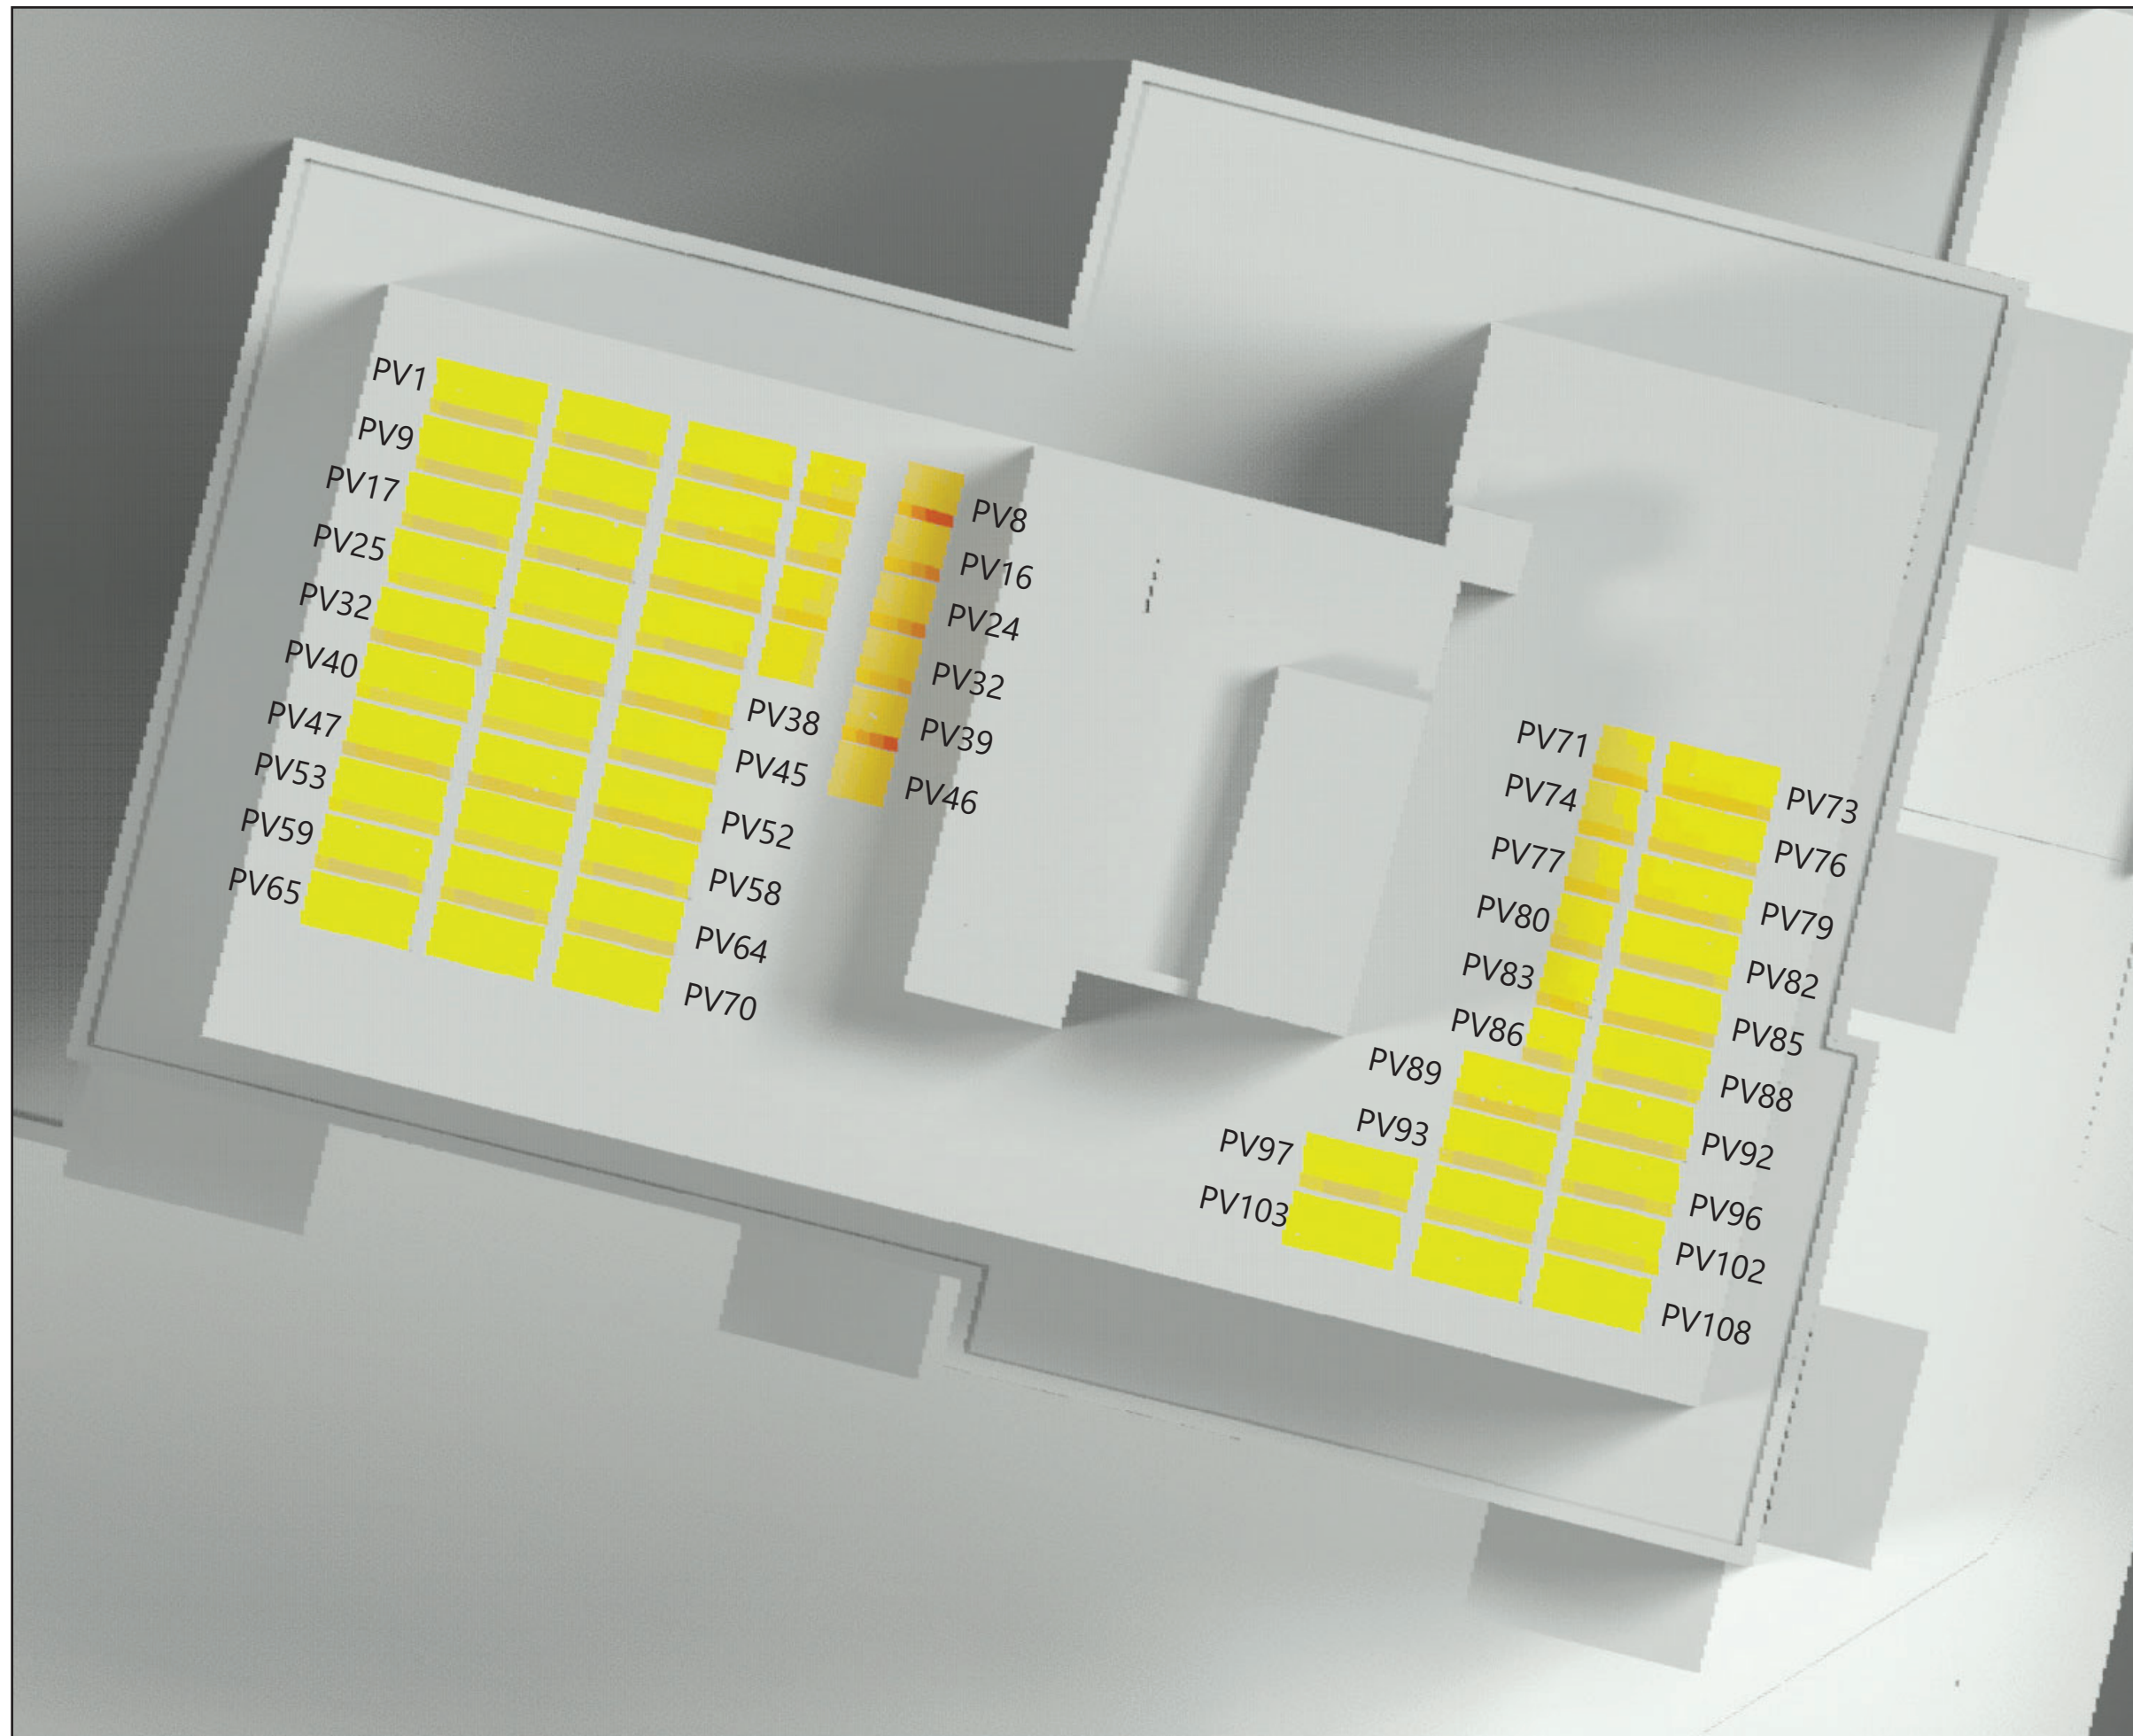

Existing Scenario - Sunlight Exposure

Sources of information

Cloud 10

Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


DLA

03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd

Site Photographs
Ordnance Survey

Values (KWh/m2)

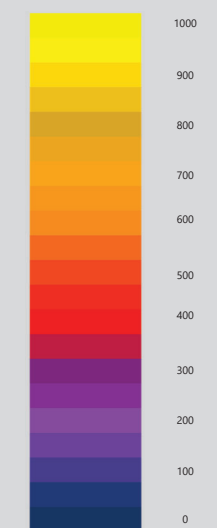


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Sessile Apartments
21st March


Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV01 Page no. 02

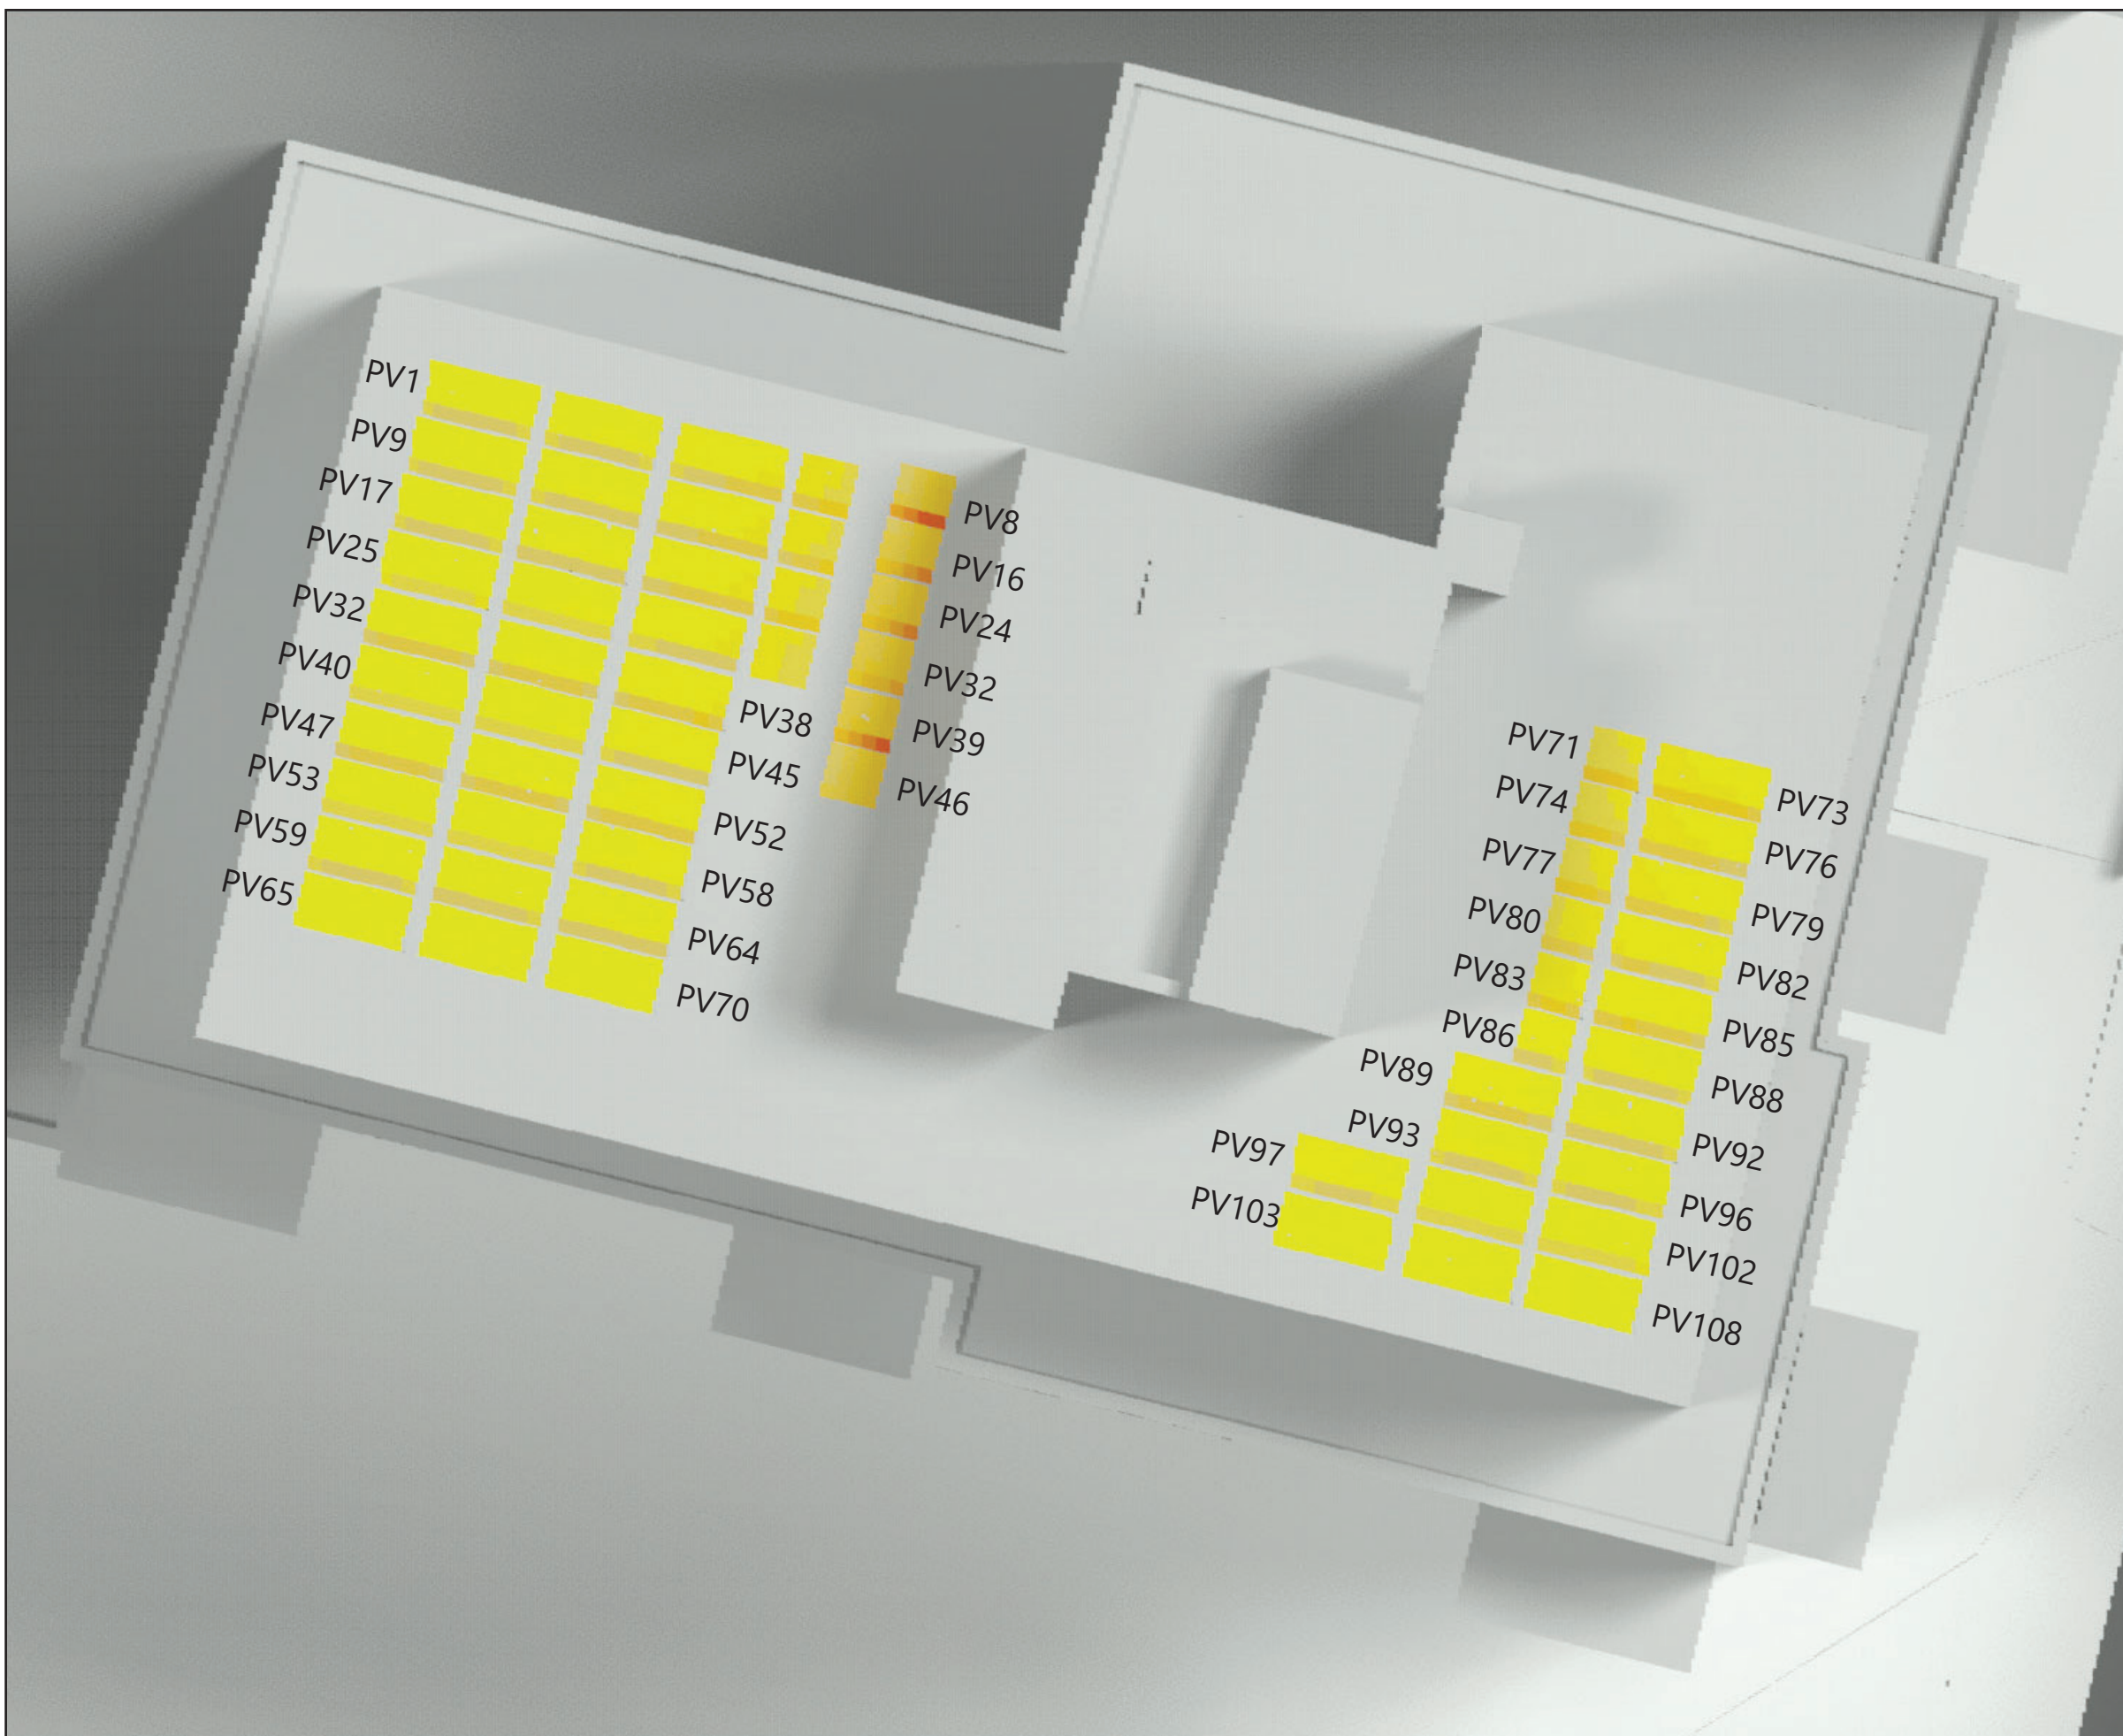

Proposed Scenario - Sunlight Exposure

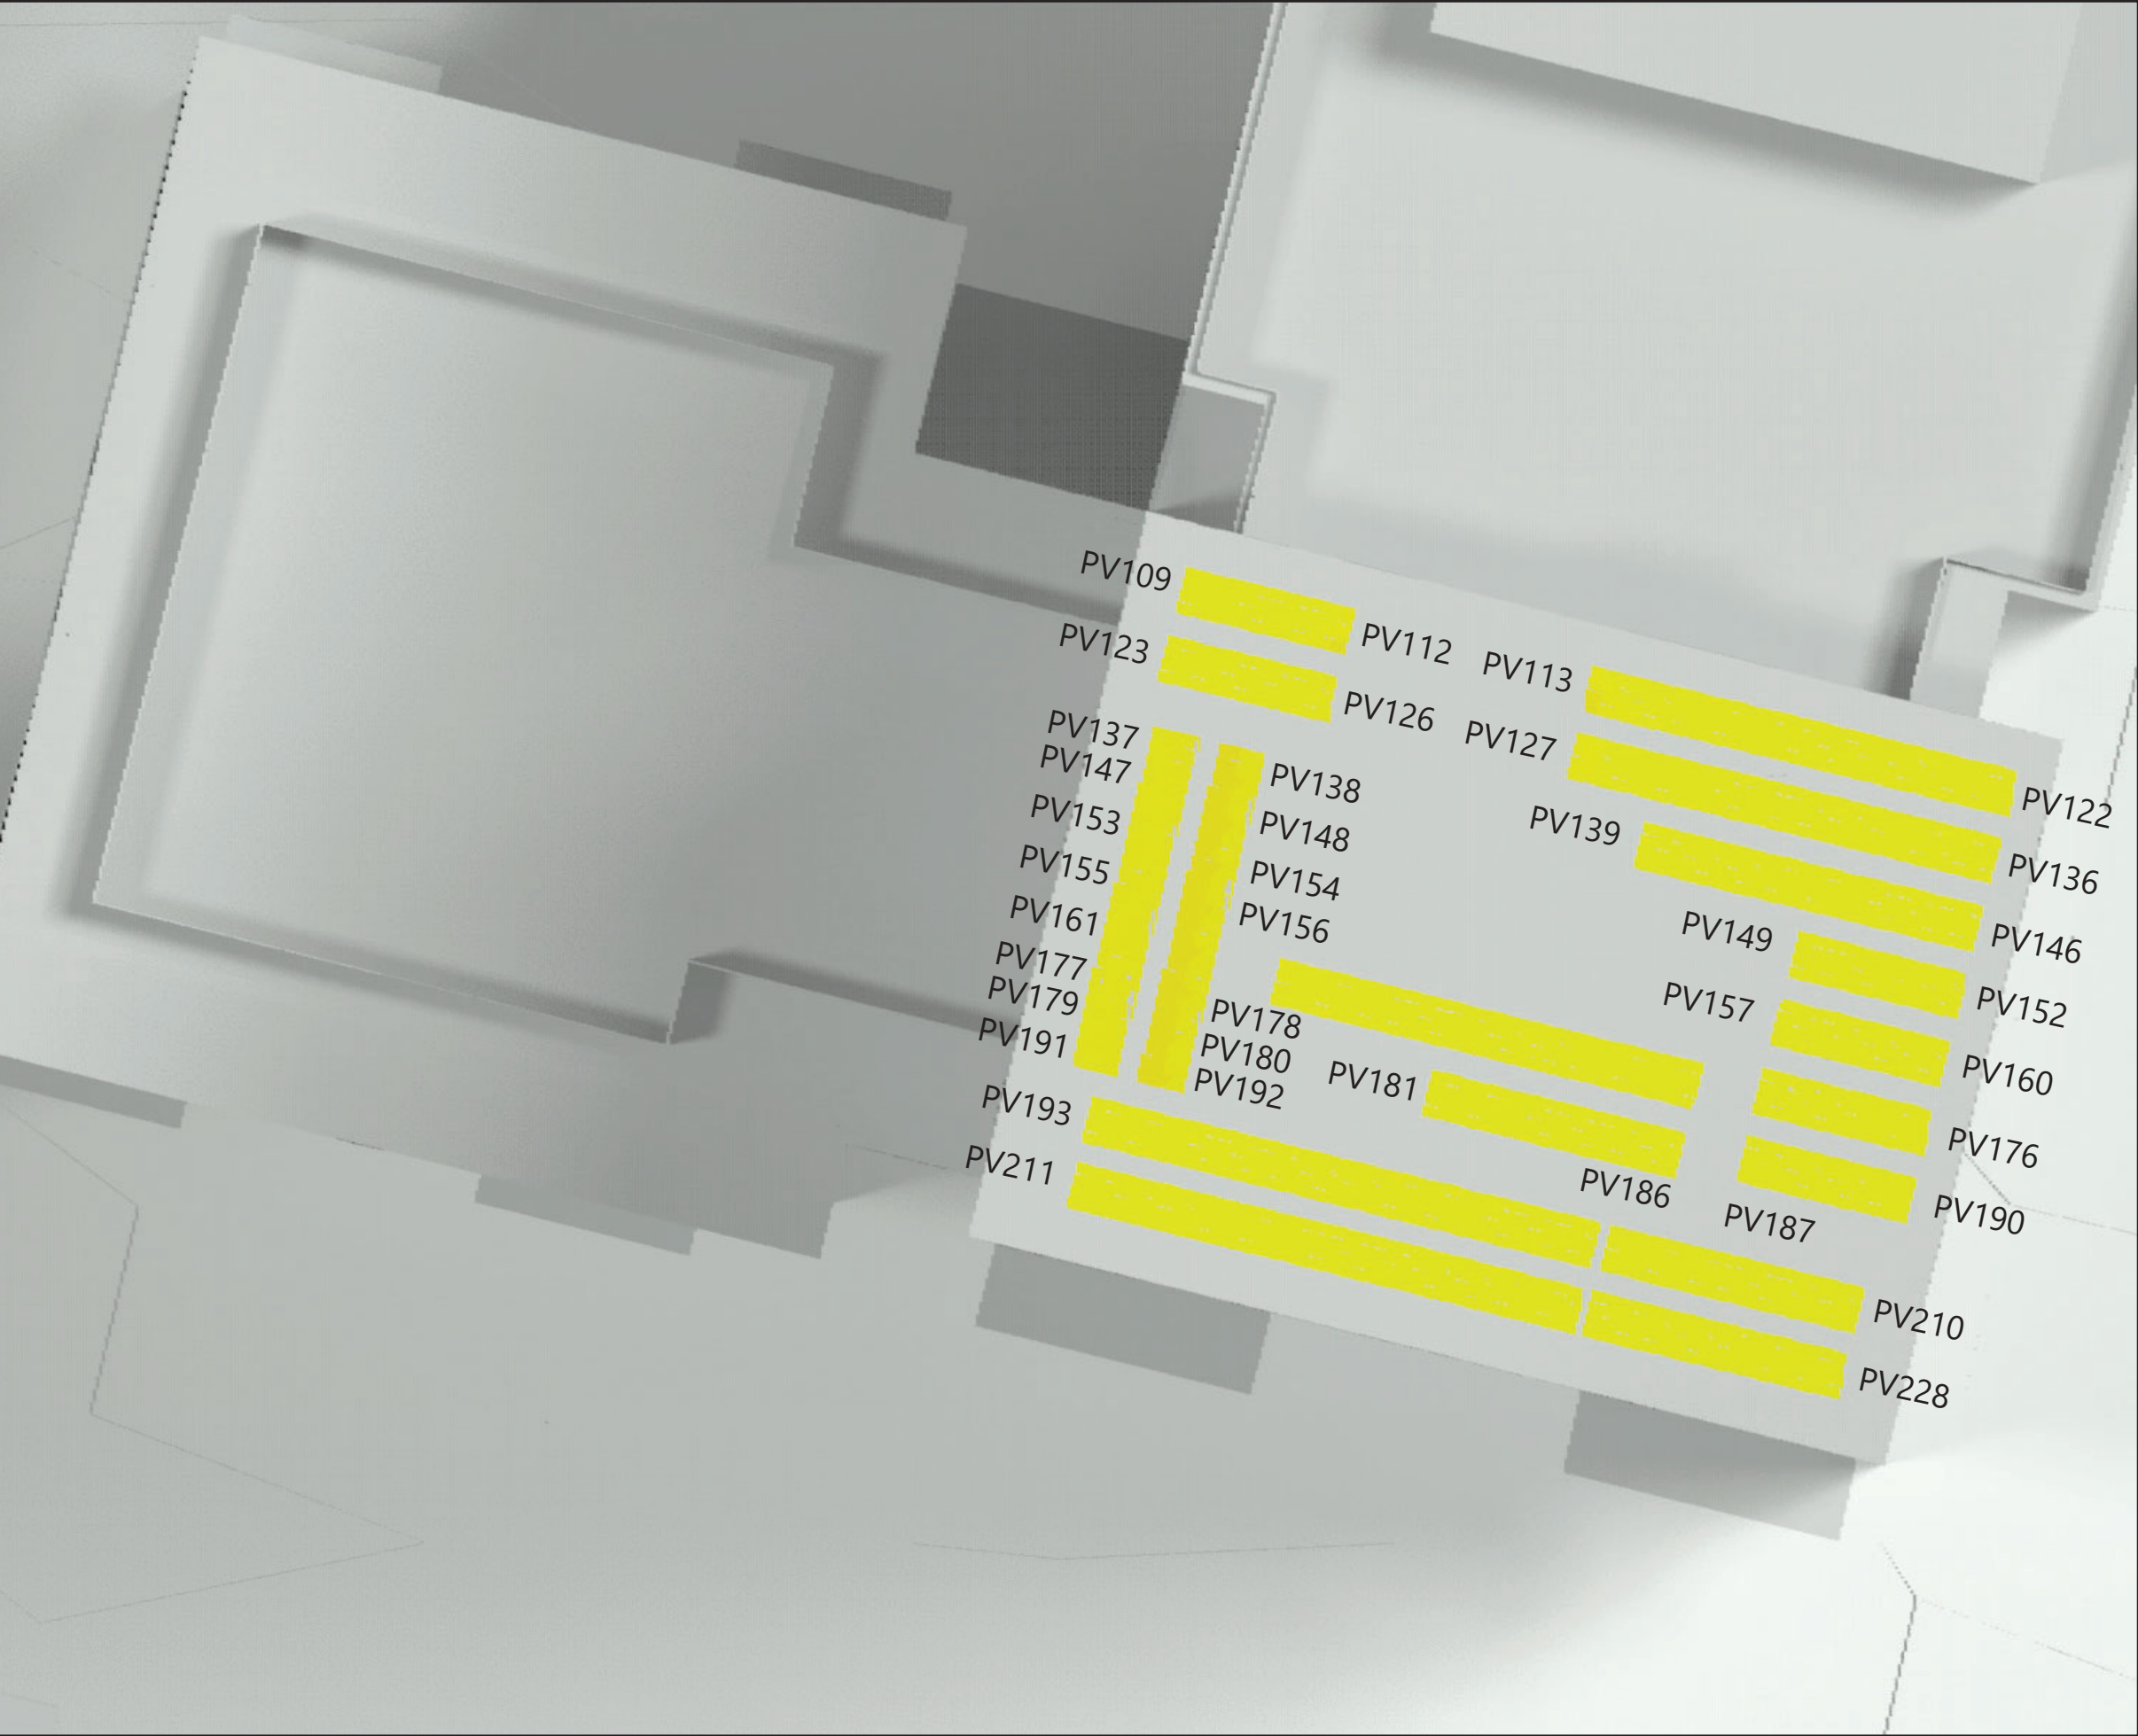


Existing Scenario - Sunlight Exposure

Sources of information

- Cloud 10**
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026
- DLA**
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

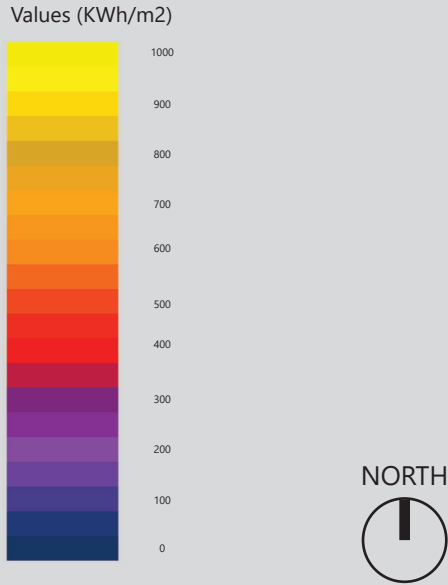


Project Ashley Road
Tottenham Hale

Title Sunlight Study
The Gessner
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV01	03

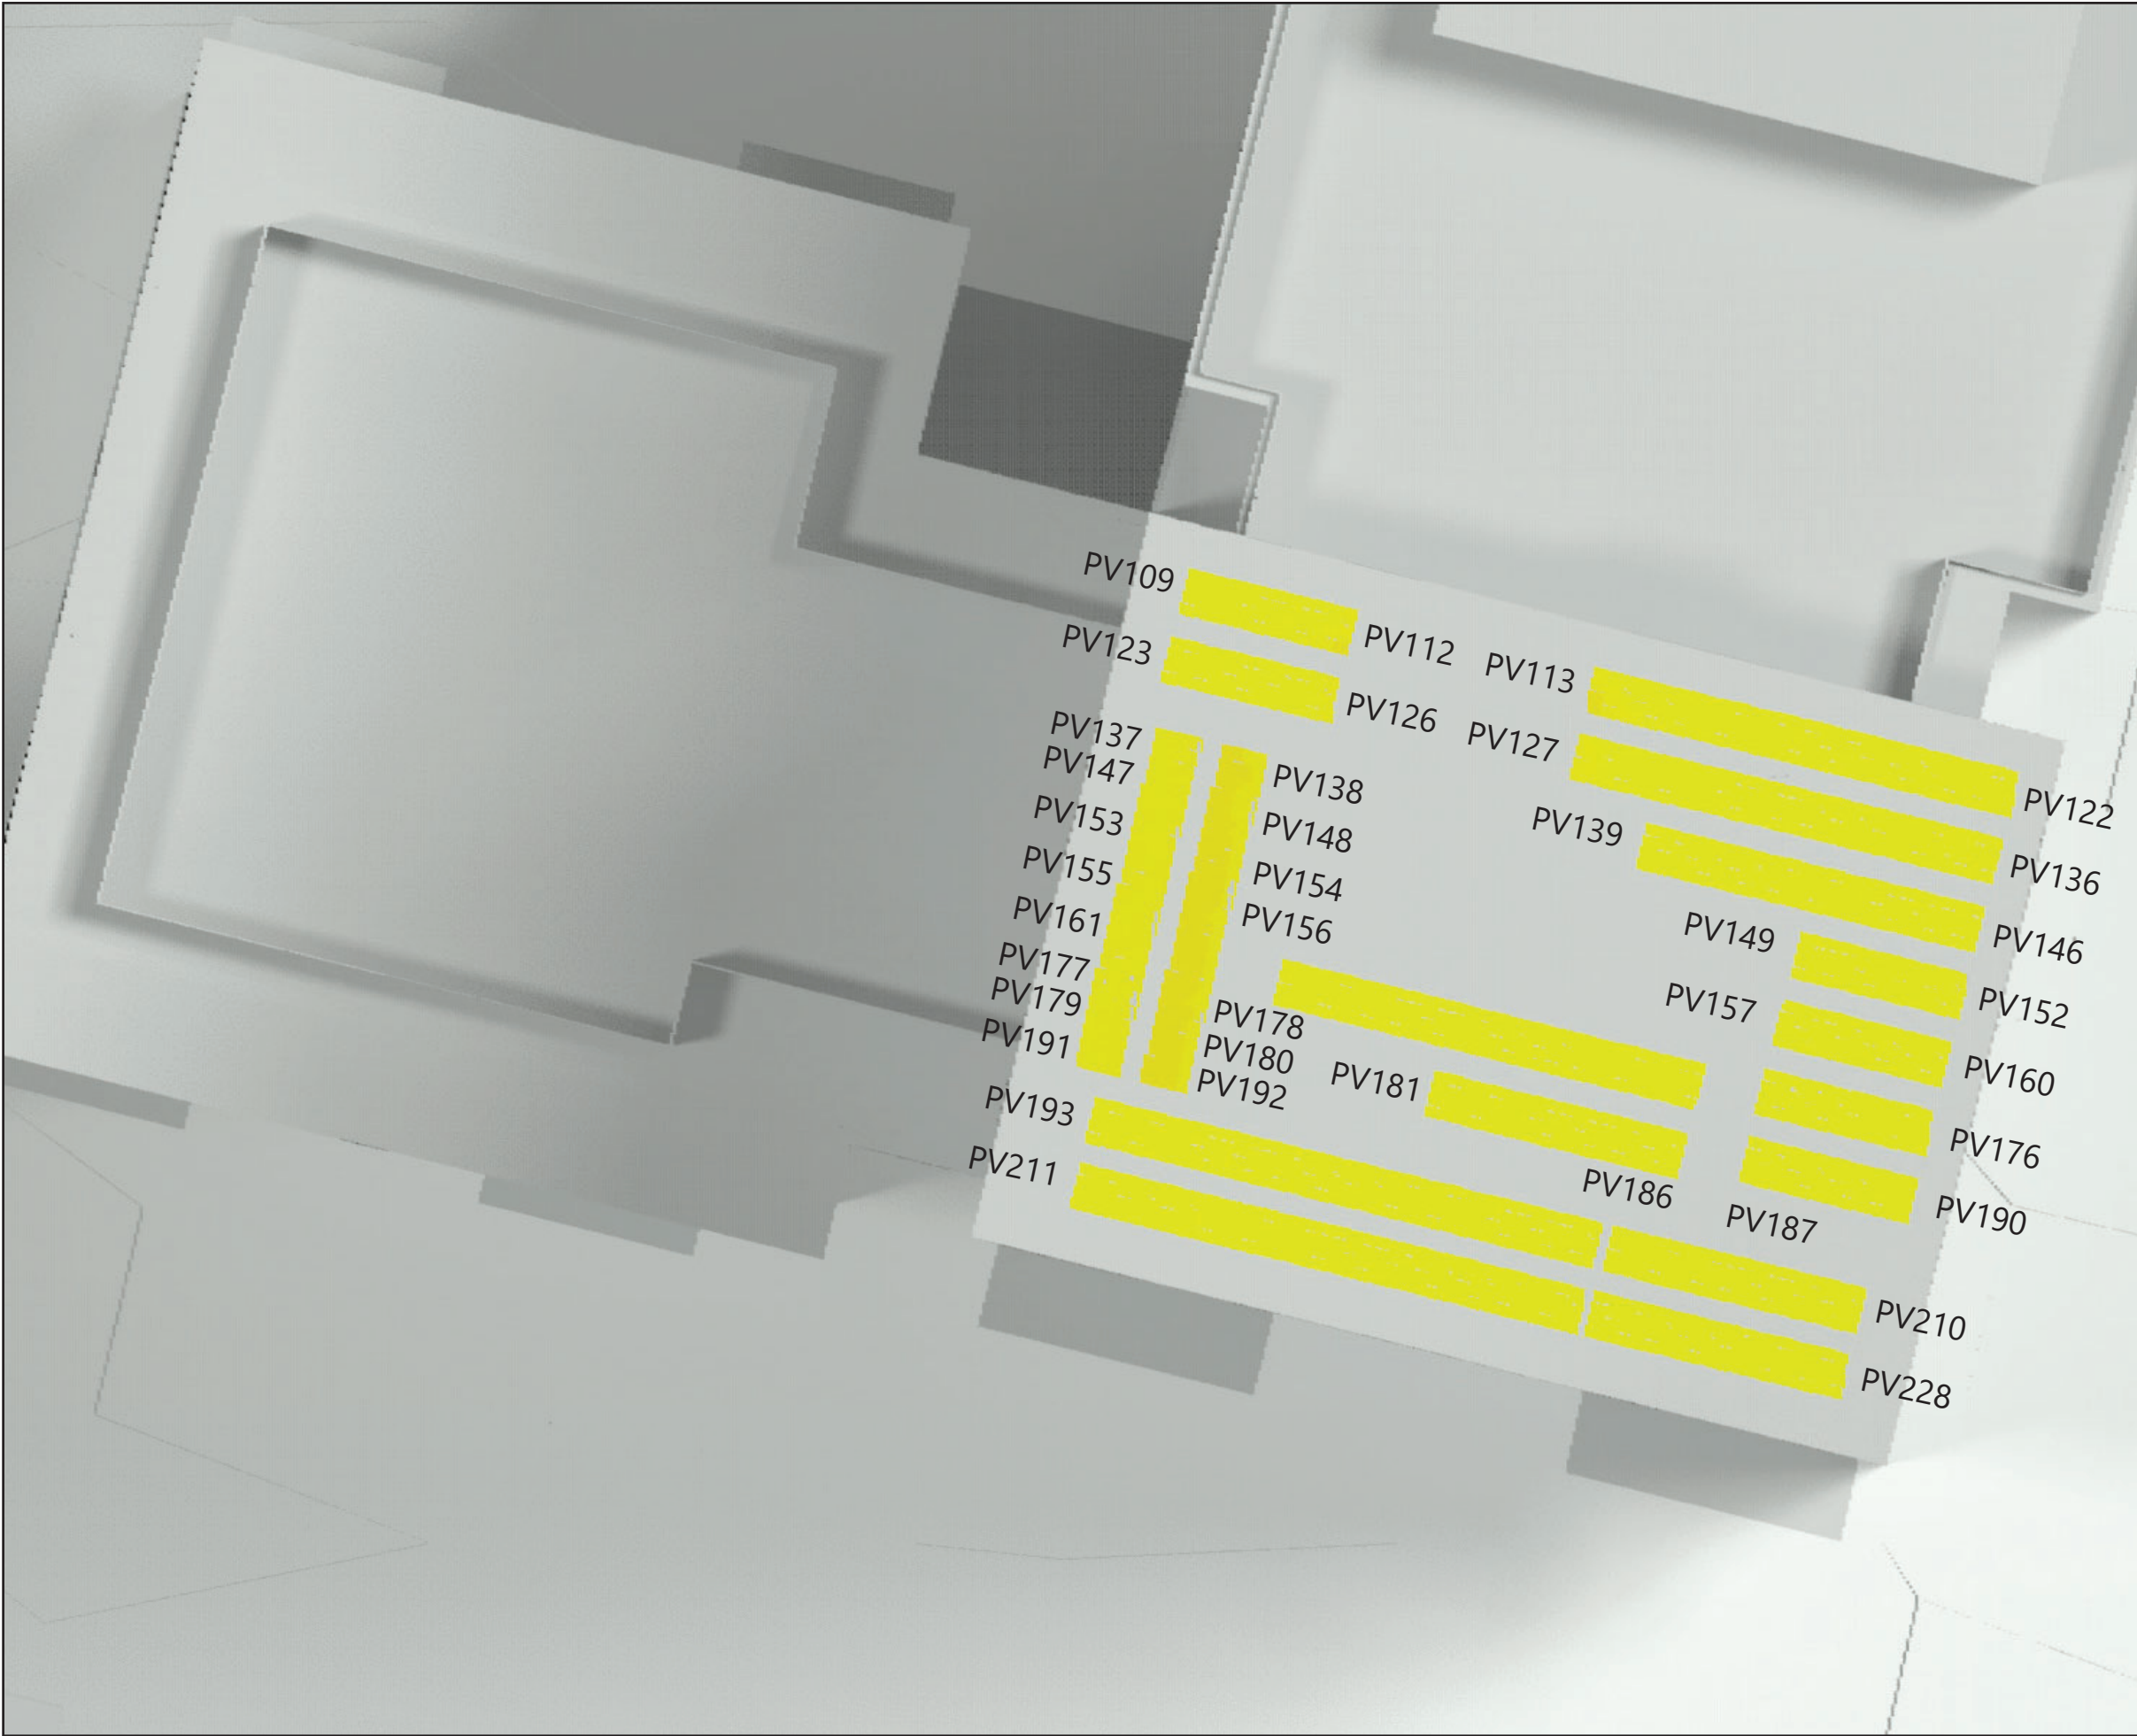


Proposed Scenario - Sunlight Exposure

Sources of information


- Cloud 10**
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

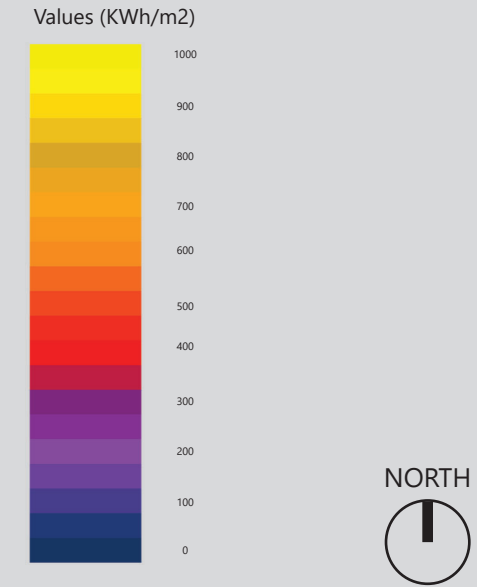

Project	Ashley Road Tottenham Hale		
Title	Sunlight Study The Gessner 21st March		
Drawn	TR	Checked	--
Date	07/08/2026	Project	10106
Rel no.	08	Prefix	PV01
		Page no.	04

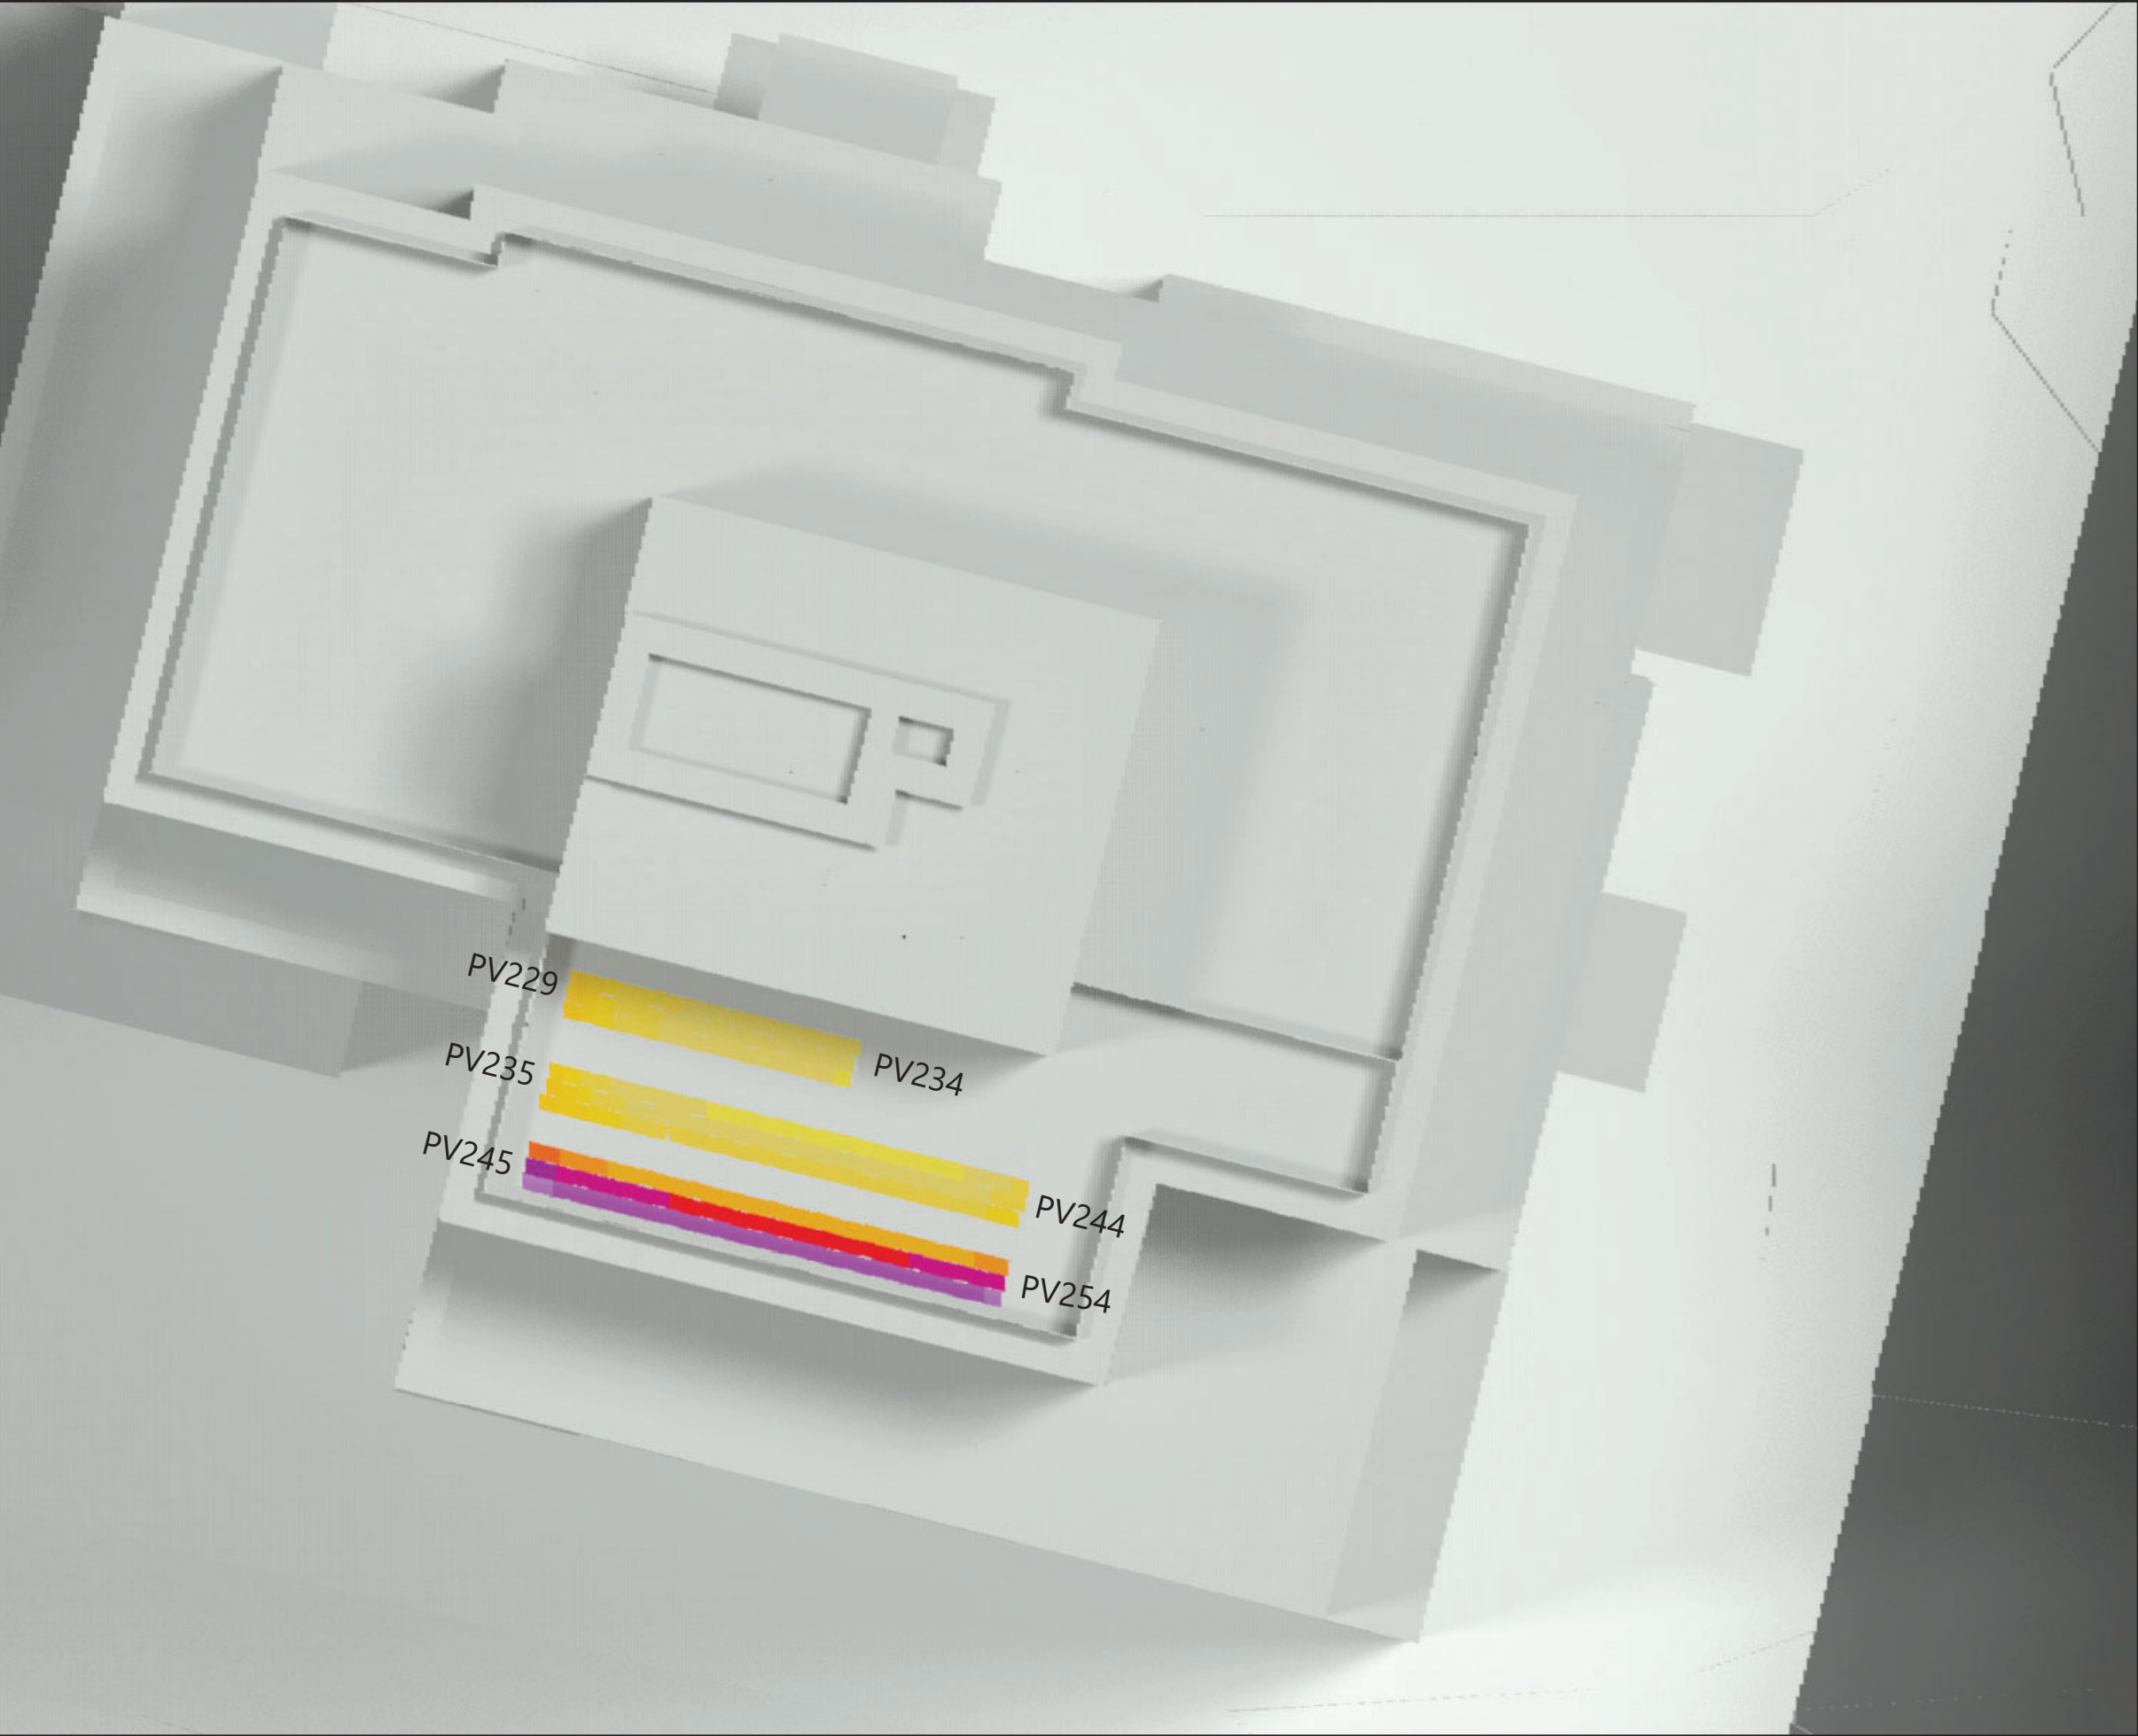


Existing Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

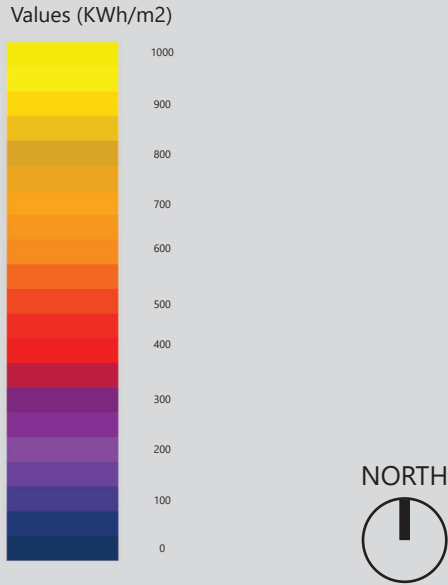


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV01 Page no. 05

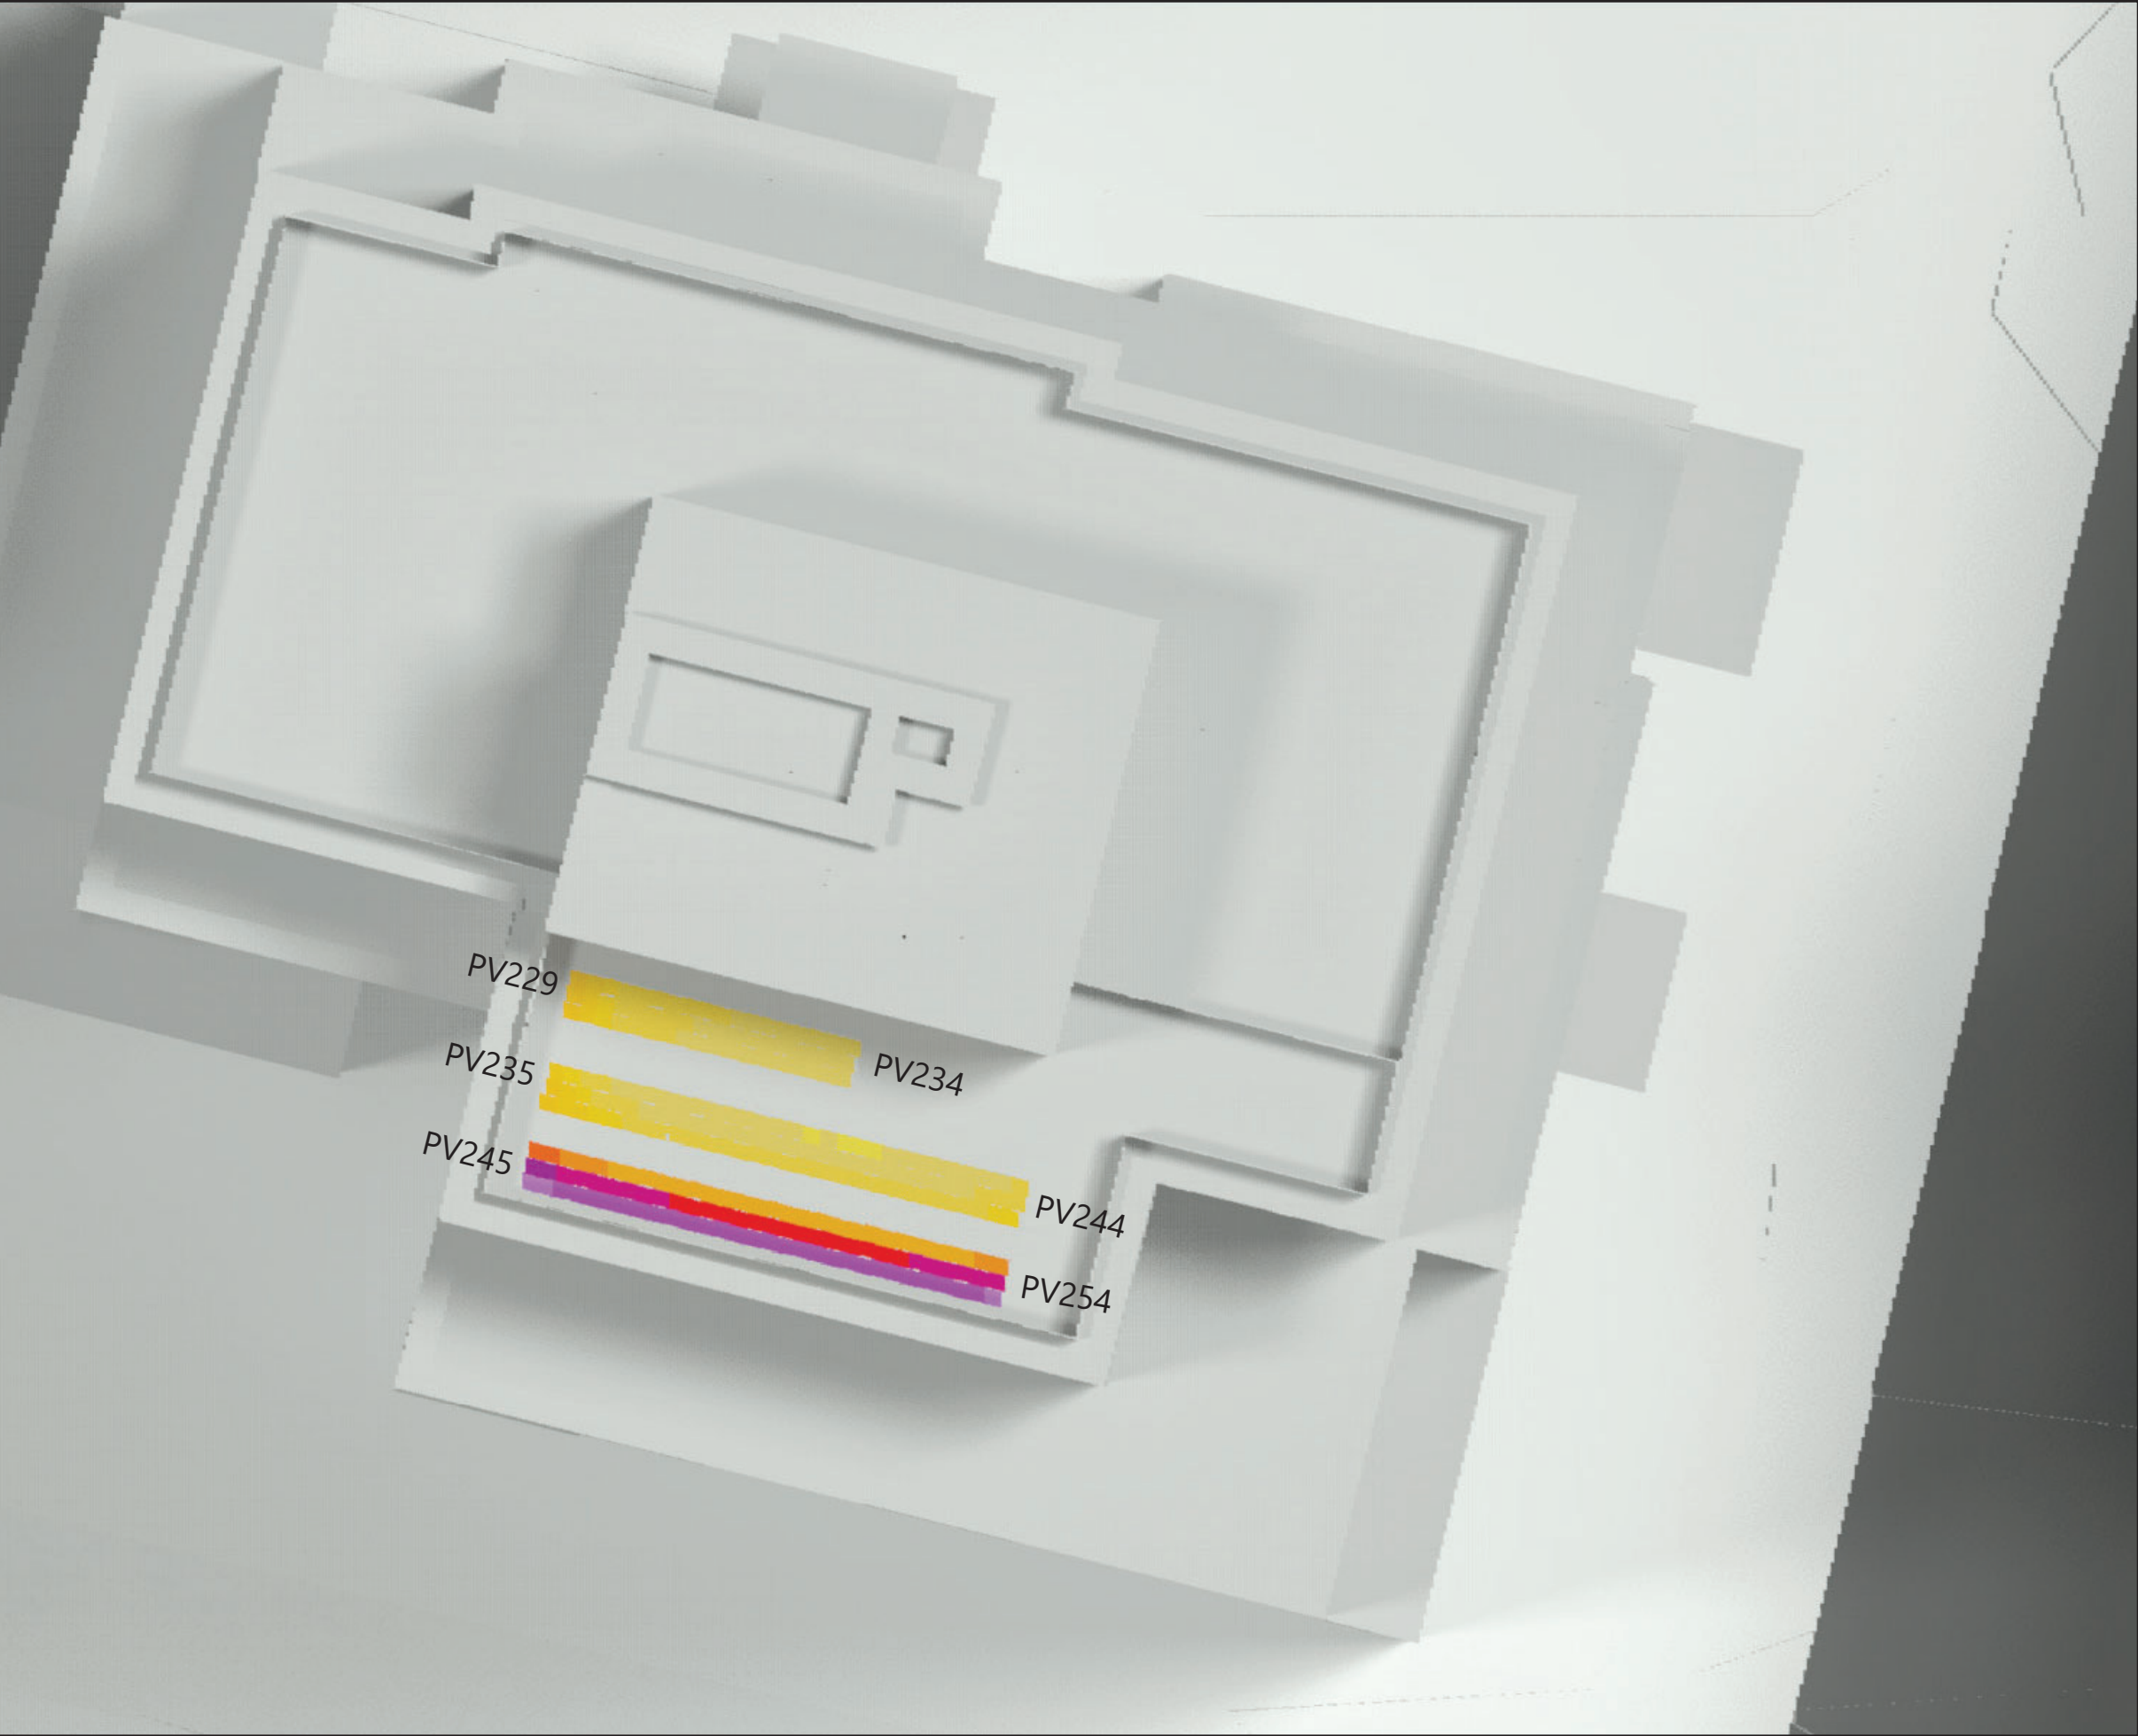


Proposed Scenario - Sunlight Exposure

Sources of information

- Cloud 10**
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026
- DLA**
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

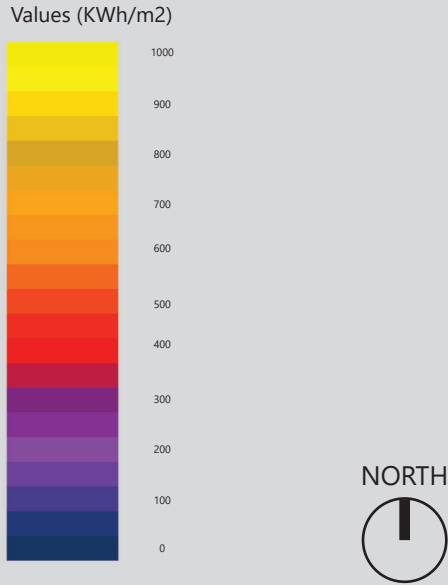

Project Ashley Road
Tottenham Hale

Title Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------


Rel no.	Prefix	Page no.
08	PV01	06

Cloud 10

DLA

EB7 Ltd

Values (KWh/m2)

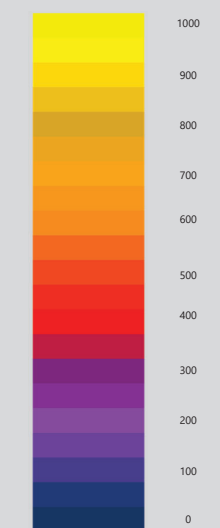

NORTH




Title Sunlight Study
East Apartments
21st March

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV01	07

eb7 © copyright 2026

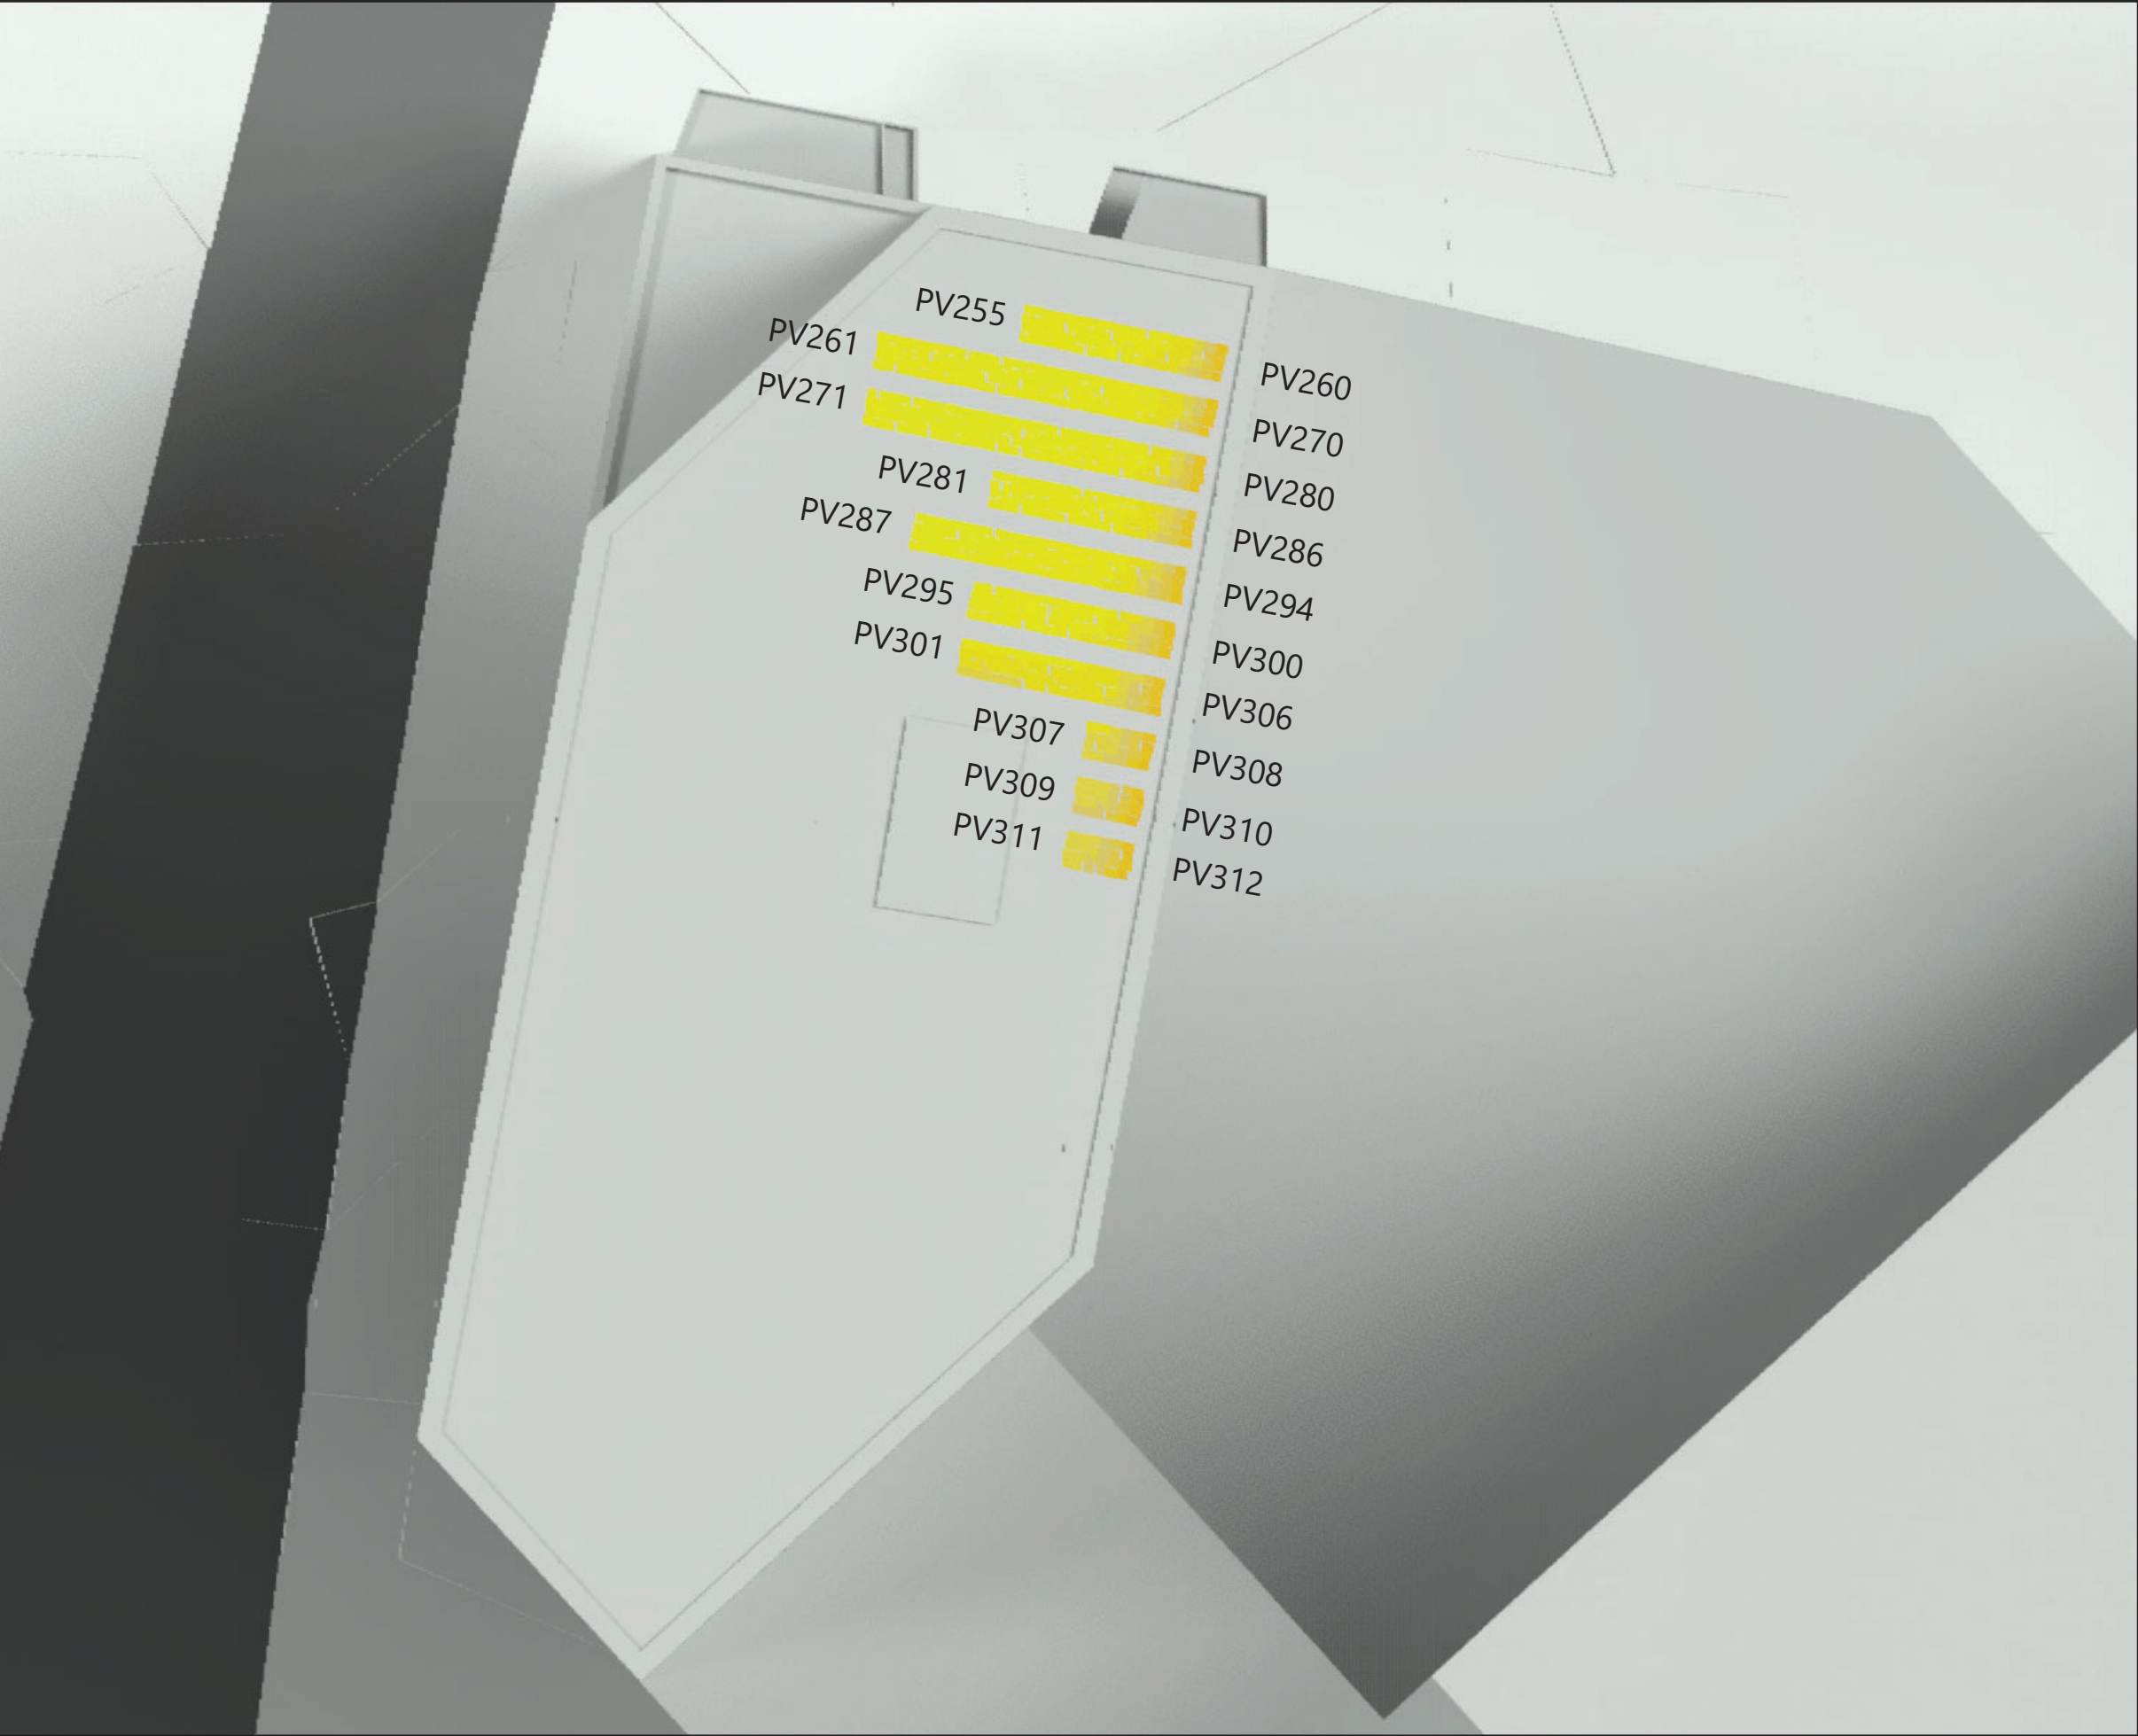


Proposed Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

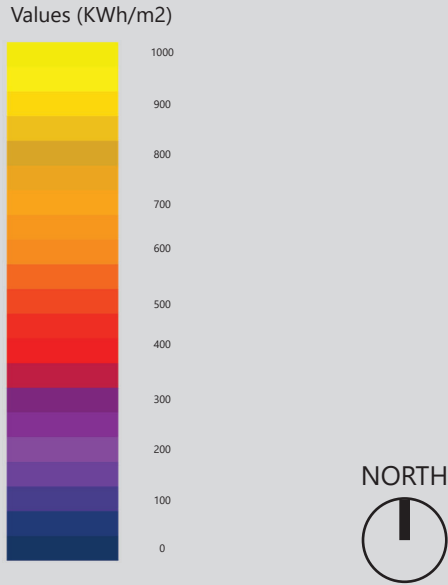

Project Ashley Road
Tottenham Hale

Title Sunlight Study
East Apartments
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------


Rel no.	Prefix	Page no.
08	PV01	08

Cloud 10

DLA


EB7 Ltd

Values (KWh/m2)

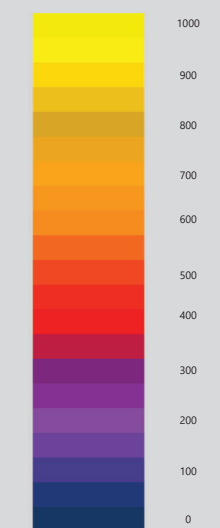

Rel no.	Prefix	Page no.
08	PV01	09

eb7 © copyright 2026

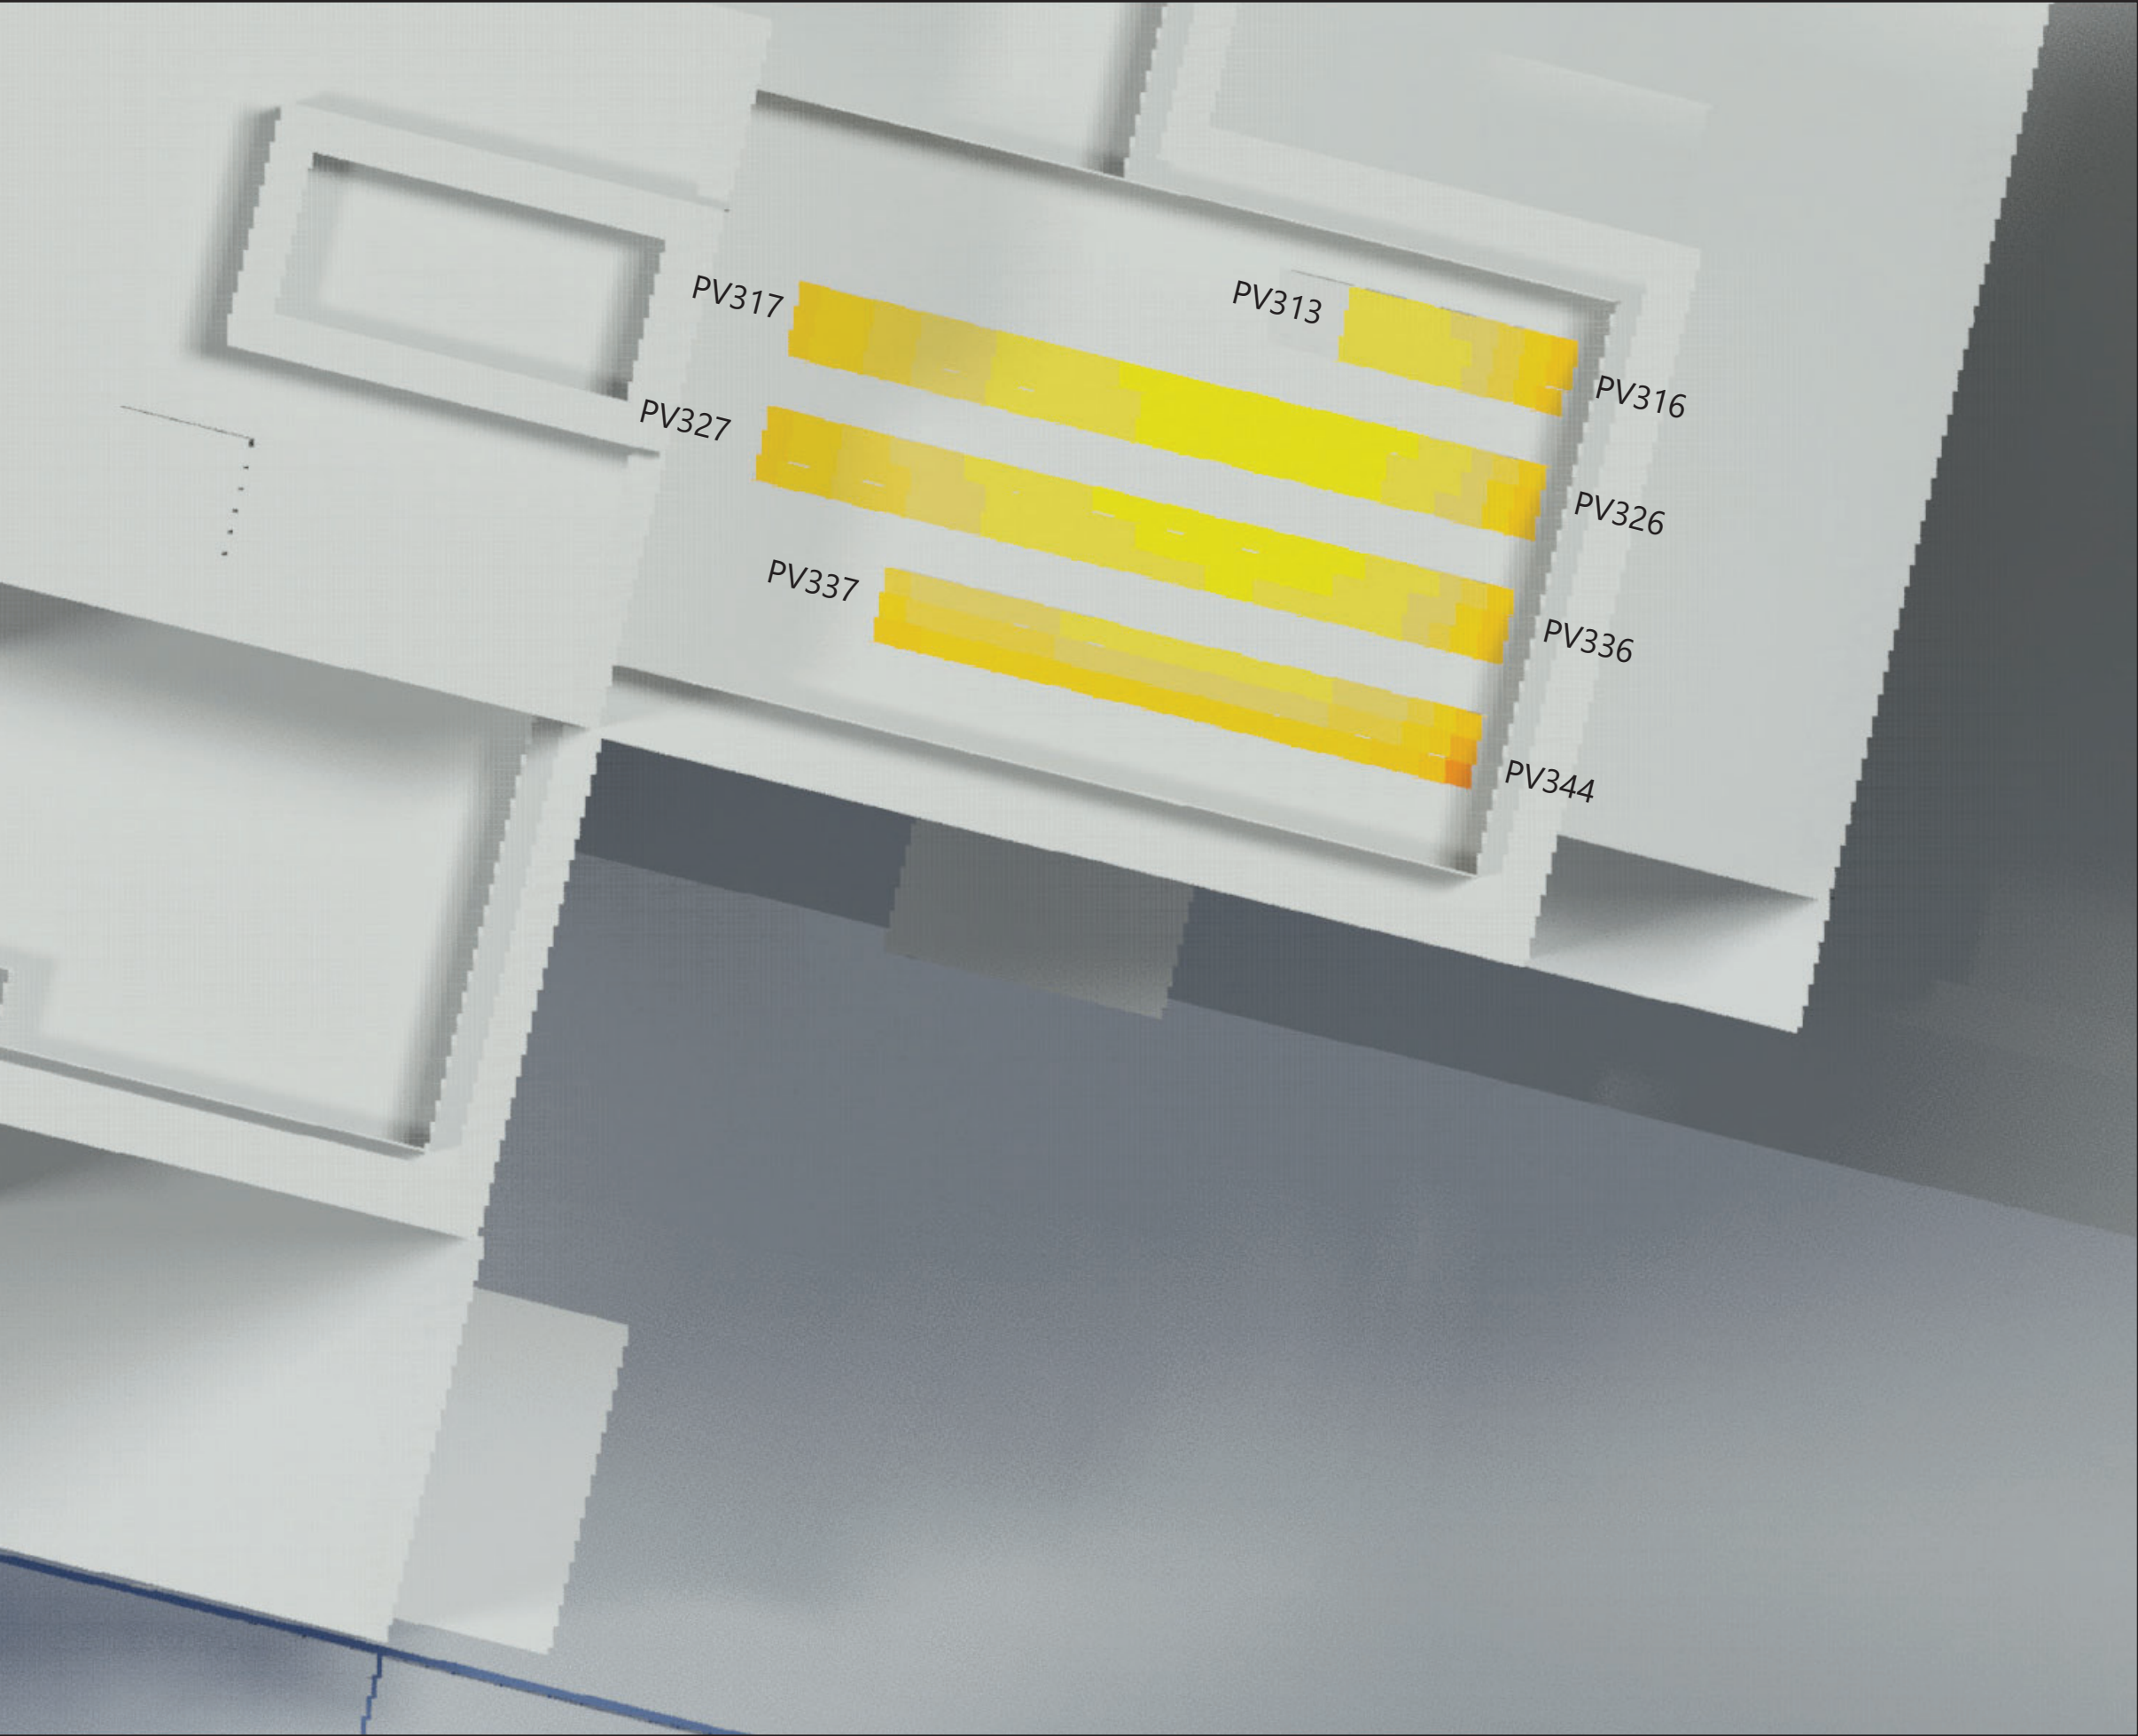


Proposed Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

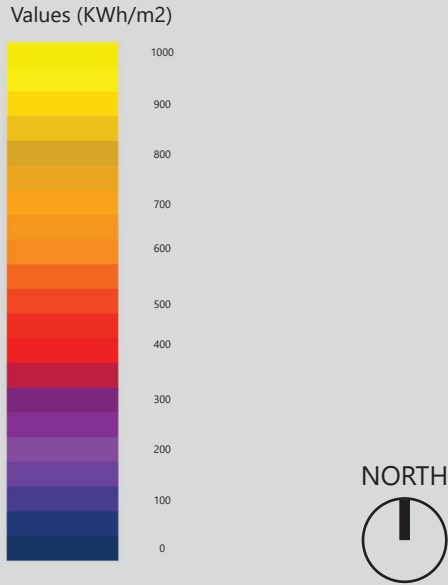

Project Ashley Road
Tottenham Hale

Title Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV01	10

Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained
		(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)	
PV01	1.0	981.8	973.8	0.99	PV43	1.0	978.5	970.8	0.99	PV85	1.0	940.3	935.4	0.99
PV02	1.0	978.1	971.2	0.99	PV44	1.0	964.3	956.0	0.99	PV86	1.0	940.1	934.5	0.99
PV03	1.0	974.3	966.7	0.99	PV45	1.0	943.2	935.8	0.99	PV87	1.0	959.2	953.0	0.99
PV04	1.0	967.1	960.3	0.99	PV46	1.0	754.4	743.6	0.99	PV88	1.0	970.2	964.9	0.99
PV05	1.0	953.7	946.0	0.99	PV47	1.0	973.7	965.0	0.99	PV89	1.0	944.0	937.3	0.99
PV06	1.0	927.8	921.4	0.99	PV48	1.0	970.1	962.4	0.99	PV90	1.0	954.3	948.6	0.99
PV07	1.0	878.2	870.8	0.99	PV49	1.0	966.6	958.0	0.99	PV91	1.0	964.9	958.4	0.99
PV08	1.0	695.9	689.1	0.99	PV50	1.0	961.2	953.7	0.99	PV92	1.0	971.4	965.9	0.99
PV09	1.0	980.0	972.1	0.99	PV51	1.0	950.1	941.8	0.99	PV93	1.0	965.8	958.9	0.99
PV10	1.0	976.2	969.1	0.99	PV52	1.0	932.7	925.5	0.99	PV94	1.0	972.5	966.5	0.99
PV11	1.0	971.6	963.9	0.99	PV53	1.0	993.3	984.0	0.99	PV95	1.0	979.4	973.1	0.99
PV12	1.0	963.4	956.6	0.99	PV54	1.0	990.0	981.9	0.99	PV96	1.0	984.5	979.0	0.99
PV13	1.0	948.3	940.4	0.99	PV55	1.0	986.8	977.9	0.99	PV97	1.0	966.3	958.6	0.99
PV14	1.0	921.1	914.5	0.99	PV56	1.0	982.8	975.0	0.99	PV98	1.0	971.6	965.3	0.99
PV15	1.0	876.8	869.4	0.99	PV57	1.0	973.9	965.2	0.99	PV99	1.0	979.3	971.9	0.99
PV16	1.0	711.5	704.4	0.99	PV58	1.0	961.7	954.2	0.99	PV100	1.0	982.8	976.8	0.99
PV17	1.0	978.7	970.2	0.99	PV59	1.0	983.0	973.8	0.99	PV101	1.0	987.3	980.8	0.99
PV18	1.0	974.8	967.6	0.99	PV60	1.0	980.4	971.9	0.99	PV102	1.0	990.8	985.2	0.99
PV19	1.0	970.0	962.0	0.99	PV61	1.0	978.4	969.0	0.99	PV103	1.0	1022.8	1012.5	0.99
PV20	1.0	961.8	954.8	0.99	PV62	1.0	974.8	967.1	0.99	PV104	1.0	1025.8	1016.0	0.99
PV21	1.0	946.1	938.4	0.99	PV63	1.0	969.4	960.4	0.99	PV105	1.0	1030.3	1020.3	0.99
PV22	1.0	919.5	912.8	0.99	PV64	1.0	961.3	953.5	0.99	PV106	1.0	1032.7	1022.9	0.99
PV23	1.0	870.0	862.1	0.99	PV65	1.0	1039.8	1026.5	0.99	PV107	1.0	1035.2	1025.5	0.99
PV24	1.0	708.3	700.6	0.99	PV66	1.0	1039.1	1025.9	0.99	PV108	1.0	1036.8	1027.5	0.99
PV25	1.0	993.0	984.5	0.99	PV67	1.0	1037.6	1024.4	0.99	PV109	0.9	1039.0	1037.5	1.00
PV26	1.0	989.3	981.8	0.99	PV68	1.0	1035.2	1022.4	0.99	PV110	0.9	1034.5	1033.5	1.00
PV27	1.0	984.3	976.2	0.99	PV69	1.0	1030.7	1018.2	0.99	PV111	0.9	1024.7	1023.6	1.00
PV28	1.0	976.9	969.7	0.99	PV70	1.0	1025.8	1013.4	0.99	PV112	0.9	989.5	988.8	1.00
PV29	1.0	960.9	952.7	0.99	PV71	1.0	838.6	837.2	1.00	PV113	0.9	980.0	980.0	1.00
PV30	1.0	934.9	928.0	0.99	PV72	1.0	887.7	883.5	1.00	PV114	0.9	1021.5	1021.5	1.00
PV31	1.0	915.7	905.1	0.99	PV73	1.0	915.1	910.3	0.99	PV115	0.9	1033.6	1033.6	1.00
PV32	1.0	717.5	709.6	0.99	PV74	1.0	855.1	851.7	1.00	PV116	0.9	1037.6	1037.1	1.00
PV33	1.0	972.9	964.3	0.99	PV75	1.0	906.1	900.3	0.99	PV117	0.9	1039.0	1038.7	1.00
PV34	1.0	968.9	961.6	0.99	PV76	1.0	932.3	927.2	0.99	PV118	0.9	1040.2	1039.5	1.00
PV35	1.0	964.5	956.4	0.99	PV77	1.0	863.4	857.5	0.99	PV119	0.9	1040.9	1040.0	1.00
PV36	1.0	957.4	950.3	0.99	PV78	1.0	912.6	906.8	0.99	PV120	0.9	1041.2	1040.4	1.00
PV37	1.0	943.1	935.1	0.99	PV79	1.0	936.8	931.6	0.99	PV121	0.9	1042.1	1041.6	1.00
PV38	1.0	919.0	912.1	0.99	PV80	1.0	884.7	877.9	0.99	PV122	0.9	1044.9	1044.1	1.00
PV39	1.0	698.9	691.2	0.99	PV81	1.0	927.1	921.0	0.99	PV123	0.9	1045.8	1044.3	1.00
PV40	1.0	992.0	983.2	0.99	PV82	1.0	947.5	942.2	0.99	PV124	0.9	1044.0	1042.6	1.00
PV41	1.0	988.7	980.7	0.99	PV83	1.0	897.7	891.2	0.99	PV125	0.9	1036.2	1035.1	1.00
PV42	1.0	984.2	975.8	0.99	PV84	1.0	925.1	919.0	0.99	PV126	0.9	1005.7	1004.1	1.00

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project Ashley Road
Tottenham Hale

Title

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV01 Page no. 11

Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained
		(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)	
PV127	0.9	994.3	994.3	1.00	PV169	0.9	994.3	994.3	1.00	PV211	0.9	1046.1	1044.6	1.00
PV128	0.9	1032.1	1031.5	1.00	PV170	0.9	1032.1	1031.5	1.00	PV212	0.9	1046.3	1045.1	1.00
PV129	0.9	1038.4	1037.4	1.00	PV171	0.9	1038.4	1037.4	1.00	PV213	0.9	1046.4	1045.2	1.00
PV130	0.9	1040.4	1039.2	1.00	PV172	0.9	1040.4	1039.2	1.00	PV214	0.9	1047.1	1045.2	1.00
PV131	0.9	1041.2	1040.4	1.00	PV173	0.9	1041.2	1040.4	1.00	PV215	0.9	1047.2	1045.6	1.00
PV132	0.9	1041.9	1041.2	1.00	PV174	0.9	1041.9	1041.2	1.00	PV216	0.9	1047.5	1046.1	1.00
PV133	0.9	1042.4	1041.5	1.00	PV175	0.9	1042.4	1041.5	1.00	PV217	0.9	1047.6	1046.2	1.00
PV134	0.9	1042.7	1041.7	1.00	PV176	0.9	1042.7	1041.7	1.00	PV218	0.9	1048.0	1046.5	1.00
PV135	0.9	1043.4	1042.7	1.00	PV177	0.9	1043.4	1042.7	1.00	PV219	0.9	1048.1	1046.8	1.00
PV136	0.9	1045.9	1045.1	1.00	PV178	0.9	1045.9	1045.1	1.00	PV220	0.9	1048.4	1047.0	1.00
PV137	0.9	955.4	953.4	1.00	PV179	0.9	955.4	953.4	1.00	PV221	0.9	1048.8	1047.2	1.00
PV138	0.9	945.6	944.5	1.00	PV180	0.9	945.6	944.5	1.00	PV222	0.9	1048.5	1047.5	1.00
PV139	0.9	1048.1	1046.8	1.00	PV181	0.9	1048.1	1046.8	1.00	PV223	0.9	1049.0	1047.9	1.00
PV140	0.9	1048.7	1047.9	1.00	PV182	0.9	1048.7	1047.9	1.00	PV224	0.9	1049.1	1048.0	1.00
PV141	0.9	1049.1	1047.9	1.00	PV183	0.9	1049.1	1047.9	1.00	PV225	0.9	1049.2	1048.1	1.00
PV142	0.9	1047.1	1046.0	1.00	PV184	0.9	1047.1	1046.0	1.00	PV226	0.9	1049.6	1048.3	1.00
PV143	0.9	1042.9	1041.5	1.00	PV185	0.9	1042.9	1041.5	1.00	PV227	0.9	1049.7	1048.6	1.00
PV144	0.9	1041.9	1040.9	1.00	PV186	0.9	1041.9	1040.9	1.00	PV228	0.9	1050.0	1048.8	1.00
PV145	0.9	1042.1	1041.5	1.00	PV187	0.8	1042.1	1041.5	1.00	PV229	0.8	681.8	681.8	1.00
PV146	0.9	1044.8	1043.8	1.00	PV188	0.8	1044.8	1043.8	1.00	PV230	0.8	777.0	771.5	0.99
PV147	0.9	955.2	953.1	1.00	PV189	0.8	955.2	953.1	1.00	PV231	0.8	812.4	797.2	0.98
PV148	0.9	944.6	943.7	1.00	PV190	0.8	944.6	943.7	1.00	PV232	0.8	826.9	808.9	0.98
PV149	0.9	1043.4	1042.5	1.00	PV191	0.8	1043.4	1042.5	1.00	PV233	0.8	835.1	816.1	0.98
PV150	0.9	1042.6	1041.6	1.00	PV192	0.8	1042.6	1041.6	1.00	PV234	0.8	840.5	821.4	0.98
PV151	0.9	1042.9	1042.2	1.00	PV193	0.8	1042.9	1042.2	1.00	PV235	0.8	687.7	687.7	1.00
PV152	0.9	1045.5	1044.7	1.00	PV194	0.8	1045.5	1044.7	1.00	PV236	0.8	778.7	774.4	0.99
PV153	0.9	954.7	953.0	1.00	PV195	0.8	954.7	953.0	1.00	PV237	0.8	810.6	802.2	0.99
PV154	0.9	944.4	943.2	1.00	PV196	0.8	944.4	943.2	1.00	PV238	0.8	823.8	814.6	0.99
PV155	0.9	955.0	952.8	1.00	PV197	0.8	955.0	952.8	1.00	PV239	0.8	830.3	821.4	0.99
PV156	0.9	944.2	943.2	1.00	PV198	0.8	944.2	943.2	1.00	PV240	0.8	833.1	824.8	0.99
PV157	0.9	1043.2	1042.2	1.00	PV199	0.8	1043.2	1042.2	1.00	PV241	0.8	833.8	825.3	0.99
PV158	0.9	1042.6	1041.6	1.00	PV200	0.8	1042.6	1041.6	1.00	PV242	0.8	831.0	822.9	0.99
PV159	0.9	1043.1	1042.2	1.00	PV201	0.8	1043.1	1042.2	1.00	PV243	0.8	820.0	812.1	0.99
PV160	0.9	1045.4	1044.8	1.00	PV202	0.8	1045.4	1044.8	1.00	PV244	0.8	783.2	775.2	0.99
PV161	0.9	954.7	952.6	1.00	PV203	0.8	954.7	952.6	1.00	PV245	0.8	358.3	358.3	1.00
PV162	0.9	944.1	942.9	1.00	PV204	0.8	944.1	942.9	1.00	PV246	0.8	397.8	397.8	1.00
PV163	0.9	1045.9	1045.0	1.00	PV205	0.8	1045.9	1045.0	1.00	PV247	0.8	413.1	413.1	1.00
PV164	0.9	1046.7	1045.1	1.00	PV206	0.8	1046.7	1045.1	1.00	PV248	0.8	420.1	420.1	1.00
PV165	0.9	1046.7	1045.4	1.00	PV207	0.8	1046.7	1045.4	1.00	PV249	0.8	423.4	423.4	1.00
PV166	0.9	1045.2	1043.8	1.00	PV208	0.8	1045.2	1043.8	1.00	PV250	0.8	424.3	424.3	1.00
PV167	0.9	1042.1	1040.8	1.00	PV209	0.8	1042.1	1040.8	1.00	PV251	0.8	423.7	423.7	1.00
PV168	0.9	1041.2	1040.1	1.00	PV210	0.8	1041.2	1040.1	1.00	PV252	0.8	420.8	420.8	1.00

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project Ashley Road
Tottenham Hale

Title

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV01 Page no. 12

Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained
		(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)	
PV253	0.8	412.2	412.2	1.00	PV295	0.9	985.2	985.2	1.00	PV337	0.8	766.8	753.2	0.98
PV254	0.8	387.5	387.5	1.00	PV296	0.9	982.7	982.5	1.00	PV338	0.8	792.7	779.5	0.98
PV255	0.9	994.4	994.4	1.00	PV297	0.9	974.0	974.0	1.00	PV339	0.8	808.9	795.7	0.98
PV256	0.9	993.1	993.1	1.00	PV298	0.9	958.7	958.6	1.00	PV340	0.8	818.2	805.7	0.98
PV257	0.9	986.3	986.3	1.00	PV299	0.9	914.1	913.9	1.00	PV341	0.8	821.7	808.8	0.98
PV258	0.9	970.8	970.8	1.00	PV300	0.9	759.0	758.8	1.00	PV342	0.8	815.5	802.6	0.98
PV259	0.9	923.7	923.7	1.00	PV301	0.9	915.6	915.4	1.00	PV343	0.8	785.9	773.6	0.98
PV260	0.9	767.4	767.6	1.00	PV302	0.9	926.6	926.6	1.00	PV344	0.8	666.2	653.9	0.98
PV261	0.9	969.8	969.8	1.00	PV303	0.9	934.7	934.7	1.00					
PV262	0.9	991.4	991.4	1.00	PV304	0.9	934.0	933.9	1.00					
PV263	0.9	999.6	999.6	1.00	PV305	0.9	901.1	901.2	1.00					
PV264	0.9	1002.9	1002.9	1.00	PV306	0.9	751.1	751.2	1.00					
PV265	0.9	1002.6	1002.6	1.00	PV307	0.9	877.1	876.9	1.00					
PV266	0.9	1000.0	1000.0	1.00	PV308	0.9	740.8	740.8	1.00					
PV267	0.9	992.8	992.8	1.00	PV309	0.9	861.0	861.0	1.00					
PV268	0.9	976.5	976.5	1.00	PV310	0.9	733.2	733.2	1.00					
PV269	0.9	928.2	928.3	1.00	PV311	0.9	862.6	862.6	1.00					
PV270	0.9	770.9	771.1	1.00	PV312	0.9	735.5	735.5	1.00					
PV271	0.9	996.9	996.9	1.00	PV313	0.8	920.5	886.1	0.96					
PV272	0.9	1004.7	1004.7	1.00	PV314	0.8	917.4	883.7	0.96					
PV273	0.9	1007.2	1007.2	1.00	PV315	0.8	884.5	851.1	0.96					
PV274	0.9	1007.1	1007.1	1.00	PV316	0.8	750.2	717.1	0.96					
PV275	0.9	1003.6	1003.6	1.00	PV317	0.8	721.5	716.6	0.99					
PV276	0.9	999.3	999.3	1.00	PV318	0.8	804.8	788.1	0.98					
PV277	0.9	991.5	991.5	1.00	PV319	0.8	864.5	837.8	0.97					
PV278	0.9	974.9	975.1	1.00	PV320	0.8	907.6	874.8	0.96					
PV279	0.9	926.6	926.7	1.00	PV321	0.8	931.8	897.7	0.96					
PV280	0.9	769.0	769.1	1.00	PV322	0.8	945.0	911.6	0.96					
PV281	0.9	1001.1	1001.1	1.00	PV323	0.8	952.6	919.1	0.96					
PV282	0.9	997.6	997.6	1.00	PV324	0.8	945.7	912.9	0.97					
PV283	0.9	989.3	989.4	1.00	PV325	0.8	908.8	876.4	0.96					
PV284	0.9	972.8	972.8	1.00	PV326	0.8	768.4	736.1	0.96					
PV285	0.9	924.4	924.3	1.00	PV327	0.8	718.3	708.6	0.99					
PV286	0.9	766.8	766.5	1.00	PV328	0.8	801.3	779.3	0.97					
PV287	0.9	1003.3	1003.3	1.00	PV329	0.8	861.5	832.5	0.97					
PV288	0.9	1002.5	1002.5	1.00	PV330	0.8	899.0	869.5	0.97					
PV289	0.9	998.6	998.7	1.00	PV331	0.8	921.5	892.6	0.97					
PV290	0.9	993.9	993.9	1.00	PV332	0.8	934.5	905.7	0.97					
PV291	0.9	985.1	985.2	1.00	PV333	0.8	939.5	910.8	0.97					
PV292	0.9	968.3	968.2	1.00	PV334	0.8	930.8	902.9	0.97					
PV293	0.9	920.2	920.1	1.00	PV335	0.8	893.9	866.3	0.97					
PV294	0.9	763.2	763.2	1.00	PV336	0.8	755.6	728.4	0.96					

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project Ashley Road
Tottenham Hale

Title

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV01 Page no. 13



Cumulative Scenario

Sources of information

Cloud 10

Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026


DLA

03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd

Site Photographs
Ordnance Survey

Values (KWh/m2)

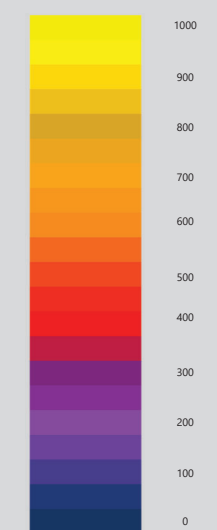


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Sessile Apartments
21st March


Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV02 Page no. 01

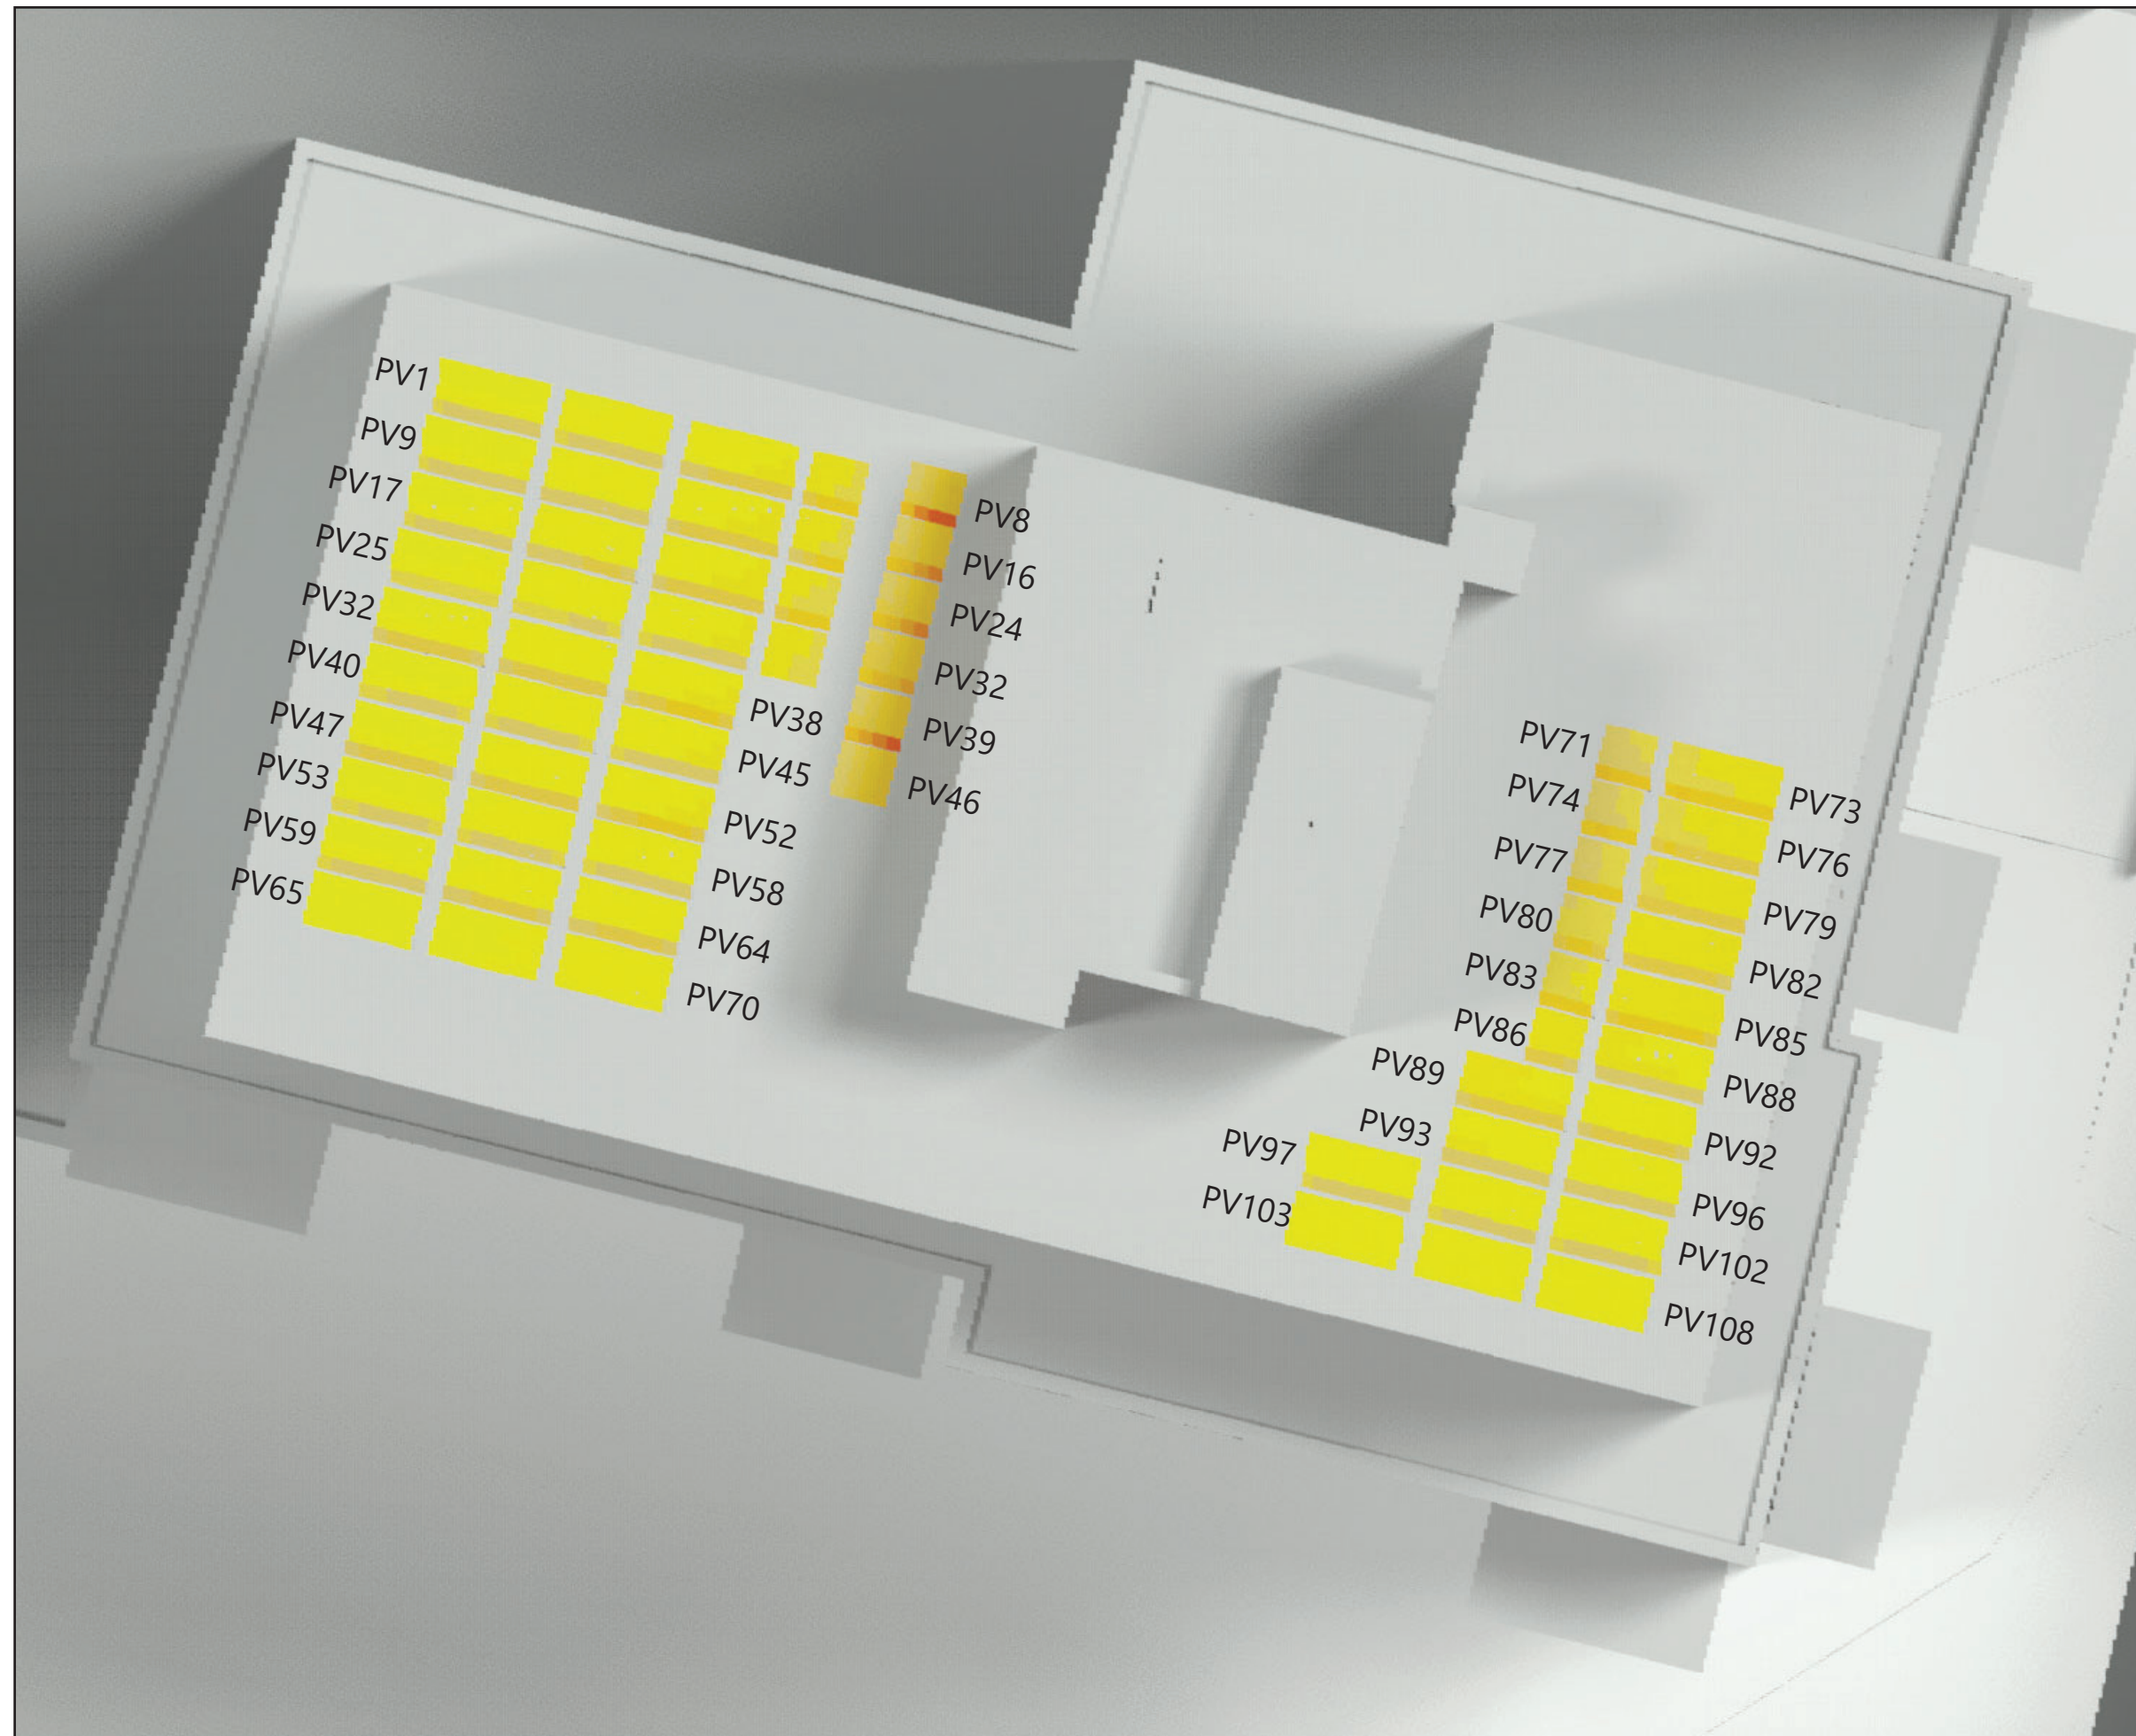

Existing Scenario - Sunlight Exposure

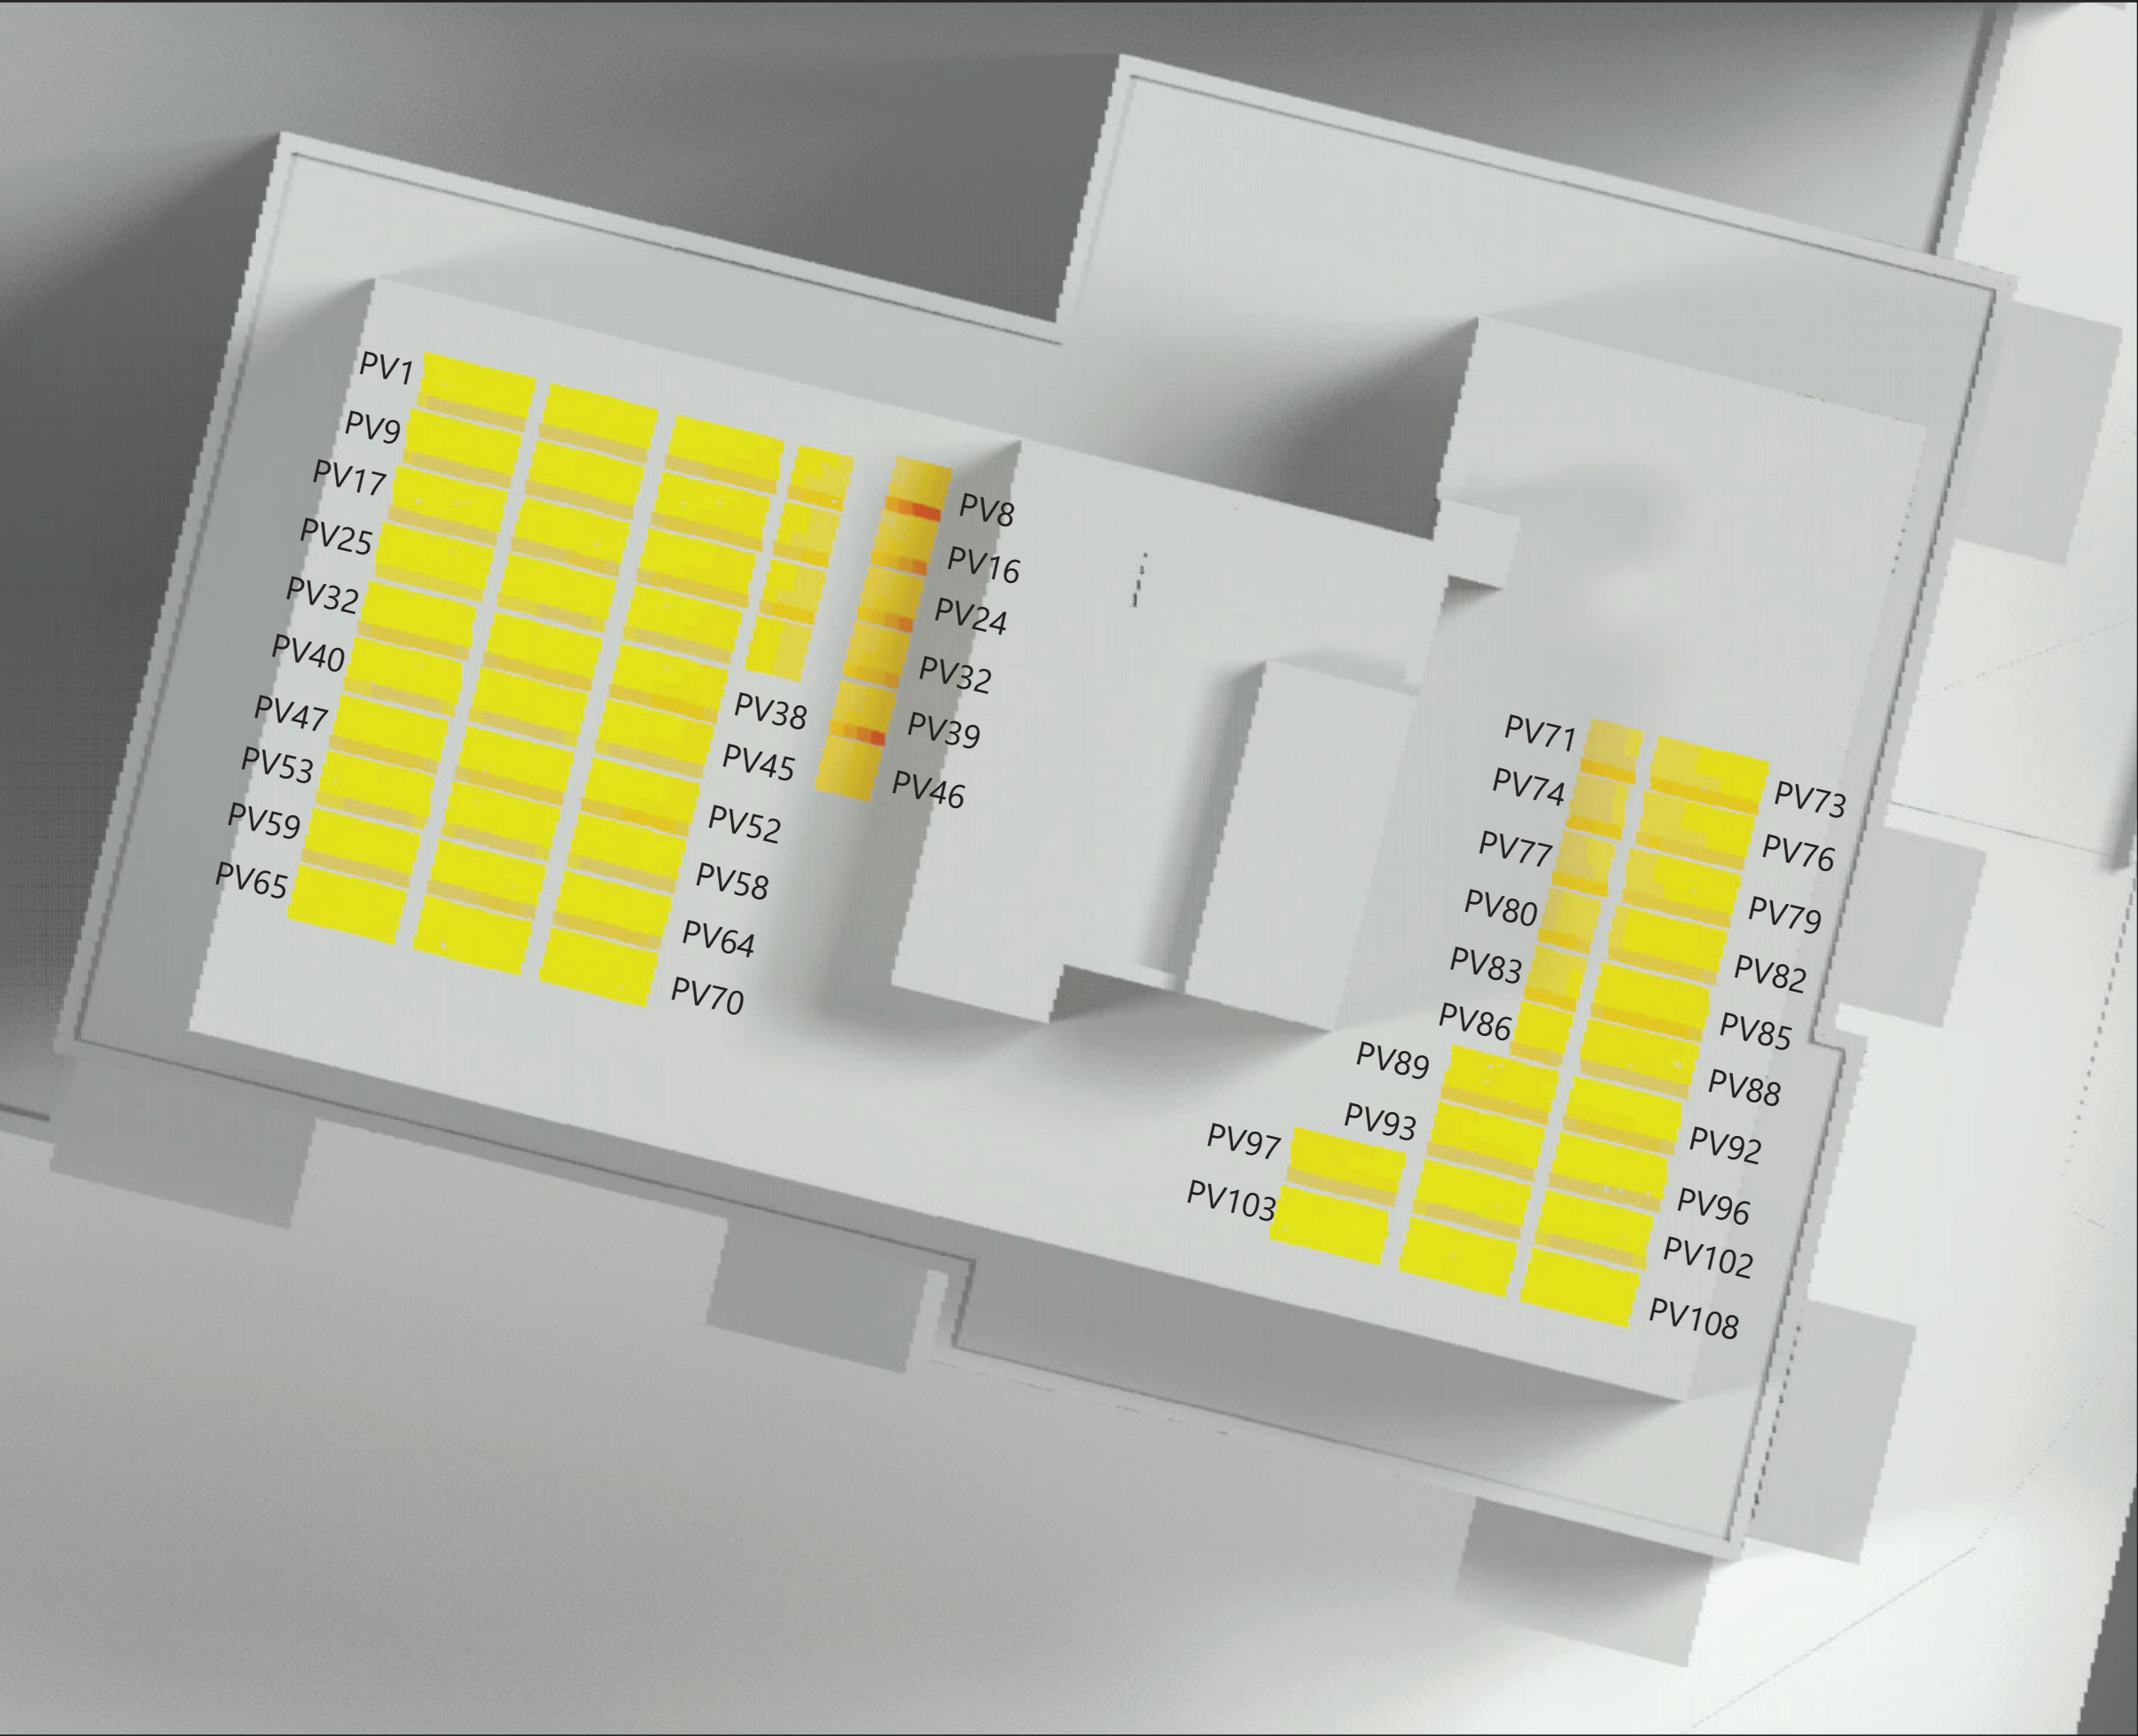


Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

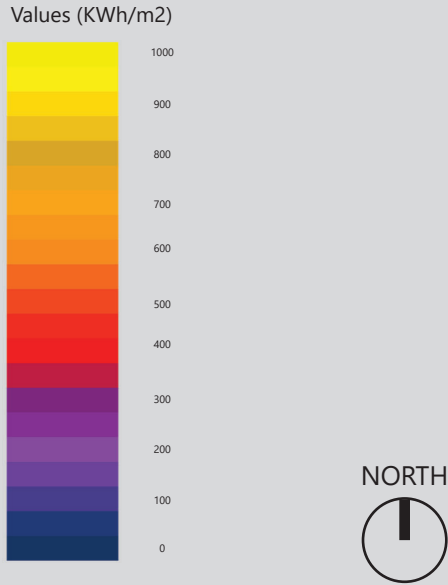


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Sessile Apartments
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	02

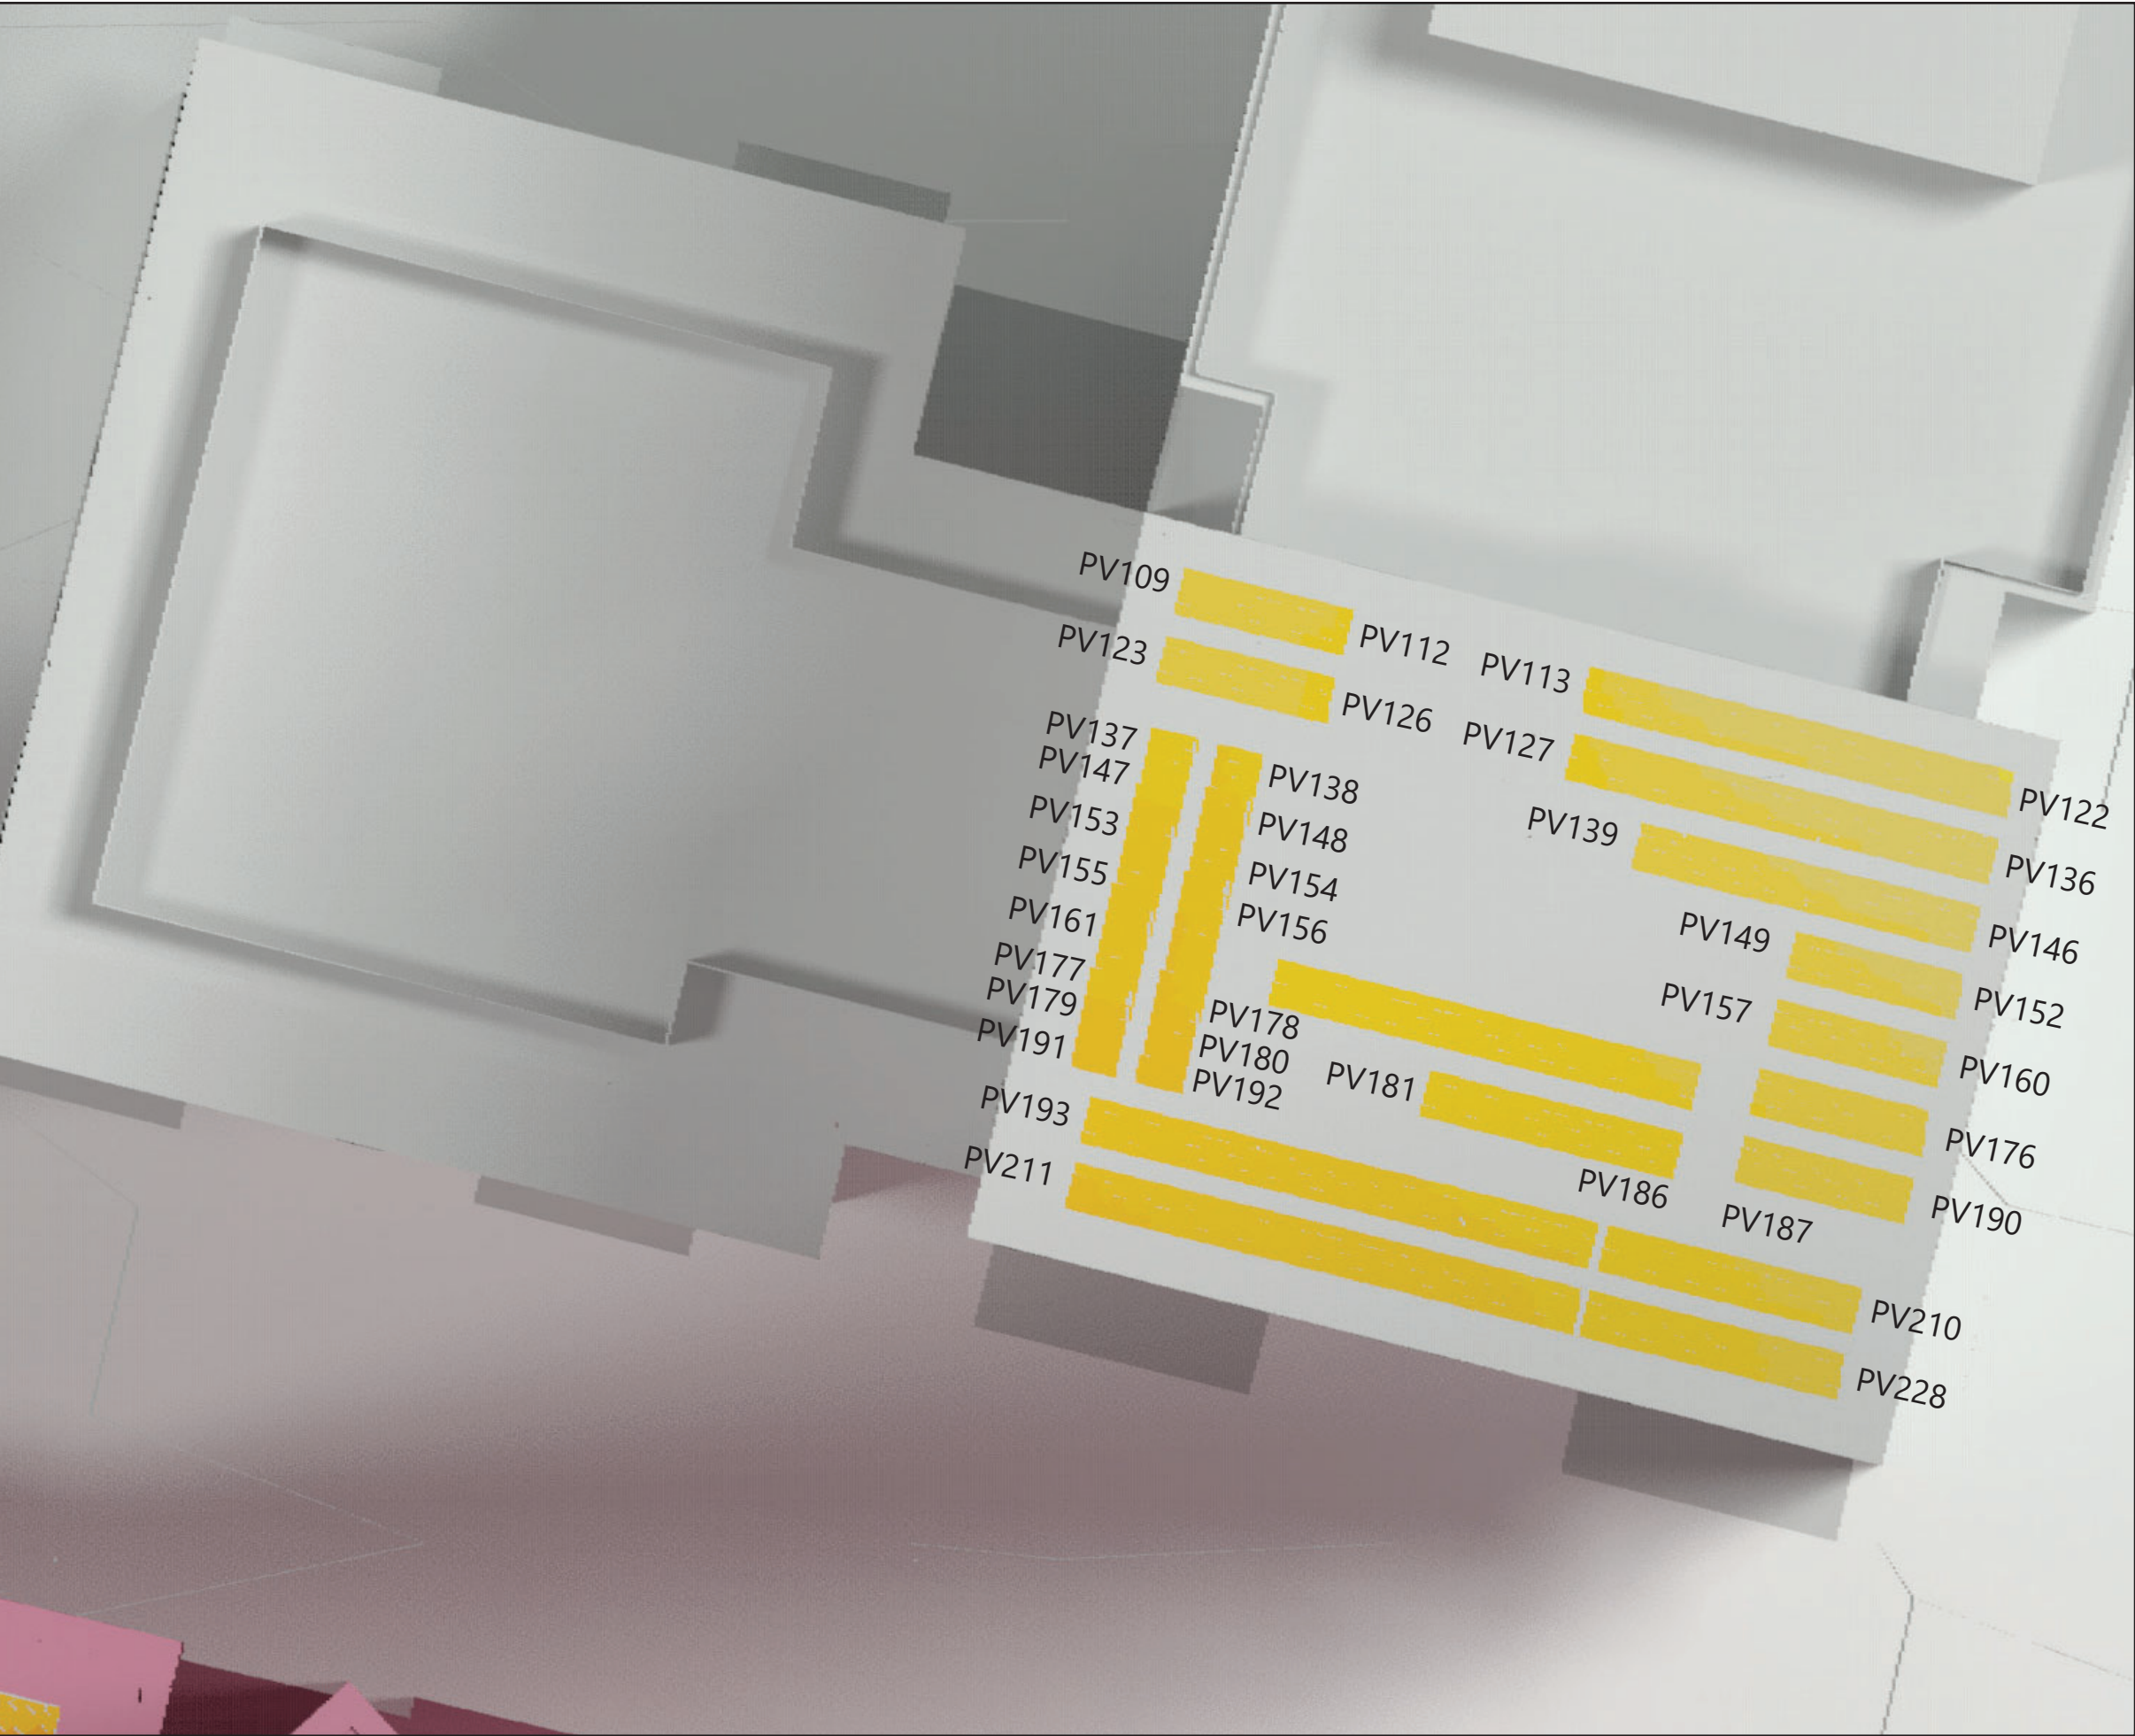


Existing Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

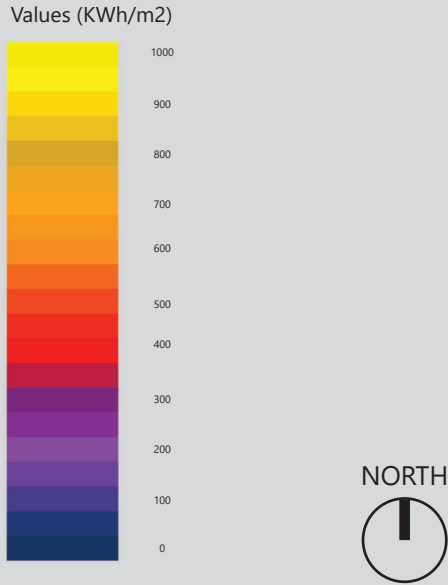


Project Ashley Road
Tottenham Hale

Title Sunlight Study
The Gessner
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	03

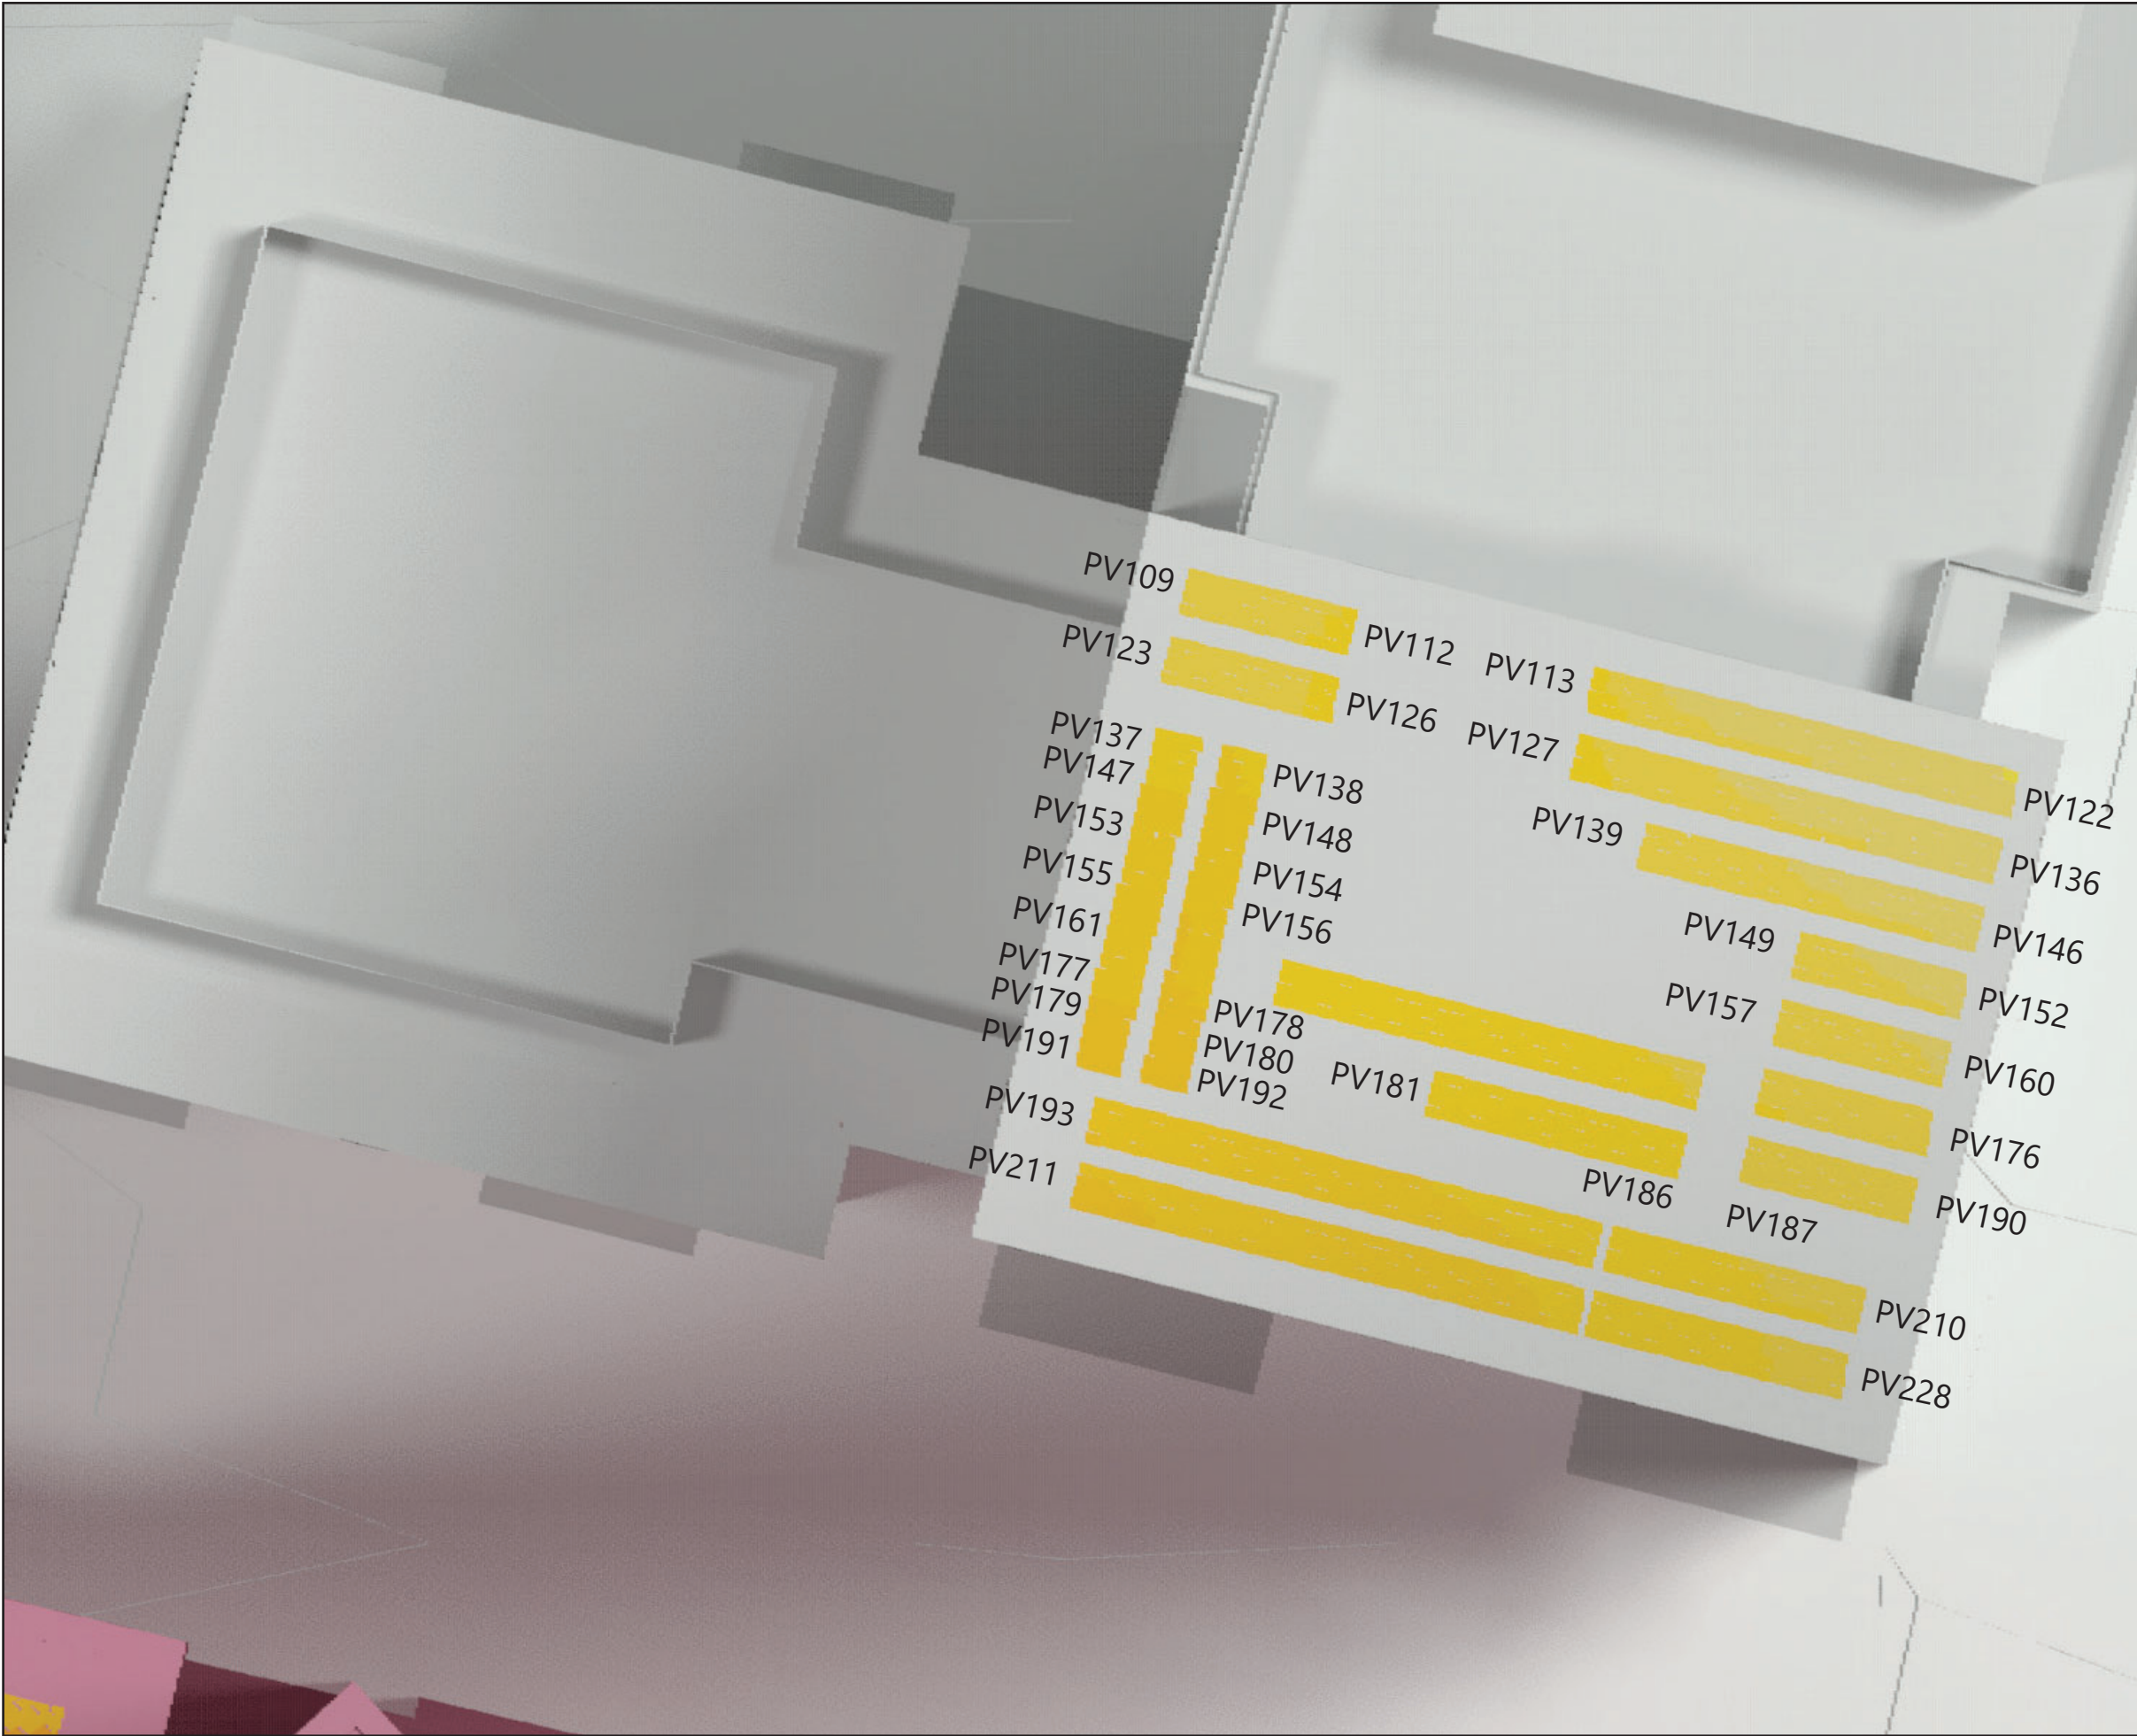


Proposed Scenario - Sunlight Exposure

Sources of information

- Cloud 10**
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

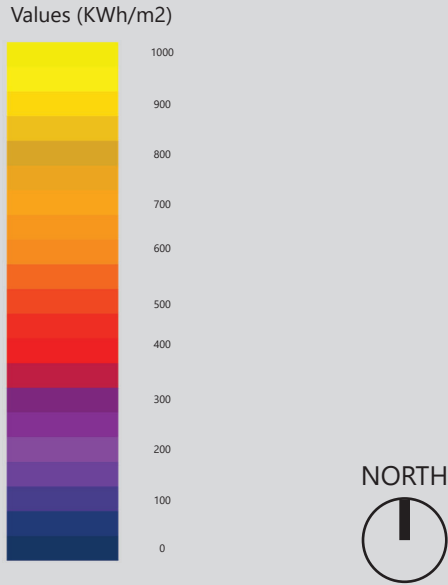


Project Ashley Road
Tottenham Hale

Title Sunlight Study
The Gessner
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	04

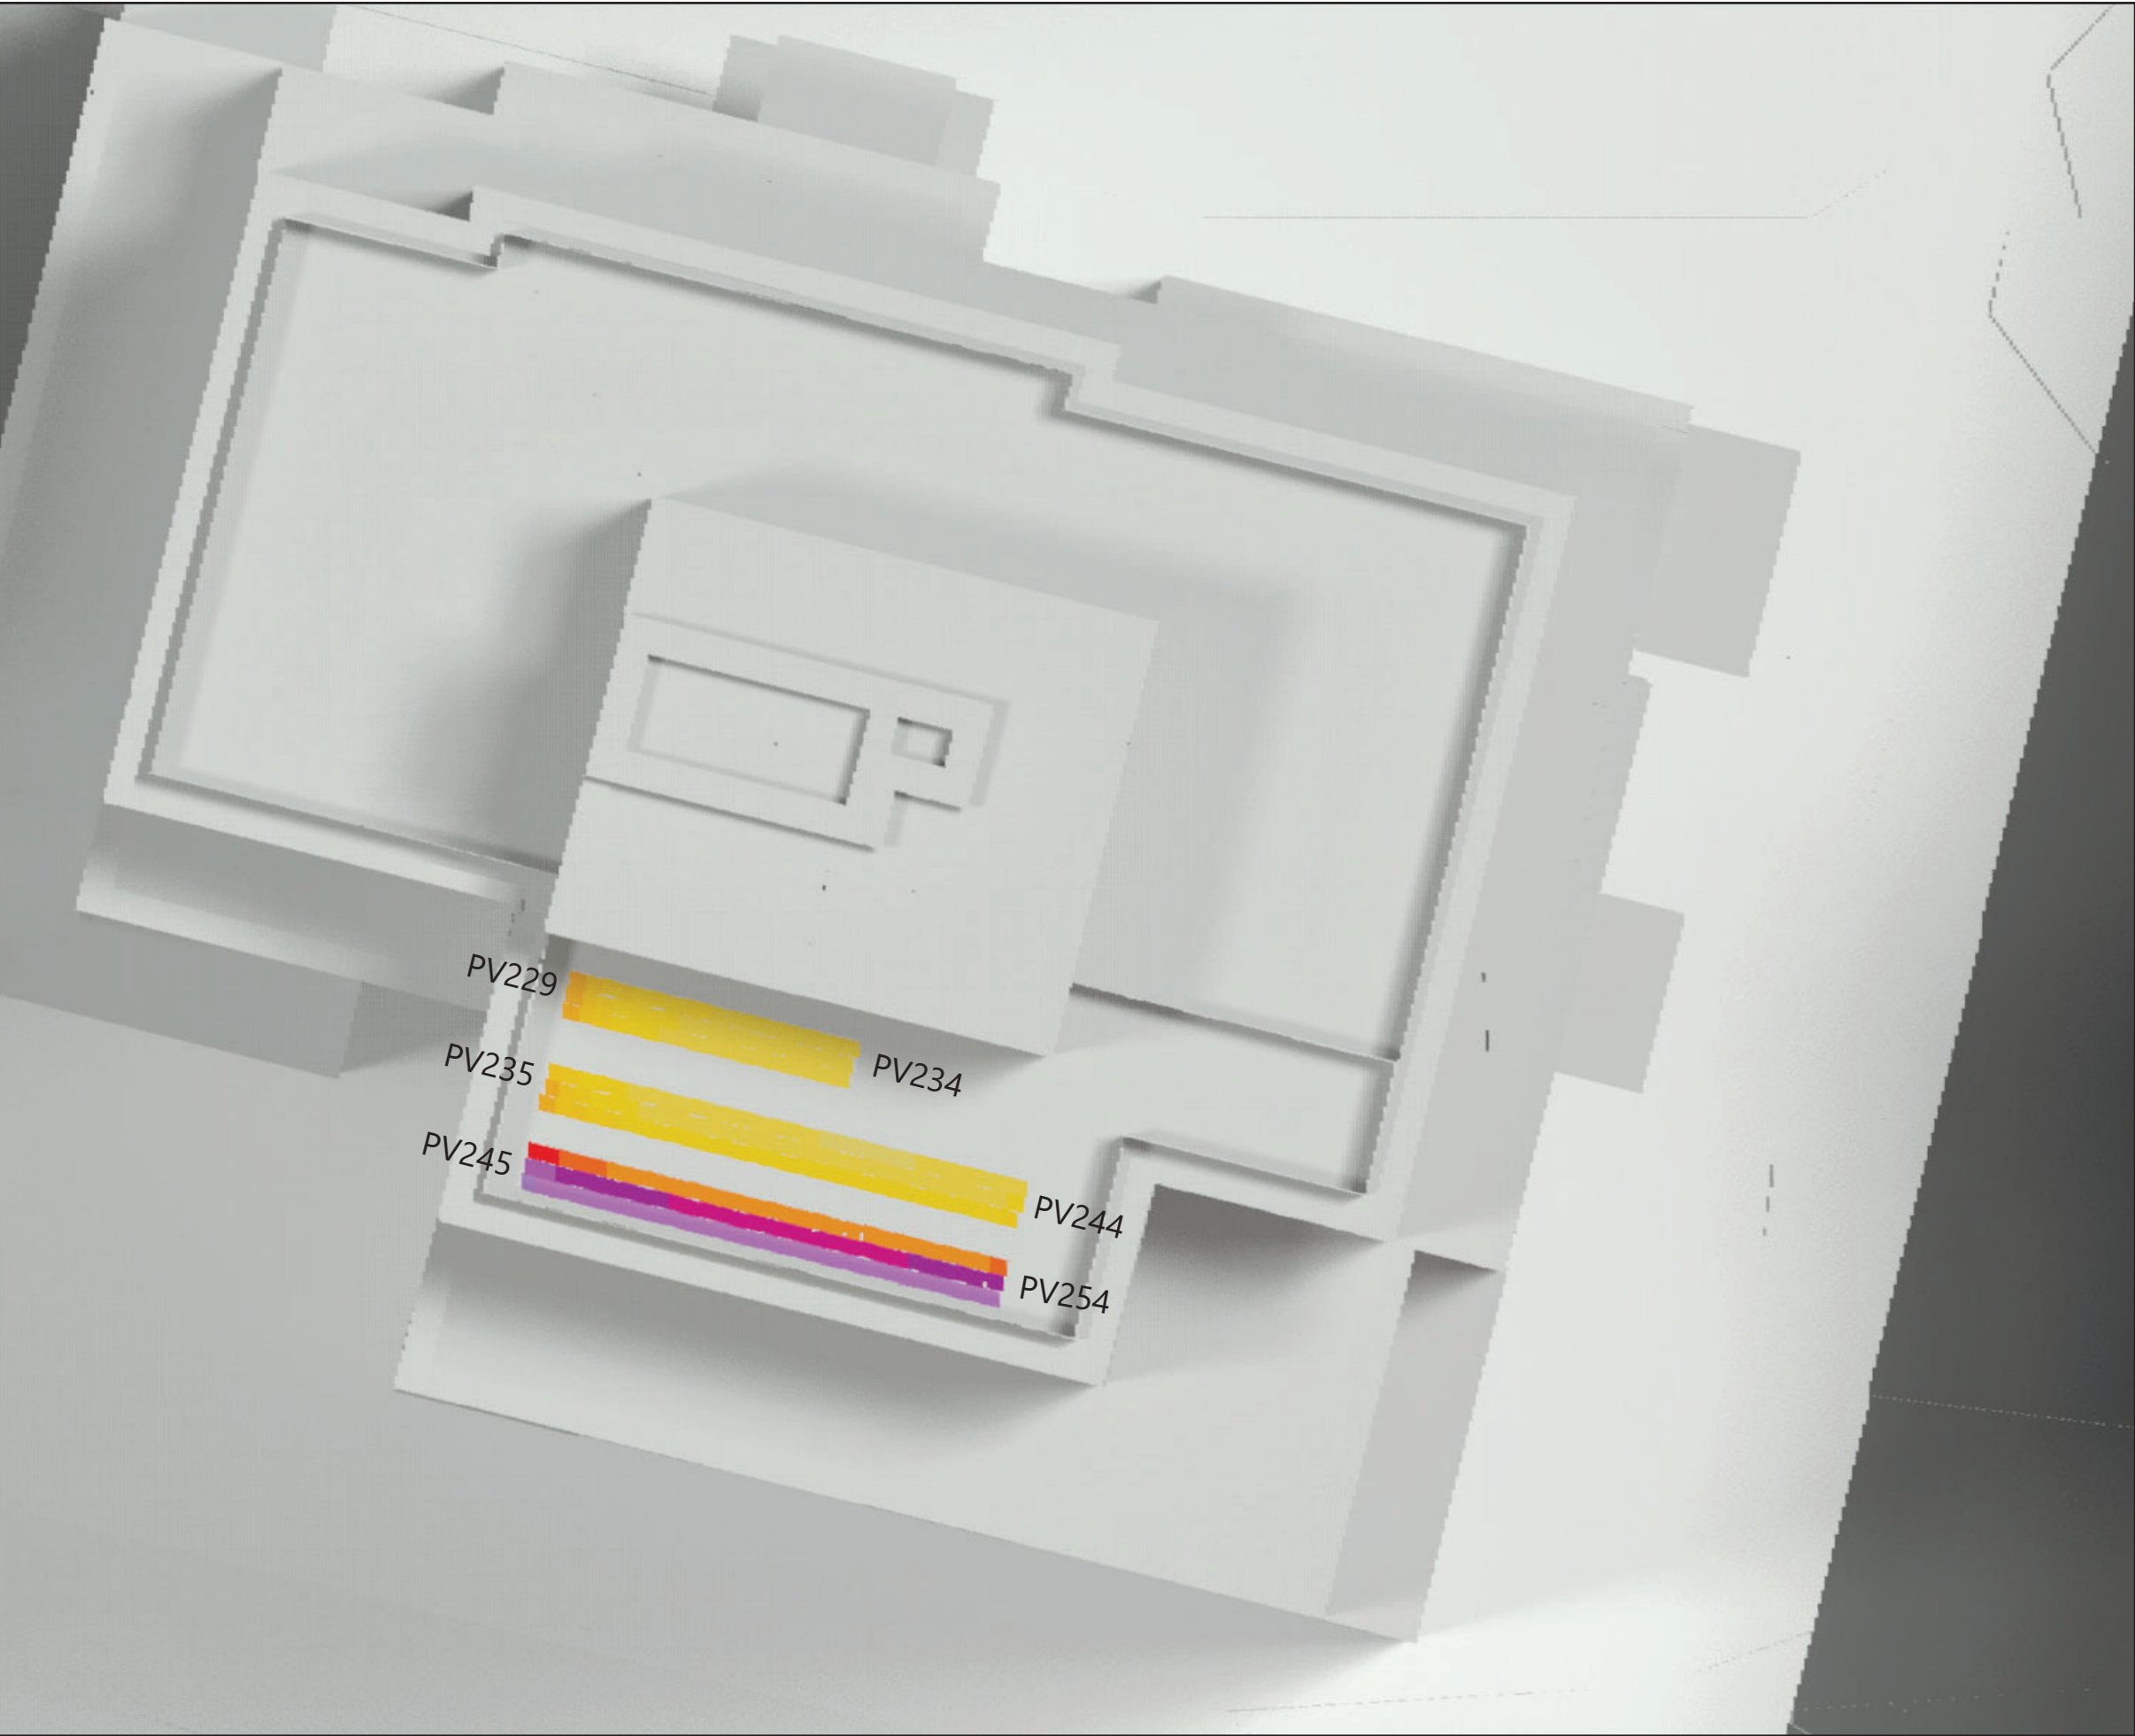


Existing Scenario - Sunlight Exposure

Sources of information

- Cloud 10**
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

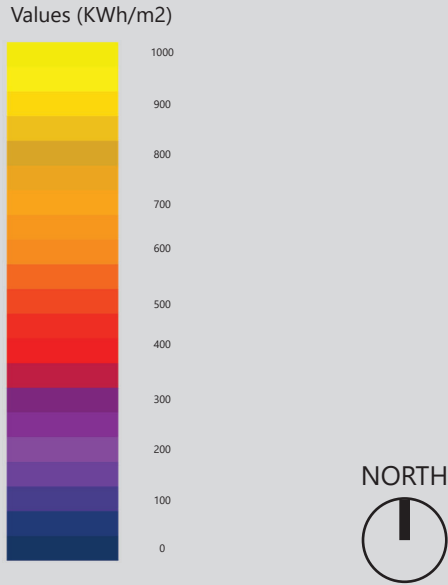


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	05

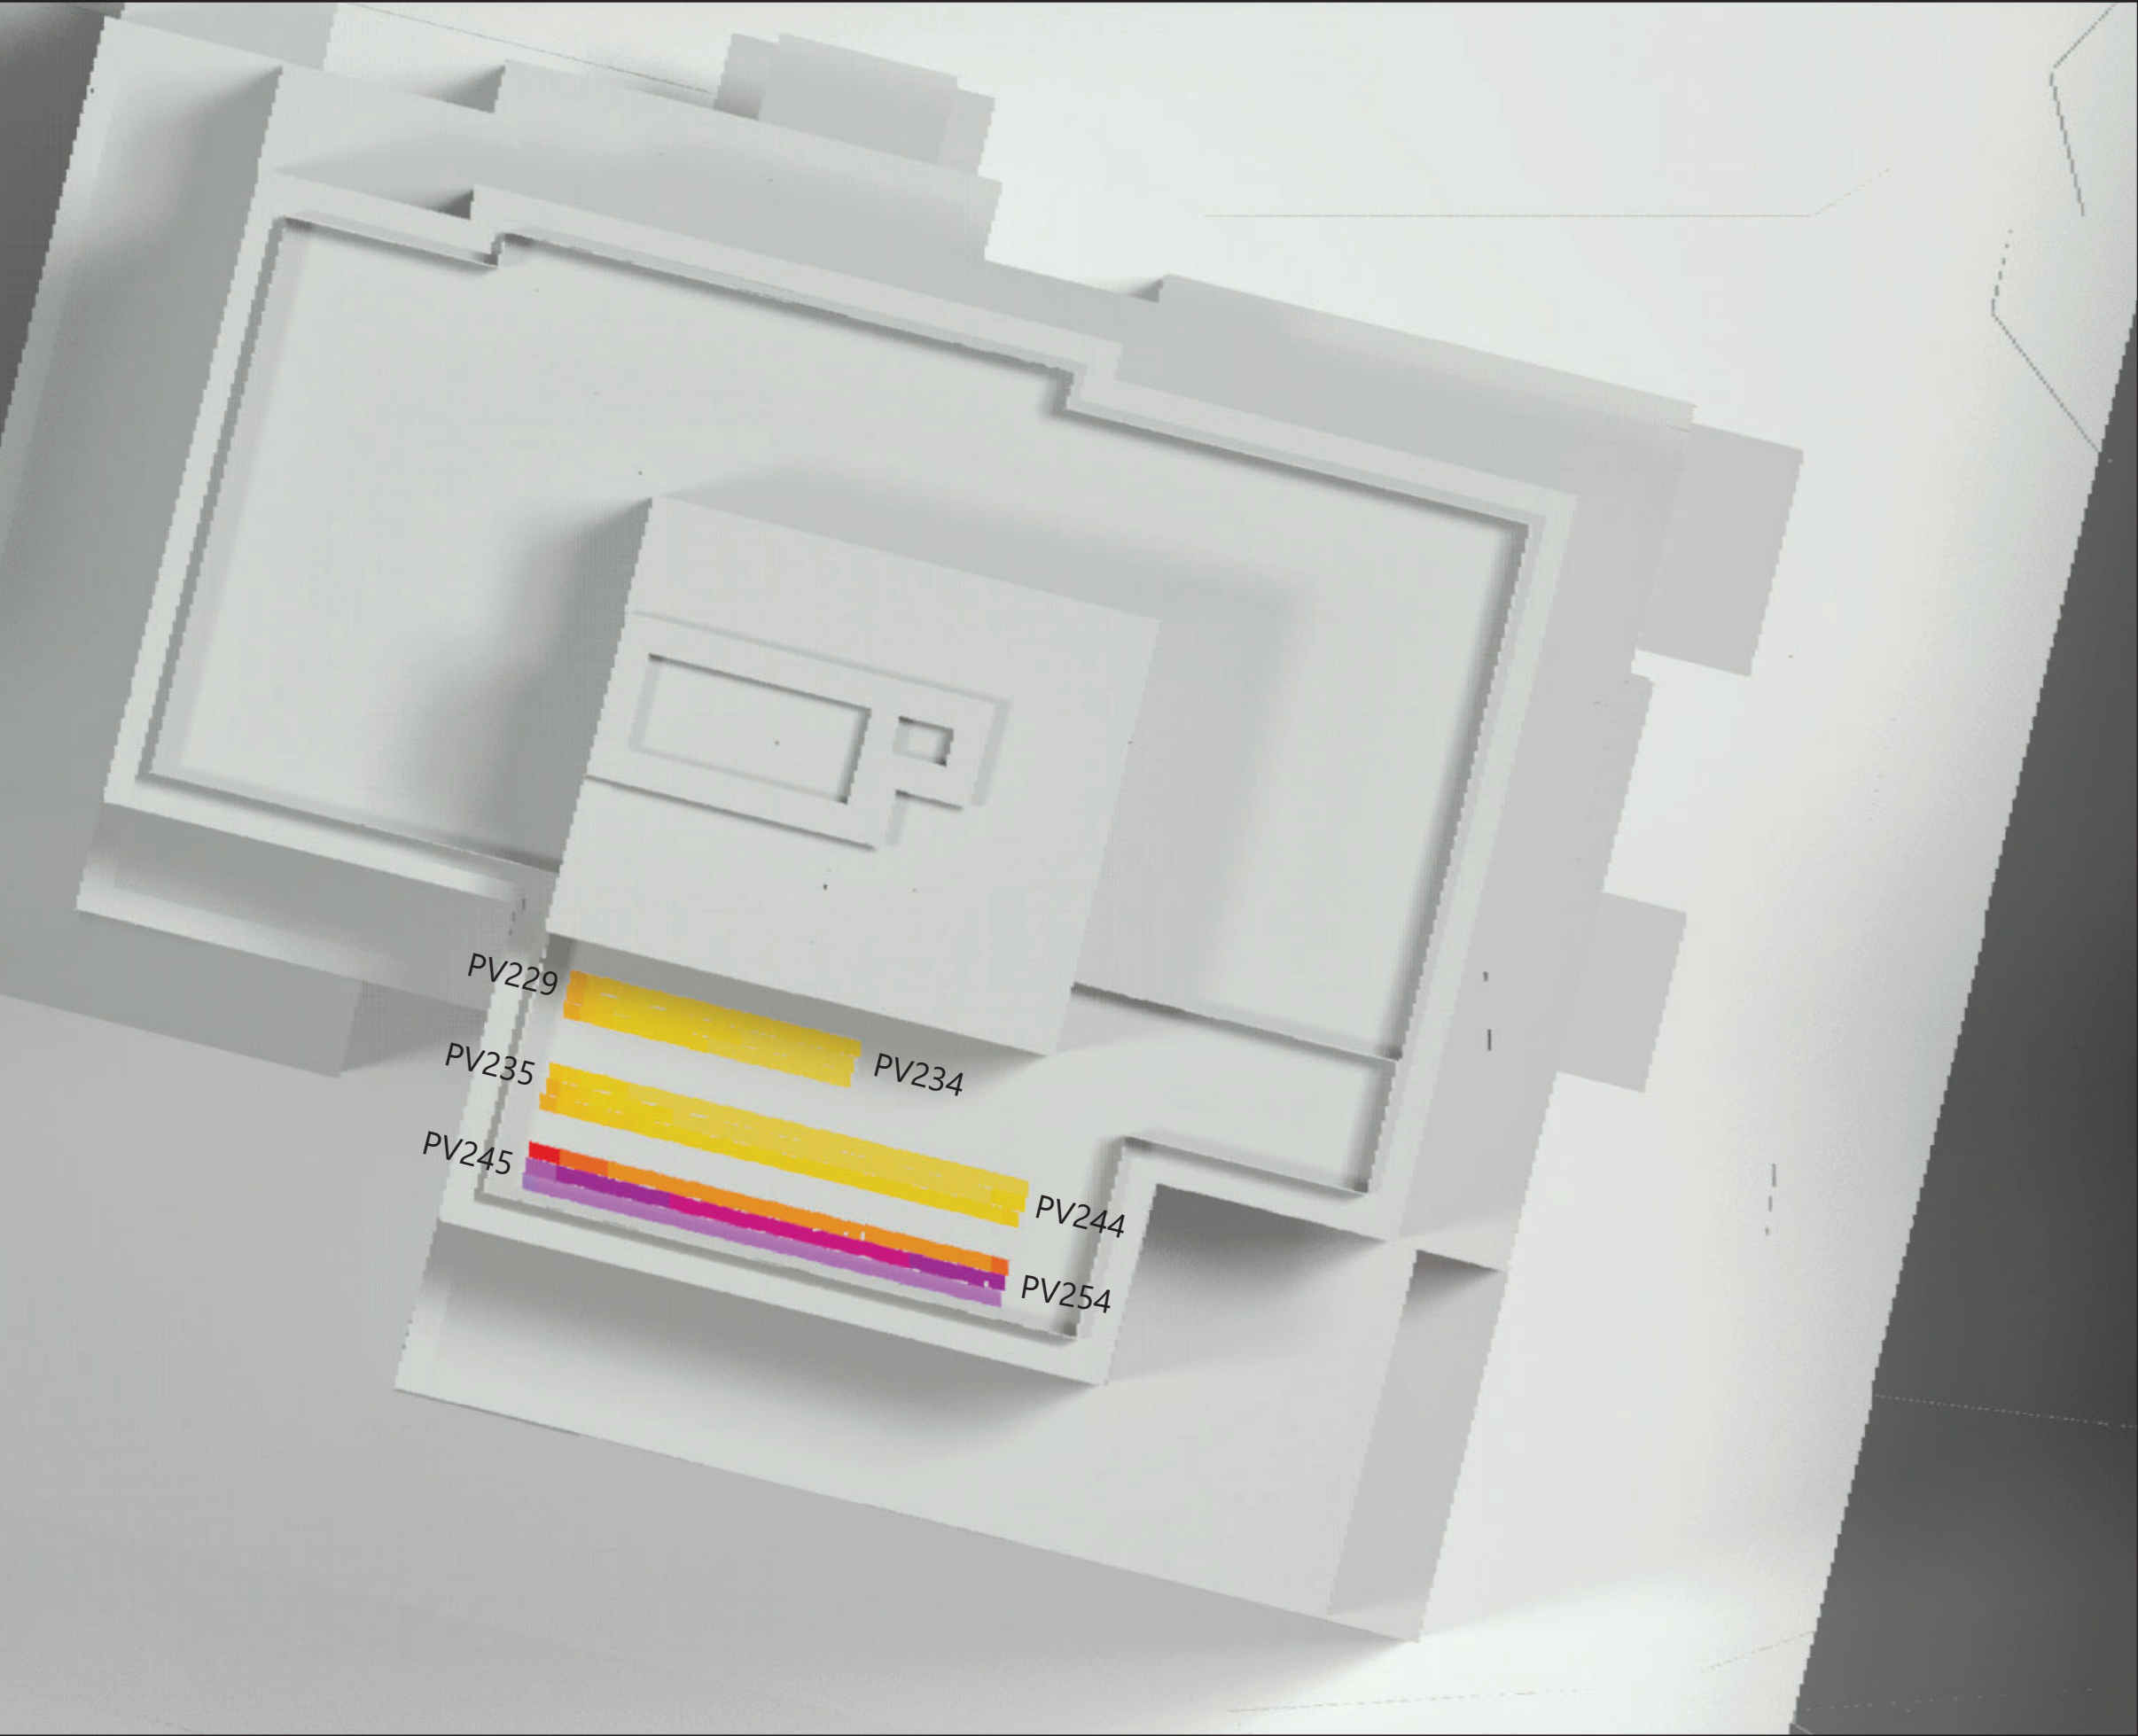


Proposed Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordinance Survey

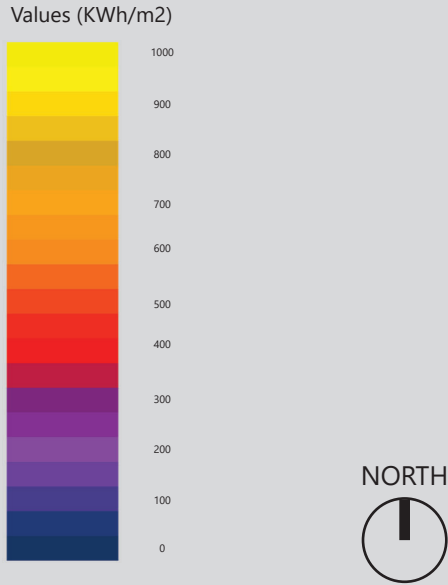


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	06

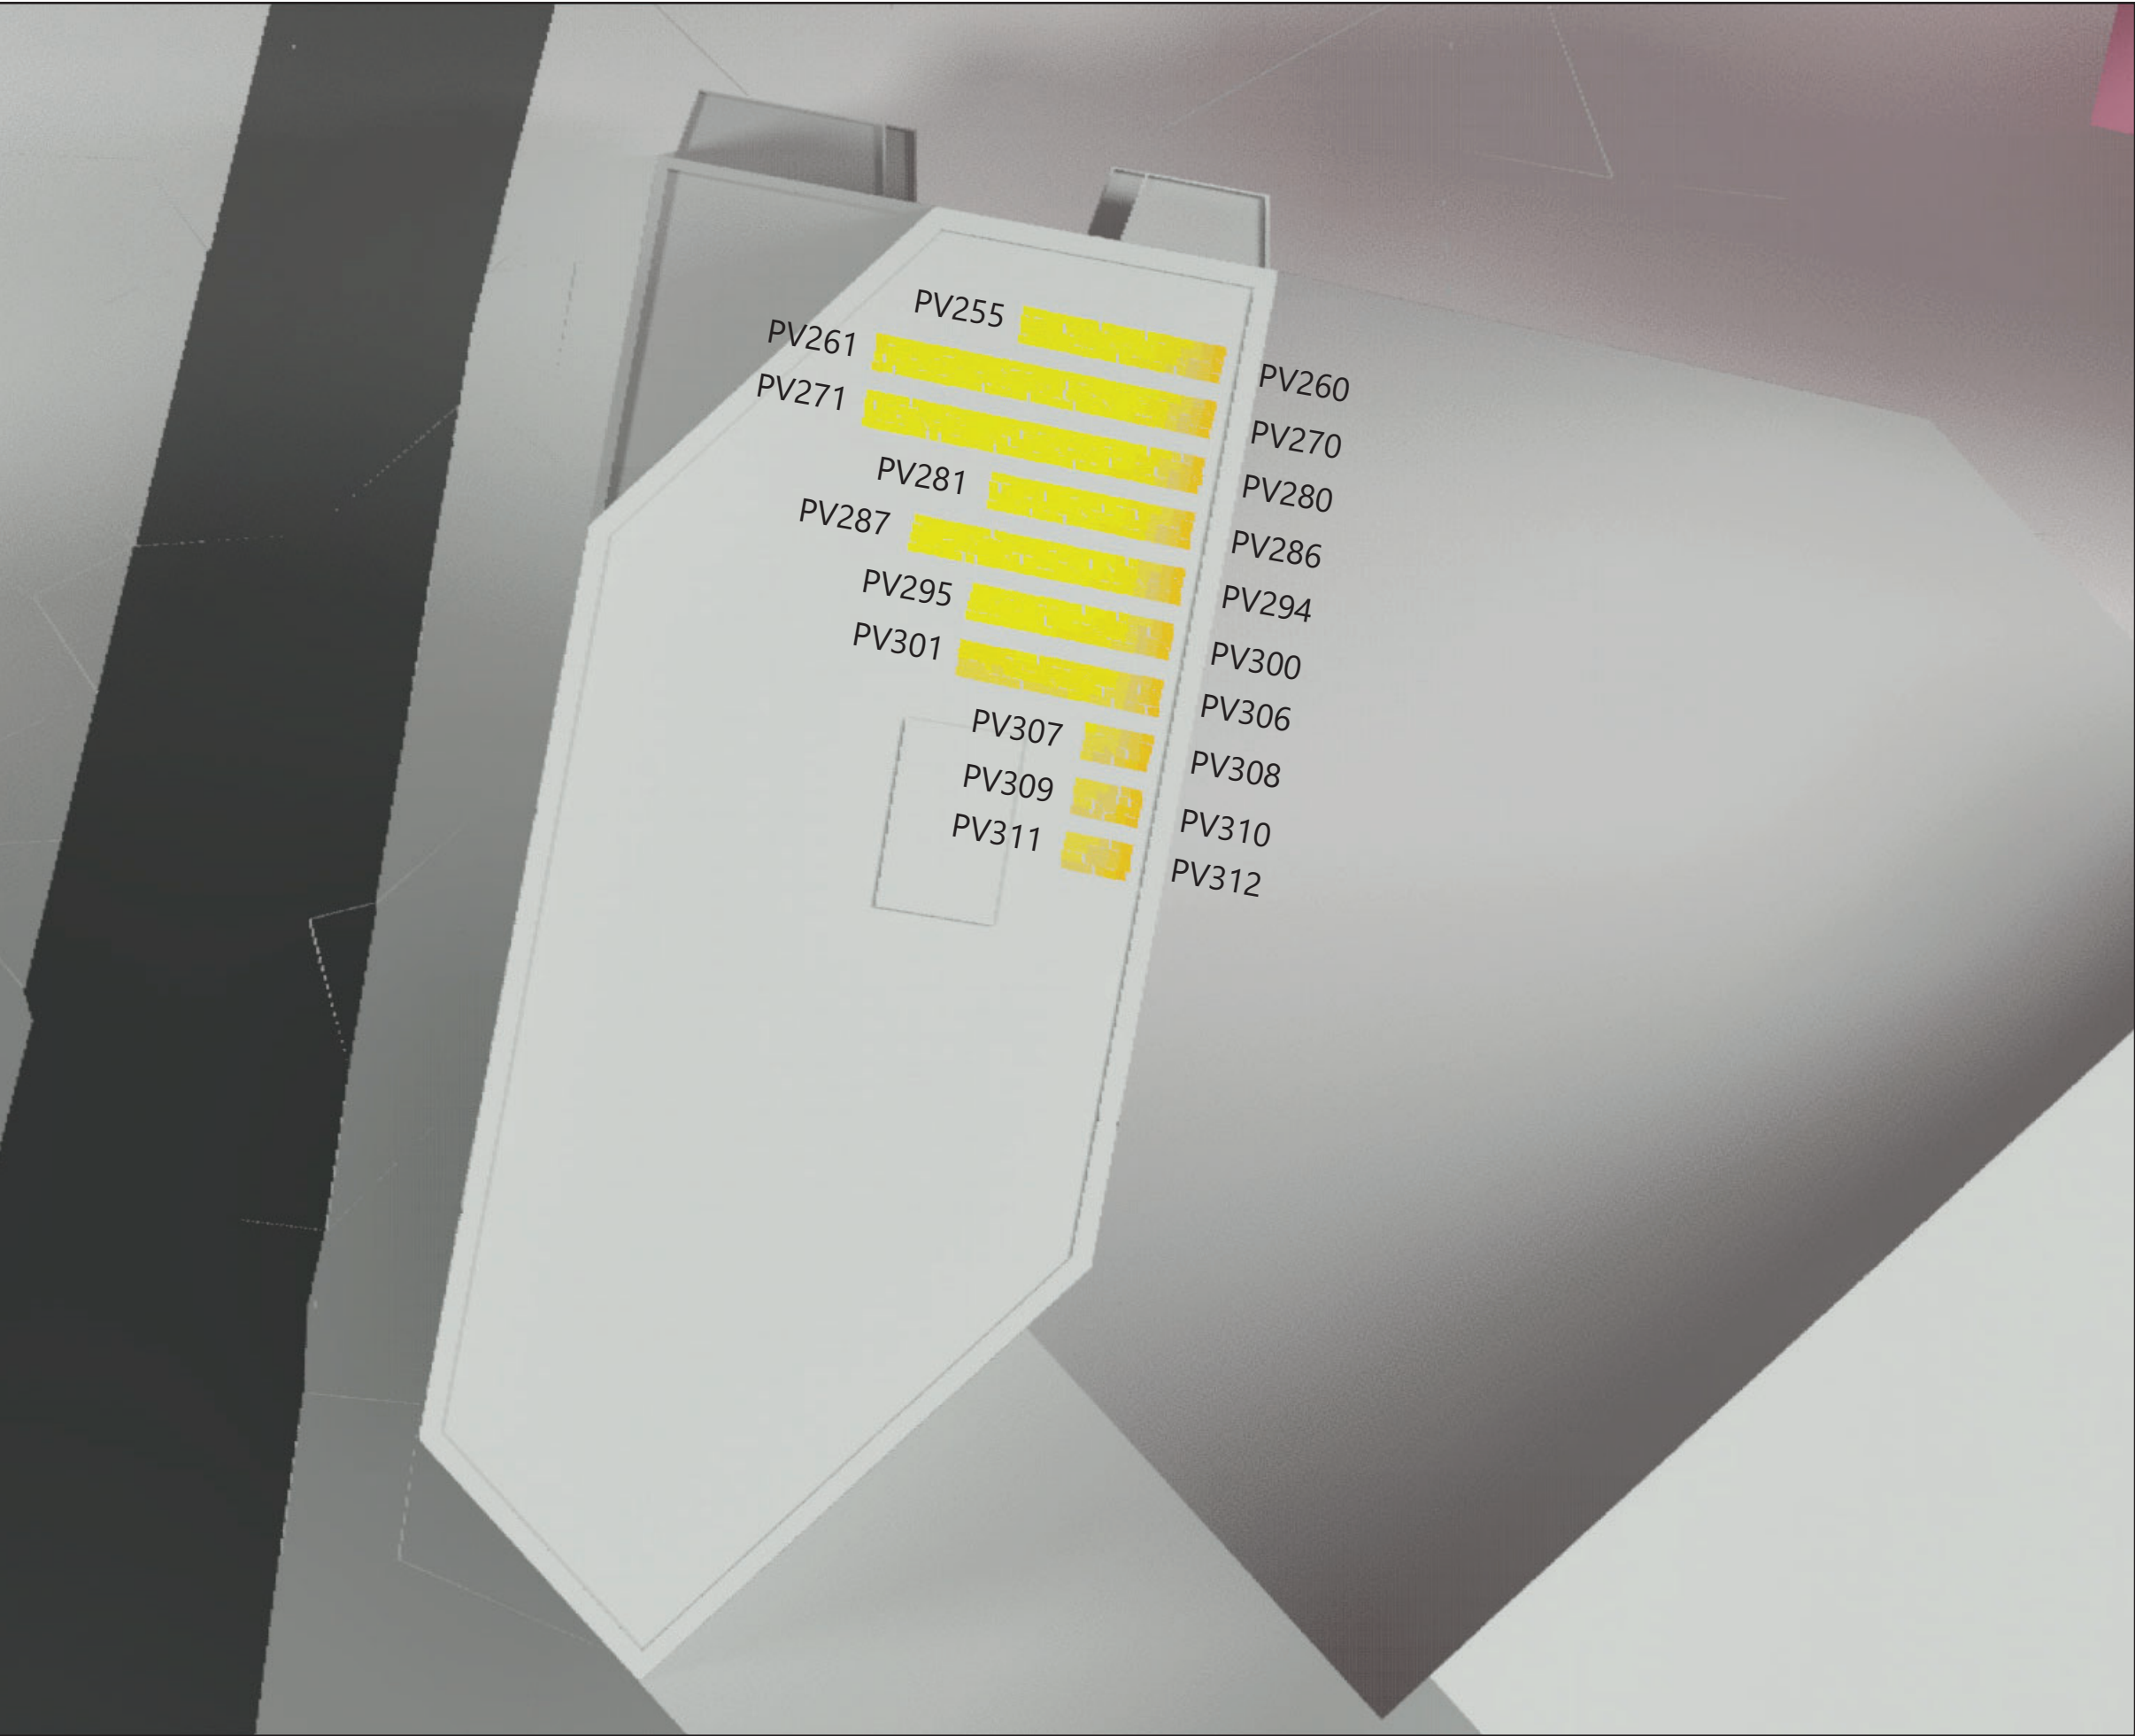


Existing Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

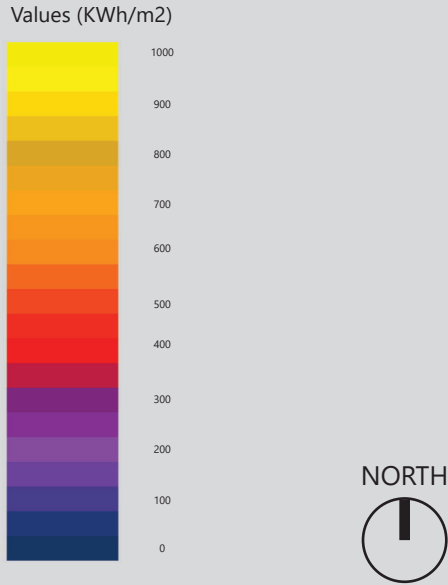


Project Ashley Road
Tottenham Hale

Title Sunlight Study
East Apartments
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	07

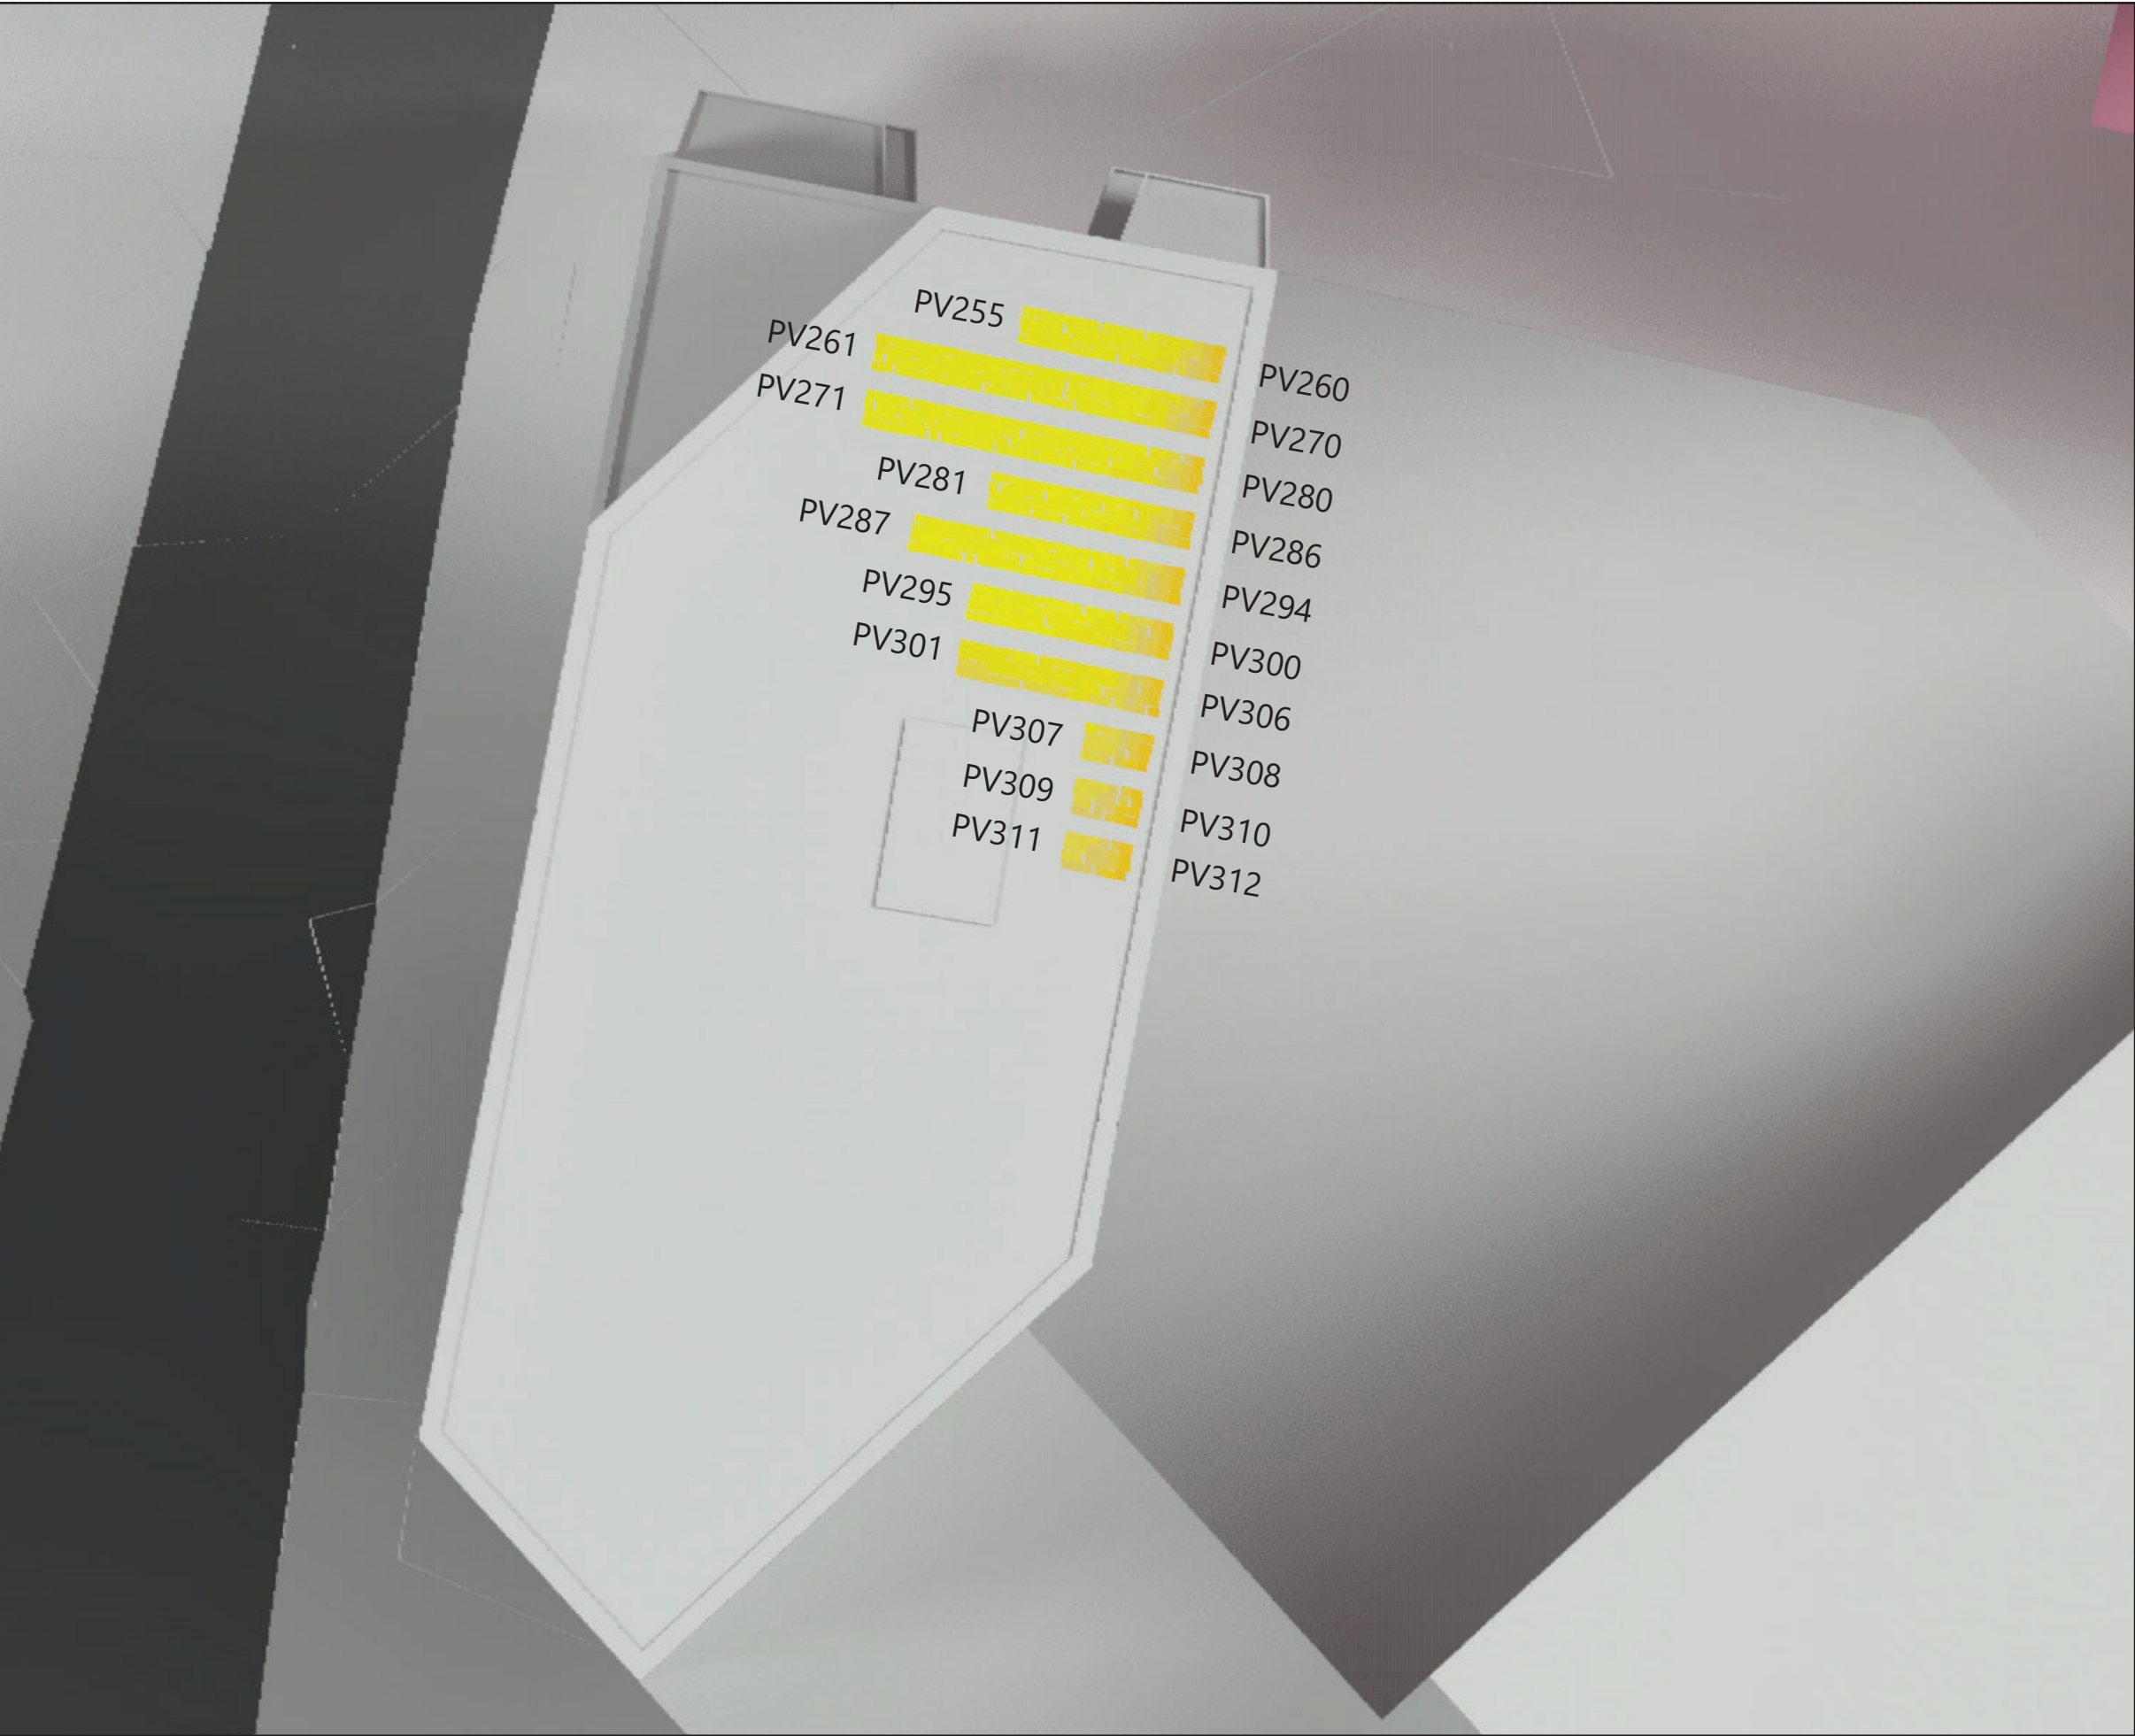


Proposed Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

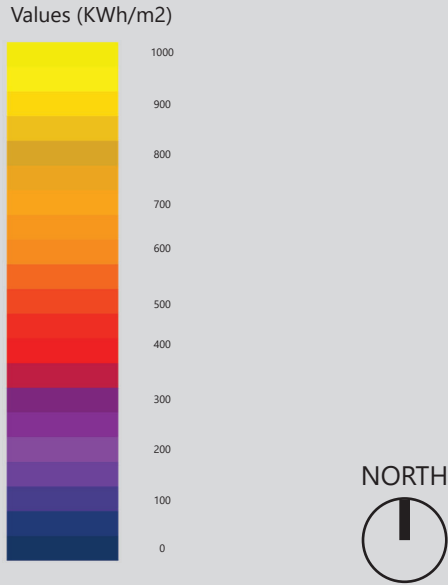


Project Ashley Road
Tottenham Hale

Title Sunlight Study
East Apartments
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	08

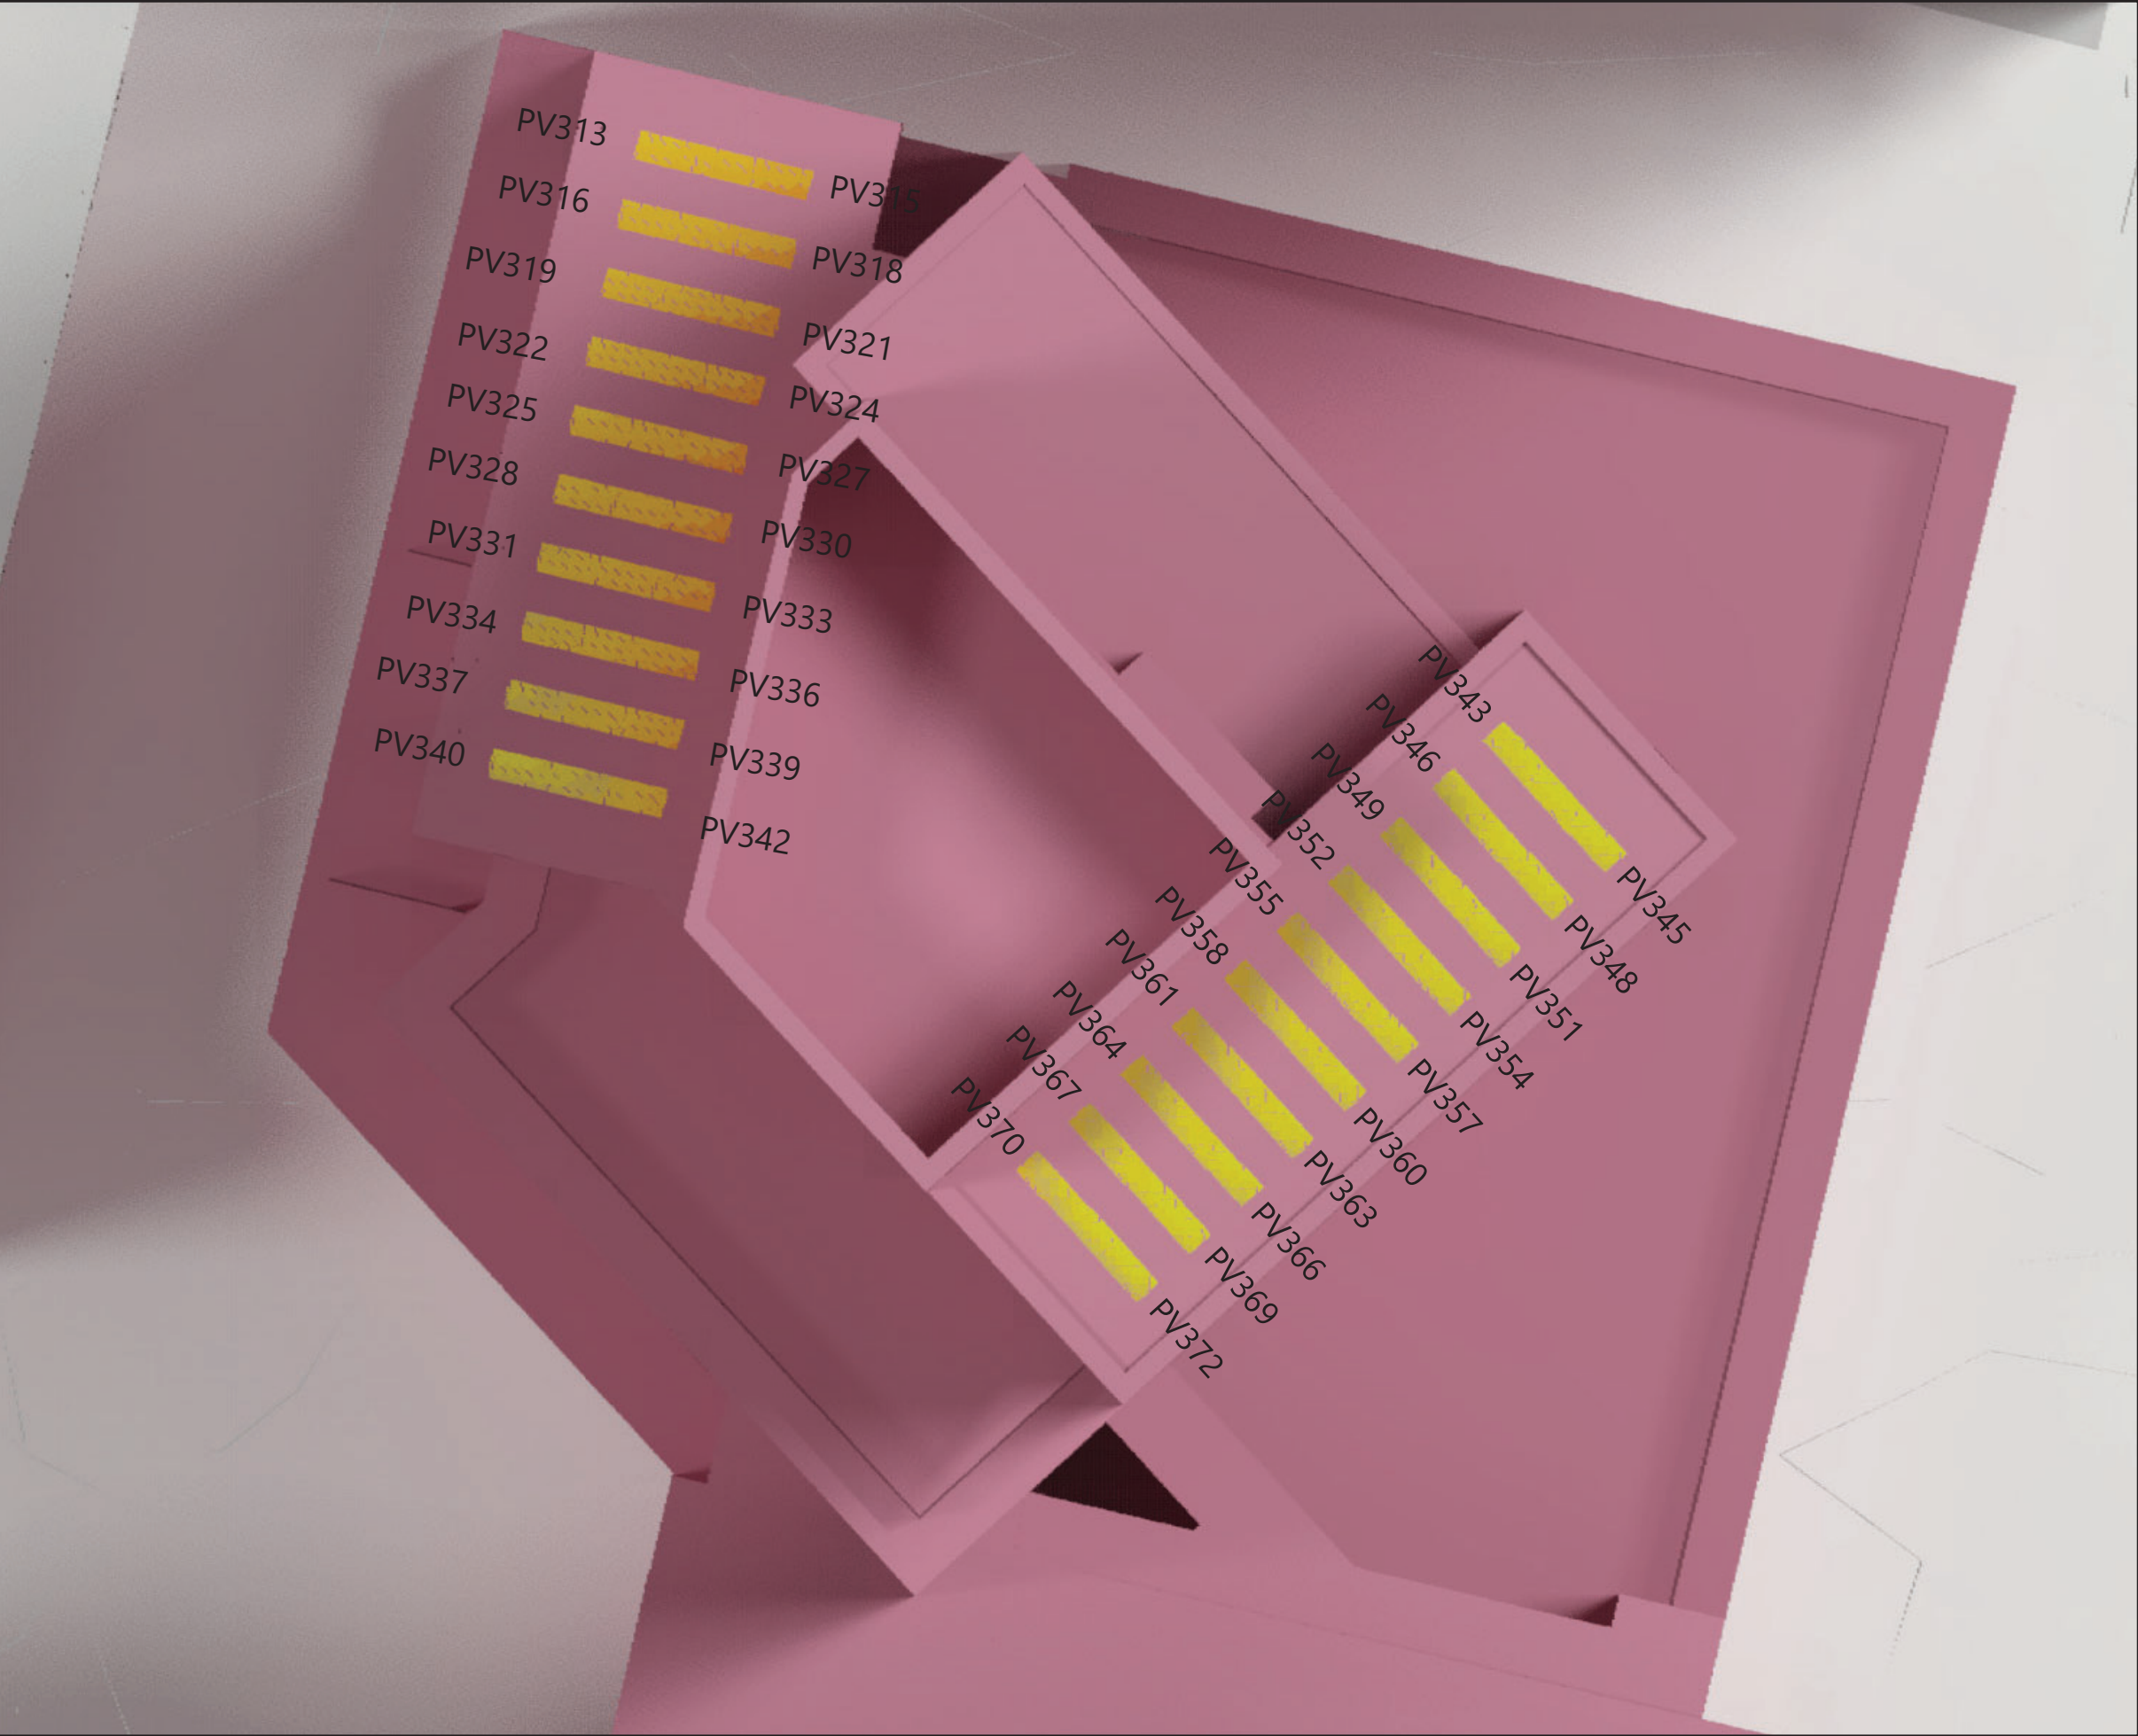


Existing Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

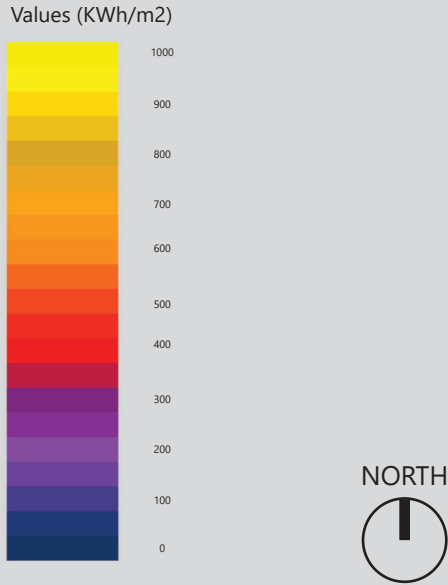


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Berol Quarter
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	09

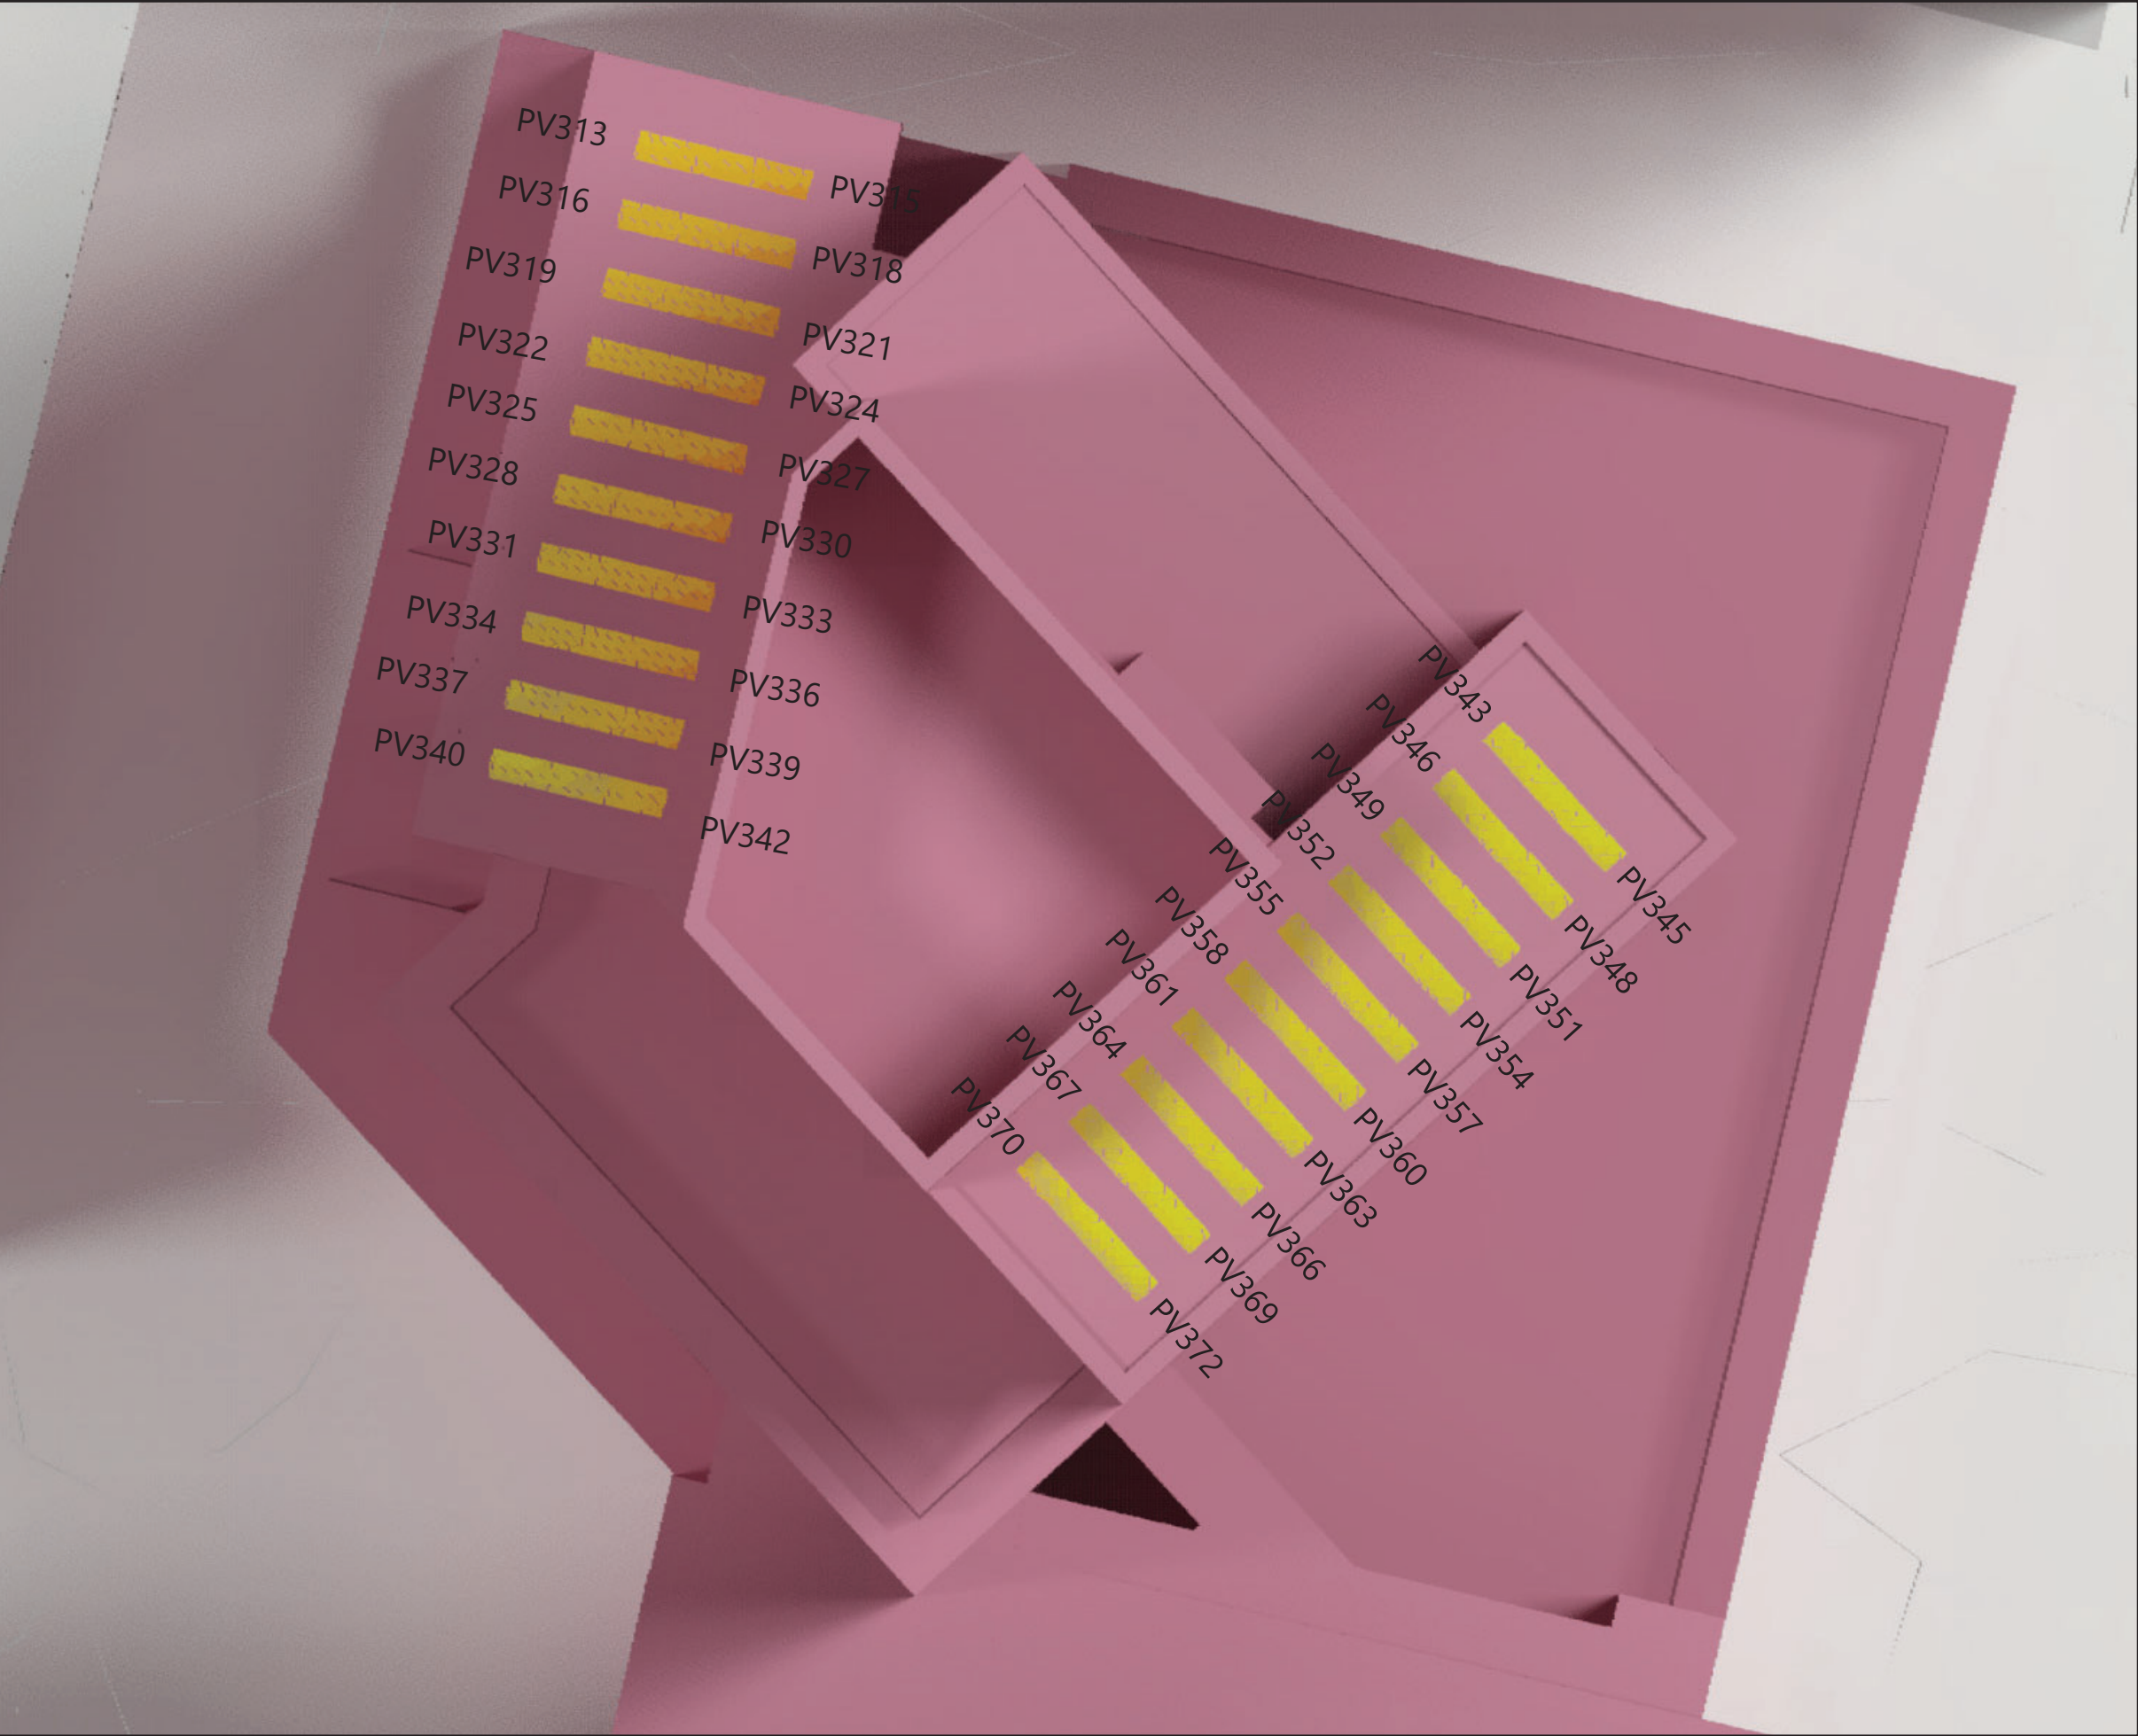


Proposed Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

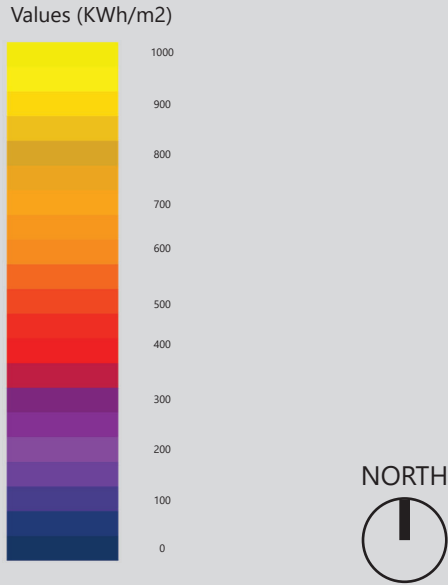


Project Ashley Road
Tottenham Hale

Title Sunlight Study
Berol Quarter
21st March

Drawn	TR	Checked	--
-------	----	---------	----

Date	07/08/2026	Project	10106
------	------------	---------	-------

Rel no.	Prefix	Page no.
08	PV02	10

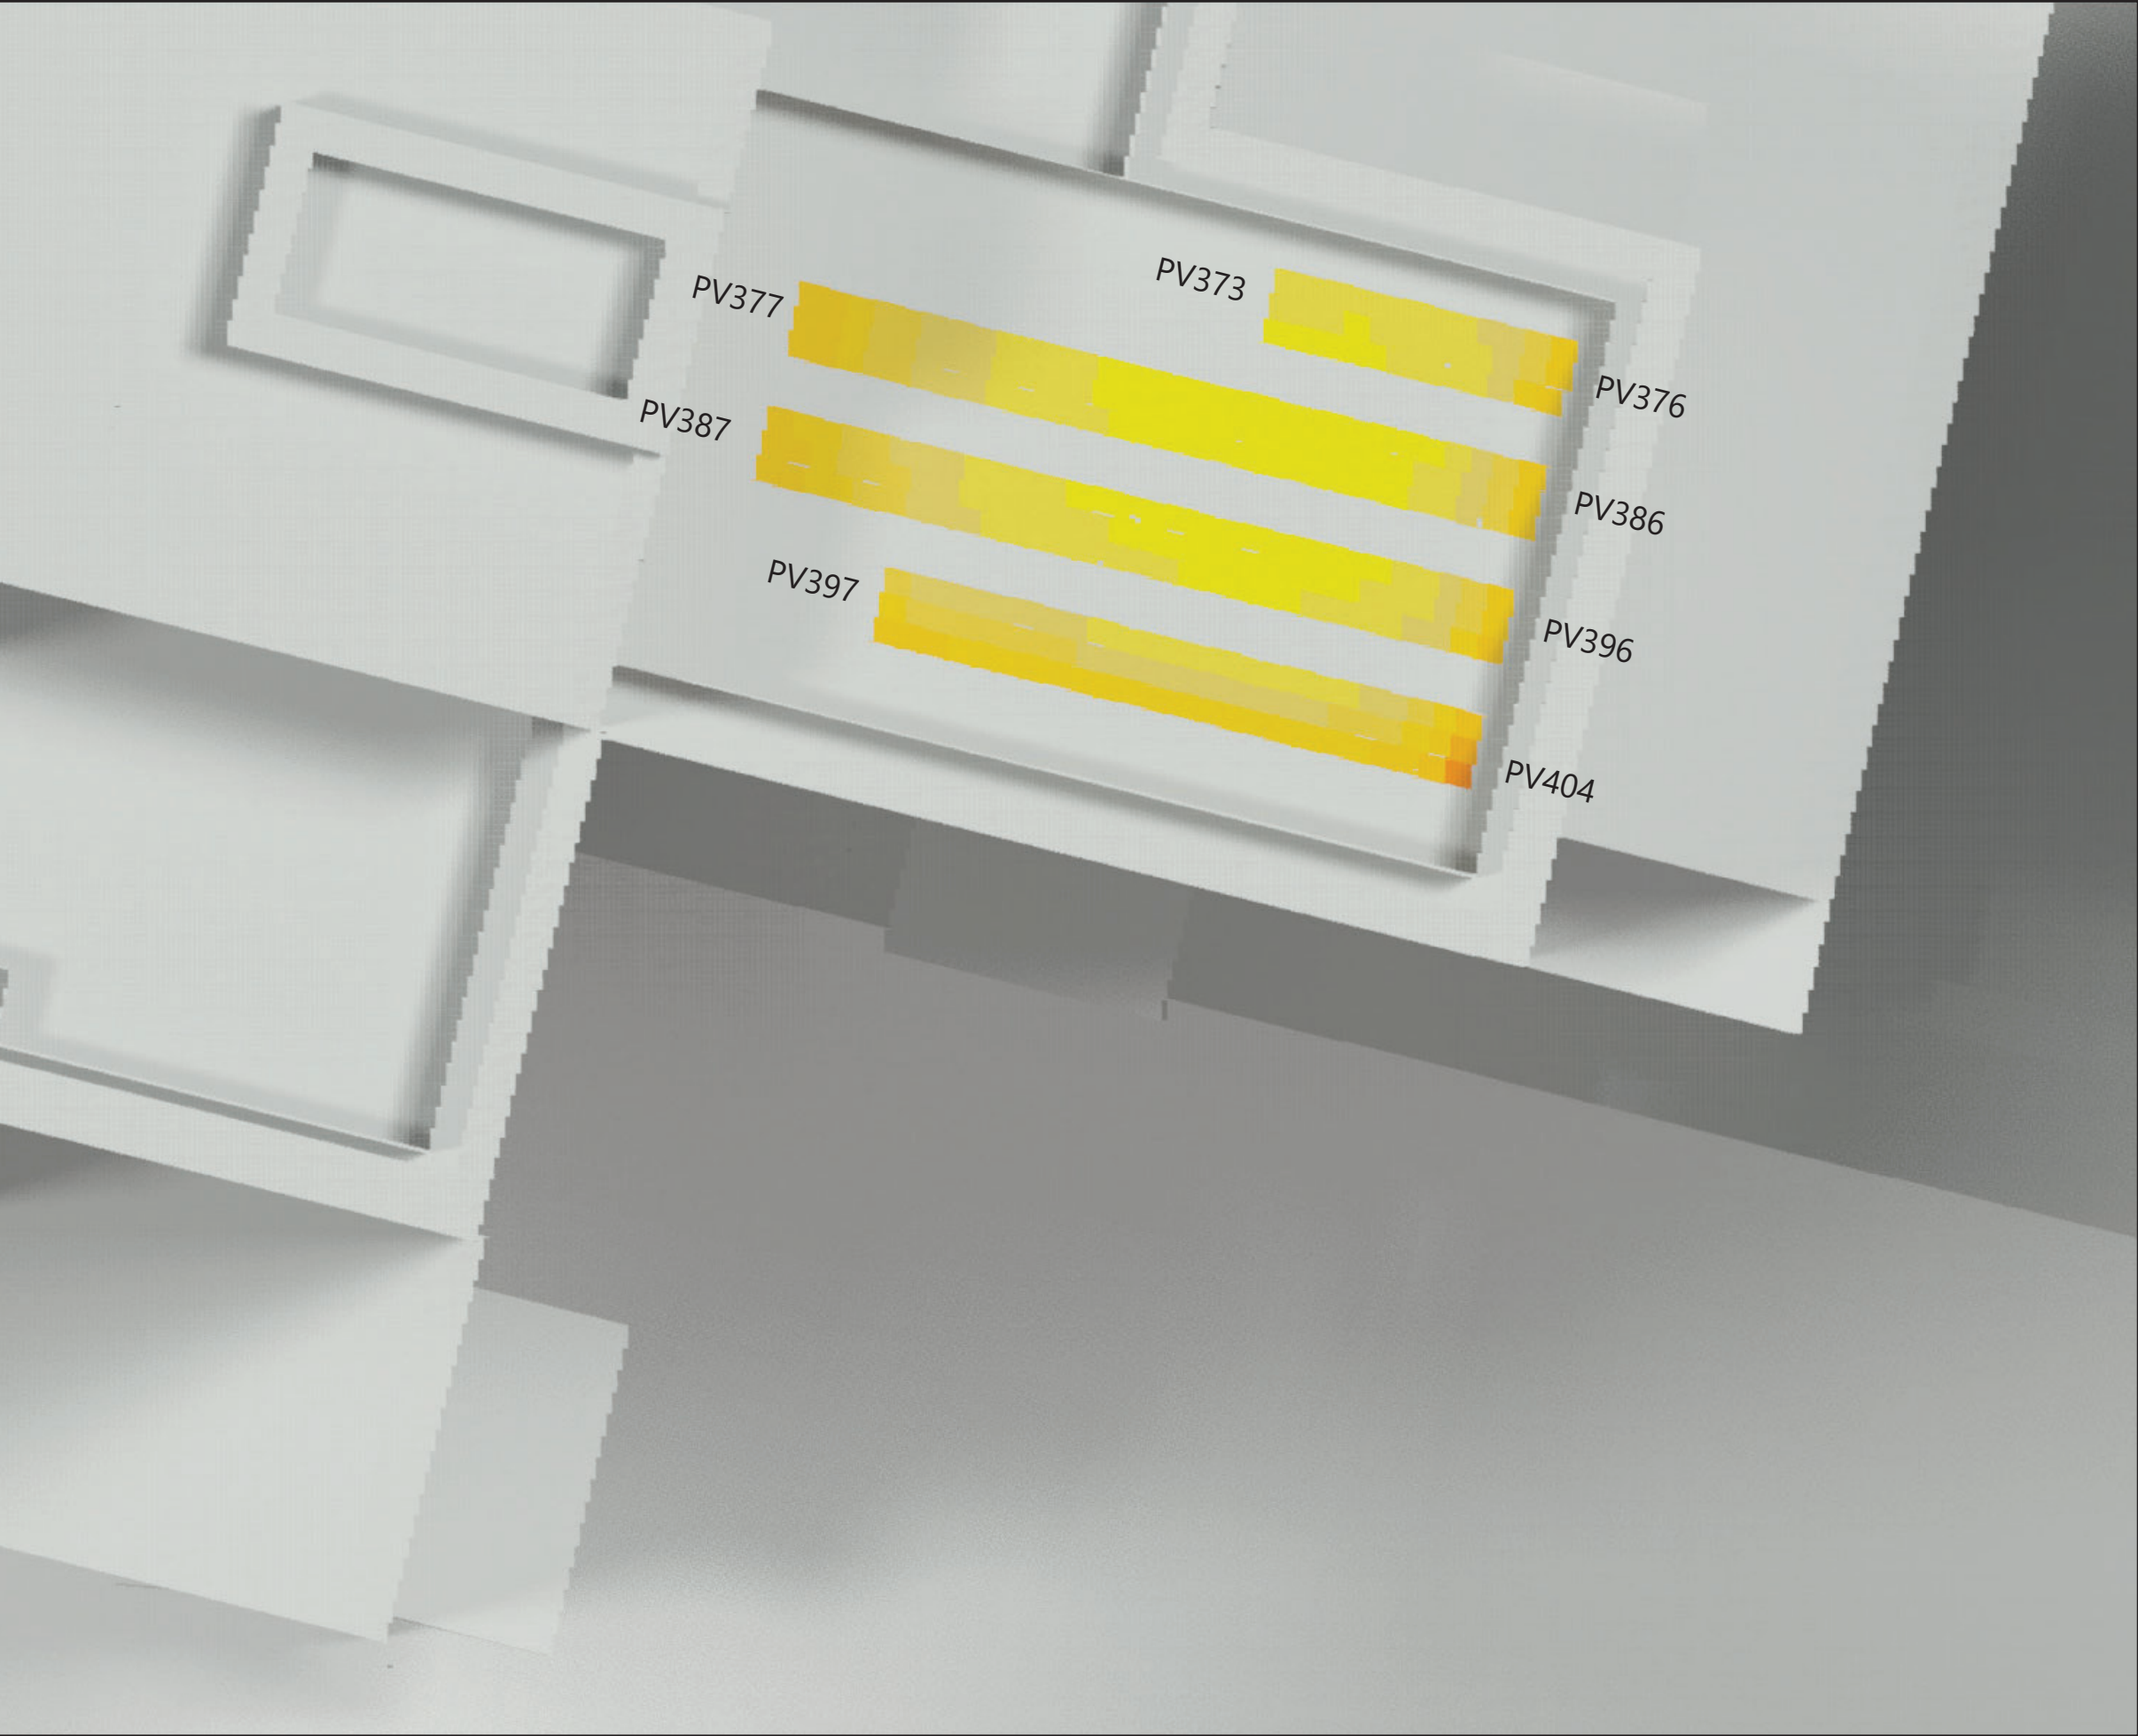


Existing Scenario - Sunlight Exposure

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey

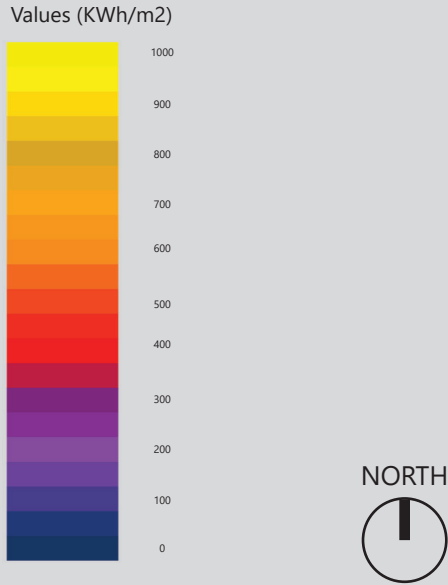

Project Ashley Road
Tottenham Hale

Title Sunlight Study
Rose Lexumburg Apartments
21st March

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV02 Page no. 11

Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained
		(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)	
PV01	1.0	959.5	952.1	0.99	PV43	1.0	949.5	942.2	0.99	PV85	1.0	891.2	886.1	0.99
PV02	1.0	955.2	949.0	0.99	PV44	1.0	936.3	928.7	0.99	PV86	1.0	893.2	887.4	0.99
PV03	1.0	953.1	946.2	0.99	PV45	1.0	917.6	910.9	0.99	PV87	1.0	912.1	905.9	0.99
PV04	1.0	946.8	940.4	0.99	PV46	1.0	750.4	740.3	0.99	PV88	1.0	919.1	913.7	0.99
PV05	1.0	935.8	928.7	0.99	PV47	1.0	948.3	940.1	0.99	PV89	1.0	899.8	893.3	0.99
PV06	1.0	913.2	907.1	0.99	PV48	1.0	943.2	936.0	0.99	PV90	1.0	907.3	901.6	0.99
PV07	1.0	870.0	863.5	0.99	PV49	1.0	939.9	932.2	0.99	PV91	1.0	917.8	911.3	0.99
PV08	1.0	693.8	687.5	0.99	PV50	1.0	933.1	926.2	0.99	PV92	1.0	920.2	914.7	0.99
PV09	1.0	957.0	949.6	0.99	PV51	1.0	922.1	914.4	0.99	PV93	1.0	920.1	913.2	0.99
PV10	1.0	952.5	946.0	0.99	PV52	1.0	902.0	895.5	0.99	PV94	1.0	924.0	918.2	0.99
PV11	1.0	949.9	942.5	0.99	PV53	1.0	966.0	957.6	0.99	PV95	1.0	930.7	924.3	0.99
PV12	1.0	942.8	936.3	0.99	PV54	1.0	961.6	953.9	0.99	PV96	1.0	932.3	926.4	0.99
PV13	1.0	930.0	923.0	0.99	PV55	1.0	958.6	950.1	0.99	PV97	1.0	922.4	914.6	0.99
PV14	1.0	906.3	900.3	0.99	PV56	1.0	953.2	945.6	0.99	PV98	1.0	924.7	918.5	0.99
PV15	1.0	868.8	861.7	0.99	PV57	1.0	944.1	935.9	0.99	PV99	1.0	932.2	925.0	0.99
PV16	1.0	709.5	702.5	0.99	PV58	1.0	929.4	922.3	0.99	PV100	1.0	933.2	927.0	0.99
PV17	1.0	954.9	947.1	0.99	PV59	1.0	956.3	947.7	0.99	PV101	1.0	937.4	930.7	0.99
PV18	1.0	950.1	943.4	0.99	PV60	1.0	952.1	944.3	0.99	PV102	1.0	937.6	932.0	0.99
PV19	1.0	947.2	939.6	0.99	PV61	1.0	950.2	941.8	0.99	PV103	1.0	970.4	960.1	0.99
PV20	1.0	939.5	933.0	0.99	PV62	1.0	945.4	938.0	0.99	PV104	1.0	972.2	962.1	0.99
PV21	1.0	927.8	920.9	0.99	PV63	1.0	939.9	931.1	0.99	PV105	1.0	974.6	964.7	0.99
PV22	1.0	904.5	898.3	0.99	PV64	1.0	929.3	922.0	0.99	PV106	1.0	975.5	965.7	0.99
PV23	1.0	861.4	854.4	0.99	PV65	1.0	1006.4	994.3	0.99	PV107	1.0	976.0	966.9	0.99
PV24	1.0	706.1	699.0	0.99	PV66	1.0	1004.7	992.6	0.99	PV108	1.0	976.0	966.9	0.99
PV25	1.0	967.5	959.5	0.99	PV67	1.0	1002.1	990.1	0.99	PV109	0.9	788.1	786.5	1.00
PV26	1.0	962.5	955.9	0.99	PV68	1.0	999.3	987.7	0.99	PV110	0.9	784.4	783.1	1.00
PV27	1.0	958.9	951.1	0.99	PV69	1.0	993.5	982.1	0.99	PV111	0.9	774.6	773.5	1.00
PV28	1.0	951.8	945.1	0.99	PV70	1.0	988.1	976.3	0.99	PV112	0.9	739.5	738.4	1.00
PV29	1.0	939.9	932.4	0.99	PV71	1.0	795.2	794.2	1.00	PV113	0.9	748.9	748.9	1.00
PV30	1.0	919.3	912.7	0.99	PV72	1.0	845.6	841.3	0.99	PV114	0.9	783.8	783.8	1.00
PV31	1.0	905.5	895.8	0.99	PV73	1.0	869.1	864.3	0.99	PV115	0.9	797.4	797.4	1.00
PV32	1.0	715.1	707.9	0.99	PV74	1.0	810.0	806.8	1.00	PV116	0.9	805.1	805.2	1.00
PV33	1.0	948.2	940.6	0.99	PV75	1.0	861.8	855.8	0.99	PV117	0.9	811.5	811.0	1.00
PV34	1.0	943.1	935.9	0.99	PV76	1.0	884.2	879.4	0.99	PV118	0.9	817.3	816.6	1.00
PV35	1.0	938.9	931.3	0.99	PV77	1.0	817.9	811.9	0.99	PV119	0.9	823.0	822.1	1.00
PV36	1.0	931.1	924.5	0.99	PV78	1.0	867.4	861.8	0.99	PV120	0.9	828.5	827.6	1.00
PV37	1.0	920.3	912.9	0.99	PV79	1.0	888.1	882.8	0.99	PV121	0.9	834.3	833.4	1.00
PV38	1.0	901.0	894.3	0.99	PV80	1.0	838.2	831.4	0.99	PV122	0.9	842.3	841.6	1.00
PV39	1.0	696.7	689.3	0.99	PV81	1.0	880.9	874.8	0.99	PV123	0.9	777.4	776.1	1.00
PV40	1.0	965.7	957.7	0.99	PV82	1.0	897.4	892.3	0.99	PV124	0.9	775.7	774.3	1.00
PV41	1.0	960.8	953.9	0.99	PV83	1.0	851.9	845.6	0.99	PV125	0.9	768.6	767.4	1.00
PV42	1.0	956.8	948.7	0.99	PV84	1.0	880.2	874.0	0.99	PV126	0.9	738.0	736.7	1.00

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project Ashley Road
Tottenham Hale

Title

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV02 Page no. 13

Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained
		(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)	
PV127	0.9	740.1	740.0	1.00	PV169	0.9	732.9	732.4	1.00	PV211	0.9	648.2	647.6	1.00
PV128	0.9	774.3	773.7	1.00	PV170	0.9	737.1	736.3	1.00	PV212	0.9	652.6	652.1	1.00
PV129	0.9	786.1	785.2	1.00	PV171	0.9	742.2	741.8	1.00	PV213	0.9	657.0	656.3	1.00
PV130	0.9	794.2	792.8	1.00	PV172	0.9	750.3	749.7	1.00	PV214	0.9	661.2	660.5	1.00
PV131	0.9	800.2	799.3	1.00	PV173	0.9	764.4	764.1	1.00	PV215	0.9	665.7	665.1	1.00
PV132	0.9	806.3	805.4	1.00	PV174	0.9	771.3	770.8	1.00	PV216	0.9	670.6	670.2	1.00
PV133	0.9	812.0	811.5	1.00	PV175	0.9	778.8	778.5	1.00	PV217	0.9	675.8	675.5	1.00
PV134	0.9	817.7	817.2	1.00	PV176	0.9	788.9	788.7	1.00	PV218	0.9	680.8	680.9	1.00
PV135	0.9	824.2	823.4	1.00	PV177	0.9	660.3	658.2	1.00	PV219	0.9	686.3	686.2	1.00
PV136	0.9	832.6	832.0	1.00	PV178	0.9	650.0	648.9	1.00	PV220	0.9	691.9	691.7	1.00
PV137	0.9	709.8	707.8	1.00	PV179	0.9	648.6	646.8	1.00	PV221	0.9	697.9	697.8	1.00
PV138	0.9	699.3	698.3	1.00	PV180	0.9	639.6	638.4	1.00	PV222	0.9	705.0	704.8	1.00
PV139	0.9	779.6	778.4	1.00	PV181	0.9	715.5	714.8	1.00	PV223	0.9	716.0	715.8	1.00
PV140	0.9	786.0	784.9	1.00	PV182	0.9	719.5	718.7	1.00	PV224	0.9	725.7	725.7	1.00
PV141	0.9	791.9	791.1	1.00	PV183	0.9	723.0	722.7	1.00	PV225	0.9	735.5	735.5	1.00
PV142	0.9	795.8	794.9	1.00	PV184	0.9	727.7	727.2	1.00	PV226	0.9	745.1	745.1	1.00
PV143	0.9	798.8	798.2	1.00	PV185	0.9	733.2	732.9	1.00	PV227	0.9	754.9	754.9	1.00
PV144	0.9	805.1	804.3	1.00	PV186	0.9	740.2	740.1	1.00	PV228	0.9	765.0	765.0	1.00
PV145	0.9	811.5	810.8	1.00	PV187	0.9	759.3	759.4	1.00	PV229	0.8	624.7	624.7	1.00
PV146	0.9	820.5	819.9	1.00	PV188	0.9	767.5	767.3	1.00	PV230	0.8	717.7	712.4	0.99
PV147	0.9	700.8	698.8	1.00	PV189	0.9	776.4	776.2	1.00	PV231	0.8	751.9	736.9	0.98
PV148	0.9	689.5	688.4	1.00	PV190	0.9	785.7	785.4	1.00	PV232	0.8	765.3	746.9	0.98
PV149	0.9	787.2	786.7	1.00	PV191	0.9	636.8	634.9	1.00	PV233	0.8	772.5	753.5	0.98
PV150	0.9	793.8	792.9	1.00	PV192	0.9	629.8	628.6	1.00	PV234	0.8	777.5	758.5	0.98
PV151	0.9	800.6	800.3	1.00	PV193	0.9	663.3	662.4	1.00	PV235	0.8	631.0	631.0	1.00
PV152	0.9	809.9	809.6	1.00	PV194	0.9	666.7	665.6	1.00	PV236	0.8	720.3	716.4	0.99
PV153	0.9	691.1	689.3	1.00	PV195	0.9	669.6	668.8	1.00	PV237	0.8	751.2	742.6	0.99
PV154	0.9	680.3	679.3	1.00	PV196	0.9	672.9	672.4	1.00	PV238	0.8	763.4	753.9	0.99
PV155	0.9	681.3	679.4	1.00	PV197	0.9	676.6	676.0	1.00	PV239	0.8	768.3	759.7	0.99
PV156	0.9	670.6	669.8	1.00	PV198	0.9	680.4	680.0	1.00	PV240	0.8	770.9	762.1	0.99
PV157	0.9	775.3	774.8	1.00	PV199	0.9	684.4	683.9	1.00	PV241	0.8	771.8	763.5	0.99
PV158	0.9	782.1	781.6	1.00	PV200	0.9	688.7	688.6	1.00	PV242	0.8	770.9	763.0	0.99
PV159	0.9	789.5	789.4	1.00	PV201	0.9	693.3	693.1	1.00	PV243	0.8	766.3	758.6	0.99
PV160	0.9	799.5	799.1	1.00	PV202	0.9	698.0	697.5	1.00	PV244	0.8	746.5	738.6	0.99
PV161	0.9	671.0	669.2	1.00	PV203	0.9	702.7	702.6	1.00	PV245	0.8	314.3	314.3	1.00
PV162	0.9	660.5	659.3	1.00	PV204	0.9	709.3	709.0	1.00	PV246	0.8	352.9	352.9	1.00
PV163	0.9	718.7	717.9	1.00	PV205	0.9	718.1	717.8	1.00	PV247	0.8	367.3	367.3	1.00
PV164	0.9	721.3	720.4	1.00	PV206	0.9	726.6	726.6	1.00	PV248	0.8	372.9	372.9	1.00
PV165	0.9	723.9	722.8	1.00	PV207	0.9	735.5	735.5	1.00	PV249	0.8	375.3	375.3	1.00
PV166	0.9	725.1	724.0	1.00	PV208	0.9	744.2	744.3	1.00	PV250	0.8	376.0	376.0	1.00
PV167	0.9	726.8	725.6	1.00	PV209	0.9	753.4	753.4	1.00	PV251	0.8	374.9	374.9	1.00
PV168	0.9	729.8	729.3	1.00	PV210	0.9	765.6	765.6	1.00	PV252	0.8	372.6	372.6	1.00

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project Ashley Road
Tottenham Hale

Title

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV02 Page no. 14

Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained	Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained
		(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)				(KWh/m2)	(KWh/m2)	
PV253	0.8	367.1	367.1	1.00	PV295	0.9	974.8	975.0	1.00	PV337	1.6	823.4	823.4	1.00
PV254	0.8	353.8	353.8	1.00	PV296	0.9	971.7	972.0	1.00	PV338	1.6	751.7	751.7	1.00
PV255	0.9	982.4	982.4	1.00	PV297	0.9	963.8	963.7	1.00	PV339	1.6	654.1	654.1	1.00
PV256	0.9	980.9	980.9	1.00	PV298	0.9	948.6	948.6	1.00	PV340	1.6	877.3	877.3	1.00
PV257	0.9	973.8	973.8	1.00	PV299	0.9	904.8	904.8	1.00	PV341	1.6	833.1	833.1	1.00
PV258	0.9	958.3	958.3	1.00	PV300	0.9	755.5	755.2	1.00	PV342	1.6	719.1	719.1	1.00
PV259	0.9	912.2	912.2	1.00	PV301	0.9	906.1	906.1	1.00	PV343	1.6	929.9	929.9	1.00
PV260	0.9	762.5	762.7	1.00	PV302	0.9	916.7	916.9	1.00	PV344	1.6	951.9	951.9	1.00
PV261	0.9	957.5	957.5	1.00	PV303	0.9	925.3	925.0	1.00	PV345	1.6	940.1	940.1	1.00
PV262	0.9	978.9	978.9	1.00	PV304	0.9	924.8	924.6	1.00	PV346	1.6	890.1	890.1	1.00
PV263	0.9	986.8	986.8	1.00	PV305	0.9	892.8	892.6	1.00	PV347	1.6	929.6	929.6	1.00
PV264	0.9	989.8	989.8	1.00	PV306	0.9	748.3	747.8	1.00	PV348	1.6	927.4	927.4	1.00
PV265	0.9	989.5	989.5	1.00	PV307	0.9	869.2	869.4	1.00	PV349	1.6	862.7	862.7	1.00
PV266	0.9	986.9	986.9	1.00	PV308	0.9	737.9	737.7	1.00	PV350	1.6	916.6	916.6	1.00
PV267	0.9	979.3	979.3	1.00	PV309	0.9	853.8	853.8	1.00	PV351	1.6	920.1	920.1	1.00
PV268	0.9	963.1	963.1	1.00	PV310	0.9	730.2	730.2	1.00	PV352	1.6	841.8	841.8	1.00
PV269	0.9	916.5	916.5	1.00	PV311	0.9	856.1	856.1	1.00	PV353	1.6	904.8	904.8	1.00
PV270	0.9	766.0	766.2	1.00	PV312	0.9	732.9	732.9	1.00	PV354	1.6	913.8	913.8	1.00
PV271	0.9	985.3	985.3	1.00	PV313	1.6	682.7	682.7	1.00	PV355	1.6	816.8	816.8	1.00
PV272	0.9	992.7	992.7	1.00	PV314	1.6	652.6	652.6	1.00	PV356	1.6	892.3	892.3	1.00
PV273	0.9	995.1	995.1	1.00	PV315	1.6	615.9	615.9	1.00	PV357	1.6	908.1	908.1	1.00
PV274	0.9	994.9	994.9	1.00	PV316	1.6	671.4	671.4	1.00	PV358	1.6	808.4	808.4	1.00
PV275	0.9	990.9	990.9	1.00	PV317	1.6	640.4	640.4	1.00	PV359	1.6	887.8	887.8	1.00
PV276	0.9	986.5	986.5	1.00	PV318	1.6	602.8	602.8	1.00	PV360	1.6	907.1	907.1	1.00
PV277	0.9	978.9	978.9	1.00	PV319	1.6	669.4	669.4	1.00	PV361	1.6	810.5	810.5	1.00
PV278	0.9	962.4	962.2	1.00	PV320	1.6	636.3	636.3	1.00	PV362	1.6	891.5	891.5	1.00
PV279	0.9	915.4	915.2	1.00	PV321	1.6	596.9	596.9	1.00	PV363	1.6	911.2	911.2	1.00
PV280	0.9	764.6	764.3	1.00	PV322	1.6	672.0	672.0	1.00	PV364	1.6	818.3	818.3	1.00
PV281	0.9	989.4	989.4	1.00	PV323	1.6	636.8	636.8	1.00	PV365	1.6	900.9	900.9	1.00
PV282	0.9	985.9	985.9	1.00	PV324	1.6	594.9	594.9	1.00	PV366	1.6	920.6	920.6	1.00
PV283	0.9	977.6	977.5	1.00	PV325	1.6	680.2	680.2	1.00	PV367	1.6	837.0	837.0	1.00
PV284	0.9	960.7	960.9	1.00	PV326	1.6	640.9	640.9	1.00	PV368	1.6	920.6	920.6	1.00
PV285	0.9	913.7	913.5	1.00	PV327	1.6	593.8	593.8	1.00	PV369	1.6	941.7	941.7	1.00
PV286	0.9	762.5	762.2	1.00	PV328	1.6	697.1	697.1	1.00	PV370	1.6	833.5	833.5	1.00
PV287	0.9	993.0	993.0	1.00	PV329	1.6	649.2	649.2	1.00	PV371	1.6	902.9	902.9	1.00
PV288	0.9	992.0	992.0	1.00	PV330	1.6	597.5	597.5	1.00	PV372	1.6	907.0	907.0	1.00
PV289	0.9	987.9	988.0	1.00	PV331	1.6	724.6	724.6	1.00	PV373	0.8	893.9	861.8	0.96
PV290	0.9	982.9	983.0	1.00	PV332	1.6	665.8	665.8	1.00	PV374	0.8	894.1	862.1	0.96
PV291	0.9	974.1	973.8	1.00	PV333	1.6	606.6	606.6	1.00	PV375	0.8	868.1	836.3	0.96
PV292	0.9	957.5	957.3	1.00	PV334	1.6	765.3	765.3	1.00	PV376	0.8	740.8	710.0	0.96
PV293	0.9	910.2	910.3	1.00	PV335	1.6	697.5	697.5	1.00	PV377	0.8	696.2	692.8	1.00
PV294	0.9	759.1	759.0	1.00	PV336	1.6	622.6	622.6	1.00	PV378	0.8	778.3	763.9	0.98

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project Ashley Road
Tottenham Hale

Title

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV02 Page no. 15

Area	Total Area (sq.m)	Mean Solar Value Existing	Mean Solar Value Proposed	Proportion Retained
		(KWh/m2)	(KWh/m2)	
PV379	0.8	837.9	813.5	0.97
PV380	0.8	880.8	850.0	0.97
PV381	0.8	905.1	872.8	0.96
PV382	0.8	919.4	887.1	0.96
PV383	0.8	927.6	895.7	0.97
PV384	0.8	924.6	892.9	0.97
PV385	0.8	894.2	863.2	0.97
PV386	0.8	761.0	729.9	0.96
PV387	0.8	694.0	685.6	0.99
PV388	0.8	776.5	756.2	0.97
PV389	0.8	836.9	808.9	0.97
PV390	0.8	874.0	845.7	0.97
PV391	0.8	896.6	868.7	0.97
PV392	0.8	910.3	882.6	0.97
PV393	0.8	916.1	888.5	0.97
PV394	0.8	910.9	883.9	0.97
PV395	0.8	880.8	853.9	0.97
PV396	0.8	749.7	723.5	0.96
PV397	0.8	746.1	732.7	0.98
PV398	0.8	771.5	758.4	0.98
PV399	0.8	787.8	774.7	0.98
PV400	0.8	797.3	784.6	0.98
PV401	0.8	801.8	788.9	0.98
PV402	0.8	798.8	786.2	0.98
PV403	0.8	775.9	763.4	0.98
PV404	0.8	663.4	651.2	0.98

Sources of information

Cloud 10
Ashley Rd_TH Pt1 15-06-2026
Received 15/06/2026
Ashley Rd_TH Pt2 19-06-2026
Received 22/06/2026

DLA
03 Ashley House - Design Freeze_
selected_2026-07-30_12-06-41pm
Received 30/07/2026

EB7 Ltd
Site Photographs
Ordnance Survey



Project Ashley Road
Tottenham Hale

Title

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix PV02 Page no. 16

Appendix: Daylight, Sunlight, Overshadowing and Solar Glare

Annex 1: Drawings of Existing, Proposed and Surrounding Buildings

**Annex 2: Results of the Daylight and Sunlight Assessments with Neighbouring
Properties**

Annex 3: Results of the Cumulative Daylight and Sunlight Assessments

Annex 4: Results of the Future Baseline Daylight and Sunlight Assessments

Annex 5: Results of the Consented Baseline Daylight and Sunlight Assessments

Annex 6: Results of the Mirrored Assessment for Rosa Luxemburg Apartments

Annex 7: Results of the Sunlight Amenity Assessments

Annex 8: Transient Shadow Images

Annex 9: Solar Glare Images

Annex 10: Policy and Legislation Review

Annex 11: Hale Road Properties



Annex 8

Transient Shadow images



2nd Floor, Chancery Exchange
10 Fumival Street
London EC4A 1AB

T: +44(0)20 7148 6290
E: info@eb7.co.uk
W: eb7.co.uk

Transient Overshadowing

Ashley Road
Tottenham Hale
31 July 2026

Ref. 10106-R08-TS01