

2026

re:shape

# Internal Daylight & Sunlight Report

Ashley Park





2nd Floor, Chancery Exchange  
10 Fumival Street  
London  
EC4A 1AB

T: +44 (0) 20 7148 6290  
E: [info@eb7.co.uk](mailto:info@eb7.co.uk)  
W: [www.eb7.co.uk](http://www.eb7.co.uk)

# INTERNAL DAYLIGHT & SUNLIGHT REPORT

## Ashley Park

Former Ashley House site

Ashley Road, Tottenham Hale, London Borough of Haringey, N17 9LZ

Our Ref: 10106

28 August 2026

## Contents

|           |                                                          |           |
|-----------|----------------------------------------------------------|-----------|
| <b>1</b>  | <b>Introduction.....</b>                                 | <b>2</b>  |
| <b>2</b>  | <b>Guidance .....</b>                                    | <b>3</b>  |
| <b>3</b>  | <b>Application of the guidance.....</b>                  | <b>5</b>  |
| <b>4</b>  | <b>Planning Policy.....</b>                              | <b>7</b>  |
| <b>5</b>  | <b>Sources of Information &amp; Assumptions.....</b>     | <b>11</b> |
| <b>6</b>  | <b>The Site and Proposal.....</b>                        | <b>13</b> |
| <b>7</b>  | <b>Internal Daylight &amp; Sunlight Assessment .....</b> | <b>16</b> |
| <b>8</b>  | <b>Cumulative Internal Analysis .....</b>                | <b>22</b> |
| <b>9</b>  | <b>Sunlight to Proposed Amenity Areas .....</b>          | <b>25</b> |
| <b>10</b> | <b>Local Precedents .....</b>                            | <b>29</b> |
| <b>11</b> | <b>Conclusions.....</b>                                  | <b>30</b> |

Appendix 1 – Drawings of the existing, proposed and surrounding buildings

Appendix 2 – Detailed results of the daylight and sunlight assessments within the Shared-Living Block (BRE 2022)

Appendix 3 – Detailed results of the daylight and sunlight assessments within the C3 Affordable Block (BRE 2022)

Appendix 4 – Assessed layouts within the proposed accommodation

Appendix 5 – Detailed results of the daylight assessments within the C3 Affordable Block (BRE 2011)

Appendix 6 – Additional balconies and access decks off results within the C3 Affordable block (BRE 2022)

Appendix 7 – Detailed daylight and sunlight assessments within the proposed accommodation in the cumulative context

Appendix 8 – Sunlight amenity assessments within the proposed amenity spaces

Appendix 9 – Precedent study of comparable consents within the local area

## Report details

Client: Re:shape T Ltd,  
73 Cornhill,  
London,  
United Kingdom,  
EC3V 3QQ

Prepared by: JP

Checked by: HG

Date of issue: August 2026

# 1 Introduction

- 1.1.1 eb7 have been instructed to assess the quality of internal amenity within the proposed new development at the Former Ashley House Site. This assessment is based on the latest scheme proposals dated 14/08/2026, comprising:

*"Full planning permission for a phased mixed-use development comprising: (i) enabling works and operations; (ii) residential development (Use Class C3) including affordable housing; (iii) shared living accommodation (Sui Generis), (iv) commercial and community floorspace (Use Classes E and F2); and (v) site-wide and/or phase-specific access, servicing, public realm, blue-badge parking, cycle parking, open space, hard and soft landscaping, utilities, plant and all other associated works."*

- 1.1.2 The methodology and criteria used for these assessments is provided by Building Research Establishment's (BRE) guidance 'Site layout planning for daylight and sunlight: A guide to good practice' (BRE 209 3<sup>rd</sup> edition, 2022), which in turn references the British Standard BS EN17037:2018 'Daylight in buildings'.
- 1.1.3 In order to carry out an assessment, we have generated a 3D computer model (Test Environment) of the proposed development, surrounding buildings and other relevant obstructions. Using this model and our specialist software, we have calculated the daylight and sunlight levels within the proposed new dwellings.
- 1.1.4 The numerical criteria suggested within the BRE guidelines has been applied to each of the assessments mentioned above. It is important to note that the numerical criteria within the BRE guidance are advisory and should be applied flexibly having regard to the specific site context and other design considerations.

## 2 Guidance

*'Site layout planning for daylight and sunlight: A guide to good practice'*, BRE 2022

- 2.1.1 The Building Research Establishment (BRE) Report 209, *'Site layout planning for daylight and sunlight: A guide to good practice'*, is the reference document used by most local authorities for assessing daylight and sunlight in relation to new developments. Commonly referred to as 'the BRE guidelines', it provides various testing methodologies to calculate the potential light levels received by neighbours of a development site and provided within proposed new development.
- 2.1.2 The guidance given within the BRE document makes direct reference to the British Standard BS EN17037 (2018) and the CIBSE (Chartered Institute of Building Services Engineers) guide LG10: Daylighting – a guide for designers (2014). It is intended to be used in conjunction with these documents, which provide guidance on the assessment of daylight and sunlight within new buildings.
- 2.1.3 The 2022 update to the BRE guidance was published on 9th June 2022. The assessment methodologies and target metrics in respect of the impacts to neighbouring properties remain broadly unchanged from the earlier guidance save for certain clarifications. The primary change relates to the assessment of internal daylight and sunlight amenity within proposed habitable accommodation. The new guidance reflects the British Standard BS EN17037, published in 2018, which was based on the relevant European Standard but, included a 'National Annex' clarifying the proposed application of the new internal guidance within the UK.
- 2.1.4 Detailed guidance upon the updated internal amenity standards is set out below. It is important to note that the standards set out in BS EN17037 and BRE 209 (2022) are generally more demanding than the previous Average Daylight Factor (ADF) assessments under the 2011 guidance. A lower compliance rate against the new targets is not, of itself, indicative of a poorer scheme and should be understood in the context of the changed methodology. This is particularly so in respect of urban development where a number of important design factors such as the provision of balcony private amenity space and limiting solar gain / overheating may lead to a trade-off against achieving higher internal amenity levels.

### 2.2 Daylight to new buildings or consented developments

- 2.2.1 The 2022 update to the BRE 209 document was published on 9<sup>th</sup> June 2022. The new guidance reflects the UK National Annex of the British Standard: BS EN17037 (2018) and provides two methodologies for assessing the internal daylight amenity to new residential properties. The assessment method is known as 'Daylight Illuminance' and is described in more detail below:

#### ***Daylight Illuminance Assessment***

- 2.2.2 The Daylight Illuminance method utilises climatic data for the location of the site, based on a weather file for a typical or average year, to calculate the illuminance at points within a room on at least hourly intervals across a year. The illuminance is calculated across an assessment grid sat at the reference plane (usually desk height).
- 2.2.3 The guidance provides target illuminance levels that should be achieved across at least half of the reference plane for half of the daylight hours within a year.<sup>1</sup> The targets set out within the national annex are as follows:
- Bedrooms – 100 Lux
  - Living Rooms – 150 Lux
  - Kitchens – 200 Lux
- 2.2.4 For spaces with a shared use the higher target would generally apply such that it would be appropriate to adopt a target of 150 Lux for a student bed sitting room if students would often spend time in their room during the day. The guidance notes that discretion should be used and, for example, a target of 150 Lux may be appropriate in a Living / Kitchen / Dining Room within a modern flatted development where the kitchens are not 'habitable' space and small separate kitchens are to be avoided.

### **2.3 Sunlight to new buildings or consented developments**

- 2.3.1 In respect of direct sunlight, the 2022 BRE guidance reflects the BS EN17037 recommendation that a space should receive a minimum of 1.5 hours of direct sunlight on a selected date between 1<sup>st</sup> February and 21<sup>st</sup> March with cloudless conditions. It is suggested that 21<sup>st</sup> March (equinox) be used for the assessment.
- 2.3.2 The BS EN17037 criterion can be applied to all rooms of a unit but it is preferable for the target to be achieved within a main living room. Rooms in all orientations may be assessed and the sunlight received by different windows may be added together providing there is no 'double-counting'.
- 2.3.3 Where a group of dwellings are planned the site layout and design should maximise the number of dwellings with main living rooms meeting these targets. It is also advised that a dwelling has at least one window wall facing within 90 degrees of due south.

---

<sup>1</sup> The European Standard also includes a minimum illuminance target to be achieved over 95% of the reference plane however this need not apply to dwellings in the UK.

## 3 Application of the guidance

### 3.1 Scope of assessment

- 3.1.1 Our assessment has considered all proposed residential accommodation within the scheme, including both the C3 residential units and shared-living studios. For the C3 units, the daylight assessment considers all main habitable rooms, including bedrooms, living rooms and kitchens. For the shared-living accommodation, the assessment considers the primary studio living/sleeping spaces, which perform the function of habitable rooms. Toilets, bathrooms, hallways, circulation areas and staircases are not considered habitable accommodation and have therefore been excluded from the assessment.

### 3.2 Application of the numerical criteria

- 3.2.1 The opening paragraphs of the BRE guidelines state:

*"The guide is intended for building designers and their clients, consultants, and planning officials. The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly since natural lighting is only one of many factors in site layout design (see Section 5). In special circumstances the developer or planning authority may wish to use different target values. For example, in a historic city centre, or in an area with modern high-rise buildings, a higher degree of obstruction may be unavoidable if new developments are to match the height and proportions of existing buildings."*

- 3.2.2 It is therefore very important to apply the BRE guidance sensibly and flexibly, with careful consideration of the specific site context. Its numerical targets theoretically apply to any built environment, from city centres to rural villages. However, in more tightly constrained environments, achieving the default BRE targets can be very challenging and conflict with other beneficial factors of site layout design.

- 3.2.3 With the above in mind, rigid adherence to the BRE in certain situations could easily result in an inappropriate form of development. In such circumstances, it may be appropriate to apply alternative or more context-responsive target values to the location concerned. This is acknowledged in the BRE guidance at paragraph 2.2.3 (page 14):

*"Note that numerical values given here are purely advisory. Different criteria maybe used, based on the requirements for daylighting in an area viewed against other site layout constraints."*

#### **Criteria for daylight assessment**

*"2.1.14 Living rooms and kitchens need more daylight than bedrooms, so where there is a choice it is best to site the living room or kitchen away from*

*obstructions. Dual-storey maisonette-type apartments may be planned with the main living rooms on the upper storey and the bedrooms on the lower floor for this reason. Areas without a special requirement for daylight, like bathrooms, stairwells, garages, and storage areas, can occupy the most obstructed areas such as internal corners of buildings. In mixed use developments commercial uses may occupy the less well daylighted areas, allowing residential parts to have better access to light."*

#### **Criteria for sunlight assessment**

*"3.1.14 The BS EN 17037 criteria are intended to apply to minimum, medium, and high levels of sunlight in a range of situations. However, in special circumstances the designer or planning authority may wish to choose a different target value for hours of sunlight. If sunlight is particularly important in a building, a higher target value or different target date may be chosen, although the risk of overheating needs to be borne in mind. Section 4 gives guidance on passive solar design. Conversely, if in a particular development sunlight is deemed to be less important but still worth checking for, a lower target value could be used. In either case, the sunpath indicators in Appendix A will still show whether the hours of sunlight received meet the target."*

## 4 Planning Policy

- 4.1.1 Local, regional and national planning policy and guidance relevant to daylight and sunlight have been considered. In general terms, these documents require decision-makers to assess whether proposed development would provide satisfactory living conditions for future occupants and avoid unreasonable or unacceptable impacts on neighbouring occupiers, having regard to the context of the site and the detailed design of the scheme.
- 4.1.2 The need to provide satisfactory internal and external amenity is reinforced in the London Plan, the Mayor's guidance and national policy. These documents also recognise that daylight and sunlight guidance should be applied flexibly and with regard to context, particularly in higher-density urban locations and regeneration areas where site-specific constraints and design objectives may influence the extent to which numerical guidelines can be achieved.

### 4.2 The Haringey Local Plan (2017)

#### SP0: Presumption in Favour of Sustainable Development

*"The Council will promote the most efficient use of land in Haringey and buildings while also seeking to improve the quality of our environment protect the amenity of occupiers and neighbours and meet other planning objectives."*

#### SP1: Managing Growth

*"The Council will expect development in the growth areas to maximise site opportunities and the opportunities and benefits for the borough and the local area within the context of the full range of Haringey's planning policies and objectives, including those relating to amenity, sustainability, heritage/ built environment, open space, community safety and sustainable transport."*

#### SP2: Housing

*"Good quality housing design can improve social well-being and quality of life by reducing crime, improving public health, easing transport problems and increasing property values."*

*"Haringey will ensure that CABE's Building for Life criteria are used to evaluate the quality of new housing developments across the borough and that all new affordable housing funded through the Affordable Housing Programme meets or exceeds the minimum standards set by the Mayor."*

*"The Council will expect good quality housing design to be contextually sensitive so that it positively contributes to the local and historic character of an area/neighbourhood."*

### 4.3 The London Plan – The Mayor of London (March 2021)

- 4.3.1 The Mayor of London's New London Plan gives the following: -

**Policy D6 Housing quality and standards**

*"C. Housing development should maximise the provision of dual aspect dwellings and normally avoid the provision of single aspect dwellings. A single aspect dwelling should only be provided where it is considered a more appropriate design solution to meet the requirements of Part B in Policy D3 Optimising site capacity through the design-led approach than a dual aspect dwelling, and it can be demonstrated that it will have adequate passive ventilation, daylight and privacy, and avoid overheating."*

*"D. The design of development should provide sufficient daylight and sunlight to new and surrounding housing that is appropriate for its context, whilst avoiding overheating, minimising overshadowing and maximising the usability of outside amenity space."*

**4.4 The London Plan Guidance: Support for Housebuilding – The Mayor of London (March 2026)**

- 4.4.1 The London Plan Guidance: Support for Housebuilding states the following: -

**3. Changes to housing design standards**

**3.1 Dual aspect and dwellings per core**

*"To avoid the inflexible application of particular standards in the Housing Design Standards London Plan Guidance 2023, the following standards are withdrawn: Standard C4.1 and Standard B2.5. London Plan Policy D6 Housing quality and standards will continue to apply."*

*Standard C4.1 required new homes to be dual aspect unless exceptional circumstances make it impractical or undesirable. This standard linked to London Plan Policy D6 part C, which continues to apply. When applying this policy, flexibility should be afforded to the provision of dual and single aspect dwellings by decision makers. Where single aspect dwellings are proposed, it should be demonstrated by the applicant that they will have adequate passive ventilation, daylight and privacy, and avoid overheating."*

- 4.4.2 This policy is central to the assessment presented in this report, as it requires a contextual planning judgement as to whether the daylight and sunlight conditions experienced by both proposed and neighbouring accommodation are acceptable and appropriate in the circumstances of the site, rather than relying on strict compliance with a single numerical benchmark.

**4.5 The Tottenham Area Action Plan (Adopted July 2017)**

- 4.5.1 The site also falls within the Tottenham Hale regeneration area and is subject to site allocations supporting comprehensive mixed-use redevelopment, higher density growth and improved east-west connectivity. This wider allocation and regeneration

context is therefore relevant to the planning judgement on daylight and sunlight outcomes.

#### Policy AAP1: Sustainable Design and Development

*"Development proposals should be of the highest standard of design and provide a high quality residential environment for existing and future occupiers."*

*"Development proposals will be required to demonstrate how they have addressed issues relating to amenity, privacy, overlooking, enclosure and environmental quality."*

*"All new homes should provide a high quality living environment and meet or exceed the relevant standards set out in the London Plan and associated guidance."*

*"Development should safeguard the amenity of surrounding occupiers whilst delivering an attractive and sustainable place."*

#### **4.6 The National Planning Policy Framework - Department for Housing, Communities and Local Government (August 2026)**

4.6.1 The National Planning Policy Framework (NPPF) published in August 2026 is a material consideration in decision-making. It confirms that the planning system should contribute to the achievement of sustainable development and that proposals should be assessed against the development plan and the national decision-making policies in the NPPF.

4.6.2 Policy P3 is a national decision-making policy of applying to all types of development and stating that development proposals should:

*"a. Provide healthy living conditions for occupiers and users in terms of adequate access to light [...]"*

*"b. Not give rise to, or contribute to, an unacceptable level of access to daylight and sunlight for neighbouring residents and occupiers [...] Adverse impacts of this nature should be avoided where possible, or else mitigated to an acceptable degree."*

4.6.3 Policy P3 does not prescribe numerical daylight or sunlight standards. Whether living conditions are "adequate", or whether effects on neighbouring occupiers would be "unacceptable", is therefore a matter of planning judgement informed by the specific context of the site and the detailed design of the proposals.

4.6.4 This may be interpreted by reference to the Planning Practice Guidance 'Making Effective Use of Land' (February 2025) which plays an important supporting role to the policy. It similarly states that local planning authorities will need to consider whether the proposed development "would have an unreasonable impact on the daylight and sunlight levels enjoyed by neighbouring occupiers", as well as assessing "whether daylight and sunlight within the development itself will provide satisfactory living conditions for future occupants".

- 4.6.5 On the standard to be applied, the guidance states that all developments should maintain acceptable living standards, and that:

*"What this means in practice, in relation to assessing appropriate levels of sunlight and daylight, will depend to some extent on the context for the development as well as its detailed design. For example, in areas of high-density historic buildings, or city centre locations where tall modern buildings predominate, lower daylight and daylight and sunlight levels at some windows may be unavoidable if new developments are to be in keeping with the general form of their surroundings."*

- 4.6.6 Policy L1 to L3 of the NPPF deal with Making effective use of land' set out further considerations which apply, in addition to Policy P3, to defined categories of development.
- 4.6.7 In addition to Policy P3, the NPPF includes policies on making effective use of land. These support the efficient use of previously developed and accessible urban land, including the optimisation of suitable sites within settlements and in proximity to well-connected stations, whilst also requiring development to respond appropriately to local character and secure well-designed places. This policy context is relevant to the assessment of daylight and sunlight in this case, given the site's brownfield status, high accessibility and regeneration context.
- 4.6.8 Taken together, the policy framework does not impose a rigid requirement for compliance with BRE numerical guidelines. Rather, it requires an overall planning judgement on whether the proposals would provide satisfactory living conditions for future occupants and an acceptable relationship with neighbouring occupiers, having regard to the site's urban context, its allocation and regeneration role, and the wider public benefits of the scheme.

## 5 Sources of Information & Assumptions

5.1.1 A measured survey, a photogrammetric 3D model, architectural drawings, site photographs and Ordnance Survey information have been used to create a 3D computer model of the proposed development in the context of the surrounding buildings.

5.1.2 The full list of sources of information used in this assessment is as follows: -

### 5.2 Cloud 10

#### Measured Survey Information

Ashley Rd\_TH Pt1 15-06-2026

Received 15/06/2026

Ashley Rd\_TH Pt2 19-06-2026

Received 22/06/2026

### 5.3 DLA

#### 3D model and 2D drawings

03 Ashley House - Design Freeze\_selected\_2026-07-30\_12-06-41pm

Received 30/07/2026

### 5.4 Eb7 Ltd

Site Photographs

Ordnance Survey

5.4.1 In order to produce the daylight and sunlight assessments in line with BRE guidance, we have applied a number of inputs to represent the physical nature of the proposed development and surrounding context. These inputs are: -

### 5.5 Material reflectance values

| Surface                         | Reflectance value                       |
|---------------------------------|-----------------------------------------|
| Interior walls                  | 0.8 (white paint)                       |
| Interior ceilings               | 0.8 (white paint)                       |
| Floors                          | 0.4 (light coloured carpet or flooring) |
| Exterior walls and obstructions | 0.4                                     |
| Exterior ground                 | 0.2                                     |
| External balconies              | 0.6                                     |

*Table 1 - Surface reflectance of construction materials*

## 5.6 Glazing properties

- 5.6.1 We have assumed that the glazing used within the development will be standard clear double glazed with a low emissivity coating with a diffuse transmittance factor of 0.68. We have also applied a window framing factor, to account for the proportion of frame to glazing. We have used the standard BRE assumptions as listed in Appendix C of the BRE guidance.

## 5.7 Maintenance Factors

- 5.7.1 We have also applied a maintenance factor to the windows to account for the build-up of dirt. These are listed in the table below: -

| Type of window                    | Urban |
|-----------------------------------|-------|
| Vertical, no overhang             | 0.92  |
| Vertical, sheltered from the rain | 0.76  |
| Sloping rooflight                 | 0.84  |
| Horizontal rooflight              | 0.76  |

*Table 2 - Surface reflectance of construction materials*

## 6 The Site and Proposal

- 6.1.1 The existing site comprises vacant brownfield land, with the previous existing buildings having been demolished in August 2023.
- 6.1.2 The site is located to the west of Ashley Road, south of the Rosa Luxemburg residential building, east of Down Lane Park and north of a number of residential properties along Hale Road. Berol House, a locally listed building, sits on the opposite side of Ashley Road and is currently vacant. The site is located to the northwest of Tottenham Hale underground and railway station. The surroundings comprise a mix of uses, including a range of recent developments providing ground and lower floor commercial units, with residential development. The site lies within the Tottenham Hale regeneration area and forms part of an area that has undergone substantial recent redevelopment and intensification.
- 6.1.3 The site is subject to extant planning consents. The wider Ashley House and Cannon Factory site was granted outline planning permission (ref. HGY/2016/4615, approved 02/05/2018) for:

*"Demolition of the existing buildings at Ashley House and Cannon Factory and erection of three buildings to provide up to 3,600sqm of commercial floorspace (GEA) (Class A1/A3/B1/D1), up to 265 residential units (Class C3), new public realm, landscaped amenity space, car and cycle parking and all associated works."*

- 6.1.4 This was subsequently amended by NMA ref. HGY/2018/2210 (approved 09/08/2018) to update the parameter plans approved under the outline planning permission and Reserved Matters Application (RMA) (ref. HGY/2018/2353) for appearance, landscaping, layout, scale and access details was approved in November 2018. The RMA was subsequently amended via NMAs to update the wording of conditions to allow for site demolition, clearance and drainage works to be carried out prior to submission of details (refs. HGY/2022/4230 and HGY/2023/0890). This was implemented by way of demolition works and confirmed via a certificate of lawfulness (ref. HGY/2023/1622) in August 2023. The permission remains extant.
- 6.1.5 Full planning permission was also secured for the Ashley Park site, ref. HGY/2019/0108 (refused by the LPA) was approved at appeal on 16/04/2020 (ref. APP/Y5420/W/19/3232707) for:

*"Demolition of existing buildings and erection of a part 6, part 8 storey building to provide 97 residential units (Class C3), 170 sqm of commercial floorspace (Class A1/A3/B1), new public realm, car and cycle parking and associated works."*

- 6.1.6 NMA ref. HGY/2022/4229 approved 03/03/2023 then made changes to the wording of conditions to allow or site demolition, clearance and drainage works to be carried out prior to the submission of details. The implementation of both planning

permissions has been confirmed by the approval of Certificate of Lawfulness (existing use) applications as follows, and both sites therefore have an extant consent. These implemented consents form part of the relevant planning baseline and are a material contextual consideration in considering the acceptability of the current proposals.

Ref. HGY/2023/1622 approved 21/8/2023:

*"Certificate of lawfulness (existing use) for implementation of planning permission HGY/2016/4165, by way of demolition works involving the demolition of brickwork, demolition of corrugated walls, dismantling of roller shutters, and removal of windows."*

Ref. HGY/2023/1621 approved 21/08/2023:

*"Certificate of lawfulness (existing use) for implementation of planning permission HGY/2019/0108 allowed at appeal under APP/Y5420/W/19/3232707, by way of demolition works involving the demolition of brickwork, demolition of areas of the facade and removal of windows."*

- 6.1.7 There has been no further activity at the site following site clearance and the delivery of the schemes has been stalled since 2023.
- 6.1.8 The new proposals involve comprise:
  - "Full planning permission for a phased mixed-use development comprising: (i) enabling works and operations; (ii) residential development (Use Class C3) including affordable housing; (iii) shared living accommodation (Sui Generis), (iv) commercial and community floorspace (Use Classes E and F2); and (v) site-wide and/or phase-specific access, servicing, public realm, blue-badge parking, cycle parking, open space, hard and soft landscaping, utilities, plant and all other associated works."*
- 6.1.9 The site lies within the Tottenham Hale regeneration area and, in part, within the existing District Centre, where the planning framework envisages significant growth, increased density and urban intensification. The proposed development has evolved through an extensive iterative design process, with daylight and sunlight testing playing a key role in informing the height, massing and arrangement of buildings across the site. This process included relocating the taller building element closer to the park and refining the affordable housing block to optimise residential amenity wherever possible.
- 6.1.10 The site forms part of the Ashley Road South Masterplan area and is one of the remaining undeveloped plots within a wider programme of high-density mixed-use regeneration around Tottenham Hale. The surrounding area has undergone substantial recent change, with a number of consented and completed schemes altering the prevailing scale, massing and urban grain. This is a material consideration when assessing the amenity performance of the proposed accommodation
- 6.1.11 The internal daylight and sunlight results should be considered in the context of

delivering a comprehensive mixed-use redevelopment on a constrained and highly accessible urban site, within an established regeneration area and against the backdrop of implemented extant consents. The scheme seeks to balance residential amenity with the delivery of new homes, affordable housing, active ground-floor uses and wider placemaking objectives within a master-planned regeneration area. While these objectives can place constraints on the amenity performance achievable for some dwellings, extensive daylight and sunlight testing has informed the evolution of the design, helping to maximise residential amenity within the context of a higher-density mixed-use development.



**Image 1 - 3D image of the existing site and surrounding context**



**Image 2 - 3D image of the proposals and surrounding context**

## 7 Internal Daylight & Sunlight Assessment

- 7.1.1 The daylight and sunlight amenity provided within the proposed residential accommodation has been assessed using the Daylight Illuminance and Sunlight Exposure assessments set out within the 2022 BRE guidance.
- 7.1.2 Full results of these assessments within the proposed shared-living block and C3 block, along with drawings to show the layout of rooms and windows, are attached within the appendices.

### 7.2 Shared Living Block

#### Daylight

| Room use & target                       | No. of Rooms Assessed | Rooms meeting target |
|-----------------------------------------|-----------------------|----------------------|
| Shared-living rooms<br>(150-lux target) | 522                   | 358 (69%)            |
| Shared-living rooms<br>(100-lux target) | 522                   | 426 (82%)            |
| Communal spaces<br>(150-lux target)     | 8                     | 6 (75%)              |

*Table 3 - Shared-living block internal daylight summary*

- 7.2.1 A comprehensive internal daylight assessment has been undertaken for all proposed habitable spaces within the shared-living block. As the shared-living accommodation provides a dual function, incorporating both private sleeping and living space within a single room, the assessment has been considered against two daylight performance benchmarks. Firstly, the rooms have been tested against the 100-lux BRE target, which is typically associated with bedrooms and sleeping accommodation. Secondly, the spaces have also been assessed against the more onerous 150-lux criterion generally applied to living rooms and multipurpose living, kitchen and dining (LKD) spaces. This approach provides a robust assessment framework that acknowledges the hybrid nature of the proposed accommodation while allowing daylight performance to be considered against both residential functions.
- 7.2.2 Of the 522 shared-living rooms assessed, 426 rooms (82%) will meet or exceed the BRE Daylight Illuminance target of 100-lux. This level of compliance is considered to represent a very strong performance, particularly when viewed in the context of a high-density urban development where site constraints, neighbouring buildings and urban enclosure can limit opportunities for daylight penetration. The results demonstrate that most of the proposed shared-living rooms will benefit from good levels of daylight and a high-quality internal environment.

- 7.2.3 When assessed against the more demanding 150-lux benchmark, 358 rooms (69%) achieve compliance. Given that this target is generally associated with dedicated living spaces rather than combined bedroom accommodation, the proportion of rooms achieving this higher threshold supports the conclusion that the block provides a good level of daylight amenity overall.
- 7.2.4 Of the 96 shared-living rooms that do not achieve the 100-lux target, 92 of these rooms achieve median lux levels of between 54 lux and 97 lux. This indicates that the vast majority of these rooms will only experience minor to moderate deviations from the targets and will still receive usable and reasonable levels of internal daylight.
- 7.2.5 Daylight levels have also been assessed within the proposed communal spaces at the ground, 7<sup>th</sup> and 22<sup>nd</sup> floor levels. The 6 communal spaces located on the 7<sup>th</sup> and 22<sup>nd</sup> floors achieve excellent levels of daylight and comfortably meet the BRE Daylight Illuminance targets, providing bright and attractive spaces that will offer a high-quality environment for future residents.
- 7.2.6 The two ground-floor communal spaces will fall below the 150-lux BRE target, achieving median illuminance levels of 129-lux and 123-lux respectively. These shortfalls are minor and should be considered in the context of their ground floor location, where daylight is inherently more constrained by the surrounding built form. These spaces will however still achieve good levels of natural daylight and will provide functional and well-lit communal spaces within a dense urban setting for the residents.

### Sunlight

- 7.2.7 In respect of direct sunlight, the target is for units to achieve at least 1.5 hours of direct sunlight on 21<sup>st</sup> March, ideally within the main living space, in accordance with the criterion set out in BS EN 17037 and referenced in the BRE Guide.
- 7.2.8 It should be recognised that sunlight availability is inherently dependent on orientation. As the sun remains within the southern half of the sky at the equinox, north-facing units and rooms will naturally receive lower levels of direct sunlight regardless of design quality. This reflects the fundamental characteristics of solar geometry in the UK rather than any deficiency in the proposed accommodation, with such spaces continuing to benefit from natural daylight.

| Room type           | No. of rooms assessed | No. rooms that meet target |
|---------------------|-----------------------|----------------------------|
| Shared-living Rooms | 522                   | 299 (57%)                  |
| Communal spaces     | 8                     | 7 (88%)                    |

*Table 4 - Sunlight summary within the shared-living block*

- 7.2.9 The BRE Sunlight Exposure assessment indicates that 299 (57%) of the proposed shared-living rooms will receive at least 1.5 hours of direct sunlight on 21 March. This represents a good level of sunlight provision for a high-density urban development,

where neighbouring buildings and site constraints can limit opportunities for direct solar access.

- 7.2.10 Whilst the BRE guidance assesses all habitable rooms, sunlight availability is inherently dependent on orientation. Rooms with northerly aspects will naturally receive reduced levels of direct sunlight. Accordingly, the majority of rooms that do not achieve the BRE sunlight target are located on the northern elevation of the building, reflecting the site's orientation rather than any shortcoming in the design.
- 7.2.11 The scheme has also been designed to maximise sunlight access to the shared communal amenity spaces. Of the 8 communal living areas assessed, 7 (88%) meet the BRE sunlight target. These well-sunlit communal environments provide an important amenity for future residents and ensure that all occupants have access to areas benefiting from good levels of direct sunlight throughout the year.
- 7.2.12 It is neither practical nor typical for all residential accommodation within a development of this scale to be south-facing. Nevertheless, the proposed layout has been carefully designed to maximise the number of south-facing and favourably oriented rooms where feasible, whilst responding to the site's urban context and design requirements. The overall level of sunlight compliance achieved within this block is therefore considered appropriate and reflects a balanced and well-designed proposed scheme in accordance with the objectives of the BRE guidance.

### 7.3 C3 Affordable Block

#### Daylight

| Room Type    | No. of rooms assessed | Rooms meeting target |
|--------------|-----------------------|----------------------|
| LKD          | 73                    | 30                   |
| Bedroom      | 196                   | 75                   |
| Kitchen      | 14                    | 1                    |
| Living Room  | 14                    | 0                    |
| <b>Total</b> | <b>293</b>            | <b>107 (37%)</b>     |

*Table 5 - C3 Affordable Block internal daylight summary*

- 7.3.1 The results of our BRE Daylight Illuminance assessments within the C3 Affordable Block have indicated that 107 (37%) of the 293 habitable rooms will meet the targets. The results should be considered in the context of the site's highly constrained urban setting and the specific design characteristics of the proposed scheme.
- 7.3.2 The daylight performance within this block is influenced by a combination of factors including the close proximity of neighbouring development at Rosa Luxemburg Apartments, the relationship with the proposed shared-living building to the south, and the inclusion of external access decks and private balconies. These elements

inevitably restrict the amount of daylight able to reach certain windows, particularly at the lower levels of the building. However, they also perform important residential amenity functions, including enabling dual-aspect homes that can enhance residential quality through improved daylight, outlook and natural ventilation. Whilst no longer expressly required by London Plan Guidance, the provision of dual-aspect dwellings remains a beneficial design outcome. In addition, the balconies provide private outdoor amenity space and assist in the efficient delivery of housing within a higher-density urban context.

- 7.3.3 The assessment indicates that a number of the rooms within the central core of the building fall below the BRE Daylight Illuminance targets. This is primarily due to the combined influence of the external access decks to the north, overhanging balconies to the south, and the constrained urban context within which the building is situated. Paragraph 2.1.17 of the BRE guidelines acknowledges that balconies, access decks and other external overhangs can have a significant effect on the amount of daylight reaching windows beneath them.
- 7.3.4 To better understand the extent of this influence, an additional assessment was undertaken with the balconies and access decks removed from the model. In this scenario, compliance increases to 63% of assessed rooms meeting the BRE Daylight Illuminance targets, demonstrating that these architectural elements make a substantial contribution to the reduced daylight levels. Whilst the access decks and balconies inevitably constrain daylight to some rooms, they perform important functions in providing circulation, private amenity space and critically dual-aspect accommodation, which are key components of the overall design strategy and residential quality of the development.
- 7.3.5 These results should be read in the context of the scheme's wider design objectives, including the delivery of affordable housing, family-sized social rented homes, and dual-aspect accommodation on a sustainable urban site. The scheme provides a significant quantum of much-needed affordable housing, including family-sized social rented homes, on a sustainable urban site within a strategic regeneration area. The design has been carefully developed to optimise housing delivery whilst also ensuring that the majority of dwellings benefit from private amenity space in the form of balconies and dual-aspect layouts.
- 7.3.6 The results of this analysis reflect the realities of delivering new affordable housing within a dense urban environment that has been shaped by the established and emerging built form of the wider Tottenham Hale masterplan area. On balance, the daylight performance should therefore be considered alongside the substantial public benefits of the scheme and the broader residential quality measures incorporated into the design.

## Sunlight

| No. of units assessed | No. of units that meet target |
|-----------------------|-------------------------------|
| 87                    | 43 (49%)                      |

*Table 6 - Summary sunlight results for within the C3 block*

- 7.3.7 In respect of direct sunlight, the BRE guidance recommends that at least one habitable room within each dwelling should receive a minimum of 1.5 hours of direct sunlight on 21<sup>st</sup> March. Whilst the guidance places particular emphasis on main living spaces, the assessment considers sunlight availability across all habitable rooms within each dwelling.
- 7.3.8 Our assessment within the C3 Affordable Block indicates that 43 of the 87 dwellings assessed (49%) contain at least one habitable room that achieves the BRE sunlight target. Again, the results should be considered in the context of the site's dense urban setting and the constraints associated with delivering a residential development as part of the wider Tottenham Hale regeneration area.
- 7.3.9 The majority of the south-facing windows are restricted by the presence of overhanging balconies and access decks, which limit the availability of direct sunlight. An additional assessment, undertaken with these elements removed from the model, demonstrates a notable improvement in compliance, with 75% of the proposed units within this block meeting the BRE sunlight targets. This confirms that these design features are a key factor influencing the sunlight performance within the proposed dwellings. Nevertheless, the balconies and access decks remain integral to the design, providing private amenity space, circulation and supporting the delivery of dual-aspect homes.
- 7.3.10 The BRE guidance acknowledges that its numerical sunlight targets should be applied flexibly, particularly within larger residential developments and constrained urban sites. It specifically notes that it may not be possible for every dwelling to contain a habitable room facing within 90 degrees of due south. Taking these factors into account, the overall level of sunlight provision is considered appropriate for a development of this scale and nature within a highly urbanised environment.

## **7.4 Ashley Park Consent (HGY/2019/0108)**

- 7.4.1 Where a site benefits from an extant but unimplemented planning permission, as is the case here, it is appropriate and reasonable to have regard to the daylight and sunlight performance of the consented scheme as a relevant benchmark. Such an approach provides an established planning baseline against which the performance of the new proposals can be assessed and assists in determining whether the new development would deliver a materially different level of residential amenity compared with that which has already been accepted by the Local Planning Authority.

- 7.4.2 The consented Ashley Park scheme was subject to a comprehensive daylight and sunlight assessment undertaken in accordance with BRE 2011 guidance. The southern building followed a very similar internal design strategy to the proposed C3 building incorporating both access decks and private balconies to deliver dual aspect units.
- 7.4.3 When assessed against the BRE Average Daylight Factor (ADF) targets, the assessment concluded that 102 of the 273 habitable rooms (37%) would achieve the relevant ADF criteria under the future baseline scenario considered appropriate for the development. For comparison purposes, the proposed C3 Affordable Block has been assessed using the same methodology as a secondary assessment and achieves an ADF compliance of 40%. This demonstrates a modest improvement over the extant consent and indicates that the new scheme would provide internal daylight conditions that are at least comparable to those previously accepted for the site.
- 7.4.4 Notwithstanding the relatively modest level of ADF compliance, the consented Ashley Park scheme of the same typology was accepted by the Council as providing an appropriate standard of residential amenity, having regard to the site's urban regeneration context, the evolving high-density character of Tottenham Hale and the recognised need for flexibility in applying BRE guidance within such locations.
- 7.4.5 In this context, the proposed development's marginally improved ADF performance provides further confidence that it would continue to deliver an acceptable standard of residential amenity and remains consistent with the level of daylight quality previously found acceptable in planning terms with a materially similar approach to the internal design and layouts.

## **7.5 Ashley Park Consent (HGY/2018/2353)**

- 7.5.1 The site also benefits from an extant, but unimplemented, planning permission covering the northern part of the current application site. However, the daylight and sunlight assessment associated with this consent was undertaken within a materially different testing environment and cumulative development scenario to that which applies today. As a result, the findings of the extant consent are not directly comparable with those of the current proposals and should not be relied upon as a benchmark for assessing the performance of the proposed development.

## 8 Cumulative Internal Analysis

- 8.1.1 In addition to the assessment of the proposed development in isolation, a future baseline scenario has been considered which assumes that committed developments within the surrounding area are constructed. These developments have the potential to alter the levels of amenity available within the proposed development and therefore may influence the internal daylight and sunlight performance of the proposed accommodation.
- 8.1.2 Accordingly, an assessment has been undertaken to consider the internal daylight and sunlight conditions within the Proposed Development under the future baseline scenario. The assessment assumes the construction of Berol Quarter (HGY/2023/0261), 29-33 The Hale (HGY/2021/2304), and Berol House (HGY\_2025\_0930) together with the Proposed Development, to determine the extent to which these committed developments may influence the daylight and sunlight levels achieved within the proposed accommodation.



**Image 3 - 3D image of the proposed scheme, surrounding and cumulative context**

## 8.2 Shared Living Block

### Daylight

| Room use & target                       | No. of rooms assessed | Rooms meeting target |
|-----------------------------------------|-----------------------|----------------------|
| Shared-living rooms<br>(150-lux target) | 522                   | 310 (59%)            |
| Shared-living rooms<br>(100-lux target) | 522                   | 389 (74%)            |
| Communal spaces<br>(150-lux target)     | 8                     | 6 (75%)              |

*Table 7 - Shared Living Block internal daylight summary in cumulative context*

### Sunlight

| Room use            | No. of rooms assessed | Rooms meeting target |
|---------------------|-----------------------|----------------------|
| Shared-Living Rooms | 522                   | 295 (57%)            |
| Communal spaces     | 8                     | 7 (88%)              |

*Table 8 - Shared Living Block internal sunlight summary in cumulative context*

- 8.2.1 The cumulative assessment within this block demonstrates that future developments surrounding the site would have only a limited influence on the daylight and sunlight levels achieved within the proposed shared-living accommodation. Although there is a modest reduction in the proportion of rooms meeting the BRE targets under the future baseline scenario, the overall performance of the proposed development remains broadly unchanged from the standalone assessment.
- 8.2.2 This indicates that the daylight and sunlight performance of the proposals is resilient to the effects of surrounding committed developments. The results are consistent with those typically associated with higher-density development within the Tottenham Hale regeneration area and continue to provide an appropriate standard of residential amenity.
- 8.2.3 Accordingly, the cumulative assessment confirms that the future developments considered will not materially alter the conclusions of the existing scenario assessment, and that the proposed shared-living block remains acceptable from an internal daylight and sunlight perspective.

### 8.3 C3 Affordable Block

#### Daylight

| Room type    | No. of rooms assessed | Rooms meeting target |
|--------------|-----------------------|----------------------|
| LKD          | 73                    | 24                   |
| Bedroom      | 196                   | 62                   |
| Kitchen      | 14                    | 1                    |
| Living Room  | 14                    | 0                    |
| <b>Total</b> | <b>293</b>            | <b>87 (30%)</b>      |

Table 9 - C3 Affordable Block internal daylight summary in cumulative context

#### Sunlight

| No. of units assessed | No. of units that meet the targets |
|-----------------------|------------------------------------|
| 87                    | 34 (44%)                           |

Table 10 - C3 Affordable Block internal sunlight summary in cumulative context

- 8.3.1 The cumulative assessment indicates future committed developments surrounding the site would have only a limited effect on the daylight and sunlight performance of the proposed affordable housing block. While compliance levels reduce slightly under the future baseline scenario, the overall pattern of results remains largely unchanged. This demonstrates that the daylight and sunlight performance of the proposed accommodation is driven principally by the site's urban context and design parameters, rather than the future developments coming forward.
- 8.3.2 The findings are consistent with the character of the Tottenham Hale regeneration area, where higher-density development and a degree of mutual enclosure between buildings are expected. The cumulative assessment therefore does not alter the conclusions of the existing scenario assessment and confirms that committed developments would not impose a material additional constraint on the acceptability of the proposed affordable housing block.

## 9 Sunlight to Proposed Amenity Areas

- 9.1.1 In addition to the amenity within the units, we have assessed the provision of sunlight to the proposed communal amenity areas using the BRE's 2-hour sun on-ground (sunlight amenity) assessment.
- 9.1.2 This involves dividing the areas that can receive at least two hours of sunlight on the ground (shaded in yellow on the drawings) from those that receive less than two hours (shaded in blue) on 21<sup>st</sup> March (the equinox). The BRE Guide recommends that at least 50% of an amenity area should receive a minimum of two hours of direct sunlight on this date. The full results of these assessments can be found within Appendix 8.
- 9.1.3 We have considered the following amenity spaces:
- 1) The courtyard for the shared living residents at the ground floor level
  - 2) The communal landscape between the two blocks
  - 3) The shared-living roof terrace at the 7<sup>th</sup> floor level

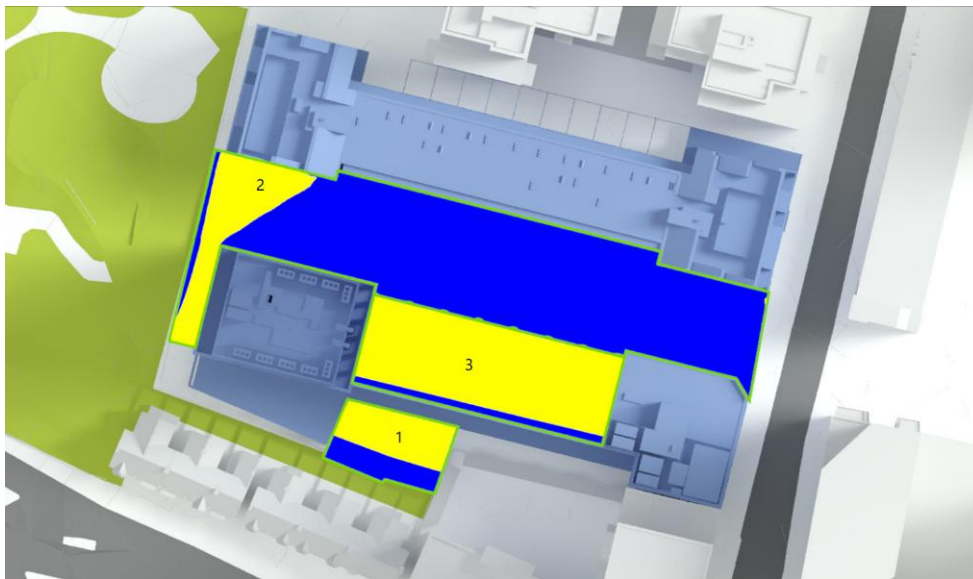


**Image 4 - Sunlight to the proposed amenity spaces on 21<sup>st</sup> March**

- 9.1.4 The results of the sunlight assessment indicate that the shared-living courtyard (No. 1) and the shared-living terrace (No. 3) will both be very well sunlit. The assessment demonstrates that 64% and 92% of the respective amenity areas receive at least two hours of direct sunlight on 21<sup>st</sup> March, comfortably exceeding the BRE target of 50%. This level of performance reflects the generally open aspect of these spaces and their favourable orientation within the proposed development, providing occupants with high-quality outdoor amenity areas that benefit from good access to direct sunlight throughout much of the day.
- 9.1.5 Whilst the amenity space located between the two blocks (No. 2) is inherently more

constrained due to the surrounding built form, the landscape strategy has been carefully developed to optimise the usability and environmental quality of the area.

- 9.1.6 As illustrated on the landscape plan below, the more sunlight-sensitive elements, including children's play areas and informal seating spaces, have been positioned towards the western side of the courtyard where sunlight availability is greatest. In contrast, the eastern side of the space, which is naturally more restricted by the relationship between the buildings, accommodates hard landscaping, circulation routes and parking spaces that are less dependent on direct sunlight. This considered arrangement ensures that the areas most likely to be used for recreation and outdoor amenity benefit from the highest levels of available sunlight.



**Image 5 - Ground floor level landscape proposal**

- 9.1.7 As part of the wider informative analysis an additional sunlight assessment has been undertaken for 21<sup>st</sup> June to demonstrate the performance of the proposed amenity spaces during the summer months when outdoor amenity areas are likely to experience their greatest levels of use.
- 9.1.8 The results indicate that all amenity areas will be very well sunlit at this time of year. Notably, the central communal space between the two blocks achieves two hours of direct sunlight across 98% of its area on 21<sup>st</sup> June, demonstrating that it will provide a highly usable and attractive outdoor environment during the period when occupants are most likely to make use of external amenity space.



**Image 6 - Sunlight to the proposed amenity spaces on 21<sup>st</sup> June**

- 9.1.9 A supplementary graded sunlight assessment has also been undertaken for 21<sup>st</sup> March to illustrate the distribution of sunlight across the central communal space. Whilst this area is inherently more constrained by the relationship between the surrounding buildings, the assessment demonstrates that sunlight is distributed across much of the space, with the highest levels occurring within the areas intended for recreation and informal use. This assessment confirms that the space will remain a pleasant and functional component of the wider amenity offering within the development.

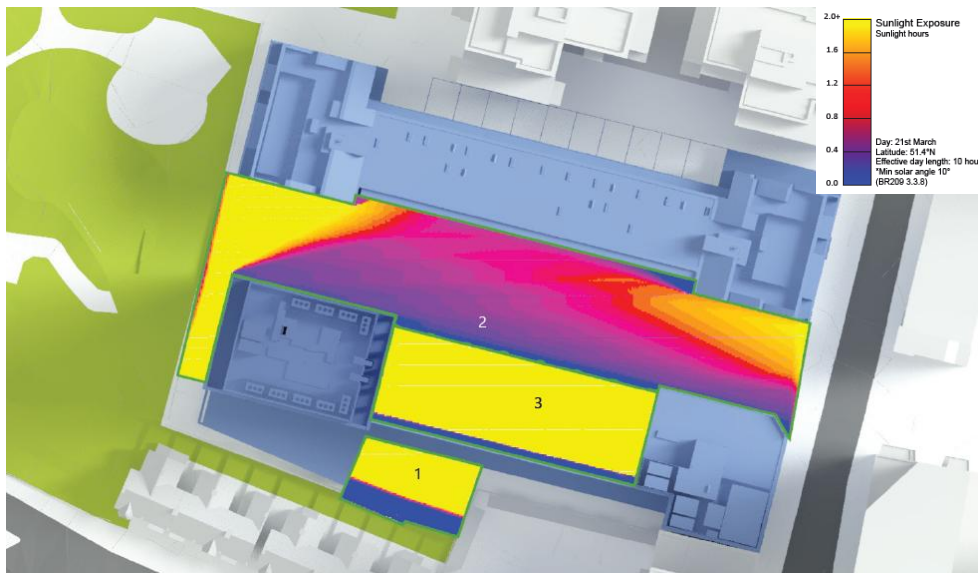


**Image 7 - Graded sunlight assessment to proposed amenity spaces**

- 9.1.10 When considered in the context of the extant consents, the proposed arrangement is consistent with the previously approved form of development. Whilst the amenity space between the two principal blocks remains subject to constraints arising from the surrounding built form, this reflects the characteristics of the consented scheme, where the central courtyard was similarly constrained in terms of sunlight access, as illustrated in the image below.



**Image 8 - Sunlight amenity to the consented proposals March 21<sup>st</sup>**

- 9.1.11 Overall, the proposed development has been carefully designed to optimise the quality and usability of its communal amenity spaces, providing a range of outdoor environments with varying characteristics and levels of sunlight exposure.
- 9.1.12 The assessment demonstrates that the principal amenity areas are well sunlit and comfortably exceed the BRE target, whilst the more constrained central communal space benefits from a landscape strategy that directs the most sunlight-sensitive uses towards the sunniest areas. The supplementary June assessment further confirms that all amenity spaces will perform very well during the summer months when they are most likely to be used. Taken as a whole, the proposed amenity provision is considered to provide a high-quality outdoor environment and a standard of sunlight amenity that is consistent with the previously approved development.

## 10 Local Precedents

10.1.1 In assessing the results of the internal daylight & sunlight analysis, it is important to consider the performance of the proposals within the context of comparable consented schemes in the local area. A review has been undertaken of developments of a similar typology approved within the London Borough of Haringey, including schemes within the Tottenham Hale regeneration area, where internal daylight and sunlight compliance levels were accepted by the local planning authority.

10.1.2 These schemes demonstrate that, within dense urban environments, BRE target compliance must be considered alongside wider site constraints, the established and emerging urban form, and the significant public benefits associated with optimising housing delivery on sustainable brownfield sites. This is particularly relevant within Tottenham Hale, where the established and emerging townscape is characterised by higher-density development consistent with the area's regeneration objectives. Key examples include:

- Ashley House South, Tottenham Hale (HGY/2019/0108), where 37% of habitable rooms achieved the BRE ADF targets. The scheme was nevertheless accepted as providing an appropriate standard of residential accommodation having regard to the site's constrained urban context and the cumulative effects of surrounding regeneration proposals.
- Tottenham Hale Centre SDP Sites (HGY/2018/2223), where 57% of habitable rooms within the Ferry Island Building achieved the BRE ADF targets. The assessment recognised that many non-compliant rooms remained adequately lit and that the overall daylight performance was acceptable within the context of a major high-density regeneration scheme. Planning permission was subsequently granted.
- Brunel Walk (HGY/2022/2723), where 51% of assessed rooms achieved the relevant daylight targets. The planning officer concluded that the level of compliance was not unusual in an urban setting and that the development would provide an acceptable standard of accommodation for future residents.

10.1.3 These precedents demonstrate a consistent approach within Haringey whereby internal daylight and sunlight performance is considered as one aspect of overall residential quality, rather than a standalone pass-or-fail exercise. Lower levels of compliance have been accepted where schemes respond appropriately to their urban context and deliver wider planning benefits.

10.1.4 As part of the Tottenham Hale regeneration area, the proposed development reflects the higher-density pattern of development established through successive permissions. The daylight and sunlight results should therefore be considered within the context of this evolving urban form. Full details of the precedent review are provided in Appendix 9.

# 11 Conclusions

11.1.1 This practice has undertaken a detailed assessment of the daylight and sunlight amenity provided within the proposed development at Ashley Road in accordance with the recommendations of set out within the BRE document BR209 '*Site layout planning for daylight and sunlight: A guide to good practice*' (BRE, 2022) and the British Standard BS EN17037:2018 'Daylight in buildings'.

## 11.2 Daylight within the proposed accommodation

11.2.1 The assessment of daylight has principally been undertaken using the Daylight Illuminance methodology set out in the BRE 2022 guidance, with supplementary ADF-based comparison provided where relevant to the extant consent. The results demonstrate that the proposed shared-living block will achieve a strong level of daylight performance, with 82% of the shared-living rooms meeting the 100-lux target and 69% meeting the more onerous 150-lux target. The majority of rooms that fall below these targets achieve daylight levels that are only modestly below the recommended benchmarks and will continue to benefit from good levels of natural illumination.

11.2.2 Within the C3 Affordable Block, 37% of habitable rooms achieve the BRE Daylight Illuminance targets. Whilst this represents a lower level of compliance, the results are significantly influenced by the constrained urban context of the site, the proximity of surrounding development, and the inclusion of design features such as access decks and balconies. These elements perform important residential, architectural and placemaking functions and contribute to the delivery of dual-aspect homes, private amenity space and a substantial provision of affordable housing.

11.2.3 It should be noted that the extant Ashley Park consent (HGY/2019/0108) was assessed under the BRE 2011 ADF methodology and therefore is not directly comparable with the BRE 2022 targets applied in this assessment. Nevertheless, on a comparable ADF basis, the C3 Affordable Block would achieve 40% compliance, compared to 37% for the extant consent. This indicates a broadly similar level of internal daylight performance to that previously accepted for the site.

11.2.4 The assessment demonstrates that the daylight performance of the proposals must be considered in the context of the wider Tottenham Hale regeneration area, where higher-density development and associated urban constraints are characteristic of the emerging townscape. The identified local precedents further demonstrate that similar levels of internal daylight compliance have previously been accepted for residential developments within comparable urban environments.

## 11.3 Sunlight within the proposed accommodation

11.3.1 The assessment of sunlight has been undertaken using the Sunlight Exposure

methodology set out within BS EN 17037 and referenced by the BRE guidance. The results indicate that 57% of the proposed shared-living rooms and 88% of the shared communal spaces achieve the recommended sunlight target. This level of compliance is considered appropriate for a development of this scale and nature within a dense urban setting.

- 11.3.2 Within the C3 Affordable Block, 43 of the 87 dwellings assessed (49%) contain at least one habitable room that receives the recommended 1.5 hours of direct sunlight on 21 March. Sunlight availability is inherently dependent upon orientation and the majority of dwellings falling below the target are affected by physical constraints associated with their orientation, surrounding built form and the design requirements of the scheme.

#### **11.4 Sunlight within the proposed amenity areas**

- 11.4.1 The assessment of sunlight within the proposed communal amenity areas demonstrates that the development will provide a high standard of sunlight amenity for future occupants. The shared-living courtyard and roof terrace comfortably exceed the BRE target, benefiting from good levels of direct sunlight and providing attractive, well-sunlit outdoor spaces.
- 11.4.2 Whilst the central communal space between the two blocks is inherently more constrained by the surrounding built form on 21<sup>st</sup> March, the additional assessment undertaken for 21<sup>st</sup> June demonstrates that it performs very well during the summer months when outdoor amenity spaces are likely to experience their greatest levels of use. The assessment shows that 98% of the space receives at least two hours of direct sunlight on this date, confirming that it will provide a highly usable and attractive communal environment.
- 11.4.3 Overall, the proposed amenity provision is considered to deliver a high-quality range of outdoor spaces that respond positively to the site's urban context and provide an appropriate standard of sunlight amenity for future occupants.

#### **11.5 Conclusion**

- 11.5.1 Overall, the proposed development represents a carefully balanced response to the opportunities and constraints of the site. The scheme has evolved through an extensive iterative design process, with daylight and sunlight testing informing key design decisions relating to the height, massing and arrangement of buildings across the site. This assessment confirms that, notwithstanding the challenges associated with delivering a high-density mixed-use development within an established urban context, the scheme will provide good levels of daylight and sunlight across substantial parts of the development.
- 11.5.2 Where deviations from the BRE targets occur, these are primarily attributable to the site's constrained urban context and the design measures necessary to secure wider residential, placemaking and regeneration benefits. In particular, elements such as


access decks and the efficient arrangement of accommodation support the delivery of new homes, including affordable and family-sized housing, whilst ensuring the effective use of a sustainable brownfield site. These measures also support the overall deliverability and fundability of the development, which are important considerations in securing the scheme's wider public benefits.

- 11.5.3 The assessment findings should also be viewed in the context of the extant Ashley Park consent and other comparable schemes approved within Tottenham Hale and the wider London Borough of Haringey, where similar levels of internal daylight and sunlight performance have been accepted having regard to the urban context, regeneration objectives and wider planning benefits of development.
- 11.5.4 When considered alongside the site's urban context, the extensive design evolution undertaken, the conclusions of the cumulative assessment, the extant Ashley Park consent, relevant local precedents, and the overall planning and public benefits of the proposal, the resulting standard of internal daylight and sunlight is considered appropriate and should not preclude the grant of planning permission.



# Appendix 1

Drawings of the existing, proposed and surrounding buildings

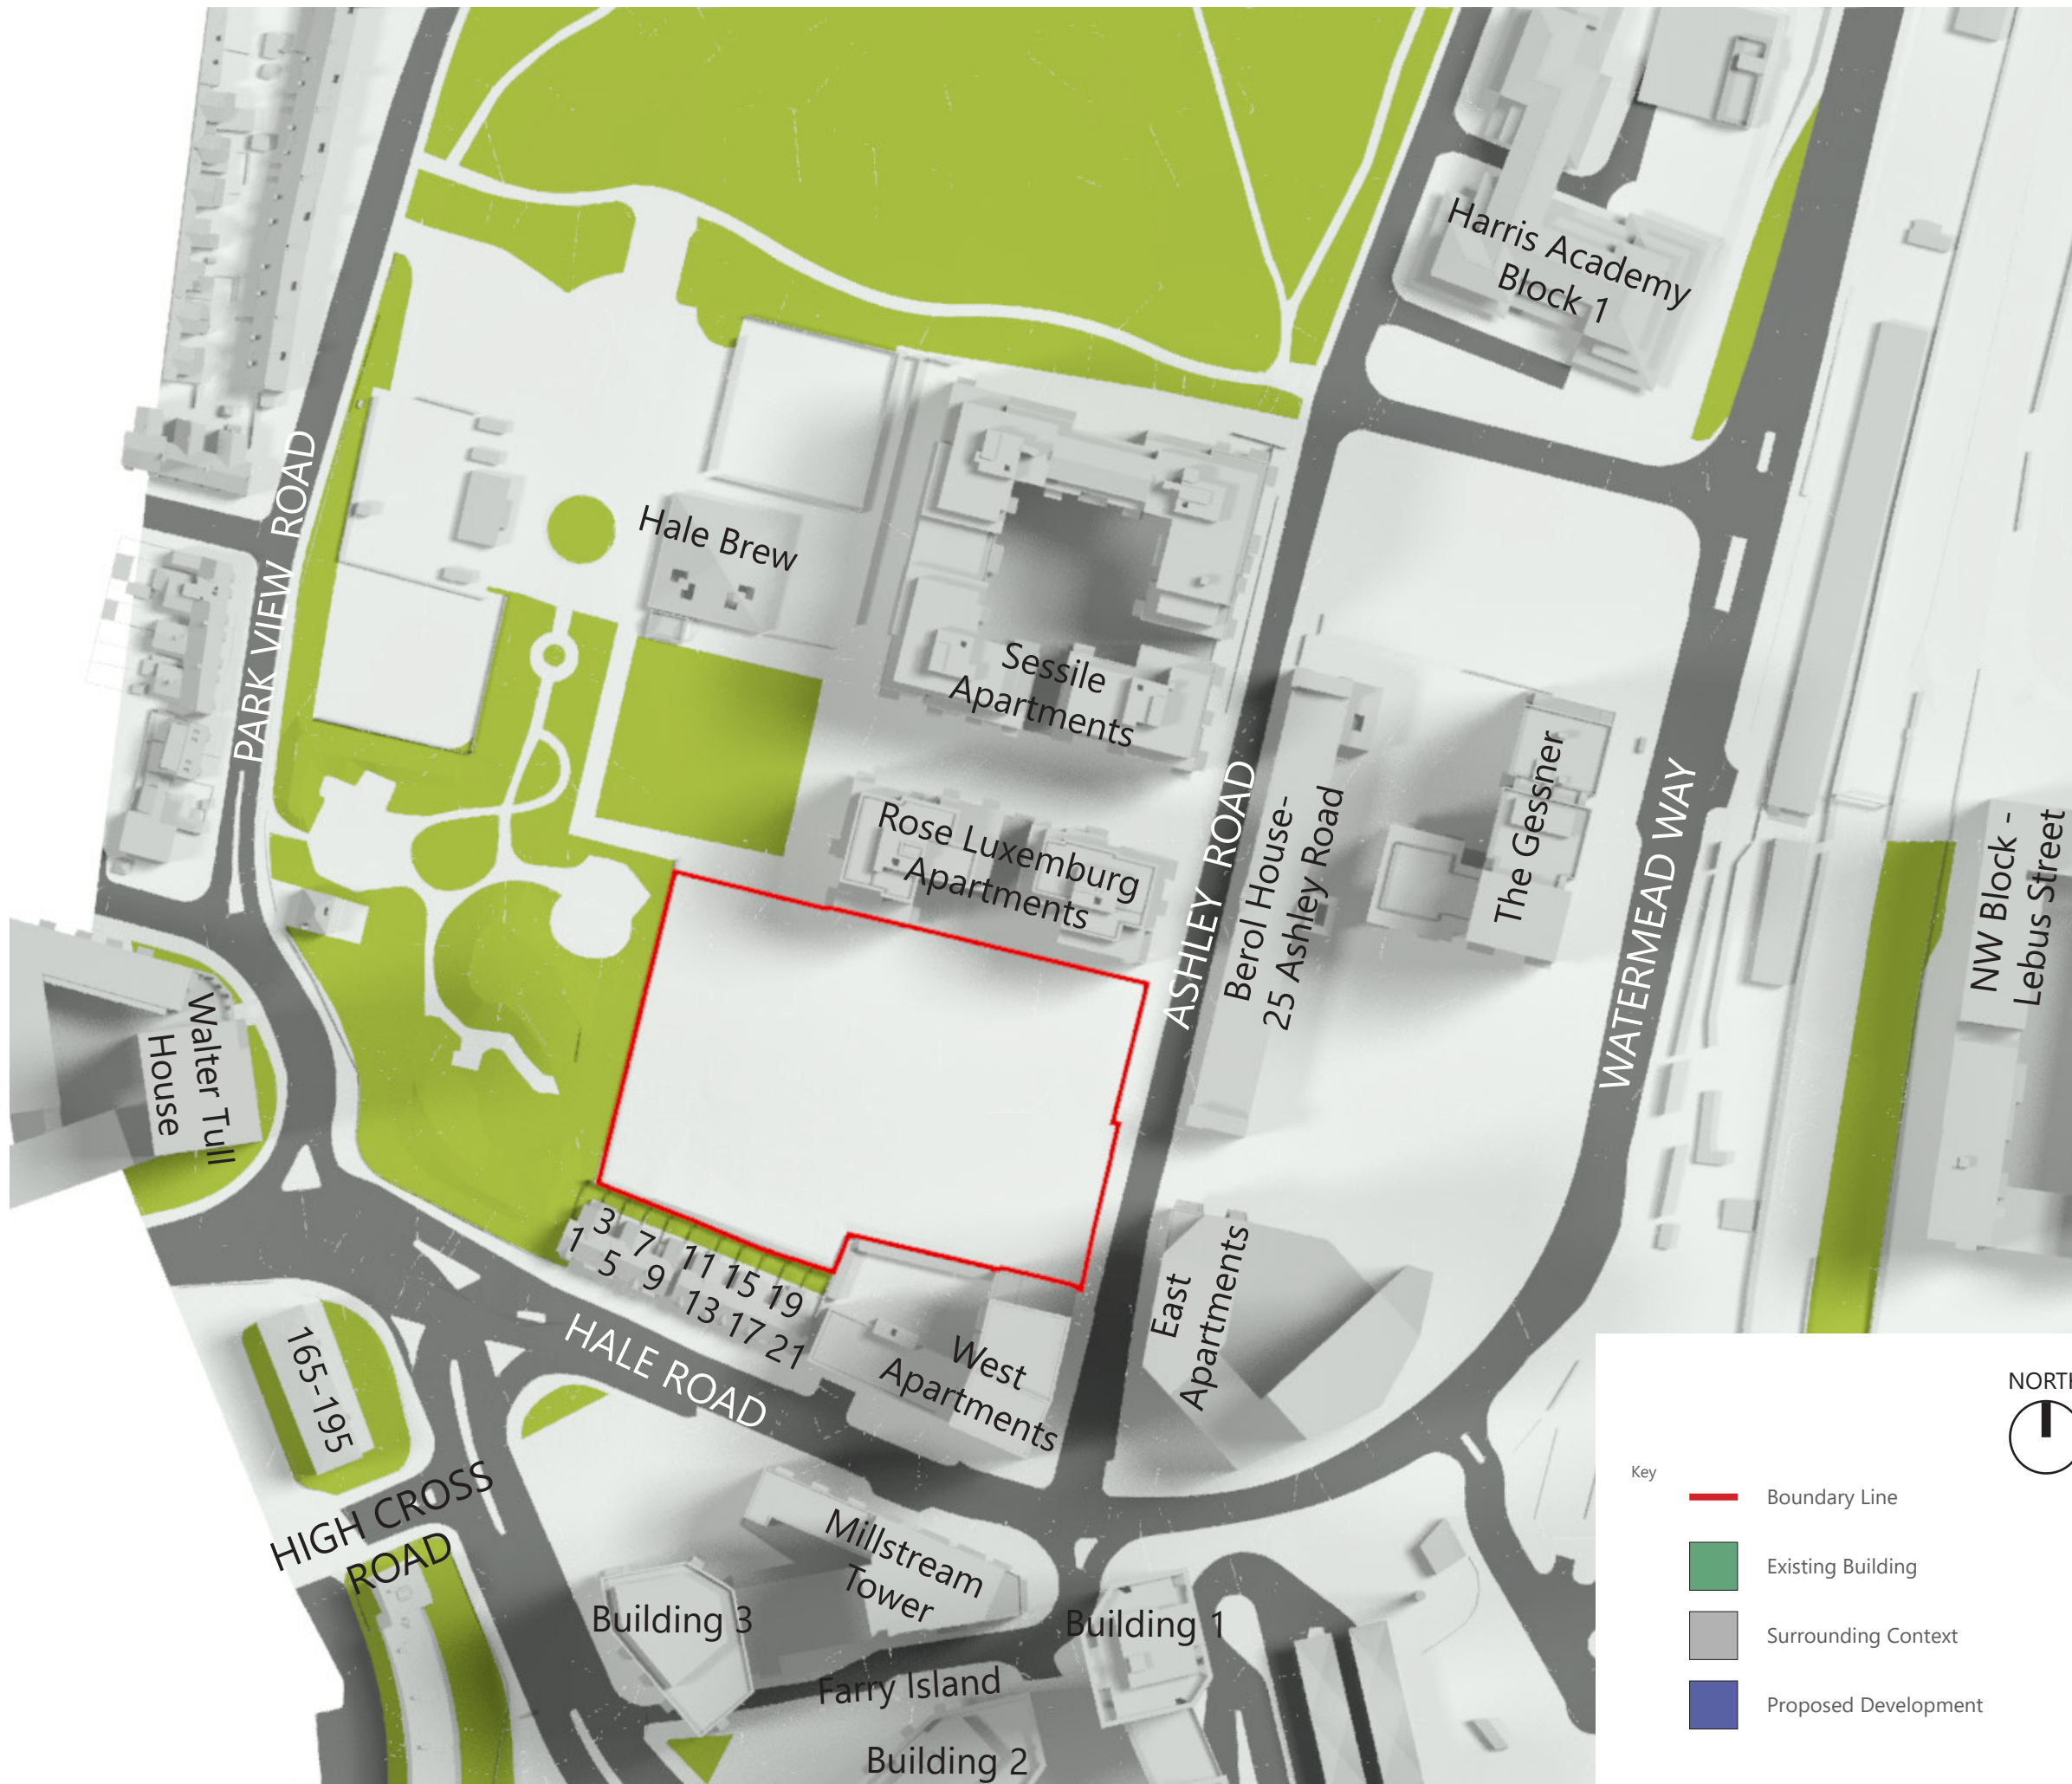

Sources of information

**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey



|     |                      |
|-----|----------------------|
| Key |                      |
|     | Existing Building    |
|     | Surrounding Context  |
|     | Proposed Development |

Project Ashley Road  
Tottenham Hale

Title Existing Condition  
Plan View

|       |    |         |    |
|-------|----|---------|----|
| Drawn | TR | Checked | -- |
|-------|----|---------|----|

|      |            |         |       |
|------|------------|---------|-------|
| Date | 08/08/2026 | Project | 10106 |
|------|------------|---------|-------|

|         |        |          |
|---------|--------|----------|
| Rel no. | Prefix | Page no. |
| 08      | DS01   | 01       |

|     |                      |
|-----|----------------------|
| Key |                      |
|     | Boundary Line        |
|     | Existing Building    |
|     | Surrounding Context  |
|     | Proposed Development |

NORTH



Sources of information

**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026


**EB7 Ltd**  
Site Photographs  
Ordnance Survey

|                                                                                       |                      |
|---------------------------------------------------------------------------------------|----------------------|
| Key                                                                                   |                      |
|  | Existing Building    |
|  | Surrounding Context  |
|  | Proposed Development |

Project Ashley Road  
Tottenham Hale

Title Existing Condition  
3D View

|         |            |          |       |
|---------|------------|----------|-------|
| Drawn   | TR         | Checked  | --    |
| Date    | 08/08/2026 | Project  | 10106 |
| Rel no. | 08         | Prefix   | DS01  |
|         |            | Page no. | 02    |

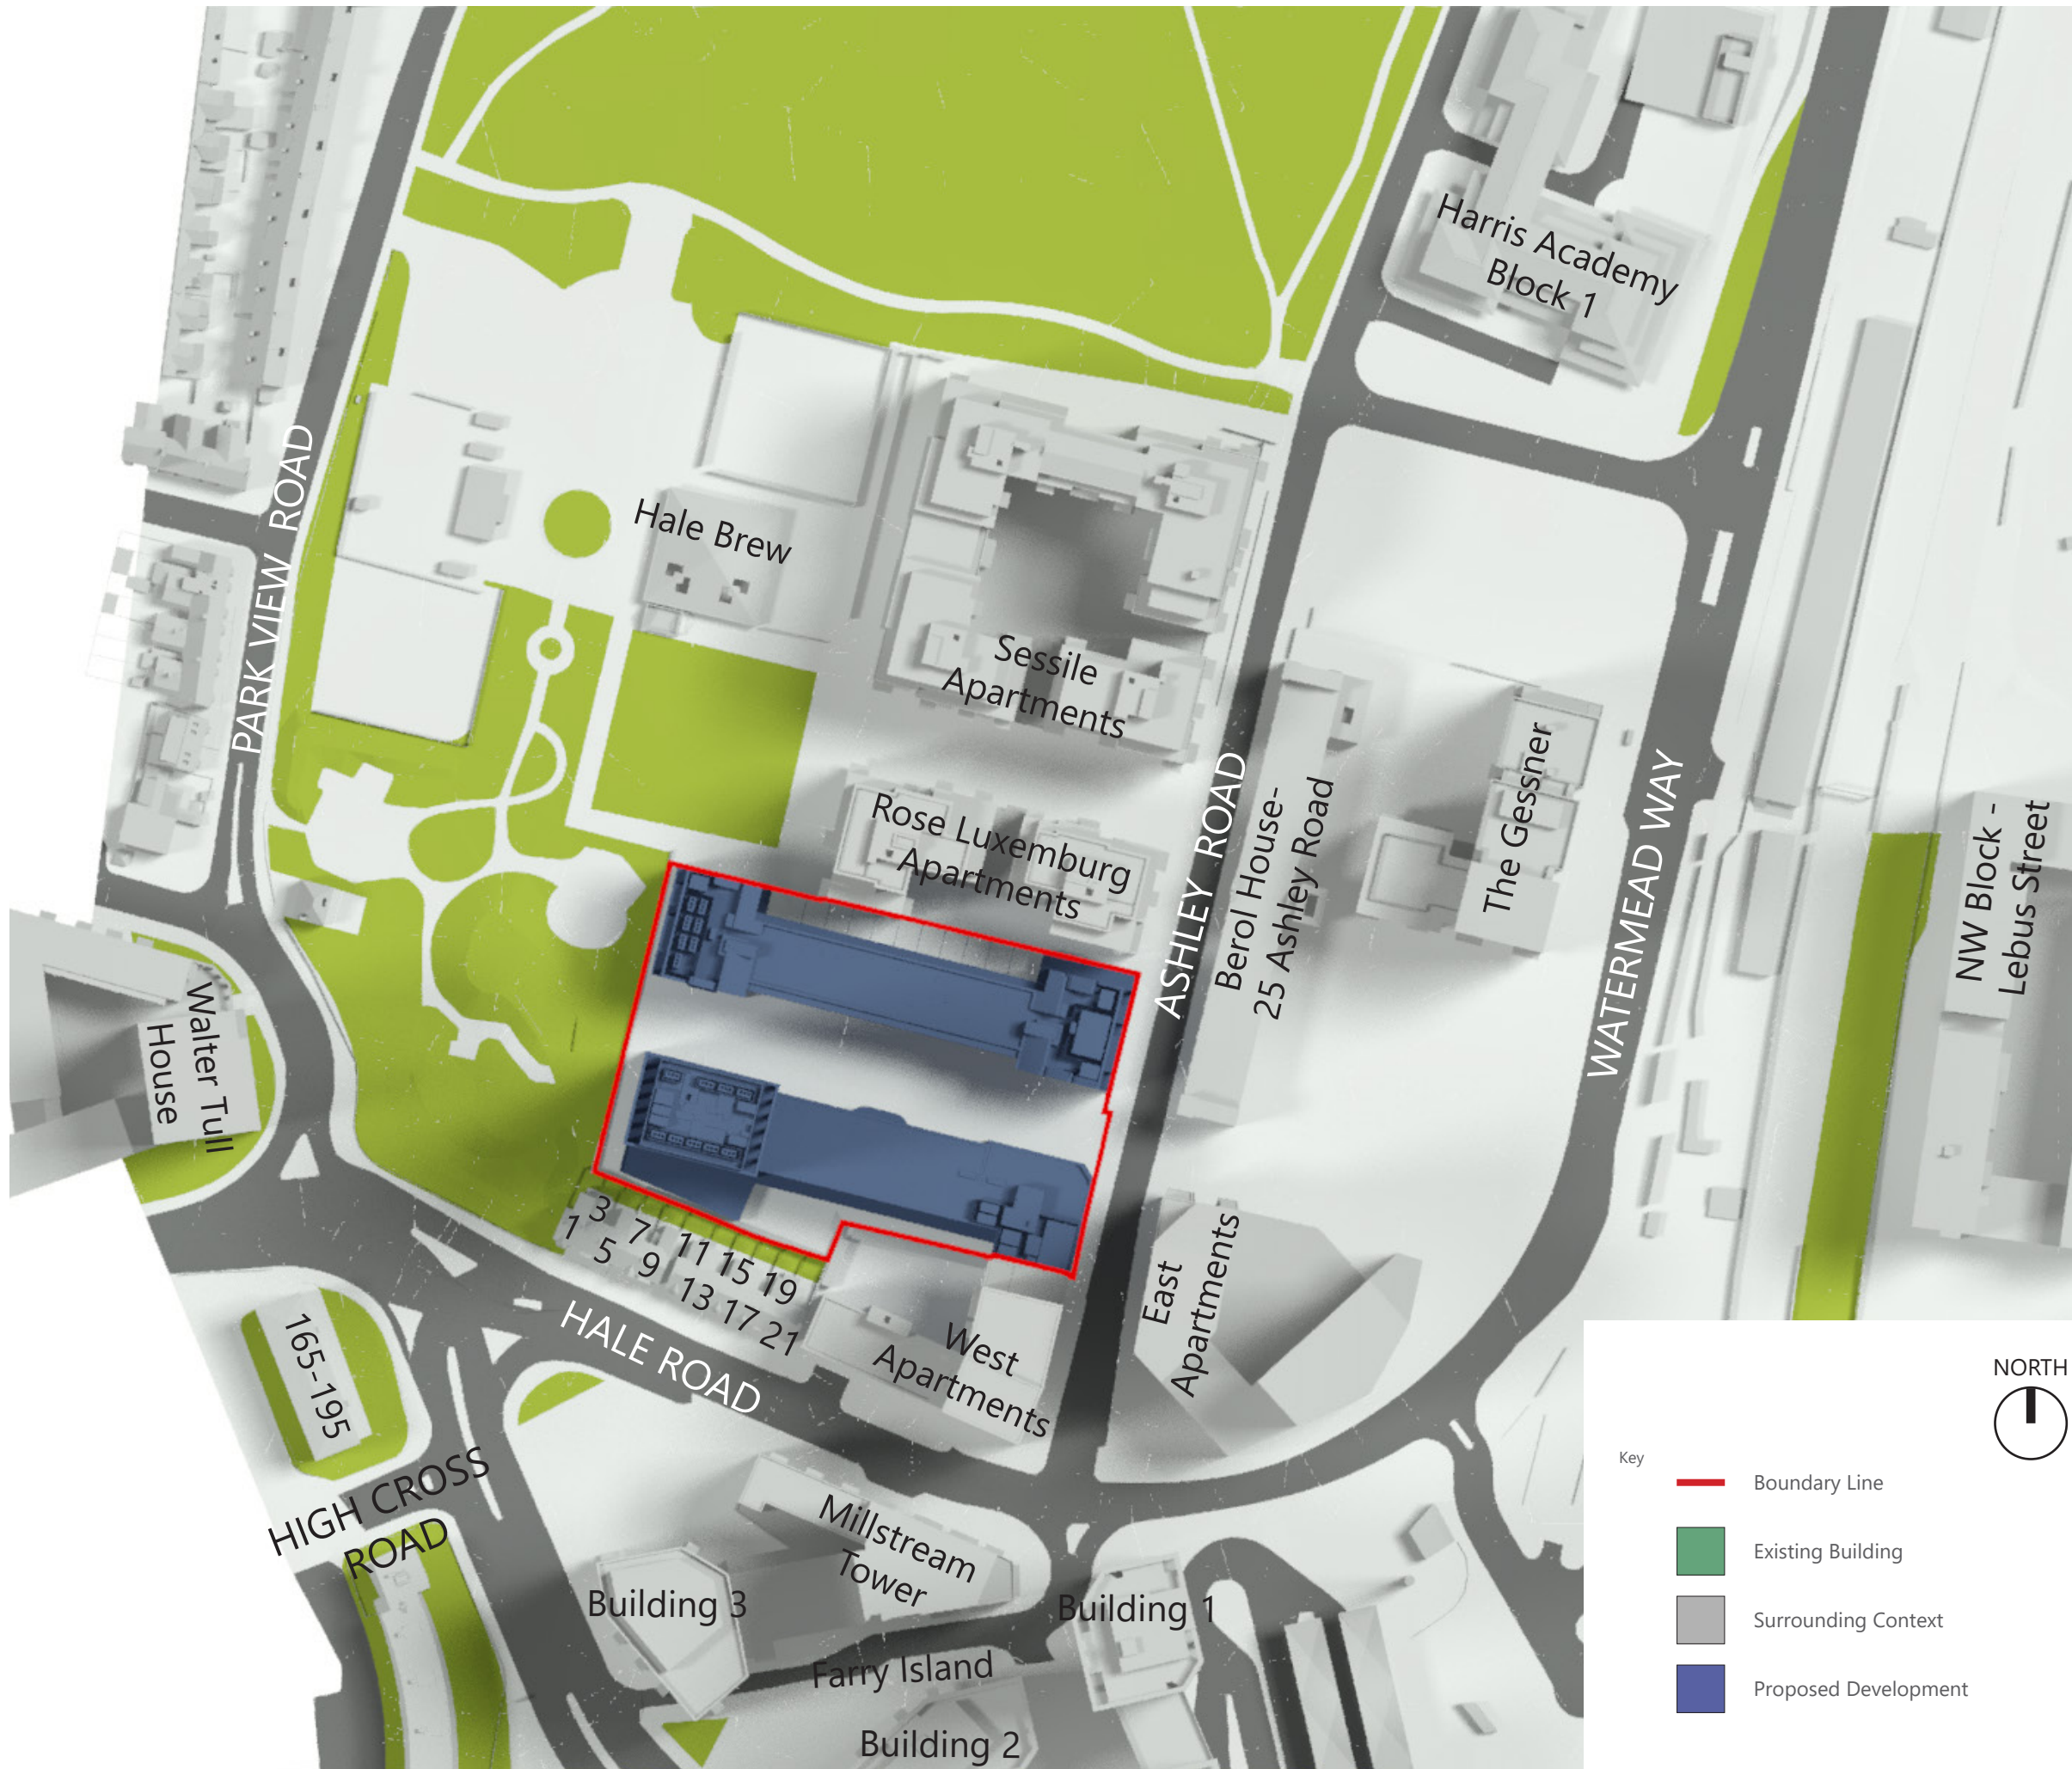

- Key
- Boundary Line
  - Existing Building
  - Surrounding Context
  - Proposed Development



Sources of information

**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

- Key
- Existing Building
  - Surrounding Context
  - Proposed Development


Project Ashley Road  
Tottenham Hale

Title Proposed Development  
Plan View

Drawn TR Checked --

Date 08/08/2026 Project 10106

Rel no. 08 Prefix DS01 Page no. 03

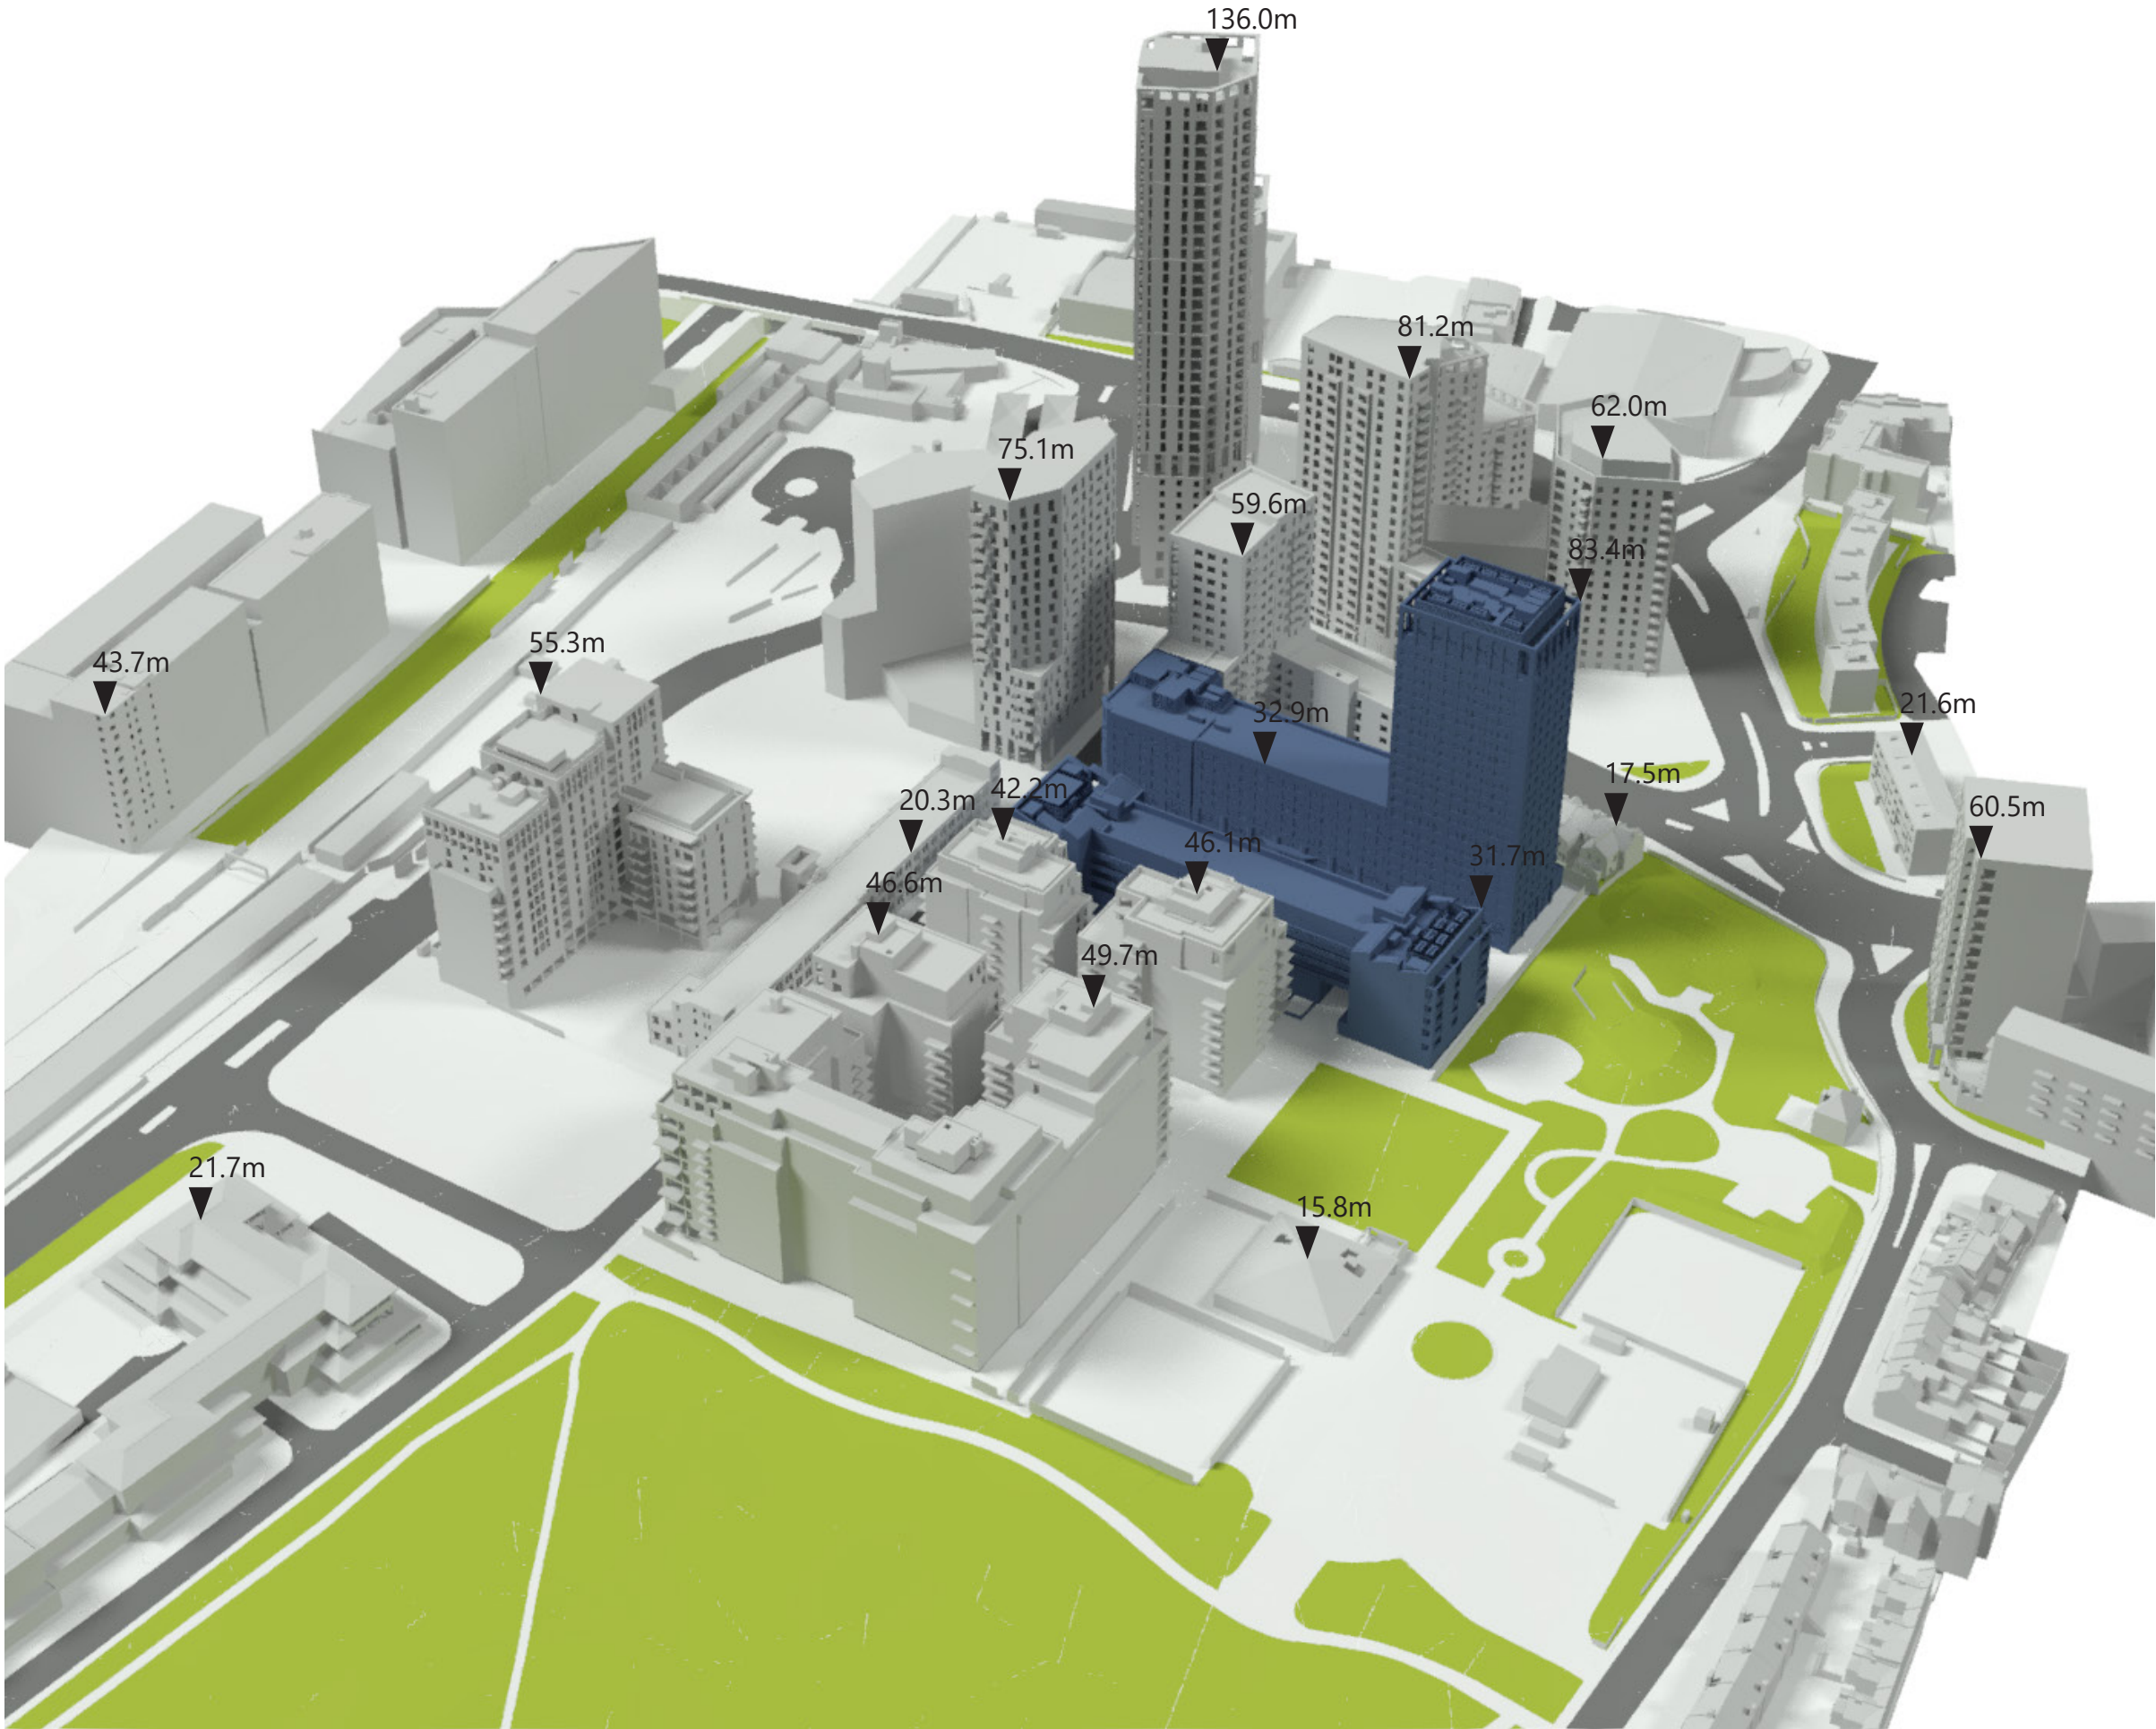

Sources of information

**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

|                                                                                       |                      |
|---------------------------------------------------------------------------------------|----------------------|
| Key                                                                                   |                      |
|  | Existing Building    |
|  | Surrounding Context  |
|  | Proposed Development |


Project Ashley Road  
Tottenham Hale

Title Proposed Development  
3D View

Drawn TR Checked --

Date 08/08/2026 Project 10106

Rel no. 08 Prefix DS01 Page no. 04

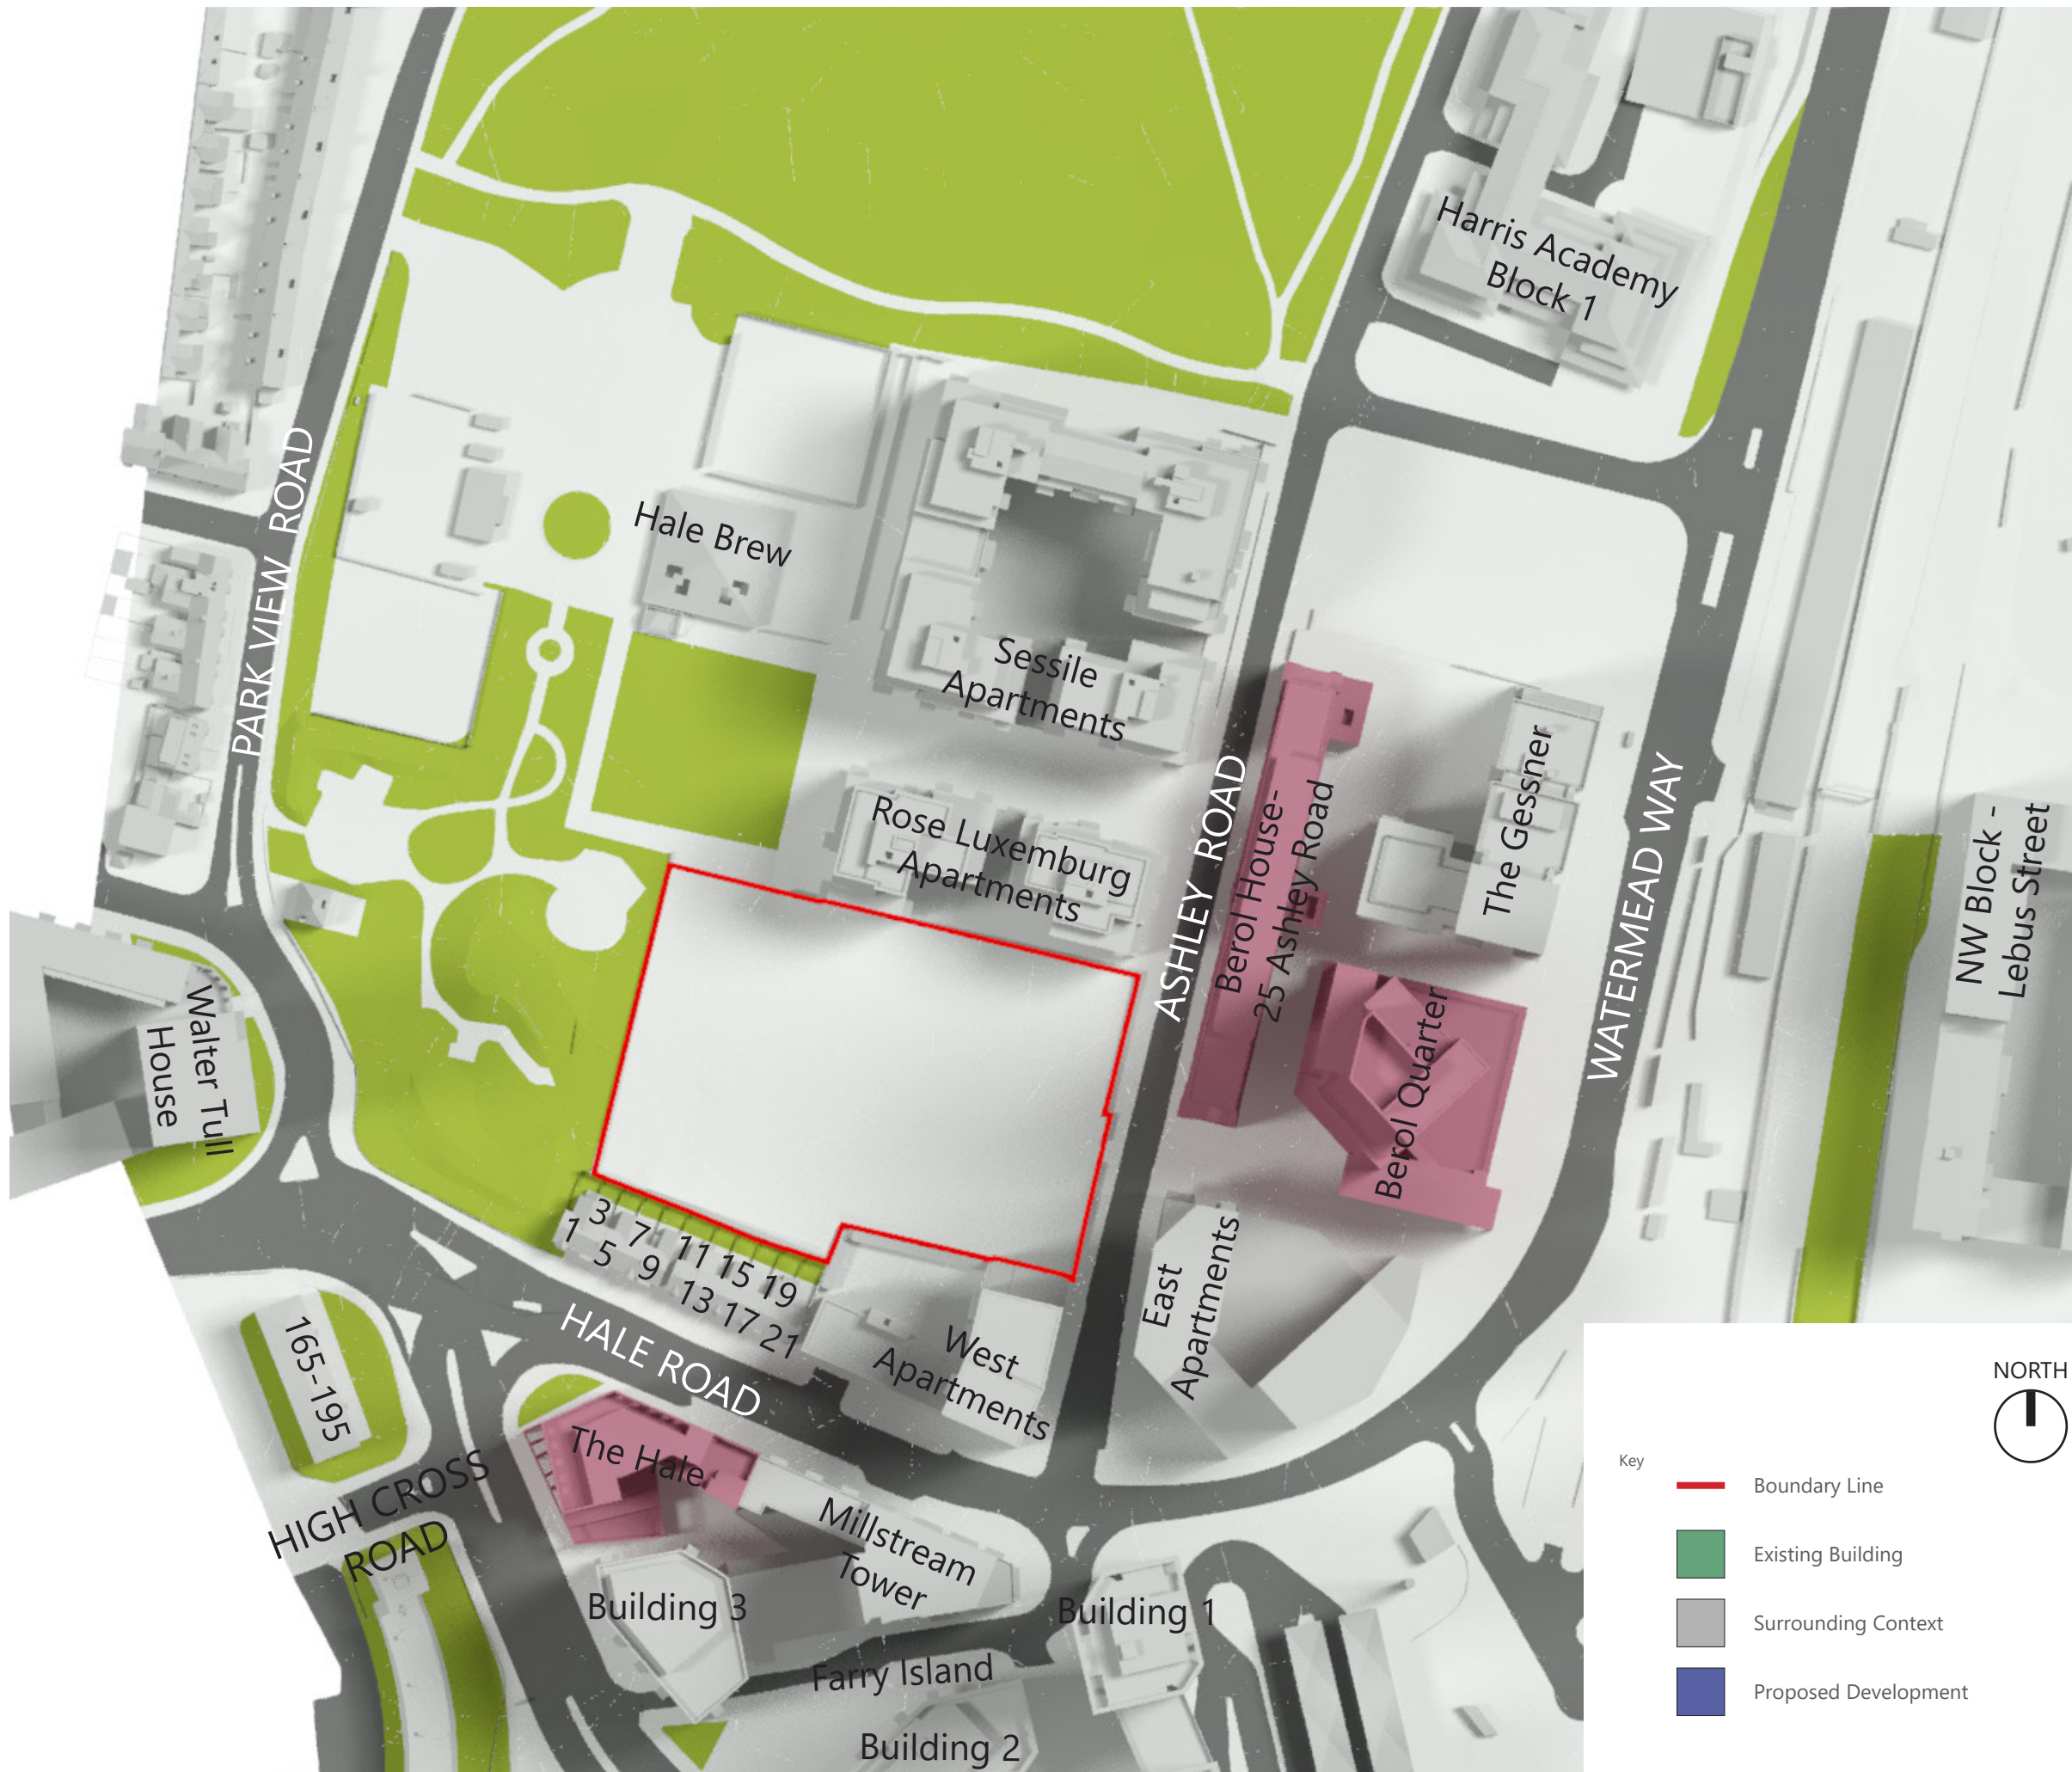

2nd Floor, Chancery  
Exchange, 10 Furnival  
Street, EC4A 1AB  
T: +44(0)20 7148 6290  
E: info@eb7.co.uk  
W: eb7.co.uk



#### Sources of information

**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey



|     |                        |
|-----|------------------------|
| Key |                        |
|     | Cumulative Development |
|     | Existing Building      |
|     | Surrounding Context    |
|     | Proposed Development   |

Project Ashley Road  
Tottenham Hale

Title Existing Condition  
Plan View

|       |    |         |    |
|-------|----|---------|----|
| Drawn | TR | Checked | -- |
|-------|----|---------|----|

|      |            |         |       |
|------|------------|---------|-------|
| Date | 08/08/2026 | Project | 10106 |
|------|------------|---------|-------|

|         |        |          |
|---------|--------|----------|
| Rel no. | Prefix | Page no. |
| 08      | DS02   | 01       |



Sources of information

**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

|             |                        |
|-------------|------------------------|
| Key         |                        |
| <div></div> | Cumulative Development |
| <div></div> | Existing Building      |
| <div></div> | Surrounding Context    |
| <div></div> | Proposed Development   |


Project Ashley Road  
Tottenham Hale

Title Existing Condition  
3D View

|       |    |         |    |
|-------|----|---------|----|
| Drawn | TR | Checked | -- |
|-------|----|---------|----|

|      |            |         |       |
|------|------------|---------|-------|
| Date | 08/08/2026 | Project | 10106 |
|------|------------|---------|-------|

|         |        |          |
|---------|--------|----------|
| Rel no. | Prefix | Page no. |
| 08      | DS02   | 02       |

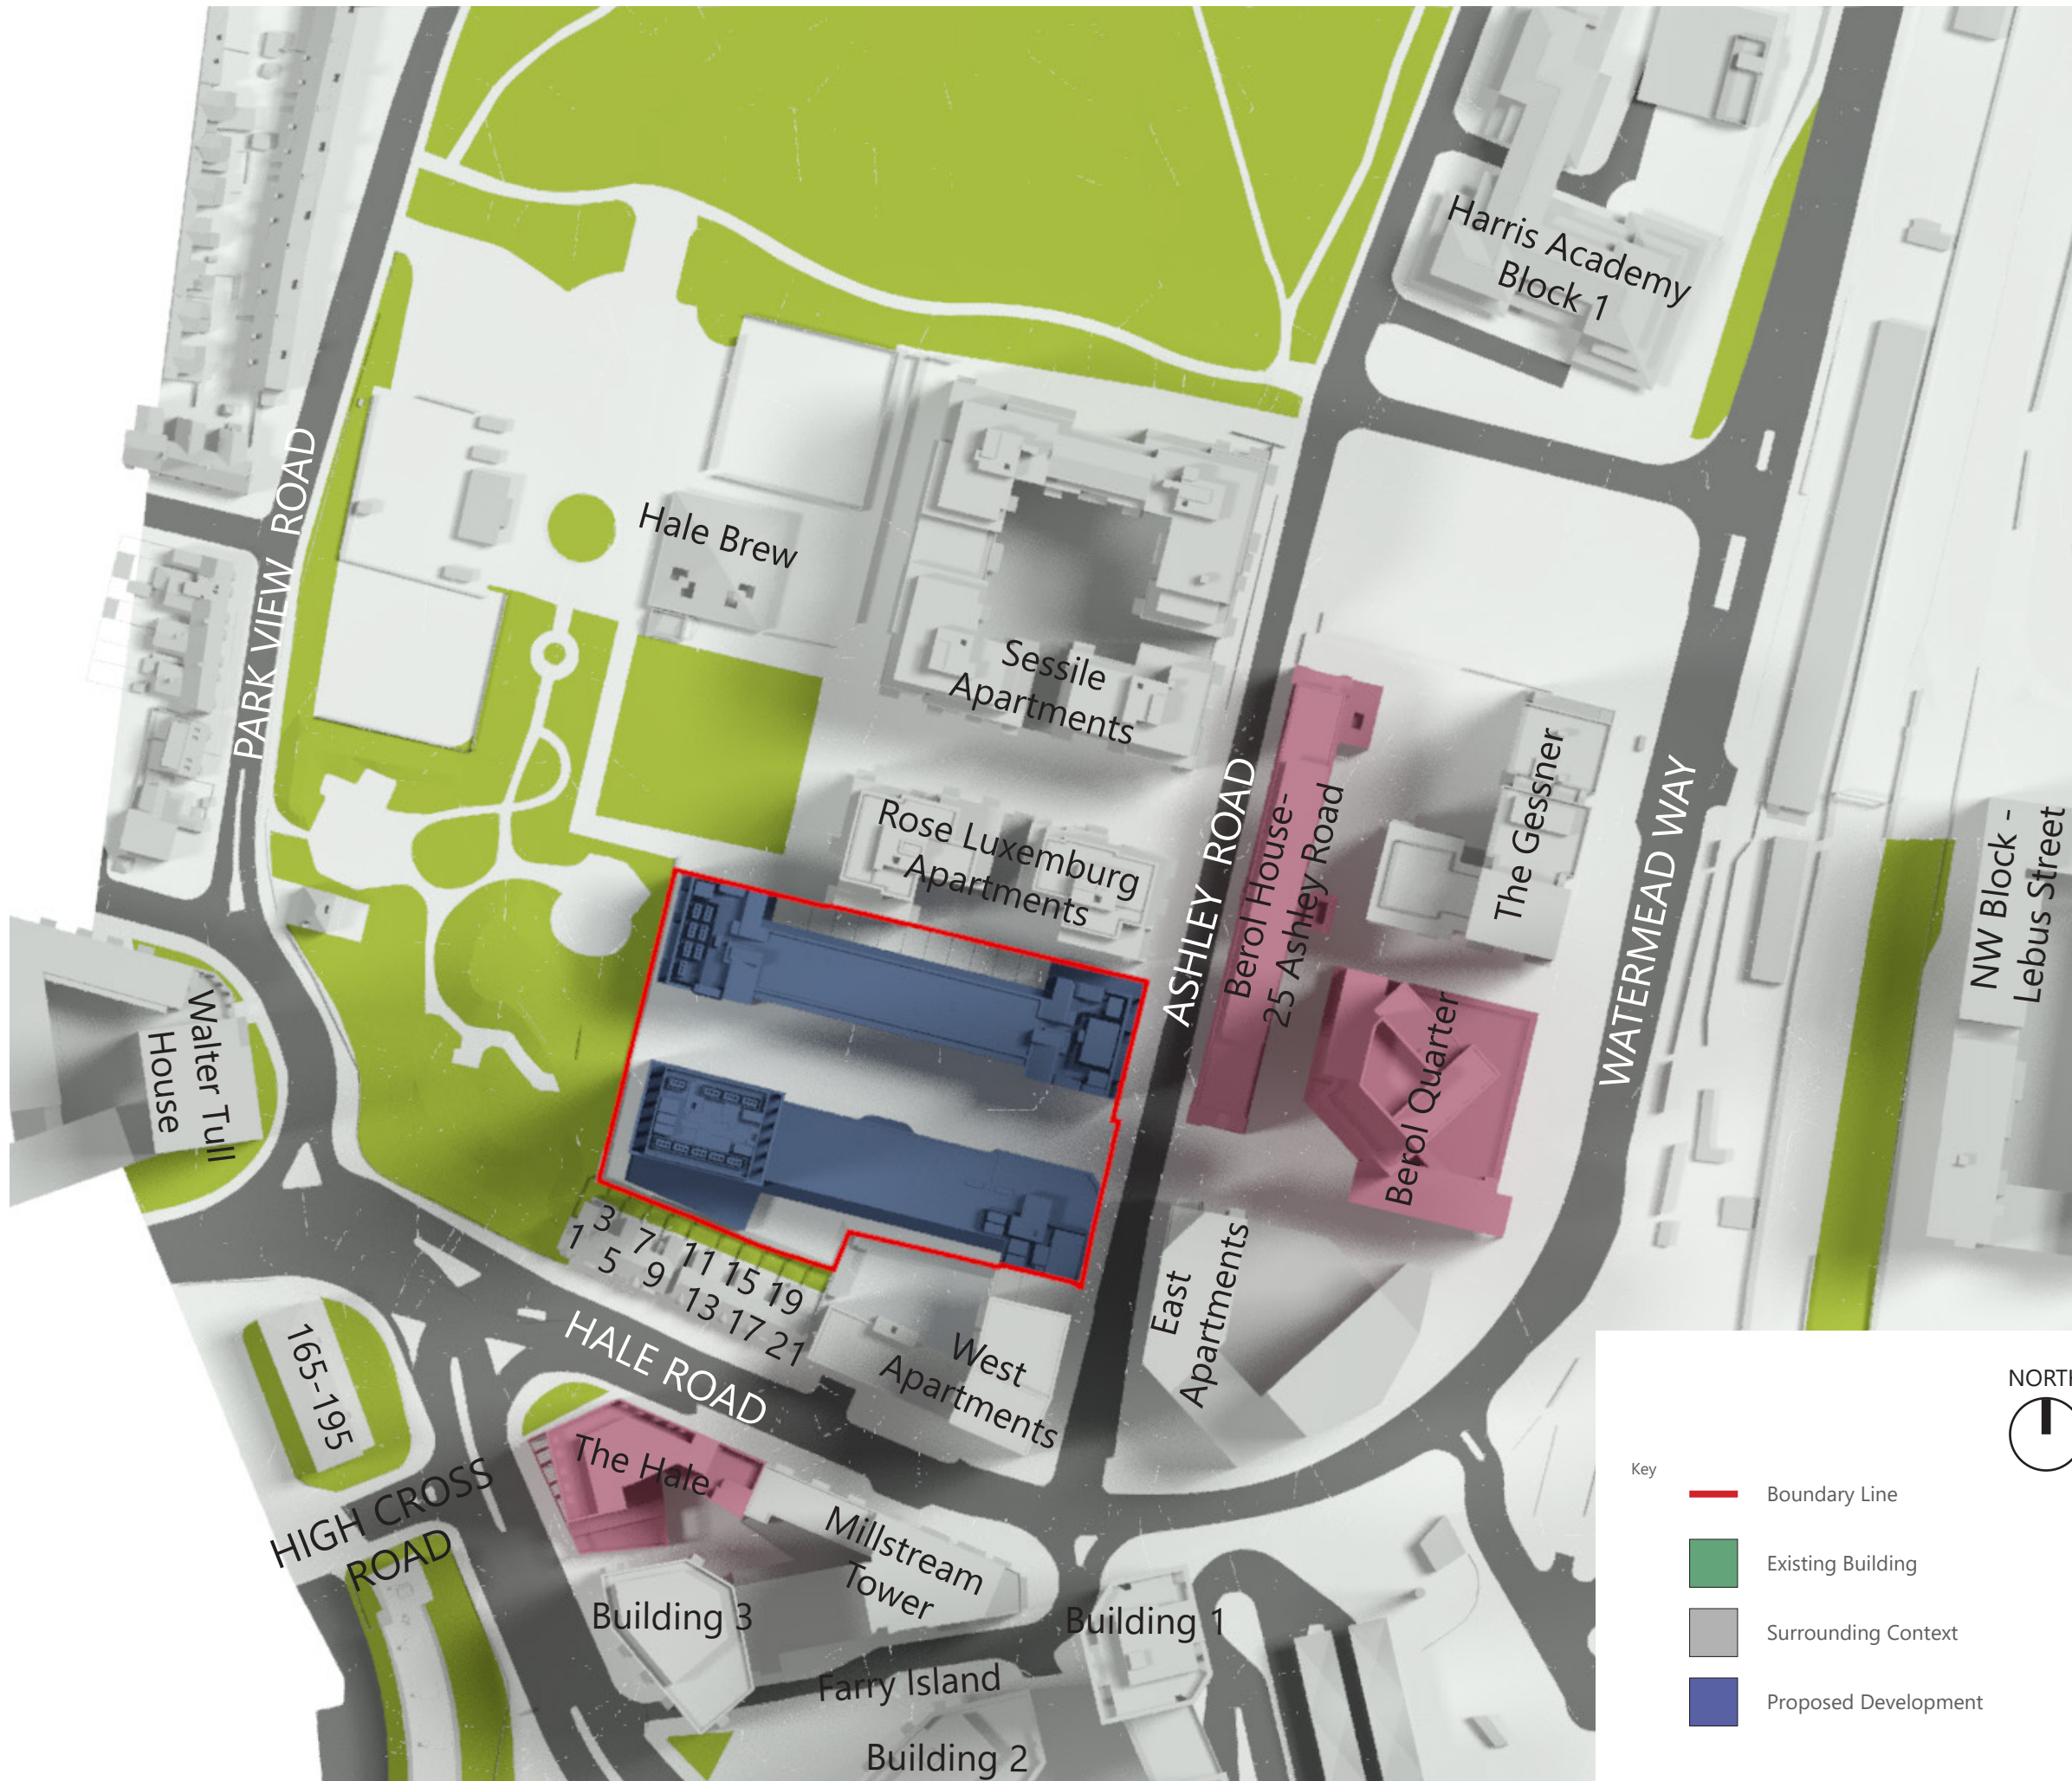

- Key
- Boundary Line
  - Existing Building
  - Surrounding Context
  - Proposed Development



2nd Floor, Chancery  
Exchange, 10 Furnival  
Street, EC4A 1AB  
T: +44(0)20 7148 6290  
E: info@eb7.co.uk  
W: eb7.co.uk



#### Sources of information

##### Cloud 10

Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

##### DLA

03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

##### EB7 Ltd

Site Photographs  
Ordnance Survey



- Key
- Cumulative Development
  - Existing Building
  - Surrounding Context
  - Proposed Development


Project Ashley Road  
Tottenham Hale

Title Proposed Development  
Plan View

Drawn TR Checked --

Date 08/08/2026 Project 10106

Rel no. 08 Prefix DS02 Page no. 03

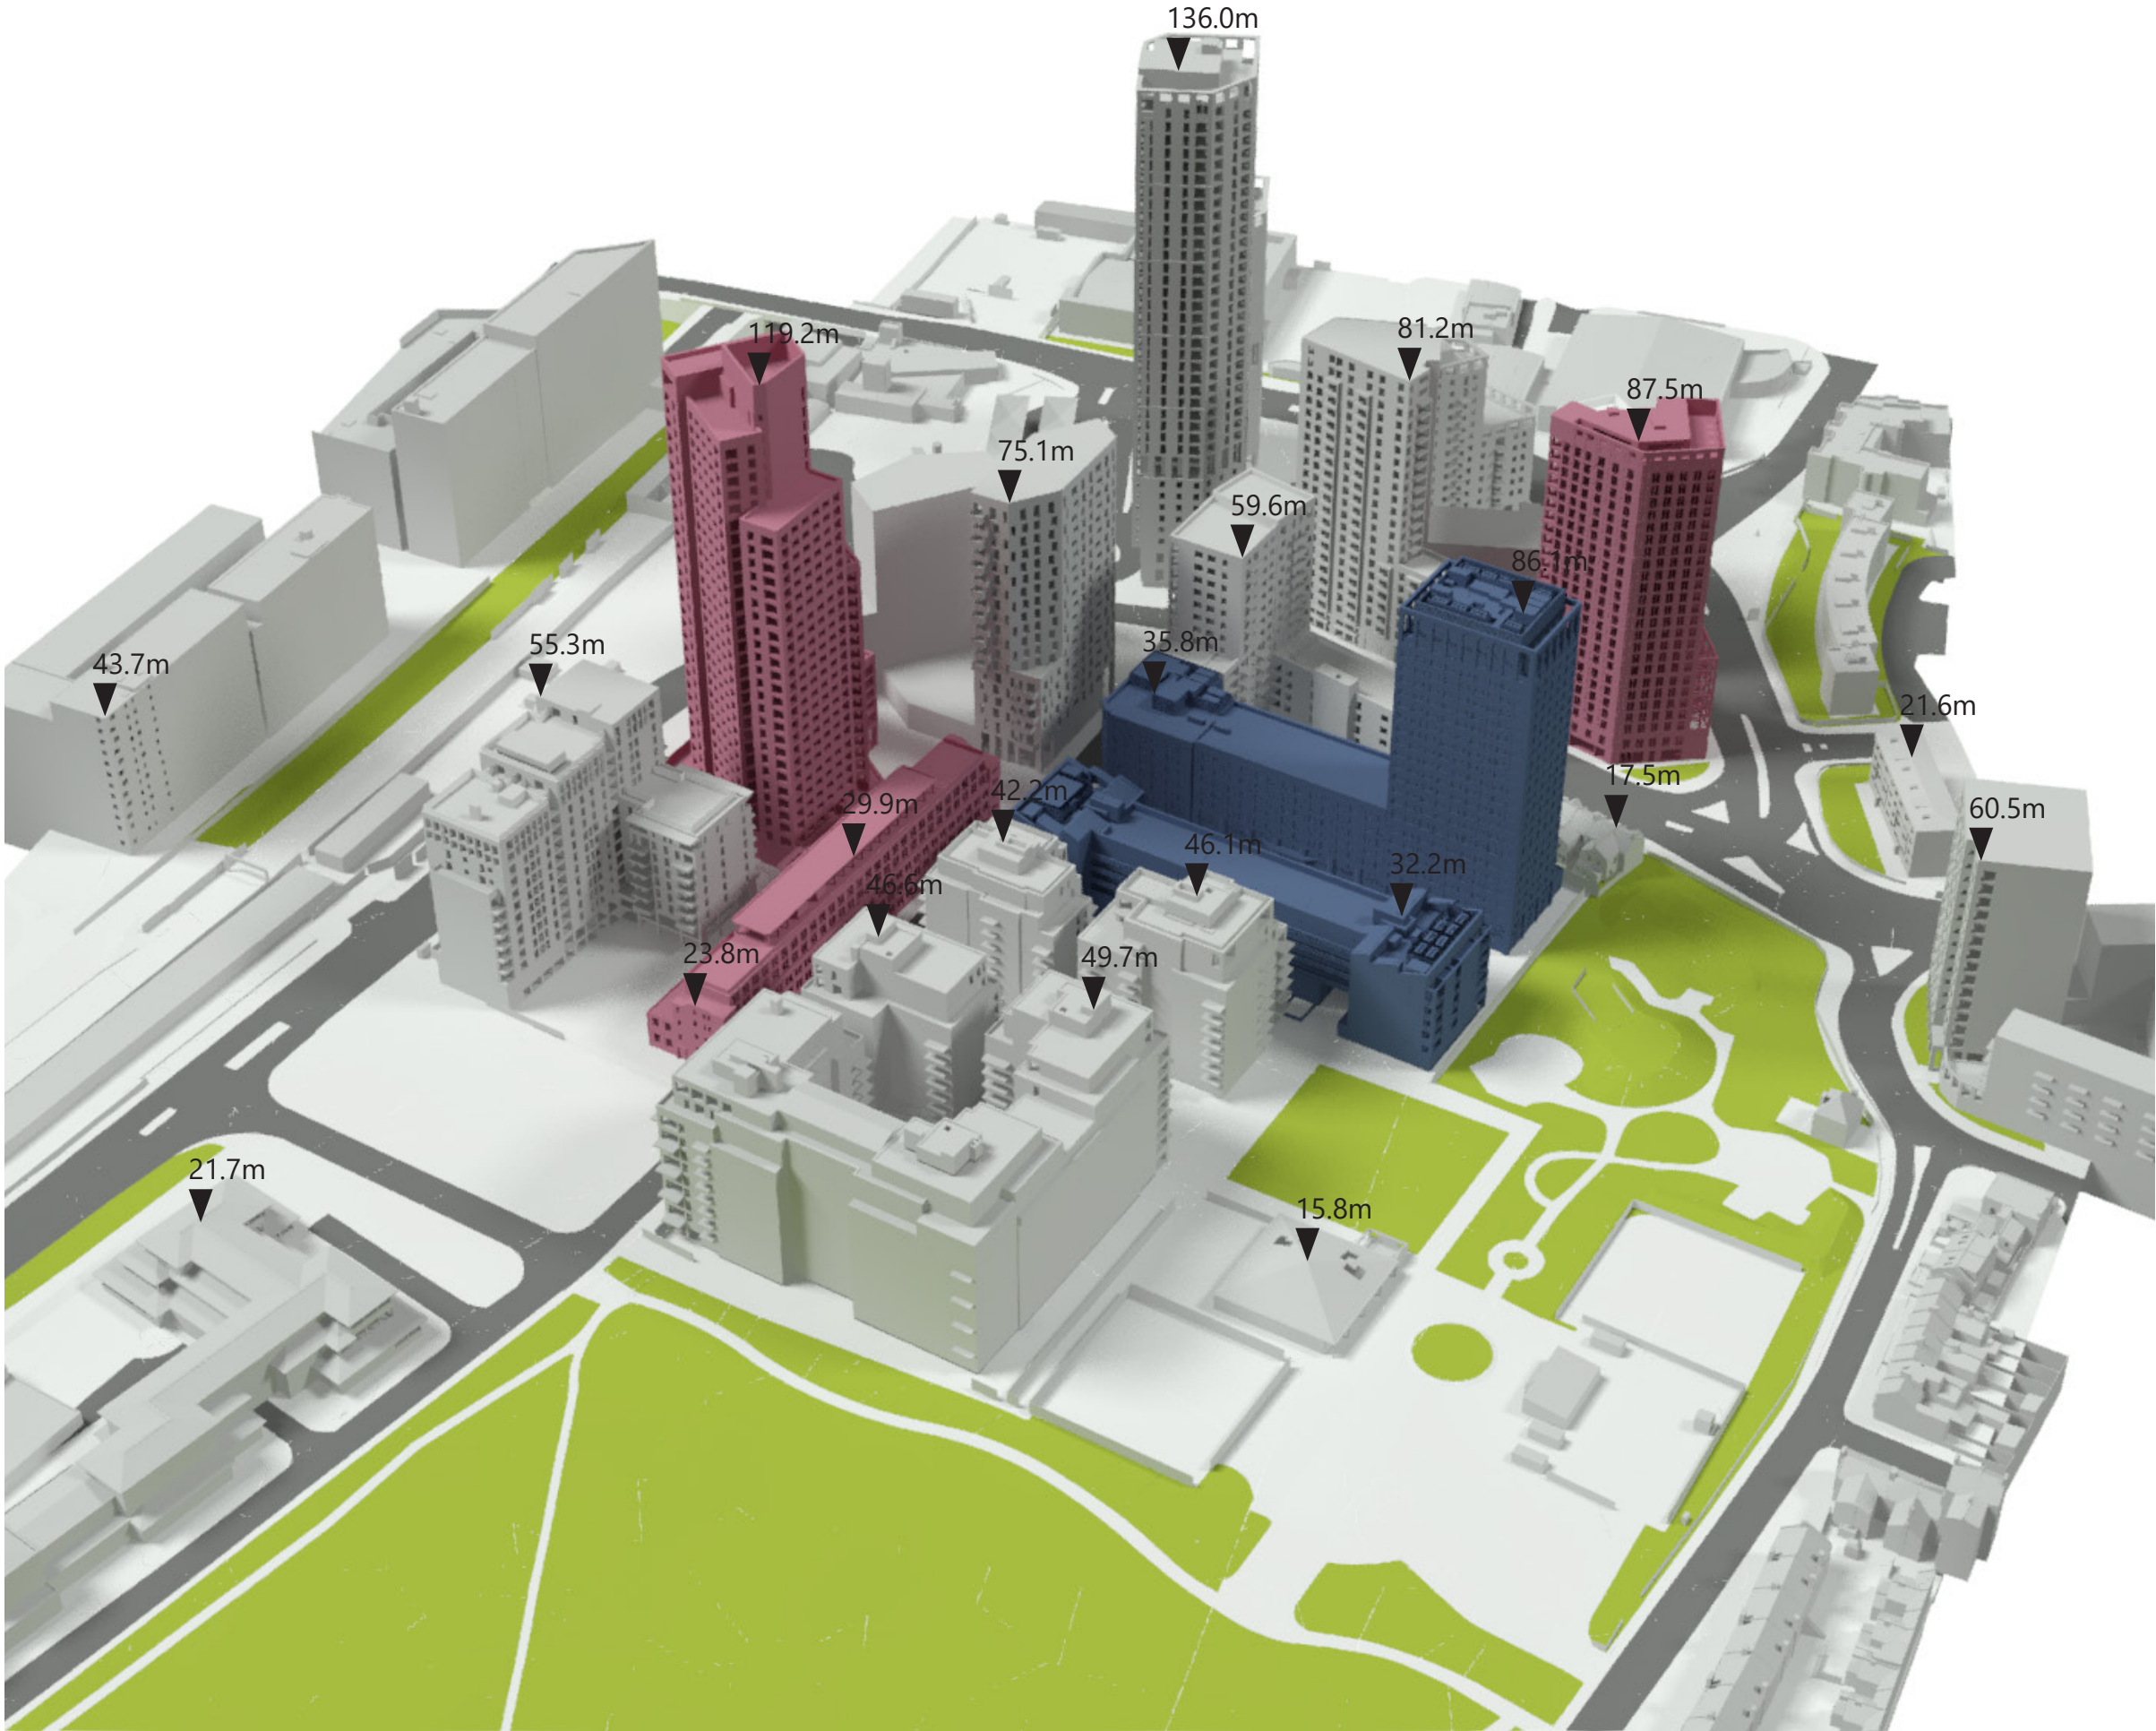

#### Sources of information

##### Cloud 10

Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

##### DLA

03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

##### EB7 Ltd

Site Photographs  
Ordnance Survey

#### Key

- Cumulative Development
- Existing Building
- Surrounding Context
- Proposed Development

Project Ashley Road  
Tottenham Hale

Title Proposed Development  
3D View

Drawn TR Checked --

Date 08/08/2026 Project 10106

Rel no. 08 Prefix DS02 Page no. 04



## Appendix 2

Detailed results of the daylight and sunlight assessments  
within the Shared-Living Block (BRE 2022)

| Floor  | Room | Window | Room Use      | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|--------|---------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |        |               | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |        |               | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Ground | R1   | W1     | Communal Area | 150               | 40%                      | 123                | 1.5                    | 5.1               | N/F          |
|        |      | W2     |               |                   |                          |                    |                        |                   | N/F          |
|        |      | W3     |               |                   |                          |                    |                        |                   | N/F          |
|        |      | W4     |               |                   |                          |                    |                        |                   | N/F          |
|        |      | W5     |               |                   |                          |                    |                        |                   | N/F          |
|        |      | W6     |               |                   |                          |                    |                        |                   | N/F          |
|        |      | W7     |               |                   |                          |                    |                        |                   | N/F          |
|        |      | W8     |               |                   |                          |                    |                        |                   | N/F          |
|        |      | W9     |               |                   |                          |                    |                        |                   | N/F          |
|        | R2   | W10    | Communal Area | 150               | 38%                      | 129                | 1.5                    | 1.3               |              |
|        |      | W11    |               |                   |                          |                    |                        |                   |              |
|        |      |        |               |                   |                          |                    |                        |                   |              |
|        |      |        |               |                   |                          |                    |                        |                   |              |
|        |      |        |               |                   |                          |                    |                        |                   |              |
|        |      |        |               |                   |                          |                    |                        |                   |              |
|        |      |        |               |                   |                          |                    |                        |                   |              |
|        |      |        |               |                   |                          |                    |                        |                   |              |
|        |      |        |               |                   |                          |                    |                        |                   |              |
| First  | R1   | W1     | Studio        | 100               | 33%                      | 75                 | 1.5                    | 0.0               | N/F          |
| First  | R2   | W2     | Studio        | 100               | 36%                      | 79                 | 1.5                    | 0.0               | N/F          |
| First  | R3   | W3     | Studio        | 100               | 36%                      | 81                 | 1.5                    | 0.0               | N/F          |
| First  | R4   | W4     | Studio        | 100               | 40%                      | 81                 | 1.5                    | 0.0               | N/F          |
| First  | R5   | W5     | Studio        | 100               | 40%                      | 83                 | 1.5                    | 0.0               | N/F          |
| First  | R6   | W6     | Studio        | 100               | 49%                      | 99                 | 1.5                    | 0.0               | N/F          |
| First  | R7   | W7     | Studio        | 100               | 54%                      | 106                | 1.5                    | 0.0               | N/F          |
| First  | R8   | W8     | Studio        | 100               | 55%                      | 102                | 1.5                    | 0.0               | N/F          |

| Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| First | R9   | W9     | Studio   | 100               | 49%                      | 99                 | 1.5                    | 0.0               | N/F          |
| First | R10  | W10    | Studio   | 100               | 40%                      | 84                 | 1.5                    | 0.0               | N/F          |
| First | R11  | W11    | Studio   | 100               | 36%                      | 80                 | 1.5                    | 0.0               | N/F          |
| First | R12  | W12    | Studio   | 100               | 40%                      | 81                 | 1.5                    | 0.0               | N/F          |
| First | R13  | W13    | Studio   | 100               | 35%                      | 82                 | 1.5                    | 0.0               | N/F          |
| First | R14  | W14    | Studio   | 100               | 29%                      | 72                 | 1.5                    | 0.0               | N/F          |
| First | R15  | W15    | Studio   | 100               | 33%                      | 76                 | 1.5                    | 0.0               | N/F          |
| First | R16  | W16    | Studio   | 100               | 32%                      | 77                 | 1.5                    | 0.0               | N/F          |
| First | R17  | W17    | Studio   | 100               | 25%                      | 64                 | 1.5                    | 0.0               | N/F          |
| First | R18  | W18    | Studio   | 100               | 38%                      | 83                 | 1.5                    | 0.0               | N/F          |
| First | R19  | W19    | Studio   | 100               | 29%                      | 70                 | 1.5                    | 0.0               | N/F          |
| First | R20  | W20    | Studio   | 100               | 19%                      | 49                 | 1.5                    | 0.0               |              |
| First | R21  | W21    | Studio   | 100               | 26%                      | 65                 | 1.5                    | 0.3               |              |
| First | R22  | W22    | Studio   | 100               | 27%                      | 64                 | 1.5                    | 0.2               |              |

| Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| First | R23  | W23    | Studio   | 100               | 0%                       | 9                  | 1.5                    | 0.0               |              |
| First | R24  | W24    | Studio   | 100               | 23%                      | 57                 | 1.5                    | 0.8               |              |
| First | R25  | W25    | Studio   | 100               | 86%                      | 164                | 1.5                    | 0.1               | N/F          |
| First | R26  | W26    | Studio   | 100               | 55%                      | 104                | 1.5                    | 0.7               | N/F          |
| First | R27  | W27    | Studio   | 100               | 28%                      | 50                 | 1.5                    | 2.6               |              |
| First | R28  | W28    | Studio   | 100               | 19%                      | 54                 | 1.5                    | 2.1               |              |
| First | R29  | W29    | Studio   | 100               | 17%                      | 44                 | 1.5                    | 2.4               |              |
| First | R30  | W30    | Studio   | 100               | 26%                      | 61                 | 1.5                    | 3.3               |              |
| First | R31  | W31    | Studio   | 100               | 65%                      | 130                | 1.5                    | 4.5               |              |
| First | R32  | W32    | Studio   | 100               | 70%                      | 150                | 1.5                    | 3.7               |              |
| First | R33  | W33    | Studio   | 100               | 81%                      | 163                | 1.5                    | 4.6               |              |
| First | R34  | W34    | Studio   | 100               | 84%                      | 183                | 1.5                    | 4.4               |              |
| First | R35  | W35    | Studio   | 100               | 76%                      | 152                | 1.5                    | 3.8               |              |
| First | R36  | W36    | Studio   | 100               | 40%                      | 87                 | 1.5                    | 0.6               |              |

| Floor | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| First | R37  | W37               | Studio   | 100               | 92%                      | 172                | 1.5                    | 4.2               |              |
| First | R38  | W38<br>W39        | Studio   | 100               | 91%                      | 218                | 1.5                    | 6.0               |              |
| First | R39  | W40<br>W41        | Studio   | 100               | 100%                     | 244                | 1.5                    | 6.1               |              |
| First | R40  | W42<br>W43<br>W44 | Studio   | 100               | 100%                     | 639                | 1.5                    | 6.4               | N/F          |
| First | R41  | W45               | Studio   | 100               | 100%                     | 288                | 1.5                    | 2.7               | N/F          |
| First | R42  | W46               | Studio   | 100               | 100%                     | 291                | 1.5                    | 2.7               | N/F          |
| First | R43  | W47               | Studio   | 100               | 100%                     | 300                | 1.5                    | 2.7               | N/F          |
| First | R44  | W48               | Studio   | 100               | 100%                     | 293                | 1.5                    | 2.7               | N/F          |
| First | R45  | W49<br>W50        | Studio   | 100               | 100%                     | 337                | 1.5                    | 2.7               | N/F<br>N/F   |
| First | R46  | W51<br>W52        | Studio   | 100               | 72%                      | 117                | 1.5                    | 0.0               | N/F<br>N/F   |
| First | R47  | W53               | Studio   | 100               | 64%                      | 125                | 1.5                    | 0.0               | N/F          |

| Floor  | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|        |      | W54    |          |                   |                          |                    |                        |                   | N/F          |
| First  | R48  | W55    | Studio   | 100               | 27%                      | 66                 | 1.5                    | 0.0               | N/F          |
| First  | R49  | W56    | Studio   | 100               | 23%                      | 59                 | 1.5                    | 0.0               | N/F          |
| Second | R1   | W1     | Studio   | 100               | 46%                      | 88                 | 1.5                    | 0.0               | N/F          |
| Second | R2   | W2     | Studio   | 100               | 49%                      | 91                 | 1.5                    | 0.0               | N/F          |
| Second | R3   | W3     | Studio   | 100               | 50%                      | 96                 | 1.5                    | 0.0               | N/F          |
| Second | R4   | W4     | Studio   | 100               | 49%                      | 93                 | 1.5                    | 0.0               | N/F          |
| Second | R5   | W5     | Studio   | 100               | 49%                      | 97                 | 1.5                    | 0.0               | N/F          |
| Second | R6   | W6     | Studio   | 100               | 49%                      | 93                 | 1.5                    | 0.0               | N/F          |
| Second | R7   | W7     | Studio   | 100               | 50%                      | 97                 | 1.5                    | 0.0               | N/F          |
| Second | R8   | W8     | Studio   | 100               | 49%                      | 96                 | 1.5                    | 0.0               | N/F          |
| Second | R9   | W9     | Studio   | 100               | 50%                      | 97                 | 1.5                    | 0.0               | N/F          |
| Second | R10  | W10    | Studio   | 100               | 49%                      | 96                 | 1.5                    | 0.0               | N/F          |
| Second | R11  | W11    | Studio   | 100               | 49%                      | 94                 | 1.5                    | 0.0               | N/F          |

| Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Second | R12  | W12        | Studio   | 100               | 49%                      | 96                 | 1.5                    | 0.0               | N/F          |
| Second | R13  | W13        | Studio   | 100               | 48%                      | 95                 | 1.5                    | 0.0               | N/F          |
| Second | R14  | W14        | Studio   | 100               | 40%                      | 84                 | 1.5                    | 0.0               | N/F          |
| Second | R15  | W15        | Studio   | 100               | 41%                      | 86                 | 1.5                    | 0.0               | N/F          |
| Second | R16  | W16        | Studio   | 100               | 42%                      | 87                 | 1.5                    | 0.0               | N/F          |
| Second | R17  | W17        | Studio   | 100               | 42%                      | 89                 | 1.5                    | 0.0               | N/F          |
| Second | R18  | W18        | Studio   | 100               | 37%                      | 83                 | 1.5                    | 0.0               | N/F          |
| Second | R19  | W19<br>W20 | Studio   | 100               | 100%                     | 274                | 1.5                    | 0.0               | N/F<br>N/F   |
| Second | R20  | W21        | Studio   | 100               | 48%                      | 94                 | 1.5                    | 0.0               |              |
| Second | R21  | W22        | Studio   | 100               | 44%                      | 87                 | 1.5                    | 0.0               |              |
| Second | R22  | W23        | Studio   | 100               | 29%                      | 70                 | 1.5                    | 0.0               |              |
| Second | R23  | W24        | Studio   | 100               | 28%                      | 64                 | 1.5                    | 0.2               |              |
| Second | R24  | W25        | Studio   | 100               | 24%                      | 61                 | 1.5                    | 0.6               |              |
| Second | R25  | W26        | Studio   | 100               | 25%                      | 62                 | 1.5                    | 0.8               |              |

| Floor  | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Second | R26  | W27    | Studio   | 100               | 95%                      | 173                | 1.5                    | 1.2               | N/F          |
| Second | R27  | W28    | Studio   | 100               | 64%                      | 109                | 1.5                    | 1.4               | N/F          |
| Second | R28  | W29    | Studio   | 100               | 29%                      | 55                 | 1.5                    | 2.8               |              |
| Second | R29  | W30    | Studio   | 100               | 19%                      | 55                 | 1.5                    | 2.1               |              |
| Second | R30  | W31    | Studio   | 100               | 17%                      | 47                 | 1.5                    | 2.4               |              |
| Second | R31  | W32    | Studio   | 100               | 30%                      | 62                 | 1.5                    | 3.3               |              |
| Second | R32  | W33    | Studio   | 100               | 36%                      | 72                 | 1.5                    | 2.7               |              |
| Second | R33  | W34    | Studio   | 100               | 36%                      | 75                 | 1.5                    | 3.6               |              |
| Second | R34  | W35    | Studio   | 100               | 48%                      | 93                 | 1.5                    | 2.9               |              |
| Second | R35  | W36    | Studio   | 100               | 50%                      | 100                | 1.5                    | 3.9               |              |
| Second | R36  | W37    | Studio   | 100               | 58%                      | 113                | 1.5                    | 3.2               |              |
| Second | R37  | W38    | Studio   | 100               | 60%                      | 112                | 1.5                    | 4.1               |              |
| Second | R38  | W39    | Studio   | 100               | 66%                      | 132                | 1.5                    | 3.6               |              |
| Second | R39  | W40    | Studio   | 100               | 71%                      | 134                | 1.5                    | 4.6               |              |

| Floor  | Room | Window     | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|--------|------|------------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|        |      |            |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|        |      |            |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Second | R40  | W41        | Studio   | 100               | 78%                         | 156                   | 1.5                    | 4.0                  |              |
| Second | R41  | W42        | Studio   | 100               | 81%                         | 157                   | 1.5                    | 4.9                  |              |
| Second | R42  | W43        | Studio   | 100               | 82%                         | 170                   | 1.5                    | 4.2                  |              |
| Second | R43  | W44        | Studio   | 100               | 83%                         | 159                   | 1.5                    | 3.9                  |              |
| Second | R44  | W45        | Studio   | 100               | 95%                         | 195                   | 1.5                    | 4.5                  |              |
| Second | R45  | W46        | Studio   | 100               | 96%                         | 199                   | 1.5                    | 5.1                  |              |
| Second | R46  | W47<br>W48 | Studio   | 100               | 100%                        | 290                   | 1.5                    | 5.7                  |              |
| Second | R47  | W49<br>W50 | Studio   | 100               | 100%                        | 335                   | 1.5                    | 5.9                  |              |
| Second | R48  | W51<br>W52 | Studio   | 100               | 100%                        | 407                   | 1.5                    | 6.4                  | N/F          |
| Second | R49  | W53        | Studio   | 100               | 100%                        | 305                   | 1.5                    | 1.9                  | N/F          |
| Second | R50  | W54        | Studio   | 100               | 100%                        | 305                   | 1.5                    | 1.9                  | N/F          |
| Second | R51  | W55        | Studio   | 100               | 100%                        | 309                   | 1.5                    | 1.9                  | N/F          |

| Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Second | R52  | W56        | Studio   | 100               | 100%                     | 311                | 1.5                    | 1.9               | N/F          |
| Second | R53  | W57<br>W58 | Studio   | 100               | 100%                     | 366                | 1.5                    | 1.9               | N/F<br>N/F   |
| Second | R54  | W59<br>W60 | Studio   | 100               | 79%                      | 129                | 1.5                    | 0.0               | N/F<br>N/F   |
| Second | R55  | W61<br>W62 | Studio   | 100               | 70%                      | 154                | 1.5                    | 0.0               | N/F<br>N/F   |
| Second | R56  | W63        | Studio   | 100               | 33%                      | 68                 | 1.5                    | 0.0               | N/F          |
| Second | R57  | W64        | Studio   | 100               | 33%                      | 67                 | 1.5                    | 0.0               | N/F          |
| Third  | R1   | W1         | Studio   | 100               | 63%                      | 133                | 1.5                    | 0.0               | N/F          |
| Third  | R2   | W2         | Studio   | 100               | 66%                      | 140                | 1.5                    | 0.0               | N/F          |
| Third  | R3   | W3         | Studio   | 100               | 67%                      | 146                | 1.5                    | 0.0               | N/F          |
| Third  | R4   | W4         | Studio   | 100               | 67%                      | 143                | 1.5                    | 0.0               | N/F          |
| Third  | R5   | W5         | Studio   | 100               | 67%                      | 145                | 1.5                    | 0.0               | N/F          |
| Third  | R6   | W6         | Studio   | 100               | 67%                      | 142                | 1.5                    | 0.0               | N/F          |
| Third  | R7   | W7         | Studio   | 100               | 68%                      | 149                | 1.5                    | 0.0               | N/F          |

| Floor | Room | Window     | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|-------|------|------------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|       |      |            |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|       |      |            |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Third | R8   | W8         | Studio   | 100               | 68%                         | 145                   | 1.5                    | 0.0                  | N/F          |
| Third | R9   | W9         | Studio   | 100               | 70%                         | 147                   | 1.5                    | 0.0                  | N/F          |
| Third | R10  | W10        | Studio   | 100               | 69%                         | 144                   | 1.5                    | 0.0                  | N/F          |
| Third | R11  | W11        | Studio   | 100               | 69%                         | 144                   | 1.5                    | 0.0                  | N/F          |
| Third | R12  | W12        | Studio   | 100               | 67%                         | 145                   | 1.5                    | 0.0                  | N/F          |
| Third | R13  | W13        | Studio   | 100               | 65%                         | 140                   | 1.5                    | 0.0                  | N/F          |
| Third | R14  | W14        | Studio   | 100               | 62%                         | 114                   | 1.5                    | 0.0                  | N/F          |
| Third | R15  | W15        | Studio   | 100               | 59%                         | 120                   | 1.5                    | 0.0                  | N/F          |
| Third | R16  | W16        | Studio   | 100               | 58%                         | 113                   | 1.5                    | 0.0                  | N/F          |
| Third | R17  | W17        | Studio   | 100               | 56%                         | 110                   | 1.5                    | 0.0                  | N/F          |
| Third | R18  | W18        | Studio   | 100               | 53%                         | 103                   | 1.5                    | 0.0                  | N/F          |
| Third | R19  | W19<br>W20 | Studio   | 100               | 100%                        | 279                   | 1.5                    | 0.0                  | N/F<br>N/F   |
| Third | R20  | W21        | Studio   | 100               | 54%                         | 103                   | 1.5                    | 0.0                  |              |

| Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Third | R21  | W22    | Studio   | 100               | 48%                      | 95                 | 1.5                    | 0.0               |              |
| Third | R22  | W23    | Studio   | 100               | 33%                      | 77                 | 1.5                    | 0.0               |              |
| Third | R23  | W24    | Studio   | 100               | 33%                      | 70                 | 1.5                    | 0.2               |              |
| Third | R24  | W25    | Studio   | 100               | 28%                      | 68                 | 1.5                    | 0.6               |              |
| Third | R25  | W26    | Studio   | 100               | 30%                      | 68                 | 1.5                    | 0.8               |              |
| Third | R26  | W27    | Studio   | 100               | 100%                     | 188                | 1.5                    | 1.9               | N/F          |
| Third | R27  | W28    | Studio   | 100               | 79%                      | 118                | 1.5                    | 1.4               | N/F          |
| Third | R28  | W29    | Studio   | 100               | 32%                      | 65                 | 1.5                    | 2.0               |              |
| Third | R29  | W30    | Studio   | 100               | 27%                      | 64                 | 1.5                    | 3.0               |              |
| Third | R30  | W31    | Studio   | 100               | 21%                      | 57                 | 1.5                    | 2.4               |              |
| Third | R31  | W32    | Studio   | 100               | 33%                      | 72                 | 1.5                    | 3.3               |              |
| Third | R32  | W33    | Studio   | 100               | 44%                      | 85                 | 1.5                    | 2.7               |              |
| Third | R33  | W34    | Studio   | 100               | 42%                      | 88                 | 1.5                    | 3.6               |              |
| Third | R34  | W35    | Studio   | 100               | 54%                      | 108                | 1.5                    | 3.0               |              |

| Floor | Room | Window     | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|-------|------|------------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|       |      |            |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|       |      |            |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Third | R35  | W36        | Studio   | 100               | 59%                         | 112                   | 1.5                    | 4.0                  |              |
| Third | R36  | W37        | Studio   | 100               | 70%                         | 135                   | 1.5                    | 3.4                  |              |
| Third | R37  | W38        | Studio   | 100               | 70%                         | 128                   | 1.5                    | 4.4                  |              |
| Third | R38  | W39        | Studio   | 100               | 77%                         | 151                   | 1.5                    | 3.9                  |              |
| Third | R39  | W40        | Studio   | 100               | 81%                         | 147                   | 1.5                    | 4.9                  |              |
| Third | R40  | W41        | Studio   | 100               | 86%                         | 169                   | 1.5                    | 4.2                  |              |
| Third | R41  | W42        | Studio   | 100               | 90%                         | 167                   | 1.5                    | 5.2                  |              |
| Third | R42  | W43        | Studio   | 100               | 89%                         | 180                   | 1.5                    | 4.5                  |              |
| Third | R43  | W44        | Studio   | 100               | 85%                         | 166                   | 1.5                    | 4.3                  |              |
| Third | R44  | W45        | Studio   | 100               | 98%                         | 198                   | 1.5                    | 4.9                  |              |
| Third | R45  | W46        | Studio   | 100               | 97%                         | 197                   | 1.5                    | 5.4                  |              |
| Third | R46  | W47<br>W48 | Studio   | 100               | 100%                        | 287                   | 1.5                    | 6.0                  |              |
| Third | R47  | W49<br>W50 | Studio   | 100               | 100%                        | 326                   | 1.5                    | 5.9                  |              |

| Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Third  | R48  | W51<br>W52 | Studio   | 100               | 100%                     | 416                | 1.5                    | 6.5               | N/F          |
| Third  | R49  | W53        | Studio   | 100               | 100%                     | 317                | 1.5                    | 1.9               | N/F          |
| Third  | R50  | W54        | Studio   | 100               | 100%                     | 317                | 1.5                    | 1.9               | N/F          |
| Third  | R51  | W55        | Studio   | 100               | 100%                     | 318                | 1.5                    | 1.9               | N/F          |
| Third  | R52  | W56        | Studio   | 100               | 100%                     | 320                | 1.5                    | 1.9               | N/F          |
| Third  | R53  | W57<br>W58 | Studio   | 100               | 100%                     | 385                | 1.5                    | 1.9               | N/F<br>N/F   |
| Third  | R54  | W59<br>W60 | Studio   | 100               | 88%                      | 168                | 1.5                    | 0.0               | N/F<br>N/F   |
| Third  | R55  | W61<br>W62 | Studio   | 100               | 82%                      | 217                | 1.5                    | 0.0               | N/F<br>N/F   |
| Third  | R56  | W63        | Studio   | 100               | 47%                      | 90                 | 1.5                    | 0.0               | N/F          |
| Third  | R57  | W64        | Studio   | 100               | 46%                      | 90                 | 1.5                    | 0.0               | N/F          |
| Fourth | R1   | W1         | Studio   | 100               | 88%                      | 180                | 1.5                    | 0.0               | N/F          |
| Fourth | R2   | W2         | Studio   | 100               | 94%                      | 189                | 1.5                    | 0.0               | N/F          |

| Floor  | Room | Window | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|--------|------|--------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|        |      |        |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|        |      |        |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Fourth | R3   | W3     | Studio   | 100               | 92%                         | 194                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R4   | W4     | Studio   | 100               | 95%                         | 192                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R5   | W5     | Studio   | 100               | 95%                         | 197                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R6   | W6     | Studio   | 100               | 92%                         | 194                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R7   | W7     | Studio   | 100               | 95%                         | 196                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R8   | W8     | Studio   | 100               | 93%                         | 193                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R9   | W9     | Studio   | 100               | 97%                         | 193                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R10  | W10    | Studio   | 100               | 95%                         | 194                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R11  | W11    | Studio   | 100               | 96%                         | 191                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R12  | W12    | Studio   | 100               | 95%                         | 196                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R13  | W13    | Studio   | 100               | 94%                         | 192                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R14  | W14    | Studio   | 100               | 78%                         | 156                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R15  | W15    | Studio   | 100               | 88%                         | 174                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R16  | W16    | Studio   | 100               | 79%                         | 171                   | 1.5                    | 0.0                  | N/F          |

| Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Fourth | R17  | W17        | Studio   | 100               | 75%                      | 160                | 1.5                    | 0.0               | N/F          |
| Fourth | R18  | W18        | Studio   | 100               | 76%                      | 141                | 1.5                    | 0.0               | N/F          |
| Fourth | R19  | W19<br>W20 | Studio   | 100               | 100%                     | 332                | 1.5                    | 0.0               | N/F<br>N/F   |
| Fourth | R20  | W21        | Studio   | 100               | 65%                      | 117                | 1.5                    | 0.0               |              |
| Fourth | R21  | W22        | Studio   | 100               | 55%                      | 107                | 1.5                    | 0.0               |              |
| Fourth | R22  | W23        | Studio   | 100               | 40%                      | 86                 | 1.5                    | 0.0               |              |
| Fourth | R23  | W24        | Studio   | 100               | 38%                      | 77                 | 1.5                    | 0.2               |              |
| Fourth | R24  | W25        | Studio   | 100               | 33%                      | 75                 | 1.5                    | 0.6               |              |
| Fourth | R25  | W26        | Studio   | 100               | 33%                      | 76                 | 1.5                    | 0.8               |              |
| Fourth | R26  | W27        | Studio   | 100               | 100%                     | 207                | 1.5                    | 1.9               | N/F          |
| Fourth | R27  | W28        | Studio   | 100               | 83%                      | 127                | 1.5                    | 1.4               | N/F          |
| Fourth | R28  | W29        | Studio   | 100               | 34%                      | 74                 | 1.5                    | 2.1               |              |
| Fourth | R29  | W30        | Studio   | 100               | 31%                      | 72                 | 1.5                    | 3.0               |              |
| Fourth | R30  | W31        | Studio   | 100               | 25%                      | 66                 | 1.5                    | 2.4               |              |

| Floor  | Room | Window | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|--------|------|--------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|        |      |        |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|        |      |        |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Fourth | R31  | W32    | Studio   | 100               | 40%                         | 85                    | 1.5                    | 3.3                  |              |
| Fourth | R32  | W33    | Studio   | 100               | 50%                         | 100                   | 1.5                    | 2.7                  |              |
| Fourth | R33  | W34    | Studio   | 100               | 51%                         | 101                   | 1.5                    | 3.8                  |              |
| Fourth | R34  | W35    | Studio   | 100               | 63%                         | 122                   | 1.5                    | 3.2                  |              |
| Fourth | R35  | W36    | Studio   | 100               | 65%                         | 123                   | 1.5                    | 4.2                  |              |
| Fourth | R36  | W37    | Studio   | 100               | 78%                         | 142                   | 1.5                    | 3.8                  |              |
| Fourth | R37  | W38    | Studio   | 100               | 76%                         | 138                   | 1.5                    | 4.8                  |              |
| Fourth | R38  | W39    | Studio   | 100               | 89%                         | 162                   | 1.5                    | 4.3                  |              |
| Fourth | R39  | W40    | Studio   | 100               | 88%                         | 157                   | 1.5                    | 5.3                  |              |
| Fourth | R40  | W41    | Studio   | 100               | 92%                         | 180                   | 1.5                    | 4.6                  |              |
| Fourth | R41  | W42    | Studio   | 100               | 93%                         | 178                   | 1.5                    | 5.5                  |              |
| Fourth | R42  | W43    | Studio   | 100               | 95%                         | 189                   | 1.5                    | 4.9                  |              |
| Fourth | R43  | W44    | Studio   | 100               | 89%                         | 176                   | 1.5                    | 4.6                  |              |
| Fourth | R44  | W45    | Studio   | 100               | 100%                        | 203                   | 1.5                    | 5.2                  |              |

| Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Fourth | R45  | W46        | Studio   | 100               | 97%                      | 204                | 1.5                    | 5.8               |              |
| Fourth | R46  | W47<br>W48 | Studio   | 100               | 100%                     | 294                | 1.5                    | 6.1               |              |
| Fourth | R47  | W49<br>W50 | Studio   | 100               | 100%                     | 331                | 1.5                    | 5.9               |              |
| Fourth | R48  | W51<br>W52 | Studio   | 100               | 100%                     | 426                | 1.5                    | 6.5               | N/F          |
| Fourth | R49  | W53        | Studio   | 100               | 100%                     | 326                | 1.5                    | 1.9               | N/F          |
| Fourth | R50  | W54        | Studio   | 100               | 100%                     | 320                | 1.5                    | 1.9               | N/F          |
| Fourth | R51  | W55        | Studio   | 100               | 100%                     | 326                | 1.5                    | 1.9               | N/F          |
| Fourth | R52  | W56        | Studio   | 100               | 100%                     | 325                | 1.5                    | 1.9               | N/F          |
| Fourth | R53  | W57<br>W58 | Studio   | 100               | 100%                     | 407                | 1.5                    | 1.9               | N/F<br>N/F   |
| Fourth | R54  | W59<br>W60 | Studio   | 100               | 98%                      | 222                | 1.5                    | 0.0               | N/F<br>N/F   |
| Fourth | R55  | W61<br>W62 | Studio   | 100               | 100%                     | 274                | 1.5                    | 0.0               | N/F<br>N/F   |

| Floor  | Room | Window | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|--------|------|--------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|        |      |        |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|        |      |        |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Fourth | R56  | W63    | Studio   | 100               | 62%                         | 134                   | 1.5                    | 0.0                  | N/F          |
| Fourth | R57  | W64    | Studio   | 100               | 63%                         | 134                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R1   | W1     | Studio   | 100               | 98%                         | 222                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R2   | W2     | Studio   | 100               | 100%                        | 239                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R3   | W3     | Studio   | 100               | 100%                        | 236                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R4   | W4     | Studio   | 100               | 100%                        | 234                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R5   | W5     | Studio   | 100               | 100%                        | 233                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R6   | W6     | Studio   | 100               | 100%                        | 236                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R7   | W7     | Studio   | 100               | 100%                        | 236                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R8   | W8     | Studio   | 100               | 100%                        | 235                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R9   | W9     | Studio   | 100               | 100%                        | 238                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R10  | W10    | Studio   | 100               | 100%                        | 233                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R11  | W11    | Studio   | 100               | 100%                        | 234                   | 1.5                    | 0.0                  | N/F          |
| Fifth  | R12  | W12    | Studio   | 100               | 100%                        | 235                   | 1.5                    | 0.0                  | N/F          |

| Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Fifth | R13  | W13        | Studio   | 100               | 100%                     | 235                | 1.5                    | 0.0               | N/F          |
| Fifth | R14  | W14        | Studio   | 100               | 92%                      | 197                | 1.5                    | 0.0               | N/F          |
| Fifth | R15  | W15        | Studio   | 100               | 100%                     | 229                | 1.5                    | 0.0               | N/F          |
| Fifth | R16  | W16        | Studio   | 100               | 100%                     | 227                | 1.5                    | 0.0               | N/F          |
| Fifth | R17  | W17        | Studio   | 100               | 100%                     | 220                | 1.5                    | 0.0               | N/F          |
| Fifth | R18  | W18        | Studio   | 100               | 98%                      | 184                | 1.5                    | 0.0               | N/F          |
| Fifth | R19  | W19<br>W20 | Studio   | 100               | 100%                     | 377                | 1.5                    | 0.0               | N/F<br>N/F   |
| Fifth | R20  | W21        | Studio   | 100               | 74%                      | 131                | 1.5                    | 0.0               |              |
| Fifth | R21  | W22        | Studio   | 100               | 63%                      | 118                | 1.5                    | 0.0               |              |
| Fifth | R22  | W23        | Studio   | 100               | 48%                      | 97                 | 1.5                    | 0.0               |              |
| Fifth | R23  | W24        | Studio   | 100               | 45%                      | 91                 | 1.5                    | 0.2               |              |
| Fifth | R24  | W25        | Studio   | 100               | 40%                      | 84                 | 1.5                    | 0.6               |              |
| Fifth | R25  | W26        | Studio   | 100               | 41%                      | 85                 | 1.5                    | 0.8               |              |

| Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Fifth | R26  | W27    | Studio   | 100               | 100%                     | 225                | 1.5                    | 1.9               | N/F          |
| Fifth | R27  | W28    | Studio   | 100               | 90%                      | 135                | 1.5                    | 1.4               | N/F          |
| Fifth | R28  | W29    | Studio   | 100               | 42%                      | 82                 | 1.5                    | 2.1               |              |
| Fifth | R29  | W30    | Studio   | 100               | 36%                      | 83                 | 1.5                    | 3.0               |              |
| Fifth | R30  | W31    | Studio   | 100               | 29%                      | 71                 | 1.5                    | 2.4               |              |
| Fifth | R31  | W32    | Studio   | 100               | 49%                      | 99                 | 1.5                    | 3.5               |              |
| Fifth | R32  | W33    | Studio   | 100               | 57%                      | 113                | 1.5                    | 3.0               |              |
| Fifth | R33  | W34    | Studio   | 100               | 63%                      | 112                | 1.5                    | 4.2               |              |
| Fifth | R34  | W35    | Studio   | 100               | 73%                      | 133                | 1.5                    | 3.7               |              |
| Fifth | R35  | W36    | Studio   | 100               | 72%                      | 133                | 1.5                    | 4.8               |              |
| Fifth | R36  | W37    | Studio   | 100               | 88%                      | 151                | 1.5                    | 4.4               |              |
| Fifth | R37  | W38    | Studio   | 100               | 83%                      | 149                | 1.5                    | 5.3               |              |
| Fifth | R38  | W39    | Studio   | 100               | 92%                      | 171                | 1.5                    | 4.7               |              |
| Fifth | R39  | W40    | Studio   | 100               | 91%                      | 165                | 1.5                    | 5.6               |              |

| Floor | Room | Window     | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|-------|------|------------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|       |      |            |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|       |      |            |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Fifth | R40  | W41        | Studio   | 100               | 95%                         | 192                   | 1.5                    | 4.8                  |              |
| Fifth | R41  | W42        | Studio   | 100               | 96%                         | 184                   | 1.5                    | 5.7                  |              |
| Fifth | R42  | W43        | Studio   | 100               | 98%                         | 207                   | 1.5                    | 4.9                  |              |
| Fifth | R43  | W44        | Studio   | 100               | 93%                         | 190                   | 1.5                    | 4.6                  |              |
| Fifth | R44  | W45        | Studio   | 100               | 100%                        | 218                   | 1.5                    | 5.2                  |              |
| Fifth | R45  | W46        | Studio   | 100               | 98%                         | 213                   | 1.5                    | 5.8                  |              |
| Fifth | R46  | W47<br>W48 | Studio   | 100               | 100%                        | 305                   | 1.5                    | 6.1                  |              |
| Fifth | R47  | W49<br>W50 | Studio   | 100               | 100%                        | 340                   | 1.5                    | 5.9                  |              |
| Fifth | R48  | W51<br>W52 | Studio   | 100               | 100%                        | 438                   | 1.5                    | 6.5                  | N/F          |
| Fifth | R49  | W53        | Studio   | 100               | 100%                        | 333                   | 1.5                    | 1.9                  | N/F          |
| Fifth | R50  | W54        | Studio   | 100               | 100%                        | 324                   | 1.5                    | 1.9                  | N/F          |
| Fifth | R51  | W55        | Studio   | 100               | 100%                        | 335                   | 1.5                    | 1.9                  | N/F          |
| Fifth | R52  | W56        | Studio   | 100               | 100%                        | 327                   | 1.5                    | 1.9                  | N/F          |

| Floor | Room | Window     | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|-------|------|------------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|       |      |            |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|       |      |            |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Fifth | R53  | W57<br>W58 | Studio   | 100               | 100%                        | 432                   | 1.5                    | 1.9                  | N/F<br>N/F   |
| Fifth | R54  | W59<br>W60 | Studio   | 100               | 100%                        | 271                   | 1.5                    | 0.0                  | N/F<br>N/F   |
| Fifth | R55  | W61<br>W62 | Studio   | 100               | 100%                        | 336                   | 1.5                    | 0.0                  | N/F<br>N/F   |
| Fifth | R56  | W63        | Studio   | 100               | 83%                         | 176                   | 1.5                    | 0.0                  | N/F          |
| Fifth | R57  | W64        | Studio   | 100               | 83%                         | 176                   | 1.5                    | 0.0                  | N/F          |
| Sixth | R1   | W1         | Studio   | 100               | 100%                        | 258                   | 1.5                    | 0.0                  | N/F          |
| Sixth | R2   | W2         | Studio   | 100               | 100%                        | 275                   | 1.5                    | 0.0                  | N/F          |
| Sixth | R3   | W3         | Studio   | 100               | 100%                        | 274                   | 1.5                    | 0.0                  | N/F          |
| Sixth | R4   | W4         | Studio   | 100               | 100%                        | 272                   | 1.5                    | 0.0                  | N/F          |
| Sixth | R5   | W5         | Studio   | 100               | 100%                        | 270                   | 1.5                    | 0.0                  | N/F          |
| Sixth | R6   | W6         | Studio   | 100               | 100%                        | 273                   | 1.5                    | 0.0                  | N/F          |
| Sixth | R7   | W7         | Studio   | 100               | 100%                        | 267                   | 1.5                    | 0.0                  | N/F          |

| Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Sixth | R8   | W8         | Studio   | 100               | 100%                     | 269                | 1.5                    | 0.0               | N/F          |
| Sixth | R9   | W9         | Studio   | 100               | 100%                     | 266                | 1.5                    | 0.0               | N/F          |
| Sixth | R10  | W10        | Studio   | 100               | 100%                     | 266                | 1.5                    | 0.0               | N/F          |
| Sixth | R11  | W11        | Studio   | 100               | 100%                     | 267                | 1.5                    | 0.0               | N/F          |
| Sixth | R12  | W12        | Studio   | 100               | 100%                     | 263                | 1.5                    | 0.0               | N/F          |
| Sixth | R13  | W13        | Studio   | 100               | 100%                     | 265                | 1.5                    | 0.0               | N/F          |
| Sixth | R14  | W14        | Studio   | 100               | 98%                      | 229                | 1.5                    | 0.0               | N/F          |
| Sixth | R15  | W15        | Studio   | 100               | 100%                     | 263                | 1.5                    | 0.0               | N/F          |
| Sixth | R16  | W16        | Studio   | 100               | 100%                     | 260                | 1.5                    | 0.0               | N/F          |
| Sixth | R17  | W17        | Studio   | 100               | 100%                     | 260                | 1.5                    | 0.0               | N/F          |
| Sixth | R18  | W18        | Studio   | 100               | 100%                     | 219                | 1.5                    | 0.0               | N/F          |
| Sixth | R19  | W19<br>W20 | Studio   | 100               | 100%                     | 405                | 1.5                    | 0.0               | N/F<br>N/F   |
| Sixth | R20  | W21        | Studio   | 100               | 83%                      | 144                | 1.5                    | 0.0               |              |
| Sixth | R21  | W22        | Studio   | 100               | 74%                      | 137                | 1.5                    | 0.0               |              |

| Floor | Room | Window | Room Use | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|-------|------|--------|----------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|       |      |        |          | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|       |      |        |          | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
| Sixth | R22  | W23    | Studio   | 100               | 56%                         | 107                   | 1.5                    | 0.0                  |              |
| Sixth | R23  | W24    | Studio   | 100               | 51%                         | 106                   | 1.5                    | 0.2                  |              |
| Sixth | R24  | W25    | Studio   | 100               | 47%                         | 93                    | 1.5                    | 0.6                  |              |
| Sixth | R25  | W26    | Studio   | 100               | 48%                         | 94                    | 1.5                    | 0.8                  |              |
| Sixth | R26  | W27    | Studio   | 100               | 100%                        | 250                   | 1.5                    | 1.9                  | N/F          |
| Sixth | R27  | W28    | Studio   | 100               | 92%                         | 142                   | 1.5                    | 1.4                  | N/F          |
| Sixth | R28  | W29    | Studio   | 100               | 47%                         | 96                    | 1.5                    | 2.9                  |              |
| Sixth | R29  | W30    | Studio   | 100               | 43%                         | 89                    | 1.5                    | 2.3                  |              |
| Sixth | R30  | W31    | Studio   | 100               | 31%                         | 76                    | 1.5                    | 2.8                  |              |
| Sixth | R31  | W32    | Studio   | 100               | 55%                         | 108                   | 1.5                    | 4.0                  |              |
| Sixth | R32  | W33    | Studio   | 100               | 67%                         | 121                   | 1.5                    | 3.6                  |              |
| Sixth | R33  | W34    | Studio   | 100               | 70%                         | 125                   | 1.5                    | 4.8                  |              |
| Sixth | R34  | W35    | Studio   | 100               | 84%                         | 142                   | 1.5                    | 4.2                  |              |
| Sixth | R35  | W36    | Studio   | 100               | 83%                         | 145                   | 1.5                    | 5.3                  |              |

| Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Sixth | R36  | W37        | Studio   | 100               | 92%                      | 165                | 1.5                    | 4.6               |              |
| Sixth | R37  | W38        | Studio   | 100               | 91%                      | 158                | 1.5                    | 5.4               |              |
| Sixth | R38  | W39        | Studio   | 100               | 94%                      | 182                | 1.5                    | 4.7               |              |
| Sixth | R39  | W40        | Studio   | 100               | 97%                      | 174                | 1.5                    | 5.6               |              |
| Sixth | R40  | W41        | Studio   | 100               | 96%                      | 201                | 1.5                    | 4.8               |              |
| Sixth | R41  | W42        | Studio   | 100               | 98%                      | 195                | 1.5                    | 5.7               |              |
| Sixth | R42  | W43        | Studio   | 100               | 99%                      | 223                | 1.5                    | 4.9               |              |
| Sixth | R43  | W44        | Studio   | 100               | 96%                      | 201                | 1.5                    | 4.6               |              |
| Sixth | R44  | W45        | Studio   | 100               | 100%                     | 220                | 1.5                    | 5.4               |              |
| Sixth | R45  | W46        | Studio   | 100               | 98%                      | 225                | 1.5                    | 5.4               |              |
| Sixth | R46  | W47<br>W48 | Studio   | 100               | 100%                     | 310                | 1.5                    | 5.4               |              |
| Sixth | R47  | W49<br>W50 | Studio   | 100               | 100%                     | 356                | 1.5                    | 5.4               |              |
| Sixth | R48  | W51        | Studio   | 100               | 100%                     | 448                | 1.5                    | 6.5               |              |

| Floor   | Room | Window | Room Use      | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|---------|------|--------|---------------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|         |      |        |               | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|         |      |        |               | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
|         |      | W52    |               |                   |                             |                       |                        |                      | N/F          |
| Sixth   | R49  | W53    | Studio        | 100               | 100%                        | 339                   | 1.5                    | 1.9                  | N/F          |
| Sixth   | R50  | W54    | Studio        | 100               | 100%                        | 329                   | 1.5                    | 1.9                  | N/F          |
| Sixth   | R51  | W55    | Studio        | 100               | 100%                        | 341                   | 1.5                    | 1.9                  | N/F          |
| Sixth   | R52  | W56    | Studio        | 100               | 100%                        | 330                   | 1.5                    | 1.9                  | N/F          |
| Sixth   | R53  | W57    | Studio        | 100               | 100%                        | 450                   | 1.5                    | 1.9                  | N/F          |
|         |      | W58    |               |                   |                             |                       |                        |                      | N/F          |
| Sixth   | R54  | W59    | Studio        | 100               | 100%                        | 321                   | 1.5                    | 0.0                  | N/F          |
|         |      | W60    |               |                   |                             |                       |                        |                      | N/F          |
| Sixth   | R55  | W61    | Studio        | 100               | 100%                        | 387                   | 1.5                    | 0.0                  | N/F          |
|         |      | W62    |               |                   |                             |                       |                        |                      | N/F          |
| Sixth   | R56  | W63    | Studio        | 100               | 98%                         | 213                   | 1.5                    | 0.0                  | N/F          |
| Sixth   | R57  | W64    | Studio        | 100               | 100%                        | 212                   | 1.5                    | 0.0                  | N/F          |
| Seventh | R7   | W9     | Communal Area | 150               | 100%                        | 563                   | 1.5                    | 1.7                  | N/F          |
|         |      | W10    |               |                   |                             |                       |                        |                      | N/F          |
|         |      | W11    |               |                   |                             |                       |                        |                      | N/F          |
|         |      | W12    |               |                   |                             |                       |                        |                      | N/F          |
|         |      | W13    |               |                   |                             |                       |                        |                      | N/F          |

| Floor   | Room | Window                                        | Room Use      | Illuminance (SDA) |                             |                       | Sunlight Exposure (SE) |                      |              |
|---------|------|-----------------------------------------------|---------------|-------------------|-----------------------------|-----------------------|------------------------|----------------------|--------------|
|         |      |                                               |               | Target Lux        | % of Room<br>meeting target | Median Lux of<br>Room | Target                 | Sunlight<br>Exposure | North Facing |
|         |      |                                               |               | (Lux)             | (%)                         | (Lux)                 | (Hrs)                  | (Hrs)                | (NF)         |
|         |      | W14<br>W15<br>W16                             |               |                   |                             |                       |                        |                      | N/F          |
|         | R8   | W17<br>W18<br>W19<br>W20<br>W21<br>W22<br>W23 | Communal Area | 150               | 100%                        | 615                   | 1.5                    | 6.8                  |              |
| Seventh | R1   | W1<br>W2                                      | Studio        | 100               | 100%                        | 712                   | 1.5                    | 6.5                  | N/F          |
| Seventh | R2   | W3                                            | Studio        | 100               | 100%                        | 513                   | 1.5                    | 1.9                  | N/F          |
| Seventh | R3   | W4                                            | Studio        | 100               | 100%                        | 501                   | 1.5                    | 1.9                  | N/F          |
| Seventh | R4   | W5                                            | Studio        | 100               | 100%                        | 520                   | 1.5                    | 1.9                  | N/F          |
| Seventh | R5   | W6                                            | Studio        | 100               | 100%                        | 503                   | 1.5                    | 1.9                  | N/F          |
| Seventh | R6   | W7<br>W8                                      | Studio        | 100               | 100%                        | 695                   | 1.5                    | 1.9                  | N/F<br>N/F   |
| Eighth  | R1   | W1<br>W2                                      | Studio        | 100               | 100%                        | 396                   | 1.5                    | 0.0                  | N/F<br>N/F   |

| Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Eighth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 451                | 1.5                    | 0.0               | N/F<br>N/F   |
| Eighth | R3   | W5         | Studio   | 100               | 100%                     | 261                | 1.5                    | 0.0               | N/F          |
| Eighth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 423                | 1.5                    | 1.2               | N/F          |
| Eighth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 412                | 1.5                    | 6.2               |              |
| Eighth | R6   | W10        | Studio   | 100               | 100%                     | 242                | 1.5                    | 5.7               |              |
| Eighth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 331                | 1.5                    | 6.1               |              |
| Eighth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 374                | 1.5                    | 5.9               |              |
| Eighth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 487                | 1.5                    | 6.5               | N/F          |
| Eighth | R10  | W17        | Studio   | 100               | 100%                     | 350                | 1.5                    | 1.9               | N/F          |
| Eighth | R11  | W18        | Studio   | 100               | 100%                     | 336                | 1.5                    | 1.9               | N/F          |
| Eighth | R12  | W19        | Studio   | 100               | 100%                     | 352                | 1.5                    | 1.9               | N/F          |

| Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Eighth | R13  | W20        | Studio   | 100               | 100%                     | 338                | 1.5                    | 1.9               | N/F          |
| Eighth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 480                | 1.5                    | 1.9               | N/F<br>N/F   |
| Ninth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 410                | 1.5                    | 0.0               | N/F<br>N/F   |
| Ninth  | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 463                | 1.5                    | 0.0               | N/F<br>N/F   |
| Ninth  | R3   | W5         | Studio   | 100               | 100%                     | 274                | 1.5                    | 0.0               | N/F          |
| Ninth  | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 433                | 1.5                    | 1.3               | N/F          |
| Ninth  | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 420                | 1.5                    | 6.2               |              |
| Ninth  | R6   | W10        | Studio   | 100               | 100%                     | 254                | 1.5                    | 5.7               |              |
| Ninth  | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 345                | 1.5                    | 6.1               |              |
| Ninth  | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 384                | 1.5                    | 5.9               |              |

| Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Ninth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 499                | 1.5                    | 6.5               | N/F          |
| Ninth | R10  | W17        | Studio   | 100               | 100%                     | 352                | 1.5                    | 1.9               | N/F          |
| Ninth | R11  | W18        | Studio   | 100               | 100%                     | 341                | 1.5                    | 1.9               | N/F          |
| Ninth | R12  | W19        | Studio   | 100               | 100%                     | 354                | 1.5                    | 1.9               | N/F          |
| Ninth | R13  | W20        | Studio   | 100               | 100%                     | 344                | 1.5                    | 1.9               | N/F          |
| Ninth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 492                | 1.5                    | 1.9               | N/F<br>N/F   |
| Tenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 418                | 1.5                    | 0.0               | N/F<br>N/F   |
| Tenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 472                | 1.5                    | 0.0               | N/F<br>N/F   |
| Tenth | R3   | W5         | Studio   | 100               | 100%                     | 275                | 1.5                    | 0.0               | N/F          |
| Tenth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 448                | 1.5                    | 1.6               | N/F          |
| Tenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 435                | 1.5                    | 6.4               |              |

| Floor    | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|          |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|          |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Tenth    | R6   | W10        | Studio   | 100               | 100%                     | 265                | 1.5                    | 5.7               |              |
| Tenth    | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 357                | 1.5                    | 6.1               |              |
| Tenth    | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 394                | 1.5                    | 5.9               |              |
| Tenth    | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 508                | 1.5                    | 6.5               | N/F          |
| Tenth    | R10  | W17        | Studio   | 100               | 100%                     | 358                | 1.5                    | 1.9               | N/F          |
| Tenth    | R11  | W18        | Studio   | 100               | 100%                     | 347                | 1.5                    | 1.9               | N/F          |
| Tenth    | R12  | W19        | Studio   | 100               | 100%                     | 358                | 1.5                    | 1.9               | N/F          |
| Tenth    | R13  | W20        | Studio   | 100               | 100%                     | 347                | 1.5                    | 1.9               | N/F          |
| Tenth    | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 496                | 1.5                    | 1.9               | N/F<br>N/F   |
| Eleventh | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 423                | 1.5                    | 0.0               | N/F<br>N/F   |
| Eleventh | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 478                | 1.5                    | 0.0               | N/F<br>N/F   |

| Floor    | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|          |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|          |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Eleventh | R3   | W5         | Studio   | 100               | 100%                     | 276                | 1.5                    | 0.0               | N/F          |
| Eleventh | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 455                | 1.5                    | 1.8               | N/F          |
| Eleventh | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 445                | 1.5                    | 6.6               |              |
| Eleventh | R6   | W10        | Studio   | 100               | 100%                     | 270                | 1.5                    | 5.7               |              |
| Eleventh | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 372                | 1.5                    | 6.1               |              |
| Eleventh | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 402                | 1.5                    | 5.9               |              |
| Eleventh | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 515                | 1.5                    | 6.5               | N/F          |
| Eleventh | R10  | W17        | Studio   | 100               | 100%                     | 361                | 1.5                    | 1.9               | N/F          |
| Eleventh | R11  | W18        | Studio   | 100               | 100%                     | 352                | 1.5                    | 1.9               | N/F          |
| Eleventh | R12  | W19        | Studio   | 100               | 100%                     | 361                | 1.5                    | 1.9               | N/F          |
| Eleventh | R13  | W20        | Studio   | 100               | 100%                     | 353                | 1.5                    | 1.9               | N/F          |
| Eleventh | R14  | W21        | Studio   | 100               | 100%                     | 503                | 1.5                    | 1.9               | N/F          |

| Floor   | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|         |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|         |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|         |      | W22        |          |                   |                          |                    |                        |                   | N/F          |
| Twelfth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 423                | 1.5                    | 0.0               | N/F<br>N/F   |
| Twelfth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 483                | 1.5                    | 0.0               | N/F<br>N/F   |
| Twelfth | R3   | W5         | Studio   | 100               | 100%                     | 278                | 1.5                    | 0.0               | N/F          |
| Twelfth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 460                | 1.5                    | 2.0               | N/F          |
| Twelfth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 458                | 1.5                    | 6.9               |              |
| Twelfth | R6   | W10        | Studio   | 100               | 100%                     | 276                | 1.5                    | 5.7               |              |
| Twelfth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 378                | 1.5                    | 6.2               |              |
| Twelfth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 411                | 1.5                    | 5.9               |              |
| Twelfth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 525                | 1.5                    | 6.5               | N/F          |
| Twelfth | R10  | W17        | Studio   | 100               | 100%                     | 365                | 1.5                    | 1.9               | N/F          |

| Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Twelfth    | R11  | W18        | Studio   | 100               | 100%                     | 357                | 1.5                    | 1.9               | N/F          |
| Twelfth    | R12  | W19        | Studio   | 100               | 100%                     | 367                | 1.5                    | 1.9               | N/F          |
| Twelfth    | R13  | W20        | Studio   | 100               | 100%                     | 358                | 1.5                    | 1.9               | N/F          |
| Twelfth    | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 508                | 1.5                    | 1.9               | N/F<br>N/F   |
| Thirteenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 425                | 1.5                    | 0.0               | N/F<br>N/F   |
| Thirteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 478                | 1.5                    | 0.0               | N/F<br>N/F   |
| Thirteenth | R3   | W5         | Studio   | 100               | 100%                     | 278                | 1.5                    | 0.0               | N/F          |
| Thirteenth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 469                | 1.5                    | 2.3               | N/F          |
| Thirteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 471                | 1.5                    | 7.1               |              |
| Thirteenth | R6   | W10        | Studio   | 100               | 100%                     | 282                | 1.5                    | 5.7               |              |
| Thirteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 389                | 1.5                    | 6.2               |              |

| Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Thirteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 424                | 1.5                    | 5.9               |              |
| Thirteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 535                | 1.5                    | 6.5               | N/F          |
| Thirteenth | R10  | W17        | Studio   | 100               | 100%                     | 368                | 1.5                    | 1.9               | N/F          |
| Thirteenth | R11  | W18        | Studio   | 100               | 100%                     | 362                | 1.5                    | 1.9               | N/F          |
| Thirteenth | R12  | W19        | Studio   | 100               | 100%                     | 367                | 1.5                    | 1.9               | N/F          |
| Thirteenth | R13  | W20        | Studio   | 100               | 100%                     | 363                | 1.5                    | 1.9               | N/F          |
| Thirteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 511                | 1.5                    | 1.9               | N/F<br>N/F   |
| Fourteenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 424                | 1.5                    | 0.0               | N/F<br>N/F   |
| Fourteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 480                | 1.5                    | 0.0               | N/F<br>N/F   |
| Fourteenth | R3   | W5         | Studio   | 100               | 100%                     | 279                | 1.5                    | 0.0               | N/F          |
| Fourteenth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 474                | 1.5                    | 2.7               | N/F          |

| Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Fourteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 487                | 1.5                    | 7.3               |              |
| Fourteenth | R6   | W10        | Studio   | 100               | 100%                     | 289                | 1.5                    | 5.7               |              |
| Fourteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 401                | 1.5                    | 6.3               |              |
| Fourteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 434                | 1.5                    | 5.9               |              |
| Fourteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 541                | 1.5                    | 6.5               | N/F          |
| Fourteenth | R10  | W17        | Studio   | 100               | 100%                     | 371                | 1.5                    | 1.9               | N/F          |
| Fourteenth | R11  | W18        | Studio   | 100               | 100%                     | 366                | 1.5                    | 1.9               | N/F          |
| Fourteenth | R12  | W19        | Studio   | 100               | 100%                     | 372                | 1.5                    | 1.9               | N/F          |
| Fourteenth | R13  | W20        | Studio   | 100               | 100%                     | 367                | 1.5                    | 1.9               | N/F          |
| Fourteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 515                | 1.5                    | 1.9               | N/F<br>N/F   |
| Fifteenth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 425                | 1.5                    | 0.0               | N/F<br>N/F   |

| Floor     | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|           |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|           |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Fifteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 478                | 1.5                    | 0.0               | N/F<br>N/F   |
| Fifteenth | R3   | W5         | Studio   | 100               | 100%                     | 279                | 1.5                    | 0.0               | N/F          |
| Fifteenth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 479                | 1.5                    | 3.1               | N/F          |
| Fifteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 502                | 1.5                    | 7.5               |              |
| Fifteenth | R6   | W10        | Studio   | 100               | 100%                     | 296                | 1.5                    | 5.7               |              |
| Fifteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 410                | 1.5                    | 6.3               |              |
| Fifteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 444                | 1.5                    | 5.9               |              |
| Fifteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 552                | 1.5                    | 6.5               | N/F          |
| Fifteenth | R10  | W17        | Studio   | 100               | 100%                     | 375                | 1.5                    | 1.9               | N/F          |
| Fifteenth | R11  | W18        | Studio   | 100               | 100%                     | 369                | 1.5                    | 1.9               | N/F          |
| Fifteenth | R12  | W19        | Studio   | 100               | 100%                     | 374                | 1.5                    | 1.9               | N/F          |

| Floor     | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|           |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|           |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Fifteenth | R13  | W20        | Studio   | 100               | 100%                     | 370                | 1.5                    | 1.9               | N/F          |
| Fifteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 517                | 1.5                    | 1.9               | N/F<br>N/F   |
| Sixteenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 424                | 1.5                    | 0.0               | N/F<br>N/F   |
| Sixteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 479                | 1.5                    | 0.0               | N/F<br>N/F   |
| Sixteenth | R3   | W5         | Studio   | 100               | 100%                     | 277                | 1.5                    | 0.0               | N/F          |
| Sixteenth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 483                | 1.5                    | 3.2               | N/F          |
| Sixteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 509                | 1.5                    | 7.6               |              |
| Sixteenth | R6   | W10        | Studio   | 100               | 100%                     | 301                | 1.5                    | 5.7               |              |
| Sixteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 420                | 1.5                    | 6.3               |              |
| Sixteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 454                | 1.5                    | 5.9               |              |

| Floor       | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|             |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|             |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Sixteenth   | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 560                | 1.5                    | 6.5               | N/F          |
| Sixteenth   | R10  | W17        | Studio   | 100               | 100%                     | 377                | 1.5                    | 1.9               | N/F          |
| Sixteenth   | R11  | W18        | Studio   | 100               | 100%                     | 374                | 1.5                    | 1.9               | N/F          |
| Sixteenth   | R12  | W19        | Studio   | 100               | 100%                     | 376                | 1.5                    | 1.9               | N/F          |
| Sixteenth   | R13  | W20        | Studio   | 100               | 100%                     | 373                | 1.5                    | 1.9               | N/F          |
| Sixteenth   | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 519                | 1.5                    | 1.9               | N/F<br>N/F   |
| Seventeenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 422                | 1.5                    | 0.0               | N/F<br>N/F   |
| Seventeenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 477                | 1.5                    | 0.0               | N/F<br>N/F   |
| Seventeenth | R3   | W5         | Studio   | 100               | 100%                     | 277                | 1.5                    | 0.0               | N/F          |
| Seventeenth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 488                | 1.5                    | 3.2               | N/F          |
| Seventeenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 518                | 1.5                    | 7.7               |              |

| Floor       | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|             |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|             |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Seventeenth | R6   | W10        | Studio   | 100               | 100%                     | 308                | 1.5                    | 5.7               |              |
| Seventeenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 430                | 1.5                    | 6.3               |              |
| Seventeenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 461                | 1.5                    | 5.9               |              |
| Seventeenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 566                | 1.5                    | 6.5               | N/F          |
| Seventeenth | R10  | W17        | Studio   | 100               | 100%                     | 378                | 1.5                    | 1.9               | N/F          |
| Seventeenth | R11  | W18        | Studio   | 100               | 100%                     | 376                | 1.5                    | 1.9               | N/F          |
| Seventeenth | R12  | W19        | Studio   | 100               | 100%                     | 377                | 1.5                    | 1.9               | N/F          |
| Seventeenth | R13  | W20        | Studio   | 100               | 100%                     | 376                | 1.5                    | 1.9               | N/F          |
| Seventeenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 519                | 1.5                    | 1.9               | N/F<br>N/F   |
| Eighteenth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 424                | 1.5                    | 0.0               | N/F<br>N/F   |
| Eighteenth  | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 478                | 1.5                    | 0.0               | N/F<br>N/F   |

| Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Eighteenth | R3   | W5         | Studio   | 100               | 100%                     | 275                | 1.5                    | 0.0               | N/F          |
| Eighteenth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 489                | 1.5                    | 3.2               | N/F          |
| Eighteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 524                | 1.5                    | 8.1               |              |
| Eighteenth | R6   | W10        | Studio   | 100               | 100%                     | 311                | 1.5                    | 5.7               |              |
| Eighteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 438                | 1.5                    | 6.3               |              |
| Eighteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 470                | 1.5                    | 5.9               |              |
| Eighteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 573                | 1.5                    | 6.5               | N/F          |
| Eighteenth | R10  | W17        | Studio   | 100               | 100%                     | 378                | 1.5                    | 1.9               | N/F          |
| Eighteenth | R11  | W18        | Studio   | 100               | 100%                     | 374                | 1.5                    | 1.9               | N/F          |
| Eighteenth | R12  | W19        | Studio   | 100               | 100%                     | 378                | 1.5                    | 1.9               | N/F          |
| Eighteenth | R13  | W20        | Studio   | 100               | 100%                     | 376                | 1.5                    | 1.9               | N/F          |
| Eighteenth | R14  | W21        | Studio   | 100               | 100%                     | 519                | 1.5                    | 1.9               | N/F          |

| Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|            |      | W22        |          |                   |                          |                    |                        |                   | N/F          |
| Nineteenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 424                | 1.5                    | 0.0               | N/F<br>N/F   |
| Nineteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 474                | 1.5                    | 0.0               | N/F<br>N/F   |
| Nineteenth | R3   | W5         | Studio   | 100               | 100%                     | 277                | 1.5                    | 0.0               | N/F          |
| Nineteenth | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 494                | 1.5                    | 3.2               | N/F          |
| Nineteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 533                | 1.5                    | 8.1               |              |
| Nineteenth | R6   | W10        | Studio   | 100               | 100%                     | 317                | 1.5                    | 5.7               |              |
| Nineteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 448                | 1.5                    | 6.3               |              |
| Nineteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 477                | 1.5                    | 5.9               |              |
| Nineteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 576                | 1.5                    | 6.5               | N/F          |
| Nineteenth | R10  | W17        | Studio   | 100               | 100%                     | 379                | 1.5                    | 1.9               | N/F          |

| Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Nineteenth | R11  | W18        | Studio   | 100               | 100%                     | 375                | 1.5                    | 1.9               | N/F          |
| Nineteenth | R12  | W19        | Studio   | 100               | 100%                     | 378                | 1.5                    | 1.9               | N/F          |
| Nineteenth | R13  | W20        | Studio   | 100               | 100%                     | 378                | 1.5                    | 1.9               | N/F          |
| Nineteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 520                | 1.5                    | 1.9               | N/F<br>N/F   |
| Twentieth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 422                | 1.5                    | 0.0               | N/F<br>N/F   |
| Twentieth  | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 473                | 1.5                    | 0.0               | N/F<br>N/F   |
| Twentieth  | R3   | W5         | Studio   | 100               | 100%                     | 275                | 1.5                    | 0.0               | N/F          |
| Twentieth  | R4   | W6<br>W7   | Studio   | 100               | 100%                     | 500                | 1.5                    | 3.2               | N/F          |
| Twentieth  | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 538                | 1.5                    | 8.1               |              |
| Twentieth  | R6   | W10        | Studio   | 100               | 100%                     | 320                | 1.5                    | 5.7               |              |
| Twentieth  | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 453                | 1.5                    | 6.3               |              |

| Floor     | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|-----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|           |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|           |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Twentieth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 485                | 1.5                    | 5.9               |              |
| Twentieth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 580                | 1.5                    | 6.5               | N/F          |
| Twentieth | R10  | W17        | Studio   | 100               | 100%                     | 381                | 1.5                    | 1.9               | N/F          |
| Twentieth | R11  | W18        | Studio   | 100               | 100%                     | 377                | 1.5                    | 1.9               | N/F          |
| Twentieth | R12  | W19        | Studio   | 100               | 100%                     | 381                | 1.5                    | 1.9               | N/F          |
| Twentieth | R13  | W20        | Studio   | 100               | 100%                     | 378                | 1.5                    | 1.9               | N/F          |
| Twentieth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 521                | 1.5                    | 1.9               | N/F<br>N/F   |



## Appendix 3

Detailed results of the daylight and sunlight assessments  
within the C3 Affordable Block (BRE 2022)

| Building Name | Unit No. | Floor  | Room | Window         | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3            | Flat1    | Ground | R1   | W1<br>W2       | LKD      | 150               | 67%                      | 265                | 1.5                    | 2.5               | N/F          |
|               |          |        | R2   | W3<br>W4       | Bedroom  | 100               | 100%                     | 179                | 1.5                    | 0.4               | N/F          |
|               |          |        | R3   | W5             | Bedroom  | 100               | 100%                     | 327                | 1.5                    | 1.0               | N/F          |
|               | Flat1    | First  | R1   | W1             | Bedroom  | 100               | 29%                      | 67                 | 1.5                    | 1.9               |              |
|               |          |        | R2   | W2             | Bedroom  | 100               | 45%                      | 89                 | 1.5                    | 2.3               |              |
|               |          |        | R3   | W3<br>W4<br>W5 | LKD      | 150               | 39%                      | 132                | 1.5                    | 3.3               | N/F          |
|               | Flat2    | First  | R4   | W6<br>W7       | LKD      | 150               | 99%                      | 312                | 1.5                    | 4.0               | N/F          |
|               |          |        | R5   | W8<br>W9       | Bedroom  | 100               | 100%                     | 322                | 1.5                    | 2.8               | N/F          |
|               |          |        | R6   | W10            | Bedroom  | 100               | 100%                     | 274                | 1.5                    | 2.6               | N/F          |
|               | Flat3    | First  | R7   | W11            | Bedroom  | 100               | 100%                     | 161                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13     | LKD      | 150               | 51%                      | 157                | 1.5                    | 2.5               | N/F          |
|               | Flat4    | First  | R9   | W14<br>W15     | LKD      | 150               | 69%                      | 236                | 1.5                    | 0.1               | N/F<br>N/F   |
|               |          |        | R10  | W16            | Bedroom  | 100               | 32%                      | 75                 | 1.5                    | 0.0               |              |
|               |          |        | R11  | W17            | Bedroom  | 100               | 11%                      | 36                 | 1.5                    | 0.0               |              |
|               | Flat5    | First  | R12  | W18            | Bedroom  | 100               | 0%                       | 8                  | 1.5                    | 0.0               | N/F          |
|               |          |        | R13  | W19            | Bedroom  | 100               | 34%                      | 73                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        | R14  | W20               | LKD      | 150               | 2%                       | 27                 | 1.5                    | 0.8               |              |
|               | Flat6    | First  | R15  | W21<br>W22        | LKD      | 150               | 19%                      | 36                 | 1.5                    | 1.9               |              |
|               |          |        | R16  | W23               | Bedroom  | 100               | 22%                      | 64                 | 1.5                    | 0.8               |              |
|               | Flat7    | First  | R17  | W24               | Bedroom  | 100               | 52%                      | 101                | 1.5                    | 0.5               |              |
|               |          |        | R18  | W25<br>W26        | Bedroom  | 100               | 63%                      | 128                | 1.5                    | 0.2               |              |
|               |          |        | R19  | W27<br>W28        | LKD      | 150               | 14%                      | 99                 | 1.5                    | 0.9               |              |
|               | Flat8    | First  | R20  | W29<br>W30<br>W31 | LKD      | 150               | 6%                       | 62                 | 1.5                    | 0.0               |              |
|               |          |        | R21  | W32               | Bedroom  | 100               | 28%                      | 75                 | 1.5                    | 0.0               |              |
|               |          |        | R22  | W33               | Bedroom  | 100               | 21%                      | 66                 | 1.5                    | 0.0               |              |
|               | Flat1    | Second | R1   | W1                | Bedroom  | 100               | 38%                      | 79                 | 1.5                    | 0.5               |              |
|               |          |        | R2   | W2                | Bedroom  | 100               | 54%                      | 104                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5    | LKD      | 150               | 52%                      | 154                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Second | R4   | W6<br>W7          | LKD      | 150               | 100%                     | 335                | 1.5                    | 1.5               | N/F          |
|               |          |        | R5   | W8<br>W9          | Bedroom  | 100               | 100%                     | 357                | 1.5                    | 1.0               | N/F          |
|               |          |        | R6   | W10               | Bedroom  | 100               | 100%                     | 294                | 1.5                    | 0.6               | N/F          |
|               | Flat3    | Second | R7   | W11               | Bedroom  | 100               | 100%                     | 164                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat4    | Second | R8   | W12<br>W13 | LKD      | 150               | 50%                      | 148                | 1.5                    | 0.7               | N/F          |
|               |          |        | R9   | W14<br>W15 | LKD      | 150               | 72%                      | 255                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |        | R10  | W16        | Bedroom  | 100               | 44%                      | 90                 | 1.5                    | 0.3               |              |
|               | Flat5    | Second | R11  | W17        | Bedroom  | 100               | 14%                      | 44                 | 1.5                    | 0.0               |              |
|               |          |        | R12  | W18        | Bedroom  | 100               | 64%                      | 142                | 1.5                    | 0.0               | N/F          |
|               |          |        | R13  | W19        | Bedroom  | 100               | 82%                      | 112                | 1.5                    | 0.0               | N/F          |
|               | Flat6    | Second | R14  | W20        | Bedroom  | 100               | 9%                       | 51                 | 1.5                    | 0.3               |              |
|               |          |        | R15  | W21        | LKD      | 150               | 1%                       | 48                 | 1.5                    | 0.0               |              |
|               |          |        | R16  | W22        | Bedroom  | 100               | 45%                      | 93                 | 1.5                    | 0.0               | N/F          |
|               | Flat7    | Second | R17  | W23        | Bedroom  | 100               | 15%                      | 54                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R18  | W24        | LKD      | 150               | 4%                       | 51                 | 1.5                    | 0.4               |              |
|               |          |        | R19  | W25        | Bedroom  | 100               | 21%                      | 66                 | 1.5                    | 0.0               |              |
|               | Flat8    | Second | R20  | W26        | Bedroom  | 100               | 3%                       | 32                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R21  | W27        | Bedroom  | 100               | 0%                       | 34                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R22  | W28        | Bedroom  | 100               | 7%                       | 53                 | 1.5                    | 0.2               |              |
|               | Flat9    | Second | R23  | W29        | LKD      | 150               | 6%                       | 61                 | 1.5                    | 0.0               |              |
|               |          |        | R24  | W30        | Bedroom  | 100               | 0%                       | 24                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R25  | W31        | LKD      | 150               | 3%                       | 60                 | 1.5                    | 0.3               |              |
|               |          |        | R26  | W32        | Bedroom  | 100               | 0%                       | 23                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Flat10        | Second   |       | R27  | W33        | LKD         | 150               | 4%                       | 67                 | 1.5                    | 0.3               |              |
|               |          |       | R28  | W34        | Bedroom     | 100               | 16%                      | 58                 | 1.5                    | 0.0               |              |
|               |          |       | R29  | W35        | Bedroom     | 100               | 0%                       | 42                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R30  | W36        | Bedroom     | 100               | 2%                       | 33                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R31  | W37        | LKD         | 150               | 3%                       | 48                 | 1.5                    | 0.3               |              |
| Flat11        | Second   |       | R32  | W38        | Bedroom     | 100               | 6%                       | 40                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R33  | W39        | Bedroom     | 100               | 13%                      | 54                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R34  | W40        | LKD         | 150               | 3%                       | 50                 | 1.5                    | 0.3               |              |
| Flat12        | Second   |       | R35  | W41        | Bedroom     | 100               | 0%                       | 30                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R36  | W42        | Bedroom     | 100               | 5%                       | 43                 | 1.5                    | 0.3               |              |
|               |          |       | R37  | W43        | LKD         | 150               | 8%                       | 82                 | 1.5                    | 0.3               |              |
| Flat13        | Second   |       | R38  | W44        | Bedroom     | 100               | 0%                       | 26                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R39  | W45        | Kitchen     | 200               | 0%                       | 33                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R40  | W46        | Bedroom     | 100               | 10%                      | 53                 | 1.5                    | 0.0               |              |
| Flat14        | Second   |       | R41  | W47        | Living Room | 150               | 5%                       | 77                 | 1.5                    | 0.0               |              |
|               |          |       | R42  | W48        | Bedroom     | 100               | 3%                       | 30                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R43  | W49        | Bedroom     | 100               | 45%                      | 95                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R44  | W50        | LKD         | 150               | 21%                      | 68                 | 1.5                    | 1.5               |              |
| Flat15        | Second   |       | R45  | W51<br>W52 | LKD         | 150               | 29%                      | 78                 | 1.5                    | 3.1               |              |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat16   | Second | R46  | W53               | Bedroom  | 100               | 100%                     | 151                | 1.5                    | 1.5               |              |
|               |          |        | R47  | W54               | Bedroom  | 100               | 99%                      | 162                | 1.5                    | 2.7               |              |
|               |          |        | R48  | W55<br>W56        | Bedroom  | 100               | 100%                     | 208                | 1.5                    | 1.8               |              |
|               | Flat17   | Second | R49  | W57<br>W58        | LKD      | 150               | 58%                      | 166                | 1.5                    | 1.0               |              |
|               |          |        | R50  | W59<br>W60<br>W61 | LKD      | 150               | 9%                       | 80                 | 1.5                    | 0.0               |              |
|               |          |        | R51  | W62               | Bedroom  | 100               | 41%                      | 93                 | 1.5                    | 0.0               |              |
|               | Flat1    | Third  | R52  | W63               | Bedroom  | 100               | 32%                      | 76                 | 1.5                    | 0.0               |              |
|               |          |        | R1   | W1                | Bedroom  | 100               | 43%                      | 87                 | 1.5                    | 0.6               |              |
|               |          |        | R2   | W2                | Bedroom  | 100               | 64%                      | 113                | 1.5                    | 0.9               |              |
|               | Flat2    | Third  | R3   | W3<br>W4<br>W5    | LKD      | 150               | 53%                      | 164                | 1.5                    | 2.0               | N/F          |
|               |          |        | R4   | W6<br>W7          | LKD      | 150               | 98%                      | 325                | 1.5                    | 1.5               | N/F          |
|               |          |        | R5   | W8<br>W9          | Bedroom  | 100               | 100%                     | 360                | 1.5                    | 1.0               | N/F          |
|               | Flat3    | Third  | R6   | W10               | Bedroom  | 100               | 100%                     | 300                | 1.5                    | 0.6               | N/F          |
|               |          |        | R7   | W11               | Bedroom  | 100               | 100%                     | 159                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13        | LKD      | 150               | 50%                      | 149                | 1.5                    | 0.7               | N/F          |
|               | Flat4    | Third  | R9   | W14               | LKD      | 150               | 69%                      | 243                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |       |      | W15    |          |                   |                          |                    |                        |                   | N/F          |
|               |          |       | R10  | W16    | Bedroom  | 100               | 58%                      | 110                | 1.5                    | 0.7               |              |
|               |          |       | R11  | W17    | Bedroom  | 100               | 19%                      | 52                 | 1.5                    | 0.1               |              |
|               | Flat5    | Third | R12  | W18    | Bedroom  | 100               | 73%                      | 154                | 1.5                    | 0.0               | N/F          |
|               |          |       | R13  | W19    | Bedroom  | 100               | 86%                      | 115                | 1.5                    | 0.0               | N/F          |
|               |          |       | R14  | W20    | Bedroom  | 100               | 37%                      | 87                 | 1.5                    | 0.3               |              |
|               |          |       | R15  | W21    | LKD      | 150               | 4%                       | 53                 | 1.5                    | 0.0               |              |
|               | Flat6    | Third | R16  | W22    | Bedroom  | 100               | 49%                      | 98                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R17  | W23    | Bedroom  | 100               | 27%                      | 73                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R18  | W24    | LKD      | 150               | 18%                      | 89                 | 1.5                    | 0.4               |              |
|               |          |       | R19  | W25    | Bedroom  | 100               | 21%                      | 66                 | 1.5                    | 0.0               |              |
|               | Flat7    | Third | R20  | W26    | Bedroom  | 100               | 6%                       | 39                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R21  | W27    | Bedroom  | 100               | 0%                       | 43                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R22  | W28    | Bedroom  | 100               | 47%                      | 98                 | 1.5                    | 0.2               |              |
|               |          |       | R23  | W29    | LKD      | 150               | 12%                      | 70                 | 1.5                    | 0.0               |              |
|               | Flat8    | Third | R24  | W30    | Bedroom  | 100               | 0%                       | 30                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R25  | W31    | LKD      | 150               | 14%                      | 93                 | 1.5                    | 0.5               |              |
|               | Flat9    | Third | R26  | W32    | Bedroom  | 100               | 0%                       | 30                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R27  | W33    | LKD      | 150               | 26%                      | 116                | 1.5                    | 1.1               |              |
|               |          |       | R28  | W34    | Bedroom  | 100               | 16%                      | 57                 | 1.5                    | 0.4               |              |

| Building Name | Unit No. | Floor | Room | Window     | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat10   | Third | R29  | W35        | Bedroom     | 100               | 6%                       | 53                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R30  | W36        | Bedroom     | 100               | 10%                      | 43                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R31  | W37        | LKD         | 150               | 11%                      | 71                 | 1.5                    | 1.1               |              |
|               | Flat11   | Third | R32  | W38        | Bedroom     | 100               | 16%                      | 49                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R33  | W39        | Bedroom     | 100               | 24%                      | 66                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R34  | W40        | LKD         | 150               | 11%                      | 71                 | 1.5                    | 1.1               |              |
|               | Flat12   | Third | R35  | W41        | Bedroom     | 100               | 8%                       | 37                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R36  | W42        | Bedroom     | 100               | 38%                      | 84                 | 1.5                    | 2.2               |              |
|               |          |       | R37  | W43        | LKD         | 150               | 16%                      | 95                 | 1.5                    | 1.0               |              |
|               | Flat13   | Third | R38  | W44        | Bedroom     | 100               | 4%                       | 32                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R39  | W45        | Kitchen     | 200               | 0%                       | 40                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R40  | W46        | Bedroom     | 100               | 33%                      | 77                 | 1.5                    | 1.8               |              |
|               |          |       | R41  | W47        | Living Room | 150               | 11%                      | 85                 | 1.5                    | 0.2               |              |
|               | Flat14   | Third | R42  | W48        | Bedroom     | 100               | 5%                       | 36                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R43  | W49        | Bedroom     | 100               | 58%                      | 119                | 1.5                    | 0.0               | N/F          |
|               |          |       | R44  | W50        | LKD         | 150               | 25%                      | 83                 | 1.5                    | 1.5               |              |
|               | Flat15   | Third | R45  | W51<br>W52 | LKD         | 150               | 32%                      | 97                 | 1.5                    | 3.1               |              |
|               |          |       | R46  | W53        | Bedroom     | 100               | 100%                     | 179                | 1.5                    | 1.5               |              |
|               | Flat16   | Third | R47  | W54        | Bedroom     | 100               | 100%                     | 197                | 1.5                    | 2.7               |              |
|               |          |       | R48  | W55        | Bedroom     | 100               | 100%                     | 247                | 1.5                    | 2.5               |              |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        |      | W56               |          |                   |                          |                    |                        |                   |              |
|               |          |        | R49  | W57<br>W58        | LKD      | 150               | 74%                      | 208                | 1.5                    | 1.9               |              |
|               | Flat17   | Third  | R50  | W59<br>W60<br>W61 | LKD      | 150               | 15%                      | 79                 | 1.5                    | 0.3               |              |
|               |          |        | R51  | W62               | Bedroom  | 100               | 64%                      | 112                | 1.5                    | 0.5               |              |
|               |          |        | R52  | W63               | Bedroom  | 100               | 45%                      | 92                 | 1.5                    | 1.1               |              |
|               | Flat1    | Fourth | R1   | W1                | Bedroom  | 100               | 48%                      | 94                 | 1.5                    | 0.6               |              |
|               |          |        | R2   | W2                | Bedroom  | 100               | 73%                      | 123                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5    | LKD      | 150               | 54%                      | 177                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Fourth | R4   | W6<br>W7          | LKD      | 150               | 99%                      | 331                | 1.5                    | 1.5               | N/F          |
|               |          |        | R5   | W8<br>W9          | Bedroom  | 100               | 100%                     | 364                | 1.5                    | 1.0               | N/F          |
|               |          |        | R6   | W10               | Bedroom  | 100               | 100%                     | 303                | 1.5                    | 0.6               | N/F          |
|               | Flat3    | Fourth | R7   | W11               | Bedroom  | 100               | 100%                     | 160                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13        | LKD      | 150               | 53%                      | 154                | 1.5                    | 0.9               | N/F          |
|               | Flat4    | Fourth | R9   | W14<br>W15        | LKD      | 150               | 71%                      | 247                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |        | R10  | W16               | Bedroom  | 100               | 90%                      | 146                | 1.5                    | 1.4               |              |
|               |          |        | R11  | W17               | Bedroom  | 100               | 29%                      | 67                 | 1.5                    | 0.2               |              |

| Building Name | Unit No. | Floor  | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat5    | Fourth | R12  | W18    | Bedroom  | 100               | 84%                      | 167                | 1.5                    | 0.0               | N/F          |
|               |          |        | R13  | W19    | Bedroom  | 100               | 90%                      | 119                | 1.5                    | 0.0               | N/F          |
|               |          |        | R14  | W20    | Bedroom  | 100               | 27%                      | 76                 | 1.5                    | 0.3               |              |
|               |          |        | R15  | W21    | LKD      | 150               | 10%                      | 74                 | 1.5                    | 0.0               |              |
|               | Flat6    | Fourth | R16  | W22    | Bedroom  | 100               | 59%                      | 109                | 1.5                    | 0.0               | N/F          |
|               |          |        | R17  | W23    | Bedroom  | 100               | 36%                      | 80                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R18  | W24    | LKD      | 150               | 20%                      | 83                 | 1.5                    | 0.4               |              |
|               |          |        | R19  | W25    | Bedroom  | 100               | 62%                      | 110                | 1.5                    | 0.0               |              |
|               | Flat7    | Fourth | R20  | W26    | Bedroom  | 100               | 11%                      | 48                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R21  | W27    | Bedroom  | 100               | 8%                       | 57                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R22  | W28    | Bedroom  | 100               | 48%                      | 97                 | 1.5                    | 0.2               |              |
|               |          |        | R23  | W29    | LKD      | 150               | 30%                      | 103                | 1.5                    | 0.0               |              |
|               | Flat8    | Fourth | R24  | W30    | Bedroom  | 100               | 2%                       | 42                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R25  | W31    | LKD      | 150               | 29%                      | 105                | 1.5                    | 0.5               |              |
|               | Flat9    | Fourth | R26  | W32    | Bedroom  | 100               | 4%                       | 39                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R27  | W33    | LKD      | 150               | 35%                      | 121                | 1.5                    | 1.1               |              |
|               |          |        | R28  | W34    | Bedroom  | 100               | 52%                      | 103                | 1.5                    | 0.5               |              |
|               | Flat10   | Fourth | R29  | W35    | Bedroom  | 100               | 17%                      | 67                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R30  | W36    | Bedroom  | 100               | 17%                      | 57                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R31  | W37    | LKD      | 150               | 26%                      | 88                 | 1.5                    | 1.4               |              |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat11   | Fourth | R32  | W38        | Bedroom     | 100               | 23%                      | 61                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R33  | W39        | Bedroom     | 100               | 37%                      | 87                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R34  | W40        | LKD         | 150               | 27%                      | 89                 | 1.5                    | 1.7               |              |
|               | Flat12   | Fourth | R35  | W41        | Bedroom     | 100               | 17%                      | 47                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R36  | W42        | Bedroom     | 100               | 35%                      | 74                 | 1.5                    | 2.2               |              |
|               |          |        | R37  | W43        | LKD         | 150               | 45%                      | 141                | 1.5                    | 2.0               |              |
|               | Flat13   | Fourth | R38  | W44        | Bedroom     | 100               | 11%                      | 42                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R39  | W45        | Kitchen     | 200               | 0%                       | 52                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R40  | W46        | Bedroom     | 100               | 49%                      | 99                 | 1.5                    | 2.6               |              |
|               |          |        | R41  | W47        | Living Room | 150               | 46%                      | 142                | 1.5                    | 2.0               |              |
|               | Flat14   | Fourth | R42  | W48        | Bedroom     | 100               | 12%                      | 47                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R43  | W49        | Bedroom     | 100               | 84%                      | 151                | 1.5                    | 0.0               | N/F          |
|               |          |        | R44  | W50        | LKD         | 150               | 27%                      | 92                 | 1.5                    | 1.5               |              |
|               | Flat15   | Fourth | R45  | W51<br>W52 | LKD         | 150               | 35%                      | 104                | 1.5                    | 3.1               |              |
|               |          |        | R46  | W53        | Bedroom     | 100               | 100%                     | 192                | 1.5                    | 1.5               |              |
|               | Flat16   | Fourth | R47  | W54        | Bedroom     | 100               | 100%                     | 216                | 1.5                    | 2.7               |              |
|               |          |        | R48  | W55<br>W56 | Bedroom     | 100               | 100%                     | 269                | 1.5                    | 2.5               |              |
|               |          |        | R49  | W57<br>W58 | LKD         | 150               | 73%                      | 211                | 1.5                    | 3.9               |              |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat17   | Fourth | R50  | W59<br>W60<br>W61 | LKD      | 150               | 22%                      | 95                 | 1.5                    | 4.0               |              |
|               |          |        | R51  | W62               | Bedroom  | 100               | 100%                     | 139                | 1.5                    | 4.1               |              |
|               |          |        | R52  | W63               | Bedroom  | 100               | 63%                      | 119                | 1.5                    | 4.2               |              |
|               | Flat1    | Fifth  | R1   | W1                | Bedroom  | 100               | 52%                      | 101                | 1.5                    | 0.6               |              |
|               |          |        | R2   | W2                | Bedroom  | 100               | 77%                      | 132                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5    | LKD      | 150               | 54%                      | 181                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Fifth  | R4   | W6<br>W7          | LKD      | 150               | 100%                     | 550                | 1.5                    | 1.8               | N/F          |
|               |          |        | R5   | W8<br>W9          | Bedroom  | 100               | 100%                     | 458                | 1.5                    | 2.9               | N/F          |
|               |          |        | R6   | W10               | Bedroom  | 100               | 100%                     | 308                | 1.5                    | 0.8               | N/F          |
|               | Flat3    | Fifth  | R7   | W11               | Bedroom  | 100               | 100%                     | 286                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13        | LKD      | 150               | 54%                      | 171                | 1.5                    | 1.6               | N/F          |
|               | Flat4    | Fifth  | R9   | W14<br>W15        | LKD      | 150               | 100%                     | 373                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |        | R10  | W16               | Bedroom  | 100               | 100%                     | 191                | 1.5                    | 3.4               |              |
|               |          |        | R11  | W17               | Bedroom  | 100               | 47%                      | 96                 | 1.5                    | 1.1               |              |
|               | Flat5    | Fifth  | R12  | W18               | Bedroom  | 100               | 100%                     | 353                | 1.5                    | 0.0               | N/F          |
|               |          |        | R13  | W19<br>W80        | Bedroom  | 100               | 100%                     | 686                | 1.5                    | 5.6               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat6    | Fifth | R14  | W20        | Bedroom  | 100               | 67%                      | 115                | 1.5                    | 0.3               |              |
|               |          |       | R15  | W21<br>W81 | LKD      | 150               | 48%                      | 142                | 1.5                    | 3.9               |              |
|               |          |       | R16  | W22<br>W79 | Bedroom  | 100               | 100%                     | 819                | 1.5                    | 5.9               | N/F          |
|               |          |       | R17  | W23<br>W85 | Bedroom  | 100               | 100%                     | 682                | 1.5                    | 5.9               | N/F          |
|               |          |       | R18  | W24<br>W78 | LKD      | 150               | 100%                     | 299                | 1.5                    | 5.5               |              |
|               | Flat7    | Fifth | R19  | W25        | Bedroom  | 100               | 52%                      | 101                | 1.5                    | 0.0               |              |
|               |          |       | R20  | W26<br>W77 | Bedroom  | 100               | 100%                     | 649                | 1.5                    | 5.7               | N/F          |
|               |          |       | R21  | W27<br>W76 | Bedroom  | 100               | 100%                     | 749                | 1.5                    | 5.7               | N/F          |
|               |          |       | R22  | W28        | Bedroom  | 100               | 100%                     | 174                | 1.5                    | 0.0               |              |
|               | Flat8    | Fifth | R23  | W29<br>W84 | LKD      | 150               | 100%                     | 281                | 1.5                    | 5.2               |              |
|               |          |       | R24  | W30<br>W75 | Bedroom  | 100               | 100%                     | 634                | 1.5                    | 5.7               | N/F          |
|               |          |       | R25  | W31        | LKD      | 150               | 51%                      | 153                | 1.5                    | 0.3               |              |
|               | Flat9    | Fifth | R26  | W32<br>W74 | Bedroom  | 100               | 100%                     | 613                | 1.5                    | 5.7               | N/F          |
|               |          |       | R27  | W33<br>W73 | LKD      | 150               | 100%                     | 535                | 1.5                    | 5.4               |              |
|               |          |       | R28  | W34        | Bedroom  | 100               | 44%                      | 90                 | 1.5                    | 0.0               |              |

| Building Name | Unit No. | Floor | Room | Window     | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat10   | Fifth | R29  | W35<br>W72 | Bedroom     | 100               | 100%                     | 853                | 1.5                    | 5.5               | N/F          |
|               |          |       | R30  | W36<br>W70 | Bedroom     | 100               | 100%                     | 741                | 1.5                    | 5.6               | N/F          |
|               |          |       | R31  | W37<br>W71 | LKD         | 150               | 100%                     | 279                | 1.5                    | 5.5               |              |
|               | Flat11   | Fifth | R32  | W38<br>W68 | Bedroom     | 100               | 100%                     | 745                | 1.5                    | 5.8               | N/F          |
|               |          |       | R33  | W39<br>W67 | Bedroom     | 100               | 100%                     | 889                | 1.5                    | 5.9               | N/F          |
|               |          |       | R34  | W40<br>W69 | LKD         | 150               | 100%                     | 276                | 1.5                    | 5.5               |              |
|               | Flat12   | Fifth | R35  | W41<br>W65 | Bedroom     | 100               | 100%                     | 668                | 1.5                    | 5.7               | N/F          |
|               |          |       | R36  | W42        | Bedroom     | 100               | 73%                      | 138                | 1.5                    | 1.9               |              |
|               |          |       | R37  | W43<br>W66 | LKD         | 150               | 100%                     | 455                | 1.5                    | 5.8               |              |
|               | Flat13   | Fifth | R38  | W44<br>W83 | Bedroom     | 100               | 100%                     | 662                | 1.5                    | 5.5               | N/F          |
|               |          |       | R39  | W45<br>W82 | Kitchen     | 200               | 100%                     | 703                | 1.5                    | 3.1               | N/F          |
|               |          |       | R40  | W46        | Bedroom     | 100               | 71%                      | 133                | 1.5                    | 2.3               |              |
|               |          |       | R41  | W47        | Living Room | 150               | 46%                      | 142                | 1.5                    | 0.4               |              |
|               | Flat14   | Fifth | R42  | W48        | Bedroom     | 100               | 100%                     | 187                | 1.5                    | 0.0               | N/F          |
|               |          |       | R43  | W49        | Bedroom     | 100               | 100%                     | 201                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP10       | Flat15   | Fifth  | R44  | W50               | LKD         | 150               | 59%                      | 183                | 1.5                    | 2.1               |              |
|               |          |        | R45  | W51<br>W52        | LKD         | 150               | 42%                      | 124                | 1.5                    | 3.3               |              |
|               |          |        | R46  | W53               | Bedroom     | 100               | 100%                     | 414                | 1.5                    | 2.1               |              |
|               | Flat16   | Fifth  | R47  | W54               | Bedroom     | 100               | 100%                     | 231                | 1.5                    | 2.7               |              |
|               |          |        | R48  | W55<br>W56        | Bedroom     | 100               | 100%                     | 348                | 1.5                    | 3.4               |              |
|               |          |        | R49  | W57<br>W58        | LKD         | 150               | 100%                     | 397                | 1.5                    | 4.6               |              |
|               | Flat17   | Fifth  | R50  | W59<br>W60<br>W61 | LKD         | 150               | 45%                      | 142                | 1.5                    | 4.0               |              |
|               |          |        | R51  | W62               | Bedroom     | 100               | 100%                     | 176                | 1.5                    | 4.1               |              |
|               |          |        | R52  | W63               | Bedroom     | 100               | 95%                      | 153                | 1.5                    | 4.2               |              |
|               |          |        | R1   | W2<br>W1          | Kitchen     | 200               | 10%                      | 62                 | 1.5                    | 0.4               |              |
|               |          | Ground | R2   | W3                | Living Room | 150               | 48%                      | 147                | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1                | Bedroom     | 100               | 45%                      | 94                 | 1.5                    | 0.1               |              |
|               |          | First  | R2   | W2                | Bedroom     | 100               | 6%                       | 26                 | 1.5                    | 0.0               |              |
|               |          |        | R3   | W3                | Bedroom     | 100               | 15%                      | 48                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4                | Bedroom     | 100               | 33%                      | 72                 | 1.5                    | 0.0               | N/F          |
| C3 DP01       |          | Ground | R1   | W2<br>W3<br>W1    | Kitchen     | 200               | 9%                       | 80                 | 1.5                    | 0.0               | N/F          |

|               |          |         |          |             |             | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |     |
|---------------|----------|---------|----------|-------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|-----|
| Building Name | Unit No. | Floor   | Room     | Window      | Room Use    | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |     |
|               |          |         |          |             |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |     |
| C3 DP02       |          | First   | R2       | W4          | Living Room | 150               | 9%                       | 61                 | 1.5                    | 0.0               | N/F          |     |
|               |          |         | R1       | W1          | Bedroom     | 100               | 21%                      | 52                 | 1.5                    | 0.0               |              |     |
|               |          |         | R2       | W2<br>W3    | Bedroom     | 100               | 24%                      | 62                 | 1.5                    | 0.0               |              |     |
|               |          |         | R3       | W4          | Bedroom     | 100               | 7%                       | 24                 | 1.5                    | 0.0               | N/F          |     |
|               |          |         | R4       | W5<br>W6    | Bedroom     | 100               | 12%                      | 40                 | 1.5                    | 0.0               | N/F<br>N/F   |     |
|               |          | Ground  | R1       | W2<br>W1    | Kitchen     | 200               | 8%                       | 62                 | 1.5                    | 0.0               |              |     |
|               |          |         | R2       | W3          | Living Room | 150               | 13%                      | 62                 | 1.5                    | 0.0               | N/F          |     |
|               |          |         | First    | R1          | W1          | Bedroom           | 100                      | 45%                | 93                     | 1.5               | 0.0          |     |
|               |          |         |          | R2          | W2          | Bedroom           | 100                      | 7%                 | 27                     | 1.5               | 0.0          |     |
|               |          |         |          | R3          | W3          | Bedroom           | 100                      | 7%                 | 16                     | 1.5               | 0.0          | N/F |
| R4            | W4       | Bedroom |          | 100         | 11%         | 33                | 1.5                      | 0.0                | N/F                    |                   |              |     |
| C3 DP03       | Ground   | R1      | W1<br>W2 | Kitchen     | 200         | 8%                | 61                       | 1.5                | 0.0                    |                   |              |     |
|               |          | R2      | W3       | Living Room | 150         | 16%               | 69                       | 1.5                | 0.0                    | N/F               |              |     |
|               |          | First   | R1       | W1          | Bedroom     | 100               | 10%                      | 27                 | 1.5                    | 0.0               |              |     |
|               |          |         | R2       | W2          | Bedroom     | 100               | 45%                      | 97                 | 1.5                    | 0.0               |              |     |
|               |          |         | R3       | W3          | Bedroom     | 100               | 14%                      | 38                 | 1.5                    | 0.0               | N/F          |     |
| R4            | W4       |         | Bedroom  | 100         | 7%          | 17                | 1.5                      | 0.0                | N/F                    |                   |              |     |
| C3 DP04       |          | Ground  | R1       | W2          | Kitchen     | 200               | 8%                       | 63                 | 1.5                    | 0.0               |              |     |

|               |          |         |         |         |             | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |     |     |     |
|---------------|----------|---------|---------|---------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|-----|-----|-----|
| Building Name | Unit No. | Floor   | Room    | Window  | Room Use    | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |     |     |     |
|               |          |         |         |         |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |     |     |     |
| C3 DP05       |          | First   | R2      | W1      | Living Room | 150               | 14%                      | 62                 | 1.5                    | 0.0               | N/F          |     |     |     |
|               |          |         |         | W3      |             |                   |                          |                    |                        |                   |              |     |     |     |
|               |          |         | R1      | W1      | Bedroom     | 100               | 45%                      | 93                 | 1.5                    | 0.0               |              |     |     |     |
|               |          |         | R2      | W2      | Bedroom     | 100               | 7%                       | 27                 | 1.5                    | 0.0               |              |     |     |     |
|               |          |         | R3      | W3      | Bedroom     | 100               | 7%                       | 14                 | 1.5                    | 0.0               | N/F          |     |     |     |
|               |          |         | R4      | W4      | Bedroom     | 100               | 13%                      | 34                 | 1.5                    | 0.0               | N/F          |     |     |     |
|               |          |         | Ground  | R1      | W1          | Kitchen           | 200                      | 8%                 | 62                     | 1.5               | 0.0          | N/F |     |     |
|               |          |         |         |         | W2          |                   |                          |                    |                        |                   |              |     |     |     |
|               |          |         | C3 DP06 |         | First       | R2                | W3                       | Living Room        | 150                    | 9%                | 57           | 1.5 | 0.0 | N/F |
|               |          |         |         |         |             | R1                | W1                       | Bedroom            | 100                    | 7%                | 26           | 1.5 | 0.0 |     |
| R2            | W2       | Bedroom |         |         | 100         | 49%               | 97                       | 1.5                | 0.4                    | N/F               |              |     |     |     |
| R3            | W3       | Bedroom |         |         | 100         | 8%                | 28                       | 1.5                | 0.0                    |                   |              |     |     |     |
| R4            | W4       | Bedroom |         |         | 100         | 3%                | 13                       | 1.5                | 0.0                    |                   |              |     |     |     |
| Ground        | R1       | W2      |         |         | Kitchen     | 200               | 9%                       | 61                 | 1.5                    |                   | 0.0          |     |     |     |
|               |          | W1      |         |         |             |                   |                          |                    |                        |                   |              |     |     |     |
| C3 DP07       |          | First   |         |         | R2          | W3                | Living Room              | 150                | 6%                     | 50                | 1.5          | 0.0 | N/F |     |
|               |          |         |         |         | R1          | W1                | Bedroom                  | 100                | 45%                    | 93                | 1.5          | 0.4 |     |     |
|               |          | R2      |         |         | W2          | Bedroom           | 100                      | 7%                 | 27                     | 1.5               | 0.0          | N/F |     |     |
|               |          | R3      | W3      | Bedroom | 100         | 2%                | 11                       | 1.5                | 0.0                    |                   |              |     |     |     |
|               |          | R4      | W4      | Bedroom | 100         | 4%                | 23                       | 1.5                | 0.0                    |                   |              |     |     |     |
|               |          | Ground  | R1      | W1      | Kitchen     | 200               | 7%                       | 61                 | 1.5                    | 0.0               | N/F          |     |     |     |
|               |          |         |         | W2      |             |                   |                          |                    |                        |                   |              |     |     |     |







## Appendix 4

Assessed layouts within the proposed accommodation

Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

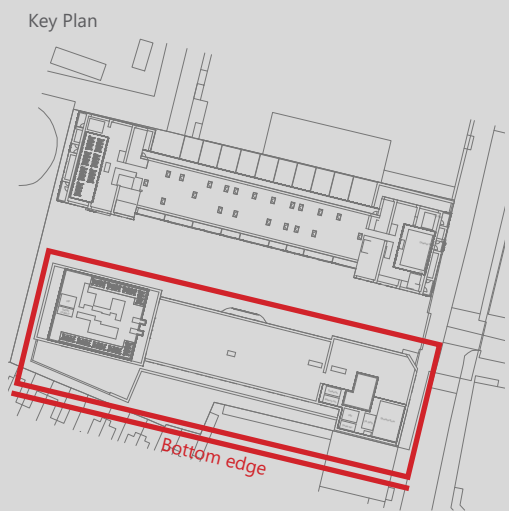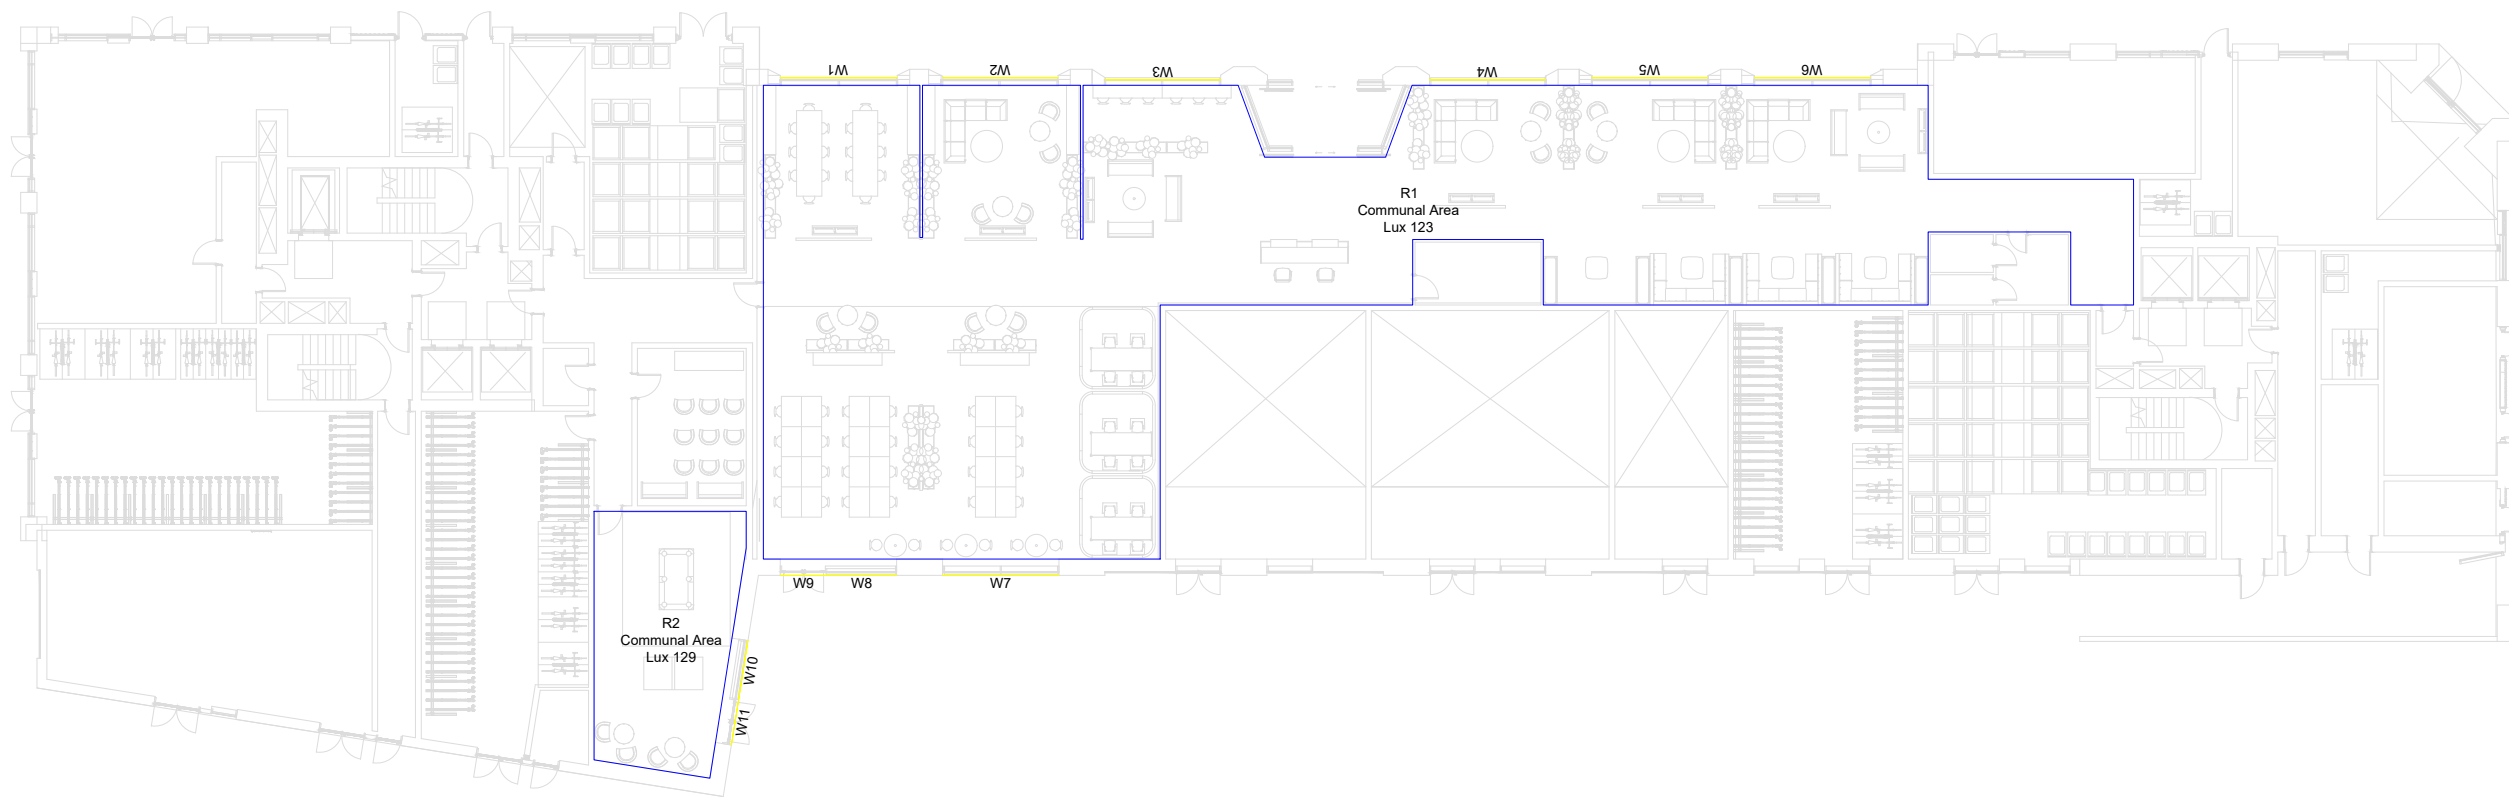


|         |                                          |          |       |
|---------|------------------------------------------|----------|-------|
| Project | Ashley Road Tottenham Hale               |          |       |
| Title   | Ground Floor<br>Room Layout<br>Co-Living |          |       |
| Drawn   | TR                                       | Checked  | --    |
| Date    | 07/08/2026                               | Project  | 10106 |
| Rel no. | 08                                       | Prefix   | ID02  |
|         |                                          | Page no. | 01    |

Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026


**EB7 Ltd**  
Site Photographs  
Ordnance Survey

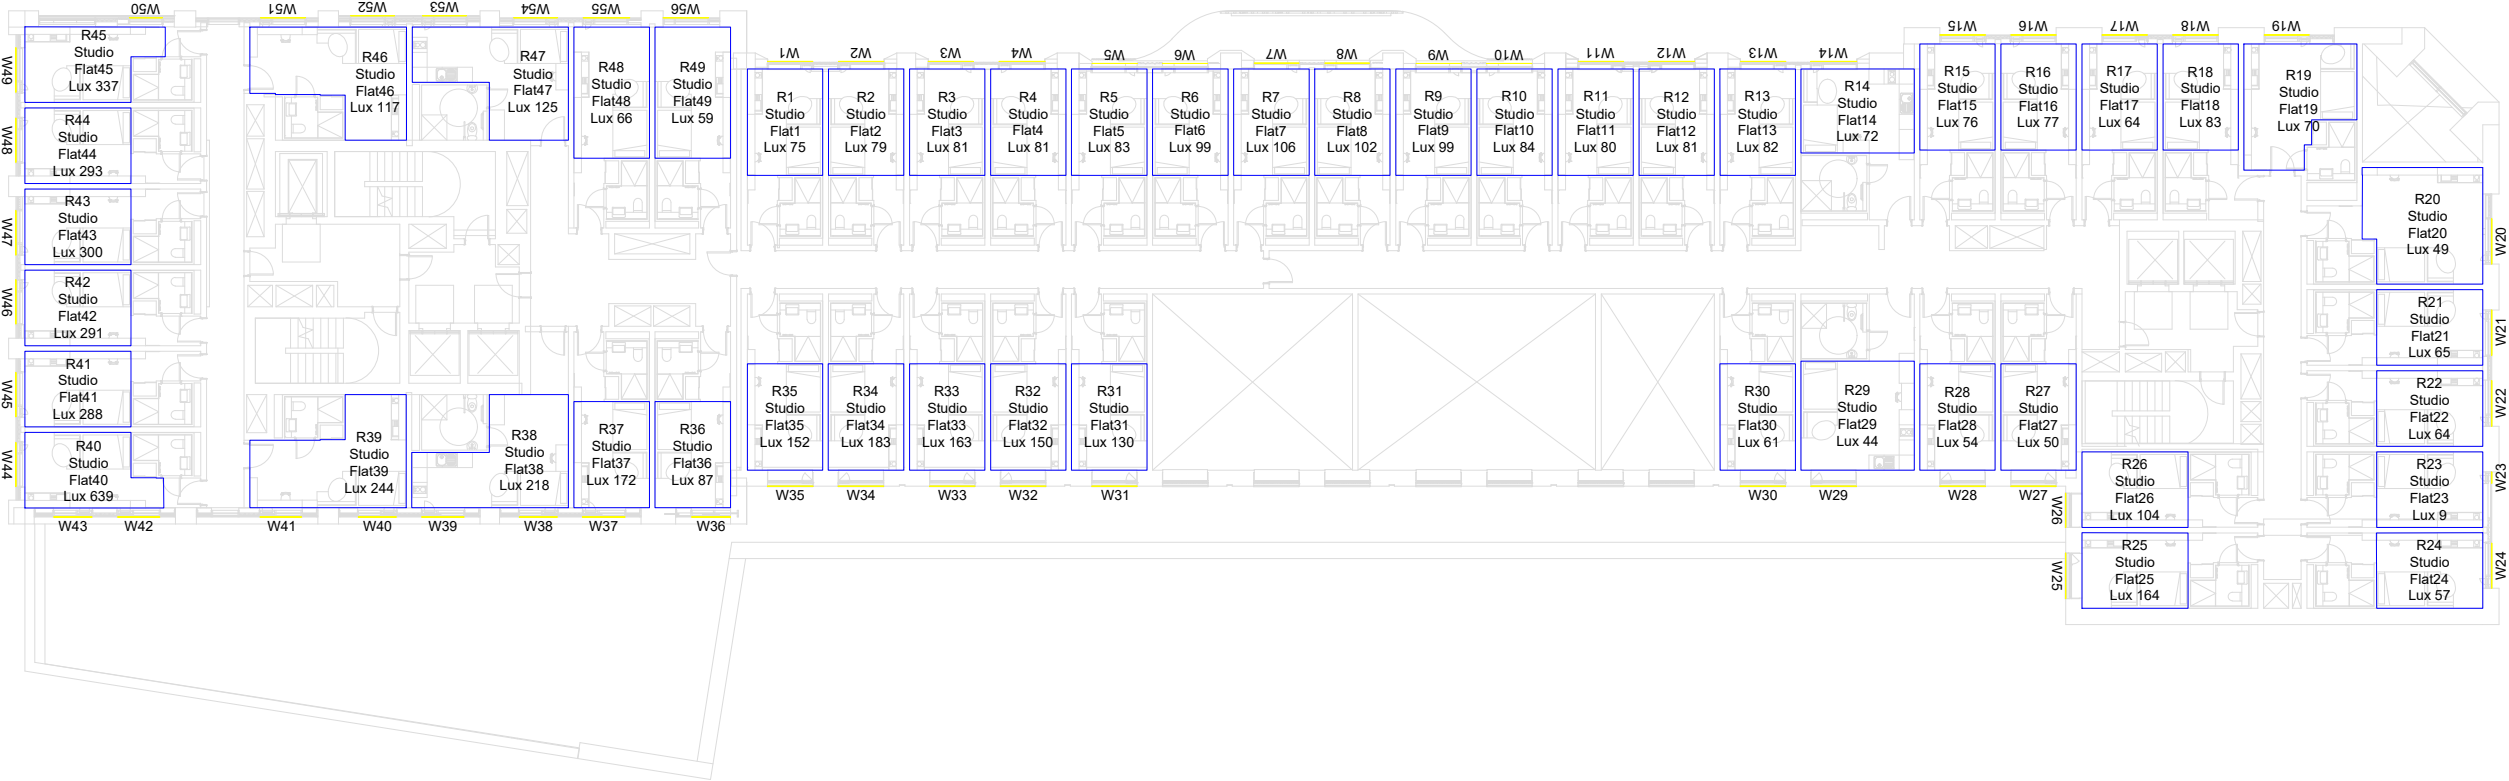


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

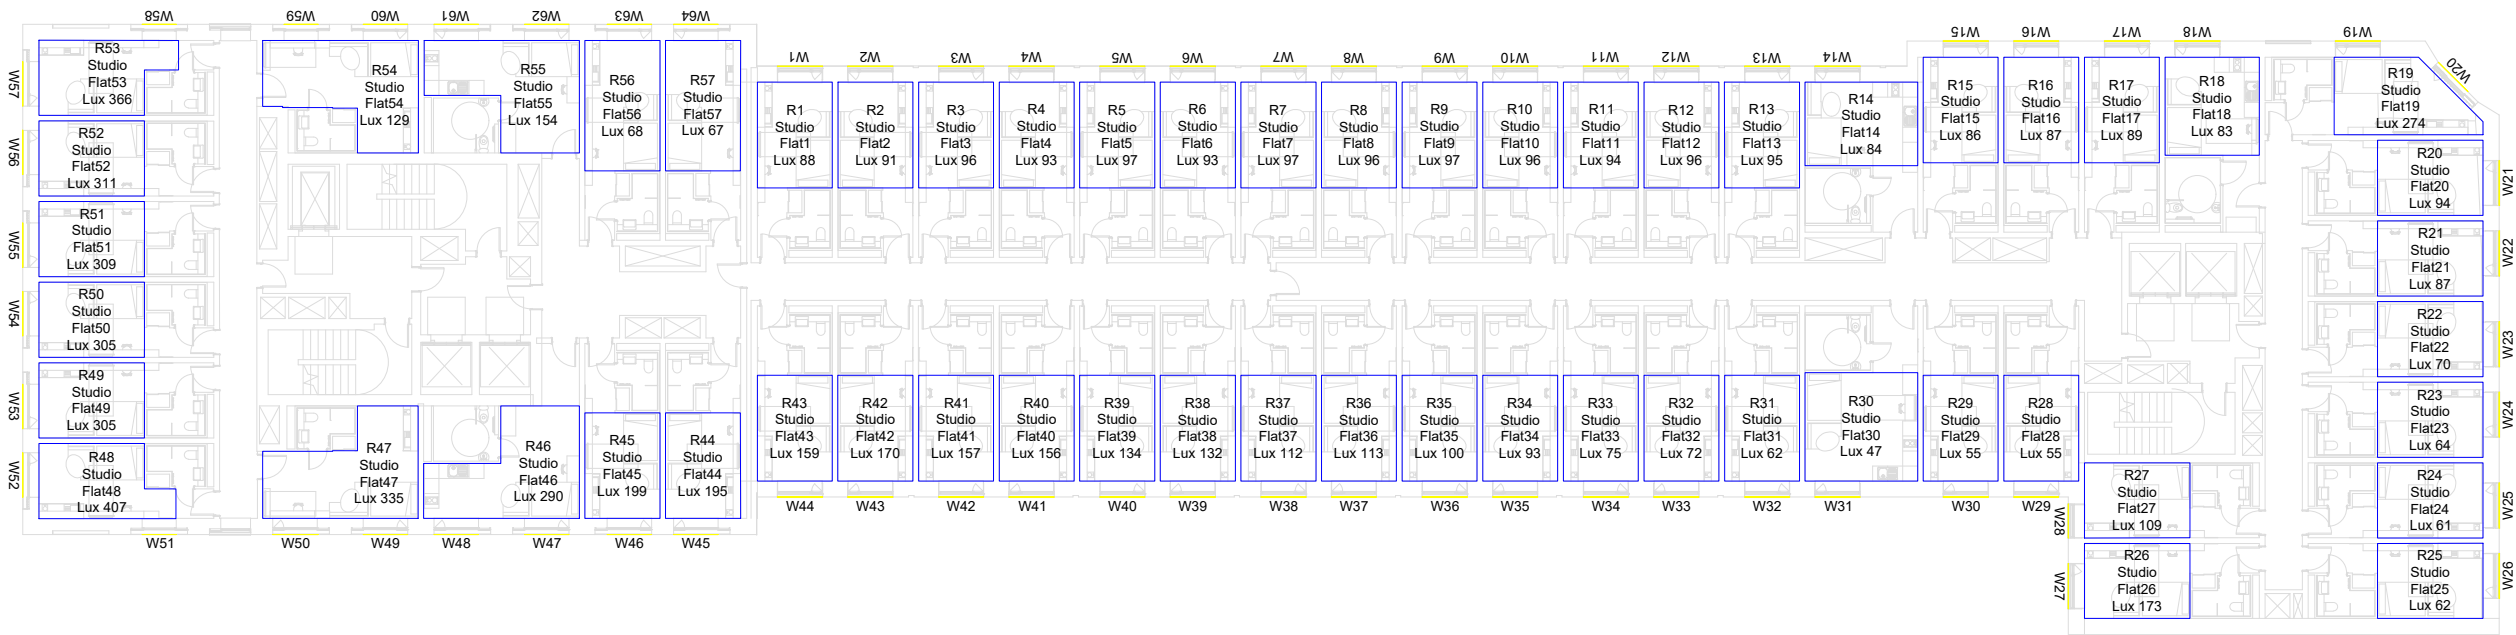

Key Plan

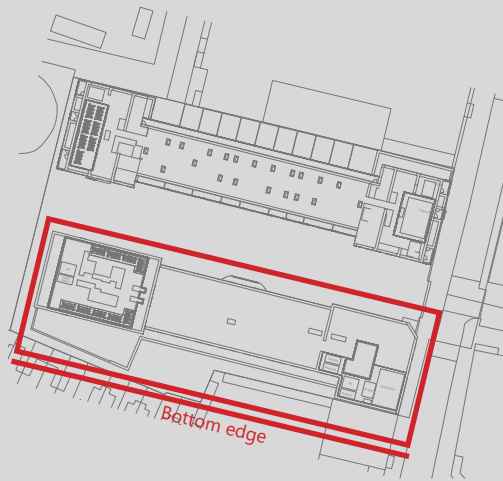


Project Ashley Road Tottenham Hale

Title Second Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 03

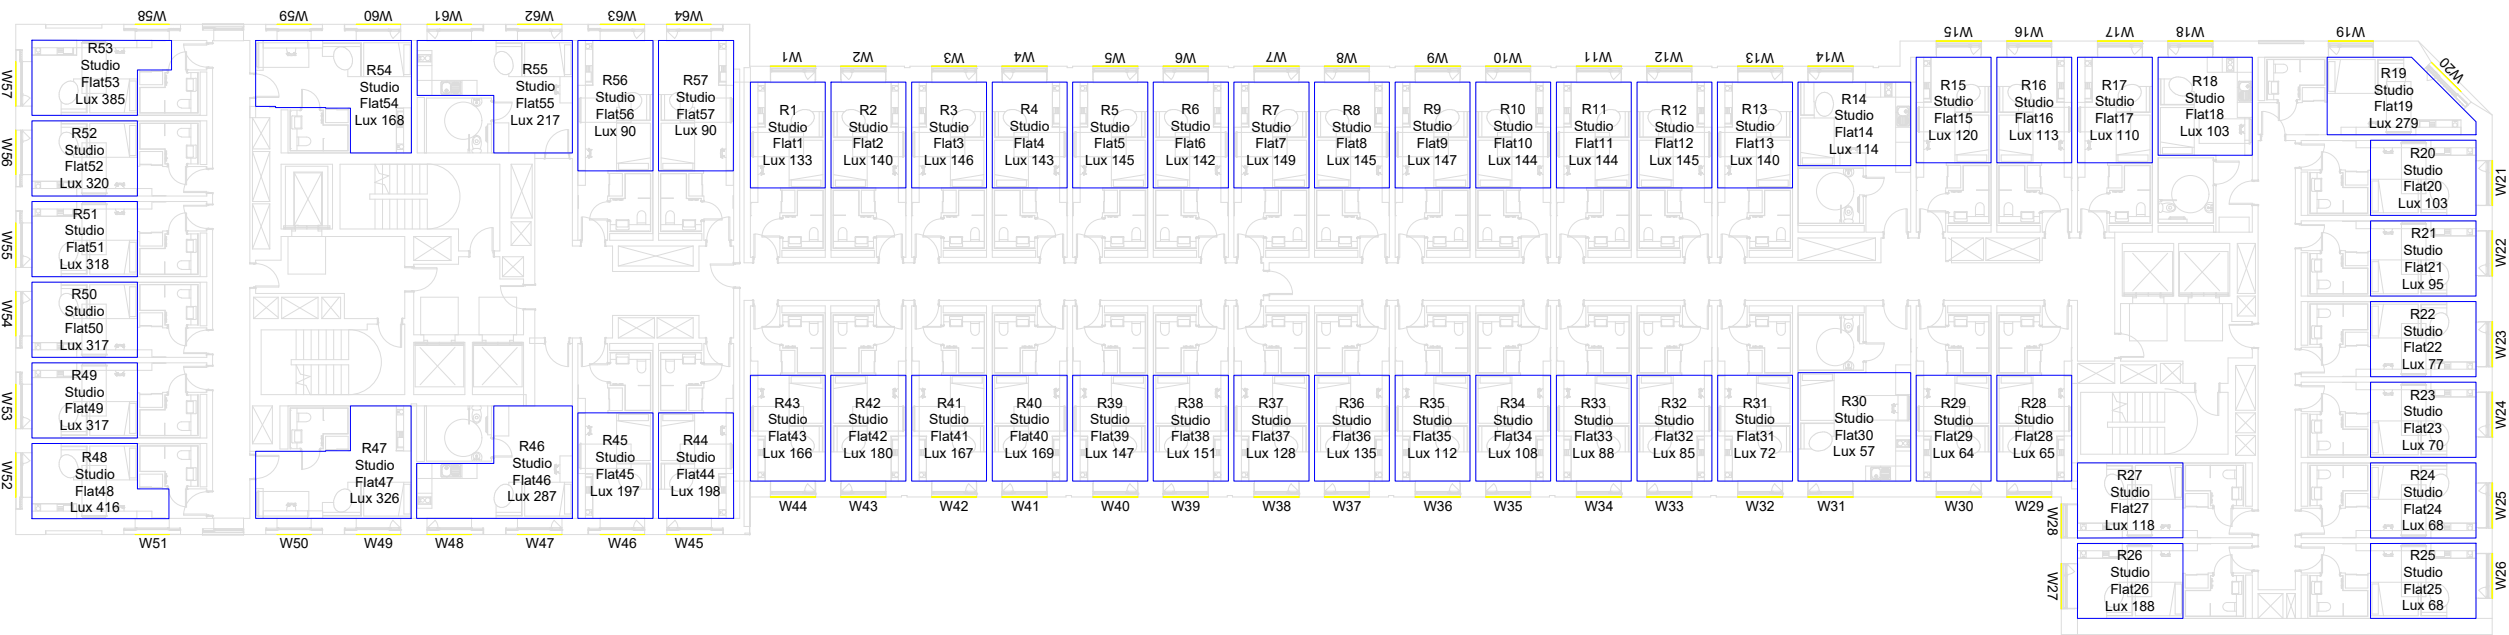


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

Key Plan

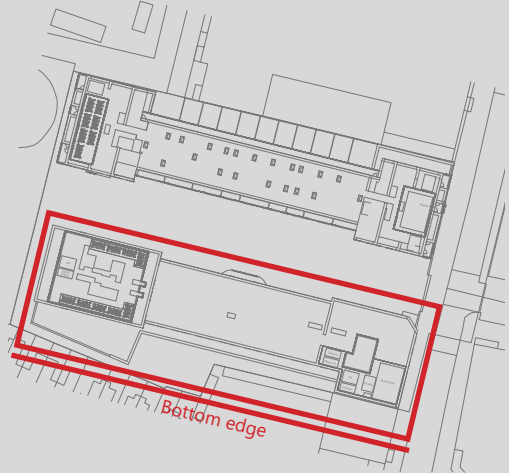


Project Ashley Road Tottenham Hale

Title Third Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 04

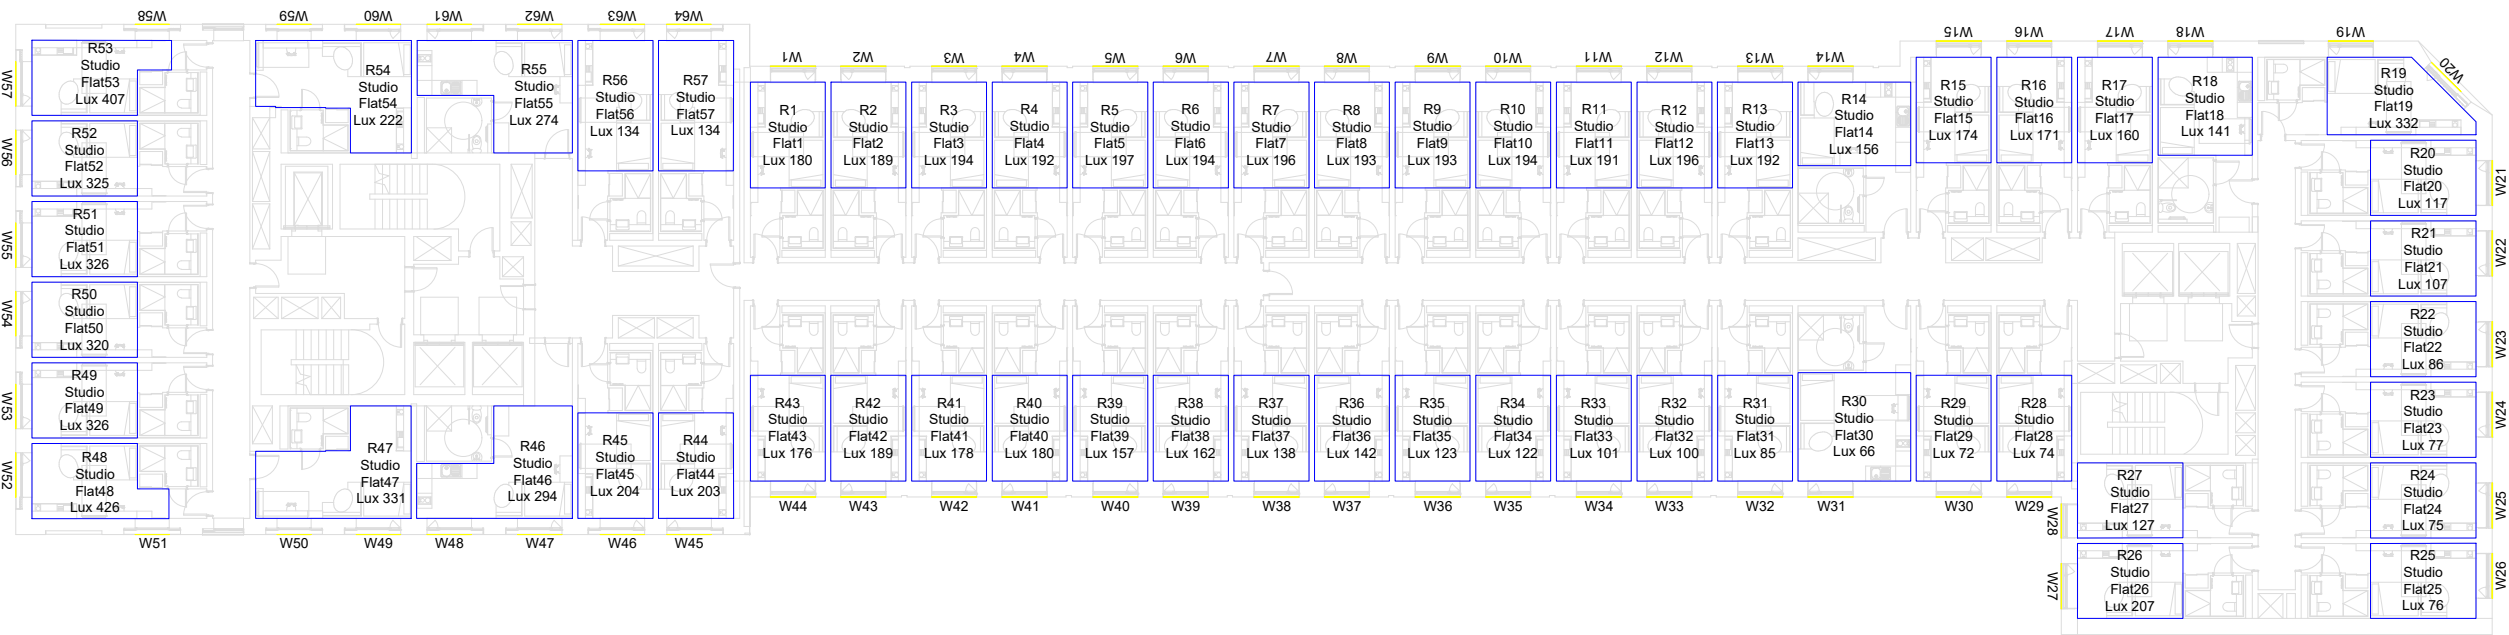


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

Key Plan

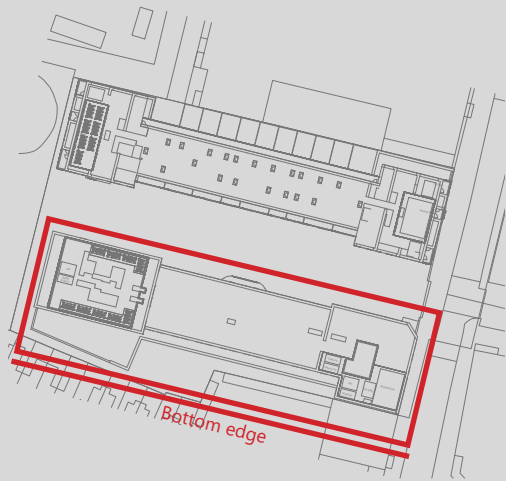


Project Ashley Road Tottenham Hale

Title Fourth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 05

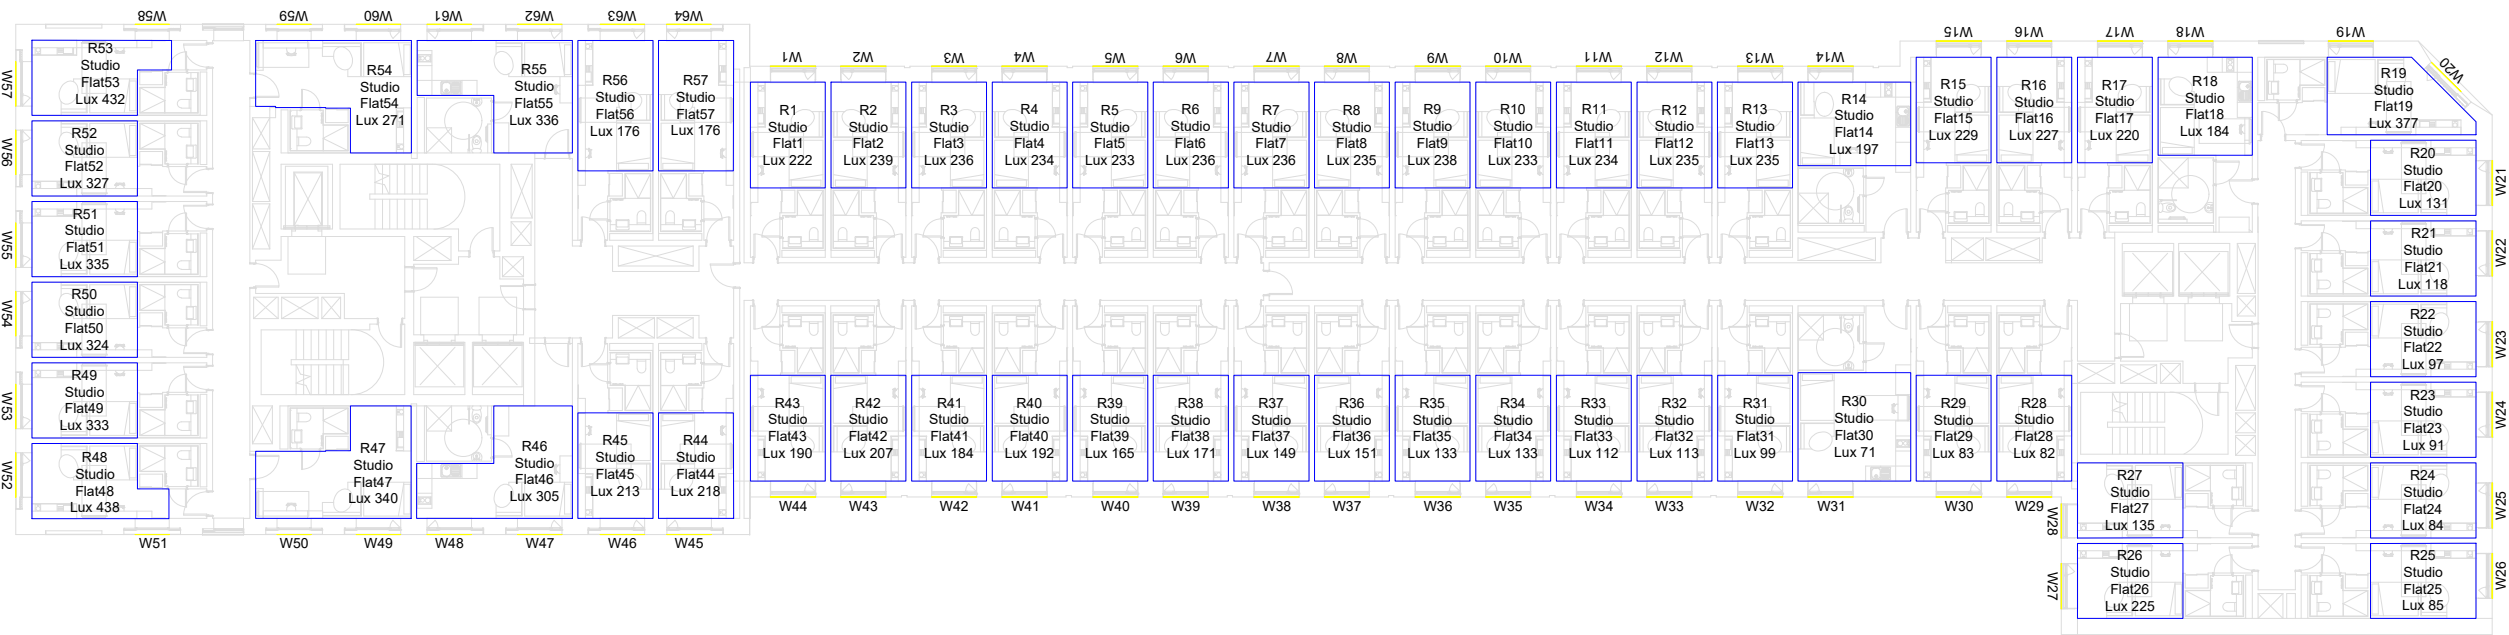


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

Key Plan

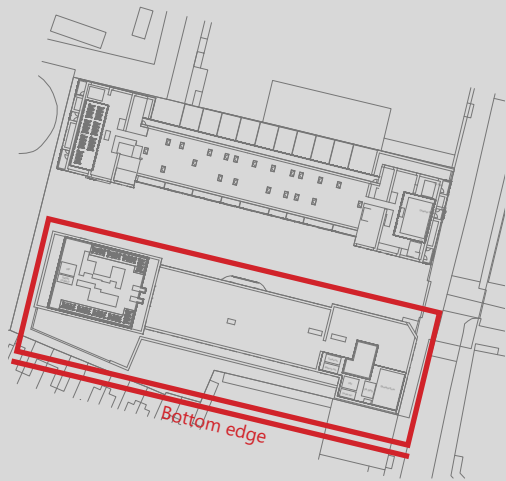

Project Ashley Road Tottenham Hale


Title Fifth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 06




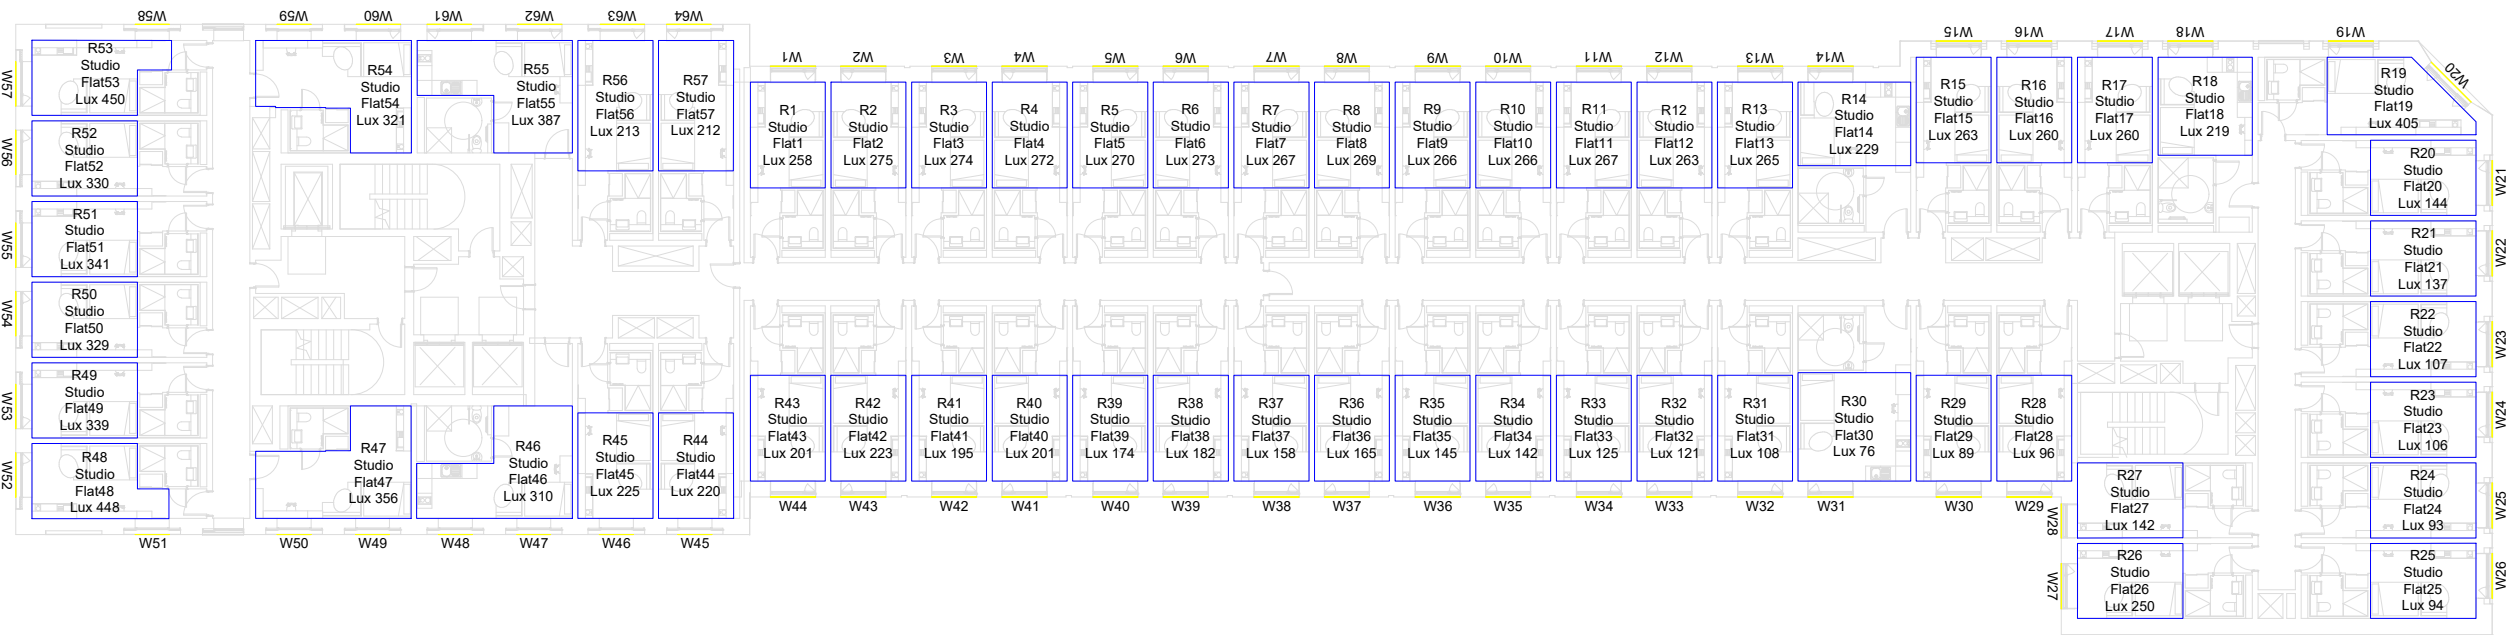


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

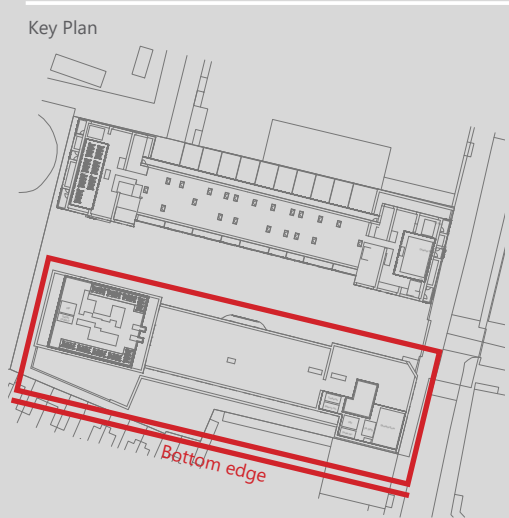

|         |                                         |          |       |
|---------|-----------------------------------------|----------|-------|
| Project | Ashley Road Tottenham Hale              |          |       |
| Title   | Sixth Floor<br>Room Layout<br>Co-Living |          |       |
| Drawn   | TR                                      | Checked  | --    |
| Date    | 07/08/2026                              | Project  | 10106 |
| Rel no. | 08                                      | Prefix   | ID02  |
|         |                                         | Page no. | 07    |

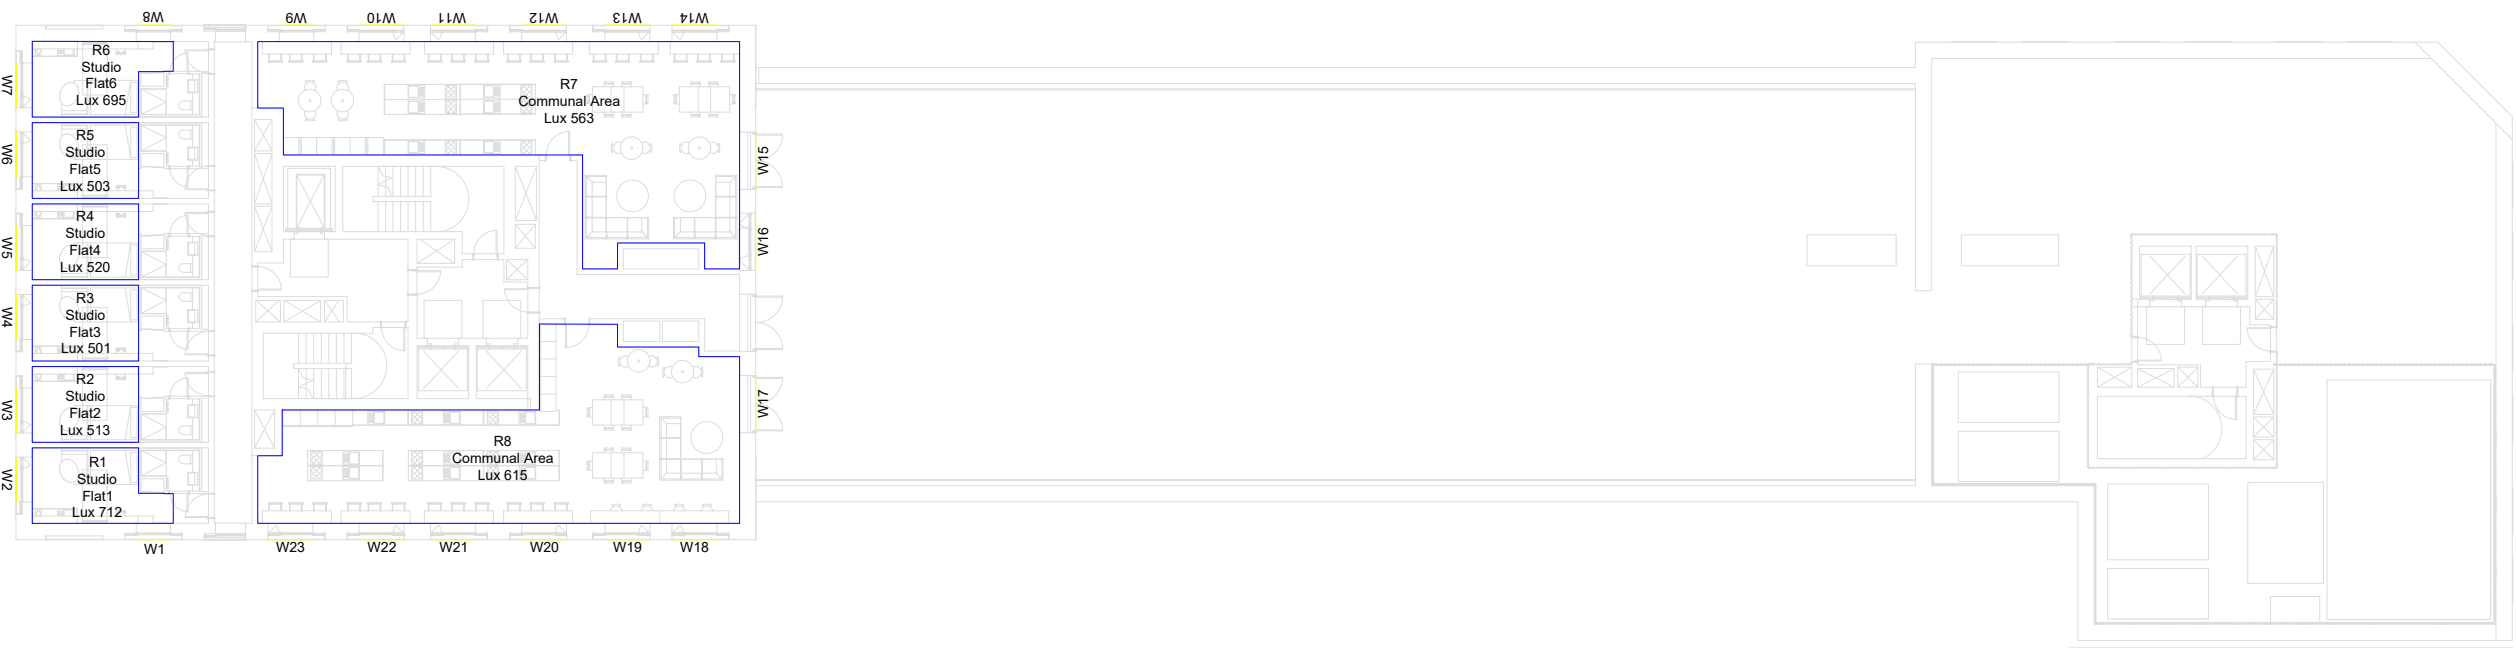


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

Key Plan

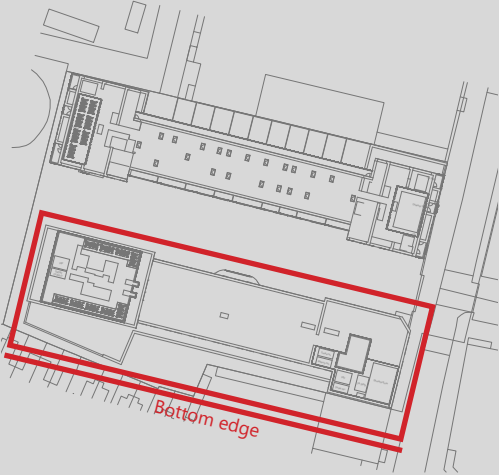

Project Ashley Road Tottenham Hale

Title Seventh Floor  
Room Layout  
Co-Living

Drawn TR Checked --


Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 08


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

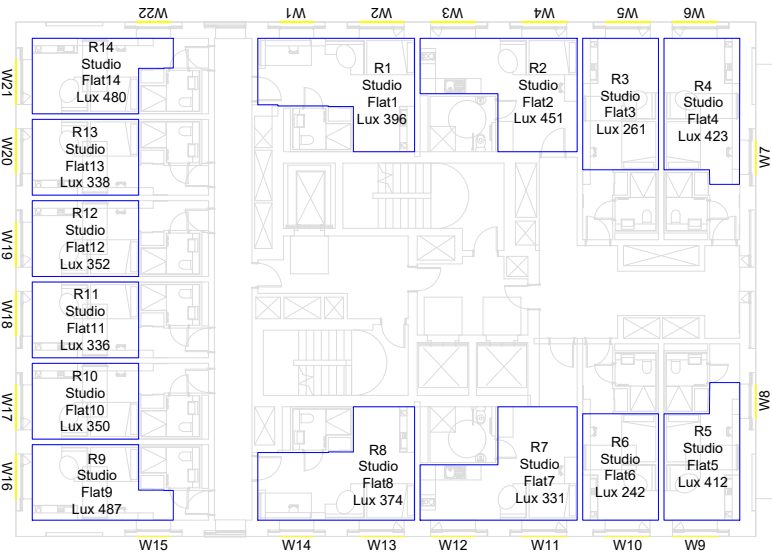

Key Plan

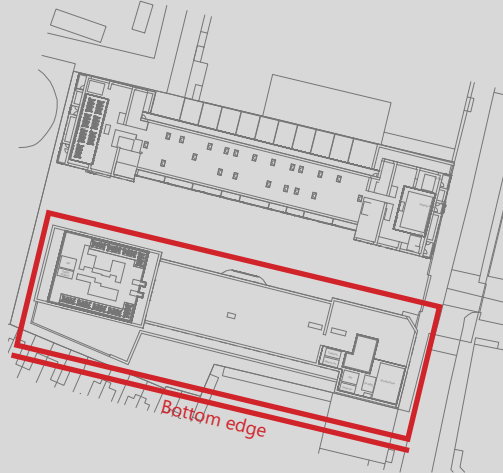

Project Ashley Road Tottenham Hale

Title Eighth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 09




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

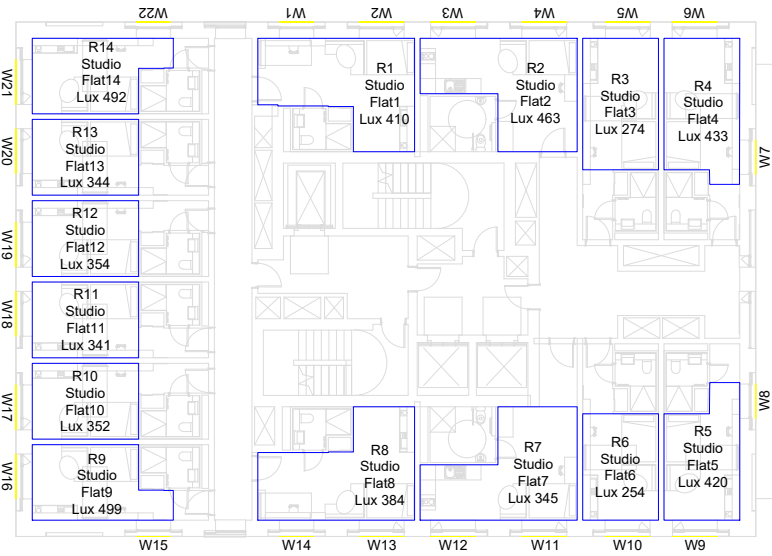

Key Plan

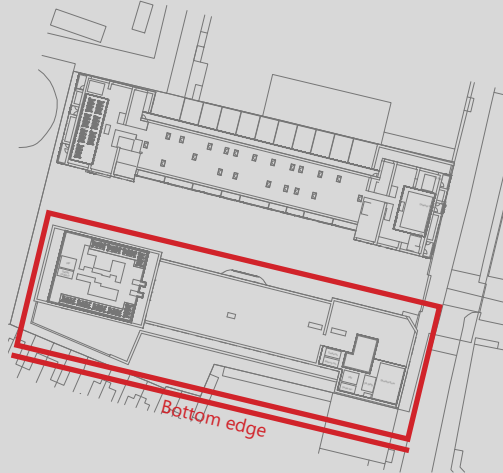

Project Ashley Road Tottenham Hale

Title Ninth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 10




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

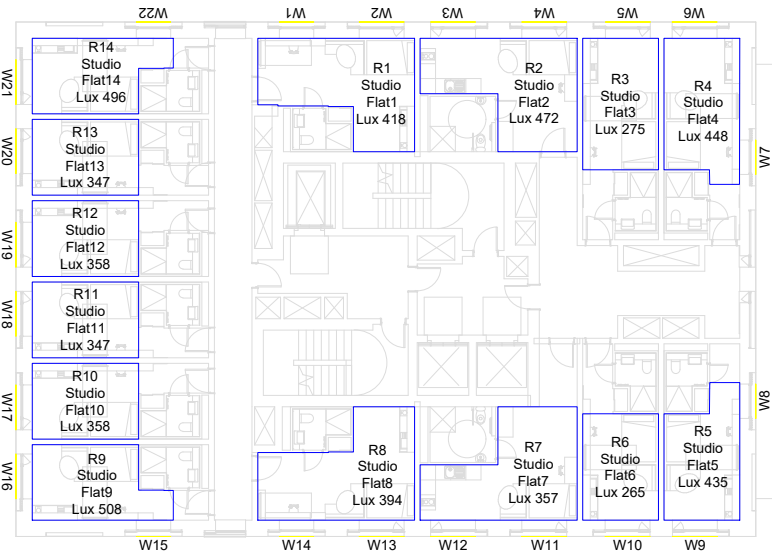

Key Plan

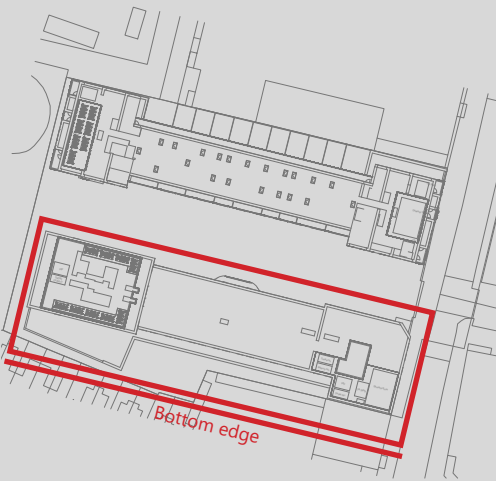

Project Ashley Road Tottenham Hale

Title Tenth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 11




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

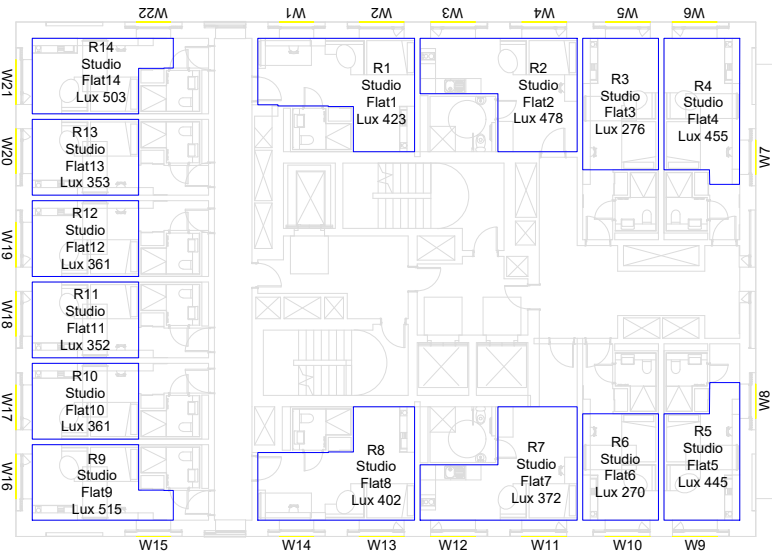

Key Plan

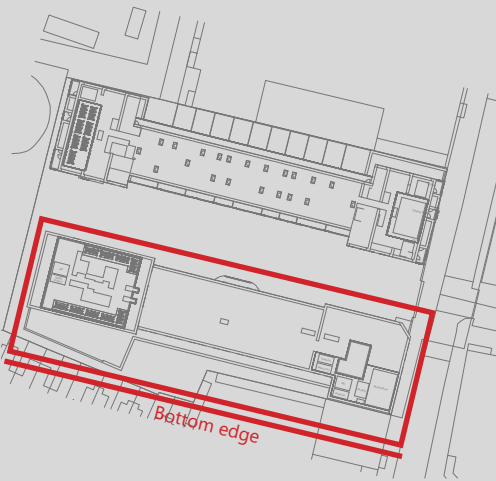

Project Ashley Road Tottenham Hale

Title Eleventh Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 12




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

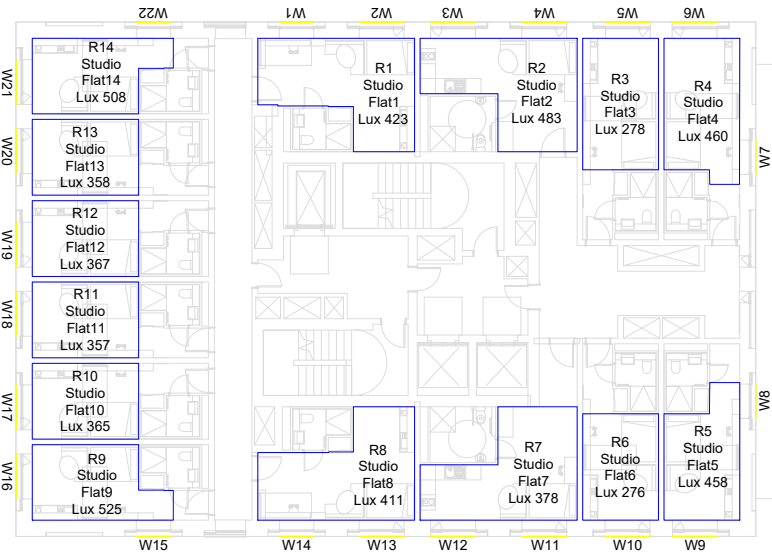

Key Plan

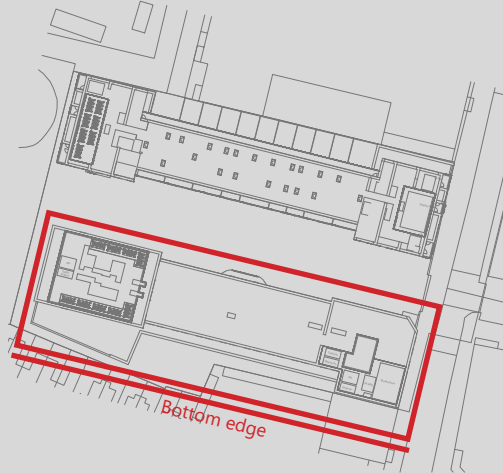

Project Ashley Road Tottenham Hale

Title Twelfth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 13




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

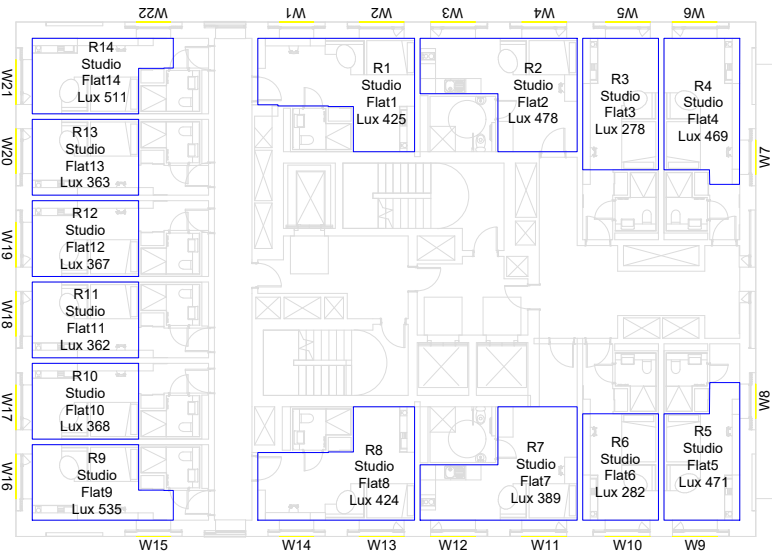

Key Plan

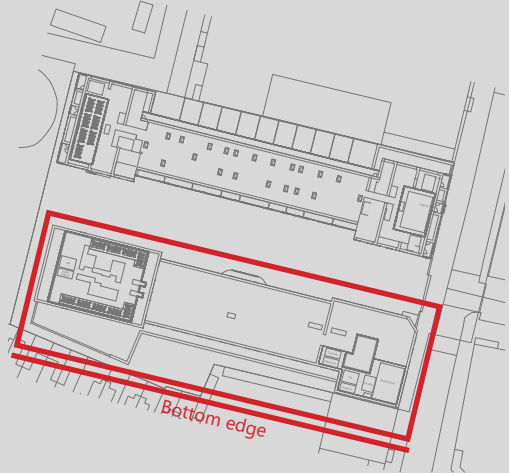

Project Ashley Road Tottenham Hale

Title Thirteenth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 14




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

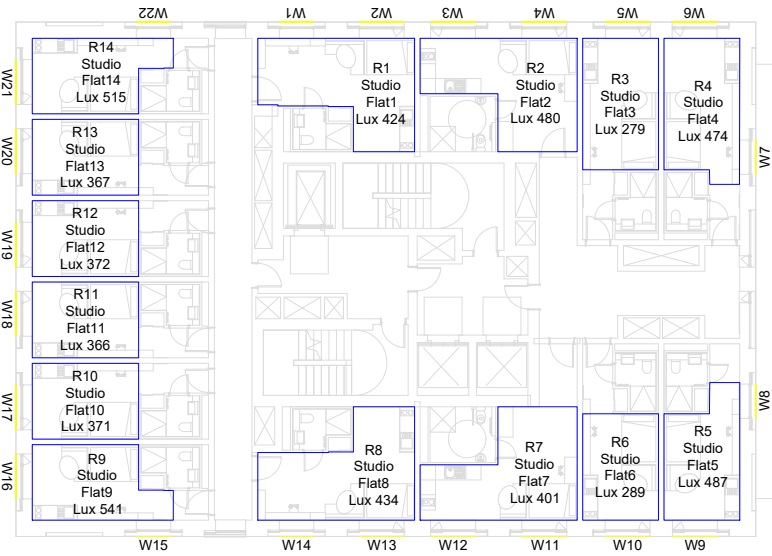

Key Plan

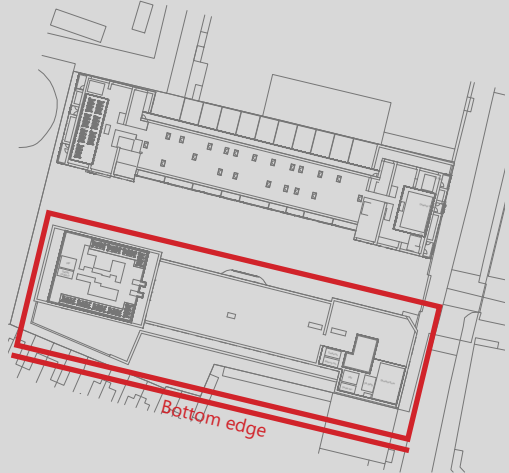

Project Ashley Road Tottenham Hale

Title Fourteenth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 15




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

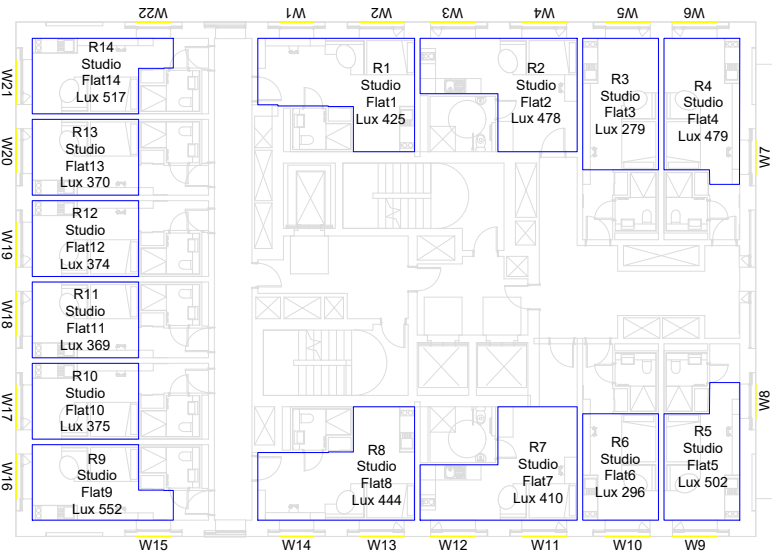

Key Plan

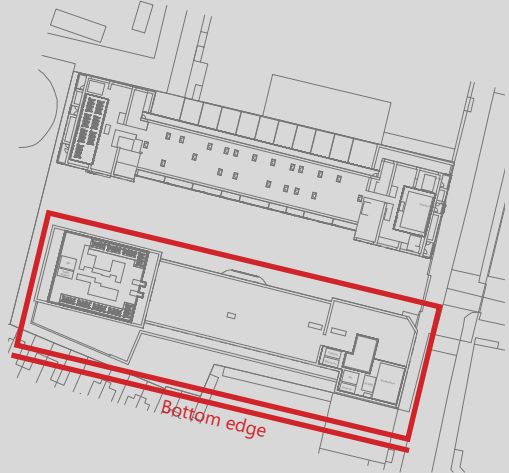

Project Ashley Road Tottenham Hale

Title Fifteenth Floor  
Room Layout  
Co-Living

Drawn TR Checked --


Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 16


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

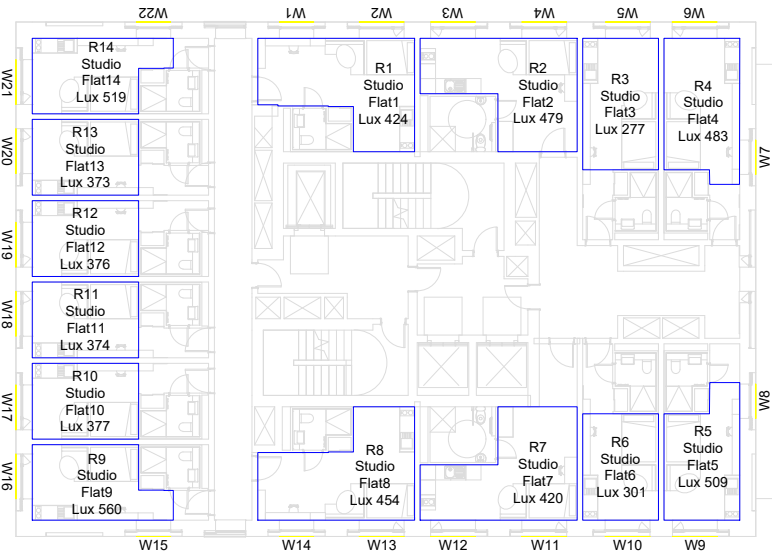

Key Plan

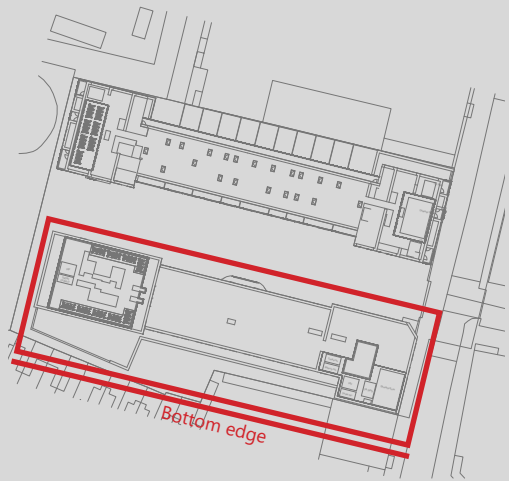

Project Ashley Road Tottenham Hale

Title Sixteenth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 17




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

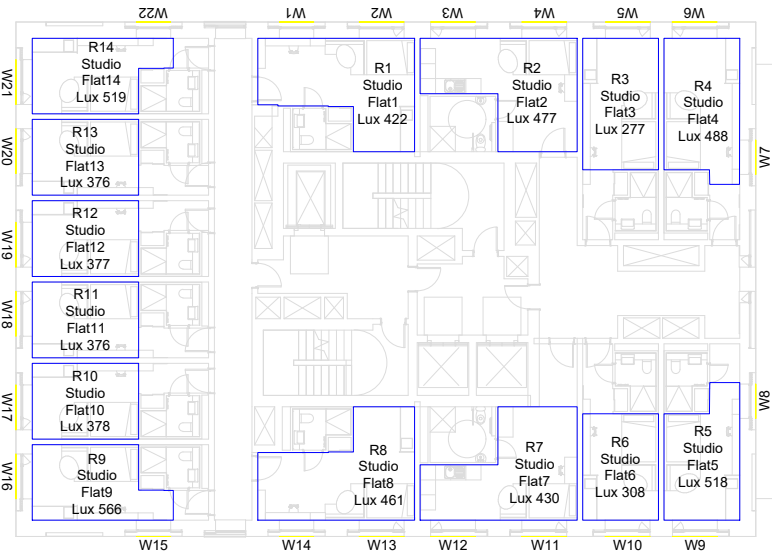

Key Plan

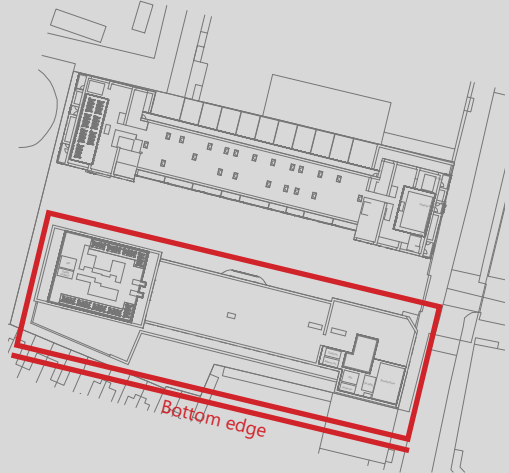

Project Ashley Road Tottenham Hale

Title Seventeenth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 18




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

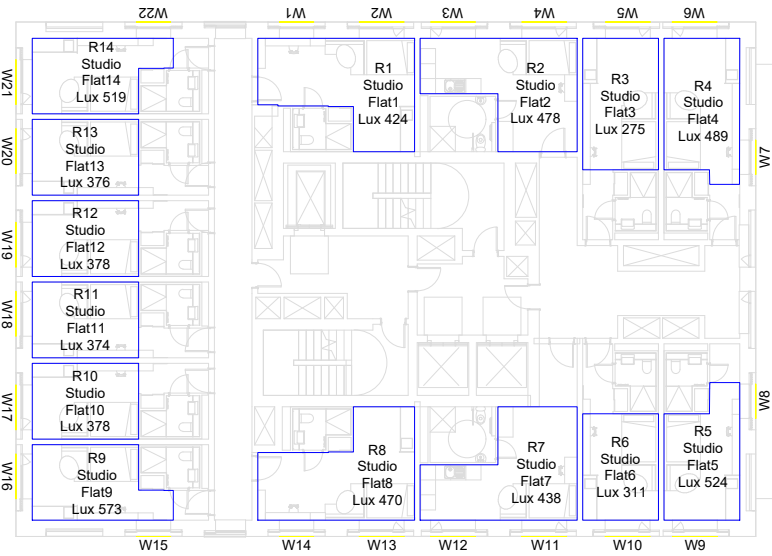

Key Plan

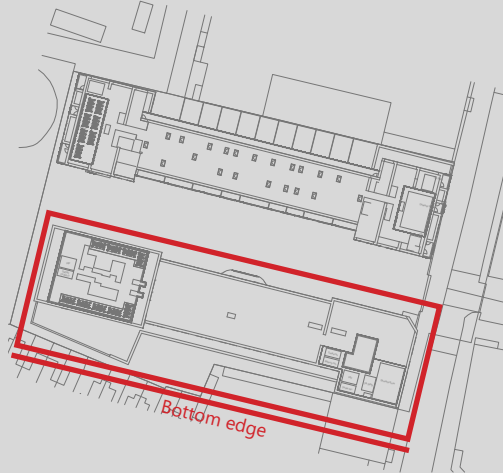

Project Ashley Road Tottenham Hale

Title Eighteenth Floor  
Room Layout  
Co-Living

Drawn TR Checked --


Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 19


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

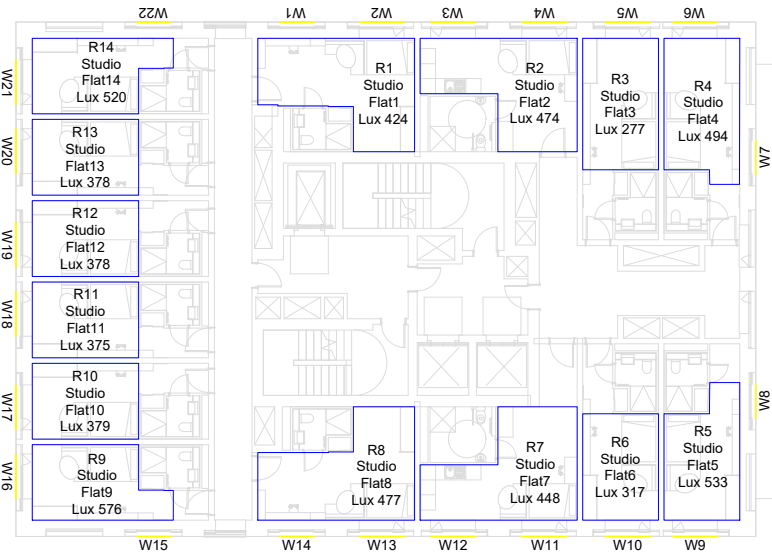

Key Plan

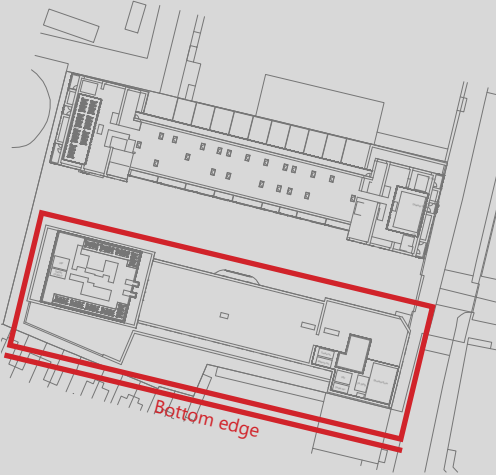

Project Ashley Road Tottenham Hale

Title Nineteenth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 20




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

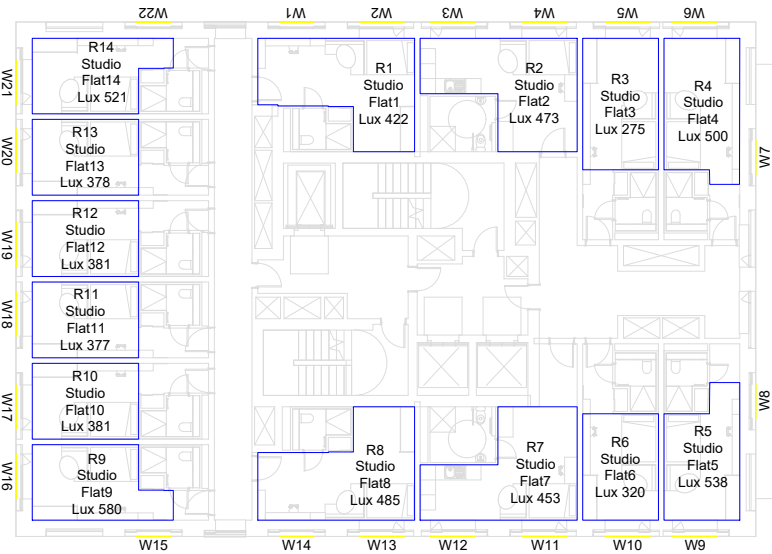

Key Plan

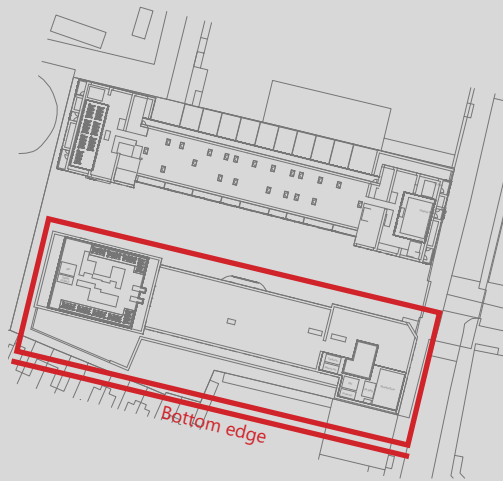

Project Ashley Road Tottenham Hale

Title Twentieth Floor  
Room Layout  
Co-Living

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 21




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

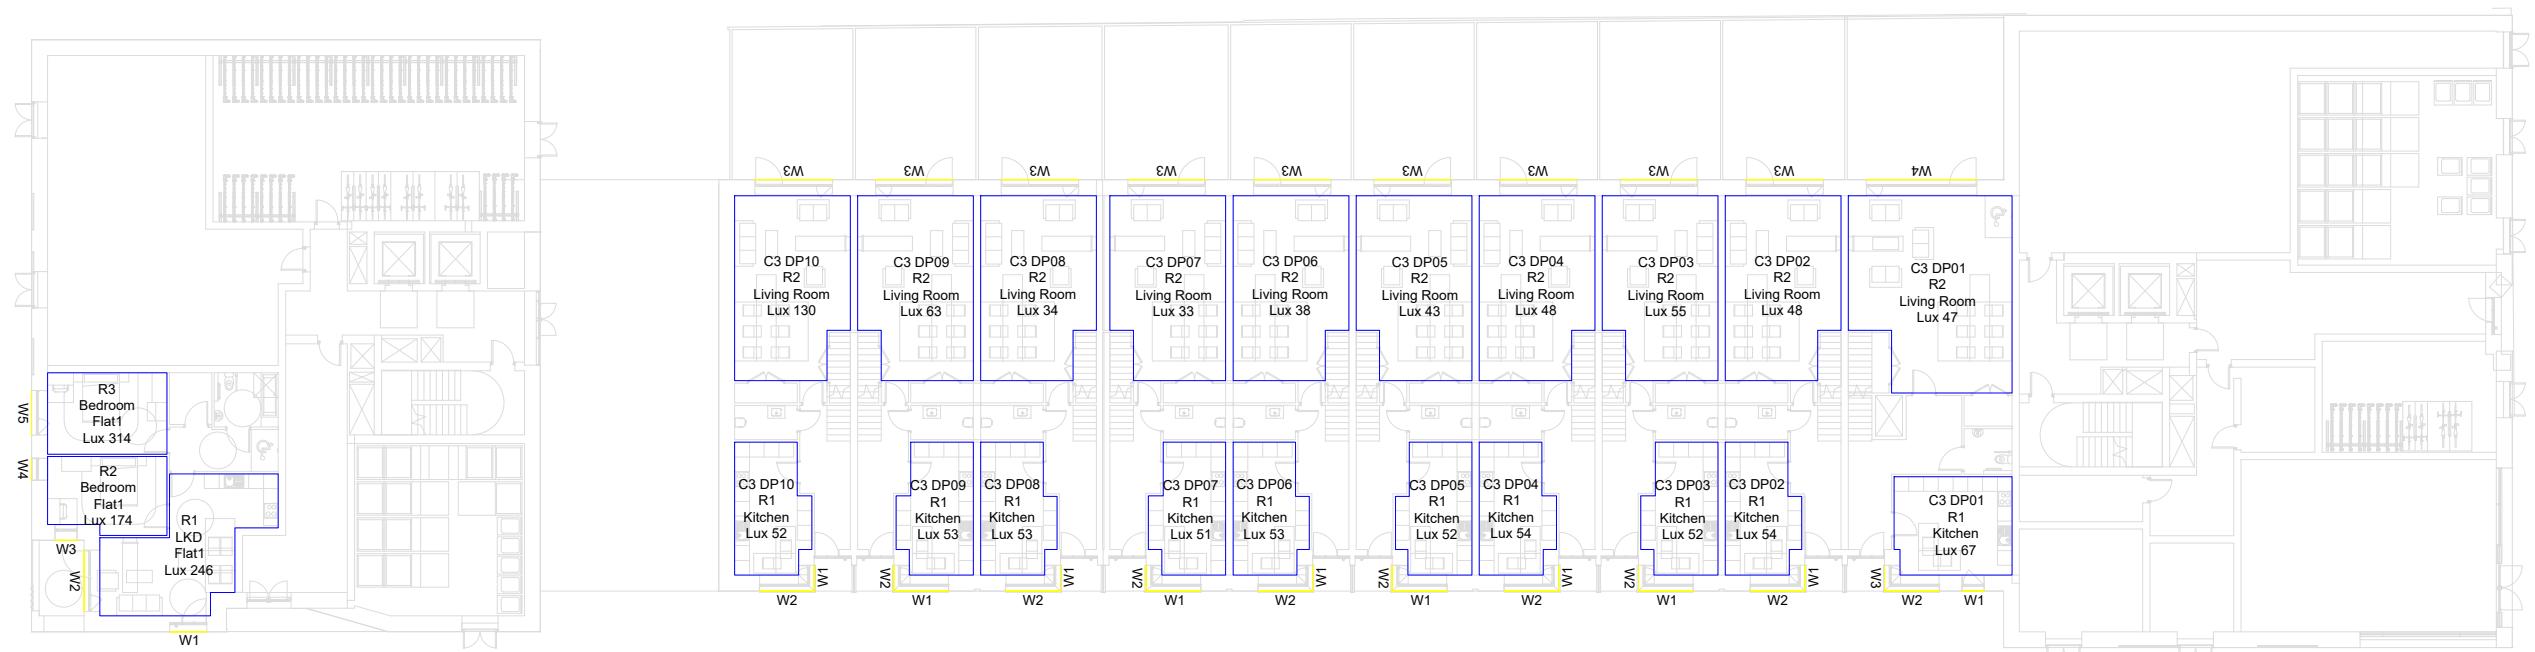

Key Plan

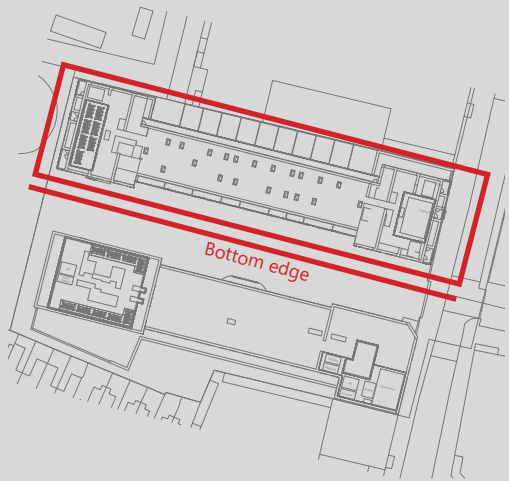


Project Ashley Road Tottenham Hale

Title Ground Floor  
Room Layout  
C3

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 22

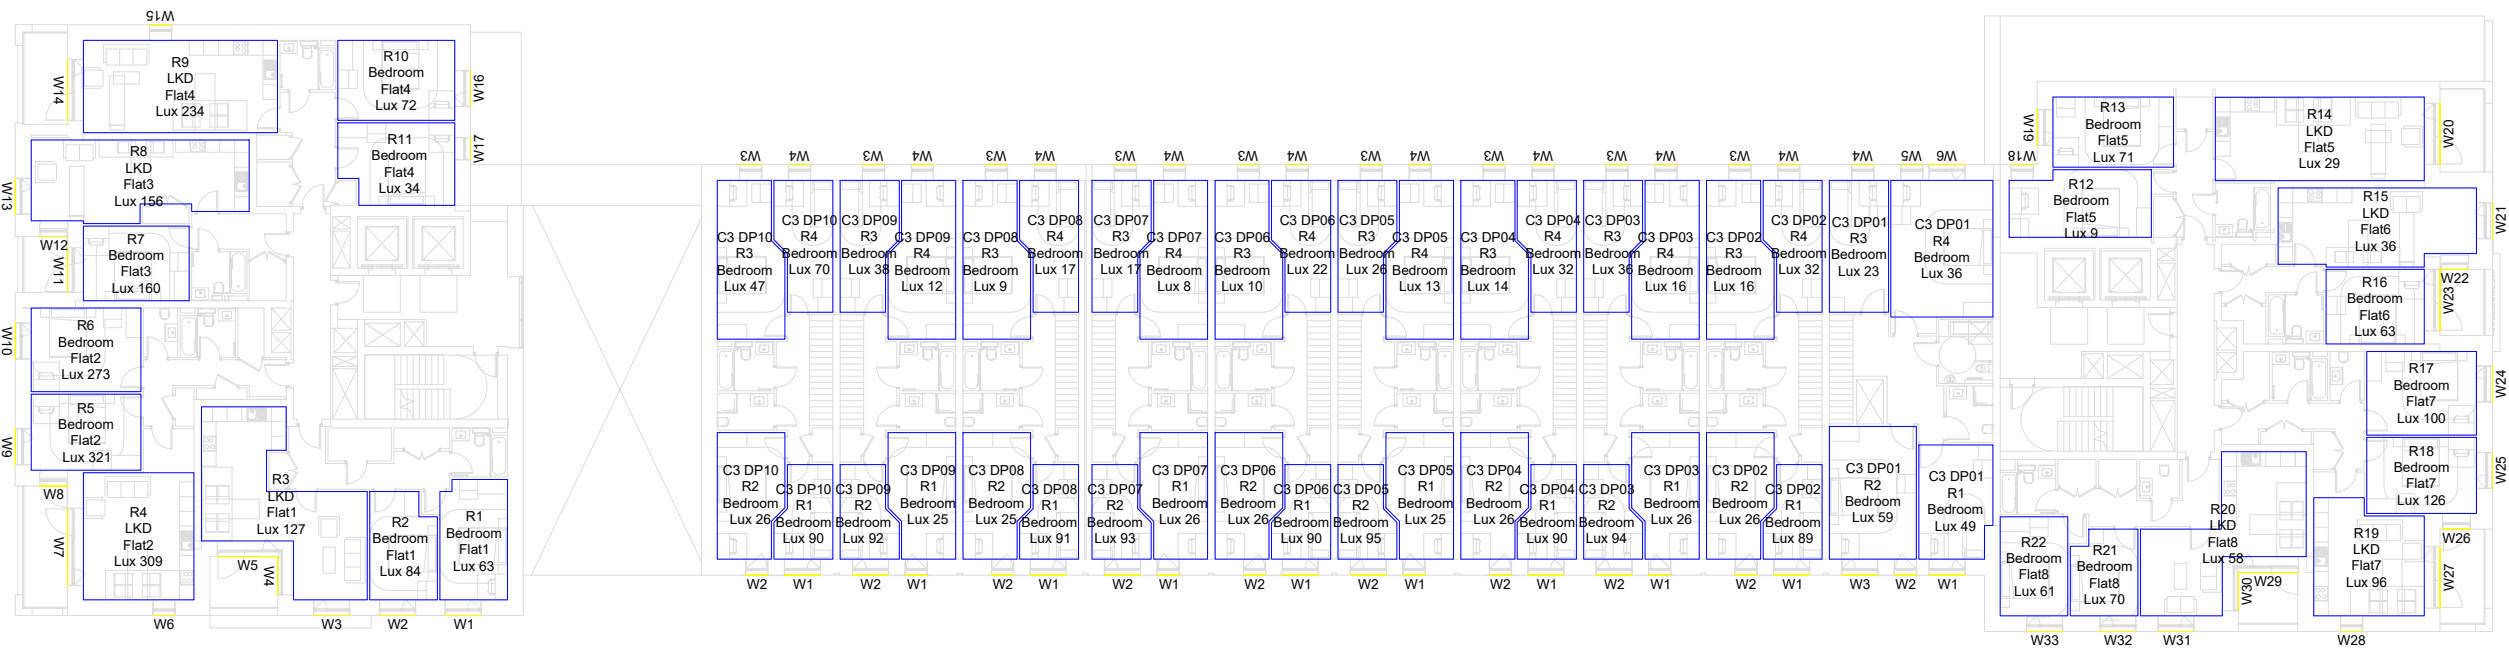


Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

Key Plan

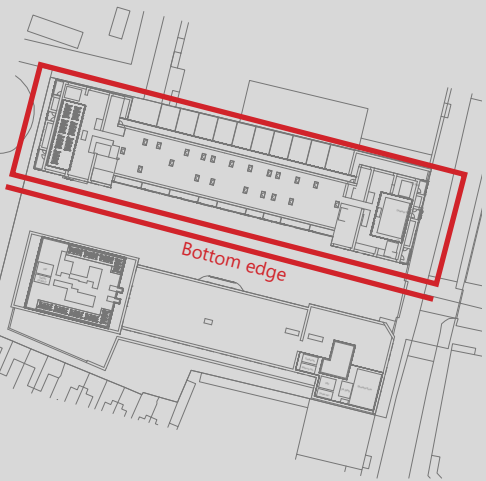

Project Ashley Road Tottenham Hale

Title First Floor  
Room Layout  
C3

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 23




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

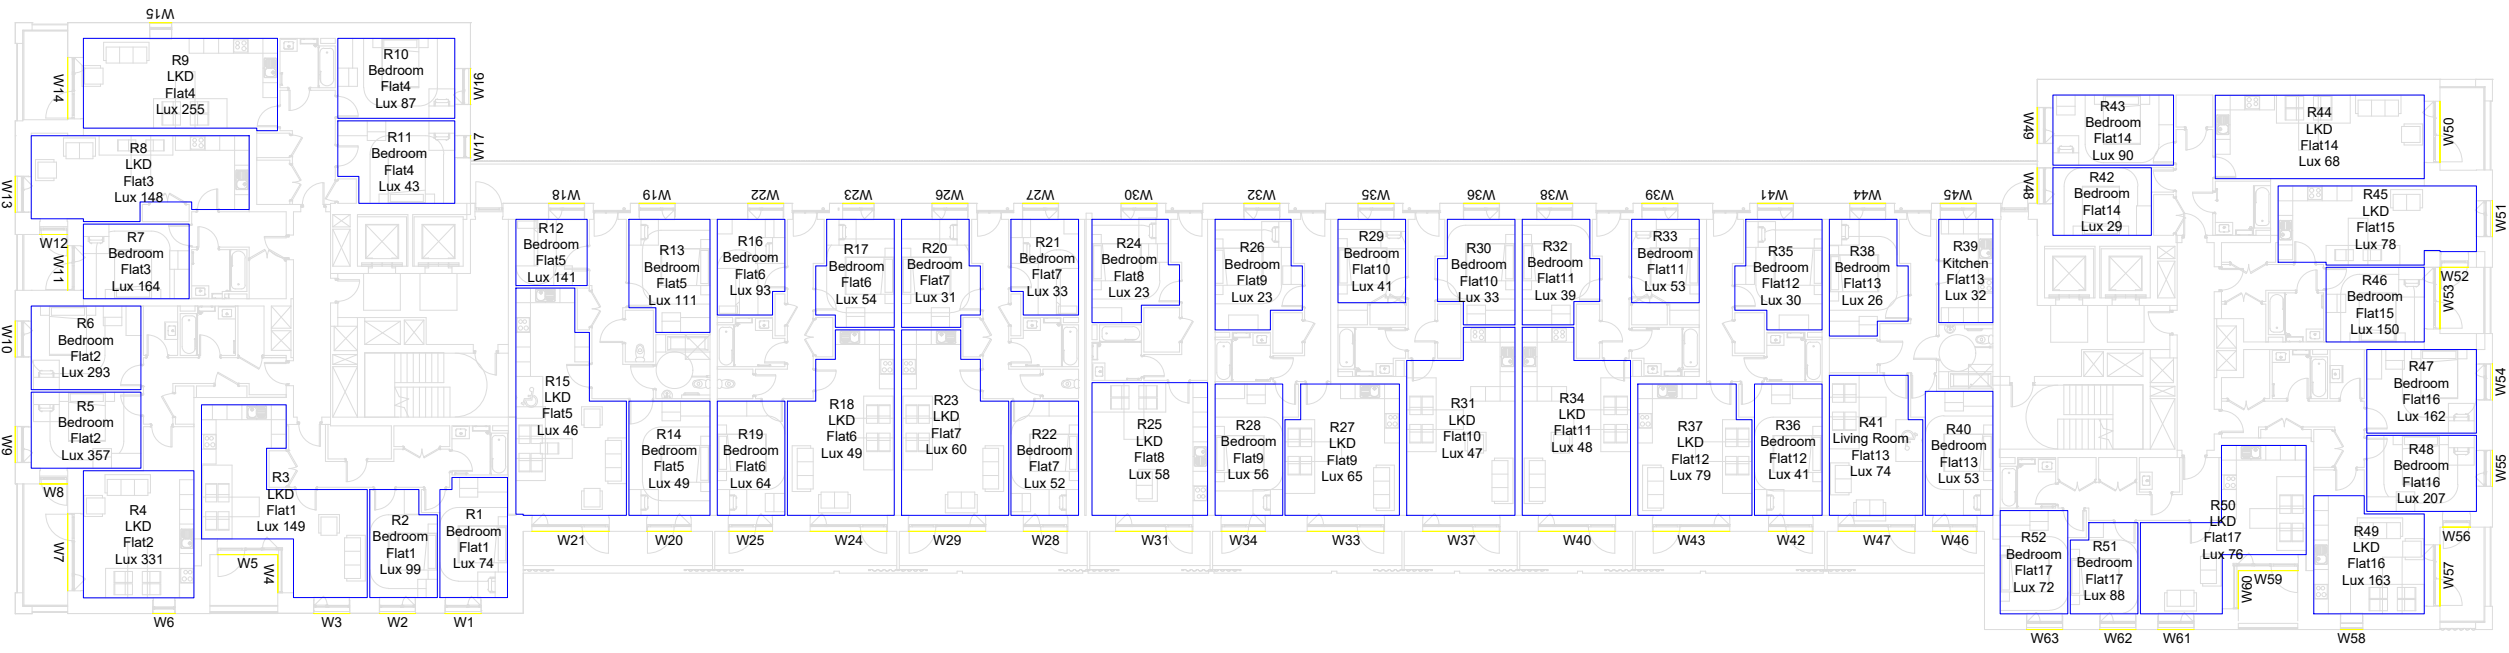

Key Plan

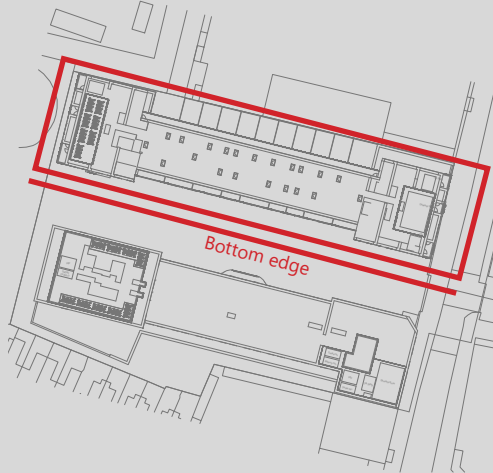

Project Ashley Road Tottenham Hale

Title Second Floor  
Room Layout  
C3

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 24




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

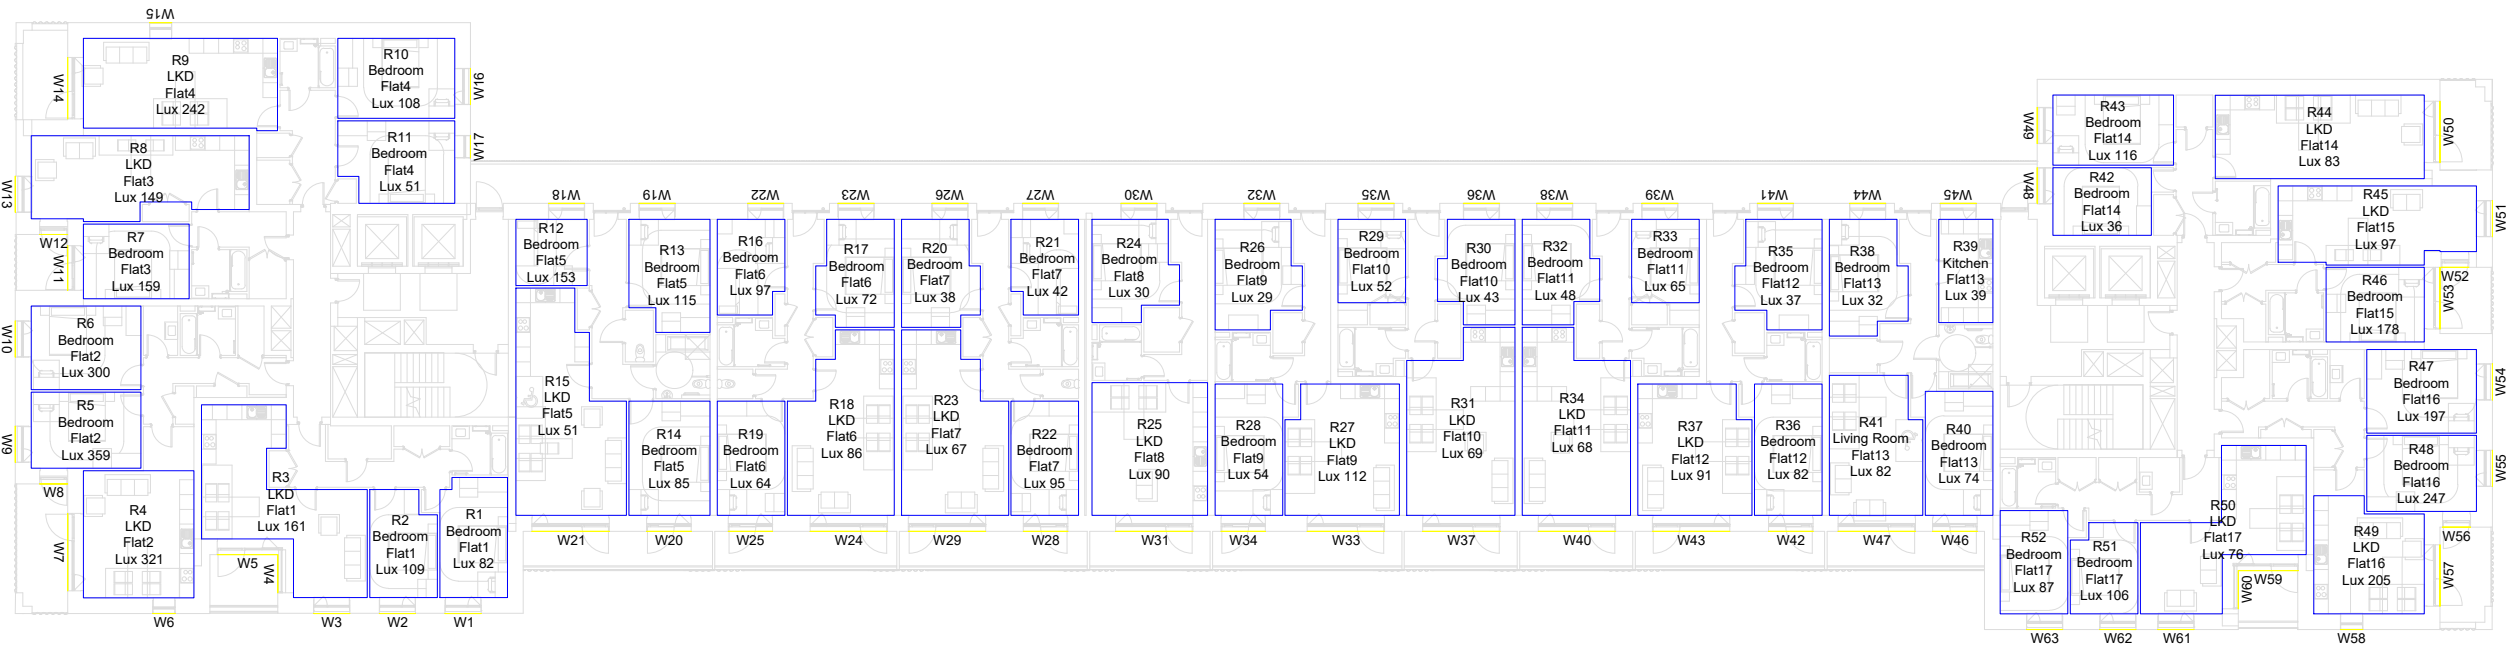

Key Plan

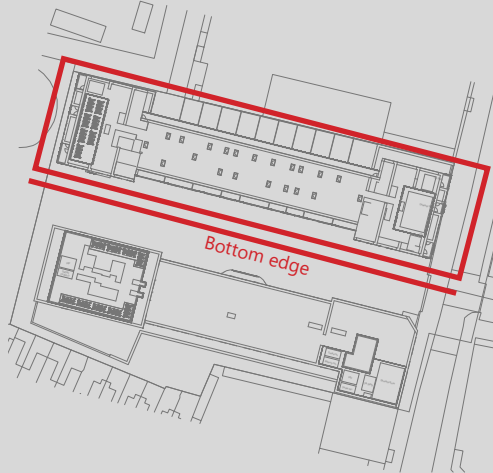

Project Ashley Road Tottenham Hale

Title Third Floor  
Room Layout  
C3

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 25




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

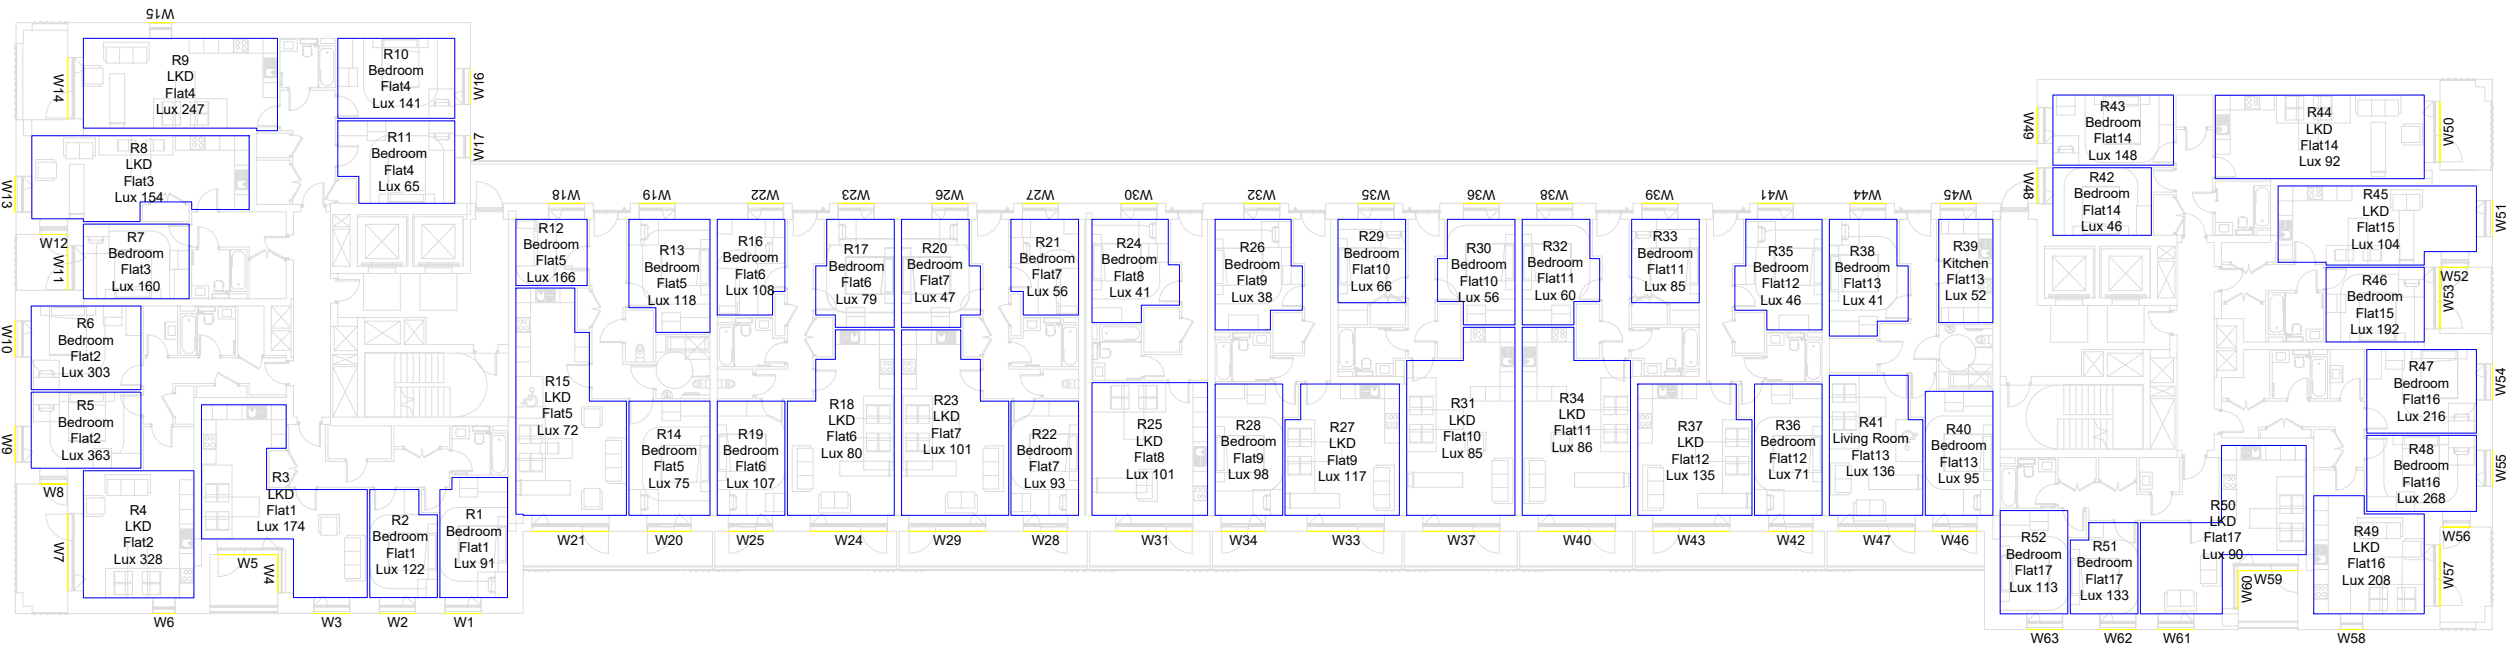

Key Plan

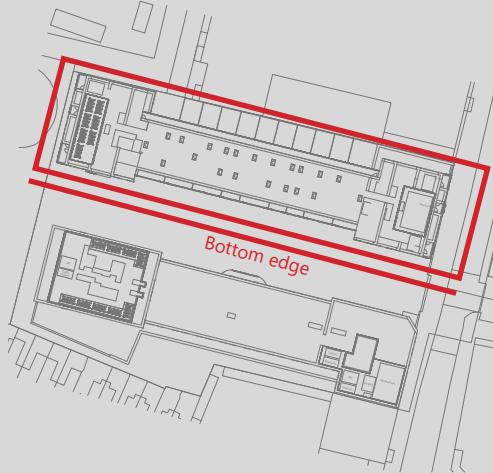

Project Ashley Road Tottenham Hale

Title Fourth Floor  
Room Layout  
C3

Drawn TR Checked --

Date 07/08/2026 Project 10106


Rel no. 08 Prefix ID02 Page no. 26




Sources of information

**DLA**  
03 Ashley House - Design Freeze\_  
selected\_2026-07-30\_12-06-41pm  
Received 30/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

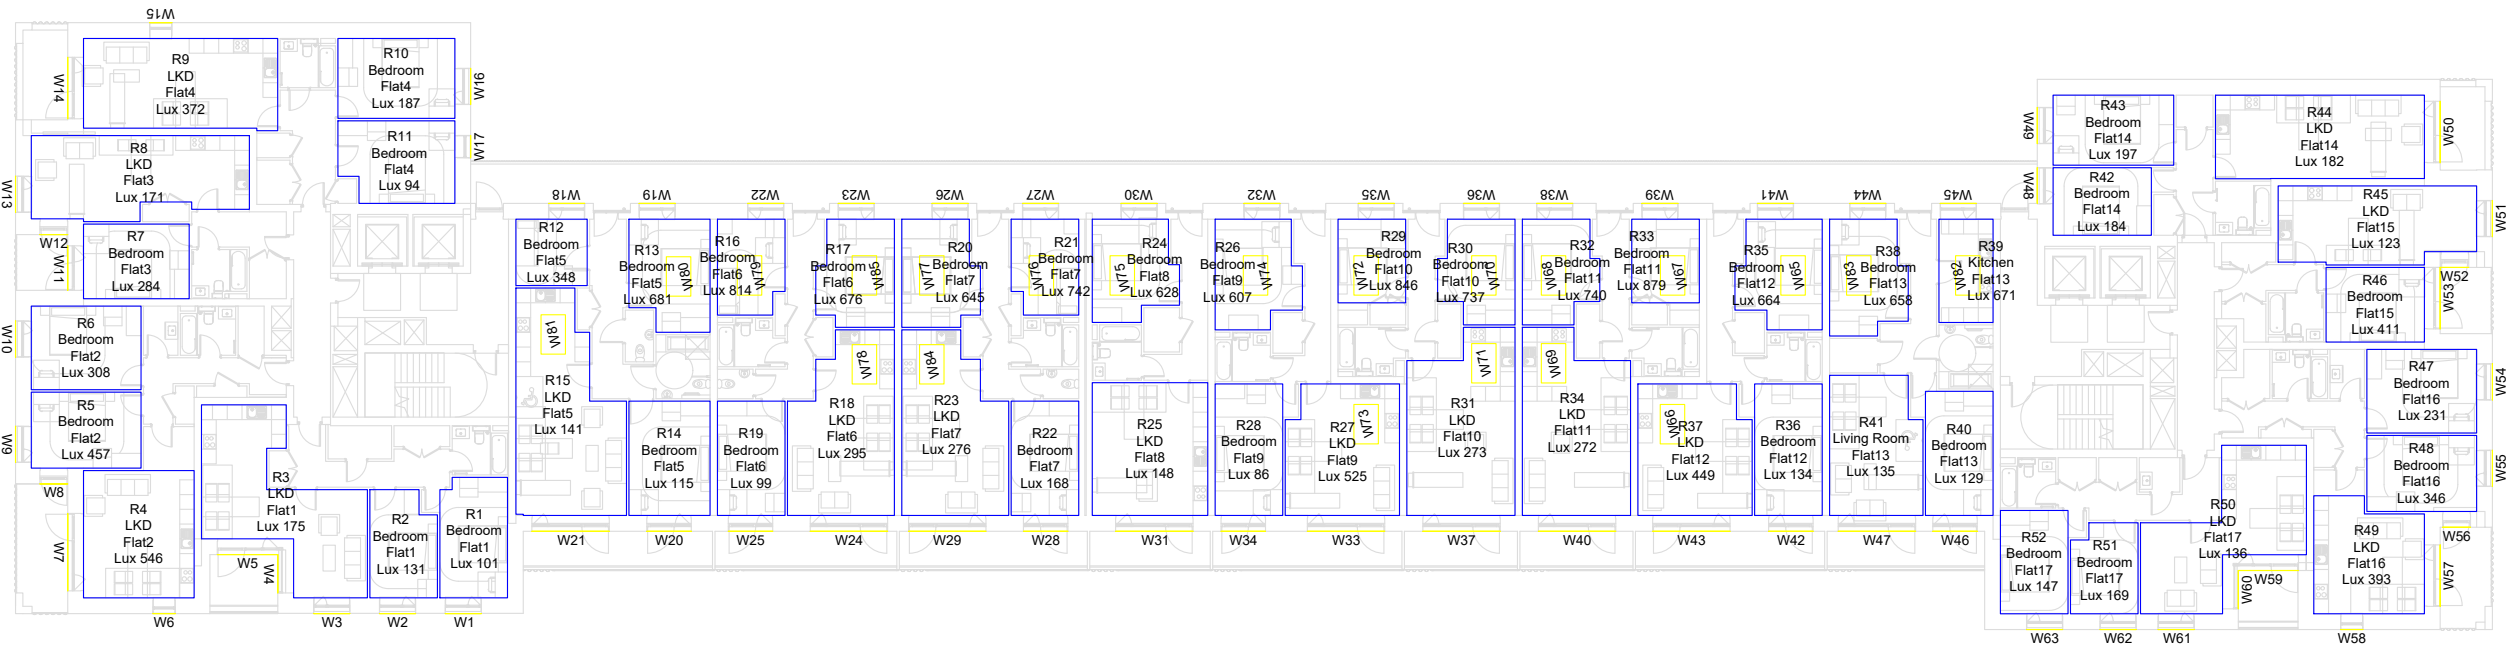

Key Plan

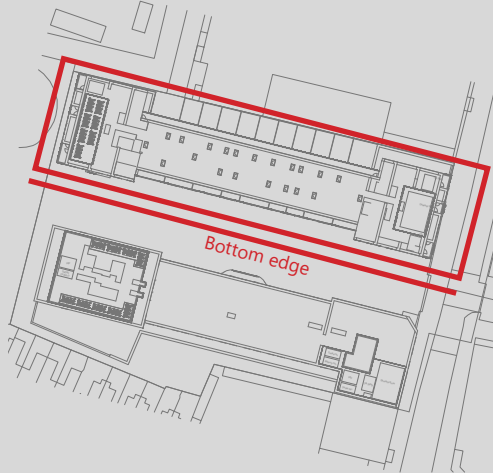

Project Ashley Road Tottenham Hale

Title Fifth Floor  
Room Layout  
C3

Drawn TR Checked --

Date 07/08/2026 Project 10106

Rel no. 08 Prefix ID02 Page no. 27



## Appendix 5

Detailed results of the daylight assessments  
within the C3 Affordable Block (BRE 2011)

|        |      |        |          | Average Daylight Factor (ADF) |
|--------|------|--------|----------|-------------------------------|
| Floor  | Room | Window | Room Use |                               |
|        |      |        |          | Room Total (%)                |
| C3     |      |        |          |                               |
| Ground | R1   | W1-L   | LKD      |                               |
|        |      | W1-U   | LKD      |                               |
|        |      | W2-L   | LKD      |                               |
|        |      | W2-U   | LKD      | 2.09                          |
| Ground | R2   | W3-L   | Bedroom  |                               |
|        |      | W3-U   | Bedroom  |                               |
|        |      | W4-L   | Bedroom  |                               |
|        |      | W4-U   | Bedroom  | 2.12                          |
| Ground | R3   | W5-L   | Bedroom  |                               |
|        |      | W5-U   | Bedroom  | 3.37                          |
| First  | R1   | W1-L   | Bedroom  |                               |
|        |      | W1-U   | Bedroom  | 1.16                          |
| First  | R2   | W2-L   | Bedroom  |                               |
|        |      | W2-U   | Bedroom  | 1.38                          |
| First  | R3   | W3-L   | LKD      |                               |
|        |      | W3-U   | LKD      |                               |
|        |      | W4-L   | LKD      |                               |
|        |      | W4-U   | LKD      |                               |
|        |      | W5-L   | LKD      |                               |
|        |      | W5-U   | LKD      | 1.34                          |
| First  | R4   | W6-L   | LKD      |                               |
|        |      | W6-U   | LKD      |                               |
|        |      | W7-L   | LKD      |                               |
|        |      | W7-U   | LKD      | 2.59                          |
| First  | R5   | W8-L   | Bedroom  |                               |
|        |      | W8-U   | Bedroom  |                               |
|        |      | W9-L   | Bedroom  |                               |
|        |      | W9-U   | Bedroom  | 3.59                          |
| First  | R6   | W10-L  | Bedroom  |                               |
|        |      | W10-U  | Bedroom  | 2.75                          |
| First  | R7   | W11-L  | Bedroom  |                               |
|        |      | W11-U  | Bedroom  | 1.50                          |
| First  | R8   | W12-L  | LKD      |                               |
|        |      | W12-U  | LKD      |                               |
|        |      | W13-L  | LKD      |                               |
|        |      | W13-U  | LKD      | 1.91                          |
| First  | R9   | W14-L  | LKD      |                               |
|        |      | W14-U  | LKD      |                               |
|        |      | W15-L  | LKD      |                               |
|        |      | W15-U  | LKD      | 2.09                          |
| First  | R10  | W16-L  | Bedroom  |                               |
|        |      | W16-U  | Bedroom  | 1.11                          |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|        |     |                                                    |                                          |      |
|--------|-----|----------------------------------------------------|------------------------------------------|------|
| First  | R11 | W17-L<br>W17-U                                     | Bedroom<br>Bedroom                       | 0.61 |
| First  | R12 | W18-L<br>W18-U                                     | Bedroom<br>Bedroom                       | 0.32 |
| First  | R13 | W19-L<br>W19-U                                     | Bedroom<br>Bedroom                       | 1.21 |
| First  | R14 | W20-L<br>W20-U                                     | LKD<br>LKD                               | 0.43 |
| First  | R15 | W21-L<br>W21-U<br>W22-L<br>W22-U                   | LKD<br>LKD<br>LKD<br>LKD                 | 1.41 |
| First  | R16 | W23-L<br>W23-U                                     | Bedroom<br>Bedroom                       | 0.64 |
| First  | R17 | W24-L<br>W24-U                                     | Bedroom<br>Bedroom                       | 1.85 |
| First  | R18 | W25-L<br>W25-U<br>W26-L<br>W26-U                   | Bedroom<br>Bedroom<br>Bedroom<br>Bedroom | 2.05 |
| First  | R19 | W27-L<br>W27-U<br>W28-L<br>W28-U                   | LKD<br>LKD<br>LKD<br>LKD                 | 1.09 |
| First  | R20 | W29-L<br>W29-U<br>W30-L<br>W30-U<br>W31-L<br>W31-U | LKD<br>LKD<br>LKD<br>LKD<br>LKD<br>LKD   | 0.56 |
| First  | R21 | W32-L<br>W32-U                                     | Bedroom<br>Bedroom                       | 1.37 |
| First  | R22 | W33-L<br>W33-U                                     | Bedroom<br>Bedroom                       | 1.22 |
| Second | R1  | W1-L<br>W1-U                                       | Bedroom<br>Bedroom                       | 0.98 |
| Second | R2  | W2-L<br>W2-U                                       | Bedroom<br>Bedroom                       | 1.19 |
| Second | R3  | W3-L<br>W3-U<br>W4-L<br>W4-U<br>W5-L<br>W5-U       | LKD<br>LKD<br>LKD<br>LKD<br>LKD<br>LKD   | 1.26 |

|          |                           |                                  |                                          |            |
|----------|---------------------------|----------------------------------|------------------------------------------|------------|
| 10106    | Internal Daylight Amenity |                                  |                                          | 07/08/2026 |
| R08_ID01 |                           |                                  |                                          |            |
| Second   | R4                        | W6-L<br>W6-U<br>W7-L<br>W7-U     | LKD<br>LKD<br>LKD<br>LKD                 | 2.48       |
| Second   | R5                        | W8-L<br>W8-U<br>W9-L<br>W9-U     | Bedroom<br>Bedroom<br>Bedroom<br>Bedroom | 3.32       |
| Second   | R6                        | W10-L<br>W10-U                   | Bedroom<br>Bedroom                       | 2.52       |
| Second   | R7                        | W11-L<br>W11-U                   | Bedroom<br>Bedroom                       | 1.39       |
| Second   | R8                        | W12-L<br>W12-U<br>W13-L<br>W13-U | LKD<br>LKD<br>LKD<br>LKD                 | 1.66       |
| Second   | R9                        | W14-L<br>W14-U<br>W15-L<br>W15-U | LKD<br>LKD<br>LKD<br>LKD                 | 2.00       |
| Second   | R10                       | W16-L<br>W16-U                   | Bedroom<br>Bedroom                       | 1.14       |
| Second   | R11                       | W17-L<br>W17-U                   | Bedroom<br>Bedroom                       | 0.60       |
| Second   | R12                       | W18                              | Bedroom                                  | 1.23       |
| Second   | R13                       | W19                              | Bedroom                                  | 0.88       |
| Second   | R14                       | W20-L<br>W20-U                   | Bedroom<br>Bedroom                       | 0.42       |
| Second   | R15                       | W21-L<br>W21-U                   | LKD<br>LKD                               | 0.09       |
| Second   | R16                       | W22                              | Bedroom                                  | 1.12       |
| Second   | R17                       | W23                              | Bedroom                                  | 0.67       |
| Second   | R18                       | W24-L<br>W24-U                   | LKD<br>LKD                               | 0.39       |
| Second   | R19                       | W25-L<br>W25-U                   | Bedroom<br>Bedroom                       | 0.17       |
| Second   | R20                       | W26                              | Bedroom                                  | 0.52       |
| Second   | R21                       | W27                              | Bedroom                                  | 0.41       |
| Second   | R22                       | W28-L<br>W28-U                   | Bedroom<br>Bedroom                       | 0.27       |
| Second   | R23                       | W29-L                            | LKD                                      |            |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|        |     |                                  |                            |      |
|--------|-----|----------------------------------|----------------------------|------|
|        |     | W29-U                            | LKD                        | 0.18 |
| Second | R24 | W30                              | Bedroom                    | 0.21 |
| Second | R25 | W31-L<br>W31-U                   | LKD<br>LKD                 | 0.20 |
| Second | R26 | W32                              | Bedroom                    | 0.08 |
| Second | R27 | W33-L<br>W33-U                   | LKD<br>LKD                 | 0.23 |
| Second | R28 | W34-L<br>W34-U                   | Bedroom<br>Bedroom         | 0.20 |
| Second | R29 | W35                              | Bedroom                    | 0.14 |
| Second | R30 | W36                              | Bedroom                    | 0.16 |
| Second | R31 | W37-L<br>W37-U                   | LKD<br>LKD                 | 0.19 |
| Second | R32 | W38                              | Bedroom                    | 0.28 |
| Second | R33 | W39                              | Bedroom                    | 0.39 |
| Second | R34 | W40-L<br>W40-U                   | LKD<br>LKD                 | 0.19 |
| Second | R35 | W41                              | Bedroom                    | 0.21 |
| Second | R36 | W42-L<br>W42-U                   | Bedroom<br>Bedroom         | 0.18 |
| Second | R37 | W43-L<br>W43-U                   | LKD<br>LKD                 | 0.25 |
| Second | R38 | W44                              | Bedroom                    | 0.07 |
| Second | R39 | W45                              | Kitchen                    | 0.00 |
| Second | R40 | W46-L<br>W46-U                   | Bedroom<br>Bedroom         | 0.19 |
| Second | R41 | W47-L<br>W47-U                   | Living Room<br>Living Room | 0.26 |
| Second | R42 | W48-L<br>W48-U                   | Bedroom<br>Bedroom         | 0.40 |
| Second | R43 | W49-L<br>W49-U                   | Bedroom<br>Bedroom         | 1.25 |
| Second | R44 | W50-L<br>W50-U                   | LKD<br>LKD                 | 0.97 |
| Second | R45 | W51-L<br>W51-U<br>W52-L<br>W52-U | LKD<br>LKD<br>LKD<br>LKD   | 1.39 |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|        |     |                                                    |                                          |      |
|--------|-----|----------------------------------------------------|------------------------------------------|------|
| Second | R46 | W53-L<br>W53-U                                     | Bedroom<br>Bedroom                       | 1.63 |
| Second | R47 | W54-L<br>W54-U                                     | Bedroom<br>Bedroom                       | 1.92 |
| Second | R48 | W55-L<br>W55-U<br>W56-L<br>W56-U                   | Bedroom<br>Bedroom<br>Bedroom<br>Bedroom | 2.16 |
| Second | R49 | W57-L<br>W57-U<br>W58-L<br>W58-U                   | LKD<br>LKD<br>LKD<br>LKD                 | 1.81 |
| Second | R50 | W59-L<br>W59-U<br>W60-L<br>W60-U<br>W61-L<br>W61-U | LKD<br>LKD<br>LKD<br>LKD<br>LKD<br>LKD   | 0.64 |
| Second | R51 | W62-L<br>W62-U                                     | Bedroom<br>Bedroom                       | 1.54 |
| Second | R52 | W63-L<br>W63-U                                     | Bedroom<br>Bedroom                       | 1.38 |
| Third  | R1  | W1-L<br>W1-U                                       | Bedroom<br>Bedroom                       | 1.00 |
| Third  | R2  | W2-L<br>W2-U                                       | Bedroom<br>Bedroom                       | 1.21 |
| Third  | R3  | W3-L<br>W3-U<br>W4-L<br>W4-U<br>W5-L<br>W5-U       | LKD<br>LKD<br>LKD<br>LKD<br>LKD<br>LKD   | 1.27 |
| Third  | R4  | W6-L<br>W6-U<br>W7-L<br>W7-U                       | LKD<br>LKD<br>LKD<br>LKD                 | 2.47 |
| Third  | R5  | W8-L<br>W8-U<br>W9-L<br>W9-U                       | Bedroom<br>Bedroom<br>Bedroom<br>Bedroom | 3.35 |
| Third  | R6  | W10-L<br>W10-U                                     | Bedroom<br>Bedroom                       | 2.54 |
| Third  | R7  | W11-L<br>W11-U                                     | Bedroom<br>Bedroom                       | 1.39 |
| Third  | R8  | W12-L                                              | LKD                                      |      |

|       |     |       |         |      |
|-------|-----|-------|---------|------|
|       |     | W12-U | LKD     |      |
|       |     | W13-L | LKD     |      |
|       |     | W13-U | LKD     | 1.67 |
| Third | R9  | W14-L | LKD     |      |
|       |     | W14-U | LKD     |      |
|       |     | W15-L | LKD     |      |
|       |     | W15-U | LKD     | 1.98 |
| Third | R10 | W16-L | Bedroom |      |
|       |     | W16-U | Bedroom | 1.32 |
| Third | R11 | W17-L | Bedroom |      |
|       |     | W17-U | Bedroom | 0.66 |
| Third | R12 | W18   | Bedroom | 1.25 |
| Third | R13 | W19   | Bedroom | 0.89 |
| Third | R14 | W20-L | Bedroom |      |
|       |     | W20-U | Bedroom | 0.51 |
| Third | R15 | W21-L | LKD     |      |
|       |     | W21-U | LKD     | 0.24 |
| Third | R16 | W22   | Bedroom | 1.13 |
| Third | R17 | W23   | Bedroom | 0.78 |
| Third | R18 | W24-L | LKD     |      |
|       |     | W24-U | LKD     | 0.55 |
| Third | R19 | W25-L | Bedroom |      |
|       |     | W25-U | Bedroom | 0.50 |
| Third | R20 | W26   | Bedroom | 0.52 |
| Third | R21 | W27   | Bedroom | 0.41 |
| Third | R22 | W28-L | Bedroom |      |
|       |     | W28-U | Bedroom | 0.57 |
| Third | R23 | W29-L | LKD     |      |
|       |     | W29-U | LKD     | 0.53 |
| Third | R24 | W30   | Bedroom | 0.21 |
| Third | R25 | W31-L | LKD     |      |
|       |     | W31-U | LKD     | 0.65 |
| Third | R26 | W32   | Bedroom | 0.10 |
| Third | R27 | W33-L | LKD     |      |
|       |     | W33-U | LKD     | 0.71 |
| Third | R28 | W34-L | Bedroom |      |
|       |     | W34-U | Bedroom | 0.53 |
| Third | R29 | W35   | Bedroom | 0.21 |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|       |     |       |             |      |
|-------|-----|-------|-------------|------|
| Third | R30 | W36   | Bedroom     | 0.25 |
| Third | R31 | W37-L | LKD         | 0.57 |
|       |     | W37-U | LKD         |      |
| Third | R32 | W38   | Bedroom     | 0.34 |
| Third | R33 | W39   | Bedroom     | 0.44 |
| Third | R34 | W40-L | LKD         | 0.56 |
|       |     | W40-U | LKD         |      |
| Third | R35 | W41   | Bedroom     | 0.25 |
| Third | R36 | W42-L | Bedroom     | 0.57 |
|       |     | W42-U | Bedroom     |      |
| Third | R37 | W43-L | LKD         | 0.69 |
|       |     | W43-U | LKD         |      |
| Third | R38 | W44   | Bedroom     | 0.11 |
| Third | R39 | W45   | Kitchen     | 0.11 |
| Third | R40 | W46-L | Bedroom     | 0.40 |
|       |     | W46-U | Bedroom     |      |
| Third | R41 | W47-L | Living Room | 0.46 |
|       |     | W47-U | Living Room |      |
| Third | R42 | W48-L | Bedroom     | 0.49 |
|       |     | W48-U | Bedroom     |      |
| Third | R43 | W49-L | Bedroom     | 1.41 |
|       |     | W49-U | Bedroom     |      |
| Third | R44 | W50-L | LKD         | 1.01 |
|       |     | W50-U | LKD         |      |
| Third | R45 | W51-L | LKD         | 1.48 |
|       |     | W51-U | LKD         |      |
|       |     | W52-L | LKD         |      |
|       |     | W52-U | LKD         |      |
| Third | R46 | W53-L | Bedroom     | 1.85 |
|       |     | W53-U | Bedroom     |      |
| Third | R47 | W54-L | Bedroom     | 2.04 |
|       |     | W54-U | Bedroom     |      |
| Third | R48 | W55-L | Bedroom     | 2.31 |
|       |     | W55-U | Bedroom     |      |
|       |     | W56-L | Bedroom     |      |
|       |     | W56-U | Bedroom     |      |
| Third | R49 | W57-L | LKD         | 2.02 |
|       |     | W57-U | LKD         |      |
|       |     | W58-L | LKD         |      |
|       |     | W58-U | LKD         |      |

|                   |                           |                                                    |                                          |             |
|-------------------|---------------------------|----------------------------------------------------|------------------------------------------|-------------|
| 10106<br>R08_ID01 | Internal Daylight Amenity |                                                    |                                          | 07/08/2026  |
| Third             | R50                       | W59-L<br>W59-U<br>W60-L<br>W60-U<br>W61-L<br>W61-U | LKD<br>LKD<br>LKD<br>LKD<br>LKD<br>LKD   | <b>0.75</b> |
| Third             | R51                       | W62-L<br>W62-U                                     | Bedroom<br>Bedroom                       | <b>1.76</b> |
| Third             | R52                       | W63-L<br>W63-U                                     | Bedroom<br>Bedroom                       | <b>1.57</b> |
| Fourth            | R1                        | W1-L<br>W1-U                                       | Bedroom<br>Bedroom                       | <b>1.01</b> |
| Fourth            | R2                        | W2-L<br>W2-U                                       | Bedroom<br>Bedroom                       | <b>1.22</b> |
| Fourth            | R3                        | W3-L<br>W3-U<br>W4-L<br>W4-U<br>W5-L<br>W5-U       | LKD<br>LKD<br>LKD<br>LKD<br>LKD<br>LKD   | <b>1.28</b> |
| Fourth            | R4                        | W6-L<br>W6-U<br>W7-L<br>W7-U                       | LKD<br>LKD<br>LKD<br>LKD                 | <b>2.49</b> |
| Fourth            | R5                        | W8-L<br>W8-U<br>W9-L<br>W9-U                       | Bedroom<br>Bedroom<br>Bedroom<br>Bedroom | <b>3.38</b> |
| Fourth            | R6                        | W10-L<br>W10-U                                     | Bedroom<br>Bedroom                       | <b>2.56</b> |
| Fourth            | R7                        | W11-L<br>W11-U                                     | Bedroom<br>Bedroom                       | <b>1.40</b> |
| Fourth            | R8                        | W12-L<br>W12-U<br>W13-L<br>W13-U                   | LKD<br>LKD<br>LKD<br>LKD                 | <b>1.69</b> |
| Fourth            | R9                        | W14-L<br>W14-U<br>W15-L<br>W15-U                   | LKD<br>LKD<br>LKD<br>LKD                 | <b>2.00</b> |
| Fourth            | R10                       | W16-L<br>W16-U                                     | Bedroom<br>Bedroom                       | <b>1.54</b> |
| Fourth            | R11                       | W17-L<br>W17-U                                     | Bedroom<br>Bedroom                       | <b>0.78</b> |
| Fourth            | R12                       | W18                                                | Bedroom                                  | <b>1.28</b> |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|        |     |                |                    |      |
|--------|-----|----------------|--------------------|------|
| Fourth | R13 | W19            | Bedroom            | 0.90 |
| Fourth | R14 | W20-L<br>W20-U | Bedroom<br>Bedroom | 0.48 |
| Fourth | R15 | W21-L<br>W21-U | LKD<br>LKD         | 0.32 |
| Fourth | R16 | W22            | Bedroom            | 1.13 |
| Fourth | R17 | W23            | Bedroom            | 0.78 |
| Fourth | R18 | W24-L<br>W24-U | LKD<br>LKD         | 0.76 |
| Fourth | R19 | W25-L<br>W25-U | Bedroom<br>Bedroom | 0.75 |
| Fourth | R20 | W26            | Bedroom            | 0.52 |
| Fourth | R21 | W27            | Bedroom            | 0.41 |
| Fourth | R22 | W28-L<br>W28-U | Bedroom<br>Bedroom | 0.88 |
| Fourth | R23 | W29-L<br>W29-U | LKD<br>LKD         | 0.84 |
| Fourth | R24 | W30            | Bedroom            | 0.21 |
| Fourth | R25 | W31-L<br>W31-U | LKD<br>LKD         | 1.03 |
| Fourth | R26 | W32            | Bedroom            | 0.11 |
| Fourth | R27 | W33-L<br>W33-U | LKD<br>LKD         | 1.15 |
| Fourth | R28 | W34-L<br>W34-U | Bedroom<br>Bedroom | 0.94 |
| Fourth | R29 | W35            | Bedroom            | 0.28 |
| Fourth | R30 | W36            | Bedroom            | 0.32 |
| Fourth | R31 | W37-L<br>W37-U | LKD<br>LKD         | 0.94 |
| Fourth | R32 | W38            | Bedroom            | 0.40 |
| Fourth | R33 | W39            | Bedroom            | 0.53 |
| Fourth | R34 | W40-L<br>W40-U | LKD<br>LKD         | 0.94 |
| Fourth | R35 | W41            | Bedroom            | 0.34 |
| Fourth | R36 | W42-L<br>W42-U | Bedroom<br>Bedroom | 0.91 |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|        |     |                                                    |                                          |      |
|--------|-----|----------------------------------------------------|------------------------------------------|------|
| Fourth | R37 | W43-L<br>W43-U                                     | LKD<br>LKD                               | 1.20 |
| Fourth | R38 | W44                                                | Bedroom                                  | 0.27 |
| Fourth | R39 | W45                                                | Kitchen                                  | 0.29 |
| Fourth | R40 | W46-L<br>W46-U                                     | Bedroom<br>Bedroom                       | 0.97 |
| Fourth | R41 | W47-L<br>W47-U                                     | Living Room<br>Living Room               | 1.28 |
| Fourth | R42 | W48-L<br>W48-U                                     | Bedroom<br>Bedroom                       | 0.61 |
| Fourth | R43 | W49-L<br>W49-U                                     | Bedroom<br>Bedroom                       | 1.68 |
| Fourth | R44 | W50-L<br>W50-U                                     | LKD<br>LKD                               | 1.04 |
| Fourth | R45 | W51-L<br>W51-U<br>W52-L<br>W52-U                   | LKD<br>LKD<br>LKD<br>LKD                 | 1.54 |
| Fourth | R46 | W53-L<br>W53-U                                     | Bedroom<br>Bedroom                       | 1.90 |
| Fourth | R47 | W54-L<br>W54-U                                     | Bedroom<br>Bedroom                       | 2.09 |
| Fourth | R48 | W55-L<br>W55-U<br>W56-L<br>W56-U                   | Bedroom<br>Bedroom<br>Bedroom<br>Bedroom | 2.33 |
| Fourth | R49 | W57-L<br>W57-U<br>W58-L<br>W58-U                   | LKD<br>LKD<br>LKD<br>LKD                 | 1.92 |
| Fourth | R50 | W59-L<br>W59-U<br>W60-L<br>W60-U<br>W61-L<br>W61-U | LKD<br>LKD<br>LKD<br>LKD<br>LKD<br>LKD   | 0.88 |
| Fourth | R51 | W62-L<br>W62-U                                     | Bedroom<br>Bedroom                       | 1.97 |
| Fourth | R52 | W63-L<br>W63-U                                     | Bedroom<br>Bedroom                       | 1.77 |
| Fifth  | R1  | W1-L<br>W1-U                                       | Bedroom<br>Bedroom                       | 1.02 |
| Fifth  | R2  | W2-L                                               | Bedroom                                  |      |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|       |     |       |         |      |
|-------|-----|-------|---------|------|
|       |     | W2-U  | Bedroom | 1.23 |
| Fifth | R3  | W3-L  | LKD     |      |
|       |     | W3-U  | LKD     |      |
|       |     | W4-L  | LKD     |      |
|       |     | W4-U  | LKD     |      |
|       |     | W5-L  | LKD     |      |
|       |     | W5-U  | LKD     | 1.29 |
| Fifth | R4  | W6-L  | LKD     |      |
|       |     | W6-U  | LKD     |      |
|       |     | W7-L  | LKD     |      |
|       |     | W7-U  | LKD     | 4.31 |
| Fifth | R5  | W8-L  | Bedroom |      |
|       |     | W8-U  | Bedroom |      |
|       |     | W9-L  | Bedroom |      |
|       |     | W9-U  | Bedroom | 3.97 |
| Fifth | R6  | W10-L | Bedroom |      |
|       |     | W10-U | Bedroom | 2.57 |
| Fifth | R7  | W11-L | Bedroom |      |
|       |     | W11-U | Bedroom | 2.51 |
| Fifth | R8  | W12-L | LKD     |      |
|       |     | W12-U | LKD     |      |
|       |     | W13-L | LKD     |      |
|       |     | W13-U | LKD     | 1.88 |
| Fifth | R9  | W14-L | LKD     |      |
|       |     | W14-U | LKD     |      |
|       |     | W15-L | LKD     |      |
|       |     | W15-U | LKD     | 3.02 |
| Fifth | R10 | W16-L | Bedroom |      |
|       |     | W16-U | Bedroom | 1.80 |
| Fifth | R11 | W17-L | Bedroom |      |
|       |     | W17-U | Bedroom | 1.02 |
| Fifth | R12 | W18   | Bedroom | 2.87 |
| Fifth | R13 | W19   | Bedroom |      |
|       |     | W80   | Bedroom | 4.88 |
| Fifth | R14 | W20-L | Bedroom |      |
|       |     | W20-U | Bedroom | 0.69 |
| Fifth | R15 | W21-L | LKD     |      |
|       |     | W21-U | LKD     |      |
|       |     | W81   | LKD     | 1.61 |
| Fifth | R16 | W22   | Bedroom |      |
|       |     | W79   | Bedroom | 6.19 |
| Fifth | R17 | W23   | Bedroom |      |
|       |     | W85   | Bedroom | 5.13 |
| Fifth | R18 | W24-L | LKD     |      |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|       |     |       |         |      |
|-------|-----|-------|---------|------|
|       |     | W24-U | LKD     |      |
|       |     | W78   | LKD     | 2.68 |
| Fifth | R19 | W25-L | Bedroom |      |
|       |     | W25-U | Bedroom | 0.89 |
| Fifth | R20 | W26   | Bedroom |      |
|       |     | W77   | Bedroom | 4.77 |
| Fifth | R21 | W27   | Bedroom |      |
|       |     | W76   | Bedroom | 5.62 |
| Fifth | R22 | W28-L | Bedroom |      |
|       |     | W28-U | Bedroom | 1.16 |
| Fifth | R23 | W29-L | LKD     |      |
|       |     | W29-U | LKD     |      |
|       |     | W84   | LKD     | 2.80 |
| Fifth | R24 | W30   | Bedroom |      |
|       |     | W75   | Bedroom | 4.62 |
| Fifth | R25 | W31-L | LKD     |      |
|       |     | W31-U | LKD     | 1.28 |
| Fifth | R26 | W32   | Bedroom |      |
|       |     | W74   | Bedroom | 4.42 |
| Fifth | R27 | W33-L | LKD     |      |
|       |     | W33-U | LKD     |      |
|       |     | W73   | LKD     | 3.57 |
| Fifth | R28 | W34-L | Bedroom |      |
|       |     | W34-U | Bedroom | 0.87 |
| Fifth | R29 | W35   | Bedroom |      |
|       |     | W72   | Bedroom | 6.36 |
| Fifth | R30 | W36   | Bedroom |      |
|       |     | W70   | Bedroom | 5.23 |
| Fifth | R31 | W37-L | LKD     |      |
|       |     | W37-U | LKD     |      |
|       |     | W71   | LKD     | 2.88 |
| Fifth | R32 | W38   | Bedroom |      |
|       |     | W68   | Bedroom | 5.30 |
| Fifth | R33 | W39   | Bedroom |      |
|       |     | W67   | Bedroom | 6.66 |
| Fifth | R34 | W40-L | LKD     |      |
|       |     | W40-U | LKD     |      |
|       |     | W69   | LKD     | 2.86 |
| Fifth | R35 | W41   | Bedroom |      |
|       |     | W65   | Bedroom | 4.76 |
| Fifth | R36 | W42-L | Bedroom |      |
|       |     | W42-U | Bedroom | 1.17 |

|       |     |                                                    |                                          |      |
|-------|-----|----------------------------------------------------|------------------------------------------|------|
| Fifth | R37 | W43-L<br>W43-U<br>W66                              | LKD<br>LKD<br>LKD                        | 3.50 |
| Fifth | R38 | W44<br>W83                                         | Bedroom<br>Bedroom                       | 4.94 |
| Fifth | R39 | W45<br>W82                                         | Kitchen<br>Kitchen                       | 5.47 |
| Fifth | R40 | W46-L<br>W46-U                                     | Bedroom<br>Bedroom                       | 1.19 |
| Fifth | R41 | W47-L<br>W47-U                                     | Living Room<br>Living Room               | 1.26 |
| Fifth | R42 | W48-L<br>W48-U                                     | Bedroom<br>Bedroom                       | 1.92 |
| Fifth | R43 | W49-L<br>W49-U                                     | Bedroom<br>Bedroom                       | 1.94 |
| Fifth | R44 | W50-L<br>W50-U                                     | LKD<br>LKD                               | 2.07 |
| Fifth | R45 | W51-L<br>W51-U<br>W52-L<br>W52-U                   | LKD<br>LKD<br>LKD<br>LKD                 | 1.88 |
| Fifth | R46 | W53-L<br>W53-U                                     | Bedroom<br>Bedroom                       | 3.80 |
| Fifth | R47 | W54-L<br>W54-U                                     | Bedroom<br>Bedroom                       | 2.13 |
| Fifth | R48 | W55-L<br>W55-U<br>W56-L<br>W56-U                   | Bedroom<br>Bedroom<br>Bedroom<br>Bedroom | 2.99 |
| Fifth | R49 | W57-L<br>W57-U<br>W58-L<br>W58-U                   | LKD<br>LKD<br>LKD<br>LKD                 | 3.37 |
| Fifth | R50 | W59-L<br>W59-U<br>W60-L<br>W60-U<br>W61-L<br>W61-U | LKD<br>LKD<br>LKD<br>LKD<br>LKD<br>LKD   | 1.29 |
| Fifth | R51 | W62-L<br>W62-U                                     | Bedroom<br>Bedroom                       | 2.19 |
| Fifth | R52 | W63-L<br>W63-U                                     | Bedroom<br>Bedroom                       | 1.96 |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

C3 DP10

|        |    |      |             |      |
|--------|----|------|-------------|------|
| Ground | R1 | W1-L | Kitchen     | 1.58 |
|        |    | W1-U | Kitchen     |      |
|        |    | W2-L | Kitchen     |      |
|        |    | W2-U | Kitchen     |      |
| Ground | R2 | W3-L | Living Room | 2.05 |
|        |    | W3-U | Living Room |      |
| First  | R1 | W1-L | Bedroom     | 1.43 |
|        |    | W1-U | Bedroom     |      |
| First  | R2 | W2-L | Bedroom     | 0.49 |
|        |    | W2-U | Bedroom     |      |
| First  | R3 | W3-L | Bedroom     | 0.85 |
|        |    | W3-U | Bedroom     |      |
| First  | R4 | W4-L | Bedroom     | 0.99 |
|        |    | W4-U | Bedroom     |      |

C3 DP01

|        |    |      |             |      |
|--------|----|------|-------------|------|
| Ground | R1 | W1-L | Kitchen     | 1.90 |
|        |    | W1-U | Kitchen     |      |
|        |    | W2-L | Kitchen     |      |
|        |    | W2-U | Kitchen     |      |
|        |    | W3-L | Kitchen     |      |
|        |    | W3-U | Kitchen     |      |
| Ground | R2 | W4-L | Living Room | 1.06 |
|        |    | W4-U | Living Room |      |
| First  | R1 | W1-L | Bedroom     | 1.05 |
|        |    | W1-U | Bedroom     |      |
| First  | R2 | W2-L | Bedroom     | 1.44 |
|        |    | W2-U | Bedroom     |      |
|        |    | W3-L | Bedroom     |      |
|        |    | W3-U | Bedroom     |      |
| First  | R3 | W4-L | Bedroom     | 0.59 |
|        |    | W4-U | Bedroom     |      |
| First  | R4 | W5-L | Bedroom     | 0.95 |
|        |    | W5-U | Bedroom     |      |
|        |    | W6-L | Bedroom     |      |
|        |    | W6-U | Bedroom     |      |

C3 DP02

|        |    |      |             |      |
|--------|----|------|-------------|------|
| Ground | R1 | W1-L | Kitchen     | 1.61 |
|        |    | W1-U | Kitchen     |      |
|        |    | W2-L | Kitchen     |      |
|        |    | W2-U | Kitchen     |      |
| Ground | R2 | W3-L | Living Room | 1.20 |
|        |    | W3-U | Living Room |      |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|         |    |                              |                                          |      |
|---------|----|------------------------------|------------------------------------------|------|
| First   | R1 | W1-L<br>W1-U                 | Bedroom<br>Bedroom                       | 1.67 |
| First   | R2 | W2-L<br>W2-U                 | Bedroom<br>Bedroom                       | 0.71 |
| First   | R3 | W3-L<br>W3-U                 | Bedroom<br>Bedroom                       | 0.54 |
| First   | R4 | W4-L<br>W4-U                 | Bedroom<br>Bedroom                       | 0.67 |
| C3 DP03 |    |                              |                                          |      |
| Ground  | R1 | W1-L<br>W1-U<br>W2-L<br>W2-U | Kitchen<br>Kitchen<br>Kitchen<br>Kitchen | 1.61 |
| Ground  | R2 | W3-L<br>W3-U                 | Living Room<br>Living Room               | 1.26 |
| First   | R1 | W1-L<br>W1-U                 | Bedroom<br>Bedroom                       | 0.71 |
| First   | R2 | W2-L<br>W2-U                 | Bedroom<br>Bedroom                       | 1.66 |
| First   | R3 | W3-L<br>W3-U                 | Bedroom<br>Bedroom                       | 0.72 |
| First   | R4 | W4-L<br>W4-U                 | Bedroom<br>Bedroom                       | 0.56 |
| C3 DP04 |    |                              |                                          |      |
| Ground  | R1 | W1-L<br>W1-U<br>W2-L<br>W2-U | Kitchen<br>Kitchen<br>Kitchen<br>Kitchen | 1.62 |
| Ground  | R2 | W3-L<br>W3-U                 | Living Room<br>Living Room               | 1.20 |
| First   | R1 | W1-L<br>W1-U                 | Bedroom<br>Bedroom                       | 1.65 |
| First   | R2 | W2-L<br>W2-U                 | Bedroom<br>Bedroom                       | 0.69 |
| First   | R3 | W3-L<br>W3-U                 | Bedroom<br>Bedroom                       | 0.50 |
| First   | R4 | W4-L<br>W4-U                 | Bedroom<br>Bedroom                       | 0.70 |
| C3 DP05 |    |                              |                                          |      |
| Ground  | R1 | W1-L<br>W1-U                 | Kitchen<br>Kitchen                       |      |

10106  
R08\_ID01

Internal Daylight Amenity

07/08/2026

|         |    |      |             |      |
|---------|----|------|-------------|------|
|         |    | W2-L | Kitchen     |      |
|         |    | W2-U | Kitchen     | 1.55 |
| Ground  | R2 | W3-L | Living Room |      |
|         |    | W3-U | Living Room | 1.05 |
| First   | R1 | W1-L | Bedroom     |      |
|         |    | W1-U | Bedroom     | 0.68 |
| First   | R2 | W2-L | Bedroom     |      |
|         |    | W2-U | Bedroom     | 1.60 |
| First   | R3 | W3-L | Bedroom     |      |
|         |    | W3-U | Bedroom     | 0.56 |
| First   | R4 | W4-L | Bedroom     |      |
|         |    | W4-U | Bedroom     | 0.46 |
| C3 DP06 |    |      |             |      |
| Ground  | R1 | W1-L | Kitchen     |      |
|         |    | W1-U | Kitchen     |      |
|         |    | W2-L | Kitchen     |      |
|         |    | W2-U | Kitchen     | 1.62 |
| Ground  | R2 | W3-L | Living Room |      |
|         |    | W3-U | Living Room | 0.95 |
| First   | R1 | W1-L | Bedroom     |      |
|         |    | W1-U | Bedroom     | 1.58 |
| First   | R2 | W2-L | Bedroom     |      |
|         |    | W2-U | Bedroom     | 0.65 |
| First   | R3 | W3-L | Bedroom     |      |
|         |    | W3-U | Bedroom     | 0.34 |
| First   | R4 | W4-L | Bedroom     |      |
|         |    | W4-U | Bedroom     | 0.50 |
| C3 DP07 |    |      |             |      |
| Ground  | R1 | W1-L | Kitchen     |      |
|         |    | W1-U | Kitchen     |      |
|         |    | W2-L | Kitchen     |      |
|         |    | W2-U | Kitchen     | 1.51 |
| Ground  | R2 | W3-L | Living Room |      |
|         |    | W3-U | Living Room | 0.87 |
| First   | R1 | W1-L | Bedroom     |      |
|         |    | W1-U | Bedroom     | 0.63 |
| First   | R2 | W2-L | Bedroom     |      |
|         |    | W2-U | Bedroom     | 1.51 |
| First   | R3 | W3-L | Bedroom     |      |
|         |    | W3-U | Bedroom     | 0.31 |
| First   | R4 | W4-L | Bedroom     |      |

|         |    |      |             |      |
|---------|----|------|-------------|------|
|         |    | W4-U | Bedroom     | 0.28 |
| C3 DP08 |    |      |             |      |
| Ground  | R1 | W1-L | Kitchen     |      |
|         |    | W1-U | Kitchen     |      |
|         |    | W2-L | Kitchen     |      |
|         |    | W2-U | Kitchen     | 1.58 |
| Ground  | R2 | W3-L | Living Room |      |
|         |    | W3-U | Living Room | 0.96 |
| First   | R1 | W1-L | Bedroom     |      |
|         |    | W1-U | Bedroom     | 1.48 |
| First   | R2 | W2-L | Bedroom     |      |
|         |    | W2-U | Bedroom     | 0.59 |
| First   | R3 | W3-L | Bedroom     |      |
|         |    | W3-U | Bedroom     | 0.19 |
| First   | R4 | W4-L | Bedroom     |      |
|         |    | W4-U | Bedroom     | 0.20 |
| C3 DP09 |    |      |             |      |
| Ground  | R1 | W1-L | Kitchen     |      |
|         |    | W1-U | Kitchen     |      |
|         |    | W2-L | Kitchen     |      |
|         |    | W2-U | Kitchen     | 1.53 |
| Ground  | R2 | W3-L | Living Room |      |
|         |    | W3-U | Living Room | 1.41 |
| First   | R1 | W1-L | Bedroom     |      |
|         |    | W1-U | Bedroom     | 0.56 |
| First   | R2 | W2-L | Bedroom     |      |
|         |    | W2-U | Bedroom     | 1.44 |
| First   | R3 | W3-L | Bedroom     |      |
|         |    | W3-U | Bedroom     | 0.72 |
| First   | R4 | W4-L | Bedroom     |      |
|         |    | W4-U | Bedroom     | 0.41 |



## Appendix 6

Additional balconies and access decks off results  
within the C3 Affordable block (BRE 2022)

| Building Name | Unit No. | Floor  | Room | Window         | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3            | Flat1    | Ground | R1   | W1             | LKD      | 150               | 69%                      | 286                | 1.5                    | 2.5               | N/F          |
|               |          |        |      | W2             |          |                   |                          |                    |                        |                   |              |
|               |          |        | R2   | W3<br>W4       | Bedroom  | 100               | 100%                     | 193                | 1.5                    | 0.4               | N/F          |
|               | Flat1    | First  | R3   | W5             | Bedroom  | 100               | 100%                     | 349                | 1.5                    | 1.0               | N/F          |
|               |          |        | R1   | W1             | Bedroom  | 100               | 32%                      | 73                 | 1.5                    | 1.9               | N/F          |
|               |          |        |      | W2             | Bedroom  | 100               | 49%                      | 96                 | 1.5                    | 2.3               |              |
|               |          |        | R3   | W3<br>W4<br>W5 | LKD      | 150               | 47%                      | 141                | 1.5                    | 3.3               |              |
|               |          |        |      |                |          |                   |                          |                    |                        |                   |              |
|               |          |        | R4   | W6<br>W7       | LKD      | 150               | 100%                     | 332                | 1.5                    | 4.0               |              |
|               |          |        |      | W8<br>W9       | Bedroom  | 100               | 100%                     | 341                | 1.5                    | 2.8               |              |
|               |          |        |      | W10            | Bedroom  | 100               | 100%                     | 291                | 1.5                    | 2.6               |              |
|               | Flat3    | First  | R7   | W11            | Bedroom  | 100               | 100%                     | 171                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13     | LKD      | 150               | 54%                      | 169                | 1.5                    | 2.5               | N/F          |
|               | Flat4    | First  | R9   | W14<br>W15     | LKD      | 150               | 74%                      | 252                | 1.5                    | 0.1               | N/F<br>N/F   |

| Building Name | Unit No. | Floor | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |       | R10  | W16               | Bedroom  | 100               | 44%                      | 89                 | 1.5                    | 0.0               |              |
|               |          |       | R11  | W17               | Bedroom  | 100               | 17%                      | 47                 | 1.5                    | 0.0               |              |
|               | Flat5    | First | R12  | W18               | Bedroom  | 100               | 0%                       | 10                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R13  | W19               | Bedroom  | 100               | 45%                      | 91                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R14  | W20               | LKD      | 150               | 3%                       | 33                 | 1.5                    | 0.8               |              |
|               | Flat6    | First | R15  | W21<br>W22        | LKD      | 150               | 19%                      | 41                 | 1.5                    | 1.9               |              |
|               |          |       | R16  | W23               | Bedroom  | 100               | 24%                      | 69                 | 1.5                    | 0.8               |              |
|               | Flat7    | First | R17  | W24               | Bedroom  | 100               | 54%                      | 108                | 1.5                    | 0.5               |              |
|               |          |       | R18  | W25<br>W26        | Bedroom  | 100               | 65%                      | 135                | 1.5                    | 0.2               |              |
|               |          |       | R19  | W27<br>W28        | LKD      | 150               | 16%                      | 107                | 1.5                    | 0.9               |              |
|               | Flat8    | First | R20  | W29<br>W30<br>W31 | LKD      | 150               | 6%                       | 67                 | 1.5                    | 0.0               |              |
|               |          |       | R21  | W32               | Bedroom  | 100               | 30%                      | 80                 | 1.5                    | 0.0               |              |
|               |          |       | R22  | W33               | Bedroom  | 100               | 23%                      | 71                 | 1.5                    | 0.0               |              |

| Building Name | Unit No. | Floor  | Room | Window         | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat1    | Second | R1   | W1             | Bedroom  | 100               | 43%                      | 87                 | 1.5                    | 0.5               |              |
|               |          |        | R2   | W2             | Bedroom  | 100               | 63%                      | 114                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5 | LKD      | 150               | 53%                      | 164                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Second | R4   | W6<br>W7       | LKD      | 150               | 100%                     | 362                | 1.5                    | 1.5               | N/F          |
|               |          |        | R5   | W8<br>W9       | Bedroom  | 100               | 100%                     | 382                | 1.5                    | 1.0               | N/F          |
|               |          |        | R6   | W10            | Bedroom  | 100               | 100%                     | 314                | 1.5                    | 0.6               | N/F          |
|               | Flat3    | Second | R7   | W11            | Bedroom  | 100               | 100%                     | 175                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13     | LKD      | 150               | 53%                      | 161                | 1.5                    | 0.7               | N/F          |
|               | Flat4    | Second | R9   | W14<br>W15     | LKD      | 150               | 78%                      | 275                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |        | R10  | W16            | Bedroom  | 100               | 56%                      | 108                | 1.5                    | 0.4               |              |
|               |          |        | R11  | W17            | Bedroom  | 100               | 24%                      | 60                 | 1.5                    | 0.1               |              |
|               | Flat5    | Second | R12  | W18            | Bedroom  | 100               | 100%                     | 276                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        | R13  | W19    | Bedroom  | 100               | 98%                      | 185                | 1.5                    | 0.0               | N/F          |
|               |          |        | R14  | W20    | Bedroom  | 100               | 76%                      | 129                | 1.5                    | 1.7               |              |
|               |          |        | R15  | W21    | LKD      | 150               | 25%                      | 97                 | 1.5                    | 1.4               |              |
|               | Flat6    | Second | R16  | W22    | Bedroom  | 100               | 100%                     | 168                | 1.5                    | 0.0               | N/F          |
|               |          |        | R17  | W23    | Bedroom  | 100               | 46%                      | 94                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R18  | W24    | LKD      | 150               | 61%                      | 169                | 1.5                    | 3.0               |              |
|               |          |        | R19  | W25    | Bedroom  | 100               | 100%                     | 175                | 1.5                    | 2.0               |              |
|               | Flat7    | Second | R20  | W26    | Bedroom  | 100               | 28%                      | 68                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R21  | W27    | Bedroom  | 100               | 35%                      | 82                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R22  | W28    | Bedroom  | 100               | 100%                     | 186                | 1.5                    | 3.0               |              |
|               |          |        | R23  | W29    | LKD      | 150               | 60%                      | 168                | 1.5                    | 3.0               |              |
|               | Flat8    | Second | R24  | W30    | Bedroom  | 100               | 22%                      | 60                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R25  | W31    | LKD      | 150               | 84%                      | 199                | 1.5                    | 3.1               |              |
|               | Flat9    | Second | R26  | W32    | Bedroom  | 100               | 22%                      | 60                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R27  | W33    | LKD      | 150               | 95%                      | 214                | 1.5                    | 2.8               |              |
|               |          |        | R28  | W34    | Bedroom  | 100               | 85%                      | 154                | 1.5                    | 3.0               |              |

| Building Name | Unit No. | Floor  | Room | Window | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|--------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |        |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |        |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat10   | Second | R29  | W35    | Bedroom     | 100               | 57%                      | 113                | 1.5                    | 0.0               | N/F          |
|               |          |        | R30  | W36    | Bedroom     | 100               | 45%                      | 92                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R31  | W37    | LKD         | 150               | 55%                      | 161                | 1.5                    | 2.7               |              |
|               | Flat11   | Second | R32  | W38    | Bedroom     | 100               | 51%                      | 101                | 1.5                    | 0.0               | N/F          |
|               |          |        | R33  | W39    | Bedroom     | 100               | 86%                      | 136                | 1.5                    | 0.0               | N/F          |
|               |          |        | R34  | W40    | LKD         | 150               | 55%                      | 159                | 1.5                    | 2.6               |              |
|               | Flat12   | Second | R35  | W41    | Bedroom     | 100               | 35%                      | 75                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R36  | W42    | Bedroom     | 100               | 81%                      | 151                | 1.5                    | 2.3               |              |
|               |          |        | R37  | W43    | LKD         | 150               | 92%                      | 214                | 1.5                    | 2.5               |              |
|               | Flat13   | Second | R38  | W44    | Bedroom     | 100               | 28%                      | 64                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R39  | W45    | Kitchen     | 200               | 17%                      | 82                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R40  | W46    | Bedroom     | 100               | 75%                      | 133                | 1.5                    | 1.4               |              |
|               |          |        | R41  | W47    | Living Room | 150               | 79%                      | 210                | 1.5                    | 2.1               |              |
|               | Flat14   | Second | R42  | W48    | Bedroom     | 100               | 70%                      | 123                | 1.5                    | 0.0               | N/F          |
|               |          |        | R43  | W49    | Bedroom     | 100               | 64%                      | 124                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        | R44  | W50               | LKD      | 150               | 23%                      | 75                 | 1.5                    | 1.5               |              |
|               | Flat15   | Second | R45  | W51<br>W52        | LKD      | 150               | 29%                      | 84                 | 1.5                    | 3.1               |              |
|               |          |        | R46  | W53               | Bedroom  | 100               | 100%                     | 161                | 1.5                    | 1.5               |              |
|               | Flat16   | Second | R47  | W54               | Bedroom  | 100               | 100%                     | 172                | 1.5                    | 2.7               |              |
|               |          |        | R48  | W55<br>W56        | Bedroom  | 100               | 100%                     | 220                | 1.5                    | 1.8               |              |
|               |          |        | R49  | W57<br>W58        | LKD      | 150               | 67%                      | 179                | 1.5                    | 1.0               |              |
|               | Flat17   | Second | R50  | W59<br>W60<br>W61 | LKD      | 150               | 10%                      | 88                 | 1.5                    | 0.0               |              |
|               |          |        | R51  | W62               | Bedroom  | 100               | 55%                      | 100                | 1.5                    | 0.0               |              |
|               |          |        | R52  | W63               | Bedroom  | 100               | 36%                      | 84                 | 1.5                    | 0.0               |              |
|               | Flat1    | Third  | R1   | W1                | Bedroom  | 100               | 48%                      | 95                 | 1.5                    | 0.6               |              |
|               |          |        | R2   | W2                | Bedroom  | 100               | 73%                      | 123                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5    | LKD      | 150               | 54%                      | 177                | 1.5                    | 2.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat2    | Third | R4   | W6<br>W7   | LKD      | 150               | 100%                     | 347                | 1.5                    | 1.5               | N/F          |
|               |          |       | R5   | W8<br>W9   | Bedroom  | 100               | 100%                     | 384                | 1.5                    | 1.0               | N/F          |
|               |          |       | R6   | W10        | Bedroom  | 100               | 100%                     | 321                | 1.5                    | 0.6               | N/F          |
|               | Flat3    | Third | R7   | W11        | Bedroom  | 100               | 100%                     | 169                | 1.5                    | 0.0               | N/F          |
|               |          |       | R8   | W12<br>W13 | LKD      | 150               | 54%                      | 162                | 1.5                    | 0.7               | N/F          |
|               | Flat4    | Third | R9   | W14<br>W15 | LKD      | 150               | 74%                      | 261                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |       | R10  | W16        | Bedroom  | 100               | 82%                      | 129                | 1.5                    | 0.7               |              |
|               |          |       | R11  | W17        | Bedroom  | 100               | 31%                      | 70                 | 1.5                    | 0.2               |              |
|               | Flat5    | Third | R12  | W18        | Bedroom  | 100               | 100%                     | 299                | 1.5                    | 0.0               | N/F          |
|               |          |       | R13  | W19        | Bedroom  | 100               | 99%                      | 190                | 1.5                    | 0.0               | N/F          |
|               |          |       | R14  | W20        | Bedroom  | 100               | 98%                      | 148                | 1.5                    | 1.7               |              |
|               |          |       | R15  | W21        | LKD      | 150               | 31%                      | 112                | 1.5                    | 1.7               |              |
|               | Flat6    | Third | R16  | W22        | Bedroom  | 100               | 100%                     | 172                | 1.5                    | 0.0               | N/F          |
|               |          |       | R17  | W23        | Bedroom  | 100               | 63%                      | 117                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Flat7         | Third    |       | R18  | W24    | LKD      | 150               | 50%                      | 150                | 1.5                    | 3.1               |              |
|               |          |       | R19  | W25    | Bedroom  | 100               | 100%                     | 166                | 1.5                    | 2.0               |              |
|               |          |       | R20  | W26    | Bedroom  | 100               | 31%                      | 75                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R21  | W27    | Bedroom  | 100               | 46%                      | 92                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R22  | W28    | Bedroom  | 100               | 100%                     | 177                | 1.5                    | 3.0               |              |
| Flat8         | Third    |       | R23  | W29    | LKD      | 150               | 48%                      | 147                | 1.5                    | 3.1               |              |
|               |          |       | R24  | W30    | Bedroom  | 100               | 28%                      | 68                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R25  | W31    | LKD      | 150               | 67%                      | 177                | 1.5                    | 3.4               |              |
| Flat9         | Third    |       | R26  | W32    | Bedroom  | 100               | 29%                      | 65                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R27  | W33    | LKD      | 150               | 77%                      | 191                | 1.5                    | 3.7               |              |
|               |          |       | R28  | W34    | Bedroom  | 100               | 76%                      | 139                | 1.5                    | 3.6               |              |
| Flat10        | Third    |       | R29  | W35    | Bedroom  | 100               | 65%                      | 123                | 1.5                    | 0.0               | N/F          |
|               |          |       | R30  | W36    | Bedroom  | 100               | 51%                      | 102                | 1.5                    | 0.0               | N/F          |
|               |          |       | R31  | W37    | LKD      | 150               | 47%                      | 145                | 1.5                    | 3.9               |              |
| Flat11        | Third    |       | R32  | W38    | Bedroom  | 100               | 59%                      | 114                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |       | R33  | W39        | Bedroom     | 100               | 95%                      | 159                | 1.5                    | 0.0               | N/F          |
|               |          |       | R34  | W40        | LKD         | 150               | 48%                      | 144                | 1.5                    | 4.0               |              |
|               | Flat12   | Third | R35  | W41        | Bedroom     | 100               | 42%                      | 83                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R36  | W42        | Bedroom     | 100               | 77%                      | 141                | 1.5                    | 4.1               |              |
|               |          |       | R37  | W43        | LKD         | 150               | 77%                      | 190                | 1.5                    | 4.2               |              |
|               | Flat13   | Third | R38  | W44        | Bedroom     | 100               | 34%                      | 73                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R39  | W45        | Kitchen     | 200               | 22%                      | 93                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R40  | W46        | Bedroom     | 100               | 76%                      | 132                | 1.5                    | 3.6               |              |
|               |          |       | R41  | W47        | Living Room | 150               | 76%                      | 198                | 1.5                    | 4.2               |              |
|               | Flat14   | Third | R42  | W48        | Bedroom     | 100               | 82%                      | 136                | 1.5                    | 0.0               | N/F          |
|               |          |       | R43  | W49        | Bedroom     | 100               | 78%                      | 145                | 1.5                    | 0.0               | N/F          |
|               |          |       | R44  | W50        | LKD         | 150               | 27%                      | 90                 | 1.5                    | 1.5               |              |
|               | Flat15   | Third | R45  | W51<br>W52 | LKD         | 150               | 35%                      | 105                | 1.5                    | 3.1               |              |
|               |          |       | R46  | W53        | Bedroom     | 100               | 100%                     | 189                | 1.5                    | 1.5               |              |
|               | Flat16   | Third | R47  | W54        | Bedroom     | 100               | 100%                     | 209                | 1.5                    | 2.7               |              |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat17   | Third  | R48  | W55<br>W56        | Bedroom  | 100               | 100%                     | 262                | 1.5                    | 2.5               |              |
|               |          |        | R49  | W57<br>W58        | LKD      | 150               | 80%                      | 223                | 1.5                    | 1.9               |              |
|               |          |        | R50  | W59<br>W60<br>W61 | LKD      | 150               | 16%                      | 85                 | 1.5                    | 0.3               |              |
|               |          | Fourth | R51  | W62               | Bedroom  | 100               | 86%                      | 121                | 1.5                    | 0.5               |              |
|               |          |        | R52  | W63               | Bedroom  | 100               | 50%                      | 100                | 1.5                    | 1.1               |              |
|               | Flat1    | Fourth | R1   | W1                | Bedroom  | 100               | 52%                      | 103                | 1.5                    | 0.6               |              |
|               |          |        | R2   | W2                | Bedroom  | 100               | 78%                      | 133                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5    | LKD      | 150               | 55%                      | 188                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Fourth | R4   | W6<br>W7          | LKD      | 150               | 100%                     | 354                | 1.5                    | 1.5               | N/F          |
|               |          |        | R5   | W8<br>W9          | Bedroom  | 100               | 100%                     | 388                | 1.5                    | 1.0               | N/F          |
|               |          |        | R6   | W10               | Bedroom  | 100               | 100%                     | 325                | 1.5                    | 0.6               | N/F          |
|               | Flat3    | Fourth | R7   | W11               | Bedroom  | 100               | 100%                     | 171                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        | R8   | W12<br>W13 | LKD      | 150               | 55%                      | 168                | 1.5                    | 0.9               | N/F          |
|               | Flat4    | Fourth | R9   | W14<br>W15 | LKD      | 150               | 76%                      | 265                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |        | R10  | W16        | Bedroom  | 100               | 99%                      | 162                | 1.5                    | 1.4               |              |
|               |          |        | R11  | W17        | Bedroom  | 100               | 36%                      | 83                 | 1.5                    | 0.4               |              |
|               | Flat5    | Fourth | R12  | W18        | Bedroom  | 100               | 100%                     | 329                | 1.5                    | 0.0               | N/F          |
|               |          |        | R13  | W19        | Bedroom  | 100               | 100%                     | 204                | 1.5                    | 0.0               | N/F          |
|               |          |        | R14  | W20        | Bedroom  | 100               | 100%                     | 169                | 1.5                    | 1.8               |              |
|               |          |        | R15  | W21        | LKD      | 150               | 36%                      | 123                | 1.5                    | 1.8               |              |
|               | Flat6    | Fourth | R16  | W22        | Bedroom  | 100               | 100%                     | 193                | 1.5                    | 0.0               | N/F          |
|               |          |        | R17  | W23        | Bedroom  | 100               | 78%                      | 133                | 1.5                    | 0.0               | N/F          |
|               |          |        | R18  | W24        | LKD      | 150               | 64%                      | 188                | 1.5                    | 3.3               |              |
|               |          |        | R19  | W25        | Bedroom  | 100               | 100%                     | 206                | 1.5                    | 2.1               |              |
|               | Flat7    | Fourth | R20  | W26        | Bedroom  | 100               | 46%                      | 93                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R21  | W27        | Bedroom  | 100               | 63%                      | 115                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        | R22  | W28    | Bedroom  | 100               | 100%                     | 244                | 1.5                    | 3.0               |              |
|               |          |        | R23  | W29    | LKD      | 150               | 63%                      | 181                | 1.5                    | 3.3               |              |
|               | Flat8    | Fourth | R24  | W30    | Bedroom  | 100               | 42%                      | 88                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R25  | W31    | LKD      | 150               | 98%                      | 238                | 1.5                    | 3.6               |              |
|               | Flat9    | Fourth | R26  | W32    | Bedroom  | 100               | 42%                      | 86                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R27  | W33    | LKD      | 150               | 100%                     | 264                | 1.5                    | 3.8               |              |
|               |          |        | R28  | W34    | Bedroom  | 100               | 100%                     | 192                | 1.5                    | 3.6               |              |
|               | Flat10   | Fourth | R29  | W35    | Bedroom  | 100               | 94%                      | 155                | 1.5                    | 0.0               | N/F          |
|               |          |        | R30  | W36    | Bedroom  | 100               | 68%                      | 131                | 1.5                    | 0.0               | N/F          |
|               |          |        | R31  | W37    | LKD      | 150               | 61%                      | 177                | 1.5                    | 4.0               |              |
|               | Flat11   | Fourth | R32  | W38    | Bedroom  | 100               | 72%                      | 143                | 1.5                    | 0.0               | N/F          |
|               |          |        | R33  | W39    | Bedroom  | 100               | 100%                     | 194                | 1.5                    | 0.0               | N/F          |
|               |          |        | R34  | W40    | LKD      | 150               | 62%                      | 177                | 1.5                    | 4.1               |              |
|               | Flat12   | Fourth | R35  | W41    | Bedroom  | 100               | 58%                      | 112                | 1.5                    | 0.0               | N/F          |
|               |          |        | R36  | W42    | Bedroom  | 100               | 99%                      | 180                | 1.5                    | 4.3               |              |
|               |          |        | R37  | W43    | LKD      | 150               | 100%                     | 267                | 1.5                    | 4.3               |              |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat13   | Fourth | R38  | W44               | Bedroom     | 100               | 47%                      | 93                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R39  | W45               | Kitchen     | 200               | 32%                      | 118                | 1.5                    | 0.0               | N/F          |
|               |          |        | R40  | W46               | Bedroom     | 100               | 98%                      | 176                | 1.5                    | 3.8               |              |
|               |          |        | R41  | W47               | Living Room | 150               | 100%                     | 264                | 1.5                    | 4.3               |              |
|               | Flat14   | Fourth | R42  | W48               | Bedroom     | 100               | 95%                      | 161                | 1.5                    | 0.0               | N/F          |
|               |          |        | R43  | W49               | Bedroom     | 100               | 99%                      | 171                | 1.5                    | 0.0               | N/F          |
|               |          |        | R44  | W50               | LKD         | 150               | 30%                      | 100                | 1.5                    | 1.5               |              |
|               | Flat15   | Fourth | R45  | W51<br>W52        | LKD         | 150               | 36%                      | 112                | 1.5                    | 3.1               |              |
|               |          |        | R46  | W53               | Bedroom     | 100               | 100%                     | 204                | 1.5                    | 1.5               |              |
|               | Flat16   | Fourth | R47  | W54               | Bedroom     | 100               | 100%                     | 229                | 1.5                    | 2.7               |              |
|               |          |        | R48  | W55<br>W56        | Bedroom     | 100               | 100%                     | 284                | 1.5                    | 2.5               |              |
|               |          |        | R49  | W57<br>W58        | LKD         | 150               | 78%                      | 225                | 1.5                    | 3.9               |              |
|               | Flat17   | Fourth | R50  | W59<br>W60<br>W61 | LKD         | 150               | 24%                      | 101                | 1.5                    | 4.0               |              |

| Building Name | Unit No. | Floor | Room | Window         | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|----------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |                |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |                |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |       | R51  | W62            | Bedroom  | 100               | 100%                     | 150                | 1.5                    | 4.1               |              |
|               |          |       | R52  | W63            | Bedroom  | 100               | 74%                      | 130                | 1.5                    | 4.2               |              |
|               | Flat1    | Fifth | R1   | W1             | Bedroom  | 100               | 59%                      | 110                | 1.5                    | 0.6               |              |
|               |          |       | R2   | W2             | Bedroom  | 100               | 86%                      | 141                | 1.5                    | 0.9               |              |
|               |          |       | R3   | W3<br>W4<br>W5 | LKD      | 150               | 55%                      | 195                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Fifth | R4   | W6<br>W7       | LKD      | 150               | 100%                     | 592                | 1.5                    | 1.8               | N/F          |
|               |          |       | R5   | W8<br>W9       | Bedroom  | 100               | 100%                     | 492                | 1.5                    | 2.9               | N/F          |
|               |          |       | R6   | W10            | Bedroom  | 100               | 100%                     | 330                | 1.5                    | 0.8               | N/F          |
|               | Flat3    | Fifth | R7   | W11            | Bedroom  | 100               | 100%                     | 304                | 1.5                    | 0.0               | N/F          |
|               |          |       | R8   | W12<br>W13     | LKD      | 150               | 56%                      | 187                | 1.5                    | 1.6               | N/F          |
|               | Flat4    | Fifth | R9   | W14<br>W15     | LKD      | 150               | 100%                     | 402                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |       | R10  | W16            | Bedroom  | 100               | 100%                     | 204                | 1.5                    | 3.4               |              |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat5    | Fifth | R11  | W17        | Bedroom  | 100               | 54%                      | 103                | 1.5                    | 1.1               |              |
|               |          |       | R12  | W18        | Bedroom  | 100               | 100%                     | 362                | 1.5                    | 0.0               | N/F          |
|               |          |       | R13  | W19<br>W80 | Bedroom  | 100               | 100%                     | 706                | 1.5                    | 5.6               | N/F          |
|               |          |       | R14  | W20        | Bedroom  | 100               | 100%                     | 192                | 1.5                    | 1.8               |              |
|               |          |       | R15  | W21<br>W81 | LKD      | 150               | 100%                     | 258                | 1.5                    | 3.9               |              |
|               | Flat6    | Fifth | R16  | W22<br>W79 | Bedroom  | 100               | 100%                     | 829                | 1.5                    | 5.9               | N/F          |
|               |          |       | R17  | W23<br>W85 | Bedroom  | 100               | 100%                     | 690                | 1.5                    | 5.9               | N/F          |
|               |          |       | R18  | W24<br>W78 | LKD      | 150               | 100%                     | 455                | 1.5                    | 5.5               |              |
|               | Flat7    | Fifth | R19  | W25        | Bedroom  | 100               | 100%                     | 238                | 1.5                    | 2.1               |              |
|               |          |       | R20  | W26<br>W77 | Bedroom  | 100               | 100%                     | 655                | 1.5                    | 5.7               | N/F          |
|               |          |       | R21  | W27<br>W76 | Bedroom  | 100               | 100%                     | 756                | 1.5                    | 5.7               | N/F          |
|               |          |       | R22  | W28        | Bedroom  | 100               | 100%                     | 300                | 1.5                    | 3.0               |              |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |       | R23  | W29<br>W84 | LKD      | 150               | 100%                     | 475                | 1.5                    | 5.4               |              |
|               | Flat8    | Fifth | R24  | W30<br>W75 | Bedroom  | 100               | 100%                     | 638                | 1.5                    | 5.7               | N/F          |
|               |          |       | R25  | W31        | LKD      | 150               | 100%                     | 302                | 1.5                    | 3.7               |              |
|               | Flat9    | Fifth | R26  | W32<br>W74 | Bedroom  | 100               | 100%                     | 613                | 1.5                    | 5.7               | N/F          |
|               |          |       | R27  | W33<br>W73 | LKD      | 150               | 100%                     | 756                | 1.5                    | 5.4               |              |
|               |          |       | R28  | W34        | Bedroom  | 100               | 100%                     | 249                | 1.5                    | 3.6               |              |
|               | Flat10   | Fifth | R29  | W35<br>W72 | Bedroom  | 100               | 100%                     | 857                | 1.5                    | 5.5               | N/F          |
|               |          |       | R30  | W36<br>W70 | Bedroom  | 100               | 100%                     | 745                | 1.5                    | 5.6               | N/F          |
|               |          |       | R31  | W37<br>W71 | LKD      | 150               | 100%                     | 485                | 1.5                    | 5.8               |              |
|               | Flat11   | Fifth | R32  | W38<br>W68 | Bedroom  | 100               | 100%                     | 752                | 1.5                    | 5.8               | N/F          |
|               |          |       | R33  | W39<br>W67 | Bedroom  | 100               | 100%                     | 890                | 1.5                    | 5.9               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |       | R34  | W40<br>W69 | LKD         | 150               | 100%                     | 477                | 1.5                    | 5.9               |              |
|               | Flat12   | Fifth | R35  | W41<br>W65 | Bedroom     | 100               | 100%                     | 676                | 1.5                    | 5.7               | N/F          |
|               |          |       | R36  | W42        | Bedroom     | 100               | 100%                     | 233                | 1.5                    | 4.4               |              |
|               |          |       | R37  | W43<br>W66 | LKD         | 150               | 100%                     | 730                | 1.5                    | 6.0               |              |
|               | Flat13   | Fifth | R38  | W44<br>W83 | Bedroom     | 100               | 100%                     | 669                | 1.5                    | 5.5               | N/F          |
|               |          |       | R39  | W45<br>W82 | Kitchen     | 200               | 100%                     | 715                | 1.5                    | 3.1               | N/F          |
|               |          |       | R40  | W46        | Bedroom     | 100               | 100%                     | 227                | 1.5                    | 3.9               |              |
|               |          |       | R41  | W47        | Living Room | 150               | 100%                     | 344                | 1.5                    | 4.4               |              |
|               | Flat14   | Fifth | R42  | W48        | Bedroom     | 100               | 100%                     | 189                | 1.5                    | 0.0               | N/F          |
|               |          |       | R43  | W49        | Bedroom     | 100               | 100%                     | 215                | 1.5                    | 0.0               | N/F          |
|               |          |       | R44  | W50        | LKD         | 150               | 64%                      | 200                | 1.5                    | 2.1               |              |
|               | Flat15   | Fifth | R45  | W51<br>W52 | LKD         | 150               | 45%                      | 134                | 1.5                    | 3.3               |              |
|               |          |       | R46  | W53        | Bedroom     | 100               | 100%                     | 441                | 1.5                    | 2.1               |              |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP10       | Flat16   | Fifth  | R47  | W54               | Bedroom     | 100               | 100%                     | 245                | 1.5                    | 2.7               |              |
|               |          |        | R48  | W55<br>W56        | Bedroom     | 100               | 100%                     | 370                | 1.5                    | 3.4               |              |
|               |          |        | R49  | W57<br>W58        | LKD         | 150               | 100%                     | 424                | 1.5                    | 4.6               |              |
|               | Flat17   | Fifth  | R50  | W59<br>W60<br>W61 | LKD         | 150               | 54%                      | 154                | 1.5                    | 4.0               |              |
|               |          |        | R51  | W62               | Bedroom     | 100               | 100%                     | 189                | 1.5                    | 4.1               |              |
|               |          |        | R52  | W63               | Bedroom     | 100               | 100%                     | 166                | 1.5                    | 4.2               |              |
|               |          | Ground | R1   | W2<br>W1          | Kitchen     | 200               | 10%                      | 71                 | 1.5                    | 0.4               |              |
|               |          |        | R2   | W3                | Living Room | 150               | 57%                      | 164                | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1                | Bedroom     | 100               | 53%                      | 102                | 1.5                    | 0.1               |              |
|               |          |        | R2   | W2                | Bedroom     | 100               | 6%                       | 29                 | 1.5                    | 0.0               |              |
|               |          |        | R3   | W3                | Bedroom     | 100               | 18%                      | 51                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4                | Bedroom     | 100               | 37%                      | 79                 | 1.5                    | 0.0               | N/F          |
|               | C3 DP01  | Ground | R1   | W2                | Kitchen     | 200               | 9%                       | 90                 | 1.5                    | 0.0               |              |

| Building Name | Unit No. | Floor  | Room | Window | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|--------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |        |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |        |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP02       |          | First  |      | W3     | Living Room | 150               | 12%                      | 73                 | 1.5                    | 0.0               | N/F          |
|               |          |        |      | W1     |             |                   |                          |                    |                        |                   |              |
|               |          |        | R2   | W4     | Living Room | 150               | 12%                      | 73                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1     | Bedroom     | 100               | 22%                      | 57                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2     | Bedroom     | 100               | 29%                      | 69                 | 1.5                    | 0.0               |              |
|               |          |        |      | W3     |             |                   |                          |                    |                        |                   |              |
|               |          |        | R3   | W4     | Bedroom     | 100               | 7%                       | 27                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W5     | Bedroom     | 100               | 13%                      | 45                 | 1.5                    | 0.0               | N/F          |
|               |          |        |      | W6     |             |                   |                          |                    |                        |                   | N/F          |
|               |          | Ground | R1   | W2     | Kitchen     | 200               | 9%                       | 70                 | 1.5                    | 0.0               |              |
|               |          |        |      | W1     |             |                   |                          |                    |                        |                   |              |
|               |          |        | R2   | W3     | Living Room | 150               | 17%                      | 74                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1     | Bedroom     | 100               | 53%                      | 101                | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2     | Bedroom     | 100               | 7%                       | 30                 | 1.5                    | 0.0               |              |
|               |          |        | R3   | W3     | Bedroom     | 100               | 8%                       | 18                 | 1.5                    | 0.0               | N/F          |
|               |          | Ground | R4   | W4     | Bedroom     | 100               | 13%                      | 36                 | 1.5                    | 0.0               | N/F          |
|               |          |        |      |        |             |                   |                          |                    |                        |                   |              |
|               |          |        | R1   | W1     | Kitchen     | 200               | 8%                       | 69                 | 1.5                    | 0.0               |              |
|               |          |        |      | W2     |             |                   |                          |                    |                        |                   | N/F          |

| Building Name | Unit No. | Floor  | Room | Window   | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |          |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |          |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP04       |          | First  | R2   | W3       | Living Room | 150               | 21%                      | 81                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1       | Bedroom     | 100               | 10%                      | 29                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 53%                      | 105                | 1.5                    | 0.0               |              |
|               |          |        | R3   | W3       | Bedroom     | 100               | 15%                      | 40                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom     | 100               | 8%                       | 19                 | 1.5                    | 0.0               | N/F          |
|               |          | Ground | R1   | W2<br>W1 | Kitchen     | 200               | 9%                       | 72                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W3       | Living Room | 150               | 17%                      | 74                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1       | Bedroom     | 100               | 53%                      | 102                | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 7%                       | 29                 | 1.5                    | 0.0               |              |
|               |          |        | R3   | W3       | Bedroom     | 100               | 7%                       | 16                 | 1.5                    | 0.0               | N/F          |
| C3 DP05       |          | Ground | R4   | W4       | Bedroom     | 100               | 13%                      | 38                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1<br>W2 | Kitchen     | 200               | 8%                       | 72                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R2   | W3       | Living Room | 150               | 11%                      | 68                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1       | Bedroom     | 100               | 9%                       | 29                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 53%                      | 106                | 1.5                    | 0.4               |              |

| Building Name | Unit No. | Floor  | Room | Window   | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |          |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |          |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP06       |          | Ground | R3   | W3       | Bedroom     | 100               | 8%                       | 31                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom     | 100               | 4%                       | 15                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W2<br>W1 | Kitchen     | 200               | 10%                      | 71                 | 1.5                    | 0.0               |              |
|               |          | First  | R2   | W3       | Living Room | 150               | 7%                       | 60                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1       | Bedroom     | 100               | 53%                      | 101                | 1.5                    | 0.4               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 7%                       | 30                 | 1.5                    | 0.0               |              |
| C3 DP07       |          | Ground | R3   | W3       | Bedroom     | 100               | 2%                       | 12                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom     | 100               | 4%                       | 26                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1<br>W2 | Kitchen     | 200               | 8%                       | 69                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R2   | W3       | Living Room | 150               | 5%                       | 56                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1       | Bedroom     | 100               | 9%                       | 28                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 53%                      | 102                | 1.5                    | 0.3               |              |
|               |          |        | R3   | W3       | Bedroom     | 100               | 0%                       | 22                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom     | 100               | 0%                       | 11                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window   | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |          |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |          |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP08       |          | Ground | R1   | W2<br>W1 | Kitchen     | 200               | 10%                      | 70                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W3       | Living Room | 150               | 6%                       | 57                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1       | Bedroom     | 100               | 49%                      | 99                 | 1.5                    | 0.2               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 7%                       | 28                 | 1.5                    | 0.0               |              |
|               |          |        | R3   | W3       | Bedroom     | 100               | 0%                       | 12                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom     | 100               | 0%                       | 23                 | 1.5                    | 0.0               | N/F          |
| C3 DP09       |          | Ground | R1   | W1<br>W2 | Kitchen     | 200               | 8%                       | 72                 | 1.5                    | 0.1               | N/F          |
|               |          |        | R2   | W3       | Living Room | 150               | 22%                      | 91                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1       | Bedroom     | 100               | 7%                       | 28                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 53%                      | 104                | 1.5                    | 0.1               |              |
|               |          |        | R3   | W3       | Bedroom     | 100               | 9%                       | 43                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom     | 100               | 3%                       | 15                 | 1.5                    | 0.0               | N/F          |



## Appendix 7

Detailed daylight and sunlight assessments  
within the proposed accommodation in the cumulative context

| Building Name | Unit No. | Floor  | Room | Window         | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3            | Flat1    | Ground | R1   | W1<br>W2       | LKD      | 150               | 66%                      | 259                | 1.5                    | 2.5               | N/F          |
|               |          |        | R2   | W3<br>W4       | Bedroom  | 100               | 100%                     | 173                | 1.5                    | 0.4               | N/F          |
|               |          |        | R3   | W5             | Bedroom  | 100               | 100%                     | 323                | 1.5                    | 1.0               | N/F          |
|               | Flat1    | First  | R1   | W1             | Bedroom  | 100               | 28%                      | 64                 | 1.5                    | 1.6               |              |
|               |          |        | R2   | W2             | Bedroom  | 100               | 42%                      | 85                 | 1.5                    | 2.0               |              |
|               |          |        | R3   | W3<br>W4<br>W5 | LKD      | 150               | 34%                      | 128                | 1.5                    | 2.9               | N/F          |
|               | Flat2    | First  | R4   | W6<br>W7       | LKD      | 150               | 98%                      | 305                | 1.5                    | 3.5               | N/F          |
|               |          |        | R5   | W8<br>W9       | Bedroom  | 100               | 100%                     | 317                | 1.5                    | 2.8               | N/F          |
|               |          |        | R6   | W10            | Bedroom  | 100               | 100%                     | 271                | 1.5                    | 2.6               | N/F          |
|               | Flat3    | First  | R7   | W11            | Bedroom  | 100               | 100%                     | 160                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13     | LKD      | 150               | 50%                      | 154                | 1.5                    | 2.5               | N/F          |
|               | Flat4    | First  | R9   | W14<br>W15     | LKD      | 150               | 68%                      | 234                | 1.5                    | 0.1               | N/F<br>N/F   |
|               |          |        | R10  | W16            | Bedroom  | 100               | 17%                      | 48                 | 1.5                    | 0.0               |              |
|               |          |        | R11  | W17            | Bedroom  | 100               | 7%                       | 23                 | 1.5                    | 0.0               |              |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat5    | First  | R12  | W18               | Bedroom  | 100               | 0%                       | 8                  | 1.5                    | 0.0               | N/F          |
|               |          |        | R13  | W19               | Bedroom  | 100               | 33%                      | 69                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R14  | W20               | LKD      | 150               | 0%                       | 15                 | 1.5                    | 0.0               |              |
|               | Flat6    | First  | R15  | W21<br>W22        | LKD      | 150               | 6%                       | 19                 | 1.5                    | 0.6               |              |
|               |          |        | R16  | W23               | Bedroom  | 100               | 0%                       | 34                 | 1.5                    | 0.0               |              |
|               | Flat7    | First  | R17  | W24               | Bedroom  | 100               | 16%                      | 39                 | 1.5                    | 0.5               |              |
|               |          |        | R18  | W25<br>W26        | Bedroom  | 100               | 29%                      | 58                 | 1.5                    | 0.2               |              |
|               |          |        | R19  | W27<br>W28        | LKD      | 150               | 2%                       | 72                 | 1.5                    | 0.8               |              |
|               | Flat8    | First  | R20  | W29<br>W30<br>W31 | LKD      | 150               | 5%                       | 54                 | 1.5                    | 0.0               |              |
|               |          |        | R21  | W32               | Bedroom  | 100               | 23%                      | 66                 | 1.5                    | 0.0               |              |
|               |          |        | R22  | W33               | Bedroom  | 100               | 17%                      | 58                 | 1.5                    | 0.0               |              |
|               | Flat1    | Second | R1   | W1                | Bedroom  | 100               | 36%                      | 76                 | 1.5                    | 0.5               |              |
|               |          |        | R2   | W2                | Bedroom  | 100               | 53%                      | 101                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5    | LKD      | 150               | 50%                      | 149                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Second | R4   | W6                | LKD      | 150               | 99%                      | 328                | 1.5                    | 1.5               |              |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        |      | W7         |          |                   |                          |                    |                        |                   | N/F          |
|               |          |        | R5   | W8<br>W9   | Bedroom  | 100               | 100%                     | 350                | 1.5                    | 1.0               | N/F          |
|               |          |        | R6   | W10        | Bedroom  | 100               | 100%                     | 290                | 1.5                    | 0.6               | N/F          |
|               | Flat3    | Second | R7   | W11        | Bedroom  | 100               | 100%                     | 162                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13 | LKD      | 150               | 48%                      | 146                | 1.5                    | 0.7               | N/F          |
|               | Flat4    | Second | R9   | W14<br>W15 | LKD      | 150               | 71%                      | 253                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |        | R10  | W16        | Bedroom  | 100               | 25%                      | 61                 | 1.5                    | 0.0               |              |
|               |          |        | R11  | W17        | Bedroom  | 100               | 7%                       | 29                 | 1.5                    | 0.0               |              |
|               | Flat5    | Second | R12  | W18        | Bedroom  | 100               | 63%                      | 139                | 1.5                    | 0.0               | N/F          |
|               |          |        | R13  | W19        | Bedroom  | 100               | 81%                      | 111                | 1.5                    | 0.0               | N/F          |
|               |          |        | R14  | W20        | Bedroom  | 100               | 7%                       | 50                 | 1.5                    | 0.3               |              |
|               |          |        | R15  | W21        | LKD      | 150               | 1%                       | 46                 | 1.5                    | 0.0               |              |
|               | Flat6    | Second | R16  | W22        | Bedroom  | 100               | 42%                      | 92                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R17  | W23        | Bedroom  | 100               | 15%                      | 54                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R18  | W24        | LKD      | 150               | 2%                       | 48                 | 1.5                    | 0.4               |              |
|               |          |        | R19  | W25        | Bedroom  | 100               | 18%                      | 63                 | 1.5                    | 0.0               |              |
|               | Flat7    | Second | R20  | W26        | Bedroom  | 100               | 3%                       | 31                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Flat8         | Second   |       | R21  | W27    | Bedroom  | 100               | 0%                       | 33                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R22  | W28    | Bedroom  | 100               | 7%                       | 51                 | 1.5                    | 0.1               |              |
|               |          |       | R23  | W29    | LKD      | 150               | 4%                       | 59                 | 1.5                    | 0.0               |              |
|               |          |       | R24  | W30    | Bedroom  | 100               | 0%                       | 23                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R25  | W31    | LKD      | 150               | 2%                       | 57                 | 1.5                    | 0.1               |              |
| Flat9         | Second   |       | R26  | W32    | Bedroom  | 100               | 0%                       | 22                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R27  | W33    | LKD      | 150               | 4%                       | 64                 | 1.5                    | 0.2               |              |
|               |          |       | R28  | W34    | Bedroom  | 100               | 14%                      | 55                 | 1.5                    | 0.0               |              |
| Flat10        | Second   |       | R29  | W35    | Bedroom  | 100               | 0%                       | 38                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R30  | W36    | Bedroom  | 100               | 0%                       | 31                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R31  | W37    | LKD      | 150               | 1%                       | 45                 | 1.5                    | 0.3               |              |
| Flat11        | Second   |       | R32  | W38    | Bedroom  | 100               | 4%                       | 37                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R33  | W39    | Bedroom  | 100               | 10%                      | 51                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R34  | W40    | LKD      | 150               | 1%                       | 46                 | 1.5                    | 0.3               |              |
| Flat12        | Second   |       | R35  | W41    | Bedroom  | 100               | 0%                       | 29                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R36  | W42    | Bedroom  | 100               | 4%                       | 39                 | 1.5                    | 0.3               |              |
|               |          |       | R37  | W43    | LKD      | 150               | 5%                       | 76                 | 1.5                    | 0.3               |              |
| Flat13        | Second   |       | R38  | W44    | Bedroom  | 100               | 0%                       | 25                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        | R39  | W45               | Kitchen     | 200               | 0%                       | 30                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R40  | W46               | Bedroom     | 100               | 10%                      | 49                 | 1.5                    | 0.0               |              |
|               |          |        | R41  | W47               | Living Room | 150               | 4%                       | 71                 | 1.5                    | 0.0               |              |
|               | Flat14   | Second | R42  | W48               | Bedroom     | 100               | 1%                       | 27                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R43  | W49               | Bedroom     | 100               | 43%                      | 88                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R44  | W50               | LKD         | 150               | 0%                       | 26                 | 1.5                    | 0.0               |              |
|               | Flat15   | Second | R45  | W51<br>W52        | LKD         | 150               | 9%                       | 24                 | 1.5                    | 1.2               |              |
|               |          |        | R46  | W53               | Bedroom     | 100               | 0%                       | 43                 | 1.5                    | 0.0               |              |
|               | Flat16   | Second | R47  | W54               | Bedroom     | 100               | 21%                      | 53                 | 1.5                    | 1.0               |              |
|               |          |        | R48  | W55<br>W56        | Bedroom     | 100               | 42%                      | 82                 | 1.5                    | 1.1               |              |
|               |          |        | R49  | W57<br>W58        | LKD         | 150               | 17%                      | 102                | 1.5                    | 1.0               |              |
|               | Flat17   | Second | R50  | W59<br>W60<br>W61 | LKD         | 150               | 9%                       | 70                 | 1.5                    | 0.0               |              |
|               |          |        | R51  | W62               | Bedroom     | 100               | 33%                      | 83                 | 1.5                    | 0.0               |              |
|               |          |        | R52  | W63               | Bedroom     | 100               | 24%                      | 68                 | 1.5                    | 0.0               |              |
|               | Flat1    | Third  | R1   | W1                | Bedroom     | 100               | 42%                      | 83                 | 1.5                    | 0.6               |              |

| Building Name | Unit No. | Floor | Room | Window         | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|----------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |                |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |                |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat2    | Third | R2   | W2             | Bedroom  | 100               | 60%                      | 110                | 1.5                    | 0.9               |              |
|               |          |       | R3   | W3<br>W4<br>W5 | LKD      | 150               | 52%                      | 159                | 1.5                    | 2.0               | N/F          |
|               |          |       | R4   | W6<br>W7       | LKD      | 150               | 97%                      | 317                | 1.5                    | 1.5               | N/F          |
|               |          |       | R5   | W8<br>W9       | Bedroom  | 100               | 100%                     | 353                | 1.5                    | 1.0               | N/F          |
|               |          |       | R6   | W10            | Bedroom  | 100               | 100%                     | 295                | 1.5                    | 0.6               | N/F          |
|               | Flat3    | Third | R7   | W11            | Bedroom  | 100               | 100%                     | 158                | 1.5                    | 0.0               | N/F          |
|               |          |       | R8   | W12<br>W13     | LKD      | 150               | 49%                      | 147                | 1.5                    | 0.7               | N/F          |
|               |          |       | R9   | W14<br>W15     | LKD      | 150               | 69%                      | 242                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat4    | Third | R10  | W16            | Bedroom  | 100               | 33%                      | 77                 | 1.5                    | 0.0               |              |
|               |          |       | R11  | W17            | Bedroom  | 100               | 12%                      | 34                 | 1.5                    | 0.0               |              |
|               |          |       | R12  | W18            | Bedroom  | 100               | 73%                      | 151                | 1.5                    | 0.0               | N/F          |
|               |          |       | R13  | W19            | Bedroom  | 100               | 84%                      | 115                | 1.5                    | 0.0               | N/F          |
|               |          |       | R14  | W20            | Bedroom  | 100               | 35%                      | 85                 | 1.5                    | 0.3               |              |
|               |          |       | R15  | W21            | LKD      | 150               | 3%                       | 51                 | 1.5                    | 0.0               |              |
|               |          |       | R16  | W22            | Bedroom  | 100               | 48%                      | 96                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Flat7         | Third    |       | R17  | W23    | Bedroom  | 100               | 27%                      | 72                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R18  | W24    | LKD      | 150               | 17%                      | 84                 | 1.5                    | 0.4               |              |
|               |          |       | R19  | W25    | Bedroom  | 100               | 20%                      | 64                 | 1.5                    | 0.0               |              |
|               |          |       | R20  | W26    | Bedroom  | 100               | 5%                       | 38                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R21  | W27    | Bedroom  | 100               | 0%                       | 41                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R22  | W28    | Bedroom  | 100               | 42%                      | 92                 | 1.5                    | 0.2               |              |
|               |          |       | R23  | W29    | LKD      | 150               | 10%                      | 67                 | 1.5                    | 0.0               |              |
|               |          |       | R24  | W30    | Bedroom  | 100               | 0%                       | 29                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R25  | W31    | LKD      | 150               | 13%                      | 86                 | 1.5                    | 0.5               |              |
|               |          |       | R26  | W32    | Bedroom  | 100               | 0%                       | 27                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R27  | W33    | LKD      | 150               | 21%                      | 107                | 1.5                    | 0.7               |              |
| Flat8         | Third    |       | R28  | W34    | Bedroom  | 100               | 15%                      | 53                 | 1.5                    | 0.4               |              |
|               |          |       | R29  | W35    | Bedroom  | 100               | 5%                       | 48                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R30  | W36    | Bedroom  | 100               | 7%                       | 40                 | 1.5                    | 0.0               | N/F          |
| Flat9         | Third    |       | R31  | W37    | LKD      | 150               | 10%                      | 65                 | 1.5                    | 0.6               |              |
|               |          |       | R32  | W38    | Bedroom  | 100               | 12%                      | 46                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R33  | W39    | Bedroom  | 100               | 21%                      | 62                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R34  | W40    | LKD      | 150               | 10%                      | 65                 | 1.5                    | 0.7               |              |

| Building Name | Unit No. | Floor | Room | Window            | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|-------------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |                   |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |                   |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat12   | Third | R35  | W41               | Bedroom     | 100               | 7%                       | 35                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R36  | W42               | Bedroom     | 100               | 33%                      | 77                 | 1.5                    | 1.4               |              |
|               |          |       | R37  | W43               | LKD         | 150               | 15%                      | 88                 | 1.5                    | 0.7               |              |
|               | Flat13   | Third | R38  | W44               | Bedroom     | 100               | 4%                       | 31                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R39  | W45               | Kitchen     | 200               | 0%                       | 36                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R40  | W46               | Bedroom     | 100               | 27%                      | 69                 | 1.5                    | 1.0               |              |
|               |          |       | R41  | W47               | Living Room | 150               | 10%                      | 77                 | 1.5                    | 0.2               |              |
|               | Flat14   | Third | R42  | W48               | Bedroom     | 100               | 4%                       | 33                 | 1.5                    | 0.0               | N/F          |
|               |          |       | R43  | W49               | Bedroom     | 100               | 55%                      | 110                | 1.5                    | 0.0               | N/F          |
|               |          |       | R44  | W50               | LKD         | 150               | 0%                       | 28                 | 1.5                    | 0.0               |              |
|               | Flat15   | Third | R45  | W51<br>W52        | LKD         | 150               | 12%                      | 31                 | 1.5                    | 1.8               |              |
|               |          |       | R46  | W53               | Bedroom     | 100               | 7%                       | 54                 | 1.5                    | 0.5               |              |
|               | Flat16   | Third | R47  | W54               | Bedroom     | 100               | 33%                      | 72                 | 1.5                    | 1.7               |              |
|               |          |       | R48  | W55<br>W56        | Bedroom     | 100               | 55%                      | 110                | 1.5                    | 1.6               |              |
|               |          |       | R49  | W57<br>W58        | LKD         | 150               | 31%                      | 123                | 1.5                    | 1.7               |              |
|               | Flat17   | Third | R50  | W59<br>W60<br>W61 | LKD         | 150               | 12%                      | 70                 | 1.5                    | 0.3               |              |

| Building Name | Unit No. | Floor  | Room | Window         | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        | R51  | W62            | Bedroom  | 100               | 48%                      | 99                 | 1.5                    | 0.5               |              |
|               |          |        | R52  | W63            | Bedroom  | 100               | 37%                      | 82                 | 1.5                    | 1.1               |              |
|               | Flat1    | Fourth | R1   | W1             | Bedroom  | 100               | 46%                      | 91                 | 1.5                    | 0.6               |              |
|               |          |        | R2   | W2             | Bedroom  | 100               | 69%                      | 119                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5 | LKD      | 150               | 53%                      | 170                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Fourth | R4   | W6<br>W7       | LKD      | 150               | 98%                      | 325                | 1.5                    | 1.5               | N/F          |
|               |          |        | R5   | W8<br>W9       | Bedroom  | 100               | 100%                     | 356                | 1.5                    | 1.0               | N/F          |
|               |          |        | R6   | W10            | Bedroom  | 100               | 100%                     | 298                | 1.5                    | 0.6               | N/F          |
|               | Flat3    | Fourth | R7   | W11            | Bedroom  | 100               | 100%                     | 159                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13     | LKD      | 150               | 52%                      | 153                | 1.5                    | 0.9               | N/F          |
|               | Flat4    | Fourth | R9   | W14<br>W15     | LKD      | 150               | 70%                      | 246                | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |        | R10  | W16            | Bedroom  | 100               | 53%                      | 103                | 1.5                    | 0.7               |              |
|               |          |        | R11  | W17            | Bedroom  | 100               | 19%                      | 44                 | 1.5                    | 0.0               |              |
|               | Flat5    | Fourth | R12  | W18            | Bedroom  | 100               | 79%                      | 164                | 1.5                    | 0.0               | N/F          |
|               |          |        | R13  | W19            | Bedroom  | 100               | 90%                      | 118                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window  | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|---------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |         |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |         |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| Flat6         | Fourth   | R14   | W20  | Bedroom |          | 100               | 25%                      | 74                 | 1.5                    | 0.3               |              |
|               |          | R15   | W21  | LKD     |          | 150               | 9%                       | 72                 | 1.5                    | 0.0               |              |
|               |          | R16   | W22  | Bedroom |          | 100               | 58%                      | 107                | 1.5                    | 0.0               | N/F          |
|               |          | R17   | W23  | Bedroom |          | 100               | 36%                      | 80                 | 1.5                    | 0.0               | N/F          |
|               |          | R18   | W24  | LKD     |          | 150               | 17%                      | 78                 | 1.5                    | 0.4               |              |
| Flat7         | Fourth   | R19   | W25  | Bedroom |          | 100               | 54%                      | 106                | 1.5                    | 0.0               |              |
|               |          | R20   | W26  | Bedroom |          | 100               | 10%                      | 46                 | 1.5                    | 0.0               | N/F          |
|               |          | R21   | W27  | Bedroom |          | 100               | 6%                       | 55                 | 1.5                    | 0.0               | N/F          |
|               |          | R22   | W28  | Bedroom |          | 100               | 43%                      | 86                 | 1.5                    | 0.2               |              |
|               |          | R23   | W29  | LKD     |          | 150               | 25%                      | 97                 | 1.5                    | 0.0               |              |
| Flat8         | Fourth   | R24   | W30  | Bedroom |          | 100               | 1%                       | 39                 | 1.5                    | 0.0               | N/F          |
|               |          | R25   | W31  | LKD     |          | 150               | 20%                      | 94                 | 1.5                    | 0.5               |              |
| Flat9         | Fourth   | R26   | W32  | Bedroom |          | 100               | 3%                       | 35                 | 1.5                    | 0.0               | N/F          |
|               |          | R27   | W33  | LKD     |          | 150               | 28%                      | 107                | 1.5                    | 1.1               |              |
|               |          | R28   | W34  | Bedroom |          | 100               | 43%                      | 92                 | 1.5                    | 0.5               |              |
| Flat10        | Fourth   | R29   | W35  | Bedroom |          | 100               | 16%                      | 60                 | 1.5                    | 0.0               | N/F          |
|               |          | R30   | W36  | Bedroom |          | 100               | 15%                      | 52                 | 1.5                    | 0.0               | N/F          |
|               |          | R31   | W37  | LKD     |          | 150               | 19%                      | 78                 | 1.5                    | 1.4               |              |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat11   | Fourth | R32  | W38        | Bedroom     | 100               | 21%                      | 56                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R33  | W39        | Bedroom     | 100               | 32%                      | 79                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R34  | W40        | LKD         | 150               | 20%                      | 78                 | 1.5                    | 1.6               |              |
|               | Flat12   | Fourth | R35  | W41        | Bedroom     | 100               | 14%                      | 44                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R36  | W42        | Bedroom     | 100               | 30%                      | 66                 | 1.5                    | 1.8               |              |
|               |          |        | R37  | W43        | LKD         | 150               | 39%                      | 127                | 1.5                    | 1.8               |              |
|               | Flat13   | Fourth | R38  | W44        | Bedroom     | 100               | 10%                      | 39                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R39  | W45        | Kitchen     | 200               | 0%                       | 48                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R40  | W46        | Bedroom     | 100               | 46%                      | 88                 | 1.5                    | 2.0               |              |
|               |          |        | R41  | W47        | Living Room | 150               | 39%                      | 127                | 1.5                    | 1.6               |              |
|               | Flat14   | Fourth | R42  | W48        | Bedroom     | 100               | 12%                      | 43                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R43  | W49        | Bedroom     | 100               | 73%                      | 141                | 1.5                    | 0.0               | N/F          |
|               |          |        | R44  | W50        | LKD         | 150               | 3%                       | 35                 | 1.5                    | 0.0               |              |
|               | Flat15   | Fourth | R45  | W51<br>W52 | LKD         | 150               | 15%                      | 37                 | 1.5                    | 1.8               |              |
|               |          |        | R46  | W53        | Bedroom     | 100               | 18%                      | 70                 | 1.5                    | 0.5               |              |
|               | Flat16   | Fourth | R47  | W54        | Bedroom     | 100               | 43%                      | 91                 | 1.5                    | 1.9               |              |
|               |          |        | R48  | W55<br>W56 | Bedroom     | 100               | 63%                      | 125                | 1.5                    | 1.9               |              |

| Building Name | Unit No. | Floor  | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        | R49  | W57<br>W58        | LKD      | 150               | 34%                      | 121                | 1.5                    | 3.4               |              |
|               | Flat17   | Fourth | R50  | W59<br>W60<br>W61 | LKD      | 150               | 18%                      | 82                 | 1.5                    | 3.2               |              |
|               |          |        | R51  | W62               | Bedroom  | 100               | 83%                      | 124                | 1.5                    | 3.2               |              |
|               |          |        | R52  | W63               | Bedroom  | 100               | 54%                      | 106                | 1.5                    | 3.3               |              |
|               | Flat1    | Fifth  | R1   | W1                | Bedroom  | 100               | 49%                      | 98                 | 1.5                    | 0.6               |              |
|               |          |        | R2   | W2                | Bedroom  | 100               | 76%                      | 128                | 1.5                    | 0.9               |              |
|               |          |        | R3   | W3<br>W4<br>W5    | LKD      | 150               | 54%                      | 177                | 1.5                    | 2.0               | N/F          |
|               | Flat2    | Fifth  | R4   | W6<br>W7          | LKD      | 150               | 100%                     | 541                | 1.5                    | 1.8               | N/F          |
|               |          |        | R5   | W8<br>W9          | Bedroom  | 100               | 100%                     | 444                | 1.5                    | 2.9               | N/F          |
|               |          |        | R6   | W10               | Bedroom  | 100               | 100%                     | 303                | 1.5                    | 0.8               | N/F          |
|               | Flat3    | Fifth  | R7   | W11               | Bedroom  | 100               | 100%                     | 285                | 1.5                    | 0.0               | N/F          |
|               |          |        | R8   | W12<br>W13        | LKD      | 150               | 54%                      | 169                | 1.5                    | 1.6               | N/F          |
|               | Flat4    | Fifth  | R9   | W14<br>W15        | LKD      | 150               | 100%                     | 372                | 1.5                    | 0.0               | N/F<br>N/F   |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat5    | Fifth | R10  | W16        | Bedroom  | 100               | 88%                      | 152                | 1.5                    | 2.7               |              |
|               |          |       | R11  | W17        | Bedroom  | 100               | 31%                      | 71                 | 1.5                    | 0.5               |              |
|               |          |       | R12  | W18        | Bedroom  | 100               | 100%                     | 348                | 1.5                    | 0.0               | N/F          |
|               |          |       | R13  | W19<br>W80 | Bedroom  | 100               | 100%                     | 680                | 1.5                    | 5.1               | N/F          |
|               |          |       | R14  | W20        | Bedroom  | 100               | 64%                      | 111                | 1.5                    | 0.3               |              |
|               | Flat6    | Fifth | R15  | W21<br>W81 | LKD      | 150               | 46%                      | 139                | 1.5                    | 3.5               |              |
|               |          |       | R16  | W22<br>W79 | Bedroom  | 100               | 100%                     | 809                | 1.5                    | 5.4               | N/F          |
|               |          |       | R17  | W23<br>W85 | Bedroom  | 100               | 100%                     | 663                | 1.5                    | 5.4               | N/F          |
|               |          |       | R18  | W24<br>W78 | LKD      | 150               | 100%                     | 283                | 1.5                    | 5.2               |              |
|               |          |       | R19  | W25        | Bedroom  | 100               | 49%                      | 98                 | 1.5                    | 0.0               |              |
|               | Flat7    | Fifth | R20  | W26<br>W77 | Bedroom  | 100               | 100%                     | 631                | 1.5                    | 5.3               | N/F          |
|               |          |       | R21  | W27<br>W76 | Bedroom  | 100               | 100%                     | 725                | 1.5                    | 5.2               | N/F          |
|               |          |       | R22  | W28        | Bedroom  | 100               | 95%                      | 151                | 1.5                    | 0.0               |              |
|               |          |       | R23  | W29<br>W84 | LKD      | 150               | 100%                     | 262                | 1.5                    | 4.9               |              |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat8    | Fifth | R24  | W30<br>W75 | Bedroom  | 100               | 100%                     | 613                | 1.5                    | 5.1               | N/F          |
|               |          |       | R25  | W31        | LKD      | 150               | 35%                      | 131                | 1.5                    | 0.3               |              |
|               | Flat9    | Fifth | R26  | W32<br>W74 | Bedroom  | 100               | 100%                     | 587                | 1.5                    | 5.1               | N/F          |
|               |          |       | R27  | W33<br>W73 | LKD      | 150               | 100%                     | 456                | 1.5                    | 5.0               |              |
|               |          |       | R28  | W34        | Bedroom  | 100               | 33%                      | 80                 | 1.5                    | 0.0               |              |
|               | Flat10   | Fifth | R29  | W35<br>W72 | Bedroom  | 100               | 100%                     | 812                | 1.5                    | 4.9               | N/F          |
|               |          |       | R30  | W36<br>W70 | Bedroom  | 100               | 100%                     | 719                | 1.5                    | 5.0               | N/F          |
|               |          |       | R31  | W37<br>W71 | LKD      | 150               | 100%                     | 243                | 1.5                    | 5.0               |              |
|               | Flat11   | Fifth | R32  | W38<br>W68 | Bedroom  | 100               | 100%                     | 711                | 1.5                    | 5.1               | N/F          |
|               |          |       | R33  | W39<br>W67 | Bedroom  | 100               | 100%                     | 848                | 1.5                    | 5.2               | N/F          |
|               |          |       | R34  | W40<br>W69 | LKD      | 150               | 100%                     | 241                | 1.5                    | 5.0               |              |
|               | Flat12   | Fifth | R35  | W41<br>W65 | Bedroom  | 100               | 100%                     | 643                | 1.5                    | 5.3               | N/F          |
|               |          |       | R36  | W42        | Bedroom  | 100               | 61%                      | 120                | 1.5                    | 1.9               |              |

| Building Name | Unit No. | Floor | Room | Window            | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|-------------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |                   |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |                   |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat13   | Fifth | R37  | W43<br>W66        | LKD         | 150               | 100%                     | 412                | 1.5                    | 5.4               |              |
|               |          |       | R38  | W44<br>W83        | Bedroom     | 100               | 100%                     | 633                | 1.5                    | 5.3               | N/F          |
|               |          |       | R39  | W45<br>W82        | Kitchen     | 200               | 100%                     | 684                | 1.5                    | 3.1               | N/F          |
|               |          |       | R40  | W46               | Bedroom     | 100               | 61%                      | 117                | 1.5                    | 2.2               |              |
|               |          |       | R41  | W47               | Living Room | 150               | 38%                      | 126                | 1.5                    | 0.4               |              |
|               | Flat14   | Fifth | R42  | W48               | Bedroom     | 100               | 100%                     | 178                | 1.5                    | 0.0               | N/F          |
|               |          |       | R43  | W49               | Bedroom     | 100               | 100%                     | 194                | 1.5                    | 0.0               | N/F          |
|               |          |       | R44  | W50               | LKD         | 150               | 29%                      | 86                 | 1.5                    | 0.7               |              |
|               | Flat15   | Fifth | R45  | W51<br>W52        | LKD         | 150               | 21%                      | 53                 | 1.5                    | 2.1               |              |
|               |          |       | R46  | W53               | Bedroom     | 100               | 100%                     | 196                | 1.5                    | 1.1               |              |
|               | Flat16   | Fifth | R47  | W54               | Bedroom     | 100               | 52%                      | 102                | 1.5                    | 1.9               |              |
|               |          |       | R48  | W55<br>W56        | Bedroom     | 100               | 99%                      | 185                | 1.5                    | 2.9               |              |
|               |          |       | R49  | W57<br>W58        | LKD         | 150               | 94%                      | 265                | 1.5                    | 4.2               |              |
|               | Flat17   | Fifth | R50  | W59<br>W60<br>W61 | LKD         | 150               | 31%                      | 123                | 1.5                    | 3.3               |              |

| Building Name | Unit No. | Floor  | Room | Window         | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |                |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |                |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP10       |          | Ground | R51  | W62            | Bedroom     | 100               | 100%                     | 154                | 1.5                    | 3.4               |              |
|               |          |        | R52  | W63            | Bedroom     | 100               | 73%                      | 134                | 1.5                    | 3.7               |              |
|               |          | First  | R1   | W2<br>W1       | Kitchen     | 200               | 9%                       | 59                 | 1.5                    | 0.4               |              |
|               |          |        | R2   | W3             | Living Room | 150               | 47%                      | 144                | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1             | Bedroom     | 100               | 45%                      | 90                 | 1.5                    | 0.1               |              |
|               |          |        | R2   | W2             | Bedroom     | 100               | 6%                       | 25                 | 1.5                    | 0.0               |              |
| C3 DP01       |          | Ground | R3   | W3             | Bedroom     | 100               | 15%                      | 48                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4             | Bedroom     | 100               | 32%                      | 72                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W2<br>W3<br>W1 | Kitchen     | 200               | 8%                       | 74                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R2   | W4             | Living Room | 150               | 8%                       | 58                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1             | Bedroom     | 100               | 19%                      | 47                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2<br>W3       | Bedroom     | 100               | 19%                      | 57                 | 1.5                    | 0.0               |              |
| C3 DP02       |          | Ground | R3   | W4             | Bedroom     | 100               | 7%                       | 22                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W5<br>W6       | Bedroom     | 100               | 9%                       | 37                 | 1.5                    | 0.0               | N/F<br>N/F   |
|               |          |        | R1   | W2<br>W1       | Kitchen     | 200               | 8%                       | 57                 | 1.5                    | 0.0               |              |
|               |          |        |      |                |             |                   |                          |                    |                        |                   |              |



| Building Name | Unit No. | Floor  | Room | Window   | Room Use    | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------|-------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |          |             | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |          |             | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP05       |          | Ground | R1   | W1<br>W2 | Kitchen     | 200               | 6%                       | 59                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R2   | W3       | Living Room | 150               | 7%                       | 52                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1       | Bedroom     | 100               | 6%                       | 24                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 40%                      | 91                 | 1.5                    | 0.4               |              |
|               |          |        | R3   | W3       | Bedroom     | 100               | 5%                       | 26                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom     | 100               | 3%                       | 13                 | 1.5                    | 0.0               | N/F          |
| C3 DP06       |          | Ground | R1   | W2<br>W1 | Kitchen     | 200               | 8%                       | 58                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W3       | Living Room | 150               | 4%                       | 47                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1       | Bedroom     | 100               | 43%                      | 87                 | 1.5                    | 0.4               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 6%                       | 25                 | 1.5                    | 0.0               |              |
|               |          |        | R3   | W3       | Bedroom     | 100               | 1%                       | 10                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom     | 100               | 3%                       | 21                 | 1.5                    | 0.0               | N/F          |
| C3 DP07       |          | Ground | R1   | W1<br>W2 | Kitchen     | 200               | 6%                       | 58                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R2   | W3       | Living Room | 150               | 2%                       | 42                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1       | Bedroom     | 100               | 6%                       | 25                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2       | Bedroom     | 100               | 40%                      | 90                 | 1.5                    | 0.3               |              |
|               |          |        | R3   | W3       | Bedroom     | 100               | 0%                       | 18                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window   | Room Use      | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|----------|---------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |          |               | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |          |               | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
| C3 DP08       |          | Ground | R4   | W4       | Bedroom       | 100               | 0%                       | 8                  | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W2<br>W1 | Kitchen       | 200               | 8%                       | 59                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W3       | Living Room   | 150               | 3%                       | 43                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1       | Bedroom       | 100               | 43%                      | 88                 | 1.5                    | 0.2               |              |
|               |          |        | R2   | W2       | Bedroom       | 100               | 6%                       | 24                 | 1.5                    | 0.0               |              |
| C3 DP09       |          | Ground | R3   | W3       | Bedroom       | 100               | 0%                       | 9                  | 1.5                    | 0.0               | N/F          |
|               |          |        | R4   | W4       | Bedroom       | 100               | 0%                       | 18                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1<br>W2 | Kitchen       | 200               | 6%                       | 60                 | 1.5                    | 0.1               |              |
|               |          |        | R2   | W3       | Living Room   | 150               | 17%                      | 73                 | 1.5                    | 0.0               | N/F          |
|               |          | First  | R1   | W1       | Bedroom       | 100               | 5%                       | 24                 | 1.5                    | 0.0               |              |
|               |          |        | R2   | W2       | Bedroom       | 100               | 42%                      | 92                 | 1.5                    | 0.1               |              |
|               |          |        | R3   | W3       | Bedroom       | 100               | 9%                       | 38                 | 1.5                    | 0.0               | N/F          |
| Co-Living     |          | Ground | R4   | W4       | Bedroom       | 100               | 1%                       | 13                 | 1.5                    | 0.0               | N/F          |
|               |          |        | R1   | W1       | Communal Area | 150               | 32%                      | 98                 | 1.5                    | 3.6               | N/F          |
|               |          |        |      | W2       |               |                   |                          |                    |                        |                   | N/F          |
|               |          |        |      | W3       |               |                   |                          |                    |                        |                   | N/F          |
|               |          |        |      | W4       |               |                   |                          |                    |                        |                   | N/F          |
|               |          |        |      | W5       |               |                   |                          |                    |                        |                   | N/F          |
|               |          |        |      | W6       |               |                   |                          |                    |                        |                   | N/F          |
|               |          |        |      | W7       |               |                   |                          |                    |                        |                   | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use      | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|---------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |               | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |               | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |       |      | W8<br>W9   |               |                   |                          |                    |                        |                   |              |
|               |          |       | R2   | W10<br>W11 | Communal Area | 150               | 30%                      | 116                | 1.5                    | 1.2               |              |
|               | Flat1    | First | R1   | W1         | Studio        | 100               | 30%                      | 69                 | 1.5                    | 0.0               | N/F          |
|               | Flat2    | First | R2   | W2         | Studio        | 100               | 33%                      | 75                 | 1.5                    | 0.0               | N/F          |
|               | Flat3    | First | R3   | W3         | Studio        | 100               | 33%                      | 76                 | 1.5                    | 0.0               | N/F          |
|               | Flat4    | First | R4   | W4         | Studio        | 100               | 33%                      | 78                 | 1.5                    | 0.0               | N/F          |
|               | Flat5    | First | R5   | W5         | Studio        | 100               | 34%                      | 78                 | 1.5                    | 0.0               | N/F          |
|               | Flat6    | First | R6   | W6         | Studio        | 100               | 47%                      | 94                 | 1.5                    | 0.0               | N/F          |
|               | Flat7    | First | R7   | W7         | Studio        | 100               | 50%                      | 99                 | 1.5                    | 0.0               | N/F          |
|               | Flat8    | First | R8   | W8         | Studio        | 100               | 49%                      | 96                 | 1.5                    | 0.0               | N/F          |
|               | Flat9    | First | R9   | W9         | Studio        | 100               | 44%                      | 90                 | 1.5                    | 0.0               | N/F          |
|               | Flat10   | First | R10  | W10        | Studio        | 100               | 33%                      | 77                 | 1.5                    | 0.0               | N/F          |
|               | Flat11   | First | R11  | W11        | Studio        | 100               | 31%                      | 72                 | 1.5                    | 0.0               | N/F          |
|               | Flat12   | First | R12  | W12        | Studio        | 100               | 32%                      | 74                 | 1.5                    | 0.0               | N/F          |
|               | Flat13   | First | R13  | W13        | Studio        | 100               | 31%                      | 72                 | 1.5                    | 0.0               | N/F          |
|               | Flat14   | First | R14  | W14        | Studio        | 100               | 26%                      | 65                 | 1.5                    | 0.0               | N/F          |
|               | Flat15   | First | R15  | W15        | Studio        | 100               | 23%                      | 63                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat16   | First | R16  | W16    | Studio   | 100               | 25%                      | 67                 | 1.5                    | 0.0               | N/F          |
|               | Flat17   | First | R17  | W17    | Studio   | 100               | 17%                      | 50                 | 1.5                    | 0.0               | N/F          |
|               | Flat18   | First | R18  | W18    | Studio   | 100               | 30%                      | 70                 | 1.5                    | 0.0               | N/F          |
|               | Flat19   | First | R19  | W19    | Studio   | 100               | 19%                      | 53                 | 1.5                    | 0.0               | N/F          |
|               | Flat20   | First | R20  | W20    | Studio   | 100               | 4%                       | 27                 | 1.5                    | 0.0               |              |
|               | Flat21   | First | R21  | W21    | Studio   | 100               | 14%                      | 44                 | 1.5                    | 0.3               |              |
|               | Flat22   | First | R22  | W22    | Studio   | 100               | 13%                      | 44                 | 1.5                    | 0.2               |              |
|               | Flat23   | First | R23  | W23    | Studio   | 100               | 0%                       | 8                  | 1.5                    | 0.0               |              |
|               | Flat24   | First | R24  | W24    | Studio   | 100               | 17%                      | 51                 | 1.5                    | 0.8               |              |
|               | Flat25   | First | R25  | W25    | Studio   | 100               | 80%                      | 153                | 1.5                    | 0.1               | N/F          |
|               | Flat26   | First | R26  | W26    | Studio   | 100               | 48%                      | 97                 | 1.5                    | 0.3               | N/F          |
|               | Flat27   | First | R27  | W27    | Studio   | 100               | 23%                      | 46                 | 1.5                    | 1.7               |              |
|               | Flat28   | First | R28  | W28    | Studio   | 100               | 17%                      | 48                 | 1.5                    | 1.6               |              |
|               | Flat29   | First | R29  | W29    | Studio   | 100               | 13%                      | 36                 | 1.5                    | 1.6               |              |
|               | Flat30   | First | R30  | W30    | Studio   | 100               | 23%                      | 49                 | 1.5                    | 2.0               |              |
|               | Flat31   | First | R31  | W31    | Studio   | 100               | 46%                      | 88                 | 1.5                    | 2.9               |              |
|               | Flat32   | First | R32  | W32    | Studio   | 100               | 51%                      | 102                | 1.5                    | 2.1               |              |
|               | Flat33   | First | R33  | W33    | Studio   | 100               | 55%                      | 112                | 1.5                    | 3.0               |              |

| Building Name | Unit No. | Floor | Room | Window            | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|-------------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |                   |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |                   |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat34   | First | R34  | W34               | Studio   | 100               | 59%                      | 124                | 1.5                    | 2.7               |              |
|               | Flat35   | First | R35  | W35               | Studio   | 100               | 48%                      | 96                 | 1.5                    | 2.1               |              |
|               | Flat36   | First | R36  | W36               | Studio   | 100               | 25%                      | 66                 | 1.5                    | 0.6               |              |
|               | Flat37   | First | R37  | W37               | Studio   | 100               | 61%                      | 119                | 1.5                    | 2.4               |              |
|               | Flat38   | First | R38  | W38<br>W39        | Studio   | 100               | 75%                      | 166                | 1.5                    | 4.3               |              |
|               | Flat39   | First | R39  | W40<br>W41        | Studio   | 100               | 91%                      | 190                | 1.5                    | 4.5               |              |
|               | Flat40   | First | R40  | W42<br>W43<br>W44 | Studio   | 100               | 100%                     | 555                | 1.5                    | 4.7               | N/F          |
|               | Flat41   | First | R41  | W45               | Studio   | 100               | 100%                     | 283                | 1.5                    | 2.7               | N/F          |
|               | Flat42   | First | R42  | W46               | Studio   | 100               | 100%                     | 287                | 1.5                    | 2.7               | N/F          |
|               | Flat43   | First | R43  | W47               | Studio   | 100               | 100%                     | 295                | 1.5                    | 2.7               | N/F          |
|               | Flat44   | First | R44  | W48               | Studio   | 100               | 100%                     | 289                | 1.5                    | 2.7               | N/F          |
|               | Flat45   | First | R45  | W49<br>W50        | Studio   | 100               | 100%                     | 331                | 1.5                    | 2.7               | N/F<br>N/F   |
|               | Flat46   | First | R46  | W51<br>W52        | Studio   | 100               | 67%                      | 111                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat47   | First | R47  | W53<br>W54        | Studio   | 100               | 61%                      | 120                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat48   | First | R48  | W55               | Studio   | 100               | 26%                      | 63                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat49   | First  | R49  | W56    | Studio   | 100               | 19%                      | 55                 | 1.5                    | 0.0               | N/F          |
|               | Flat1    | Second | R1   | W1     | Studio   | 100               | 44%                      | 82                 | 1.5                    | 0.0               | N/F          |
|               | Flat2    | Second | R2   | W2     | Studio   | 100               | 47%                      | 86                 | 1.5                    | 0.0               | N/F          |
|               | Flat3    | Second | R3   | W3     | Studio   | 100               | 47%                      | 91                 | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Second | R4   | W4     | Studio   | 100               | 48%                      | 87                 | 1.5                    | 0.0               | N/F          |
|               | Flat5    | Second | R5   | W5     | Studio   | 100               | 48%                      | 91                 | 1.5                    | 0.0               | N/F          |
|               | Flat6    | Second | R6   | W6     | Studio   | 100               | 48%                      | 87                 | 1.5                    | 0.0               | N/F          |
|               | Flat7    | Second | R7   | W7     | Studio   | 100               | 46%                      | 90                 | 1.5                    | 0.0               | N/F          |
|               | Flat8    | Second | R8   | W8     | Studio   | 100               | 46%                      | 89                 | 1.5                    | 0.0               | N/F          |
|               | Flat9    | Second | R9   | W9     | Studio   | 100               | 47%                      | 90                 | 1.5                    | 0.0               | N/F          |
|               | Flat10   | Second | R10  | W10    | Studio   | 100               | 45%                      | 86                 | 1.5                    | 0.0               | N/F          |
|               | Flat11   | Second | R11  | W11    | Studio   | 100               | 46%                      | 86                 | 1.5                    | 0.0               | N/F          |
|               | Flat12   | Second | R12  | W12    | Studio   | 100               | 43%                      | 86                 | 1.5                    | 0.0               | N/F          |
|               | Flat13   | Second | R13  | W13    | Studio   | 100               | 44%                      | 82                 | 1.5                    | 0.0               | N/F          |
|               | Flat14   | Second | R14  | W14    | Studio   | 100               | 35%                      | 75                 | 1.5                    | 0.0               | N/F          |
|               | Flat15   | Second | R15  | W15    | Studio   | 100               | 35%                      | 74                 | 1.5                    | 0.0               | N/F          |
|               | Flat16   | Second | R16  | W16    | Studio   | 100               | 35%                      | 74                 | 1.5                    | 0.0               | N/F          |
|               | Flat17   | Second | R17  | W17    | Studio   | 100               | 33%                      | 75                 | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat18   | Second | R18  | W18        | Studio   | 100               | 30%                      | 69                 | 1.5                    | 0.0               | N/F          |
|               | Flat19   | Second | R19  | W19<br>W20 | Studio   | 100               | 100%                     | 194                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat20   | Second | R20  | W21        | Studio   | 100               | 18%                      | 54                 | 1.5                    | 0.0               |              |
|               | Flat21   | Second | R21  | W22        | Studio   | 100               | 14%                      | 46                 | 1.5                    | 0.0               |              |
|               | Flat22   | Second | R22  | W23        | Studio   | 100               | 13%                      | 46                 | 1.5                    | 0.0               |              |
|               | Flat23   | Second | R23  | W24        | Studio   | 100               | 14%                      | 47                 | 1.5                    | 0.2               |              |
|               | Flat24   | Second | R24  | W25        | Studio   | 100               | 18%                      | 51                 | 1.5                    | 0.6               |              |
|               | Flat25   | Second | R25  | W26        | Studio   | 100               | 20%                      | 55                 | 1.5                    | 0.8               |              |
|               | Flat26   | Second | R26  | W27        | Studio   | 100               | 85%                      | 159                | 1.5                    | 0.6               | N/F          |
|               | Flat27   | Second | R27  | W28        | Studio   | 100               | 50%                      | 100                | 1.5                    | 0.6               | N/F          |
|               | Flat28   | Second | R28  | W29        | Studio   | 100               | 25%                      | 49                 | 1.5                    | 1.7               |              |
|               | Flat29   | Second | R29  | W30        | Studio   | 100               | 17%                      | 48                 | 1.5                    | 1.6               |              |
|               | Flat30   | Second | R30  | W31        | Studio   | 100               | 13%                      | 36                 | 1.5                    | 1.6               |              |
|               | Flat31   | Second | R31  | W32        | Studio   | 100               | 24%                      | 51                 | 1.5                    | 2.0               |              |
|               | Flat32   | Second | R32  | W33        | Studio   | 100               | 26%                      | 55                 | 1.5                    | 1.7               |              |
|               | Flat33   | Second | R33  | W34        | Studio   | 100               | 26%                      | 56                 | 1.5                    | 2.2               |              |
|               | Flat34   | Second | R34  | W35        | Studio   | 100               | 33%                      | 66                 | 1.5                    | 1.7               |              |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat35   | Second | R35  | W36        | Studio   | 100               | 33%                      | 71                 | 1.5                    | 2.5               |              |
|               | Flat36   | Second | R36  | W37        | Studio   | 100               | 40%                      | 80                 | 1.5                    | 1.7               |              |
|               | Flat37   | Second | R37  | W38        | Studio   | 100               | 39%                      | 78                 | 1.5                    | 2.6               |              |
|               | Flat38   | Second | R38  | W39        | Studio   | 100               | 44%                      | 91                 | 1.5                    | 2.1               |              |
|               | Flat39   | Second | R39  | W40        | Studio   | 100               | 46%                      | 94                 | 1.5                    | 3.0               |              |
|               | Flat40   | Second | R40  | W41        | Studio   | 100               | 52%                      | 105                | 1.5                    | 2.4               |              |
|               | Flat41   | Second | R41  | W42        | Studio   | 100               | 55%                      | 106                | 1.5                    | 3.3               |              |
|               | Flat42   | Second | R42  | W43        | Studio   | 100               | 56%                      | 112                | 1.5                    | 2.5               |              |
|               | Flat43   | Second | R43  | W44        | Studio   | 100               | 49%                      | 99                 | 1.5                    | 2.1               |              |
|               | Flat44   | Second | R44  | W45        | Studio   | 100               | 66%                      | 126                | 1.5                    | 2.7               |              |
|               | Flat45   | Second | R45  | W46        | Studio   | 100               | 66%                      | 137                | 1.5                    | 3.3               |              |
|               | Flat46   | Second | R46  | W47<br>W48 | Studio   | 100               | 87%                      | 220                | 1.5                    | 4.0               |              |
|               | Flat47   | Second | R47  | W49<br>W50 | Studio   | 100               | 99%                      | 258                | 1.5                    | 4.2               |              |
|               | Flat48   | Second | R48  | W51<br>W52 | Studio   | 100               | 100%                     | 380                | 1.5                    | 4.7               | N/F          |
|               | Flat49   | Second | R49  | W53        | Studio   | 100               | 100%                     | 301                | 1.5                    | 1.9               | N/F          |
|               | Flat50   | Second | R50  | W54        | Studio   | 100               | 100%                     | 301                | 1.5                    | 1.9               | N/F          |
|               | Flat51   | Second | R51  | W55        | Studio   | 100               | 100%                     | 304                | 1.5                    | 1.9               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat52   | Second | R52  | W56        | Studio   | 100               | 100%                     | 307                | 1.5                    | 1.9               | N/F          |
|               | Flat53   | Second | R53  | W57<br>W58 | Studio   | 100               | 100%                     | 360                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat54   | Second | R54  | W59<br>W60 | Studio   | 100               | 77%                      | 123                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat55   | Second | R55  | W61<br>W62 | Studio   | 100               | 70%                      | 148                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat56   | Second | R56  | W63        | Studio   | 100               | 33%                      | 66                 | 1.5                    | 0.0               | N/F          |
|               | Flat57   | Second | R57  | W64        | Studio   | 100               | 32%                      | 65                 | 1.5                    | 0.0               | N/F          |
|               | Flat1    | Third  | R1   | W1         | Studio   | 100               | 58%                      | 127                | 1.5                    | 0.0               | N/F          |
|               | Flat2    | Third  | R2   | W2         | Studio   | 100               | 64%                      | 134                | 1.5                    | 0.0               | N/F          |
|               | Flat3    | Third  | R3   | W3         | Studio   | 100               | 67%                      | 139                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Third  | R4   | W4         | Studio   | 100               | 64%                      | 136                | 1.5                    | 0.0               | N/F          |
|               | Flat5    | Third  | R5   | W5         | Studio   | 100               | 66%                      | 139                | 1.5                    | 0.0               | N/F          |
|               | Flat6    | Third  | R6   | W6         | Studio   | 100               | 64%                      | 135                | 1.5                    | 0.0               | N/F          |
|               | Flat7    | Third  | R7   | W7         | Studio   | 100               | 67%                      | 141                | 1.5                    | 0.0               | N/F          |
|               | Flat8    | Third  | R8   | W8         | Studio   | 100               | 66%                      | 138                | 1.5                    | 0.0               | N/F          |
|               | Flat9    | Third  | R9   | W9         | Studio   | 100               | 66%                      | 139                | 1.5                    | 0.0               | N/F          |
|               | Flat10   | Third  | R10  | W10        | Studio   | 100               | 65%                      | 136                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat11   | Third | R11  | W11        | Studio   | 100               | 65%                      | 135                | 1.5                    | 0.0               | N/F          |
|               | Flat12   | Third | R12  | W12        | Studio   | 100               | 64%                      | 134                | 1.5                    | 0.0               | N/F          |
|               | Flat13   | Third | R13  | W13        | Studio   | 100               | 64%                      | 130                | 1.5                    | 0.0               | N/F          |
|               | Flat14   | Third | R14  | W14        | Studio   | 100               | 56%                      | 105                | 1.5                    | 0.0               | N/F          |
|               | Flat15   | Third | R15  | W15        | Studio   | 100               | 51%                      | 106                | 1.5                    | 0.0               | N/F          |
|               | Flat16   | Third | R16  | W16        | Studio   | 100               | 49%                      | 98                 | 1.5                    | 0.0               | N/F          |
|               | Flat17   | Third | R17  | W17        | Studio   | 100               | 47%                      | 94                 | 1.5                    | 0.0               | N/F          |
|               | Flat18   | Third | R18  | W18        | Studio   | 100               | 40%                      | 87                 | 1.5                    | 0.0               | N/F          |
|               | Flat19   | Third | R19  | W19<br>W20 | Studio   | 100               | 99%                      | 206                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat20   | Third | R20  | W21        | Studio   | 100               | 22%                      | 60                 | 1.5                    | 0.0               |              |
|               | Flat21   | Third | R21  | W22        | Studio   | 100               | 19%                      | 52                 | 1.5                    | 0.0               |              |
|               | Flat22   | Third | R22  | W23        | Studio   | 100               | 18%                      | 52                 | 1.5                    | 0.0               |              |
|               | Flat23   | Third | R23  | W24        | Studio   | 100               | 18%                      | 52                 | 1.5                    | 0.2               |              |
|               | Flat24   | Third | R24  | W25        | Studio   | 100               | 23%                      | 56                 | 1.5                    | 0.6               |              |
|               | Flat25   | Third | R25  | W26        | Studio   | 100               | 22%                      | 60                 | 1.5                    | 0.8               |              |
|               | Flat26   | Third | R26  | W27        | Studio   | 100               | 94%                      | 169                | 1.5                    | 0.8               | N/F          |
|               | Flat27   | Third | R27  | W28        | Studio   | 100               | 60%                      | 105                | 1.5                    | 0.6               | N/F          |
|               | Flat28   | Third | R28  | W29        | Studio   | 100               | 24%                      | 56                 | 1.5                    | 1.6               |              |

| Building Name | Unit No. | Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat29   | Third | R29  | W30    | Studio   | 100               | 25%                      | 55                 | 1.5                    | 1.8               |              |
|               | Flat30   | Third | R30  | W31    | Studio   | 100               | 15%                      | 41                 | 1.5                    | 1.6               |              |
|               | Flat31   | Third | R31  | W32    | Studio   | 100               | 30%                      | 57                 | 1.5                    | 2.0               |              |
|               | Flat32   | Third | R32  | W33    | Studio   | 100               | 30%                      | 67                 | 1.5                    | 1.7               |              |
|               | Flat33   | Third | R33  | W34    | Studio   | 100               | 32%                      | 64                 | 1.5                    | 2.3               |              |
|               | Flat34   | Third | R34  | W35    | Studio   | 100               | 40%                      | 80                 | 1.5                    | 1.7               |              |
|               | Flat35   | Third | R35  | W36    | Studio   | 100               | 40%                      | 82                 | 1.5                    | 2.5               |              |
|               | Flat36   | Third | R36  | W37    | Studio   | 100               | 48%                      | 93                 | 1.5                    | 1.9               |              |
|               | Flat37   | Third | R37  | W38    | Studio   | 100               | 45%                      | 90                 | 1.5                    | 2.9               |              |
|               | Flat38   | Third | R38  | W39    | Studio   | 100               | 55%                      | 104                | 1.5                    | 2.3               |              |
|               | Flat39   | Third | R39  | W40    | Studio   | 100               | 54%                      | 106                | 1.5                    | 3.3               |              |
|               | Flat40   | Third | R40  | W41    | Studio   | 100               | 58%                      | 118                | 1.5                    | 2.6               |              |
|               | Flat41   | Third | R41  | W42    | Studio   | 100               | 56%                      | 115                | 1.5                    | 3.5               |              |
|               | Flat42   | Third | R42  | W43    | Studio   | 100               | 58%                      | 120                | 1.5                    | 2.8               |              |
|               | Flat43   | Third | R43  | W44    | Studio   | 100               | 51%                      | 103                | 1.5                    | 2.6               |              |
|               | Flat44   | Third | R44  | W45    | Studio   | 100               | 67%                      | 132                | 1.5                    | 3.1               |              |
|               | Flat45   | Third | R45  | W46    | Studio   | 100               | 66%                      | 136                | 1.5                    | 3.6               |              |
|               | Flat46   | Third | R46  | W47    | Studio   | 100               | 89%                      | 217                | 1.5                    | 4.3               |              |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        |      | W48        |          |                   |                          |                    |                        |                   |              |
|               | Flat47   | Third  | R47  | W49<br>W50 | Studio   | 100               | 99%                      | 247                | 1.5                    | 4.2               |              |
|               | Flat48   | Third  | R48  | W51<br>W52 | Studio   | 100               | 100%                     | 388                | 1.5                    | 4.8               | N/F          |
|               | Flat49   | Third  | R49  | W53        | Studio   | 100               | 100%                     | 312                | 1.5                    | 1.9               | N/F          |
|               | Flat50   | Third  | R50  | W54        | Studio   | 100               | 100%                     | 312                | 1.5                    | 1.9               | N/F          |
|               | Flat51   | Third  | R51  | W55        | Studio   | 100               | 100%                     | 313                | 1.5                    | 1.9               | N/F          |
|               | Flat52   | Third  | R52  | W56        | Studio   | 100               | 100%                     | 317                | 1.5                    | 1.9               | N/F          |
|               | Flat53   | Third  | R53  | W57<br>W58 | Studio   | 100               | 100%                     | 380                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat54   | Third  | R54  | W59<br>W60 | Studio   | 100               | 86%                      | 165                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat55   | Third  | R55  | W61<br>W62 | Studio   | 100               | 79%                      | 210                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat56   | Third  | R56  | W63        | Studio   | 100               | 47%                      | 87                 | 1.5                    | 0.0               | N/F          |
|               | Flat57   | Third  | R57  | W64        | Studio   | 100               | 45%                      | 86                 | 1.5                    | 0.0               | N/F          |
|               | Flat1    | Fourth | R1   | W1         | Studio   | 100               | 83%                      | 173                | 1.5                    | 0.0               | N/F          |
|               | Flat2    | Fourth | R2   | W2         | Studio   | 100               | 86%                      | 183                | 1.5                    | 0.0               | N/F          |
|               | Flat3    | Fourth | R3   | W3         | Studio   | 100               | 90%                      | 186                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Fourth | R4   | W4         | Studio   | 100               | 85%                      | 185                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat5    | Fourth | R5   | W5         | Studio   | 100               | 88%                      | 189                | 1.5                    | 0.0               | N/F          |
|               | Flat6    | Fourth | R6   | W6         | Studio   | 100               | 88%                      | 187                | 1.5                    | 0.0               | N/F          |
|               | Flat7    | Fourth | R7   | W7         | Studio   | 100               | 88%                      | 188                | 1.5                    | 0.0               | N/F          |
|               | Flat8    | Fourth | R8   | W8         | Studio   | 100               | 90%                      | 184                | 1.5                    | 0.0               | N/F          |
|               | Flat9    | Fourth | R9   | W9         | Studio   | 100               | 92%                      | 185                | 1.5                    | 0.0               | N/F          |
|               | Flat10   | Fourth | R10  | W10        | Studio   | 100               | 91%                      | 184                | 1.5                    | 0.0               | N/F          |
|               | Flat11   | Fourth | R11  | W11        | Studio   | 100               | 93%                      | 181                | 1.5                    | 0.0               | N/F          |
|               | Flat12   | Fourth | R12  | W12        | Studio   | 100               | 89%                      | 184                | 1.5                    | 0.0               | N/F          |
|               | Flat13   | Fourth | R13  | W13        | Studio   | 100               | 89%                      | 179                | 1.5                    | 0.0               | N/F          |
|               | Flat14   | Fourth | R14  | W14        | Studio   | 100               | 74%                      | 147                | 1.5                    | 0.0               | N/F          |
|               | Flat15   | Fourth | R15  | W15        | Studio   | 100               | 76%                      | 158                | 1.5                    | 0.0               | N/F          |
|               | Flat16   | Fourth | R16  | W16        | Studio   | 100               | 72%                      | 154                | 1.5                    | 0.0               | N/F          |
|               | Flat17   | Fourth | R17  | W17        | Studio   | 100               | 67%                      | 144                | 1.5                    | 0.0               | N/F          |
|               | Flat18   | Fourth | R18  | W18        | Studio   | 100               | 65%                      | 123                | 1.5                    | 0.0               | N/F          |
|               | Flat19   | Fourth | R19  | W19<br>W20 | Studio   | 100               | 100%                     | 247                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat20   | Fourth | R20  | W21        | Studio   | 100               | 30%                      | 71                 | 1.5                    | 0.0               |              |
|               | Flat21   | Fourth | R21  | W22        | Studio   | 100               | 24%                      | 60                 | 1.5                    | 0.0               |              |

| Building Name | Unit No. | Floor  | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat22   | Fourth | R22  | W23    | Studio   | 100               | 21%                      | 58                 | 1.5                    | 0.0               |              |
|               | Flat23   | Fourth | R23  | W24    | Studio   | 100               | 21%                      | 57                 | 1.5                    | 0.2               |              |
|               | Flat24   | Fourth | R24  | W25    | Studio   | 100               | 25%                      | 63                 | 1.5                    | 0.6               |              |
|               | Flat25   | Fourth | R25  | W26    | Studio   | 100               | 27%                      | 67                 | 1.5                    | 0.8               |              |
|               | Flat26   | Fourth | R26  | W27    | Studio   | 100               | 97%                      | 178                | 1.5                    | 0.8               | N/F          |
|               | Flat27   | Fourth | R27  | W28    | Studio   | 100               | 70%                      | 111                | 1.5                    | 0.6               | N/F          |
|               | Flat28   | Fourth | R28  | W29    | Studio   | 100               | 30%                      | 62                 | 1.5                    | 1.6               |              |
|               | Flat29   | Fourth | R29  | W30    | Studio   | 100               | 27%                      | 61                 | 1.5                    | 1.8               |              |
|               | Flat30   | Fourth | R30  | W31    | Studio   | 100               | 17%                      | 48                 | 1.5                    | 1.7               |              |
|               | Flat31   | Fourth | R31  | W32    | Studio   | 100               | 33%                      | 68                 | 1.5                    | 2.0               |              |
|               | Flat32   | Fourth | R32  | W33    | Studio   | 100               | 39%                      | 79                 | 1.5                    | 1.7               |              |
|               | Flat33   | Fourth | R33  | W34    | Studio   | 100               | 38%                      | 78                 | 1.5                    | 2.4               |              |
|               | Flat34   | Fourth | R34  | W35    | Studio   | 100               | 46%                      | 90                 | 1.5                    | 1.9               |              |
|               | Flat35   | Fourth | R35  | W36    | Studio   | 100               | 45%                      | 94                 | 1.5                    | 2.8               |              |
|               | Flat36   | Fourth | R36  | W37    | Studio   | 100               | 52%                      | 105                | 1.5                    | 2.3               |              |
|               | Flat37   | Fourth | R37  | W38    | Studio   | 100               | 50%                      | 99                 | 1.5                    | 3.3               |              |
|               | Flat38   | Fourth | R38  | W39    | Studio   | 100               | 59%                      | 117                | 1.5                    | 2.7               |              |
|               | Flat39   | Fourth | R39  | W40    | Studio   | 100               | 58%                      | 115                | 1.5                    | 3.7               |              |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat40   | Fourth | R40  | W41        | Studio   | 100               | 64%                      | 129                | 1.5                    | 3.0               |              |
|               | Flat41   | Fourth | R41  | W42        | Studio   | 100               | 63%                      | 122                | 1.5                    | 3.9               |              |
|               | Flat42   | Fourth | R42  | W43        | Studio   | 100               | 66%                      | 131                | 1.5                    | 3.2               |              |
|               | Flat43   | Fourth | R43  | W44        | Studio   | 100               | 53%                      | 106                | 1.5                    | 2.9               |              |
|               | Flat44   | Fourth | R44  | W45        | Studio   | 100               | 68%                      | 137                | 1.5                    | 3.4               |              |
|               | Flat45   | Fourth | R45  | W46        | Studio   | 100               | 66%                      | 139                | 1.5                    | 4.0               |              |
|               | Flat46   | Fourth | R46  | W47<br>W48 | Studio   | 100               | 89%                      | 221                | 1.5                    | 4.4               |              |
|               | Flat47   | Fourth | R47  | W49<br>W50 | Studio   | 100               | 99%                      | 249                | 1.5                    | 4.2               |              |
|               | Flat48   | Fourth | R48  | W51<br>W52 | Studio   | 100               | 100%                     | 398                | 1.5                    | 4.8               | N/F          |
|               | Flat49   | Fourth | R49  | W53        | Studio   | 100               | 100%                     | 323                | 1.5                    | 1.9               | N/F          |
|               | Flat50   | Fourth | R50  | W54        | Studio   | 100               | 100%                     | 317                | 1.5                    | 1.9               | N/F          |
|               | Flat51   | Fourth | R51  | W55        | Studio   | 100               | 100%                     | 321                | 1.5                    | 1.9               | N/F          |
|               | Flat52   | Fourth | R52  | W56        | Studio   | 100               | 100%                     | 321                | 1.5                    | 1.9               | N/F          |
|               | Flat53   | Fourth | R53  | W57<br>W58 | Studio   | 100               | 100%                     | 401                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat54   | Fourth | R54  | W59<br>W60 | Studio   | 100               | 95%                      | 217                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat55   | Fourth | R55  | W61        | Studio   | 100               | 100%                     | 267                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        |      | W62    |          |                   |                          |                    |                        |                   | N/F          |
|               | Flat56   | Fourth | R56  | W63    | Studio   | 100               | 59%                      | 130                | 1.5                    | 0.0               | N/F          |
|               | Flat57   | Fourth | R57  | W64    | Studio   | 100               | 61%                      | 130                | 1.5                    | 0.0               | N/F          |
|               | Flat1    | Fifth  | R1   | W1     | Studio   | 100               | 97%                      | 217                | 1.5                    | 0.0               | N/F          |
|               | Flat2    | Fifth  | R2   | W2     | Studio   | 100               | 100%                     | 230                | 1.5                    | 0.0               | N/F          |
|               | Flat3    | Fifth  | R3   | W3     | Studio   | 100               | 100%                     | 229                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Fifth  | R4   | W4     | Studio   | 100               | 100%                     | 225                | 1.5                    | 0.0               | N/F          |
|               | Flat5    | Fifth  | R5   | W5     | Studio   | 100               | 100%                     | 226                | 1.5                    | 0.0               | N/F          |
|               | Flat6    | Fifth  | R6   | W6     | Studio   | 100               | 100%                     | 227                | 1.5                    | 0.0               | N/F          |
|               | Flat7    | Fifth  | R7   | W7     | Studio   | 100               | 100%                     | 226                | 1.5                    | 0.0               | N/F          |
|               | Flat8    | Fifth  | R8   | W8     | Studio   | 100               | 98%                      | 226                | 1.5                    | 0.0               | N/F          |
|               | Flat9    | Fifth  | R9   | W9     | Studio   | 100               | 100%                     | 228                | 1.5                    | 0.0               | N/F          |
|               | Flat10   | Fifth  | R10  | W10    | Studio   | 100               | 99%                      | 222                | 1.5                    | 0.0               | N/F          |
|               | Flat11   | Fifth  | R11  | W11    | Studio   | 100               | 100%                     | 222                | 1.5                    | 0.0               | N/F          |
|               | Flat12   | Fifth  | R12  | W12    | Studio   | 100               | 99%                      | 223                | 1.5                    | 0.0               | N/F          |
|               | Flat13   | Fifth  | R13  | W13    | Studio   | 100               | 100%                     | 221                | 1.5                    | 0.0               | N/F          |
|               | Flat14   | Fifth  | R14  | W14    | Studio   | 100               | 91%                      | 186                | 1.5                    | 0.0               | N/F          |
|               | Flat15   | Fifth  | R15  | W15    | Studio   | 100               | 98%                      | 212                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat16   | Fifth | R16  | W16        | Studio   | 100               | 98%                      | 209                | 1.5                    | 0.0               | N/F          |
|               | Flat17   | Fifth | R17  | W17        | Studio   | 100               | 98%                      | 200                | 1.5                    | 0.0               | N/F          |
|               | Flat18   | Fifth | R18  | W18        | Studio   | 100               | 93%                      | 168                | 1.5                    | 0.0               | N/F          |
|               | Flat19   | Fifth | R19  | W19<br>W20 | Studio   | 100               | 100%                     | 292                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat20   | Fifth | R20  | W21        | Studio   | 100               | 38%                      | 83                 | 1.5                    | 0.0               |              |
|               | Flat21   | Fifth | R21  | W22        | Studio   | 100               | 32%                      | 73                 | 1.5                    | 0.0               |              |
|               | Flat22   | Fifth | R22  | W23        | Studio   | 100               | 26%                      | 67                 | 1.5                    | 0.0               |              |
|               | Flat23   | Fifth | R23  | W24        | Studio   | 100               | 24%                      | 65                 | 1.5                    | 0.2               |              |
|               | Flat24   | Fifth | R24  | W25        | Studio   | 100               | 30%                      | 69                 | 1.5                    | 0.6               |              |
|               | Flat25   | Fifth | R25  | W26        | Studio   | 100               | 30%                      | 73                 | 1.5                    | 0.8               |              |
|               | Flat26   | Fifth | R26  | W27        | Studio   | 100               | 100%                     | 189                | 1.5                    | 0.8               | N/F          |
|               | Flat27   | Fifth | R27  | W28        | Studio   | 100               | 72%                      | 115                | 1.5                    | 0.6               | N/F          |
|               | Flat28   | Fifth | R28  | W29        | Studio   | 100               | 32%                      | 67                 | 1.5                    | 1.7               |              |
|               | Flat29   | Fifth | R29  | W30        | Studio   | 100               | 29%                      | 68                 | 1.5                    | 1.8               |              |
|               | Flat30   | Fifth | R30  | W31        | Studio   | 100               | 20%                      | 52                 | 1.5                    | 1.7               |              |
|               | Flat31   | Fifth | R31  | W32        | Studio   | 100               | 39%                      | 79                 | 1.5                    | 2.1               |              |
|               | Flat32   | Fifth | R32  | W33        | Studio   | 100               | 45%                      | 90                 | 1.5                    | 2.0               |              |
|               | Flat33   | Fifth | R33  | W34        | Studio   | 100               | 45%                      | 88                 | 1.5                    | 2.8               |              |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat34   | Fifth | R34  | W35        | Studio   | 100               | 53%                      | 103                | 1.5                    | 2.4               |              |
|               | Flat35   | Fifth | R35  | W36        | Studio   | 100               | 52%                      | 105                | 1.5                    | 3.4               |              |
|               | Flat36   | Fifth | R36  | W37        | Studio   | 100               | 60%                      | 114                | 1.5                    | 2.9               |              |
|               | Flat37   | Fifth | R37  | W38        | Studio   | 100               | 56%                      | 107                | 1.5                    | 3.8               |              |
|               | Flat38   | Fifth | R38  | W39        | Studio   | 100               | 68%                      | 128                | 1.5                    | 3.1               |              |
|               | Flat39   | Fifth | R39  | W40        | Studio   | 100               | 60%                      | 125                | 1.5                    | 4.0               |              |
|               | Flat40   | Fifth | R40  | W41        | Studio   | 100               | 71%                      | 138                | 1.5                    | 3.2               |              |
|               | Flat41   | Fifth | R41  | W42        | Studio   | 100               | 64%                      | 132                | 1.5                    | 4.0               |              |
|               | Flat42   | Fifth | R42  | W43        | Studio   | 100               | 70%                      | 140                | 1.5                    | 3.2               |              |
|               | Flat43   | Fifth | R43  | W44        | Studio   | 100               | 59%                      | 114                | 1.5                    | 2.8               |              |
|               | Flat44   | Fifth | R44  | W45        | Studio   | 100               | 74%                      | 145                | 1.5                    | 3.5               |              |
|               | Flat45   | Fifth | R45  | W46        | Studio   | 100               | 69%                      | 142                | 1.5                    | 4.0               |              |
|               | Flat46   | Fifth | R46  | W47<br>W48 | Studio   | 100               | 93%                      | 226                | 1.5                    | 4.4               |              |
|               | Flat47   | Fifth | R47  | W49<br>W50 | Studio   | 100               | 100%                     | 256                | 1.5                    | 4.2               |              |
|               | Flat48   | Fifth | R48  | W51<br>W52 | Studio   | 100               | 100%                     | 408                | 1.5                    | 4.8               | N/F          |
|               | Flat49   | Fifth | R49  | W53        | Studio   | 100               | 100%                     | 329                | 1.5                    | 1.9               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat50   | Fifth | R50  | W54        | Studio   | 100               | 100%                     | 321                | 1.5                    | 1.9               | N/F          |
|               | Flat51   | Fifth | R51  | W55        | Studio   | 100               | 100%                     | 331                | 1.5                    | 1.9               | N/F          |
|               | Flat52   | Fifth | R52  | W56        | Studio   | 100               | 100%                     | 324                | 1.5                    | 1.9               | N/F          |
|               | Flat53   | Fifth | R53  | W57<br>W58 | Studio   | 100               | 100%                     | 426                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat54   | Fifth | R54  | W59<br>W60 | Studio   | 100               | 100%                     | 266                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat55   | Fifth | R55  | W61<br>W62 | Studio   | 100               | 100%                     | 329                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat56   | Fifth | R56  | W63        | Studio   | 100               | 81%                      | 172                | 1.5                    | 0.0               | N/F          |
|               | Flat57   | Fifth | R57  | W64        | Studio   | 100               | 81%                      | 171                | 1.5                    | 0.0               | N/F          |
|               | Flat1    | Sixth | R1   | W1         | Studio   | 100               | 100%                     | 252                | 1.5                    | 0.0               | N/F          |
|               | Flat2    | Sixth | R2   | W2         | Studio   | 100               | 100%                     | 266                | 1.5                    | 0.0               | N/F          |
|               | Flat3    | Sixth | R3   | W3         | Studio   | 100               | 100%                     | 267                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Sixth | R4   | W4         | Studio   | 100               | 100%                     | 262                | 1.5                    | 0.0               | N/F          |
|               | Flat5    | Sixth | R5   | W5         | Studio   | 100               | 100%                     | 263                | 1.5                    | 0.0               | N/F          |
|               | Flat6    | Sixth | R6   | W6         | Studio   | 100               | 100%                     | 262                | 1.5                    | 0.0               | N/F          |
|               | Flat7    | Sixth | R7   | W7         | Studio   | 100               | 100%                     | 258                | 1.5                    | 0.0               | N/F          |
|               | Flat8    | Sixth | R8   | W8         | Studio   | 100               | 100%                     | 260                | 1.5                    | 0.0               | N/F          |
|               | Flat9    | Sixth | R9   | W9         | Studio   | 100               | 100%                     | 256                | 1.5                    | 0.0               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat10   | Sixth | R10  | W10        | Studio   | 100               | 100%                     | 255                | 1.5                    | 0.0               | N/F          |
|               | Flat11   | Sixth | R11  | W11        | Studio   | 100               | 100%                     | 256                | 1.5                    | 0.0               | N/F          |
|               | Flat12   | Sixth | R12  | W12        | Studio   | 100               | 100%                     | 252                | 1.5                    | 0.0               | N/F          |
|               | Flat13   | Sixth | R13  | W13        | Studio   | 100               | 100%                     | 252                | 1.5                    | 0.0               | N/F          |
|               | Flat14   | Sixth | R14  | W14        | Studio   | 100               | 96%                      | 215                | 1.5                    | 0.0               | N/F          |
|               | Flat15   | Sixth | R15  | W15        | Studio   | 100               | 100%                     | 244                | 1.5                    | 0.0               | N/F          |
|               | Flat16   | Sixth | R16  | W16        | Studio   | 100               | 100%                     | 245                | 1.5                    | 0.0               | N/F          |
|               | Flat17   | Sixth | R17  | W17        | Studio   | 100               | 100%                     | 238                | 1.5                    | 0.0               | N/F          |
|               | Flat18   | Sixth | R18  | W18        | Studio   | 100               | 100%                     | 201                | 1.5                    | 0.0               | N/F          |
|               | Flat19   | Sixth | R19  | W19<br>W20 | Studio   | 100               | 100%                     | 326                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat20   | Sixth | R20  | W21        | Studio   | 100               | 47%                      | 96                 | 1.5                    | 0.0               |              |
|               | Flat21   | Sixth | R21  | W22        | Studio   | 100               | 41%                      | 87                 | 1.5                    | 0.0               |              |
|               | Flat22   | Sixth | R22  | W23        | Studio   | 100               | 30%                      | 72                 | 1.5                    | 0.0               |              |
|               | Flat23   | Sixth | R23  | W24        | Studio   | 100               | 27%                      | 71                 | 1.5                    | 0.2               |              |
|               | Flat24   | Sixth | R24  | W25        | Studio   | 100               | 33%                      | 75                 | 1.5                    | 0.6               |              |
|               | Flat25   | Sixth | R25  | W26        | Studio   | 100               | 33%                      | 79                 | 1.5                    | 0.8               |              |
|               | Flat26   | Sixth | R26  | W27        | Studio   | 100               | 100%                     | 209                | 1.5                    | 0.8               | N/F          |

| Building Name | Unit No. | Floor | Room | Window | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|--------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |        |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |        |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               | Flat27   | Sixth | R27  | W28    | Studio   | 100               | 78%                      | 119                | 1.5                    | 0.6               | N/F          |
|               | Flat28   | Sixth | R28  | W29    | Studio   | 100               | 39%                      | 76                 | 1.5                    | 1.7               |              |
|               | Flat29   | Sixth | R29  | W30    | Studio   | 100               | 29%                      | 72                 | 1.5                    | 1.8               |              |
|               | Flat30   | Sixth | R30  | W31    | Studio   | 100               | 22%                      | 58                 | 1.5                    | 2.1               |              |
|               | Flat31   | Sixth | R31  | W32    | Studio   | 100               | 43%                      | 86                 | 1.5                    | 2.7               |              |
|               | Flat32   | Sixth | R32  | W33    | Studio   | 100               | 50%                      | 98                 | 1.5                    | 2.6               |              |
|               | Flat33   | Sixth | R33  | W34    | Studio   | 100               | 49%                      | 98                 | 1.5                    | 3.5               |              |
|               | Flat34   | Sixth | R34  | W35    | Studio   | 100               | 57%                      | 114                | 1.5                    | 3.0               |              |
|               | Flat35   | Sixth | R35  | W36    | Studio   | 100               | 55%                      | 115                | 1.5                    | 3.9               |              |
|               | Flat36   | Sixth | R36  | W37    | Studio   | 100               | 70%                      | 123                | 1.5                    | 3.1               |              |
|               | Flat37   | Sixth | R37  | W38    | Studio   | 100               | 61%                      | 120                | 1.5                    | 3.9               |              |
|               | Flat38   | Sixth | R38  | W39    | Studio   | 100               | 75%                      | 136                | 1.5                    | 3.1               |              |
|               | Flat39   | Sixth | R39  | W40    | Studio   | 100               | 66%                      | 133                | 1.5                    | 4.0               |              |
|               | Flat40   | Sixth | R40  | W41    | Studio   | 100               | 74%                      | 145                | 1.5                    | 3.2               |              |
|               | Flat41   | Sixth | R41  | W42    | Studio   | 100               | 67%                      | 140                | 1.5                    | 4.0               |              |
|               | Flat42   | Sixth | R42  | W43    | Studio   | 100               | 76%                      | 149                | 1.5                    | 3.2               |              |
|               | Flat43   | Sixth | R43  | W44    | Studio   | 100               | 60%                      | 122                | 1.5                    | 2.9               |              |
|               | Flat44   | Sixth | R44  | W45    | Studio   | 100               | 73%                      | 143                | 1.5                    | 3.6               |              |

| Building Name | Unit No. | Floor   | Room | Window                  | Room Use      | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |                          |
|---------------|----------|---------|------|-------------------------|---------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------------------|
|               |          |         |      |                         |               | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing             |
|               |          |         |      |                         |               | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)                     |
|               | Flat45   | Sixth   | R45  | W46                     | Studio        | 100               | 70%                      | 146                | 1.5                    | 3.5               |                          |
|               | Flat46   | Sixth   | R46  | W47<br>W48              | Studio        | 100               | 93%                      | 228                | 1.5                    | 3.7               |                          |
|               | Flat47   | Sixth   | R47  | W49<br>W50              | Studio        | 100               | 100%                     | 257                | 1.5                    | 3.7               |                          |
|               | Flat48   | Sixth   | R48  | W51<br>W52              | Studio        | 100               | 100%                     | 416                | 1.5                    | 4.8               | N/F                      |
|               | Flat49   | Sixth   | R49  | W53                     | Studio        | 100               | 100%                     | 336                | 1.5                    | 1.9               | N/F                      |
|               | Flat50   | Sixth   | R50  | W54                     | Studio        | 100               | 100%                     | 326                | 1.5                    | 1.9               | N/F                      |
|               | Flat51   | Sixth   | R51  | W55                     | Studio        | 100               | 100%                     | 338                | 1.5                    | 1.9               | N/F                      |
|               | Flat52   | Sixth   | R52  | W56                     | Studio        | 100               | 100%                     | 328                | 1.5                    | 1.9               | N/F                      |
|               | Flat53   | Sixth   | R53  | W57<br>W58              | Studio        | 100               | 100%                     | 445                | 1.5                    | 1.9               | N/F<br>N/F               |
|               | Flat54   | Sixth   | R54  | W59<br>W60              | Studio        | 100               | 100%                     | 315                | 1.5                    | 0.0               | N/F<br>N/F               |
|               | Flat55   | Sixth   | R55  | W61<br>W62              | Studio        | 100               | 100%                     | 382                | 1.5                    | 0.0               | N/F<br>N/F               |
|               | Flat56   | Sixth   | R56  | W63                     | Studio        | 100               | 97%                      | 208                | 1.5                    | 0.0               | N/F                      |
|               | Flat57   | Sixth   | R57  | W64                     | Studio        | 100               | 99%                      | 207                | 1.5                    | 0.0               | N/F                      |
|               |          | Seventh | R7   | W9<br>W10<br>W11<br>W12 | Communal Area | 150               | 100%                     | 540                | 1.5                    | 1.7               | N/F<br>N/F<br>N/F<br>N/F |

| Building Name | Unit No. | Floor   | Room | Window                                        | Room Use      | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|---------|------|-----------------------------------------------|---------------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |         |      |                                               |               | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |         |      |                                               |               | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |         |      | W13<br>W14<br>W15<br>W16                      |               |                   |                          |                    |                        |                   | N/F<br>N/F   |
|               |          |         | R8   | W17<br>W18<br>W19<br>W20<br>W21<br>W22<br>W23 | Communal Area | 150               | 100%                     | 445                | 1.5                    | 5.8               |              |
|               | Flat1    | Seventh | R1   | W1<br>W2                                      | Studio        | 100               | 100%                     | 659                | 1.5                    | 4.8               | N/F          |
|               | Flat2    | Seventh | R2   | W3                                            | Studio        | 100               | 100%                     | 508                | 1.5                    | 1.9               | N/F          |
|               | Flat3    | Seventh | R3   | W4                                            | Studio        | 100               | 100%                     | 496                | 1.5                    | 1.9               | N/F          |
|               | Flat4    | Seventh | R4   | W5                                            | Studio        | 100               | 100%                     | 515                | 1.5                    | 1.9               | N/F          |
|               | Flat5    | Seventh | R5   | W6                                            | Studio        | 100               | 100%                     | 497                | 1.5                    | 1.9               | N/F          |
|               | Flat6    | Seventh | R6   | W7<br>W8                                      | Studio        | 100               | 100%                     | 688                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Eighth  | R1   | W1<br>W2                                      | Studio        | 100               | 100%                     | 390                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Eighth  | R2   | W3<br>W4                                      | Studio        | 100               | 100%                     | 445                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Eighth  | R3   | W5                                            | Studio        | 100               | 100%                     | 256                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Eighth  | R4   | W6                                            | Studio        | 100               | 100%                     | 397                | 1.5                    | 1.2               | N/F          |

| Building Name | Unit No. | Floor  | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|--------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |        |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |        |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |        |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Eighth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 291                | 1.5                    | 4.4               |              |
|               | Flat6    | Eighth | R6   | W10        | Studio   | 100               | 83%                      | 164                | 1.5                    | 3.9               |              |
|               | Flat7    | Eighth | R7   | W11<br>W12 | Studio   | 100               | 98%                      | 254                | 1.5                    | 4.4               |              |
|               | Flat8    | Eighth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 279                | 1.5                    | 4.2               |              |
|               | Flat9    | Eighth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 451                | 1.5                    | 4.7               | N/F          |
|               | Flat10   | Eighth | R10  | W17        | Studio   | 100               | 100%                     | 347                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Eighth | R11  | W18        | Studio   | 100               | 100%                     | 334                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Eighth | R12  | W19        | Studio   | 100               | 100%                     | 348                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Eighth | R13  | W20        | Studio   | 100               | 100%                     | 336                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Eighth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 474                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Ninth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 405                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Ninth  | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 454                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Ninth  | R3   | W5         | Studio   | 100               | 100%                     | 268                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Ninth  | R4   | W6         | Studio   | 100               | 100%                     | 413                | 1.5                    | 1.3               | N/F          |

| Building Name | Unit No. | Floor | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |       |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |       |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |       |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Ninth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 296                | 1.5                    | 4.4               |              |
|               | Flat6    | Ninth | R6   | W10        | Studio   | 100               | 86%                      | 171                | 1.5                    | 3.9               |              |
|               | Flat7    | Ninth | R7   | W11<br>W12 | Studio   | 100               | 99%                      | 262                | 1.5                    | 4.4               |              |
|               | Flat8    | Ninth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 285                | 1.5                    | 4.4               |              |
|               | Flat9    | Ninth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 463                | 1.5                    | 5.0               | N/F          |
|               | Flat10   | Ninth | R10  | W17        | Studio   | 100               | 100%                     | 349                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Ninth | R11  | W18        | Studio   | 100               | 100%                     | 338                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Ninth | R12  | W19        | Studio   | 100               | 100%                     | 351                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Ninth | R13  | W20        | Studio   | 100               | 100%                     | 341                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Ninth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 487                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Tenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 413                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Tenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 465                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Tenth | R3   | W5         | Studio   | 100               | 100%                     | 270                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Tenth | R4   | W6         | Studio   | 100               | 100%                     | 424                | 1.5                    | 1.6               | N/F          |

| Building Name | Unit No. | Floor    | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |          |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |          |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |          |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Tenth    | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 309                | 1.5                    | 4.8               |              |
|               | Flat6    | Tenth    | R6   | W10        | Studio   | 100               | 92%                      | 179                | 1.5                    | 4.3               |              |
|               | Flat7    | Tenth    | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 273                | 1.5                    | 5.0               |              |
|               | Flat8    | Tenth    | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 292                | 1.5                    | 5.0               |              |
|               | Flat9    | Tenth    | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 470                | 1.5                    | 5.9               | N/F          |
|               | Flat10   | Tenth    | R10  | W17        | Studio   | 100               | 100%                     | 356                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Tenth    | R11  | W18        | Studio   | 100               | 100%                     | 344                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Tenth    | R12  | W19        | Studio   | 100               | 100%                     | 354                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Tenth    | R13  | W20        | Studio   | 100               | 100%                     | 344                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Tenth    | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 493                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Eleventh | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 416                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Eleventh | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 470                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Eleventh | R3   | W5         | Studio   | 100               | 100%                     | 273                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Eleventh | R4   | W6         | Studio   | 100               | 100%                     | 432                | 1.5                    | 1.8               | N/F          |

| Building Name | Unit No. | Floor    | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |          |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |          |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |          |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Eleventh | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 321                | 1.5                    | 5.6               |              |
|               | Flat6    | Eleventh | R6   | W10        | Studio   | 100               | 94%                      | 183                | 1.5                    | 5.0               |              |
|               | Flat7    | Eleventh | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 280                | 1.5                    | 5.8               |              |
|               | Flat8    | Eleventh | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 301                | 1.5                    | 5.7               |              |
|               | Flat9    | Eleventh | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 476                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Eleventh | R10  | W17        | Studio   | 100               | 100%                     | 359                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Eleventh | R11  | W18        | Studio   | 100               | 100%                     | 349                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Eleventh | R12  | W19        | Studio   | 100               | 100%                     | 358                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Eleventh | R13  | W20        | Studio   | 100               | 100%                     | 351                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Eleventh | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 499                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Twelfth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 420                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Twelfth  | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 471                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Twelfth  | R3   | W5         | Studio   | 100               | 100%                     | 274                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Twelfth  | R4   | W6         | Studio   | 100               | 100%                     | 439                | 1.5                    | 2.0               | N/F          |

| Building Name | Unit No. | Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |            |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Twelfth    | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 332                | 1.5                    | 6.6               |              |
|               | Flat6    | Twelfth    | R6   | W10        | Studio   | 100               | 98%                      | 188                | 1.5                    | 5.6               |              |
|               | Flat7    | Twelfth    | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 289                | 1.5                    | 6.2               |              |
|               | Flat8    | Twelfth    | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 306                | 1.5                    | 5.9               |              |
|               | Flat9    | Twelfth    | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 484                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Twelfth    | R10  | W17        | Studio   | 100               | 100%                     | 363                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Twelfth    | R11  | W18        | Studio   | 100               | 100%                     | 355                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Twelfth    | R12  | W19        | Studio   | 100               | 100%                     | 364                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Twelfth    | R13  | W20        | Studio   | 100               | 100%                     | 356                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Twelfth    | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 504                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Thirteenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 420                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Thirteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 469                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Thirteenth | R3   | W5         | Studio   | 100               | 100%                     | 274                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Thirteenth | R4   | W6         | Studio   | 100               | 100%                     | 449                | 1.5                    | 2.3               | N/F          |

| Building Name | Unit No. | Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |            |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Thirteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 346                | 1.5                    | 7.1               |              |
|               | Flat6    | Thirteenth | R6   | W10        | Studio   | 100               | 100%                     | 195                | 1.5                    | 5.7               |              |
|               | Flat7    | Thirteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 303                | 1.5                    | 6.2               |              |
|               | Flat8    | Thirteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 324                | 1.5                    | 5.9               |              |
|               | Flat9    | Thirteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 490                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Thirteenth | R10  | W17        | Studio   | 100               | 100%                     | 366                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Thirteenth | R11  | W18        | Studio   | 100               | 100%                     | 360                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Thirteenth | R12  | W19        | Studio   | 100               | 100%                     | 365                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Thirteenth | R13  | W20        | Studio   | 100               | 100%                     | 361                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Thirteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 507                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Fourteenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 420                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Fourteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 472                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Fourteenth | R3   | W5         | Studio   | 100               | 100%                     | 275                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Fourteenth | R4   | W6         | Studio   | 100               | 100%                     | 453                | 1.5                    | 2.7               | N/F          |

| Building Name | Unit No. | Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |            |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Fourteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 363                | 1.5                    | 7.3               |              |
|               | Flat6    | Fourteenth | R6   | W10        | Studio   | 100               | 100%                     | 200                | 1.5                    | 5.7               |              |
|               | Flat7    | Fourteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 319                | 1.5                    | 6.3               |              |
|               | Flat8    | Fourteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 340                | 1.5                    | 5.9               |              |
|               | Flat9    | Fourteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 502                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Fourteenth | R10  | W17        | Studio   | 100               | 100%                     | 370                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Fourteenth | R11  | W18        | Studio   | 100               | 100%                     | 365                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Fourteenth | R12  | W19        | Studio   | 100               | 100%                     | 370                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Fourteenth | R13  | W20        | Studio   | 100               | 100%                     | 365                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Fourteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 511                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Fifteenth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 421                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Fifteenth  | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 471                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Fifteenth  | R3   | W5         | Studio   | 100               | 100%                     | 274                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Fifteenth  | R4   | W6         | Studio   | 100               | 100%                     | 463                | 1.5                    | 3.1               | N/F          |

| Building Name | Unit No. | Floor     | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |           |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |           |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |           |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Fifteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 381                | 1.5                    | 7.5               |              |
|               | Flat6    | Fifteenth | R6   | W10        | Studio   | 100               | 100%                     | 208                | 1.5                    | 5.7               |              |
|               | Flat7    | Fifteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 330                | 1.5                    | 6.3               |              |
|               | Flat8    | Fifteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 354                | 1.5                    | 5.9               |              |
|               | Flat9    | Fifteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 513                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Fifteenth | R10  | W17        | Studio   | 100               | 100%                     | 373                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Fifteenth | R11  | W18        | Studio   | 100               | 100%                     | 369                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Fifteenth | R12  | W19        | Studio   | 100               | 100%                     | 373                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Fifteenth | R13  | W20        | Studio   | 100               | 100%                     | 369                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Fifteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 515                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Sixteenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 418                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Sixteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 471                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Sixteenth | R3   | W5         | Studio   | 100               | 100%                     | 273                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Sixteenth | R4   | W6         | Studio   | 100               | 100%                     | 468                | 1.5                    | 3.2               | N/F          |

| Building Name | Unit No. | Floor       | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |             |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |             |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |             |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Sixteenth   | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 393                | 1.5                    | 7.6               |              |
|               | Flat6    | Sixteenth   | R6   | W10        | Studio   | 100               | 100%                     | 223                | 1.5                    | 5.7               |              |
|               | Flat7    | Sixteenth   | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 345                | 1.5                    | 6.3               |              |
|               | Flat8    | Sixteenth   | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 367                | 1.5                    | 5.9               |              |
|               | Flat9    | Sixteenth   | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 521                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Sixteenth   | R10  | W17        | Studio   | 100               | 100%                     | 375                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Sixteenth   | R11  | W18        | Studio   | 100               | 100%                     | 373                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Sixteenth   | R12  | W19        | Studio   | 100               | 100%                     | 375                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Sixteenth   | R13  | W20        | Studio   | 100               | 100%                     | 372                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Sixteenth   | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 517                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Seventeenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 418                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Seventeenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 468                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Seventeenth | R3   | W5         | Studio   | 100               | 100%                     | 274                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Seventeenth | R4   | W6         | Studio   | 100               | 100%                     | 473                | 1.5                    | 3.2               | N/F          |

| Building Name | Unit No. | Floor       | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |             |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |             |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |             |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Seventeenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 407                | 1.5                    | 7.7               |              |
|               | Flat6    | Seventeenth | R6   | W10        | Studio   | 100               | 100%                     | 240                | 1.5                    | 5.7               |              |
|               | Flat7    | Seventeenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 364                | 1.5                    | 6.3               |              |
|               | Flat8    | Seventeenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 382                | 1.5                    | 5.9               |              |
|               | Flat9    | Seventeenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 527                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Seventeenth | R10  | W17        | Studio   | 100               | 100%                     | 377                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Seventeenth | R11  | W18        | Studio   | 100               | 100%                     | 374                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Seventeenth | R12  | W19        | Studio   | 100               | 100%                     | 376                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Seventeenth | R13  | W20        | Studio   | 100               | 100%                     | 375                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Seventeenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 517                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Eighteenth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 419                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Eighteenth  | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 469                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Eighteenth  | R3   | W5         | Studio   | 100               | 100%                     | 273                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Eighteenth  | R4   | W6         | Studio   | 100               | 100%                     | 475                | 1.5                    | 3.2               | N/F          |

| Building Name | Unit No. | Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |            |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Eighteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 421                | 1.5                    | 8.1               |              |
|               | Flat6    | Eighteenth | R6   | W10        | Studio   | 100               | 100%                     | 259                | 1.5                    | 5.7               |              |
|               | Flat7    | Eighteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 374                | 1.5                    | 6.3               |              |
|               | Flat8    | Eighteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 395                | 1.5                    | 5.9               |              |
|               | Flat9    | Eighteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 535                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Eighteenth | R10  | W17        | Studio   | 100               | 100%                     | 377                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Eighteenth | R11  | W18        | Studio   | 100               | 100%                     | 372                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Eighteenth | R12  | W19        | Studio   | 100               | 100%                     | 376                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Eighteenth | R13  | W20        | Studio   | 100               | 100%                     | 375                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Eighteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 517                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Nineteenth | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 420                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Nineteenth | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 469                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Nineteenth | R3   | W5         | Studio   | 100               | 100%                     | 273                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Nineteenth | R4   | W6         | Studio   | 100               | 100%                     | 478                | 1.5                    | 3.2               | N/F          |

| Building Name | Unit No. | Floor      | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|------------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |            |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |            |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |            |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Nineteenth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 443                | 1.5                    | 8.1               |              |
|               | Flat6    | Nineteenth | R6   | W10        | Studio   | 100               | 100%                     | 266                | 1.5                    | 5.7               |              |
|               | Flat7    | Nineteenth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 384                | 1.5                    | 6.3               |              |
|               | Flat8    | Nineteenth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 415                | 1.5                    | 5.9               |              |
|               | Flat9    | Nineteenth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 544                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Nineteenth | R10  | W17        | Studio   | 100               | 100%                     | 378                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Nineteenth | R11  | W18        | Studio   | 100               | 100%                     | 373                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Nineteenth | R12  | W19        | Studio   | 100               | 100%                     | 377                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Nineteenth | R13  | W20        | Studio   | 100               | 100%                     | 376                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Nineteenth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 518                | 1.5                    | 1.9               | N/F<br>N/F   |
|               | Flat1    | Twentieth  | R1   | W1<br>W2   | Studio   | 100               | 100%                     | 419                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat2    | Twentieth  | R2   | W3<br>W4   | Studio   | 100               | 100%                     | 468                | 1.5                    | 0.0               | N/F<br>N/F   |
|               | Flat3    | Twentieth  | R3   | W5         | Studio   | 100               | 100%                     | 272                | 1.5                    | 0.0               | N/F          |
|               | Flat4    | Twentieth  | R4   | W6         | Studio   | 100               | 100%                     | 483                | 1.5                    | 3.2               | N/F          |

| Building Name | Unit No. | Floor     | Room | Window     | Room Use | Illuminance (SDA) |                          |                    | Sunlight Exposure (SE) |                   |              |
|---------------|----------|-----------|------|------------|----------|-------------------|--------------------------|--------------------|------------------------|-------------------|--------------|
|               |          |           |      |            |          | Target Lux        | % of Room meeting target | Median Lux of Room | Target                 | Sunlight Exposure | North Facing |
|               |          |           |      |            |          | (Lux)             | (%)                      | (Lux)              | (Hrs)                  | (Hrs)             | (NF)         |
|               |          |           |      | W7         |          |                   |                          |                    |                        |                   |              |
|               | Flat5    | Twentieth | R5   | W8<br>W9   | Studio   | 100               | 100%                     | 468                | 1.5                    | 8.1               |              |
|               | Flat6    | Twentieth | R6   | W10        | Studio   | 100               | 100%                     | 275                | 1.5                    | 5.7               |              |
|               | Flat7    | Twentieth | R7   | W11<br>W12 | Studio   | 100               | 100%                     | 403                | 1.5                    | 6.3               |              |
|               | Flat8    | Twentieth | R8   | W13<br>W14 | Studio   | 100               | 100%                     | 431                | 1.5                    | 5.9               |              |
|               | Flat9    | Twentieth | R9   | W15<br>W16 | Studio   | 100               | 100%                     | 552                | 1.5                    | 6.5               | N/F          |
|               | Flat10   | Twentieth | R10  | W17        | Studio   | 100               | 100%                     | 379                | 1.5                    | 1.9               | N/F          |
|               | Flat11   | Twentieth | R11  | W18        | Studio   | 100               | 100%                     | 376                | 1.5                    | 1.9               | N/F          |
|               | Flat12   | Twentieth | R12  | W19        | Studio   | 100               | 100%                     | 379                | 1.5                    | 1.9               | N/F          |
|               | Flat13   | Twentieth | R13  | W20        | Studio   | 100               | 100%                     | 377                | 1.5                    | 1.9               | N/F          |
|               | Flat14   | Twentieth | R14  | W21<br>W22 | Studio   | 100               | 100%                     | 520                | 1.5                    | 1.9               | N/F<br>N/F   |



## Appendix 8


Sunlight amenity assessments  
within the proposed amenity spaces

Sources of information


**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
AHCF-DLA-Z1-ZZ-M3-A-00001-BLOCK A\_  
SHARED LIVING\_Design Freeze\_20260713.dwg  
AHCF-DLA-Z2-ZZ-M3-A-00002-BLOCK B\_AF-  
FORDABLE\_Design Freeze\_20260713.dwg  
Received 13/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey

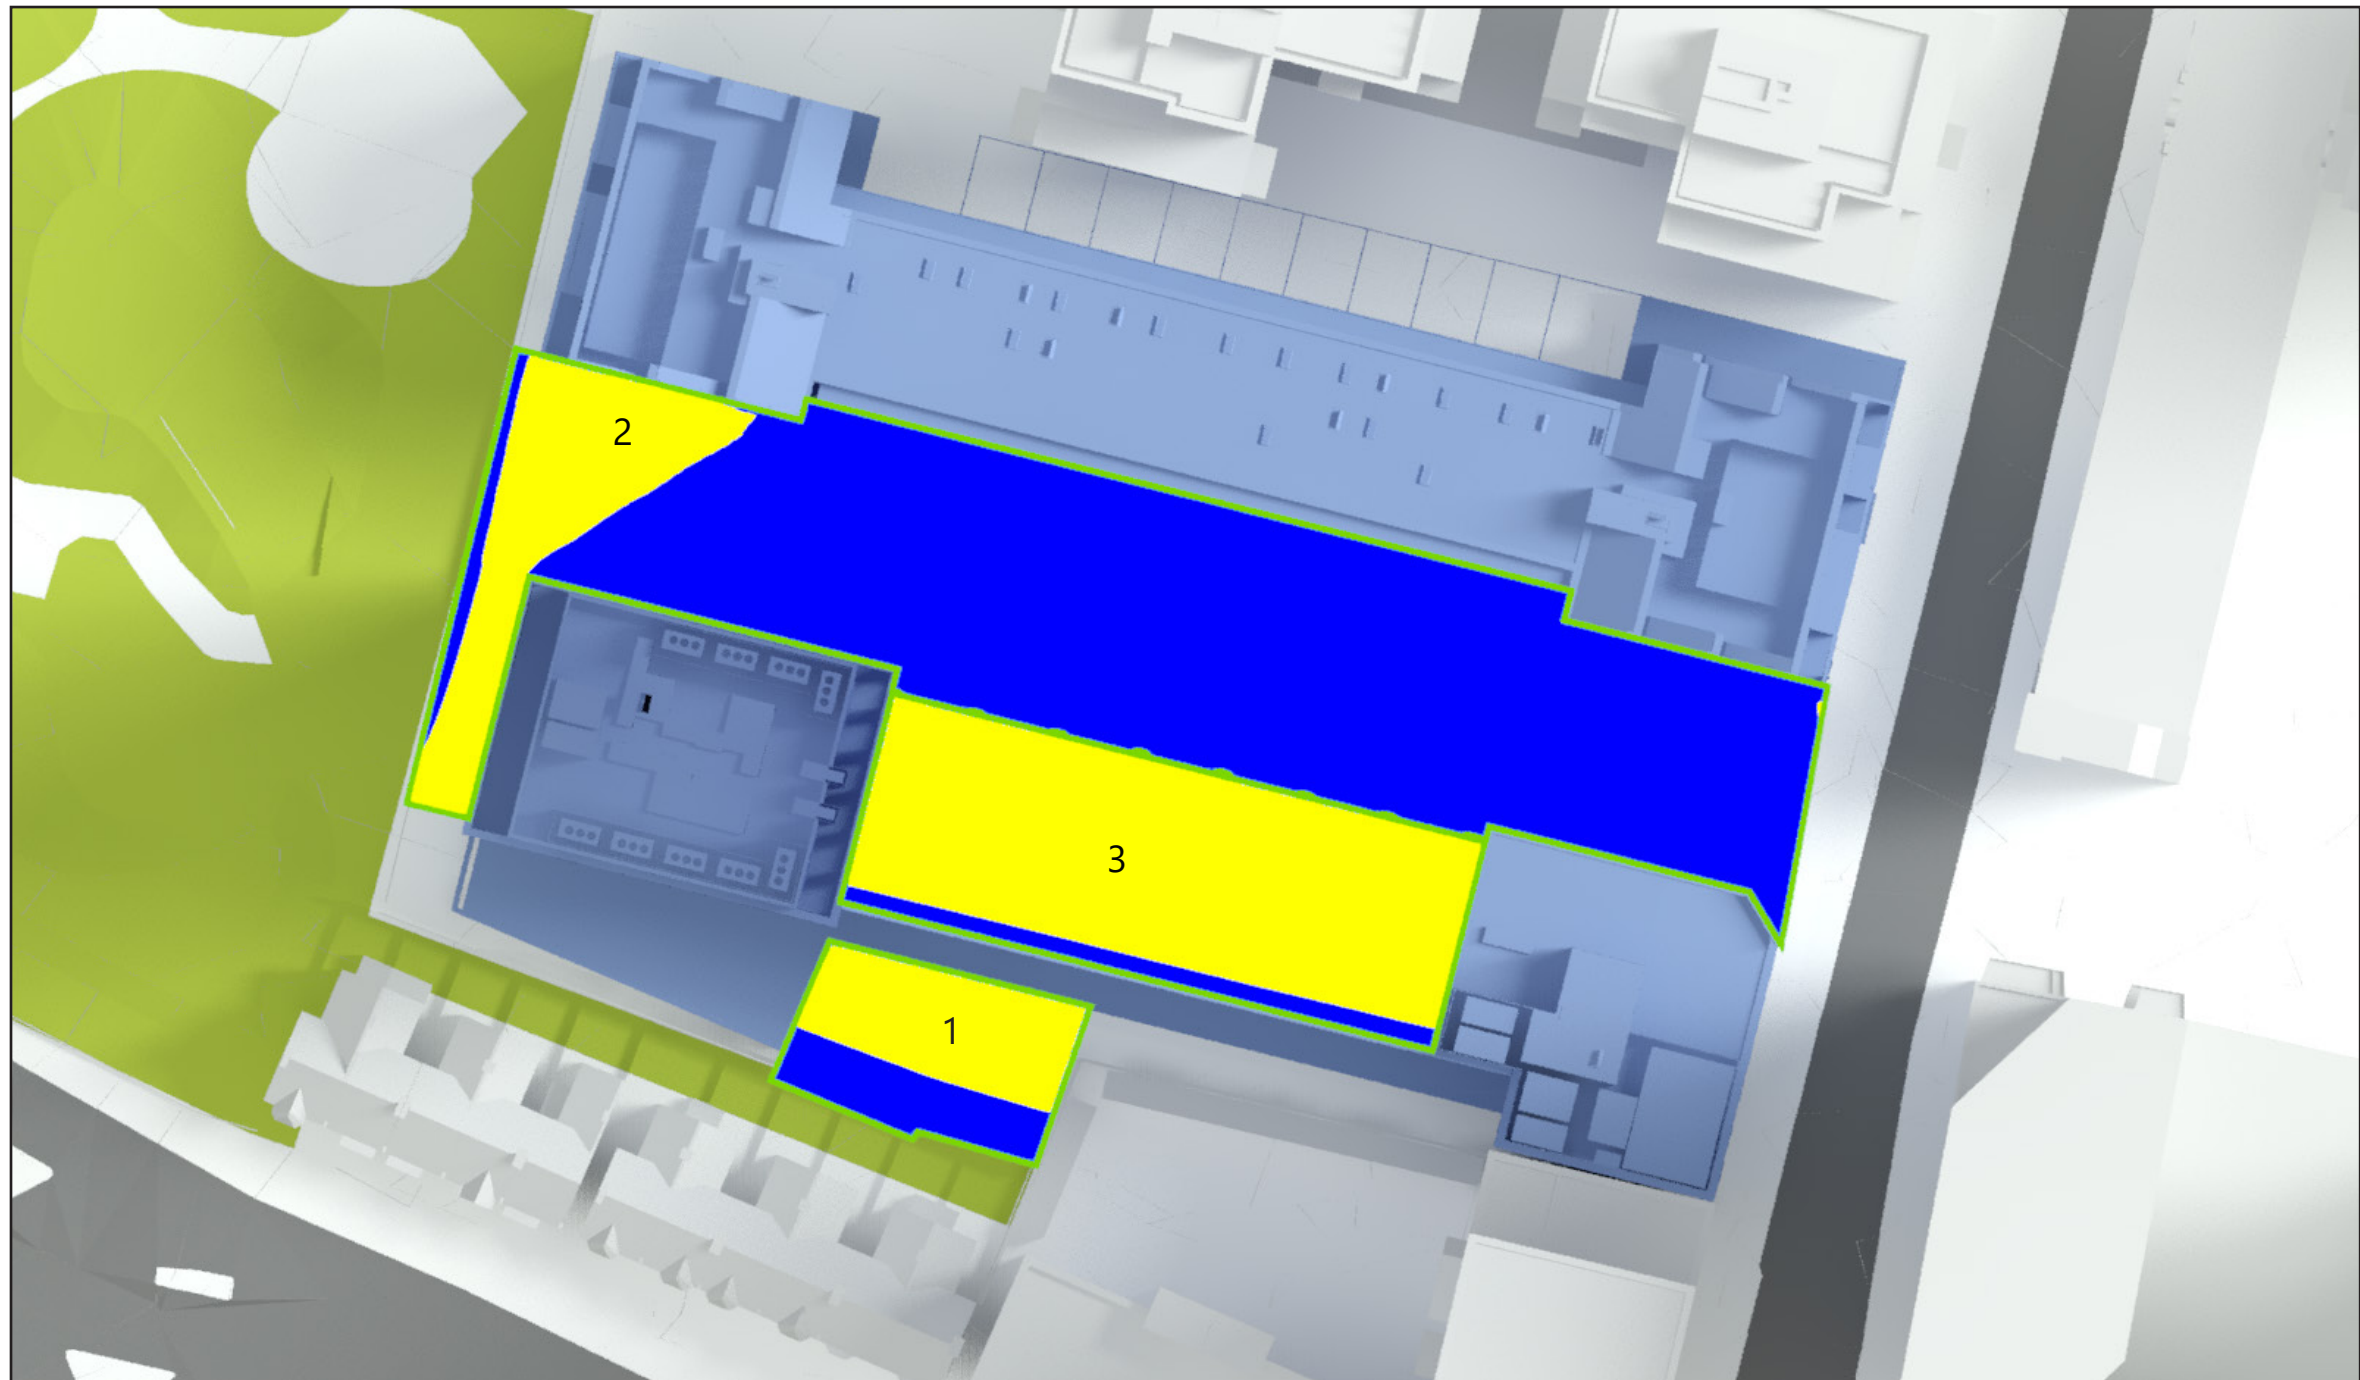

| Area  | Floor   | Total Area<br>(sq.m) | Area recieving more<br>than two hours of sun |    |
|-------|---------|----------------------|----------------------------------------------|----|
|       |         |                      | (m²)                                         | %  |
| 1     | Ground  | 241.91               | 154.91                                       | 64 |
| 2     | Ground  | 1927.36              | 248.82                                       | 13 |
| 3     | Seventh | 728.00               | 670.15                                       | 92 |
| Total |         | 2897.26              | 1073.88                                      | 37 |

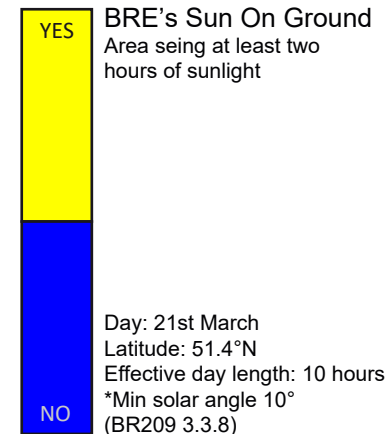

|     |  |                      |
|-----|--|----------------------|
| Key |  | Proposed Development |
|     |  | Area of assessment   |


Project Ashley Road  
Tottenham Hale

Title Sunlight Amenity Study  
Proposed  
21st March

Drawn DC Checked --

Date 11/08/2026 Project 10106

Rel no. 07 Prefix SA01 Page no. 01

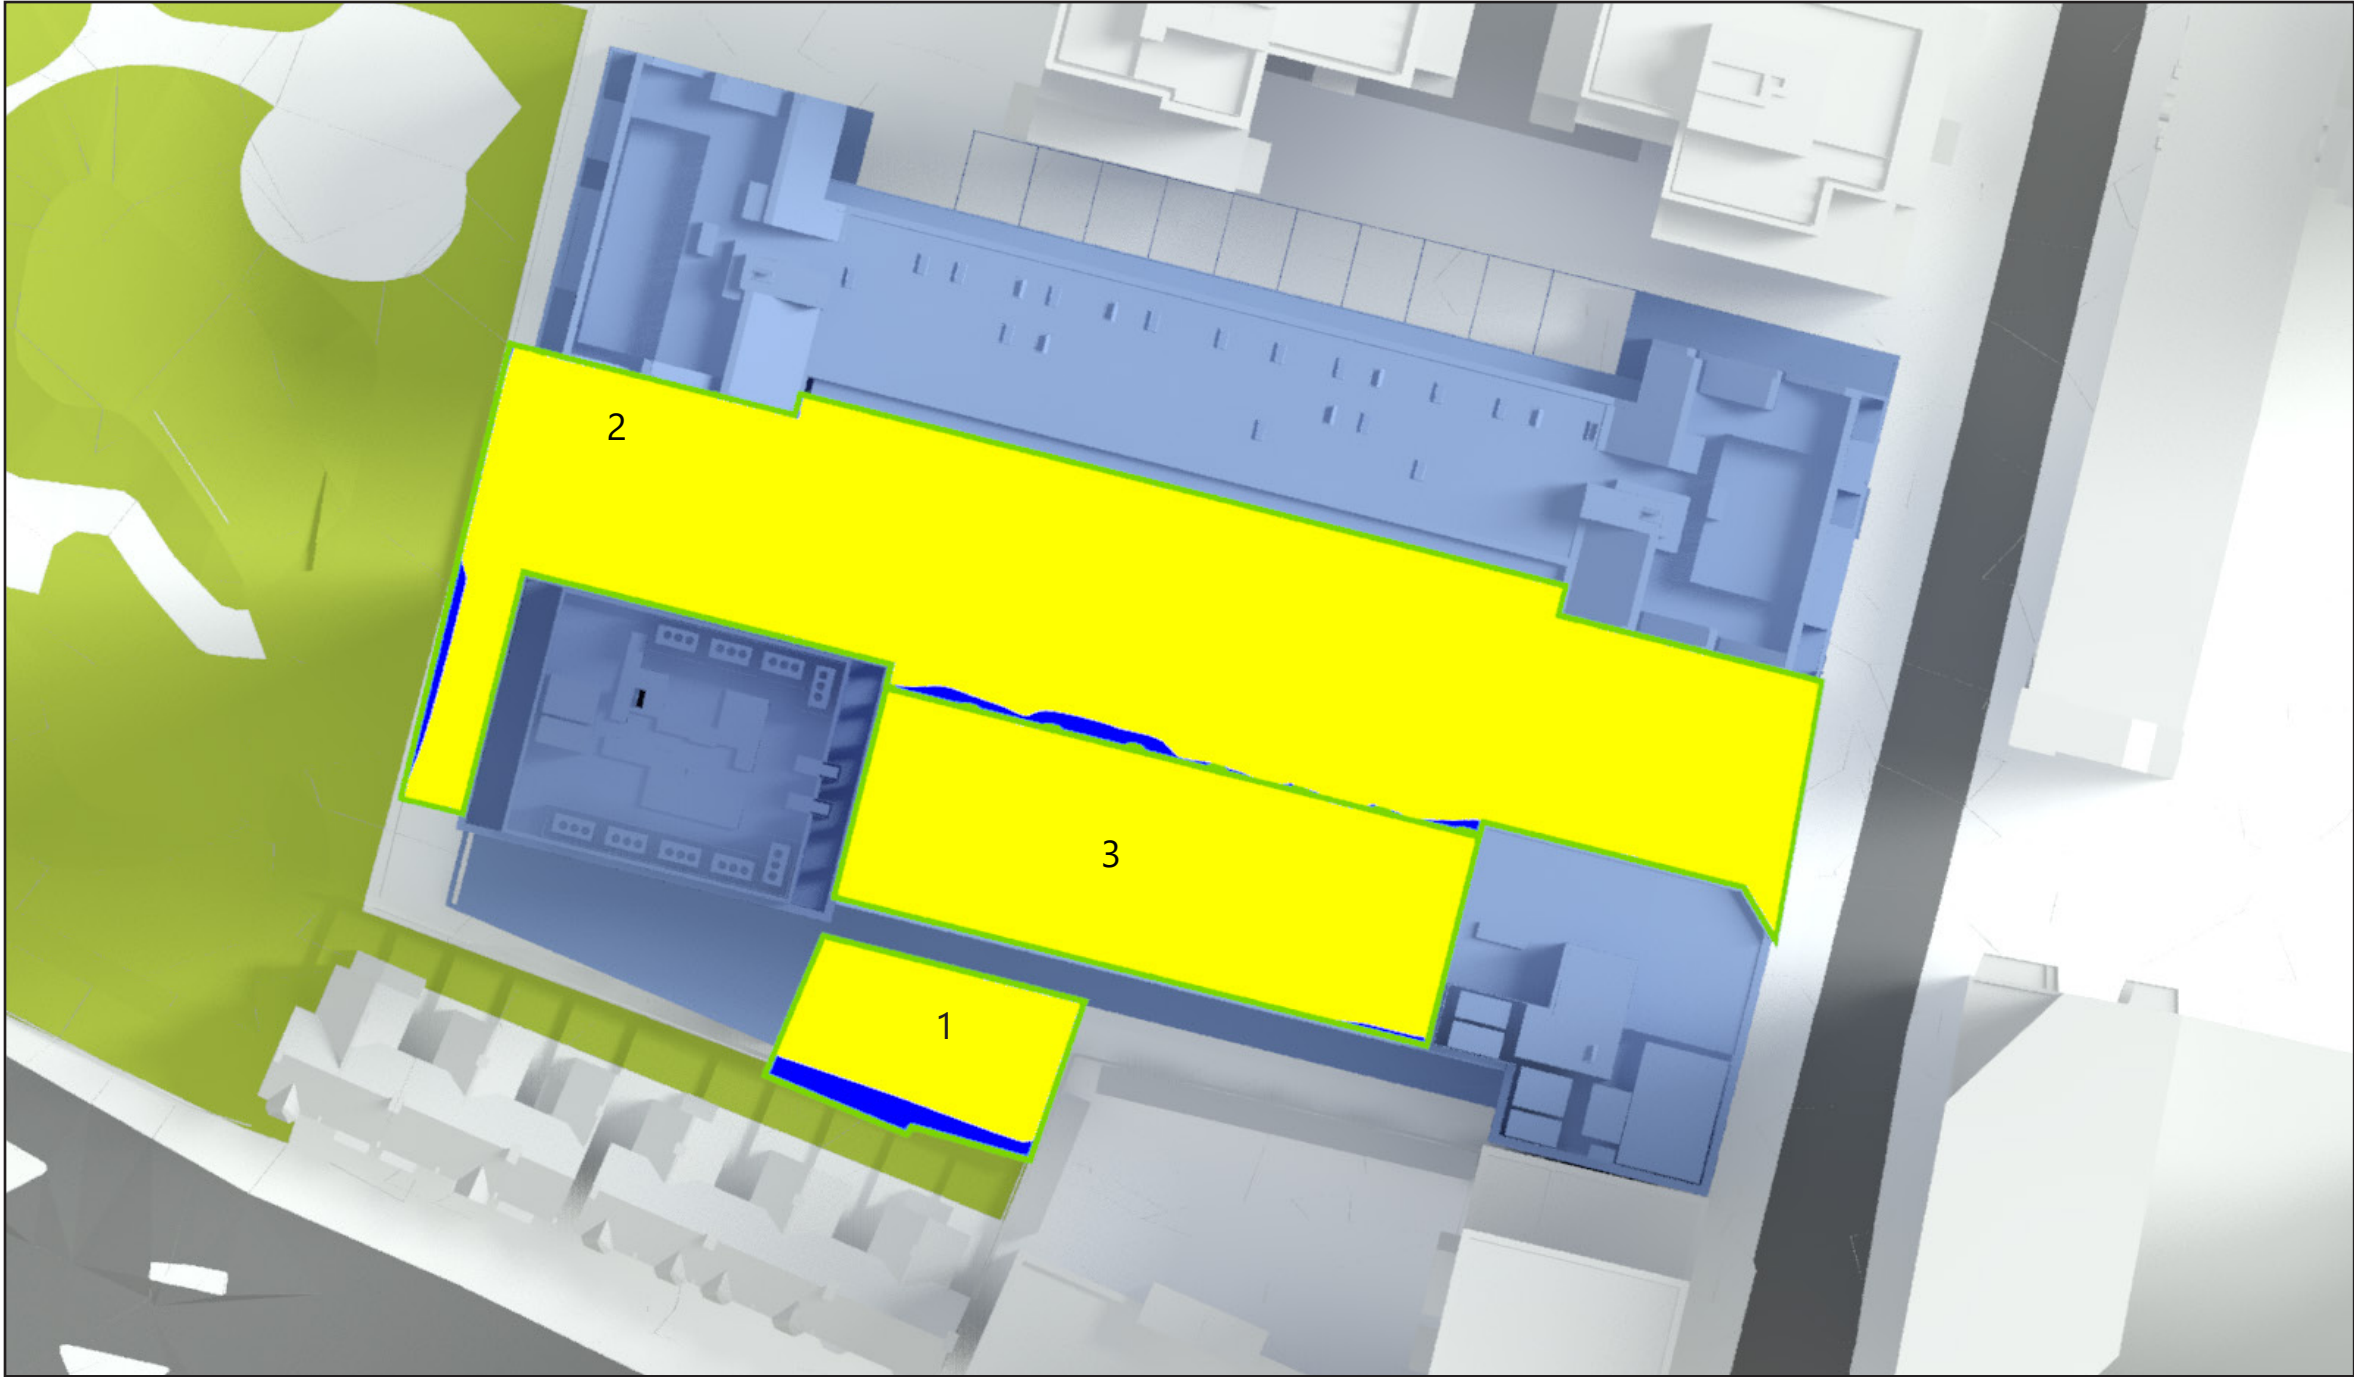

| Area  | Floor   | Total Area (sq.m) | Area recieving more than two hours of sun |     |
|-------|---------|-------------------|-------------------------------------------|-----|
|       |         |                   | (m²)                                      | %   |
| 1     | Ground  | 241.91            | 241.91                                    | 91  |
| 2     | Ground  | 1927.36           | 1894.77                                   | 98  |
| 3     | Seventh | 728.00            | 726.29                                    | 100 |
| Total |         | 2897.26           | 2840.67                                   | 98  |

YES

NO

**BRE's Sun On Ground**  
Area seing at least two hours of sunlight

Sources of information

**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
AHCF-DLA-Z1-ZZ-M3-A-00001-BLOCK A\_  
SHARED LIVING\_Design Freeze\_20260713.dwg  
AHCF-DLA-Z2-ZZ-M3-A-00002-BLOCK B\_AF-  
FORDABLE\_Design Freeze\_20260713.dwg  
Received 13/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey



Key

Proposed Development

Area of assessment



Project Ashley Road  
Tottenham Hale

Title Sunlight Amenity Study  
Proposed  
21st June

Drawn DC Checked --

Date 11/08/2026 Project 10106

Rel no. 07 Prefix SA02 Page no. 01

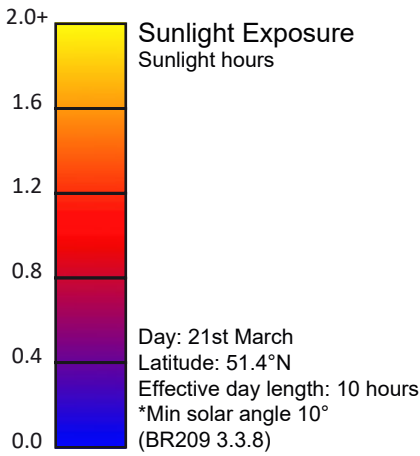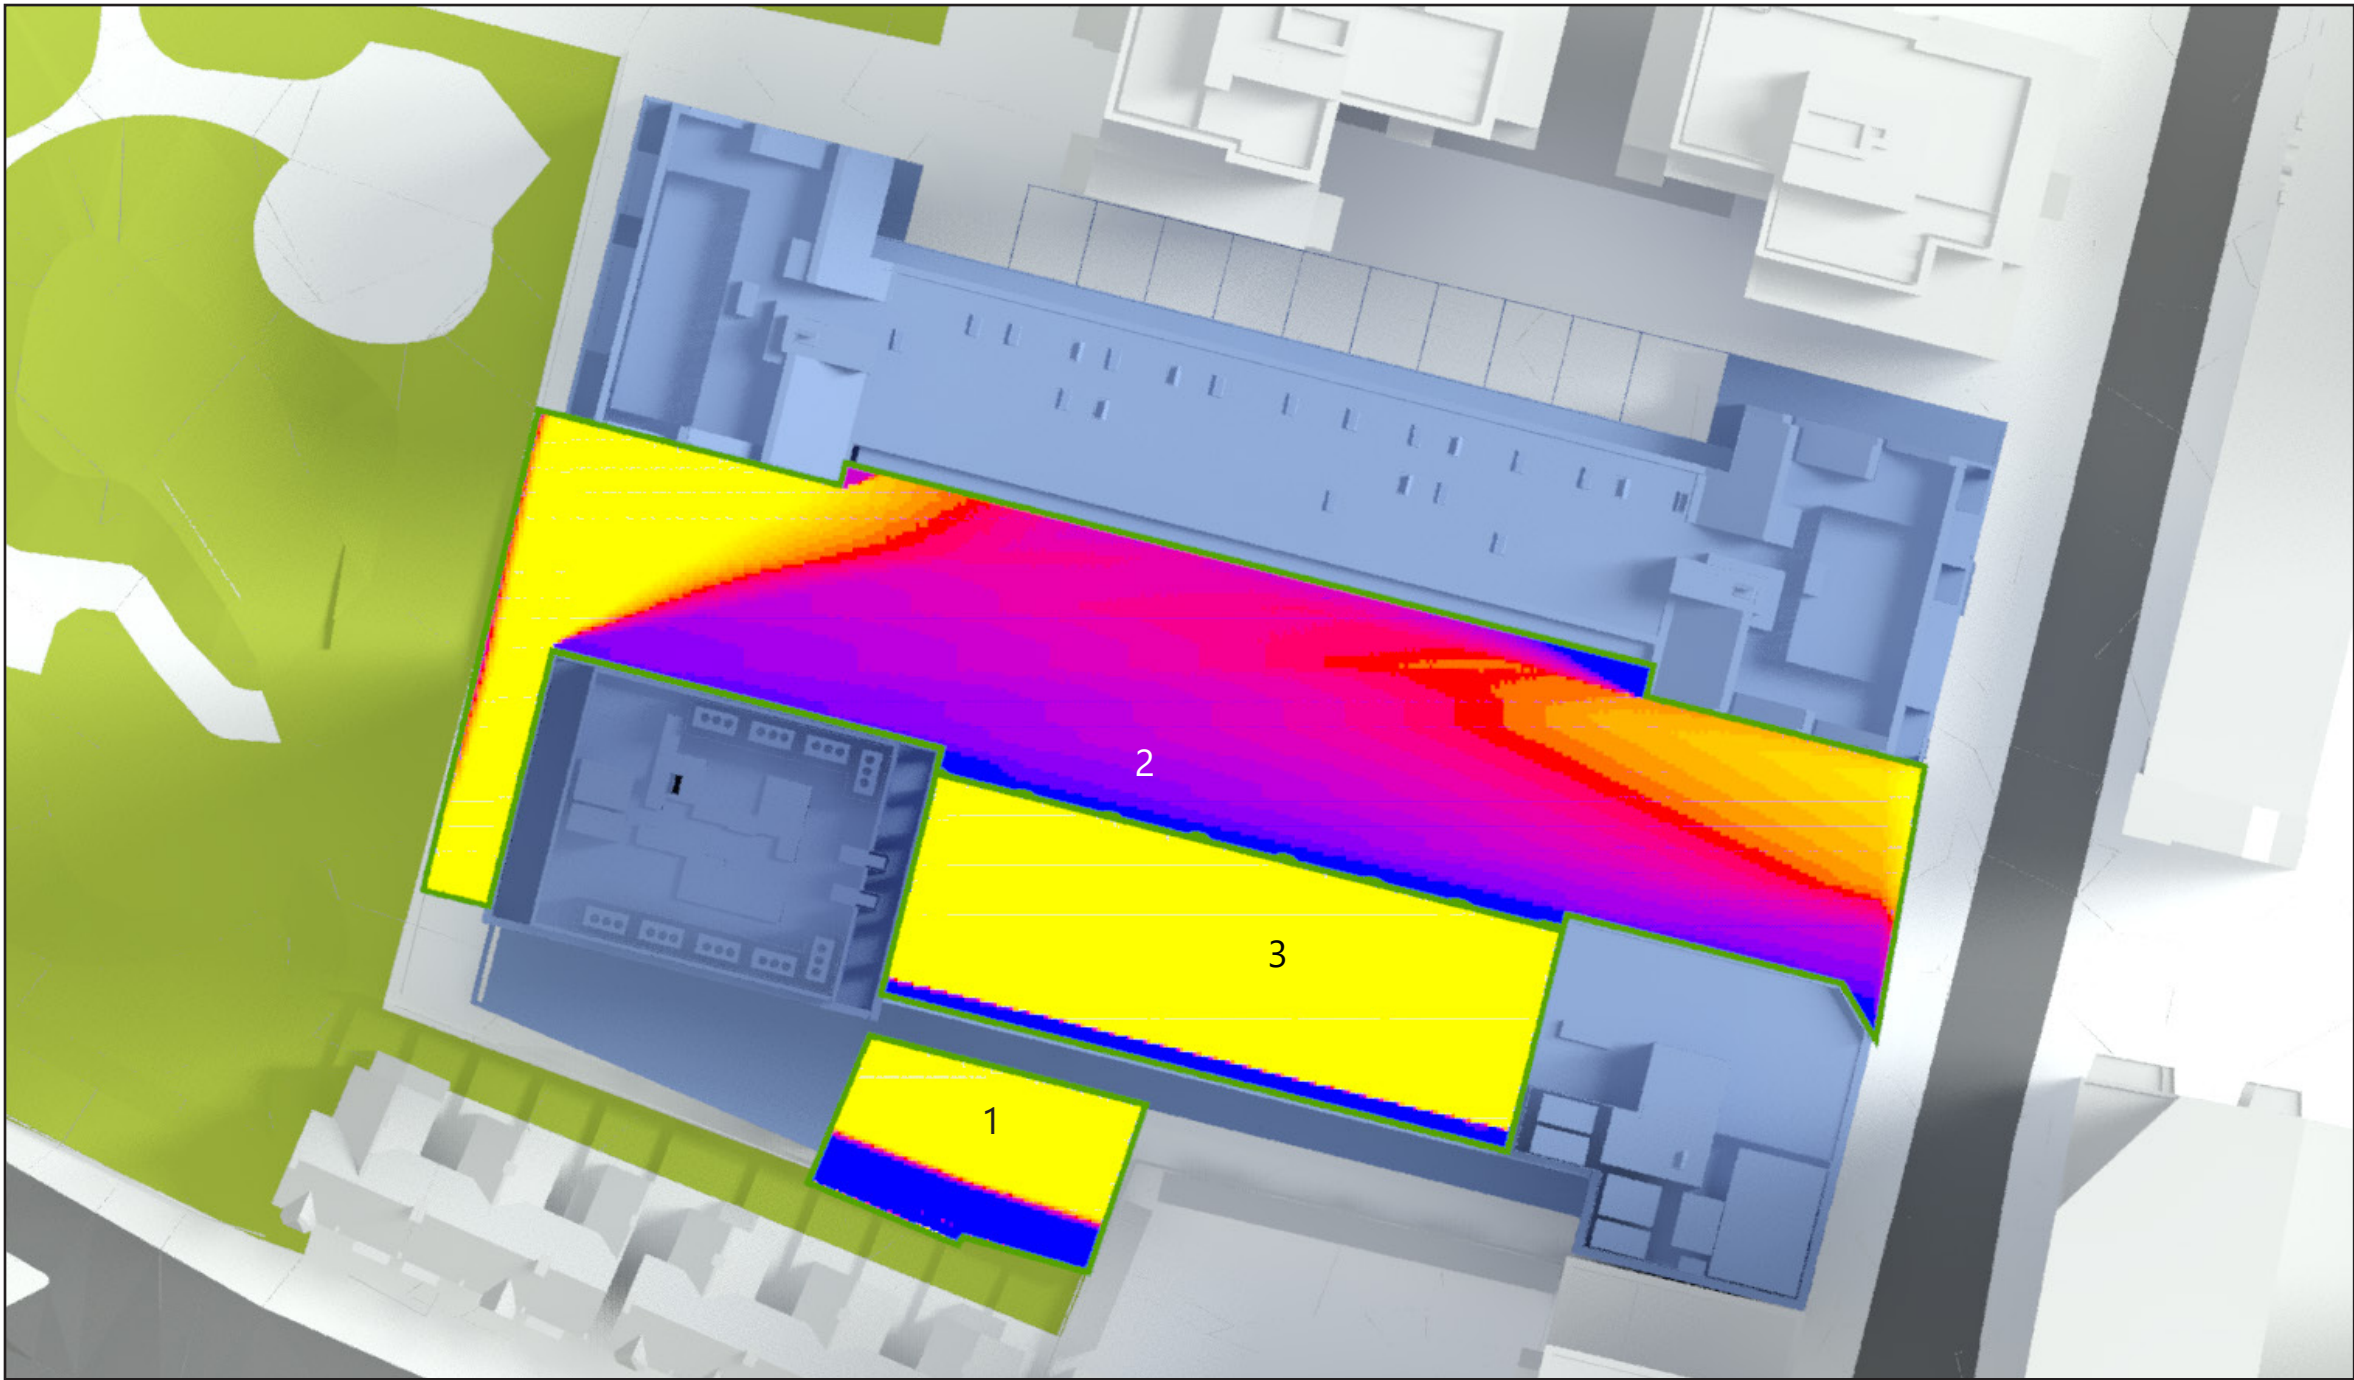

2nd Floor, Chancery  
Exchange, 10 Fumival  
Street, EC4A 1AB  
T: +44(0)20 7148 6290  
E: info@eb7.co.uk  
W: eb7.co.uk



Sources of information

**Cloud 10**  
Ashley Rd\_TH Pt1 15-06-2026  
Received 15/06/2026  
Ashley Rd\_TH Pt2 19-06-2026  
Received 22/06/2026

**DLA**  
AHCF-DLA-Z1-ZZ-M3-A-00001-BLOCK A\_  
SHARED LIVING\_Design Freeze\_20260713.dwg  
AHCF-DLA-Z2-ZZ-M3-A-00002-BLOCK B\_AF-  
FORDABLE\_Design Freeze\_20260713.dwg  
Received 13/07/2026

**EB7 Ltd**  
Site Photographs  
Ordnance Survey



Key

Proposed Development

Area of assessment

Project Ashley Road  
Tottenham Hale

Title Sunlight Amenity Study  
Proposed  
21st March

Drawn DC Checked JG

Date 11/08/2026 Project 10106

Rel no. 07 Prefix SA03 Page no. 01



## Appendix 9

Precedent study of comparable consents  
within the local area

## Site Consent

| Site information                                                                                                                                                                               | Summary of the proposed scheme                                                                                                                                                         | Summary of Daylight & Sunlight to proposed accommodation                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p><u>Address:</u><br/>Ashley House<br/>South, N17 9LJ</p> <p><u>Planning reference:</u><br/>HGY/2019/0108<br/>AP-7456</p> <p><u>Date of approval:</u><br/>10 April 2019<br/>10 March 2020</p> | <p>Demolition of existing buildings and erection of a part 6, part 8 storey building to provide 97 residential units (Class C3), 170 sqm of commercial floorspace (Class A1/A3/B1)</p> |  <ul style="list-style-type: none"> <li>• The consented Ashley Park scheme achieved 102 of 273 habitable rooms (37%) compliant with the BRE 2011 ADF targets under the cumulative future baseline scenario.</li> <li>• Rooms falling below the ADF targets were primarily bedrooms located behind the northern access deck and south-facing living spaces affected by surrounding consented and proposed development.</li> <li>• The assessment concluded that the results reflected the site's constrained urban context and the cumulative effects of the Tottenham Hale regeneration area.</li> <li>• Despite the 37% ADF compliance, the scheme was considered to provide an acceptable standard of residential amenity. The Planning Officer accepted the daylight performance as appropriate for a high-density urban development and planning permission was granted.</li> </ul> |

## Precedent Cases in the London Borough of Haringey

| Site information                                                                                                                                                                                      | Summary of the proposed scheme                                                                                                                                                                                                                                                                                            | Summary of Daylight & Sunlight to proposed accommodation                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <p><u>Address:</u><br/>Strategic Development Partnership (SDP) Sites in Tottenham Hale, N17</p> <p><u>Planning reference:</u><br/>HGY/2018/2223</p> <p><u>Date of approval:</u><br/>27 March 2019</p> | <p>Demolition works and clearance of existing site to provide a mixed-use development comprising 6 buildings up to 38 storeys, comprising residential (Use Class C3) (up to 1,036 units), retail (Use Class A1-A4), health centre (Use Class D1), office (Use Class B1), leisure (Use Class D2), and other amenities.</p> |  <p><u>Ferry Island (Building 2)</u></p> <ul style="list-style-type: none"> <li>The daylight assessment for the consented Tottenham Hale Centre (SDP) scheme identified that 161 of 281 habitable rooms (57%) within the Ferry Island Building 2 achieved the BRE 2011 ADF targets under the cumulative scenario.</li> <li>Rooms falling below the ADF targets were primarily bedrooms and LKDs room affected by the proximity of surrounding consented development within the Tottenham Hale regeneration area.</li> <li>The assessment noted that many of the non-compliant rooms were dual aspect and continued to achieve reasonable daylight levels, with a number of rooms only marginally below the BRE target values.</li> <li>The report concluded that the daylight performance remained acceptable in the context of a high-density urban development and that the cumulative effects of neighbouring schemes did not materially affect the internal daylight performance of the building.</li> <li>The Planning Officer concluded that the scheme would provide high-quality residential accommodation with good levels of daylight and sunlight, and planning permission was granted.</li> </ul> |

Address:  
Brunel Walk,  
London, N15 5HQ

Planning reference:  
HGY/2022/2723

Date of approval:  
04 April 2023

Redevelopment of Brunel Walk to provide 45 new Council rent homes in four buildings ranging from 3 to 4-storeys high including 39 apartments and 6 maisonettes



- The Daylight & Sunlight report prepared in accordance with the BRE 2022 guidance concluded that 83 of 163 assessed rooms (51%) met or exceeded the recommended Daylight Illuminance targets.
- The report stated that this level of compliance was not unusual in an urban location and noted that a number of the non-compliant rooms were affected by balconies provided as private amenity space. The report explained that, while the balconies reduced daylight to some rooms, they delivered important residential amenity benefits and that daylight performance would improve significantly if they were removed.
- The Planning Officer subsequently concluded the following in his report:

*"It concludes that the dwellings achieve a very high level of compliance with the BRE recommendations. Whilst a small number of rooms and outdoor amenity areas do not meet the recommendations, the results are not unusual in the context of an urban location. The proposal would therefore result in an acceptable standard of accommodation for future occupiers in this regard."*



eb7 Ltd  
2nd Floor, Chancery Exchange  
10 Furnival Street London  
EC4A 1AB