




EASTBOUND PLATFORM 1 EXISTING ELEVATION
SCALE 1:50

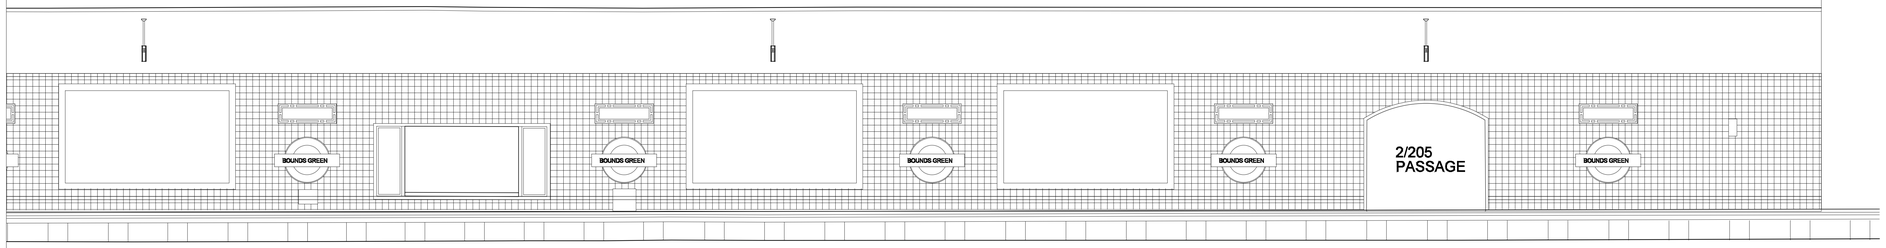

EASTBOUND PLATFORM 1 EXISTING ELEVATION
SCALE 1:50

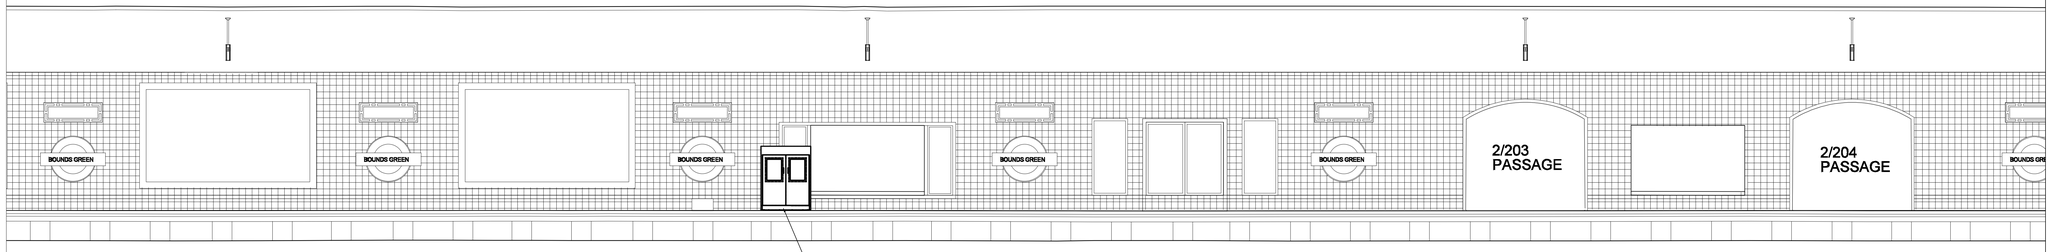


EASTBOUND PLATFORM 1 PROPOSED ELEVATION
SCALE 1:50

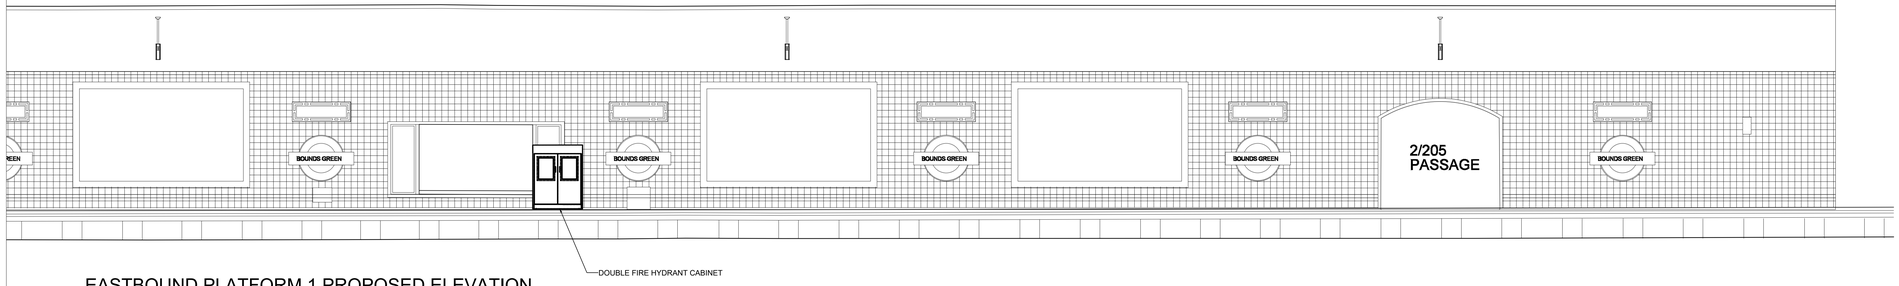



EASTBOUND PLATFORM 1 PROPOSED ELEVATION
SCALE 1:50

SCALE BAR (1:50)



CABINET DETAIL

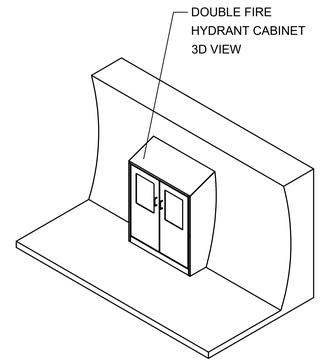



DETAIL 'A' OF DOUBLE FIRE HYDRANT CABINET ELEVATION
SCALE 1:20

DESIGN & MATERIALS SPECIFICATION

All new pipe work to be hydrostatically tested for no less than 2 hrs, to a pressure of no less than 15 bar, or 1,5 times the maximum pressure to which the system will be subjected, (both measured at the installation control valves), whichever the greater.

COPYRIGHT

COPYRIGHT IN THIS DRAWING IS THE PROPERTY OF LB FOSTER SPECIALIST SERVICES LTD. IT MUST NOT BE REPRODUCED, AMENDED OR USED FOR THE EXECUTION OF ANY WORKS WHETHER IN CONNECTION WITH THE PROPOSED WORKS FOR WHICH IT IS PREPARED OR OTHERWISE WITH OUT THE EXPRESS CONSENT IN WRITING FROM LB FOSTER SPECIALIST SERVICES LTD.

This drawing is to be read in conjunction with Drg. Nos :
2854-HYD-BG-DWG-007, & 2854-HYD-BG-DWG-009
Protection designed to:-
BS 9990: 2015 EDITION - NON AUTOMATIC FIRE FIGHTING SYSTEMS IN BUILDINGS

NO.	DESCRIPTION	DWN	CHKD	DATE
P2	PRELIMINARY LAYOUT FOR REVIEW	OT	RT	14/09/26
P1	PRELIMINARY LAYOUT FOR REVIEW	OT	RT	14/09/26

MODIFICATIONS

PROJECT
FIRE HYDRANT SYSTEM UPGRADE

LOCATION
BOUNDS GREEN STATION

TITLE
BOUNDS GREEN
EASTBOUND PLATFORM 1
PROPOSED HYDRANT CABINETS

LBFoster Specialist Services
214 The Record Hall, 2nd Floor
16-16A Baldwin Gardens
London, EC1N 7RJ

DRAWN	CHECKED	DATE	SCALE	REVISION No.
O.T.	R.T.	14/09/26	1:50 @ A0	P.2

DRAWING No. 2854-HYD-BG-DWG-008