




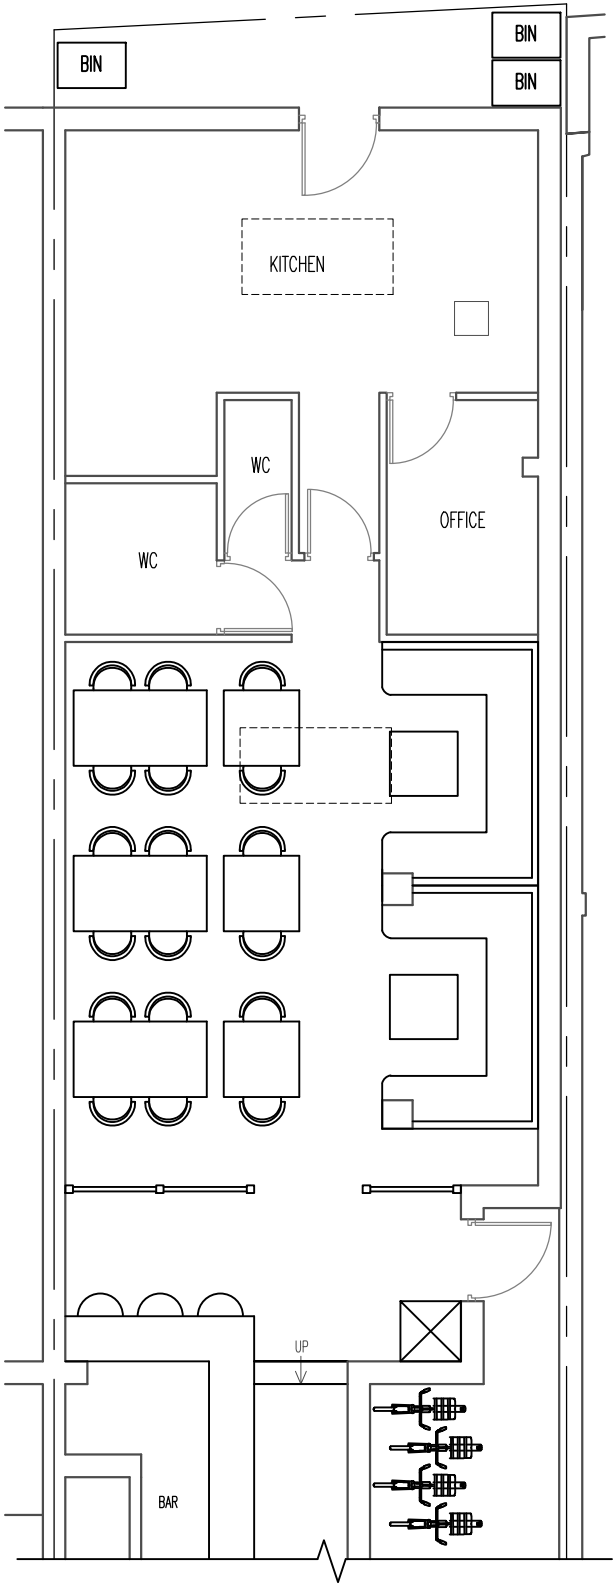

PART GROUND FLOOR PLAN

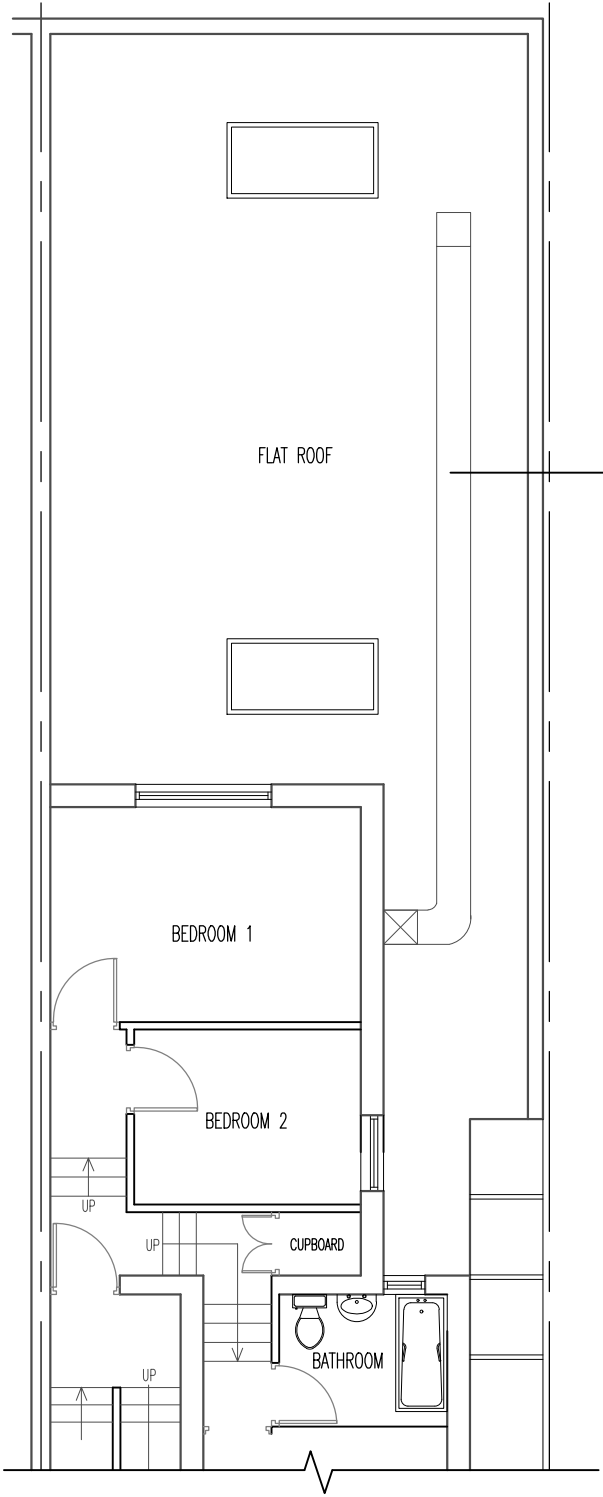

PART ROOF PLAN

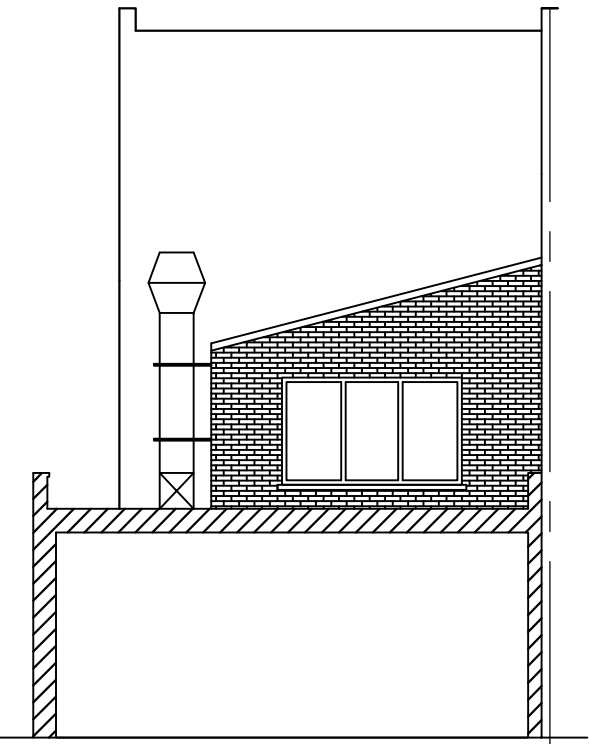

PROPOSED REAR ELEVATION/SECTION



PROPOSED SIDE ELEVATION

- KITCHEN EXTRACTION SYSTEM AND MAINTENANCE
- 450 DIAMETER KITCHEN EXTRACTION CANOPY FITTED WITH WASHABLE GREASE FILTERS (MESH/BAFFLE) SITED DIRECTLY OVER COOKING RANGE AND FILTERS TO BE CLEANED TWICE A WEEK.
 - EXTRACTION AIR RATE: FACE VELOCITY AT THE CANOPY OF 0.5 M/S AND A DISCHARGE VELOCITY AT THE DUCT TERMINUS OF 12M/S.
 - FILTERS TO BE CLEANED TWICE A WEEK AND CHANGED EVERY 6 MONTHS.
 - ISOLATOR: INSULATED FLEXIBLE CANVAS CONNECTORS TO BE FIXED BETWEEN THE FAN AND THE REST OF THE DUCTING FROM EACH SIDE OF THE FAN TO PREVENT TRANSMISSION OF VIBRATION.
 - 450ØMM EXTRACTION FLUE PIPES FITTED WITH ANTI-VIBRATION BRACKETS AND RUBBER MOUNTING. EXTERNAL DUCTING IS MECHANICALLY FIXED TO EXISTING STRUCTURE. (CAN BE PAINTED IF REQUIRED)
 - DUCTING SHOULD BE EQUIPPED WITH ACCESS PANELS FOR CLEANING AND ALL DUCTWORK MUST MEET TR/19.
 - ALL PENETRATIONS MADE GOOD AND APPROPRIATE FIRESTOP APPLIED.
 - THE FLUE PIPE PASSES THROUGH WALL/ ROOF FORMED COMBUSTIBLE MATERIALS TO BE ENCLOSED IN A SLEEVE OF NON-COMBUSTIBLE MATERIAL AND 25MM AIR SPACE BETWEEN FLUE AND SLEEVE.
 - MAINTENANCE CONTRACT INCLUDING SCHEDULED CLEANING TO BE PROVIDED BY INSTALLING CONTRACTOR.

ISSUED FOR PLANNING PERMISSION ONLY (SINGLE STOREY FRONT EXTENSION AND CONVERSION INTO RESTAURANT)



THE COPYRIGHT OF THIS DRAWING BELONGS TO THE ARCHITECT AND MAY NOT BE ALTERED WITHOUT THE ARCHITECT'S WRITTEN CONSENT

BUILDING REGULATION APPROVAL IS REQUIRED PRIOR TO CONSTRUCTION COMMENCING THE CONTRACTOR IS TO CHECK ALL DIMENSIONS ON SITE PRIOR TO CONSTRUCTION COMMENCING AND REPORT ANY DISCREPANCIES TO THE ARCHITECT

REV	DATE	DESCRIPTION

WWW.IBIDESIGN.COM

IBI DESIGN ASSOCIATES

CHARTERED ARCHITECTS AND DESIGNERS
59 CHELMSFORD ROAD, LONDON N14 5PY
T: 020 8447 8434
e-mail: ibides@aol.com

PROJECT 66 TURNPIKE LANE, LONDON N8 OPR
DRAWING TITLE KITCHEN EXTRACTOR SCHEMATIC DRAWINGS
SCALE 1:100 @ A3 PROJECT No. HR/66/PR/07C
DATE JUNE 2024